

# Seismic Retrofit for Electric Power Systems

**Natalia Romero<sup>a)</sup>, Linda K. Nozick<sup>a)</sup>, Ian Dobson<sup>b)</sup>, Ningxiong Xu<sup>a)</sup>,  
Dean A. Jones<sup>c)</sup>**

Keywords: Electric power, Earthquake, Extreme events, Optimization, Network flows

This paper develops a two-stage stochastic program and solution procedure to optimize the selection of seismic mitigation strategies to increase the resilience of electric power systems to earthquake hazards. The model explicitly considers the range of earthquake events that are possible and, for each, an approximation to the joint distribution of damage that is experienced. This is important because electric power systems are spatially distributed; hence their performance is driven by the joint distribution of damage of the components. We test this solution procedure against the nonlinear integer solver in LINGO 13 and apply the formulation and solution strategy to the Eastern Interconnection where the seismic hazard stems from the New Madrid Seismic Zone.

## INTRODUCTION

Earthquakes pose a significant risk to electric power systems as demonstrated by the following examples. On January 17, 1994 the Northridge earthquake struck the city of Los Angeles and surrounding areas. Two and a half million customers lost power (Dong et al. 2004). The Great Hanshin earthquake occurred a year later affecting the city of Kobe, Japan. Twenty fossil-fire power generation units, six 275 kV substations, and two 154 kV substations were damaged. Approximately, 2.6 million customers were affected by outages (Noda 2001). On May 18, 2008, the Wenchuan earthquake caused extensive damage to the local power transmission and distributions systems in the Sichuan province, China. Approximately 900 substations and 270 transmission lines of the State Power Grid were

---

<sup>a)</sup> *School of Civil and Environmental Engineering, Cornell University, Hollister Hall, Ithaca, NY 14850, USA*

<sup>b)</sup> *Department of Electrical and Computer Engineering, Iowa State University, Ames IA 50011, USA*

<sup>c)</sup> *Sandia National Laboratories, PO Box 5800, Albuquerque, NM 87185-1138, USA*

damaged. It has been estimated that at least 90% of the damage could have been avoided by adopting new guidelines for seismic design (Eidinger 2009). 90% of Chileans did not have electricity immediately following the February 27, 2010 8.8  $M_w$  earthquake. The event caused the largest power transmission company in Chile to have direct losses of approximately US \$ 6.5 billion (Long 2010). The devastating Tohoku Chiho – Taiheiyo-Oki earthquake on March 11, 2011 and its aftershocks damaged 14 power plants, 70 transformers, and 42 transmission towers, among other failures. Outage stemming from the event affected 4.6 million residences and the April 7 aftershock affected an additional 4 million (Shumuta 2011).

This paper formulates an optimization model to select hardening-based mitigation measures for earthquake events and proposes a solution procedure for that optimization. The method is applied to address seismic risk in the Central United States. This region has received less attention than zones in the west but it has been the source of strong earthquakes in the past. In the winter of 1811-1812, a 7.8  $M_w$  intraplate earthquake centered in the New Madrid Seismic Zone (NMSZ) struck the central United States inducing liquefaction and permanent ground motion (Tuttle et al. 2002). It is important to notice that historic records of large earthquakes in the NMSZ suggest that the time between large events is somewhere between 200 to 800 years with an average of about 500 years. Considering that the last recorded high magnitude earthquake was in 1811-1812, we might be close to an event based on the low estimate of the recurrence relationship (Tuttle et al. 2002). In addition, due to soil conditions, ground shaking in this area is expected to affect a greater area than would be expected in California for a similar magnitude earthquake (Gomberg and Schweig 2007). Another characteristic to consider about the NMSZ is that since earthquakes are not as frequent as those on other faults, like San Andreas, there may be an insufficient understanding of the earthquake risk in the area and, therefore, mitigation strategies in use may not be adequate.

We implement a knapsack based heuristic to solve the non-linear integer programming problem (NLIP) to optimize the selection of reinforcement strategies for electric power system components used in earthquake mitigation. To model the seismic risk, we use a suite of earthquake scenarios that nearly replicates the exceedance curves for peak ground acceleration (PGA) as measured at 81 control locations across the NMSZ. Since the electric power system is a spatially distributed system, we create a suite of consequence scenarios for

each earthquake scenario where each consequence scenario identifies the resulting damage state of each component. Once the damage state of a component is known, the expected time required for the component to be operational again and the cost of the repair can be estimated. The construction of these consequence scenarios provides an implicit representation of the joint distribution of damage for each earthquake scenario. The damage to the power grid considered is limited to transmission lines and substations. The operation of the power grid is modeled using an economic dispatch model and it is assumed that the operator of the network has a limited budget to invest in mitigating the risk. A simpler version of the NLIP is solved using Lingo 13. The results using Lingo and our proposed heuristic are compared for different mitigation budgets to gain a sense of the performance of the heuristic.

The next section develops the formulation. The third section presents the solution procedure. The fourth section describes the key elements of the case study. The fifth section describes the results of the application of the tools developed in sections two and three to the case study described in section four. It also includes a comparison of the performance of the solution procedure developed in the third section to LINGO 13, a commercial solver, for a simplified problem instance. The sixth section summarizes the key elements of the paper and next steps for future research.

## **FORMULATION**

We formulate this optimization problem as a two-stage stochastic program. A two-stage stochastic program is an optimization model formulation that incorporates uncertainty in the parameters of the model. The two-stage structure assumes that all decisions are made at one time instance prior to the resolution of all uncertainty. In this case, the uncertainty revolves around what damage will occur to each component in the electric power system. This uncertainty is expressed through the use of a number of consequence scenarios, where each consequence scenario gives the damage to each component. The decisions are made in what is termed the “first-stage” of the model. In our formulation, the first-stage is the identification of what components in the electric power system should be hardened. The consequences of those decisions, under each consequence scenario, occur in the “second-stage” of the model. In this problem formulation, the second-stage is the power flow across each component including what demands for power are not satisfied under each consequence scenario.

We first introduce the topology of the power network. Let  $\Pi$  be the set of transmission lines. Let  $S$  be the set of substations. Let  $G$  be the set of generators. Let  $B$  be the set of buses. Let  $I(i)$  be the set of the generators connected to bus  $i$ . We define the first-stage binary decision variables as follows. Let  $x_s^D = 1$  if substation  $s$  is reinforced and  $x_s^D = 0$  otherwise. The cost to reinforce substation  $s$  is  $b_s^D$ . Let  $y_{ij}^D = 1$  if transmission line  $(i, j)$  is reinforced and  $y_{ij}^D = 0$  otherwise. The cost to reinforce transmission line  $(i, j)$  is  $f_{ij}^D$ . We assume that the total available budget is  $M^D$ . Since the total investment to reinforce the components cannot exceed the available budget, then equation (1) must hold.

$$\sum_{s \in S} b_s^D x_s^D + \sum_{(i,j) \in \Pi} f_{ij}^D y_{ij}^D \leq M^D. \quad (1)$$

In this application, the seismic reinforcement of transmission lines is assumed to be a percentage of the total replacement cost of the line obtained from Balducci (Balducci et al. 2006). Seismic reinforcement of substations is defined as the anchorage of the transformers in the substations. Therefore the cost to reinforce a substation is estimated by multiplying the cost of anchoring a transformer (Shinozuka et al. 2003) by the number of transformers in the substation.

Based on the HAZUS seismic risk assessment methodology (FEMA 2003), five damage states are defined for electric power components: none, minor, moderate, extensive and complete. We choose to focus on the damage states none, moderate, extensive and complete because the damage associated with minor is not substantial in this context. Moderate damage generates a repair cost of 40% of substation cost and does not affect any of the transformers in the substation. Extensive damage is assumed to imply damages costing 70% of the value of the substation including impacting 50% of the transformers in the substation. Complete damage, causes the complete loss of the substation including all the transformers. The estimated time for repair is 3 days for the moderate damage and a week for extensive damage. For complete damage, repairs can vary depending on the ease with which the transformers can be replaced. High voltage and/or customized transformers can have very large lead-times. Thus, for modeling purposes, we assume that for low voltage transformers, the operator would have access to spares within a month. We assume that the average lead-time for medium and high voltage transformers is 6 months. Therefore, all the components in substations under complete damage are back to normal within a month with the exception of medium and high voltage transformers which is 6 months. For transmission lines we only

model two levels of damage: extensive and complete. Extensive damage for a transmission line corresponds to a damage ratio of 50% of the total cost of the line and complete damage results in costs totaling the full cost of the line. Transmission lines under extensive damage can be repaired within 3 days and under complete damage within a week. This implies that by the end of 6 months, in the worst case, the system is back to normal.

From a modeling perspective, this implies that we must divide the repair process into 4 time periods. The first period extends from the event to the end of the third day. By then, transmission lines that have experienced extensive damage have been restored. Also, substations under moderate damage have been repaired. The second time period extends from the beginning of day four to the end of the first week. By then, transmission lines that have experienced complete damage have been repaired, as well as substations under extensive damage. The third time period extends from the end of the first week to the end of the first month. By the end of this time period, low voltage transformers will have been replaced. The final time period extends from one month to six months. Six months after the event, medium and large voltage transformers will have been repaired. We define the following notation to encapsulate these time period definitions. Let  $t_0 = 0$ ,  $t_1 = 3$  days,  $t_2 = 1$  week,  $t_3 = 1$  month, and  $t_4 = 6$  months, Then  $t_k - t_{k-1}$  is the time length in days of period  $k$  for  $k = 1, 2, 3, 4$ .

We assume that there are  $N$  earthquake consequence scenarios, i.e.,  $n = 1, \dots, N$ . The associated annual probability of scenario  $n$  is  $Pr(n)$ . Let  $c^B$  be the per unit load shed cost. Let  $c_g^G$  be the unit power generation cost of generator  $g$ . Note that the first-stage reinforcement decisions and the earthquake scenario determine the level of damage in the component; hence, the length of time from the earthquake that the component is unavailable and the repair cost is known. Let  $\Psi_s^n(x_s^D)$  be the repair cost for substation  $s$  under the first-stage decision  $x_s^D$  for the earthquake scenario  $n$ . Let  $\Omega_{ij}^n(y_{ij}^D)$  be the repair cost of damaged transmission line  $(i, j)$  under the first-stage decision  $y_{ij}^D$  and given earthquake scenario  $n$ . Let  $\Delta_s^{nk}(x_s^D) = 1$  if substation  $s$  is not functional in period  $k$  under earthquake scenario  $n$  for the given first-stage decision  $x_s^D$  and  $\Delta_s^{nk}(x_s^D) = 0$  otherwise. Similarly, let  $\Lambda_{ij}^{nk}(y_{ij}^D) = 1$  if transmission line  $(i, j)$  is not functional in period  $k$  under scenario  $n$  for the given first-stage decision  $y_{ij}^D$  and  $\Lambda_{ij}^{nk}(y_{ij}^D) = 0$  otherwise. Note that in this application, functions  $\Psi_s^n(x_s^D)$

and  $\Delta_s^{nk}(x_s^D)$  are nonlinear functions in  $x_s^D$  and functions  $\Omega_{ij}^n(y_{ij}^D)$  and  $\Lambda_{ij}^{nk}(y_{ij}^D)$  are nonlinear functions in  $y_{ij}^D$ .

Now we define the second-stage decision variables. Let  $\theta_i^{nk}$  be the phase angle in bus  $i$  and in period  $k$  under scenario  $n$ . Let  $P_{ij}^{nk}$  be the real power flow in transmission line  $(i, j)$  in period  $k$  under scenario  $n$ . Since the electric flows can go in both directions, then  $P_{ij}^{nk}$  can be either positive or negative. Let  $G_g^{nk}$  be the nonnegative generation output from generator  $g$  in period  $k$  under scenario  $n$ . Let  $U_i^{nk}$  be the nonnegative load shed in bus  $i$  in period  $k$  under scenario  $n$ .

Let  $m_{ij}$  be the reactance in transmission line  $(i, j)$  and let  $T_{ij}$  be an indicator with value 1 when the operator has a spare transformer for transmission line  $(i, j)$  and 0 otherwise.

$$(\theta_i^{n1} - \theta_j^{n1}) (1 - \Lambda_{ij}^{n1}(y_{ij}^D)) (1 - \Delta_{s_i}^{n1}(x_s^D)) (1 - \Delta_{s_j}^{n1}(x_s^D)) = m_{ij} P_{ij}^{n1}, \quad \forall (i, j), n \quad (2)$$

$$(\theta_i^{n2} - \theta_j^{n2}) (1 - \Lambda_{ij}^{n2}(y_{ij}^D)) (1 - \Delta_{s_i}^{n2}(x_s^D)) (1 - \Delta_{s_j}^{n2}(x_s^D)) = m_{ij} P_{ij}^{n2}, \quad \forall (i, j), n \quad (3)$$

$$(\theta_i^{n3} - \theta_j^{n3}) (1 - \Delta_{s_i}^{n3}(x_s^D)) (1 - \Delta_{s_j}^{n3}(x_s^D)) = m_{ij} P_{ij}^{n3}, \quad \forall (i, j), n \quad (4)$$

$$(\theta_i^{n4} - \theta_j^{n4}) (1 - \Delta_{s_i}^{n4}(x_s^D)) (1 - T_{ij}) = m_{ij} P_{ij}^{n4}, \quad \forall (i, j), n \quad (5)$$

Constraints (2), (3), (4), and (5) approximate the active power flows on the transmission lines in the four periods of the repair process. If the per day demand at bus  $i$  is  $D_i$ , then constraints (6) states flow conservation at each bus under each earthquake scenario.

$$\sum_{g \in I(i)} G_g^{nk} - \sum_{(i,j) \in \delta^+(i)} P_{ij}^{nk} + \sum_{(j,i) \in \delta^-(i)} P_{ji}^{nk} = D_i - U_i^{nk}, \quad \forall i, k, n, \quad (6)$$

where  $\delta^+(i)$  is the set of the transmission lines such that  $(i, j) \in \Pi$  and  $\delta^-(i)$  is the set of transmission lines such that  $(j, i) \in \Pi$ . Since the load shed at a bus cannot exceed the demand at the bus.

$$0 \leq U_i^{nk} \leq D_i, \quad \forall i, k, n. \quad (7)$$

We assume that generator  $g$  has capacity  $G_g^m$  and transmission line  $(i, j)$  has capacity  $P_{ij}^m$ . Equations (8)-(12) reflect the capacity constraints in each generator and each transmission line in each time period under each earthquake scenario.

$$0 \leq G_g^{nk} \leq G_g^m, \quad \forall g, k, n \quad (8)$$

$$|P_{ij}^{n1}| \leq P_{ij}^m \left(1 - \Lambda_{ij}^{n1}(y_{ij}^D)\right) \left(1 - \Delta_{s_i}^{n1}(x_{s_i}^D)\right) \left(1 - \Delta_{s_j}^{n1}(x_{s_j}^D)\right), \quad \forall (i, j), n \quad (9)$$

$$|P_{ij}^{n2}| \leq P_{ij}^m \left(1 - \Lambda_{ij}^{n2}(y_{ij}^D)\right) \left(1 - \Delta_{s_i}^{n2}(x_{s_i}^D)\right) \left(1 - \Delta_{s_j}^{n2}(x_{s_j}^D)\right), \quad \forall (i, j), n \quad (10)$$

$$|P_{ij}^{n3}| \leq P_{ij}^m \left(1 - \Delta_{s_i}^{n3}(x_{s_i}^D)\right) \left(1 - \Delta_{s_j}^{n3}(x_{s_j}^D)\right), \quad \forall (i, j), n \quad (11)$$

$$|P_{ij}^{n4}| \leq P_{ij}^m \left(1 - \Delta_{s_i}^{n4}(x_{s_i}^D)(1 - T_{ij})\right), \quad \forall (i, j), n \quad (12)$$

where  $s_i$  is the substation, to which bus  $i$  belongs. The objective function of the two-stage stochastic program is to minimize the expected generation, load shed and repair costs in the four recovery periods as given in Equation (13).

$$\sum_{n=1}^N Pr(n) \sum_{k=1,2,3,4} (t_k - t_{k-1}) \left( \sum_{i \in B} c^B U_i^{nk} + \sum_{g \in G} c_g^G G_g^{nk} \right) + \sum_{s \in S} \Psi_s(x_s^D) + \sum_{(i,j) \in \Pi} \Omega_{ij}(y_{ij}^D) \quad (13)$$

where  $\Psi_s(x_s^D) = \sum_{n=1}^N Pr(n) \Psi_s^n(x_s^D)$  and  $\Omega_{ij}(y_{ij}^D) = \sum_{n=1}^N Pr(n) \Omega_{ij}^n(y_{ij}^D)$ .

Note that the two-stage stochastic program (1) – (13) is a nonlinear mixed integer stochastic program. To better understand the structure of the two-stage nonlinear mixed integer stochastic program, we rewrite the program as follows. Let  $x^D = (x_s^D : s \in S)$  and  $y^D = (y_{ij}^D : (i, j) \in \Pi)$ . For the given first-stage decision variables  $(x^D, y^D)$ , the second-stage optimization problem is to choose  $(G_g^{nk}, P_{ij}^{nk}, U_i^{nk})$  to minimize

$$\sum_{n=1}^N Pr(n) \sum_{k=1,2,3,4} \left( \sum_{i \in B} c^B U_i^{nk} + \sum_{g \in G} c_g^G G_g^{nk} \right) (t_k - t_{k-1}) \quad (14)$$

subject to constraints (2) – (12). Note that the second-stage optimization problem is a linear program and the program can be solved by scenario when the first stage decisions are known. Let  $\Phi(x^D, y^D)$  be the objective function value associated with Equation (14) subject to constraints (2)-(12) for the given first stage variables  $(x^D, y^D)$ . Then the first-stage of the two-stage nonlinear mixed integer stochastic program is to choose the binary variables  $(x^D, y^D)$  to minimize

$$\Phi(x^D, y^D) + \sum_{s \in S} \Psi_s(x_s^D) + \sum_{(i,j) \in \Pi} \Omega_{ij}(y_{ij}^D) \quad (15)$$

subject to (1). Notice that this is a knapsack problem. This motivates our solution procedure described in the next section.

### SOLUTION PROCEDURE

As mentioned previously, the first-stage problem is a knapsack problem with a nonlinear objective function. The key idea of our heuristic is to construct a knapsack problem with a linear objective function so that the solution of the knapsack problem is also a good solution to the first-stage problem. The heuristic consists of four steps. The first step is to run the dc economic dispatch model assuming all components are available. The second step is to run the dc economic dispatch assuming that a single component  $\in \text{set}(R)$  (set of all components that can be reinforced) is not functional. The third step is done for each component that can be reinforced. This step involves computing the relative benefit for reinforcing each component. The fourth step identifies the subset of reinforcement strategies that maximizes the benefit (as approximated using the weights developed in step 2) subject to the budget constraint given in equation (1). To simplify the notations, let us consider the following parametric dc load flow dispatch problem where we determine  $(\theta_i, G_g, P_{ij}, U_i)$  that minimizes

$$\sum_{i \in B} c^B U_i + \sum_{g \in G} c_g^G G_g \quad (16)$$

subject to

$$(\theta_i - \theta_j)(1 - \tau_{ij})(1 - \zeta_{s_i})(1 - \zeta_{s_j}) = m_{ij} P_{ij} \quad \forall (i, j) \quad (17)$$

$$\sum_{g \in I(i)} G_g - \sum_{(i, j) \in \delta^+(i)} P_{ij} + \sum_{(j, i) \in \delta^-(i)} P_{ji} = D_i - U_i \quad \forall i, \quad (18)$$

$$|P_{ij}| \leq P_{ij}^m (1 - \tau_{ij}) \quad \forall (i, j), \quad (19)$$

$$0 \leq U_i \leq D_i \quad \forall i, \quad (20)$$

$$0 \leq G_g \leq G_g^m \quad \forall g \quad (21)$$

where  $\tau_{ij}$  and  $\zeta_{s_i}$  are input parameters for all  $(i, j)$ . The solution procedure can be presented as follows.

**Step 1:** Run the dc flow economic dispatch problem (16) – (21) with  $\tau_{ij} = \zeta_{s_i} = \zeta_{s_j} = 0$  for all  $(i, j)$  to determine  $(\theta_i, G_g, P_{ij}, U_i)$ . Note that the load shed at each bus  $U_i = 0$  since we assume that all components in the network are functional. Let  $\bar{\lambda}$  be the optimal objective value.

**Step 2:** Let the set( $R$ ) be comprised of the collection of components  $r$  for which there is at least one consequence scenario under which the component is not operational but with mitigation it becomes operational, for at least one time period. Run the dc flow economic dispatch problem (16) – (21) for each component  $r \in \text{set}(R)$  assuming that component  $r$  is not functional. To do this, the parameters in the program are set as follows. If  $r = (i, j)$ , we let  $\tau_{ij} = 1$  for  $(i, j) = r$  and let  $\tau_{ij} = 0$  for  $(i, j) \neq r$ . We also let  $\zeta_{s_i} = \zeta_{s_j} = 0$  for all  $(i, j)$ . If  $r = s_i$ , we let  $\zeta_{s_i} = 1$  for  $s_i = r$  and let  $\zeta_{s_i} = 0$  for  $s_i \neq r$ . We also let  $\tau_{ij} = 0$  for  $(i, j)$ . We determine the solution  $(\theta_i, G_g, P_{ij}, U_i)$  and let  $\lambda^r$  be the optimal objective value.

**Step 3:** Estimate the benefit of reinforcement for all components for which it is a consideration. Let  $r \in \text{set}(R)$  be the members of that set.

If  $r = (i, j)$ , let

$$\beta_{ij}^D = \sum_{n=1}^N Pr(n) \sum_{k=1,2} (\lambda^{ij} - \bar{\lambda}) \left( \Lambda_{ij}^{nk}(0) - \Lambda_{ij}^{nk}(1) \right) (t_k - t_{k-1}) + \Omega_{ij}(0) - \Omega_{ij}(1).$$

If  $r = s$ , let

$$\beta_s^D = \sum_{n=1}^N Pr(n) \left( \sum_{k=1,2,3} (\lambda^s - \bar{\lambda}) \left( \Delta_s^{nk}(0) - \Delta_s^{nk}(1) \right) (t_k - t_{k-1}) \right) + \sum_{n=1}^N Pr(n) \left( (\lambda^s - \bar{\lambda}) \bar{S}(s) \left( \Delta_s^{n4}(0) - \Delta_s^{n4}(1) \right) (t_4 - t_3) \right) + \Psi_s(0) - \Psi_s(1) \quad (22)$$

It is important to notice that in the fourth time period some large transformers may not be operational in some substations. The substation may still be used, but its performance has not been fully restored. To reflect this we define  $\bar{S}(s)$  be the serviceability of a substation. The definition of this quantity is the fraction of lines and transformers that are functional within the substation to the total number of lines and transformers (both functional and non-functional) within the substation. Notice that the values  $\lambda^{ij}$  and  $\lambda^s$  are the result of step 2. Also,  $\Lambda_{ij}^{nk}(0)$  ( $\Delta_s^{nk}(0)$ ) are binary input data that reflect whether a line (substation) is operational during period  $k$  under scenario  $n$  if no mitigation is performed. Similarly,  $\Lambda_{ij}^{nk}(1)$  ( $\Delta_s^{nk}(1)$ ) are binary input data that reflect whether a line (substation) is operational during period  $k$  under scenario  $n$  if mitigation is performed. Finally,  $\Omega_{ij}(0) - \Omega_{ij}(1)$  reflects the repair costs savings if mitigation is performed on a line. Similarly,  $\Psi_s(0) - \Psi_s(1)$  is the same quantity, except it is associated with substation repair cost savings.

**Step 4:** Determine the reinforcement strategy for the network. Run the integer problem to determine the reinforcement strategy  $(x, y)$  that maximize

$$\sum_{s \in S} \beta_s^D x_s^D + \sum_{(i,j) \in \Pi} \beta_{ij}^D y_{ij}^D \quad (23)$$

subject to

$$\sum_{s \in S} b_s^D x_s^D + \sum_{(i,j) \in \Pi} f_{ij}^D y_{ij}^D \leq M^D \quad (24)$$

$$x_s^D = 0, y_{ij}^D = 0 \text{ for } s \notin \text{set}(R), (i, j) \notin \text{set}(R) \quad (25)$$

## CASE STUDY

To illustrate the model and solution procedure described above, we focus on questions of seismic mitigation of the U. S. Eastern Interconnection power grid (EI) under limited budget. The representation of the EI was developed in 1998 by the Multi-Area Modeling Working Group. It is a representation of the system as of 1998 with demands reflective of a prediction of the summer of 2003. This case includes direct representation of every region in the EI. Detailed representation is only provided for voltages greater than 100 kV. It includes information for 23,416 transmission lines and 14,957 buses. These buses are grouped in 2,765 substations with two or more buses and 6,448 single buses. Load shed, generation output, repair, and mitigation costs were estimated in 2002 U.S. dollars.

We only consider the seismic risk from the NMSZ. In order to model the hazard, the first step is to develop a suite of earthquake scenarios (location and magnitude) that replicate important measures of the seismic hazard. For electric power systems, the key measure is the exceedance curves for PGA where seismically sensitive components are located. We located 81 control points in the NMSZ area and obtained the PGA exceedance curves for each point from the U.S. Geological Survey (USGS) Seismic Hazard Maps (USGS 2008b).

The hazard is modeled by a set of earthquake scenarios selected using the mathematical optimization method developed by Vaziri et al. (*in press*). The method also assigns an adjusted occurrence probability to each scenario minimizing the discrepancy with the seismic behavior as represented in the exceedance curves for PGA. A key input to that optimization is the identification of the candidate set of earthquake events. We used two sources to create the candidate set: the earthquake catalog from the USGS website (USGS 2008) and a synthetic data set created by the USGS. This earthquake catalog includes 433 earthquakes that occurred within the NMSZ. The magnitudes were converted from  $m_{blg}$  to  $M_w$  using

Atkinson and Boore (1995) and Johnston (1996) equally weighted as given in Petersen et al (2008). The mean PGA for each control point was estimated using Toro et al (1997), Frankel et al (1996), Campbell (2003), Atkinson and Boore (2006), Tavakoli and Pezeshk (2005), and Silva et al (2002) assuming soil type BC (Firm Rock), the relative weights given in Petersen et al (2008). In addition to the 433 earthquakes identified in the Central-East United States earthquake scenarios catalog, we use 20 synthetic events on 5 synthetic faults created by USGS to represent the hazard in New Madrid. The 20 scenarios correspond to each of the 4 possible magnitudes (7.3, 7.5, 7.7 and 8) for ruptures in the 5 different branches described in Petersen et al (2008). USGS (2008c) provides computer code that can be compiled and run to generate each of these deterministic scenarios in New Madrid.


Table 1 presents the 8 earthquake scenarios selected (from the 433 earthquake events in the historic catalogue and the 20 synthetic events developed by USGS) with their adjusted occurrence probability. Figure 1 illustrates the exceedance curve from USGS and the implied exceedance curve obtained from the selected scenarios (and their probabilities of occurrence) based on the formulation given in Vaziri et al. (in press) for a single control point located near the border between Tennessee and Arkansas at the Mississippi River near Osceola, Arkansas. Notice that there is very little difference in the implied exceedance curves based on the 8 scenarios versus the exceedance information provided by USGS.

**Table 1.** Selected earthquake events and their probabilities of occurrence.

Location		Fault Info.	Depth [km]	Magnitude		Date	Source	Adjusted occurrence probability
Lat.	Long.			m <sub>blg</sub>	M <sub>w</sub>			
36.7	-90.3	Mid-East West	0.0	4.3		2/2/1954	NCEER	0.0500
38.2	-89.8		11.0	4.3		4/9/1955	NCEER	0.0500
37.9	-88.4		21.0	5.5		11/9/1968	NCEER	0.0078
38.7	-88.0		10.0	5.2		6/10/1987	USHIS 5.20mn	0.0069
36.8	-89.2		5.0	4.5		9/29/1987	USHIS 4.50mn	0.0500
35.8	-90.2		9.0	4.2		5/1/2005	PDE 4.20mw	0.0500
					7.7		USGS faults	0.0018
					8.0		USGS faults	0.0010


Figure 2 gives a histogram of the difference between the PGA for each of the return periods based on the USGS data at each location and the probability based on the earthquakes selected for that same value of PGA. It useful to notice that the errors are quite small and the

distribution of errors is symmetric indicating that the approximation of the exceedance curves is not biased.

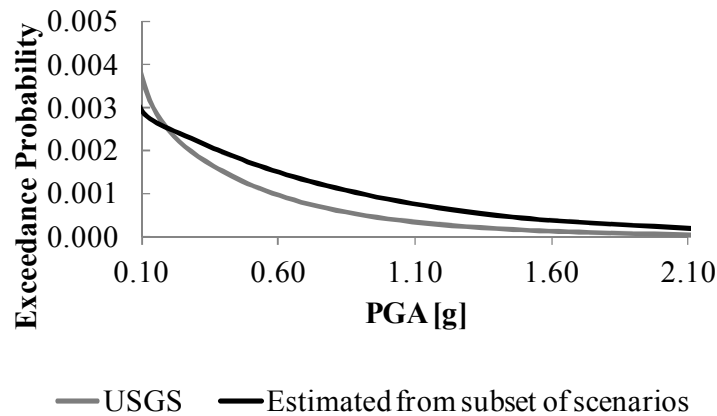

**Figure 1.** Exceedance curves for location P84, control point located at the border between Tennessee and Arkansas at the Mississippi River near Osceola, Arkansas.

Under each scenario the probability that each component sustains specific levels of damage is then computed using a regional loss estimation methodology, in this case HAZUS (FEMA 2003). HAZUS categorizes damage to substations and transmission lines into five classes: no damage, slight, moderate, extensive and complete. As mentioned before, we only modeled moderate, extensive and complete damage for substations and extensive and complete for transmission lines.

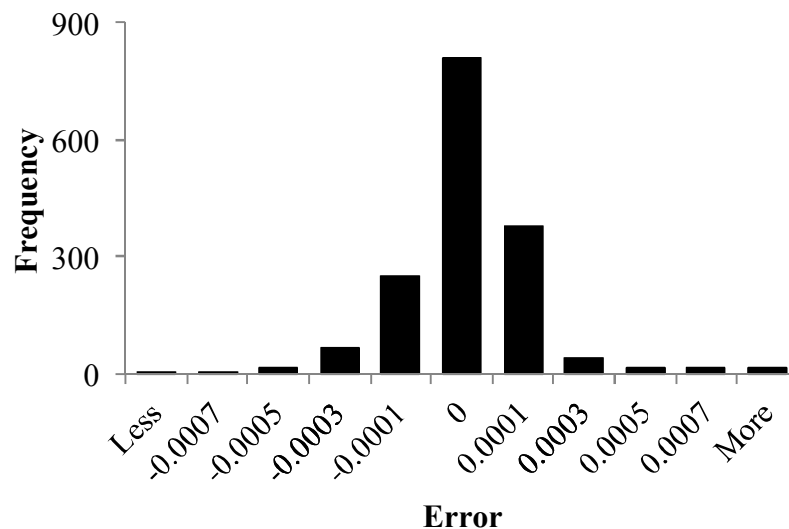

**Figure 2.** Histogram of PGA optimization error for every combination of location and return period.


Since the performance of lifelines is governed by the joint distribution of damage over all components, each earthquake scenario must be translated into a set of consequence scenarios and their hazard-adjusted occurrence probabilities. In each consequence scenario, the level of damage of each component is specified. More generally, we develop these consequence scenarios specifying the condition for each component with and without seismic mitigation.

**Table 2.** Consequence scenarios use to represent the NMSZ hazard on the EI.

Source	ID	Adjusted occurrence probability	Basic design					Seismically reinforced components				
			Transmission Lines damage		Substations damage			Transmission Lines damage		Substations damage		
			Ext.	Com.	Mod.	Ext.	Com.	Ext.	Com.	Mod.	Ext.	Com.
West branch, 8.0 M <sub>w</sub>	1	0.000160	5	24	18	8	15	2	24	15	3	7
	2	0.000200	5	25	23	19	8	6	20	13	15	7
	3	0.000080	15	24	68	24	10	25	5	66	26	9
	4	0.000180	4	25	13	14	10	5	20	7	12	7
	5	0.000240	6	24	12	16	9	4	22	8	20	6
	6	0.000140	6	22	26	22	12	4	21	26	12	6
Mid-East branch, 7.7 M <sub>w</sub>	7	0.000126	27	11	35	16	14	21	9	29	13	14
	8	0.000396	28	14	4	13	11	16	6	3	13	9
	9	0.000288	30	13	17	12	12	19	8	9	8	11
	10	0.000342	28	13	6	7	19	24	8	9	10	11
	11	0.000432	24	14	5	13	13	18	8	3	19	6
	12	0.000216	28	26	25	10	13	15	9	13	16	5


Mod.=Moderate, Ext.=Extensive, Com.=Complete

We use the optimization method introduced by Brown et al. (2011) to develop consequence scenarios and their hazard-consistent probability of occurrence. Each consequence scenario has a realized damage state for each component of the infrastructure and an associated probability. For a given component, the damage state and probability from each scenario can be used to determine the implied vulnerability. The objective of the optimization is to select the consequence scenarios and associated probabilities so the implied vulnerabilities of each component match the “true” (input) vulnerability as closely as possible. For the purposes of this research, the Brown et al. (2011) optimization model is expanded to include the performance of the components prior to reinforcement and after reinforcement.

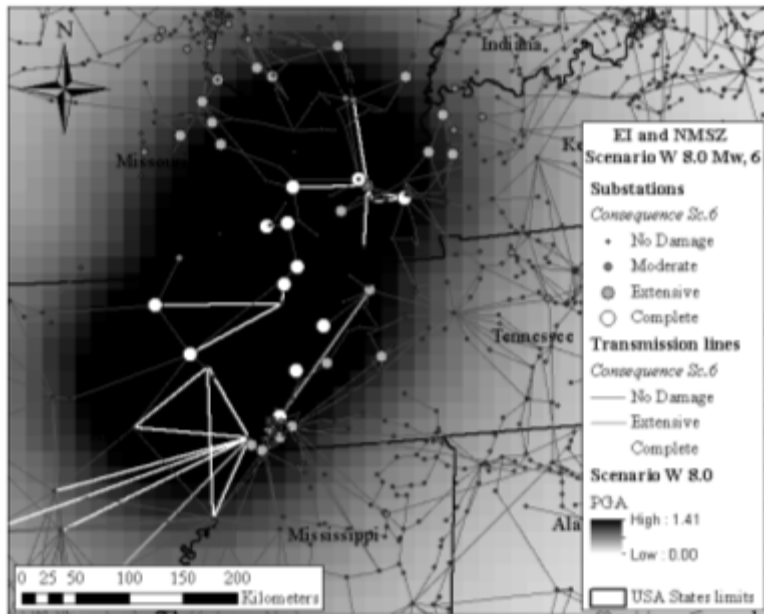

**Figure 3.** Distribution of PGA and damage for an 8.0  $M_w$  earthquake on the West Branch under consequence scenario 6.

The six events with  $m_{blg}$  less than 6 (See Table 1) result in effectively no physical damage to the electric power grid based on the fragility curves given in HAZUS and the probability distribution for PGA for each event at each location. The earthquake scenario on the Mid-East fault of magnitude 7.7  $M_w$ , and the earthquake scenario on the West fault of magnitude 8.0  $M_w$  do result in considerable damage. For each of these events, we generate 6 consequence scenarios. Table 2 presents the 12 consequence scenarios and the number of transmission lines and substations that fall into each of the possible damage states. Figure 3 shows the spatial distribution of PGA for the earthquake scenario in the West branch with a magnitude of 8.0  $M_w$  and the consequence scenario 6 (See ID column in Table 2). It is useful to notice that there is substantial damage across the New Madrid area including in Memphis, TN, Evansville, IN and St. Louis, IL. Figure 4 gives the estimated load shed for that same event. Again, the impacts across the region are very significant.

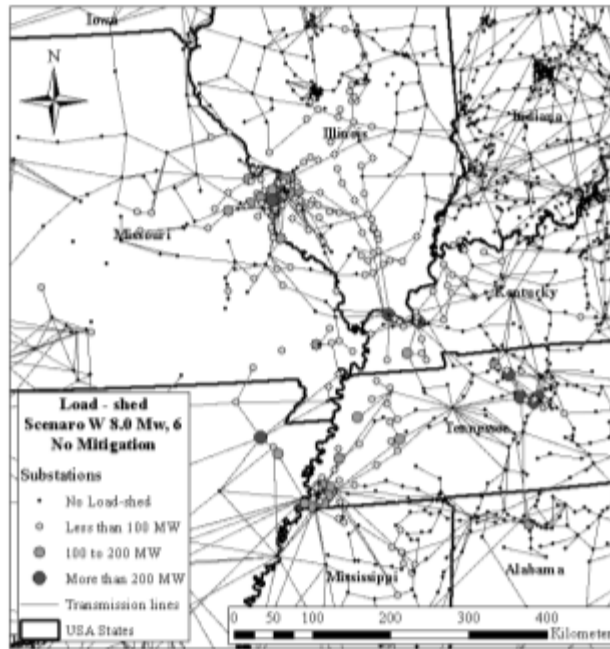

**Figure 4.** Estimated load shed for an 8.0  $M_w$  earthquake on the West Branch under consequence scenario 6.


## RESULTS

The heuristic was tested using a simplified version of the model which considers only the first time period and two of the twelve earthquake scenarios. We solved the nonlinear integer programming problem (NLIP) for 3 different mitigation budgets: US\$100 million, US\$20 million, and US\$10 million using two methods: the proposed heuristic coded in C++ with IBM ILOG Optimization Studio CPLEX 12.2 serving as an LP solver, and the full NLIP in Lingo 13 (which has a non-linear integer solver) in a Dell Precision T5500, Intel® Xeon® X5650 with 2 processors of 2.66 GHz., and 6.00 GB of total RAM memory. Lingo found a 0.5% better solution for a mitigation budget of US\$100 million; for the other two problem instances the heuristic method found solutions that were 20% better in quality. Lingo took over 8 hours to solve and the heuristic took 8 minutes. Given the computational burden, Lingo cannot be used to address the full problem formulation for the EI.


We used the heuristic to find the optimal seismic risk mitigation strategy for the full problem formulation for the EI using the 12 consequence scenarios identified to represent the NMSZ hazard. EI performance was modeled using the 4 time periods as defined by the repair times for the various components described above. We assume about 50 lines and 110

substations are viable candidates for reinforcement. The total running time varies depending on the budget; the average computation time is 1 hour using the machine described above.


Figure 5 shows the exceedance probability of load shed costs during repair time for 5 different investment scenarios: no-mitigation, US\$ 5 million, US\$ 10 million, US\$ 20 million, and US\$ 50 million, respectively. For a budget of US\$ 5 million, the model suggests no seismic reinforcement for lines, and that about 63% of substations should be anchored. For a budget of US\$ 10 million, 6% of transmission lines and 87% of substations are selected for reinforcement. For US\$ 20 million, about 12% of transmission lines and 98% of substation are reinforced. Finally, for US\$ 50 million, 36% of transmission lines and 100% of substations should be reinforced. Figure 6 shows the repair costs exceedance probability. Investing US\$ 10 million can reduce the load shed costs by almost 40% of the load shed costs without mitigation, and the repair costs in almost 20%. In expectation, this reduction translates to a saving of about US\$ 12 million annually stemming from an upfront investment of US\$ 10 million. Figure 7 gives the load shed based on the recommended mitigation when the budget is US\$ 10 million. It is useful to notice that, in contrast to Figure 4, there is substantially less load shed, particularly in and around the St Louis Area.

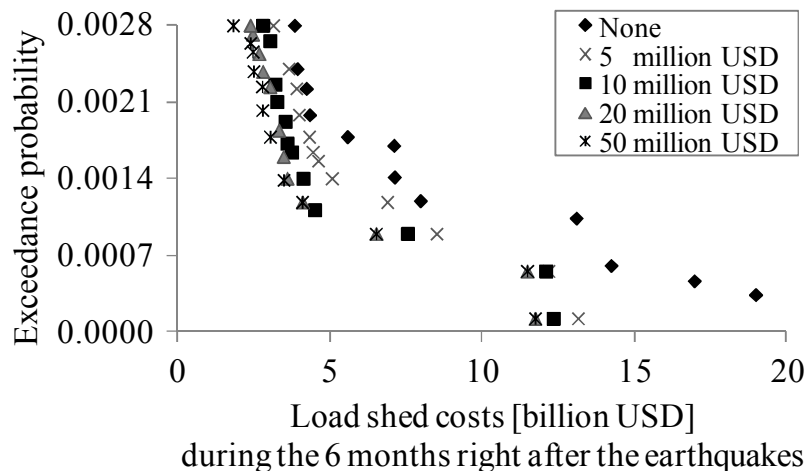

**Figure 5.** Exceedance probability for load –shed costs during repair.

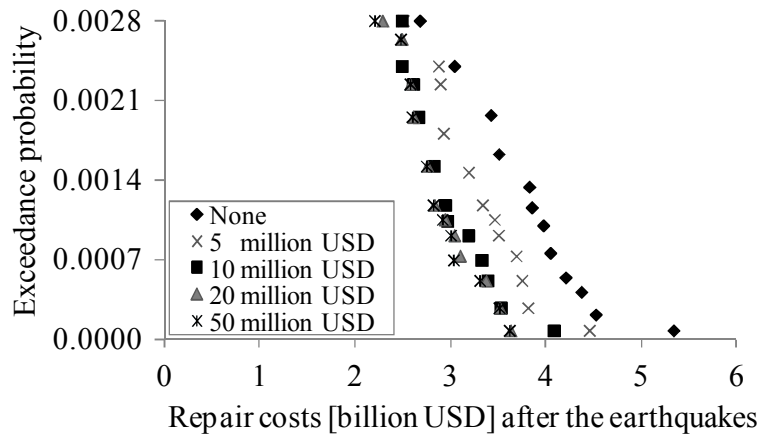

**Figure 6.** Repair costs exceedance probability.

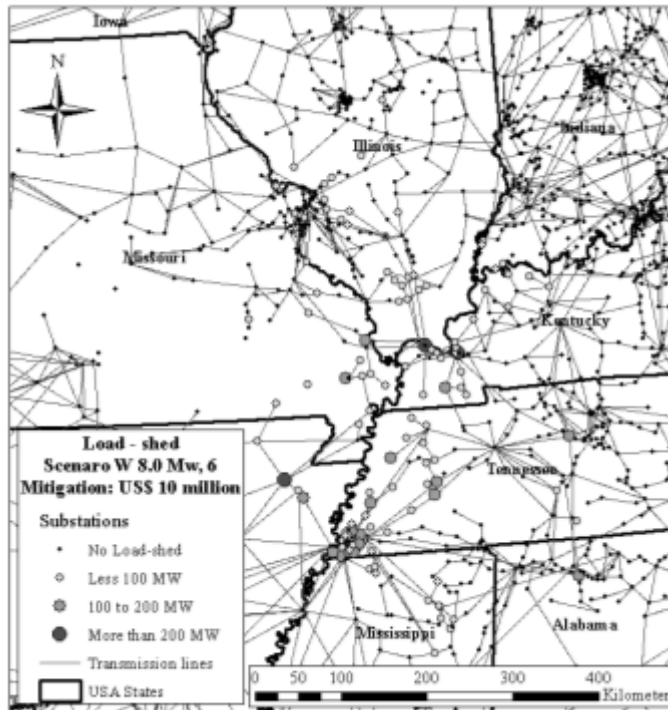

**Figure 7.** Load shed with seismic reinforcement the seismic reinforcement recommended under a budget constraint of US \$10 million under consequence scenario 6.

## CONCLUSIONS

This paper has developed a method, using two-stage stochastic programming, to identify an approximately optimal seismic mitigation strategy for electric power system components that can be used to address large scale problem instances. It makes use of methods already

developed to create a range of seismic events (location and magnitude) and their hazard-consistent probabilities to characterize the hazard. For each of these events, consequence scenarios and their probability of occurrence are developed to understand the joint distribution of damage under that event and the level of degradation in system performance. These two steps provide a robust mechanism to understand the impacts of earthquakes on the system and how that impact might be modified through specific investments. The remainder of the paper developed an optimization method to understand how to optimize the selection of mitigation strategies under a budget constraint.

More specifically, a two-stage stochastic program was developed. The first stage identifies the mitigation strategies to perform, whereas the second stage is effectively an economic dispatch model of the electric power system to compute the repair costs and the load shed under each consequence scenario, based on the investments made. In the case study developed in this paper, the regional loss estimation methodology, HAZUS, was used to compute the probability that each component fell into each of a set of mutually exclusive and exhaustive damage states for each consequence scenario. The method was applied to the EI where the seismic hazard considered stems from the NMSZ.

There are a range of opportunities for further research. First, the key mitigation strategy considered in this paper is the anchoring of components. There is also the opportunity to add capacity to the existing network to increase earthquake resilience. How to add this additional capacity then becomes the subject of an optimization. One of the key benefits of addressing seismic hazard via capacity augmentation is that the added capacity is valuable under a range of circumstances beyond addressing the consequences of earthquakes including periods of peak demand (heat waves, etc.), hurricanes and ice storms. Moreover, under normal operation, the added capacity can enable cheaper, cleaner or more sustainable generation or increased reliability. Second, the assessment of the impacts of each of the consequence scenarios based on the mitigation performed did not include the potential for further cascading beyond the initial damage. While the cascading usually involves outages that do not damage components, it can lead to a more widespread load shed and blackout that can delay the recovery from the earthquake. Modeling cascades in electric power systems stemming from earthquakes is complicated, and approximate methods are beginning to be developed (Kim and Dobson 2010). Cascades occur when the system is fragile and in a damaged state. Considering the potential for cascades when developing mitigation strategies

for electric power systems is important. Finally, the electric power system is critical to the operation of many other infrastructures. Conversely, the electric power system is dependent on other infrastructures. Understanding the impact of earthquakes on interdependent infrastructures (including electric power networks) is very important. In the context of mitigation, this avenue for additional research becomes even more compelling.

## ACKNOWLEDGEMENTS

Ian Dobson gratefully acknowledges funding in part from DOE grant DE-SC0002283.

## REFERENCES

- Atkinson, G. M., and Boore, D. M., 1995. Ground-Motion relations for eastern North America. *Bulletin of the Seismological Society of America* **85**, 17 - 30.
- Atkinson, G. M., and Boore, D. M., 2006. Earthquake ground motion prediction equations for eastern North America, *Bulletin of the Seismological Society of America* **96**, 2181 - 2205.
- Balducci, P. J., Schienbein, L. A., Nguyen, T.B., Brown, D. R. and Fathelrahman, E. M. 2006. An examination of the costs and critical characteristics of electric utility distribution system capacity enhancement projects in *Proc. Transmission and Distribution Conference and Exhibition*, pp. 78 – 86.
- Billington, R, Kumar, S., Chowdhury, N., Chu, K., and Debnath, K. 1989. A reliability test system for educational purposes – basic data. *IEEE Transactions on Power Systems* **4**, 1238 - 1244.
- Brown, N. J. K., Gearhart, J. L., Jones, D. A., Nozick, L. K., Xu, N., and Romero, N., 2011. Optimizing the selection of scenarios for loss estimation in transportation networks in *Proceedings of the 2011 WSC: Simulation for a Sustainable World*. Phoenix, Arizona.
- Campbell, K. W., 2003. Prediction of strong ground motion using the hybrid empirical method and its use in the development of ground-motion (attenuation) relations in eastern North America. *Bulletin of the Seismological Society of America* **93**, 1012 - 1033.
- Dong, X., Shinozuka, M., and Change, S., 2004. Power network systems in *Proceedings of the 13th World Conference on Earthquake Engineering*, Vancouver, Canada.
- Eidinger, J., 2009. Wenchuan Earthquake Impact to Power Systems in *Proceedings of the 2008 TCLEE: Lifeline Earthquake Engineering in a Multihazard Environment*, Oakland, California.
- Federal Emergency Management Agency, Department of Homeland Security, 2003. *HAZUS-MH Multi-hazard loss estimation methodology, earthquake model – Technical Manual*. Washington, D.C.
- Frankel, A., Mueller, C., Bamhard, T., Perkins, D., Leyendecker, E., Dickman, N., Hanson, S., and Hopper, M., 1996. National Seismic Hazard Maps: Documentation U. S. Geological Survey, *Report 96-532*.
- Gomberg, J., and Schweig, E., 2007. Understanding Earthquake Hazards in the Central United States, Earthquake Hazard in the Heart of the Homeland, U. S. Geological Survey, *Fact Sheet 2006-3125*.
- Johnston, A. C., 1996. Seismic moment assessment of earthquakes in stable continental regions-I. Instrumental seismicity. *Geophysical Journal International* **124**, 381 - 414.
- Kim, J. and Dobson, I., 2010. Approximating a loading-dependent cascading failure model with a branching process, *IEEE Transactions on Reliability* **59**, 691 – 699.
- Long, G., 2010 Reconectando a Chile después del terremoto, *Revista Business Chile*. < <http://businesschile.cl/es/noticia/terremoto/reconectando-chile-despues-del-terremoto> >

- Noda, M., 2001. Disaster and restoration of electricity supply system by Hanshin-Awaji Earthquake in *Proceeding of the Seminar on Earthquake Disaster Management of Energy Supply System. Chinese Taipei: Earthquake Response Cooperation Program for Energy Supply Systems*.
- Obermeier, S. F., Gohn, G. S., Weems, R. E., Gelinas, G. L., and Meyer, R., 1985. Geologic evidence for recurrent moderate to large earthquakes near Charleston, South Carolina, *Science* **227**, 408 - 411.
- Petersen, M. D., Frankel, A. D., Harmsen, S. C., Mueller, C. S., Haller, K. M., Wheeler, R. L., Wesson, R. L., Zeng, Y., Boyd, O. S., Perkins, D. M., Luco, N., Field, E. H., Wills, C. J., and Rukstales, K. S. 2008. Documentation for the 2008 update of the United States national seismic hazard maps. U. S. Geological Survey, *Report 2008-1128*.
- Shinozuka, M., Feng, M., Dong, X., Chang, S., Cheng, T., Jin, X. and Saadeghvaziri, M. A., 2003. Advances in seismic performance evaluation of power systems, *Resilience of Electric Power Substation Equipment*, MCEER, Buffalo, New York.
- Shumuta, Y., 2011. *Tohoku Chiho-Taiheiyo-Oki Earthquake - Damage of electric power facilities in Tohoku Electric Power Co., Inc.* Central Research Institute of Electric Power Industry, Civil Engineering Lab.
- Silva, W., Gregor, N., and Darragh, R., 2002. Development of regional hard rock attenuation relations for central and eastern North America, *Pacific Engineering*, El Cerrito, CA.
- Tavakoli, B., and Pezeshk, S., 2005. Empirical-stochastic ground-motion prediction for eastern North America. *Bulletin of the Seismological Society of America* **95**, 2283 - 2296.
- Toro, G. R., Abrahamson, N. A., and Schneider, J. F., 1997. A model of strong ground motions from earthquakes in central and eastern North America: Best estimates and uncertainties. *Seismological Society of America* **68**, 41 - 57.
- Tuttle, M. P., Schweig, E. S., Sims, J. D., Lafferty, R. H., Wolf, L.W., and Hayes, M. L., 2002. The earthquake potential of the New Madrid seismic zone, *Bulletin of the Seismological Society of America* **92**, 2080 - 2089.
- U.S. Department of Energy, 2009. *Electric Power Annual*, Energy Information Administration, Washington, D.C.
- U. S. Geological Survey, 2008a. CEUS Catalog #3: emb.cc, *National Seismic Hazard Maps Catalogs*, <<http://earthquake.usgs.gov/hazards/products/conterminous/2008/catalogs/>>.
- U. S. Geological Survey. 2008b. *National Seismic Hazard Maps Gridded Data, Peak Ground Acceleration Hazard Curve*. <<http://earthquake.usgs.gov/hazards/products/conterminous/2008/data/>>
- U. S. Geological Survey, 2008c. *National Seismic Hazard Maps Software*. <<http://earthquake.usgs.gov/hazards/products/conterminous/2008/software>>
- Vaziri, P., Davidson, R., and Nozick, L.. Identification of hazard-consistent probabilistic earthquake scenarios for regional loss estimation. *Journal of Earthquake Engineering*, In press.