

Storing Carbon Dioxide in Saline Formations: Analyzing Extracted Water Treatment and Use for Power Plant Cooling

Peter H. Kobos, Sandia National Laboratories, (505) 845-7086, phkobos@sandia.gov

Jesse D. Roach, Sandia National Laboratories

Geoffrey T. Klise, Sandia National Laboratories

Jim L. Krumhansl, Sandia National Laboratories

Thomas A. Dewers, Sandia National Laboratories

Jason E. Heath, Sandia National Laboratories

Brian Dwyer, Sandia National Laboratories

David J. Borns, Sandia National Laboratories

Andrea McNemar, National Energy Technology Laboratory

Abstract

In an effort to address the potential to scale up of carbon dioxide (CO₂) capture and sequestration in the United States' saline formations, an assessment model is being developed using a national database and modeling tool. This tool builds upon the existing NatCarb database as well as supplemental geological information to address scale up potential for carbon dioxide storage within these formations. The focus of the assessment model is to specifically address the question, "Where are opportunities to couple CO₂ storage and extracted water use for existing and expanding power plants, and what are the economic impacts of these systems relative to traditional power systems?" Initial findings indicate that approximately less than 20% of all the existing complete saline formation well data points meet the working criteria for combined CO₂ storage and extracted water treatment systems.

1. Introduction

The Water Energy and Carbon Sequestration (WECS) model was developed to integrate the full data set of U.S. power plants, geological saline formations, carbon capture and sequestration scenarios, and saline formation water extraction and treatment technologies. The model, developed in Powersim Studio, also included a statistical binning of the saline formations based on their geochemical, depth, salinity and other important parameter profiles. These efforts build from several years' worth of research in an ongoing project in its first three phases. Phase I of the project developed a framework and model to assess a specific source of CO₂ (San Juan generating station in northwest New Mexico) to a specific sink for the CO₂ (the Morrison formation also in northwest New Mexico). In Phase II, the project expanded to include other regions of the U.S. For example, there is substantial variability associated with different saline formations, power plant configurations, and regional constraints such as the level of existing infrastructure that will affect the overall systems' costs.

In the beginning stages of Phase III presented here, a large down-selecting set of criteria, methodology and data assessment was developed. A well selector tool allows the analysis to assess saline formations according to criteria for storing specific volumes of CO₂. The national-level WECS model, (WECS II) currently evaluates implications of carbon capture and compression at any coal or natural gas-based power plant in the U.S. (sources of CO₂) and sequestration of that CO₂ in any of 325 deep saline formations in the U.S (sinks for CO₂). The estimated parameters include the distance from source to sink, costs associated with carbon capture, compression, transportation, and sequestration, the length of time the formation may last for a given CO₂ sequestration rate, how much water may be extracted to make room for the CO₂, and what the high-level costs of water treatment may be to reuse the extracted water to offset additional water demands at the power plant associated with carbon capture and compression. With this full analysis, multiple scenarios can be developed with custom site and sink combinations. In the coming years, the model will be used to evaluate carbon capture and sequestration with extracted water treatment at all currently operational coal and natural gas fired power plants in the U.S. Additionally, other sources of CO₂ can be included as desired based on custom options (e.g., hypothetical power plants using new technologies). This paper describes the current state of the WECS model's development for this multi-year effort.

2. Model Architecture and Scope

The model's development has been based on a bottom-up approach both from the traditional definition of energy-economic-engineering modeling, the 'integrated assessment' model methodology, and from a pragmatic approach (e.g., begin with a single test case) then refining the analysis framework and extending it to multiple power generating stations and potential CO₂ sink locations.¹ The initial stages of the model's development it analyzed a single power plant relative to a single saline formation (CO₂ sink). The current model (WECS II) is able to compare any combination of a single power plant (amongst the U.S. coal and natural gas power plants) with any single saline formation in the U.S. Future work may address the capability to simultaneously compare all CO₂ sources to all saline formation CO₂ sinks through time under hypothetical carbon emission abatement scenarios.

The WECS II model is divided into 5 interrelated modules: (1) a power plant module, (2) a carbon capture module, (3) a carbon (CO₂) sequestration (geologic formations) module, (4) a water extraction module, and (5) an integrating power cost module. The relationships between the modules, and the key information passed between them is shown in Figure 1.

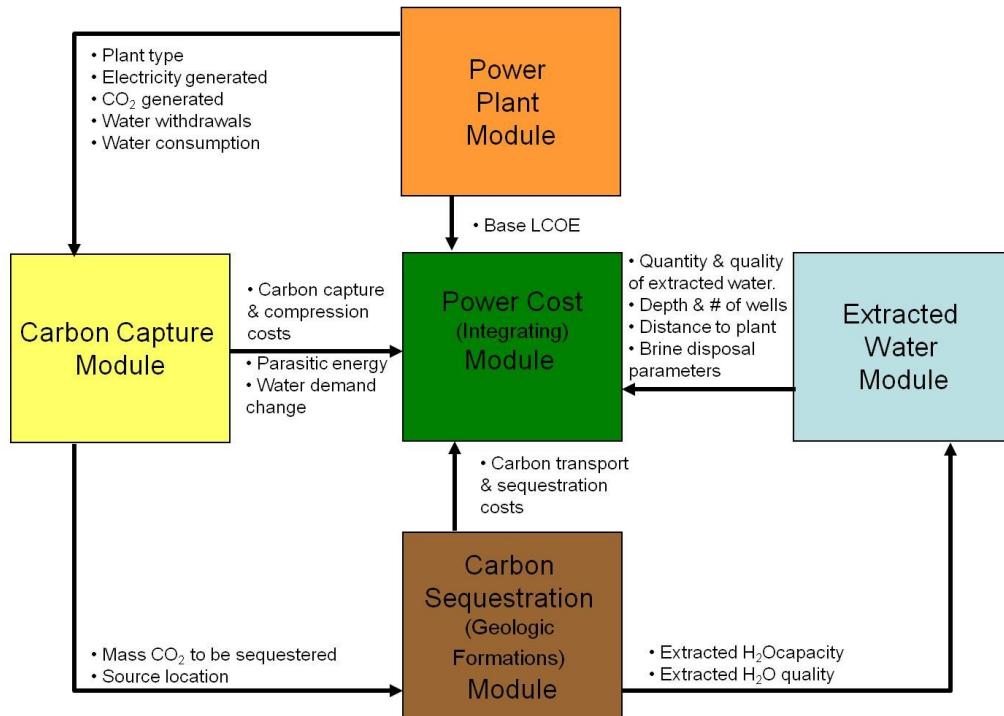


Figure 1. Modular structure of the WECS II model.

2.1. Power Plant Module Inputs

The power plant module allows users to select a specific (or generic) power plant from the existing U.S. fleet. These types of power plants represent either subcritical or supercritical pulverized coal (PC), integrated gasification combined cycle (IGCC), natural gas combined cycle (NGCC), or a natural gas turbine system (Figure 2). The plant's location, overall generating capacity and capacity factors can be changed to address custom options at a specific location. In WECS II, the overall plant lifetime has an impact on the financial calculations in terms of how quickly any investment in carbon capture and sequestration infrastructure must be recovered. In future potential iterations of the model, the plant lifetime will become important for time based simulations of carbon capture and sequestration by multiple plants to multiple sinks.

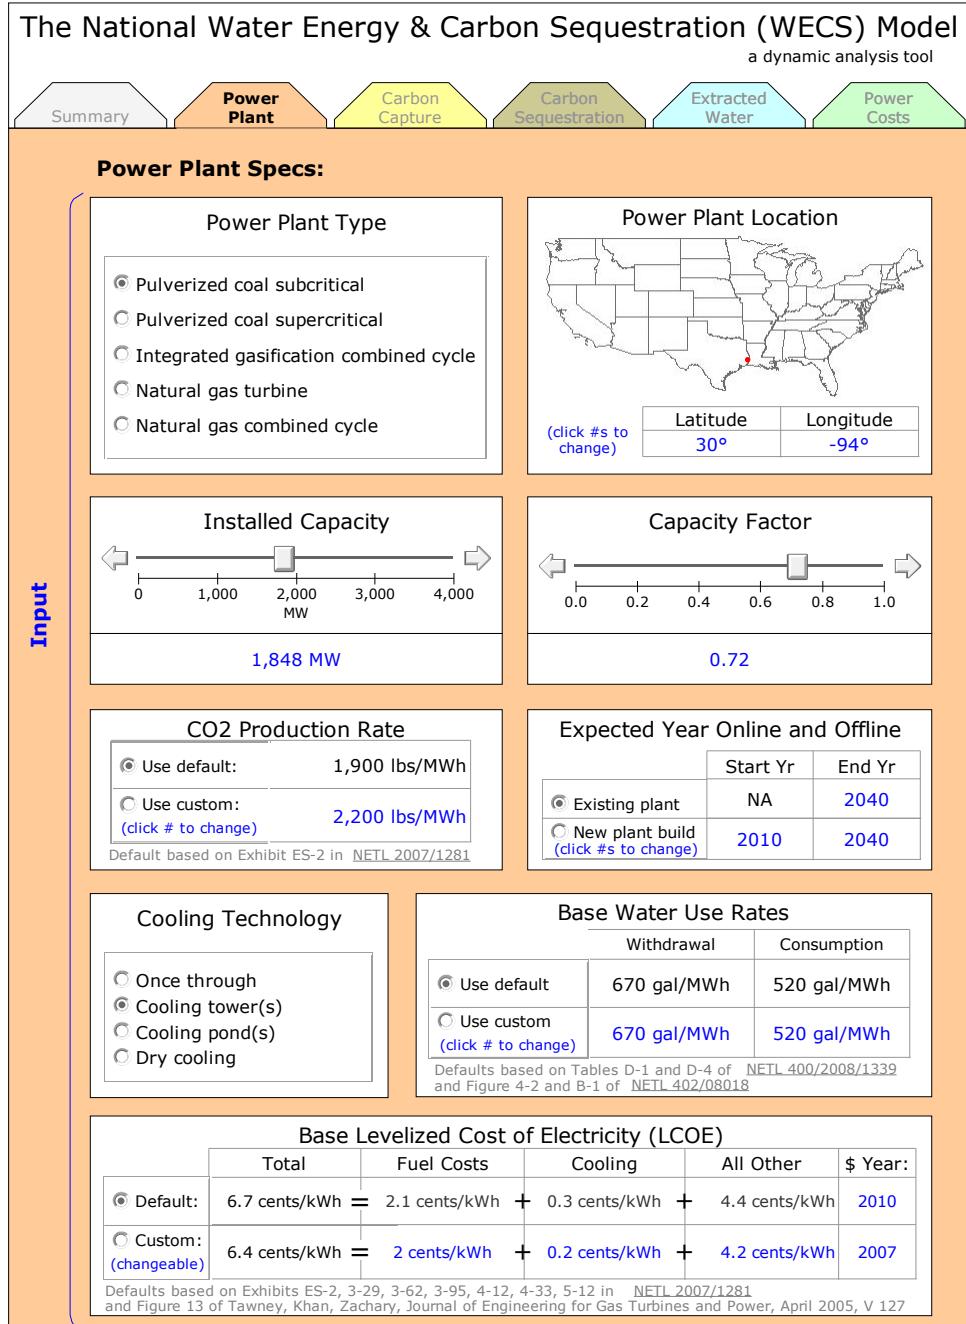


Figure 2. User interface inputs to WECS II power plant module.
Values in blue and radio buttons or slider bars can be changed by the user.

The selected cooling technology and power plant type determine a default water withdrawal and consumption rate as seen in Figure 2. Additionally, the analysis allows users to build from the base case leveled costs of electricity (LCOE) for the plant broken down into fuel costs, cooling, and other costs. This also includes specifying the reference year to display the default costs (and all other costs in the model) in as well as the reference year associated with the custom cost input values.ⁱⁱ

The defaults for the power plant module are based on analysis of data contained in several NETL (2007a, 2008, 2009) and Tawney et al. (2005) reports characterizing aspects of power plant operations and can be changed to custom values to allow for site-specific scenario analysis.

The default CO₂ production rates for each technology type of power plant used by the model are shown in Table 2.

Power Plant Type	Default CO ₂ Production Rate (lb/MWh)
Pulverized Coal: Subcritical	1900
Pulverized Coal: Supercritical	1800
Integrated Gas Combined Cycle (IGCC)	1700
Natural Gas Turbine	1000
Natural Gas Combined Cycle	800

Table 2. Default CO₂ production rates utilized by the WECS II power plant module.ⁱⁱⁱ

Cooling Technology

The cooling technology is also specified in the power plant module with a default use of cooling towers and the option to choose once through, cooling ponds, or dry cooling instead. For each of these configurations, baseline water withdrawal and consumption rates and LCOE are needed. As with CO₂ production rate, the model is set up so that the defaults can be overridden by the user if they have specific information or want to evaluate the impact of different values. Table 3 illustrates the base case values used in the model.

Model Default Base Plant Water Use					
Withdrawal	Plant Type	Base H ₂ O withdrawal [gal/MWh]			
		Once Through	Tower	Cooling Pond	Dry
	PC Sub	27113	531	17927	76
	PC Super	22611	669	15057	67
	IGCC	11002	226	7284	57
Consumption	Plant Type	Base H ₂ O consumption [gal/MWh]			
		Once Through	Tower	Cooling Pond	Dry
	PC Sub	138	462	804	68
	PC Super	124	518	64	59
	IGCC	32	173	220	53
Data	NGCC				
	9010				
Dry cooling values for PC and IGCC taken from non cooling term in Figures 4-2 and B-1 of NETL 402/080108 (2009). IGCC once-through and cooling pond values (in blue) are interpolated based on surrounding values. All other values are from Tables D-1 and D-4 in NETL-400/2008/1339 (2008).					

Table 3.. Model default water withdrawal and consumption rates for different power plant and cooling technologies.^{iv}

To estimate default water withdrawal and consumption rates for each of the other 16 potential plant configurations, information was adapted from the NETL (2008) report. The assumptions within NETL (2009) were used to estimate dry cooling requirements for PC and IGCC plant types by taking the water requirements for processes besides cooling. The dry-fed IGCC plant types were assumed for the IGCC plants. Water usage by an IGCC plant with once through or cooling pond systems was not available in either report, and were estimated by interpolation between the PC supercritical and NGCC values for once through and cooling pond cooling as compared to the relationship of all three technologies for tower cooling. The relatively small sample size (five data points) that were used to initially derive it (NETL, 2008) suggest it may not be widely representative. Therefore, it is recommended that where more specific information is available, it should be incorporated by using the custom input capability of the WECS II model.

Levelized Cost of Energy

The leveled cost of electricity (LCOE) estimates for new PC, IGCC, and NGCC plants with tower cooling are adapted from Exhibit ES-2 of NREL (2007a). The IGCC value is an average of three IGCC systems considered in the NREL (2007a) report.^v Additional costs associated with the cooling system were estimated by assuming 10% of fixed costs (labor) and 100% of water costs (variable operating cost) are associated with the cooling system. Finally, the total capital, fixed, and variable costs associated with the cooling system were leveled into the portion of LCOE attributable to the cooling system. The percent of LCOE estimated to be a result of the cooling system is shown in Column B of Table 4.

Column ID	(A)	(B)	(C)	(D)	(E)	(F)
Method	NETL (2007a)		A*B	C*0.64	C*2.7	A-C
Plant Type	LCOE (¢/kWh)	Plant Cost From Cooling System (%)	Cost of tower cooling (¢/kWh)	Cost of once-through cooling (¢/kWh)	Cost of dry cooling (¢/kWh)	Cost w/o cooling (¢/kWh)
PC Sub-Cooling Tower	6.4	3.7	0.24	0.15	0.64	6.16
PC Super-Cooling Tower	6.3	3.7	0.23	0.15	0.62	6.07
IGCC-Cooling Tower	7.8	2.8	0.22	0.14	0.59	7.58
NGCC-Cooling Tower	6.8	1.5	0.10	0.06	0.27	6.70

Table 4. Cost of Power Plant Cooling Default Values used in the WECS Model.

Columns A and B are based on data in NREL (2007a) report 2007/1281 Exhibits ES-2, 3-29, 3-62, 3-95, 4-12, 4-33, and 5-12. Factors 0.64 and 2.7 represent relative costs of once-through and dry cooling systems respectively compared to tower cooling as reported in Tawney et al. (2005). The calculations in columns C-F use the Tawney et al. (2005) relative cooling cost factors.^{vi}

Finally, the LCOE exclusive of cooling costs is estimated by subtracting the estimated cost of tower cooling in Column C of Table 4 from the total LCOE in Column A of Table 4. Results are shown in Column F of Table 4.

Gas turbine systems are assumed to have a LCOE of 10 cents per kilowatt-hour (¢/kWh) and no cooling system. These assumptions, along with the information in Table 4 were sufficient to estimate a default LCOE for each plant configuration considered by the model as summarized in Table 5.

LCOE (cents/kWh)				
Plant Type	One Through	Tower	Cooling Pond	Dry
Pulverized Coal, Subcritical	6.3	6.4	6.3	6.8
Pulverized Coal, Supercritical	6.2	6.3	6.2	6.7
Integrated Gasification Combined Cycle (IGCC)	7.7	7.8	7.7	8.2
Gas Turbine	10	10	10	10
Natural Gas Combined Cycle (NGCC)	6.8	6.8	6.8	7.0

Table 5. Default Levelized Cost of Electricity (LCOE) values used by the model (2007 \$US).

The default water use and LCOE values described here are intended to represent initial starting values that can be changed by the model user. The model employs these assumptions and user inputs to calculate the total annual electricity generation, CO₂ production, water withdrawal demand, and water consumption, and energy production costs at the plant level as seen in Figure 3. Additionally, the user interface to the model allows one to compare the electricity generation, capacity, capacity factor, and emission rates to all other power plants using coal or gas in operation in the U.S. in 2005 as reported in eGRID2007 (2007).

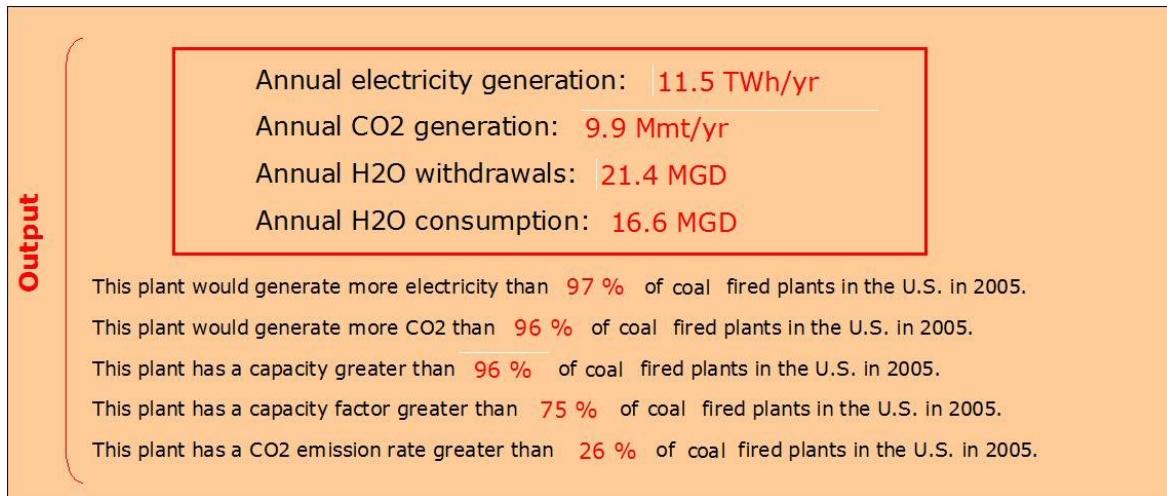


Figure 3. User interface outputs from WECS II power plant module including electricity generation in Terawatt hours per year (TWh/yr), CO₂ generation in millions of metric tonnes per year (Mmt/yr), and water withdrawals and consumption in millions of gallons per day (MGD), and how plant properties compare to the suite of power plants operating in 2005.

Figure 4 shows the user interface for changes in inputs to the carbon capture module of the WECS II model. Once the percentage of CO₂ to be captured has been chosen, the model selects an associated parasitic energy requirement from a set of curves relating % CO₂ capture to parasitic energy requirements by power plant type as seen in Figure 4. A default relationship is specified by the dashed line in the graph, with the default passing through the red crosses for pulverized coal plants, and of the same relative shape but passing through the purple or orange cross for NGCC and IGCC plants respectively (Figure 4, Table 6). The blue solid line can be adjusted by clicking on it once to see the points that describe it corresponding to 0%, 30%, 50%, 70%, 90% and 100% CO₂ capture. These points can then be moved up and down until the desired relationship is shown. With these inputs, the model has the custom parasitic energy requirements selected for carbon capture and compression as a percentage of the energy production for the power plant specified.

The WECS II model requires that make-up power be produced to offset parasitic losses associated with carbon capture and compression at the original power plant. The make-up power is assumed to come from a new power plant (with customizable options) located close to the original power plant. It should be noted that for new power plants, the notion of makeup power is not applicable. In these cases the cost, CO₂ generation rates, and water requirements of the make-up power plant can be set to zero and all power plant characteristics for the new power plant with sequestration capabilities would be defined in the power plant module.


In addition to water demand associated with makeup power, CO₂ capture and compression also results in additional water demand at the original power plant. This 'process' water is largely a result of additional cooling demands due to compression of the captured CO₂, and is specified in Table 7.

The National Water Energy & Carbon Sequestration (WECS) Model

a dynamic analysis tool



Carbon capture and compression (CCC) amount and energy needs:

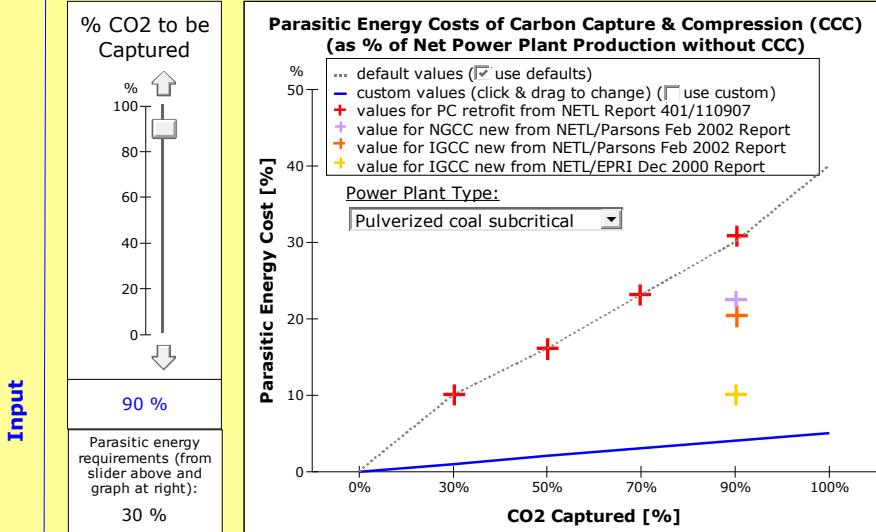

Make-up power characteristics:

Model treats make-up power as if it is generated on site, and thus any carbon captured in makeup power production is added to the amount captured at the original plant for sequestration.

Make-up Power Source Coal: Supercritical	Make-up Power CO ₂ Capture % 0 %	Make-up Power Cooling Type Cooling tower(s)
Make-up Power LCOE Default: 6.6 cents/kWh (2010 dollars) Custom: 6.4 cents/kWh (2010 dollars) Default based on NETL 2007/1281 and Tawney, Khan, Zachary 2005	Make-up Power CO ₂ Generation Default: 1,800 lbs/MWh Custom: 2,200 lbs/MWh Default based on Exhibit ES-2 in NETL 2007/1281	Make-up Power H ₂ O Withdrawal Default: 530 gal/MWh Custom: 530 gal/MWh Defaults based on NETL 400/2008/1339 and NETL 402/080108

Additional H₂O needs due to CO₂ capture & compression (CCC)

Added H₂O Withdrawals Rate per Mass CO₂ Captured at Original Plant Due to CO₂ Capture & Compression Processes (due mostly to cooling needs of compression)

Use default:	298 gal/tonne CO ₂ captured
Use custom: (click # to change)	300 gal/tonne CO ₂ captured

Default based on interpretations of NETL 402/080108 and 2007/1281

Figure 1. User interface inputs to WECS II carbon capture module.
Values in blue and radio buttons or slider bars can be changed by the user.

Plant Type	% Carbon Captured and Compressed				
	30%	50%	70%	90%	100%
PC Sub	10%	16%	23%	30%	40%
PC Super	10%	16%	23%	30%	40%
IGCC	6%	11%	15%	20%	27%
Gas Turbine	8%	14%	19%	25%	34%
NGCC	7%	12%	17%	22%	29%

Table 6. Default parasitic energy penalties associated with percentage of CO₂ capture as a function of power plant type. NETL (2007b) and NETL/CTC (2002).

The power required for carbon capture and compression systems at power plants also requires additional water at the original power plant due mostly to cooling requirements associated with compression of the CO₂ to a supercritical state. This marginal water demand per mass CO₂ captured was calculated based on carbon emissions and water use for carbon capture values reported by NETL (2007a) and Appendix B in NETL (2009), respectively. These calculations and the resulting default values for marginal water use at the original power plant due to CO₂ capture and compression are shown in Table 7. The indicated values assume the use of cooling towers. Scenarios utilizing other cooling technologies require custom input from the model user.

Column ID	A	B	C
Column Name	CO ₂ Emissions	Marginal H ₂ O withdrawal for 90% CO ₂ capture	Marginal H ₂ O withdrawal per tonne CO ₂ captured
Unit	[lb CO ₂ /MMBTU]	[gal/MMBTU]	[gal/tonne CO ₂]
Method	NETL (2007a) 2007/1281	NETL (2009) report 402/080108	2204.6*B/(0.9A)
Plant Type	PC Sub 203	24.7	298
	PC Super 203	24.4	294
	IGCC 200	9.55	117
	Gas Turbine 140	22.1	387
	NGCC 119	22.1	455

Table 7. Default marginal water withdrawal values per mass of CO₂ captured by power plant type.

Once all user inputs have been selected, the carbon capture module calculates the marginal water demand, and the total amount of CO₂ captured and compressed at the original and makeup power plants. Figure 5 illustrates the salient output from a subcritical pulverized coal power plant.

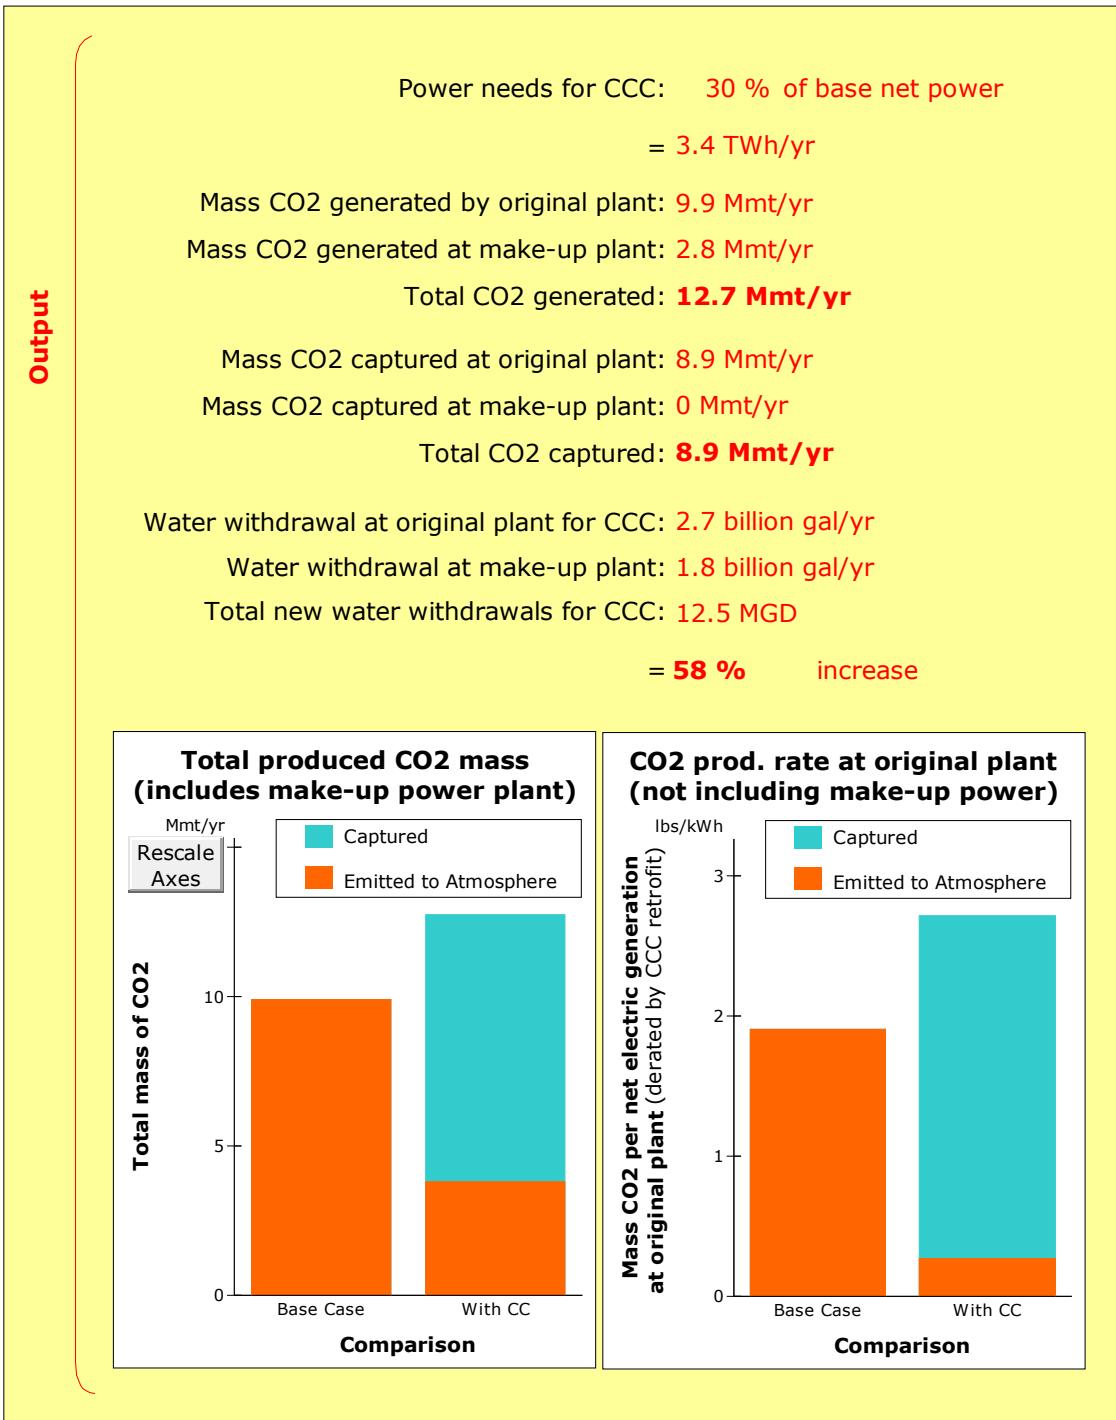


Figure 5. User interface outputs from WECS II carbon capture module include parasitic energy requirements, CO₂ generation and water use values associated with both the original subcritical pulverized coal plant (approximately 1800 MW) and makeup power plants. The bar chart on the left shows that the total amount of CO₂ generation increases with CO₂ capture, but the amount released to the atmosphere decreases. The bar chart on the right shows that the amount of CO₂ generated per net energy produced at the source plant increases due to the decrease in net energy production resulting from the parasitic energy requirements of carbon capture.

2.2. Carbon Sequestration Module

The carbon sequestration module utilizes geologic information to calculate sequestration costs from the selected power plant to any of 325 geologic formations listed in the NatCarb database (NatCarb, 2008).^{vii} The carbon sequestration module estimates the cost of piping and injecting CO₂ from the specified source into a given formation. The module calculates the costs associated with transportation and sequestration of the CO₂ specified by the carbon capture module from the source specified by the power plant module, to any given formation considered for sequestration. When a user selects a specific formation the default values will be specified based on the chosen formation. The partnership, basin, and formation name for each of the 325 formations are from the National Carbon Atlas (NatCarb 2008) database. Figure 6 illustrates the down selection process used to identify wells that meet the saline formation CO₂ storage and water extraction criteria (e.g., 2,500 feet below the surface, TDS between 10,000 and 20,000 mg/l, etc.).

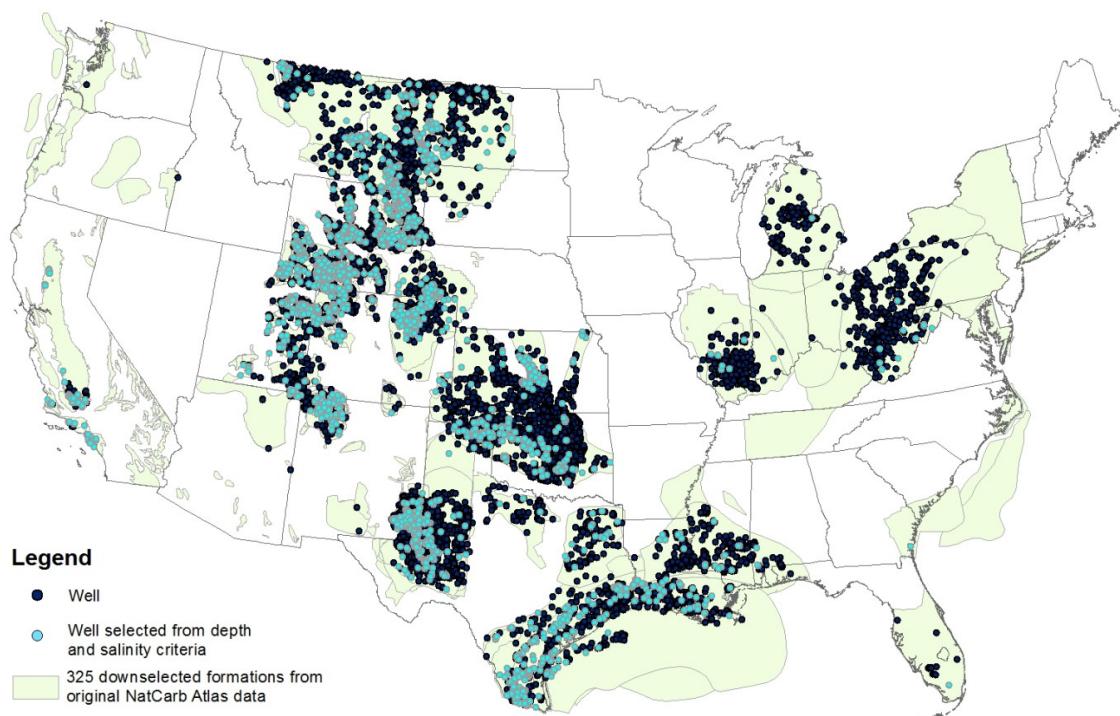


Figure 6. Selected wells from the NatCarb database that meet specific selection criteria.

Using this information, the carbon sequestration module provides a cost estimate for CO₂ sequestration to all of the formations considered. It begins by calculating the distance from the power plant selected to each of the potential formations based on a centroid location of the target formation. The spatial area of the formation is estimated such that a CO₂ pipeline would only need to extend to the edge of the formation, and not to the actual formation centroid. Although the carbon sequestration module calculates expected sequestration costs for all formations, only formations within the distance specified in Figure 7 will be considered as the model chosen default formation.

The National Water Energy & Carbon Sequestration (WECS) Model
a dynamic analysis tool

Summary Power Plant Carbon Capture Carbon Sequestration Extracted Water Power Costs

Selected Sequestration Formation

Partnership	Basin Name	Formation Name
<input checked="" type="radio"/> Model Default: SECARB	Gulf Coast	Eocene Sand
<input type="radio"/> Custom: (changeable with dropdown)	New (not in database)	
	Not in database	Not in database
	Not in database	Not in database

Locations of Formation & Power Plant

Selected formation centroid location

Power plant location (set on Power Plant Tab)

Formation Centroid Location

Latitude	Longitude
<input checked="" type="radio"/> Default	29°59'34.8"
<input type="radio"/> Custom (changeable)	36°
	-93°53'58.2"
	-108°

Power plant to formation distance

<input checked="" type="radio"/> Default	6 mi
<input type="radio"/> Custom (changeable)	0 mi

Formation Shape and Areal Extent
Approximate formation extent from centroid in 8 directions

<input checked="" type="radio"/> Default	NW	N	NE
	0 mi	446 mi	192 mi
	W	Centroid	116 mi
	389 mi	253 mi	147 mi
	SW	S	SE

Maximum distance power plant to default formation
Representing potential institutional constraints on moving extracted water back to power plant

50 mi

Formation Footprint Area
Calculated based on geometry specified to the left, or input directly here

<input checked="" type="radio"/> Default	92,123 mi ²
<input type="radio"/> Custom (changeable)	1,000 mi ²

Sequestration Depth (below land surface)

<input checked="" type="radio"/> Default	3,500 ft
<input type="radio"/> Custom (changeable)	5,000 ft

Temperature at Sequestration Depth

<input checked="" type="radio"/> Default	44 C
<input type="radio"/> Custom (changeable)	50 C

Pressure at Sequestration Depth

<input checked="" type="radio"/> Default	103 atm
<input type="radio"/> Custom (changeable)	150 atm

Formation Thickness

<input checked="" type="radio"/> Default	502 ft
<input type="radio"/> Custom (changeable)	500 ft

Formation Porosity

<input checked="" type="radio"/> Default	0.1
<input type="radio"/> Custom (changeable)	0.15

Formation Permeability

<input checked="" type="radio"/> Default	50 mD
<input type="radio"/> Custom (changeable)	51 mD

Number of injection wells
Default based on maximum injection per well calculated from typical well limits and formation thickness, porosity, and permeability.

<input checked="" type="radio"/> Default	10
<input type="radio"/> Custom (changeable)	5

Steady State Density Sequestered CO₂
Default calculated with pressure and temperature at sequestration depth from above.

<input checked="" type="radio"/> Default	581 kg/m ³
<input type="radio"/> Custom (changeable)	650 kg/m ³

Sequestration Efficiency
(% of void space occupied by CO₂)

30 %

CO₂ Storage Capacity
Default calculated with formation area, thickness, porosity, sequestration efficiency, and CO₂ density

<input checked="" type="radio"/> Default	649,062 Mmt
<input type="radio"/> NatCarb	51,000 Mmt
<input type="radio"/> Custom (changeable)	50,000 Mmt

Input

Figure 7. User interface inputs to WECS II carbon sequestration module.
Values in blue and radio buttons or slider bars can be changed by the user.

Once the depth of sequestration is determined, default values for temperature and pressure are calculated based on geothermal gradient estimates, and an assumed hydrostatic pressure gradient starting at the surface. The model uses this information to calculate volumes of CO₂ managed at depth.

Default values for formation CO₂ storage capacity, thickness, porosity, temperature and pressure are based on published data in the National Carbon Sequestration Atlas (NatCarb, 2008) where available. Where data are not found in the present NatCarb database, general estimates are based on relationships between formation geology, depth, and porosity/permeability where available (these continue to be refined or included). Figure 7 also specifies the sequestration efficiency or “sweep efficiency” (meaning the percent of void space that would actually be occupied by supercritical CO₂) built from a base case value of 30%. Sequestration efficiency is used along with the formation area, thickness, porosity, and CO₂ density to calculate the mass storage capacity of the formation. Using these results, the model user can choose between the calculated default storage capacity, the NatCarb reported capacity, or a custom value to begin to address the often relatively large range of calculated volumes reported for saline formations to store CO₂^{viii}.

For all 325 potential formations in NatCarb, the distance between source and sink, the depth of sequestration, the number of injection wells needed, and the capacity of the formation is passed to the power costs module for use in calculation of costs from which the default formation is selected. Additionally, important variables are displayed in the output section of the carbon sequestration module user interface shown in Figure 8.

Output	Distance from source to sink (linear distance):	6.2 mi
	Sequestration depth:	5,000 ft
	Steady state temperature at sequestration depth:	55.1 C
	Steady state pressure at sequestration depth:	147.5 atm
	Steady state density of CO ₂ in sequestration formation:	653 kg/m ³
	Expected life of sequestration formation for selected source:	82,000 yr
	Number of sequestration (injection) wells needed:	10
	Total rate of sequestration:	8.92 Mmt/yr
	Levelized cost of CO ₂ transport and sequestration:	0.05 cents/kWh

Figure 8. User interface outputs from WECS II carbon sequestration module that include distance between power plant and sink, depth and rate of sequestration, steady state temperature, pressure, and resulting CO₂ density at the sequestration depth, expected life of the formation, required number of injection wells, and the levelized cost of the CO₂ transport and sequestration per unit of energy generated.

Addressing Uncertainty in the Geological Data

To address the impact of uncertainty (or availability) of data, such as porosity and permeability, on important performance criteria such as ‘sweep efficiency’ and similar parameters, the project will look to develop probabilistic distribution functions (PDF) for select parameters. Important parameters such as permeability can vary many orders of magnitude within common reservoir rocks (e.g., sandstones, limestones), and the parameters can also vary with the scale of measurement (e.g., measurements made on core or via pump tests).

Geostatistical methods provide techniques to deterministically or stochastically estimate the spatial distribution of subsurface parameters at unsampled locations. They also offer methods for quantitatively describing spatial relationships of parameters. Especially important is the ability to provide estimates of uncertainty associated with the interpolated and extrapolated parameter values (Kelkar and Perez, 2002). To include uncertainty in reservoir and caprock properties in the WECS model, the team is running multiple 3D realizations of injection and fluid extraction in the Mount Simon Formation, from which the analysis is constructing probability distribution functions in plume extent, injectivity and plume sweep efficiency. These can be used within the WECS structure to assess the relative importance of uncertainty in reservoir parameters in assessing the overall economics of the coupled use model. The Mount Simon Formation is an important storage target in the Illinois Basin in the U.S. (Finley et al., 2005).

This involves running multiple realizations of injection in a reservoir model (TOUGH2; Pruess et al., 1999) with spatially correlated porosity, permeability, and capillary pressure functions, and examining the resulting variation in plume migration, injectivity, and sweep efficiency. To allow for heterogeneity in single and multiphase transport properties in TOUGH2, distributions of porosity and permeability for the Mount Simon Formation sandstone were taken from core and wireline logs from previous studies in the Illinois Basin by the Midwest Geological Sequestration Consortium (Finley, 2005). Spatial correlations in porosity are quantifiable via correlation functions or graphically in variograms (for the Mount Simon, see Finley et al., 2005). The analysis is generating multiple realizations of porosity distributions mapped onto a TOUGH2 grid using this variogram information and the geostatistical Sequential Gaussian algorithm via the computer program “SGSIM” of the GSLIB family of programs (Deutsch and Journel, 1998). Correlated permeability distributions were obtained using the coregionalization method, which uses a relationship between core and wireline log porosity values and permeability measurements made on core, while still producing spatially correlated permeability values (Rautman and McKenna, 1997). One such realization is shown below in Figure 9(A), with grid block size of 10 m, 10 m, and 1 m in the x, y, and z directions, respectively for a 500mx500mx35m domain.

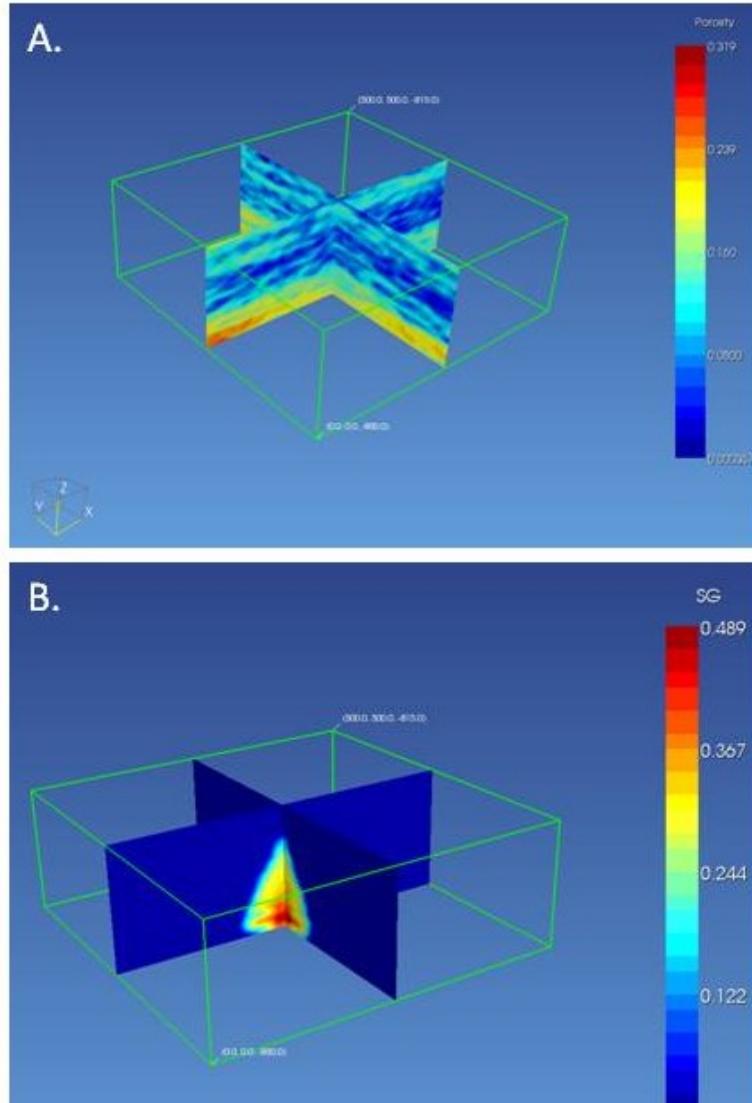


Figure 9. (A). Example of porosity realization of the Mount Simon Formation upper sandstone facies. In this realization there is a lower, more porous zone. **(B).** After three years of injection, supercritical CO₂ has produced an inverted profile due to the heterogeneity, in particular advancing further along the bottom of the domain. This plume shape is counter to that observed for injection into a homogeneous body (i.e., due to gravity override). 5x vertical exaggeration in the vertical direction.

Multiphase fluid flow modeling is being performed using these spatially correlated realizations in porosity, permeability, and capillary pressure using TOUGH2 (Pruess et al., 1999) and the ECO2N equation of state module (Pruess, 2005). An example after 3 years of injection at a rate of 0.15 kg/s ($\sim 5 \times 10^{-3}$ Mtonne/yr) is shown in Figure 9(B). Inclusion of heterogeneity in this case has produced a plume shape that is inverted from the usual ‘gravity override’ plume shape, a plume migration that is about twice that than a homogeneous case (due to fast paths), an injectivity that is about an order of magnitude less, and a sweep efficiency that is at least an order of magnitude less than the homogeneous case. The team is running multiple realizations of CO₂ injection in this manner, from which it can extract probability distribution functions of these parameters. With this type of information, the overarching system’s flow dynamics can be better categorized, and the resulting costs (ultimately leveled cost of electricity) will reflect the uncertainties present throughout the physical CO₂ sequestration and water extraction systems.

2.3. Extracted Water Module

The WECS II model assumes that water will be extracted from the sequestration formation. This extraction may be used to manage pressure build up, control CO₂ plume migration, and provide a means to offset increased power plant water demands associated with carbon capture and sequestration. The distance between the wells and the representative power plant can change according to user input. The default distance is set to shorter distances to help minimize the need to move extracted water long distances (and across several political boundaries) from the formation back to the power plant. Next, the module calculates the depth of sequestration. Within a 500' interval starting at 2500' to 3000', then 3000' to 3500' and so on up to 9500' to 10,000' the maximum sequestration depth was considered. If information on formation depth and thickness improves, the formation selected may at some point determine the sequestration depth without the associated well analysis.

User input options for the extracted water module are shown in Figure 9. The user inputs determine the range of water quality defined by total dissolved solids (TDS) to be targeted by the extraction wells. Total Dissolved Solids is defined in units of parts per thousand (ppt). Based on this range and the distribution of salinity in the formation, the model chooses a default extraction depth interval of 2500'–4999', 5000'–7499', or 7500'–10000' to minimize water extraction and treatment costs. The WECS II model assumes that extracting waters from any of those depth intervals can accomplish the desired pressure relief and plume management goals regardless of the depth of sequestration. Once the salinity range and extraction depth range have been selected, the model can calculate the probability of drilling a well with acceptable water quality (this probability has cost implications associated with drilling wells that cannot be used) which becomes the default, base case value. The distribution of water qualities in the formation at the given depth for useable wells then determines the average salinity expected from useable wells.


Figure 9 illustrates the assumptions used to specify how much water is actually removed from the formation with the default value being an equal volume to the volume of CO₂ injected into the formation.^{ix}

The National Water Energy & Carbon Sequestration (WECS) Model
a dynamic analysis tool

Summary Power Plant Carbon Capture Carbon Sequestration **Extracted Water** Power Costs


Input

Min useable TDS
(potential drinking supply below this)



10 ppt

Max useable TDS
(highest salinity treated in model)



30 ppt

Question marks (?) in any of the default fields below mean that there is not well data to support an estimate, and a custom input must be specified.

Probability of drilling a useable well
(default based on useable tds range, & tds distribution in formation)

<input checked="" type="radio"/> Default	58 %
<input type="radio"/> Custom (changeable)	50 %


Average salinity from useable wells
(average salinity of well records with acceptable TDS in selected formation near extraction depth)

<input checked="" type="radio"/> Default	20 ppt
<input type="radio"/> Custom (changeable)	20 ppt

Extraction wells depth
(default based on minimizing drilling costs resulting from probability of drilling a useable well)

<input checked="" type="radio"/> Default	2500' to 5000'
<input type="radio"/> Custom (changeable)	4,725 ft

H2O volumetric extraction rate as % of CO2 volumetric injection rate
(100% means the same volume of water is removed from the formation as the volume of CO2 added)



100 % = 8.97 MGD

Number of operating extraction wells
Default based on formation thickness, porosity, and permeability.

<input checked="" type="radio"/> Default	18
<input type="radio"/> Custom (changeable)	4

Brine Disposal Method
Custom option will change disposal method for the selected formation only. Unlike other custom inputs, it will not alter the model selected default formation.

<input checked="" type="radio"/> Default	Injection wells
<input type="radio"/> Custom	<input style="width: 100%;" type="button" value="Evaporation ponds"/>

Net evaporation rate at power plant
The higher the net evaporation, the more effective evaporation ponds for brine disposal. They won't work at all if it is zero or negative.

<input checked="" type="radio"/> Default	60 in/yr
<input type="radio"/> Custom (changeable)	10 in/yr

Required evaporation pond area
If brine is to be disposed of using evaporation ponds, how large an area of ponds would be required?

<input checked="" type="radio"/> Default	554 acres
<input type="radio"/> Custom (changeable)	10 acres

Distance to brine injection point
Distance waste brine would need to be transported for disposal by injection. Default is distance from plant to sequestration formation.

<input checked="" type="radio"/> Default	6 mi
<input type="radio"/> Custom (changeable)	0 mi

Distance to free brine disposal point
Distance waste brine would need to be transported for free disposal (eg to an ocean).

<input checked="" type="radio"/> Default	66 mi
<input type="radio"/> Custom (changeable)	0 mi

Figure 9. User interface inputs to WECS II extracted water module showing adjustable inputs. Values in blue and radio buttons or slider bars can be changed by the user.

The extracted water module also selects a least cost default brine disposal method based on the least cost method for a particular power plant. The brine disposal methods currently considered are evaporation ponds, delivery to the ocean, and injection back into the source formation, with a brine concentrator option planned for incorporation in the next model iteration. The relative cost of these disposal methods varies with net evaporation at the power plant, distance of the plant to the ocean, and distance between the plant and the saline formation being utilized that can all be customized if desired.

Using the information and results of the extracted water model, several select variables including a histogram of water quality in well records associated with the geologic formation in the target extraction depth range are displayed as output in the user interface of the extracted water module as shown in 10.

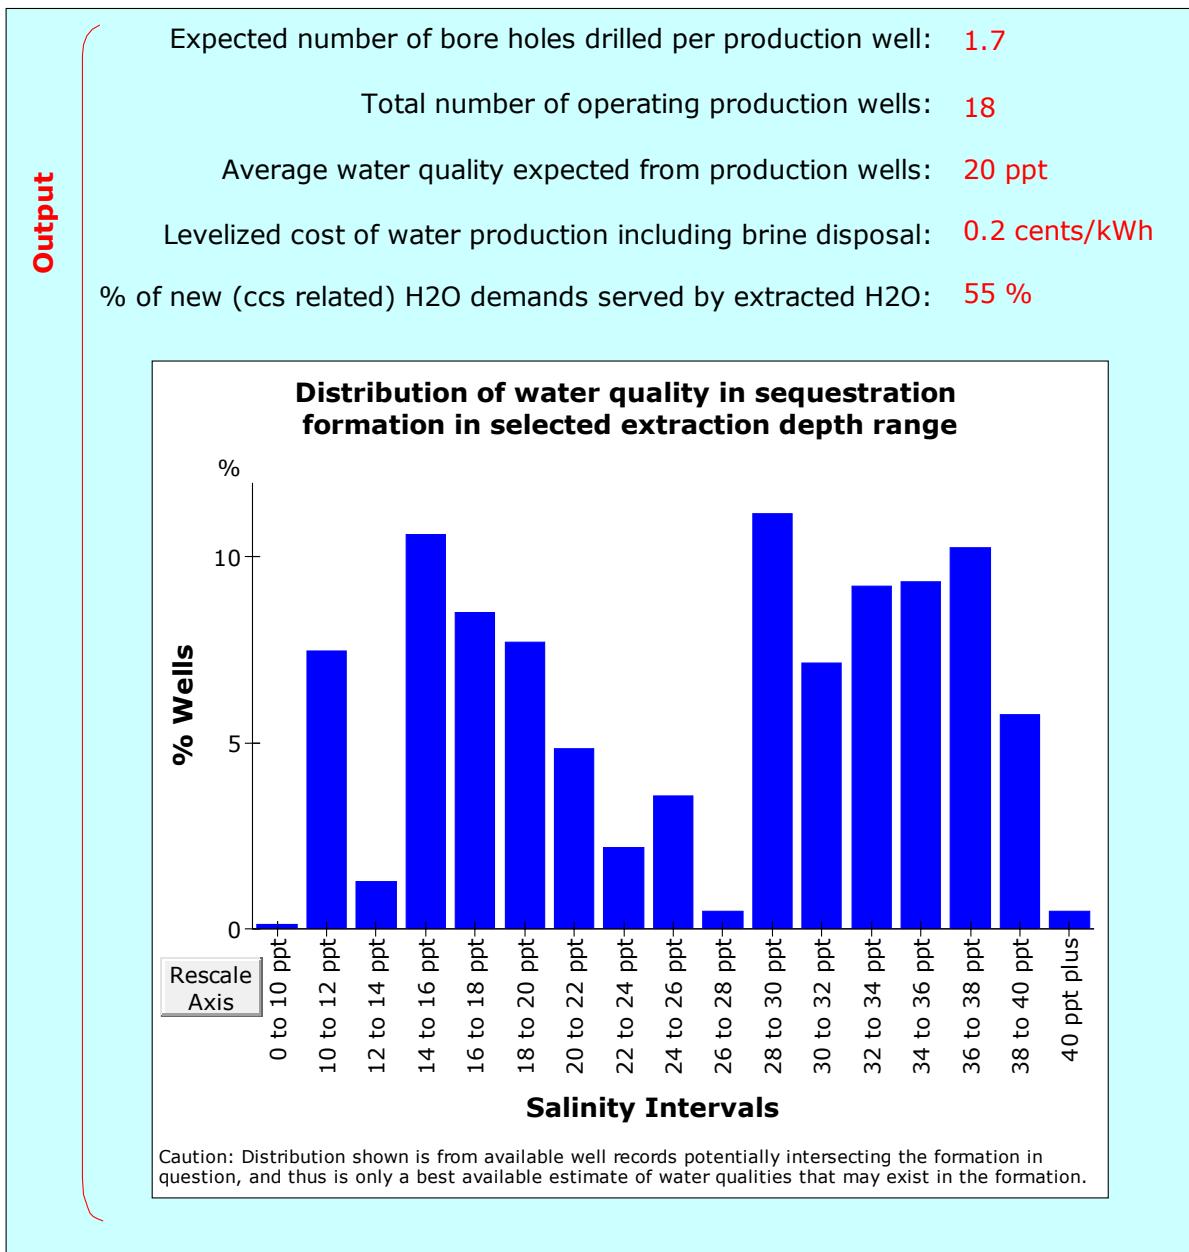


Figure 10. User interface outputs from the WECS II extracted water module.

The power cost module uses the results of the power plant, water extraction, and carbon capture modules to calculate the least cost formation for sequestration and water extraction. It also calculates changes to LCOE based

on capital and operation and maintenance costs associated with carbon capture and use of the selected formation for sequestration and water extraction.^x

WECS II assumes amine scrubbing technology for all plant types with the exception of IGCC, which are assumed to use selexol technology (NETL, 2007a). This approach is based on costs of new IGCC plants, and may underestimate costs for CO₂ capture in a retrofit situation. A method based on retrofit costs should be developed when retrofit specific data becomes available for this particular situation. The Selexol equations are shown in the last 3 data rows of Table 8 below. An interesting insight to highlight is the capital costs and the combined O&M costs are substantially smaller per mass of CO₂ captured for the Selexol processes than for the amine based processes. This difference suggests that existing IGCC plants represent initially the more cost-effective options compared to other technology configurations for carbon capture retrofits.

Cost Type	Equation (2006 \$US)	R ²
Amine Capital	CCost[\$1000] = 839.59*CO ₂ Captured[tonne/hr] + 119453	0.98
Amine VO&M	VO&M[\$1000/yr] = 46.183*CO ₂ Captured[tonne/hr] + 1838.6	1
Amine FO&M	FO&M[\$1000/yr] = 2.6896*CO ₂ Captured[tonne/hr] + 1556.9	1
Selexol Capital	CCost[\$1000] = 361.8*CO ₂ Captured[tonne/hr]	N/A
Selexol VO&M	VO&M[\$1000/yr] = (3.1+153*CoalCost[\$1000/ton])*CO ₂ Captured[tonne/hr]	N/A
Selexol FO&M	FO&M[\$1000/yr] = 5*CO ₂ Captured[tonne/hr]	N/A

Table 8. Equations relating capital costs, variable operations and maintenance (VO&M) costs, and fixed operations and maintenance (FO&M) costs to the amount of carbon captures using amine technologies. The goodness of fit (R²) parameter refers only to the fit of the amine equations to 4 estimated points from one report (NETL, 2007b) on one pulverized coal unit, and not necessarily to the overall extendibility of the initial equation results beyond the representative technologies.

The parasitic energy losses are specified in the CO₂ capture module. The underlying default equations for the cost of CO₂ transport and sequestration are based on Ogden (2002), but may be adjusted to custom input levels as desired. The parameters used to calculate the well costs also follow those outlined by Ogden (2002).^{xi}

The current model version assumes that the potential energy of the CO₂ going down an injection well is sufficient to preclude the need for additional energy to actively pump the CO₂ down into the formation. As a result, no additional energy costs are added to the injection well costs. This may be changed in subsequent scenarios.

It is important to note that the WECS II model currently has no cost associated with buying or leasing subsurface pore-space in the formation for storage of CO₂. The legal ownership issues associated with pore-space ownership are still being considered. As information becomes available, these costs may be added to the model.

The base case assumptions for WECS II specify that the well capital costs are \$375 per foot of depth and million gallons per day (MGD) of extraction, in year 2000 dollars. For example, a well 1000 feet deep extracting 10 MGD would cost \$375*1000*10 = \$3.75 million (2000 \$US). This methodology follows that used in the original WECS model (Kobos et al., 2008a,b; 2009, 2010), that also draws from NETL (2009a) and the U.S. Bureau of Reclamation Desalting Handbook (USBR, 2003). When a well is drilled that cannot be used (based on a similar probabilistic methodology outlined in the carbon sequestration well development module), WECS II assumes that 75% of the cost of a completed well is spent on drilling only, and is lost to any unusable effort. Unlike the case for the CO₂ injection wells, the water extraction well may require substantial amounts of energy to pump the water from the extraction well depth.

Finally, the model adds an additional 1.5% of capital costs as non energy related O&M. The capital cost of water pipelines (in year 2000 dollars) is calculated as \$111,314 per mile plus an additional \$35,761 per mile per MGD of flow building from the methodology outlined in Kobos (2008a,b; 2009, 2010). Thus a pipeline 100 miles long carrying 10 MGD would have a capital cost of \$111,314*100 + \$35,761*100*10, or about \$47 million (\$US 2000). Energy costs of the water pipeline are calculated based on the friction coefficient of the pipeline times the length of the pipeline, times the mass of the water being transported times the acceleration due to gravity divided by the efficiency of the pipeline pumps. No elevation change from the point of extraction to the treatment plant is currently incorporated. Finally, an additional 1.5% of capital costs are assumed as the non energy related O&M costs of the pipeline. Figure 11 illustrates the water treatment costs. The WECS II model assumes use of High Efficiency Reverse Osmosis (HEROTM) water treatment.^{xii} The feed flow refers to the total amount of untreated

water that enters the treatment plant. The plant capacity on the other hand is the design capacity of treated water that the plant can produce. The capital cost of the treatment plant is calculated as the sum of two components, one for piping infrastructure, and one for the treatment related infrastructure. The default values for these in 2004 dollars are \$779,931 per MGD feed flow for the piping, and approximately \$3.5 million per MGD feed flow for the treatment. Annual labor costs in year 2000 dollars are calculated as \$171,778 per year per gallon per minute of plant capacity multiplied by the plant capacity raised to the power of 0.2322. Annual energy requirements for water treatment are calculated as 2.41 kWh/1000 gallons of treated water plus 0.6 kWh/1000 gallons of treated water/ ppt of treated water extracted.

Additional parameters relevant to the underlying economic calculations include the loan interest rate, period, expected life of the sequestration formation that help calculate the subsequent levelized costs within the LCOE. In subsequent user option pages, custom scenario options include the CO₂ pipeline metrics (length, flow rate, capital cost, O&M costs), injection well and water collection parameters (pipeline fixed cost, \$/km cost, water flow rate, well pump efficiency, water well O&M) and water transport cost parameters (pipeline base cost, marginal cost, friction coefficient, pump efficiency). The water treatment module parameter inputs include the initial capital costs (HEROTM system, labor, electricity use, O&M) and the concentrated brine disposal costs (evaporation ponds, injection wells, O&M costs). All of these parameters may be adjusted to run custom scenarios. The base case options draw from the original WECS options (Kobos et al., 2008b) and ongoing model updates.

The National Water Energy & Carbon Sequestration (WECS) Model
a dynamic analysis tool

Summary Power Plant Carbon Capture Carbon Sequestration Extracted Water Power Costs

Display year for output \$ values

1950 1960 1970 1980 1990 2000 2010

Loan interest rate 5 %/yr
Loan period 10 yr

Smaller of loan period, power plant remaining life, & formation life used to calculate capitalization factors

Base Levelized Cost of Electricity (LCOE)

	Total	Fuel Costs	Cooling	All Other	\$ Year:
<input checked="" type="radio"/> Default:	6.7 cents/kWh	= 2.1 cents/kWh	+ 0.3 cents/kWh	+ 4.4 cents/kWh	2010
<input type="radio"/> Custom: (changeable)	6.4 cents/kWh	= 2 cents/kWh	+ 0.2 cents/kWh	+ 4.2 cents/kWh	2007

Defaults based on Exhibits ES-2, 3-29, 3-62, 3-95, 4-12, 4-33, 5-12 in NREL 2007/1281 and Figure 13 of Tawney, Khan, Zachary, Journal of Engineering for Gas Turbines and Power, April 2005, Vol. 127

CO2 Capture, Compression, and Makeup Power Cost Parameters:

Cost Parameters for Amine Scrubbing Capture and Compression:

Capital costs. Fixed portion. (2006 \$)	\$119,453,000
Capital costs. Variable portion. (2006 \$)	\$839,590 hr/tonne
Variable O&M costs. Fixed portion. (2006 \$)	\$1,838,600 per yr
Variable O&M costs. Variable portion. (2006 \$)	46,183 USD/yr/(tonne/hr)
Fixed O&M costs. Fixed portion. (2006 \$)	\$1,556,900 per yr
Fixed O&M costs. Variable portion. (2006 \$)	2,690 USD/yr/(tonne/hr)

Defaults based on data published in Table ES-1 of DOE/NETL report # 401/110907, "Carbon Dioxide Capture from Existing Coal-Fired Power Plants". Regressions were created for capital cost, fixed O&M, and variable O&M costs (not including make-up power which is handled separately) as a function of carbon dioxide captured:

Cost Type	Equation	R2
Capital	CCost[Thousands of 2006\$] = 839.59*CO2Captured[tonne/hr] + 119453	0.977
Variable O&M	VO&M[Thousands of 2006\$/yr] = 46.183*CO2Captured[tonne/hr] + 1838.6	0.996
Fixed O&M	FO&M[Thousands of 2006\$/yr] = 2.6896*CO2Captured[tonne/hr] + 1556.9	1

Cost Parameters for Selexol Capture and Compression (for IGCC):

Capital costs per CO2 captured. (2006 \$)	\$190 hr/lb
Selexol fixed O&M costs per CO2 captured. (2006 \$)	\$0.35 per tonne
Selexol variable O&M costs per CO2 captured. (2006 \$)	\$0.57 per tonne
Additional coal use at IGCC per CO2 captured. (2006 \$)	0.07 tons/yr/(lb/hr)
Assumed cost of coal. (2006 \$)	\$42.11 per ton

Default values based on data in NREL 2007/1281 for LCOE from new IGCC plants with and without carbon capture. Thus the cost of carbon capture on retrofit IGCC plants may be more than this.

Make-up Power LCOE

<input checked="" type="radio"/> Default:	6.6 cents/kWh	(2010 dollars)
<input type="radio"/> Custom (changeable):	6.4 cents/kWh	(2010 dollars)

Default based on NREL 2007/1281 and Tawney, Khan, Zachary 2005

Input

Figure 21. User interface inputs to the WECS II power costs module showing adjustable inputs. Values in blue and radio buttons or slider bars can be changed by the user.

Once the water has been treated, the resulting brine concentrate must be disposed of using three potential options: evaporation ponds, reinjection, and/or discharge to the ocean. Additional brine concentrate management technologies may be included in subsequent versions of the analysis, but the current calculations are based on those employed by the WECS I model (Kobos, et al., 2008; USBR, 2003). The flow rate of the concentrated brine pipelines will be less for ocean discharge than it was for the extracted water, so in general the pipeline costs for the brine concentrate will be less than those for the extracted water. For brine concentrate discharge to the ocean, no additional costs are added, while for reinjection, there are additional costs associated with construction of injection wells. It may be possible, to use the CO₂ injection wells for brine concentrate disposal, that may have benefits related to CO₂ plume management. However, for the purposes of the WECS II model at this time, it is assumed that new injection wells will be required for the brine concentrate. Once the annualized costs associated with CO₂ capture, compression, sequestration, and extracted water use have been calculated, they can also be expressed in terms of leveled cost of electricity.

3. WECS II Summary Interface

The General Summary illustrated in Figure 12 gives a high level summary of the base case scenario for one representative power plant amongst the hundreds throughout the United States. The reported results include the power plant capacity and type, the percentage of CO₂ being captured, the LCOE and water demand increases resulting from carbon capture, the cost of avoided CO₂ emissions, the distance between power plant and sequestration formation, the size of the sequestration formation in terms of the estimated number of years of sequestration available, and the percent of water demand increase served by the extracted water. Additional detail on the carbon capture aspects of the representative scenario include the percent of CO₂ captured, the resulting parasitic energy loss, CO₂ generation as a result of make-up power generation, the percent of this carbon that is captured, and the added water withdrawal demands associated with CO₂ capture and compression. Additionally, the model user can receive information about the formation under consideration for sequestration including location. Regional Carbon Sequestration Partnership name, geologic basin and formation names, and the estimated number of years of sequestration available are also reported for the given sequestration location. The extracted water summary returns information on the extracted water module including the rate of extraction, the treated water resource, the percent of added water demand associated with CO₂ capture and compression that is served by this resource, the target water quality, the extraction well depth, and the selected brine concentrate disposal method. The power costs summary displays information regarding the power costs module including the base LCOE, and the incremental LCOE associated with carbon capture and compression, CO₂ transport, and water extraction and treatment, the total new LCOE, the percent increase from base that this represents, and the cost of avoided atmospheric CO₂ emissions.

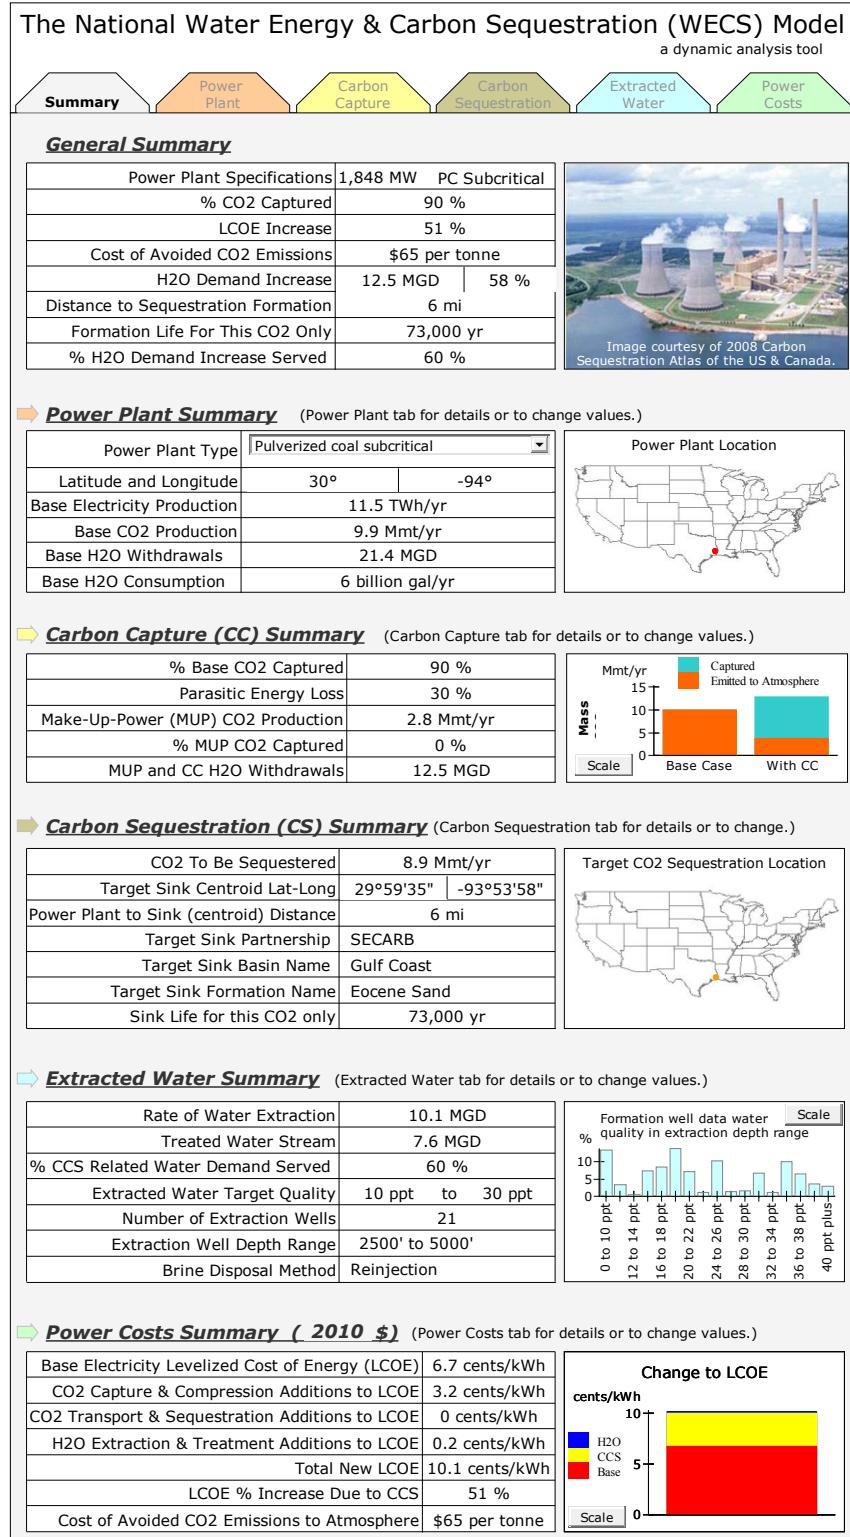


Figure 12. WECS II summary interface page.

This page combines select information from all modules to provide the important parameters associated with the scenario being evaluated by the model user.

4. Future Work Efforts

Each regional partnership was contacted to determine whether all of the site-specific attributes of their supporting data used to make the CO₂ capacity estimates as reported in the NatCarb database was being sufficiently incorporated. The analysis also builds from work developed and incorporated by Hovorka et al. (2000) characterized additional saline formation data in the U.S. In the short term, the WECS II model will focus on completing the sequestration formation database and related interface updates. The first set of scenario analyses will focus on comparing the output of this model to those of relevant, published studies as an initial validation of model function. Following this phase of analysis, the national suite of existing coal and gas fired power plants will be analyzed with WECS II. Finally, an uncertainty analysis aspect will be incorporated to bound uncertainty associated with the model's key assumptions and input data.

The WECS II model will be used to evaluate the national fleet of existing coal and gas fired electricity generators. These results will include the cost of avoided CO₂ emissions for each plant, which can be ranked, ordered, and plotted as an estimated supply curve for avoided CO₂ emissions in the early phase of carbon capture and sequestration efforts in the U.S. This would be an initial scenario because each power plant is evaluated in isolation, with no competition from other power plants for geologic resources (e.g., multiple power plants' CO₂ being stored in a single saline formation). A later phase analysis is planned that will incorporate the PDF analysis results across multiple geophysical parameters, and a temporal dimension of national carbon capture and sequestration efforts such that as a plant adds carbon capture, the space available for sequestration is limited to pore space that other plants have not already reserved for their own sequestration programs.

Conclusions

The initial results of the analysis indicate that less than 20% of all the existing complete saline formation well data may meet the working depth, salinity and formation intersecting criteria. These results were taken from examining updated NatCarb data. This finding, while just an initial result, suggests that the combined use of saline formations for CO₂ storage and extracted water use may be limited by the selection criteria chosen. A second preliminary finding of the analysis suggests that some of the necessary data required for this analysis is not present in all of the NatCarb records.

This type of analysis represents the beginning of the larger, in depth study for all existing coal and natural gas power plants and saline formations in the U.S. for the purpose of potential CO₂ storage and water reuse for supplemental cooling. Additionally, this allows for potential policy insight when understanding the difficult nature of combined potential institutional (regulatory) and physical (engineered geological sequestration and extracted water system) constraints across the United States. Finally, a representative scenario for a 1,800 MW subcritical coal fired power plant (amongst other types including supercritical coal, integrated gasification combined cycle, natural gas turbine and natural gas combined cycle) can look to existing and new carbon capture, transportation, compression and sequestration technologies along with a suite of extracting and treating technologies for water to assess the system's overall physical and economic viability. Thus, this particular plant, with 90% capture, will reduce the net emissions of CO₂ (original less the amount of energy and hence CO₂ emissions required to power the carbon capture water treatment systems) less than 90%, and its water demands will increase by approximately 50%. These systems may increase the plant's LCOE by approximately 50% or more. This representative example suggests that scaling up these carbon capture and sequestration technologies to many plants throughout the country could increase the water demands substantially at the regional, and possibly national level. These scenarios for all power plants and saline formations throughout U.S. can incorporate new information as it becomes available for potential new plant build out planning.

Acknowledgements

The authors would like to thank the National Energy Technology Laboratory (NETL) for their ongoing support for this project. Additionally, the authors also appreciate the assistance provided by Sean McKenna with the Geostatistics methods, as well as the insights provided by Malynda A. Cappelle and Barbara D. Moreland.

References

Angus, S., Armstrong, B., and K.M. de Reuck, 1976, International thermodynamic tables of the fluid state. Carbon dioxide, Pergamon Press, Oxford.

Deutsch, C. V., and Journel, A. G., 1998, GSLIB: Geostatistical Software Library and User's Guide: New York, New York, Oxford University Press, Inc., 369 p.

eGRID2007 Version 1.1, 2007, EPA database of power plants in the United States. Spreadsheet: eGRID2007V_1_year05_plant.xls PLNT05 tab. Available from <http://www.epa.gov/cleanenergy/energy-resources/egrid/index.html#download>

Finley, R., 2005, An assessment of geological carbon sequestration options in the Illinois Basin, final report, Illinois State Geological Survey, U.S. DOE Contract: DE-FC26-03NT41994.

Hovorka, S.D, M.L. Romero, R.H. Trevino, A.G. Warne, W.A. Ambrose, P.R. Knox, and T.A. Tremblay, 2000, Technical summary: optimal geological environments for carbon dioxide disposal in brine-bearing formations (aquifers) in the United States. The University of Texas at Austin, Bureau of Economic Geology, final report prepared for U.S. Department of Energy, National Energy Technology Laboratory, under contract no. DE-AC26-98FT40417, 232 p. GCCC Digital Publication Series #00-01.

Jacobs, M.A., 2005, Measurement and modeling of thermodynamic properties for the processing of polymers in supercritical fluids, PhD thesis, Eindhoven University of Technology, Eindhoven.

Kelkar, M., and Perez, G., 2002, Applied Geostatistics for Reservoir Characterization: Richardson, Texas, Society of Petroleum Engineers, Inc., 264 p.

Kobos, P.H., Cappelle, M.A., Krumhansl, J.L., Dewers, T., Borns, D.J., Brady, P.V. and A. McNemar, 2008a, Using Saline Aquifers for Combined Power Plant Water Needs and Carbon Sequestration. 28th USAEE/IAEE North American Conference, December 3-5, 2008. SAND2008-6482C.

Kobos, P.H., M.A. Cappelle, J.L. Krumhansl, D.J. Borns, M. Hightower, and A. McNemar, 2008b, Study of the Use of Saline Aquifers for Combined Thermoelectric Power Plant Water Needs and Carbon Sequestration at Regional-Scale: Phase I Report. SAND2008-4037, Sandia National Laboratories, Albuquerque, NM.

Kobos, P.H., J.L. Krumhansl, T.A. Dewers, J.E. Heath, M.A. Cappelle, D.J. Borns, G.T. Klise, B.P. Dwyer and A. McNemar, 2009, Combining Power Plant Water Needs and Carbon Storage using Saline Formations: An Assessment Tool, 8th Annual Conference on Carbon Capture and Sequestration – DOE/NETL, Pittsburgh, PA, May 4-7, 2009.

Kobos, P.H., Roach, J.D., Klise, G.T., Krumhansl, J.L., Dewers, T.A., Dwyer, B.P., Heath, J.E., Borns, D.J. and A. McNemar, 2010, Saline Formations, Carbon Dioxide Storage, and Extracted Water Treatment: A National Assessment Tool Ninth Annual Conference on Carbon Capture & Sequestration, SAND2010-2899C, Pittsburgh, PA, May 10-13, 2010.

NatCarb, 2008, Carbon Sequestration Atlas of the United States and Canada – 2nd Edition., National Energy Technology Laboratory. Report available at: http://www.netl.doe.gov/technologies/carbon_seq/refshelf/atlasII/index.html

National Energy Technology Laboratory (NETL) and Concurrent Technologies Corporation (CTC), 2002, Evaluation of Fossil Fuel Power Plants with CO₂ Recovery. Contract No. DE-AM26-99FT40465, Final Report, February 2002. http://www.netl.doe.gov/technologies/carbon_seq/Resources/Analysis/pubs/Evaluation_of_Fossil_Fuel_Power_Plants_with_CO2_Recovery.pdf

National Energy Technology Laboratory (NETL), 2007a, Cost and Performance Baseline for Fossil Energy Power Plants study, Volume 1: Bituminous Coal and Natural Gas to Electricity Report. DOE/NETL-2007/1281, Revised August 2007. http://www.netl.doe.gov/energy-analyses/pubs/Bituminous%20Baseline_Final%20Report.pdf

National Energy Technology Laboratory (NETL), 2007b, Carbon Dioxide Capture from Existing Coal-Fired Power Plants. DOE/NETL-401-110907. (Final Report (Original Issue Date, December 2006)), Revision Date, November 2007. <http://www.netl.doe.gov/energy-analyses/pubs/CO2%20Retrofit%20From%20Existing%20Plants%20Revised%20November%202007.pdf>

National Energy Technology Laboratory (NETL), 2008, Estimating Freshwater Needs to Meet Future Thermoelectric Generation Requirements. Report DOE/NETL 400/2008/1339, Revised August 2008.

http://www.netl.doe.gov/technologies/coalpower/ewr/pubs/2008_Water_Needs_Analysis-Final_10-2-2008.pdf

National Energy Technology Laboratory (NETL), 2009, Water Requirements for Existing and Emerging Thermoelectric Plant Technologies. Report DOE/NETL-402/080108, Revised April 2009. <http://www.netl.doe.gov/energy-analyses/pubs/WaterRequirements.pdf>

Office of Management and Budget (OMB), 2010, Gross Domestic Product and Deflators Used in the Historical Tables. <http://www.whitehouse.gov/omb/budget/fy2010/assets/hist10z1.xls>

Ogden, J.M., 2002, Modeling Infrastructure For a Fossil Hydrogen Energy System with CO₂ Sequestration. Sixth Greenhouse Gas Control Technologies Conference, Kyoto, Japan, 9/30/2002 – 10/4/2002.

Pruess, K., 2005, ECO2N: a TOUGH2 fluid property module for mixtures of water, NaCl, and CO₂: Lawrence Berkeley National Laboratory, LBNL-57952.

Pruess, K., Oldenburg, C., and Moridis, G., 1999, TOUGH2 User's Guide, Version 2.0, Lawrence Berkeley National Laboratory, LBNL-43134, 198 p.

Rautman, C. A., and McKenna, S. A., 1997, Three-Dimensional Hydrological and Thermal Property Models of Yucca Mountain, Nevada, Sandia Report SAND97-1730: Albuquerque, New Mexico, Sandia National Laboratories, 322 p.

Span, R. and W. Wagner, 1996, A new equation of state for carbon dioxide covering the fluid region from the triple-point temperature to 1100 K at pressures up to 800 Mpa. *J. Phys. Chem. Ref. Data* 25, 1509-1596.

Tawney, R. Z. Khan, and J. Zachary, 2005, Economic and Performance Evaluation of Heat Sink Options in Combined Cycle Applications. *Journal of Engineering for Gas Turbines and Power*, April 2005, Vol. 127. <http://asmedl.aip.org/getpdf/servlet/GetPDFServlet?filetype=pdf&id=JETPEZ000127000002000397000001&idtype=cvips&prog=normal>

United States Bureau of Reclamation (USBR), 2003, Desalting Handbook for Planners, 3rd Edition.

ⁱ This paper draws heavily from Kobos et al., 2010 and represents the next iteration of this ongoing, multi-year project.

ⁱⁱ The correction for selected reference year is calculated based on the historic United States Gross Domestic Product Chained Price Index which is available by year from 1940 to 2014 (2009-2014 estimated) from OMB (2010).

ⁱⁱⁱ The values in Table 2 are adapted from NETL (2007a), rounded to the nearest 100 pounds of CO₂ per megawatt hour electricity produced (lb/MWh). For the IGCC system, the value used is the rounded average of all 3 brands. For the gas turbine, a value of 1000 lb/MWh is assumed. Where additional information is available, user input can supersede the default values.

^{iv} Gas turbines were assumed to have minimal water requirements.

^v Exhibits 3-29, 3-62, 3-95, 4-12, 4-33, and 5-12 in the same report itemize total capital costs in such a way that the cooling system capital cost can be isolated. Exhibits 3-31, 3-64, 3-97, 4-14, 4-35, and 5-14 show variable, fixed, and fuel based operating costs.

^{vi} Tawney et al. (2005) reports multiplicative factors of 0.64 and 2.7 for the relative costs of once-through and dry cooling systems respectively compared to tower cooling. These factors were multiplied by the estimates of leveled cost of tower cooling in Column C of Table 4 to get estimates of the leveled cost of once through and dry cooling as seen in Columns D and E of Table 4. It was assumed that cooling pond systems would have a cost similar to once-through systems.

^{vii} The data related to the potential sequestration formations is still being developed as described by NatCarb (2008 and beyond). There is a moderately high degree of uncertainty associated with the characterization of deep saline formations for a variety of reasons including observation difficulty, spatial heterogeneity, and many other factors for relatively few test cases. As a result, the data required to drive the entire WECS II model is limited in some areas. Thus, as the data is filled in, the carbon sequestration module interface will be updated as needed to allow a level of transparency between the model user and the underlying observations and assumptions related to the geologic data. To address this uncertainty, a probability distribution will be assigned to many of the model inputs and the resulting uncertainty passed through the model to generate probability distributions associated with model outputs. Thus, likely bounds to model outputs such as the supply curve for avoided CO₂ emissions can be estimated.

^{viii} The authors derived a lookup table for CO₂ density based on the carbon dioxide density pressure phase diagram from Jacobs, M.A., 2005. The work of Jacobs, M.A. (2005) also builds from the works of Angus, S., Armstrong, and K.M. de Reuck, 1976 as well as Span and Wagner, 1996.

^{ix} The model will likely refine this calculation using permeability, porosity, and formation thickness to estimate the number of extraction wells needed to achieve the target water extraction, and that value will populate the default option in future versions.

^x The underlying model structure uses the literature or user-based input for cost figures in their respective base year dollars. From this information the model allows for this input and the subsequent results based on this data to be shown in 2010 \$US by default. The results, however may be shown in the base year most relevant to the model user by adjusting the blue colored inputs for the \$US.

^{xi} The equation used was developed by Ogden (2002) as follows: Cost (Q,L) = \$700/m x (Q/Q₀)^{0.48} x (L/L₀)^{0.24} where Cost is capital cost in 2001 \$US, Q is the flow rate of the pipeline being built, Q₀ is a reference flow rate of 16,000 tonnes per day, L is the length of the pipeline being built, and L₀ is a reference length of 100 km. The 0.48 and 0.24 determine how sensitive the cost is to differences in flow rate and length from the reference values. O&M costs are assumed to be 4% of capital costs.

^{xii} The High Efficiency Reverse Osmosis (HEROTM) system is a registered trademark of Debasish Mukhopadhyay.