

DOE/MC--95/C0499  
DOE/NBM--96000403

**Shell/METC High-Temperature, High- Pressure Filtration Program**

**Authors:**

James A. Salter  
John M. Rockey

RECEIVED  
DEC 28 1995  
OSTI

**Contractor:**

Shell Synthetic Fuels, Inc.  
Two Shell Plaza  
P.O. Box 2099  
Houston, Texas 77252

**Contract Number:**

CRADA No. 93-011

**Conference Title:**

12th International Pittsburgh Coal Conference

**Conference Location:**

Pittsburgh, Pennsylvania

**Conference Dates:**

September 11-15, 1995

**Conference Sponsor:**

University of Pittsburgh and U.S. Department of Energy

MASTER

## **DISCLAIMER**

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

This report has been reproduced directly from the best available copy.

Available to DOE and DOE contractors from the Office of Scientific and Technical Information, 175 Oak Ridge Turnpike, Oak Ridge, TN 37831; prices available at (615) 576-8401.

Available to the public from the National Technical Information Service, U.S. Department of Commerce, 5285 Port Royal Road, Springfield, VA 22161; phone orders accepted at (703) 487-4650.

# **SHELL/METC HIGH TEMPERATURE HIGH PRESSURE FILTRATION PROGRAM**

James A. Salter                      and  
Shell Synthetic Fuels Inc.  
Two Shell Plaza  
P. O. Box 2099  
Houston, Texas 77252

John M. Rockey  
U. S. Department of Energy  
Morgantown Energy Technology Center  
P. O. Box 880  
Morgantown, W. Va. 26507

## **ABSTRACT**

The purpose of this paper is to present the program objectives and non-proprietary results of the high temperature, high pressure filtration work done under the Shell/METC Cooperative Research and Development Agreement (CRADA) 93-011. The primary purpose of this CRADA was to collect data relevant to the design and operation of dry particulate solids filters employing rigid ceramic (silicon carbide) filter elements in a gasifying environment at conditions of commercial interest; e.g., temperatures up to 1100 °F and system pressures between 300 and 350 psia. Shell provided the ceramic filter elements and evaluated the exposed filter elements. METC installed the filter elements and operated their 10" Fluid Bed Gasification and Cleanup facility as required for their Hot Gas Clean-up Test Program. Filter elements were removed from service after approximately 254, 525 and 868 hours of on-line operation. The exposed filter elements were analyzed and compared to an unexposed element with respect to changes in physical property.

## **INTRODUCTION**

Coal is an abundant fuel which has been used for the generation of power. Coal combustion or gasification converts the chemical energy of this fuel into power via the Rankine cycle or the combination of the Brayton and the Rankine cycle. The reality of coal combustion or coal gasification is that its intermediate products are dirty and pollute the air, water and the solids by-products. Cleaning up these intermediate products is necessary, complex and costly.

Coal combustion as practiced always involves reducing particulate emissions and sulfur oxide emissions. Improved emissions to the atmosphere means removing "all" of the particulates and/or removing "most" (greater than 95%) of the sulfur oxides. Added to this cleanup is removal or avoidance of nitrogen oxide formation, halide removal, and mercury removal. In coal gasification, sulfur is easily converted to elemental sulfur; particulates are removed to less than .01% wt.; and nitrogen compounds are converted to basic nitrogen or must be reduced by selective catalytic reduction. Halides, alkali, trace elements and mercury are removed by solution or absorption to extremely low levels.

Integrated coal gasification (IGCC) is being demonstrated in various forms at locations around the world. Removal of contaminants to very low levels has been practiced in "cold gas cleanup" unit operations (usually at ambient to moderate process temperatures). Cold gas cleanup has been practiced in such gasification technologies developed by Destec, Prenflo, Texaco and Shell. Cold gas cleanup equipment and operations are not very costly compared to other process steps such as high temperature heat transfer equipment. There remains the desirability of dry gas cleanup technology development at high to moderate temperatures to improve thermal efficiency and, hopefully, reduce capital and operating costs.

The objective of dry gas cleanup is to keep the syngas dry, the solids dry, and reduce solids/water contact and thus avoid potential leaching or hazardous waste generation. It is always desirable to reduce water effluent generation and contamination and reduce water cleanup costs. (It must be noted that coal gasification is at least one to two orders of magnitude cleaner than coal combustion.)

Shell Oil and Shell Internationale (SIPM) demonstrated and reported on the success of clay bonded silicon carbide porous ceramic candles in dry particulate service in 1989 to 1991. The 4175-hour demonstration of these porous ceramic filter elements in the reducing atmosphere of the Shell entrained bed gasifier showed that ceramic candle filters could be used to effectively remove particulate solids at 400 to 500°F and 350 to 450 psia. At these conditions, particulate removal exceeded 99.5 -99.95% weight on a particulate solids basis or 99.99% on a gas mass flow rate basis. The average inlet particulate loading, depending upon the process configuration, was in the range of 2-20 g/Nm<sup>3</sup> or 150-1500 lb/hr in a 60,000-65,000 lb/hr gas stream.

Shell Oil contracted with Westinghouse Science and Technology Center to evaluate the physical structure and chemical composition of the new and used filter elements. Results from this evaluation showed after 4175 hours of operation that the clay bonded silicon carbide filter elements maintained their physical integrity in low temperature (< 500 °F) gasification conditions [1]. There were, however, some microstructural changes that might affect the ultimate service life of the material. Although there were no signs of pore plugging, there was evidence that submicron particles have an affinity for adhering along the pore cavity binder surface.

Filter system design variations were studied and resulted in the construction of a single, large vessel capable of processing the equivalent of 1400 MMSCFD of syngas at the SEP Buggenum Plant in Holland,

The Department of Energy has developed a mechanism in which an industrial partner can cooperate with the Morgantown Energy Technical Center, and similar centers, in research and development of materials, catalysts, technology, and demonstration for use in a commercial venture. These CRADAs (Cooperative Research and Development Agreements) are designed to effectively transfer technology developed through government funding to industry, and to encourage industrial participation in federal programs.

In 1993, Shell Oil joined with the Department of Energy Morgantown Energy Technical Center (METC) in a cooperative research and development agreement (CRADA) to test ceramic candles at high temperature (1000 °F) in a reducing atmosphere, high pressure, fluidized bed gasifier. The purpose of these tests was to identify the feasibility of ceramic candle filtration in syngas service and add to the overall knowledge of high temperature solids filtration.

## **HIGH TEMPERATURE HIGH PRESSURE FILTRATION**

### Objectives

The purpose of this effort is to collect process data relevant to the design and operation of dry particulate solids filters employing rigid ceramic filter elements in a gasifying (reducing) environment at temperatures between 1,000 and 1,100 °F, system pressures between 300 and 350 psia, filter pressure differentials between 1 and 10 psig, filter superficial face velocities between 5 and 10 fpm, and solids loadings in the range of 2-30 g/Nm<sup>3</sup> ( $1.25 \times 10^{-4}$  -  $18.75 \times 10^{-4}$  lbs/ft<sup>3</sup>).

### Experimental

In conjunction with shakedown, operation, and desulfurization testing at the Morgantown Energy Technology Center (METC) 10" Fluid Bed Gasification and Cleanup facility, a series of tests was completed in cooperation with Shell Synthetic Fuels Incorporated to obtain data relevant to the design and operation of dry particulate solids filters.

Shell Synthetic Fuels Incorporated provided 60 mm O.D. x 40 mm I.D. x 0.5 m long silicon carbide Industrial Filter and Pump (IFP) LayCer® 70/3 candles for use in filtering coal gas from the METC gasifier. METC installed the filters in a vessel existing in the DOE/METC cleanup facility and provided process data in exchange for ceramic filter characterization. Details of the cooperative research and development agreement (CRADA) are found in CRADA #93-011.

Seven gasifier runs were conducted over an 18 month period using five different feed stocks, as shown in Table 1, to accumulate 868 hours of operation. During this time, 3 filters were used two at a time (see Table 2) to give individual candle usage of 254, 525, and 868, respectively. During one 89-hour test, one LayCer 70/3 candle was in-line with a 3M ceramic composite filter. The face velocity through the candles was maintained nominally at 2.5 ft/min throughout the testing. This velocity is lower than the 5-10 fpm stated in the objective because going to 5 fpm would mean that only one filter element could be tested at a time.

Limiting testing to one element at a time would have limited the amount of information that could be obtained over a given run length and increased the risk of gaining no information if something should happen to the one element before the test could be completed and the material analyzed. Thus, two filter elements were always in service at any given time. Average operating conditions are given in Table 3. The blowback cycle for the filters was approximately once per hour for 100-200 msec duration. A typical analysis of the gas to the filter is given in Table 4.

## Results

Proximate, Ultimate, Ash Mineral and Trace Metals for typical fly ash samples are given in Table 5, and Coulter Counter particle size analyses are given in Table 6.

Shell Oil again contracted with Westinghouse Science and Technology Center to evaluate the physical structure and chemical composition of the new and used filter elements. Figure 1 shows a scanning electron microscope photograph of a cross-section of an "as-manufactured" IFP LayCer 70/3 clay bonded silicon carbide filter element. The fine outer membrane can be seen on the far left side of the photograph. Dirty gas would flow from the left or membrane side to the right or coarse substrate side. Figures 2, 3 and 4 show photographs taken at similar (NOT identical magnifications) after 254, 525 and 868 hours of filtration service in synthesis gas from the METC MCGR 10" gasifier.

A thin layer of char remains on the outer surface (left side of the photo). Although there is some penetration of fine particles through the barrier membrane, there is no sign of filling or blocking of the coarser silicon carbide substrate. Higher magnification photographs indicate that some phase changes (i.e., crystallization) occurred along the surface of the residual binder phase that coats the silicon carbide grains in the membrane of the filter element. Scanning electron microscopy/energy dispersive x-ray analysis (SEM/EDAX) indicates that the crystal formation may have resulted from oxidation of the surface of the silicon carbide grain. This crystallization is thought to be the cause of the tensile strength loss as indicated by the room temperature and high temperature C-ring tension and compression tests shown in Figure 6. From these figures it appears that the residual strength of the matrix may have plateaued. Thus, the LayCer 70/3 filter elements appear to be approaching their "conditioned" strength.

Figure 5 shows the inside diameter of the filter element exposed for 868 hours. There is negligible penetration of fine particles. Although observed, changes in the morphology, however, were limited to the binder ligaments that bind two grains together.

## **SUMMARY/CONCLUSIONS**

The results of 868 hours of testing at 1000 °F can be summarized as follows: 1) there were no broken clay bonded silicon carbide filter elements, 2) some fine particles penetrated the outer porous membrane, 3) there were no signs of blinding of pores, 4) C-ring tensile and compression strength tests run at room temperature and 1000 °F indicate that the clay bonded silicon carbide matrix lost some strength but appears to be approaching its "conditioned" strength.

These results were expected and are consistent with similar observations made after 4175 hours of exposure with Schumacher candle filters and 821 hours exposure with Industrial Pump and Filter (IFP) candle filters at 500 °F at the Shell Deer Park Demonstration Plant (SCGP-1) between November of 1989 and April 1991. Specifically, there was no strength loss of C-ring sections from the conditioned candle filters when they were tested at room temperature and 500 °F, but C-ring sections of the same conditioned elements did show some strength loss when tested at 1000 °F.

# TABLES

| TABLE 1a<br>FILTER TEST FEED COAL CHARACTERIZATION       |          |          |          |         |             |
|----------------------------------------------------------|----------|----------|----------|---------|-------------|
| COAL TYPE                                                | MONT. #5 | MONT. #6 | MONT. #7 | ILL. #6 | COKE BREEZE |
| PROXIMATE ANALYSIS<br>(% wt. ON AS RECEIVED COAL)        |          |          |          |         |             |
| HMO                                                      | 4.19     | 7.12     | 3.46     | 3.38    | 0.46        |
| ASH                                                      | 8.94     | 10.24    | 12.79    | 8.26    | 9.72        |
| VOLATILES                                                | 38.32    | 36.85    | 36.18    | 26.34   | 3.28        |
| FIXED CARBON (BY DIFFERENCE)                             | 48.55    | 45.79    | 47.57    | 62.02   | 86.54       |
| HEATING VALUE (BTU/lb)                                   | 10992    | 10901    | 11126    | 12294   | 12316       |
| SULFUR (%)                                               | 0.56     | 1.24     | 2.19     | 1.98    | 0.78        |
| ALKALI AS SODIUM OXIDE                                   | 0.07     | 0.1      | 0.11     | N/A     | N/A         |
| ULTIMATE ANALYSIS<br>(% wt. ON AS RECEIVED ASH)          |          |          |          |         |             |
| HMO                                                      | 4.19     | 7.12     | 3.46     | 3.38    | 0.46        |
| CARBON                                                   | 65.85    | 62.43    | 63.83    | 73.39   | 85.84       |
| HYDROGEN                                                 | 4.55     | 4.36     | 4.22     | 3.6     | 1.22        |
| NITROGEN                                                 | 0.99     | 1.01     | 1.01     | 1.26    | 1.01        |
| SULFUR                                                   | 0.56     | 1.24     | 2.19     | 1.98    | 0.78        |
| CHLORINE                                                 | 0.0      | N/A      | N/A      | N/A     | N/A         |
| ASH                                                      | 8.94     | 10.24    | 12.79    | 8.26    | 9.72        |
| OXYGEN (BY DIFFERENCE)                                   | 14.92    | 13.6     | 12.5     | 8.13    | 0.97        |
| ASH MINERAL ANALYSIS<br>(% wt. ON IGNITED ASH BASIS ASH) |          |          |          |         |             |
| SiO <sub>2</sub>                                         | 39.14    | 35.16    | 23.54    | 39.1    | N/A         |
| Al <sub>2</sub> O <sub>3</sub>                           | 19.24    | 12.85    | 14.49    | 779     | N/A         |
| Fe <sub>2</sub> O <sub>3</sub>                           | 3.77     | 12.88    | 23.02    | 1.74    | N/A         |
| CaO                                                      | 15.79    | 13.72    | 14.92    | 3.14    | N/A         |
| MgO                                                      | 4.21     | 3.96     | 3.71     | 0.92    | N/A         |
| TiO <sub>2</sub>                                         | 0.89     | 1.03     | 0.54     | 0.24    | N/A         |
| K <sub>2</sub> O                                         | 0.42     | 0.3      | 0.09     | 1.5     | N/A         |
| Na <sub>2</sub> O                                        | 0.52     | 0.74     | 0.8      | N/A     | N/A         |
| P <sub>2</sub> O <sub>5</sub>                            | 0.43     | 0.16     | 0.29     | 0.41    | N/A         |
| SO <sub>3</sub>                                          | 14.85    | 18.27    | 16.47    | N/A     | N/A         |
| SrO                                                      | 0.40     | 0.5      | 0.28     | N/A     | N/A         |
| BaO                                                      | 0.13     | 0.14     | 1.01     | N/A     | N/A         |
| MnO                                                      | 0.21     | 0.06     | 0.13     | N/A     | N/A         |
| undetermined                                             | 0        | 0        | 0        | NA      | N/A         |
| TYPE (lignitic, etc.)                                    | LIGNITIC | N/A      | N/A      | N/A     | N/A         |
| SILICA VALUE                                             | 62.22    | N/A      | N/A      | N/A     | N/A         |
| BASE:ACID RATIO                                          | 0.42     | N/A      | N/A      | N/A     | N/A         |
| FOULING INDEX                                            | 0.52     | N/A      | N/A      | N/A     | N/A         |
| T <sub>20</sub> TEMPERATURE (°F)                         | 2391     | N/A      | N/A      | N/A     | N/A         |

| TABLE 1b<br>FILTER TEST FEED COAL CHARACTERIZATION |          |          |          |         |             |
|----------------------------------------------------|----------|----------|----------|---------|-------------|
| TRACE ELEMENT (ppm):                               | MONT. #5 | MONT. #6 | MONT. #7 | ILL. #6 | COKE BREEZE |
| ANTIMONY, (Sb)                                     | <4       |          |          | N/A     | N/A         |
| ARSENIC, (As)                                      | <1       |          |          | N/A     | N/A         |
| BERYLLIUM, (Be)                                    | 0.2      | 0.6      | <0.3     | N/A     | N/A         |
| BORON, (B)                                         | 180      |          |          | N/A     | N/A         |
| CADMIUM, (Cd)                                      | <0.2     | <0.3     | <0.3     | N/A     | N/A         |
| CHROMIUM, (Cr)                                     | 2        | 6        | 1        | N/A     | N/A         |
| COBALT, (Co)                                       | <1       |          |          | N/A     | N/A         |
| COPPER, (Cu)                                       | 7        | 10       | 8        | N/A     | N/A         |
| FLUORIDE, (F)                                      | 30       |          |          | N/A     | N/A         |
| LEAD, (Pb)                                         | 6        | 12       |          | N/A     | N/A         |
| MANGANESE, (Mn)                                    |          | 36       | 120      | N/A     | N/A         |
| MERCURY, (Hg)                                      | 0.08     |          |          | N/A     | N/A         |
| MOLYBDENUM, (Mo)                                   | <3       |          |          | N/A     | N/A         |
| NICKEL, (Ni)                                       | <1       | 4        | <1       | N/A     | N/A         |
| SELENIUM, (Se)                                     | <1       |          |          | N/A     | N/A         |
| SILVER, (Ag)                                       | <0.2     |          |          | N/A     | N/A         |
| THALIUM, (Tl)                                      | <1       |          |          | N/A     | N/A         |
| TIN, (Sn)                                          | <4       |          |          | N/A     | N/A         |
| URANIUM, (U)                                       | 1.2      |          |          | N/A     | N/A         |
| VANADIUM, (V)                                      | 8        | 12       | 7        | N/A     | N/A         |
| ZINC, (Zn)                                         | <1       | 20       | 3        | N/A     | N/A         |
| ZIRCONIUM, (Zr)                                    | 17       |          |          | N/A     | N/A         |

| TABLE 2<br>FILTER TEST OVERVIEW |                 |                 |                                                           |            |
|---------------------------------|-----------------|-----------------|-----------------------------------------------------------|------------|
| CAMPAIGN NUMBER                 | OPERATING HOURS | FILTER ELEMENTS | FEED COAL                                                 | ASH SAMPLE |
| 1                               | 108             | C34 C35         | MONTANA #5                                                | 93MGC04    |
| 2                               | 145             | C34, C35        | MONTANA #6                                                | 93MGC05    |
| 3                               | 130             | C34, C36        | MONTANA #6                                                | 93MGC06    |
| 4                               | 119             | C34, C36        | MONTANA #6                                                | 94MGC07    |
| 5                               | 191             | C34, C36        | MONTANA #6                                                | 94MGC08    |
| 6                               | 85              | C34, C36        | MONTANA #6,<br>MONTANA #7,<br>COKE BREEZE,<br>ILLINOIS #6 | 94MGC09    |
| 7                               | 89              | C34, C36        | MONTANA #6,<br>MONTANA #7                                 | 94MGC10    |

| TABLE 3<br>AVERAGE PROCESS CONDITIONS DURING FILTER TESTS |                           |                           |                           |                           |                           |                           |                           |
|-----------------------------------------------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|
|                                                           | CAMP.<br>1<br>93MGC<br>04 | CAMP.<br>2<br>93MGC<br>05 | CAMP.<br>3<br>94MGC<br>06 | CAMP.<br>4<br>94MGC<br>07 | CAMP.<br>5<br>94MGC<br>08 | CAMP.<br>6<br>94MGC<br>09 | CAMP.<br>7<br>94MGC<br>10 |
| PRESSURE IN (psia)                                        | 308.4                     | 308.5                     | 313.2                     | 305.2                     | 304.7                     | 306.7                     | 304.7                     |
| BLOWBACK PRESSURE (psia)                                  | 429.3                     | 432.7                     | 502.0                     | 480.2                     | 467.7                     | 471.7                     | 464.7                     |
| DIFFERENTIAL PRESSURE (psid)                              | 6.3                       | 5.2                       | 7.5                       | 3.5                       | 3.22                      | 4.1                       | 6.34                      |
| TEMPERATURE IN (°F)                                       | 1017                      | 1066                      | 1089                      | 1089                      | 926                       | 1128                      | 1053                      |
| TEMPERATURE OUT (°F)                                      | 1027                      | 1126                      | 1106                      | 1047                      | 1043                      | 1074                      | 1024                      |
| GAS MASS FLOW RATE (lb/hr)                                | 121                       | 120                       | 127                       | 118                       | 134                       | 138                       | 131                       |
| GAS VOL. FLOW RATE (scfm/acfm)                            | 28.8/4.4                  | 28.5/4.5                  | 30.3/4.8                  | 28.1/4.5                  | 32.0/4.6                  | 33.0/5.5                  | 31.2/4.95                 |
| AVE. SOLIDS FLOW RATE IN<br>(LB/HR)                       | 0.035                     | 0.033                     | 0.018                     | 0.03                      | 0.04                      | 0.03                      | 0.03                      |

| TABLE 4<br>TYPICAL ANALYSIS OF GAS TO FILTER |       |
|----------------------------------------------|-------|
| COMPONENT                                    | MOL % |
| CO                                           | 10    |
| CO <sub>2</sub>                              | 11    |
| H <sub>2</sub>                               | 15    |
| H <sub>2</sub> O                             | 12    |
| N <sub>2</sub>                               | 49    |
| CH <sub>4</sub>                              | 2.4   |
| H <sub>2</sub> S                             | 0.3   |
| Ar                                           | 0.3   |

**TABLE 5a  
FILTER ASH CHARACTERIZATION**

| SAMPLE NUMBER                                         | 93MGC05A | 93MGC05B | 93MGC06 | 94MGC07 | 94MGC08 | 94MGC09 | 94MGC10 |
|-------------------------------------------------------|----------|----------|---------|---------|---------|---------|---------|
| PROXIMATE ANALYSIS (% wt. ON AS RECEIVED COAL)        |          |          |         |         |         |         |         |
| HMO                                                   | 1.54     | 1.42     | 1.31    | 1.57    | 0.89    | 1.04    | 1.05    |
| ASH                                                   | 61.96    | 62.8     | 64.09   | 62.53   | 62.89   | 60.73   | 62.09   |
| VOLATILES                                             | 4.8      | 2.91     | 3.77    | 4.35    | 3.4     | 3.69    | 2.36    |
| FIXED CARBON (BY DIFFERENCE)                          | 31.7     | 32.87    | 30.83   | 31.55   | 32.82   | 3.54    | 34.5    |
| HEATING VALUE (BTU/lb)                                | 4968     | 4899     | 4976    | 4843    | 5081    | 5310    | 5308    |
| SULFUR (%)                                            | 0.6      | 0.6      | 1.05    | 0.77    | 0.41    | 0.28    | 0.3     |
| ALKALI AS SODIUM OXIDE                                | 1.21     | 1.22     | 1.84    | 1.32    | 1.15    | 0.31    | 0.31    |
| ULTIMATE ANALYSIS (% wt. ON AS RECEIVED ASH)          |          |          |         |         |         |         |         |
| HMO                                                   | 1.54     | 1.42     | 1.31    | 1.57    | 0.89    | 1.04    | 1.05    |
| CARBON                                                | 34.42    | 33.86    | 32.86   | 34.18   | 35.02   | 37.13   | 35.75   |
| HYDROGEN                                              | 0.36     | 0.39     | 0.31    | 0.37    | 0.25    | 0.2     | 0.31    |
| NITROGEN                                              | 0.39     | 0.33     | 0.33    | 0.3     | 0.25    | 0.28    | 0.27    |
| SULFUR                                                | 0.6      | 0.6      | 1.04    | 0.77    | 0.41    | 0.28    | 0.3     |
| CHLORINE                                              | N/A      | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |
| ASH                                                   | 61.96    | 62.8     | 64.94   | 62.53   | 62.89   | 60.73   | 62.09   |
| OXYGEN (BY DIFFERENCE)                                | 0.73     | 0.6      | 0.06    | 0.28    | 0.29    | 0.34    | 0.23    |
| ASH MINERAL ANALYSIS (% wt. ON IGNITED ASH BASIS ASH) |          |          |         |         |         |         |         |
| SiO <sub>2</sub>                                      | 41.19    | 40.65    | 39.85   | 42.26   | 41.1    | 33.39   | 35.8    |
| Al <sub>2</sub> O <sub>3</sub>                        | 17.74    | 17.71    | 21.99   | 18.12   | 18.73   | 17.04   | 16.68   |
| Fe <sub>2</sub> O <sub>3</sub>                        | 4.93     | 4.84     | 4.44    | 5.49    | 4.32    | 3.59    | 3.35    |
| CaO                                                   | 22.17    | 22.44    | 17.41   | 20.04   | 22.11   | 29.03   | 28.48   |
| MgO                                                   | 7.14     | 7.25     | 5.67    | 6.53    | 7.11    | 9.93    | 9.89    |
| TiO <sub>2</sub>                                      | 1.71     | 1.73     | 1.89    | 1.75    | 1.7     | 1.79    | 1.74    |
| K <sub>2</sub> O                                      | 0.38     | 0.36     | 0.61    | 0.44    | 0.38    | 0.07    | 0.11    |
| Na <sub>2</sub> O                                     | 1.7      | 1.7      | 2.47    | 1.82    | 1.56    | 0.47    | 0.42    |
| P <sub>2</sub> O <sub>5</sub>                         | 0.13     | 0.13     | 0.07    | 0.1     | 0.14    | 0.58    | 0.5     |
| SO <sub>3</sub>                                       | 0.13     | 2.19     | 2.72    | 2.5     | 1.88    | 1.57    | 1.37    |
| SrO                                                   | 0.78     | 0.82     | 0.66    | 0.72    | 0.78    | 1.21    | 0.18    |
| BaO                                                   | 0.08     | 0.09     | 0       | 0       | 0.11    | 0.27    | 0.26    |
| MnO                                                   | 0.1      | 0.09     | 0.07    | 0.1     | 0.09    | 0.22    | 0.22    |
| undetermined                                          | 0        | 0        | 0       | 0       | 0       | 0       | 0       |
| TYPE (lignitic, etc.)                                 | LIGNITIC | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |
| SILICA VALUE                                          | 54.61    | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |
| BASE:ACID RATIO                                       | 0.6      | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |
| FOULING INDEX                                         | 1.7      | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |
| T <sub>250</sub> TEMPERATURE (°F)                     | 2247     | N/A      | N/A     | N/A     | N/A     | N/A     | N/A     |

| TABLE 5b<br>FILTER ASH CHARACTERIZATION |             |             |             |             |             |             |             |
|-----------------------------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| TRACE ELEMENT<br>(ppm):                 | 93MGC<br>04 | 93MGC<br>05 | 93MGC<br>06 | 94MGC<br>07 | 94MGC<br>08 | 94MGC<br>09 | 94MGC<br>10 |
| BERYLLIUM, (Be)                         | 8.2         | 19          | 11          | 14          | 17          | 7.9         | 6.6         |
| CADMIUM, (Cd)                           | <2          | <2          | <2          | <2          | <2          | <2          | <2          |
| CHROMIUM, (Cr)                          | 84          | 100         | 230         | 120         | 87          | 82          | 84          |
| COPPER, (Cu)                            | 48          | 67          | 81          | 79          | 29          | 21          | 380         |
| LEAD, (Pb)                              | 39          | 31          | 53          | 81          | 32          | 14          | 77          |
| MANGANESE, (Mn)                         | 420         | 460         | 360         | 430         | 410         | 1100        | 1000        |
| NICKEL, (Ni)                            | 130         | 310         | 760         | 330         | 120         | 80          | 180         |
| VANADIUM, (V)                           | 130         | 140         | 110         | 140         | 140         | 160         | 130         |
| ZINC, (Zn)                              | 130         | 350         | 5800        | 1500        | 90          | 1800        | 2700        |

| TABLE 6<br>PARTICLE SIZE DISTRIBUTION ANALYSIS OF ASHES<br>(MICRONS) |             |             |             |             |             |             |             |
|----------------------------------------------------------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| PERCENT LESS THAN                                                    | 93MGC<br>05 | 93MGC<br>05 | 94MGC<br>06 | 94MGC<br>07 | 94MGC<br>08 | 94MGC<br>09 | 94MGC<br>10 |
| 90                                                                   | 3.089       | 2.848       | 3.768       | 3.696       | 3.714       | 3.184       | 3.133       |
| 75                                                                   | 2.655       | 2.458       | 3.207       | 3.157       | 3.193       | 2.787       | 2.737       |
| 50                                                                   | 2.167       | 2.013       | 2.625       | 2.525       | 2.661       | 2.317       | 2.308       |
| 25                                                                   | 1.689       | 1.570       | 2.035       | 1.894       | 2.074       | 1.836       | 1.852       |
| 10                                                                   | 1.282       | 1.207       | 1.536       | 1.404       | 1.534       | 1.423       | 1.443       |

#### REFERENCE:

1. J. A. Salter and J. L. Monsavoir, "SCGP-1 High Temperature Filtration Experience," Proceedings: Second EPRI Workshop on Filtration of Dusts from Coal-Derived Reducing and Combustion Gases at High Temperature, San Francisco, California, March 11-13, 1992.

# FIGURES



Figure 1 - Cross-section of "as manufactured clay bonded silicon carbide filter matrix. The fine outer surface membrane and the underlying coarse support silicon carbide grains are evident.

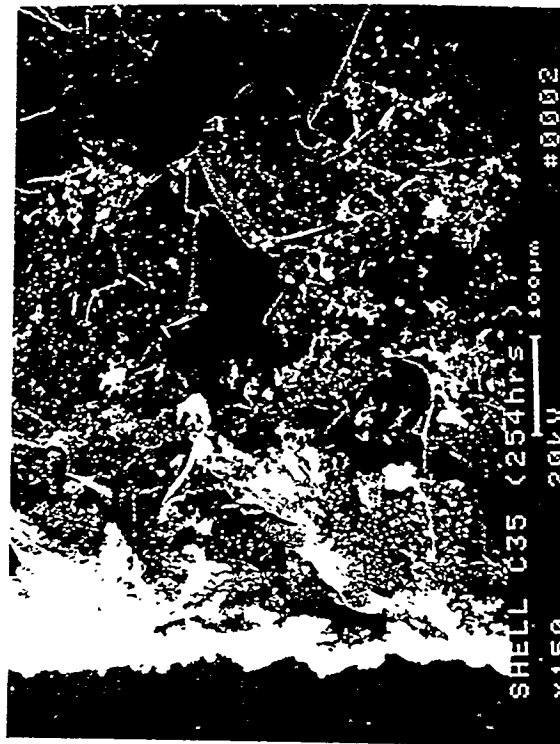
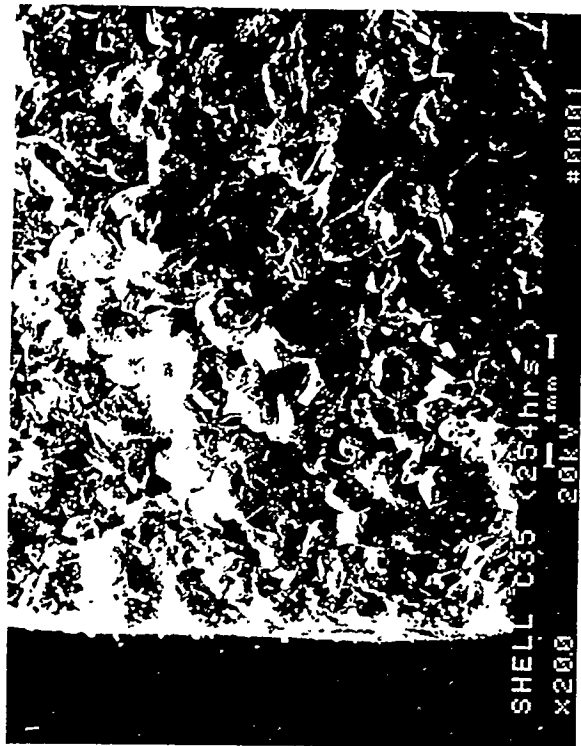


Figure 2 - Morphology of the 254 hour gasifier exposed clay bonded silicon carbide candle filter matrix.



Figure 4 - Morphology of the 868 hour gasifier exposed clay bonded silicon carbide candle filter matrix.

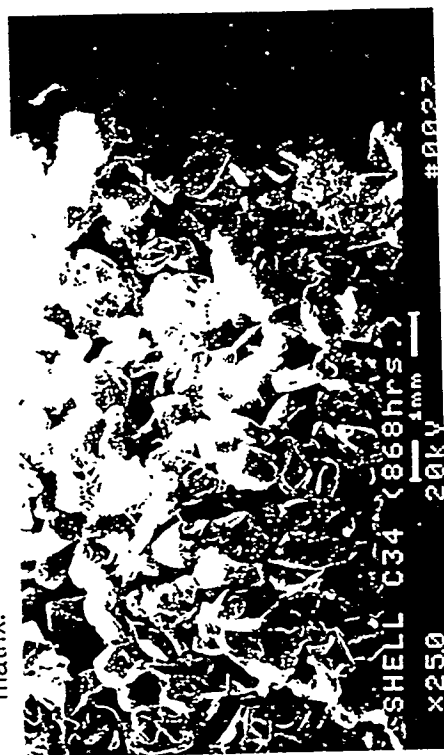


Figure 5 - Morphology of the clay bonded silicon carbide matrix along the ID of the pulse cycled surface of the 868 hour gasifier exposed candle filter.

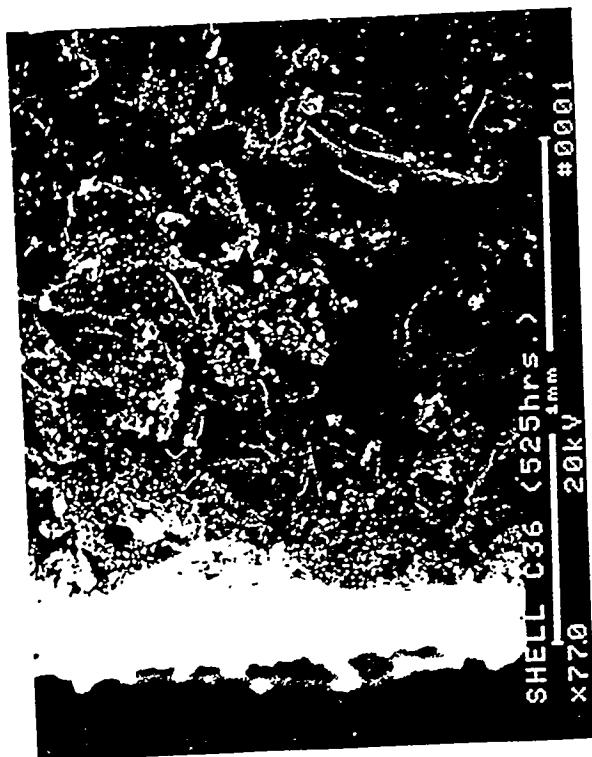


Figure 3 - Morphology of the 525 hour gasifier exposed clay bonded silicon carbide candle matrix. Char particles that were evident between the first and second grain layer in the support structure may have been a result of sample preparation.

# Shell/METC High Temperature Filtration Program C-Ring Tensile and Compression Test Results

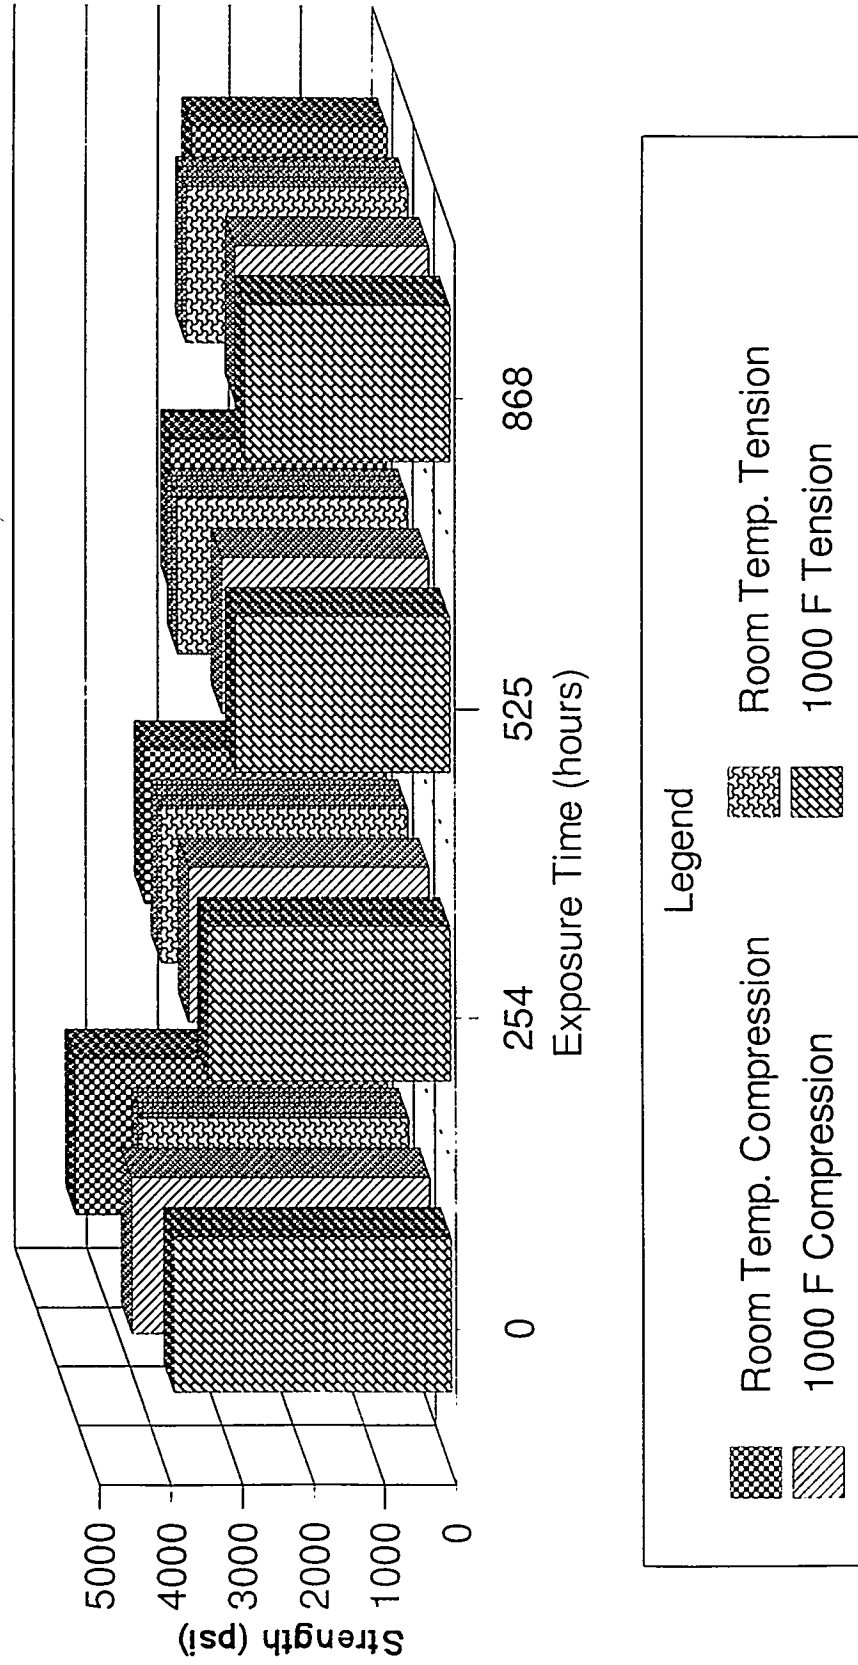


Figure 6 - C-Ring Tension and Compression Tests