

Quantitative Risk Analysis to Guide Station Design

Gabriela Bran-Anleu

Team: Chris LaFleur, Alice Muna, Brian Ehrhart, Myra Blaylock, Ethan Hecht


Sandia National Laboratories

September 11, 2018


SAND2018-4133 PE

This presentation does not contain any proprietary, confidential, or otherwise restricted information

Quantitative Risk Assessment is enabling infrastructure deployment

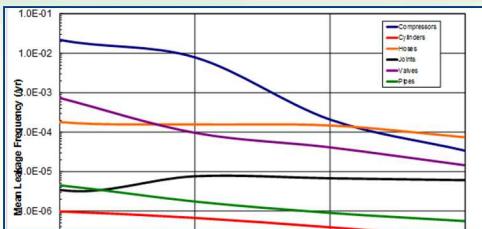


Established risk-informed processes for separation distances

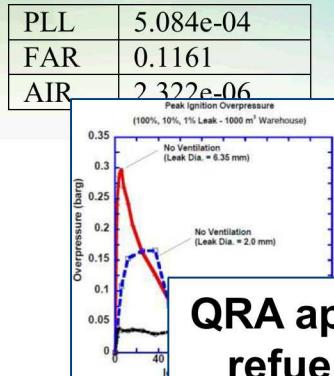

QRA applied to indoor refueling to inform code revision

Performance-based system layout demonstrated


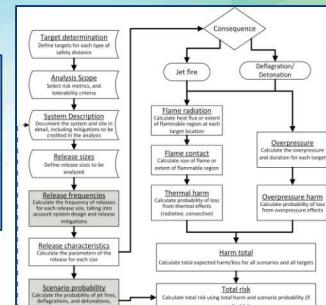


ISO TC197 WG24 incorporating QRA and behavior modeling



QRA-informed separation distances in NFPA 2


Risk assessment proposed for hydrogen systems at ICHS

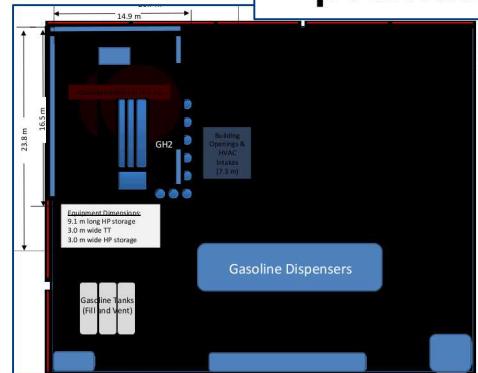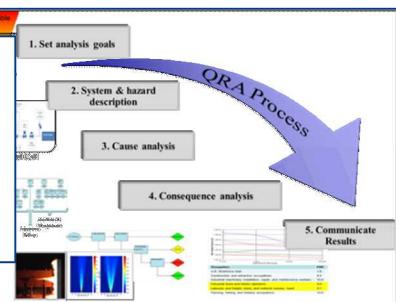

Public release of HyRAM R&D tool



Hydrogen behavior studies are at the foundation of consequence modeling capabilities

Radiative properties of H₂ flames quantified

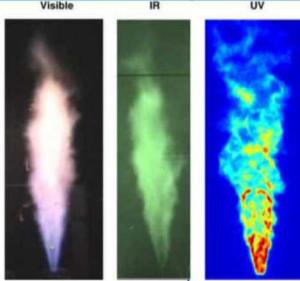

Barrier walls for risk reduction

Ignition of under-expanded H₂ jets

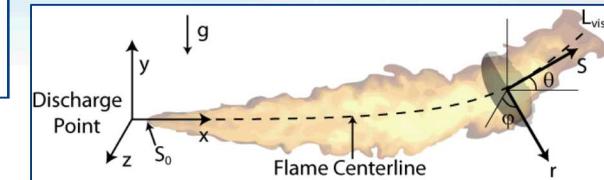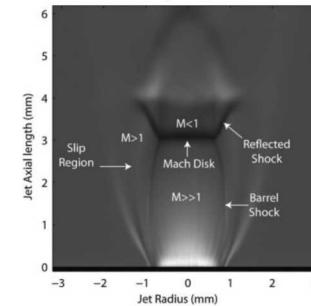

Buoyant jet flame model with multi-source radiation

2005

2007


2009

2011


2013

2015

2017




Ignition limits of turbulent H₂ flows

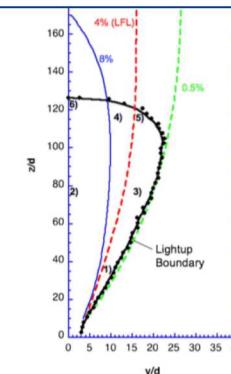


Advanced laser diagnostics applied to turbulent H₂ combustion

Experiment and simulation of indoor H₂ releases

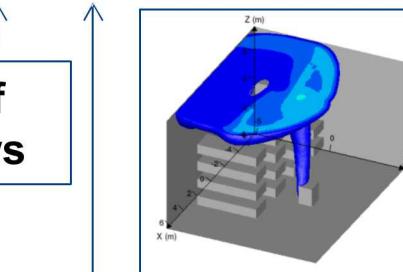


Laboratory-scale characterization of LH₂ plumes and jets

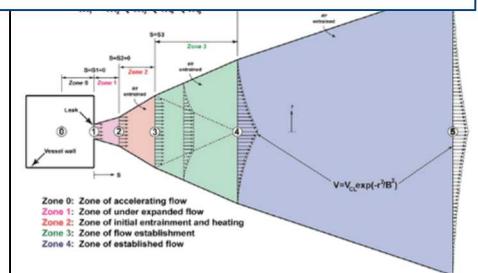

Coordinated activities to enable consistent, rigorous, and accepted safety analysis


Behavior R&D (SCS 010)

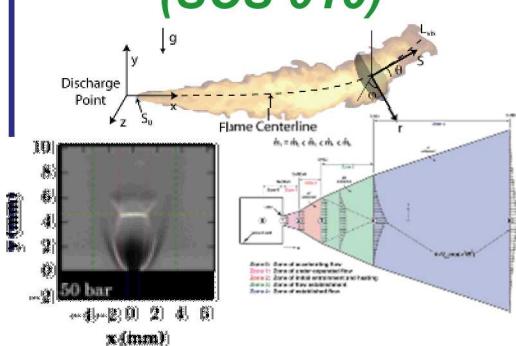

Develop and validate scientific models

to accurately predict hazards and harm from liquid releases, flames, etc.


Risk R&D (SCS 011)

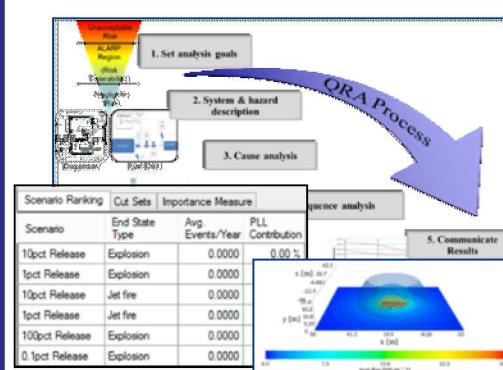

Develop integrated methods and algorithms

for enabling consistent, traceable and rigorous QRA

Application in SCS (SCS025)

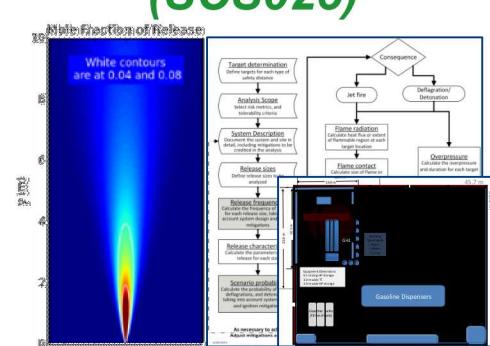


Apply QRA & behavior models to real problems




in hydrogen infrastructure and emerging technology

Developing methods, data, tools for H_2 safety & SCS

Building a Scientific Platform for




1. Set analysis goals

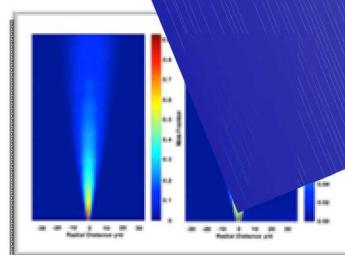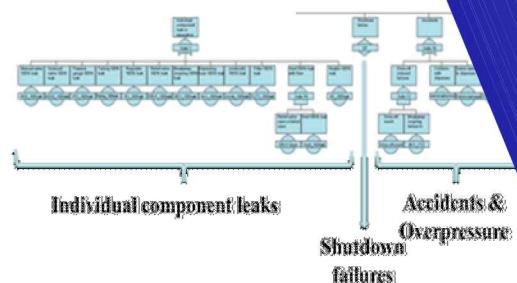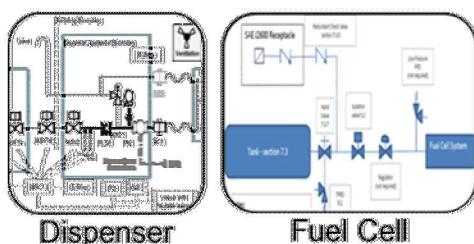

QRA Process

5. Communicate Results

Challenge: A quality QRA incorporates a large body of information from different areas

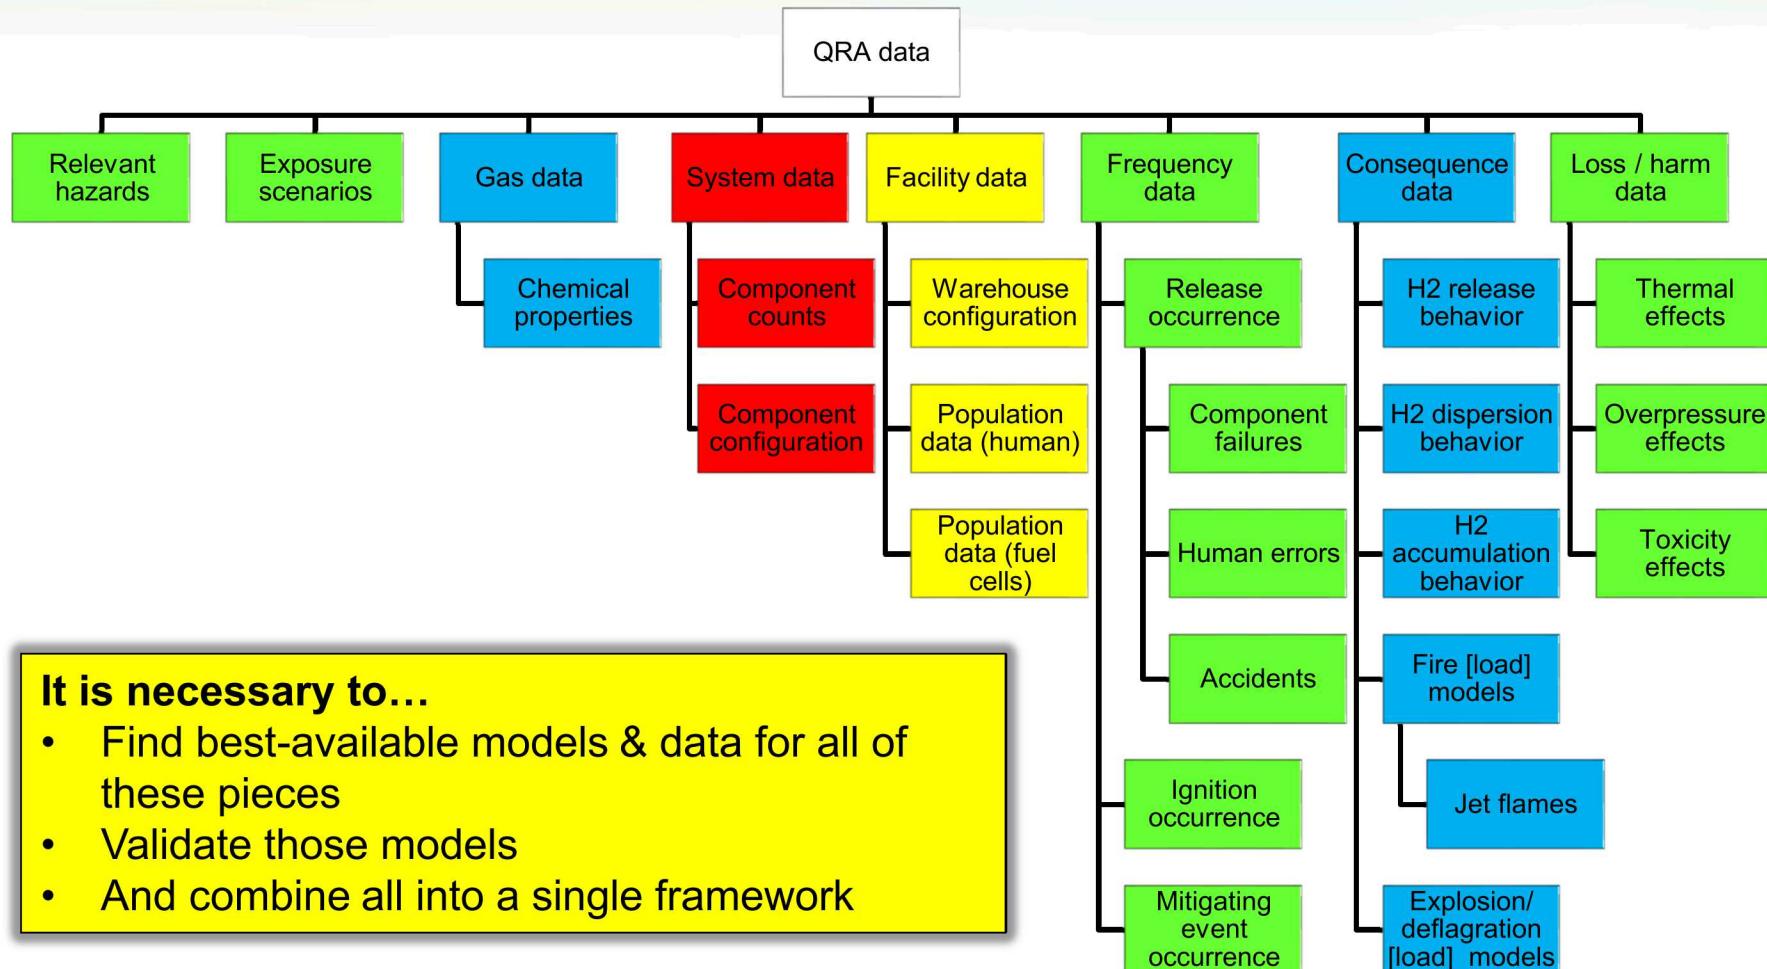


HyRAM: Making hydrogen safety science accessible through integrated tools

First-of-its-kind integration platform for state-of-the-art hydrogen safety models & data - built to put the R&D into the hands of industry safety experts

Core functionality:

- Quantitative risk assessment (QRA) methodology
- Frequency & probability data for hydrogen component failures
- Fast-running models of hydrogen gas and flame behaviors

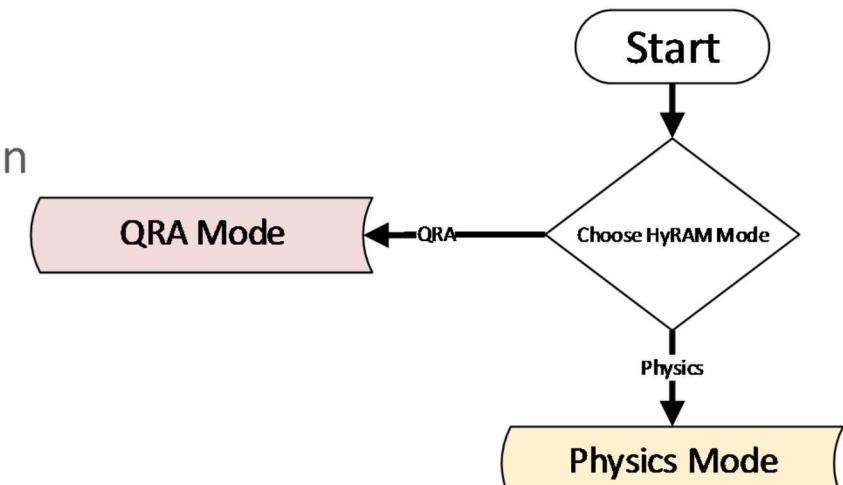

Key features:

- GUI & Mathematics Middleware
- Documented approach, models, algorithms
- Flexible and expandable framework; supported by active R&D

Current release is version 1.1.1.1341

Major Elements of HyRAM Software: QRA Mode

QRA Methodology

- Risk metrics calculations: FAR, PLL, AIR
- Scenario models & frequency
- Release frequency
- Harm models

Generic Freq. & Prob. data


- Ignition probabilities
- Component leak frequencies (9 types)

Software Language

- C# for GUI and QRA (planned conversion of QRA to Python)
- Python for Physics Modules

Documentation

- Algorithm report (SAND2017-2998)
- User guide (SAND2018-0749)

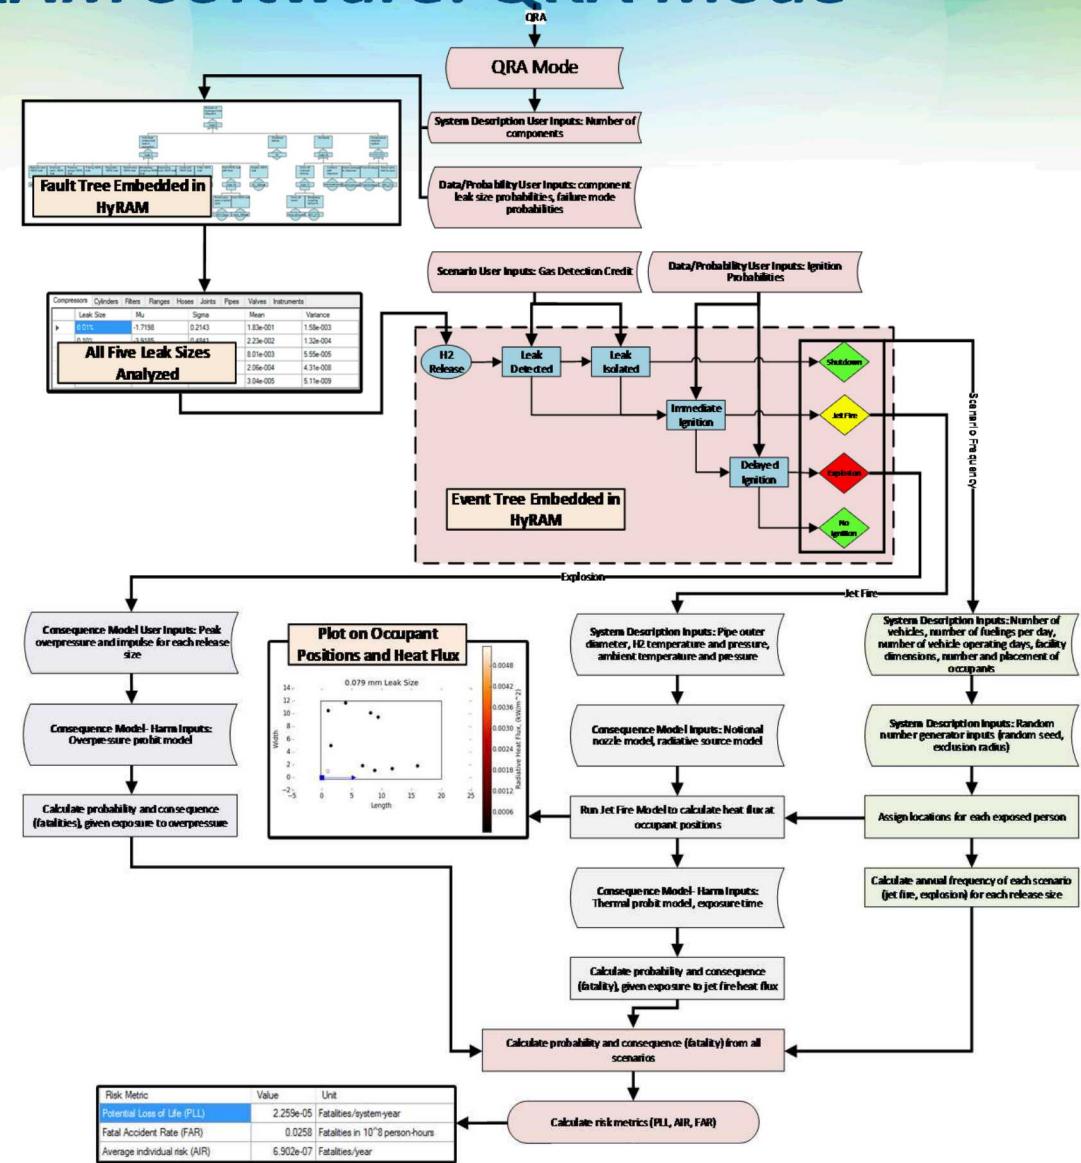

Major Elements of HyRAM Software: Physics Mode

Physics models


- Properties of Hydrogen
- Unignited releases: Orifice flow; Notional nozzles; Gas jet/plume; Accumulation in enclosures
- Ignited releases: Jet flames; overpressures in enclosures

Software Language

- Python for Modules
- C# for GUI


Documentation

- Algorithm report (SAND2017-2998)
- User guide (SAND2018-0749)

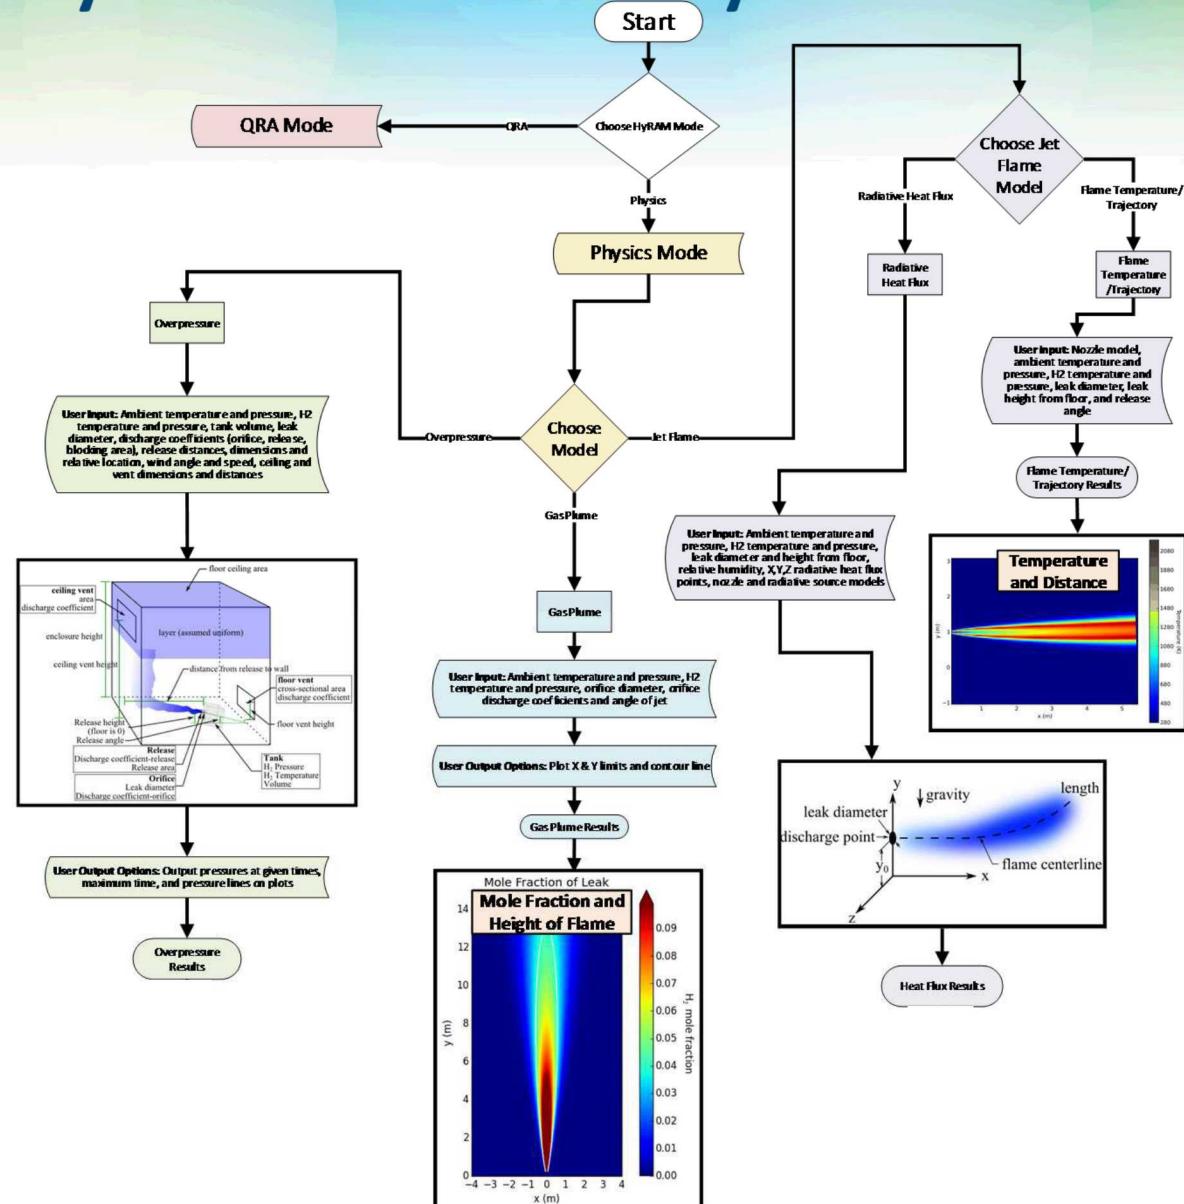

Summary

- **HyRAM is an integration platform built to enable hydrogen safety** for state-of-the-art H₂ safety models – enables consistent industry-led QRA and consequence analysis with documented, referenceable, validated models
- **Demonstrated Impact:** Enabling the deployment of refueling stations by developing science-based, risk-informed codes & standards
 - Analyses for NFPA 2 and ISO TR-19880-1
 - Benchmarked results (SAND2014-3416): Survey of proposed H2 stations show that changes to NFPA 2 gaseous separation distance requirements increased station siting options by 20%.

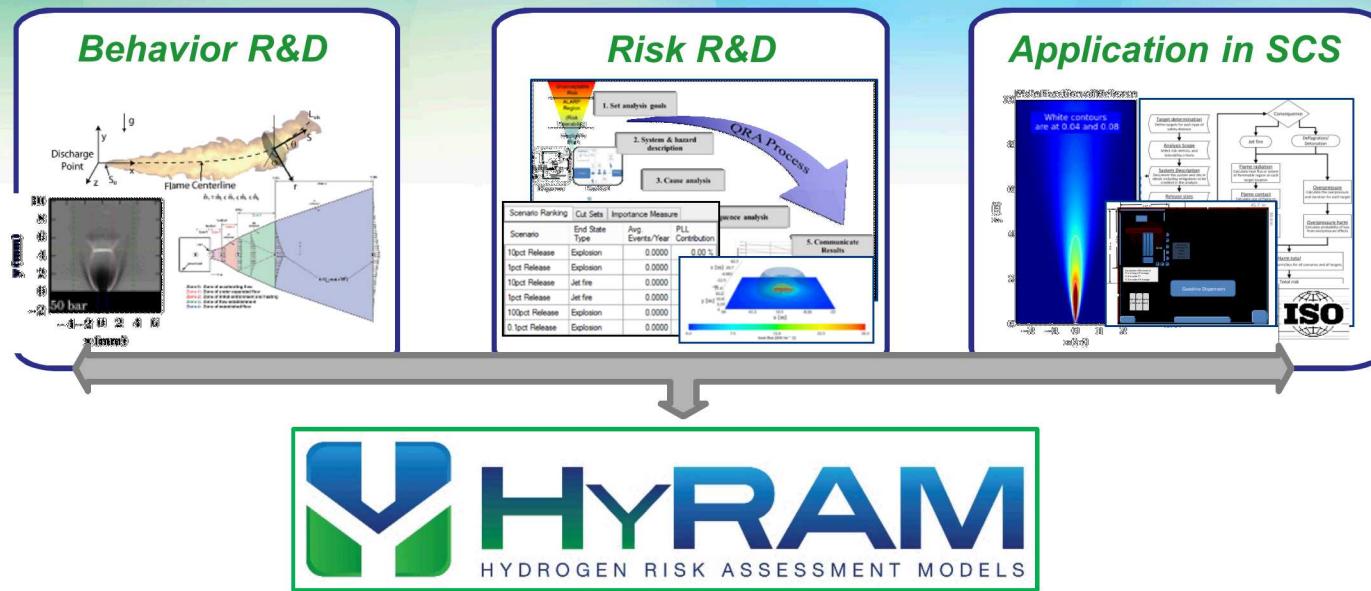

Thank you!

Gabriela Bran Anleu

Sandia National Laboratories

gabrana@sandia.gov



<https://hyram.sandia.gov>

Research supported by DOE Fuel Cell Technologies Office
(DOE EERE/FCTO)

Technical Back-Up Slides

Benefits of Reduced-Order Models

- Short run-time
- Modeling expert not required
- Useful for quantification
 - If a hydrogen leak occurs, how far away does the hazard get?
- Useful for comparisons
 - What is the effect on safety is a system size is reduced?

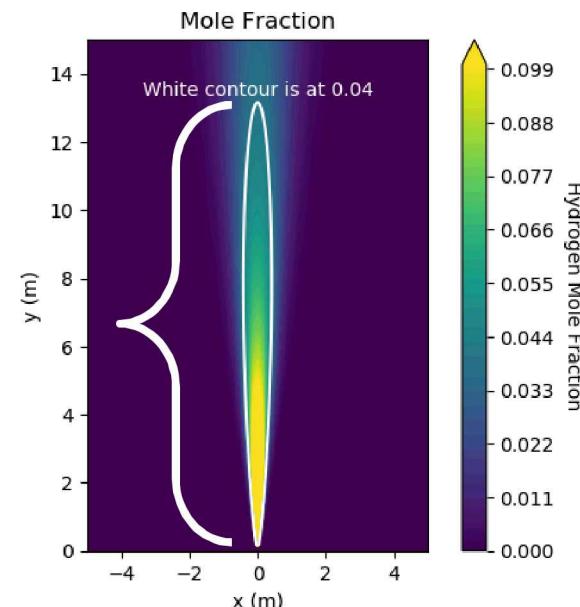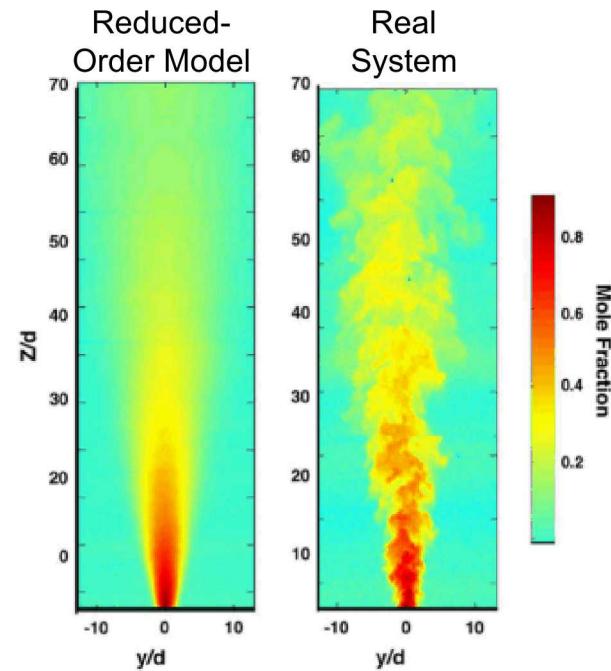


Greater Fidelity and Flexibility of QRA Models


Expand HyRAM QRA beyond fueling stations

- Customization of event and fault trees
- Perform risk assessment and calculate risk results in an efficient manner
- Applicable for new hydrogen industries **beyond fueling stations**
- Underlying physics-based analysis would remain the same

Event Sequence Diagram

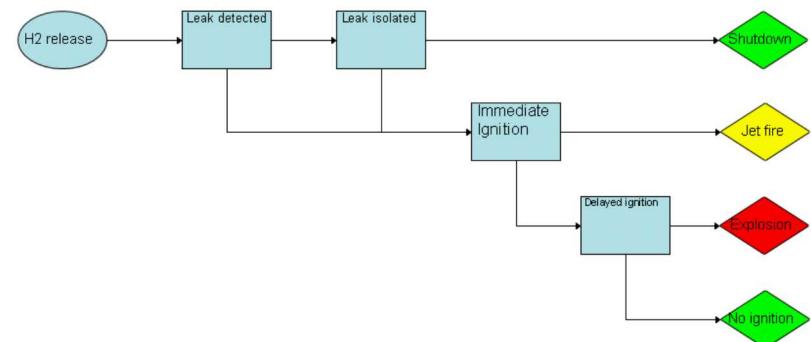

Fault Trees



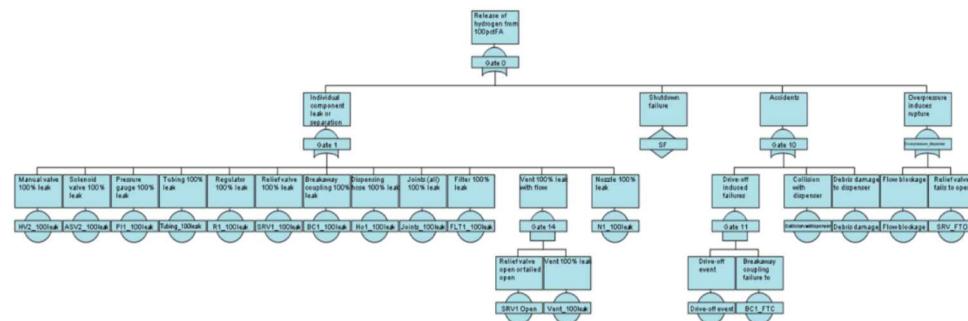


Customization of scenario will lead to broader application of HyRAM and hydrogen QRA

Laboratory-scale characterization of LH2 plumes and jets

- Validation of near-field model complete including mole fraction, temperature and velocity
- Development of diagnostic to measure full-scale cold vapor releases underway
- Development of full-scale release experiments underway


Validated LH2 release model will be used to risk-inform the revised LH2 bulk separation

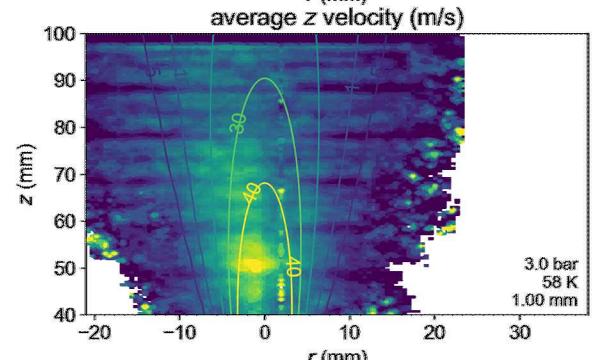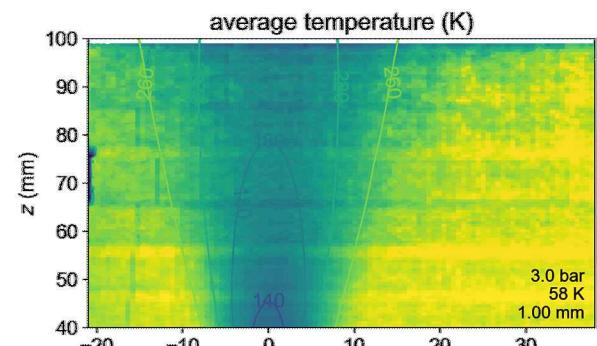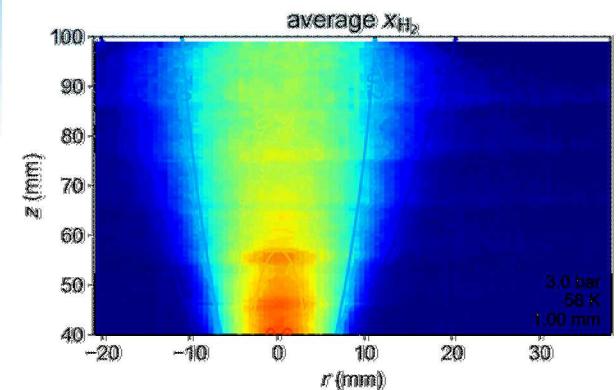

R&D provides science-based tools: Examples of *Scenario & Probability* models

Accident sequences

- Hazards considered: Thermal effects (jet fire), overpressure (explosion/deflagration)

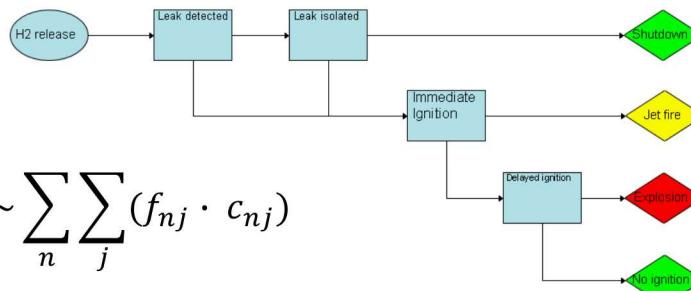

$$\text{Risk} \sim \sum_n \sum_j (f_{nj} \cdot c_{nj})$$

$$f(\text{JetFire}) = f(\text{H2release}) * (1 - \text{Pr}(\text{Detect})) * \text{Pr}(\text{IgnImmed})$$

Ignition probability


- Extrapolated from methane ignition probabilities
- Flow rate calculated using *Release Characteristics* module

Hydrogen Release Rate (kg/s)	Immediate Ignition Probability	Delayed Ignition Probability
<0.125	0.008	0.004
0.125 – 6.25	0.053	0.027
>6.25	0.23	0.12

Release frequency



- Expected annual leak freq. for each component type -- Data developed from limited H2 data combined w/ data from other industries.

$$\begin{aligned} f(\text{H2release}) &= \sum_{i=9 \text{ comps}} n_i * E(f(\text{Leak})_i) \\ &+ E(\text{Pr}(\text{accidents})) \\ &* n_{\text{demands}} \end{aligned}$$

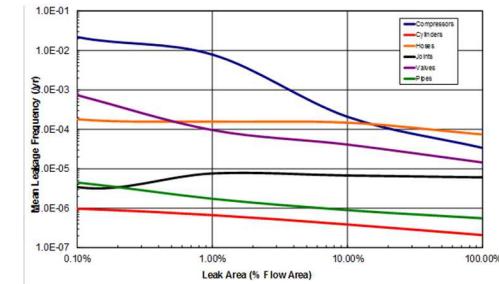

Harm models



- Probability of fatality from exposure to heat flux and overpressures – multiple options

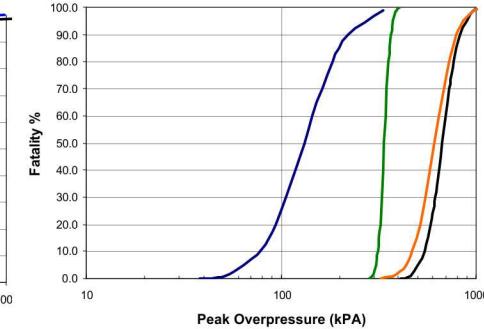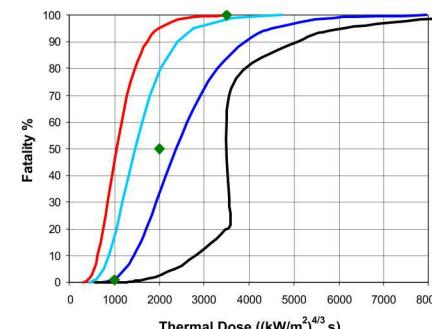

R&D provides science-based tools: Examples of *Behavior & Consequence models*

Release Characteristics

- Prediction of hydrogen jet plumes (concentration boundaries)
- Prediction of hydrogen jet flames
- Simplified models of hydrogen sources (choked flow, notional nozzles, etc)

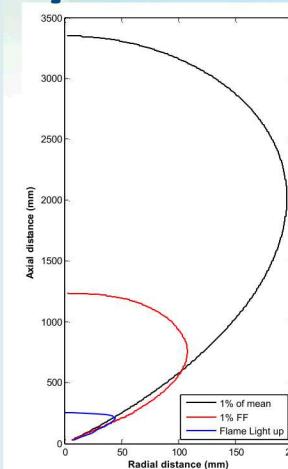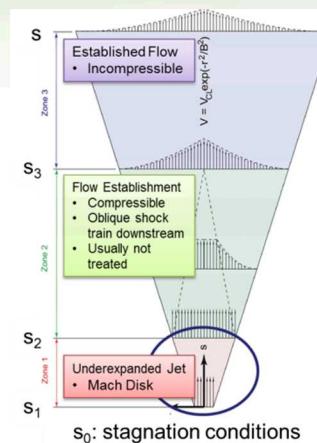


Ignition/Flame Light-up

- Prediction of ignition (flammability factor concept)
- Identification of light-up boundaries
- Prediction of sustained flame


Flame Radiation

- Flame integral model, effects of buoyancy
- Multi-source models significantly improve heat flux prediction
- Surface reflection can be a major potential heat flux contributor

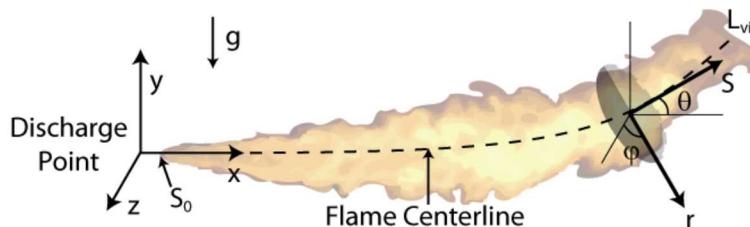

Deflagration within Enclosures


- Overpressure associated with deflagration
- Quantitative role of ventilation

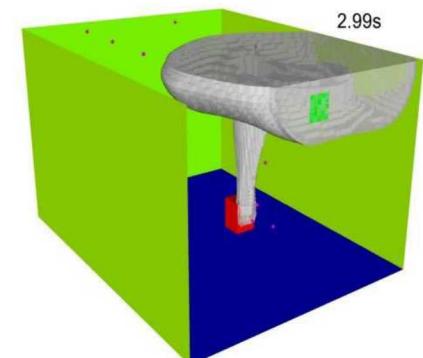

Overpressure & layer modules




Input: Release conditions and enclosure configuration

Variable	Value	Unit	▼
Ambient Pressure	101325	Pa	▼
Ambient Temperature	288.15	Kelvin	▼
H ₂ Tank Pressure	70	MPa	▼
H ₂ Tank Temperature	287.8	Kelvin	▼
H ₂ Tank Volume	0.00363	CubicMeter	▼
Leak Diameter	0.1	Centimeter	▼
Discharge Coefficient-Orifice	0.61
Discharge Coefficient-Release	1
Release Area	0.01716	SqMeters	▼
Release Height	0.2495	Meter	▼
Enclosure Height	2.72	Meter	▼
Floor/Ceiling Area	16.72216	SqMeters	▼
Distance from Release to Wall	2.1255	Meter	▼
Vent 1 Cross-Sectional Area	0.090792027688...	SqMeters	▼
Vent 1 Vent Height from Floor	2.42	Meter	▼
Vent 2 Cross-Sectional Area	0.00762	SqMeters	▼
Vent 2 Height from Floor	0.044	Meter	▼
Vent Volumetric Flow Rate	0	CubicMeters...	▼
Angle of Release (0=Horz.)	0	Degrees	▼

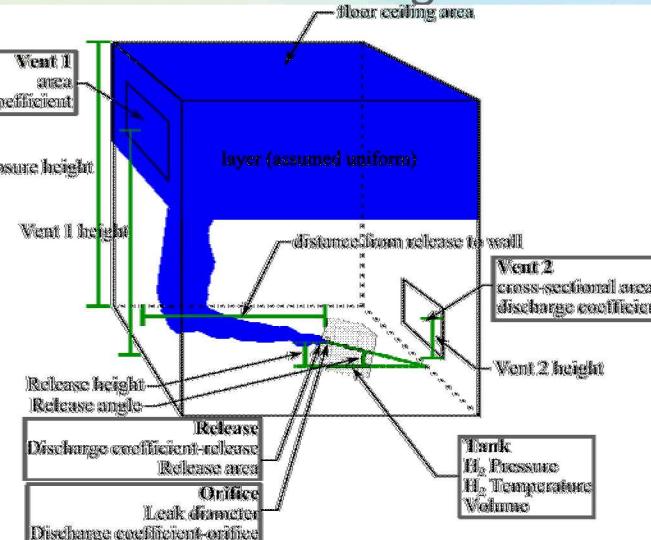


- Enables calculation of consequences inside of enclosures.
- Insight into enclosure design, effectiveness of mitigations

Output: Overpressure (ignited) & Height of accumulated layer (unignited)

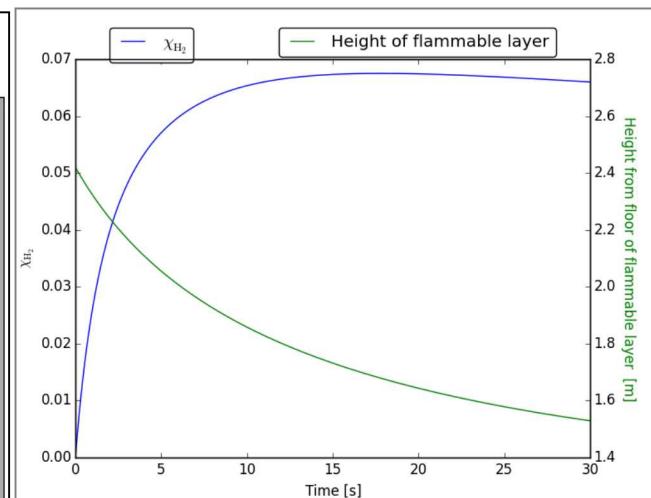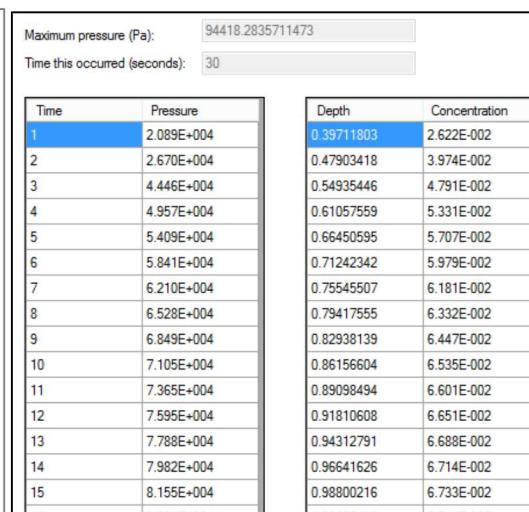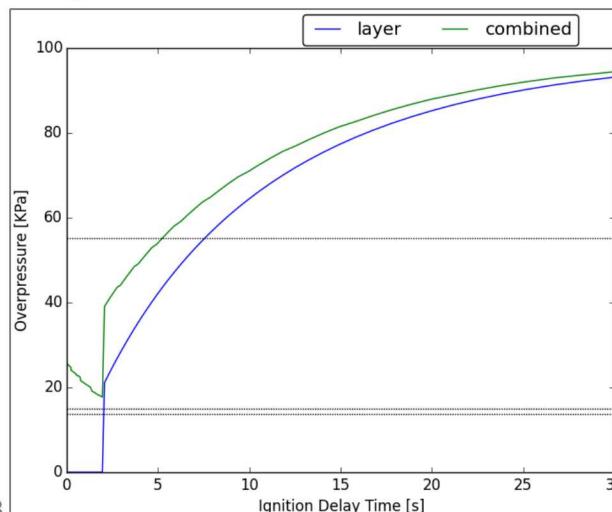

Building a scientific platform for hydrogen QRA

Adding more flexibility for users

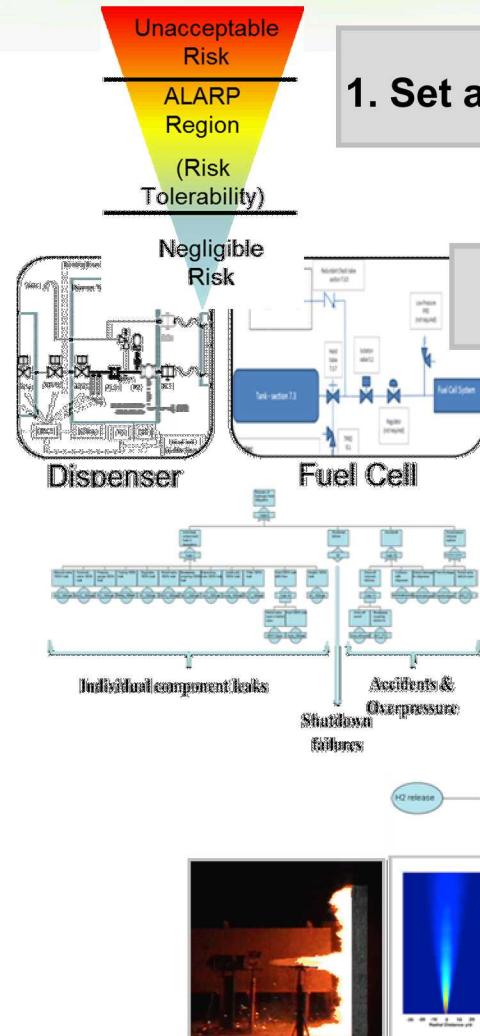

1. Set analysis goals

User-specific – Elicit from range of stakeholders.


2. System & hazard description

User-neutral – Establish science & engineering basis (with user input)

3. Cause analysis


4. Consequence analysis

5. Communicate Results

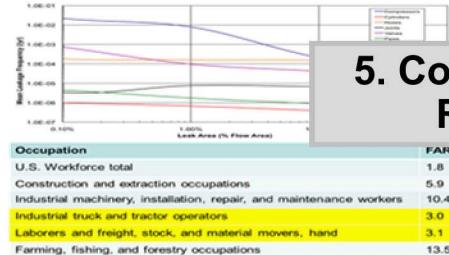


Current HyRAM QRA Analysis

- Focused on a gaseous hydrogen dispenser fueling forklifts located in a warehouse
- Analysis can be altered for generic fueling stations, but applicability is limited beyond that scope

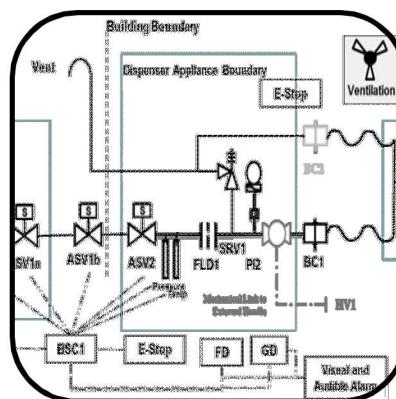


Dispenser

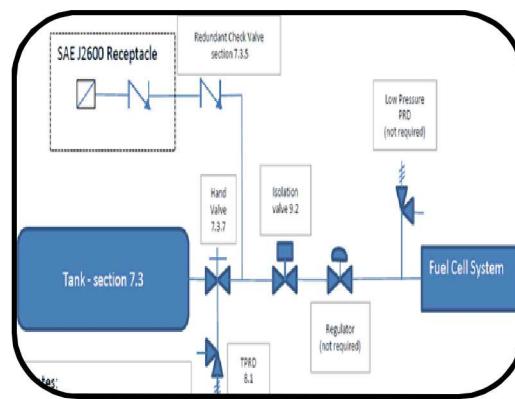


Fuel Cell



Vehicle

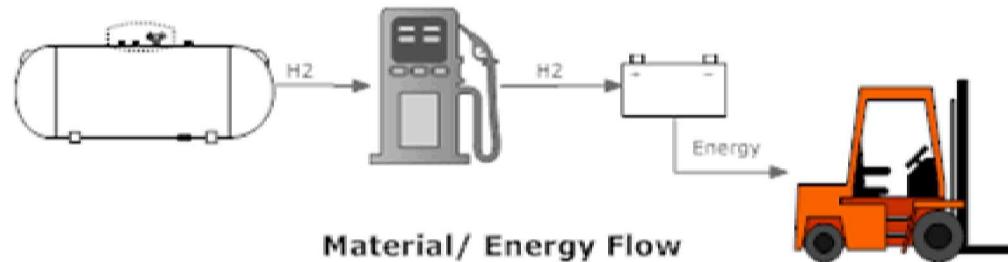

Fault Tree Customization

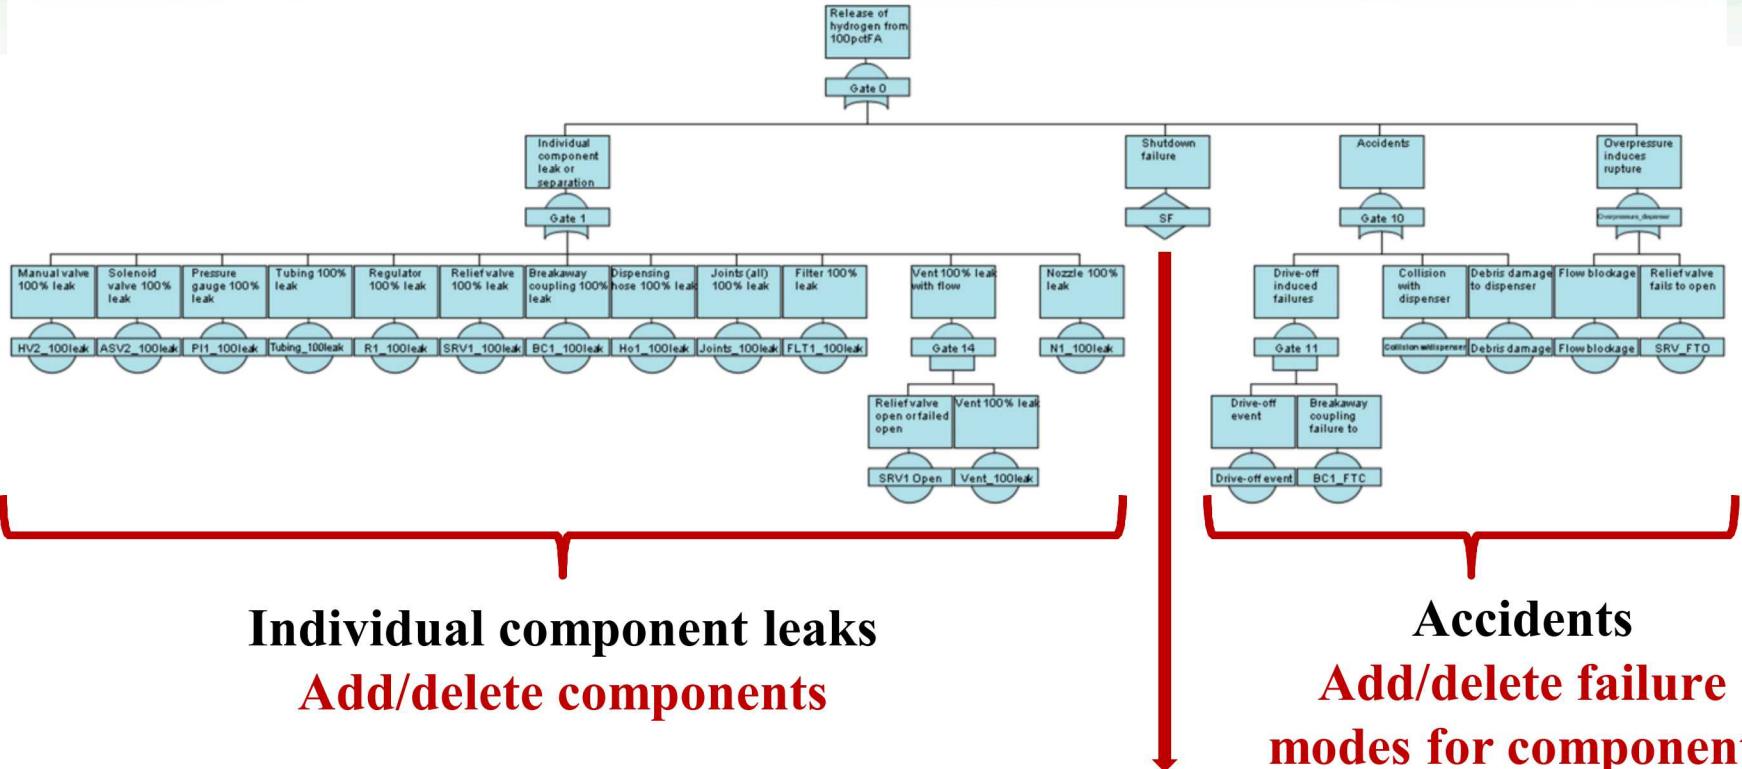

Individual component leaks
Add/delete components

Shutdown failures
Add/delete failure
modes for components
& scenarios


Accidents
Add/delete failure
modes for components
& scenarios

Event Tree and Resulting Calculations

- Fault tree will feed into the overall event tree
- Resulting QRA results will remain the same:
 - Average Individual Risk (AIR): **Fatalities/year**
 - Fatal Accident Rate (FAR): **Fatalities in 10⁸ person-hours**
 - Potential Loss of Life (PLL): **Fatalities/system-year**

Risk Metric	Value	Unit
Potential Loss of Life (PLL)	2.146e-05	Fatalities/system-year
Fatal Accident Rate (FAR)	0.0245	Fatalities in 10 ⁸ person-ho...
Average individual risk (AIR)	6.556e-07	Fatalities/year

$$Risk \propto \sum_{i,j,k} P(\text{Release}_i) P(\text{Ignition}_j | \text{Release}_i) P(\text{Hazard}_k | \text{Ignition}_j \cap \text{Release}_i) P(\text{Harm} | \text{Hazard}_k)$$

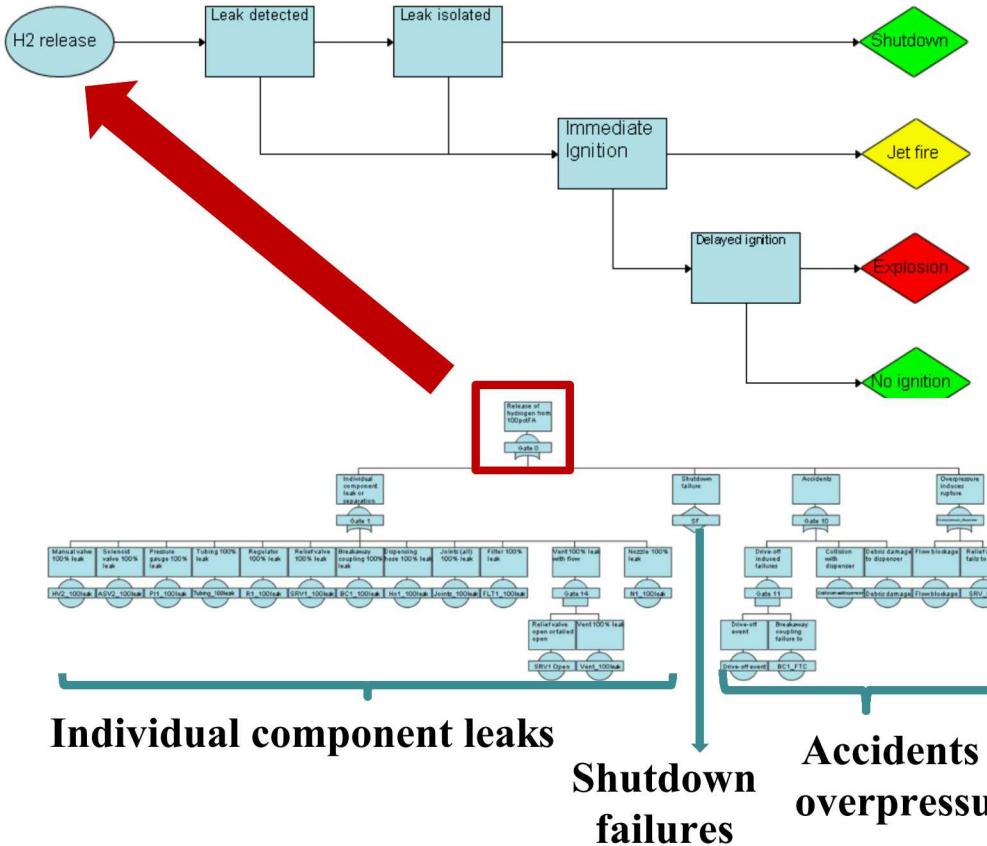

Incorporation of Alternative Fuels


- QRA beyond hydrogen
- Customization of the components, failure modes and accidents, will allow for the risk analysis of alternative fuels (LNG, propane) ***with the addition of the appropriate physics/behavior models***
- Component release frequencies, failure frequencies, accident frequencies, ignition probabilities and gas detection probabilities would all have to be calculated

Elements of Quality QRA

- **Repeatability**
 - Defined objectives and scope
 - Clear definitions of failure modes, consequences, criteria, models, and data
 - Document the system, assumptions
- **Validity & Verifiability**
 - Data, models, system, and analysis must be sufficiently documented for a peer reviewer to evaluate assumptions, completeness, etc.
 - Use experimentally validated models (as available) and published models and data
- **Comparability**
 - Necessitates flexible modeling tools, documentation of methodology
- **Completeness**
 - Ability to update models as knowledge improves
 - Ensure that the analyzed system matches the system as built and operated



Hydrogen Behavior studies are at the foundation of HyRAM's consequence modeling capabilities

Radiative properties of H₂ flames quantified

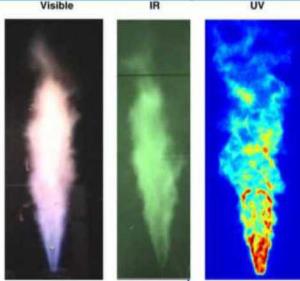

Barrier walls for risk reduction

Ignition of under-expanded H₂ jets

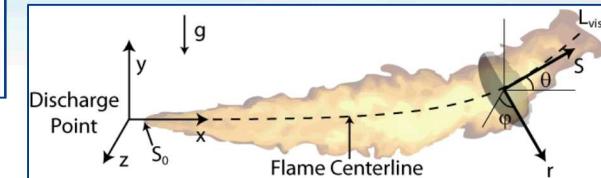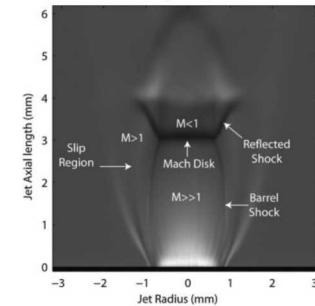

Buoyant jet flame model with multi-source radiation

2005

2007


2009

2011



2013

2015


2017



Ignition limits of turbulent H₂ flows

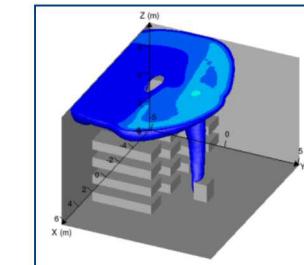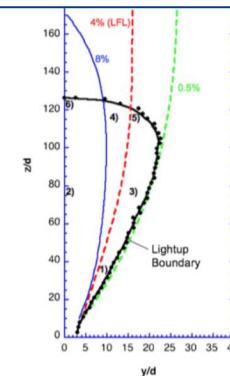


Laboratory-scale characterization of LH₂ plumes and jets

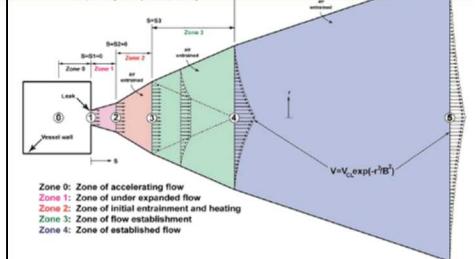


Experiment and simulation of indoor H₂ releases

Advanced laser diagnostics applied to turbulent H₂ combustion

Quantitative Risk Assessment is enabling infrastructure deployment

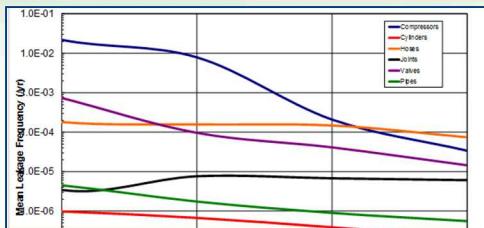


Established risk-informed processes for separation distances

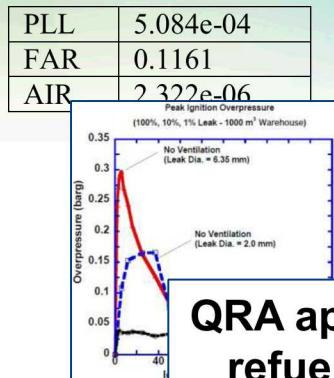

QRA applied to indoor refueling to inform code revision

Performance-based system layout demonstrated


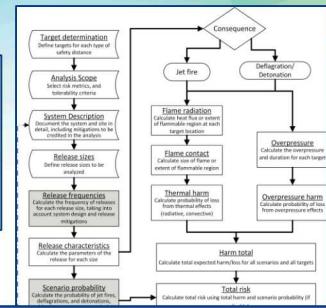


ISO TC197 WG24 incorporating QRA and behavior modeling



QRA-informed separation distances in NFPA 2

Risk assessment proposed for hydrogen systems at ICHS

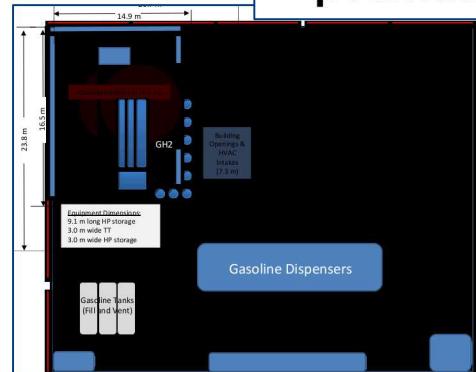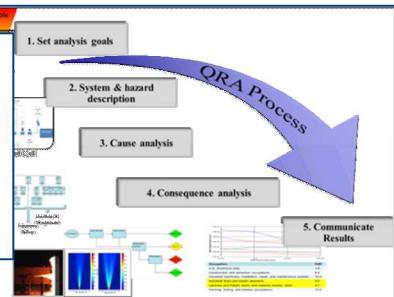

Public release of HyRAM R&D tool