



Sandia
National
Laboratories

Analysis of Diesel Generation and Energy Storage Integration Benefits

A case study for the Levelock Village of Alaska

Rodrigo D. Trevizan*, Alexander J. Headley†, Tu A. Nguyen*, Stan Atcity*, and Alexander Tallekparek‡

*Sandia National Laboratories, Albuquerque, NM

†University of Memphis, Memphis TN

‡Village of Levelock Council

2021 DOE Office of Electricity Energy Storage Program Annual Peer Review
October 26 – 28, 2021



Sandia National Laboratories is a multimission laboratory managed and operated by National Technology & Engineering Solutions of Sandia, LLC, a wholly owned subsidiary of Honeywell International Inc., for the U.S. Department of Energy's National Nuclear Security Administration under contract DE-NA0003525.

Background – Levelock Village of Alaska



- Tribal community of 49 residents, 300 members
- Commercial fishing
- Isolated power system
- Powered by 3 diesel generators (DGs)
- Diesel costs 20% more than national average
- Diesel generation system is aged and unreliable
- Average of 3 to 4 outages / month
- Investigate benefits of hybrid energy system
 - Battery energy storage system (BESS) paired DGs



Source: Google, TerraMetrics, SK telecom, INEGI.

Study – Benefits of BESS



Reliability improvements

- Automation of backup power
- Extended time for repairs
- BESS reserve must be sized to cover typical outages

Fuel savings

- Operating DGs at most efficient point (close to full load)
- Charge BESS to shift the point of operation of DGs

Generator replacement deferral


- Reducing run-hours

Potential value changes with load and DG characteristics

- Energy Opportunity Ratio (EOR)
- Portion of energy supplied away from peak DG efficiency

Low-Power Opportunity Ratio (LOR)


- Energy needing to be supplied below wet stacking limit

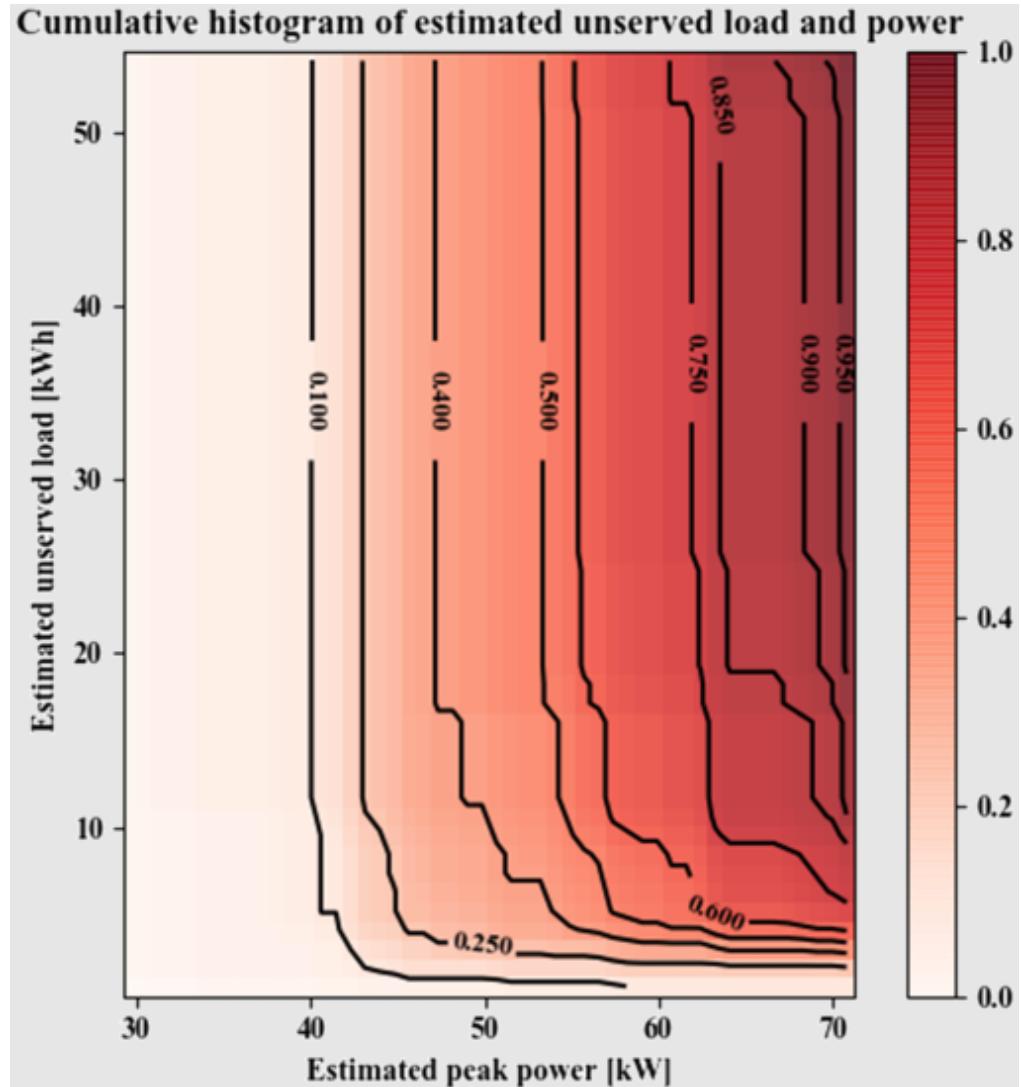


Results – Case Study for Levelock



PV of 2 DG, 50 kW/25kWh system versus 3 DG system, no solar (EOR = 0.29, LPOR = 0.0001)

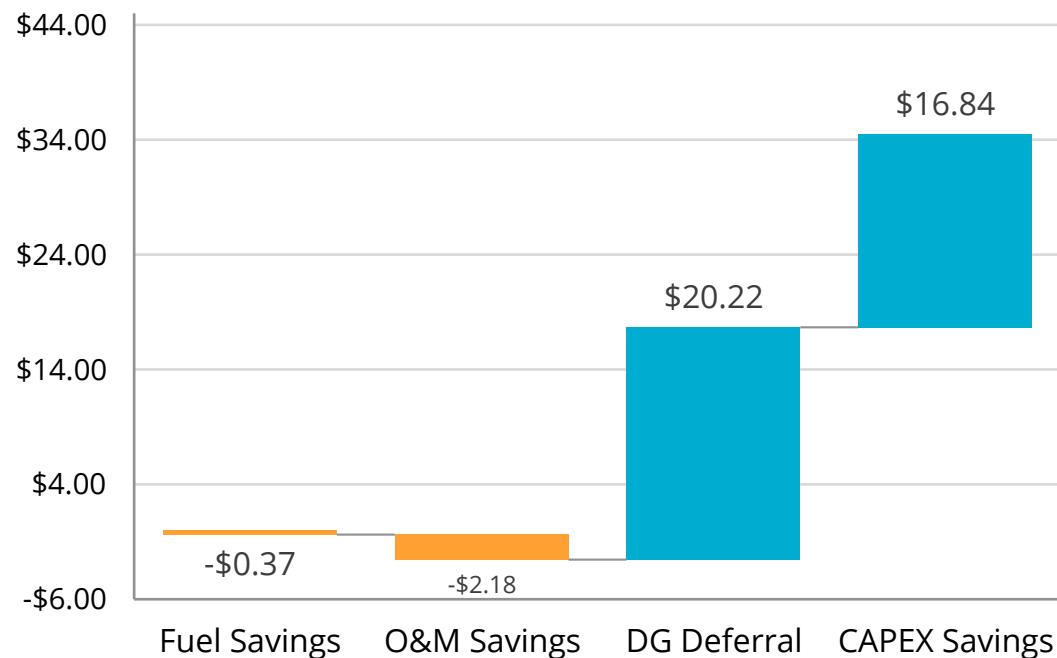

PV of 2 DG, 50 kW/25kWh system versus 3 DG system, 50 kW solar (EOR = 0.57, LPOR = 0.086)

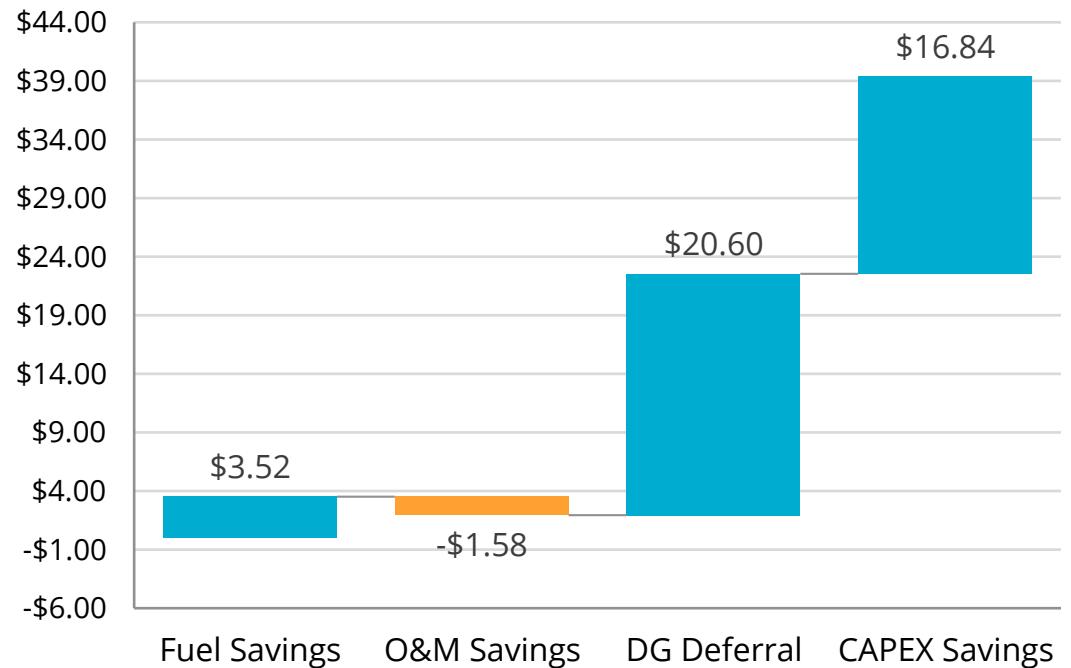

Major findings

- Larger BESS more viable at EOR > 0.45 (potentially from solar integration)
- Biggest financial benefit from DG deferral and reliability improvements

Conclusion

- BESS can significantly increase reliability indices by providing fast-responding automatic power backup
- Operation of BESS in tandem with DG can reduce generator runtime, deferring DG replacement or overhaul
- Larger benefits can be obtained if solar photovoltaic generation is added
- Analysis can help tribal leadership to take informed decisions about energy investments
- By deploying renewables plus storage on tribal lands, the tribe can secure **greater tribal and economic sovereignty** through energy independence and economic development

Project Deliverables

- R.D. Trevizan, A.J. Headley, R. Geer, S. Atcitty, I. Gyuk "Integration of Energy Storage with Diesel Generation in Remote Communities" in *MRS Energy and Sustainability*, 2021, DOI : 10.1557/s43581-021-00013-9, accepted for publication.

Acknowledgment

The authors would like to thank Dr. Imre Gyuk, Director of the Energy Storage Program, for his continued support.