


April 1996

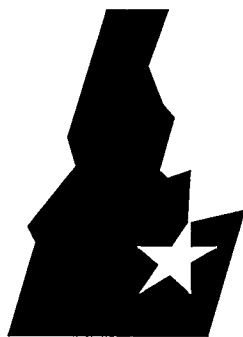

**Idaho
National
Engineering
Laboratory**

ICPP Environmental Monitoring Report CY-1995

**RECEIVED
JUL 29 1996
OSTI**

MASTER

 **Lockheed**
Idaho Technologies Company

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED 

ICPP Environmental Monitoring Report CY-1995

Published April 1996

**Idaho National Engineering Laboratory
Environmental Protection Department
Lockheed Idaho Technologies Company
Idaho Falls, Idaho 83415**

**Prepared for the
U.S. Department of Energy
Assistant Secretary for Environmental Management
Under DOE Idaho Operations Office
Contract DE-AC07-94ID13223**

DISCLAIMER

**Portions of this document may be illegible
in electronic image products. Images are
produced from the best available original
document.**

TABLE OF CONTENTS

I.	INTRODUCTION	1
II.	AIRBORNE MONITORING	5
	1. INTRODUCTION	5
	2. AIRBORNE RELEASES TO THE ENVIRONMENT	5
	2.1 Main Stack	5
	2.2 FAST Stack	17
	2.3 NWCF Stack	17
	2.4 RAL Stack	17
	2.5 Coal Fired Steam Generating Facility (CFSGF)	17
III.	LIQUID MONITORING	29
	1. INTRODUCTION	29
	2. LIQUID RELEASES TO THE ENVIRONMENT	29
	2.1 Service Waste System	29
	2.2 Production and Potable Water Wells	40
	2.3 Sewage Treatment Plant	40
	2.4 ICPP Injection Well	40

FIGURES

1-1.	SUMMARY OF AIRBORNE RELEASES	3
1-2.	SUMMARY OF LIQUID RELEASES	4
2-1.	MAIN STACK EFFLUENT - Total Activity	7
2-2.	MAIN STACK EFFLUENT - I-129	8
2-3.	MAIN STACK EFFLUENT - Cs-137	9
2-4.	MAIN STACK EFFLUENT - Sr-90	10
2-5.	MAIN STACK EFFLUENT - Ru-106	11
2-6.	MAIN STACK EFFLUENT - Pu-Total	12
2-7.	MAIN STACK EFFLUENT - Sb-125	13
2-8.	MAIN STACK EFFLUENT - C-14	14
2-9.	MAIN STACK EFFLUENT - H-3	15
2-10.	NO _x RELEASES FROM ICPP MAIN STACK	16

2-11.	FAST STACK EFFLUENT - Total Activity	19
2-12.	FAST STACK EFFLUENT - Pu-238	20
2-13.	FAST STACK EFFLUENT - Pu-239	21
2-14.	FAST STACK EFFLUENT - Sb-125	22
2-15.	FAST STACK EFFLUENT - CS-137	23
2-16.	NWCF STACK EFFLUENT - Total Activity	25
2-17.	RAL STACK EFFLUENT - Total Activity	27
3-1.	SERVICE WASTE EFFLUENT - Total Activity	33
3-2.	SERVICE WASTE EFFLUENT - Pu-238	34
3-3.	SERVICE WASTE EFFLUENT - U-234	35
3-4.	SERVICE WASTE EFFLUENT - U-235	36
3-5.	SERVICE WASTE EFFLUENT - U-238	37
3-6.	SERVICE WASTE EFFLUENT - Sr-90	38
3-7.	SERVICE WASTE EFFLUENT - Cs-137	39
3-8.	SEWAGE TREATMENT PLANT - BOD, BOD Efficiency	44
3-9.	SEWAGE TREATMENT PLANT - DO	45
3-10.	SEWAGE TREATMENT PLANT - pH	46
3-11.	SEWAGE TREATMENT PLANT - Volume	47

TABLES

1-1.	SUMMARY OF RELEASE DATA FOR 1995	2
2-1.	AIRBORNE RELEASES FROM ICPP MAIN STACK - CY-1995	6
2-2.	AIRBORNE RELEASES FROM ICPP FAST STACK - CY-1995	18
2-3.	AIRBORNE RELEASES FROM ICPP NWCF STACK - CY-1995	24
2-4.	AIRBORNE RELEASES FROM ICPP RAL STACK - CY-1995	26
2-5.	COAL FIRED STEAM GENERATING FACILITY - CY-1995	28
3-1.	SERVICE WASTE RELEASES - CY-1995	30
3-2.	SERVICE WASTE METALS - CY-1995	31

3-3.	DCG RATIOS - DOE - CY-1995	32
3-4.	PRODUCTION WELL - CY-1995	41
3-5.	POTABLE WATER WELL - CY-1995	42
3-6.	SEWAGE TREATMENT PLANT ANALYSIS - CY-1995	43

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

ACRONYM LIST

BAT	Best Available Technology
BOD	Biological Oxygen Demand
CFSGF	Coal Fired Steam Generating Facility
DCGs	Derived Concentration Guides
DO	Dissolved Oxygen
DOE	Department of Energy
EPA	Environmental Protection Agency
FAST	Fluorinel Dissolution Process & Fuel Storage Facility
ICPP	Idaho Chemical Processing Plant
LITCO	Lockheed Idaho Technologies Company
NO _x	Nitrogen Oxide
NWCF	New Waste Calcining Facility
pH	Potential of Hydrogen
QA	Quality Assurance
QAPJP	Quality Assurance Project Plan
RAL	Remote Analytical Laboratory
STP	Sewage Treatment Plant
SO ₂	Sulfur Dioxide
VOG	Ventilation Off-Gas

ICPP ENVIRONMENTAL MONITORING REPORT 1995

I. INTRODUCTION

Summarized in this report are the data collected through Environmental Monitoring programs conducted at the Idaho Chemical Processing Plant (ICPP) by the Environmental Protection Department. This report is published in response to DOE Order 5400.1.

The ICPP is responsible for complying with all applicable Federal, State, Local and DOE Rules, Regulations and Orders. Radiological effluent and emissions are regulated by the DOE in accordance with the Derived Concentration Guides (DCGs) as presented in DOE Order 5400.5. The State of Idaho regulates nonradiological waste resulting from the ICPP operations including airborne, liquid, and solid waste.

The Environmental Department updated the Quality Assurance (QA) Project Plan for Environmental Monitoring activities during the third quarter of 1992. QA activities have resulted in the ICPP's implementation of the Environmental Protection Agency (EPA) rules and guidelines pertaining to the collection, analyses, and reporting of environmentally related samples. Where no EPA methods for analyses existed for radionuclides, Lockheed Idaho Technologies Company (LITCO) methods were used.

Table 1-1 summarizes the volumes and activity released from ICPP stacks and liquid release points. Figure 1-1 is a graphic representation of cumulative volume & airborne releases and Figure 1-2 depicts cumulative volume & liquid releases for the year. The graphs allow trends to be made of waste volume and activity released for the year. The Main Stack gaseous monitor was not in operation for 1995. New Waste Calcining Facility (NWCF) was not in operation in 1995. During 1995 the cumulative airborne and liquid release of radionuclides was 2.20E-01 curies. Airborne releases to the atmosphere contributed 4.53-04 curies and liquid effluent released to the Percolation Pond contributed 2.20E-01 curies. Liquid Effluent Treatment and Disposal (LET&D) began operation on January 1, 1993. PEW condensates which previously were discharged to Service Waste are now treated in the LET&D facility. Table 3-1 and 3-2 provide information on radionuclide activity and concentration of inorganic chemicals present in the service waste. The values are compared to regulatory limits where applicable.

Table 1-1
SUMMARY OF RELEASE DATA FOR 1995

AIRBORNE

	Volume (E+09 m3)		Activity (curies)	
	<u>Month</u>	<u>YTD</u>	<u>Month</u>	<u>YTD</u>
Jan	0.328	0.328	9.64E-06	9.64E-06
Feb	0.336	0.664	3.42E-05	4.38E-05
Mar	0.314	0.978	2.33E-05	6.71E-05
Apr	0.360	1.338	3.13E-05	9.84E-05
May	0.322	1.660	5.18E-05	1.50E-04
Jun	0.339	1.999	2.19E-05	1.72E-04
Jul	0.276	2.275	8.54E-05	2.58E-04
Aug	0.320	2.595	3.73E-05	2.95E-04
Sep	0.398	2.993	1.10E-04	4.05E-04
Oct	0.388	3.381	1.66E-05	4.21E-04
Nov	0.362	3.743	1.93E-05	4.41E-04
Dec	0.360	4.103	1.24E-05	4.53E-04

LIQUID

	Volume (E+09 L)		Activity (curies)	
	<u>Month</u>	<u>YTD</u>	<u>Month</u>	<u>YTD</u>
	0.150	0.150	5.02E-04	5.02E-04
	0.154	0.304	4.64E-04	9.66E-04
	0.144	0.448	1.49E-03	2.46E-03
	0.220	0.668	2.65E-03	5.11E-03
	0.174	0.842	3.21E-03	8.32E-03
	0.136	0.978	5.31E-04	8.85E-03
	0.135	1.113	1.33E-03	1.02E-02
	0.171	1.284	8.50E-04	1.10E-02
	0.143	1.427	1.03E-04	1.11E-02
	0.170	1.597	1.21E-01	1.32E-01
	0.138	1.735	3.53E-04	1.32E-01
	0.145	1.880	8.79E-02	2.20E-01

Figure 1-1
AIRBORNE RELEASES
CY-1995


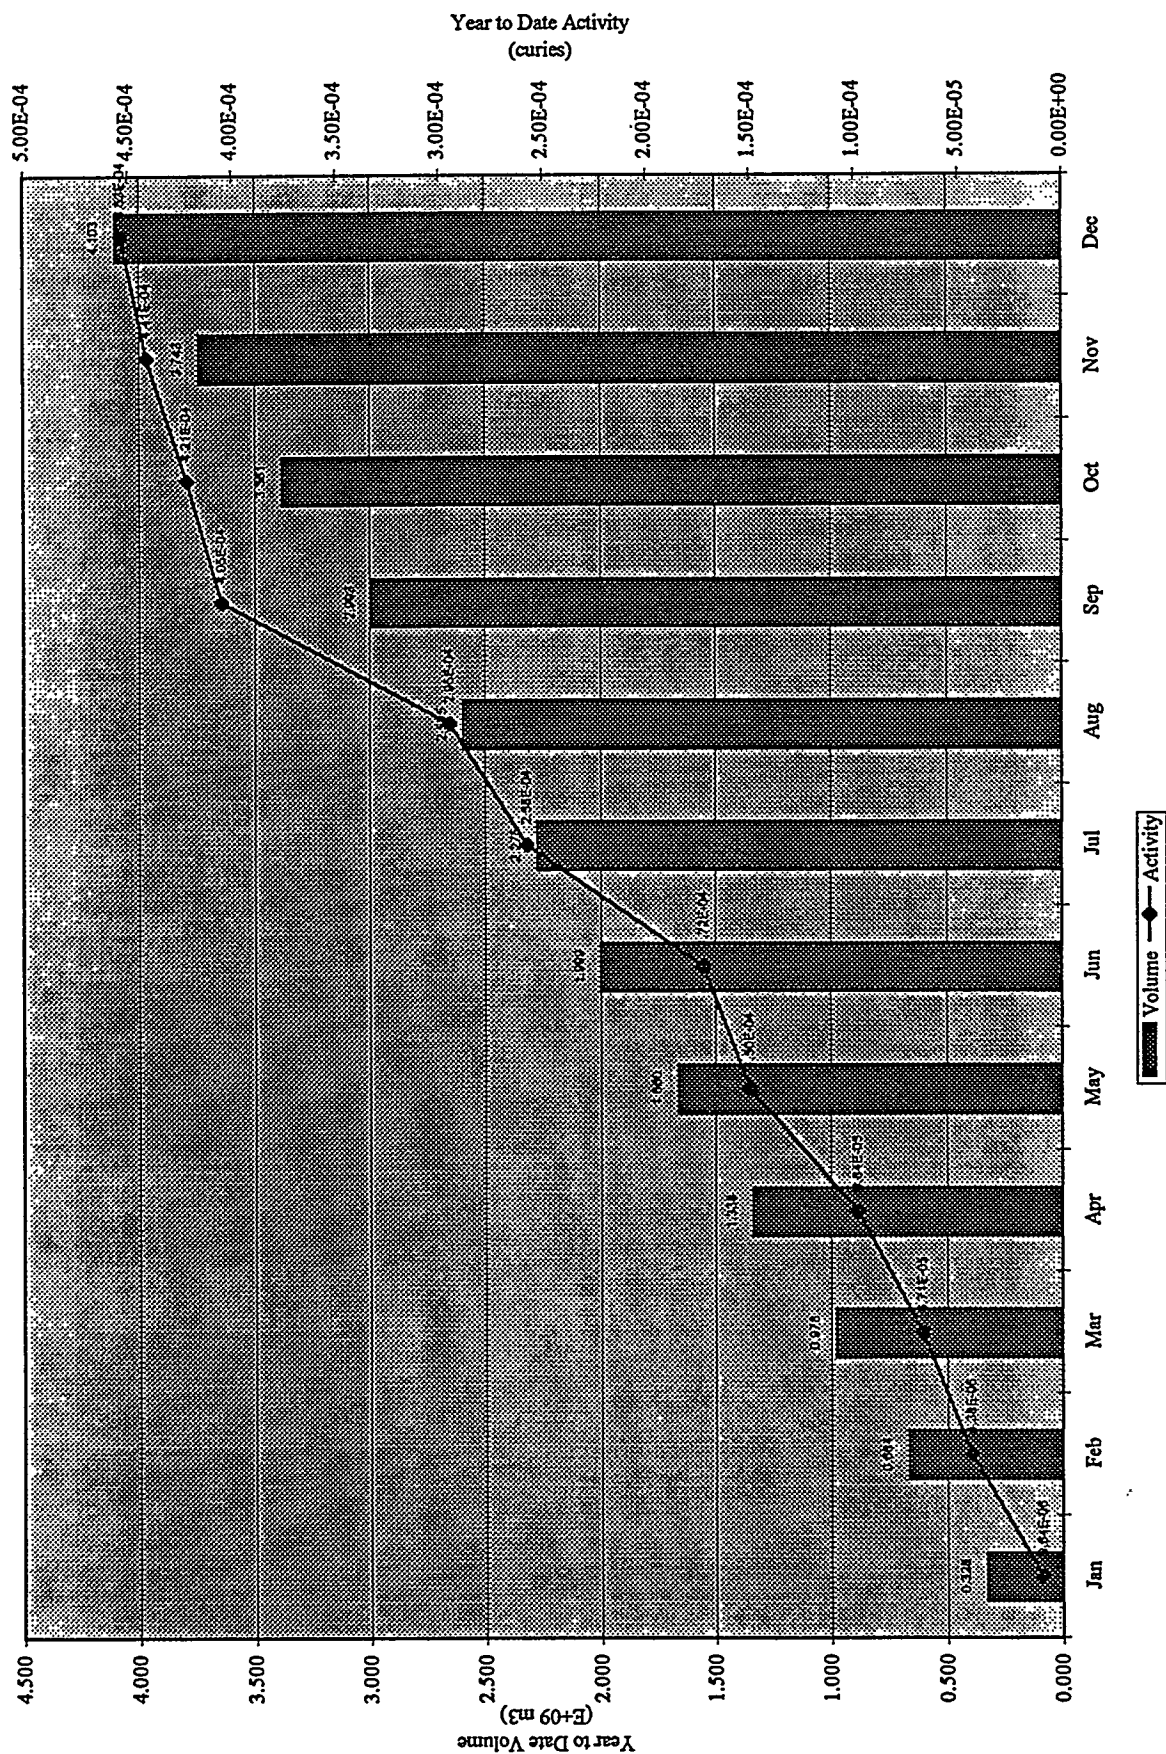


Figure 1-2
LIQUID EFFLUENT RELEASES
CY-1995

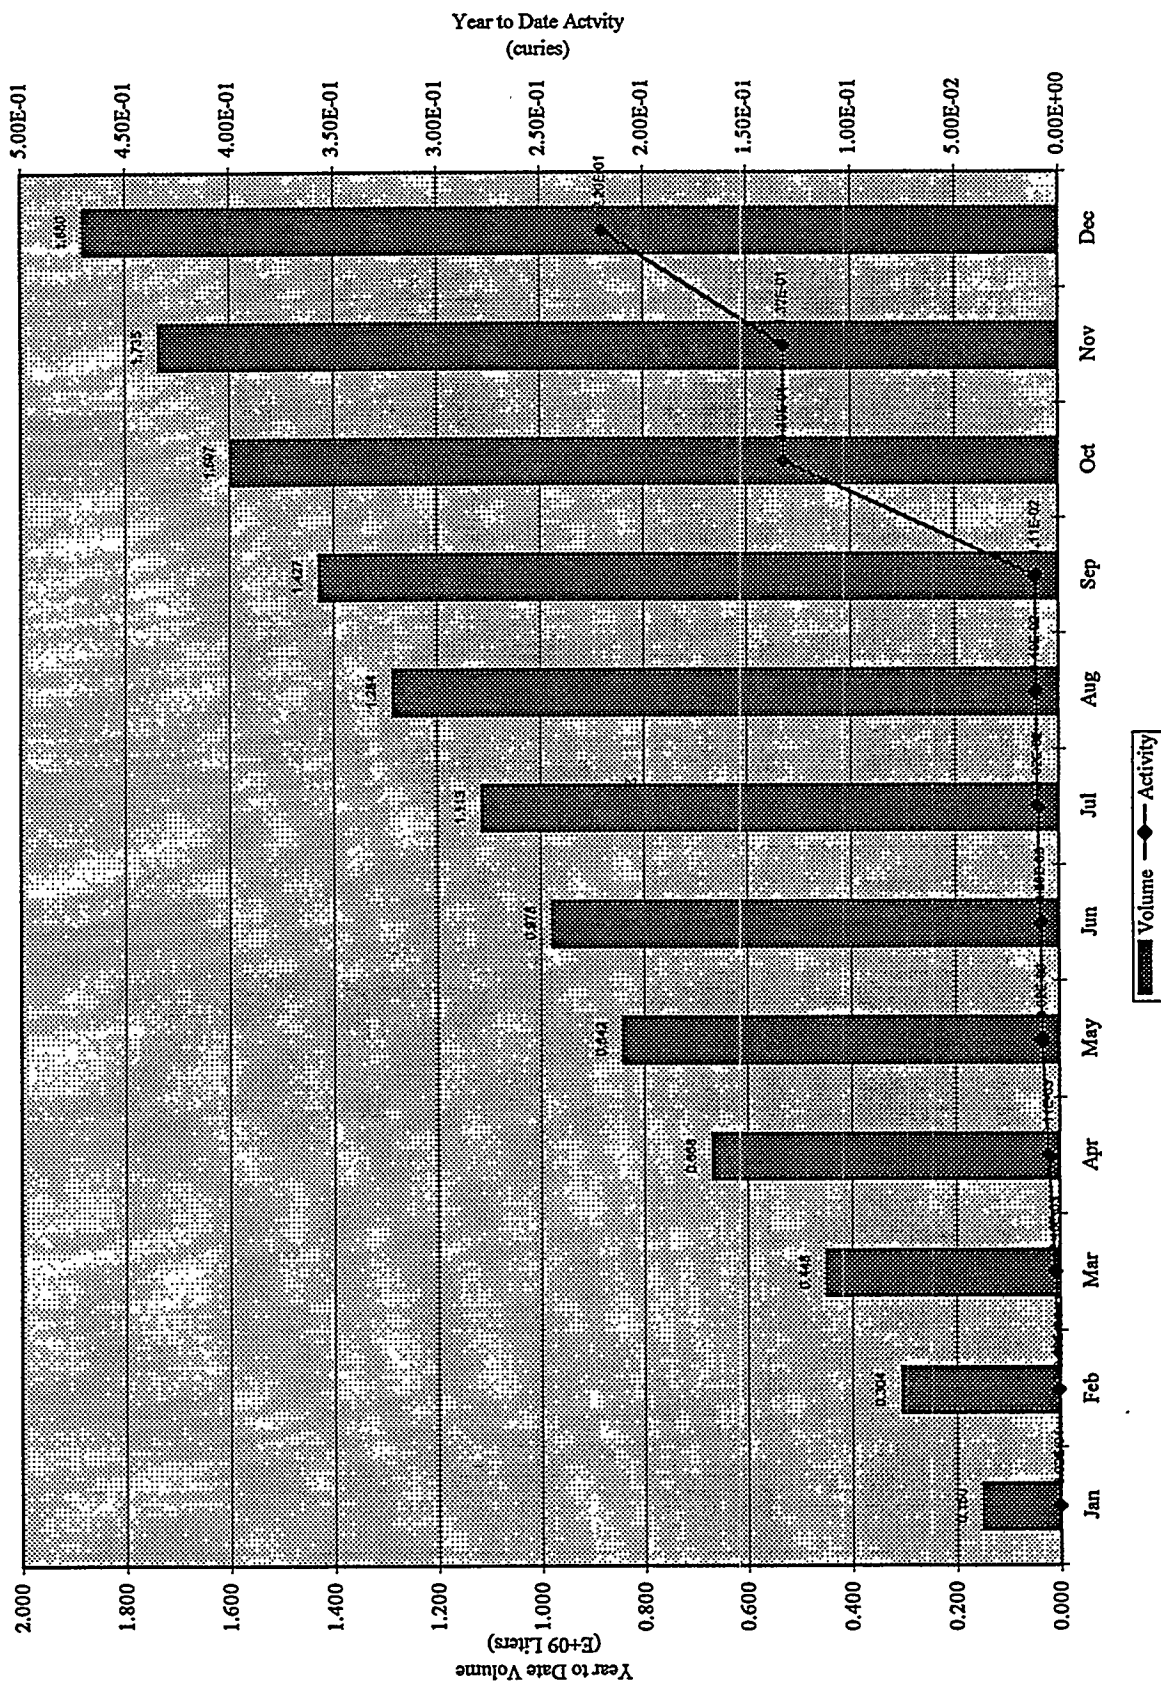

II. AIRBORNE MONITORING

1. INTRODUCTION

Airborne radioactive emissions are monitored from the Main Stack (CPP-708), the Fluorinel Dissolution Process and Fuel Storage Facility (FAST) Stack (CPP-767), the New Waste Calcining Facility (NWCF) Stack (CPP-659), and the Remote Analytical Laboratory (RAL) Stack (CPP-684). NWCF was not in operation in 1995.

The Main Stack is equipped with radiological particulate and gaseous monitoring systems and the FAST Stack is equipped with a particulate monitoring system. The Main Stack gaseous monitor was not in operation in 1995. The airborne monitoring systems are based upon a proportional isokinetic sample. Particulate filters are collected and analyzed daily on the Main Stack. Nitrogen oxide (NO_x) emissions are the only nonradioactive airborne contaminant that is monitored from the Main Stack.

Particulate filters for the RAL Stack and FAST Stack are pulled and analyzed monthly. The NWCF HVAC stack monitor filters are collected weekly and the Ventilation Off-Gas (VOG) system is continuously monitored for radioactive particulates. The CFSGF is monitored for NO_x, SO₂, carbon monoxide, and opacity in accordance with the State of Idaho, the EPA and the DOE-ID.

Radioactive releases for each emission point were well below the DOE DCGs for 1995. DCGs at the INEL boundary are reference values for conducting radiological environmental protection programs at operational DOE facilities and sites.

Quality assurance objectives for data measurement and laboratory performance are listed in the Quality Assurance Project Plan (QAPjP-001) for the Analysis of the Environmental Samples by both the LITCO CPP Analytical Labs and Radiation and Radioanalytical Chemistry. Final data reduction is performed by the Environmental Support section of the Environmental Protection Department.

2. AIRBORNE RELEASES TO THE ENVIRONMENT

2.1 Main Stack

Airborne radioactive release data from the Main Stack for each month and the year are given in Table 2-1. This information is presented graphically in Figure 2-1. Graphic presentations showing yearly trends for radionuclides most likely to be present (iodine-129, cesium-137, strontium-90, ruthenium-106, plutonium (total), antimony-125, C-14, and H-3), are given in Figures 2-2 through 2-9, respectively. I-129, C-14, and H-3 will have no results reported for 1994 and 1995 because the gaseous monitor was not in operation. Also NWCF was not in operation during 1995 so no releases for those radionuclides are apparent.

Nitrogen oxide (NO_x) emission from the Main Stack is the only nonradioactive airborne contaminant continuously monitored. NO_x concentration levels, while they do not violate any ambient air quality standard, must not exceed limits imposed by the FPR PSD permit. The limits set for the Main Stack are 472 pounds per hour and 1700 tons per year. Figure 2-10 provides NO_x emissions for the last three years. The total NO_x released in 1995 was 0 tons.

Table 2-1
AIRBORNE RELEASES FROM ICPP MAIN STACK CY-95 (curies)

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	TOTAL
Co-57													
Co-60					1.87E-07		1.94E-07		6.64E-08		3.77E-08		4.85E-07
Cs-134					4.06E-05	1.93E-05	4.73E-05	2.33E-05	8.16E-05	1.10E-05	1.12E-05	2.83E-06	3.07E-04
Cs-137	8.72E-06	2.06E-05	1.52E-05	2.58E-05									
Eu-152													
Eu-154									1.72E-07				1.72E-07
Pu-238				5.25E-08	2.04E-07	1.66E-07	8.02E-08	1.27E-07	1.58E-07	3.84E-08	4.06E-08	1.40E-08	8.81E-07
Pu-239				8.55E-09	1.41E-08	1.81E-08	8.18E-09	1.11E-08	2.08E-08	8.62E-09	7.58E-09		9.70E-08
Ru-106	3.54E-07	2.79E-06	2.10E-06	1.01E-06	3.54E-06	8.08E-07	4.63E-06	4.99E-07	4.58E-06		3.33E-07		2.06E-05
Sb-125	1.10E-07	6.57E-07	1.17E-06	4.48E-07	1.62E-06	4.40E-07	1.25E-07	7.00E-07	1.38E-07				5.41E-06
Sr-90		1.01E-05	4.70E-06	3.53E-06	5.06E-06		1.30E-05		7.99E-06				4.44E-05
TOTAL ACTIVITY	9.18E-06	3.41E-05	2.32E-05	3.08E-05	5.12E-05	2.07E-05	6.53E-05	2.46E-05	9.47E-05	1.10E-05	1.16E-05	2.84E-06	3.80E-04
TOTAL VOLUME (cubic meters)	1.22E+08	1.30E+08	1.21E+08	1.33E+08	1.31E+08	1.34E+08	1.28E+08	1.30E+08	1.78E+08	1.39E+08	1.38E+08	1.41E+08	
CUMULATIVE ACTIVITY	9.18E-06	4.33E-05	6.65E-05	9.74E-05	1.49E-04	1.69E-04	2.35E-04	2.59E-04	3.54E-04	3.65E-04	3.77E-04	3.80E-04	

*September Total volume includes August 21 to October 1, 1995

BLANKS FOR Sr-90 AND Pu REPRESENT BELOW DETECTION AND REMAINING BLANKS REPRESENT NOT DETECTED IN THE GAMMA SCAN

Figure 2-1
MAIN STACK EFFLUENT
Total Activity (curies)

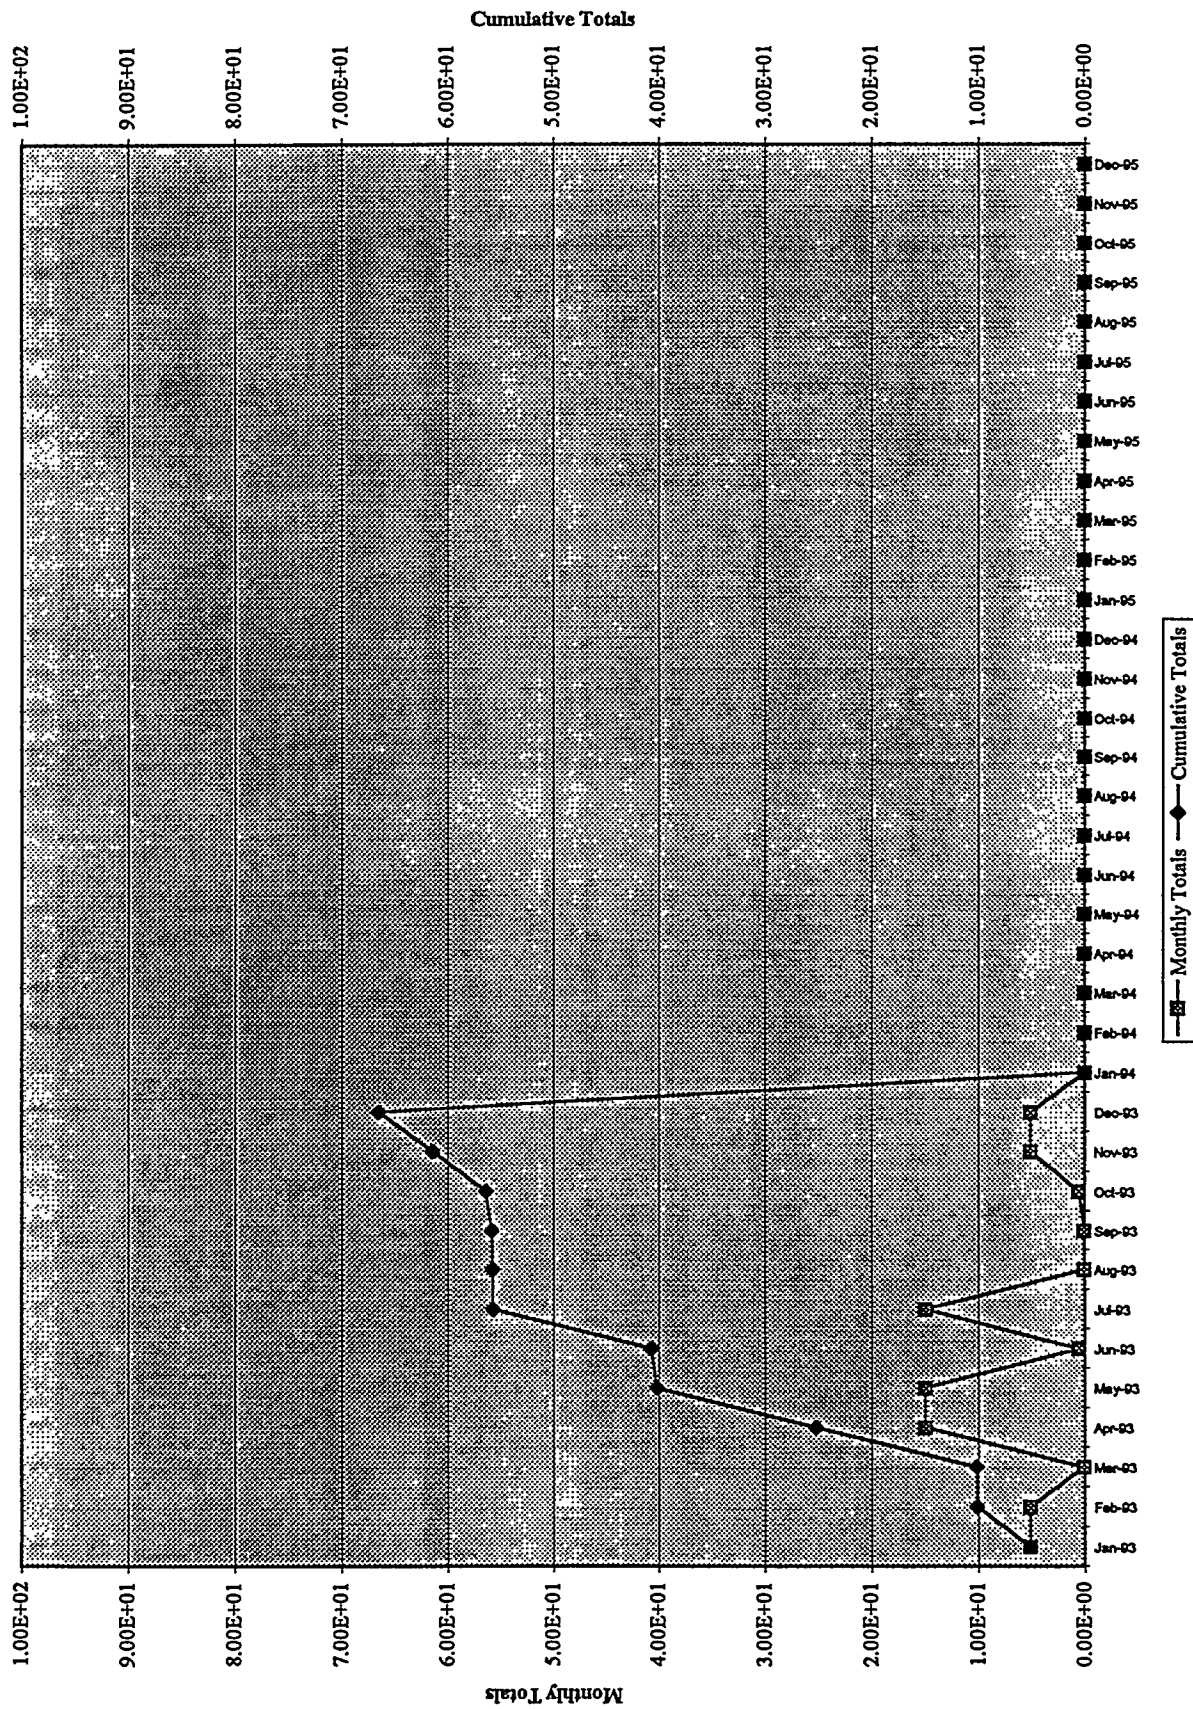


Figure 2-2
MAIN STACK EFFLUENT
I-129 (curies)

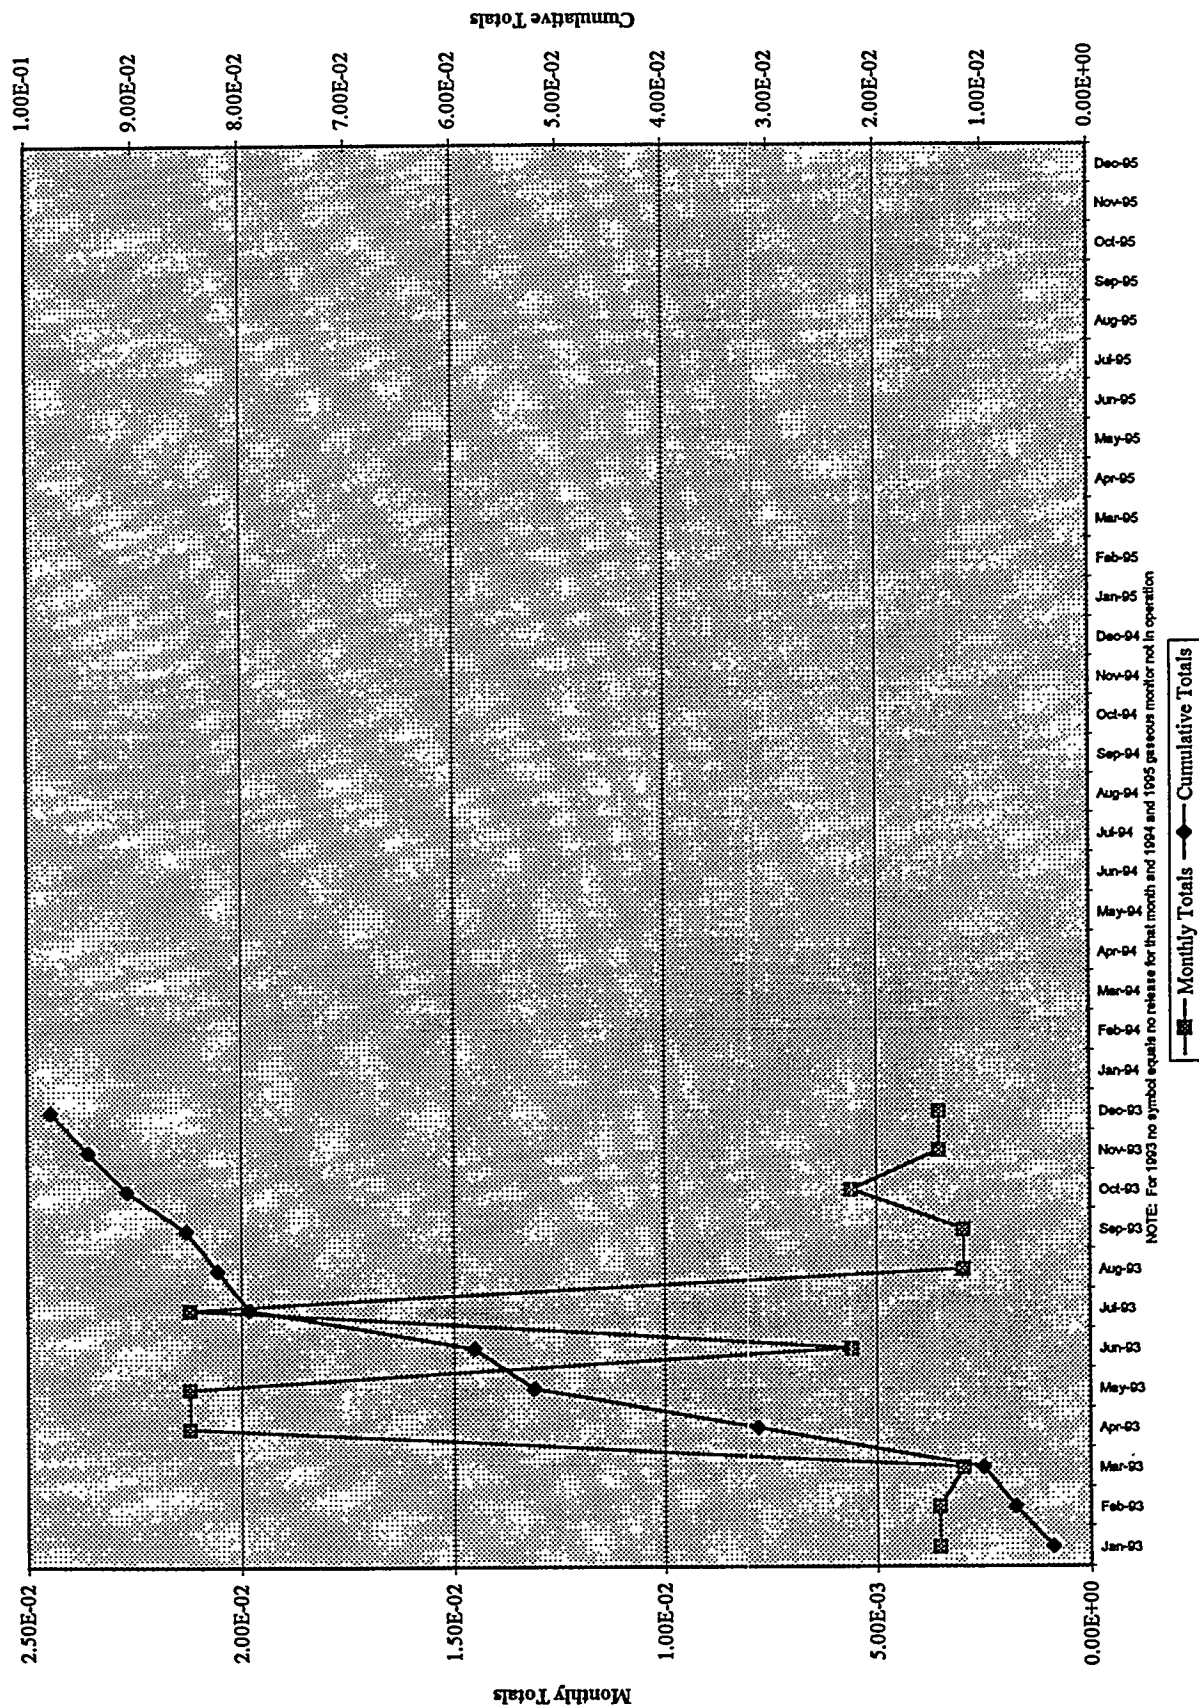


Figure 2-3
MAIN STACK EFFLUENT
Cs-137 (curies)

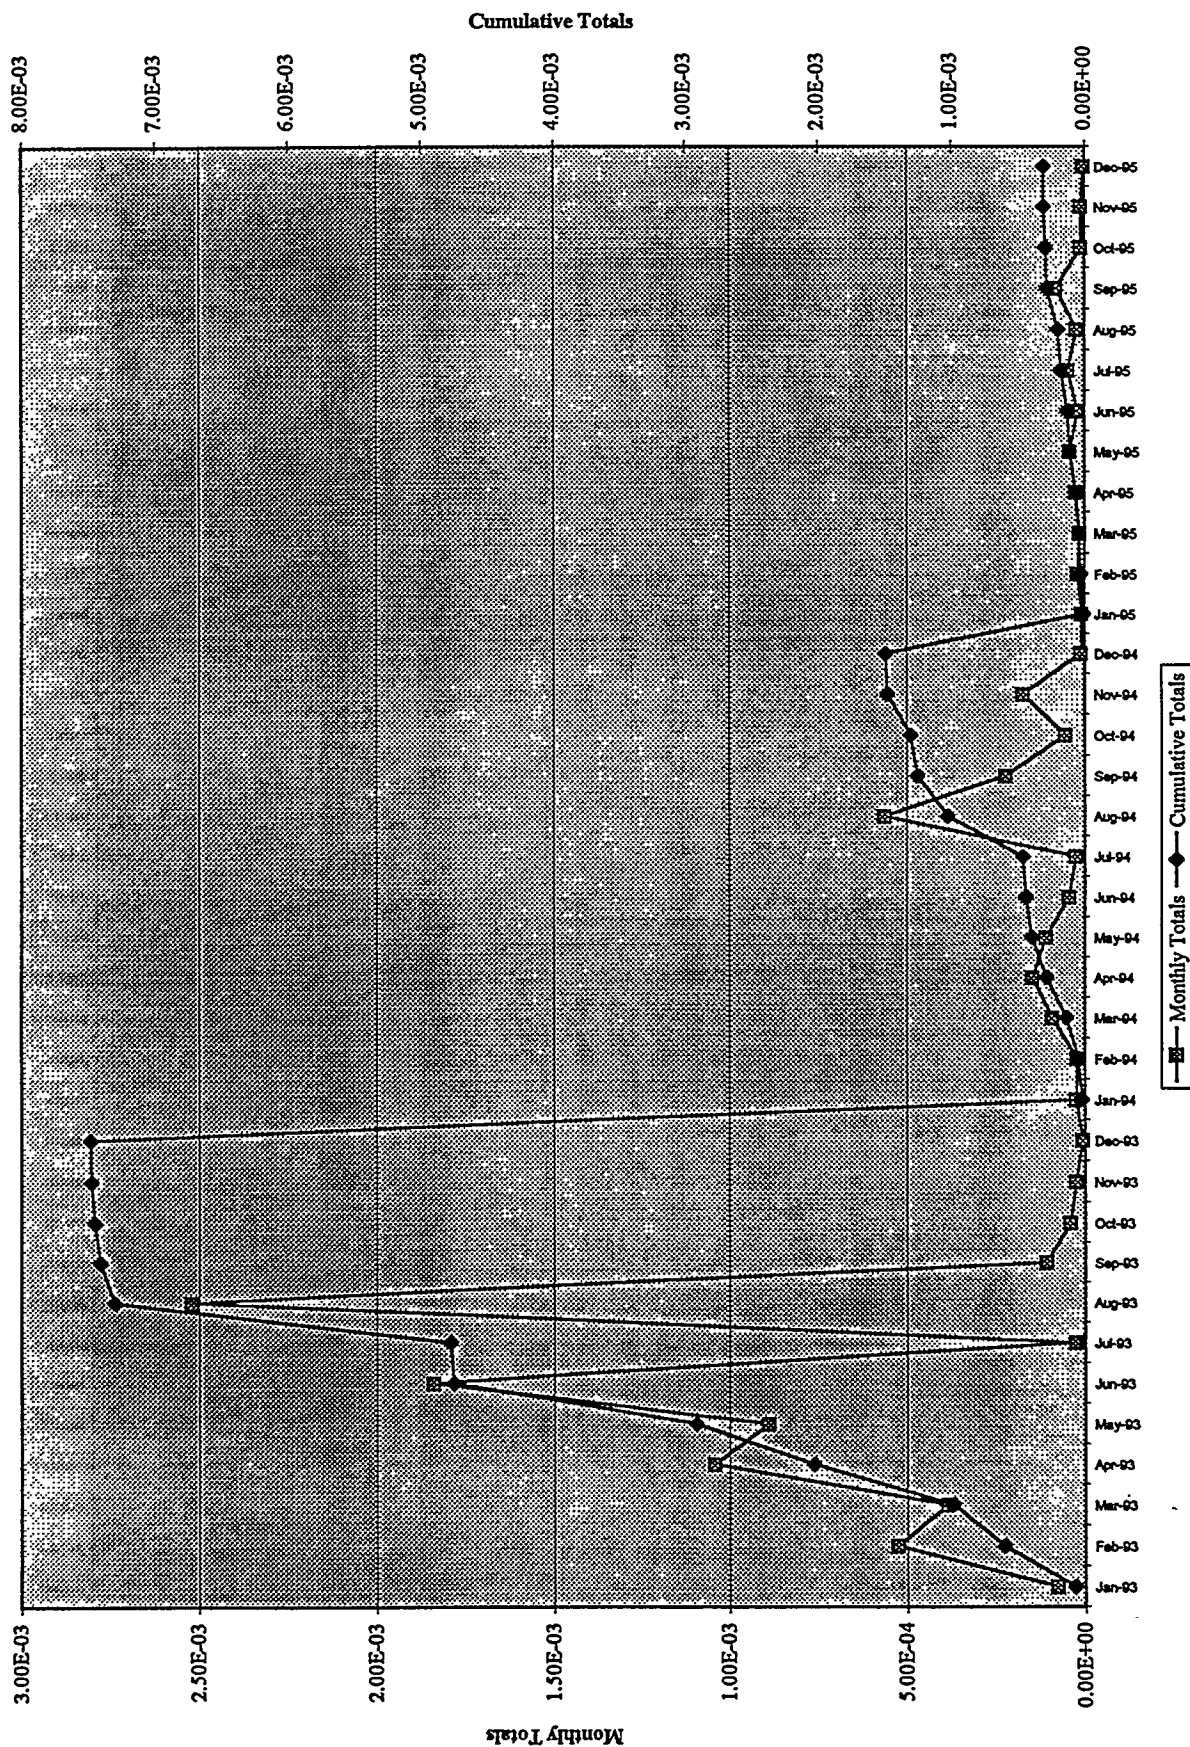


Figure 2-4
MAIN STACK EFFLUENT
Sr-90 (curies)

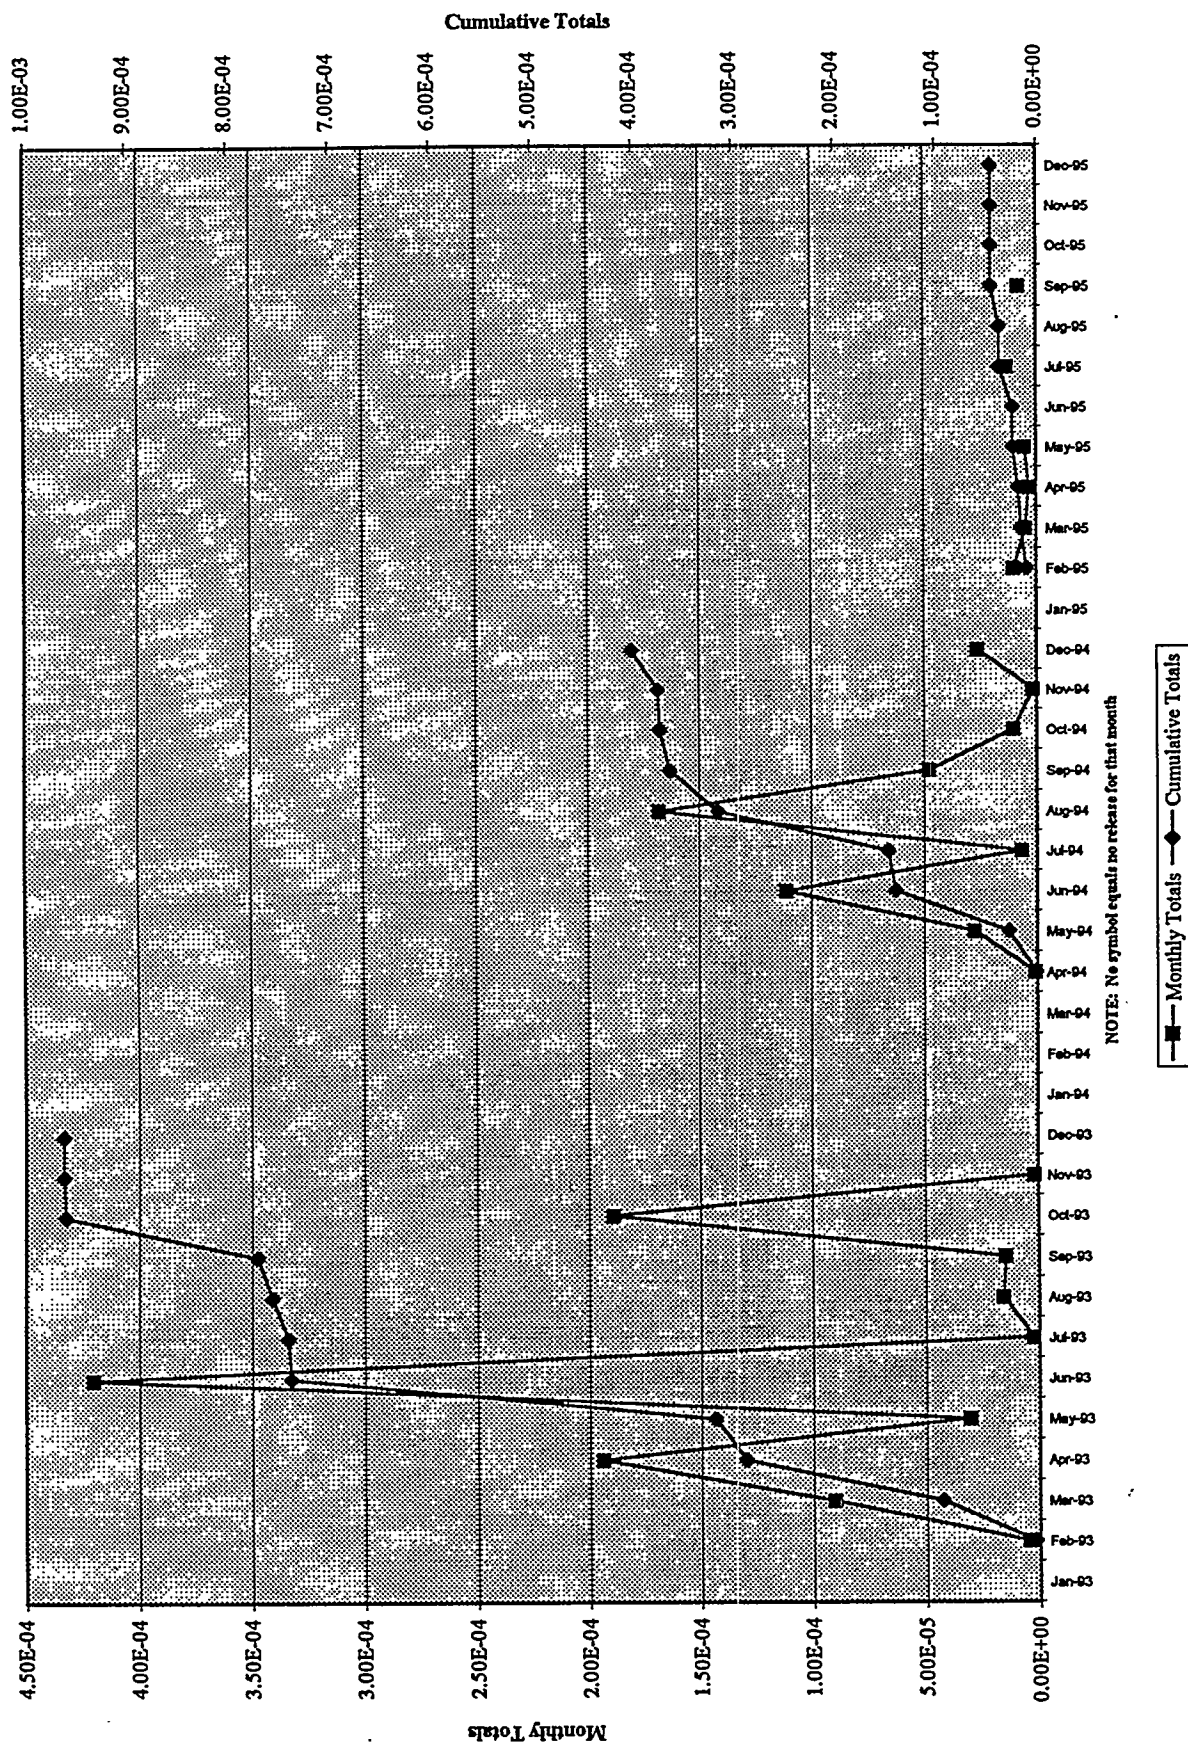


Figure 2-5
MAIN STACK EFFLUENT
Ru-106 (curies)

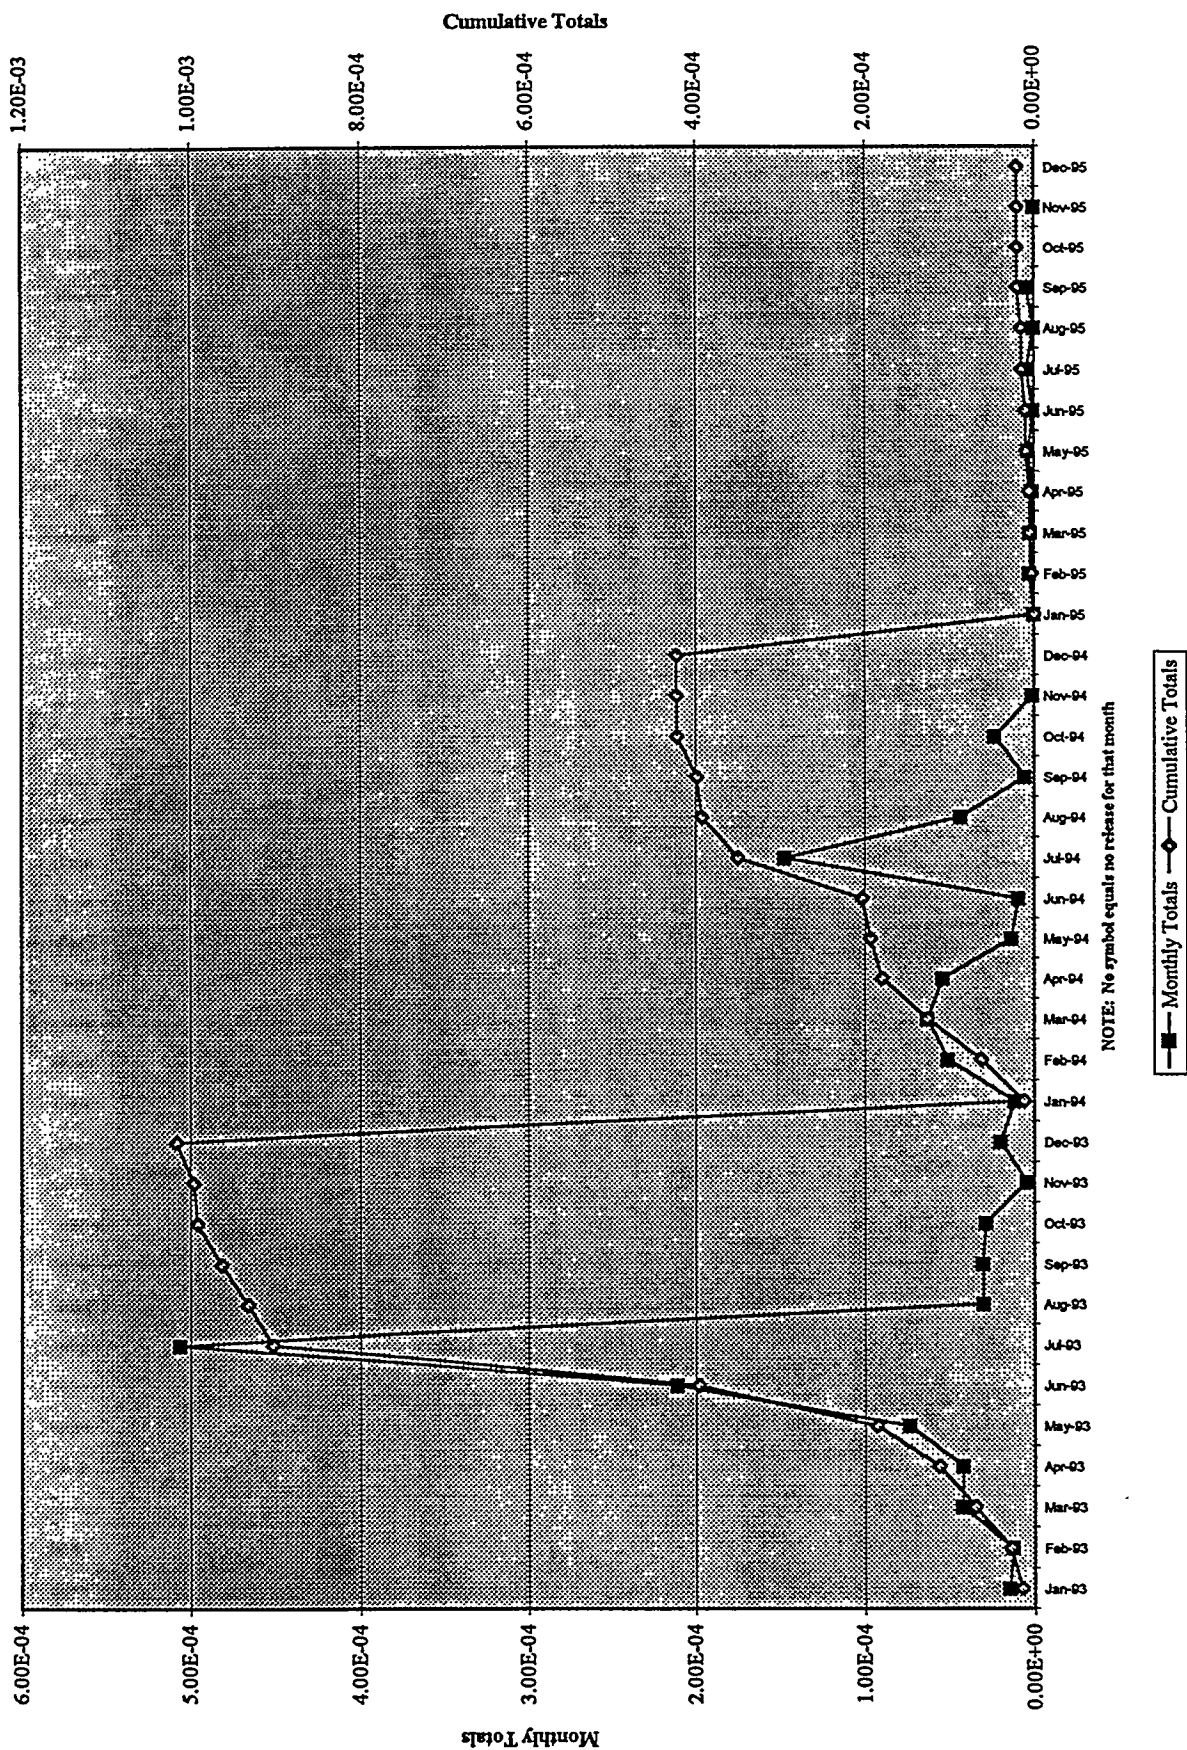


Figure 2-6
MAIN STACK EFFLUENT
Pu-Total (curies)

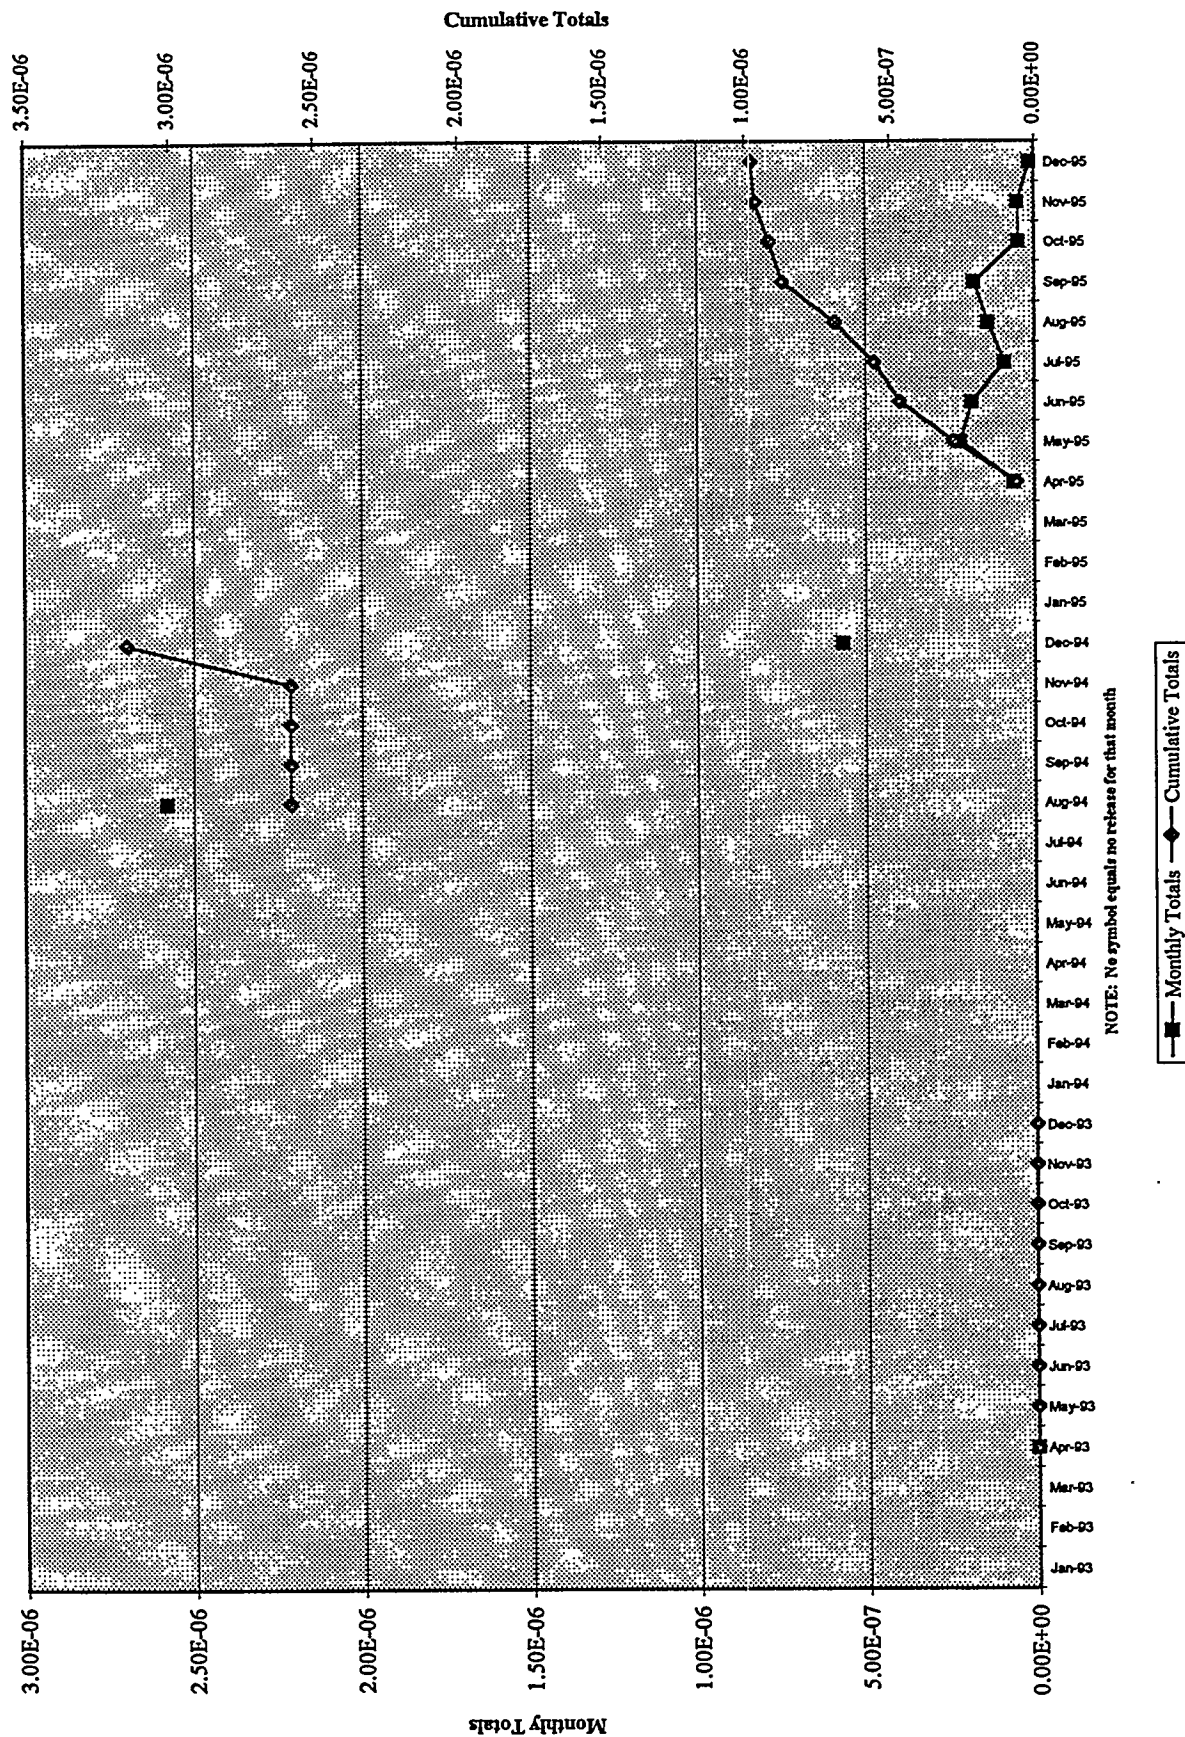


Figure 2-7
MAIN STACK EFFLUENT
Sb-125 (curies)

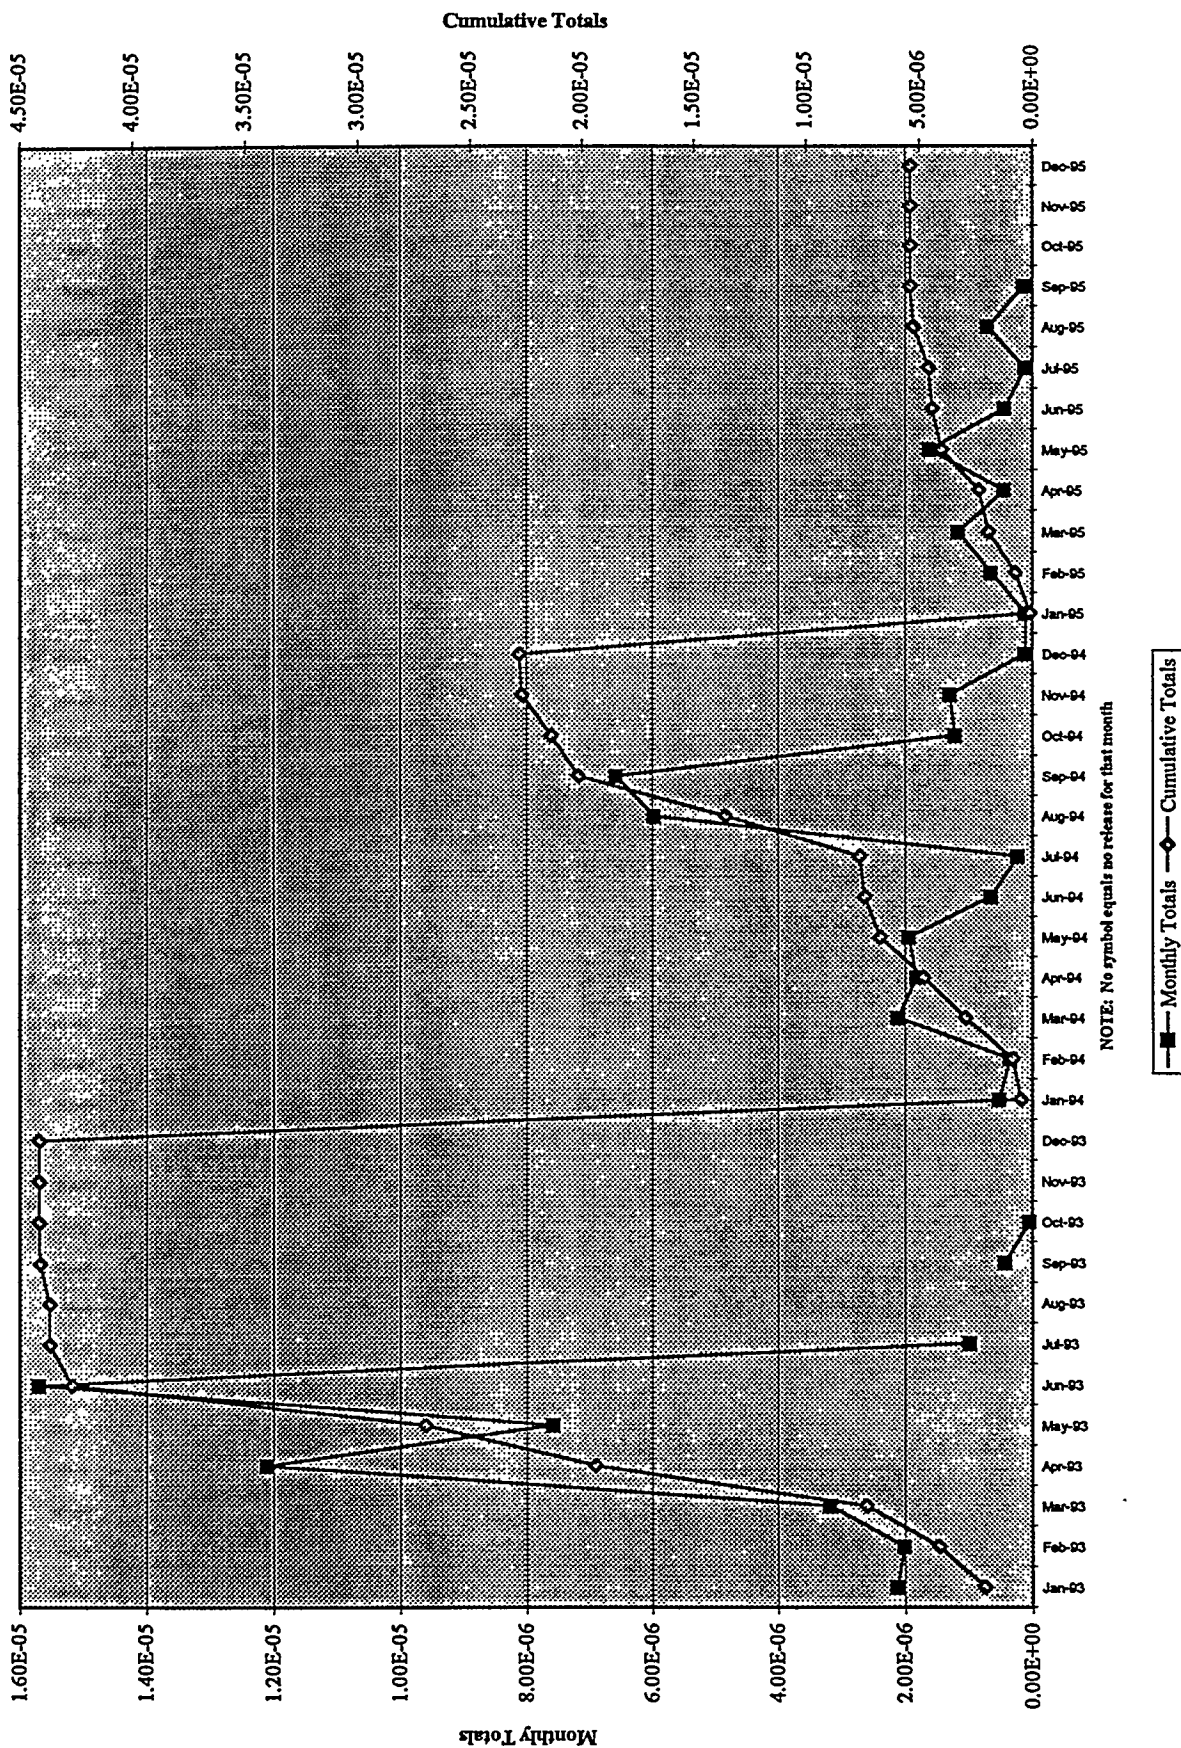


Figure 2-8
MAIN STACK EFFLUENT
C-14 (curies)

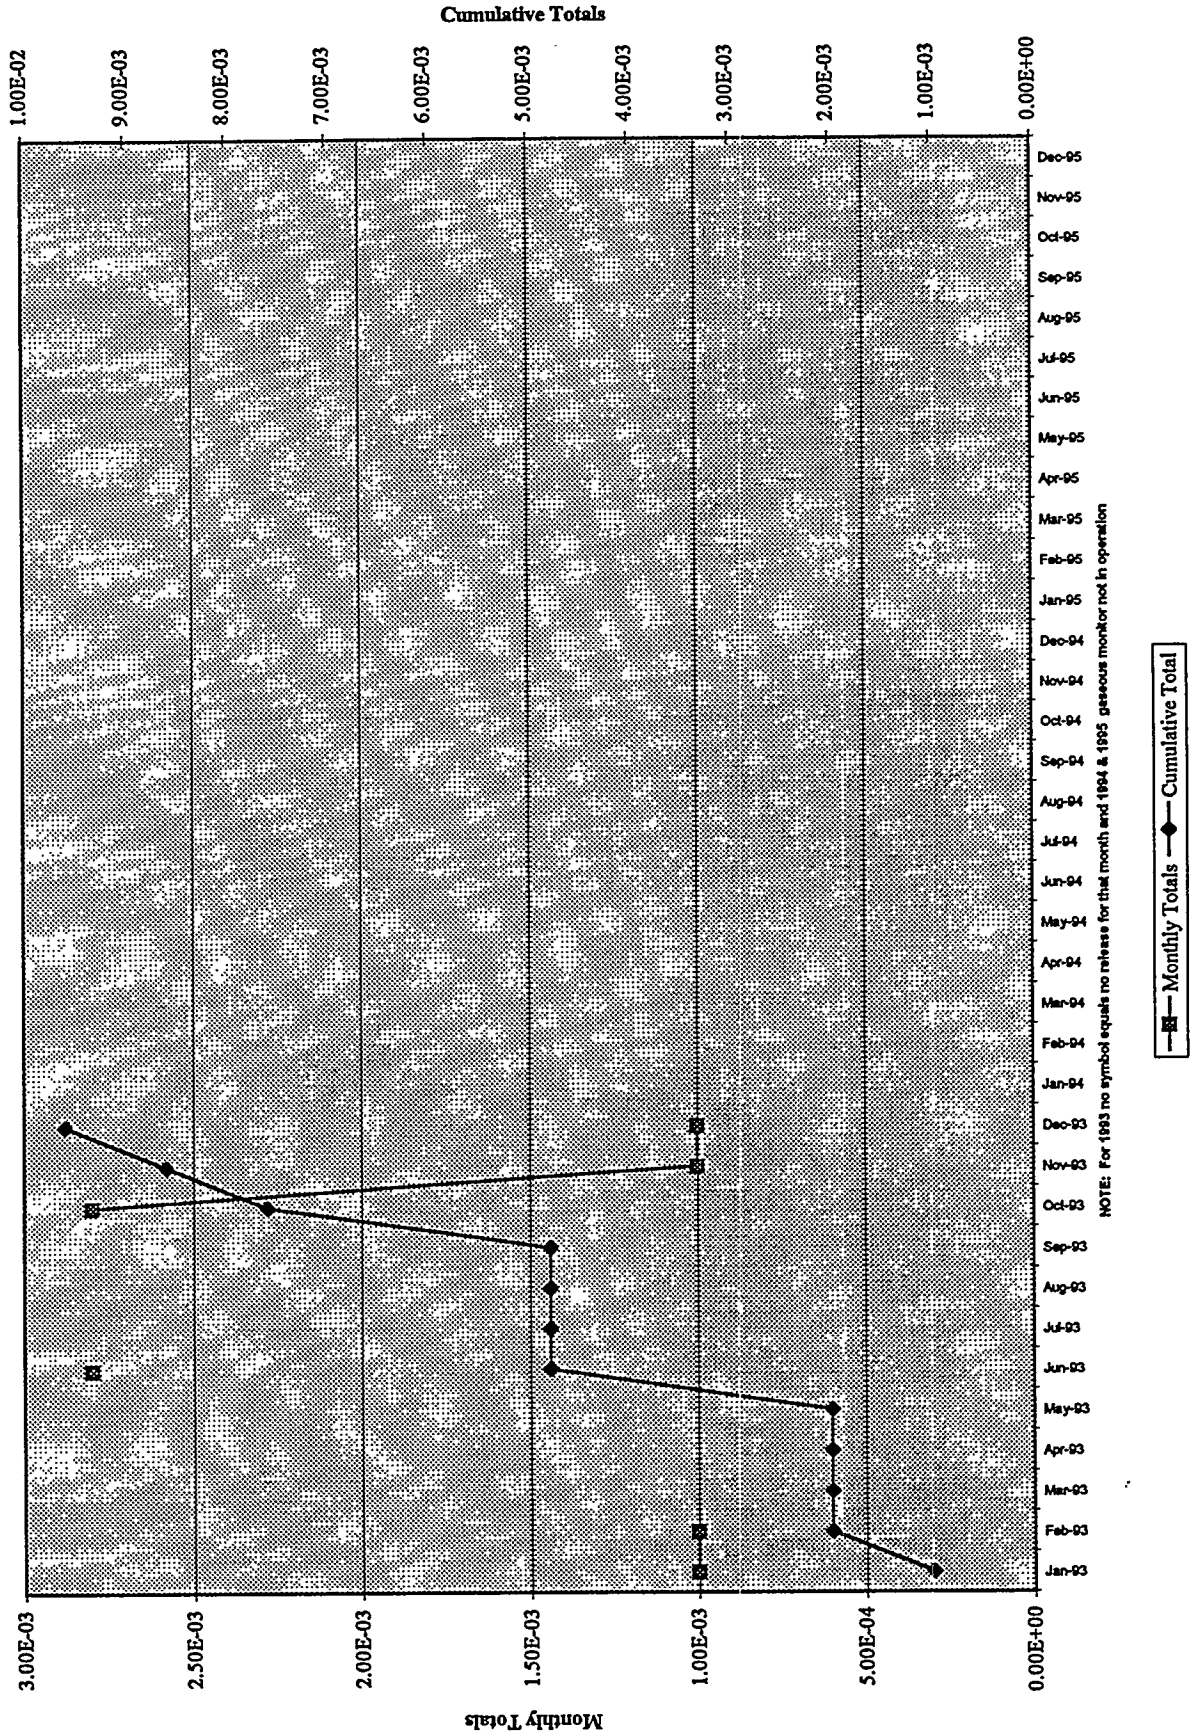


Figure 2-9
MAIN STACK EFFLUENT
H-3 (curies)


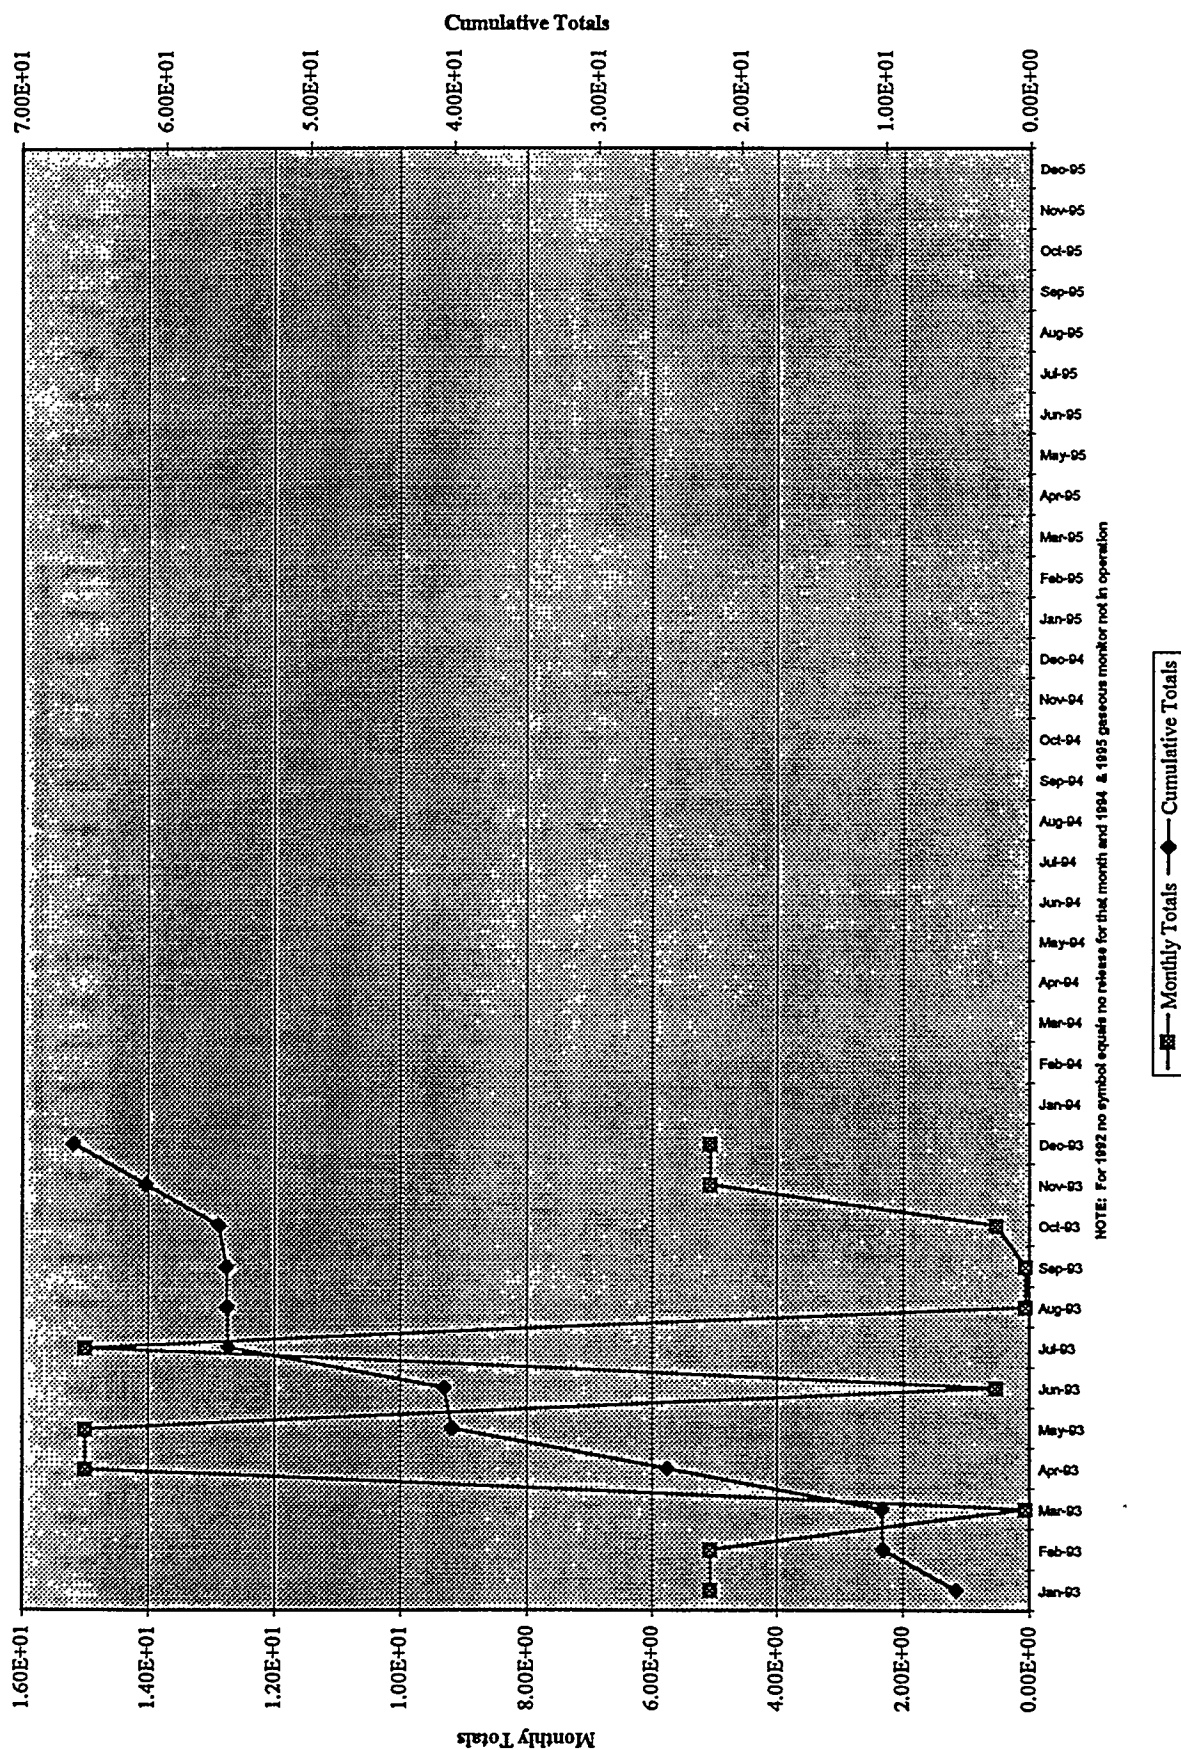


Figure 2-10
NOx Released from ICPP Main Stack (tons)

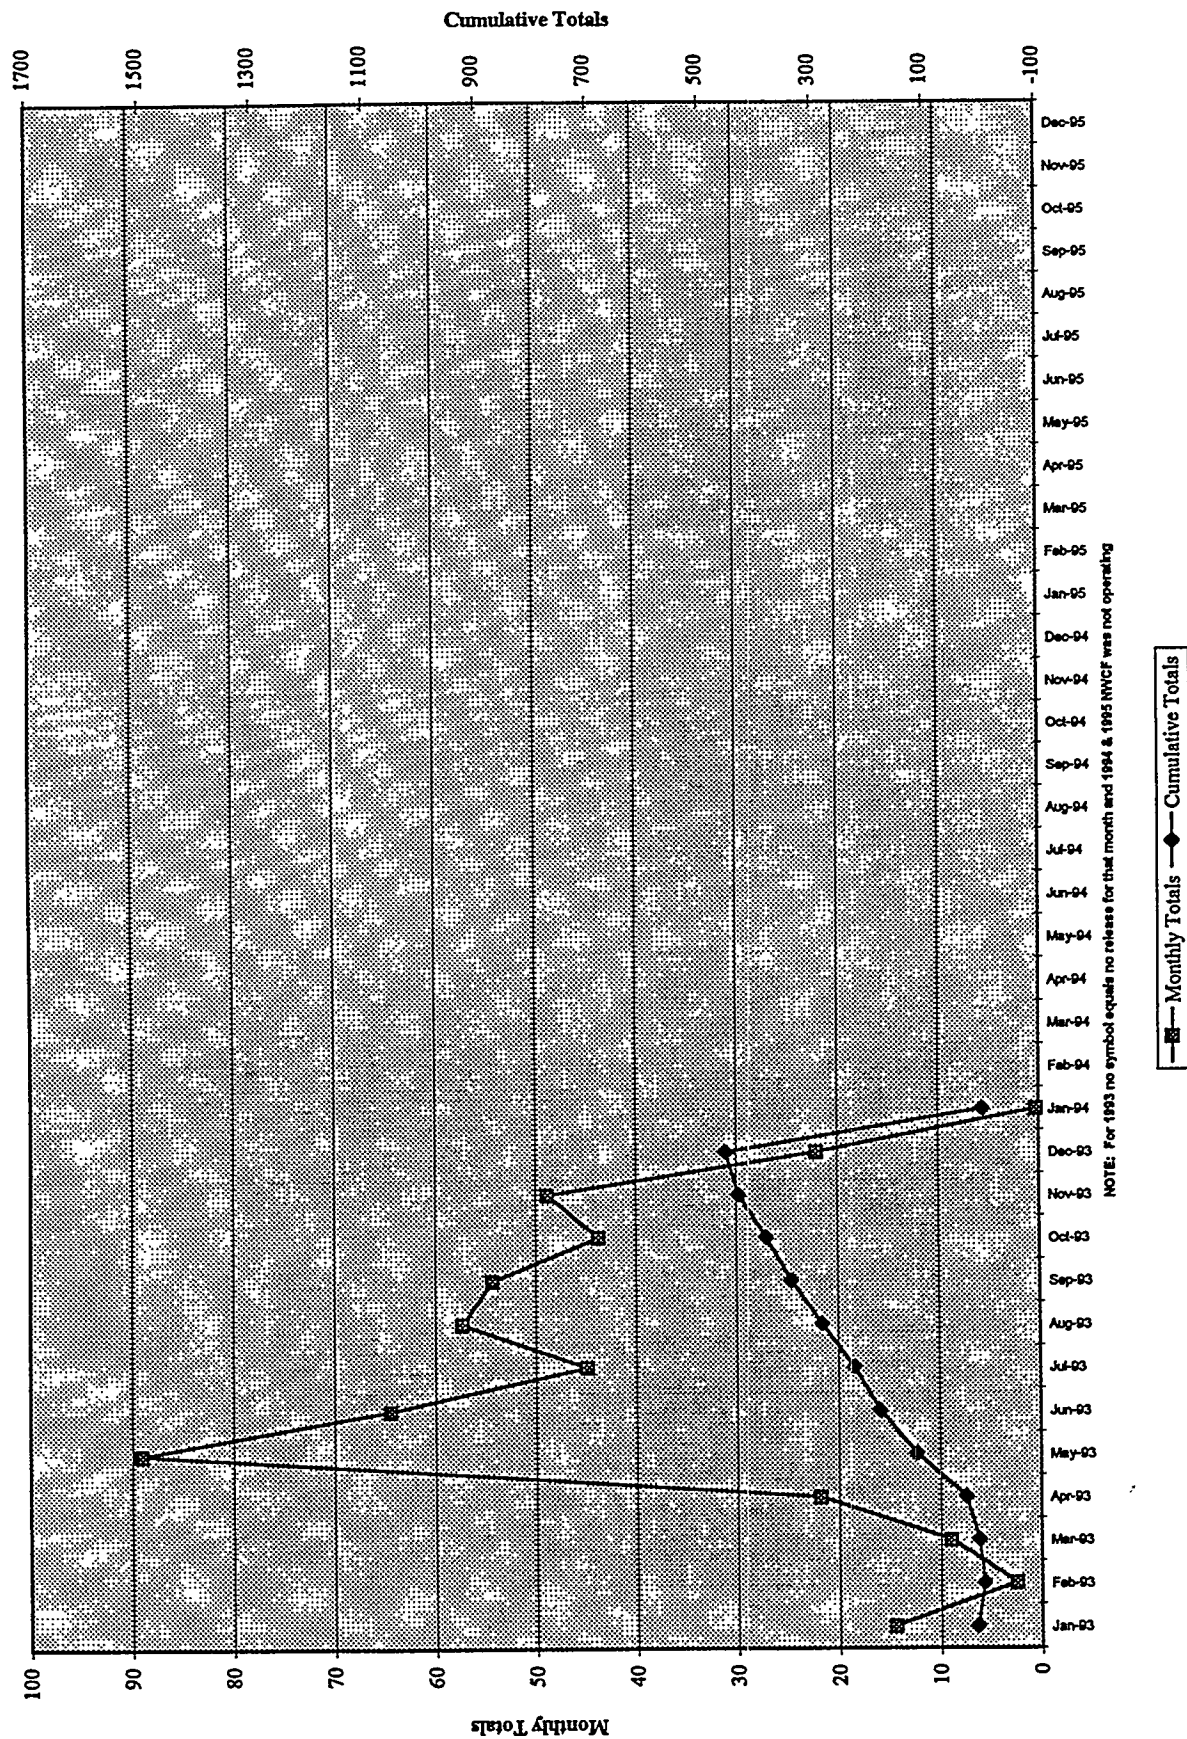

2.2 FAST Stack

Table 2-2 lists the total radionuclide releases in curies from the FAST Stack per month by radionuclide and Figure 2-11 depicts the total monthly activity. Graphic presentations for plutonium 238, plutonium 239, antimony-125, and cesium 137 showing yearly trends are given in Figures 2-12 through 2-15, respectively.

2.3 NWCF Stack

Table 2-3 presents the radioactive emissions from the NWCF VOG system. The radionuclides reported are those that have been routinely analyzed for in the ventilation stack emissions. Figure 2-16 depicts the total monthly activity.

2.4 RAL Stack

Table 2-4 presents the radioactive emissions from the RAL VOG system. The radionuclides reported are those that have been identified in the ventilation stack emissions. Figure 2-17 depicts the total monthly activity.

2.5 Coal Fired Steam Generating Facility (CFSGF)

The CFSGF stack is monitored continuously for sulfur dioxide (SO_2), nitrogen oxide (NO_x), and opacity. Carbon monoxide (CO) is calculated by using AP-42 emission factors and fuel consumption rates. Emission limits for the stack are set by the Environmental Protection Agency (EPA) and the State of Idaho. Table 2-5 lists the releases per month for the CFSGF. The facility must provide a minimum removal efficiency of 70% for SO_2 calculated as an average over a 30 day period. SO_2 emissions shall not exceed an average of 0.6 pounds per MM/Btu of fuel input averaged over a 24 hour period. NO_x emissions shall not exceed an average of 0.5 pounds per MM/Btu of fuel input averaged over a 24 hour period when the steam load is equal to or greater than 35,000 pounds per hour. NO_x emissions shall not exceed 0.7 pounds per MM/Btu of fuel input averaged over a 24 hour period when the steam load is less than 35,000 pounds per hour. Carbon monoxide shall not exceed 148.5 lbs/hr or 650.4 tons/yr. Opacity limit for the CFSGF is 20%.

Table 2-2
AIRBORNE RELEASES FROM ICPP FAST STACK FY-1995
(curies)

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	TOTAL
Co-60													
Cs-134													
Cs-137					9.02E-08								9.02E-08
Eu-152													
Eu-154													
Mn-54													
Pu-238				4.28E-09	5.72E-09	5.44E-09	4.84E-09	3.27E-09	4.28E-09	5.47E-09	4.73E-09	1.55E-09	3.96E-08
Pu-239				3.42E-09	5.31E-09	3.74E-09	4.76E-09	5.26E-09	5.54E-09	5.35E-09	4.58E-09		3.80E-08
Ru-106													
Sb-125	3.58E-07	1.32E-07	1.07E-07	3.11E-07	4.21E-07	1.14E-06	2.01E-05	1.27E-05	1.55E-05	5.58E-06	7.72E-06	9.59E-06	7.37E-05
Si-90				3.19E-08									3.19E-08
Tl-208													
TOTAL ACTIVITY	3.58E-07	1.32E-07	1.07E-07	3.51E-07	5.22E-07	1.15E-06	2.01E-05	1.27E-05	1.55E-05	5.59E-06	7.73E-06	9.59E-06	7.39E-05
TOTAL VOLUME (cubic meters)	1.10E+08	1.07E+08	9.72E+07	1.06E+08	1.03E+08	1.09E+08	9.00E+07	1.10E+08	1.09E+08	1.48E+08	1.03E+08	1.05E+08	
CUMULATIVE ACTIVITY	3.58E-07	4.90E-07	5.97E-07	9.48E-07	1.47E-06	2.62E-06	2.27E-05	3.54E-05	5.09E-05	5.65E-05	6.43E-05	7.39E-05	

BLANKS FOR Si-90 AND Pu REPRESENT BELOW DETECTION AND REMAINING BLANKS REPRESENT NOT DETECTED IN THE GAMMA SCAN

Figure 2-11
FAST STACK EFFLUENT
Total Activity (curies)

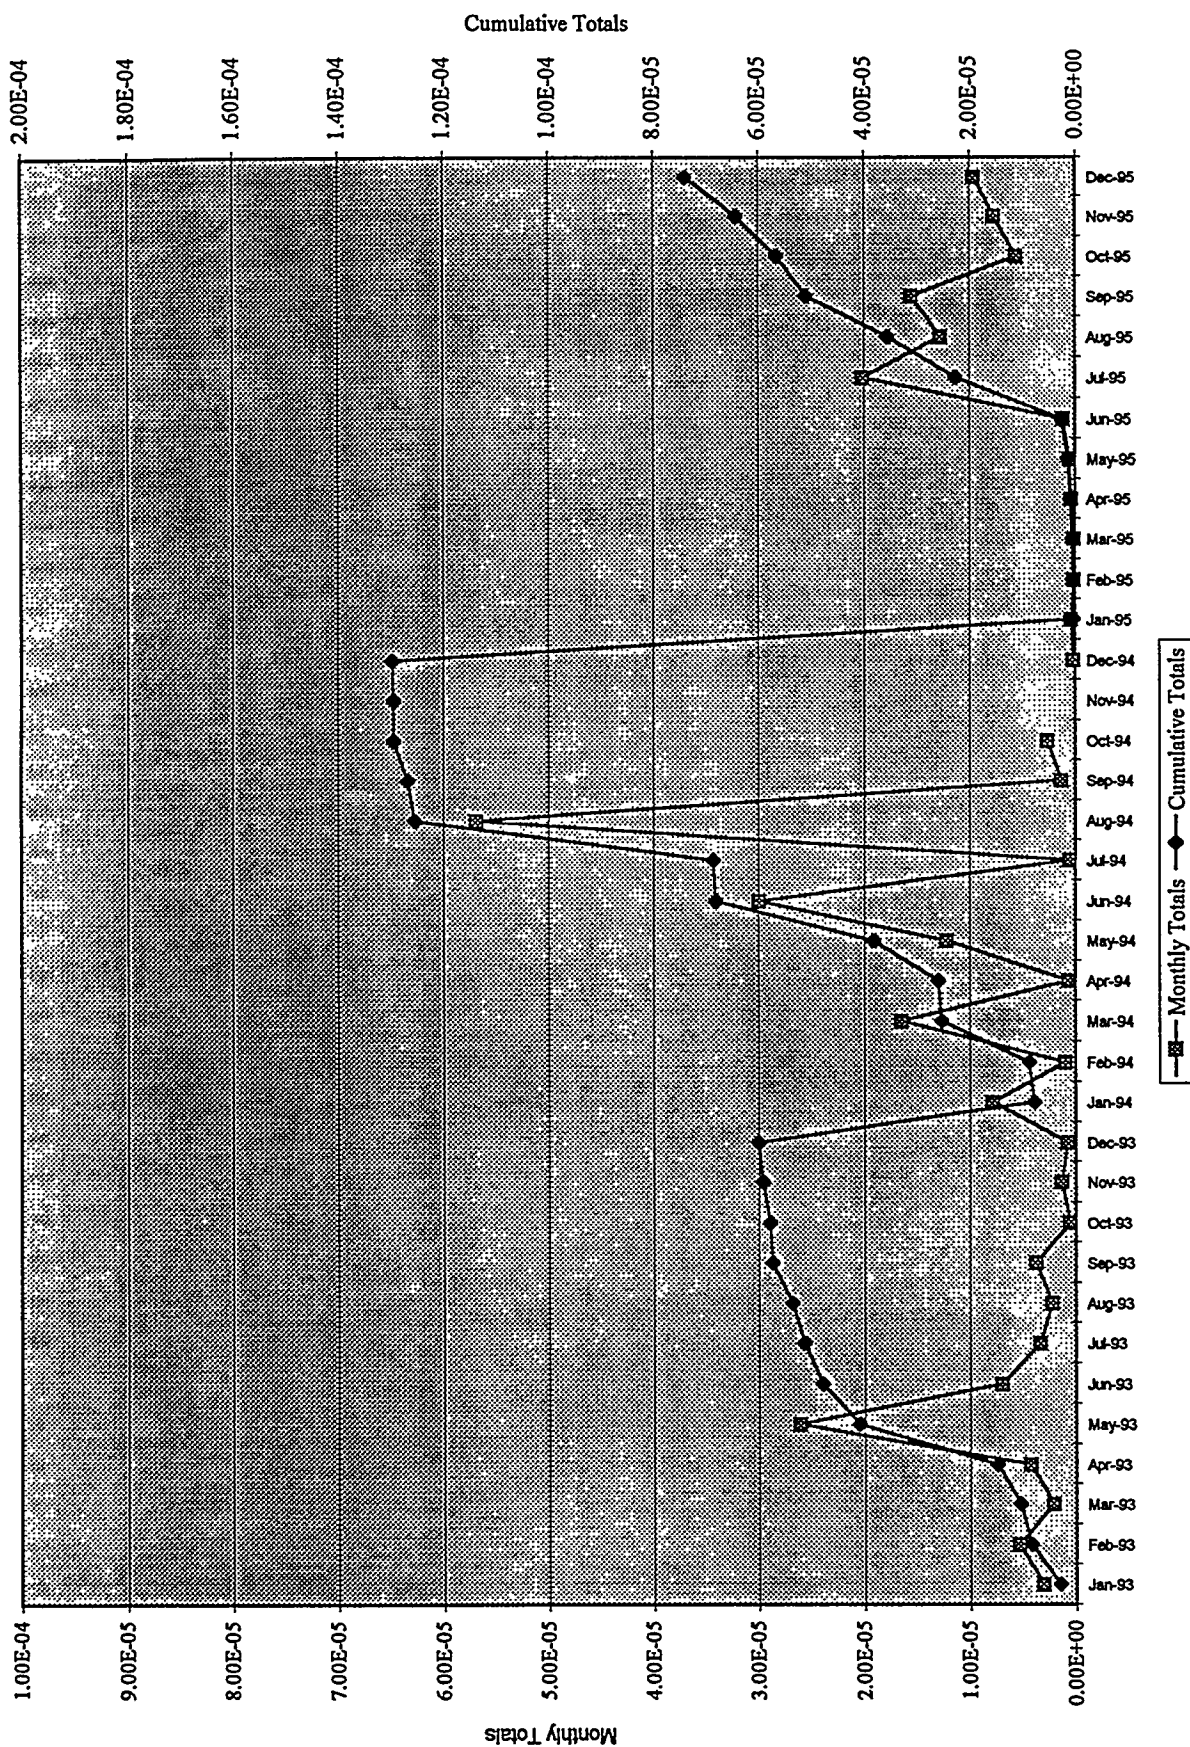


Figure 2-12
FAST STACK EFFLUENT
Pu-238 (curies)

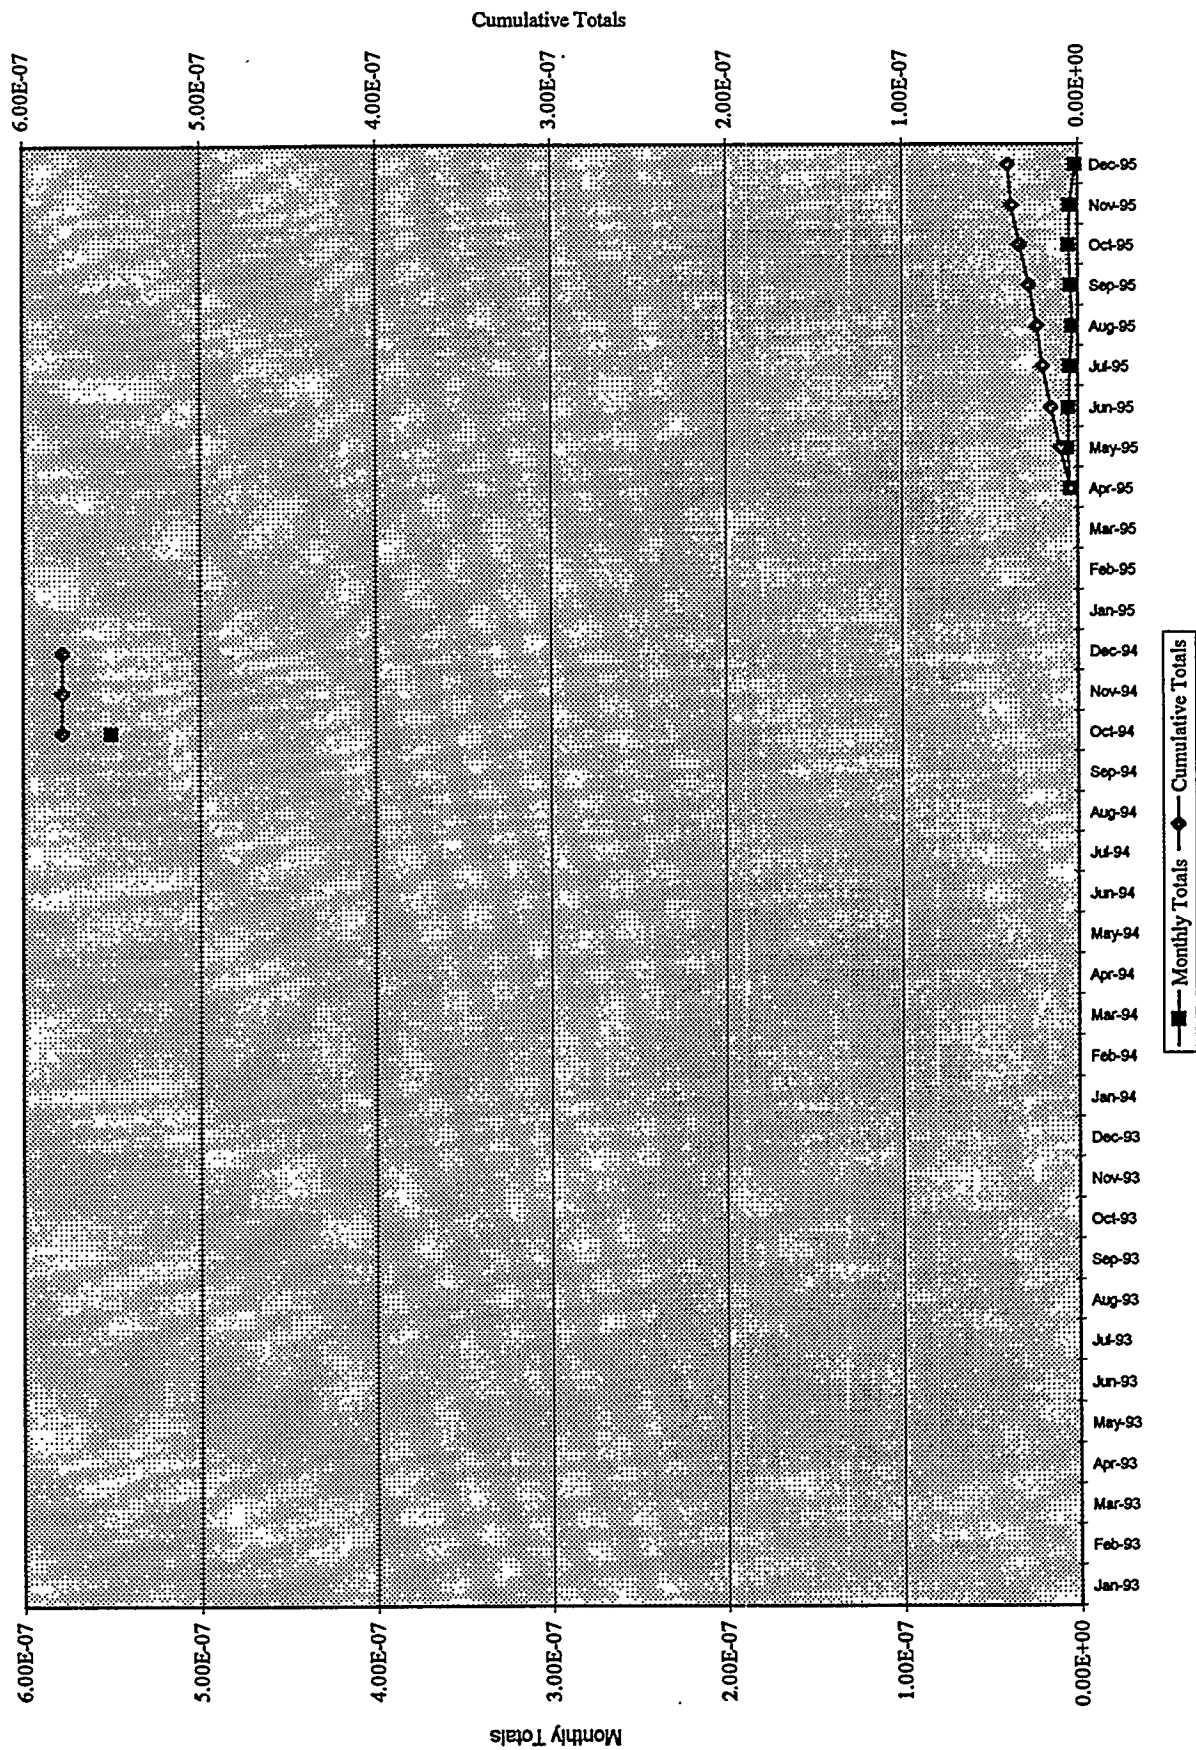


Figure 2-13
FAST STACK EFFLUENT
Pu-239 (curies)

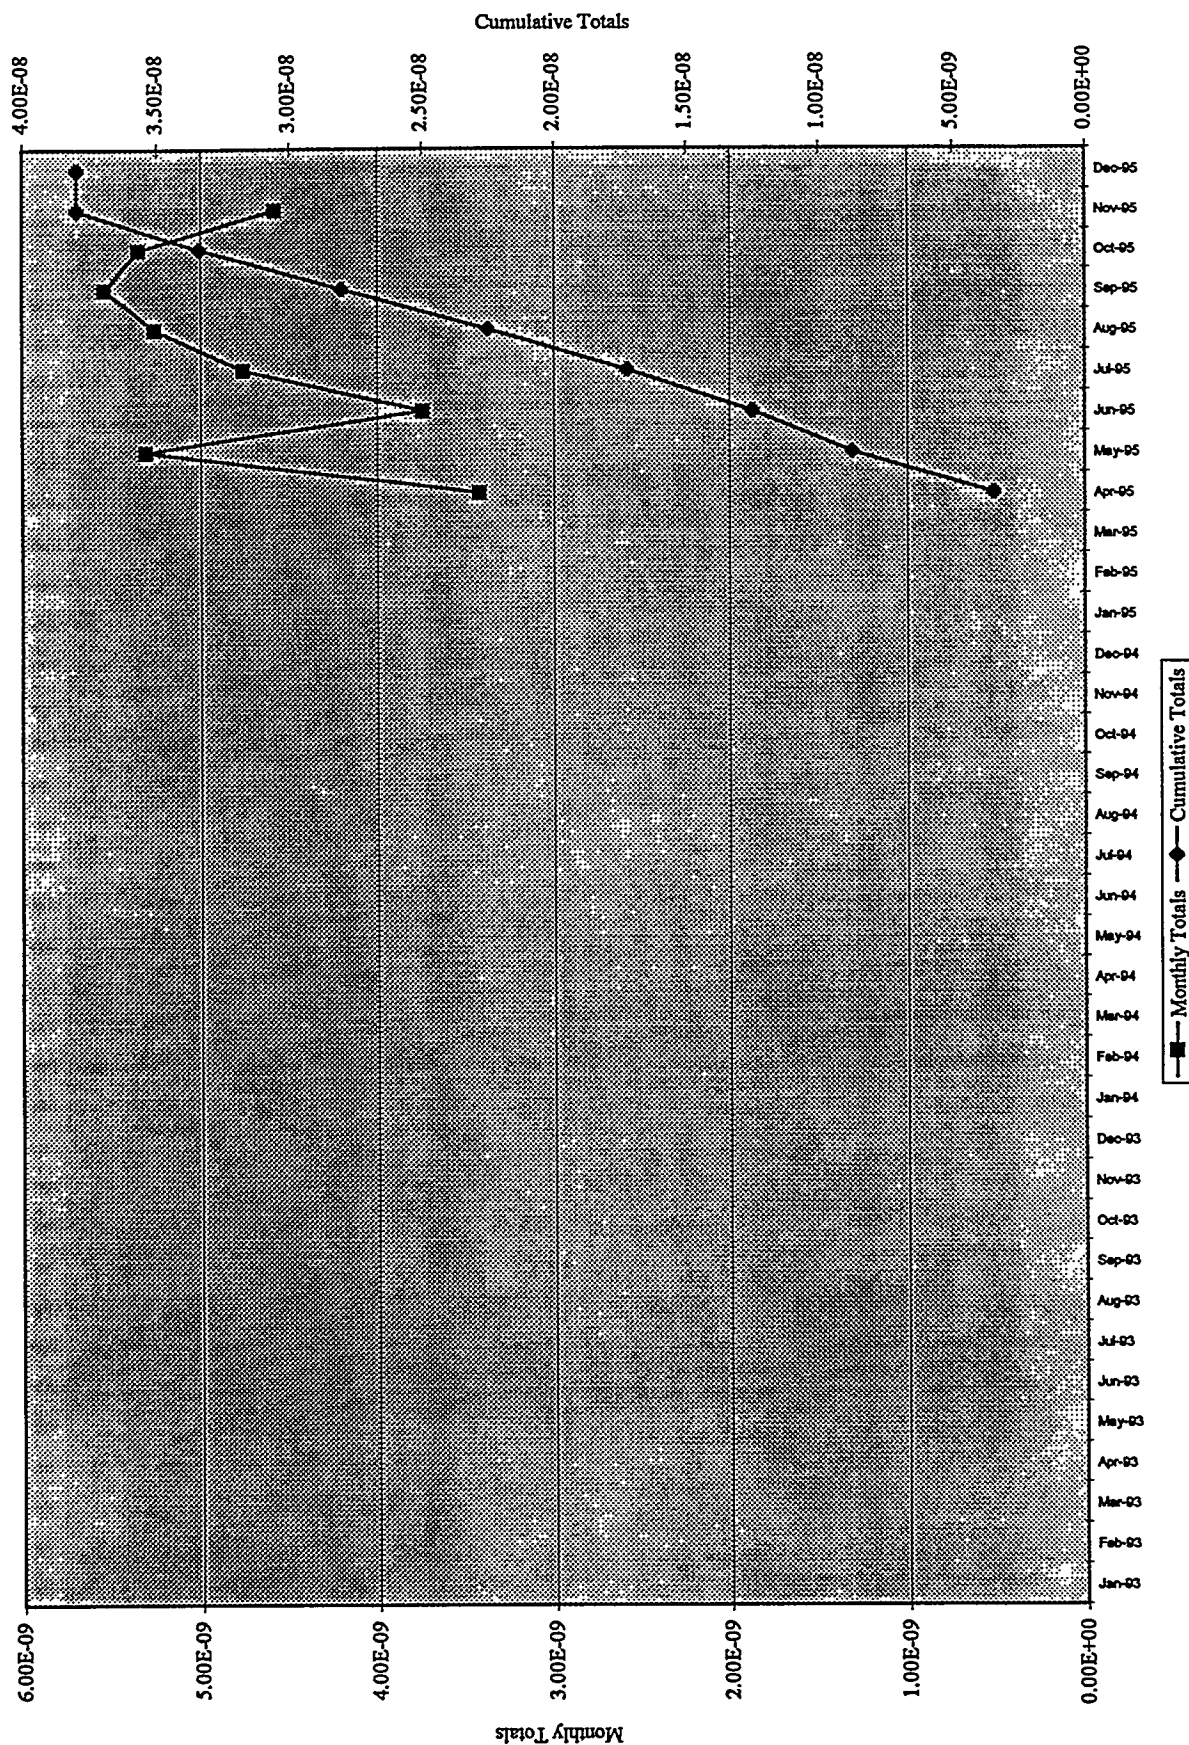


Figure 2-14
FAST STACK EFFLUENT
Sb-125 (curies)

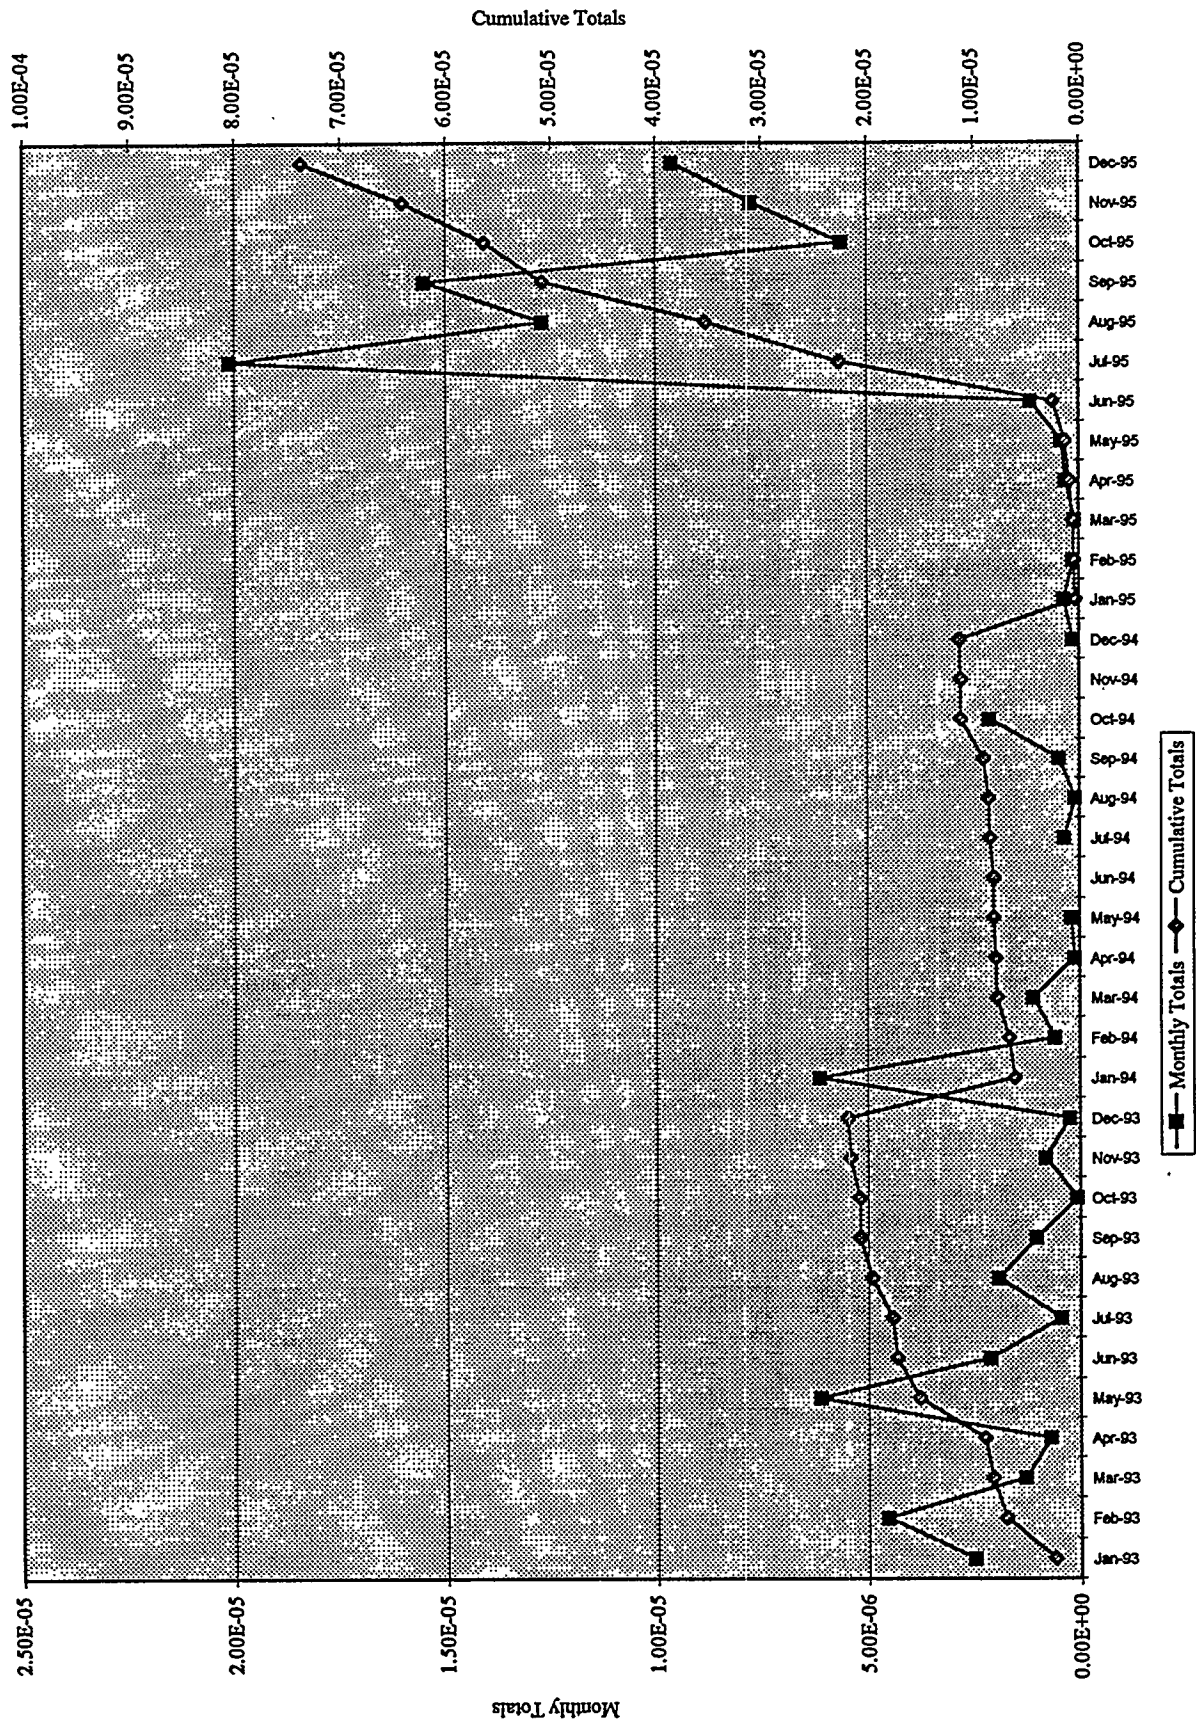


Figure 2-15
FAST STACK EFFLUENT
Cs-137 (curies)

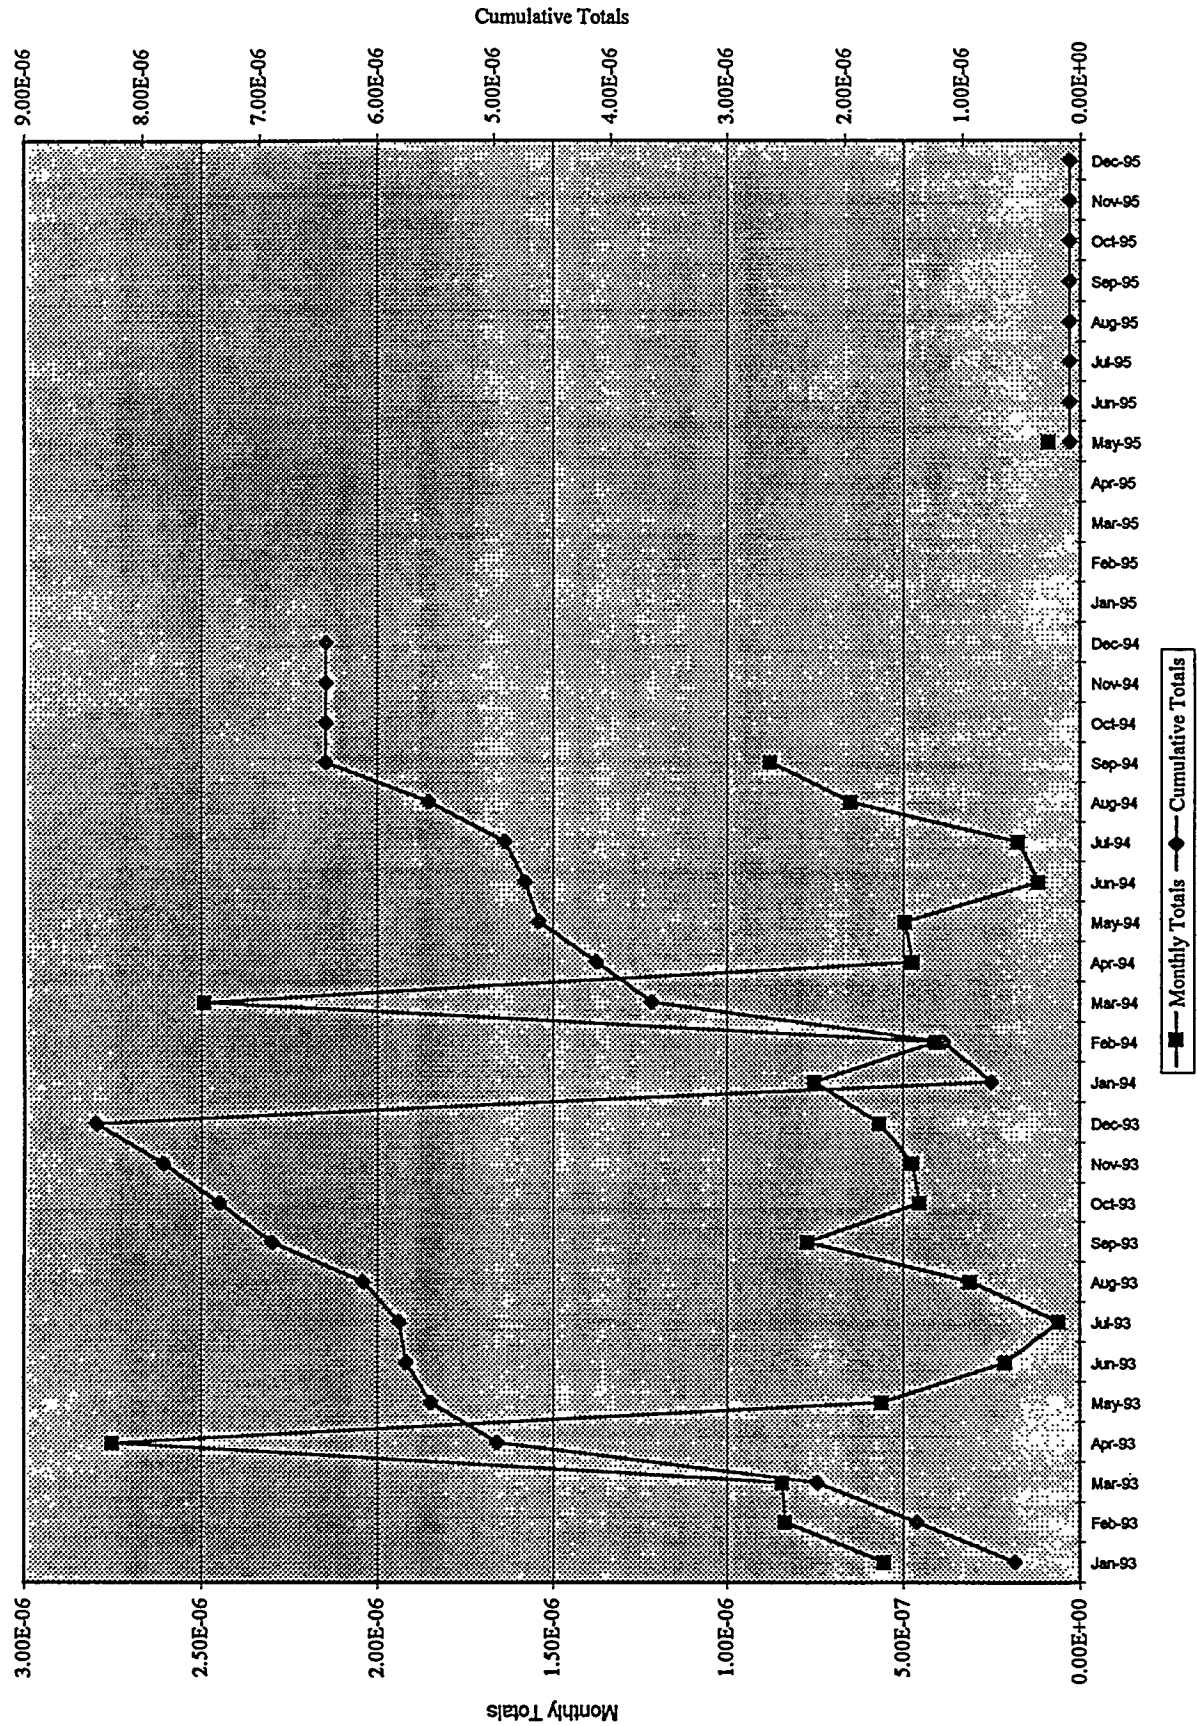


Table 2-3
AIRBORNE RELEASES FROM ICPP NWCF CY-1995
(curies)

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	TOTAL
Cs-137													
Pu-238													
Pu-239													
Ru-106													
Sb-125													
Sr-90					3.53E-08								3.53E-08
TOTAL ACTIVITY					3.53E-08								3.53E-08
TOTAL VOLUME (cubic meters)	7.56E+07	7.86E+07	7.54E+07	9.90E+07	6.74E+07	7.62E+07	3.73E+07	5.89E+07	9.09E+07	8.00E+07	1.01E+08	9.36E+07	
CUMULATIVE ACTIVITY					3.53E-08	3.53E-08	3.53E-08	3.53E-08	3.53E-08	3.53E-08	3.53E-08	3.53E-08	3.53E-08

BLANKS REPRESENT BELOW DETECTION LIMITS

Figure 2-16
NWCFF STACK EFFLUENT
Total Activity (curies)

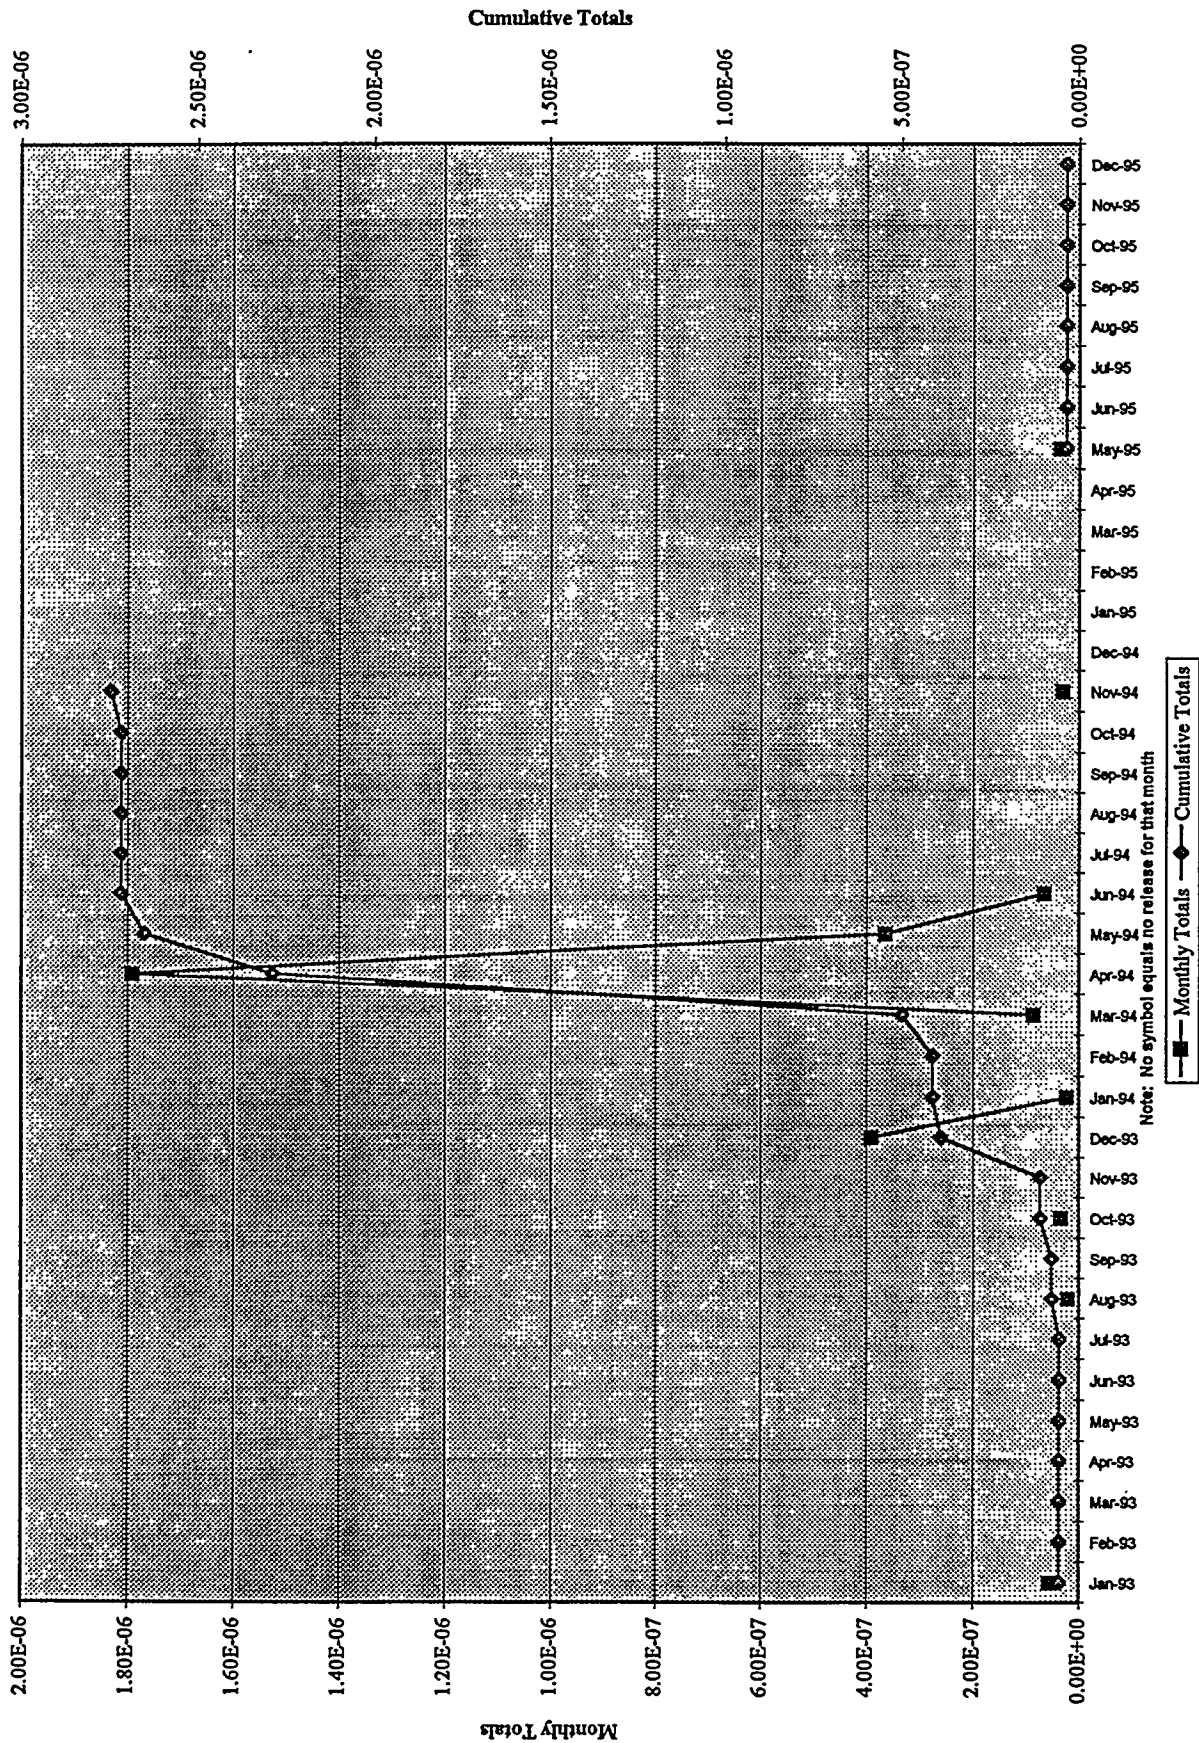


Table 2-4
AIRBORNE RELEASES FROM ICPP RAL STACK CY-1995
(curies)

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	TOTAL
Co-60													
Cs-134													
Cs-137	1.05E-07												1.05E-07
Pu-238				2.69E-09	3.43E-09	3.99E-09	2.91E-09	2.74E-09	4.71E-09	2.32E-09	4.68E-09	3.22E-12	2.75E-08
Pu-239				3.45E-09	4.49E-09	3.53E-09	2.98E-09	3.26E-09	3.36E-09	3.18E-09	4.48E-09	6.32E-10	2.94E-08
Ru-106													
Sb-125													
Sr-90				1.01E-07									1.01E-07
TOTAL ACTIVITY	1.05E-07			1.07E-07	7.92E-09	7.52E-09	5.89E-09	6.00E-09	8.07E-09	5.50E-09	9.16E-09	6.35E-10	2.63E-07
TOTAL VOLUME (cubic meters)	2.08E+07	2.08E+07	2.08E+07	2.02E+07	2.08E+07	2.02E+07	2.08E+07	2.08E+07	2.02E+07	2.08E+07	2.02E+07	2.08E+07	
CUMULATIVE ACTIVITY	1.05E-07	1.05E-07	1.05E-07	2.12E-07	2.20E-07	2.28E-07	2.33E-07	2.39E-07	2.48E-07	2.53E-07	2.62E-07	2.63E-07	

Blanks for Sr-90 and Pu represent below detection and remaining blanks represent not detected in the gamma scan

Figure 2-17
RAL STACK EFFLUENT
Total Activity (curies)

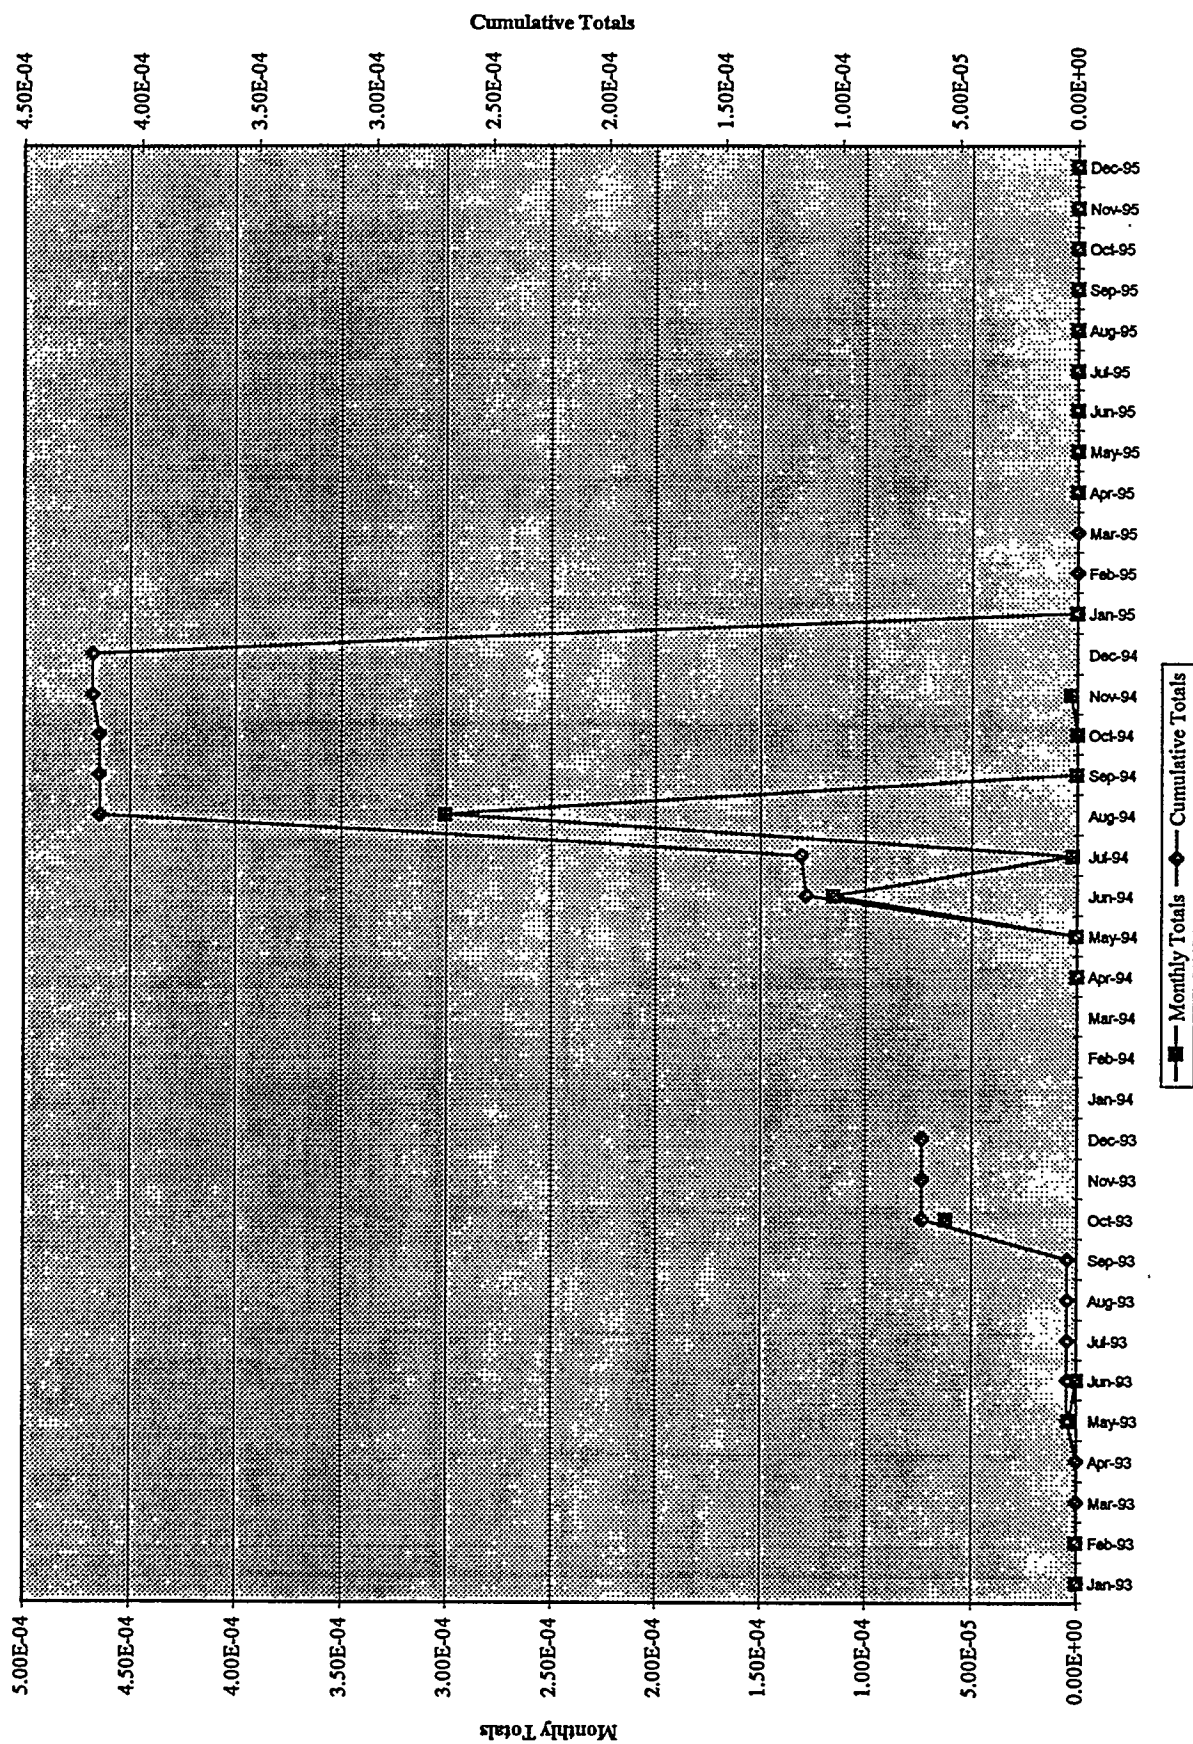


Table 2-5
CY-1995
COAL FIRED STEAM GENERATOR FACILITY

	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	EMISSION LIMITATIONS
COAL BURNED (TONS)	1448	1370	1479	1298	1097	686	742	95	0	701	1332	1513	N/A
CUMULATIVE COAL BURNED (TONS)	1448	2818	4297	5595	6692	7378	8120	8215	8215	8916	10248	11761	N/A
MM/Btu/#Burned	0.012695	0.012695	0.012695	0.012695	0.012695	0.012668	0.012668	0.012668	0.000000	0.012668	0.012668	0.012668	N/A
% Sulfur	0.43	0.43	0.43	0.43	0.43	0.37	0.37	0.37	0	0.37	0.37	0.37	N/A
#NO _x /MM/Btu	0.37	0.42	0.38	0.41	0.51	0.51	0.6	0.65	0	0.43	0.45	0.4	SEE FOOTNOTE
#SO ₂ /MM/Btu	0.03	0.03	0.06	0.04	0.09	0.08	0.1	0.11	0	0.04	0.09	0.09	0.6
Permit Steam Flow Range A or B	B	A	B	A	A	A	A	A	0	A	A	A	SEE FOOTNOTE
% SO ₂ Removed	95	95.2	91.5	93.1	81	84	83.7	81.5	0	93.2	86.7	86.4	70% OR GREATER
% Opacity	5	3	1	1	1	1	1	1	0	2	3	3	
*Carbon Monoxide (CO) lbs/hr	33.3	34.94	33.1	25.8	20.8	15.6	14.8	14.8	0	22.8	24.7	30.4	148.5
Carbon Monoxide (CO) tons	11.67	11.74	12.33	9.32	7.75	5.08	5.49	0.66	0	4.62	8.9	11.3	
Carbon Monoxide (CO) TONS CUMULATIVE	11.67	23.41	35.74	45.06	52.81	57.89	63.38	64.04	64.04	68.66	77.56	88.86	650.4

Opacity = <20%

Coal Burned (tons) = N/A

mm BTU/burned = N/A

% Sulfur = N/A

Nitrogen oxide (lbs. NO_x/mmBTU) emissions shall not exceed an average of 0.5 pounds per million BTUs (Range B) for steam flow greater or equal to 35000 lbs/hr.

Nitrogen oxide (lbs. NO_x/mmBTU) emissions shall not exceed an average of 0.7 pounds per million BTUs (Range A) for steam flow less than 35000 lbs/hr.

Sulfur dioxide (lbs. SO₂/mmBTU) emissions shall not exceed an average of 0.6 pounds per million BTU of fuel input, averaged over a 24 hour period.

%SO₂ removal = 70% or greater and shall be calculated as an average over a 30 day period.

Steam flow = N/A (Range B = steam load equal to or greater than 35000 pounds per hour and Range A = steam load less than 35000 pounds per hour)

Carbon monoxide (CO) emissions for the boilers shall not exceed an average of 148.5 lbs/hr averaged over a 30 day period.

III. LIQUID MONITORING

1. INTRODUCTION

Liquid monitoring discussed in this report includes: 1) Service Waste System; 2) Percolation Ponds 1 & 2) Sewage Treatment Plant; and 4) Production and Potable Water Wells. Quality Assurance objectives for measurement data and laboratory performance are listed in both the Quality Assurance Project Plan for the Analysis of Environmental Samples by the LITCO Analytical Chemistry Section and the Special Technologies Quality Assurance Project Plans for Work Subject to EPA QAMS-005/80.

2. LIQUID RELEASES TO THE ENVIRONMENT

2.1 Service Waste System

Liquid waste streams are generated from all areas of the ICPP. The waste streams vary in volume. Waste streams are disposed of through the Service Waste System. The Liquid Effluent Treatment and Disposal (LET&D) Facility began operation on January 1, 1993.

Wastewater Land Application Permit (WLAP) LA-000130 for the Idaho Chemical Processing Plant (ICPP) percolation ponds was effective September 20, 1995. The permit authorizes construction, installation, modification or operation of a WLAP treatment system in conformance with requirements, limitations and conditions required in the permit.

Isotopic radionuclide and inorganic chemical release data for the Service Waste System for each month and year totals are presented in Table 3-1 and 3-2. Table 3-3 lists the monthly DCG release ratios respectively for individual radionuclides. DCGs are not release limits, but rather are screening values for considering Best Available Technology (BAT) for discharges and dose estimates.

The radionuclides reported are those that have been found in the past. Listed radionuclides that do not have values shown were not observed during the reporting month or were below detection limits. Figure 3-1 depicts the total monthly activity released to the active Percolation Pond at ICPP.

Figure 3-2 depicts plutonium and figures 3-3 through 3-5 depicts uranium-234, uranium-235, and uranium-238 found in the service waste stream. Figures 3-6 and 3-7 present trend information for select radionuclides in the Service Waste.

The ratio is calculated by dividing the detected radionuclide concentration by the established limit. Governmental regulations state that a corrected total ratio of 1.0 equals allowable radionuclide concentrations. The ICPP did not approach the total allowable release at any time during 1995. The ICPP did not exceed a ratio of 1.0 during any month in 1995.

Table 3-1
LIQUID RELEASES FROM ICPP SERVICE WASTE CY-1995
(curies)

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	TOTAL
C-14													
Co-57									6.65E-05				6.65E-05
Co-60		9.26E-05	2.37E-05										1.16E-04
Cs-134													
Cs-137		3.17E-05	3.93E-05										7.10E-05
Eu-152			7.74E-04	1.62E-03	2.75E-03		1.01E-03						6.15E-03
H-3										1.19E-01		8.72E-02	2.06E-01
I-129													
Pu-238	5.39E-06				1.57E-05	9.51E-06							3.06E-05
Pu-239													
Pu-241												1.89E-04	1.89E-04
Ru-106													
Sb-125													
Sr-90	9.88E-05					1.77E-04				1.15E-03		1.89E-04	1.61E-03
U-234	2.69E-04	2.31E-04	2.59E-04	7.03E-04	2.97E-04	2.31E-04	2.15E-04	4.63E-04	2.43E-05	3.05E-04	2.35E-04	2.33E-04	3.47E-03
U-235		6.17E-06	8.62E-06		8.72E-06	4.08E-06	6.73E-06	2.74E-05	1.15E-06	8.48E-06	6.92E-06	8.72E-06	8.70E-05
U-238	1.29E-04	1.03E-04	1.22E-04	3.27E-04	1.40E-04	1.09E-04	9.43E-05	3.60E-04	1.15E-05	1.36E-04	1.11E-04	1.16E-04	1.76E-03
TOTAL ACTIVITY	5.02E-04	4.64E-04	1.23E-03	2.65E-03	3.21E-03	5.31E-04	1.33E-03	8.50E-04	1.03E-04	1.21E-01	3.53E-04	8.79E-02	2.20E-01
TOTAL VOLUME (liters)	1.50E+08	1.54E+08	1.44E+08	2.20E+08	1.74E+08	1.36E+08	1.35E+08	1.71E+08	1.43E+07	1.70E+08	1.38E+08	1.45E+08	
CUMULATIVE ACTIVITY	5.02E-04	9.67E-04	2.19E-03	4.84E-03	8.05E-03	8.59E-03	9.91E-03	1.08E-02	1.09E-02	1.31E-01	1.32E-01	2.20E-01	

Blanks for H-3, C-14, Sr-90, I-129, U-234, U-235, U-238, Pu-238, Pu-239 and Pu-241 indicate below detection limit and remaining radionuclides represent not detected in gamma scan.

Table 3-2
ICPP SERVICE WASTE CY-1995
(mg/L)

SUBSTANCE	JAN.	FEB.	MAR.	APR.	MAY	JUN.	JUL.	AUG.	SEP.	OCT.	NOV.	DEC.	*Levels
Aluminum (Al)					1.85E-01								0.05 to 0.2
Arsenic (As)					2.10E-03								5.00E-02
Barium (Ba)	9.42E-02	1.80E-01	8.32E-02	9.82E-02	8.81E-02	1.09E-01	7.40E-02	7.59E-02	6.65E-02	1.30E-01	1.04E-02	9.56E-02	1.00E+00
Cadmium (Cd)			1.18E-02										1.00E-02
Chloride Ion	2.88E+02	2.27E+02	2.96E+02	2.68E+02	2.82E+02	2.33E+02	2.62E+02	2.53E+02	2.05E+02	2.78E+02	2.97E+02	2.94E+02	2.50E+02
Chromium (Cr)		4.65E-03			1.15E-02	6.30E-03	6.10E-03	5.20E-03	3.70E-03	6.30E-02	6.90E-03	3.50E-03	5.00E-02
Copper (Cu)		7.45E-03	3.26E-02		3.97E-02		2.10E-03				6.30E-03	5.70E-03	1.00E+00
Fluoride Ion	2.14E-01	2.00E-01	2.03E-01	2.42E-01	2.19E-01								2.00E+00
Iron	3.71E-02	7.34E-02	4.64E-02	2.67E-02	5.78E-01	2.63E-02	1.20E-02	1.02E-02	1.16E-02	5.70E-02	3.44E-02	2.29E-02	3.00E-01
Lead (Pb)													5.00E-02
Manganese (Mn)		1.20E-02	5.90E-03		8.80E-03			8.00E-04		4.86E-02	1.60E-03		5.00E-02
Mercury (Hg)													2.00E-03
Nitrate (NO3-N)	4.65E+00	4.78E+00	4.93E+00	4.88E+00	4.35E+00	5.24E+00	5.06E+00	4.72E+00	4.77E+00	5.58E+00	4.73E+00	5.11E+00	1.00E+01
Nitrite Ion (NO2)													N/A
Phosphate Ion	2.80E-01					2.69E-01	2.54E-01	1.27E-01			4.72E-01		N/A
Selenium (Se)											2.58E-03		1.00E-02
Silver (Ag)		5.45E-03											1.00E-01
Sodium (Na)	1.70E+02	1.60E+02	1.60E+02	1.80E+02	1.55E+02	1.77E+02	1.81E+02	1.76E+02	1.58E+02	2.14E+02	1.66E+02	1.96E+02	N/A
Sulfate Ion	2.32E+01	2.76E+01	2.76E+01	2.71E+01	2.68E+01	2.70E+01	2.80E+01	2.68E+01	2.65E+01	2.81E+01	5.20E+01	2.78E+01	2.50E+02
Total Dissolved Solids (TDS)	6.90E+02	5.58E+02	6.76E+02	7.43E+02	6.03E+02	6.79E+02	6.19E+02	5.98E+02	6.29E+02	8.97E+02	7.03E+02	6.74E+02	5.00E+02
Conductivity (uMhos)	1,280	1,300	1,260	1,300	1,260		1,172	1,158	1,142	1,611	1,333	1,330	N/A
pH	8.4	8.4	8.39	8.61	8.4	8.16	8.62	8.46	8.67	8.39	8.78	8.53	6.5-8.5
TKN										328			N/A

*Levels established from 40 CFR 141.11 and 143.2

Table 3-3
DOE DCG RATIOS CY-1995

RADIONUCLIDES	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
C-14												
Co-57									4.65E-05			
Co-60		1.20E-04	3.29E-05									
Cs-134												
Cs-137		6.86E-05	9.10E-05									
Eu-152			5.38E-04	7.36E-04	1.58E-03		7.48E-04					
H-3												3.01E-04
I-129												
Pu-238	8.98E-04				2.26E-03	1.75E-03						
Pu-239												
Pu-241												6.52E-04
Ru-106												
Sb-125												
Sr-90	6.59E-04					1.30E-03				6.76E-03		1.30E-03
U-234	3.59E-03	3.00E-03	3.60E-03	6.39E-03	3.41E-03	3.40E-03	3.19E-03	5.42E-03	3.40E-03	3.59E-03	3.41E-03	3.21E-03
U-235		6.68E-05	9.98E-05		8.35E-05	5.00E-05	8.31E-05	2.67E-04	1.34E-04	8.31E-05	8.36E-05	1.00E-04
U-238	1.43E-03	1.11E-03	1.41E-03	2.48E-03	1.34E-03	1.34E-03	1.16E-03	3.51E-03	1.34E-03	1.33E-03	1.34E-03	1.33E-03

Figure 3-1
SERVICE WASTE EFFLUENT
Total Activity (curies)

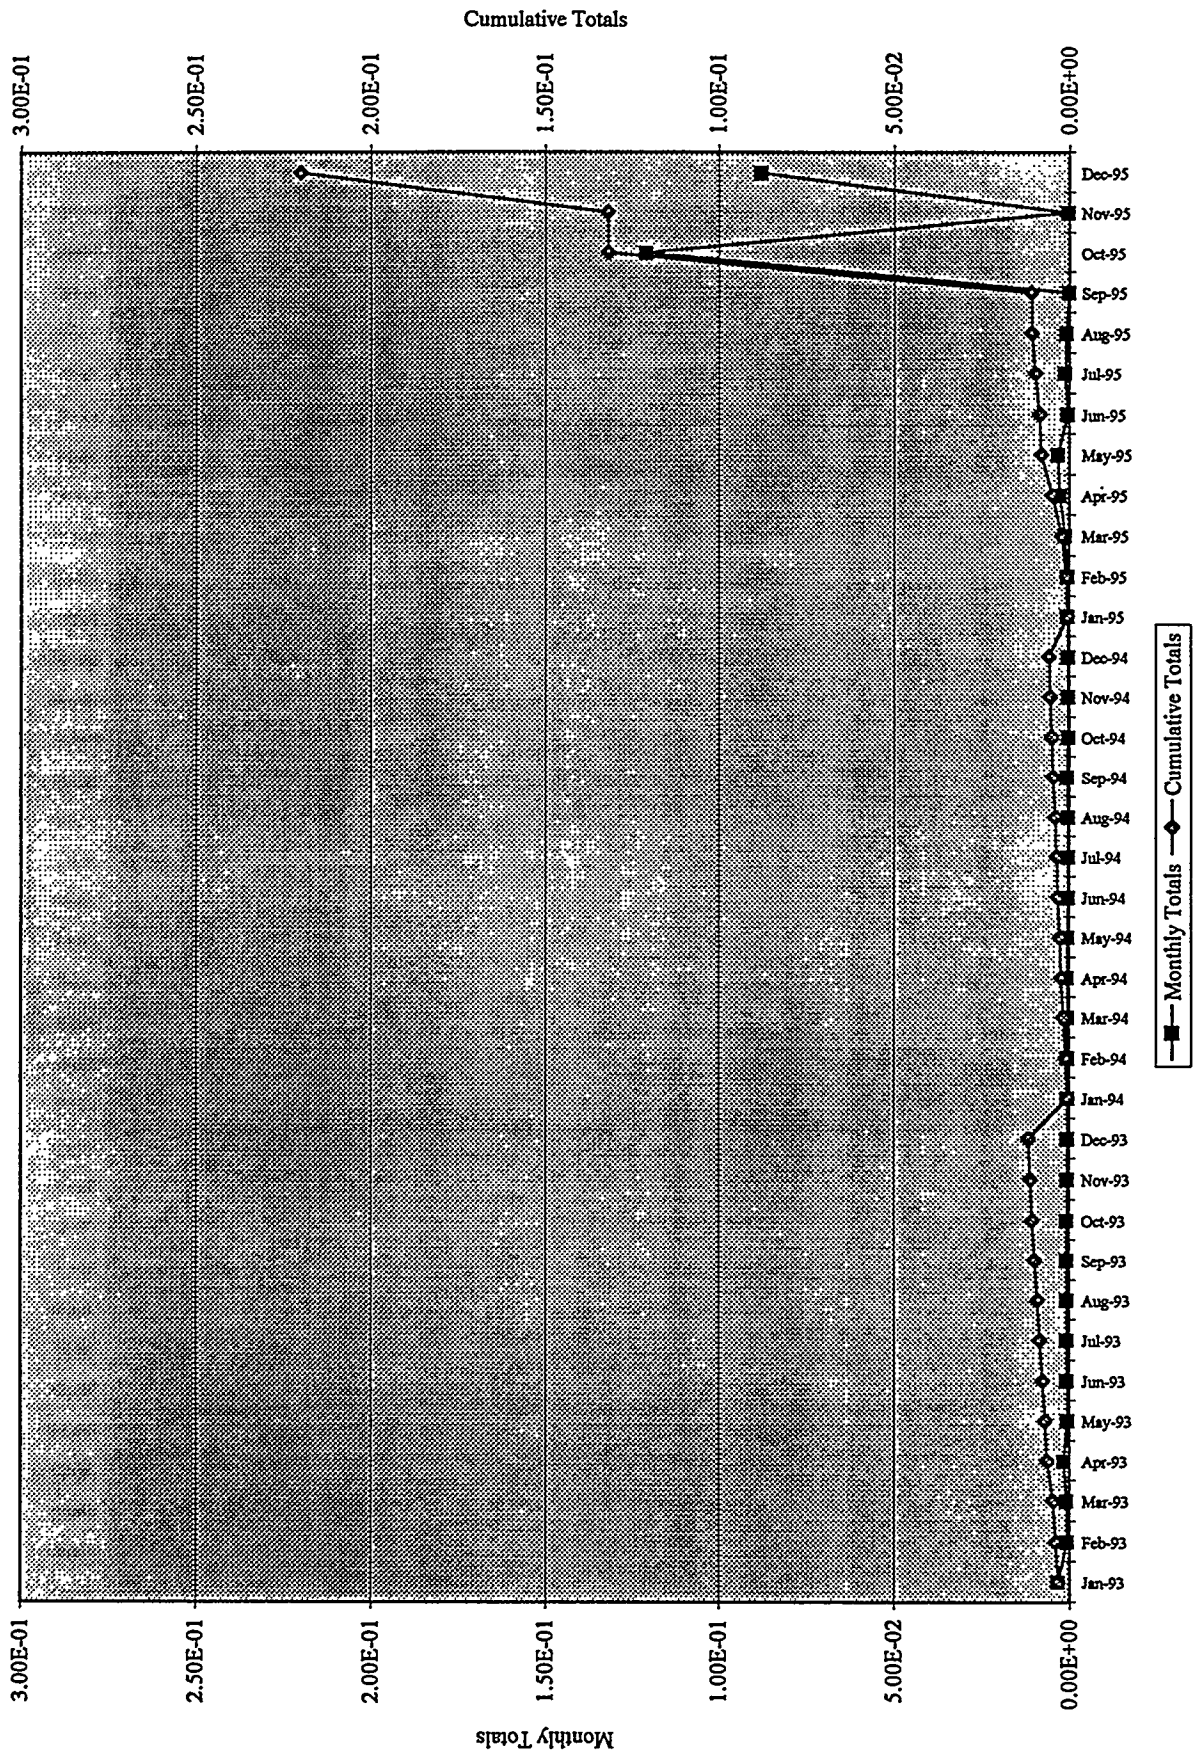


Figure 3-2
SERVICE WASTE EFFLUENT
Pu-238 (curies)



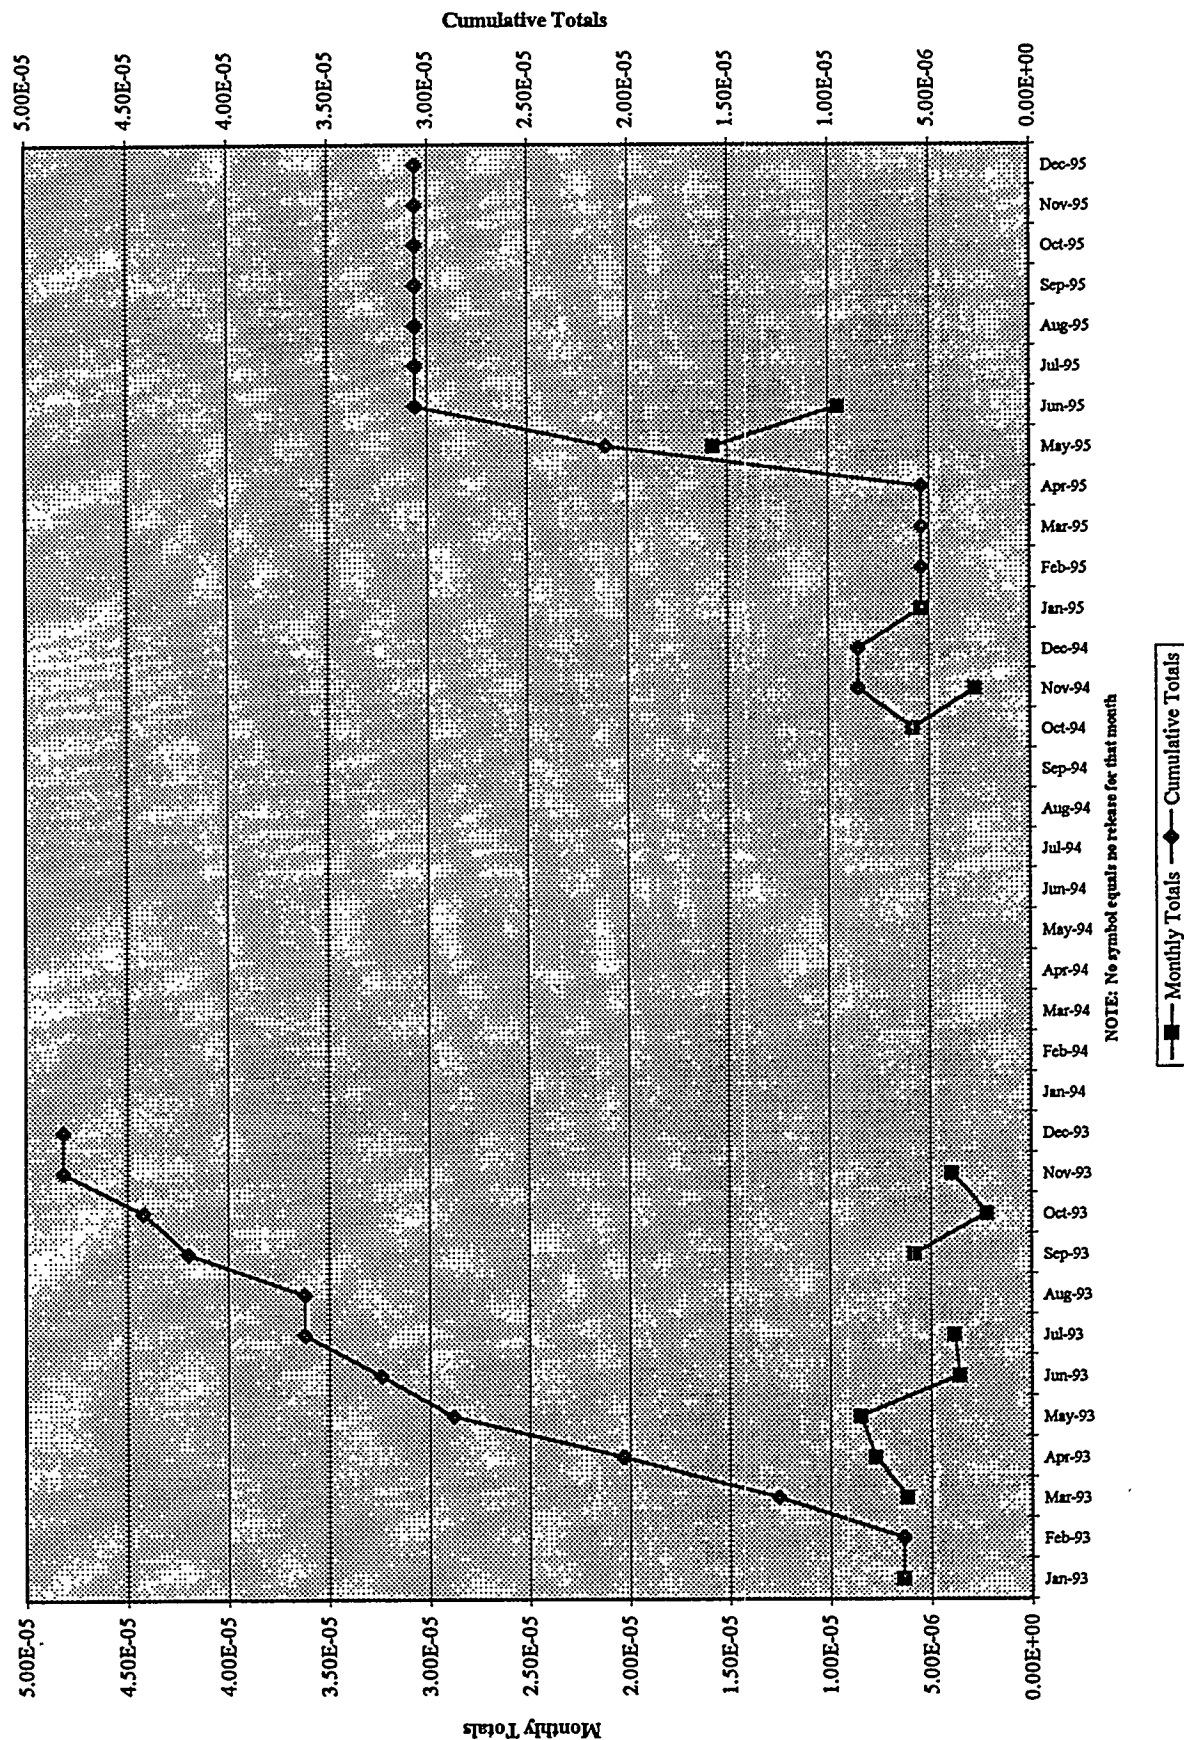


Figure 3-3
SERVICE WASTE EFFLUENT
U-234 (curies)

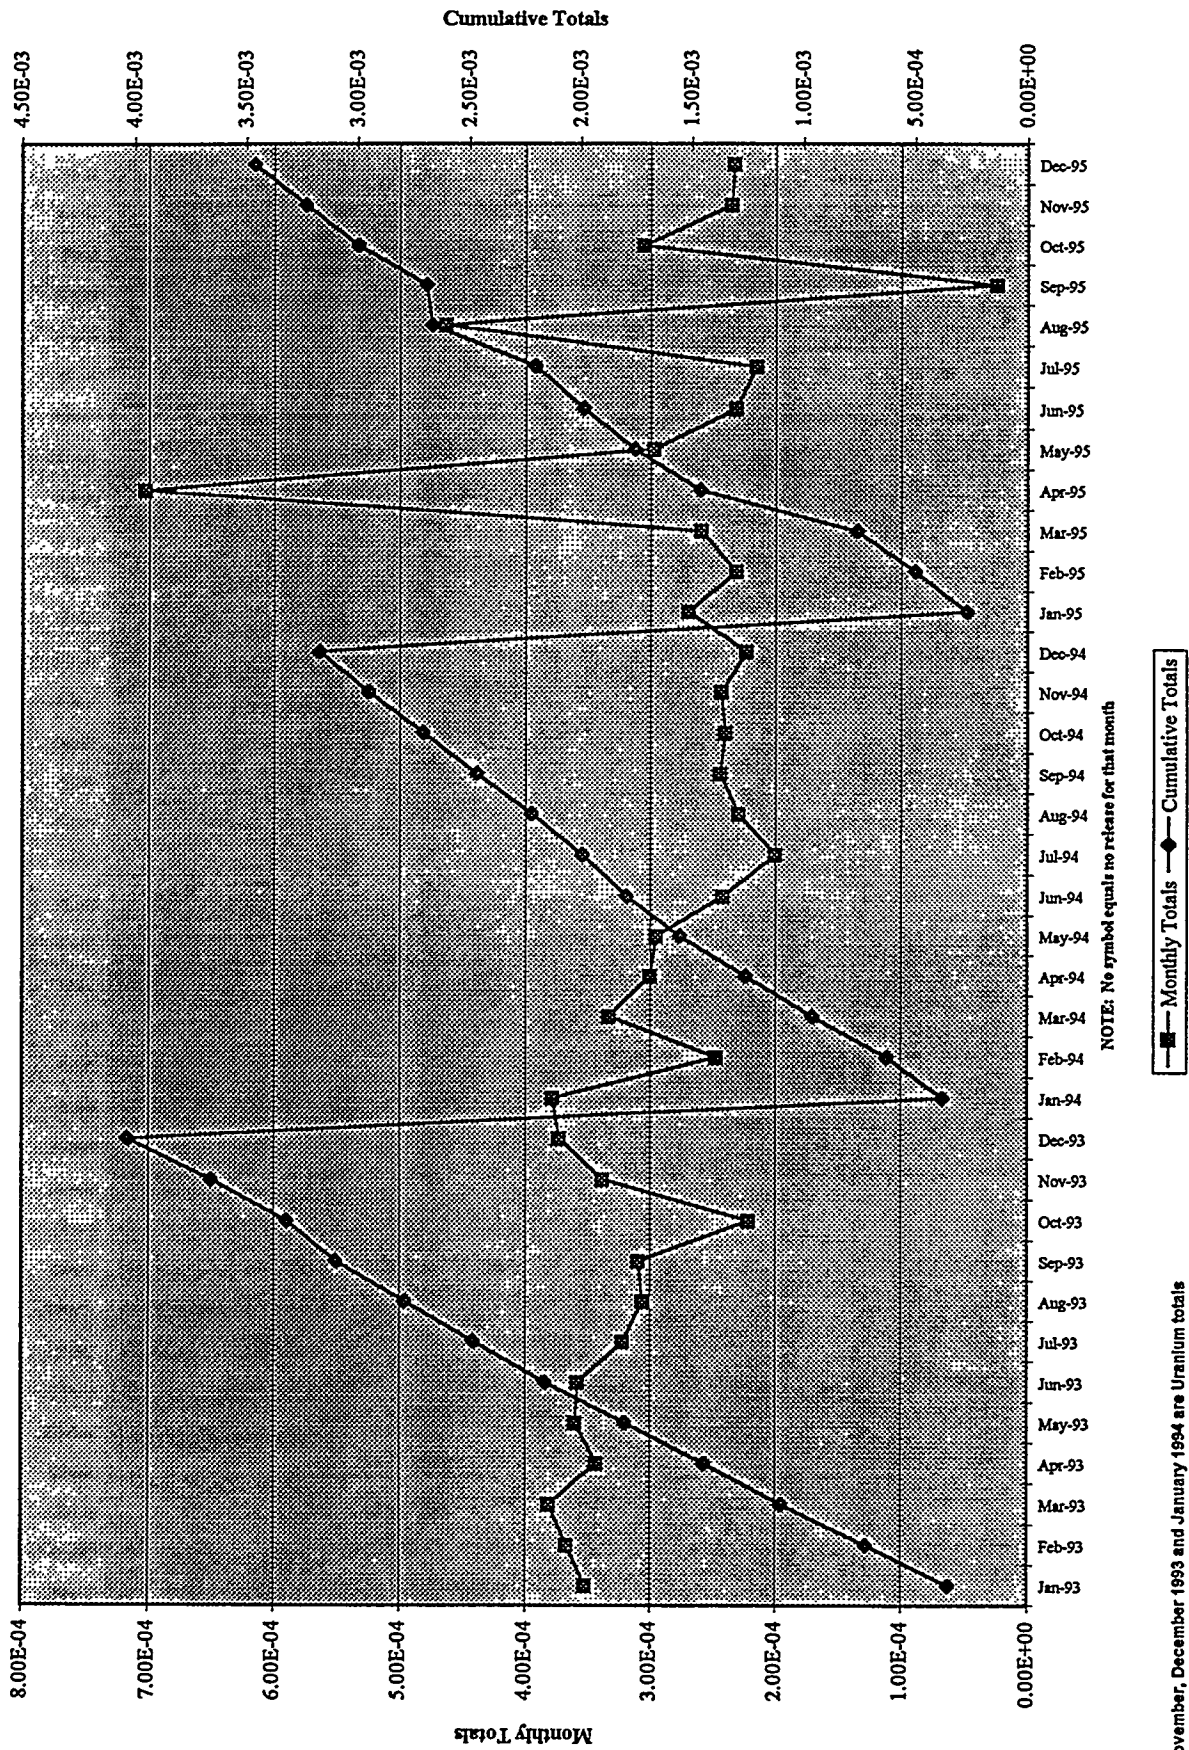


November, December 1993 and January 1994 are Uranium totals

Figure 3-4
SERVICE WASTE EFFLUENT
U-235 (curies)

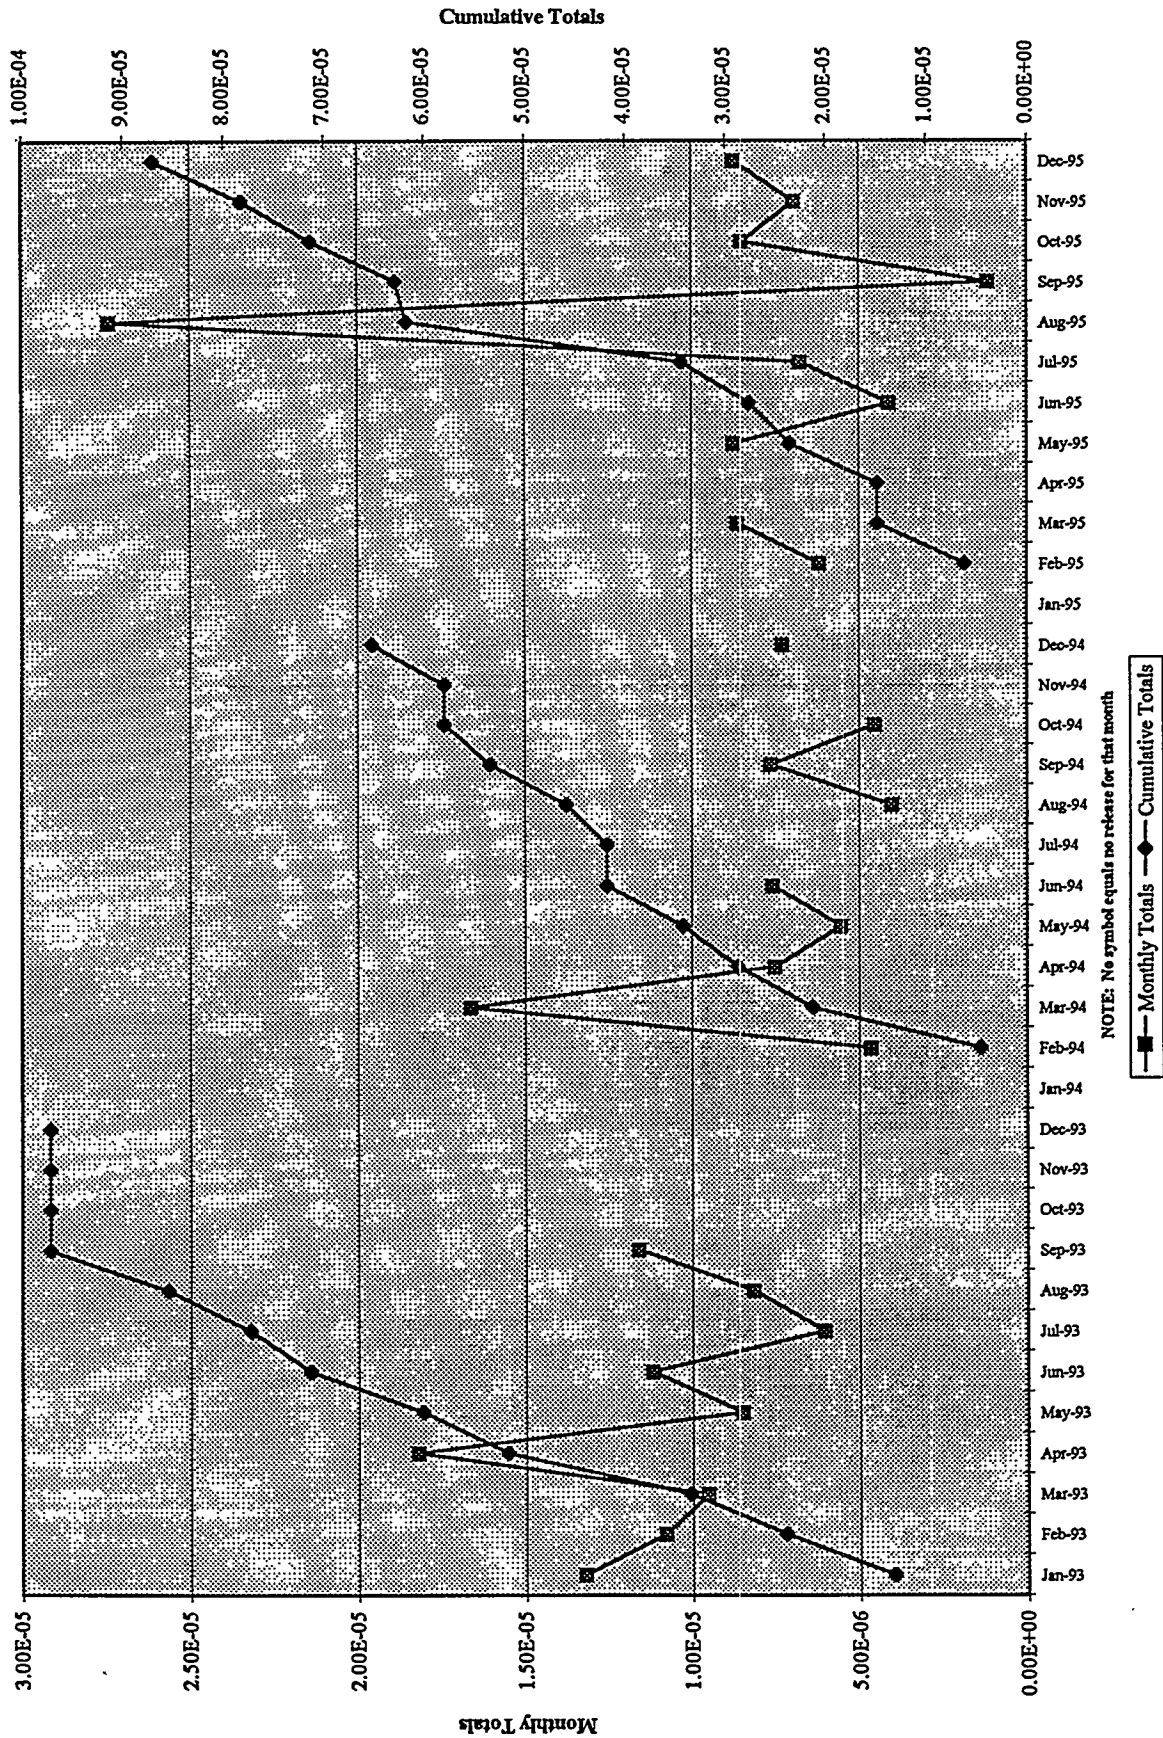

November, December 1993 and January 1994 is included in U-234 as total Uranium

Figure 3-5
SERVICE WASTE EFFLUENT
U-238 (curies)

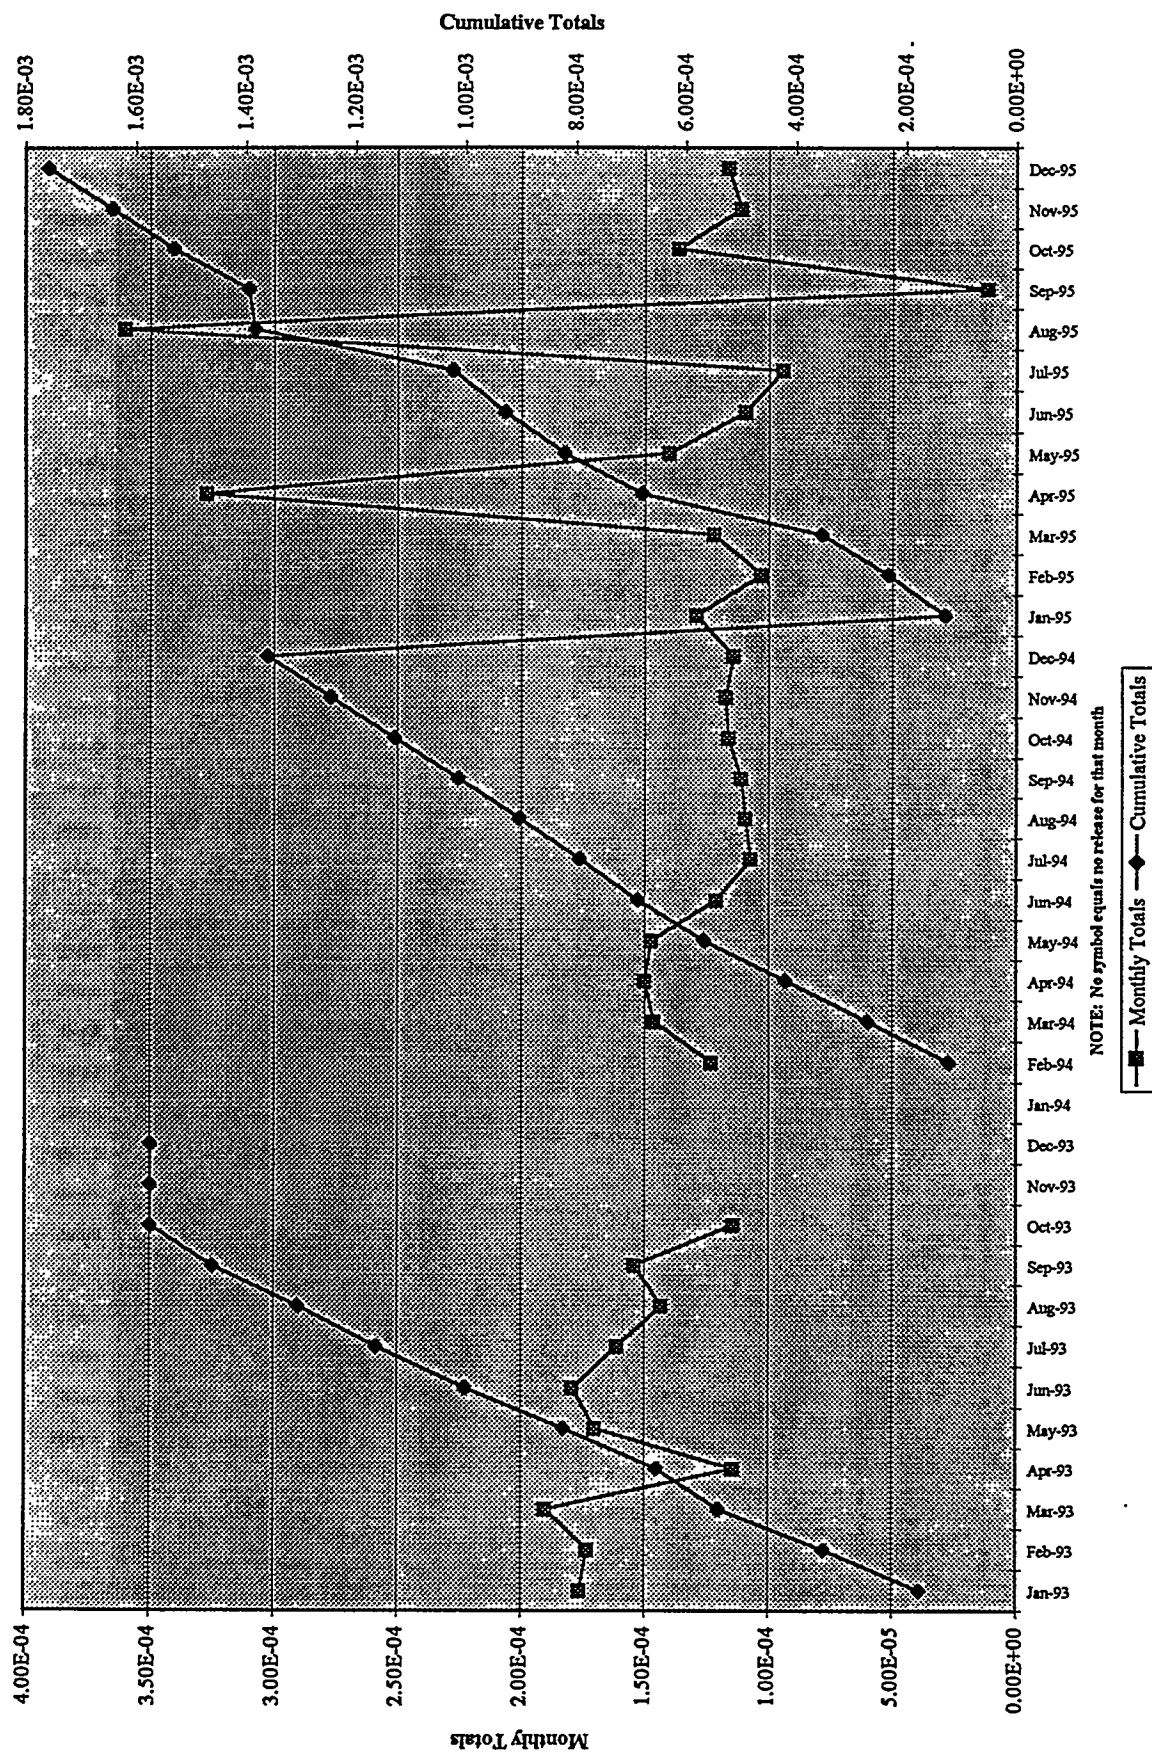

November, December 1993 and January 1994 is included in U-234 as total Uranium

Figure 3-6
SERVICE WASTE EFFLUENT
Sr-90 (curies)


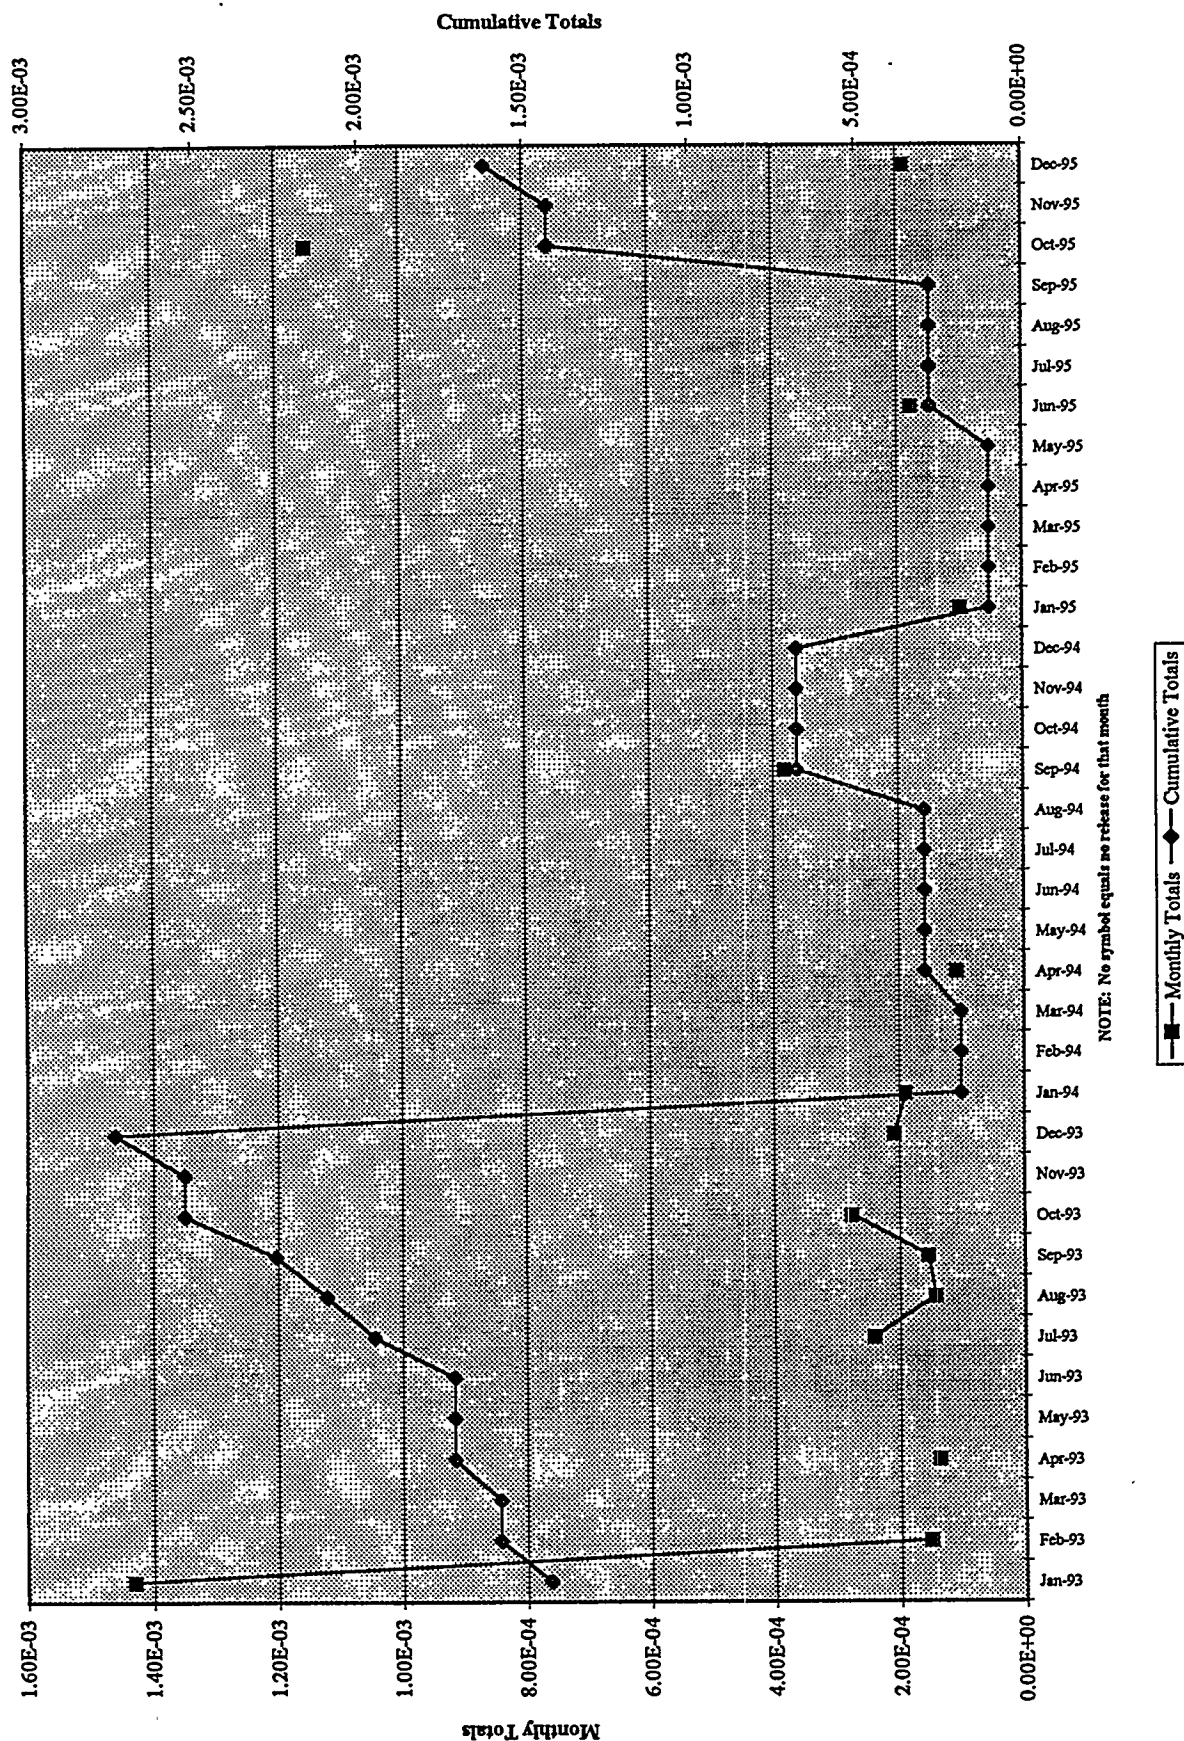


Figure 3-7
SERVICE WASTE EFFLUENT
Cs-137 (curies)

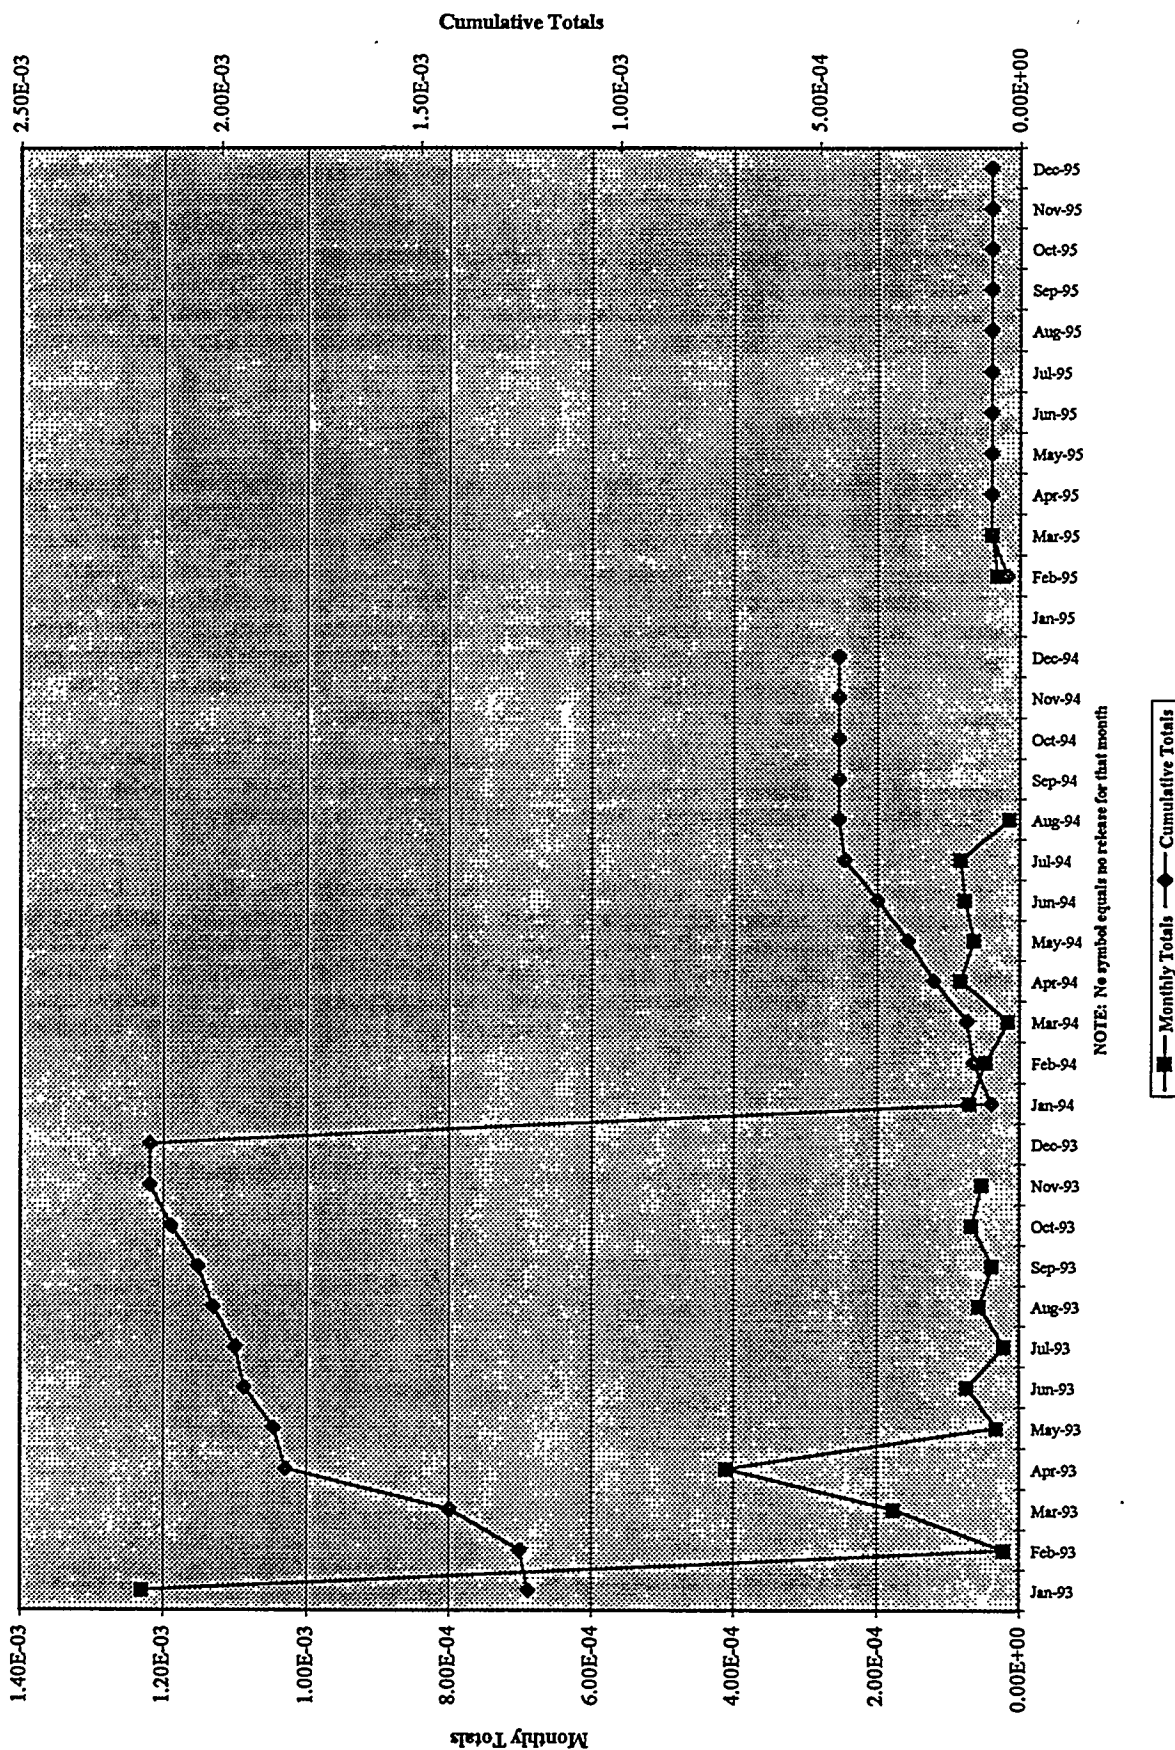

2.2 Production and Potable Water Wells

There are two production wells and one potable water well for influent at the ICPP. The production wells are operated alternately. Grab samples were collected monthly through October 1995 from the operating wells. Beginning in November, 1995 the wells are randomly sampled for compliance by the Environmental Monitoring and Water Resources Group. Tables 3-4 and 3-5 list the results of the analyses performed on the Production and Potable Water Wells. All results indicate that the ICPP well waters are below all applicable regulatory standards for trace metals and organics.

2.3 Sewage Treatment Plant

Domestic waste water at the ICPP is pumped to the Waste Water Treatment Facility which is located outside the security fence. LITCO Power Plant Services is responsible for the operation and maintenance of the Waste Water Treatment Facility. Wastewater Land Application Permit (WLAP) LA-000115-02 became effective September 17, 1995. The permit authorizes the wastewater facility to operate subject to specific requirements specified in the permit. LITCO Environmental Support takes monthly 24 hour composite samples for permit compliance and radionuclides. The radionuclide sample is analyzed for gross alpha, gross beta and gamma.

The LITCO Environmental Protection Department monitors the operation and performance of the domestic Waste Water Treatment Plant. Table 3-6 lists the monthly Biological Oxygen Demand (BOD), Dissolved Oxygen (DO) and pH for 1995.

Monthly influent (raw) and effluent (final) Biological Oxygen Demand (BOD) concentrations are shown in Figure 3-8. The difference in concentrations between influent BOD and effluent BOD represents the treatment efficiency. Dissolved Oxygen (DO) levels in the influent and effluent are indicators of proper operation. Values for influent and effluent DO are shown in Figure 3-9. Figure 3-10 lists the pH and Figure 3-11 represents STP volume.

2.4 ICPP Injection Well

The ICPP injection well was permanently sealed in November 1989.

Table 3-4
ICPP PRODUCTION WATER WELL CY-1995
(mg/L)

INORGANIC CHEMICALS	JAN	FEB	*MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	MAXIMUM CONTAMINANT LEVEL
Arsenic (As)													5.00E-02
Barium (Ba)	8.18E-02	9.40E-02			8.41E-02	8.80E-02	8.40E-02	8.12E-02	8.40E-02	8.22E-02			1.00E+00
Cadmium (Cd)					8.50E-04								1.00E-02
Chloride Ion	2.41E+01			1.97E+01	1.84E+01	1.82E+01	1.83E+01	1.92E+01	1.92E+01	1.78E+01			2.50E+02
Chromium (Cr)	6.70E-03	5.60E-03			6.15E-03	5.70E-03	6.25E-03	6.35E-03	7.75E-03				5.00E-02
Fluoride Ion	1.91E-01	2.00E-01		2.17E-01	1.94E-01	2.09E-01							2.00E+00
Lead (Pb)													5.00E-02
Mercury (Hg)													2.00E-03
Nitrate Ion	4.90E+00			4.89E+00	4.80E+00	4.76E+00	4.91E+00	4.85E+00	4.76E+00	4.16E+00			1.00E+01
Phosphate Ion				2.79E-01	1.20E-01								
Selenium (Se)													1.00E-02
Silver (Ag)													1.00E-01
Sodium (Na)	7.30E+00	8.00E+00		7.89E+00	8.30E+00	7.86E+00	8.05E+00	6.97E+00	7.98E+00	7.88E+00			
Sulfate Ion	2.67E+01			2.47E+01	2.57E+01	2.62E+01	2.60E+01	2.66E+01	2.33E+01	2.38E+01			2.50E+02

NOTE: See JCK-26-95, as of November data production well will be sampled for compliance purposes only
Blanks represent below detection limit
*No results for March

Table 3-5
ICPP POTABLE WATER WELL CY-1995
(in mg/L)

INORGANIC CHEMICALS	JAN	FEB	*MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	MAXIMUM CONTAMINANT LEVEL
Arsenic (As)						2.00E-03							5.00E-02
Barium (Ba)	8.75E-02				8.96E-02	8.70E-02	8.60E-02	8.70E-02	8.52E-02	8.98E-02			1.00E+00
Cadmium (Cd)													1.00E-02
Chloride Ion	2.02E+01	1.88E+01		1.83E+01	1.80E+01	1.79E+01	1.82E+01	1.77E+01	1.93E+01	1.98E+01			2.50E+02
Chromium (Cr)	5.80E-03	5.05E-03			5.15E-03	5.45E-03	5.65E-03	6.15E-03	7.00E-03	6.40E-03			5.00E-02
Fluoride Ion	1.90E-01	2.02E-01		2.06E-01	2.14E-01	2.00E-01							2.00E+00
Lead (Pb)													5.00E-02
Mercury (Hg)													2.00E-03
Nitrate Ion	4.81E+00	8.01E-01		4.83E+00	4.71E+00	4.86E+00	4.94E+00	4.68E+00	4.98E+00	4.86E+00			1.00E+01
Phosphate Ion				2.79E-01	1.20E-01								
Selenium (Se)													1.00E-02
Silver (Ag)										3.33E-03			1.00E-01
Sodium (Na)	6.80E+00	1.00E+02		7.71E+00	8.50E+00	7.78E+00	7.75E+00	7.25E+00	8.20E+00	7.63E+00			
Sulfate Ion	2.59E+01	2.65E+01		2.49E+01	2.55E+01	2.67E+01	2.70E+01	2.56E+01	2.33E+01	2.47E+01			2.50E+02

SEE JCK-26-95, as of November data, potable well will be sampled for compliance purposes only

Blanks represent below detection limit

*No potable water well information for March

Table 3-6
SEWAGE TREATMENT PLANT ANALYSIS
CY-1995

	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
RAW BOD	130	53	41	114	64	42	185	32	130	56	61	70
FINAL BOD	11	18	5	20	38	12	22	6	11	8	26	14
EFFICIENCY	92%	66%	88%	82%	41%	71%	88%	82%	92%	86%	57%	80%
RAW DO	1.47	1.08	0.68	0.58	0.53	0.43	0.4	0.43	0.52	0.5	0.53	0.93
FINAL DO	10.72	11.29	9.56	10.37	7.6	5.24	3.09	5.52	4.85	6.54	7.47	9.23
RAW PH	8.24	8.01	8.23	8.38	8.29	8.24	8.09	8.01	8.05	8.14	8.16	8.06
FINAL PH	8.35	7.6	8.46	8.82	8.52	7.98	7.62	7.63	7.68	7.52	7.47	7.65
TOTAL VOLUME (L)	9.31E+06	2.19E+06	8.67E+06	8.33E+06	1.16E+07	4.84E+06	4.96E+05	6.81E+06	4.81E+06	4.77E+06	5.00E+06	5.34E+06

Figure 3-8
SEWAGE TREATMENT PLANT
BOD

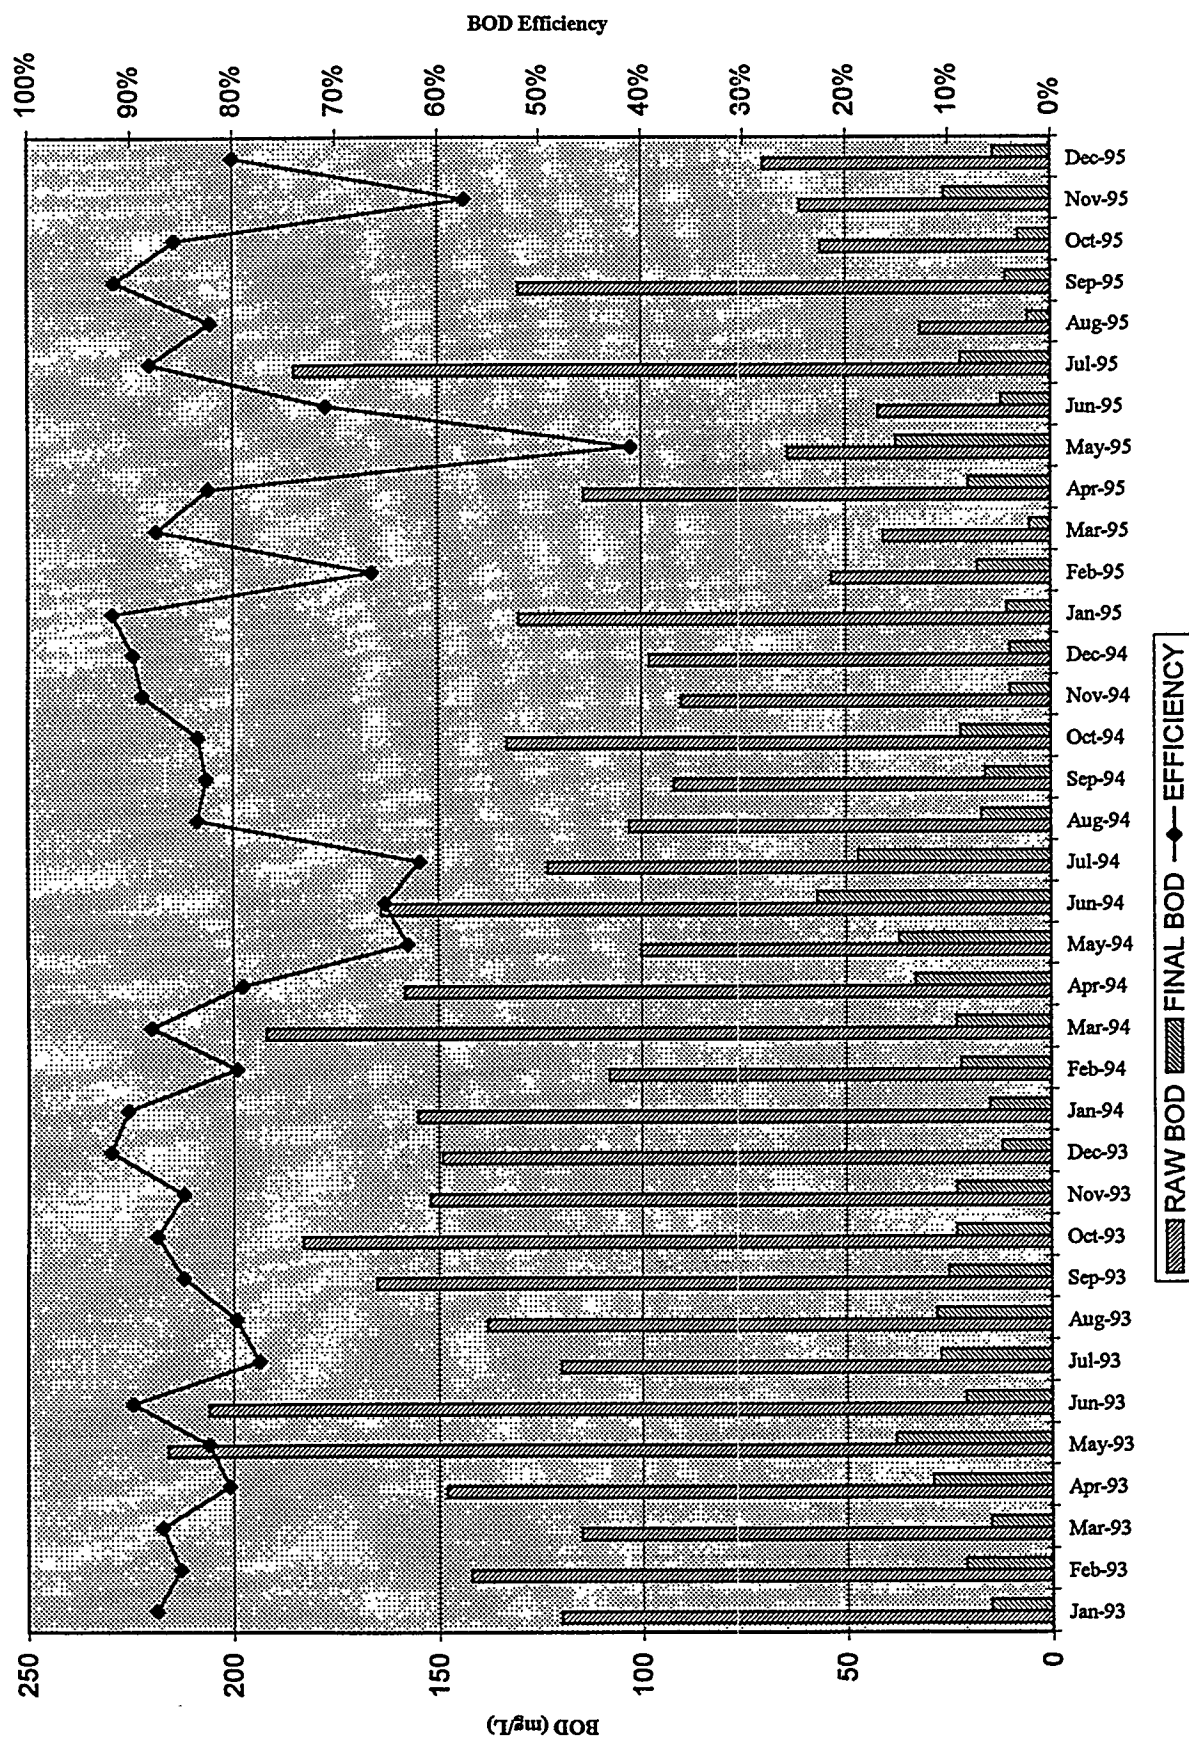


Figure 3-9
SEWAGE TREATMENT PLANT
DO

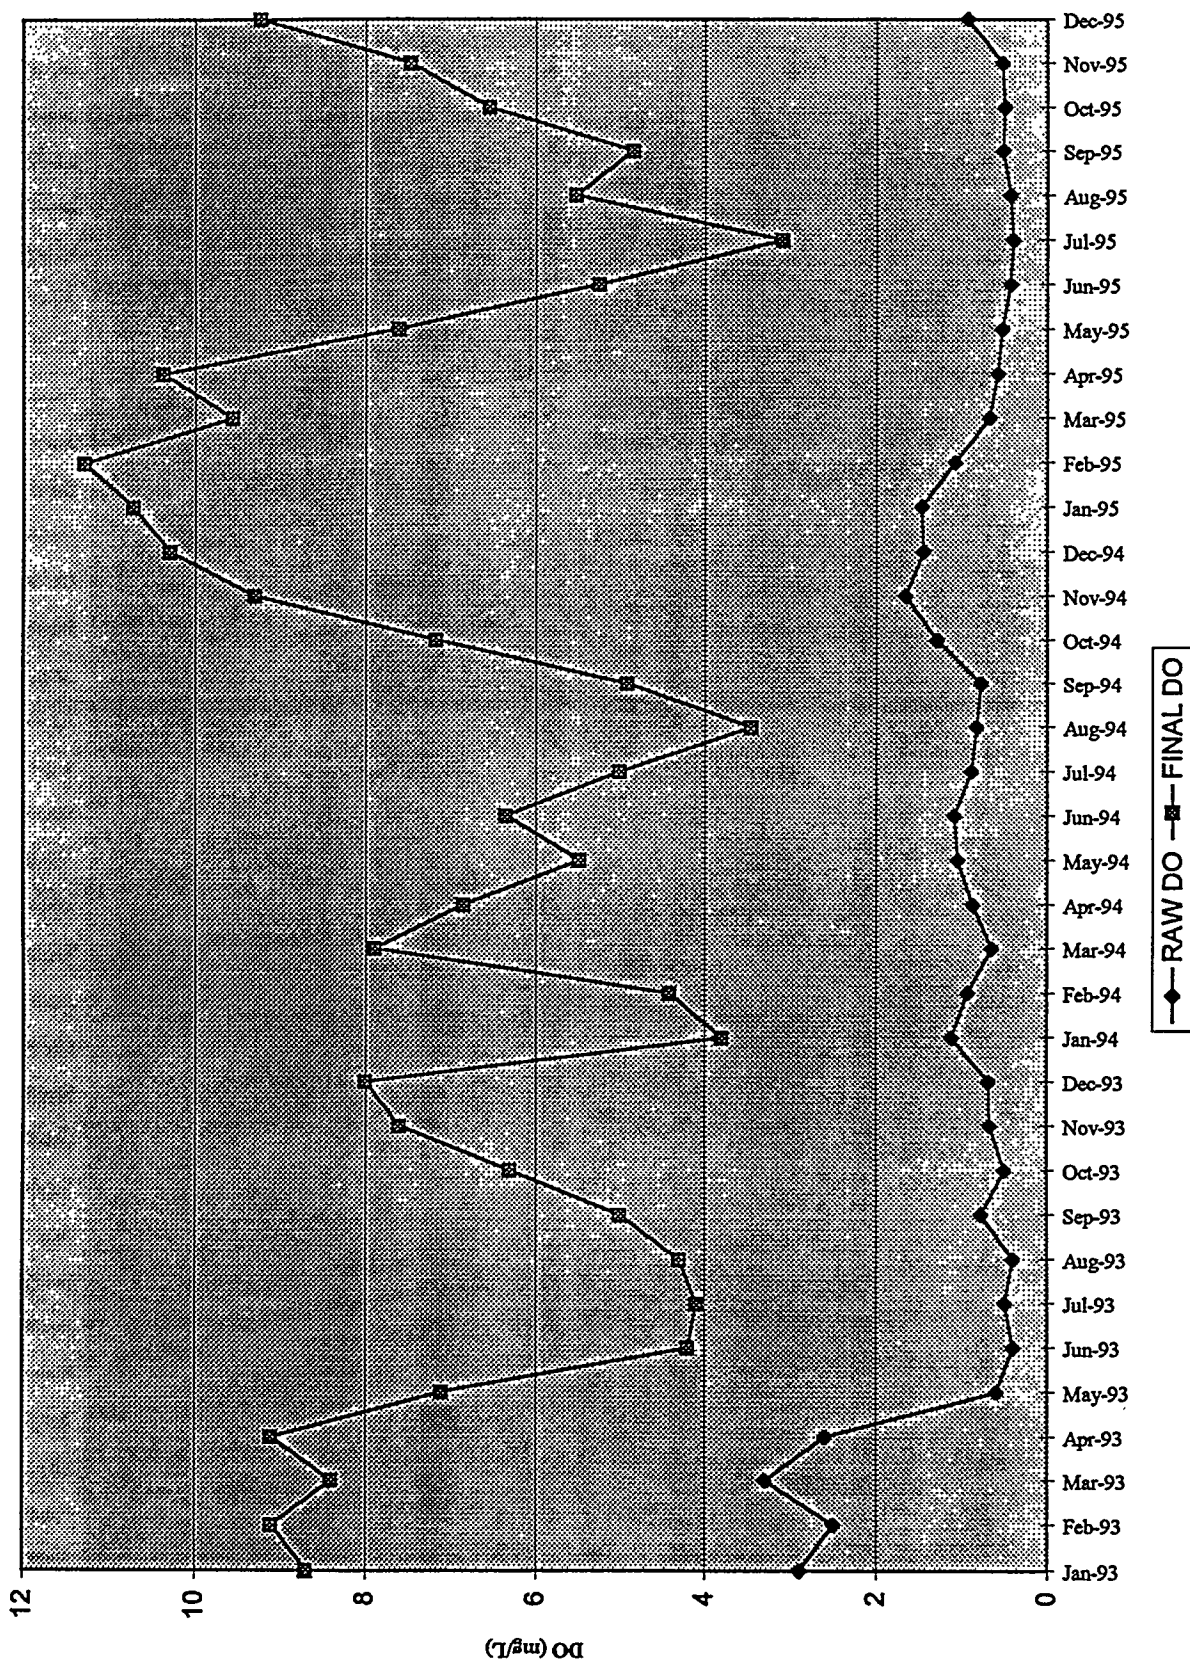


Figure 3-10
SEWAGE TREATMENT PLANT
pH


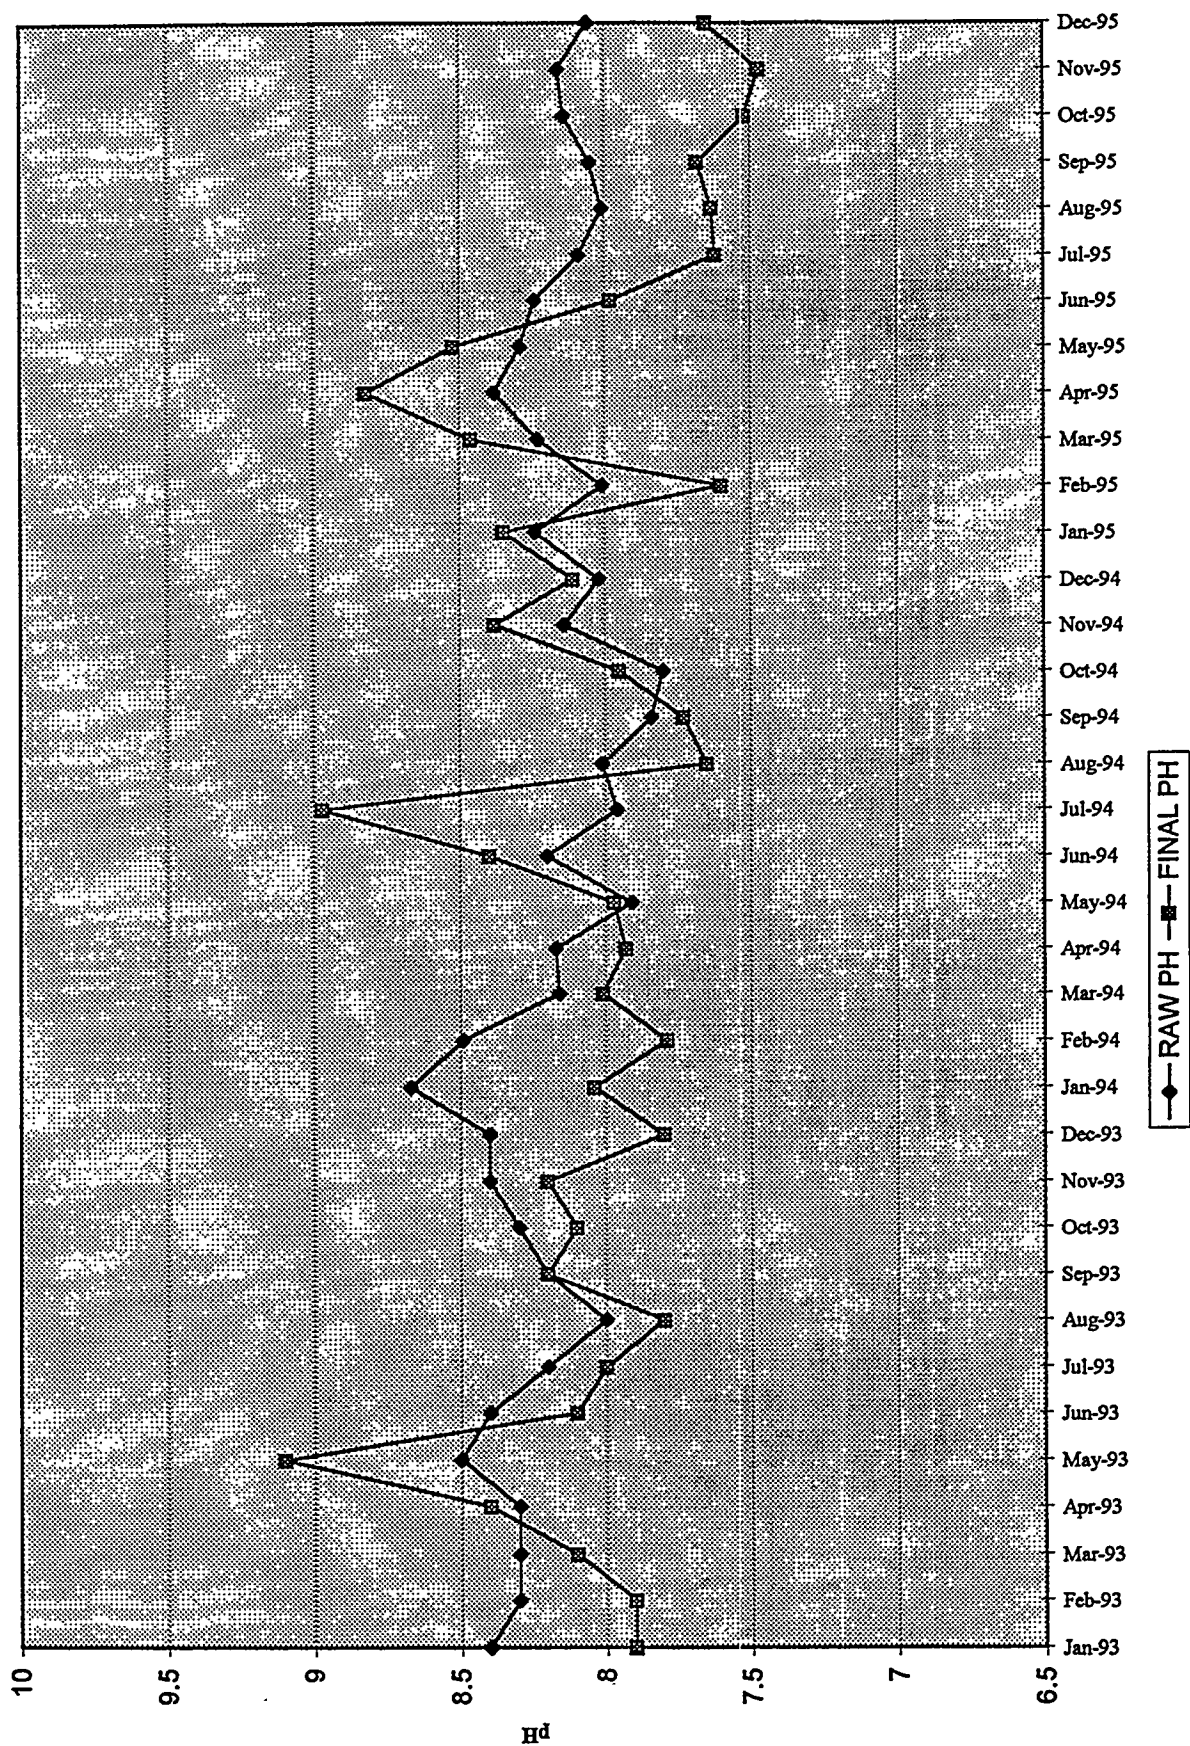


Figure 3-11
SEWAGE TREATMENT PLANT
Volume (Liters)

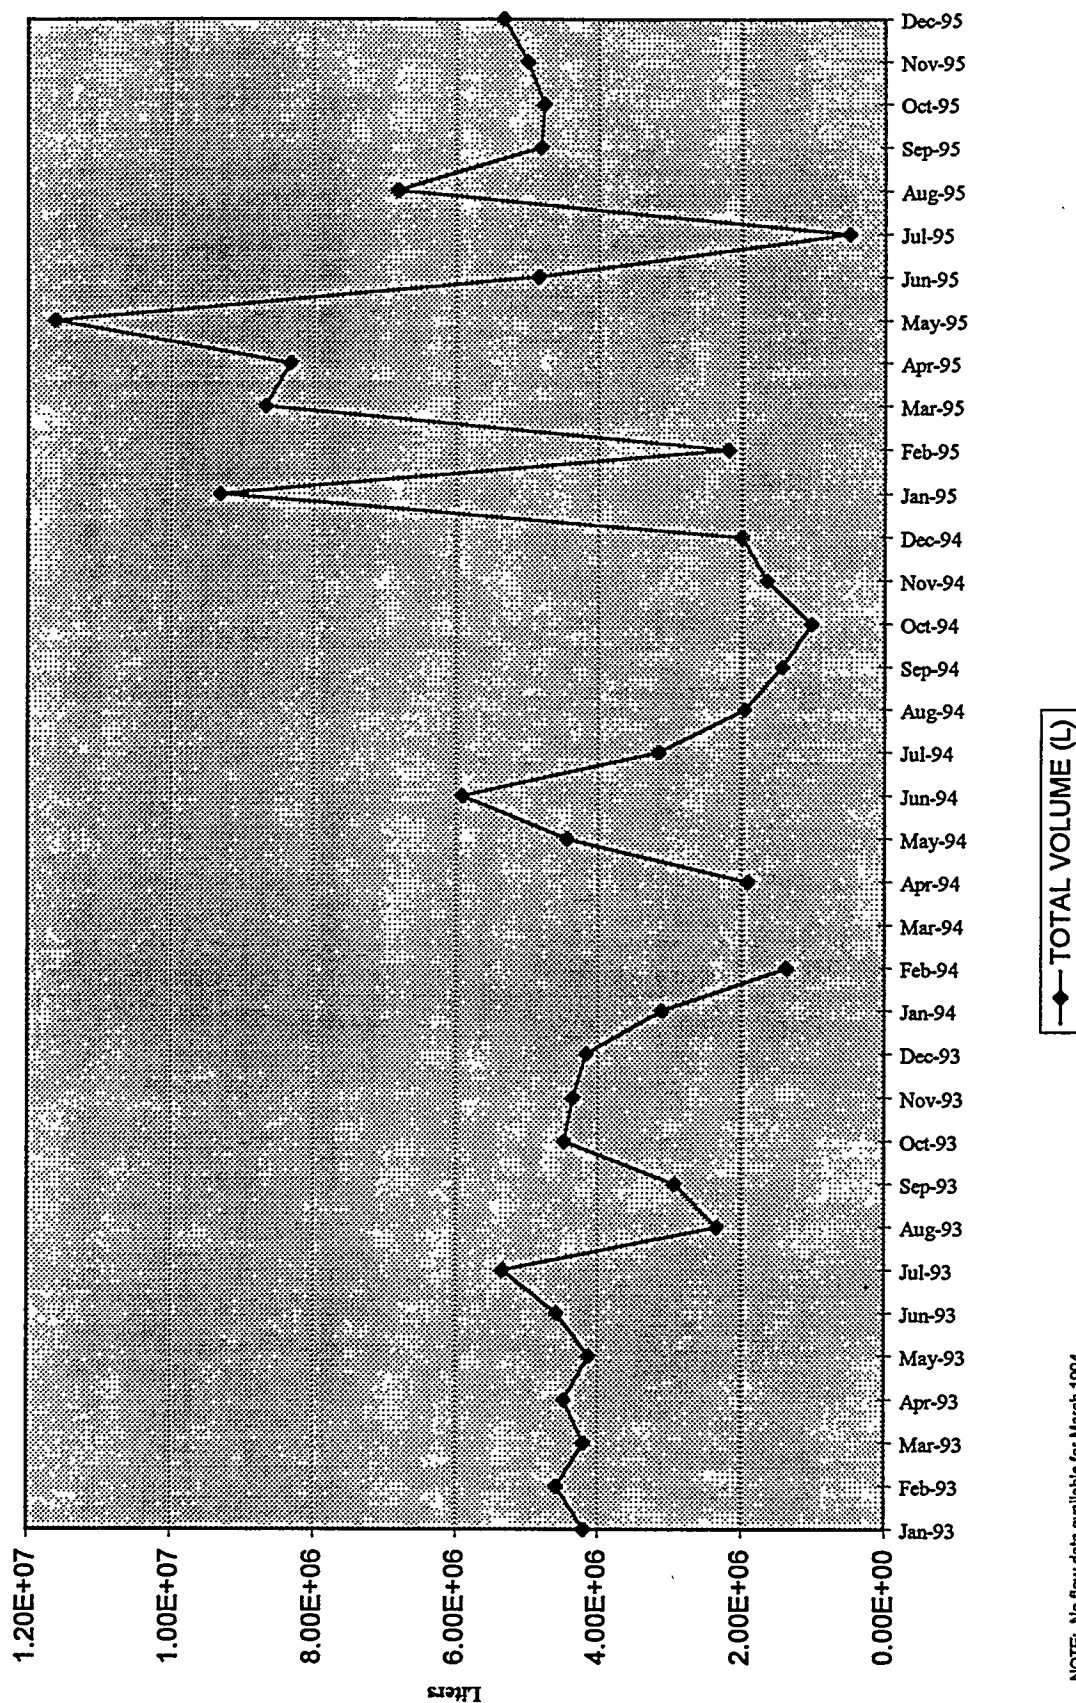

NOTE: No flow data available for March 1994

DISTRIBUTION

C. W. Bingham
T. W. Chesnovar
L. R. Dausin
S. F. Henderson
E. R. McMahaen
J. K. Neff (10)
D. J. Wiggins
D. E. Walker
ERC (2)

