

CONF-970935--1

A New Look at Moisture Control in Low Slope Roofing

André O. Desjarlais
Energy Division
Oak Ridge National Laboratory

and

Nan A. Byars
Engineering Technology Department
University of North Carolina at Charlotte
Charlotte, North Carolina 28223

To be presented and published in the
4th International Symposium on Roofing Technology
being held in Gaithersburg, Maryland
September 17-19, 1997

CONF-970935--1
MAR 13 1997
OSTI

Research sponsored by
the Office of Building Technologies and
Department of Energy

The submitted manuscript has been
authored by a contractor of the U.S.
Government under contract No. DE-
AC05-96OR22464. Accordingly, the U.S.
Government retains a nonexclusive,
royalty-free license to publish or reproduce
the published form of this contribution, or
allow others to do so, for U.S. Government
purposes.

Prepared by the
OAK RIDGE NATIONAL LABORATORY
Oak Ridge, Tennessee 37831
managed by
LOCKHEED MARTIN ENERGY RESEARCH CORP.
for the
U.S. DEPARTMENT OF ENERGY
under contract No. DE-AC05-96OR22464

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

kg
MASTER

DISCLAIMER

**Portions of this document may be illegible
in electronic image products. Images are
produced from the best available original
document.**

A NEW LOOK AT MOISTURE CONTROL

IN LOW-SLOPE ROOFING

by

André O. Desjarlais

Building Thermal Envelope Systems and Materials Group
Oak Ridge National Laboratory

and

Nan A. Byars

Engineering Technology Department
University of North Carolina at Charlotte

ABSTRACT

One of the criteria for a moisture-tolerant roof is that moisture accumulation in a roofing system must not be large enough to cause condensation within the roof, since this can damage the insulation and reduce its effectiveness. Failing this criterion would require the inclusion of a vapor retarder into the roofing system. We have tested this requirement using computer simulations for a series of new roofing systems and environmental conditions [1].

This paper uses the database from those simulations to develop a simplified method to predict condensation control using only variables associated with the roof and environmental conditions. This method assesses the potential for condensation within the roof assembly without having to perform a computer simulation.

Using the computer simulation output data, the moisture accumulation inside each of the roofing systems was calculated. A critical threshold of moisture accumulation was assigned by analyzing the roofing systems which fail to prevent condensation from occurring within the roofing system.

An empirical equation for moisture accumulation as a function of roof system and environmental condition variables is developed. The moisture accumulation calculated using this relationship correlates well with the

moisture accumulation based on the results of computer simulations. The ability of these two different relationships for moisture accumulation to predict condensation control using the established critical threshold is assessed. Accuracy of both methods is over 95%.

I. INTRODUCTION

Moist and dripping roofs have no doubt been a problem since the time humans took up residence in caves. In a more contemporary context, moisture accumulation, particularly in low-slope roofing, has become a multimillion dollar problem in the US [2].

Moisture accumulation in roofing systems can create a number of costly problems, including dripping, accelerated insulation and membrane failure, the threat of roof structure deterioration, depreciation of assets, and poor thermal performance. Moisture accumulation can severely impact the thermal performance of insulation in a roofing system. It is estimated that energy losses through roofs in the U.S. are increased by approximately 70% because of the loss of the insulation's thermal resistance due to moisture [2]. Wet roofing must be replaced at significant cost, both financially and in terms of increased construction waste [2].

Clearly, the potential cost saving of an effective and efficient roofing system is great. Intuitively, the response to the problem of moisture accumulation in roofs has been to try to limit as much as possible the inflow of moisture, for example, by improving the reliability of roofing membranes. However, as Kyle and Desjarlais point out, "...most roofing systems inevitably leak." For this reason, they suggest that the best strategy for reducing moisture accumulation is through designing moisture-tolerant roofs, which incorporate reliable ways of improving moisture flow out of the roof [2].

This strategy was suggested by Powell and Robinson's studies of the effects of water on roofing systems in the 1970s [3]. In their view, designs for insulated moisture-tolerant flat roofs would be "the most practical and economic" solution to the problems created by moisture accumulation.

To determine whether a specific roofing system is moisture-tolerant, roofing designers require accurate but convenient and cost-efficient analytical tools for evaluating their roof designs. One such tool is computer modelling. We have used finite difference computer modelling to demonstrate the effectiveness of moisture-tolerant roof designs in several different climate zones in the US [1]. However, setting up the necessary data files, running a finite difference simulation, and interpreting the output requires computer skills and very specific technical knowledge which limits the widespread usefulness of this tool. A simpler, readily available technique for assessing the suitability of different moisture-tolerant roof designs would also be useful as a practical guide in selecting appropriate materials and designs for these roofs.

This paper describes the development of such an analytical tool, based on our earlier work. Using the computer simulation data as a starting point, a method is developed for predicting the condensation potential of different new roof designs using an algorithm requiring only the variables associated with components of the roofing system and the interior and exterior climate. This algorithm can then be included in a fast, user-friendly computer program which will be accessible to a much wider user group. The capability of predicting condensation potential will allow the roofing designer to assess the need for a vapor retarder for a particular roofing design or allow the designer to engineer the roofing system so that a vapor retarder is not required. This will enable a roofing professional in the US to quickly and accurately determine if a roof constructed with a given type of membrane, insulation material and deck will be moisture-tolerant in a given location and indoor relative humidity, without the need to set up and run a computer simulation.

This paper reports on an element of our moisture tolerance research that has been ongoing for over six years. References 1, 2, 4, 9, 10, and 11 have described, validated, and used the model on low-slope roofing applications. These references describe in detail the model that is used, the limitations of the model, and sources of material property data. Other requirements for a moisture-tolerant roof are described in Reference 1, including the need for the roofing system

to be capable of eliminating moisture transport by convection and handling water leaking into the roof through imperfections in the membrane.

II. MOISTURE-TOLERANT ROOF REQUIREMENTS


We have defined a moisture-tolerant roof as "a roofing system which is designed to minimize the deleterious effects of water accumulation [2]". A moisture-tolerant low-slope roof design can be achieved by selection of roofing characteristics and materials appropriate for a given set of environmental conditions. Characteristics of the roof design that can be adjusted to offer increased moisture tolerance include the solar absorptance of the membrane, the type, permeance, and thickness of the insulation material, and the permeance of the deck material.

Moisture-tolerant roof design

Some elements of the moisture-tolerant roof were established by the work of Powell and Robinson [3]. In simplified schematic form, a roof can be modelled for moisture tolerance in five sections (Figure 1). The membrane represents the "outer" part of the roof, which is in direct contact with weather and environmental conditions such as sun, rain and wind. Next are layers of insulation, modelled in three sections, an outer section adjacent to the membrane, a core, and an inner section next to the deck. The deck is the "inner" part of the roof, which is in contact with the interior of the structure. Note that the modelling of the insulation material in three layers is simply an issue of convenience. We are interested in how moisture moves within the insulation material and the division of that material into at least three layers allows for monitoring of the moisture distribution. These three layers may be comprised of portions of a single piece of insulation or three completely separate materials as in a composite insulation system.

Figure 1

Roof schematic for used for modelling purposes

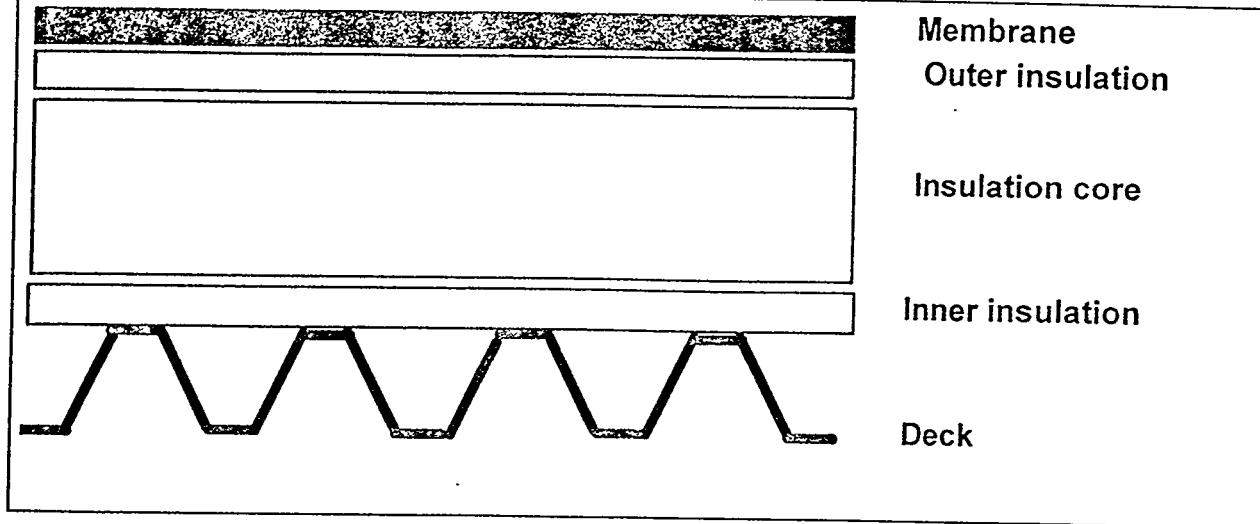

Winter uptake and condensation

We have documented a set of requirements for predicting if a roofing system will be moisture-tolerant [1]. One of these requirements is that during the winter, when uptake of water vapor from the interior of the building into the roofing system typically occurs, moisture accumulation should not be great enough to cause degradation of the insulation material or membrane. To pass this requirement, there must be no condensation under the roof membrane. Since the membrane is the coldest portion of the roofing system during winter, condensation must occur under the membrane before it does at any other location in the roofing system. Effectively, this requirement tests for the need for a vapor retarder. The computer simulation uses a finite-difference heat and mass transfer model [4] to test this requirement for different new roofing system configurations. The results are evaluated to ensure that the relative humidity of the insulation layer just below the membrane (the outer insulation in Figure 1) does not reach 100%, which would indicate that condensation has occurred. The choice of three layers of insulation material allows us to focus on localized moisture conditions just under the membrane by defining one layer as being a thin portion of the insulation just below the membrane.

III. ESTABLISHING CORRELATIONS BASED ON 'NO CONDENSATION' CRITERION

We analyzed one hundred and twenty new roofing configurations for each of five different cities according to this 'no condensation' criterion. The first objective in this paper was to use this database to develop correlations for moisture accumulation as a function of the variables associated with the roofing system and environmental conditions. If successful, this could be used as one element of a method for predicting if a given roof system would be moisture-tolerant without performing a computer simulation.

Description of the Database

Most of the database used in the research described by this paper was generated in recently completed work [1]. One additional climate, Seattle, was added for this study. The original four climates studied represent the range of climates in the continental US as measured in heating degree days: Bismarck, North Dakota; Chicago, Illinois; Knoxville, Tennessee; and Miami, Florida. Seattle, Washington was added to determine if moisture control in a roofing system installed in a coastal climate behaved differently from those installed in a continental climate. Indoor relative humidities of 40%, 50%, and 60% were used in the study; the indoor temperature was held constant at 68°F (20°C). This combination of indoor conditions defined a range of indoor vapor pressures. Note that the work to date is not applicable for cold storage buildings or any other building whose interior vapor pressure falls outside of the simulated range of vapor pressures. The analyses performed to date ignore the effects of other parameters such as snow loads and the natural variation in indoor vapor pressure due to seasonal change. The latter assumption has been studied [12] and has been found to not have a significant impact on the results as long as the average indoor vapor pressure is simulated.

Table 1

Roof systems properties and environmental conditions simulated

Roof system properties			
Insulation Type	Insulation Thickness, in (mm)	Membrane Absorptance	Deck Permeance, perms (g/Pa·s·m ²)
Fiberboard	1 (25)	0.1 (black)	0.64 (3.6×10^{-8})
Polyisocyanurate(PIR)	3 (76)	0.7 (white)	1.0 (5.7×10^{-8})
Composite	3 (76)		5.0 (29×10^{-8})
(Fiberboard +PIR)			10.0 (57×10^{-8})

Environmental conditions	
Climate (heating degree days)	Building interior relative humidity, %
Bismarck (8992)	40
Chicago (6151)	50
Knoxville (3818)	60
Miami (185)	
Seattle (5280)	

The range of roof systems evaluated included 1-inch and 3-inch (25- and 76-mm) thick wood fiberboard, 1-inch and 3-inch (25- and 76-mm) polyisocyanurate (PIR) insulation, and a 3-inch (76-mm) composite of the two (a core of 2-inch or 51mm polyisocyanurate foam sandwiched between layers of 0.5-inch or 13-mm fiberboard). Metal decks with water vapor permeances of 0.64, 1, 5, and 10 perms ($3.6, 5.7, 29$, and 57×10^{-8} g/Pa·s·m²) were included. Vapor permeance is provided through discontinuities such as burn holes, side and lap seams, and fastener penetrations. The two lower levels of deck permeance are from Reference [2]. The remaining two higher levels are assumed values for decks that would be purposely perforated for moisture-control purposes. Two values for membrane absorptance (0.7 for a white roof and 0.1 for a black roof) were modelled. All possible combinations of the above parameters were simulated using the finite-difference model. Table 1 summarizes the roof properties and environmental conditions analyzed. Note that all of the roofing simulations were performed on

new roofing configurations; reroofing applications are presently beyond the scope of this analysis, but not of the procedure.

All of the 600 configurations were evaluated according to the above moisture-tolerant requirement. Roofing systems which showed a relative humidity of 100% in the outer insulation layer just below the roof membrane were determined to fail the no condensation requirement.

IV. DETERMINATION OF MOISTURE ACCUMULATION

Moisture moves into the roofing system via vapor diffusion, air leakage, and gravimetrically through discontinuities in the insulation layer. Other requirements of a moisture-tolerant roof address the issues of moisture transport by air leakage and through cracks in the insulation; they must be eliminated [1]. If moisture transport is limited to diffusion, then the flow rate of water vapor into a roof typically occurs during the winter uptake period when the indoor vapor pressure is greater than the vapor pressure underneath the membrane of the roof. This creates a vapor pressure drive into the roof. The moisture flow rate is proportional to the magnitude of the difference in vapor pressures across the roof divided by the sum of the resistances to vapor diffusion.

$$\dot{m} = \frac{p_{vi} - p_{vm}}{R_{bl} + R_d + R_i} \quad (1)$$

where

\dot{m} = mass flow rate of moisture into the roof, lb/hr ft² (kg/hr m²);

p_{vi} = indoor vapor pressure, psi (kPa);

p_{vm} = average vapor pressure directly under the roof membrane during the winter uptake months, psi (kPa);

R_{bl} = vapor resistance of the boundary layer of air under the roof deck, Reps (metric Reps);

R_d = vapor resistance of the deck, Reps (metric Reps); and

R_i = vapor resistance of the insulation, Reps (metric Reps).

These variables were determined in the following ways: The indoor vapor pressure can be determined by multiplying the saturation vapor pressure (found in any standard saturated steam table) at the indoor temperature of 68°F (20°C) by the relative humidity [5]. The vapor resistances of the insulation and the deck can be found by taking the inverse of the permeance (or by dividing the thickness by the permeability). Permeance and permeability values can be obtained from the ASHRAE Handbook of Fundamentals [6]. More complete listings of these parameters, including the impact of relative humidity, are available from the International Energy Agency [7]. The average monthly vapor pressure values directly under the membrane during winter uptake were extracted from the finite-difference simulations and averaged, to determine the average vapor pressure under the membrane during the winter uptake months. The number of months of winter uptake were counted to determine the length of time in which moisture accumulation occurs.

These values can be used in the relationship for moisture flow rate. Total moisture accumulation, m , is then found by multiplying the moisture flow rate by the number of months of when the vapor drive is upward into the roof, t :

$$m = \dot{m} t \quad (2)$$

V. ESTABLISHMENT OF PASS/FAIL THRESHOLD FOR EACH MATERIAL

The calculated values of moisture accumulation were listed in ascending order for each type of insulation material. Next to each value of moisture accumulation was the identifying roof system code and whether or not the roofing system failed the stated condensation control requirement. These lists were examined to determine the thresholds of moisture accumulation where most roofing systems begin to fail for each type of insulation. By comparing the moisture accumulation data to the simulation outputs that indicated whether condensation occurred, the critical thresholds were readily identified by determining what value of moisture accumulation

indicated the onset of condensation. The critical thresholds of moisture accumulation were determined to be 0.012 lb/ft² (0.06 kg/m²) for polyisocyanurate, 0.14 lb/ft² (0.69 kg/m²) for the composite, and 0.20 lb/ft² (1.0 kg/m²) for the fiberboard.

VI. DEVELOPMENT OF CORRELATION BASED ON INPUT DATA

It is desirable to be able to predict failure of a roofing system using only the parameters associated with the roof system (i.e., materials and configuration) and environmental conditions without using a computer model for each new system evaluated. To this end, the second objective was to develop a correlation to predict moisture accumulation in terms of indoor relative humidity, heating degree days, deck permeance, and roof solar absorptance.

Multiple linear regression was done using combinations of first, second, third order and inverse terms of each of the four variables to develop correlations for average winter vapor pressure directly under the membrane and the length of time of the winter uptake period. Solar absorptance was shown not to affect the correlation for time of winter uptake. The results from these equations, (4) and (5), were then inserted into the moisture accumulation equation (3) to result in an equation which predicts moisture accumulation in terms of the parameters listed. These equations are seen below.

Moisture accumulation,

$$m = \frac{t(p_{vi} - p_{vm})}{R_{bl} + R_d + R_i} \quad (3);$$

where $p_{vm} = -0.93414 + 0.284\phi + 4.850 \times 10^{-4}H - 7.995 \times 10^{-8}H^2 + 4.215 \times 10^{-12}H^3 - 2.053 \times 10^{-5}H\phi + 161.0/H + 0.002305P - 8.013 \times 10^{-5}P^2 - 1.343 \times 10^{-7}HP - 0.008889\alpha \quad (4);$

$$t = -66.1 - 1.514\phi + 0.03390H - 5.655 \times 10^{-6}H^2 + 3.067 \times 10^{-10}H^3 + 0.004424H\phi - 4.327 \times 10^{-7}\phi H^2 + 11430/H \quad (5);$$

and

p_{vm} = average vapor pressure just below the membrane during the winter uptake period, (lb/in²);
 t = length of time of winter uptake, (months);
 ϕ = indoor relative humidity;
 H = climate heating degree days, (°F);
 P = deck permeance (English perms); and
 α = membrane solar absorptance.

A value of 0.0211 Reps was used for the vapor resistance of the boundary layer of air beneath the deck [8].

The average winter vapor pressure under the membrane proved to be strongly influenced by the indoor relative humidity and climate. It tended to decrease as the climate became colder yielding larger vapor pressure differences across the roofing system. Solar absorptance of the roof membrane and deck permeance were found to have a weaker effect on average winter vapor pressure.

For the length of time of winter uptake, relative humidity and heating degree days were again the significant influences. The period of winter uptake tended to increase with relative humidity and colder climates. Deck permeance had a minor effect, and membrane absorptance was found not to be a factor.


Roofing configurations with no moisture accumulation did not experience a winter uptake, but a vapor drive out of the roofing system and year-round drying. Since equation 3 is not valid for determining moisture removed, these systems were excluded from the data used to generate the correlation. However, these systems were added back into the pool of data after the correlation was done so that they could be included in the evaluation of the method. The results for these systems were near zero values of moisture accumulation.

VII. COMPARISON OF SIMULATION-BASED MOISTURE ACCUMULATION AND CORRELATION-BASED MOISTURE ACCUMULATION

The moisture accumulation values calculated using this correlation were then compared to the moisture accumulation based on computer simulations. The correlation coefficient was 0.98 between the two. The plot can be seen in Figure 2. The slope of the best-fit line is 0.88, indicating that, on average, the input-based moisture accumulation is generally conservative in its estimation.

Figure 2

Simulation-based vs. correlation-based moisture accumulation

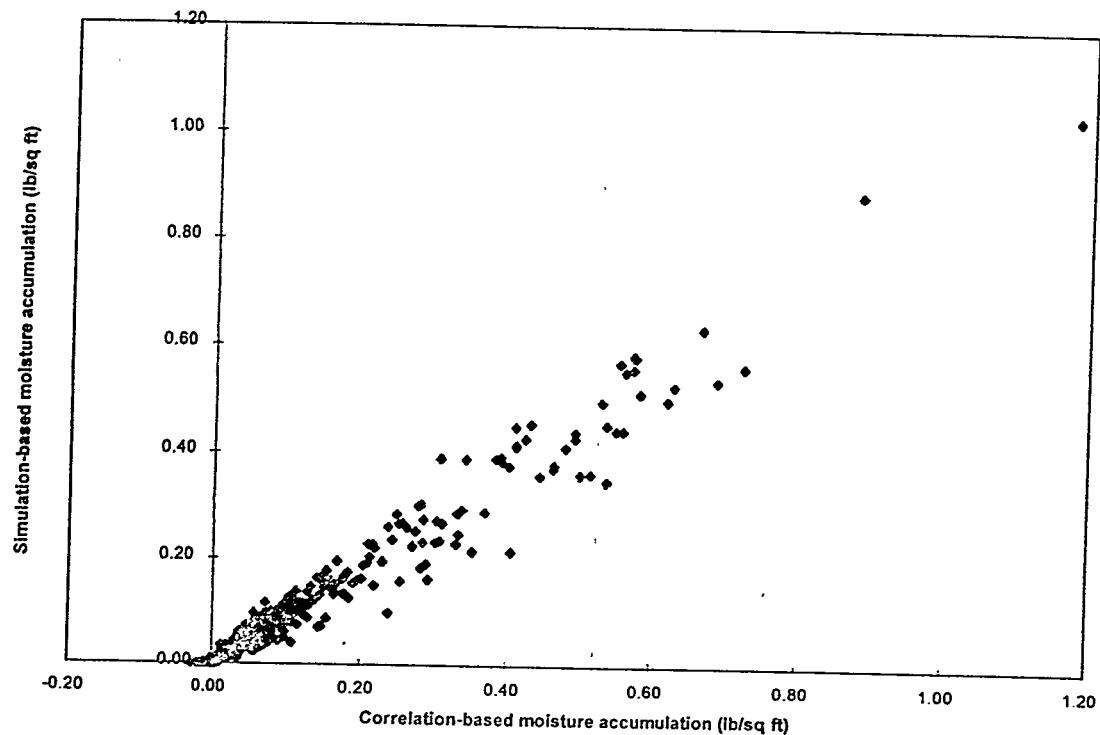

The final evaluation of the method is whether the results derived from the correlations using only the input conditions (Correlation-based) and roof properties agree with the results from the computer simulations (Simulation-based). Since data from 120 composite, 240 fiberboard and 240 PIR roofing systems and conditions were evaluated, the data is summarized by breaking the data for each insulation type into 12 groups and presenting an average value of moisture accumulation along with the predicted failures for each of the two methods. Although the listing of each individual simulation would be preferable and more clearly demonstrates the comparison between the methods, the groupings are depicted for brevity. The results are seen in Tables 2.1, 2.2, and 2.3. Note that the Correlation-based results slightly underpredict the moisture accumulation as compared to the Simulation-based results for the composite systems, but overpredict for the fiberboard and PIR systems.

Table 2.1

Composite systems
(groups of 10)
Failure Threshold = 0.14 lb/ft²

Correlation-based		Simulation-based	
Moisture Accumulation (lb/ft ²)	No. of Failures	Moisture Accumulation (lb/ft ²)	No. of Failures
-0.001	0	0.000	0
0.000	0	0.000	0
0.008	0	0.010	0
0.018	0	0.027	0
0.020	0	0.035	0
0.031	0	0.041	0
0.040	0	0.051	0
0.042	0	0.059	0
0.054	0	0.070	0
0.064	0	0.084	0
0.081	0	0.098	0
0.122	3	0.141	3

The proposed new correlation is 97% accurate in predicting passing and failure of roofing systems for the thresholds indicated above. The "worst case", a prediction of passing for a failing system happens in less than 1% of the 600 cases. Of these 5 cases, 2 occurred for "borderline" failures--systems for which the relative humidity at the membrane was above 100% for less than one month. The other 3 cases were all high (60%) relative humidity, cold climates (Bismarck and Chicago), 3 inch fiberboard systems. The reason these 3 failures were not accurately predicted is unclear.

Table 2.2

Moisture accumulation in fiberboard systems (groups of 20)			
Correlation-based		Simulation-based	
Moisture Accumulation (lb/ft²)	No. of Failures	Moisture Accumulation (lb/ft²)	No. of Failures
-0.008	0	0.000	0
0.002	0	0.000	0
0.014	0	0.014	0
0.033	0	0.035	0
0.051	0	0.051	0
0.068	0	0.066	0
0.086	0	0.082	0
0.123	3	0.111	2
0.193	5	0.166	5
0.293	17	0.254	18
0.416	20	0.379	20
0.627	20	0.561	20

Table 2.3

Moisture accumulation in PIR systems
 (In groups of 20)
 Failure Threshold = 0.012 lb/ft²

Correlation-based		Simulation-based	
Moisture Accumulation (lb/ft ²)	No of Failures	Moisture Accumulation (lb/ft ²)	No of Failures
-0.002	0	0.000	0
0.002	0	0.000	0
0.006	1	0.004	3
0.016	14	0.010	14
0.025	17	0.018	17
0.031	20	0.025	20
0.037	20	0.031	20
0.047	20	0.039	20
0.057	20	0.047	20
0.072	20	0.062	20
0.100	20	0.086	20
0.178	20	0.158	20

VIII. SUMMARY AND CONCLUSIONS

The values of moisture accumulation calculated using the results of computer simulations substituted into Equation 3 were effective in predicting failure according to the 'no condensation' moisture-tolerant roof requirement. Roofing systems which have higher moisture accumulation failed the requirement. These results were used to establish critical thresholds for fiberboard, polyisocyanurate, and the composite. The fiberboard roof systems have higher water absorbing capability and absorbed significantly higher moisture levels prior to the onset of condensation than the low absorptance polyisocyanurate insulation roofs.

Good agreement was obtained between the values of moisture accumulation calculated from simulation-generated data and moisture accumulation calculated from the correlation of variables associated with the roofing system and indoor conditions. Both methods of determining

moisture accumulation using roof system properties and environmental conditions are over 95% effective in predicting failure of a roof according to the stated moisture-tolerant requirement. This represents a huge improvement over current methods where condensation directly below the membrane is not usually assessed and a much greater number of roofs are being designed which fail this requirement for moisture tolerance.

The relationships presented can be used to effectively predict whether a roofing system will fail the 'no condensation' requirement for moisture-tolerant roof systems. This evaluation can now be accomplished without the use of a computer simulation. Simulations of the coastal climate of Seattle fit well with the continental climates; heating degree days appear to be an appropriate measure to track condensation potential for the entire US.

IX. FUTURE WORK

Similar correlations are being developed for the remainder of the moisture-tolerant roof requirements. These include a requirement that moisture will not leak into the building interior if a minor leak occurs through the roof membrane, and a requirement that drying time should be minimal after a leak occurs. In addition, the applicability of the correlation-based prediction algorithm must be tested to verify that it is appropriate to apply to other roofing systems containing other types of insulation and decks located in other climates with a wider range of indoor vapor pressures. Once these tasks are completed, the algorithms will be used as the basis of an Internet homepage where roofing designers will be able to assess the moisture tolerance of their roof designs by simply selecting the roof system components, the building location, and interior conditions. The construction of this homepage should be complete in late 1997.

X. ACKNOWLEDGMENTS

This research is sponsored by the Office of Building Technology, Building Systems and Materials Division, U.S. Department of Energy, under a subcontract with Lockheed Martin Energy Research Corporation, with additional support from the University of North Carolina at Charlotte.

XI. KEYWORDS

low-slope roof, moisture, vapor retarder, computer simulation, moisture control, vapor pressure.

REFERENCES

1. Desjarlais, A.O. (1995). *Self-Drying Roofs: What! No Dripping!* ASHRAE/DOE/BTECC Conference. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta GA.
2. Kyle, D.M., and Desjarlais, A.O. (1994). *Assessment of Technologies for Constructing Self-Drying Low-Slope Roofs*, Oak Ridge National Laboratory Report ORNL/CON-380, Oak Ridge TN.
3. Powell, F. and Robinson, H. (1971). *The Effect of Moisture on the Heat Transfer Performance of Insulated Flat-Roof Constructions*. U.S. National Bureau of Standards, Building Series 37, Gaithersburg, MD.
4. Pedersen, C. (name changed to Rode, C.). (1990). *Combined Heat and Moisture Transfer in Building Constructions*. Technical University of Denmark, Thermal Insulation Laboratory Ph.D. thesis.
5. Black, W.Z. and Hartley, J.G. (1991). *Thermodynamics*, Harper Collins Publishers.
6. ASHRAE Handbook (1993). Fundamentals, American Society of Heating, Refrigeration, and Air Conditioning Engineers, Atlanta GA.
7. IEA (1996). Heat, Air, and Moisture Transfer Through New and Retrofitted Insulated Envelope Parts (HAMTIE), IEA Report Annex 24, *Task 3, Material Properties*. International Energy Agency.
8. Burch, D.M. and Desjarlais, A.O. (1995) *Water-Vapor Measurements of Low-Slope Roofing Materials*. National Institute of Standards and Technology Report NISTIR 5681, Gaithersburg, MD.
9. Desjarlais, A.O., Christian, J.E., Kyle, D.M., and Rode, C. (1993) *Moisture: Its Effects on the Thermal Performance of a Low-Slope Roof System*, pp. 1004-1012. ASHRAE Transactions, 99(2), American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta GA.
10. Desjarlais, A.O., Kyle, D.M., and Christian, J.E. (1993). *The Simulated Impact of Climate on the Drying Times of a Wetted Low-Slope Roof System*, pp. 234-245. *J. Thermal Insulation*, vol. 16.

11. Rode, C., and Courville, G.E. (1991). *A Computer Analysis of the Annual Thermal Performance of a Roof System with Slightly Wet Fibrous Glass Insulation under Transient Conditions*, pp. 110-136. *J. Thermal Insulation*, vol. 15.
12. Patten, J.C., Sheahan, J.P., and Desjarlais, A.O. (1997). *The Pembroke Project: A Full-Scale Demonstration of Roof Re-cover*, Fourth International Symposium on Roofing Technology, National Roofing Contractors Association, Rosemont IL.

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.