

NUREG/CP-0153
CONF-960715

Proceedings of the 24th DOE/NRC Nuclear Air Cleaning and Treatment Conference

Held in Portland Oregon
July 15-18, 1996

Date Published: August 1997

Edited by
M. W. First

Sponsored by
Office of Environmental Guidance
U.S. Department of Energy
Washington, DC 20585

Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

International Society of Nuclear Air
Treatment Technologies, Inc.
4400 Glen Willow Lake Lane
Batavia, OH 45103

Harvard School of Public Health
The Harvard Air Cleaning Laboratory
665 Huntington Avenue
Boston, MA 02115-6021

Proceedings prepared by The Harvard Air Cleaning Laboratory
NRC Job Code G6543

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED



rf

PROGRAM COMMITTEE

W. L. Anderson

R. R. Bellamy

W. Bergman

R. G. Dorman

K. Duvall

T. Fukasawa

H. Gilbert

W. R. A. Goossens

J. J. Hayes, Jr.

R. T. Jubin

J. L. Kovach

R. Lee

J. D. Paul

R. D. Porco

P. Sigli

J. Slawski

R. R. Weidler

J. G. Wilhelm

R. Zavadoski

CONFERENCE CHAIRMAN

M. W. First
Harvard Air Cleaning Laboratory

DISCLAIMER

**Portions of this document may be illegible
in electronic image products. Images are
produced from the best available original
document.**

ABSTRACT

This report contains the papers presented at the 24th DOE/NRC Nuclear Air Cleaning and Treatment Conference and the associated discussions. Major topics are: (1) nuclear air cleaning issues, (2) waste management, (3) instrumentation and measurement, (4) testing air and gas cleaning systems, (5) progress and challenges in cleaning up Hanford, (6) international nuclear programs, (7) standardized test methods, (8) HVAC, (9) decommissioning, (10) computer modeling applications, (11) adsorption, (12) iodine treatment, (13) filters, and (14) codes and standards for filters and adsorbers.

TABLE OF CONTENTS

ABSTRACT	iii
FOREWORD	xvii

SESSION 1

OPENING OF THE CONFERENCE

Monday July 15, 1996

Chairman: M.W. First, *Harvard Air Cleaning Laboratory*

OPENING COMMENTS OF CHAIRMAN AND GREETINGS FROM SPONSORS M. W. First, Conference Chairman, <i>Harvard Air Cleaning Laboratory</i>	2
KEYNOTE ADDRESS: NUCLEAR AEROSOLS: UNFINISHED BUSINESS Thomas Kress, <i>US Nuclear Regulatory Commission</i> Chairman, Advisory Committee on Reactor Safeguards	5
DISCUSSION	10
AIR CLEANING ISSUES WITH CONTAMINATED SITES R.R. Bellamy, <i>US Nuclear Regulatory Commission</i>	12
DISCUSSION	30
NEW CHALLENGES TO AIR/GAS CLEANING SYSTEMS J.L. Kovach, <i>NUCON International, Inc.</i>	33
DISCUSSION	38
APPLICATION OF INNOVATIVE POLICIES FOR CONTROLLING RADIONUCLIDE RELEASES: THE "OPEN-MARKET TRADING RULE" D.W. Moeller, <i>Dade Moeller & Associates, Inc.</i>	40
DISCUSSION	49

SESSION 2

WASTE MANAGEMENT

Monday July 15, 1996

Co-Chairmen: R.R. Bellamy, *US Nuclear Regulatory Commission*
J.G. Wilhelm, *Consultant, Germany*

RADIOACTIVE WASTE TANK VENTILATION SYSTEM INCORPORATING TRITIUM CONTROL P.D. Rice, <i>ICF Kaiser Hanford Co.</i>	51
DISCUSSION	63
DEVELOPMENT OF A COMPUTER CODE TO PREDICT A VENTILATION REQUIREMENT FOR AN UNDERGROUND RADIOACTIVE WASTE STORAGE TANK Y.J. Lee and E.L. Dalpiaz, <i>ICF Kaiser Hanford Co.</i>	65
DISCUSSION	75
TESTING CLEANABLE/REUSABLE HEPA PREFILTERS FOR MIXED WASTE INCINERATOR AIR POLLUTION CONTROL SYSTEMS D. B. Burns, A. Wong, B.W. Walker, and J.D. Paul, <i>Westinghouse Savannah River Co.</i>	76
DISCUSSION	85
DEVELOPMENT OF AN AIR CLEANING SYSTEM FOR DISSOLVING HIGH EXPLOSIVES FROM NUCLEAR WAR HEADS W. Bergman, K. Wilson, K. Stagges, D. Beason, S. Doughty, R. Arganbright, and D. Wapman, <i>Lawrence Livermore National Laboratory</i> , G. Nelson, <i>Miller-Nelson Research</i>	89
DISCUSSION	117
A THICK HOMOGENEOUS VEGETATED COVER DESIGN PROVES COST- AND SCHEDULE-EFFECTIVE FOR THE RECLAMATION OF URANIUM MILL SITES NEAR SPOKANE, WASHINGTON J. Blacklaw, G. Robertson, D. Stoffel, J. Ahmad, E. Fordham, S. Pachernegg, L. Wainhouse, and J. Riley, <i>Washington State Department of Health, Division of Radiation Protection</i>	118
DISCUSSION	129
CHAIRMAN'S CONCLUSION	130

SESSION 3

INSTRUMENTATION AND MEASUREMENT

Monday July 15, 1996

Co-Chairmen: W.L. Anderson, *Consultant*
R. Zavadoski, *Defense Nuclear Facilities Safety Board*

PRACTICAL EXPERIENCE APPLIED TO THE DESIGN OF INJECTION AND SAMPLE MANIFOLDS TO PERFORM IN-PLACE SURVEILLANCE TESTS ACCORDING TO ANSI/ASME N-510 E.M. Banks, W.O. Wikoff, and L.L. Shaffer, <i>NUCON International, Inc.</i>	132
DISCUSSION	145
UNIT VENT AIRFLOW MEASUREMENTS USING A TRACER GAS TECHNIQUE D.G. Adams, <i>Union Electric Co.</i> , P.L. Lagus, <i>Lagus Applied Technology, Inc.</i> , K.M. Fleming, <i>NCS Corp.</i>	147
DISCUSSION	161
DEVELOPMENT OF REAL TIME DETECTOR FOR FLUORESCENT PARTICLES C. Prevost, J. Vendel, <i>Institut de Protection et de Sûreté Nucléaire - DPEA/SERAC</i> , and A. Seigneur, <i>LETI-CEA/Saclay, France</i>	162
ACCURACY IMPROVEMENT IN LEAK DETECTION OF CHARCOAL ADSORBERS BY HALIDE PULSE INTEGRATION METHOD B.J. Kovach and E.M. Banks, <i>NUCON International, Inc.</i>	176
DISCUSSION	180
TESTING THE SAMPLING EFFICIENCY OF A NUCLEAR POWER STATION STACK MONITOR L.H. Ström, <i>Firma Instrumentinvest, Sweden</i>	181
DISCUSSION	187
THE INFLUENCE OF SALT AEROSOL ON ALPHA RADIATION DETECTION BY WIPP CONTINUOUS AIR MONITORS W.T. Bartlett and B.A. Walker, <i>Environmental Evaluation Group</i>	188
DISCUSSION	200

SESSION 4

PANEL SESSION: TESTING AIR AND GAS CLEANING SYSTEMS
A) ACCEPTANCE TESTING: PROPOSED AG-1 CODE TA
B) IN-SERVICE TESTING: PROPOSED NUCLEAR STANDARD N511
Tuesday July 16, 1996

Co-Chairmen: S. Banton, *Consultant*
M.E. Pest, *Palo Verde Generating Station*

Panel Members: P. Burwinkel, *Georgia Power*
C. Graves, *NUCON International, Inc.*
V. Kluge, *Arizona Public Service Co.*
L. Leonard, *Leonard Designs, Inc.*

SECTION TA ACCEPTANCE TESTING, DRAFT REVISION 03/06/96 203

ASME N511-19XX, STANDARD FOR PERIODIC IN-SERVICE TESTING OF NUCLEAR AIR
TREATMENT, HEATING, VENTILATING AND AIR CONDITIONING SYSTEMS, DRAFT REVISION
07/09/96 264

DISCUSSION 317

SESSION 5

WORKING LUNCH
Tuesday July 16, 1996

Co-Chairmen: M.W. First, *Harvard Air Cleaning Laboratory*
J.L. Kovach, *NUCON International, Inc.*

Invited Speaker: John D. Wagoner, Manager
Department of Energy, Richland

PROGRESS AND CHALLENGES IN CLEANING UP HANFORD
J.D. Wagoner, *US Department of Energy, Richland* 335

DISCUSSION 364

PROVISIONS FOR CONTAINMENT VENTING IN GERMANY
J.G. Wilhelm, *Consultant* 371

SESSION 6

INTERNATIONAL PANEL
REPORTS ON NUCLEAR AIR AND GAS CLEANING ACTIVITIES
FROM AROUND THE WORLD

Tuesday July 16, 1996

Co-Chairmen: R. Weidler, *Duke Power Co.*
J.G. Wilhelm, *Consultant, Germany*

Panel Members: R.R. Bellamy, *US Nuclear Regulatory Commission*
J. Dymont, *AWE Aldermaston, England*
T. Fukasawa, *Hitachi, Ltd, Japan*
R. Lee, *US Nuclear Regulatory Commission*
R. Porco, *Ellis & Watts*
J. Slawski, *US Department of Energy*
J.G. Wilhelm, *Consultant, Germany*

PANEL DISCUSSION 380

SESSION 7

OPEN END

Tuesday July 16, 1996

Co-Chairmen: K. Duval, *US Department of Energy*
M.W. First, *Harvard Air Cleaning Laboratory*

STANDARDIZED METHODS FOR IN-PLACE FILTER TESTING

M. Dykes, *Westinghouse Savannah River Co.*, J.K. Fretthold, *Safe Sites of Colorado, Rocky Flats Environmental Technology Site*, and J. Slawski, *US Department of Energy* 386

DISCUSSION 394

CHARCOAL FILTER TESTING 396

Lyons, J, *US Nuclear Regulatory Commission*

DISCUSSION 398

SESSION 8

HVAC & DECOMMISSIONING

Wednesday July 17, 1996

Co-Chairmen: J.D. Paul, *Westinghouse Savannah River Co.*
R. Porco, *Ellis & Watts*

HVAC

CONTROL ROOM ENVELOPE UNFILTERED AIR INLEAKAGE TEST PROTOCOLS

P.L. Lagus and R.A. Grot, *Lagus Applied Technology, Inc.* 400

DISCUSSION 426

VARIABLE PATTERN CONTAMINATION CONTROL UNDER POSITIVE PRESSURE

H.M. Philippi, *Chalk River Laboratories, Canada* 428

AEROSOL DEPOSITION IN BENDS WITH TURBULENT FLOW

A.R. McFarland, H. Gong, W.B. Wentz, and N.K. Anand, *Texas A&M University*, A. Muyschondt, *University of Arkansas* 441

DISCUSSION 459

DECOMMISSIONING

**ATMOSPHERIC DISCHARGES FROM NUCLEAR FACILITIES DURING DECOMMISSIONING:
GERMAN EXPERIENCES AND CONCEPTS**

H. Braun, R. Görtz, and L. Weil, *Federal Office for Radiation Protection, Germany* 460

DISCUSSION 470

**HEATING, VENTILATING, AND AIR CONDITIONING DEACTIVATION THERMAL ANALYSIS OF
PUREX PLANT**

W.W. Chen and R.A. Gregonis, *Westinghouse Hanford Co.* 471

DISCUSSION 482

SESSION 9

COMPUTER MODELING APPLICATIONS & ADSORPTION

Wednesday July 17, 1996

Co-Chairmen: R. Lee, *US Nuclear Regulatory Commission*
D.W. Moeller, *Dade Moeller & Associates, Inc.*

COMPUTER MODELING APPLICATIONS

FILTRATION THEORY USING COMPUTER SIMULATIONS

W. Bergman and I. Corey, *Lawrence Livermore National Laboratory* 485

DISCUSSION 497

**STUDY ON COLLECTION EFFICIENCY OF FISSION PRODUCTS BY SPRAY: EXPERIMENTAL
DEVICE AND MODELLING**

D. Ducret, D. Roblot, and J. Vendel, *Institut de Protection et de Sûreté Nucléaire - DPEA/SERAC*, Y. Billarand,
ECCO Pharmacie et Chimie, France 500

DISCUSSION 519

ADSORPTION

**CHARACTERIZATION AND RESTORATION OF PERFORMANCE OF "AGED" RADIOIODINE
REMOVING ACTIVATED CARBONS**

W.P. Freeman, *NUCON International, Inc.* 520

DISCUSSION 524

**EFFECTS OF WELDING FUMES ON NUCLEAR AIR CLEANING SYSTEM CARBON ADSORBER
BANKS**

P.W. Roberson, *Duke Power Co.* 525

DISCUSSION 531

**BASIS FOR AND PRACTICAL METHODS OF CONTROLLING PAINTING ACTIVITIES AT THE
SEQUOYAH NUCLEAR PLANT**

R.R. Campbell, *Tennessee Valley Authority* 534

DISCUSSION 545

SESSION 10

**IODINE TREATMENT: CHEMICAL OPERATIONS
AND REACTOR ACCIDENT SCENARIOS**

Wednesday July 17, 1996

Co-Chairmen: R.T. Jubin, *Chemical Waste Division, ORNL*
T. Fukasawa, *Hitachi, Ltd, Japan*

OPENING COMMENTS OF SESSION CHAIRMAN	549
BEHAVIOR OF IODINE IN THE DISSOLUTION OF SPENT NUCLEAR FUELS T. Sakurai, K. Komatsu, and A. Takahashi, <i>Japan Atomic Energy Research Institute, Japan</i>	550
DISCUSSION	562
INFLUENCES OF IMPURITIES ON IODINE REMOVAL EFFICIENCY OF SILVER ALUMINA ADSORBENT T. Fukasawa, K. Funabashi, and Y. Kondo, <i>Hitachi, Ltd., Japan</i>	563
DISCUSSION	575
DIFFUSIONAL ANALYSIS OF THE ADSORPTION OF METHYL IODIDE ON SILVER EXCHANGED MORDENITE R.T. Jubin, <i>Oak Ridge National Laboratory, R.M. Counce, University of Tennessee</i>	576
DISCUSSION	608
REMOVAL EFFICIENCY OF SILVER IMPREGNATED FILTER MATERIALS AND PERFORMANCE OF IODINE FILTERS IN THE OFF-GASES OF THE KARLSRUHE REPROCESSING PLANT WAK F.J. Herrmann, B. Herrmann, V. Hoefflich, and Ch. Beyer, <i>Wiederaufarbeitungsanlage Karlsruhe, J. Furrer, Forschungszentrum Karlsruhe, Germany</i>	609
DISCUSSION	617
CONTROL OF RADIO-IODINE AT THE GERMAN REPROCESSING PLANT WAK DURING OPERATION AND AFTER SHUT DOWN F.J. Herrmann, B. Herrmann, K.D. Kuhn, A. van Schoor, and M. Weishaupt <i>Wiederaufarbeitungsanlage Karlsruhe, J. Furrer, Forschungszentrum Karlsruhe, W. Knoch, Deutsche Gesellschaft für Wiederaufarbeitung von Kernbrennstoffen m.b.H., Germany</i>	618
DISCUSSION	627
CLOSING COMMENTS OF SESSION CHAIRMAN	628

SESSION 11

FILTERS

Wednesday July 17, 1996

Co-Chairmen: R. Dorman, *Consultant*
J. Slawski, *US Department of Energy*
J. Dymant, *AWE Aldermaston, England*

A REVIEW OF DOE HEPA FILTER COMPONENT TEST ACTIVITIES: FY 1992 - FY 1995
J.W. Slawski, *US Department of Energy*, J.F. Bresson, *NFT, Inc.*, R.C. Scripsick, *Los Alamos National Laboratory* 631

DISCUSSION 647

IN-PLACE HEPA FILTER PENETRATION TESTS
W. Bergman, K. Wilson, and J. Elliot, *Lawrence Livermore National Laboratory*, J.W. Slawski, *US Department of Energy* 649

DISCUSSION 670

METHOD FOR HEPA FILTER LEAK SCANNING WITH DIFFERENTIATING AEROSOL DETECTOR
B.J. Kovach, E.M. Banks, and W.O. Wikoff, *NUCON International, Inc.* 671

DISCUSSION 675

UNCERTAINTY IN IN-PLACE FILTER TEST RESULTS
R.C. Scripsick, and R.J. Beckman, *Los Alamos National Laboratory*, B.V. Mokler, *Consultant* 676

DISCUSSION 682

VALIDATION TESTING OF RADIOACTIVE WASTE DRUM FILTER VENTS
L.D. Weber and R.S. Rahimi, *Pall Corporation*, D. Edling, *Edling & Associates, Inc.* 683

DISCUSSION 696

A GENERAL CORRELATION OF MPPS PENETRATION AS A FUNCTION OF FACE VELOCITY WITH THE MODEL 8140 USING THE CERTITEST 8160
N. Lifshutz, M.E. Pierce, *Hollingsworth & Vose Company* 698

DISCUSSION 707

FURTHER DEVELOPMENT OF THE CLEANABLE STEEL HEPA FILTER AND COMPARISON WITH COMPETING TECHNOLOGIES W. Bergman, K. Wilson, and G. Larsen, <i>Lawrence Livermore National Laboratory</i>	708
DISCUSSION	742
THE EFFECT OF MEDIA AREA ON THE DUST HOLDING CAPACITY OF DEEP PLEAT HVAC HEPA FILTERS J. Dymont, <i>AWE plc Aldermaston</i> , D. Loughborough, <i>AEAT Harwell, England</i>	743
DISCUSSION	751
POTENTIAL FOR HEPA FILTER DAMAGE FROM WATER SPRAY SYSTEMS IN FILTER PLENUMS W. Bergman, <i>Lawrence Livermore National Laboratory</i> , J.K. Fretthold, <i>Rocky Flats Environmental Technology Site</i> , J.W. Slawski, <i>US Department of Energy</i>	752
DISCUSSION	776
SIMULATION TEST OF AEROSOL GENERATION FROM VESSELS IN THE PRE- TREATMENT SYSTEM OF FUEL REPROCESSING S. Fujine, K. Kitamura, and T. Kihara, <i>Japan Atomic Energy Research Institute, Japan</i>	778
DISCUSSION	787
EXTENDED-LIFE NUCLEAR AIR CLEANING FILTERS VIA DYNAMIC EXCLUSION PREFILTERS S.W. Wright, H.S. Crouch, and J.H. Bond, <i>Micro Composite Materials Corp.</i>	788
DISCUSSION	803
CONCLUDING REMARKS OF CHAIRMAN DORMAN	805

SESSION 12

CODES & STANDARDS FOR FILTERS AND ADSORBERS

Thursday July 18, 1996

Co-Chairmen: J.J. Hayes, Jr., *US Nuclear Regulatory Commission*
R.D. Porco, *Ellis & Watts*

THE FIRST TWENTY YEARS OF THE ASME COMMITTEE ON NUCLEAR AIR AND GAS TREATMENT- A RETROSPECTIVE BY A FOUNDING MEMBER
J. Jacox, *Jacox Associates* 807

PERFORMANCE TESTING OF HEPA FILTERS: PROGRESS TOWARDS A EUROPEAN STANDARD PROCEDURE
J. Dymont, *AWE plc Aldermaston, England* 819
DISCUSSION 826

THE CASE FOR IMPROVED HEPA-FILTER MECHANICAL PERFORMANCE STANDARDS REVISITED
C.I. Ricketts and P.R. Smith, *New Mexico State University* 829
DISCUSSION 846

**PANEL SESSION: CHANGES TO ASME
CODE AG-1, SECTION FC, HEPA FILTERS**

Co-Chairmen: J.J. Hayes, Jr., *US Nuclear Regulatory Commission*
R.D. Porco, *Ellis & Watts*

Panel Members: J. Slawski, *Department of Energy*
R. Rown, *US Army, ERDEC*
B. Franklin, *AAF*
S. Klocke, *Flanders Filters, Inc.*

PANEL DISCUSSION 850

CLOSING COMMENTS OF CONFERENCE CHAIRMAN 862

INDEX OF AUTHORS AND SPEAKERS 863

LIST OF ATTENDEES 866

INDEX TO THE 21st, 22nd, 23rd, 24th CONFERENCES

PART I - INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE 875

PART II - INDEX OF PAPERS BY AUTHOR(S) 898

PART III - KWOC INDEX OF AIR CLEANING CONFERENCE TITLES 937

FOREWORD

The 24th DOE/NRC Nuclear Air Cleaning and Treatment Conference was held July 14 - 18, 1996 in Portland, Oregon. The Conference was sponsored by the International Society of Nuclear Air Treatment Technologies, the Harvard Air Cleaning Laboratory, and by the US Department of Energy and US Nuclear Regulatory Commission. International interest and participation remained high, with 30% of the papers being presented by scientists and engineers from nine foreign countries. A panel session was held to discuss international programs and research in nuclear air cleaning technology. Other major topics covered were: standards for manufacturing, operation and testing of air cleaning elements and systems; decontamination and decommissioning processes; waste management; instrumentation and measurement systems; gas adsorption; chemical operations; reactor accident scenarios; filters and filtration. Panel sessions were held to discuss the testing of air and gas cleaning systems and codes and standards for the construction and installation of filters and absorbers.

A highlight of the conference was a detailed review of DOE's operations at the Hanford Reservation, Richland, WA, where a ten-year multi-billion dollar decontamination and decommissioning project is underway. Some conference attendees toured the Hanford site after the Conference. The special emphasis on air cleaning for process gas treatment in the waste management area, featured at the 23rd Conference in July 1994, continued as a common theme throughout this conference. Air cleaning requirements for reactor decontamination and decommissioning has also come to the forefront.

I would like to express thanks to the representatives of the Conference's sponsors and financial supporters: Dr. Richard Lee, US Nuclear Regulatory Commission, Mr. James Slawski, US Department of Energy, and Mr. Richard Porco, Chairman of the International Society of Nuclear Air Treatment Technologies. Each of these individuals provided unstinting support and assistance during the planning and conduct of the Conference.

The Chairman would also like to extend his sincere thanks to all members of the Program Committee who worked diligently over the past couple of years to put together the program of the 24th Conference and who helped conduct it in an orderly manner. He is very grateful to each of them for their devotion to the Air Cleaning Conferences and for their willing assistance to the Chairman.

The thanks of all the attendees, as well as the Chairman, are due Mary Kovach for her kind management of each morning's hospitality gathering of family members.

The Chairman extends his special thanks to Suzanne Doyle Shaffner for her able handling of all the business affairs of the Conference and for her careful and timely assembly of the camera-ready master copy of the Proceedings.

Melvin W. First
28 February, 1997

SESSION 1

OPENING OF THE CONFERENCE

Monday July 15, 1996

Chairman: M.W. First

OPENING COMMENTS OF CHAIRMAN AND GREETINGS FROM SPONSORS

M. W. First, Conference Chairman

KEYNOTE ADDRESS: NUCLEAR AEROSOLS: UNFINISHED BUSINESS

Thomas Kress

Chairman, Advisory Committee on Reactor Safeguards

AIR CLEANING ISSUES WITH CONTAMINATED SITES

R.R. Bellamy

NEW CHALLENGES TO AIR/GAS CLEANING SYSTEMS

J.L. Kovach

APPLICATION OF INNOVATIVE POLICIES FOR CONTROLLING RADIONUCLIDE RELEASES: THE "OPEN-MARKET TRADING RULE"

D.W. Moeller

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

OPENING OF THE CONFERENCE & GREETINGS FROM SPONSORS

FIRST: It is my special privilege to call the Conference to order, and to bid you all welcome on behalf of the program committee and the several sponsors of this conference. One of the conference sponsors is the Harvard Air Cleaning Laboratory. I am Melvin First, I bring you Harvard's greetings and a hearty welcome. The other sponsors will greet you shortly. I would like to extend a special greeting to the many friends who have joined us from other countries. I know I speak for all of the US attendees as well as myself when I say how much we appreciate your active participation in these conferences over the many years that they have been held. The delegates from other countries continue to be a major factor in these conferences. Were it not for the fact that two of US government agencies are financial sponsors, I would think of this Conference as being a world conference because truly it does represent the world community in the technical areas covered by the conference. So once again, we welcome you and hope that you find your trip useful and pleasurable.

It's obvious that these conferences require a lot of hard work on the part of the entire Program Committee. Their duties don't cease at the beginning of the conference, because they all have been given assignments as session chairmen, and you will interact with them throughout the Conference. The Conference Committee members are listed in the Conference Program. Let me identify by name: Wendell Anderson, consultant. Ronald Bellamy, Region One, Nuclear Regulatory Commission. Werner Bergman, Lawrence Livermore National Laboratory, California. Richard Dorman, formerly with the Porton Downs military establishment in England, and currently a consultant. Ken Duvall, Department of Energy. Tetsuo Fukasawa, Hitachi in Japan. Jack Hayes, Nuclear Regulatory Commission, Headquarters in Maryland. Robert Jubin, Oak Ridge National Laboratory. J Louis Kovach, NUCON International. Richard Lee, the Nuclear Regulatory Commission. Joseph Paul, Westinghouse Savannah River Company. Richard Porco, Ellis & Watts. Richard is the president of the International Society for Nuclear Air Treatment Technologies. Paul Sigli, consultant France. James Slawski, Department of Energy. Ray Weidler, Duke Power Company. Ray is the Chairman of the Committee on Nuclear Air and Gas Standards. Jeurgen Wilhelm, Germany, many years associated with KKK, and currently a consultant. And Roger Savadowski, Defense Nuclear Facilities Safety Board. One additional member of the program committee that I have not yet named is Humphrey Gilbert. Humphrey, because of physical disability, has been unable to be with us today. I'm sure this is the first Air Cleaning Conference he has missed since they started forty-five years ago. I know we all miss him as much as he misses not being here. We extend all our best wishes to him.

Now, for the other sponsors of the conference, I'm going to call on a representative from each of the organizations to send their own greetings and welcome to you. The first of these, from the US Department of Energy, is James Slawski, who is in DOE's Industrial Hygiene Office of Defense Programs. He is a certified industrial hygienist, with twenty-five years experience in occupational safety and health. He has been at the DOE for six years.

SLAWSKI: This is the first conference, that Humphrey Gilbert has missed, and the first conference I have attended. On behalf of DOE I welcome all of you. I look at this as an opportunity for all of us to figure out where we are and figure out what we have to do to try to do our jobs a little bit better and smarter in the future. We are working with CONAGT on standards for filters on the FC section in particular. We are trying to work our way to adopting for the Department that consensus standard. We are not sure we are there yet. We are working in that direction and we have discussions ongoing here at this Conference to help us go in that direction. Whatever we can do to get us to a state that satisfies DOE's needs for a consensus standard will be very beneficial. Again, welcome and thank you for attending.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FIRST: I will next call on Dr. Richard Lee representing the US Nuclear Regulatory Commission.

LEE: On behalf of the Nuclear Regulatory Commission, I welcome you to this Conference. We are very pleased that we have supported this Conference with the DOE and since its inception, and we hope we will do so in the future. Tomorrow Ronald Bellamy and I will give you a briefing on what is happening at the Commission with respect to domestic activities and international activities. I am from the Office of Research. Most of our research now focuses on the national arena, but I hope to give you a very brief report on what other programs we are tracking in the European and in the Pacific regions. I wish that you have a successful Conference and a pleasant stay at this city.

FIRST: The fourth sponsor is the International Society of Nuclear Air Treatment Technologies. To represent that organization we have Richard Porco, who is the president of ISNATT.

PORCO: Welcome you to the 24th Nuclear Air Cleaning and Treatment Conference on behalf of ISNATT. I also welcome you to the ISNATT Expo. I hope you will all take time to visit by the exhibits. They will be held in the foyer. I think you will find a lot of equipment on display there that will be topics of discussion at some of the technical sessions. I also want to thank all you who participated in the ISNATT short courses. Those interested in future short courses should stop by the booth for the ISNATT and ASME booths. I think it is very important to point out the work that ISNATT is doing to support the Nuclear Air Cleaning and Treatment Conferences. To in this endeavor I would encourage all to join ISNATT and get involved in promoting the Expo as well as the international exchange of technologies. This is the way to make this Conference a success and to make sure that we continue to have the type of support and the type of exchange that we have enjoyed during the course of the meetings.

FIRST: In addition to the many technical papers that are a hallmark of these Conferences, there are numerous highlights that I would like to call to your attention. Shortly, our keynote speaker will address a topic of special interest to specialists in nuclear air and gas cleaning technology. This will be followed by three very seminal papers concerning new directions for the nuclear industry, in general, and air and gas cleaning specialists in particular. Each will leave you with many new and important things to think about. I look forward to hearing the presentations. On Tuesday, we will have a working lunch with John Wagoner, Manager of the DOE's Richland Operations Office. He will talk about progress and challenges in cleaning up Hanford. Those intending to go on the Hanford tour starting Thursday afternoon will, I know, find this address a very special preparation for your visit. There will be an International Panel after the working lunch, and then our traditional Open-end Session. Those who have things you would like to present or questions you would like to ask the assembled group, please keep this session in mind. There will two panel sessions: one on testing of nuclear air cleaning systems that will include a newly-proposed AG1 code section on acceptance testing, plus a new standard tentatively referred to as N-511 on in-service testing. Both of these documents are nearing their final phase, and I am sure you will be interested in learning what they propose as well as having some input into the final document. The second panel session is concerned with the new AG1 code section on HEPA filters. This code section basically replaces the military specifications that we have been using for this purpose for many decades. Here also, I think you will want to hear about projected changes to the codes and how they will be brought about. I can promise you that these will be very interesting sessions.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

KEYNOTE ADDRESS

Introduction of Thomas Kress, Keynote Speaker

FIRST: Dr. Kress has recently been appointed to the very important post of Chairman of the Nuclear Regulatory Commission's Advisory Committee for Reactor Safeguards. This committee, as many of you know, was created by a congressional statute at the very beginning of the government's nuclear program after World War II. It has continued, uninterrupted as a very important committee that assists the NRC with technical advice on all aspects of nuclear safety. One of the topics, of course, is air and gas cleaning technology. Dr. Kress has been involved in this technical area for many years. Before his appointment to the Advisory Committee for Reactor Safeguards he worked for thirty-five years at Oak Ridge National Laboratory in various posts concerned with areas of nuclear safety. He managed the NRC's research program at Oak Ridge in the area of source terms and nuclear aerosol behavior. His education included a number of different schools, but he received his doctorate in engineering sciences at the University of Tennessee. I've known Tom for many years, served on advisory panels with him, and it has been a sheer delight for me to have had him respond positively to the program committee's invitation to give this keynote address. The title of his talk is "Nuclear Aerosols: Unfinished Business".

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

NUCLEAR AEROSOLS: UNFINISHED BUSINESS

T. S. Kress

Talk presented to the 24th Nuclear Air Cleaning Conference *

July 15, 1996

Portland, Oregon

I am delighted to be here to give the keynote address to this the 24th meeting of the Nuclear Air Cleaning Conference - a conference that I well respect. I have attended several of these in the past but I haven't been active recently. That is because the extent of my technical involvement in nuclear air cleaning over the past 5 years has been to argue with fellow ACRS members as to which is most important to reactor safety - thermal hydraulics or aerosol behavior. I am not sure who is winning the ongoing argument.

I think you can even correlate being asked to be a keynote speaker as being a pretty good sign that you may be near the end of your useful technical life. When asked if I would make this presentation, my first thought was why, couldn't the 1st, 2nd, 3rd, 4th, and 5th choices make it?

I understand the focus of this conference is on "nuclear air and waste treatment technology and its relationship to nuclear safety". If I interpret that in a broad sense to include aerosol behavior in general, I can say a few words about that.

I would like, first, to make the observation that over the years that I have dealt with source terms, severe accidents, and levels 1 and 2 PRAs, I have come to realize that assessing these important aspects of nuclear safety is largely an exercise in thermal hydraulics, chemistry, and aerosol physics. In the past, this series of conferences has made very substantial contributions to the field of aerosol physics and how to effectively clean aerosols and gases from air spaces and streams.

If you look at today's NRC's research effort on aerosol behavior, it is mostly limited to evaluating a few of the source magnitudes. NRC has proclaimed that they no longer need do research on the subsequent transport behavior of aerosols. Why have they reached this conclusion? They say because, in the overall assessment of risk of nuclear power plants, the uncertainties are very large and the contribution that is due to uncertainties in the aerosol transport behavior is very small compared to the other sources of uncertainty. If this is indeed true, then I take it as a tribute to the fine work that has been done in this area by you and others. But, will this remain the situation for much longer?

One of the very strong trends on the international nuclear scene for "new generation" nuclear power plants is that the containment must be designed to cope with severe accidents - meaning that they will not fail under even the lowest probability severe accident sequences.

* I am required by the by-laws of ACRS to announce that I do not represent the committee and that the views I express are my own and are not necessarily those of the committee.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Along with this requirement for the containment to maintain its integrity under severe accident conditions, is a requirement that the release from the containment must be kept low enough that there will be no need for an emergency response.

These are, indeed, very stringent requirements. I just returned from a week-long meeting in Vienna for the IAEA in which the subject was...how should the source term be specified for such new generation plant requirements for use in containment and ESF design and for assessing compliance with the possible regulatory requirement of no evacuation.

One question we wrestled with a great deal in Vienna was...just how do you specify a fission-product/aerosol source term for a future plant of unknown design and give freedom (and even incentive) to the designer to choose such design parameters as reactor type, power, power density, fuel and cladding design, burnup, quantity of water available to the reactor cooling circuit, and strategies for coping with ex-vessel phenomena? If you have any thoughts or suggestions on this, I would like to hear about them before the follow-on meeting to be held in November which is supposed to come to grips with this issue.

Let me tell you now though that if these are to be new requirements, then the complete spectrum of aerosol considerations and their uncertainties jumps back to front and center. We may have to reconsider the need for additional research in this area.

Of course, nuclear aerosol research is still needed for decontamination, fuel reprocessing, waste treatment, and waste storage. If, also, it does re-emerge for nuclear reactor safety, then what are some of the areas that may need additional research or sharpening up?

Well - back in 19 ought..????, when I was actively developing and conducting research programs on nuclear aerosols, times were very good. *How good were they????* They were so good that my group had more research than they could actually handle. Therefore, I always made it a habit to keep in my left hand desk drawer a list of potential future aerosol research areas to follow-on with when we completed the ones that we were currently working on. In today's times of limited research money, I don't think this would be a successful strategy, but it worked well back then.

So, in preparation for this talk, I went back to my files to see if I could find my old list. Sure enough, it was still there. This is a list, mind you, that I made back in 1986 (before Chernobyl) which was essentially the time I quit being a researcher to become a Department Head -- a fate I would not wish on any of you.

[Slide number 1]

Ten years later, I do not really know the status of these, but I would bet that this would still be a pretty good list to start from. I meant to do as many of these as I could, but I didn't get the chance. That is why I have subtitled this talk "unfinished business." I no longer have a use for this list so you are welcome to it.

Before I leave this list, there is one more research area I nearly forgot. The British think more research is needed on the effects of smoke. They have concluded that smoke is an essential ingredient in making electronic and electrical equipment function properly. They reached this conclusion because of an astute observation that every time a piece of such equipment failed or malfunctioned it was because the internal smoke had escaped - they could see it leaving the piece of equipment. They conclude that better means to keep it from escaping are needed...an imminently reasonable conclusion don't you think.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In parting then, I don't think I could do better than to quote from Mel First:

[Slide number 2]

“These conferences have been a force for advancement as well as a forum for refinement of current technology.”

“The conference will continue to be highly involved in the important task of maintaining and improving engineered safety features for existing power reactors and with meeting the air cleaning and treatment needs of advanced reactors.”

I can only add ...keep up the good work and I trust this Conference will be as highly successful as have been past ones.

POTENTIAL NUCLEAR AEROSOL RESEARCH PROJECTS

THE FOLLOWING WERE COPIED FROM A 1986 LIST

1. THEORETICAL VALIDATION OF THE GRAVITATIONAL SETTLING ASSUMPTION/MODEL
2. A BETTER MODEL FOR SHAPE FACTORS AS FUNCTIONS OF AEROSOL SIZE
3. DIRECT EXPERIMENTAL MEASUREMENT OF η AND τ (AS FUNCTIONS OF AEROSOL SIZE AND TYPE)
4. EFFECTS OF HYDROGEN BURNING/DETONATION ON AEROSOL SIZE (DE-AGGLOMERATION AND EVAPORATION OF ABSORBED WATER)
5. CHEMICAL EFFECTS ON AEROSOLS (MOISTURE, H_2 BURNING, ATMOSPHERIC OXYGEN).
6. LIFT-OFF/RESUSPENSION
7. BETTER CODE TREATMENT OF MULTICOMPONENT AEROSOLS.
8. EXPERIMENTAL DETERMINATION OF THE NUCLEATION SIZES OF AEROSOLS . RELATE NUCLEATION SIZE TO MACROSCOPIC PROPERTIES.
9. AEROSOL SOURCES FROM STEAM EXPLOSIONS.
10. EFFECTS OF AEROSOLS ON RECOMBINERS.
11. BETTER IMPACTION DEPOSITION MODELING.
12. EXPERIMENTAL VALIDATION OF DIFFUSIOPHORESIS MODELS IN PRESENCE OF NON-CONDENSABLE.
13. BETTER MODELS FOR AEROSOL TRANSPORT THROUGH CRACKS IN CONCRETE CONTAINMENTS.
14. EFFECTS OF RADIATION-INDUCED CHARGES ON AEROSOL BEHAVIOR IN CONTAINMENTS.
15. EFFECTS OF AEROSOLS ON ELECTRONIC EQUIPMENT.

QUOTES FROM MEL FIRST

*THESE CONFERENCES HAVE BEEN A FORCE FOR
ADVANCEMENT AS WELL AS A FORUM FOR
REFINEMENT OF CURRENT TECHNOLOGY.”*

*THE CONFERENCE WILL CONTINUE TO BE HIGHLY
INVOLVED IN THE IMPORTANT TASK OF
MAINTAINING AND IMPROVING ENGINEERED SAFETY
FEATURES FOR EXISTING POWER REACTORS AND
WITH MEETING THE AIR CLEANING AND TREATMENT
NEEDS OF ADVANCED REACTORS.”*

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FIRST: The talk is open for questions and comments. I would like to ask Tom to comment further on the long list of projects you wrote down approximately a decade ago. I gather that they have not yet been accomplished.

KRESS: I meant to do all of them, but I got out of the business about then, and that is the reason I listed them as unfinished business. At least they are unfinished for me.

FIRST: What do you think is the most important area that we should be concentrating on now, assuming that somebody will come up with adequate funds, which I realize is somewhat uncertain these days.

KRESS: That is a tough question, but I will try to give you a quick answer. I think that better, higher capacity HEPA-type filters that do not fail under loads that are relatively large, would go a long way toward solving many problems, I think that would be my choice.

INTRODUCTION

FIRST: As I mentioned earlier, we have three seminal papers that will occupy the rest of the morning, and I do call your attention to these papers because I think they are opening new ground. They are of extreme interest at present and will continue to be into the future. The first of these papers will be presented by Dr. Ronald Bellamy. Many of you know Ron, he's been a constant attendee and contributes at these Conferences since he left Ohio State University and joined the Nuclear Regulatory Commission. Because his doctoral thesis work was in activated carbon, he came to AEC headquarters at an opportune time with all the knowledge and assurance of a newly minted Ph.D. A nice thing about Ron is his consistency, he is still very positive and he has maintained his enthusiasm and elan through the years. He is my very valued colleague. He is presently Chief of the Decommissioning and Laboratory Branch in Region One of the Nuclear Regulatory Commission. He is on the ASME and ASTM committees on standards and on the Program Committee for this Conference. He's a visiting lecturer at Harvard University and lectures in the course that I am associated with, the In-place Filter Testing Workshop, as well as Dade Moeller's course on Nuclear Emergency Preparedness issues.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

AIR CLEANING ISSUES WITH CONTAMINATED SITES

Dr. Ronald R. Bellamy
US Nuclear Regulatory Commission
King of Prussia, PA 19406

Abstract

The US Nuclear Regulatory Commission has developed a list of contaminated sites that warrant special USNRC attention because they pose unique or complex decommissioning issues. This list of radiologically contaminated sites is termed the Site Decommissioning Management Plan (SDMP), and was first issued in 1990. A site is placed on the SDMP list if it has;

1. Problems with the viability of the responsible organization (e.g., the licensee for the site is unable or unwilling to pay for the decommissioning;
2. Large amounts of soil contamination or unused settling ponds or burial grounds that may make the waste difficult to dispose of;
3. The long-term presence of contaminated, unused buildings;
4. A previously terminated license; or
5. Contaminated or potential contamination of the ground water from on-site wastes.

In deciding whether to add a site to the SDMP list, the NRC also considers the projected length of time for decommissioning and the willingness of the responsible organization to complete the decommissioning in a timely manner. Since the list was established, 9 sites have been removed from the list, and the current SDMP list contains 47 sites in 11 states. The USNRC annually publishes NUREG-1444, "Site Decommissioning Management Plan", which updates the status of each site.

This paper will discuss the philosophical goals of the SDMP, then will concentrate on the regulatory requirements associated with air cleaning issues at the SDMP sites during characterization and remediation. Both effluent and worker protection issues will be discussed. For effluents, the source terms at sites will be characterized, and measurement techniques will be presented. Off-site dose impacts will be included. For worker protection issues, air sampling analyses will be presented in order to show how the workers are adequately protected and their doses measured to satisfy regulatory criteria during decontamination operations.

Introduction

The cleanup of radiological contamination, both within the property of a licensee, and in the general environs as a result of licensee operation, is a major challenge facing the nuclear industry. In recognition of this focus of activity, the NRC formally acknowledged several contaminated sites to promote timely and safe cleanup of these sites and provide special NRC attention because they pose unique or complex decommissioning issues. This list is presently composed of 47 sites in 11 states. In addition, numerous other sites are undergoing or have completed decontamination efforts and have been decommissioned. Some of these are active licensees, while others are formerly-licensed sites from as long as 40 years ago. The methods used to review the decontamination activities, and the acceptance criteria, should be well-defined and understood so that achievable goals are acknowledged and used in the activities. The specified end-points for the cleanup

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

activities used to release areas for unrestricted use should be readily available to the technical experts, and the public alike, open to public scrutiny, and, as generic as possible.

The Site Decommissioning Management Program

NRC developed the Site Decommissioning Management Plan (SDMP) in 1990 to identify a list of contaminated sites that warrant special NRC attention because they pose unique or complex decommissioning issues. While none of these sites represent an immediate threat to the public health and safety, they have contamination that exceeds criteria for release for unrestricted use. All of these sites require some degree of remediation, and several involve regulatory issues that will need to be addressed by the NRC Commissioners. These problematic sites have buildings, former waste disposal areas, large piles of tailings, groundwater, and soil contaminated with low levels of uranium or thorium (source material) or other radionuclides. Consequently, they present varying degrees of radiological hazard, remediation complexity, and cost. Some of the sites are still under the control of active NRC licenses, whereas, licenses for other sites already may have been terminated or never may have been issued. At some sites, licensees are financially and technically capable of completing decommissioning in a reasonable timeframe, whereas, at other sites, the licensee or responsible party may be unable or unwilling to perform decommissioning. In addition, the sites are currently in various stages of decommissioning. At some sites, licensees have initiated decommissioning, whereas, at other sites, decommissioning has not yet been planned or initiated. Sites are placed on the SDMP if there are:

- (1) Problems with the viability of the responsible organization (e.g., the licensee for the site is unable or unwilling to pay for the decommissioning;
- (2) Large amounts of soil contamination or unused settling ponds or burial grounds that may make the water difficult to dispose of;
- (3) The long-term presence of contaminated, unused buildings;
- (4) A previously terminated license; or
- (5) Contamination or potential contamination of the groundwater from on-site wastes.

In deciding whether to add a site to the SDMP list, the NRC also considers the projected length of time for decommissioning and the willingness of the responsible organization to complete the decommissioning in a timely manner. Since the list was established, 9 sites have been removed from the list, and the current SDMP list contains 47 sites in 11 states. The USNRC annually publishes NUREG-1444, "Site Decommissioning Management Plan", which updates the status of each site. The list was established in 1990, and 9 sites have been removed after successful completion of cleanup to meet requirements, or transferred to another regulatory authority. There are eight major activities associated with any major decommissioning activity. Progress can be measured against these milestones.

- (1) A characterization of the site, which would identify the amount and location of radioactive material. A characterization plan is part of this activity, the performance of the characterization, and preparing the characterization report;
- (2) Regulatory review and approval of the site characterization plan and the site characterization report;
- (3) Development and submission of a decommissioning plan, outlining the steps to be taken to perform the decontamination activities;

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (4) Regulatory review and approval of the decommissioning plan;
- (5) Performance of the decontamination and decommissioning activities outlined in the plan;
- (6) Performance of a final status survey to verify releasability of the site and submittal of a final status survey report;
- (7) Regulatory review of the termination survey report, and performance of a confirmatory survey;
- (8) Termination of the license.

Radiological Criteria for Decommissioning

Generally, licensees decommission their facilities with the intent of terminating the license and using the facility for activities that do not involve licensed material. The ultimate goal of decommissioning is to reduce residual radioactivity to levels that are indistinguishable from background levels. These facilities must be decommissioned such that they do not contain residual radioactive material levels in excess of criteria for unrestricted use. The radiological criteria for unrestricted use are identified in the "Action Plan to Ensure Timely Remediation of Sites Listed in the Site Decommissioning Management Plan", 57 FR 13389, April 16, 1992. These criteria include the following:

- USNRC Policy and Guidance Directive FC 83-23, "Guidelines for Decontamination of Facilities and Equipment Prior to Release for Unrestricted Use or Termination of Byproduct, Source and Special Nuclear Material Licenses", November 14, 1983;
- Regulatory Guide 1.86, "Termination of Operating Licenses for Nuclear Reactors", June 1974;
- Options 1 and 2 of the Branch Technical Position, "Disposal or Onsite Storage of Thorium and Uranium Wastes from Past Operations" 46 FR 52601, October 23, 1981;
- 40 CFR Part 141, Interim National Primary Drinking Water Regulations;
- EPA's "Radiation Dose Guidelines for Protection Against Transuranium Elements Present in the Environment as a Result of Unplanned Contamination".

These criteria are applied on a site-specific basis with emphasis on remediating residual radioactive material to levels that are as low as reasonably achievable. In addition, these criteria will be considered in establishing site-specific ALARA levels for SDMP sites in license amendments and orders. Further, implementation of residual contamination criteria is dependent on the establishment of acceptable dose or risk criteria for unrestricted use of nuclear facilities.

The Policy and Guidance Directive and the Regulatory Guide provide criteria in terms of fixed and removable contamination and acceptable radiation exposures associated with beta-and gamma-emitting surface contamination. The guidance also provide acceptable volumetric concentrations of uranium, thorium, americium and plutonium in soil. The Branch Technical Position, published in the Federal Register on October 23, 1981, 46 FR 52061, provides acceptable activity concentrations of uranium and thorium (with and without decay products) in soil under a variety of conditions.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The Environmental Protection Agency's (EPA's) Interim National Primary Drinking Water Regulations, 40 CFR Part 141, July 9, 1976, 41 FR 38404, provides maximum contaminant limits for radionuclides in public drinking water, which can be extended to apply as acceptable activity concentration in groundwater and surface water. These documents provide guidelines for acceptable average and maximum surface contamination levels for a wide variety of radionuclides. Also provided are average and maximum radiation levels of 0.2 and 1.0 millirad per hour at 1 centimeter for beta and gamma-emitters. In addition, an acceptable external radiation exposure rate for soil contamination of 10 microrentgen above background per hour at one meter is specified.

Regulatory Guide 1.86

When these acceptable surface contamination levels are combined with an exposure rate limit of 5 $\mu\text{R/hr}$ above background at 1 meter, this guide has been used in decommissioning and terminating licenses for a number of research reactors. The 5 $\mu\text{R/hr}$ criterion for indoor contamination corresponds to an annual whole body dose of about 10 millirem for an assumed indoor occupancy period of 2000 hours per year. The 5 $\mu\text{R/hr}$ criterion has been applied to ^{60}Co , ^{137}Cs , and ^{152}Eu that may exist in concrete, components, and structures at nuclear reactor research facilities, with an overall dose objective of 10 millirem/year.

The Branch Technical Position (BTP) on Disposal or Storage of Thorium and Uranium Wastes, 46 FR 52061 provides guidance on decommissioning and cleanup of fuel cycle and other facilities contaminated with relatively large volumes of waste with low activity concentrations of uranium and thorium. In combination with the disposal provisions in 10 CFR 20.302, the technical position provides four "options" for disposal of uranium and thorium wastes, which vary in activity concentration and corresponding potential radiological dose. Only the lower-activity concentration limits and disposal methods provided in Options 1 and 2 of the technical position can be applied as criteria for the release of a site for unrestricted use. Options 3 and 4 require deed restrictions, in effect releasing a site for restricted use.

Under Option 1 of the Branch Technical Position, licensees may dispose of wastes containing natural thorium, depleted or enriched uranium, and natural uranium without restrictions for burial method or post-termination land use. The activity concentrations for this option are consistent with the levels identified in Table I. The maximum activity concentration for natural uranium is based on EPA standards for cleanup and stabilization of uranium mill tailings for ^{226}Ra (5 pCi/g) including its decay products (42 FR 2556-2563). The activity concentrations for natural thorium and depleted or enriched uranium are based on internal radiation dose guidelines recommended by the EPA for protection against transuranium elements present in the environment as a result of unplanned contamination (42 FR 60956-60959). As shown in Table 1, committed doses are expected to be on the order of one millirad per year to the lung or three millirad per year to the bone from inhalation and ingestion. The resulting concentrations would also limit external exposures to less than 10 $\mu\text{R/hr}$ above background.

Under Option 2 of the 1981 BTP, concentrations of natural thorium and depleted or enriched uranium are required to be buried under prescribed conditions without requiring land use restrictions after license termination. Disposals performed under Option 2 guidelines must be covered by four feet or more of clean soil. Acceptable activity concentrations for burial were calculated based on

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

the criteria that (1) radiation doses to members of the public should not exceed Option 1 levels when the waste is buried in an approved manner under routine exposure conditions, and (2) radiation doses to an inadvertent intruder should not exceed 170 millirems to a critical organ or whole body.

When applying Option 2 of the technical position, the human intruder pathway is evaluated. In addition, consistent with the technical position, groundwater considerations are also evaluated, when necessary, because of site specific hydrogeologic features and groundwater use. Dose from the groundwater pathway should not exceed 3 mrad/yr to the bone (approximately 1.8 mrem/yr effective-dose-equivalent) consistent with the stated dose basis for the Option 1 concentration values. Dose from the human intruder pathway should not exceed 170 mrem/yr to the critical organ. For soluble uranium, the critical organ is the bone. For insoluble uranium, the critical organ is the lung. For thorium, both soluble and insoluble, the critical organ is the whole body.

The dose of 170 mrem/yr to the whole body, from Option 2 concentrations of thorium, via the human intruder pathway, may be unacceptably high. Further, this 170 mrem/yr whole body dose assumes 0.8 occupancy factor and a 0.5 shielding factor. If the occupancy and shielding factors are set to 1, the dose from thorium may be as high as 420 mrem/yr to the whole body. Therefore, for thorium concentrations above the Option 1 limit, the 10 CFR 20 limit of 100 mrem/yr total effective dose equivalent may be the appropriate unrestricted-use release limit. The intruder exposure pathway could possibly be ignored when the disposal method makes the chance of future human access very remote, such as via deep disposal, or disposal by mine backfill. Disposals under Option 2 that involve depleted or enriched uranium are evaluated for buildup of decay products for a period of 1000 years. The original dose assessments to determine the Option 2 limits for depleted and enriched uranium did not include decay products because the decay products are removed in processing the uranium. Significant ingrowth of the decay products requires more than 1000 years and has not been routinely considered in assessing the acceptability of the disposal under Option 2 even though potential doses may increase considerably with time (i.e., beyond 10,000 years).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TABLE I

<u>Contamination</u>	<u>Criteria</u>	<u>Dose Basis</u>
Average, fixed U-nat, ²³⁵ U, ²³⁸ U,	5000 dpm/100 cm ²	13 mrem/yr
Average, fixed ²²⁶ Ra, ²²⁸ Ra, transuranics, etc.	100 dpm/100 cm ²	0.2 mrem/yr
Average, fixed Th-nat, ²³² Th, Sr, etc.	1000 dpm/100 cm ²	28 mrem/yr
Avg. and max. external beta-gamma dose	0.2-1 mrad/hr at 1 cm	20 mrem/yr
U-nat with decay products in soil	10 pCi/gm	2.4 mrem/yr
Depleted Uranium in soil	35 pCi/gm	1.8 mrem/yr
Th-nat with decay products in soil	10 pCi/gm	35 mrem/yr
Enriched Uranium in soil	30 pCi/gm	1 mrad/yr to lung 3 mrad/yr to bone
²³⁹ Pu in soil	25 pCi/gm	15 mrem/yr
²⁴¹ Am in soil	30 pCi/gm	19 mrem/yr
External radiation	10 μR/hr at 1 meter above background	24 mrem/yr

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Listing of Sites

The sites currently on the Site Decommissioning Management Plan include the following:

Advanced Medical Systems, Inc., Cleveland, OH
Aluminum Company of America, Cleveland, OH
Anne Arundel County/Curtis Bay, Anne Arundel County, MD
Army, Department of, Aberdeen Proving Ground, Aberdeen, MD
Army, Department of, Jefferson Proving Ground, Jefferson, IN
Babcock & Wilcox, Apollo, PA
Babcock & Wilcox, Parks Township, PA
BP Chemicals America, Inc., Lima, OH
Brooks & Perkins, Detroit, MI
Brooks & Perkins, Livonia, MI
Cabot Corporation, Boyerton, PA
Cabot Corporation, Reading, PA
Cabot Corporation, Revere, PA
Chemetron Corporation, Bert Avenue, Cleveland, OH
Chemetron Corporation, Harvard Avenue, Cleveland, OH
Clevite, Cleveland, OH
Dow Chemical Company, Bay City and Midland, MI
Elkem Metals, Inc., Marietta, OH
Englehard Corporation, Plainville, MA
Fansteel, Inc., Muskogee, OK
Hartley and Hartley (Kawkawlin) Landfill, Bay County, MI
Heritage Minerals, Lakehurst, NJ
Horizons, Inc., Cleveland, OH
Kaiser Aluminum, Tulsa, OK
Kerr-McGee, Cimarron, OK
Kerr-McGee, Cushing, OK
Lake City Army Ammunition Plant (formerly Remington Arms Co., Independence, MO)
Minnesota Mining and Manufacturing Co., (3M), Pine County, MN
Molycorp, Inc., Washington, PA
Molycorp, Inc., York, PA
Northeast Ohio Regional Sewer District/Southerly Plant, Cleveland, OH
Nuclear Metals, Inc., Concord, MA
Permagrain Products, Media, PA
Pesses Company, METCOA Site, Pulaski, PA
RMI Titanium Company, Ashtabula, OH
RTI, Inc., (formerly Process Technology of North Jersey, Inc.), Rockaway, NJ
Safety Light Corporation, Bloomsburg, PA
Schott Glass Technologies, Duryea, PA
Sequoyah Fuels Corporation, Gore, OK
Shieldalloy Metallurgical Corporation, Cambridge, OH
Shieldalloy Metallurgical Corporation, Newfield, NJ
Texas Instruments, Inc., Attleboro, MA
Watertown Arsenal/Mall, Watertown, MA

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Watertown GSA, Watertown, MA
Westinghouse Electric Corporation, Waltz Mill, PA
Whittaker Corporation, Greenville, PA
Wyman-Gordon Company, North Grafton, MA

The nine sites that were formerly on the list, but have been removed are:

Allied Signal, Teterboro, NJ
AMAX, Inc., Washington Bottom, WV
Budd Co., Philadelphia, PA
Chevron Corp, Pauling, NY
Magnesium Electron, Flemmington, NJ
Old Vic, Inc., Cleveland, OH
United Nuclear Corp., Wood River Junction, RI
Pratt & Whitney, Middletown, CT
West Lake Landfill, Bridgeton, MD

Formerly-Licensed Sites Identified As Potentially Contaminated

In 1976, the General Accounting Office (GAO) raised concerns about the decommissioning of sites formerly licensed by the Atomic Energy Commission's (AEC's) regulatory body, which is now the Nuclear Regulatory Commission (NRC). In its response, NRC agreed to reexamine the files of the terminated licenses. Between 1977 and 1982, Oak Ridge National Laboratory (ORNL) reviewed the docket files for all fuel cycle and materials licenses terminated before 1965 to verify that all sites had been properly decommissioned. This was done under an interagency agreement with the NRC. The files of 16,230 former licensees were reviewed and a total of 12 contaminated sites were identified. All of the 12 sites had been licensed pursuant to 10 CFR Part 40 and none represented a significant risk to public health and safety. NRC took action to have former licensees decontaminate seven of the sites. The Department of Energy (DOE) accepted responsibility for the other five sites under its Formerly Utilized Site Remedial Action Program (FUSRAP).

In 1989, GAO issued a report on NRC decommissioning procedures and criteria. This report raised additional concerns about the decommissioning of formerly-licensed sites. Before testimony presented to the House Subcommittee on Environment, Energy, and Natural Resources, a commitment was made to review the records of all sites terminated since 1965. ORNL was contracted again to review all docket files retired between 1965 and 1985. This second study required the creation of a computerized inventory of the docket files in addition to screening the files to determine whether all licensed sites had been properly decommissioned. If documentation were inadequate to verify that a formerly-licensed site had been properly decommissioned, the status of the site was to be verified by inspection. It was subsequently decided to review the files of all terminated licenses (Pre-1965 and Post-1985) using the same screening criteria and to document their status in one computer inventory. This would improve information retrieval and permit comparison of the review findings for all terminated license files.

The objective of the review was to evaluate the likelihood and possible magnitude of contamination at formerly licensed materials sites. In its review, ORNL used license files and related files (e.g., inspection and correspondence files) to obtain information relevant to the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

possibility of site contamination. The information was entered into a database and evaluated by an expert system that prompts the reviewer to enter additional data and judgements. For the sake of efficiency, the system first determined whether the license could be eliminated for administrative reasons, e.g., it was superseded by another license or it was transferred to an Agreement State. There is a provision to override this determination if the site had the potential for serious contamination based on materials possessed.

The system next assigned a score based on the nuclides and quantities the licensee was authorized to possess. This score considered the form of the material, inhalation and ingestion dose factors, and decrements for half-life. Some licenses were eliminated from consideration on the basis that they had small quantities of materials, only low-hazard materials, or materials that would have decayed to below levels of concern. The score was modified by information disposition, and by indications of possible contamination of equipment, structures, or the environment (releases, burials, incineration, operational incidents).

Using this system, ORNL has reviewed the files of over 31, 000 materials licenses. Scores from zero to as high as almost 500,000 were assigned. For 622 sites (or 2%), there was sufficient question about the documentation in the files to warrant further examination of the license. Scores greater than 300 were given first priority, then, scores less than 300 and then, sealed source files. Requests to the former licensee, current site owner or occupant, Agreement States, and NRC staff were made regarding concerns about the sites. Site visits have been required to resolve some concerns, including radiological surveys. If contamination above release limits is found, remedial actions are decided on, and responsible parties identified.

Approximately 10% of the 600 sites are being found to contain contamination above release limits for unrestricted use. Some of these sites have been cleaned up, others added to the SDMP (and in the case of Pratt-Whitney, since removed), and others are awaiting further action. This process is ongoing and is not expected to be complete until at least 1997.

Timeliness of Actions

Throughout the United States, there are approximately 7,000 licensees authorized to use nuclear materials. Each specific license expires at the end of the day listed on the license, unless a renewal is requested. If a license expires, or is terminated, it is the licensee's responsibility to initiate any necessary decontamination and decommissioning efforts, at their expense, to return the property to such a condition that it can be released for unrestricted use. Financial responsibilities are discussed in the following section.

Decommissioning begins (license status is changed from active to decommissioning) if any of the following occur:

- (1) The license expires or is revoked;
- (2) The licensee decides to permanently cease operations with licensed material at the entire site, or in any separate building or outdoor area that contains residual radioactivity, such that the area is not releasable in accordance with NRC requirements;

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (3) Twenty-four months have elapsed since principle activities have been conducted under the license; or
- (4) No principle activities have been conducted in a separate building, or outdoor area, for a period of 24 months and residual activity is present that would preclude release of the area in accordance with requirements.

Once any of the above occur, the licensee is required to notify NRC in writing, and begin decommissioning the facility, or within 12 months submit a decommissioning plan and begin decommissioning according to the plan once approved.

Regulations discussing these timeliness actions are contained in 10 CFR 30.36(d) (1-4), 40.42(d) (1-4), 70.38(d) (1-4) and 72.54(d) (1-4). The effective date of the rule was August 15, 1994, (59 FR 36026, July 15, 1994).

For licensees with unused facilities on August 15, 1994, the following submittals are required by August 15, 1996:

- (1) Within 12 months of submitting the required notification of decommissioning, they are to submit a decommissioning plan (if required) and begin decommissioning upon approval of the plan;
- (2) Unless otherwise approved, they are to complete decommissioning within 24 months of initiating decommissioning;
- (3) If notification was made prior to August 15, 1994, no further notification is required; and
- (4) Those licensees that made prior notification were required to submit a decommissioning plan, or request an alternative decommissioning schedule by August 15, 1995.

Extensions may be granted to these time periods in accordance with 10 CFR 30.36(e), 40.42(e), 70.38(e), and 72.54(s) (1). The extension must not be detrimental to the public health and safety and otherwise, in the public interest, considering:

- (1) Whether it is technically feasible to complete the decommissioning in the 24-month period;
- (2) Whether sufficient waste capacity is available to complete the decommissioning in the 24-month period;
- (3) Whether a significant volume reduction in waste requiring disposal and radiation exposures to workers will be achieved by allowing short-lived isotopes to decay, and
- (4) Other site-specific factors, such as the requirements of their regulatory agencies, lawsuits, groundwater issues, actions resulting in more environment harm than deferred cleanup, and other factors beyond the control of the licensee.

These actions are all designed to ensure that sites are decommissioned and released for unrestricted use in a timely manner, and that the responsible parties and the regulatory authorities ensure these actions occur.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Timeliness Rule for Former Radioactive Waste Burials

Prior to 1981, general licensees were allowed to bring radioactive waste on their property in accordance with 10 CFR 20.304 and 20.302. No regulatory approval was required for this action. The decommissioning timeliness rule discussed above applies to these sites, and current property owners need to assess these burials and possibly remediate them based on current regulatory release criteria for unrestricted use. However, this position was not clearly explained in 1989 with the promulgation of the Timeliness Rule, as mentioned in previous 10 CFR 20 regulations. Sites will need to be reviewed to ascertain existing information about the radionuclide content, concentration and total activity, the location and design of the burial, and applicable environmental characteristics important to waste isolation. Radionuclide concentrations and quantities below the threshold values of Table I do not warrant additional investigation, and these former burial areas are suitable for release without land use restrictions. Additional characterization may be needed to:

- (1) Assess the type, concentration, and total activity of radionuclides in the waste;
- (2) Determine environmental characteristics to estimate long-term fate and transport of radionuclides; and
- (3) Evaluate the potential for human intrusion into the waste and associated exposure characteristics.

The goal is to ensure that doses to members of the public will be a small fraction (e.g., 10-20 mrem/year) of the 100 mrem/year public dose limit in 10 CFR 20.1301. Stabilization or exhumation and disposal may be necessary if projected doses exceed a small fraction of the public dose limit.

Compliance with these decommissioning timeliness requirements may be difficult since universities and research institutions may not be aware of the requirements. There may be considerable cost to comply. The safety significance associated with the burial sites may not be high. It may not be possible to identify and notify the large number of property owners who own sites where former licensees may have conducted authorized burials. And finally, the Decommissioning Timeliness Rule only applies to present licensees. Non-licensed, responsible parties will be encouraged to meet the decommissioning schedules discussed in the timeliness Rule.

Financial Assurance

In addition to identifying a responsible party for decontamination and decommissioning activities, and criteria for release for unrestricted use, an assurance of adequate financial resources is a key component in an overall decommissioning process. In recognition of this, regulations have been promulgated at 10 CFR 30.35, 40.36, and 70.25, with the purpose of assuring that decommissioning for licensed facilities will be accomplished in a safe and timely manner and that adequate licensee funds will be available for this purpose, such that, the financial burden and responsibility does not rest with the taxpayer.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Financial assurance is based on the radioisotopes allowed to be possessed by the licensee, and the possession limits. Financial Assurance is not required for licenses involving radionuclides with half-lives less than 120 days. Possession limits for financial assurance requirements for materials licenses are based on Appendix B to 10 CFR Part 30. For a licensee that only possesses sealed sources, and in amounts greater than 10^{10} times the quantities in Appendix B, financial assurance in the amount of \$75,000 is required. For licensees with materials in unsealed form and greater than 10^3 but less than 10^4 times the quantities in Appendix B, financial assurance in the amount of \$150,000 is required. For licensees with materials in unsealed form greater than 10^4 but less than 10^5 times the quantities in Appendix B, financial assurance in the amount of \$750,000 is required. If the quantity in unsealed form exceeds 10^5 times the Appendix B quantities, a decommissioning funding plan is required.

A decommissioning funding plan outlines the work required to decommission a facility, provides a site-specific cost estimate for the decommissioning, and states that funds necessary to complete the decommissioning have been obtained. In general, the cost estimate should provide for decommissioning the facility to allow unrestricted release. The estimate should assume that the work will be performed by an independent, third party contractor and not take credit for salvage value or reduced taxes. However, for certain sites where the licensee provides a viable alternative approach, or alternative basis for the cost estimate, the plan may be approved if the approach provides sufficient assurance of funding for decommissioning. Licensees may demonstrate financial assurance for decommissioning by one or more of the following mechanisms:

- (1) Prepayment - a deposit at the start of operation in a segregated account outside of the licensee's control. Prepayment mechanisms include trust funds, escrow accounts, certificates of deposits and government securities;
- (2) Surety, Insurance, or Parent Company Guarantee Method - assurance that the cost of decommissioning will be paid by another party should the licensee default on the responsibility to complete the decommissioning. In addition to insurance, surety methods may include payment surety bonds, letters of credit, lines of credit and parent company guarantees;
- (3) External Sinking Fund - a sinking fund account plus insurance or surety mechanism, such that the total of both at least equals the cost of decommissioning. A sinking fund is a segregated account outside of the licensee's control and any of the prepayment mechanisms may be used to hold the assets for the sinking fund account.

In addition, Federal, State or Local Government licensees may provide financial assurance for decommissioning with a statement of intent. A statement of intent is a statement from the appropriate government entity indicating that decommissioning funds will be obtained when necessary. Such statements need to state the estimated cost of decommissioning, as well as a demonstration that the party signing the statement has the authority to make such a statement on behalf of the government. In limited cases, a private licensee may rely on a government statement of intent if it is part of a binding contract between the government and the licensee.

The objective of NRC's financial assurance requirements are to ensure that a suitable mechanism for completing the decommissioning of licensed facilities is in place in the event that a licensee is unwilling or unable to complete the decommissioning.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Enhanced Participating Rulemaking or Radiological Criteria for Decommissioning

Commencing in May 1993, a significant effort has been expended to establish radiological criteria for decommissioning. After a series of seven public workshops to elicit informed discussions of the options and approaches for developing criteria, a proposed rule was published August 22, 1994 (FR 43200). The proposed criteria would apply to the decommissioning of all licensed facilities. The intent is to provide a clear and consistent regulatory basis for determining the extent to which lands and structures must be remediated before a site can be considered decommissioned. It is anticipated that having specific criteria in the regulations would result in more efficient and consistent actions related to the numerous and frequently complex site remediation and decommissioning activities anticipated in the future.

Decommissioning is presently allowed on a site-specific basis using the existing guidance as discussed above. Codifying the radiological criteria for decommissioning in the regulations should allow a more effective implementation of policies to protect public health and safety and the environment at decommissioned sites, by more efficient use of regulatory and license resources, consistent application for all types of contamination, and a predictable basis for decommissioning planning. In addition, delays in decommissioning could be eliminated since licensees could proceed with decommissioning without waiting for specific regulatory approval.

The overall conceptual basis for decommissioning, as proposed in this rulemaking, consists of an objective to reduce the residual radioactivity at the site so that it is indistinguishable from the background, a limit on the dose considered acceptable for release of a site with a stipulation that dose be as far below this limit as reasonably achievable (i.e., ALARA), provisions in regulatory guidance for administrative relief from performing sophisticated ALARA analyses for licensees who have little or no site contamination, provisions for restricted termination of a license when physical remediation activities cannot achieve the limit, and enhanced provisions for public participation. The limit for release of a site is 15 mrem/year total effective dose equivalent (TEDE) for residual radioactivity distinguishable from background. If doses from residual radioactivity are less than the TEDE, the license will be terminated and release for unrestricted use following the licensee's demonstration that the residual radioactivity at the site is ALARA.

The goal is to reduce residual radioactivity to levels that will allow unrestricted release of the site. However, in recognition that this may not always be feasible, licenses may be considered for termination where restrictions may be imposed on the use of the site to ensure that public doses are maintained below the 15 mrem/year TEDE limit, provided the licensee:

- (1) Can demonstrate that further reductions in residual radioactivity necessary to comply with the 15 mrem/year TEDE limit for unrestricted use are not technically achievable, would be prohibitively expensive, or would result in net public or environmental harm;
- (2) Has made adequate provisions for institutional controls to reduce annual TEDE from residual radioactivity distinguishable from background to the average member of the appropriate critical group to 15 mrem/year TEDE;
- (3) Has provided sufficient financial assurance to enable an independent third party to assume and carry out responsibilities for any necessary control and maintenance of the site; and

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (4) Has reduced the residual radioactivity at the site so that the TEDE from residual radioactivity would not exceed 100 mrem/per year even if the restrictions applied in the termination were no longer effective in limiting the possible scenarios or pathways of exposure.

It is important for the public to not only be fully-informed of the decommissioning actions at a particular site but also to be able to effectively participate in site decommissioning decisions. The proposed rule will provide for public participation in the decommissioning process through three mechanisms in addition to the relevant requirements regarding hearing opportunities for a particular site. Upon the receipt of a decommissioning plan from the licensee or a proposal for restricted release of a site, the following actions will occur:

- (1) Notify and solicit comments from local and state governments in the vicinity of the site and Indian Nation or other indigenous people that have treaty or statutory rights that could be affected by the decommissioning;
- (2) Publish a notice in the Federal Register as well as in other media, such as local newspapers which are readily accessible to individual in the vicinity of the site; and
- (3) Solicit public comment on the proposed decommissioning action. These provisions are designed to provide affected individuals and organizations with both information about the proposed decommissioning and an opportunity to provide comments on the licensee's proposal. The Commission believes it is particularly important to provide notice in a forum that is accessible to local individuals. This forum may vary from site to site but would usually include providing notice to local media for publication.

With publication of the proposed rulemaking in August 1994, significant public comments were received. Comments argued for both higher and lower dose limits, more and less sophisticated ALARA analysis, and more and less guidance on surveys, surveying techniques and mathematical data analysis. Consideration of the comments and resolution continues.

Pennsylvania Contaminated Site I

Schott Glass Technologies in Duryea, PA, is a site on the SDMP due to an onsite landfill containing relatively small, discrete volumes of thoriated glass chips and refractory material. Waste glass and materials from manufacturing of glass, including the thoriated glass, were placed in a landfill on the licensee's property from 1969 until 1980. Schott Glass proposes to keep the thoriated glass in the landfill, undisturbed. This will reduce exposure of radiation workers to radiation and lead, a hazardous material in the refractory and minimize air cleaning issues with disturbing a land area. The landfill contains 15,000 cubic feet of scrap, with 8000 lbs. of thoriated glass at a concentration of 17%. This translates into 1400 lbs of source material, or 30 cubic feet.

Since the property will remain under the control of Schott Glass, release for restricted use is appropriate. Schott Glass will cap the existing landfill with a multi-layered cap and erosion control plan consisting of a high density polyethylene (HDPE) textured synthetic liner, HDPE composite drainage net, granular drainage layer, and either a vegetative soil layer or asphalt layer.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

These added layers will eliminate any airborne contamination, reduce the external dose to levels indistinguishable from background, provide long-term erosion control, and reduce the likelihood of future excavation in the area of the landfill.

Nonetheless, an ALARA analysis was done. This analysis assumed that an individual would excavate the landfill, select a piece of thoriated glass over refractory or other scrap, fashion a 50 carat pendant by grinding, wear the pendant, and display the thoriated glass in a display jar at home. The resulting dose for this scenario is approximately 100 mrem/year.

Pennsylvania Contaminated Site II

At the Babcock & Wilcox facility in Leechburg, PA, operations continue to decontaminate several buildings used by the reactor test staff. Procedures have been generated to assure appropriate air sampling. Air contaminant sampling is necessary in order to determine the extent of worker exposure, to determine the effectiveness of air contaminant controls, and to determine regulatory compliance.

Prior to performing air monitoring, a survey of the operation to be monitored should be made. This survey should include:

- (1) A review of specific operational activities;
- (2) A review of the materials used in the operation;
- (3) Identification of employee tasks associated with the operation; and
- (4) Review of the results of all previous monitoring for the operation.

In certain instances, it may be desirable to obtain and analyze grab samples by use of direct reading meters or instantaneous reading methods. The resulting information will be used to determine the duration of each sampling period and the number of samples required to obtain results that are representative of the normal work conditions for the operation. The sampling methodology should identify the sampling equipment, sample media, flow rate, and the total sample volume needed for proper sample collection. It is recommended that, prior to any sampling, the analytical laboratory be contacted in order to discuss any special requirements or limitations which may affect sampling methodology.

Prior to performing air sampling, all air sampling pumps must be charged and checked for proper operation prior to use. All air sampling pumps must be calibrated against a primary standard to the specific flow rate identified in the sampling methodology. As an alternate, the pumps may be calibrated against calibration equipment which is periodically checked against a primary standard.

If direct reading meters or instantaneous colorimetric detector tubes are used, follow the manufacturer's directions for equipment preparation and calibration.

Once sample pumps have been adequately charged and properly calibrated, proceed to the selected sample location and perform the following:

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (1) Record employee identification and job description;
- (2) Place the sampling pump on the employee's belt and attach the sampling media to the employee's shirt collar (or similar position) so that it is within the employee's breathing zone (within a 6 to 9 inch radius of the nose). If measuring welders, place the media under the welder's helmet;
- (3) If sampling cassettes are used, ensure that they are in a vertical position with the inlet port of the cassette facing toward the employee's feet. Remove the cap from the inlet port of the cassette;
- (4) Turn on the sample pump and note the start time;
- (5) Instruct the employee to perform his duties in a normal fashion;
- (6) Observe employee activities and operation periodically, (at least every 2 hours) and record any significant observations.

It may also be advisable to record weather conditions and, if possible, obtain photographs of typical sample pump locations.

Procedures such as these have proven to be adequate for obtaining representative samples and assessing the hazard under which decontamination operations are performed.

Massachusetts Contaminated Site

Nuclear Metals, Inc. has manufactured products from depleted uranium for various purposes since 1988. Located in Concord, MA, the major source of uranium contamination at the site was the discharge of neutralized pickling liquor containing copper and depleted uranium to an on-site holding basin between 1958 and 1985. Discharges to the holding basin ceased in 1985, and the basin has been covered with a synthetic cover to minimize evaporation, prevent additional water (rain and snow) from adding to the basin, and to eliminate the potential for any airborne concerns. A decommissioning plan has been prepared that includes removal of the basin sludge and shipment offsite in "superpoly" bags for disposal. Airborne sampling similar to that described above will be conducted during operation for worker's protection and environmental impact.

Two recent incidents have occurred that involved air cleaning issues. The first was a fire in a ventilation system, and the second was a broken buried pipe.

In February 1996, an unplanned/unexpected vent fire occurred within a torrit filter plenum housing and downstream prefilters assembly servicing a pulsed - combustion wastewater evaporation system. The thermocouple systems for the ventilation, installed to detect temperature inconsistencies, was reading low. After replacement of lead wires, troubleshooting, and startup testing, the system was approved for restart. Nonetheless, less than two hours after restart, a fire was observed coming out of the filter cartridges, and a maximum temperature of 750°F observed. Both water and carbon dioxide were used to extinguish the fire. The root cause of the fire was determined to be a thermocouple with reversed wires (polarity).

Damage was obvious. The cardboard framed pipefilters had been completely burned. The high temperature HEPA filters were substantially intact. Upon removal, they were physically dropped to the floor below, resulting in handling damage. Further analysis indicated three of the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

four HEPA filters were in good condition, with the fourth having suffered some heat damage, blinding the media rather than opening voids. The media had physically pulled away from one side of the frame, believed to be the result of dropping the filters on the floor.

A total of eight individuals were identified as potentially exposed; five were Emergency Response Team members involved in control and extinguishing of the vent fire, the remaining three acted in support positions, and were never very close to (or actively fighting) the fire itself. All personnel responding to the fire wore SCBA respiratory protective equipment, but were not monitored with any kind of breathing zone air sampler. Because the building was evacuated during response activities, and the HEPA exhaust filtration systems(s) were not compromised, there was no potential for outside/offsite exposures. Urine bioassay samples have been collected from all personnel identified as potentially exposed to any airborne activity, or involved in immediate response to the incident. No indication of uptake to any individual was noted. All potentially affected personnel were equipped with routine external dosimetry devices (film badges).

Air samples of four general types were collected and counted:

- (1) In-plant portable "hi-vol" samples (high flow rate, short duration 'grab' samples); taken during the incident, and preparatory to return to service;
- (2) In-plant stationary (fixed, continuous, low flow rate); routine workplace air monitoring samples;
- (3) Effluent (continuous, low volume); and three exhaust ventilation stacks servicing other areas;
- (4) Ambient/environmental (continuous, high volume); a total of eight samplers, two of which can be used as "backgrounds" for evaluation of local/closer stations.

Results of these analyses show no significant or unusual potential for exposure to any individuals (on or off-site) other than those eight persons already identified. Analyses (in-house counting using an automated gas-flow proportional counter) of samples from the eight environmental air stations yielded effective average ambient air alpha activity concentrations ranging from 4.9×10^{-15} to 3.1×10^{-15} $\mu\text{Ci/ml}$; this value is well within the analytical uncertainty of the measurement process, and the normal distribution of values observed in past datasets. It is apparent from these data that any potential exposure to the environment, public, or outside personnel arising from this incident is not significant with respect to routine facility operating emissions, and all applicable effluent regulatory statutes and standards.

During excavation to improve building drainage in May 1996, a wastewater transfer line was broken. This resulted in a leak of approximately 1800 gallons of water containing 380 grams of depleted uranium, a concentration of 20 picocuries/milliliter. The spill was contained onsite, and there were no offsite releases or effects. Contaminated soil was removed. The workers did not use respiratory protection equipment, but breathing zone air samples were employed. Workers with samplers included the maintenance staff who removed the soil, repaired the broken pipe, transferred the soil to bulk bags, provided shoring for the hole, and the backhoe operator. Results indicated minimal worker exposure; the highest DAC-hr (derived air concentration-hour) was less than 0.75.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In addition, two hi-vol grab samples were taken. For ten-minute intervals, the count was equivalent to the minimum detectable activity (MDA) of 4.5×10^{-13} microcuries/milliliters. Similar results were obtained with 30-second counts and an MDA of 2×10^{-13} $\mu\text{Ci/ml}$.

Conclusion

A significant challenge for the nuclear community lies ahead in being able to successfully decontaminate and decommission contaminated structures and environment. Criteria must be clear, concise, fully-understood and achievable. A successful program for decommissioning has the following objectives:

- (1) Safety and Timeliness - Ensure timely and safe decommissioning of licensed and unlicensed sites that are contaminated with radioactive materials associated with the possession and use of source, special nuclear, and byproduct materials;
- (2) Documentation - Ensure that decommissioning decisions are thoroughly documented to develop a record that will withstand the test of time and avoid transferring a burden to future generations to redevelop information on the radiological status of formerly licensed sites;
- (3) Coordination - Coordinate decommissioning actions with regulatory agencies at the federal, state and local levels, with interested parties, and with members of the public to promote efficiency and finality for decommissioning actions;
- (4) Minimal Burden - Minimize the burden imposed on licensees and other responsible parties consistent with accomplishing the other objectives; and
- (5) Review Capabilities - Develop and maintain review capabilities, as required, to fulfill the objectives of the decommissioning program.

It is expected and anticipated to be able to release sites so that members of the public will have unrestricted access to areas where radioactive materials were once used.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FIRST: The acceptable numbers that you gave us with regard to residual contamination, would the NRC consider them to be de minimus exposures? I know the word de minimus gets a lot of peoples' hackles up, but still, you are proposing what I would interpret in that context. Would you comment on that?

BELLAMY: I am glad to. The Nuclear Regulatory Commission tried, about four or five years ago, to define a term which we called, and I have to say this very quietly, "below regulatory concern". That is not a term that we are allowed to use anymore. But to answer your question very specifically, the answer is, yes. This was our attempt to try to define a de minimus-type level, to define a below regulatory concern value without using it as a number.

PORCO: A couple of general questions on the fire, were the prefilters, the Torrit prefilters, cellulose or glass?

BELLAMY: They were glass.

PORCO: Were the HEPA filters commercial grade or were they in accordance with the accepted nuclear standard?

PORCO: Did anyone check on the type of binder that was used? It seems to me that they burned more vigorously than you would expect. Was this an issue?

BELLAMY: It was not an issue. You asked whether anybody checked and the answer is I don't know. I did not check, and I can't answer your question, I believe it may be in the Licensee Event Report that they submitted and I can get you and anybody else a copy if it is of interest.

WEIDLER: You talked about some small scale projects, are there any large-scale projects going on in Region 1 right now? And if so, do the same criteria apply to power plants.

BELLAMY: The answer is, yes. Region 1, in the northeast part of the country, seems to have more than its share of these activities. Of the forty-seven STMP sites that are presently on the list, twenty are in my region, and I have project management responsibility for eleven of them. Nine are managed out of headquarters, but it is still my responsibility to inspect them and make sure that the criteria are met. I believe you are referring to the decommissioning of nuclear power plants and I can assure you that the Shoreham facility did use the criteria. Shoreham has been officially decommissioned and is basically done. The activities at Yankee Rowe are still ongoing and the criteria we are trying to use for decommissioning tend to resist coming up with definitive criteria in the beginning. They would prefer to negotiate the process as it goes along. We have had a challenging time working with them and trying to agree on what would be the objective endpoints. The answer to your question is, yes, there are a number in Region 1.

DAUBER: Were the criteria for determining what would be the worst case determined by the facility owner, by NRC, or by whom?

BELLAMY: The criteria were generated by the Nuclear Regulatory Commission staff in Region 1. The responsible project manager and I, plus our headquarters staff (who give us the project and the program management guidelines) said, what is the worst-case scenario we can come up with that is somewhat realistic? I know that is a contradiction in terms, but that is what we headed for. So it was a Nuclear

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Regulatory Commission, an agency-generated scenario. I am not sure what area of the Aberdeen Proving Grounds you are from, but I should mention that Aberdeen is one of the sites on the decommissioning management plan that will be successfully removed from the list in the near future and we expect to renew their license after a public meeting that we will have to have down there. Please attend and be my supporter in the audience. So, congratulations to Aberdeen.

ANON: You talked about Shoreham as one of the utilities that was scheduled for decommissioning, did they meet your original time line? Second, are you aware of a user group, or any issues group, that has been established to effect the decommissioning of public utilities?

BELLAMY: The answer to your first question is, no. There was no success whatsoever in meeting the time lines for any of these activities by nuclear power stations. I am not aware of any utility user group. I know that there is an inter-agency task force that Ken Duvall is a member of, that is generating many decommissioning criteria, but I don't believe there are any utility activities in this area.

FIRST: Last Conference we went out to West Valley, do you have any comments on the clean-up of that facility?

BELLAMY: We are looking at West Valley as a fuel facility, it is in our fuel facility category. I would say we are not so much concerned about the clean-up of that facility as using it for the manufacture of the waste that will be generated from the clean-up of other facilities. I am not involved in West Valley day-to-day, but I understand that we are getting closer and closer to commercial operation at that facility, although we are not there yet.

ENGELMANN: Can you tell us something about the relative authority, the interrelationship of communications between EPA, NRC, and other federal agencies with regard to release criteria?

BELLAMY: As I indicated, there is an interagency task force that is looking on these activities as we speak. If you look at the preprint of my paper, you will note that there is a very long discussion on rule making. We have an enhanced participatory rule-making process which states that members of the public are welcome and expected to participate as we go along in the process, i.e., the term is "enhanced". The proposal is to take the numerical criteria that I have just gone over, and replace them with a criterion that simply says "fifteen millirem per year to any member of the public", period. The Environmental Protection Agency has separate criteria that are in the same ballpark but they are not exactly the same. There are some high level discussions going on at the cabinet level and at the Commission level to try to work out these differences with the Environmental Protection Agency. At the staff level, we work very closely with the Environmental Protection Agency and the Department of Energy on these sites. We will review any EPA documents that are generated. They take our comments very seriously, they welcome our comments, and we are working hand-in-glove with them at the staff level on a number of sites. The particular one that I can think of is the Metcoa-Pesses site near Pittsburgh, Pennsylvania.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

INTRODUCTION

FIRST: Our next speaker is Dr. J Louis Kovach, President of NUCON International, Incorporated. Dr. Kovach is a chemical engineer who graduated from the Technical University in Hungary, his native country. This is Lou's seventeenth consecutive Air Cleaning Conference that he has attended. He tells me when he wants to remember how long he's been in the field of air and gas cleaning, he deducts seven from the current Air Cleaning Conference number, and multiplies by two, and that's how he knows how long he's been in the field. Those of you who have attended previous Conferences know that he has made a major contribution to the volumes of the Proceedings and we trust he will continue to do so. He has over a hundred papers in the field up to the present time. Currently he is on the High Level Waste Technical Advisory Panel for the Department of Energy. He is senior technical advisor of the Department of Energy's Hanford privatization initiative. And he is chairman of the Hanford Tank Waste Remediation Environmental Impact Statement preparation panel. He is a consultant for the US Department of Energy, US Environmental Protection Agency, and the US Nuclear Regulatory Commission. It seems like everybody wants a piece of Lou Kovach. We are delighted he is giving us one of the pieces this morning. The title of his paper is, "Challenges to Air and Gas Cleaning Systems".

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

NEW CHALLENGES TO AIR/GAS CLEANING SYSTEMS

J. Louis Kovach
President
NUCON International, Inc.
Columbus OH

The construction of new nuclear power reactors in the U.S. has stopped now for over a decade. Thus, the currently generated conventional air cleaning system technical information is generally restricted to evaluation of operational problems with the existing systems. However, extensive nuclear waste management related needs have developed in the U.S. during this same period—mainly at DOE sites. The waste management and site remediation related air and gas cleaning needs are much broader in scope than the control of radioiodine and low concentration aerosols, and the systems in current design or in application also have different processing conditions.

The major difference is that many of the new air and gas cleaning needs are required to treat effluents continuously and under widely different processing conditions than those applied in the past for the nuclear power industry. Even the systems which are postulated for handling gases under potential upset conditions have different design envelopes than the conventional nuclear power plant (NPP) air cleaning or air handling units.

The new, greatly varied processing conditions of waste management activities make it difficult to use the standardized designs developed by ANSI and ASME for the NPPs, and most of the current design specifications and codes are not directly applicable for the new applications. The current conditions in the waste management and remediation activity are similar to the early days of the development of the NPP air cleaning systems in that their designs are highly individual and varied both by the specifiers, the designers and the manufacturers. The result is a greatly varied quality non-standard equipment specification and supply. At the same time, many of the application needs, but not all, are one of a kind systems, making the development and application of standard specifications and codes difficult and uneconomical.

There is a change needed in the design and manufacturing philosophy from the relatively large number of identical purpose units to the highly individualized special purpose design and manufacturing philosophy. For the new needs it is difficult to use the “cookbook” concept of such standards as ANSI/ASME N-509, ASME AG-1 or to follow the test requirements of ANSI/ASME N-510 or the currently developing Section TA of the ASME AG-1 code. This does not mean that the old NPP related standards are useless, but that their usefulness is only partial and inadequate to solve the waste management needs.

Examples of New Waste Management Related Problems

Radon control from uranium wastes

Uranium processing solids containing silos need to be degassed prior to further processing by vitrification or during the initial steps of vitrification. While extensive information was developed for

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

noble gas control (krypton and xenon isotopes) of the BWR off gas system or PWR gaseous radwaste system design and operation, there is very limited data available for the commensurate radon control design and operating conditions. The recent literature and data relating to home radon control or uranium mining purge control has not been extended to satisfy the design and operating requirements of the waste management type radon processing field.

Effluent treatment from thermal processing of various radioactive wastes at greatly varying temperatures and gas compositions

Most waste management related activity is initially from dilute solutions which require concentration as a first step. As an example, evaporator effluents need to be treated under high humidity, corrosive or, in some cases, flammable gas presence conditions. Another process effluent is from drying radioisotope loaded spent liquid phase adsorbents which require both high efficiency solid particulate and vapor phase removal of hazardous constituents from humid and potentially corrosive streams.

Off gas treatment for vitrification facilities which need product recycle, and in some cases, product recovery at very high concentration of volatiles and semivolatiles and particulates

The radioactive waste vitrification technology always includes the capture and treatment of volatile and semivolatile radioactive and other hazardous constituents. In some cases, the operating temperatures are high enough to vaporize large amounts of alkali metals and other waste constituents which need to be quenched, converted to filterable components and result in an off gas stream which can be above the lower flammability limits without additional dilution. There are special selective constituent removal needs for elements such as mercury, selenium, cadmium, ruthenium, etc.

Filtration from potentially flammable gas streams

In several waste storage complexes, the original complexant organic material used to separate specific isotopes in the past is thermoradiolytically decomposing with a commensurate generation of hydrogen. This thermoradiolysis of organic compounds in the stored waste creates concerns of flammable or explosive environment generation even under normal storage temperature conditions. The various wastes have different gas retention capability and intrusive activity or transfer of the waste can release sufficient volumes of flammable gas mixtures which can result in structural damage in waste storage tanks if ignited.

Filtration from highly corrosive gases

The waste processing technology generally includes dissolution steps involving concentrated acids or alkalis. The currently used glass fiber based filtration elements do not have sufficient corrosion resistance and the typical adsorbents used (e.g. carbon based) are unsafe in highly oxidizing environments. At the present time there is inadequate corrosion resistant filter or adsorbent material development and application data available to select material of construction or estimate filter/adsorbent life and performance information.

Filtration from gas streams which may have significant pressure challenges

As an example, at the Hanford site of the U.S. DOE, many of the potential consequences of off design conditions can result in unacceptable radioactivity release estimates, if the sudden pressure rise causes failure of the conventional HEPA filters. Currently, a large percentage of the "unsafe" conditions could be eliminated from the safety analysis if the pressure resistance of the HEPA filters can be increased to prevent pressure spike related failure. There is also inadequate information available on the aging of conventional HEPA filter components, particularly under high humidity conditions, for which deterioration is not measurable by conventional in-place aerosol testing.

Back washable filter elements

The continuous processing of high particulate load streams does not permit the use of high efficiency filters which cannot be "regenerated" in place. The life of a conventional HEPA filter under many of the operating conditions is too short to permit economical and waste minimization satisfying requirements. While there is some development of metal filter media, currently there is very limited information on the efficiency, life, regenerability etc., of these media and often fibrous metal and sintered metal filters are considered as equals in performance.

Continuously operating demister elements

While in the NPP application area, demisters only have a very limited expected operating life. In the continuous waste processing applications there is a requirement for droplet elimination as a continuous unit operation. Even in the NPP field, one of the least understood components is the "moisture eliminator" element. However, for waste processing application, the mist elimination component design and continuous operating technical data is not available.

Adsorptive removal of varied constituents from air and gas streams

In the NPP applications, only radioiodine and noble gases are considered for gaseous phase treatment. The waste management area is much broader, and specific adsorbents need to be developed, optimized and applied for other elements or compounds under more adverse environmental conditions than that of the NPP field. Examples are mercury, ruthenium, iodine-129, etc.

In-place testing highly contaminated systems

One of the major shortcomings of even the NPP related air and gas cleaning activity is the proof testing of highly contaminated components or systems. (It is generally assumed that the event for the amelioration of which the "safety" train is installed will never occur, thus testing under those conditions would not be needed. This misconception, as an example, created some interesting problems even after the TMI accident when highly contaminated air cleaning systems needed to be tested or serviced.) However, in waste processing gaseous or particulate treatment systems, the air and gas cleaning components can be highly contaminated by either alpha, beta or gamma radiating components. Many of these systems do not permit man entry into the air/gas treatment units on the contaminated side and, at times, not even on the "clean" side due to the radiation fields or other hazards present. Most of the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

current in-place testing steps as described in the existing test procedures cannot be performed on highly contaminated or, as an example, flammable gas containing systems.

Maintainability under contaminated conditions

This is another area where even the NPP related currently available standards and codes fail to adequately address the design requirements. The consideration of replacement of most components of a contaminated air cleaning system are not included in the existing codes and standards. In the waste management field, the contamination of most air and gas processing systems, other than possibly the final building filtration units, is a forgone conclusion.

Waste minimization challenges for consumable components

In most cases, the disposal cost of contaminated air and gas cleaning components is higher than their initial new cost. At the same time, the least specified (if at all) of the properties of the filters or adsorbents used is their operating life or disposal cost. This is also true in the NPP field, where, as an example, radioiodine adsorbent is purchased solely on initial efficiency cost without any regard for adsorbent life.

It is intended that by describing examples of these new challenges that the standard preparers, designers and manufacturers will be better informed of the special needs of these new air cleaning/gas processing applications.

The major challenge is that all parties involved in the specification, design and operation of these systems will have to be better trained in the broader filtration, and other contaminant removal basic principles and less dependent on the set design and operation practice of the NPP related applications. There will be no time available to develop detailed consensus specifications or codes for components and systems for the waste management field, but there is time to assure that all those involved with the program have available additional training opportunities to satisfy the qualification needs, i.e. the chemical, physical and engineering principles required to comprehend the air and gas purification specification, design, construction and operation expertise.

Regulatory Concerns

The NPP related activity in the U.S. is regulated by the NRC, while the U.S. DOE sites are "self-regulated" with some oversight provided by the Defense Nuclear Facilities Safety Board (DNFSB). However, the impending privatization of some of the U.S. DOE activities postulates the integration of the NRC into the regulation of the waste management operations. The post-TMI new source term development in the U.S. has resulted in a lowered technical concern of air and gas cleaning activity by the NRC, while the administrative legalistic enforcement of Technical Specification or FSAR cited standards and codes has increased. Some of the "enforce the words," even if they are technically undefensible, has converted the regulation of the design, performance and testing of the NPP air cleaning systems into a "cargo cult" basis. This type of regulation will not suffice for the existing or the upcoming waste management area. There will be limited directly applicable standards and codes for the upcoming applications of air and gas cleaning systems and blind citing of standards and codes originally

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

developed for other applications or of those which are outdated and, in many cases, withdrawn, that will not create a better or safer environment for the workers or the public. Both the DOE and the NRC has to establish a pool of competent technical personnel who clearly understand the technical basis for the specification, design control and operation of the existing, or to be developed, components and systems which are needed for the safe operation of waste management facilities.

The technical qualifications and the basic engineering expertise of all personnel involved in air and gas processing research, specification preparation, design, construction, operation and regulation for the waste management field needs to be far better than that which existed for the relatively narrow NPP type applications, which itself lately suffered from inadequate technical expertise. As John W. Crawford, one of the DNFSB members, explicitly pointed out in one of his recent reports "An Assessment Concerning Safety at Defense Nuclear Facilities, The DOE Technical Personnel Problem,"⁽¹⁾ the root cause of all currently identified safety and operational problems is lack of adequate technical expertise of design, operation and regulatory personnel. While the Crawford report concerned itself mainly with the DOE, its conclusions are valid for the entire U.S. nuclear industry whether public or private.

Conclusions

The great variety of type and purpose of air and gas cleaning needs for radioactive waste management industry will require individual, special designs rather than many identical air/gas treatment systems. It would be very difficult to apply the existing codes and standards developed for the nuclear power plant environmental protection, as they exist, for this new application. The design, construction and safe operation of the new systems will be strongly dependent on the good understanding of the commensurate filtration, adsorption and absorption science and the special needs of engineering knowhow relating to both the nuclear and the chemical processes involved. The very large and expensive, but mostly one or two of a kind systems, are not amenable to long duration consensus standardization. The challenge of still meeting the required protection factors or separation efficiencies of the air and gas cleaning systems, often with greatly different components than the conventional systems, will be dependent on the technical understanding of all of the relevant criteria by a limited pool of personnel involved from the design of the process to the regulation of the quality and performance of these systems.

⁽¹⁾Crawford, Jr., J.W., "An assessment concerning safety at defense nuclear facilities, the DOE technical personnel problem," DNFSB/TECH-X, Vol. iii, March 1996.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FIRST: I appreciate your comments, warnings, and peering into the crystal ball. As you were talking about many of the technologies that you say we need, I was reminded of the fact that back in the 1950's and some part of the 60's, we were very much involved with the kinds of equipment that you cited. The particular application at that time was incineration. All of the problems that you enumerated, corrosion, heavy dust loadings, and so on, were all encountered in these situations. And you know we never solved the problems in 1960, therefore, we still have them with us today.

BERGMAN: A lot of comments you made ring true to many of the technical people who are familiar with the problems. For example, for the last three years, maybe even five, I have been going up and down the halls of the bureaucrats in the Department of Energy with a shopping list at least as long as yours with issues and problems, some of which are very severe. Almost invariably the response is, "we have not had a major accident". By an accident, they mean an entire city having to be evacuated, things of that nature. The philosophy is that if you don't have a major accident, you don't have to put money in. And it is a local issue. For example, it is like a stop sign, usually local communities do not install a stop sign or a street light until somebody is killed. After someone is killed they start to think, "we'd better do something about it". For example, in the HEPA filter area after the '69 Rocky Flats fire, there was a lot of money. The attitude right now from all of the bureaucrats I've encountered is that we are not going to spend any money on HEPA filters. In fact we're going to downsize. ES&H activities are slated for at least a thirty percent decrease. So, not only are we not keeping up, DOE in particular is going dramatically down. If there is no money, there are no opportunities to do any of the activities you suggest. I would appreciate your comments.

KOVACH: In some of these areas we are not doing anything either. So it is no wonder we do not have accidents. As long as we are only studying the problems rather than processing the wastes we are reasonably safe. Once we start waste processing, I am not sure we can do it without accidents.

WEBER: Dr. Bergman's comment and your response remind me of these issues every time I step on an airplane. I mean, the airplane hasn't fallen down, so why should we spend money maintaining it? That is a comment, not a question. As a comment, you mentioned a problem which was encountered with backwashing a metallic filter. I am totally unfamiliar with that particular installation. Over my involvement with backwash filters I've learned that for all manner of industries, including electric power generation, chemicals, liquids, gases, there are many, many parameters to bear in mind when installing a backwash-cleanable filter, including, but not limited to, the backwash-technique. This is because there are a myriad of backwash techniques. They include the cleaning fluid itself as you pointed out. There may be chemical interactions with the contaminant, and there are important waste disposal issues, i.e. you don't want to create more backwash waste than you started out with. I recommend that when someone is thinking of procuring such a system, that they make the vendor responsible to educate them and in those areas where they do not feel knowledgeable, that they seek out vendors who have the expertise to work with them to solve all the problems. Education can be acquired that way. So, seek out a vendor who is qualified, because if the vendor doesn't know the answer, you must question whether their system will work.

KOVACH: I agree that we all have the duty, not only the vendors, to learn at each step about the entire life cycle of the components that we are designing. When we deal with a back-washable filter, it is not enough just to say, "okay", we will just put water on it or spray a solution on it and it will be back-washed. Instead, we have to understand clearly the consequences of operating such a system.

INTRODUCTION

FIRST: Our next speaker is Dr. Dade Moeller, also a long-time attender at the Air Cleaning Conferences, and for many years a member of the Program Committee. He has taken a very active role in the conduct of the Conferences, and has made major contributions with his technical papers. He is currently President of Dade Moeller and Associates, located at New Bern, North Carolina. He worked for the US Public Health Service as a commissioned officer from 1948 to 1966, with assignments that included Oak Ridge National Laboratory, Los Alamos National Laboratory, and the headquarters offices of the US Public Health Service in Washington, DC. From 1968 to 1983 he was Professor of Engineering and Environmental Health, and Chairman of the Department of Environmental Health Sciences at the Harvard School of Public Health. During those years, Dade and I worked very closely together, and it was a delightful experience for me. He is a first-class scientist and a wonderful person to work with. From 1983 to 1993 he became Associate Dean for Continuing Education at Harvard School of Public Health. It is interesting that Dade was a member of the Advisory Committee on Reactor Safeguards from 1973 to 1988, and for a number of those years was Chairman. I invited him to introduce our current chairman but he said their tenures did not overlap and he thought perhaps he didn't know quite enough about the speaker to undertake that assignment. Dade is a certified health physicist and a diplomate of the American Academy of Environmental Engineers. He has received the distinguished achievement award of the Health Physics Society, and a meritorious achievement award from the US Nuclear Regulatory Commission in 1988. He is a member of the National Academy of Engineering, dating from 1978. He is author of a textbook, now going into its second edition, entitled Environmental Health. Dade has many more honors, but I'm taking up too much of his time, so I will stop at this point. It is a delight to have you here, Dade. The topic of his talk is, "Application of Innovative Policies for Controlling Radionuclide Releases: The 'Open-market Trading Rule'". I think you will find this a very interesting concept.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPLICATION OF INNOVATIVE POLICIES FOR CONTROLLING RADIONUCLIDE RELEASES: THE "OPEN-MARKET TRADING RULE"

Dade W. Moeller, Ph.D.
President
Dade Moeller & Associates, Inc.
147 River Island Road
New Bern, NC 28562

Abstract

In the past, most efforts for reducing airborne radionuclide releases and controlling radioactive wastes have been directed to the development of new and improved technologies. Little attention has been paid to the possible application to these problems of new, innovative policies. Yet, experience in other fields shows that such applications could be beneficial. A prime example is the "open-market trading rule," now being widely used in the U.S. for the control of a range of environmental problems. Through this rule, nuclear facility operators would be permitted to control airborne emissions in a more cost-effective manner, and those responsible for decommissioning and decontaminating nuclear facilities no longer in operation could do so at far lower costs while generating significantly smaller volumes of radioactive wastes. Application of such a policy would also significantly reduce the demands on existing, and the need for research to develop new, improved, control technologies.

I. Introduction

Most efforts for reducing airborne radionuclide releases from operating nuclear facilities have been directed to the development and application of new and improved technologies. This is also true in the case of the decommissioning and decontamination of commercial nuclear power plants and the cleanup of nuclear installations under the control of the U.S. Department of Energy (DOE), as well as in the management and disposal of the associated radioactive wastes. Little attention has been paid to the possible application of new, innovative policies. Yet, experience in other fields of environmental protection shows that the application of such policies might be beneficial. The purpose of this paper is to review one such policy that may prove useful, namely, the "open-market trading rule."

II. The "Open-Market Trading Rule"

Through the "open-market trading rule," the U.S. Environmental Protection Agency (EPA) permits an industry that is having a problem with excessive releases of a given toxic chemical either: (a) to spend whatever is required to reduce the releases; or (b) to "make room" for the releases either by purchasing and shutting down other industries discharging the same toxic

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

chemical within the same geographic area, or by assisting other dischargers of the same pollutant in reducing the quantities of their releases.

One of the major benefits of this approach, sometimes called "emissions trading," is that it enables industrial and governmental organizations to control pollutants in the most cost-effective manner.⁽¹⁾ That is to say, if one company can control their releases of a given toxic agent at a lower cost than another, it is wiser for the second company to assist the first in its cleanup efforts than to spend more money in trying to reduce its own releases.

Initially, the "open-market trading rule" was applied solely to the control of a single toxic chemical within a single environmental medium. Under the Clean Air Act, for example, U.S. industries are permitted to optimize releases to the atmosphere based on mitigative technologies, thereby "trading" exposure rights.⁽²⁾ In effect, this Act permits industries to buy and sell pollution rights and encourages one industry to assist another in reducing its airborne releases, if this can be accomplished at lesser costs. The same type of optimization is permitted under the Clean Water Act to control discharges to lakes and rivers. With the increasing success of this approach, however, its applications have been extended to broader arenas. For example, through an emission allowance program, the rule is being used to control airborne emissions that cause acid rain, thus providing opportunities for additional low-cost reductions of sulfur dioxide emissions. In fact, an allowance market for such emissions has been established by the Chicago Board of Trade.⁽³⁾ The rule is also being applied to trade-offs in which industrial and community organizations have been given permission to create artificial wetlands to replace those that have been (or will be) destroyed by industrial and commercial development.

But the broadening of the applications of this rule has not stopped here. In recent months, still wider applications have been explored and implemented. EPA, for example, is now exploring trade-offs among different pollutants within the same medium (for example, trade-offs between releases of oxides of sulfur and oxides of nitrogen to the atmosphere), as well as trade-offs among several media, so called "cross-media" trading whereby releases of one or more pollutants to the atmosphere can be balanced against releases of other pollutants to the water environment.⁽⁴⁾

To exploit the benefits of this rule, EPA is proposing that it be applied on a generic basis and they are encouraging State and local agencies to create new, innovative programs for its application.⁽⁵⁾ In fact, the EPA Assistant Administrator for Air and Radiation has stated that "EPA's experience with these trading programs, and with our own successful acid rain program, (has) led us to conclude that properly structured programs can reduce emissions earlier and cheaper than would otherwise be

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

possible."⁽⁶⁾ Dan W. Reicher, J.D., Chief of Staff, U.S. DOE, has also expressed interest and support for the concept. Concurrently, application of the "open-market trading rule" has received widespread endorsement from various independent "watch-dog" agencies, such as the U.S. General Accounting Office.^(7,8) In addition, the concept has been endorsed by a variety of other groups,^(9,10) and it is being applied internationally as part of the worldwide efforts to reduce airborne emissions that could lead to global warming. One of the major benefits of this concept is that it requires that an integrated or systems approach be applied to the control of environmental releases of various pollutants.

III. Applications of the Concept to Nuclear Facilities

Although the applications cited above have proven extremely successful, it appears that the "open-market trading rule" would have even greater benefits in the control of airborne releases from operating nuclear facilities, in the cleanup of contaminated nuclear facilities, and in the control of associated wastes. These benefits, which are unique due to the origin of the radiation sources affecting typical population groups, include those of a technical and economic nature as well as public education and goodwill. Perhaps surpassing all of these benefits, however, is the fact that applications of the "open-market trading rule" to the control of environmental radiation exposures may prove to be exactly the vehicle needed to expedite the cleanup of decommissioned commercial nuclear power plants and various DOE facilities. It may also enable State and local regulatory groups and nuclear facility operators to ensure that financial resources for the control of radiation exposures are being directed to those sources that contribute the highest dose and can be controlled at least cost.

As an example, consider the operation of an existing nuclear facility or the cleanup of a facility that is no longer in operation. As in most such cases, the goal will be to assure that offsite population groups will not be exposed to radiation doses in excess of the applicable limits. The basic steps required in applying the rule to such a situation, and the benefits that would be accrued, are outlined below. As will be noted, in certain cases, application of the concept requires changing the ways in which exposures from such sources have been viewed in the past.

Basic Steps

1. As an initial step, there would be a need to assess the full range of radiation sources that affect nearby population groups. Such sources include natural background radiation, medical and dental uses, and consumer products, as well as contributions from the nuclear facility.

The benefits of this exercise would be several. First of all, it would require all concerned parties, both within

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

and outside the facility, to apply an holistic approach to the assessment and evaluation of the various radiation sources affecting nearby members of the public and stakeholders. Other benefits would be gained in terms of public education since it would reveal to nearby groups the major sources of their exposures. In essentially all cases, the nuclear facility would prove to be a minor contributor.

2. The next step would be to rank the various sources according to their relative contributions to the doses to offsite population groups. Once this had been done, the dose rates from each source would be compared to the relevant mandatory limits, where such limits exist. This would lead to the identification of those sources to which controls must be applied and the quantification of the degree of reduction that is necessary. It is only after these basic reductions in dose rates have been achieved that the "open-market trading rule" would be applied.

For facilities being decommissioned and/or decontaminated, such an assessment would need to include the decision on whether the site on which the facility is located is to be released for unrestricted or restricted use -- with appropriate consideration of the degree to which this affects the amount by which the associated dose rates must be reduced. As a minimum, restoration efforts would probably need to be applied to the nuclear facility to reduce the accompanying dose rates to neighboring population groups to the long-term standard dose rate limit of 1 mSv (100 mrem) per year, as recommended by the International Commission on Radiological Protection and the National Council on Radiation Protection and Measurements,⁽¹¹⁾ and as required by the regulations of the U.S. Nuclear Regulatory Commission.⁽¹²⁾ Under terms of the "open-market trading rule," additional cleanup of the facility would be required only if it were more cost-effective as compared to other sources affecting local population groups.

3. Subsequent to this step, each individual contributor (from both onsite and offsite sources) to the radiation dose rates to offsite population groups would need to be evaluated in terms of its feasibility for control, including a review of the applicable control technologies, associated costs, and potential societal impacts. On the basis of this evaluation, each source would then be ranked in terms of its priority for reduction and/or control.

Following this approach, public health and regulatory agencies, as well as members of the public, would soon learn that, in many cases, it would be far more effective and less expensive to reduce exposures to offsite groups from indoor radon or medical sources, than to continue to

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

pursue additional controls on airborne releases from operating facilities or to proceed with additional cleanup of a nuclear facility that is no longer operating. Studies have shown, for example, that reductions in exposures to indoor radon (and its decay products) can be accomplished at relatively low cost.^(13,14) Other steps that could be taken include the installation of a more modern (reduced dose) mammography x-ray unit or an improved fluoroscopy screen in the local hospital, as well as encouraging wider scale application of newer techniques, such as endoscopy and colonoscopy, in place of x-ray fluoroscopy, as a primary means for conducting gastrointestinal examinations. Additional steps that might be considered include developing better controls for handling the excreta from medical patients to whom radiopharmaceuticals have been administered.

4. Once doses due to releases from the nuclear facility had been reduced to the basic mandatory standard, attention would be directed to the control of other sources for the required additional dose reductions, for example, down to perhaps 0.1 to 0.25 mSv (10 to 25 mrem) per year. As explained above, this would be accomplished by reducing those sources that can be reduced most effectively and at least cost.

Based on this information, a definitive plan of action for remediating the dose rates to the offsite population living in the neighborhood of the given facility would be proposed, taking into account the input of the facility operators, regulatory authorities, the local populace, and related stakeholders.

IV. Benefits of the "Open-Market Trading Rule"

There is a multitude of benefits that would be generated as a result of the application of the "open-market trading rule" to the cleanup of nuclear facilities.

Benefits

1. First and foremost, this rule would require the use of an integrated or systems approach in assessing and controlling radionuclide releases and associated radiation exposures. One of the immediate outcomes would be to provide significant latitude to State and local regulatory officials, as well as facility operators, in selecting which sources should be addressed to accomplish the required dose rate reductions.

- a. Having been provided this latitude, such officials and facility operators could direct their attention to sources, such as natural radiation background and medical radiation applications, which currently contribute over 95% of the total dose to the average member of the U.S. public.⁽¹⁵⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- b. This would also permit regulatory officials and facility operators to direct their attention to those sources that can be most effectively controlled at least cost.
2. Another benefit would be significant reductions in the associated costs of nuclear facility operation and/or cleanup and the volumes of radioactive wastes being generated.
 - a. Because of the reduced controls and cleanup required, there would be ancillary reductions in the demands on associated technologies.
 - b. There would be similar reductions in the expenditures required for research on the development of new, improved technologies.
3. This approach would serve as an outstanding tool for educating the public on the relative importance of various radiation sources. In this regard:
 - a. The procedures involved would offer unusual opportunities for involving and gaining the approval of offsite populations and stakeholders for programs proposed for the operation and cleanup of nuclear facilities.
 - b. This approach would enable nuclear facility operators to demonstrate on a one-on-one basis their interest and concern for controlling dose rates to local population groups. In many cases, application of this approach would enable facility operators to reduce the dose rates to neighboring populations to levels less than they were prior to the original construction and operation of the facilities. This becomes possible, as noted above, because of the relatively high dose rates currently coming from medical and natural background sources, such as indoor radon, and the fact that many of these sources can be readily controlled.
4. Application of this rule would enable nuclear facility operators to begin now to reduce the dose rates to offsite population groups, not having to wait until all the environmental and associated administrative and regulatory requirements had been met.
5. It would provide a cushion in case the engineered barriers installed to control environmental releases did not perform as designed, or unanticipated failures occurred in various natural and engineered control systems. In such cases, facility operators could immediately apply additional controls to other radiation sources while awaiting corrections to be made in the controls being applied to the nuclear facility.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

6. Application of this policy would enable State and local regulators to apply a risk-based approach to the cleanup of nuclear facilities. This has long been a major goal of the EPA, the U.S. Congress, and many State and local regulators.
7. A program such as this would provide a stimulus to the efforts of the EPA and various State and local environmental and public health groups to encourage the monitoring and control of exposures to members of the public from indoor radon. It would also provide a stimulus for increased assessment and evaluation of the radiation doses associated with medical procedures.
8. In the case of U.S. Federal nuclear facilities, such a program would provide a new and challenging mission for the DOE National Laboratories. These Laboratories represent a rich resource of scientists and engineers whose expertise would be extremely beneficial in evaluating, analyzing, and applying the concepts associated with such a program. Participation in such activities would bring them into the mainstream of DOE's environmental restoration program.
9. This approach would provide an initial step in the ultimate development of a system for making similar tradeoffs among the various human and environmental impacts of toxic chemicals and radiation sources. Here, again, the DOE National Laboratories could play a major role.

V. Commentary

As noted above, application of the "open-market trading rule" would offer a range of benefits to State and local officials and industrial organizations in their efforts to improve the control of airborne releases and the cleanup of nuclear facilities as well as to apply a risk-based approach to associated decision-making.

In addition, it appears that application of such a rule would be entirely consistent with directives issued by the President. Under Executive Order 12866, all Federal agencies, including DOE, are required, in setting regulatory priorities, to "consider, to the extent reasonable, the degree and nature of the risks posed by various substances or activities within its jurisdiction," and to "design their regulations in the most cost-effective manner to achieve the regulatory objectives.⁽¹⁶⁾ In doing so, each agency shall consider incentives for innovation, consistency, predictability, the costs of enforcement and compliance (to the government, regulated entities, and the public), flexibility, distributive impacts, and equity," and "each agency shall indentify and assess alternative forms of regulation and shall, to the extent feasible, specify performance objectives, rather than specifying the behavior or manner of compliance that regulated entities must adopt."

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

What is needed is the conduct of several pilot studies to demonstrate the feasibility of the concept through its application to one or more nuclear facilities. In terms of the commercial nuclear utilities, such studies might be directed to several of the plants for which decommissioning operations are underway or contemplated. In terms of DOE, such studies might be directed to the control of radionuclide releases from one or more operating facilities or to the cleanup of sites such as Hanford, Idaho Falls, and West Valley. Although application of this approach might not prove viable for the control of facilities in which the principal radionuclide contaminants (for example, ^{239}Pu) are extremely long-lived, it would be directly applicable to the control of doses from facilities in which shorter-lived radionuclides, such as ^3H , ^{60}Co , ^{90}Sr , and ^{137}Cs , play dominant roles. For many facilities, this is the case.

Once these studies have been completed, the resulting reports and analyses could be submitted to the National Academy of Sciences/National Research Council for review and evaluation. Assuming that such a review would result in their endorsement, Federal, State and local regulatory agencies and plant operators would be armed with a powerful tool for the more effective control of radiation doses to offsite population groups. They would also be provided with a vehicle that would enable them to move ahead with the cleanup of the vast array of Federal nuclear facilities now awaiting action. Proving success in the radiation arena could well lead to more widespread applications of the concept. Such applications might ultimately include trade offs in exposures derived from combinations of radioactive materials and toxic chemicals.

Application of the "open-market trading rule" to the control of doses to offsite populations from nuclear facilities would represent professional environmental and public health practices at their best. This approach would also serve as a superb tool for educating the U.S. public in gaining a better understanding of the relative significance of various radiation sources in their everyday lives.

References:

1. Lents, James M., "Trading Emissions Improve Air Quality," Forum for Applied Research and Public Policy, Vol. 8, No. 2, pages 45 - 48 (Summer, 1993).
2. Bryan, Lee, "Highlights of the Clean Air Act Amendments of 1990," Journal of the Air & Waste Management Association, Vol. 41, No. 1, pages 16 - 19 (January, 1991).
3. Council on Environmental Quality, Environmental Quality - The Twenty-fourth Annual Report of the Council on Environmental Quality, Executive Office of the President, Washington, DC (1993).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

4. Appleton, Elaine L., "A Cross-Media Approach to Saving the Chesapeake Bay," *Environmental Science & Technology*, Vol. 29, No. 12, pages 550A - 555A (December, 1995).
5. Anonymous, "EPA Says Trading Would Sharply Reduce Costs of Utility Air Strategy," *Inside EPA*, Vol. 17, No. 15, page 14 (April 12, 1996).
6. Nichols, Mary D., "U.S. EPA Proposes Open-Market Trading Rule," *EM, Air & Waste Management Association's Magazine for Environmental Managers*, pages 12 - 13 (July, 1995).
7. U.S. General Accounting Office, "Air Pollution: Allowance Trading Offers an Opportunity to Reduce Emissions at Less Cost," Report GAO/RCED-95-30, Washington, DC (December, 1994).
8. U.S. General Accounting Office, "Environmental Management: An Integrated Approach Could Reduce Pollution and Increase Regulatory Efficiency," Report GAO/RCED-96-41, Washington, DC (January, 1996).
9. Lents, James M., and Leyden, Patricia, "RECLAIM: Los Angeles' New Market-Based Smog Cleanup Program," *Journal of the Air & Waste Management Association*, Vol. 46, pages 195 - 206 (March, 1996).
10. Burtraw, Dallas, "Trading Emissions to Clean the Air: Exchanges Few but Savings Many," *Resources*, No. 122, pages 3 - 6, *Resources for the Future*, Washington, DC (Winter, 1996).
11. National Council on Radiation Protection and Measurements, "Limitation of Exposure to Ionizing Radiation," Report No. 116, Bethesda, MD (1993).
12. U.S. Nuclear Regulatory Commission, "10 CFR Parts 2, 19, 20, 30, 31, 32, 34, 35, 39, 40, 50, 61 and 70, Standards for Protection Against Radiation," *Federal Register*, pages 23360 - 23474 (May 21, 1991).
13. Moeller, Dade W., and Fujimoto, K., "Cost Evaluation of Control Measures for Indoor Radon Progeny," *Health Physics*, Vol. 46, No. 6, pages 1181 - 1193 (June, 1984).
14. National Council on Radiation Protection and Measurements, "Control of Radon in Houses," Report No. 103, Bethesda, MD (September, 1989).
15. National Council on Radiation Protection and Measurements, "Ionizing Radiation Exposure of the Population of the United States," Report No. 93, Bethesda, MD (September, 1987).
16. Office of the President, "Executive Order 12866 -- Regulatory Planning and Review," *Federal Register*, Washington, DC (October 4, 1993).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FIRST: I was wondering about the aspect of not requiring reductions by nuclear facilities as an offset. How do you reconcile that with the ALARA principle?

MOELLER: I have no problem whatsoever reconciling it, because I am practicing ALARA at the highest level. This is more ALARA than any nuclear facility ever thought of, because I am looking at all sources. I am saving money, that's ALARA.

FIRST: But the reality is that the regulation applies only to nuclear facilities.

MOELLER: Correct. And that is where we obviously need to make some changes. But I think we would have very little difficulty making these changes because of the support of the concept by the congress, by all of the federal agencies, and so forth. I don't mean to be flippant, but I really think that once people understand it, we will have no problems. Obviously it is going to take education of the public, the technical community, and our politicians.

FIRST: Do you think it is possible to educate the public? Look what has happened over the past fifty years with regard to trying to educate the public, not only with nuclear power, but also sanitary landfills, incinerators, and Olestra, the latest on the hit list. What gives you hope?

MOELLER: What gives me hope is the following example. At a public meeting around the XYZ Nuclear Facility, I would say all of you are taxpayers. For fifty dollars per person, (or five hundred or whatever the number is), I can reduce your dose fifty millirems a year. Would you rather have me do that by controlling something in your personal environment, radon, medical x-rays, consumer products that you use or would you rather control the same amount of dose within this nuclear facility at a cost of a million dollars per person. I think if that approach is used often enough, we will prevail, I am an optimist. I know it is going to be difficult, but if there is ever to be any hope of educating the public about the risk associated with various sources of ionizing radiation, this policy may provide a vehicle. And at the moment it seems to me to be one of our best vehicles.

DAUBER: Do you think we will have to have a congressional or a bureaucratic implementation of this principle to make it work, or can simply education do the job?

MOELLER: I believe we already have much of what we need. As I mentioned, the Chief of Staff of DOE is for it, the top people in EPA are for it. In fact they've spoken out, and have written on it. Congress is for it. I am not a lawyer or even a legislative authority, but I can see no obstacles to it if we can get the right people to get going. What is needed, immediately, is to conduct a pilot study at Hanford, at Idaho Falls, West Valley, at Oak Ridge. We need a few pilot studies. Once they have been completed the results should be submitted to the National Research Council for an independent review.

SESSION 2

WASTE MANAGEMENT

Monday July 15, 1996

Co-Chairmen: R.R. Bellamy
J.G. Wilhelm

RADIOACTIVE WASTE TANK VENTILATION SYSTEM
INCORPORATING TRITIUM CONTROL
P.D. Rice

DEVELOPMENT OF A COMPUTER CODE TO PREDICT
A VENTILATION REQUIREMENT FOR AN
UNDERGROUND RADIOACTIVE WASTE STORAGE
TANK
Y.J. Lee and E.L. Dalpiaz

TESTING CLEANABLE/REUSABLE HEPA PREFILTERS
FOR MIXED WASTE INCINERATOR AIR POLLUTION
CONTROL SYSTEMS
D. B. Burns, A. Wong, B.W. Walker, and J.D. Paul

DEVELOPMENT OF AN AIR CLEANING SYSTEM FOR
DISSOLVING HIGH EXPLOSIVES FROM NUCLEAR
WAR HEADS
W. Bergman, K. Wilson, K. Stagges, D. Beason, S. Doughty,
R. Arganbright, D. Wapman, and G. Nelson

A THICK HOMOGENEOUS VEGETATED COVER
DESIGN PROVES COST- AND SCHEDULE-EFFECTIVE
FOR THE RECLAMATION OF URANIUM MILL SITES
NEAR SPOKANE, WASHINGTON
J. Blacklaw, G. Robertson, D. Stoffel, J. Ahmad, E. Fordham,
S. Pachernegg, L. Wainhouse, and J. Riley

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

RADIOACTIVE WASTE TANK VENTILATION SYSTEM INCORPORATING TRITIUM CONTROL

Paul D. Rice, P.E.
ICF Kaiser Hanford Company
Richland, Washington 99352

Abstract

This paper describes the development of a ventilation system for radioactive waste tanks at the U.S. Department of Energy's (DOE) Hanford Site in Richland, Washington. The unique design of the system is aimed at cost-effective control of tritiated water vapor.

The system includes recirculation ventilation and cooling for each tank in the facility and a central exhaust air clean-up train that includes a low-temperature vapor condenser and high-efficiency mist eliminator (HEME). A one-seventh scale pilot plant was built and tested to verify predicted performance of the low-temperature tritium removal system. Tests were conducted to determine the effectiveness of the removal of condensible vapor and soluble and insoluble aerosols and to estimate the operating life of the mist eliminator. Definitive design of the ventilation system relied heavily on the test data.

The unique design features of the ventilation system will result in far less release of tritium to the atmosphere than from conventional high-volume dilution systems and will greatly reduce operating costs. NESHAPs and TAPs NOC applications have been approved, and field construction is nearly complete. Start-up is scheduled for late 1996.

Introduction

Safe storage of radioactive waste resulting from reprocessing nuclear reactor spent fuel can be a special challenge when large amounts of tritium are present. High tritium concentrations have been a concern at the Aging Waste Tank Farm (AWTF) at the Hanford Site in Richland, Washington. The AWTF is a complex of four 3800-m³ (1,000,000-gallon) underground double-shell tanks (DST) identified as 241-AY-101 and -102, and 241-AZ -101 and -102. Although the aging waste volume is small compared to the total waste in the 177 underground tanks at Hanford, its activity level is high. The AWTF tanks have the potential to operate at significantly higher temperatures and can generate large quantities of tritiated water vapor at the waste surface as a natural consequence of heat and mass transfer to the ventilation flow through the tank head space. The ventilation system design for heat removal alone presents no great challenge. The fact that tritium is present changes the entire direction of the design.

Background

In 1986 a conceptual design was begun by Kaiser Engineers Hanford (KEH; renamed ICF Kaiser Hanford Company in 1994) to upgrade the AWTF facility (then operated by Rockwell Hanford Operations) to current codes and standards, to achieve compliance with new environmental release criteria, and to handle unusually high heat from future fuel reprocessing campaigns.

The design criteria imposed on the project greatly restricted allowable radionuclide concentrations in the ventilation system exhaust stack and also identified deficiencies in the existing system. In particular, the HEPA filters had lifetimes that varied from two days to two years, depending on waste processing operations.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The initial conceptual design of the new system included two stages of HEPA filters to control (primarily) strontium, cesium, and plutonium particulate, and a refrigerated wet scrubber to control tritium, ruthenium, and other condensible vapors and to protect the HEPA filters from various soluble compounds such as ammonium salts.

The search for an effective wet scrubber that was practical to maintain in a radioactive mixed waste environment led to a rather novel device, patterned after a submerged gravel scrubber (SGS). The SGS had been developed by Westinghouse Hanford Company (WHC) as a passive venting system for nuclear reactor containment during accident conditions. The device designed by KEH incorporated ceramic balls, rather than gravel, and added a cooling system and a high-efficiency pad-type mist eliminator. See Figure 1.

Two stages of cooling with a total capacity of 4.4 MW (15 million Btu/h) were incorporated in the ventilation system design. The first stage incorporated shell-and-tube heat exchangers with evaporative cooling towers to take efficient advantage of the high-temperature process-ventilation air stream. The second stage of cooling was accomplished with a refrigerated heat exchanger in connection with the scrubber spray system.

Kaiser Engineers recommended that funds be allocated for construction and testing of a prototype scrubber to verify the calculated performance of the proposed system. The services of Pacific Northwest Laboratories (PNL) at Hanford were requested to construct and test the prototype.

By chance, PNL had recently completed a series of tests of a scale SGS in combination with a high-efficiency mist eliminator (HEME) as part of a development program for a waste vitrification melter off-gas ventilation system. PNL's tests revealed that operation of the SGS resulted in a large mist carryover fraction, which drove the use of the HEME in the design. Since the HEME also collected submicron particulate, PNL recommended incorporation of the HEME into KEH's scrubber system to extend the life of the HEPA filters. PNL also suggested that a shell-and-tube heat exchanger be substituted for the SGS and still accomplish the desired end results, using off-the-shelf equipment. The goal was to remove a high percentage of condensible vapors and to enhance HEPA filter protection by removing a wide range of soluble and insoluble particulate.

The "new" scrubber design proposed for testing is shown in Figure 2. It was agreed that a pilot plant based on this configuration should be built and tested. Appropriate program and test plans were prepared by PNL, while KEH procured the needed refrigeration equipment for the pilot plant. The completed pilot plant was ready for testing in 1988.

Off-Gas Characterization

In support of the PNL test program, the Hanford operations contractor, WHC, performed characterization tests of the AWTF off gas. These tests (Powell 1989) determined particle size, mass concentration, and chemical composition of the off-gas aerosol. The sample data was intended for PNL's use in selecting test aerosols for the pilot plant experiments.

The sample port in the AWTF existing ventilation system was located to approximate the conditions expected just upstream of the proposed scrubber system. The point selected was downstream of existing raw-water-cooled condensers, similar to a location between the two stages of cooling proposed in the new system. An off-gas temperature of approximately 38°C (100°F) was typical at this point.

Test results showed that the temperature of the saturated off gas leaving the condensers affected mass and beta emission concentration (principally Cs 137) in the gas stream. As the vapor outlet temperature of the condensers increased, the mass concentration in the off gas increased. Mass concentration varied from 0.9 to 64.8 $\mu\text{g}/\text{m}^3$, averaging 16.5 $\mu\text{g}/\text{m}^3$. Beta concentration increased with increasing condenser outlet temperature, varying between 507 and 2935 pCi/ m^3 . Gamma concentration in the off gas varied between 408 and 1294 pCi/ m^3 Cs137, but had no apparent correlation to condenser off-gas temperature.

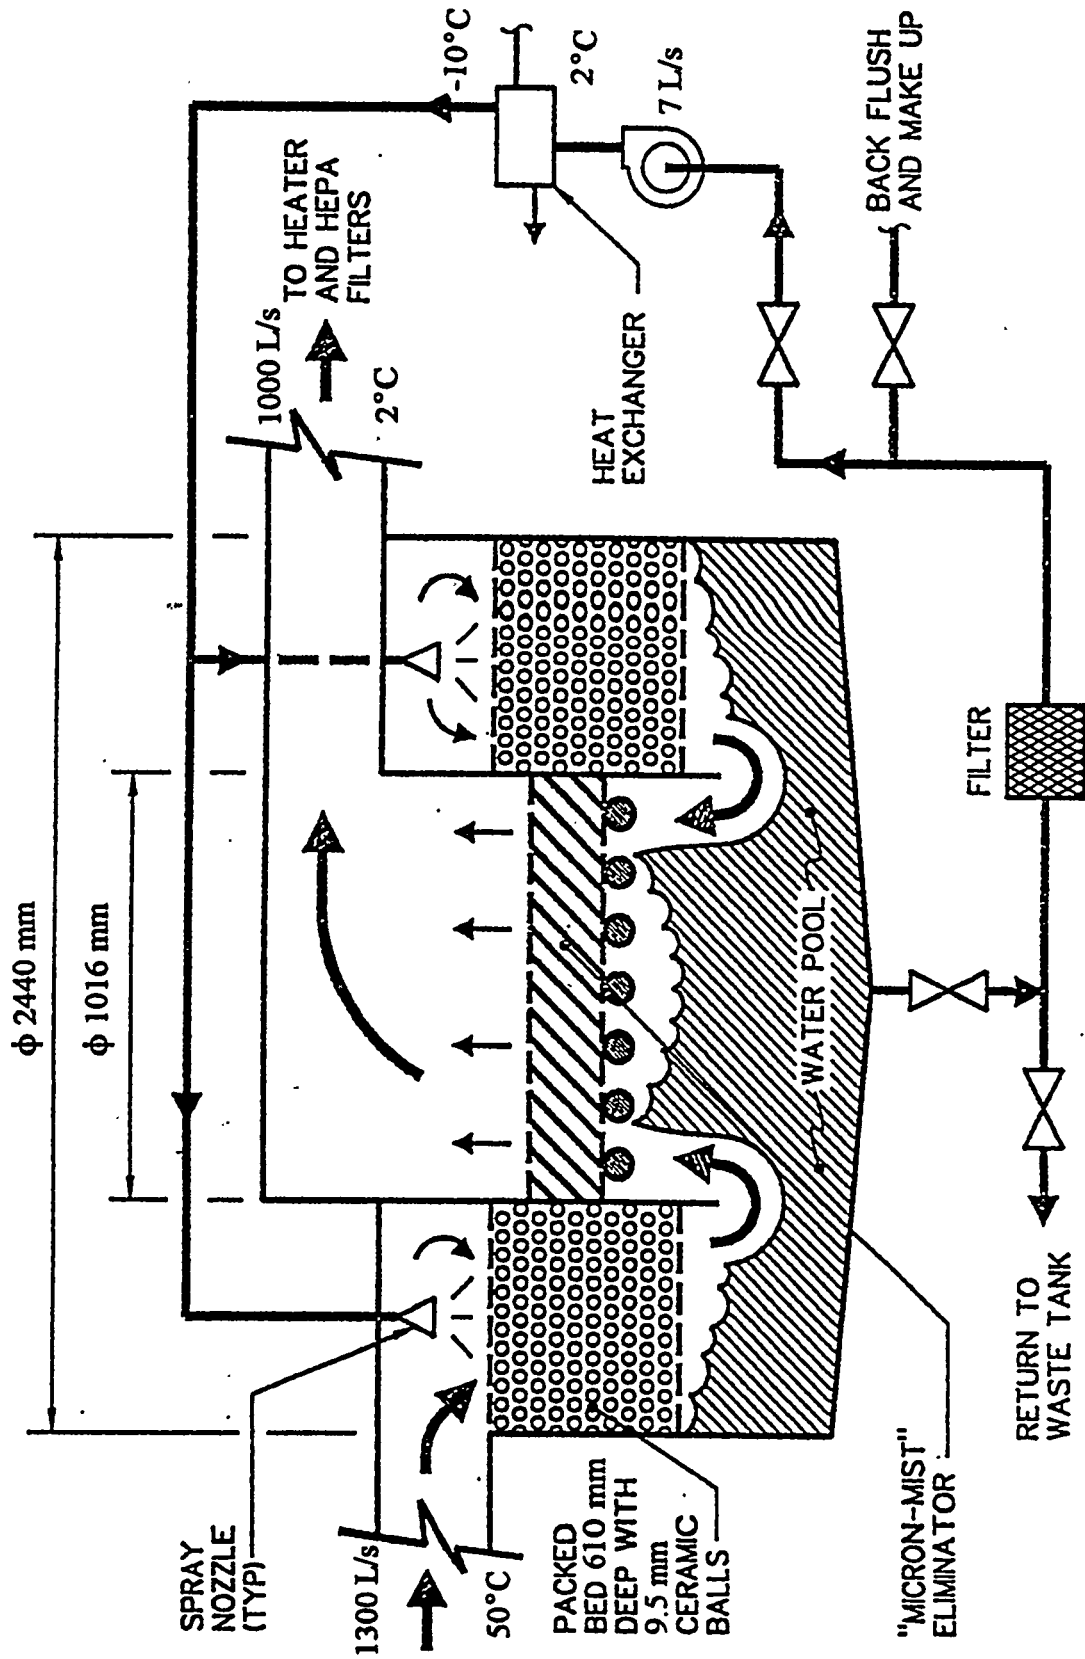


Figure 1 Scrubber/deentrainer/filter.

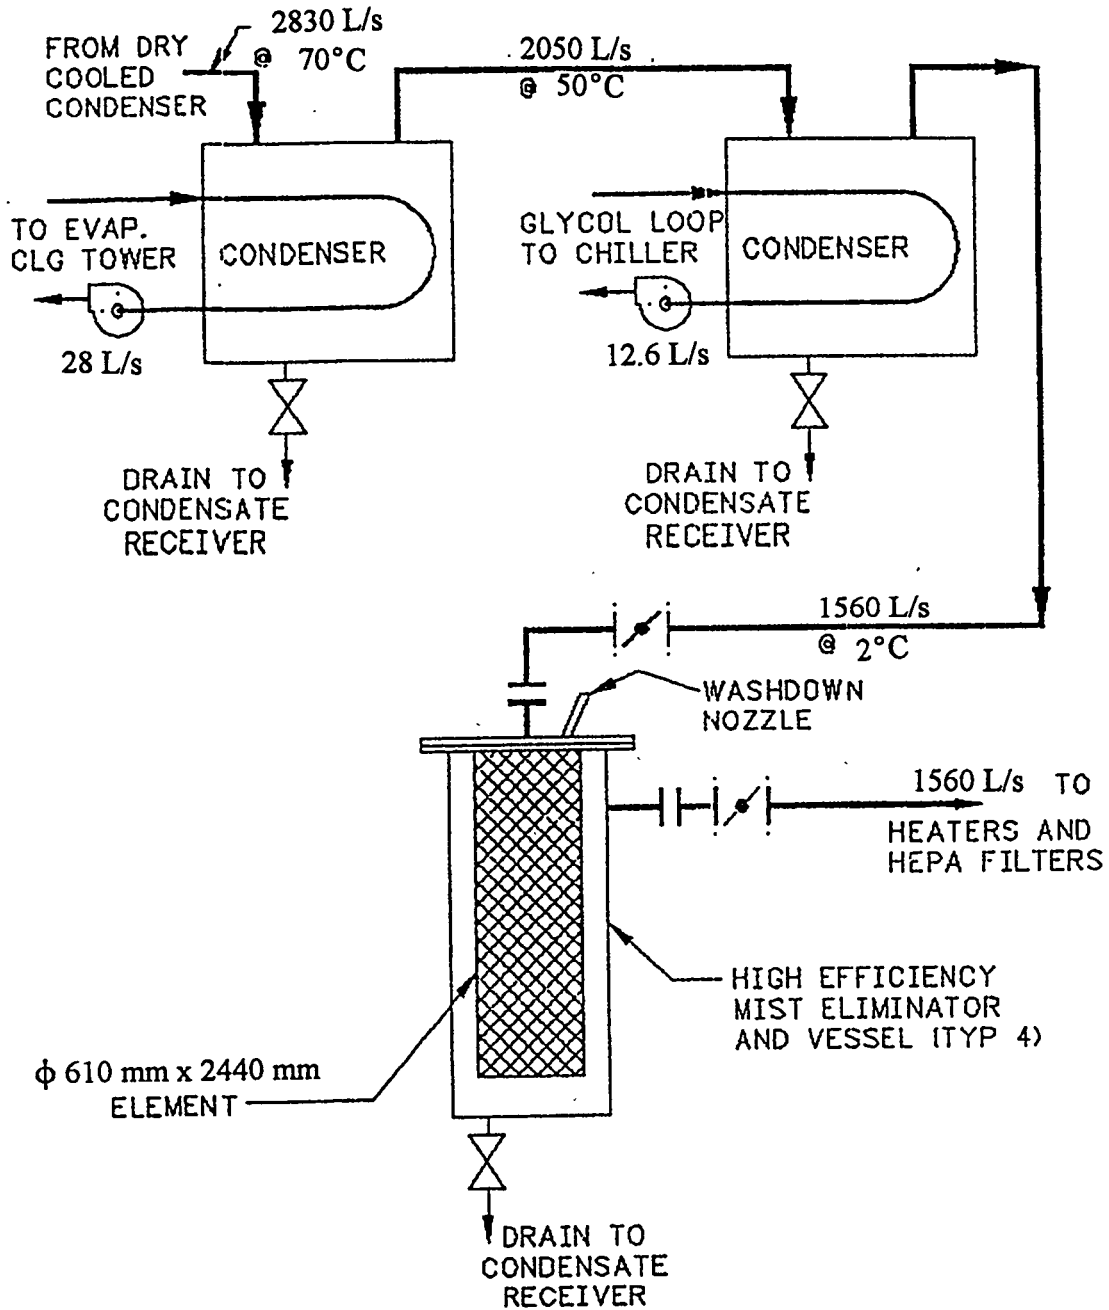


Figure 2 Primary vent scrubber.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The off-gas stream was found to have two separate mass size distributions (bimodal). Both mass and beta activity readings confirmed that the bimodal size distribution existed. Most of the mass loading and beta/gamma activity was concentrated in the smaller aerodynamic diameter size range of 0.4 to 0.05 μm . The average mass mean aerodynamic diameter (MMAD) of the particulate in the gas stream was 0.073 μm . The beta mean aerodynamic diameter (BMAD) of particulate containing beta activity was 0.084 μm . The established mean of the larger diameter mass and beta distribution was about 2 μm . Statistical analysis indicated that the mean particle size was a function of the temperature of the off gas and location of the sample point in the duct. The larger particulate size distribution was found in the high velocity center of the off-gas duct at higher off-gas temperatures.

Experimental Apparatus

A pilot-scale scrubber for a DST ventilation system, shown in Figure 3, was fabricated, installed, and tested at PNL (Brouns and Peterson 1989). Table 1 contains the key for the symbols used in Figure 3. Ambient air is pulled into the inlet through a HEPA filter by an off-gas blower. Aerosols are injected into the line to simulate test conditions. Steam can be injected into the aerosol-containing air stream through a metered injection port to adjust the absolute humidity. The stream then passes through a heat exchanger that is used to adjust the relative humidity and temperature. The simulated off gas then passes through the primary components of the pilot-scale system--the refrigerated condenser and the HEME--and then out through the off-gas blower. Temperature, pressure, and flow rate sensors are mounted throughout the test system to monitor, adjust, and record operating parameters. The system was designed to allow for simulation of a variety of conditions expected in a full-scale ventilation system. The individual components in the pilot-scale ventilation system are described in the following sections.

Aerosol Generation

Aerosols were produced by Virtis® SG-40 aerosol generators. This apparatus uses a Laskin-type nozzle that shears a liquid solution with sparged air to create a liquid aerosol. Air at 140 kPa (20 psi) was provided to generate the aerosols. Soluble aerosols were produced from a NaCl or NH_4NO_3 solution. Insoluble aerosols were produced from a suspension of TiO_2 in water. Mixed soluble-insoluble tests were conducted by means of two aerosol generators, one for soluble NH_4NO_3 and the other for insoluble TiO_2 . Each generator was adjusted separately to obtain the desired aerosol production rate. Aerosol sizes in the 0.05- to 25- μm size range were measured.

Process Gas Line Heater or Cooler

The incoming process gas stream could be heated above or cooled below the ambient temperature with the heater or cooler. The stainless steel shell and tube heat exchanger used either 200 kPa (30-psig) steam or process water. The process gas temperatures that were used in testing ranged from 16° to 66°C (60° to 150°F).

High-Efficiency Mist Eliminator

The HEME unit, shown in Figure 4, is a mist eliminator designed to eliminate submicron particles from the process gas stream. The process gas enters the top and center of the HEME and then passes through a cylindrical filter (Flexifiber® type BD-PFF) consisting of approximately 80 mm of 8- to 10- μm -diameter glass fibers. The filter captures aerosol particles by impaction and by Brownian diffusion. A water-spray full-cone nozzle positioned above the filter sprays directly at the filter and can be used to wash the filter free of captured particles. Wash solution and mist removed from the off-gas stream are collected and metered via a dip leg connected to the bottom of the HEME. This collection rate is monitored and is necessary for material balance calculations.

Process Gas Chiller

The process gas chiller consists of an air/glycol condenser coupled to a glycol/refrigerant heat removal system. The air/glycol condenser is a four-pass shell-and-tube heat exchanger, with the process gas passing through the shell side of the exchanger and the water-glycol mixture passing through the tube side. A refrigerant evaporator cools the 50 wt% water-glycol mixture, which is maintained at -1°C (30°F) to +2°C (35°F) in a storage tank. A three-way splitter valve (V8) is adjusted to maintain the temperature of the process gas stream leaving the condenser. The three-way valve is manipulated by a pneumatic actuator tied to a set-point temperature controller.

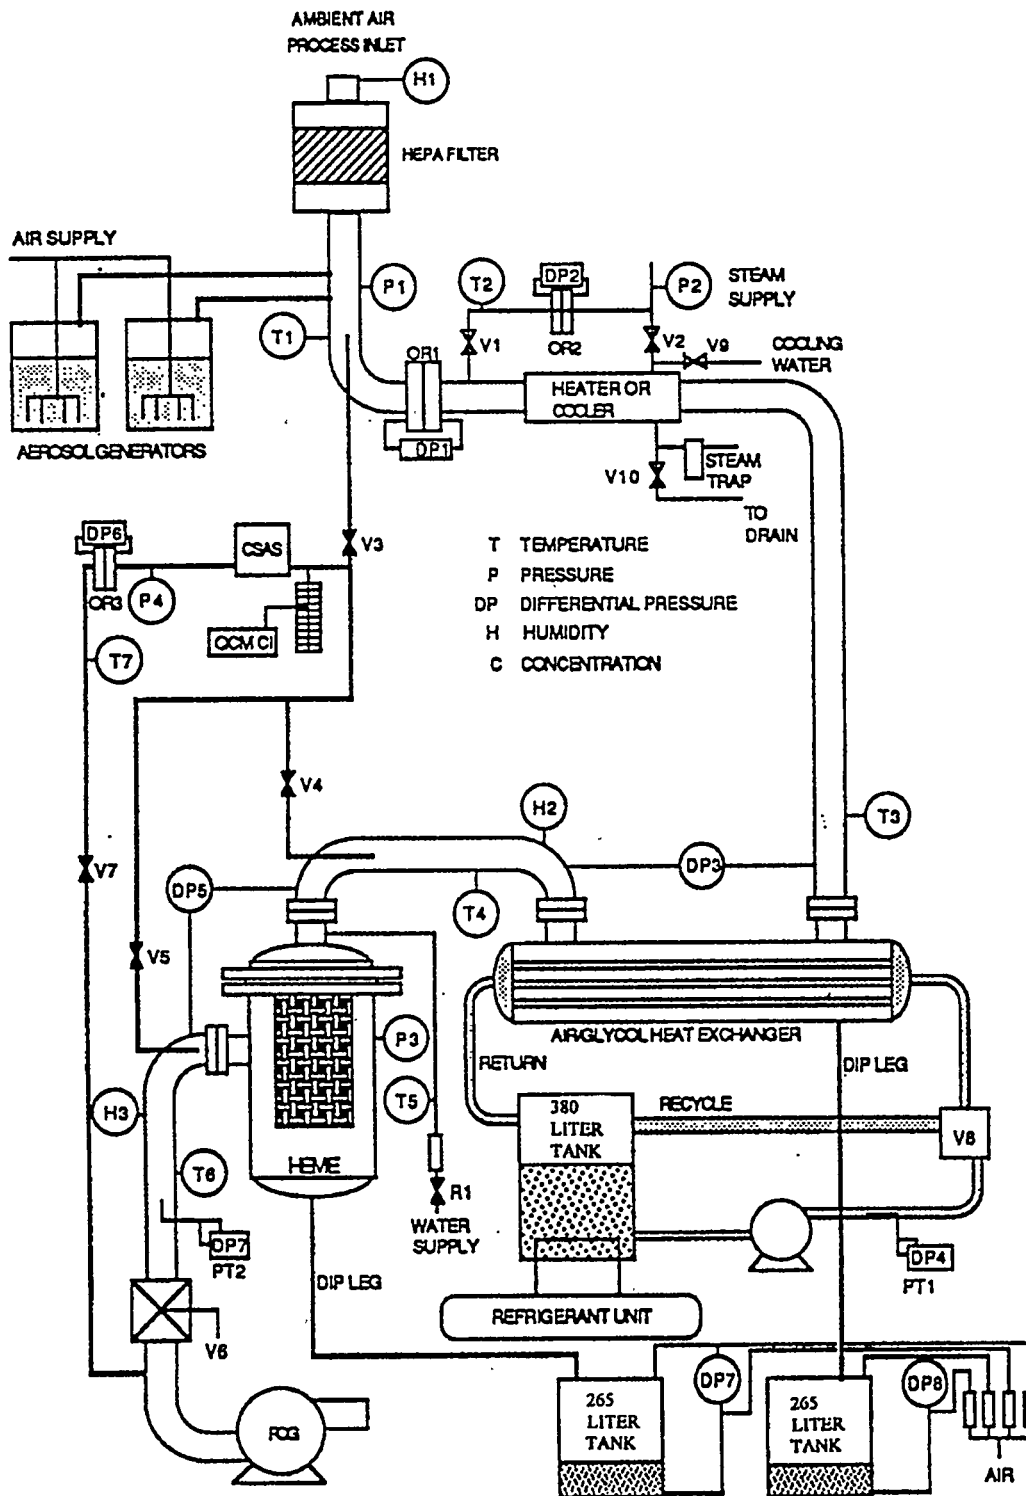


Figure 3 Schematic of the pilot-scale scrubber (from Brouns and Peterson 1989).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1 Equipment descriptions.

ID Number	Description
CSAS	Classical scattering aerosol spectrometer
QCM CI	Quartz crystal microbalance cascade impactor
TI-T7	Type K thermocouples - temperature
H1	Hygrometer - ambient air dewpoint
P1	Barometer - ambient pressure
P2	Pressure gauge - steam pressure
P3	Differential pressure transducer - HEME operating pressure
P4	Differential pressure transducer - CSAS operating pressure
OR1	Orifice plate (102 mm) - inlet flow rate
OR2	Orifice plate (13 mm) - injection steam flow rate
OR3	Orifice plate (25 mm) - CSAS flow rate
PT1	Pitot tube - water/glycol coolant flow rate
PT2	Pitot tube - HEME outlet flow rate
DP1	Differential pressure transducer - OR1
DP2	Differential pressure transducer - OR2
DP3	Differential pressure transducer - heat exchanger pressure drop
DP4	Differential pressure transducer - PT1
DP5	Differential pressure transducer - HEME pressure drop
DP6	Differential pressure transducer - OR3
DP7	Differential pressure transducer - HEME condensate level
DP8	Differential pressure transducer - HX condensate level
V1	Regulating valve - steam injection control
V2	Regulating valve - steam heater control
V3	Ball valve - inlet aerosol sample manifold
V4	Ball valve - HEME inlet aerosol sample manifold
V5	Ball valve - HEME outlet aerosol sample manifold
V6	Control valve (102 mm) - system air flow control
V7	Regulating valve - CSAS sample flow control
V8	Diverter control valve - process gas temperature control
V9	Regulating valve - water cooler control
V10	Diverter valve - cooling water drain
R1	Flowmeter and control valve - HEME water spray
POG	Primary off-gas system blower

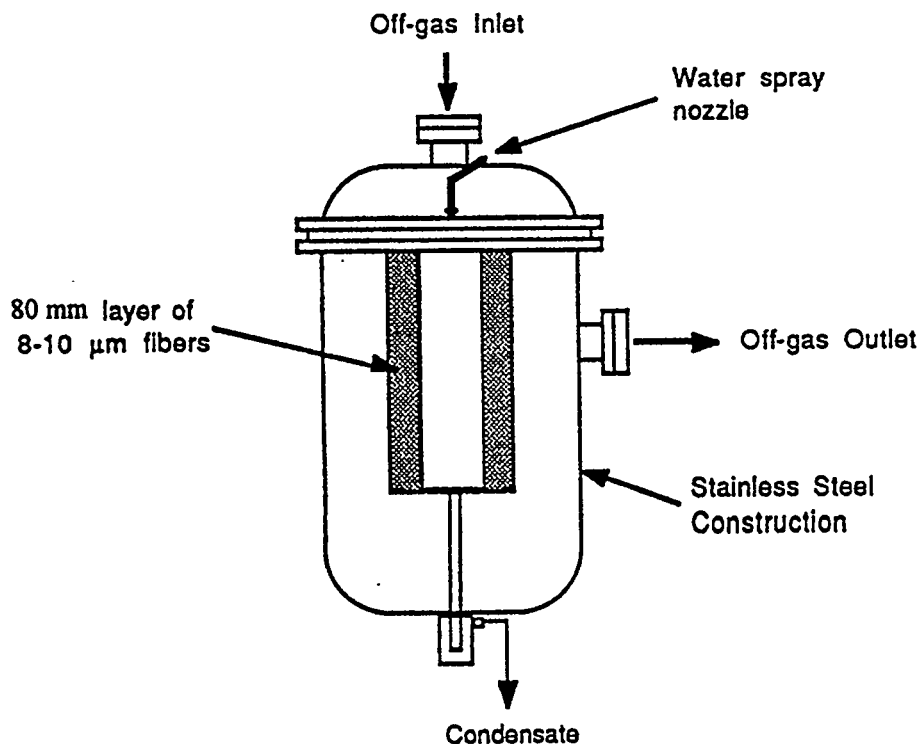


Figure 4 Schematic of the high-efficiency mist eliminator.

With this system, it is possible to cool 70 L/s (150 acfm) of saturated air at 38°C (100°F) to 2°C (35°F), saturated. Condensate from the condenser was collected and monitored by means of a dip leg arrangement similar to that described above for the HEME.

Condensate Collection System

The water collection system consists of two steel tanks to contain condensate from the condenser and HEME. Dip legs from the condenser and HEME terminate several inches above the bottom of each tank. Instrument air is purged through tubing to the top and bottom of each tank. Rotameters are used to set and adjust the purged air flow rate. Differential pressure transducers are connected between the top and bottom air lines to measure the liquid head in each tank.

Classical Scattering Aerosol Spectrometer/Sampling Manifold

The classical scattering aerosol spectrometer (CSAS) system uses light-scattering theory to measure aerosol particle diameters. A classical He-Ne laser tube is used to create a light beam that is passed through windows mounted on the side of the sample tube. The process gas is drawn through the sample tube, and any entrained aerosols will scatter the light beam. The energy of the pulse of scattered light is proportional to the size of the aerosol that scattered the light; thus, the CSAS can count the number of aerosols passing through the beam and determine the aerosol "optical" or equivalent geometric size distribution. The instrument was calibrated for aerosols in the 0.32 to 0.755- μm size range; therefore, aerosols below 0.32 μm or above 0.755 μm were not measured by the CSAS. The sampling manifold allowed for samples to be drawn from three locations in the system. By appropriate valve switching, samples were taken and analyzed from the inlet to the system, from the entrance to the HEME, and from the exit from the HEME. In general, results of aerosol sampling are expected to be quite accurate for particles smaller than 3 μm and inaccurate for larger particles. Aerosol data from each sample

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

port were used to determine the efficiency and the DF for the heat exchanger, the HEME, and the overall system. It was necessary to maintain the temperature of the gas flowing through the sampling chamber above saturation in order to avoid condensation on the optics of the CSAS. Data were not collected when sample lines were at a temperature lower than that of the process gas.

Quartz Crystal Microbalance Cascade Impactor

In addition to the CSAS, a quartz microbalance cascade impactor (QCM CI) was used to measure aerosol particle size distribution and concentration. While the CSAS measures a particle number distribution, the QCM CI measures a mass concentration distribution. Use of the QCM CI in series with the CSAS allowed comparison between the two methods and obtained data that could be compared directly to field data.

The QCM CI pulls process gas from the CSAS sampling manifold through an isokinetic sampling probe into the sensing stack, which comprises 10 impactor stages. Particles of sufficient size and mass strike a piezoelectric crystal microbalance (PCM) present on each stage of the impactor. Smaller particles escape impaction on the first stages but are captured later as the velocity of the process gas is increased through smaller orifices. The sensing stack segregates particles into ten 50%-efficiency cut-off sizes (D_{p50}) between aerodynamic diameters of 25 and 0.05 μm . With an assumed particle density of 2 g/mL, the D_{p50} s are shown in Table 2. The impacted particles on each stage result in a change in frequency of the quartz crystal that is proportional to the mass of particles collected. Because the QCM CI measures particle size distribution over a wider size range than the CSAS, it is better suited to broadly distributed aerosols. The CSAS is more precise in a narrower distribution but inaccurate for broadly distributed aerosols.

Table 2 QCM CI 50% cut-off sizes.

Stage	$D_{p50}, \mu\text{m}$
1	25.00
2	12.50
3	6.40
4	3.20
5	1.60
6	0.80
7	0.40
8	0.20
9	0.10
10	0.05

Data Acquisition System

The data acquisition system consists of a Hewlett-Packard 9000/200 computer system interfaced to a Fluke 2240B data logger, a Validyne SPM 380 digital scanning panel meter, and the CSAS. All temperature measurements were provided by Type K thermocouples interfaced to the Fluke logger. Flow rates were measured by means of orifice plates and pitot tubes with all pressure drops, and all operating pressure measurements were determined with Validyne pressure transducers interfaced to the Validyne panel meter. Temperatures, pressure drops, flow rates, and aerosol size and count in each of the 15 channels of the CSAS were collected by the HP 9000/200 computer

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

system and stored on its hard disc. QCM CI measurements were printed on thermal paper, referenced in the laboratory record book, and stored for later analysis.

Experimental Test Results

Condensible Vapor Removal

The pilot-scale ventilation system effectively removed 100% of the water that theoretically could be condensed with a saturated stream at the HEME outlet conditions. Condensed water not collected by the condenser was removed by the HEME. When the flow rate was at the high test level (70 L/s or 150 scfm) and the absolute humidity was high, condensate was collected by the condenser. At the low humidity, the condensate was carried to the HEME before collection. At the low test flow rate of 38 L/s (80 scfm), condensate was collected by the condenser at all absolute humidities. The condenser was operated with a coolant temperature of 2° to 3°C (35° to 37°F). Lower temperatures resulted in ice formation and a subsequent decrease in the heat transfer coefficient.

Soluble Aerosol Removal

Removal of sodium chloride (NaCl) and ammonium nitrate (NH_4NO_3) soluble aerosols occurred in both the condenser and the HEME. At high absolute humidity (0.07 to 0.08 kg $\text{H}_2\text{O}/\text{kg}$ air), condenser DFs ranged from 3 to 16 with a feed concentration of 30 to 51 $\mu\text{g}/\text{m}^3$. Condenser DFs generally increased with the off-gas flow rate. At a lower absolute humidity, condenser DFs ranged from 1 to 2, and decontamination was primarily controlled by the HEME. System DFs for soluble NH_4NO_3 aerosols based on total mass concentrations were between 5.8 and 37 with an average of 19. System DFs averaged 18 for NH_4NO_3 aerosols in the 0.05- to 0.1- μm size range and 7.1 for aerosols in the 1.6- to 3.2- μm size range at an inlet concentration of 120 $\mu\text{g}/\text{m}^3$.

Insoluble Aerosol Removal

Removal of insoluble titanium dioxide (TiO_2) aerosols was controlled primarily by the HEME and appeared to be affected by the aerosol concentration. HEME DFs for insoluble aerosols averaged 5.9 at an inlet concentration of 68 $\mu\text{g}/\text{m}^3$. At a higher inlet concentration of 188 $\mu\text{g}/\text{m}^3$, the average HEME DF increased to 25. An average system DF of 13 was obtained during tests with a system inlet concentration of 153 $\mu\text{g}/\text{m}^3$ and a HEME inlet concentration of 68 $\mu\text{g}/\text{m}^3$. System DFs averaged 22 for TiO_2 aerosols in the 0.05- to 0.1- μm size range and 12 for aerosols in the 1.6- to 3.2- μm size range at an inlet concentration of 153 $\mu\text{g}/\text{m}^3$.

HEME Life Expectancy

HEME life expectancy tests with soluble, insoluble, and mixed soluble-insoluble aerosols resulted in an increase in pressure drop of less than 15% over the 30-day test periods. The results of the mixed soluble-insoluble aerosol test indicated that increase in the pressure drop through the HEME of less than 8% was achieved with a system inlet concentration of 537 $\mu\text{g}/\text{m}^3$. Based on these results, an estimated average full-scale aerosol concentration of 16.5 $\mu\text{g}/\text{m}^3$, and similar operating conditions (i.e., HEME face velocity of 122 mm/s to 244 mm/s [0.4 to 0.8 ft/sec], and >80% RH), we conclude that the HEME will operate for more than 900 days ((537/16.5)(30 days)) without an appreciable (>15%) increase in the pressure drop. Water spray was effective at washing soluble aerosols from the HEME filter and partially effective at washing insoluble aerosols. Intermittent washing of the HEME filter with a water spray would be beneficial in removing collected aerosol and regenerating the filter, especially during periods of low absolute humidity. A spray flow rate of 10 L/(h·m²) (0.25 gph/ft²) filter surface was effective during testing.

The detailed report of the pilot-plant experiment was published by PNL in December 1989, in time for use by KEH in definitive design of the AWTF ventilation system.

Recirculation Ventilation Concept

Definitive design of the new AWTF ventilation system (Project W-030) was approved to start in 1989. However, changes in the project scope had occurred since the original conceptual design, creating growth in the project cost

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

estimate. The scope changes were related to changes in the Hanford mission, closure of the PUREX spent fuel reprocessing facility, interfaces with other projects, and previously hidden problems in the existing AWTF ventilation system.

A Value Engineering team was assigned to investigate methods of cutting costs. One major outcome of the investigation was the recommendation by KEH that a detailed study of a recirculation ventilation and cooling concept be performed. An engineering report (KEH 1992) comparing three alternative recirculation schemes was completed in 1992. All three schemes resulted in cost savings, mainly from the reduction in size of facilities required to house smaller equipment in a recirculation ventilation system. The report recommended a tank farm ventilation system that incorporated a small central ventilation exhaust system with individual air recirculation loops to cool each tank.

The proposed central ventilation exhaust system was sized for a 190- to 480-L/s (400- to 1000-scfm) flow rate and allowed a minimum ventilation flow of 50 L/s (100 scfm) for each of four tanks for gas dilution and pressure control. The additional 280 L/s (600 scfm) capacity provided operational flexibility for existing airlift circulator (waste mixing) operation or additional inleakage if desired. Each tank ventilation system recirculated and cooled an airflow of 240 L/s (500 scfm).

A major environmental benefit will be realized by using recirculation for cooling in lieu of the once-through system. The total discharge to the environment will be reduced from about 1400 L/s (3000 scfm) to 190 to 480 L/s (400 to 1000 scfm). Recirculation not only reduces the total discharge, but also reduces material collected in the air cleanup train which reduces operational and maintenance costs.

A side benefit of the reduced size exhaust system was to effectively change the pilot plant scale factor from 1/20 to 1/7 scale, thus boosting credibility of the test data.

The project cost for the recirculation ventilation concept was estimated at \$24.6 million. The project cost for the facility incorporating a once-through system was estimated at \$30 million. This considerable cost savings, as well as the environmental advantages, drove the definitive design to incorporate the recirculation ventilation concept.

Environmental Impact

Process flow diagrams were developed by using the pilot plant test results to predict environmental discharge for four different operating scenarios. These operating scenarios resulted from different assumptions about heat generated in the waste tanks and variations in waste composition and from operation with failed cooling systems.

During normal operation (current waste composition, no mechanical waste agitation, and operating cooling systems), the annual radioactive release was calculated to be 18 Ci, of which tritium is more than 99%. By comparison, calculated tritium release from the existing system under the same operating scenario amounts to 840 Ci/yr. This gross reduction in tritium release achieved with the new system depends heavily on reliable operation of the cooling system. It should be noted that failure of the cooling system, or for that matter, continued operation of the existing system, will result in a dose to the public that is less than 1% of the exposure permitted by DOE guidelines.

The TAP and NESHAP applications were approved in 1994, and permission to construct the project was granted by the Washington Department of Health, the Washington Department of Ecology, and the U.S. Environmental Protection Agency.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Conclusion

A unique ventilation system has been developed and constructed at the AWTF at DOE's Hanford Site. The new system includes recirculation ventilation and cooling for each tank in the facility, followed by a central exhaust air clean-up train that includes a low-temperature vapor condenser and an HEME.

The system is capable of reducing the atmospheric release of tritium to only 2% of the existing system capability. The condenser and HEME will reduce loading of the final HEPA filters in the air clean-up train by a factor of 20 for soluble aerosols, and by a factor of 13 for insoluble aerosols. The operating life of the remotely replaceable HEME cartridge is predicted to be approximately three years.

The new ventilation system, along with the support facilities, is scheduled to begin full-time operation in late 1996.

References

- Brouns, T. M., and M. E. Peterson, 1989, "Performance Evaluation of the Pilot-Scale, Double-Shell Tank Ventilation System Using Simulated Aerosol Streams," PNL-7188, Pacific Northwest Laboratory, Richland, Washington.
- KEH 1992, "Tank Farm Recirculation and Ventilation," W030ER, Kaiser Engineers Hanford Company, Richland, Washington.
- Powell, W. J., 1989, "Aging Waste Off-Gas Sampling Status Report," Internal memo 13314-89-032, Westinghouse Hanford Company, Richland, Washington.

DISCUSSION

BELLAMY: The comment I would like to make is that it took me a little while to understand exactly what you meant by HEME. I think, as an industry, we are falling into a very poor habit of using acronyms for everything. Some of the things that we discussed last week at our ASME standards committee meeting were HEMA's versus HEPA's, high efficiency metal filters versus high efficiency particulate filters, and what do these terms really mean. I think you were understood, but it took me a couple of minutes to realize exactly what you were talking about. You will notice that in the summary that we prepare for this Conference for publication in Nuclear Safety there is a very detailed list of acronyms in the beginning. I would just caution all of us to pay attention to explaining acronyms.

WILHELM: At one of the earlier Air Cleaning Conferences, we published results identified as a HEME, a metallic filter with a layer of glass fibers; in this case around twenty microns thick. The real decontamination factor measured was around 3,000 for all the aerosols together.

RICE: I might have forgotten to mention the decontamination factors that we achieved. I should have mentioned that the system of the condenser and the HEME together gave us a decontamination factor of about thirteen for insoluble particles, and about twenty for soluble particles. We really did a pretty good job of relieving the load on the HEPA filters.

CONKLIN: I am with the Washington State Department of Health, and I regulate radioactive air emissions from Hanford. Since you are already below 0.1 millirem per year to the maximally exposed individual, what was the reason to put in this system? I am not sure I caught how efficient it is for tritium. The third question is, do you consider this system cost-effective?

RICE: Yes, it was definitely cost-effective compared to other methods that might be used to reduce tritium. Of course, we are taking advantage of the fact that tritium is basically tritiated water vapor, so we are really just handling water vapor. The concentration off-site is, in fact, quite low and you asked, why did we bother to do this in the first place? I tried to point out that we engaged in this upgrading project for several reasons: one was that we were anticipating adding extra heat to the tanks by operating mixer pumps in order to keep the waste mixed. Other methods of mixing, such as the air lift circulators that are now in those tanks have given us problems. The mixer pump demonstration program will greatly impact the heat load in the tanks. That is a reason for the upgrades, plus the fact that spent fuel intended to be processed in the PUREX plant still remains in storage, and there would be a whole new load of hot fuel that we would have to handle. As it turned out, that fuel probably never will be reprocessed because the PUREX plant has been shut down. However, we do have a cooling system in the tanks that is able to handle extra heat loads. The cooling system also had to meet new codes and standards, plus the Derived Concentration Guides, at the point of release. So you see, our criteria were telling us that it did not matter what the off-site projected dose was; design-wise, we had a problem at the point of release and had to face up to it. It was kind of unrealistic in a way because the off-site impact is so terribly small. Nevertheless, it is just one of many release points at Hanford and you always do the best you can. We felt that using the refrigeration system would be very cost-effective, which it turned out to be. So, we did our job.

CONKLIN: What was the efficiency for tritium?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

RICE: The existing system, under more or less standard operating conditions, releases to the atmosphere 840 curies per year. That is more than 99% of the total radioactivity released from the entire tank farm. The new system, i.e., the recirculation and refrigeration system together, will release 18 curies, a 50:1 reduction.

WEBER: This apparently is the same HEME which was used in the Zone -1 melter offgas test. As you mentioned, it was also used upstream of a HEPA-grade filter, in fact a metallic filter. If you have not already done so you may be interested in speaking with Greg Whyatt at Battelle who did this study, and who documented the performance of the HEME and the downstream HEPA life in that study.

RICE: Yes, I know Greg Whyatt. The work for this project started back in '89. It's been a long time, and there were three different scientists at Battelle that worked on this project.

WEBER: Apparently there is a completed report by Greg and his co-authors which has now been awaiting DOE approval for issue for something like two years.

RICE: Maybe that is a different report. One of my references is a report that was done by Brouns and Peterson. They were the last two individuals that worked on the development of the HEME for this particular project. The HEME that was in the laboratory was, in fact, used for a melter off-gas experiment.

WEBER: That would put it back to Greg.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DEVELOPMENT OF A COMPUTER CODE TO PREDICT A VENTILATION REQUIREMENT FOR AN UNDERGROUND RADIOACTIVE WASTE STORAGE TANK

Young J. Lee
1800 Harrison Street
Oakland, California 94623

Edwin L. Dalpiaz
ICF Kaiser Hanford Company
P O Box 888, MSIN G3-17
Richland, Washington 99352

Abstract

Computer code, WTVFE (Waste Tank Ventilation Flow Evaluation), has been developed to evaluate the ventilation requirement for an underground storage tank for radioactive waste. Heat generated by the radioactive waste and mixing pumps in the tank is removed mainly through the ventilation system. The heat removal process by the ventilation system includes the evaporation of water from the waste and the heat transfer by natural convection from the waste surface. Also, a portion of the heat will be removed through the soil and the air circulating through the gap between the primary and secondary tanks. The heat loss caused by evaporation is modeled based on recent evaporation test results by the Westinghouse Hanford Company using a simulated small scale waste tank. Other heat transfer phenomena are evaluated based on well established conduction and convection heat transfer relationships.

I. Introduction

The ventilation system has been used as the main method of removing heat from the underground tank that stores heat-generating radioactive waste materials on the Hanford Site. The ventilation system can remove a large amount of heat from the waste tank by introducing cold and dry air into the tank vapor space and removing hot and humid air. The ventilation air removes a major portion of the heat from the tank by carrying away water vapor evaporated from the waste surface. Also, the heat is removed from the waste surface to the ventilation air by the natural convection in the vapor space. In addition to the ventilation air, a small portion of the heat will be removed by air circulating between the primary and secondary tanks (annulus flow). The tank will lose heat through the soil if the temperature of the tank is higher than the temperature of the surrounding soil. An evaluation of the required ventilation flow to remove the heat from the waste tank is an important design parameter for the design of a new tank.

Waters⁽¹⁾ developed a simple code to predict the ventilation

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

requirement based on the evaporation rate equation developed by Boelter et al⁽²⁾. In this code, other heat transfer phenomena such as the natural convection have not been evaluated properly. Recently, Crea⁽³⁾ at Westinghouse Hanford Company has performed an experiment measuring the evaporation rate from a 12-ft (3.66-m) diameter simulated waste tank to improve the Boelter equation. Based on these experimental results, computer code WTVFE has been developed to predict the ventilation flow conditions for a waste tank containing heat-generating elements. Also, other heat transfer phenomena have been properly treated in this new code.

II. Description of Analysis Methods

This section discusses the analysis methods used in code WTVFE for various heat removal modes such as evaporation, natural convection, conduction through the soil, and heat removal by the annulus flow. The analysis methods are based on steady-state conditions with well mixed waste.

1. Evaluation of Evaporation Rate from the Waste

Since water has a large latent heat, a small amount of water evaporation from the waste into the ventilation system will remove a significant amount of the heat from the tank. The water vapor pressure in the ventilation outlet depends on the equilibrium between the amount of water vapor transferred from the waste surface to the bulk air space above the waste and the amount of vapor taken away by the ventilation system. In this evaluation, it is assumed that the bulk air inside the tank is well-mixed and that the outlet condition of the ventilation air is the same as that of the bulk air inside of the tank. Boelter et al⁽²⁾ have developed the following equation to predict the amount of the water vapor transferred from the pure water surface to the bulk air based on the experimental data.

$$W = 0.00129A(P_i - P_b)^{1.22} \quad (1)$$

where:

- W -- amount of water vapor transferred (lb/hr)
- A -- surface area (ft²)
- P_i -- waste surface water vapor pressure (mm Hg)
- P_b -- bulk phase water vapor pressure (mm Hg)

The validity of applying the Boelter equation to a large tank has been questioned, since Boelter et al developed the empirical equation based on experimental data using a small pan. To confirm the Boelter equation for a large tank like the radioactive storage tanks at Hanford, an experiment was performed by Westinghouse Hanford Company⁽³⁾ to measure the evaporation rate from a 12-ft (3.66-m) diameter tank. The comparison between the experimental results and the predictions by the Boelter equation shows that the predictions by the Boelter equation are an average of 2.9% lower than the experimental data. In the code,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Boelter's equation has been used for the calculation of the evaporation rate with this adjustment. Table 1 summarizes the comparisons between the experimental data and the predictions by the original and improved Boelter's equation.

Table 1 Comparison between Westinghouse Experimental Data and Predictions for Water Loss.

Test Run No	Experimental Data (lb/hr*ft ²)	Prediction Boelter (lb/hr*ft ²)	Error (%)	Prediction Modified (lb/hr*ft ²)	Error (%)
1	1.2	1.19	-0.8	1.23	2.5
2	14.75	15.13	2.6	15.5	5.1
3	29.03	25.38	-12.6	25.9	-10.8
4	12.73	12.47	-2.0	12.79	0.5
5	23.98	22.86	-4.7	23.35	-2.6
7	30.25	27.16	-10.2	27.69	-8.5
6	9.78	8.92	-8.8	9.14	-6.5
8	23.96	21.9	-8.6	22.39	-6.6
11	25.79	22.06	-14.5	22.54	-12.6
12	3.52	2.98	-15.3	3.05	-13.4
10-10R	8.71	8.5	-2.4	8.71	0.0
17	2.58	2.74	6.2	2.81	8.9
20	12.66	13.39	5.8	13.68	8.1
5R	23.43	23.8	1.6	24.3	3.7
6R	8.48	9.02	6.4	9.25	9.1
9	14.57	16.0	9.8	16.37	12.4
21	4.92	4.55	-7.5	4.67	-5.1
13	0.71	0.69	-2.8	0.72	1.4
22	1.53	1.44	-5.9	1.49	-2.6

The inlet flow rate of the ventilation air required to remove the water vapor transferred from the waste surface shown in equation (1) is equal to:

$$V_a = \left(\frac{760}{60\rho(760-P_n)} \right) \left(\frac{1.6W}{\frac{P_b}{(760-P_b)} - \frac{P_n}{(760-P_n)}} \right) \quad (2)$$

where:

- V_a -- inlet ventilation air flow rate (SCFM)
- P_n -- inlet air water vapor pressure (mm Hg)
- ρ -- air density (lb/ft³)

Since the waste contains chemicals, the vapor pressure is lower than pure water. The code has an arrangement to input the factor representing the vapor pressure suppression due to chemicals in the waste.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

2. Evaluation of Ventilation Exit Air Temperature

The ventilation air removes heat from the waste by increasing the air temperature while the air is passing through the tank. To evaluate this method of heat removal, the temperature of the ventilation exit air has to be evaluated accurately. As stated previously, the exit conditions of the ventilation air is assumed to be the same as that of the bulk air inside of the tank. The temperature of the ventilation exit air is dependent on the heat transfer rate from the waste surface to the bulk air space above the waste and the ventilation air flow rate. The heat is transferred to the bulk air from the waste surface by the natural convection caused by the density difference between the bulk phase and the interface at the waste. This density difference is caused by the temperature and water vapor pressure differences.

The relationships between the Nusselt number (Nu) and the Rayleigh number (Ra) have been established for laminar and turbulent natural convection⁽⁴⁾. The heat transfer coefficient from the waste surface to the bulk phase can be calculated from these relationships. The Nu and Ra numbers are defined as

$$Nu = \frac{h}{Lk} \quad (3)$$

where:

- h -- heat transfer coefficient (Btu/hr*F*ft²)
- k -- conductivity (Btu/hr*F*ft)
- L -- characteristic length (ft)

$$Ra = \frac{g\Delta\rho L^3 \rho_f C_{p_f}}{\mu_f k_f} \quad (4)$$

where:

- g -- acceleration of gravity (ft/hr²)
- $\Delta\rho$ -- density gradient $(=\rho_b - \rho_i) / \rho_i$
- C_p -- specific heat (Btu/lb*F)
- μ -- viscosity (lb/ft*hr)
- subscript i -- interface
- b -- bulk phase
- f -- film

The relationship between the Nu and Ra number for the laminar natural convection ($Ra < 10^8$) is

$$Nu = 0.56Ra^{1/4} \quad (5)$$

and the relationship for the turbulent natural convection ($Ra > 10^8$) is

$$Nu = 0.13Ra^{1/3} \quad (6)$$

The exit temperature of the ventilation air can be evaluated from

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

the energy balance equation using the heat transfer coefficient obtained by either equation (5) or (6).

$$60V_a \rho C_{p_a} (T_b - T_n) + Cl = 1.5hA(T_i - T_b) + (C_{p_s}W + C_{p_a}W_{1c})(T_i - T_b) \quad (7)$$

where:

T -- temperature (F)
 Cl -- heat loss through soil (Btu/hr)
 W_{1c} -- air flow rate through air lift circulation (lb/hr)
 subscript n -- inlet
 a -- air
 s -- water vapor

The heat transfer surface, A in equation (7), is increased by 50% to account for the side wall of the tank above the waste. This surface increase minimizes the exit temperature differences between predicted values and experimental data.

Also, the code prediction for the exit temperature of ventilation air has been compared to the Westinghouse experimental data⁽³⁾. The results show that the predicted values are an average 1.2% lower than experimental ones. This difference has been factored into the code. In this comparison, a few experimental data have been disregarded since its values are so obviously erroneous. Table 2 summarizes the

Table 2. Comparison between Westinghouse Experimental Data and Predictions for Exit Air Temperature

Test Run No	Experimental Data (F)	Prediction Theory (F)	Error (%)	Prediction Modified (F)	Error (%)
1	98.8	96.0	-2.8	96.8	-2.0
2	170.1	166.8	-1.9	167.5	-1.5
3	154.4	149.0	-3.5	149.8	-3.0
4	171.7	168.4	-1.9	169.0	-1.6
5	167.2	168.8	1.0	170.4	1.9
7	163.6	159.3	-2.6	160.9	-1.7
6*	167.3	180.6	-	182.3	-
8*	172.2	182.4	-	184.2	-
11	172.2	168.6	-2.1	170.3	-1.1
12	126.2	123.0	-2.5	124.1	-1.7
10-10R	155.3	154.7	-0.4	156.1	0.5
17	141.1	143.5	1.7	144.8	2.6
20	154.2	147.8	-4.2	149.2	-3.2
5R	170.9	169.5	-0.8	171.2	0.2
6R	174.3	182.2	4.5	183.9	5.5
9*	155.3	172.6	-	174.3	-
21	140.1	138.9	-0.9	140.1	0.0
13	95.6	91.8	-4.0	92.6	-3.1
22	127.4	129.0	1.3	130.1	2.1

* These runs are not used for the comparison.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

comparisons between the experimental data and the predictions by the original and improved code calculations. If the exit water vapor pressure calculated in the previous section is higher than the saturation vapor pressure at the exit air temperature calculated in this section, the code will evaluate the exit air temperature where the exit vapor pressure matches with the saturation pressure. In this calculation, it is assumed that the heat that increases the exit air temperature to the saturation temperature comes from the condensation of the water vapor.

3. Evaluation of Heat Loss through the Soil

Since the waste tanks on the Hanford Site are underground, heat loss from the tanks to the soil will occur when the waste temperature is higher than that of the surrounding soil. Because the surrounding soil has a large heat capacity and the amount of heat generated by the waste in the tank is relatively small, it will take a long time to reach a steady state during the operation. In the code, it is assumed that there is a water table with a constant temperature of 55°F (12.8°C) below 200-ft (60.96-m) from the tank bottom and the surrounding soil has reached the steady state temperature as suggested in the thermal analyses of the MWF (Multi-Function Waste Tank Facility) design⁽⁵⁾. Also, there is a steady state heat loss through the soil covering the top of the tank to the outside air.

A simplified model developed for a disc heat source stored in the infinite medium⁽⁶⁾ was used as the basis for the calculation of heat loss from the tank through the soil to the water table. The tank is assumed to be a disk, since the tank height is small compared with the distance from the tank to the water table and the upper portion of tank will lose heat to the outside air. Furthermore, the pads installed under the tank bottom, such as the concrete and insulating pads with annulus air distribution channels, are ignored since the conduction resistance through 200-ft (60.96-m) of soil is dominant compared with the resistance through these pads.

$$Q_{cb} = \left(\frac{4.45D}{1 - \frac{D}{1-5.67z}} \right) k_z (T_t - T_w) \quad (8)$$

where:

Q_{cb} -- heat loss to water table (Btu/hr)
 D -- tank diameter (ft)
 z -- distance from tank bottom to water table (ft)
subscript t -- tank
 w -- water table
 z -- soil

The conductivity of the soil is estimated to be 0.35 Btu/F*hr*ft (0.606 W/m*K) in the code⁽⁵⁾.

The heat loss from the top of the tank to the outside air was evaluated assuming that the top surface of the tank is a flat circle and the heat transfer path in the soil is limited to the cylindrical

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

area above the tank. This is an acceptable approach since the depth from the ground surface to the tank is not generally deep. Also, a factor is assigned to adjust possible error due to this simplification as shown in the following equation.

$$Q_{ct} = F\pi D^2 \frac{1}{h_a + \frac{d_s}{k_s} + \frac{d_c}{k_c}} \quad (9)$$

where:

- Q_{ct} -- heat loss to outside air (Btu/lb)
- F -- factor to adjust the error
- d -- Thickness (ft)
- subscript c -- concrete

The heat transfer coefficient from the ground to the air is assigned to be 0.5 Btu/F*hr*ft² (2.837 W/m²*K) and the conductivity of the concrete to be 0.6 Btu/F*hr*ft (1.038 W/m*K) in the code.

If the tank top surface is not flat, it is recommended to use the average depth based on the area. The factor assigned to accommodate any possible error was determined to be 1.12 comparing the code predictions with the calculation results using a sophisticated finite element code⁽⁷⁾ for the design of the MWTF tank⁽⁵⁾. The comparisons between the finite element code calculations and the predictions with and without a factor by equation (9) are summarized in Table 3. Since the factor in equation (9) was determined based on the comparison to the analysis data for only the MWTF design, a large amount of error is possible in applying this factor to other configurations. However, an error in the conduction loss calculation will not significantly affect the evaluation of the ventilation flow rate in most cases since the conduction loss through the soil is very small compared with the other losses.

Table 3. Comparison between Finite Element Calculations and Predictions for Heat Loss through Soil

Waste Temperature (F)	Out side Air Temperature (F)	Finite Element Prediction (Btu/hr)	The Code Prediction (Btu/hr)	Error (%)
187	77	33000	31166	-5.6
118	77	12000	13539	12.8
109	77	10000	10963	9.6
104	77	9000	9757	8.4
98	77	7000	8136	16.2
93	53	12000	10267	-14.4
88	53	9000	8771	-2.5
69	53	4000	3928	-1.8
64	53	3000	2577	-14.1

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

4. Evaluation of Heat Loss to Annulus Air Flow

Most of the waste tanks designed to store radioactive nuclear waste have a secondary containment. Air is circulated through the gap between the primary tank and the secondary tank in to detect any radioactive waste leak from the primary tank. This circulating air is called the annulus air flow and removes heat from the tank. The overall heat transfer coefficient from the waste to the annulus air flow consists of the resistance in the waste side, tank wall, and air side heat transfer coefficients. An arbitrarily high heat transfer coefficient of 10 Btu/F*hr*ft² (56.74 W/m²*K) has been assigned for the waste side since the waste is assumed to be well mixed.

For the air side, the heat transfer coefficient⁽⁸⁾ based on natural convection was used when the air flow was not turbulent (Reynolds number is less than 10⁴).

$$h_a = 0.19 (\Delta T)^{1/3} \quad (10)$$

where:

ΔT -- Temperature difference (F)

Since the temperature difference is not uniform (large at the bottom of the tank and small at the top of the tank), the logarithmic mean temperature difference is used for the calculation. When the air flow is turbulent, the heat transfer coefficient is evaluated based on forced convection⁽⁹⁾.

$$h_a = 0.023 Re^{0.8} Pr^{0.4} k_a / G_p \quad (11)$$

where:

Re -- Reynolds number
Pr -- Prandtl number
Gp -- gap distance (ft)

In this equation, properties of the air are evaluated at 100°F (37.8°C).

For the overall heat transfer calculation, it is assumed that air is uniformly distributed throughout the annulus and that 30% of the tank bottom area is in contact with the annulus air. When the annulus air temperature is higher than waste temperature, it is assumed in the code that there is no heat transfer between the annulus air and the waste.

5. Consideration on Air Lift Circulation Air

Some of the radioactive waste storage tanks on the Hanford Site have an air lift circulation system to mix the waste during storage. In the air lift circulation system, air is introduced into the waste and passes through it as bubbles. Since air from the air lift circulation system is introduced into the waste, it is assumed in the code that the air temperature leaving the waste is the same as the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

waste temperature and that the water vapor pressure in the air is the same as the saturation vapor pressure for the waste at the surface. When air from the air lift circulation system mixes with the ventilation air, proper material and energy balance equations are solved to account for the high air temperature and vapor pressure from the air lift circulation system.

III. Description of Computer Code

This section presents a brief description of computer code WTVFE. The code is written in Q-Basic language and a detailed description on how to use the code is in the user's manual section of reference 10.

The code requires the ventilation air inlet conditions, the annulus flow rate, tank geometry and the vapor suppression factor for the waste as input data. Also, it requires the waste temperature and the heat generation rate as input data. First, the code calculates the heat removal rate by the conduction through the soil and annulus air flow. Then, it calculates the amount of water to be vaporized in order to remove the rest of the heat, assuming that heat removal due to the ventilation air temperature rise is negligible. The required vaporization rate is converted to the required ventilation flow rate using equation (2). Based on the required ventilation flow rate and the outlet temperature to be calculated later, heat removal by the ventilation air temperature rise will be calculated and the required ventilation flow rate recalculated. This iteration continues until the previous value of the ventilation flow rate matches the recalculated value within 0.5% of error.

After the iteration of the ventilation flow rate, the iteration of the ventilation air exit temperature will be performed. First, the temperature of the exit air is assumed to be 20°F (11°C) lower than the waste temperature. Using this assumed exit temperature, the Ra number and heat transfer coefficient are calculated. Then, the temperature of the exit air is calculated using equation (7). If the difference between the calculated temperature and the assumed temperature of the exit air is larger than 0.05°F (0.03°C), the exit temperature will be reassigned based on the previously assumed and calculated values. This iteration continues until the difference becomes less than 0.05°F (0.03°C).

After the exit air temperature is converged properly, the code will return to the iteration of ventilation air flow rate again with the newly calculated exit air temperature. Iteration of the ventilation air flow rate and exit air temperature will be repeated until the differences between the previous values and the recalculated values of both variables are within the desired limits.

IV. Conclusions

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Computer code, WTVFE, has been developed successfully to predict the requirement of the ventilation air flow rate for an underground storage tank for heat-generating radioactive materials.

Acknowledgment

This work was performed under the auspices of the U.S. Department of Energy by ICF Kaiser Hanford Company under contract number DE-AC06-87RL-10900.

References

1. Waters, E. D., "Analysis of Tank Bump Potential During In-Tank Washing Operations Proposed for the 241-AZ Tanks," Westinghouse Hanford Co., WHC-SD-WM-ER-114, Rev. 0, June 21, 1991.
2. Boelter, L. M. K., et. al., "Free Evaporation into Air of Water from a Horizontal Quiet Surface," Ind. and Eng. Chem., Vol 38, p596, 1946.
3. Crea, B. A., "Results from Evaporation Tests to Support the MWTF Heat Removal System Design," Westinghouse Hanford Co., WHC-SD-W236A-ER-009, Rev. 0, Nov. 23, 1994.
4. ASHRAE Handbook, 1993 Fundamentals, p 3.12, ASHRAE, New York, 1993.
5. Cramer, E. R., "Multi-Function Waste Tank Facility Thermal Hydraulic Analysis for Title II Design," Westinghouse Hanford Co., WHC-SD-W236A-ER-010, October, 1994.
6. Kreith, F., "Principles of Heat Transfer," 2nd Ed., p 90, International Text Book, 1954.
7. PATRAN 1991, "P/Thermal User Manual Release 2.5," PDE Engineering, Costa Mesa, CA, 1991.
8. McAdams, W. H., "Heat transmission," 3rd Ed., p 177, McGraw- Hill, 1954.
9. *ibid*, p219.
10. Lee, Y. J. and E. L. Dalpiaz, "Theoretical and Users Manual for the Computer Code WTVFE", ICF Kaiser Engineers Inc., April, 1995.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

BERGMAN: We heard this morning from Louis Kovach about potential accidents in some of the tank farms, e.g., explosions, filter burstings, things like that. Can you tell us something from your experience that you have actually observed; cracks, things of that nature?

DALPIAZ: No, I don't have any actual experiences I could use to answer your question.

PORCO: I will address this to speakers from Hanford. Based on your experience with tank farm ventilation, what do you see as the biggest need for product development? I guess the best way to phrase it is, is there a lack in the industry for a product that would serve your needs or assist you in treatment? Is everything that you need available in the market today?

RICE: The thing that comes to my mind right away as the biggest concern at Hanford, is flammable gas issues. Control of particulates is really not a problem and has never been a problem as far as I know. Sometimes the filters have a rough life and they may need rapid change-out, but they have never really been a big deal. But now the flammable gas issue is the real problem. What we are faced with are tanks that generate flammable gases in the waste that can build a pressure under the crust and then suddenly overturn the contents and make a large release to the environment. There have been occasions of this occurring. There is one tank in particular that has equipment in it, a mixer pump, to prevent gas build up by keeping the contents agitated. This prevents episodic releases of gas, by allowing continuous average releases. In the paper I presented we discussed a cleanable mist eliminator that is taking out particles. We may find out that it loads up quickly or that there is some problem with washing it. That is why we studied the prototype. We hope, based on the prototype test, that it will turn out to be okay.

BERGMAN: I forgot the exact details, but Russia had some tanks out by the Urals that had minor mishaps. And I think they had, as a consequence, several hundred miles of uninhabitable area. I am sure this is well known to your people. I was not quite satisfied with your response to my earlier question as we have an inconsistency between what Louis Kovach said this morning and what you are saying. And I would like to find out who is telling the truth.

BELLAMY: I think Dr. Kovach was indicating a little different opinion this morning. You are welcome to comment further if you want. I don't think it's a question of who is telling the truth and I do not think we should go further with that thought. The way I interpreted Mr. Porco's question was that, as a representative of the industry, if there is some piece of equipment that would help to control radioactive releases from the Hanford facility, please speak up and maybe we can take care of it. The answer I heard was that, there really is nothing that would basically solve all our problems.

RICE: I think there is really a lot to the idea that the codes and standards that we are forced to use in the processing industry are related to the nuclear power plant industry. They really do not line up very well with the real problems that we are trying to solve. We have been getting by, but if there were a set of codes and standards designed for processing and reprocessing, maybe some new equipment would come out to meet those codes. But right now, we have only N-509 and we build HEPA filter systems to that standard.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TESTING CLEANABLE/REUSABLE HEPA PREFILTERS FOR MIXED WASTE INCINERATOR AIR POLLUTION CONTROL SYSTEMS

D. B. Burns, A. Wong, B. W. Walker, and J. D. Paul
Westinghouse Savannah River Company
Savannah River Technology Center
Aiken, SC 29808

Abstract


The Consolidated Incineration Facility (CIF) at the US Department of Energy (DOE) Savannah River Site is currently undergoing preoperational testing. The CIF is designed to treat solid and liquid RCRA hazardous and mixed wastes generated by site operations and clean-up activities. The technologies selected for use in the CIF air pollution control system (APCS) were based on reviews of existing commercial and DOE incinerators, on-site air pollution control experience, and recommendations from contracted consultants. This approach resulted in a unique facility design utilizing experience gained from other operating hazardous/radioactive incinerators. In order to study the CIF APCS prior to operation, a 1/10 scale pilot facility, known as the Offgas Components Test Facility (OCTF) was constructed by the Savannah River Technology Center and has been in operation since late 1994. Its current mission is to demonstrate the design integrity of the CIF APCS and optimize equipment/instrument performance of the full scale production facility. Operation of this on-site pilot facility has provided long-term performance data of integrated systems and critical facility components. This effort has reduced facility start-up problems and helped to insure compliance with all facility performance requirements. In today's environment of increased public participation and awareness, technical support programs of this type assist in assuring all stakeholders the CIF can properly treat combustible hazardous, mixed, and low-level radioactive wastes.

Due to the nature of the wastes to be incinerated at the CIF, High Efficiency Particulate Air (HEPA) filters are used to remove hazardous and radioactive particulates from the exhaust gas stream before being released into the atmosphere. The HEPA filter change-out frequency has been a potential issue and was the first technical issue to be studied at the OCTF. Tests were conducted to evaluate the performance of HEPA filters under different operating conditions. These tests included evaluating the impact on HEPA life of scrubber operating parameters and the type of HEPA prefilter used. This pilot-scale testing demonstrated satisfactory HEPA filter life when using cleanable metal prefilters and high flows of steam and water in the offgas scrubber.

I. Introduction

The Consolidated Incineration Facility (CIF), located at the Savannah River Site, is currently undergoing preoperational testing to treat solid and liquid RCRA hazardous and mixed wastes generated by site operations and clean-up activities. In this facility, waste thermal treatment is performed in a 13 million Btu rotary kiln incinerator and 5 million Btu secondary combustion chamber. The facility air pollution control system (APCS) consists of a recirculating liquid quench and steam-atomized scrubber for offgas cooling and cleaning, a cyclone separator and mist eliminator for liquid/gas separation, and final HEPA filtration prior to atmospheric discharge through the facility stack. A process flow diagram for the CIF is shown in Figure 1.

Figure 1
CIF Process Flow Diagram

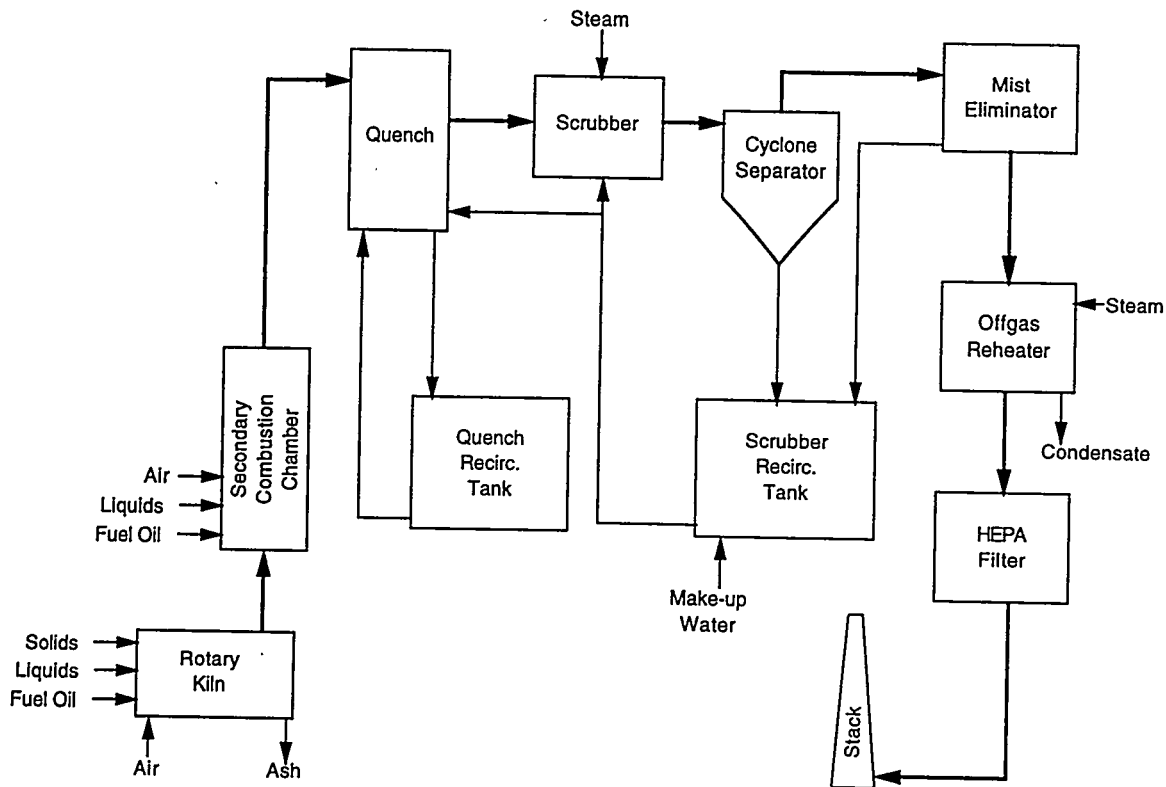

The technologies selected for use in the CIF were based on reviews of existing commercial and DOE incinerators, on-site air pollution control experience, and recommendations from contracted consultants. This approach resulted in a unique facility design utilizing experience gained from other operating hazardous/radioactive incinerators. The Savannah River Technology Center (SRTC) designed, installed, and operated a 1/10 scale pilot facility, known as the Offgas Components Test Facility (OCTF), to demonstrate the design integrity of the CIF APCS and optimize the equipment/instrument performance in the full scale waste treatment facility. Operation of this on-site pilot facility has provided long-term performance data of integrated systems and critical facility components. This effort has reduced facility start-up problems and helped to insure compliance with all facility performance requirements.


II. OCTF Design and Capabilities

The OCTF is a pilot-scale air pollution control system, currently configured to test the design of the CIF APCS. A schematic of the OCTF is shown in Figure 2. Hot offgas is produced in a three million Btu burner chamber. Particulate and HCl gas are metered into the gas stream to simulate particulate carry-over and acid gas produced during incineration of typical hazardous wastes. The offgas is cooled in a co-current recirculating water quench before entering a high efficiency steam-atomized scrubber. The scrubber removes particulates and neutralizes acid gases. The scrubbed offgas enters a cyclone separator where liquid and solid particulates are removed from the gas stream. After exiting the cyclone, the offgas enters a mist eliminator to remove any residual liquid droplets. A reheater upstream of the HEPA filters prevents

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

condensation in the filter housing. The filtered offgas is discharged to the atmosphere through the facility stack.

Figure 2
OCTF Process Flow Diagram

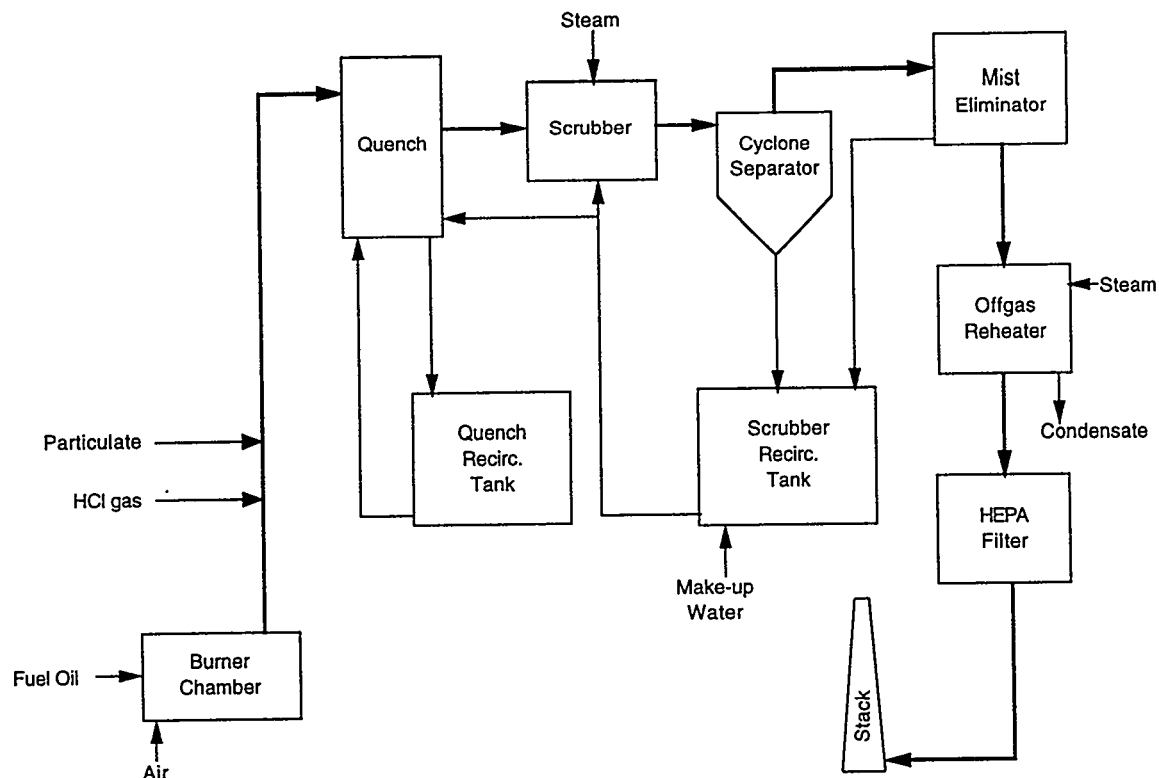

The OCTF is designed to evaluate operational parameters of air pollution control system designs. The OCTF utilizes a modular design which allows replacement/addition of existing unit operations with other technologies that could be tested in the future. The current configuration of the OCTF is a 1/10 scale mock-up of the CIF APCS. Individual equipment components and instruments currently installed were designed and fabricated by the same vendors selected for the CIF. The performance of all CIF APCS components were evaluated as a function of system operating parameters at the OCTF. In addition to obtaining valuable performance data, the OCTF is a useful tool for training operators and maintenance personnel.

III. OCTF Filter Testing

The first test series at the OCTF investigated process parameters that impact system HEPA filter and prefilter life. The APCS must be operated in such a manner to provide acceptable HEPA filter and prefilter life (> 30 days). Short filter life significantly increases facility operating costs associated with procuring, replacing (or cleaning), and disposing system filters. The filter housings used both at the CIF and the OCTF contain 24" x 24" x 11.5" disposable fiber HEPA filters. Upstream of the HEPA filters are 24" x 24" x 6" prefilters. The primary objective of these tests was to determine the APCS operating parameters that are required to meet the goal of 30-day HEPA filter and prefilter life.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Test Plan

This test consisted of six runs. The test facility was operated in a mode that simulated the average design operating conditions of the CIF. The gas temperature exiting the burner chamber was held at approximately 1026°C. The gas flow through the HEPA housing was maintained at approximately 2100 ACFM (700 ACFM/HEPA filter). The offgas temperature passing through the HEPA housing was maintained above 115°C to prevent water condensation. The concentration of salt (NaCl) in the quench recirculating stream was held constant during each run. Salt concentrations in the scrubber solution were maintained below 0.1 wt% due to inflow of makeup water. The operating parameters that were investigated in this test included:

- Type of HEPA prefilter
- Mass ratio of scrubber steam to offgas (α)
- Mass ratio of scrubber water to offgas (β)
- Salt concentration in the quench liquid

Two types of HEPA prefilters were tested. The first was a Flanders paper prefilter (model # T-00K-C-04-00-NL-12-00-E0281, 60-65% @ 1000 cfm). The second prefilter was an Otto York 304 stainless steel prefilter sized to remove 99% of all particles greater than 5 μ m in diameter. The Flanders prefilter is a disposable filter, while the Otto York prefilter was cleaned with water after each test and reused.

The test matrix for this program is shown in Table 1.

Table 1 Test Matrix

Run #	Steam/Offgas (α)	Water/Offgas (β)	Quench Salt (wt %)	Prefilter Type
1	0.22	0.5	10	Paper
2	0.22	0.5	5	Paper
3	0.43	1.0	10	304 SS
6	0.26	1.0	10	304 SS
7	0.26	1.0	10	Paper
8	0.26	0.5	10	304 SS

Discussion

The results of all HEPA life test runs are summarized in Table 2. New (or cleaned) prefilters and HEPA filters were installed in the test facility prior to beginning each run. The scrubber operating conditions were maintained at the settings given in the Table 2. Each run ended after sufficient filter pressure drop vs. time data was collected. The actual prefilter and HEPA filter pressure drop observations at the conclusion of each run is listed in Table 2.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 2 HEPA LIFE TESTS RESULTS SUMMARY

	Run #					
	1	2	3	6	7	8
Steam Alpha	0.22	0.22	0.43	0.26	0.26	0.26
Water Beta	0.5##	0.5	1.0	1.0	1.0	0.5
Prefilter Type	Paper	Paper	304 SS	304 SS	Paper	304 SS
Quench Salt Concentration	10 wt%	5 wt%	10 wt%	10 wt%	10 wt%	10 wt%
Observed Prefilter dP	3.50" after 40 hrs	2.20" after 110 hrs	1.20" after 415 hrs	1.15" after 375 hrs	3.25" after 215 hrs	0.85" after 475 hrs
Observed HEPA dP	0.40" after 40 hrs	0.35" after 110 hrs	0.85" after 415 hrs	3.00" after 375 hrs	0.40" after 215 hrs	2.80" after 475 hrs
Projected Prefilter Life*	2 days	10 days	42 days	30 days	10 days	68 days
Projected HEPA Life**	#	#	37 days	18 days	#	27 days

* Projected Prefilter Life estimates are derived by extrapolating a third order polynomial function fit to observed data. For paper prefilters, the maximum dP permitted is 4". For cleanable metal prefilters, the maximum dP is 10"

** Projected HEPA life estimates are derived by extrapolating a third order polynomial function fit to observed data. The maximum dP for HEPA filters is 4".

Insufficient data to fit a valid a third order polynomial model.

Partial plugging of scrubber water nozzles during this run is expected to have contributed to poor scrubber performance.

A mathematical model was fitted to the prefilter and HEPA filter pressure drop (dP) vs. time data. The model that consistently showed the best data fit (in particular for the data sets showing a filter at the maximum useful dP) was a third order polynomial relating the dependent variable (dP) to the independent variable (time). Using this model, filter life expectancies were extrapolated for runs ending prior to reaching the maximum allowable dP. For the disposable Flanders prefilters and HEPA filters, this value was assumed to be 4" water. If filter dP was allowed to exceed this value, filter breakthrough was often observed. For the cleanable metal prefilters, the maximum dP was assumed to be 10" water. These filter life predictions are included in the last two lines of Table 2.

Acceptable filter performance was obtained only when using the cleanable metal prefilters. The maximum observed disposable prefilter life was 10 days under all conditions tested. Under similar conditions, prefilter life was extended approximately 3X when using the metal prefilters. It should be noted that use of the disposable paper prefilters always resulted in plugging and changing of the prefilter before any significant dP increase occurred on the HEPA filter. This explains the inability to predict HEPA life for these runs (1, 2, 7). Insufficient data was available for the HEPA dP profile because the prefilter would plug too rapidly. Yet, use of the metal cleanable prefilter often resulted in plugging of the HEPA filter before the dP limit for the prefilter was obtained. Thus, the data tends to indicate the cleanable prefilter allows a greater fraction of particulate through to the HEPA filter. Yet, this more even distribution of particulate between the prefilter and HEPA filter permits a significantly longer time interval between filter (either prefilter or HEPA filter) changeout or cleaning.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The runs which utilized cleanable HEPA filters were #3, 6, and 8. During these runs, the steam/offgas flow ratio was varied between 0.43 and 0.26. Also, the scrubber water/offgas flow ratio was varied between 1.0 and 0.5. The theoretical best conditions are at higher steam and water flowrates (Run 3). Figures 3 and 4 contain the graphs of prefilter (Fig 3) and HEPA filter (Fig 4) dP vs. time. Also on the plots are the projected performance curves predicted by the third order polynomial model. For this run, it can be seen that the actual data does not cover a significant fraction of the model, particularly where the slope begins increasing. It is likely that the model being used for these conditions is a "worst case" projection. Thus, there is a relatively high probability that actual filter life would be at least what is predicted for this case (and possibly greater).

Figure 3 Run 3 Prefilter Performance


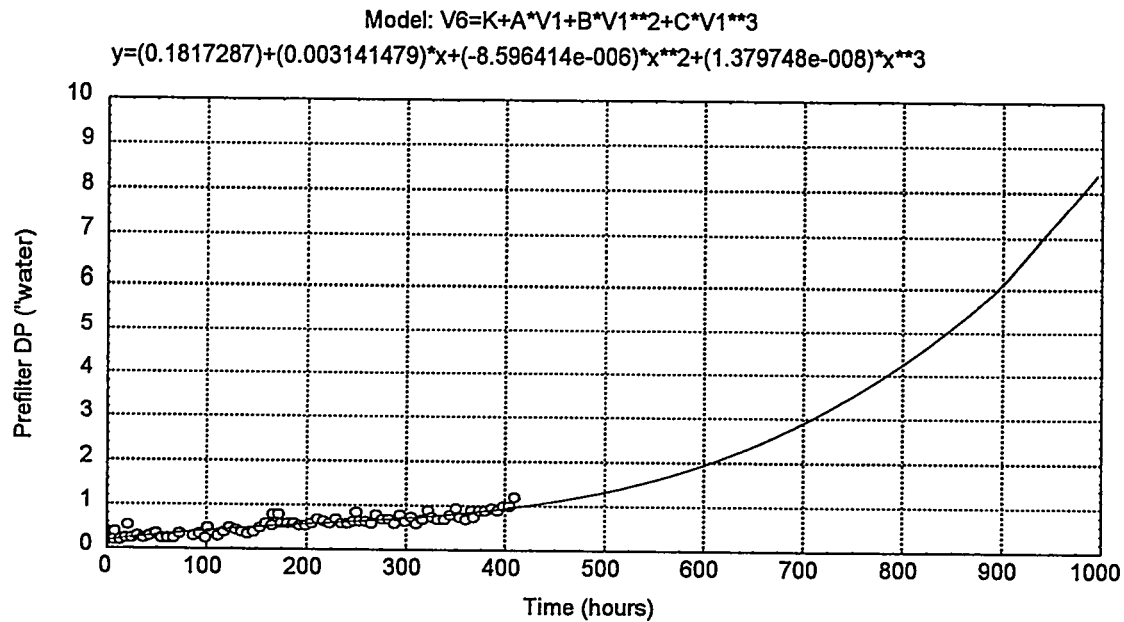


Figure 4 Run 3 HEPA Filter Performance

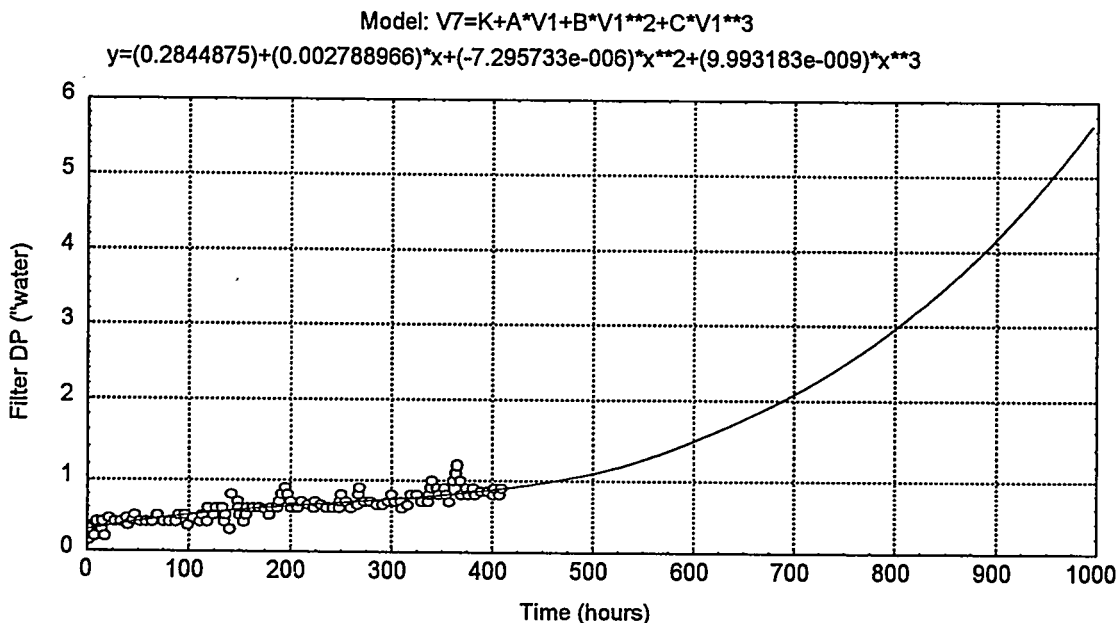

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE


The second best performance was observed in Run 8, when the steam and water flows were both low. This is due to the fact that proper scrubber performance requires the ratio between the scrubber water flow to scrubber steam flow equal two (# water / # steam = 2). If the ratio is too high, the majority of the steam is used to atomize the water and there is insufficient steam for turbulence and pulling offgas through the scrubber. While a low ratio results in insufficient water to properly scrub the offgas. This explains the relatively poor performance in Run 6 (water / steam ratio = 3.8).

Figures 5 and 6 contain the graphs of prefilter (Fig 5) and HEPA filter (Fig 6) dP vs. time for the second best run, Run 8. For this run, it can be seen that the actual data covers enough of the model (especially for the HEPA filter), to consider the projected HEPA filter life a likely estimate. Thus, it is probable that the projected HEPA life of 27 days is an accurate estimate, not a "worst-case" estimate as in Run 3

Figure 5 Run 8 Prefilter Performance

$$\text{Model: } V13=K+A*V1+B*V1**2+C*V1**3$$

$$y=(0.1525723)+(0.001824109)*x+(-3.208998e-006)*x**2+(3.36416e-009)*x**3$$

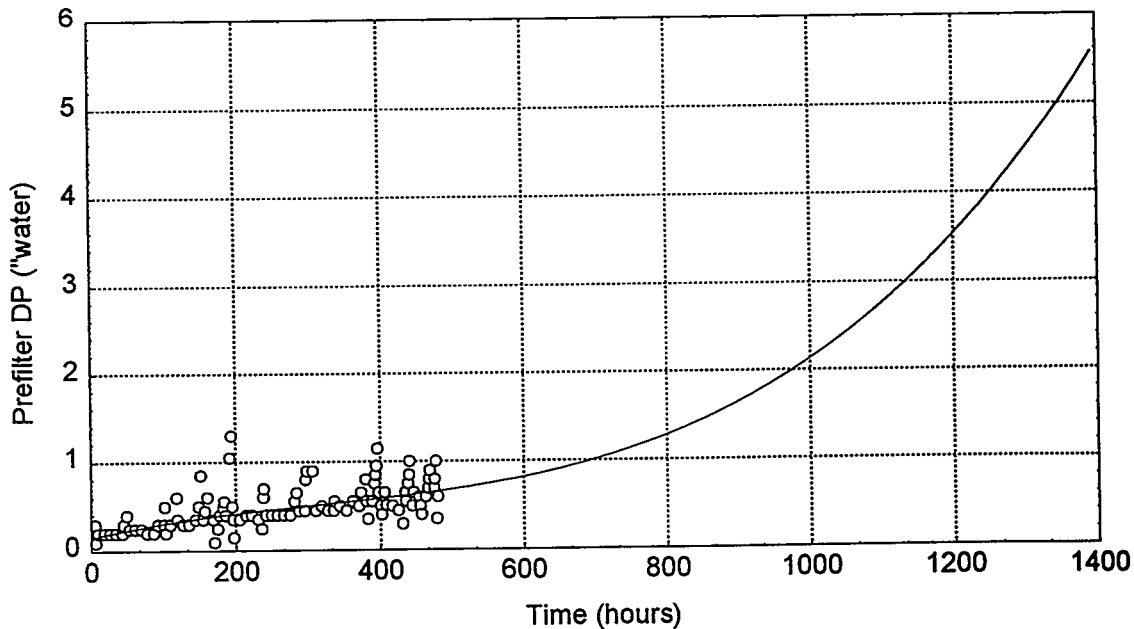

The particulate size distribution data obtained during these tests indicated that increasing the flow of steam to the scrubber decreased the fraction of large particulates (> 10 μm). This can be seen by comparing the size distribution plot for runs 6 and 3 (Figures 7 and 8). The only difference between these runs is the mass flow of steam. The steam flow was low (0.26 alpha) in Run 6 (Fig 7), and high (0.43 alpha) in Run 3 (Fig 8). This change in the particulate size distribution resulted in increased filter life at the higher steam flow (and a water/steam ratio closer to 2).

Figure 6 Run 8 HEPA Filter Performance

Model: $V12=K+A*V1+B*V1^{**2}+C*V1^{**3}$

$$y=(0.5212461)+(0.0009766396)*x+(9.477834e-006)*x^{**2}+(-4.058634e-009)*x^{**3}$$

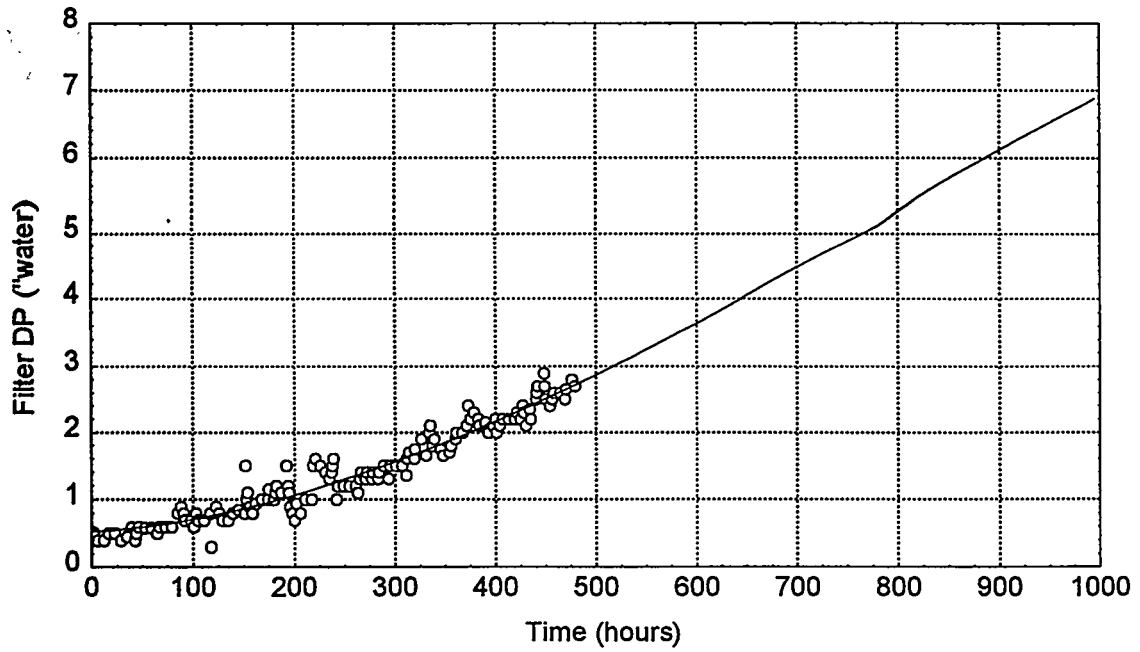


Figure 7 Run 6 Offgas Particulate Size Distribution


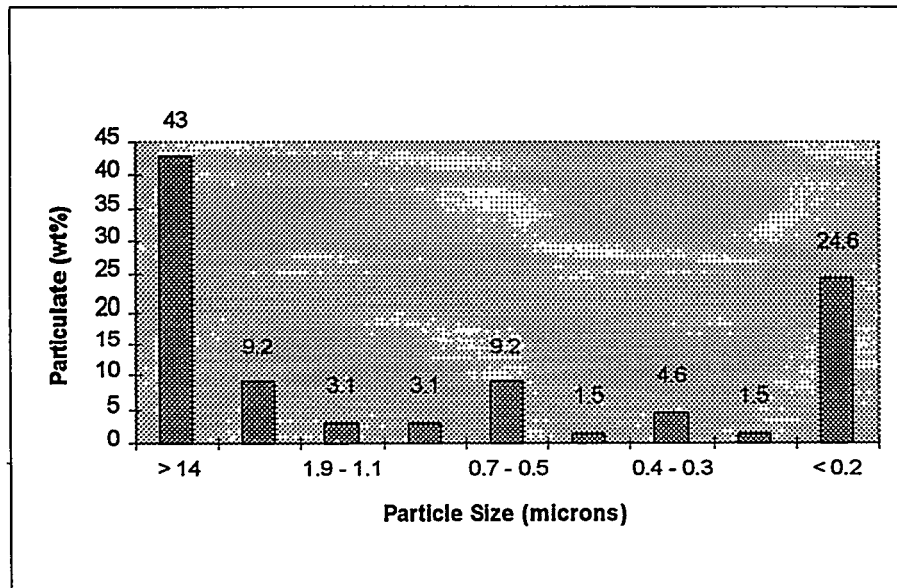


Figure 8 Run 3 Offgas Particulate Size Distribution

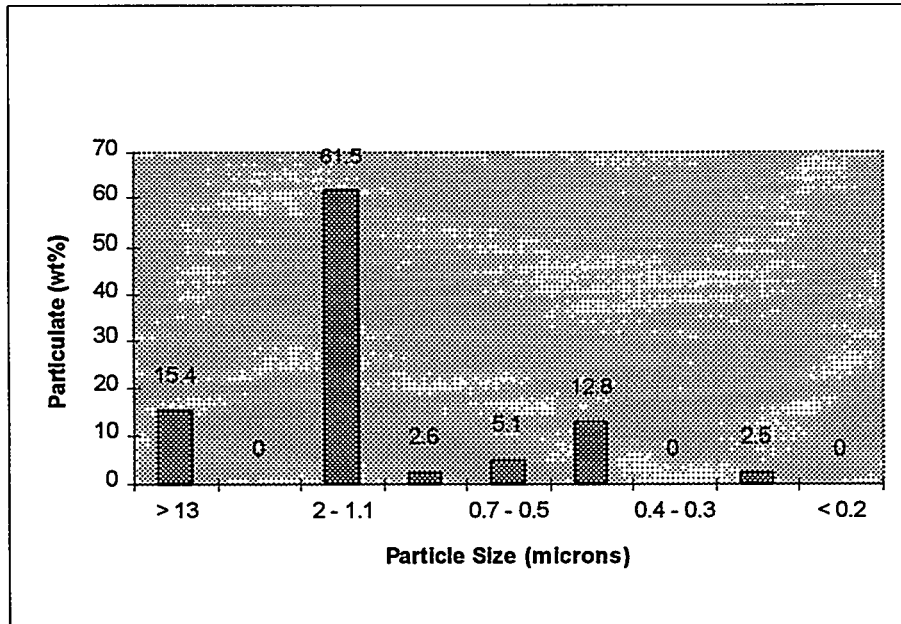

Conclusions

The primary conclusion of this test program is that satisfactory prefilter and HEPA filter life is obtainable with the existing CIF APCS. Test results indicate that the life of HEPA prefilters/filters can exceed the operational goal of thirty days under the following conditions: steam ratio, $\alpha = 0.43$, scrubber water ratio, $\beta = 1$, and using 304 SS cleanable prefilters.

IV. Summary

The Consolidated Incineration Facility (CIF) at the US Department of Energy (DOE) Savannah River Site has a unique facility design utilizing experience gained from other operating hazardous/radioactive incinerators. In order to study the CIF APCS prior to operation, a 1/10 scale pilot facility, known as the Off-gas Components Test Facility (OCTF) was constructed by the Savannah River Technology Center and has been in operation since late 1994. This test facility demonstrated the design integrity of the APCS and is currently being used to optimize the equipment/instrument performance of the full scale production facility. Operation of this on-site pilot facility has provided long-term performance data of integrated systems and critical facility components. This effort has reduced facility start-up problems and helped to insure compliance with all facility performance requirements.

Tests were conducted to evaluate the performance of the HEPA filters under different operating conditions. These tests included evaluating the impact on HEPA life of scrubber operating parameters and the type of HEPA prefilter used. This pilot-scale testing demonstrated satisfactory HEPA filter life when using cleanable metal prefilters and high flows of steam and water in the offgas scrubber.

DISCUSSION

BELLAMY: I have two questions I would like to ask. The first is on the slide that showed useful life versus number of runs. For the three runs that were done for the cleanable filters, two of the runs did not get to your acceptable thirty day life. I assume that each run was under different operating conditions?

BURNS: Correct.

BELLAMY: So run three, that was over thirty days, basically defined for you your future operating conditions, rather than the average of those three to be over thirty days?

BURNS: Each run was for a separate operating condition.

BELLAMY: The second question I have is concerned with service life and useful life. For a cleanable pre-filter, how many washable cycles are possible? If I buy one filter am I done forever? If I wash it every thirty days, do I have to replace it every year, two years, three years?

BURNS: That is something we haven't an update on. We are still using the original filter in the test facility. We have at least twenty-five cycles on it. Typically, we just load it up until we have to shut down; usually the HEPA filter is plugged and has to be replaced. The most resistance we have ever gotten on the prefilter has been about 3 in. w.g. When it starts clean, it is less than an inch.

BELLAMY: Not being intimately familiar with manufacturers' names and products, the final conclusion on your final slide used the term Otto-York prefilter. What is the significance of an Otto-York prefilter versus anybody else's prefilter?

BURNS: That just happens to be the one we tested. We consulted our site experts and they had some experience with that particular type of filter, so that was what was recommended. I have no doubt that a similar filter, manufactured by another company, would most likely behave the same.

PORCO: The question I have is, did you check the initial resistance after you cleaned your moisture separator? Did you do a pressure drop test on your moisture separator after you cleaned it?

BURNS: Yes.

PORCO: How close did it get to the original pressure drop?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

BURNS: The same.

PORCO: That answers the question about being reusable. As long as you keep coming down to the initial resistance it means you are getting most of the particles off.

BURNS: The particles we have are salt and iron oxide. When we analyze it we typically see a lot of iron chloride, stuff that washes out fairly easily. It is not sticky or anything like that. It tends to return to the silver clean appearance every time after we have washed it.

PIERCE: You noted on your slide that the glass prefilter you used was rated at 60 - 65% ASHRAE efficiency. What was the ASHRAE efficiency rating of the stainless prefilter?

BURNS: It is a mist eliminator, it has no ASHRAE efficiency rating because it is not really an air filter. The closest figure I have is what the manufacturer says, 95 % removal for water droplets greater than five microns.

PIERCE: The suggestion I am making is that you might not be looking at apples-to-apples if they do not have the same efficiency.

BURNS: It is a totally different item, it is a mist eliminator. It is not an air filter and it is not sold as an air filter.

WEBER: This was an extremely interesting paper. It is not critical to your presentation, but would you say that there was anything done to the knit-mesh of glass and stainless steel to create a fixed pore size?

BURNS: For that filter, to my knowledge, they do not advertise any kind of fixed pore size, it is just a spun fiber. This is really just a totally new application. The gases we are dealing with here contain a lot of water vapor. It is a totally different application than a typical HVAC HEPA filter application. In this case, we found that this particular unit happened to help us out quite a bit.

PORCO: If you want to find the ASHRAE efficiencies for moisture separators, there is a Mine Safety Appliances Co. report, MSAR-71-45 where you will find efficiencies for a moisture separator. Also in Air Cleaning Conference Proceedings, 14th Conf. p. 694.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FLEMING: Did you say that you were adding HCL to the airstream at some point?

BURNS: Yes, we burn PVC waste, so there is an acid gas. That is the source of the sodium chloride.

FLEMING: That is what I was going to ask, is the sodium coming from a neutralization of the HCL?

BURNS: Exactly.

FLEMING: Do you put it in after the quench or before the quench?

BURNS: It is before. Here is how the system works: from burning PVC or chlorinated waste, HCL or chlorine gas comes out of the incinerator. The scrubber takes it out and the pH in the scrubber solution quickly goes very low, so you have to neutralize it with a caustic. That creates the sodium chloride. The sodium chloride is usually what gets entrained into a fine salt mist that plugs the HEPA filters. Therefore, the concentration of sodium chloride you allow to build up in your loops is a very critical parameter.

FLEMING: What I am really getting to is, what effect does the corrosion have on the filters themselves? Up to this point, have you noticed any corrosive effects, any eating away of the filter as you rinse it off, anything like that?

BURNS: We have seen some. We have not seen any corrosion on that particular unit, but we have seen some signs of corrosion in our HEPA filter housings. Corrosion would be what is going to limit the life of the prefilter. I am surprised we have not seen any corrosion yet.

FLEMING: I am too.

BURNS: It stays pretty dry in there, so that is probably what limits corrosion.

FRANKLIN: From looking at your data, I concluded that you are really using the Otto-York pad as a mist eliminator. The pressure drop does not seem to be rising very much, and I assume all the particles are going through into your HEPA filter. Are you really collecting anything on the pad?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

BURNS: Absolutely, yes. The unit is a very dark red when pulled out. The ideal situation for us would be to get a more efficient mist eliminator that would allow more loading. We are not loading the prefilter up as much as we would like to, because our HEPA filter is plugging. To even further optimize the system, we would like to find a more efficient mist eliminator to increase HEPA life.

FRANKLIN: Have you measured the amount of particles on the prefilter?

BURNS: Yes, we did weights before and after. The most we have seen is about three pounds.

DYMENT: I am a little puzzled as to why you decided to use a mist eliminator as a dry filter. Would it not have preformed better as a mist eliminator by using it earlier in the system, before you had heated the solution?

BURNS: We have a mist eliminator earlier in the system. We have a mist eliminator already in the process line.

DYMENT: Is it perhaps not a very good mist eliminator?

BURNS: I would not argue with that.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DEVELOPMENT OF AN AIR CLEANING SYSTEM FOR DISSOLVING HIGH EXPLOSIVES FROM NUCLEAR WARHEADS*

by

W. Bergman, K. Wilson, K. Staggs, and D. Wapman
Lawrence Livermore National Laboratory
Livermore, CA 94550

Abstract

The Department of Energy (DOE) has a major effort underway in dismantling nuclear weapons. In support of this effort we have been developing a workstation for removing the high explosive (HE) from nuclear warheads using hot sprays of dimethyl sulfoxide (DMSO) solvent to dissolve the HE. An important component of the workstation is the air cleaning system that is used to contain DMSO aerosols and vapor and radioactive aerosols.

The air cleaning system consists of a condenser to liquefy the hot DMSO vapor, a demister pad to remove most of the DMSO aerosols, a high efficiency particulate air (HEPA) filter to remove the remaining aerosols, an activated carbon filter to remove the DMSO vapor, and a final HEPA filter to meet the redundancy requirement for HEPA filters in radioactive applications. The demister pad is a 4" thick mat of glass and steel fibers and was selected after conducting screening tests on promising candidates. We also conducted screening tests on various activated carbons and found that all had a similar performance. The carbon breakthrough curves were fitted to a modified Wheeler's equation and gave excellent predictions for the effect of different flow rates. After all of the components were assembled, we ran a series of performance tests on the components and system to determine the particle capture efficiency as a function of size for dioctyl sebacate (DOS) and DMSO aerosols using laser particle counters and filter samples. The pad had an efficiency greater than 99% for 0.1 μm DMSO particles. Test results on the prototype carbon filter showed only 70% efficiency, instead of the 99.9% in small scale laboratory tests. Thus further work will be required to develop the prototype carbon filter.

I. Introduction

This study is a continuation of the development previously described of an air cleaning system in support of the DOE nuclear weapons dismantlement program in which hot DMSO sprays are used to dissolve the HE from nuclear warheads.⁽¹⁾ The DMSO spray generates a high concentration of aerosols containing dissolved HE that must be contained and filtered by HEPA filters in the exhaust line to prevent HE or potential radioactive contamination from being released to the

*This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under contract no. W-7405-ENG.45.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

atmosphere. In our previous study, the exhaust from the dissolution workstation was exhausted directly into wooden frame HEPA filters.⁽¹⁾ These HEPA filters showed rapid plugging from the DMSO aerosols and developed leak paths through chemical attack by the DMSO. The exhaust system was criticized by reviewers of the previous paper for not using a demister to remove the bulk of the DMSO mist prior to reaching the HEPA filter. This paper presents the results of our recent efforts to develop a more robust exhaust filtration system for the HE dissolution workstations.

II. Air Cleaning System for the HE Dissolution Workstation

The major components of the air cleaning system for the HE Dissolution Workstation are shown in the schematic in Figure 1. The air cleaning system consists of a condenser to chill and condense the hot DMSO vapor, a demister pad to remove most of the DMSO aerosols, a high efficiency particulate air (HEPA) filter to remove the remaining aerosols, an activated carbon filter to remove the DMSO vapor, and a final HEPA filter to meet the redundancy requirement for HEPA filters in radioactive applications. An inlet valve connected to the workstation is used to vent the workstation chamber with HEPA filtered air.

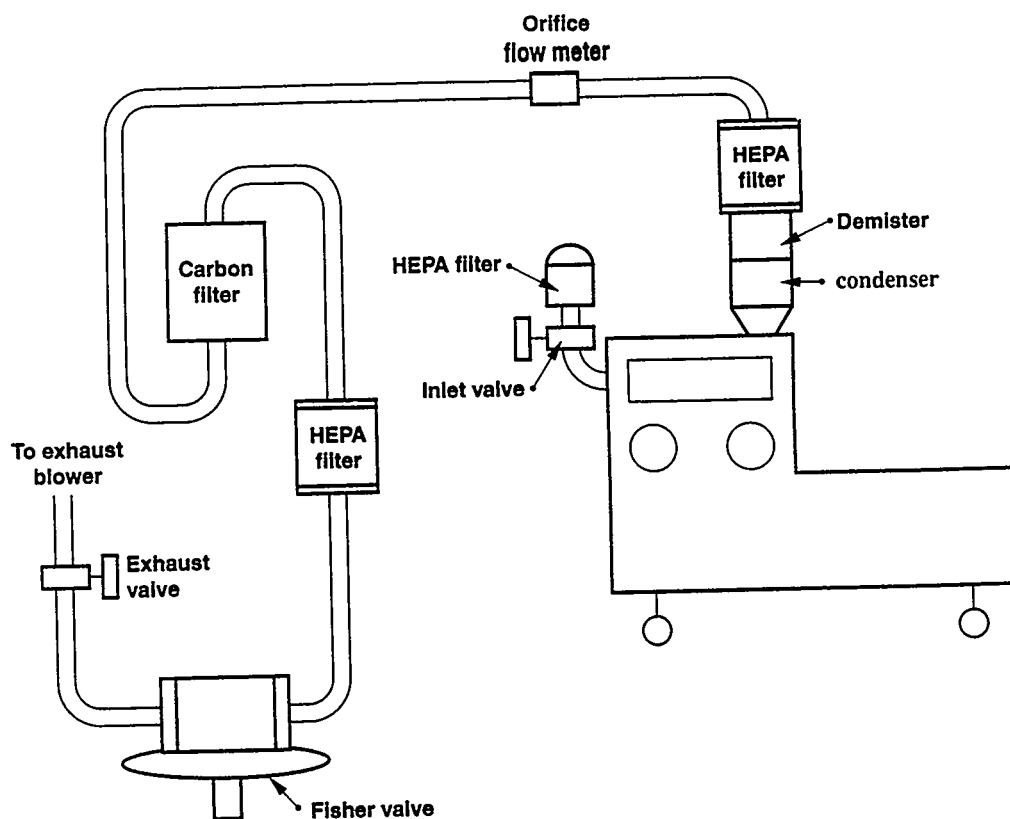


Figure 1 Schematic of exhaust system on the HE dissolution workstation.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

One of the most important safety features of the exhaust system is the Fisher regulator valve. The Fisher valve controls the amount of vacuum applied to the workstation by opening or closing the valve as the workstation vacuum drops below or increases beyond a preset vacuum (usually 1 inch of water) respectively. A vacuum control line (not shown in Figure 1) from the workstation to the diaphragm of the Fisher valve controls the opening of the valve. Maintaining a negative pressure within the workstation insures that the contaminants do not leak out into the workplace. When the inlet valve to the workstation is closed, the building exhaust blower pulls an increasing vacuum on the workstation until the Fisher valve is nearly closed. The Fisher valve is still cracked slightly open to draw a small flow through the workstation due to unintentional leaks in the workstation and components of the exhaust system. Generally this flow is about 1 cfm. The leak flow should be minimized to avoid drawing an excessive amount of DMSO aerosol and vapor through the exhaust system.

In addition to controlling the workstation vacuum during normal operations, the Fisher valve also provides a rapid exhaust flow under accident conditions when the workstation barrier is breached. The most likely scenario for a breached barrier is the loss of a glove. Under this condition, the workstation vacuum drops to nearly 0 vacuum (atmospheric pressure), and the Fisher valve opens fully. This pulls the maximum air flow from the workstation into the exhaust. The exhaust system was designed with minimal restriction to this flow.

A photograph of the front side of the HE Dissolution Workstation is shown in Figure 2. The heated DMSO reservoir and the pump for the DMSO spray are located in the lower, covered portion of the workstation. Hot water is used to heat the DMSO liquid to 150-155 °F by means of a heat exchanger also located in the lower part of the workstation. The dissolution is performed in the 18 ft³ chamber having glove ports and a viewing window. An access door on the right side of glove ports is used to install and remove the HE assembly. The exhaust condenser, demister and first HEPA filter are mounted directly on the roof of the workstation. Condensate from the condenser and the demister can freely drip back into the workstation. The carbon filter, second HEPA filter, Fisher valve, and exhaust valve are mounted on the rack to the left of the workstation.

Figure 3 shows the side view of the workstation as well as the exhaust rack on the right. The cover plate to the side access door is clearly visible. The access door is opened and closed by using a turn screw to slide the access door along tracks. The exhaust train consisting of a condenser, demister, and first HEPA filter are seen directly over the access door. The remainder of the exhaust system is mounted in the rack on the right. Note that the rack has a duplicate set of components to accommodate a second workstation. A detailed view of the exhaust rack is shown in the photograph in Figure 4. This figure also shows the inlet valve and HEPA filter leading to the workstation.

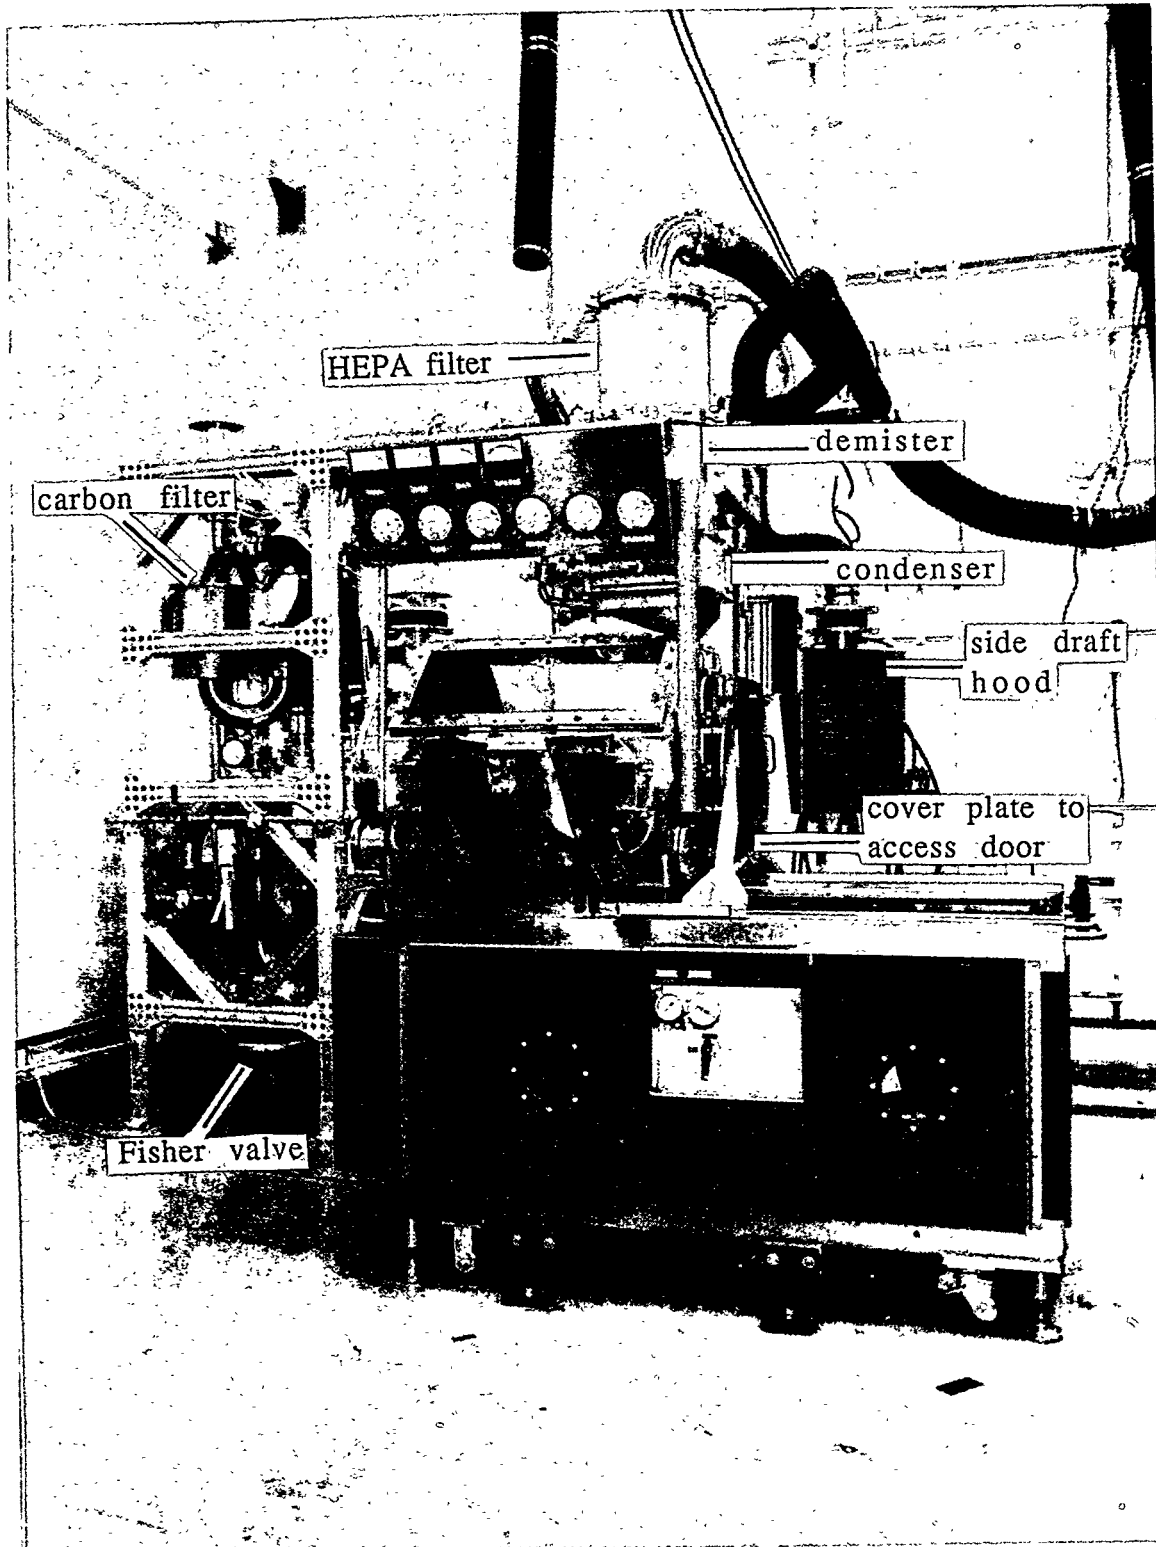


Figure 2. Photograph of the front side of the HE Dissolution Workstation with the exhaust rack on the left side.

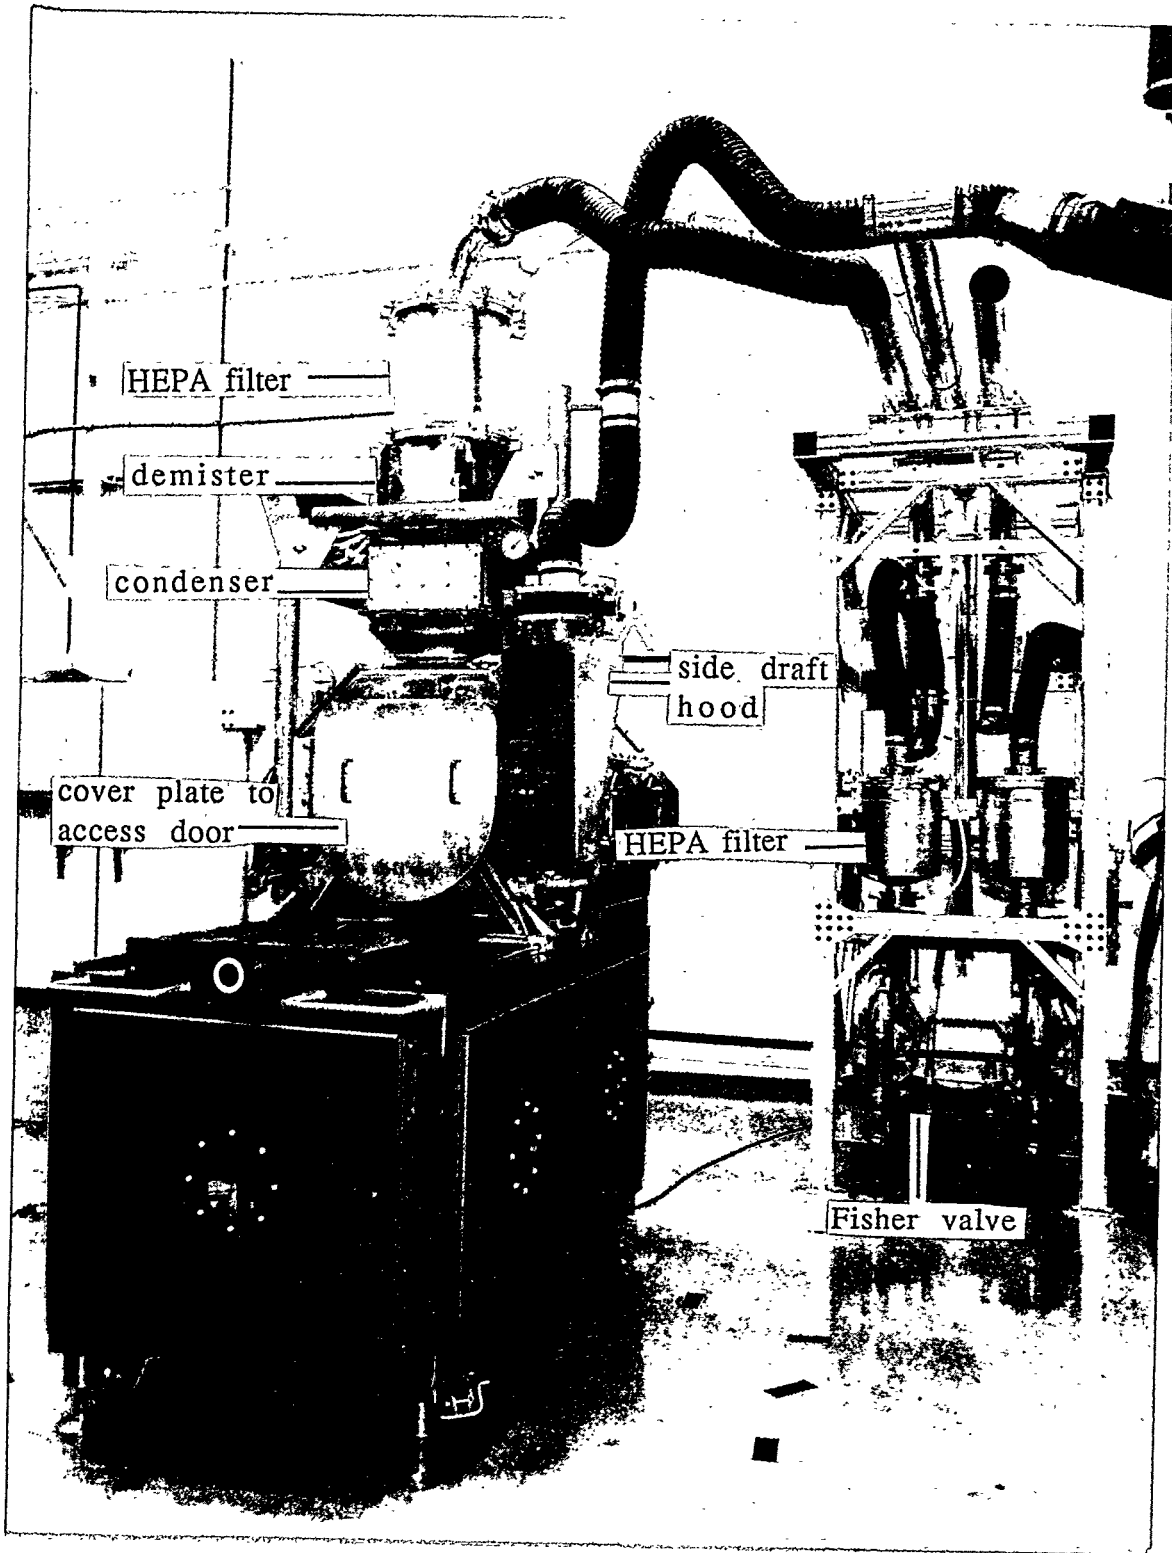


Figure 3. Photograph of the side view of the HE Dissolution Workstation with the exhaust rack shown on the right side. Note that the exhaust rack contains a duplicate set of components for a second workstation.

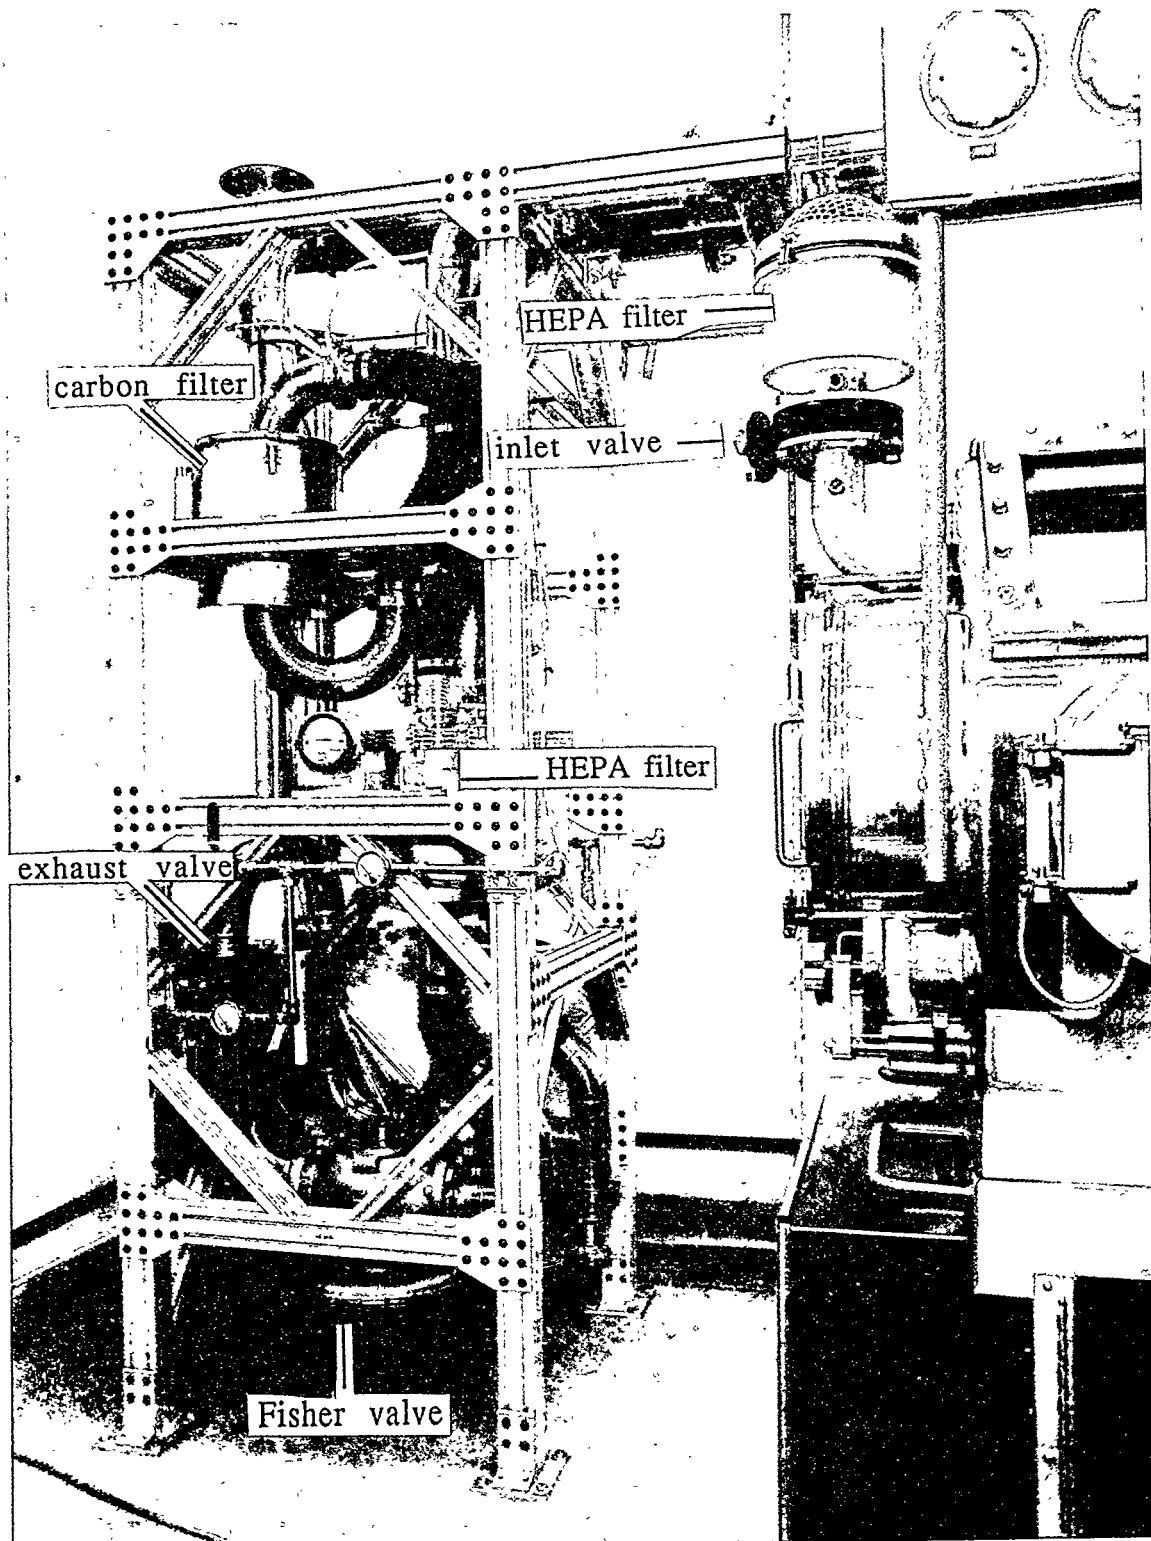


Figure 4. Photograph of the exhaust rack showing the carbon filter, HEPA filter, Fisher valve and exhaust valve. The HEPA filter and inlet valve to the workstation are also seen in this photograph.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

From the point of view of the air cleaning system, the HE dissolution operation can be divided into two phases, a dissolution phase and a venting phase. After the HE assembly is mounted on a fixture and placed inside the workstation, the inlet valve is closed and the hot DMSO spray turned on. In this dissolution phase the workstation is filled with DMSO aerosols and vapor. The only flow through the workstation into the exhaust is due to leaks. When operators need to make adjustments or other operations inside the workstation, the spray is first turned off and the inlet valve opened. This pulls HEPA filtered air through the workstation and sweeps out DMSO aerosols and vapor. The workstation is vented, and personnel are electrically bonded to the workstation prior to entry through the glove ports to prevent the unlikely occurrence of a spark from human electrostatic discharge. This phase of the dissolution operation is the vent phase. The operating parameters during the two phases and during an actual operation are shown in Table 1. We also tabulated some of the measurements made during a preliminary test to demonstrate the actual operation. The exhaust flow and temperatures in the air cleaning system are expected to differ slightly during the venting phase in production operations because the exhaust blowers are stronger than that used in our tests.

Table 1. Operating parameters in the HE Dissolution Workstation (WS).

Parameter	Steady State Simulation		Actual Operation*
	Dissolution	Venting	
Exhaust flow	1 cfm	20 cfm	1-20 cfm
DMSO liquid reservoir temp.	150+/-3 °F	150+/-3 °F	145-155 °F
WS interior air temp.	127+/-5 °F	127+/-5 °F	—
WS exterior surface temp.	107+/-3 °F	107+/-3 °F	—
Condenser inlet temp.	65+/-5 °F	105+/-5 °F	58-107 °F
Condenser exit temp.	44+/- 2 °F	52+/-3 °F	50-56 °F
Demister inlet temp.	44+/- 2 °F	52+/-3 °F	50-56 °F
Demister exit temp.	65+/-3 °F	55+/-3 °F	53-67 °F
HEPA 1 exit temp.	72+/- 2 °F	60+/-3 °F	—

*Note that not all of the temperature measurements were taken during the actual operation. The missing data falls between the 1 and 20 cfm steady state data.

The most significant improvement over the previous exhaust system was the addition of a condenser and demister at the exhaust port.⁽¹⁾ The condenser consists of tightly packed stainless steel tubes in which Fluorinert, FC-77, chilled to 40 °F, flows at 3 gallons/min. We used Fluorinert as the heat exchange medium instead of water because of incompatibility issues with water in case the condenser develops a leak. The 130 °F exhaust, which contains DMSO/HE aerosols and saturated DMSO vapor, is cooled to 50-56 °F under typical conditions. The condenser performance was selected to condense as much of the DMSO vapor as

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

possible without causing the DMSO to freeze. Although pure DMSO freezes at 65.4 °F, we did not observe any evidence of freezing, presumably due to the freezing point lowering by the dissolved HE. By condensing out the DMSO vapor into the liquid state, most of the DMSO is removed by the condenser tubes or by the demister. Locating the condenser and demister directly above the workstation allows condensate to drop back into the workstation.

We evaluated how quickly the workstation is vented after the DMSO spray is turned off and the inlet valve opened to establish a time limit before the side access door can be opened to prevent DMSO aerosols from contaminating the workplace. Figure 5 shows the concentration of DMSO aerosols measured in the exhaust of the workstation before the condenser while the inlet vent is open and a constant 20 cfm of air passes through the workstation. Separate measurements were made with the waist and the polar spray manifolds operating normally except for the inlet valve being open. These spray manifolds are two of several different types that are used in the dissolution operation. Figure 5 shows that when the spray is turned off, the aerosol concentration decreases very quickly. After 1 minute, the concentration decreased by about 70%, and after 3 minutes, by 99%. These aerosols have an average diameter of 0.1 μm and behave like gas. Figure 6 shows the same data on a logarithmic scale. The aerosol venting will be much faster in the production operations since the venting flow will be about 30 cfm instead of 20 cfm in our tests.

The release of DMSO vapor from films of hot DMSO on the interior workstation walls, the spray manifold fixture, and the cleaned assembly is expected to be the primary source of DMSO release into the workplace. Allowing the workstation to vent until most of the liquid film is drained and the temperature reduced before the side door is opened will mitigate the release of DMSO vapor. No tests were conducted to establish these time limits. A side draft hood shown in Figures 2 and 3 is intended to mitigate the vapor release when the cleaned assembly is removed from the workstation chamber.

Since we have demonstrated in our previous study that the DMSO sprays are flammable, we set a 1 minute waiting period before workers can work inside the workstation using the butyl rubber gloves after turning off the spray. This time limit was based on computations to establish how quickly the spray droplets would settle out in the workstation. The typical size of the droplets ranged from 107 to 120 μm, based on data from the spray nozzle manufacturer, Bete Fog Nozzle Company (Greenfield, MA). Willeke and Baron showed that the fraction of particles, N , remaining after time, t , is given by ⁽²⁾

$$N = \exp(-V_g t / H) \quad (1)$$

$$V_g = 0.003 \rho_p d_p^2 \quad (2)$$

- where
- N = fraction of particles of diameter d_p remaining
 - V_g = settling velocity, cm/s
 - t = time, s
 - H = height at the start of settling, cm
 - ρ_p = particle density, g/cc
 - d_p = particle diameter, μm

We used Equations 1 and 2 to compute the settling times for different size DMSO droplets and plotted the results in Figure 7. To be conservative, we assumed that all the droplets were located at the ceiling of the workstation chamber, 3 feet. We see that the spray droplets greater than $50 \mu\text{m}$ will be gone in less than one minute. Since we have shown in a separate study that it is only possible to ignite the DMSO spray droplets and not the small aerosols, waiting for one minute after the spray is turned off will eliminate any potential fire hazard from human electrostatic discharge.⁽³⁾

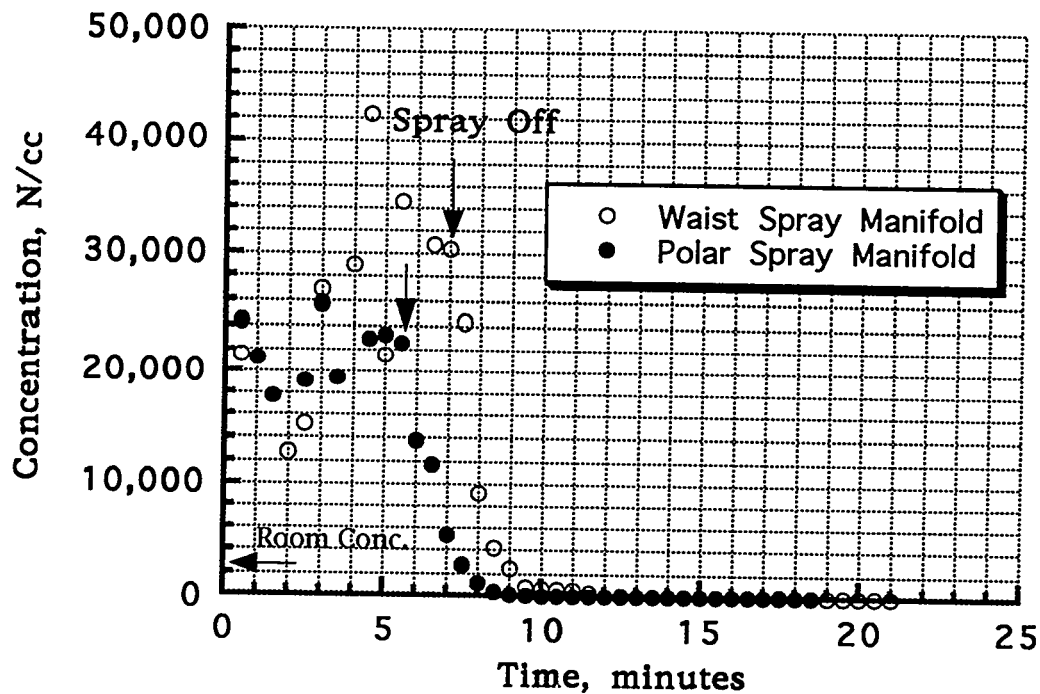


Figure 5. Concentration decay measurements using the polar and waist spray manifolds.

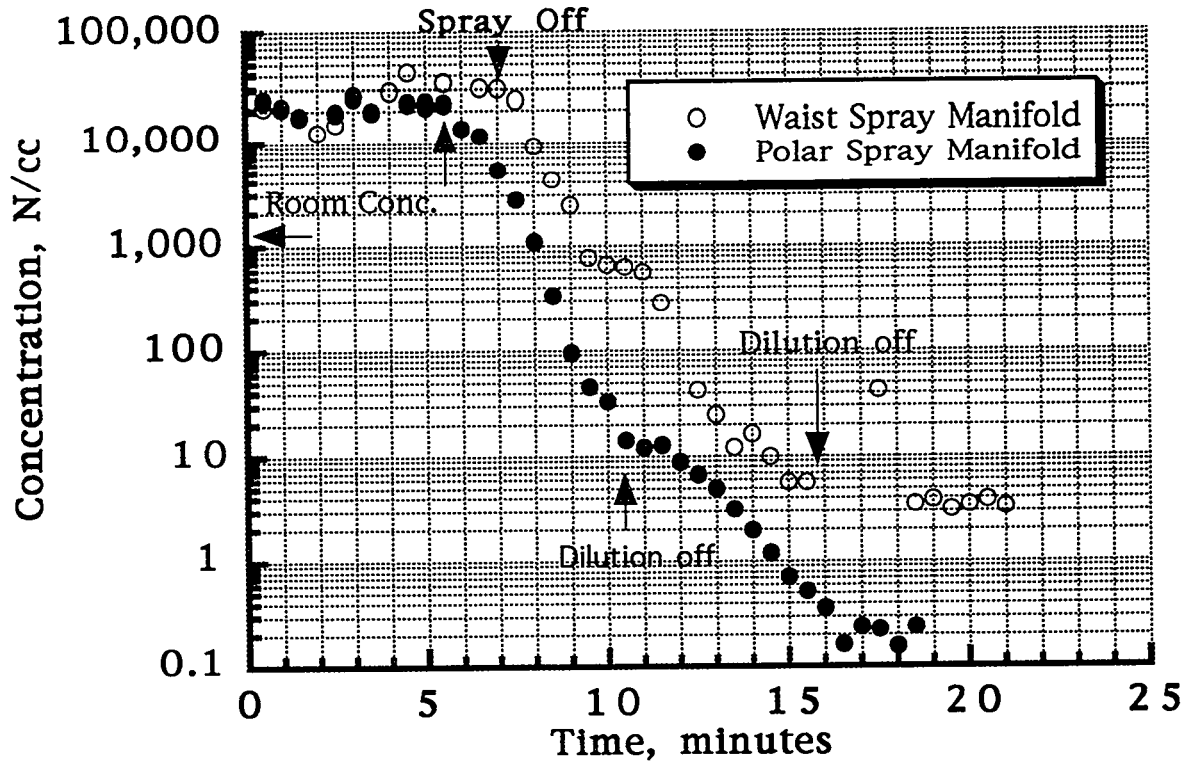


Figure 6. Concentration decay measurements using the polar and waist spray manifolds

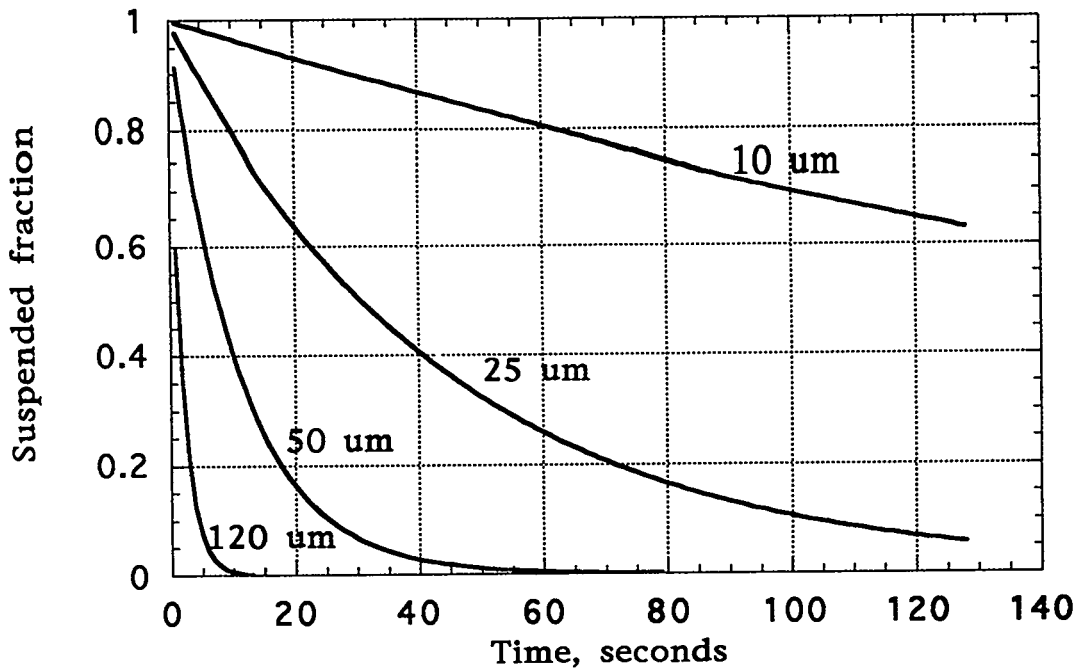


Figure 7. Sedimentation losses as a function of time for different size DMSO droplets.

III. Demister Evaluation

We conducted a series of screening tests to select the most promising demister for use in the air cleaning system. The candidate demisters were chosen based on the performance data provided by the different manufacturers. Most of the standard demisters used in nuclear exhaust systems were not available in smaller sizes and were therefore not evaluated. The most promising demisters were purchased from Amistco (Alvin, TX 77511) and from Coastal Technologies, Inc. (Hampton, SC 29924) and are designated Am and CT respectively. Each of the test samples were 12" x 12" x 4". A description of the different demisters is given in Table 2.

Table 2. Description of selected demisters evaluated in our study.

Demister	Bulk density, lb/cu. ft	Composition	Fiber volume fraction	Fiber Dia. inches
Am GLEC	15	90% 304 ss fiber 10% glass fiber by weight	0.027 ss 0.010 glass 0.037 total	0.011 ss 0.00045 glass
Am 1112	12	304 ss fiber	0.024	0.011
Am 1105	5	304 ss fiber	0.010	0.011
Am 0607	7	304 ss fiber	0.014	0.006
CT 1111	10.8	316 ss fiber	0.022	0.011
CT 911	9	316 ss fiber	0.019	0.011
CT 806	8	316 ss fiber	0.016	0.006

Our screening tests consisted of mounting each demister in a frame and measuring the penetration of DOS aerosols through the demister at 1 and 20 cfm flow rate. Since the demister has a 1 ft² cross-sectional area, the flow velocity through the filter is either 1 or 20 ft/min.. DOS aerosols were generated using the Laskin nozzle generator from the Virtis Co. (Gardiner, NY). We used the Aerodynamic Particle Sizer from TSI (Minneapolis, MN) to measure the DOS particles before and after the demister. The ratio of the downstream to the upstream concentration at each particle size gave the demister penetration at that size. Tables 3 and 4 show the test results for the demister penetration measurements at 1 and 20 cfm respectively.

Table 3. DOS penetration measurements on candidate demisters at 1 cfm.

Demister	DP, in. H ₂ O	DOS Penetration at Indicated Diameter			
		0.5 μm	1.0 μm	2.0 μm	3.0 μm
Am GLEC	0.004	0.33	0.34	0.12	0.05
Am 1112	<0.001	0.95	0.86	0.67	0.38
Am 1105	<0.001	0.91	0.83	0.70	0.45
Am 0607	<0.001	1.00	1.00	0.80	0.60
CT 1111	<0.001	0.88	0.83	0.65	0.48
CT 911	<0.001	0.90	0.85	0.72	0.56
CT 806	<0.001	1.00	0.95	0.88	0.70

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 4. DOS penetration measurements on candidate demisters at 20 cfm.

Demister	DP, in. H ₂ O	DOS Penetration at Indicated Diameter			
		0.5 μm	1.0 μm	2.0 μm	3.0 μm
Am GLEC	0.165	0.80	0.65	0.38	0.15
Am 1112	<0.001	0.86	0.85	0.80	0.68
Am 1105	<0.001	1.00	0.98	1.00	0.83
Am 0607	<0.001	0.92	0.92	0.92	0.90
CT 1111	0.002	0.90	0.90	0.90	0.80
CT 911	0.003	0.98	0.94	0.95	0.90
CT 806	0.002	0.95	0.95	0.83	0.60

Based on these screening tests, the best demister for our application was the Amistco GLEC demister. Note that this demister also had significantly higher pressure drop than the other demisters because of the glass fiber blend. We did not evaluate the ease of liquid drainage as part of our screening test because we were primarily concerned with high removal efficiency. In effect, we viewed the demister as a disposable prefilter.

Figure 8 shows a photograph of the GLEC demister pad selected for our study. The demister pad consists of multiple layers of glass fiber cloth with steel fibers interwoven to provide rigidity and some space between the layers. The high collection efficiency and pressure drop for the GLEC demister is due to the small diameter glass fibers (12 μm) that make up the yarn in the cloth layers.

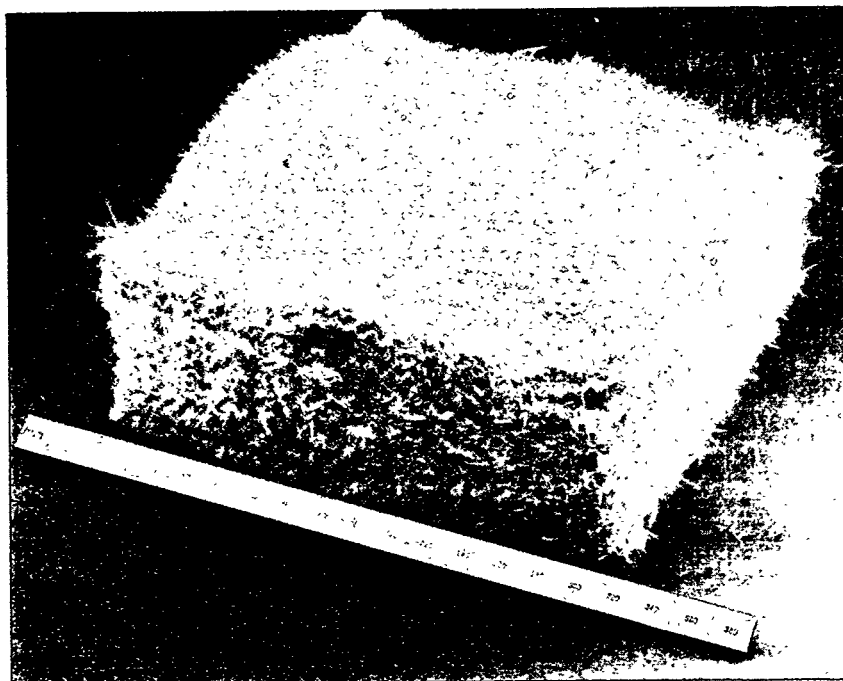


Figure 8. Photograph of the Amistco GLEC glass/steel fiber demister next to 410 mm ruler.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We then evaluated the performance of the GLEC demister using DOS aerosols at room temperature and DMSO aerosols under actual operating conditions in the HE dissolution workstation. The DOS aerosols were generated using a Laskin nozzle generator and were injected into the workstation. We determined the penetration of DOS aerosols through the demister from the ratio of the downstream to the upstream concentration measurements. We used a LASAIR laser particle counter from Particle Measuring Systems (Boulder, CO) to measure the aerosols.

Figures 9 and 10 show the results of our DOS penetration measurements on two different GLEC demisters at 1 and 20 cfm. Note that the maximum DOS penetration at 1 cfm and 20 cfm occur at about 1.4 μm and 0.5 μm diameter respectively. The aerosol penetration at 20 cfm is also much higher than at 1 cfm. These observations are consistent with filtration theory and demonstrate that diffusional deposition is the primary mechanism responsible for capturing the submicron particles.

We obtained separate measurements with the demister at 70 °F and at 40 °F to determine what effect the temperature would have on the demister performance. The data collected at 40 °F are shown as dark points, whereas the data collected at 70 °F are shown as open points. From Figures 9 and 10, we see that at 20 cfm, the tests at 40 °F showed a higher penetration at the smaller particle sizes than the corresponding tests at 70 °F. This is consistent with the diffusional capture mechanism whereby particles have lower Brownian motion at lower temperatures and consequently are not captured as well as at the higher temperatures. The temperature effect on the aerosol penetration is less noticeable at 1 cfm than at 20 cfm because Brownian capture is already dominant at the low flow rate, and increasing the temperature would not make a large change.

The higher penetration at the 1 cfm flow in Figure 10 compared to the 1 cfm flow in Figure 9 is most likely due to greater leak paths through the demister. It is well established that filters having leaks have much higher penetrations at low flow rates than filters without leaks because of the preferential flow through leaks. The preferential flow through leak paths does not occur at higher flow rates as shown by the same penetration in Figures 9 and 10.

We also measured the penetration of DMSO aerosols through the demister at 1 and 20 cfm under steady state conditions with constant DMSO spraying. Although the DMSO spray normally would be turned off before the inlet valve is opened, we conducted the tests to see if there were any differences in performance between the DMSO and the DOS tests. We also measured the DMSO concentration before the condenser to characterize the challenge DMSO aerosols. Figure 11 shows the results of the DMSO concentration measurements at 1 cfm. An important finding in this figure is that the DMSO challenge aerosols have an average diameter of 0.1 μm . These are extremely small aerosols and generally require high efficiency filters to remove them. Figure 11 also shows the condenser is removing about 50% of the aerosols. This is not surprising considering the thermal gradient that is driving the DMSO aerosols to the cold condensing tubes. A portion of this removal efficiency also may be an artifact of the aerosol measurement. The DMSO

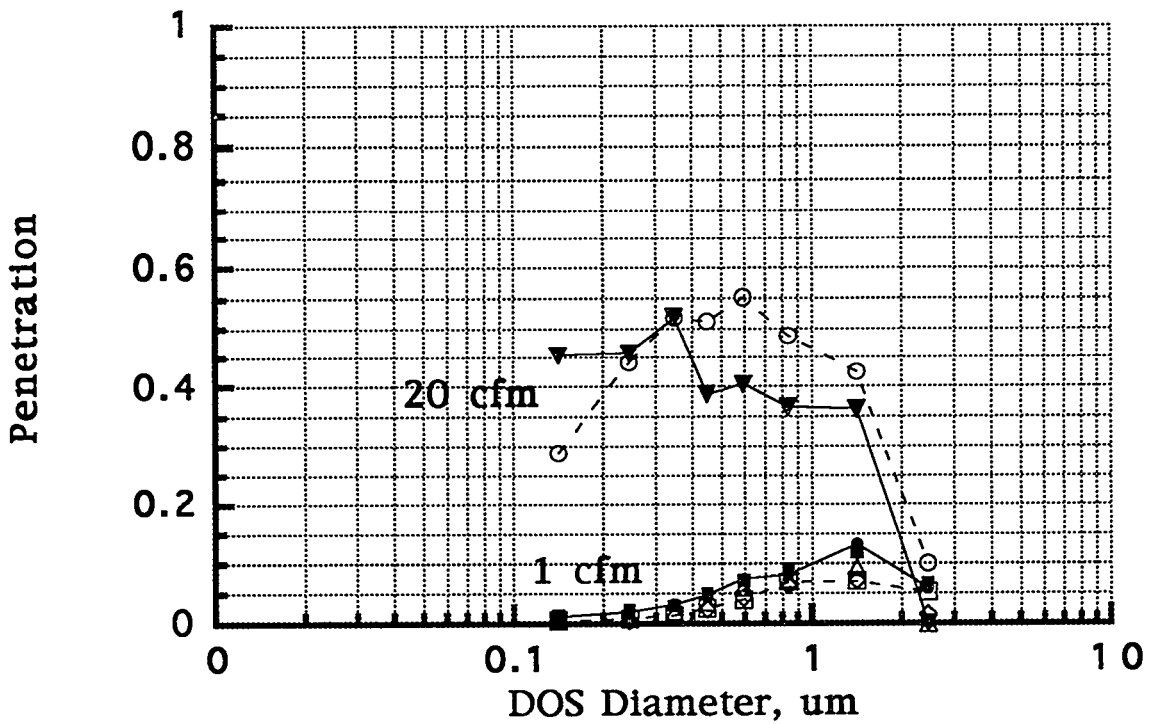


Figure 9. Penetration of DOS aerosols through a demister at 1 and 20 cfm exhaust flow. The open data points were taken at 70 °F. The solid data points were taken at 40 °F.

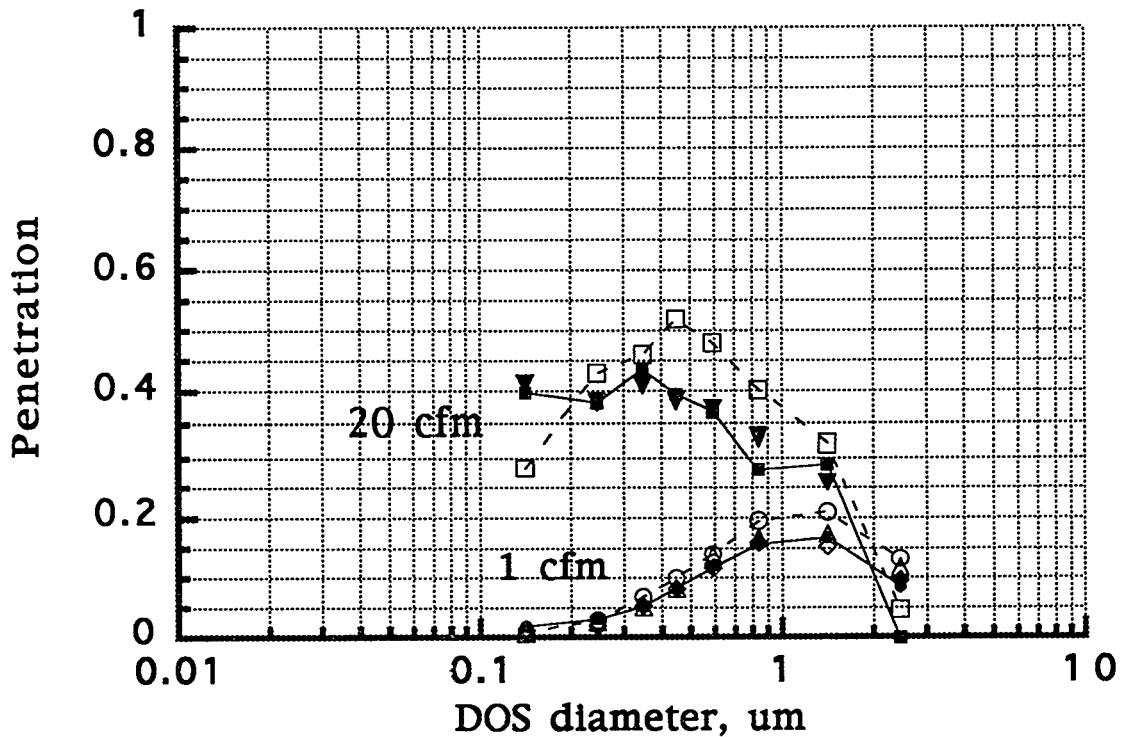


Figure 10. Penetration of DOS aerosols through another demister at 1 and 20 cfm exhaust flow. Open data points were taken at 70 F. Closed data points were taken at 40 F.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

aerosol concentration may have decreased due to evaporation in the diluter prior to the laser counter as the temperature increased from 44 °F at the condenser exit port to 70 °F at the diluter.

However, an unexpected finding in the 1 cfm test is that the aerosol penetration increases with increasing particle diameter until 65% of the particles at 0.3 μm penetrate the demister as shown in Figure 12. We did not have data beyond 0.3 μm because we did not have measurable counts with the 100:1 dilution prior to the laser counter. The DMSO penetration in Figure 12 is in sharp contrast to the DOS penetration in Figures 9 and 10, where the demisters have very low penetration in this size range. We have carefully reviewed the data in Figures 11 and 12 and verified that the results are not due to coincidence counting, a common measurement error. The unexpected results are also not due to Brownian motion effects as previously discussed with the DOS tests. In addition, we were able to repeat the results several times.

We believe that the high penetration with DMSO aerosols is an artifact resulting from a decrease in the pre-demister aerosol concentration due to evaporation as the 44 °F sample is heated to 70 °F in the sampling lines and diluter. The aerosol sample after the demister is only heated from 65 °F to 70 °F in the sampling lines and diluter and therefore would not suffer much evaporation. The disproportionate sample heating before and after the demister is the most probable cause of the unusually high demister penetration in Figure 12.

Anomalies were also found in the DMSO aerosol measurements at 20 cfm. Figure 13 shows the DMSO aerosol concentration measurements taken at 20 cfm before the condenser, before the demister, and after the demister. We see that the concentration of DMSO aerosols has increased significantly after passing through the condenser. This is opposite to what was seen in Figure 11 at 1 cfm. The only explanation is that the saturated DMSO vapor condensed into particles at a faster rate than the DMSO particles were deposited on the cooling tubes. Note in Table 1 that the temperature across the heat exchanger drops 53 °F at 20 cfm and only 21 °F at 1 cfm. The greater temperature drop coupled with the rapid transport through the condenser are the likely reasons for the increase in particle concentration across the condenser. Sampling artifacts due to heating and cooling of the aerosols and the subsequent evaporation and condensation are probably also reflected in Figure 13. Accounting for these effects would increase the difference in aerosol concentration before and after the condenser.

However, the most striking anomaly in the DMSO measurements at 20 cfm is the rapid increase in aerosol penetration with decreasing particle size as shown in Figure 14. Based on the DOS measurements shown in Figures 9 and 10, the aerosol penetration in Figure 14 should decrease with decreasing particle size, not increase. Filtration theory also supports the contention that the Brownian motion will increase with decreasing particle size and therefore result in decreased penetration. We were able to repeat the anomalous results and also verified that the laser counter was not in error due to coincidence counting. As previously

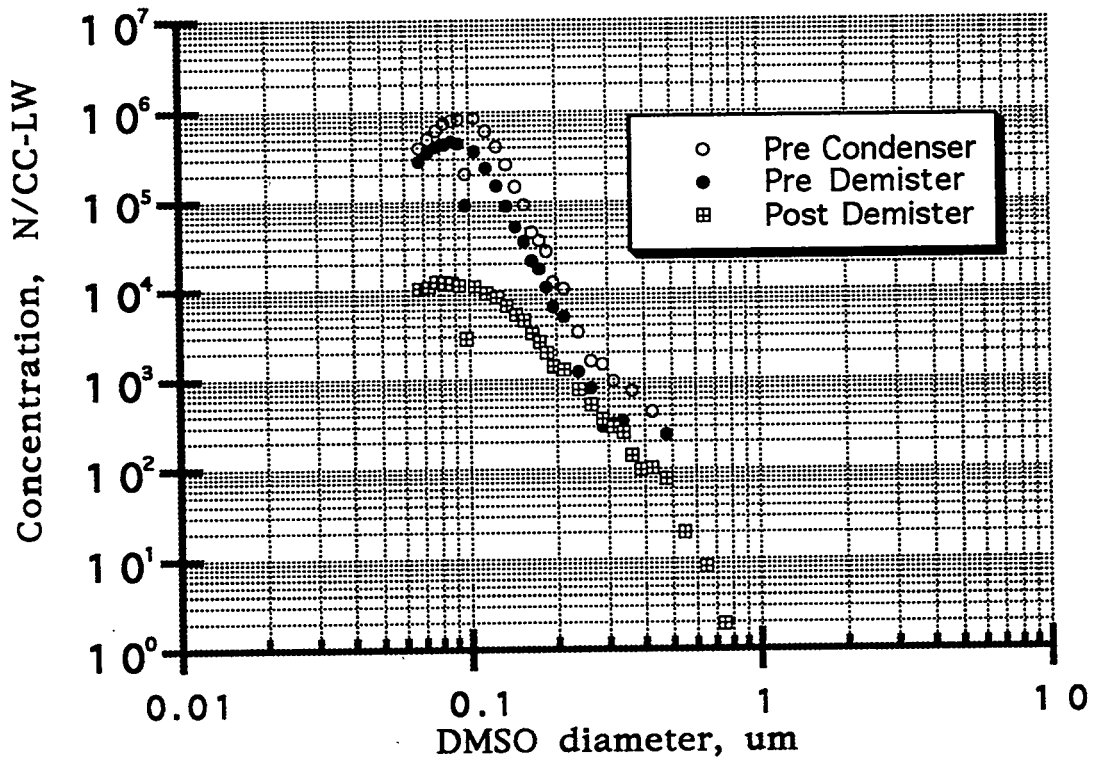


Figure 11. DMSO concentration before the condenser and before and after the demister at 1 cfm exhaust flow.

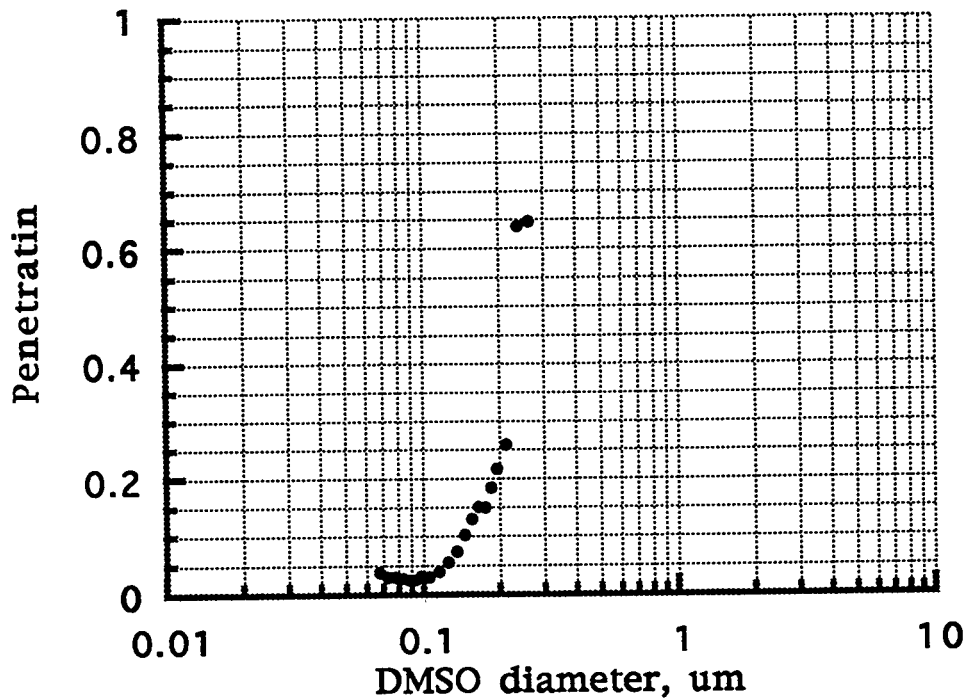


Figure 12. Penetration of DMSO aerosol through the demister at 1 cfm exhaust flow.

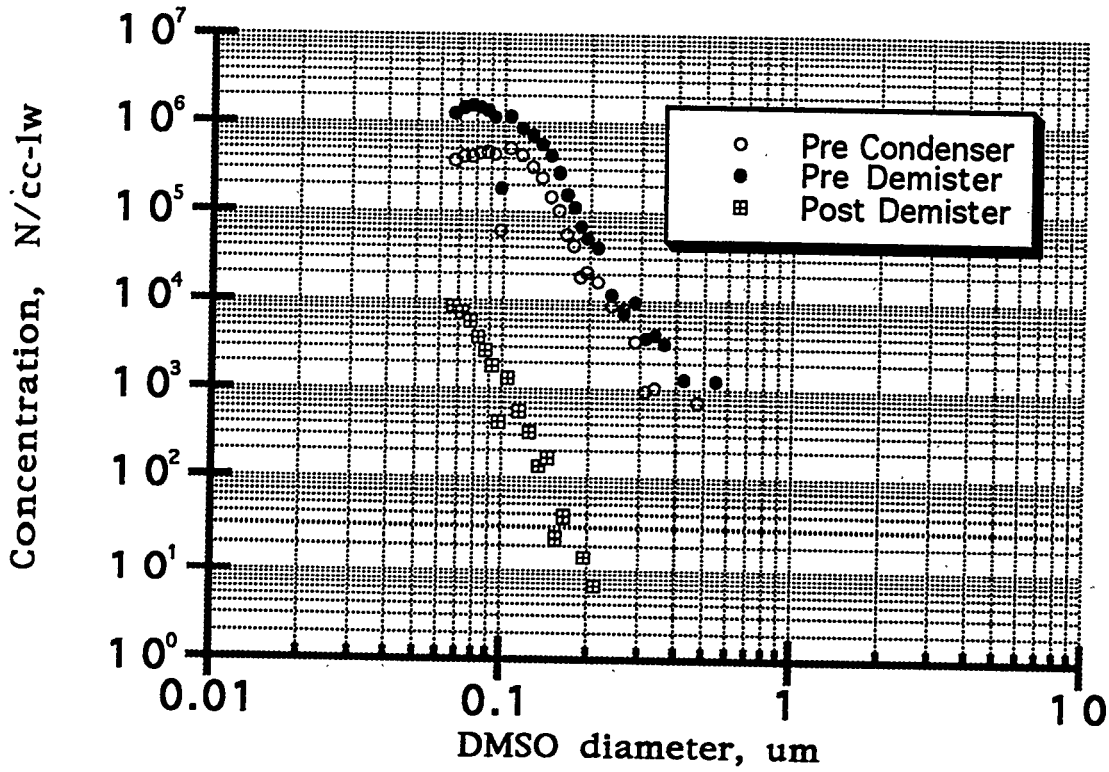


Figure 13. Concentration of DMSO aerosol before the condenser and before and after the demister at 20 cfm exhaust flow.

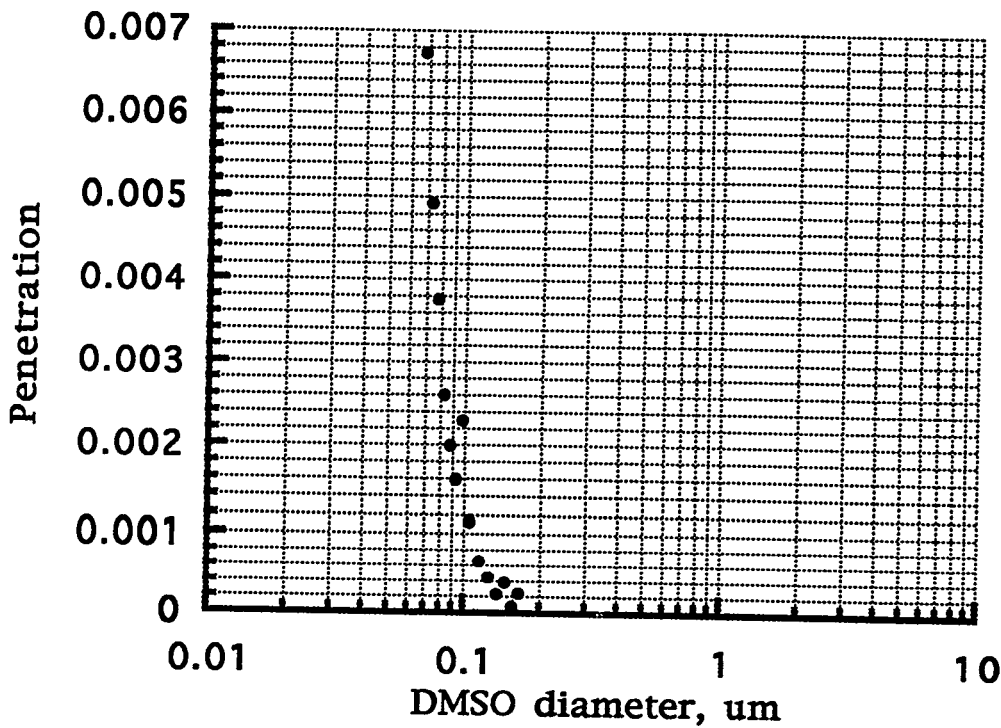


Figure 14. Penetration of DMSO aerosol through the demister at 20 cfm exhaust flow.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

discussed with the 1 cfm data, we believe that the observed penetration curve in Figure 14 is an artifact resulting from changes in concentration due to condensation/evaporation due to temperature changes.

Another observation when comparing the DMSO aerosol penetration in Figure 14 with the DOS aerosol penetration in Figures 9 and 10 is that the demister removes about 100 times more DMSO than DOS. This large difference can only be explained in terms of other processes that are occurring in the demister than classical particle filtration. We can only speculate that DMSO condensation plays a major role in these observations.

In addition to the aerosol measurements with the LASAIR and HSLAS laser counters, we also measured the aerosol concentration using filter samples. Most of our filter measurements were made using MSA HEPA filter cartridges typically used in respirators. In some cases, we also used flat filter media samples. A major problem in all of these measurements was the hygroscopic nature of the DMSO. In our initial filter measurements, we observed a weight loss despite the accumulation of significant DMSO mass. We attributed this loss to the removal of adsorbed water on the filter when filtering DMSO aerosols and vapor. To mitigate this weight loss problem, we preconditioned all filter samples by taking baseline filter samples prior to the actual sample. Another problem with the filter samples was the rapid increase in weight after the filter was removed from the filter holder. To mitigate this problem, we measured the filter weight at periodic intervals (typically 60 seconds) and extrapolated to the time the filter was removed. In some cases, we obtained negative mass measurements as seen in Tables 5 and 7 despite our precautions. For the mass measurements before and after the condenser, the DMSO liquid would condense and accumulate in the filter holder and in the upstream sample line. This weight was measured separately.

Table 5. Concentration measurements of liquid DMSO in the exhaust of the Workstation at 1 cfm.

Location	test	Concentration, g/m ³		
		Total	Aerosol	Condensate
pre-condenser	1	12.78	2.07	10.71
	2	9.16	2.45	6.71
pre-demister	1	2.64	0.54*	2.10
	2	----	0.12,0.11,0.067	----
post-demister	1	----	0.005*, 0.012*	----
	2	----	-0.011,-0.007	----

* Test conducted on a new demister. All other tests conducted on a used demister.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Using the procedures described, we measured the DMSO mass concentration before the condenser, before the demister and after the demister when the workstation was operated at 1 and 20 cfm under the conditions shown in Table 1. The test results for the 1 and 20 cfm measurements are shown in Tables 5 and 7 respectively. By taking the ratio of the mass measurements before and after the condenser and before and after the demister, we were able to determine the DMSO removal efficiency for the condenser and the demister. The mass removal efficiencies for the 1 and 20 cfm operations are shown in Tables 6 and 8 respectively. We did not compute efficiency values for negative values of the mass concentration.

Table 6. Removal efficiency for liquid DMSO in the exhaust of the Workstation at 1 cfm.

Component	test	Efficiency, %		
		Total	Aerosol	Condensate
condenser	1	79	74	80
	2	----	95,96,97	----
demister	1	----	99, 98	----
	2	----	----	----

Table 7. Concentration measurements of liquid DMSO in the exhaust of the Workstation at 20 cfm.

Location	test	Concentration, g/m ³		
		Total	Aerosol	Condensate
pre-condenser	1	11.77	1.81	9.96
	2	----	----	----
pre-demister	1	5.72	1.09	4.63
	2	----	3.62*	----
post-demister	1	----	-0.013	----
	2	----	0.0053*	----

* Test conducted on flat filter sample and may include condensate.

Table 8. Removal efficiency for liquid DMSO in the exhaust of the Workstation at 20 cfm.

Component	test	Efficiency, %		
		Total	Aerosol	Condensate
condenser	1	51	40	54
	2	----	----	----
demister	1	----	----	----
	2	----	99.9	----

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Our measurements based on laser counts and filter weights show the demister has an efficiency greater than 99% for removing 0.1 μm DMSO aerosols. This data is shown in Figures 12 and 14 for the laser counts and in Tables 6 and 8 for the filter weight measurements. The demister also has a relatively high pressure drop due to the higher fiber volume fraction and small diameter glass fibers.

However, we have not demonstrated the ability of the GLEC demister to drain the DMSO liquid. Data collected on the weight gain of the demisters used in our efficiency studies and demonstration tests showed the demister could collect about 1 kg of DMSO when the pressure drop reached our limit of one inch of water at 20 cfm. The weight gains and corresponding pressure drops for 4 GLEC demisters were 1.57 kg at 0.8 inches, 1.17 kg at 1.1 inches, 0.92 kg at 1.1 inches, and 0.55 kg at 0.7 inches. We could not determine the number of dissolution operations per demister because separate tests were not conducted. However, we estimate each demister can be used for about three dissolutions before changing the demister. No further studies were conducted because we decided to replace the demister after each dissolution operation to avoid the possibility of HE accumulation in the demister. Thus, the demister in our air cleaning system is used as a disposable prefilter.

III. Carbon Filter

We developed a carbon filter to remove the DMSO vapor from the Workstation exhaust because commercially available units were either designed for much larger ventilation systems or had excessive pressure drops. The typical ventilation filter had a 2' x 2' cross sectional area and was designed for flow rates of 1,000 cfm or greater. Smaller annular cartridge filters were developed for military vehicle applications but had pressure drops that greatly exceeded the requirement of less than one inch of water at 50 cfm. In addition to the lack of suitable carbon filter units, there also was no information on the performance of carbon filters for removing DMSO vapors. Thus, we had to establish the basic adsorption characteristics in addition to the design parameters to develop the DMSO carbon filter. The initial step was to demonstrate that activated carbon was effective in removing DMSO vapors.

We conducted a survey test of eight different activated carbons to establish that activated carbon is effective in removing DMSO vapors and to identify the best carbon. The test carbons were packed into empty respirator cartridges having a total carbon volume of 112 cc, a diameter of 7.9 cm and a bed depth of 2.3 cm. The cartridges were filled with carbon poured through a tube having multiple screens and a 2 foot free fall to insure tight packing. Each of the cartridges were weighed before and after the test to establish the weight of the carbon and the weight gain due to adsorbed DMSO vapor. The test consisted of passing 29.4 l/min air containing 500 ppm (1.59×10^{-3} g/l) of DMSO vapor with less than 10% relative humidity at 25 °C through each cartridge. This flow rate corresponded to a flow velocity of 6 m/min since the area was 49 cm² (4.9 l/m). The efficiency of DMSO removal was determined by measuring the concentration of DMSO vapor

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

before and after the cartridge using a Miran infrared analyzer (Foxborough Inc.). Since each of the tests were conducted until the carbon was saturated and had 0% efficiency, the increase in carbon weight represented the dynamic adsorption capacity of the carbon for DMSO.

Figure 15 shows the DMSO removal efficiency for each of the eight carbon canisters as a function of exposure time. All of the carbons have similar DMSO adsorption properties. However, sample G215 from PICA USA Inc. (Columbus, OH) had a slightly better performance than the other samples and was therefore selected for the carbon filter in our project. The carbon weight, adsorbed DMSO weight, and the pressure drop for each of the canisters is shown in Table 9.

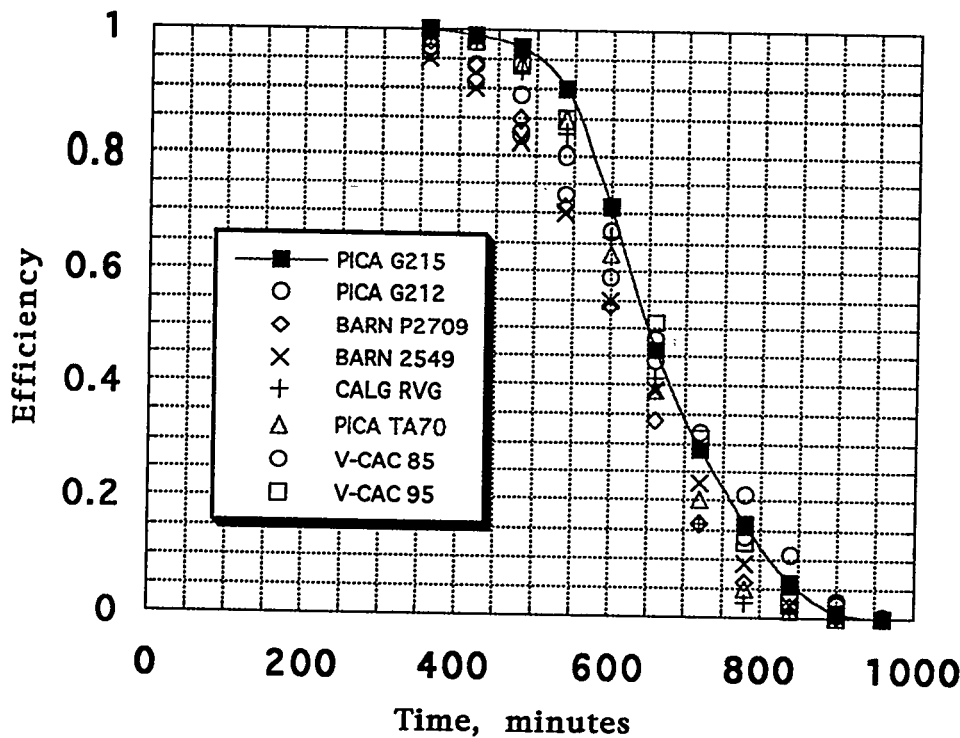


Figure 15 . Survey of carbon capacities plotted as efficiency versus exposure time at 6m/min flow velocity.

Table 9. Experimental measurements of carbon cartridge samples in screening tests at 6 m/min.

Sample	Carbon Weight, g	DMSO Adsorbed, g	Pressure Drop, in. H ₂ O
PICA G215	45.9	31.6	0.31
PICA G212	42.6	31.3	0.21
BARN P2709	55.2	29.7	0.27
BARN 2549	47.7	30.4	0.20
CALG RVG	51.7	30.9	9.31
PICA TA70	51.1	30.6	0.30
V-CAC 85	44.3	31.9	0.29
V-CAC 95	45.8	32.5	0.31

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We then conducted additional tests on new cartridges of PICA G215 at 14.7 and 43.9 l/min flow rates, which correspond to flow velocities of 3 and 12 m/min. These tests were needed to establish the adsorption parameters for the design of the carbon filter. Figure 16 shows the results of the three carbon canisters of PICA G215 tested at 3, 6 and 12 m/min flow velocity. We see that the faster flows results in shorter saturation times. The experimental measurements of the PICA G215 carbon samples are shown in Table 10.

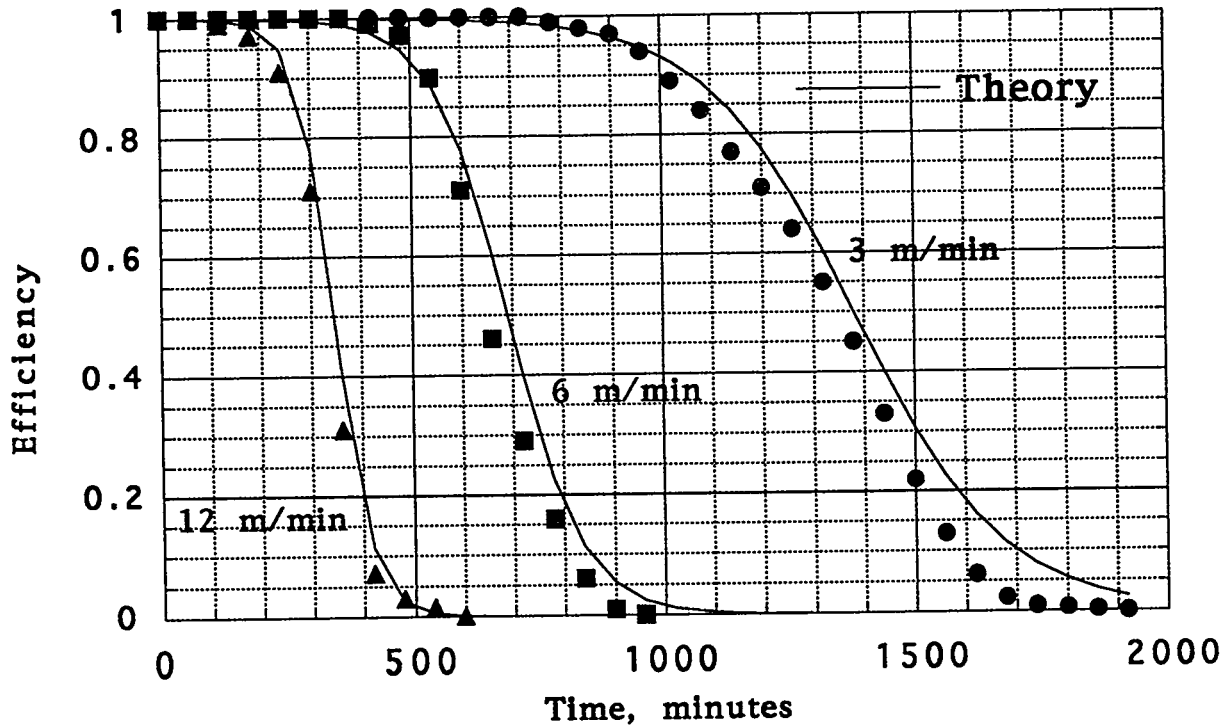


Figure 16. Efficiency of PICA G215 canisters at 3, 6 and 12 m/min flow velocity. Points are experimental data; solid lines represent theory.

Table 10. Experimental measurements of PICA G215 carbon samples in tests at 3, 6 and 12 m/min.

Velocity V m/min	Flow rate, l/min	Pressure drop in. H ₂ O	Carbon Wt W _c , g	DMSO Wt W _a , g	Saturated Capacity W _s =W _a /W _c	Carbon bulk density, ρ _c g/l
3	14.7	0.13	44.0	32.8	0.745	393
6	29.4	0.31	45.9	31.6	0.688	410
12	58.8	0.57	43.9	32.5	0.740	392

In order to design an activated carbon filter for removing DMSO vapor, it was first necessary to determine the adsorption capacity of the selected carbon for DMSO, W_s, and the coefficient, K_v, for the rate of adsorption. Once these two parameters are determined, theoretical equations can be used to determine the key design parameters for the gas filter. The dynamic adsorption capacity, W_s,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

was experimentally determined and is shown in Table 10. The kinetic coefficient, K_v , characterizing the rate of adsorption is derived from matching experimental data with a theoretical model. We used the modified Wheeler equation, shown in Equation 3 to derive the kinetic coefficient.⁽⁴⁾

$$t = W_s W_c / (C A V) + W_s \rho_c / (C K_v) \ln [(1 - E) / E] \quad (3)$$

where

- A = cartridge area, 4.9 l/m (49 cm²)
- C = DMSO concentration, 1.59×10^{-3} g/l (500 ppm)
- E = DMSO removal efficiency
- K_v = kinetic adsorption coefficient, min.⁻¹
- ρ_c = carbon bulk density, g/l
- t = time, minutes
- V = flow velocity, m/min.
- W_c = carbon weight in cartridge, g
- W_a = DMSO weight adsorbed, g
- W_s = DMSO saturated capacity = W_a / W_c , dimensionless

Values of K_v were determined by substituting the parameter values from Table 10 into Equation 3 and fitting each of the three equations to the corresponding efficiency curves in Figure 16. The least squares fits produced K_v values of 1369, 2750 and 4801 min⁻¹ at 3, 6 and 12 m/min flow velocities respectively. To establish the velocity dependence of K_v , we plotted the values of K_v versus the flow velocity in Figure 17.

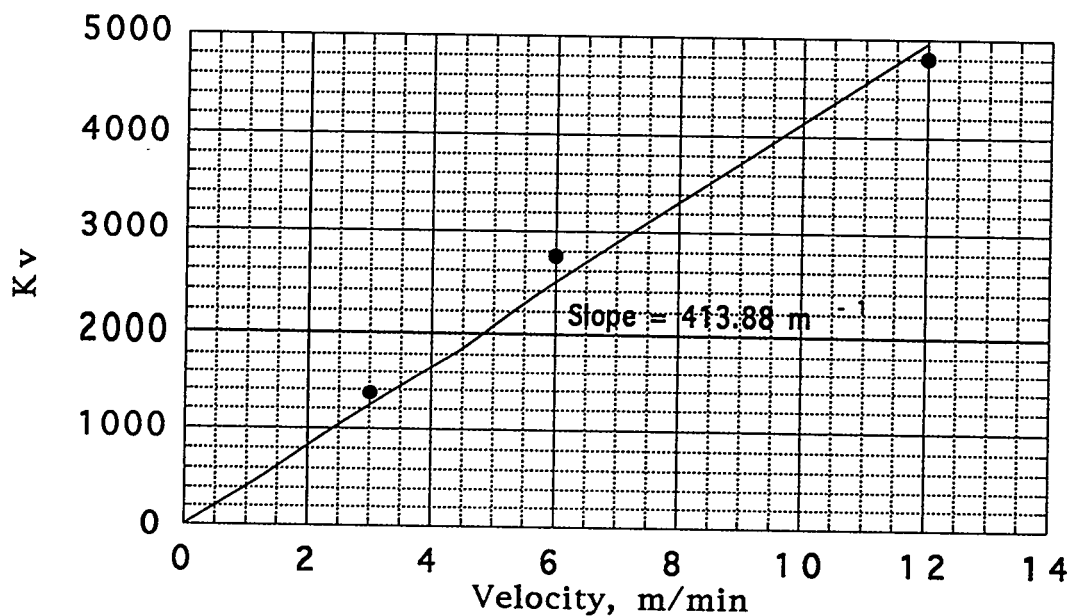


Figure 17 Determination of K_v dependence on velocity.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

From Figure 17, we have

$$K_v = k_v V = 413.88 \text{ V min.}^{-1} \quad (R=0.99035) \quad (4)$$

where the slope, k_v , equals 413.88 m^{-1} . Substituting this expression into Equation 3 yields,

$$t = W_s W_c / (C A V) + W_s \rho_c / (C k_v V) \ln [(1 - E) / E] \quad (5)$$

All of the constants in Equation 5 can be lumped together into constants c_1 and c_2 to yield.

$$t = c_1 / V + (c_2 / V) \ln [(1 - E) / E] \quad (6)$$

Replacing the constants in Equation 6 with the values in Table 10 yields $c_1 = 4207.4, 4053$ and 4169.7 and $c_2 = 444.6, 427.7$ and 439.7 for $V = 3, 6$ and 12 m/min respectively. Averaging these constant values yields

$$t = 4143.4 / V + (437.3 / V) \ln [(1 - E) / E] \quad (7)$$

Equation 7 was used to generate the theoretical curves in Figure 16.

The increasing deviation in Figure 16 between the experimental data and theory at slower velocities is most likely due to the assumption of irreversible adsorption. In practice, the adsorbed DMSO will not be adsorbed irreversibly and will be released, which is more pronounced at longer times and at higher carbon saturation values.

We used Equation 5 and the parameter values determined in the cartridge studies to design the carbon filter for use in the HE Dissolution Workstation. A major constraint on the filter design is the thickness of the carbon bed. Although we used a bed depth of 2.3 cm (0.91 inch) in our screening tests, existing standards on carbon filters require a minimum of 2 inches .^(5,6) This minimum bed depth was established to avoid channeling effects in the ventilation filters. However, since the pressure drop across the filter is directly proportional to the bed depth, it is desirable to minimize the bed depth. Thus, the optimum bed depth that satisfies the current standards and minimizes the pressure drop is 2 inches . To include the effect of carbon bed depth in Equation 5, we made the following two substitutions:

$$Q = A V \quad (8)$$

$$\rho_c = W_c / A T \quad (9)$$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

where, Q = flow rate, l/min.
 T = carbon bed thickness, m

Substituting Equations 8 and 9 into Equation 5 and rearranging yields,

$$t = W_s W_c / (C Q) \left[1 + (1 / k_v T) \ln [(1 - E) / E] \right] \quad (10)$$

Equation 10 can be used to establish how much carbon, W_c , should be used for a given set of operating conditions and for a desired filter life, t .

The primary operating conditions are exhaust flow rate, Q , and concentration of DMSO, C . The exhaust flow to be used in Equation 10 is primarily the leak flow in the Workstation during the dissolution operation. We have estimated the leak at 1 cfm based on previous measurements. The only critical leaks are those that allow air into the Workstation during the spraying operation. Leaks occurring in the exhaust system do not increase the DMSO loading on the carbon although they obviously increase the exhaust flow. The increased flow during the venting cycle can be ignored because the box is purged in less than three minutes as shown in Figures 5 and 6.

The DMSO concentration is determined by the air temperature to which the exhaust is cooled. We can assume the DMSO concentration equals the saturated concentration at the demister temperature because the demister removes nearly all of the suspended aerosols, thereby leaving only the saturated vapor to reach the carbon filter. In our application, the typical air temperature within the demister is less than 65 °F, which corresponds to a concentration of 1.6 g/m³.⁽⁷⁾

In our design, we wanted the carbon filter to have a useful life of at least one month of continuous operation. The number of operating minutes in a typical month is 5,160 minutes, assuming 4 hours of dissolution per day and 21.5 days per month. We also assumed the life of the carbon filter was over when the efficiency decreased below 95%.

Substituting these and the other parameter values into Equation 10 yields

$$5,160 \text{ min.} = \left\{ (0.724) W_c / [(1.6 \times 10^{-3} \text{ g/l})(28.3 \text{ l/min})] \right\} \times \left\{ 1 + [1 / (413.9 \text{ m}^{-1})(0.0508 \text{ m})] \ln [(1 - 0.95) / (0.95)] \right\}$$

Solving this equation yields $W_c = 375 \text{ g}$. Since the average bulk density of the carbon from Table is 398g/l, the minimum volume of carbon for one month operation is 0.95 l or 58 in.³. Dividing this volume by the required 2 inches for the bed thickness yields an area of 29 in.². How this area will be configured into a filter is now a matter of construction considerations. We have selected the cylindrical cartridge design because it is easy to fabricate and to service.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The cylindrical cartridge filter that we designed is shown in Figure 18, where the cartridge is shown mounted inside a cylindrical housing. The exhaust flows from the bottom port into the interior of the carbon filter, passes through the 2 inch bed and exits around the exterior of the cartridge and finally through the top port. The carbon bed is a 2 inch thick concentric cylinder contained between concentric cylinders made of perforated metal screens that are 12 inches long and have 10 and 6 inch diameters. The net carbon volume of this filter is 9.82 l, which is much larger than the minimum 0.95 l required for one month operation. If the operating assumptions for the HE Dissolution Workstation are correct, then the carbon filter will last for 10.4 months of daily operation before it must be recharged with fresh carbon. Even if the Workstation developed leaks up to 2 cfm, the carbon filter will last for 5.2 months of daily operation.

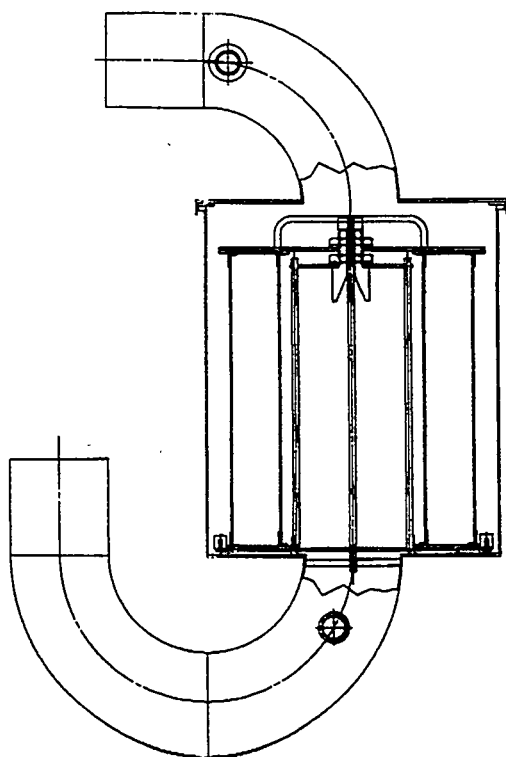


Figure 18. Schematic of cylindrical carbon filter cartridge mounted in a housing.

To prevent the remote possibility of DMSO condensing and collecting inside the carbon filter, we directed the exhaust through a U-tube section before entering the carbon filter. Any DMSO condensate would collect at the low point of the U-tube and can be drained through a plug. It is possible to form DMSO condensate in the lines if the ambient laboratory temperature is lower than the exit temperature of the demister. This can happen if the room heater or if the exhaust condenser do not work properly.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We have not yet completed developing and testing the carbon filter, but will do so in the near future. A preliminary test during a practice dissolution operation showed the carbon filter was only about 70% efficient. Since the predicted efficiency should be in excess of 99%, additional development is required before the carbon filter is acceptable for use in the HE Dissolution Workstation. One of the leading possibilities for the poor performance is the carbon loading procedure that we used. We filled the annular space with carbon by pouring the carbon granules directly from a container and then shaking the filter unit to insure tight packing. Although we designed a fixture to fill the annular space using gravitational settling, the unit was not available at the time of this report. We plan to complete the loading fixture and correct the low removal efficiency. We also plan to conduct accelerated loading tests on the filter in a similar fashion as seen in Figure 16 for the small test cartridges.

IV. Conclusions

We have developed an air cleaning system for workstations that will be used to remove HE from nuclear warheads using hot sprays of DMSO. The air cleaning system consists of a condenser to cool and condense the hot DMSO vapor, a demister pad to remove most of the DMSO aerosols, a HEPA filter to remove the remaining aerosols, an activated carbon filter to remove the DMSO vapor, and a final HEPA filter to meet the redundancy requirement for HEPA filters in radioactive applications. The demister pad is a 4" thick mat of glass and steel fibers and has an efficiency greater than 99% for 0.1 μm DMSO particles. However, the demister pad is disposed after each dissolution operation to prevent the accumulation of HE. Test results on the prototype carbon filter showed only 70% efficiency instead of the 99.9% in small scale laboratory tests. Thus further work will be required to develop the prototype carbon filter.

V. Acknowledgment

We gratefully acknowledge the help of Messrs. Donald Beason, Scott Doughty, and Ron Arganbright in performing tests on the HE Dissolution Workstation and of Mr. Jeff Oh for designing the exhaust system components. We also thank Mr. Gary Nelson of Miller-Nelson Inc. (Monterey, CA) for performing the carbon canister tests.

VI. References

1. Bergman, W., Wilson, K., Larsen, G., Lopez, R, and LeMay, J., "Degradation of HEPA filters exposed to DMSO" in Proceedings of the 23rd DOE/NRC Nuclear Air Cleaning Conference, Available from NTIS, Springfield, VA, M. First, Ed., CONF-940738, pp. 695-720, (1995).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

2. Willeke, K., and Baron, P.A., "Aerosol Measurement" Van Nostrand Reinhold, New York, (1993).
3. Bergman, W., Staggs, K.J., Turner, D.E., Greenwood, D.W., and Wapman, P.D., "Spark ignition studies of DMSO/HE sprays in the W79 HE Dissolution Workstation" Lawrence Livermore National Laboratory report UCRL-ID-126012, November, (1996).
4. Yoon, Y.H. and Nelson, J.H., "Application of gas adsorption kinetics: A theoretical model for respirator cartridge service life" Am. Ind. Hyg. Assoc. J. 45(8): 509-516 (1984).
5. ASME N509-1989, "Nuclear Power Plant Air-Cleaning Units and Components" American Society of Mechanical Engineers, 345 47th Street, New York, NY 10017, (1989).
6. ASME AG-1-1994, "Code on Nuclear Air and Gas Treatment", American Society of Mechanical Engineers, 345 47th Street, New York, NY 10017, (1994).
7. Martin, D., Hauthal, H.G., and Halberstadt, E.S., "Dimethyl Sulfoxide", Van Nostrand Reinhold Company Ltd., Berkshire, England (1975).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

BELLAMY: It is interesting to hear about the destruction effort that is underway. There are people worried about nuclear war heads, but it is now more in decontamination and decommissioning activities than in their use.

FLEMING: I was going to suggest that when conducting the filling procedure for the cartridge that perhaps you could take a lesson from the people who fill carbon filters, Fred Leckie will tell you that you need to "triculate" the carbon in to get it to pack efficiently. Perhaps you should talk to a few of the manufacturers to get a good method, because I think that will improve your efficiency dramatically.

BERGMAN: Thank you for your suggestion.

RICKETTS: I was wondering how you actually measured the DMSO concentration up and downstream of your carbon filter?

BERGMAN: We measured DMSO as a relative measurement, based on a Moran analyzer, it was not an absolute measurement. We calibrated the instrument in the laboratory with a known concentration, by injecting it with a syringe, and called that the 100% upstream concentration. Then, for zero percent, we used air filtered through a carbon bed. Although we could do this fairly nicely in the laboratory when we went into the field we did not have the luxury of all these things, and whatever the instrument read at the time, we used. So, it was a relative measurement. We had an upstream zero, and that was the extent of our calibration.

RICKETTS: I understand DMSO is very hygroscopic. Do you have to worry about the concentration of the water vapor in the air stream coming into the system?

BERGMAN: Yes, DMSO is extremely hygroscopic, to the point where we had tremendous experimental problems with things like measuring filter weights. We would load a lot of particles on to a filter, but the filter would lose weight because of losing the previously absorbed water. We had to effectively precondition the filter, i.e., dry it, by passing DMSO vapor through it. It is a tremendously effective water scrubber. For most applications we would have to use an inlet filter to remove water vapor, otherwise we would have a real horrendous problem. Fortunately, the place where these operations will be conducted is in Pantex, which typically has 10% RH, so they do not foresee it as a problem. If there is a problem, you immediately start seeing a lot of high explosives on the bottom of all your trays, not the most optimum condition. When that becomes apparent, you do not proceed very far under those conditions.

A THICK HOMOGENEOUS VEGETATED COVER
DESIGN PROVES COST- AND SCHEDULE-EFFECTIVE
FOR THE RECLAMATION OF URANIUM MILL SITES
NEAR SPOKANE, WASHINGTON

John Blacklaw, Gary Robertson, Dorothy Stoffel,
Jamil Ahmad, Earl Fordham, Sheila Pachernegg,
Leo Wainhouse, and John Riley

Division of Radiation Protection
Washington State Department of Health
Thurston Airdustrial Center, Building 5
Olympia, Washington 98504-47827

Abstract

The Washington State Department of Health (WDOH) has licensed two medium sized uranium mills with tailings impoundments covering 28 and 40 hectares (70 and 100 acres), respectively. The uranium mill licensees have submitted closure and reclamation plans to the state, and site-specific conditions have determined the closure design features.

Conventional uranium mill cover designs usually incorporate an overall cap of one to three meters, which includes a low-permeability clay barrier layer. A technical evaluation of several uranium mill facilities that used this design was published in the fall of 1994 and reported that unexpected vegetation root damage had occurred in the low-permeability clay (or bentonite amended) barrier layers. The technical report suggested that the low-permeability design feature at some sites could be compromised within a very short time and the regulatory goal of 1,000 years performance might not be achieved. In October 1994, WDOH sponsored a technical forum meeting to consider design alternatives to address these reliability concerns. Representatives from the federal government, nuclear industry, licensees, engineering firms, and state regulatory agencies attended the workshop.

Risk factors considered in the evaluation of the uranium mill reclamation plans include: (1) radon gas emanation through the cover (the air pathway), and (2) migration of hazardous and/or radioactive constituents (the groundwater pathway). Additional design considerations include site structural stability, longevity of 1,000 years, and no active (ongoing) maintenance.

Both closure plan designs originally presented to the department incorporated conventional low-permeability clay or bentonite amended cover layer designs. The department determined that the low-permeability layers at the Washington sites would be prone to failure due to biointrusion and freeze-thaw at these sites. A thick homogeneous vegetated cover design was then evaluated. Consequently, both closure plan designs were revised. All outstanding design and construction regulatory requirements were addressed prior to final approval by the state. The revised plan meets regulatory requirements, allows for construction efficiency (cost and schedule), and meets QA/QC goals.

I. Introduction

The Waste Management Section of the Division of Radiation Protection in the state's Department of Health manages the Uranium Mill program through rules and regulations. These rules are the result of professional rule development based on legislative authority and evaluation of risk. The NRC⁽¹⁾ and EPA⁽²⁾ each produced environmental impact statements as the basis for their uranium mill regulations. The state of Washington, as an NRC Agreement State, enforces the federal regulations under state legislative mandate⁽³⁾ and agency rule.⁽⁴⁾ The resulting rule language is presented in the form of performance-based, non-prescriptive "Criteria." The NRC has developed several guidance documents, with the most applicable being a Staff Technical Position for Design of Erosion Protection Covers for Uranium Mill Tailings Sites.⁽⁵⁾ This paper describes the state's involvement in the evolution of the thick homogeneous vegetated cover design.

II. Conventional Cover Design

When the state's uranium mill licensees decided to terminate their radioactive materials licenses and begin closure and reclamation of their sites, the department required that final closure plans be submitted for approval. This review was a technical evaluation to ensure compliance with regulatory criteria. WDOH regulations allow licensees to propose any cover designs that can demonstrate compliance with performance-based requirements in the regulatory "Criteria". In 1994, both uranium mill licensees submitted closure plans⁽⁶⁾ & ⁽⁷⁾ to the department for review and approval.

During the same period of time, a technical report⁽⁸⁾ was published by the Uranium Mill Tailings Remedial Action (UMTRA) Project. The report described how biointrusion on rock-covered

disposal cells had impacted the stability of covers at completed U.S. Department of Energy (DOE) sites. The study suggested that "continued plant growth on the rock-covered cells will alter the characteristics of the cover system. As roots advance through the cover, they introduce organic matter into the cover, and upon their death leave conduits through which liquids and gasses may pass readily. These roots and associated processes will eventually transform the radon barrier into a biological soil, which could degrade the performance of the engineered layer relative to its intended function." In response to this report and staff concerns, the Waste Management Section sponsored a technical meeting⁽⁹⁾ to discuss and identify potential impacts to the low-permeability barriers from biointrusion, freeze-thaw, no active maintenance, and other factors.

III. Long-Term Reliability Concerns

One of the major concern with uranium mill cover designs is that they should be stable for 1,000 years. Studies show that conventional cover designs may not meet this longevity requirement. Since department regulations do not allow the inclusion of active maintenance into closure plans, cover designs must be evaluated to account for this. The following paragraphs describe typical problems faced by uranium mill sites, which conventional cover designs may not be adequate to meet:

III.1 Background

Uranium production in this nation supports the uranium fuel cycle for the nuclear power industry, and the nation's nuclear weapons program. Uranium mill tailings are the byproduct (waste stream) resulting from the production of uranium oxide from uranium ores. Tailings are produced as a result of chemical separations and typically produce an acidic liquid slurry waste stream. The high volume liquid waste is pumped to large impoundments where pH balance is accomplished and solids precipitate and settle out. Larger particles settle near the discharge, with fine particles settling further away. This results in a concentrating effect in the distribution of fine particles, sometimes called "slimes." These slimes are difficult to stabilize because they do not readily de-water and lack structural strength.

The radioactive constituents of potential environmental concern include radium-226 and radon-222 gas produced by radioactive decay. Radon gas has a half-life of 3.8 days and

diffuses from the tailings through the cover to the atmosphere. Uranium mill covers are designed to slow the rate of radon gas diffusion/emanation to acceptable regulatory standards. Many of the radioactive and hazardous constituents present in the tailings may affect the groundwater. Their mobility and potential impacts are dependent on many factors. For example, the site-specific geology and hydrogeology can strongly influence how well the uranium mill tailings are isolated. Design features of the impoundment include the liner (or lack thereof), methods used to control pH during waste disposal, ore and process variables, and cover design. Environmental site features of major importance include weather, upstream watershed characteristics, soil characteristics, earthquake potential, and natural vegetation succession.

Since radium-226 has a half life of 1620 years, the regulatory requirement for the isolation of uranium mill tailings is "1,000 years to the extent reasonably achievable, and, in any case, for at least two hundred years." From a regulatory point of view, it is impractical to expect that active, ongoing maintenance could be assured by administrative and institutional controls for more than 100 years. Therefore, the regulatory requirement states that "final disposition of tailings or wastes at milling sites should be such that ongoing active maintenance is not necessary to preserve isolation."

III.2 UMTRA Project Experience

Burt and Cox reported on experiences at UMTRA Project sites in a technical report published in 1994⁽⁸⁾. The six sites discussed included five in relatively dry locations, some at higher elevations, and one in much wetter Pennsylvania. In each case, site-specific environmental and design features affected the impact and rate of sand and vegetation intrusion. The contaminated materials at these disposal cells were covered by a three-part system consisting of a radon barrier, a bedding layer, and a rock erosion layer. The radon barrier consists of a highly compacted soil/clay layer designed to limit radon emanation and water infiltration. The bedding layer is designed to support the rock erosion layer, prevent the rock from penetrating the radon barrier, and reduce or prevent the erosion of the radon barrier. The rock cover is designed to prevent water and wind erosion from affecting the stability of the disposal cell. In the relatively short time-span of one to three years after construction completion, the characteristics of vegetation coverage had exceeded design expectations. Deep-rooted species had invaded cover areas and had

begun to grow into the radon barrier. Maintenance of the sites now includes cutting of vegetation and use of herbicides. Report recommendations include design modifications for new sites to either increase cover rock thickness to prevent vegetation, or increase thickness of cover to minimize detrimental effects of deep-rooted vegetation.

Conventional cover designs are typically based on a design infiltration rate of 2.5×10^{-7} cm/sec (1.0×10^{-7} in/sec), and there are concerns that vegetation or animal intrusion could increase the infiltration rate.

III.3 Biointrusion

In 1994, the department began its technical review of the submitted closure plans, with both plans incorporating relatively thin (about two meters) cover designs with low-permeability clay or bentonite amended soil layers. The amended layers were 0.5 to 1.0 meter (1.5 to 3 feet) thick and were placed below native soil and a top soil cover. A rock mulch and synthetic layer were included in one of the designs. After extensive study, the department determined that biointrusion could cause failure of the low-permeability clay barrier. Factors which influenced this determination included the inability of clay-type soils to self-heal following root intrusion, and the ability of burrowing animals to move through supportive soils to depths of two meters, thus creating holes (voids) or channels which then could fill with less permeable materials. The net effect of such biointrusion is possible failure of the low-permeability clay barriers during the 1,000 year period at these sites.

III.4 Freeze-Thaw

For many sites at higher elevations or in northern latitudes, the soil column will freeze to an appreciable depth during periods of prolonged cold weather. This is true for each of Washington's sites, which are located in the northeastern section of the state. Soil columns in these areas are known to freeze to a depth of one meter or more. When considering a design that must retain performance for such a long time period, even rare occurrences that affect performance must be considered. It has been demonstrated that highly compacted clay barriers lose their low-permeability performance after repeated cycles of freeze-thaw conditions. Therefore, any clay barrier designed in a soil horizon susceptible to freeze-thaw action will not likely retain its long-term low-permeability performance.

III.5 Maintenance

Any design that must last 1,000 years must not be based on administrative/institutional controls to assure performance. Man's historical record does not justify such an allowance, even in the best of assumptions of political and economic stability. If maintenance is required over short time periods, then such a design cannot be considered, unless there is no other practical approach. When the department considered this factor, it became obvious that plant and animal intrusion would occur at Washington's sites because there is sufficient moisture and the soil and weather conditions are favorable for plant and animal life. The department had to assume that biointrusion would occur; not only that, but biointrusion could potentially be very beneficial to the cover design. Therefore, the cover must be designed to either prevent biointrusion, or to incorporate it; either way, ongoing active maintenance would not be required.

IV. Thick Homogeneous Vegetated Cover Design

The concept of a thick homogeneous vegetated cover design is certainly not new and novel in the sense that it has been considered in the past. Such a design is simple and is not considered high-technology. It is simply a brute force method that uses a larger mass of material (greater thickness) to provide isolation of tailings. The larger mass is more stable, considering structural impacts from the environment (erosion, earthquakes, root penetration, etc.). The larger mass is also less sensitive to construction methods and techniques, material properties for available borrow soils, and requires less exported materials (bentonite, clay, rock, synthetics, etc.).

IV.1 Vegetation

The thick cover design must account for vegetation and animal intrusion. Since the presence of vegetation is almost guaranteed, one should consider its effects on the design. A thick cover that contains homogeneous, free-flowing material will be self-healing and the presence of plant root successional effects will not provide preferential pathways, since a low-permeability barrier layer is not present. Performance will not be degraded by the presence of plants and plant roots. If the cover is thick enough, a very large portion of root mass will be found in the upper portion, and root effects will be diminished. A cover depth of four to five meters is considered sufficient to mitigate biointrusion impacts.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

There is a very significant benefit from vegetation in that plants transpire large volumes of water from the ground into the air in the process of producing plant mass. The ratio of water volume transpired to plant mass produced is species-dependent, and ranges from 100 to 1,000. Evapotranspiration is greater during higher temperature summer conditions and generally exceeds natural rainfall precipitation, on average. Since most precipitation occurs during winter and most evapotranspiration occurs during summer, the soil column (cover) must be thick enough to contain the water without allowing deep percolation during the winter and spring, and release it in the summer and fall through evapotranspiration. If the cover is thick enough, the seasonal cycles will not impact deeper than the upper layer of the cover, and the tailings will remain well protected. In fact, if vegetation is deep rooted enough to access available moisture, essentially all of the year's accumulated precipitation will be removed by the end of the dry season. This process achieves the same general result as a low-permeability clay layer design.

IV.2 Radon Gas Emanation

Radon gas emanation is a process of vapor diffusion through the soil and release to the atmosphere at the surface, where it could be inhaled. The radon gas inhaled could decay and produce a negative health effect to the exposed person. In practice, a relatively thin (about one meter) low-permeability clay barrier layer incorporated into a conventional design (total cover thickness of about two meters) has almost the same theoretical radon emanation rate as a thick (about four meters) homogeneous uncompact soil cover. With conservative assumptions of soil characteristics, soil moisture, and soil compaction, it becomes quite unlikely that any external variable can cause the thick soil cover design to exceed the design limit. This is not the case with thin barriers placed near the surface. For instance, gas diffusion is highly dependent upon soil moisture content. A thick cover design is much more likely to maintain generally average soil moisture properties during the course of seasons and years than will a thin clay layer.

IV.3 Infiltration of Radioactive or Hazardous Constituents

Infiltration of moisture through the cover, and subsequent percolation through tailings and the underlying vadose zone to the groundwater, will determine the groundwater impact. This impact is generally in the form of a concentration (e.g., ppm) or a rate of contaminant flux, (e.g., gm/yr). For radioactivity, the usual

units are pCi/l for concentration and pCi/yr for flux rate, and each radionuclide is considered individually because of the inherent difference in potential health effects. Reducing infiltration rates to zero theoretically eliminates the groundwater impact, since a potential waste stream that does not flow is not evident (impacting) to a potential recipient. Low-permeability barrier layers that are likely to fail their design permeability rates will likely produce greater infiltration rates on average over the design life of 1,000 years, than thick homogeneous vegetated cover designs that are optimized for vegetative production and high rates of evapotranspiration. Specific site conditions are important to this general statement and must be fully evaluated to achieve the benefit expressed.

IV.4 Structural Stability

The structural stability design parameters for uranium mills provide guidance to assess performance over the long term. This includes resistance to the detrimental effects of wind and water erosion, earthquakes, post-construction settlement, rock durability limitations, and others. The design analysis that justifies the design compliance with structural requirements includes long-term wind and water erosion and deposition estimates, and flooding from a probable maximum precipitation (PMP) event and its resulting probable maximum flood (PMF). In all cases, the thickness of the cover enhances compliance and long-term reliability performance. The effects of settlement can produce changes in slope that could affect erosion or deposition. Closure plans reviewed by the department used very shallow slopes (less than 2%) and did not require rock mulch on the surface to attain erosional stability. This enhances the natural vegetative production needed by other performance parameters. It was determined that even if settlement occurred and changed the slope, it would not be significant to erosional performance; vegetation would eliminate any ponding of water that might result, so there would be no increase in infiltration. The detrimental settlement effects of compacted clay barriers (infiltration breaks) are absent in thick homogeneous cover designs. Therefore, an uncompacted cover design would not be compromised by settlement. The department also found that the thick homogeneous cover is easy to build and readily meets design specifications.

IV.5 Longevity

The thick homogeneous cover was determined to be the most suitable for assuring compliance with the 1,000 year design

criteria at Washington State sites.

IV.6 Administrative Requirements

The regulations impose several administrative requirements that take effect after construction is completed, and after the radioactive materials license is terminated. By regulation, the following requirements are imposed: (1) surety is provided, based on a 1% real rate of return, to perpetually fund a surveillance program; (2) the state or federal government will own the land and/or provide responsibility for long-term performance; and (3) the facility will be annually surveyed.

V. Conclusions

The performance-based regulations relative to the development of closure and reclamation plans at Washington's two uranium mill sites have allowed for a potential improvement in their closure designs. There is now another method of isolating waste using a thick cover approach that has potential long-term reliability benefits, when compared with the low-permeability, relatively thin barrier designs. It is likely that these benefits can also be achieved at other sites with similar environmental characteristics. In the following sections are examples of department experience at the two uranium mill sites, both of which are located in northeastern Washington:

V.1 Cost Impacts

The closure design for one of the mills was approved conceptually, on condition that detailed construction designs and specifications be submitted for review when the site is ready for final closure. It is estimated that by using the thick cover design instead of the conventional design, approximately \$1 million will be saved on closure costs.

Closure of the other uranium mill is being performed in phases and contains a Tailings Reclamation Plan that includes the design basis and construction of the tailings cover and surrounding diversion channel. The mill building and process equipment were disposed of previously. Contaminated site soils were cleaned up in a separate plan that is essentially complete. Construction is well underway and is expected to be essentially complete by autumn 1996. The cover will be installed, the diversion channel cut, rock erosion protection placed, and exposed disturbed ground re-vegetated (seeded). Again, it is estimated that by using the thick

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

cover design instead of the conventional design, approximately \$1 million will be saved on closure costs.

V.2 Schedule Impacts

Schedule impacts at one uranium mill facility have not been identified, as the design is approved only conceptually and details of construction scheduling have not been developed. Nevertheless, it will certainly be a positive schedule benefit when bentonite imported from Wyoming and mixed and placed to tight specifications is replaced by native borrow material from the site or from other local sources.

It is readily apparent that the closure project at the other uranium mill facility would be greatly impacted by the schedule implications of a conventional cover design. The normal weather conditions in northeast Washington would make it quite difficult to produce a highly compacted clay barrier in any case. The normal requirement to monitor for settlement of the cover would, in itself, cause an additional year of construction. The design, as approved is approximately 25% complete at this time and is expected to be greater than 95% complete this fall. When time is money, this schedule benefit will surely result in additional unaccounted cost savings.

V.3 Quality Assurance

Although not mandated, it is important for a regulatory agency to be cost or schedule conscious; it is a public service to be considerate of such things, so long as the environment and the public are adequately protected by compliance with regulatory requirements. Quality assurance can therefore provide the check that all regulatory requirements have been, or will be, met. Compliance has been assured by considerable technical review by a multi-disciplinary review team of engineers, hydrogeologists, health physicists, licensing specialists, and others. The licensees, their engineering and technical consultants and their contractors have been most cooperative. Quality control will be provided by department field inspection.

V.4 Long-Term Reliability

One of the best ways to achieve long-term reliability is to develop something that is in harmony with its environment and also resistant to the erosional and depositional forces that may come to bear. Such stability must be assured for both the relentless

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

forces of everyday environmental impacts and for the intensity of the unusual event (floods, earthquakes, droughts, and others).

References

1. "Final Generic Environmental Impact Statement on Uranium Milling, Project M-25," NUREG-0706, Office of Nuclear Material, Safety and Safeguards, U.S. Nuclear Regulatory Commission, September 1980.
2. "Final Environmental Impact Statement for Standards for the Control of Byproduct Materials from Uranium Ore Processing (40 CFR 192)," EPA 520/1-83-008-1, Office of Radiation Programs, U.S. Environmental Protection Agency, September 1983.
3. "Mill Tailings - Licensing and Perpetual Care," Chapter 70.121, Revised Code of Washington.
4. "Radiation Protection - Uranium and/or Thorium Milling," Chapter 246-252, Washington Administrative Code.
5. "Final Staff Technical Position, Design of Erosion Protection Covers for Stabilization of Uranium Mill Tailings Sites," U.S. Nuclear Regulatory Commission, August 1990.
6. "Closure Plan for Closure of the Dawn Mining Company Uranium Millsite Near Ford, Washington," prepared by Dawn Mining Company, Shepherd Miller, Inc., Western Radiation Consultants, Inc., Keystone Scientific, Inc. and VZM, May 1994, and revisions thereto.
7. "Sherwood Project, Tailing Reclamation Plan," Prepared for Western Nuclear, Inc., Prepared by Shepherd Miller, Inc., December 1994, and revisions thereto.
8. Burt, Charles J., and Cox, Steven W., "An Assessment of Plant Biointrusion on Six UMTRA Project Disposal Cells," UMTRA Project, Albuquerque, NM, 1994.
9. Technical Meeting, Sponsored by Waste Management Section, Division of Radiation Protection, Washington Department of Health, "Conceptual Cover Designs," September 29, 1994, Spokane, WA.

DISCUSSION

BELLAMY: Do you know any basis for the thousand-year criterion that you mentioned, because I don't?

BLACKLAW: The first basis is that it is in the regulations as a criterion, and is specifically noted there. I believe it comes from the development of regulations by NRC, which also came from a generic environmental impact statement where risks were evaluated. I am sure that it comes from the half-life of radium-226, 1600 years.

CHAIRMAN'S CONCLUSION

BELLAMY: It is clear that decontamination and decommissioning in the waste management area is an up and coming concern and that we are going to have to tackle it in the years to come. Additional discussion of Hanford will be presented tomorrow at the working luncheon. I encourage everybody to have further thoughts on the topic.

SESSION 3

INSTRUMENTATION AND MEASUREMENT

Monday, July 15, 1996

Co-Chairmen: W.L. Anderson
R. Zavadoski

PRACTICAL EXPERIENCE APPLIED TO THE DESIGN OF
INJECTION AND SAMPLE MANIFOLDS TO PERFORM IN-PLACE
SURVEILLANCE TESTS ACCORDING TO ANSI/ASME N-510

E.M. Banks, W.O. Wikoff, and L.L. Shaffer

UNIT VENT AIRFLOW MEASUREMENTS USING A TRACER
GAS TECHNIQUE

D.G. Adams, P.L. Lagus, and K.M. Fleming

DEVELOPMENT OF REAL TIME DETECTOR FOR
FLUORESCENT PARTICLES

C. Prevost, J. Vendel, and A. Seigneur

ACCURACY IMPROVEMENT IN LEAK DETECTION OF
CHARCOAL ADSORBERS BY HALIDE PULSE INTEGRATION
METHOD

B.J. Kovach and E.M. Banks

TESTING THE SAMPLING EFFICIENCY OF A NUCLEAR
POWER STATION STACK MONITOR

L.H. Ström

THE INFLUENCE OF SALT AEROSOL ON ALPHA RADIATION
DETECTION BY WIPP CONTINUOUS AIR MONITORS

W.T. Bartlett and B.A. Walker

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

PRACTICAL EXPERIENCE APPLIED TO THE DESIGN OF INJECTION AND SAMPLE MANIFOLDS TO PERFORM IN-PLACE SURVEILLANCE TESTS ACCORDING TO ANSI/ASME N-510

Eric M. Banks, Walter O. Wikoff, Larry L. Shaffer
NUCON International, Inc.
Columbus, Ohio

Abstract

At the current level of maturity and experience in the nuclear industry, regarding testing of air treatment systems, it is now possible to design and qualify injection and sample manifolds for most applications. While the qualification of sample manifolds is still in its infancy, injection manifolds have reached a mature stage that helps to eliminate the "hit or miss" type of design.

During the design phase, manifolds can be adjusted to compensate for poor airflow distribution, laminar flow conditions, and to take advantage of any system attributes. Experience has shown that knowing the system attributes before the design phase begins is an essential element to a successful manifold design. The use of a spreadsheet type program commonly found on most personal computers can afford a greater flexibility and a reduction in time spent in the design phase.

The experience gained from several generations of manifold design has culminated in a set of general design guidelines. Use of these guidelines, along with a good understanding of the type of testing (theoretical and practical), can result in a good manifold design requiring little or no field modification. The requirements for manifolds came about because of the use of multiple banks of components and unconventional housing inlet configurations. Multiple banks of adsorbers and pre and post HEPA's required that each bank be tested to insure that each one does not exceed a specific allowable leakage criterion.

Introduction

The often critical application of nuclear air treatment systems (NATS) installed at various nuclear, chemical, and biological facilities has necessitated the testing of the individual components to ensure their leak tightness. As the various facilities have grown and matured over the years, so have the NATS. The design of NATS has gone from simple single bank, sheet metal, and silicone sealed units to multiple bank, stainless or coated steel, all welded construction. Since the industry needs to ensure with a high degree of confidence that the individual banks of components inside the NATS will perform as required, refined injection and sampling techniques had to be developed. The use of injection and sample manifolds has been introduced to meet this need.

While this paper will introduce some basic design guidelines for manifolds, it can in no way envelop all of the variables associated with system, component, and application design and installation. The major emphasis will be placed on injection manifolds required on post installation NATS. Although the major emphasis is on injection manifolds, most of these guidelines can be applied to the design of sample manifolds as well.

Discussion

One of the most important steps in the design of an injection manifold is deciding where to place the manifold in the NATS. The primary placement of the manifold is determined by the function of the manifold and the component layout of the filter bank. The best location takes advantage of system or component attributes that create increased velocity and flow turbulence in the housing (for example, at the outlet air slots of type II adsorber trays or at the inlet or outlet slots of a type III deep bed adsorber bank). Other locations could be at the air flow traverse station or just upstream of the system inlet plenum. All these options must be examined and the best location chosen before the design phase.

These steps are given in order of importance for determining the best location of the injection manifold:

- Function of the injection manifold.
 - Is it an injection or sample manifold only or is to be used as a combination injection / sample manifold?
- Airflow velocity.
 - What are the maximum and minimum velocities expected at the manifold location?
- Airflow distribution.
 - What is the velocity profile of the airstream at the manifold location?
- Ease of installation and use.
 - Is the manifold to be temporary or permanent?
 - Is the manifold to be installed in the ductwork or inside the NATS housing?
 - From what material should the manifold be constructed?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

During the design process it is important to understand how the system and its components work. For example:

- The air velocity through a NATS housing is usually less than 200 feet per minute (fpm) which is considered to be in the laminar flow region. By being laminar, very little mixing will occur inside the housing.
- The air velocity at the face of a 24 x 24 x 11.5 inch standard size 1000 cfm HEPA filter is approximately 300 fpm.
- The air velocity at the face of the outlet air slot for a standard type II adsorber tray is approximately 1300 fpm.
- The airflow velocity at the inlet and outlet air slots of a type III adsorber bed is generally lower than that exiting a type II tray, and higher than at the face of a standard size HEPA.
- On most Type III adsorber beds the outermost air slots are, by design, operating at an assumed 50% of the airflow of the inner air slots due to the bed geometry.

Another factor that will affect the manifold design is the airflow distribution (velocity profile) at the proposed manifold location. When designing an injection manifold for use downstream of the upstream HEPA bank, an airflow distribution test must be performed. If the airflow distribution meets the acceptance criteria of no one reading exceeding $\pm 20\%$ of the average velocity, then no special design adjustments are required. However, if this $\pm 20\%$ is exceeded then design adjustments of the manifold may be required.

Generally in most NATS there are other factors that enhance challenge agent mixing (e.g., distance) to eliminate a concern over a $\leq 20\%$ difference in airflow distribution. If the manifold is to be located where the airflow distribution exceeds $\pm 20\%$, then the manifold should be designed proportionately. The need for proportionate design usually occurs when the manifold is to be installed in ductwork where short distance mixing is required.

A typical manifold consists of a header and risers (See Figure 1). Each riser has a series of holes through which the challenge agent is introduced to, or withdrawn from, the air stream. See Figure 2 for more details.

Figure 1 Simplified layout of an injection/sample manifold.


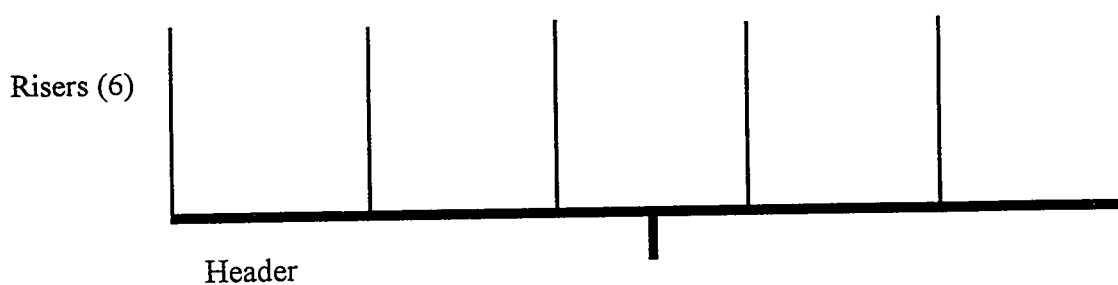


Figure 2
Typical combination manifold (injection & sample) designed to be installed in the air channels of a type II adsorber bank.

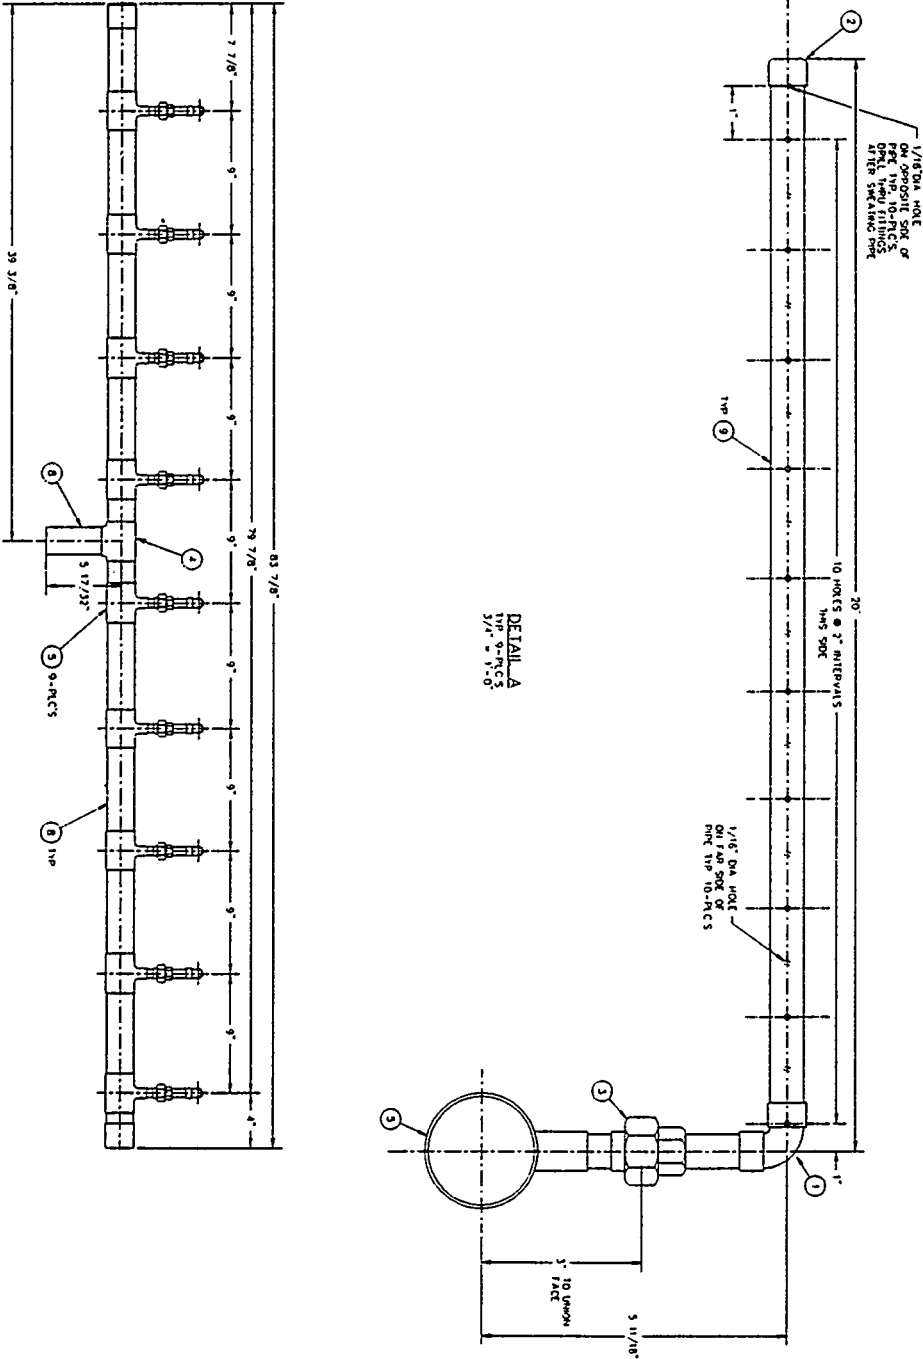

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Once the location of the manifold is identified, the next step is determining the location of each riser. The risers should be placed to take advantage of system or component designs that increase velocity. For example, risers placed directly in the air channel of a type II or type III adsorber bed will take advantage of the increased velocity associated with those air channels.

If the manifold is to be placed in rectangular ductwork supplying the NATS, then divide one axis of the ductwork into equal areas using the same methodology for determining the traverse points for a rectangular duct airflow traverse. Each manifold riser should be positioned in the center of these equal areas. The distance between these equal areas should generally not exceed six inches. Depending on the velocity of the airflow, duct layout and the distance to the bank being tested, the distance between these equal areas could exceed or be less than six inches. This methodology can also be applied to a round duct.

Another possible location is at the downstream face of the prefilter bank or upstream HEPA bank. The latter would be necessary if the NATS contained a downstream HEPA bank that was required to be tested. While this location is usually less desirable due to the low exit airflow velocity of these components, designing a suitable manifold is possible. Two items to keep in mind are; first, if the filters do not load evenly (dirt loading) this will affect the performance of the manifold and second, when the filter bank is replaced it should be a full replacement rather than a partial replacement. The location of the risers is determined using the same method as for ductwork. The risers need to be positioned to cover only the face of each filter. No holes should be drilled in an area of no airflow (i.e., between filters).

An ideal location for a manifold in a NATS housing will take advantage of the high airflow velocities associated with type II or Type III adsorber banks. The risers for these manifolds need to be located at each air channel. The best position for each riser is just inside each air channel (approximately 50% should be inside the air channel) to take full advantage of the higher velocities.


Design Method

After the location of the manifold and positioning of the risers has been established, the next step is designing the manifold. The basic steps in designing a manifold require determining:

- 1) Riser hole layouts (spacing and angular position with respect to airflow).
- 2) Quantity of holes per riser.
- 3) Diameter and area of the riser holes.
- 4) Riser pipe diameter and area.
- 5) Header pipe diameter and area.

The hole layout on each riser should cover the effective airflow area. From applied experience a hole spacing of approximately two inches apart per side and staggered on each side is desirable. Hole location should be 180° degrees apart and perpendicular to the direction of airflow.

Figure 3 Typical hole layout of a riser.

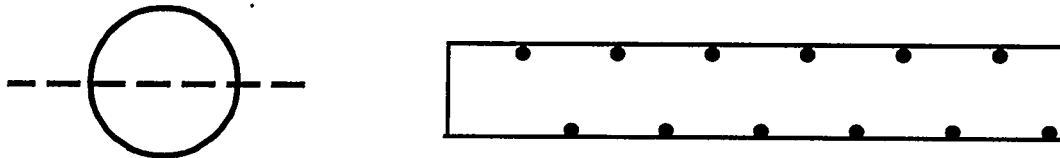

The riser pipe diameter depends on the quantity of holes per riser and the sum of their areas. Depending on the positioning of the individual risers and the adjacent components (if any), the riser diameter can also be used to increase the velocity and turbulent flow of the air stream. Experience has shown that the decrease in air channel area will add approximately 0.5 to 1.0 inches of pressure drop across the bank. This does not apply when the risers are to be positioned in the ductwork or on the downstream side of a prefilter or HEPA bank.

Two rules apply to the sizing of riser holes:

- The cross-sectional area of the riser should be greater than or equal to ($\pm 10\%$) the sum of the areas of the holes per riser.
- The cross-sectional area of the header should be greater than or equal to ($\pm 10\%$) the sum of the areas of the holes in all the risers.

When designing a manifold to be placed where the airflow distribution (velocity profile) exceeds $\pm 20\%$ of the average and short distance mixing is required, the hole sizing on the risers must be proportional to the airflow. The use of any spreadsheet program with plotting capabilities is very useful when performing the following steps:

- 1) Perform an airflow distribution test by measuring the airflow velocities at equal areas for each riser region position.
- 2) Calculate the velocity total for all readings.
- 3) Calculate the % of average for each velocity reading.
- 4) Determine the % of total velocity for each riser region.
- 5) Determine the total riser area.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- 6) Calculate the required total hole area for each riser region.
- 7) Determine the quantity of holes corresponding to each riser region from the location of the velocity readings and the desired hole layout.
- 8) Determine the hole diameter for each riser region.

The sizing of the holes, riser, and header may allow several variations from which to decide. From these options, several items should be evaluated:

- Difficulty in drilling the holes.
 - Very small holes are difficult and time consuming to drill.
- Ease of use if it is only installed temporarily for testing.
- Complexity of assembling temporary manifolds.

Once the design is finished, the material from which to construct the manifold needs to be chosen. Things to consider when deciding on construction materials are:

- Composition of the airstream (e.g., acid or alkaline gases, particulate types and concentration, moisture, etc.).
- Temperature of the air stream.
- Velocity of the air stream at the manifold location.
- Decontamination requirements, especially if it is a temporary manifold.

While PVC, stainless steel, and mild steel have all been used in the past, copper tends to be the best overall choice. It is easy to work with, relatively light, and cost effective. After the manifold has been constructed it is important that all burrs be ground smooth and provisions made to clean the internals of the manifold. This is especially important when the manifold is to be used as a combination injection and sample manifold.

Once the manifold has been constructed, it still must be qualified by performing an air-aerosol mixing test. If the design guidelines have been properly followed then this test should be uneventful. However, if the design guidelines were not followed or some unforeseen problems occur, then field modifications of the manifold may be required. This field modification may range from minor changes, such as hole plugging or enlarging holes, to major redesign work.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The following is an illustration of a 30,000 CFM NATS. Although it contained only a single HEPA and adsorber, bank an injection manifold was required. The only available injection point was located at the pitot traverse location. This location was approximately four feet from the inlet to the housing (See Figure 4). First, a velocity traverse was performed and this profile was graphically plotted out (See Charts 1 & 2). After analyzing the velocity profile and determining the riser hole layout a spreadsheet was designed to simplify the process of calculating the required velocity percentages and hole areas (See Table 1). The manifold was designed using this information and a successful air-aerosol mixing test was performed with no field modifications required of the manifold (See Figure 5).

Figure 4 Physical layout of the 30,000 CFM NATS.

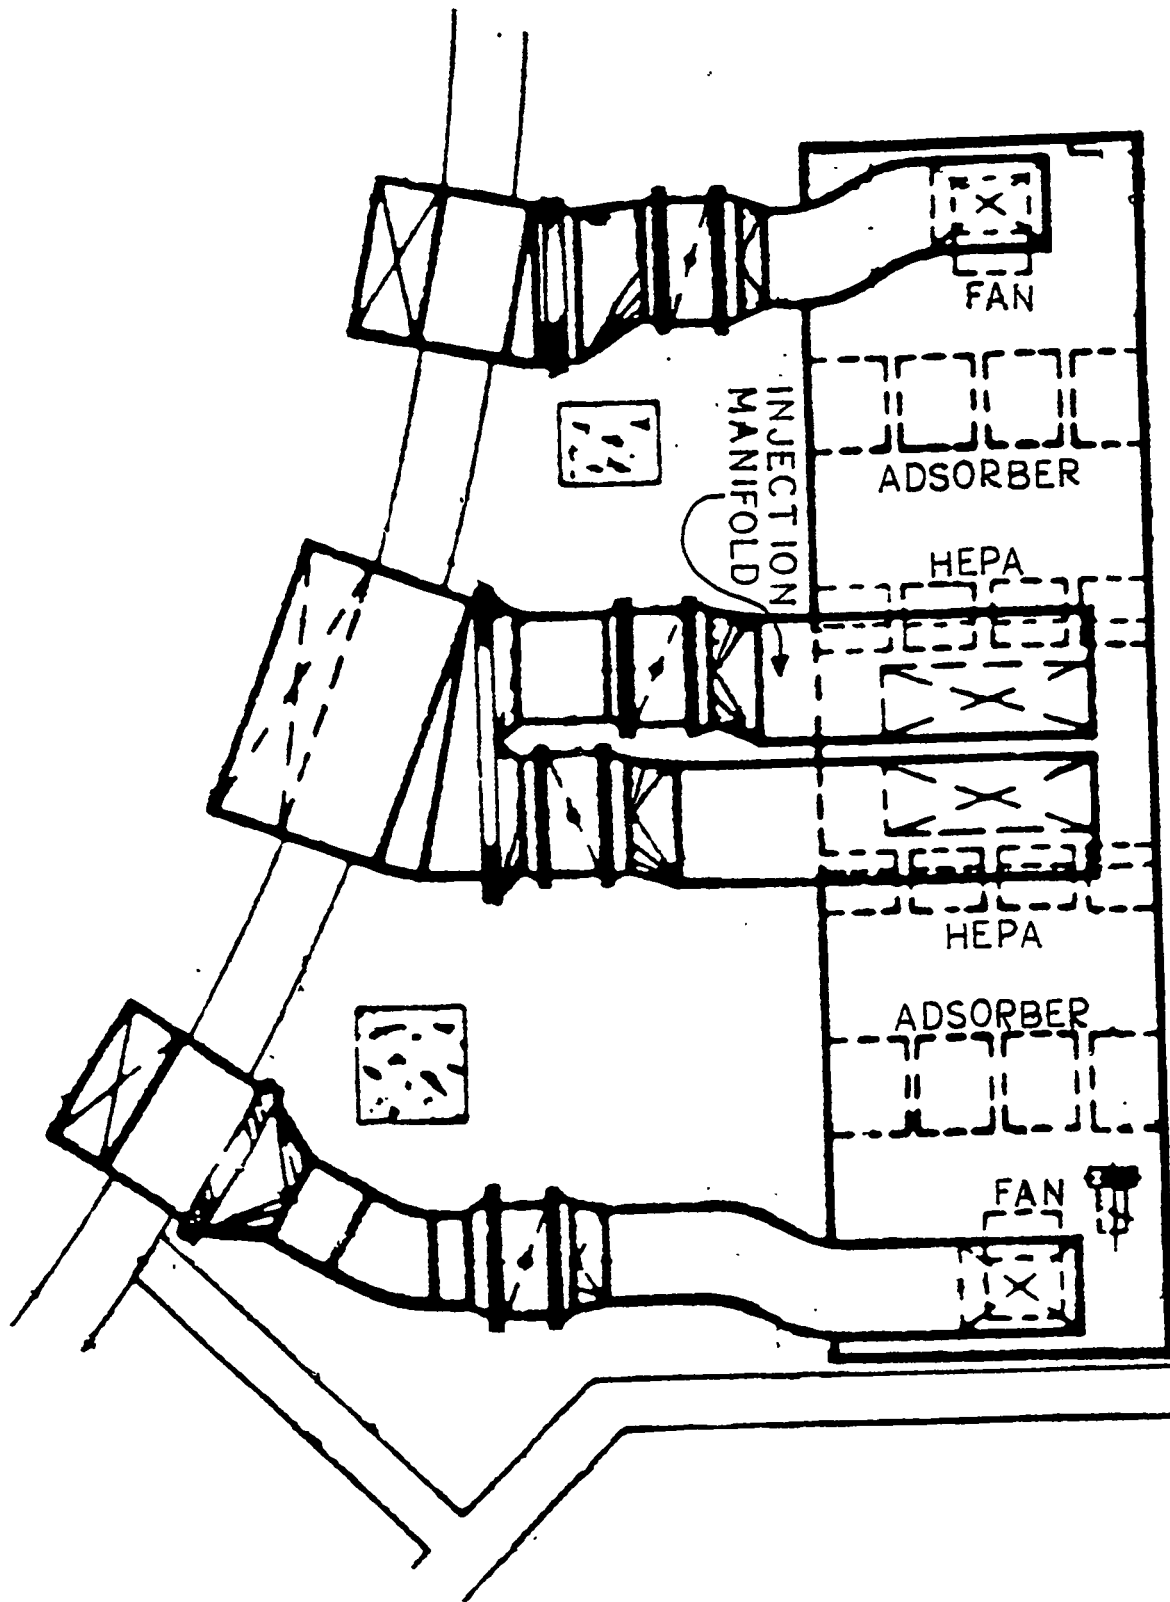


Chart 1 Bar graph plot of the individual velocity points inside the duct.


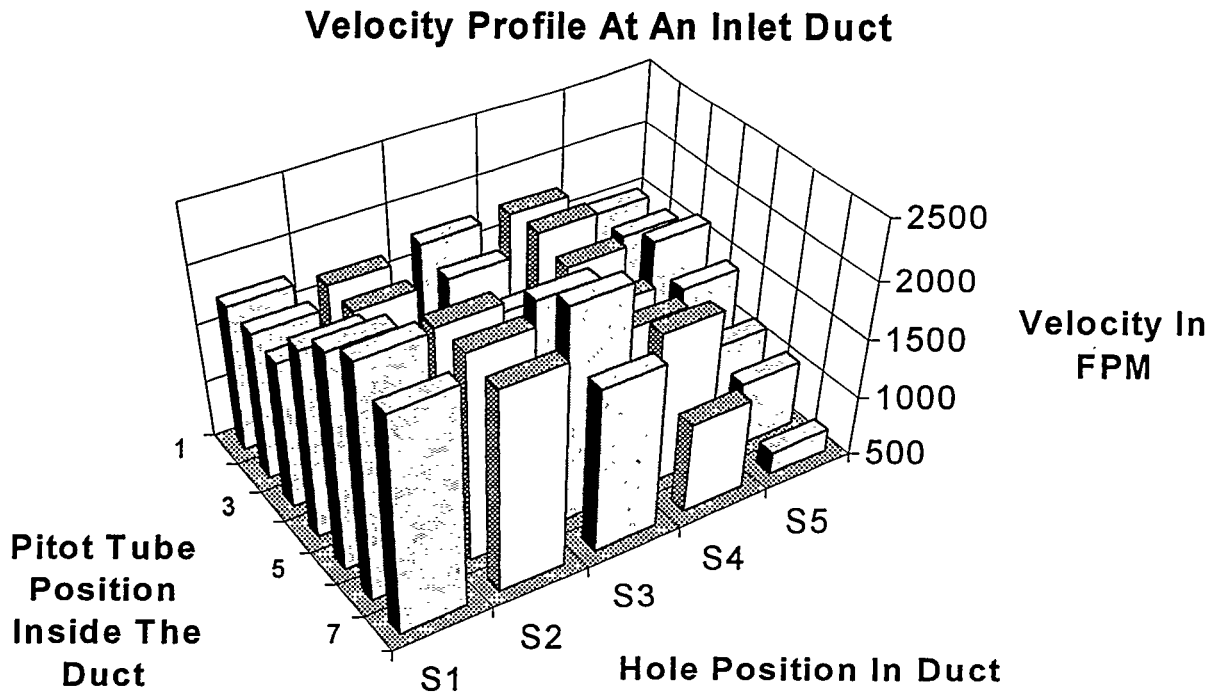


Chart 2 Surface plot of the velocity profile inside the duct.

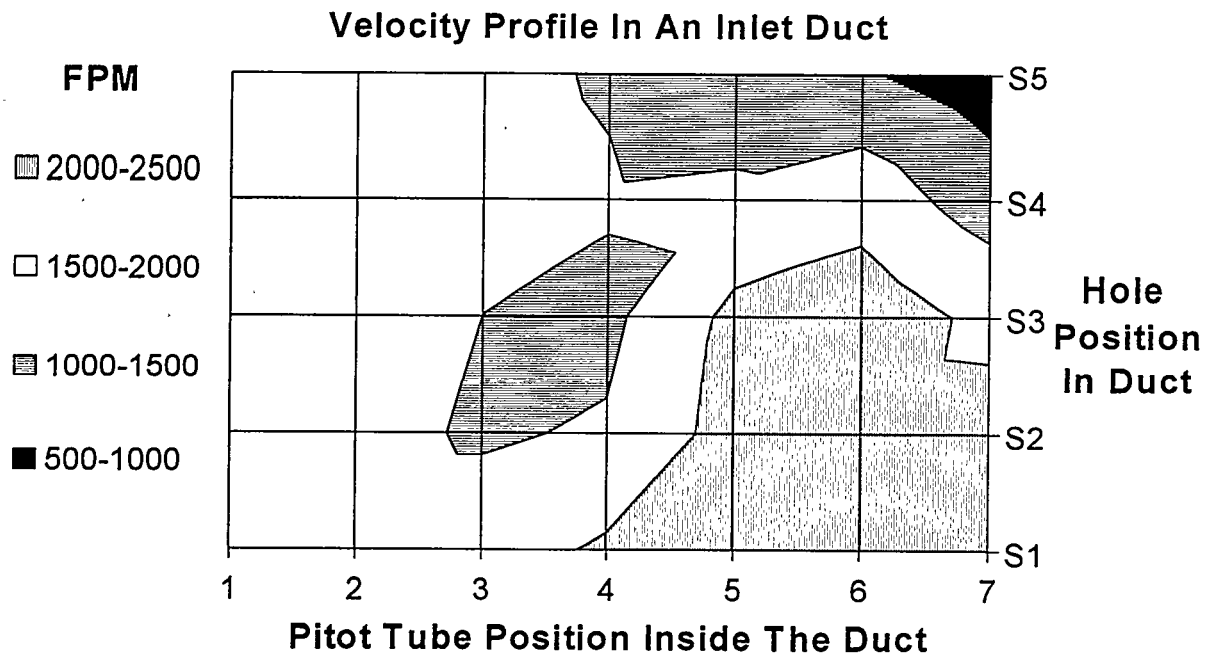

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1 Worksheet used to plot velocity graphs and calculate hole size.

DATA VELOCITY							TOTAL BY TUBE	% BY TUBE	
1499	1499	1651	1444	1133	1060	694	8980	15%	
1746	1791	1699	1551	1602	1791	1266	11446	19%	
1746	1651	1499	1387	2119	2301	1879	12582	21%	
1651	1651	1444	1551	2194	2230	2194	12915	21%	
1746	1746	1746	2081	2301	2469	2335	14424	24%	
TOTAL	8388	8338	8039	8014	9349	9851	8368	60347	100%

PERCENT OF AVERAGE FLOW

87%	87%	96%	84%	66%	61%	40%
101%	104%	99%	90%	93%	104%	73%
101%	96%	87%	80%	123%	133%	109%
96%	96%	84%	90%	127%	129%	127%
101%	101%	101%	121%	133%	143%	135%

PERCENT OF FLOW BY RISER

16.7%	16.7%	18.4%	16.1%	12.6%	11.8%	7.7%	100%
15.3%	15.6%	14.8%	13.6%	14.0%	15.6%	11.1%	100%
13.9%	13.1%	11.9%	11.0%	16.8%	18.3%	14.9%	100%
12.8%	12.8%	11.2%	12.0%	17.0%	17.3%	17.0%	100%
12.1%	12.1%	12.1%	14.4%	16.0%	17.1%	16.2%	100%

AREA OF
HOLES


AREAS OF OPENINGS BY REGION

							TOTAL	2
0.050	0.050	0.055	0.048	0.038	0.035	0.023	0.298	0.30
0.058	0.059	0.056	0.051	0.053	0.059	0.042	0.379	0.38
0.058	0.055	0.050	0.046	0.070	0.076	0.062	0.417	0.42
0.055	0.055	0.048	0.051	0.073	0.074	0.073	0.428	0.43
0.058	0.058	0.058	0.069	0.076	0.082	0.077	0.478	0.48

HOLE SIZE BY REGION

QTY	6	6	5	6	5	6	6
	0.103	0.103	0.118	0.101	0.098	0.086	0.070
	0.111	0.112	0.120	0.104	0.116	0.112	0.094
	0.111	0.108	0.112	0.099	0.134	0.127	0.115
	0.108	0.108	0.110	0.104	0.136	0.125	0.124
	0.111	0.111	0.121	0.121	0.139	0.132	0.128

Figure 5 Injection manifold designed for the inlet duct of a 30,000 CFM NATS.

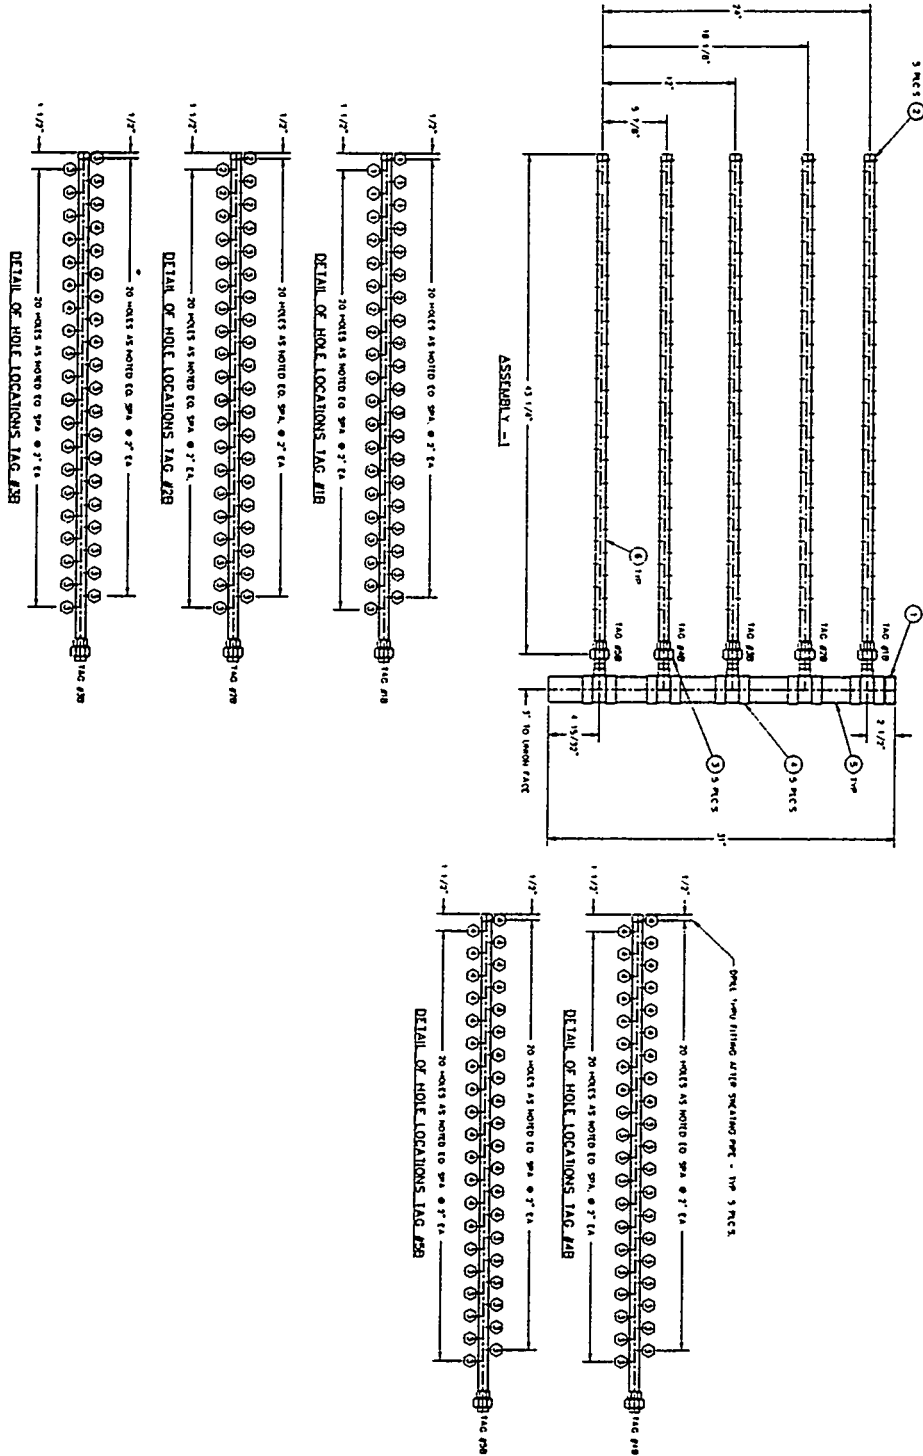

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

While this paper does not address manifolds dedicated to sampling only, the general design guidelines for an injection manifold may be applied to the design of sample manifolds. When a manifold is to be used as both an injection and sample manifold, the design guidelines that apply to the injection manifold take precedence.

Summary

The need to test multiple banks of components in a single NATS required that a method be developed to introduce a test agent uniformly for each bank in the NATS. For a single bank of components, this requirement for uniform distribution of the test agent is still required. To meet the acceptance requirements of the various testing documents and Regulatory Guides, a qualified method of test agent distribution had to be developed. Injection and sample manifolds have made it possible to test entire NATS without having to disturb a single bank of components or by placing test personnel inside the NATS to perform a multi-point sample or shroud test method.

The authors would like to thank Mr. Robert R. Sommer II and Mr. Jonathan E. Otermat for their editorial reviews and technical contributions in the writing of this paper.

References

1. ANSI/ASME N-509, "Nuclear Power Plant Air-Cleaning Unit and Components."
2. ANSI/ASME N-510, "Testing of Nuclear Air Treatment Systems."
3. ASME, CONAGT, AG-1, "Code On Nuclear Air and Gas Treatment."
4. USNRC, Regulatory Guide 1.52, "Design, Testing and Maintenance Criteria for Atmosphere Cleanup System Air Filtration and Adsorption Unit of Light-Water-Cooled Nuclear Power Plants."
5. USNRC, Regulatory Guide 1.140, "Design, Testing and Maintenance Criteria for Normal Ventilation Exhaust System air Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power Plants."

DISCUSSION

SCRIPSICK: Has size dependent particle loss been considered when testing HEPA filter systems? Photometry can introduce you to uncertainties. Are you evaluating injection sample manifolds for size-dependent effects? I do not think that has been addressed in this work. For the kinds of testing being conducted the type generator being used, and the amount of aerosol generated, there should be no such effects. I do not think there is a problem in that regard because they are using $0.3 \mu\text{m}$ particles according to the procedure in N510. When using a light scattering photometer the response is strongly dependent on particle size. Therefore, if you introduce a size bias either to your sampling technique or your injection device, the size distribution upstream will be different from the size distribution downstream. Alternatively, if you have losses in the sampling system that are not balanced, you will not have the same losses as a function of size upstream as you do downstream. The error propagates into your photometer measurement, and ultimately will affect the error in your test results.

GRAVES: I am not sure I follow you, but we can always make the case that our sampling lines will affect the results. I do not believe the aerosol was degenerated. We were using NUCON equipment, we were not using laser light for particle light scattering. I don't think that is a problem with this technique.

KOVACH, B: I know you are talking about large particles becoming lost in different places. This means that you are going to smaller and smaller particles when you use a manifold. Let me tell you that the aerosol generator being used has no particles above $2\mu\text{m}$. There is a baffle plate that collects the larger particles. Therefore the manifold is contributing little to change the particle size. Using the particle size spectrometer we have at NUCON, we could not see much difference. Therefore size change if any, has been neglected. If we used a laser spectrometer we might find size differences, but they would not make much change in the results.

ENGELMANN: As a quality control-quality assurance matter, did you, by any chance, sample without any intervening filtration? Did you look at the release characteristics to see if your sampler showed the same thing as is present in the air stream?

GRAVES: After installation you have to qualify manifolds. You do this with an aerosol mixing test; in this particular case, at 30,000 CFM maximum flow rate as shown on the view graphs. You must make the usual scan to see if you have good aerosol mixing. Between the injection point and the measurement point all you have is duct length so there is no filtration involved.

ENGELMANN: The reason for looking at particle size might be to see to what extent the particle size distribution may become biased between the release point and the sampling point in the interpretation of the results. They should show the same sizes.

GRAVES: I would expect them to be the same sizes.

ENGELMANN: What about concentration?

GRAVES: You inject aerosol upstream through a manifold to solve a maldistribution problem. You are using a device that generates an aerosol of the appropriate particle size distribution. You use one that is know to do that. You are simply directing it in such a way as to cover the cross section of the airstream and to get the required distribution. You are solving a problem with a single point injection into the manifold.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

and to get the required distribution. You are solving a problem with a single point injection into the manifold.

ENGELMANN: I wonder if you determined the need for an injection manifold based on a mixing test, or just on the geometry of the housing?

GRAVES: In this particular case a single injection point without a manifold was deemed to be unsuitable because mixing was not very good. A manifold was needed to solve that problem.

HOLTORP: Did you perform some air-aerosol mixing uniformity tests before installing the manifold? What was the improvement you saw on the mixing test results?

GRAVES: This was used as an example because of the quality of the solution. In this particular case, there was no good place designated for this particular system, it just didn't work. After installation it went from failure to easy pass. We are very happy with this particular installation.

UNIT VENT AIRFLOW MEASUREMENTS
USING A TRACER GAS TECHNIQUE

Dennis G. Adams
Union Electric Company
Callaway Nuclear Plant
Fulton, MO

P.L. Lagus, Ph.D., CIH
Lagus Applied Technology, Inc.
San Diego, CA

K.M. Fleming
NCS Corporation
Columbus, OH

ABSTRACT

An alternative method for assessing flowrates that does not depend on point measurements of air flow velocity is the constant tracer injection technique. In this method one injects a tracer gas at a constant rate into a duct and measures the resulting concentration downstream of the injection point. A simple equation derived from the conservation of mass allows calculation of the flowrate at the point of injection.

Flowrate data obtained using both a pitot tube and a flow measuring station were compared with tracer gas flowrate measurements in the unit vent duct at the Callaway Nuclear Station during late 1995 and early 1996. These data are presented and discussed with an eye toward obtaining precise flowrate data for release rate calculations. The advantages and disadvantages of the technique are also described.

In those test situations for which many flowrate combinations are required, or in large area ducts, a tracer flowrate determination requires fewer man-hours than does a conventional traverse-based technique and does not require knowledge of the duct area.

I INTRODUCTION

Air balance and ventilation performance testing requires precise flowrate measurement. Conventionally, flowrates are calculated from duct area and air velocity data. Velocity data are usually obtained by performing a multi-point traverse at the duct using a pitot tube or hot wire anemometer. In order to minimize non quantifiable errors in the velocity measurement certain conditions must be satisfied:

- (1) The flow streamlines are parallel to the axis of the duct.
- (2) No significant flow change occurs upstream for 8 to 10 diameters and downstream for 2 to 4 diameters from the flow measurement point.

Often in the field, these conditions cannot be satisfied and significant non-quantifiable errors may exist in the measurement. For example, due to access conditions or ductwork design, velocity measurements may have to be performed near a duct transition, elbow or damper. In these cases, the flow profile is perturbed and the previously stated conditions for precise measurement cannot be achieved.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Other field situations exist which resist precise measurement by conventional techniques, e.g. the measurement of air flowrates in plant chiller equipment where duct runs are minimal and velocity traverse based measurements are severely compromised.

II. TECHNICAL BACKGROUND

For most ventilation type measurements, duct flow is completely turbulent resulting in differences in flow velocities measured across the diameter of a duct even in the absence of flow perturbing elements such as the above mentioned transitions, elbows or dampers. ANSI/ASHRAE Standard 111⁽¹⁾ requires that for any flow traverse measurement to be valid more than 75% of the traverse readings must be greater than 10% of the maximum velocity pressure. Yet sometimes a flow rate is required from a point where this condition is NOT satisfied. Any flow rate calculated from a traverse under these conditions is in error by an unknown amount. This standard also requires a minimum of 25 measurement points even in moderately sized ducts.⁽²⁾ For rectangular ducts larger than 4.5 feet on any side a maximum measurement spacing of eight inches is recommended. This can require that a very large number of data points be obtained. Hence to perform a traverse measurement correctly can require a substantial investment of time to obtain the necessary individual data points in addition to requiring that the flow be well behaved.

For at least twenty years it has been known that an alternative method to measure duct flowrates exists. It entails the use of a tracer gas dilution method. This method is a *volumetric* as opposed to a point measurement. To undertake such a measurement, a tracer gas is continuously metered into a flowing duct at a known rate. After allowing for mixing, air samples are collected at a point downstream and the concentration of tracer gas is measured. The rate of flow is readily calculated from the ratio of the tracer injection flowrate to the diluted concentration--in symbols:

$$Q = S / C$$

where Q = volumetric flowrate

S = tracer injection flow rate

C = duct tracer concentration

Note that for this equation to be valid the tracer must be *well mixed* within the duct. Since mixing is enhanced by the existence of flow direction changes within a duct, unsatisfied conditions (1) and (2) above which serve to complicate a traverse-type flow measurement actually enhance a tracer dilution flow measurement.

The tracer dilution technique has been used in the mine engineering, industrial hygiene, and energy conservation communities, but has been largely ignored in the ventilation engineering community.^(3,4,5) This is unfortunate since many difficult flow characterization problems can be easily accommodated using the technique.

The tracer gas of choice for tracer dilution flowrate testing is sulfur hexafluoride, SF₆. This gas is inert, non-toxic, non-reactive, and is easily measured by means of electron capture gas chromatography to concentrations approaching one part per trillion.(10⁻¹²) although this sensitivity level is only required for the largest of flows. The gas is monitored on-site using specially designed monitors that have been optimized for the detection of SF₆ used as a tracer gas. These monitors are not affected by the presence of

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

other gases in the plant background such as freons and halogenated solvents. In addition since SF₆ possesses a zero ozone depletion factor it will not harm the ozone layer.

Tracer gas is injected into a duct using a mass flow controller or calibrated orifice. If the duct is large or the sampling point is fairly close to the injection point without adequate flow disturbances to promote mixing, tracer gas may be injected using a distributed manifold inserted into the duct. Tracer gas samples are drawn from the duct using a recirculating pump to take samples for analysis using a gas chromatograph.

III. SYSTEM DESCRIPTION

Ventilation System Lineups

A combination of charcoal filtration units and fans discharge to the unit vent based upon the operational requirements of the plant. The components with their design flow rates for each applicable system are given in Table 1. Which fan or filtration unit is running depends on the ventilation system lineup required by the plant.

Table 1 Unit vent exhaust plenum

<u>Fan/Filtration Unit</u>	<u>Design Flow</u>
Condenser Air Removal Filtration Unit (GE)	1000 cfm
Main Steam Enclosure Fan Exhaust (GF)	16500 cfm
Aux/Fuel Building Emergency Exhaust Filtration Unit-Train A(GG)	9000 cfm
Aux/Fuel Building Emergency Exhaust Filtration Unit-Train B(GG)	9000 cfm
Auxiliary Building Access Control Exhaust Filtration Unit(GK)	6000 cfm
Auxiliary/Fuel Building Normal Exhaust Filtration Unit(GL)	32000 cfm (Fast)
	13000 cfm (Slow)
Containment Mini-Purge Exhaust Filtration Unit(GT)	4000 cfm

There are five major ventilation system lineups that occur during normal plant operations. Each is given in Table 2 with the fan status as shown. These lineups are designated for testing purposes as Normal, Normal/Mini-Purge, FBIS (Fuel Building Ventilation Isolation Signal)/Mini-Purge, FBIS/CRVIS (Control Room Ventilation Isolation Signal)/Mini-Purge and FBIS/CRVIS. Each lineup is fully explained below.

Table 2 Ventilation lineups/fan status

(X) indicates running

VENTILATION LINEUP	GE	GK	GF	GL (SLOW)	GL (FAST)	GG	GT
NORMAL	X	X	X		X		
NORMAL/MINI PURGE	X	X	X		X		X
FBIS/MINI PURGE	X	X	X	X		X	X
FBIS/CRVIS/ MINI PURGE	X		X	X		X	X
FBIS/CRVIS	X		X	X		X	

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Normal Ventilation Lineup-The normal ventilation lineup is a combination of charcoal filtration units GL(Fast), GE,GK and the GF exhaust fan. This ventilation lineup exhausts the Auxiliary Building, the Fuel Building, Access Control Area and the Condenser Air Removal System. The design air flow rates are listed in Table 1. The fans normally exhausting to the unit vent during this ventilation lineup are shown by the shaded portions in Figure 1.

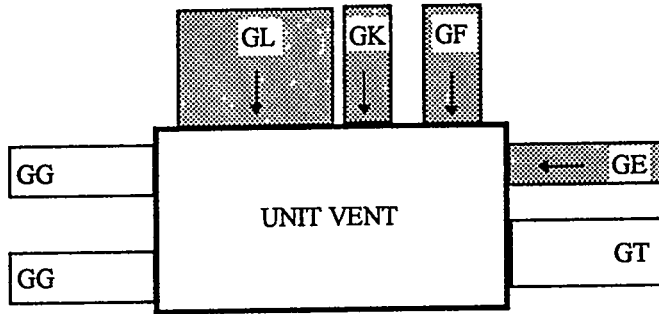


Figure 1 Normal ventilation lineup

Normal/Mini-Purge Ventilation Lineup-The Normal/Mini-Purge Ventilation Lineup is a combination of charcoal filtration units GL(Fast), GE,GK, GT and the GF exhaust fan. The Containment Mini-Purge Charcoal Filtration Unit, GT, controls the containment atmosphere during normal plant operations. The design air flow rates are listed in Table 1. The fans normally exhausting to the unit vent during this ventilation lineup are shown by the shaded portions in Figure 2.

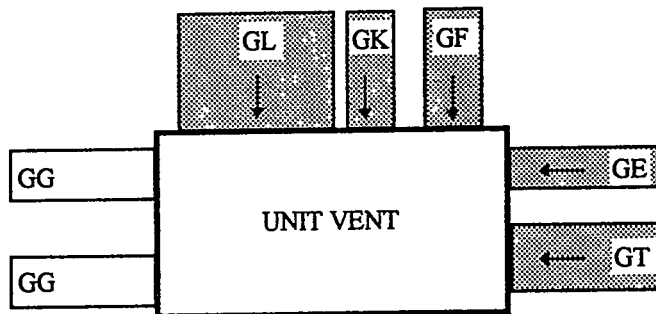


Figure 2 Normal/Mini-Purge ventilation lineup

FBIS/Mini-Purge Ventilation Lineup-The FBIS/Mini-Purge Ventilation Lineup is a combination of charcoal filtration units GL(Slow), GE,GK, GT, GG and the GF exhaust fan. This ventilation lineup supports special fuel handling operations for the Fuel Building. The design air flow rates are listed in Table 1. The fans normally exhausting to the unit vent during this ventilation lineup are shown by the shaded portions in Figure 3.

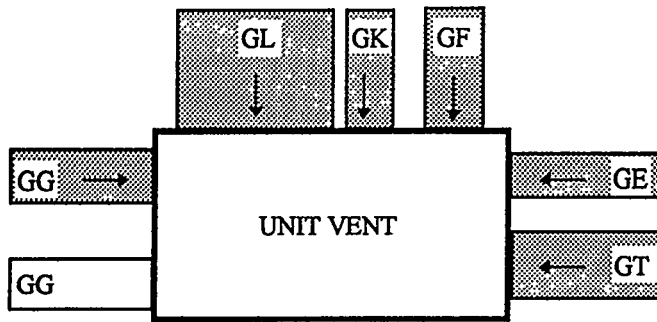


Figure 3 FBIS/Mini-Purge ventilation lineup

FBIS/CRVIS/Mini-Purge Ventilation Lineup-The FBIS/CRVIS/Mini-Purge Ventilation Lineup is a combination of charcoal filtration units GL(Slow), GE, GT, GG and the GF exhaust fan. The ventilation lineup supports special control room and fuel building ventilation requirements. The design air flow rates are listed in Table 1. The fans normally exhausting to the unit vent during this ventilation lineup are shown by the shaded portions in the Figure 4.

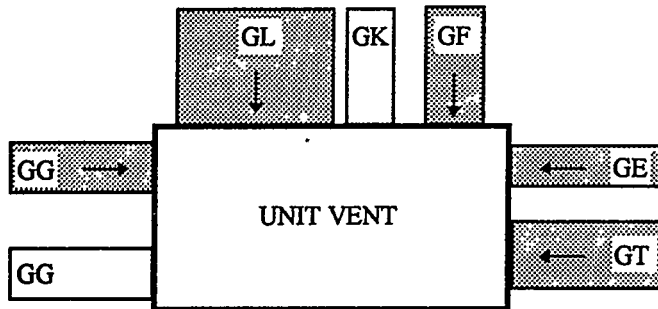


Figure 4 FBIS/CRVIS/Mini-Purge ventilation lineup

FBIS/CRVIS Ventilation Lineup-The FBIS/CRVIS Ventilation Lineup is a combination of charcoal filtration units GL(Slow), GE, GG and the GF exhaust fan. The ventilation lineup supports special control room and fuel building ventilation requirements. The design air flow rates are listed in Table 1. The fans normally exhausting to the unit vent during this ventilation lineup are shown by the shaded portions in Figure 5.

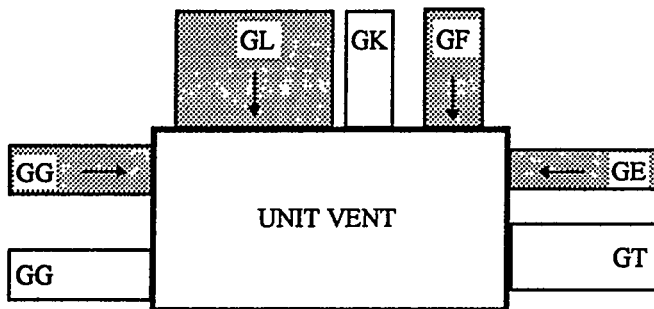


Figure 5 FBIS/CRVIS ventilation lineup

Unit Vent Configuration

The unit vent exhaust plenum exits the Auxiliary Building through the roof as shown by Figure 6 only to make two short coupled 90 degree turns before continuing along the Reactor Building containment structure.

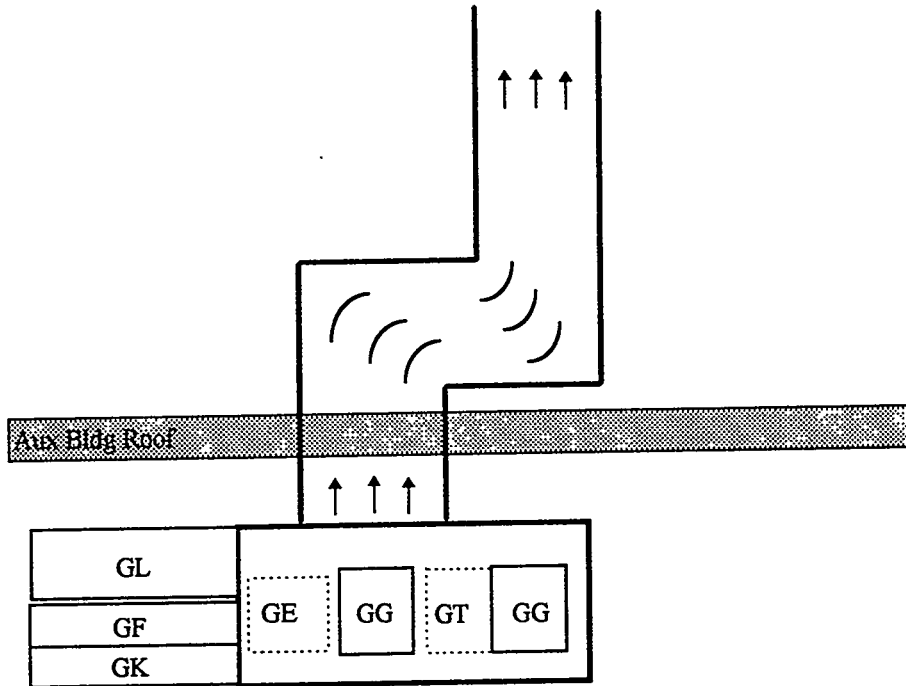


Figure 6 Unit vent exhaust plenum

Figure 7 below shows the physical location of the unit along the Reactor Building containment structure.

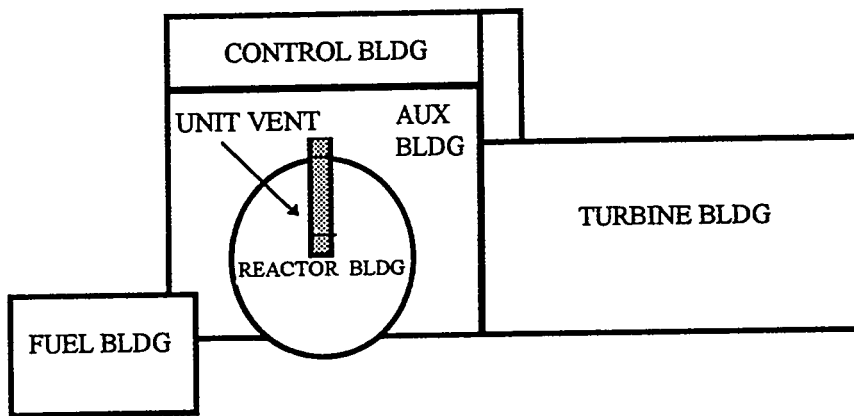


Figure 7 Unit vent location

Figure 8 below shows a side view of the unit vent ducting along the containment structure.

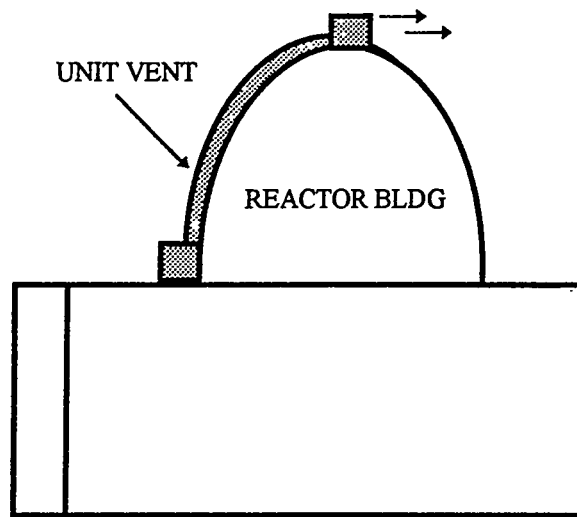


Figure 8 Unit vent physical layout

IV. HISTORICAL SYSTEM PERFORMANCE

The function of the flow measurement station is to provide a 0-5 VDC signal to the Wide Range Gas Monitor (WRGM) RM-80 microprocessor which in turn displays this flow value (cfm) on the RM-11 control panel. The 0-5 VDC output signal is used by the WRGM to maintain isokinetic flow control, isokinetic nozzle selection and perform effluent calculations. The RM-80 microprocessor data base file determines which set of sampling nozzles, *normal or accident*, to use based upon the flow signal developed by the flow measuring station. If the flow signal is above the isokinetic range (46,930 cfm), the *normal* nozzles will be on-line and conversely for the *accident* nozzles should the flowrate become non-isokinetic. An alarm will sound on the RM-11 panel should this condition exist. Nearly all normal operation flow lineups result in isokinetic flow conditions in the unit vent. Should the unit vent flow measuring equipment become inoperable, installation of conservative substituted flows will be initiated. Precise flow measurement to preclude premature switching of the sampling nozzles or the initiation of manual sampling due to inoperable sampling nozzles has proven to be labor intensive and a *work-around* for the unit operators.

October 1994 Testing

Corrective action measures were initiated as early as October 1994 to ensure the unit vent instrumentation components were properly calibrated. Each specific ventilation lineup imparts a different air flow signal for the instrumentation to acquire and condition. Not only did it take several days to affect a complete calibration but the instrumentation exhibited evidence of drift over a period of time.

A pitot tube traverse of the unit vent ducting was performed just upstream of the installed air flow measuring station for each ventilation lineup previously discussed in this paper. This required the erection of a thirty foot scaffolding adjacent to the unit vent ducting. In conjunction with the pitot tube traverse data, RM-11 readings were obtained for comparison. The results of this testing are documented in Table 3. Based upon the data obtained, a single correction factor was applied to the RM-11 readings using linear regression analysis to achieve an RM-11 flow more in line with the pitot tube traverse. This method proved to be precise on only certain areas of the curve.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 3 Unit vent measurements without Tracer-Oct 94

VENTILATION LINEUP	PITOT cfm	RM-11 cfm	Difference cfm
NORMAL	50194	63616	13422
NORMAL/MINI PURGE	50394	69014	18620
FBIS/MINI PURGE	44556	55545	10989
FBIS/CRVIS	36813	41639	4826

As can be seen from Table 3, a large difference existed between the RM-11 reading and the pitot tube traverse results for most lineups. Since the unit vent instrumentation was calibrated just prior to the test, the difference between the RM-11 and the pitot tube traverse results was due to the inability to precisely measure the effective duct area or achieve optimum pitot tube orientation in the duct. Figure 9 shows the basic internal construction of the ducting in the area of the flow measuring station. One inch diameter cross-members extend diagonally across the duct every two feet. Additionally, a two inch internal angle iron web is added for strength every two feet as well. The cross-members and the internal web serve to decrease the effective flow area of the duct by approximately 16% as well as set up turbulence throughout the flowstream. These turbulence coupled with an unknown flow area imposes non quantifiable errors for calculating the air flow rate in the duct.

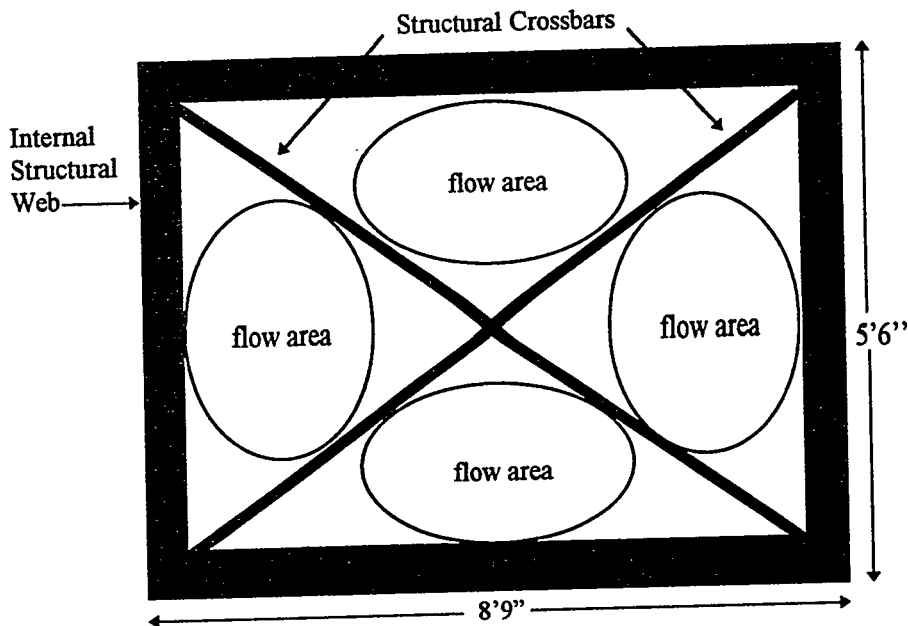


Figure 9 Internal duct construction

V. TRACER GAS TECHNIQUE

Tracer Gas Test Setup

Figure 10 shows the equipment setup to perform the tracer gas test. A 150 ft³ cylinder of 0.1 % SF₆ injection gas was connected to a flow control valve. The mass flow controller served to finely control the flow of SF₆ injection gas to the injection tube manifold. The injection point for the gas was selected upstream of a fan inlet approximately 50 feet from the unit vent plenum and a total of 90 feet from the sampling point. The injection gas was introduced at three different points across the traverse of the duct with insignificant changes in the results. This established the fact that the gas was sufficiently mixed prior to pulling a sample. The downstream sample was obtained by inserting a sample tube at specific locations in the flowstream and using a pump to retrieve the sample. A list of specific equipment and test precautions is provided in the appendix attached to this paper.

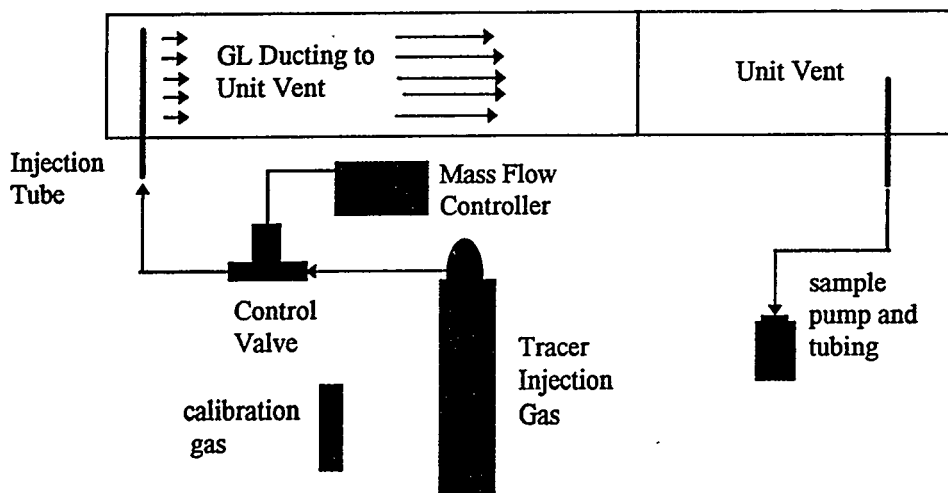


Figure 10 Tracer gas injection setup

Preliminary tracer gas testing-October 1995

Tracer gas technology was tested as to the applicability to Callaway Nuclear for potential incorporation not only in unit vent flow measurement but in the routine checks of all systems and components capacities. The technology had been used for other applications within the nuclear industry to check the migration of noble gases. (6) Basic test verification was conducted to demonstrate the desired results could be achieved on the unit vent.

By October 1995, procedures were in place and equipment had been obtained to perform a trial test of the Tracer Gas Technique in the Normal Ventilation Lineup. A total of 15 samples were taken in the unit vent as shown on Figure 11. There are seventeen access plugs available for testing. Plug #4, #9 and #14 were selected since they were evenly spaced across the duct area and were representative of the total flow within the unit vent. Five samples were taken in each plug location and the samples were labeled accordingly. The results of the test are given in Table 4.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 4 Preliminary single test-October 1995

VENTILATION LINEUP	PITOT cfm	TRACER cfm	Difference cfm (pitot - tracer)	RM-11 cfm	Difference cfm (RM 11-tracer)
NORMAL	51037	50812	225	54960	4148

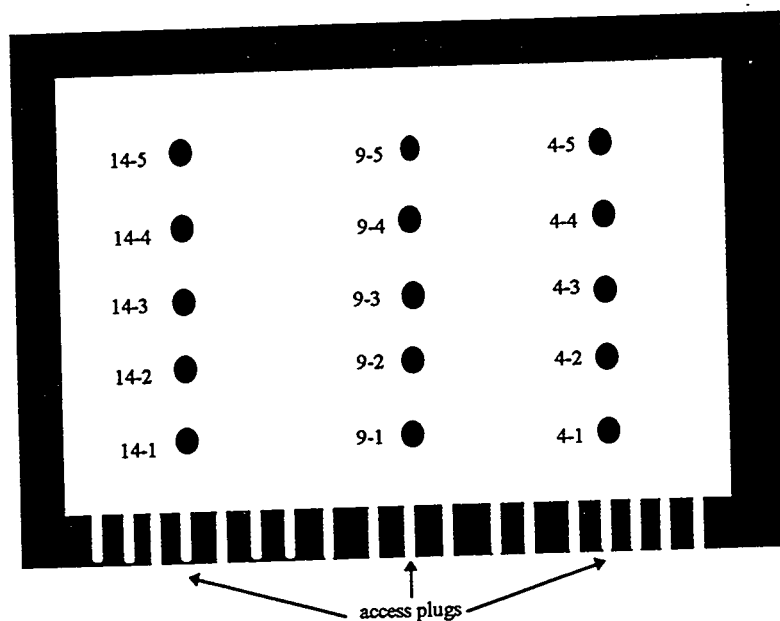


Figure 11 Unit vent sample locations-top view

Tracer gas test-January 1996

January 1996 marked to first unit vent test to be performed at Callaway Nuclear with the Tracer Gas Technique. Ventilation systems were placed in standard lineups that would occur during normal plant operation. A pitot tube traverse was performed on the unit vent ducting just upstream of the flow measuring station at 170 points. The ducting area was estimated based upon the outside diameter of the duct minus the area of the internal web and the cross-members. There would still be non quantifiable errors due to the estimation of area as well as effects from turbulence set up by the design. Nevertheless, attempts were made to meticulously measure the velocity pressures in the duct without encountering the effects of any cross-member. Table 5 below shows the results of this test for the standard ventilation lineups.

Based on the data shown in Table 5, it was apparent that the RM-11 instrumentation was out of calibration. Additionally, the observed difference between the pitot traverse and the tracer gas measurement under these same conditions also indicated a greater difference than projected. The test was rescheduled and the instrumentation was to be calibrated just prior to the next test.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 5 Tracer gas test-January 1996

VENTILATION LINEUP	PITOT cfm	TRACER cfm	Difference cfm (pitot-tracer)	RM-11 cfm	Difference cfm (RM-11-tracer)
NORMAL	55881	52027	3854	78200	26173
NORMAL/MINI PURGE	55254	58674	3420	79600	20926
FBIS/MINI PURGE	51480	52614	1134	71800	19186
FBIS/CRVIS/MINI PURGE	48752	43151	5598	66700	23549
FBIS/CRVIS	45186	47247	2061	63000	15753

Tracer gas test- February 1996

The unit vent instrumentation was calibrated and verified to be operating correctly. The same ventilation lineups used in January 1996 were repeated. Table 6 shows fairly good alignment between the pitot traverse and the tracer measurement for most ventilation lineups. Where differences were greater, this would be attributed to the error in determining the effective flow area. Some disparity existed between the RM-11 and the tracer gas test but to a lesser degree after calibration. This can be attributed to several factors in addition to the calibration of instrumentation. The use of a recorder with much better resolution than that used in any previous test improved the precision of this testing. Another impact was the experience level of the individuals performing the testing and refining the test methodology.

Table 6 Tracer gas test-February 1996

VENTILATION LINEUP	PITOT cfm	TRACER cfm	Difference cfm (pitot-tracer)	RM-11 cfm	Difference (RM 11-tracer)
NORMAL	56984	49187	7797	52400	3213
NORMAL/MINI PURGE	56588	53245	3343	56000	2755
FBIS/MINI PURGE	53547	44409	9138	49600	5191
FBIS/CRVIS/MINI PURGE	46167	44187	1980	45400	1213
FBIS/CRVIS	45978	42748	3230	42600	148

Test preparation

Several preliminary items were required prior to the actual performance of the test such as determining the injection rate for the SF₆ gas. This is calculated based upon the estimated flow rate of the system based upon the design flow for the ventilation lineup described given in Table 1 and 2 above. Injection rate is a function of the volumetric flowrate of the system and concentration of tracer gas as discussed in Section II, Technical Background, of this paper. The selection of the concentration value is based upon testing experience to render acceptable results when using a mixture of 0.1% or 0.01% SF₆ in nitrogen or air as the tracer gas. Other parameters such as airstream temperature and barometric pressure are required for conversion assistance.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The equipment was configured as described in Figure 10. Sample retrieval was obtained using heavy duty syringes and needles. Each syringe was clearly marked prior to the test so as not to delay sampling. The syringe with needle attached was exercised prior to sampling to ensure no clogging of the tip occurred.

Tracer gas injection and sampling

Radio communications were established between the injection gas operator and the sampling station at the unit vent. The injection gas was introduced into the airstream and the sampling station was notified. Injection rate was monitored every 30 seconds. A delay of 1-2 minutes was required prior to taking the first sample to ensure the injection gas mixing had time to stabilize. A sample was taken every 30 seconds until all samples for a given access hole were taken. The sampling tube was moved from access hole #4 to #9 and finally to #14 until all samples were obtained. The samples were transported to the counting station taking care not to depress the syringe prematurely.

Sample analysis

Before any sample was analyzed, the atmospheric level of SF₆ (if any) in the vicinity of the gas chromatograph was determined. In addition, two calibration gas standards were read to provide the standard response level for calculating the gas concentration in each sample. Each sample was successively injected into the gas chromatograph after the proper stripchart response was achieved.

Data reduction

The response of each sample is determined by measuring the peak height of each sample. From this value and the standard response level of the calibration gas samples, the concentration of the downstream sample can be determined. From this concentration level and a known tracer gas injection rate, the flowrate of the airstream can be precisely determined.

VI. CONCLUSIONS

By performing flow tests using the tracer dilution method, *volumetric* flowrate data can be easily obtained in the worst duct configurations. Errors introduced by probe orientation, manometer orientation, state of the thermoanemometer batteries, marginal duct velocities, physical configuration, operator fatigue, vents, grilles, and the condition of the flow are eliminated. Another benefit is that expensive flow probes do not have to be inserted into potentially contaminated ducts. The only equipment that actually goes into the airstream is cheap, disposable tubing. Other benefits include minimizing the number of penetrations that must be made in a duct thereby reducing the amount of inleakage or outleakage induced by these holes as well as creating less structural weakening. Flow measurements by the tracer dilution method are more rapid than those by conventional techniques thereby decreasing the time required in high radiation areas in keeping with ALARA considerations of the Health Physics staff.

Since the flow data are not dependent on operator skill and the other physical problems associated with the flow measurement process, more reliable, precise and defensible test data can be generated. These flow rate data can be directly compared to one another to assess the effect of various operational configurations. In-place flow measurement instruments can be directly and wholly calibrated with real volumetric flows using real time data. This provides Health Physics personnel with reliable flowrates to calculate precise radioactive release data. The technique can also provide operations personnel with precise air flow monitoring information, and systems engineering personnel with flow balancing data that are more reliable than those obtained by conventional techniques.

VII. REFERENCES

- (1) ASHRAE STANDARD 111, "Practices for measurement, testing, adjusting, and balancing of building heating, ventilation, air-conditioning, and refrigeration systems", American Society of Heating, Refrigerating, and Air Conditioning Engineers, 1988
- (2) Industrial Ventilation-20th Edition, American Conference of Government Industrial Hygienists, 1990
- (3) Technical Note AIVC 34, "Air flow patterns within buildings-measurement techniques", Air Infiltration and Ventilation Centre, University of Warwick, England, 1991
- (4) Persily, A.K., "Air Flow Calibration of Building Pressurization Devices" NBSIR 84-2849, National Bureau of Standards, 1984
- (5) Lagus, P.L., Flanagan, B.F., Peterson, M.E., Clowney, S.L., "Tracer dilution method indicates flowrate through compressor", Oil & Gas Journal, February, 1991
- (6) Lagus, P.L., Kluge, V., Woods, P., Pearson, J. , "Tracer gas testing within the Palo Verde Nuclear Generating Station unit 3 auxiliary building".

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Appendix A. Equipment list and test precautions

Equipment list

- Electron capture gas chromatograph with SF₆ oven installed
- Mass flow meter
- Mass flow meter, extension transducer
- 30 ft³ cylinder SF₆, 1 ppb calibration gas with regulator
- 30 ft³ cylinder SF₆, 10 ppb calibration gas with regulator
- 150 ft³ cylinder .1% SF₆ injection gas with regulator
- 150 ft³ cylinder .01% SF₆ injection gas with regulator
- Sample pump with tubing and septa
- Tracer gas injection manifold and tubing
- Tracer gas sample retrieval tube and tubing
- Needles-(23 X 1")
- Syringes-(12-20 cc)
- Spare septum
- External recorder

Test precautions

- An electron capture gas chromatograph was used to measure the samples obtained. This same instrument was used to perform bypass leakage test on charcoal filter beds however, the oven column was replaced with one compatible with SF₆ gas. Approximately 24 hours is required for the unit to properly warm-up.
- Cross contamination of the SF₆ gas within hoses and regulators is a constant prevention requirement.
- Background samples of the surrounding atmosphere where the samples are being analyzed is required for pre and post test validation.
- Calibration gas samples are analyzed prior to sample counting.
- Septum on the Calibration Gas tank and sample pump should be periodically changed out.
- New syringes should be used for each sample series/location to preclude any cross contamination.
- A high resolution printer with an integrator is best for a more precise reading.
- Care should be taken to use needles on the syringes that do not clog when the septum is penetrated.
- This test is currently limited to areas where the exhaust from the airstream does not communicate with the compartment where injection is taking place.
- If air flow is < 5,000 cfm, the .01% injection gas should be used.
- Samples should be pulled from the downstream at least every 30 seconds during the injection phase.
- Purging of calibration gas through the regulator prior to taking a calibration sample is essential.
- Samples should not be injected into the gas chromatograph more frequently than 3 minutes apart.
- If replacement of the sample oven is performed on site, ensure the oven snaps fully in place to prevent contamination of the system.
- The holes in the injection tube should point into the direction of flow.
- Only polyethylene or nylon tubing is recommended for use with SF₆.
- All SF₆ containing cylinders and tubing should be stored in a separate cabinet, to prevent cross contamination.

DISCUSSION

RICKETTS: I am wondering if you addressed the compatibility of your choice for a test gas with the proper operation of iodine adsorption filters?

ADAMS: I am not sure I am qualified to answer that. Seeing that the trace gas was inert and non-toxic and that the same tracer gas has been used in other industries, we felt comfortable in doing likewise. Especially because it was not ozone depleting. In fact, I made some calls to some of the charcoal vendors prior to doing the test, and it was their determination that it did not affect the carbon or the HEPA filter tests. The other thing we did to make sure it would have less effect on the filters, was to inject it downstream of the charcoal filtration units. The real answer to your question, I think, is that we injected downstream of the adsorber units and upstream of a fan to get proper mixing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

**24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
PORTLAND, OREGON, JULY 15-18, 1996**

**DEVELOPMENT OF REAL TIME DETECTOR FOR FLUORESCENT PARTICLES
C. PREVOST*, A. SEIGNEUR**, J. VENDEL***

*Institut de Protection et de Sûreté Nucléaire
Département de Prévention et d'Etude des Accidents - DPEA/SERAC
CEA/Saclay, Bâtiment 383 - 91191 GIF-SUR-YVETTE Cedex, France
**LETI (Direction des Techniques Avancées)
Département d'Electronique et d'Instrumentation
CEA/Saclay, Bâtiment 528 - 91191 GIF-SUR-YVETTE Cedex, France

ABSTRACT

Aerosols tagged by a fluorescent dye are a worthwhile tool within the framework of ventilation and filtration studies. The detection in real time of a specific particulate tracer allows characterization of ventilation behaviour such as air change rate, the determination of a good or bad mixing zone and transfer coefficient, or the determination of the decontamination factor for High Efficiency Particulate Air (HEPA) filters.

Generally, these tests require specific aerosols in order to get rid of the atmospheric aerosol background.

Until now the principle of fluorescent aerosol concentration measuring has only allowed an integral response with a time lag by means of sampling on filters and a fluorimetric analysis after specific conditioning of these filters.

To make it possible to detect a specific tracer in real time, a new monitor has been developed to count these particles on the following basis :

- ⇒ fluorescent particles pass through a sampling nozzle to a specially designed measurement chamber ; ducting flow rate is used to contain the test aerosol in the sample flow rate at the nozzle outlet ;
- ⇒ interception of this stream with a laser beam allows aerosol detection and characterization, particle by particle ;
- ⇒ optical signals are produced by fluorescence emission of glycerol particles tagged with fluorescein sodium when they are excited by a laser beam emitting on a suitable wavelength (ionized argon laser) ; these signals are transmitted to a photodetector by a patented optical arrangement.

The paper presents the detection concept and the experimental device. The main results achieved in this study show the feasibility of such a technique providing aerosol tracer detection in real time.

I. INTRODUCTION

Aerosols artificially tagged with a fluorescent substance are a powerful tool for the specific follow-up of a polluting agent in an atmosphere naturally free from such particles. Most tests carried out within the framework of research into air contamination, confinement or else purification act on these aerosols both in some industrial fields and in specialist laboratories.

The detection of such particles can thus help in understanding the various complex phenomena produced inside premises and thus enable them to be controlled. In fact, the combination of ventilation and pollutant is a major concern when designing ventilation plant and making it comply with the relevant standards.

Therefore, the follow-up in real time of the transfer of contamination from a harmless polluting agent injected instead of a source of contamination enables the location of detection markers to be optimized and the rate of homogenization of the pollutant in the premises determined. Optimization of the rate of renewal is then conceivable when making a "map" of the concentration of the pollutant inside the premises. This reveals the presence of a "dead zone", the site of pollutant accumulation, and thus enables it to be eliminated.

This particle tracing technique can also be used in designwork concerning in particular dynamic confinement, the validation of aerodynamic design calculation codes, the modelling of flows of air loaded with particles or even the qualification of the filtering equipment.

The principle of measuring such specific aerosols previously only allowed for integral measurement of their concentration with a time lag through taking samples on filters, and then preparing the samples for analysis by fluorimetry.

As has previously been explained, the need for following up the concentration of a tracer in the air in real time has led us to show the feasibility of a new technique for detecting fluorescent aerosols.

In this paper, we explain the principle of detection which we apply, the experimental device made, and the main results achieved during our research.

II. PRINCIPLE OF MEASUREMENT

The main objective of our research lies in designing a technique for characterizing and counting aerosols, based on detection of their fluorescence, in real time [4].

When a fluorescent fluid aerosol intercepts a beam of monochromatic light of a wavelength included within its spectrum of absorption, it sends back a light of a higher wavelength due to the fluorescence.

With constant lighting, its intensity is in proportion to the amount of fluorescent substance contained in the particle.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

It's a question of collecting this fluorescent light using a suitable optical system on a photosensitive detector in order to quantify the fluorophore content [5].

$$Q_f = k \cdot P_L \cdot \lambda_a \cdot \Phi \cdot \varepsilon \cdot N_f \cdot t$$

where Q_f = amount of fluorescence (number of photons)
 k = proportionality factor
 P_L = power of the laser beam (Watt)
 λ_a = absorption wavelength (nm)
 Φ = quantum yield of fluorescence
 ε = molar absorption coefficient (L/mol.cm)
 t = time during particle remains in the light beam (s)

An aerodynamic focusing device aligns the particles behind each other. Fine focusing of the excitation light enables lighting as a particle moves.

Using a laser source of light facilitates concentration of the excitation power of the beam on a narrow spot of light.

The volume of measurement can be estimated at about $3 \cdot 10^{-6} \text{ cm}^3$; the maximum concentration which can be detected with a rate of coincidence below 5% must not exceed 10^4 particles/cm³.

III. MEASUREMENT CELL AND ASSOCIATED OPTICS

The measurement cell essentially comprises :

⇒ a sampling system (Figure 1) in brass with a low surface finish index for the inner surface, ending in a small diameter nozzle ($d_{bp} = 0.6 \text{ mm}$) which allows the aerosols to be routed into the measurement chamber within a centered jet.

A ducting air system improves the aerodynamic centering of the output jet in the same time as it prevents any droplets being deposited on the walls of the collector optics.

⇒ a measurement chamber (Figure 2), the special geometry of which enables the maximum fluorescent light emitted to be collected. The fluorescence collection performance is in the region of 15 %. This collector optics is covered by a patent [1]. Its rear face, centered on the jet, is metallized which allows the light emitted to the rear to be returned to the place of emission where it's added to the flow emitted forward.

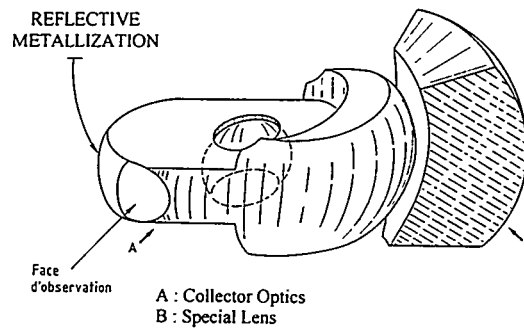
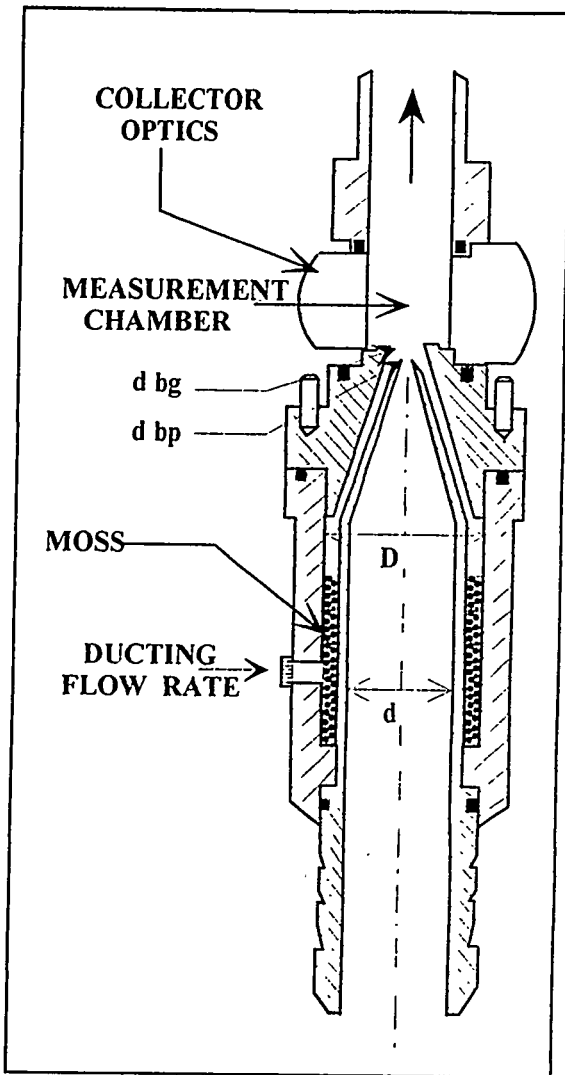


Figure 2 : Measurement chamber

Lens B catches the flow of light and sends it all back to the rest of the optic arrangement.

Figure 1 : Sampling system

Specification of the nozzle : $D = 10.6 \text{ mm}$
 $d = 6.0 \text{ mm}$
 $d_{bp} = 0.6 \text{ mm}$
 $d_{bg} = 2.6 \text{ mm}$

IV. CHOICE OF FLUOROPHORE

The fluorophore selected for carrying out our tests is soda fluorescein ($C_{20}H_{10}O_5Na_2$) ; it is an excellent product to use in tracing work, essentially because it's non toxic in the usual concentrations and also because it is soluble in water and in glycerol, often used when producing calibrated droplets.

Further, it's used in a standardized measurement method (NF Standard X 44.011) for the test of HEPA filters efficiency.

This tracer has very good fluorescence properties in solution in glycerol (quantum performance evaluated at 92% under the best conditions) and can easily be detected by any fluorimetric technique.

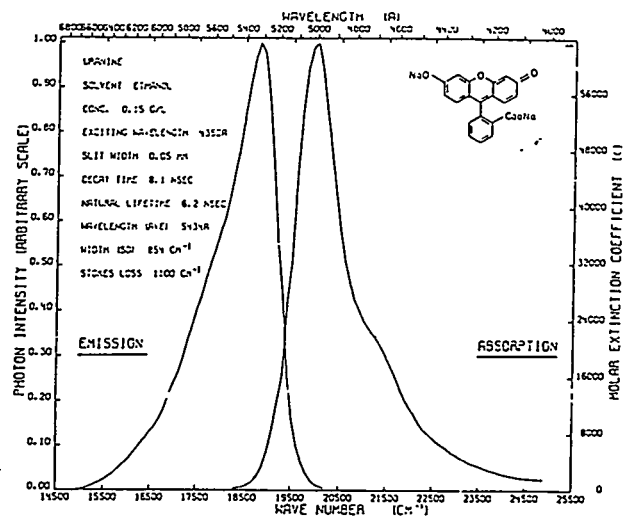


Figure 3 : Spectrum of soda fluorescein absorption and emission [3].

V. SETUP OF THE EXPERIMENT

Two main sections can illustrate the principle of operation of our arrangement (Figure 4) :

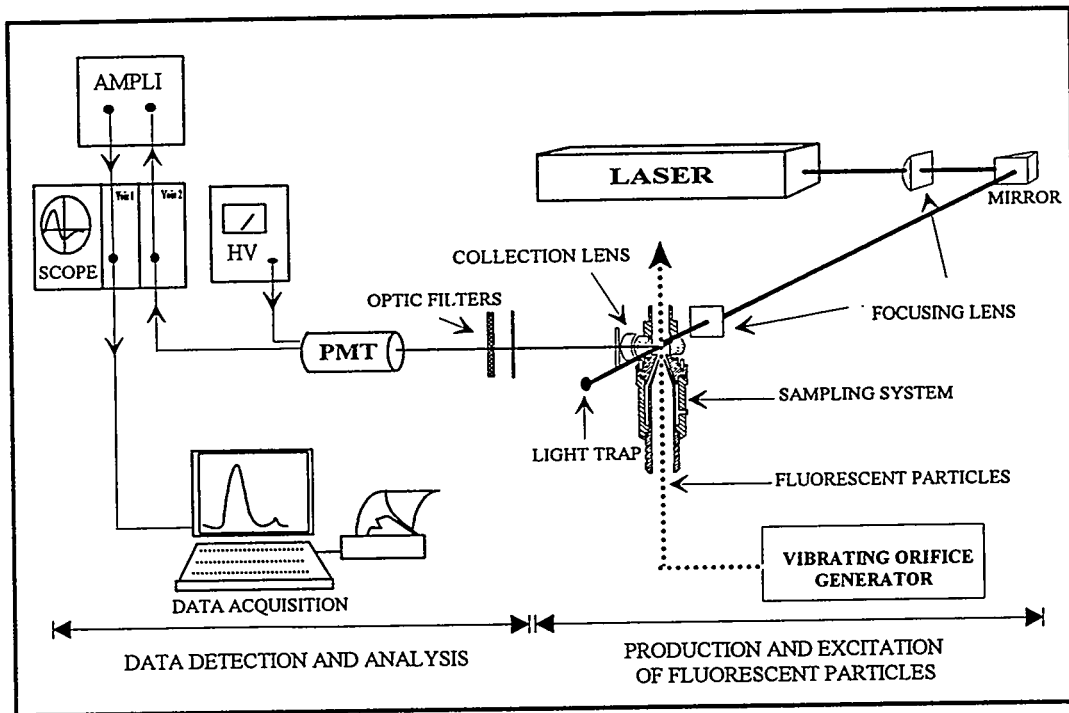


Figure 4 : Overall view of the experimental device

V.1. Production of droplets

A vibrating orifice generator (TSI Inc., Model 3050) provides for producing monodispersed droplets of glycerol tagged with soda fluorescein at concentrations of 1 and 10 g/L.

The range of diameters of aerosols produced extends from 1 to 10 μm (aerodynamic diameter), i.e. quantities of fluorophore contained per particle between $3 \cdot 10^{-16}$ and $3 \cdot 10^{-12}$ g/particle inclusive i.e. $6 \cdot 10^5$ to $6 \cdot 10^9$ molecules/particle.

It has been possible to check the particle size features of the test aerosols by means of an APS (Aerodynamic Particle Sizer, Model 3310, TSI Inc.). The spectrum illustrated in Figure 5 is found when producing droplets with a diameter of 5 μm .

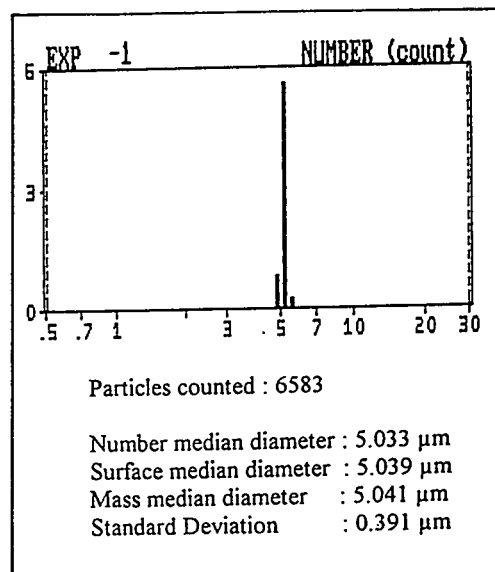


Figure 5 : Results from APS System

V.2. Dilution and sampling

The reference sample is delivered by an ejector with the flow rate controlled by a calibrated sonic orifice (SAPELEM) at the required rate (5 L/min.).

The total sample (sum of ducting and sampling flow rates) is delivered by two vane pumps mounted in series (RIETSCHLE).

The ducting deliveries and total sampling are checked by calibrated mass flowmeters (BROOKS, Models 5851) in the range of outputs used ; the difference corresponds to the delivery of particles taken.

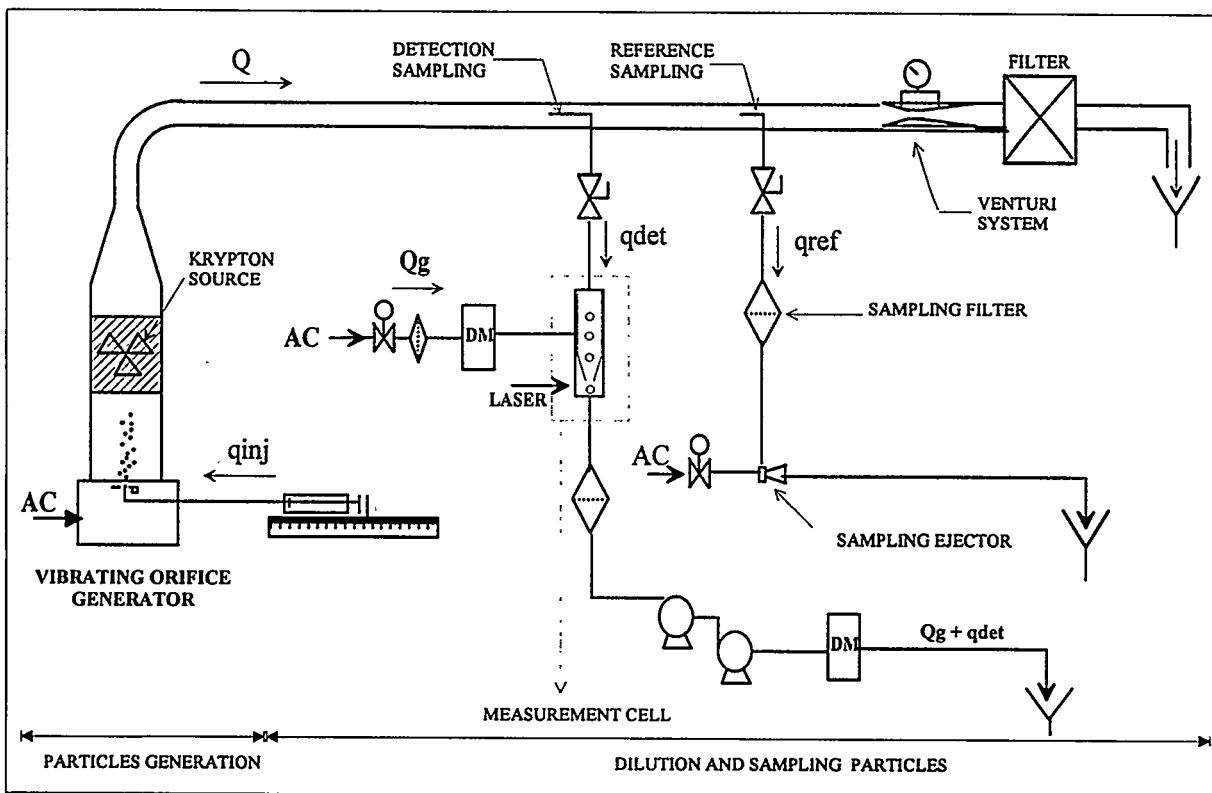


Figure 6 : Aerologic diagram for the counter qualification

KEYS:

- Q = dilution output of aerosols in the main line (m^3/h)
- Q_g = delivery of ducting air in the measuring cell (L/min)
- q_{det} = sample flow rate in the detection cell (L/min)
- q_{ref} = sample flow rate on the reference filter (L/min)
- q_{inj} = injection delivery of fluorescent solution into the generator (mL/min)
- DM = mass flowmeter
- AC = compressed air

VI. DETECTION OF AEROSOLS

VI.1. Laser source

The intention to make a device for measuring high sensitivity has led us to adopt a laser as the source of very bright light, monochromatic, easy to focus and, moreover, stable.

So we use an ionized argon laser (SPECTRA PHYSICS, Series 2000) which emits on wavelength 488 nm in accordance with the absorption wavelength of fluorescein sodium. The power is intentionally limited from 10 to 300 mW. It supplies a beam on TEM₀₀ mode, i.e. its profile of intensity is Gaussian.

VI.2. Focusing the beam

Figure 7 shows the distribution of the intensity of the laser beam at the level of the particles loaded air jet.

The focusing device is large in front of the diameter of the sample stream ; the intensity of the particle excitation is thus uniform, even for particle positions which fluctuate slightly in the lighted area.

The combination of special lenses enables the beam to take on the appearance of a sheet of light at the level of the flow of particles, the focusing thickness of which is fine so as only to illuminate a single particle going through (see Principle of Measurement).

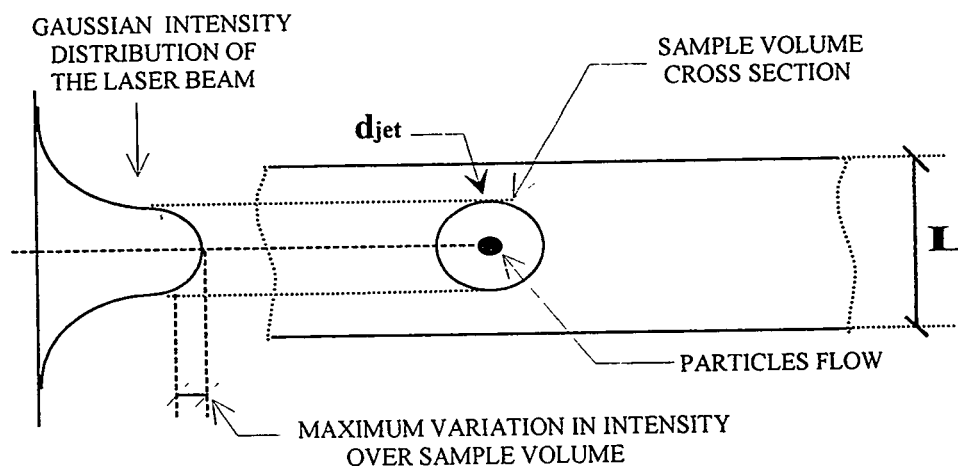


Figure 7 : Distribution of the laser intensity at the level of the jet as it leaves the nozzle.

VI.3. Chromatic filtering on the fluorescence light analysis channel

The association in series of an interference filter (CORION, LL500) and a colored filter (OG515) discriminates well between the wavelengths transmitted in comparison with the excitation light ; only fluorescence signals coming from the particles reach the detector.

Therefore, we clear the parasite light reflected mainly by the walls of the cell and the diffusion light also produced by the particles.

VI.4. Detection and collection of data

A photomultiplier (HAMAMATSU, Type R928) collects the fluorescence photons and converts them, depending on the performance of the photocathode and its gain, into electric current ; the signal leaving this detector can be observed directly on one of the two channels of an oscilloscope before it is transmitted to the amplifier (SCHLUMBERGER, Type 7129) where it is formed and amplified.

The outlet from the amplifier is connected to the second channel of the oscilloscope mounted in parallel with the data collection line.

The data collection line consists of a computer (PC 386) completed with an interface card, type Accuspec NaI (CANBERRA) ; the coding is done on 2048 channels.

We thus have a high performance pulse analyzer which reconstitutes the spectrum of quantities of fluorescent photons detected ; it delivers histograms worked out by adding up the number of events filed according to their amplitude.

This arrangement allows us to follow in real time the detection of fluorescence signals emitted by the particles, simultaneously on the dial of the oscilloscope and on the computer. It is then easy correctly to adjust the focusing of the laser beam on the jet of particles by adjusting the micrometric settings of the cell (XY movement). The interaction between the laser beam and the particle flow is thus optimized by finding the maximum amplitude signal which offers the best resolution.

VII. MAIN RESULTS

VII.1. Estimating the rate of retention in the measurement cell

One of the main stages in the qualification of our device is to validate that laser detection is representative in relation to a reference sampling made in parallel. To do this, we have estimated the rate of retention "T" of the droplets right inside the device.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Three series of ten tests with simultaneous sampling reference and downstream of the laser detection device (Figure 6) carried out for each particle diameter between 1 and 10 μm inclusive, enable us to draw a retention curve characteristic of the device (Figure 8) after conventional fluorimetric analysis of the sampling filters.

The bars associated with the results correspond to uncertainty over the results, given with 95% probability.

$$T = \frac{C_{\text{ref}} - C_{\text{det}}}{C_{\text{ref}}}$$

where C_{ref} = reference concentration (g/L)
 C_{det} = concentration (sampling) measured downstream of the device (g/L)

The characteristic spectrum found during the detection of fluorescent particles is illustrated by few results recorded when detecting particles of different diameters (Figure 9).

The scale of the abscissa is in direct proportion to the amount of fluorescein measured per particle counted off, i.e. to the volume of the particle for a constant fluorescein concentration in the solvent (glycerol).

As far as the scale of the ordinates is concerned, it totals the number of particles detected per unit of time.

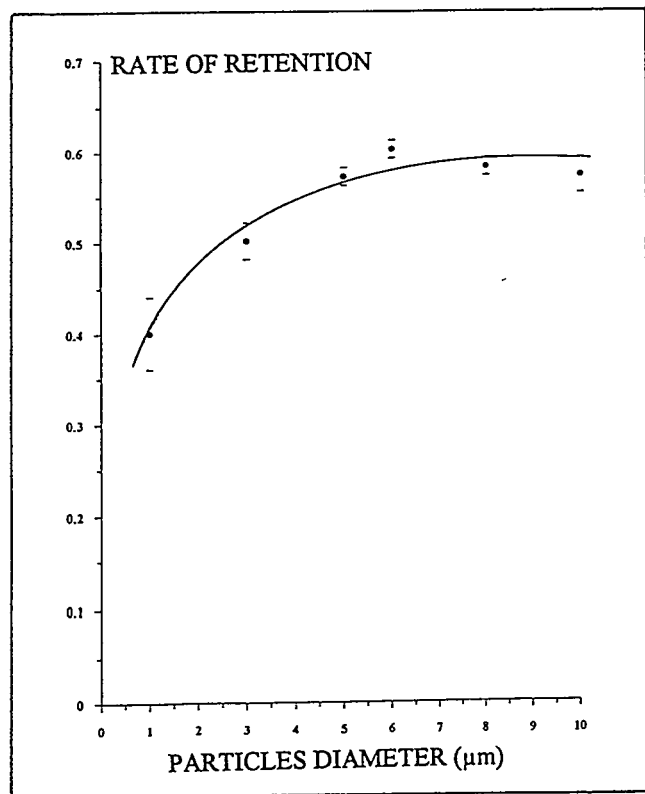


Figure 8 : Rate of retention versus particle diameter.

VII.2. Analysis of the signal given

Under good test conditions, i.e. optimum focusing of the laser beam on the jet of particles and a population of monodispersed droplets, the histogram found takes on a gaussian pace centered on the average value of the intensity of fluorescence measured.

Integration under the peak allows for determining the total number of particles detected during the analysis time.

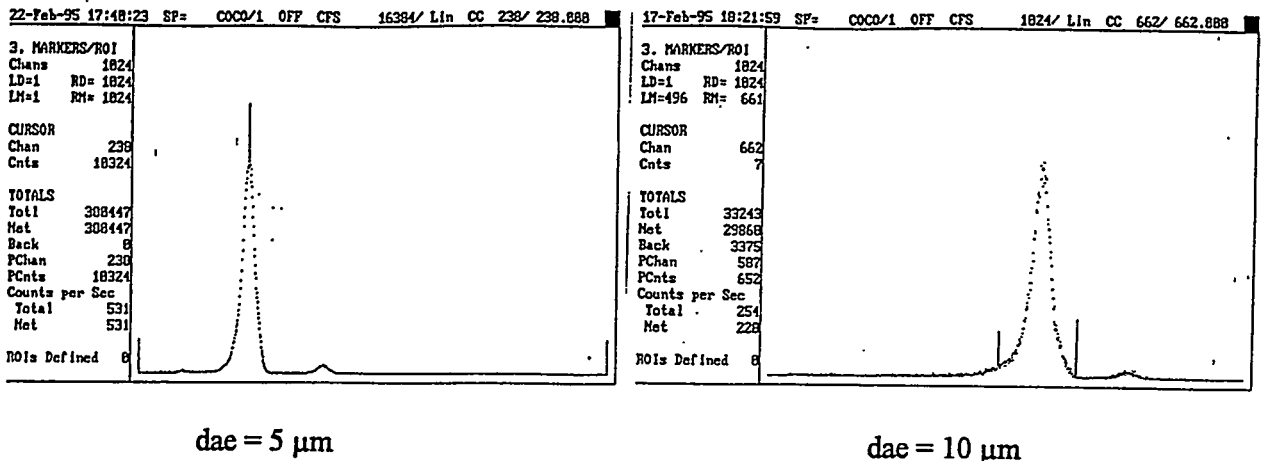


Figure 9 : Examples of spectra recorded

VII.3. Effect of different parameters

Several parameters can change the rate of the spectra recorded for a given diameter of particle with a fixed fluorophore concentration ; they are mainly :

- power of the laser beam (therefore of the excitation lighting) ;
- high voltage applied at the photomultiplier (PMT) ;
- time during particle remains in the laser beam ;
- alignment of the excitation beam on the jet of particles ;
- centering of the flow of particles (action of the ducting air flow rate).

The first three parameters quoted act essentially on the limit of detection of the device ; as for the other two, they can entail the spectrum being wrongly interpreted when they are incorrect.

Figures 10 and 11 show that the figures for the power provided by the laser and for the high voltage applied at the PMT must be optimized to maintain the linearity of the detection signal with the fluorescence of standard particles.

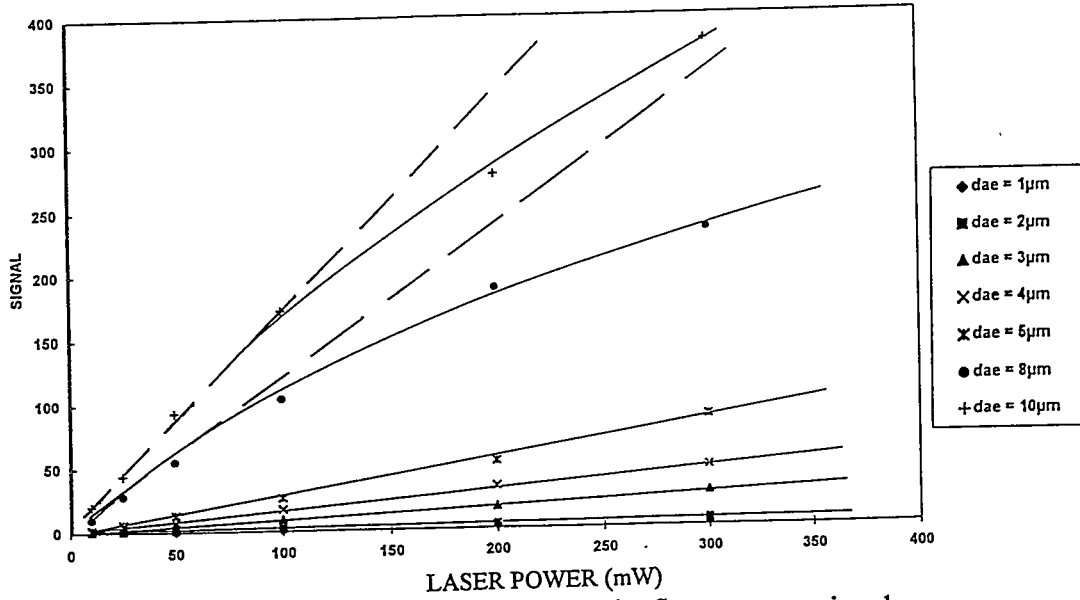


Figure 10 : Effect of the laser power on the fluorescence signal.

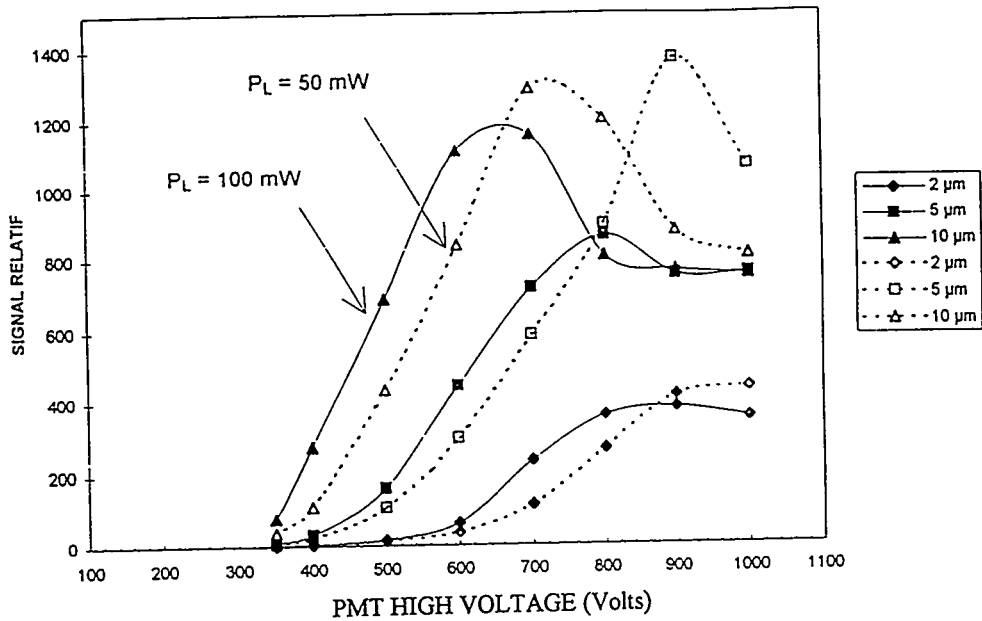


Figure 11 : Effect of the High Voltage of the PMT on the fluorescence signal

VII.4. Calibration test

A calibration curve can be drawn from the time one is working with all different optimized and fixed parameters.

The fluorescence signals emitted depend on the weight of fluorophore contained per particle, this is shown in Figure 12.

However, beyond certain conditions concerning laser power, high voltage of the PMT, size of droplets or else the fluorescein concentration, we encounter problems both with the limit of detection and with electronic saturation of the system.

In fact, when any of these various parameters increase, the linearity of the signal is only maintained in a certain field.

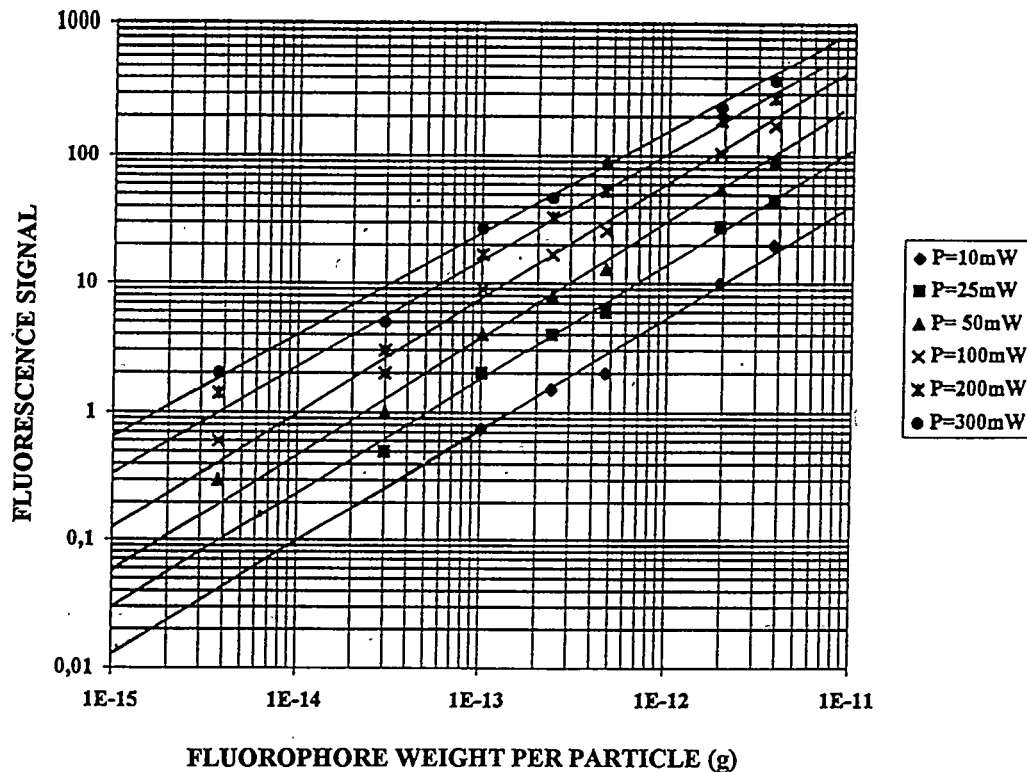


Figure 12 : Fluorescence signal versus weight of fluorophore contained per particle.

VII.5. Threshold of detection

The detection threshold of the device depends on the noise disturbing the signal for a fixed high voltage and laser power.

Thus, the detection threshold characteristic of our device is expressed as the lowest amount of fluorophore which can be detected. It's about $6 \cdot 10^6$ molecules per particle (10^{-15} g of soda fluorescein) detected at a laser power of 50 mW .

This limit value of detection can also be expressed in terms of the minimum particle diameter which can be measured, variable in accordance with the fluorophore concentration used.

VII.6. Comparison of results with conventional fluorimetry

Various tests have enabled us to compare the two different systems by estimating the mean deviation between the results achieved by laser detection with those achieved with conventional fluorimetry when measuring an identical particulate concentration, for different droplet diameters.

We find results which are quite closed between the two techniques since the difference is below 10% in all instances in which the spectra obtained can be used (separation of the fluorescence signal with that corresponding to the electronic or optic noise).

The parity diagram (Figure 13) illustrates that the laser detection is a reliable method of particles counting versus the conventional fluorimetry method.

The analysis times using the laser counting method are reduced and depend only on the particulate concentration present, for a constant delivery : it is desirable to wait for detection for a minimum of 10^4 events in total in order to reach satisfactory counting statistics (2 % accuracy) which, depending on the concentration measured, can involve counting times of less than one minute.

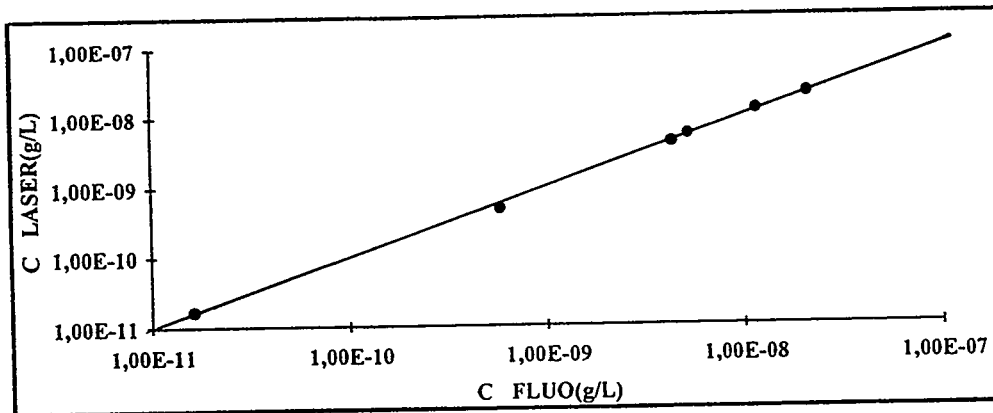


Figure 13 : Parity diagram

where C_{LASER} = results from laser detection (g/L)
 C_{FLUO} = results from conventional fluorimetry (g/L)

Our device allows great selectivity of detection since it only counts fluorescent particles. Spectra which have nil counting rates are found when samples are taken direct in the ambient air.

VIII. CONCLUSIONS AND PROSPECTS

Using a suitable laser source associated with high yield collection optics contributes to making a high performance fluorescent aerosol detection device for follow-up in real time and continuously of a test particulate concentration injected into a room or test rig.

Through the data collected the technique allows direct access to particle counting rates while controlling the particle size of the aerosols produced.

Estimating the total weight of fluorophore detected is facilitated for monodispersed particle analysis as soon as the content of each of them is known.

The limitations of this technique are directly connected with the noise level (optics and electronics) produced by the device as well as by the physical and chemical properties of the fluorophore used.

Manufacturing in the course of time a portable unit for taking measurements on site, calls for a technology which is compact and light and that essentially limits the size of the laser source used. In spite of the fact that there are ionized argon lasers on the market producing powers in the region of 20 to 100 mW, it would be wise to consider new excitable dyes in the red to permit the use of laser diodes which are very small and inexpensive. However, the dyes used must be quite harmless to human beings, which considerably limits the choice. In spite of our various researchs, only one dye is appropriate, the allophycocyanin that is a very costly product.

BIBLIOGRAPHY

[1] GAUCHER J.C. : Dispositif optique à rendement de collection élevée et Cytofluorimètre en faisant l'application. Brevet n° 84-09676, France, 20 juin 1984.

[2] SEIGNEUR A. : Cytométrie en flux : conception d'un appareil et validation expérimentale. Thèse - Université de Paris - sud. Centre d'Orsay - Février 1987.

[3] BERLMAN L.B. : Handbook of fluorescence spectra of aromatic molecules. Academic Press (1971).

[4] PREVOST C. : Etude d'un dispositif de comptage en continu d'un aérosol fluorescent. Mémoire CNAM - Paris, Juin 1996.

[5] STEEN H.B. : Characteristics of Flow Cytometers
Flow Cytometry and Sorting, Sec.Edi., pp 11-25, Wiley-liss, Inc.1990.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

ACCURACY IMPROVEMENT IN LEAK DETECTION OF CHARCOAL ADSORBERS BY HALIDE PULSE INTEGRATION METHOD.

Bela J. Kovach, Eric M. Banks
NUCON International, Inc.
Columbus, Ohio

Abstract

Due to the phaseout of the supply of R-11, which is used as a charcoal adsorber leak-testing agent, several new substitutes have been suggested and tested. ⁽²⁾ Pulse testing using agents with higher boiling points produced longer response times (due to prolonged evaporation and dispersion times). This longer evaporation time alters the pulse shape and lowers the peak concentration. Since the dispersion and evaporation time under different ambient condition are unpredictable, the peak concentration becomes unpredictable as well. One way to eliminate this unpredictability is to determine the area under the curve (of concentration versus time) after test-agent injection rather than the peak concentration (height). This value should be independent of the injection time and evaporation rate as long as the volume of the test agent injected remains constant.

Thus, tests were performed with a constant volume injection of test agent but with different injection times and evaporation rates. The area under the curve of concentration versus time was then compared with the peak concentration for each injection.

Introduction

Testing with a pulse of challenge agent has an advantage over testing with continuous injection, as described by several authors. ^(1,3,4) During pulse mode leak testing, the leak is calculated from the ratio of the pulse height detected simultaneously on the downstream and upstream side of the adsorber bed. This calculation is correct as long as the referenced two detectors have identical characteristics and they are working in their linear range. Several institutions have pushed the permissible leak threshold level from 10^{-2} % to 10^{-4} %. This is a new challenge for the detectors, since there is no sensor with linear characteristics over 6-7 orders of magnitude. Therefore, such tests are performed by comparison of a calculated upstream concentration with the detected highest peak concentration detected downstream of the adsorber. The comparison of a calculated concentration value on the upstream side of the adsorber to a detected peak height on the downstream side can be a significant source of error, varying with ambient conditions.

However, if the area under the curve of concentration versus time is used rather than the peak concentration (with constant volume injection of test agent), then this source of error can be reduced. Tests were performed to confirm this hypothesis.

Test and Equipment Description

A test was performed on a full size air cleaning unit at the NUCON[®] facilities to check the validity of the concept. The purpose was to show that no matter what the geometric shape of the pulse, the integrated value would provide an accurate measurement of the quantity of challenge agent.

The challenge agent was injected at the inlet of a 6,000 scfm. air cleaning unit in which the air flow is provided by a downstream fan. A long length of duct (approximately 30 ft) and three stages of filtration (mist eliminator, pre-filter and HEPA filter) provided enough time for complete evaporation and dispersion. A syringe was used to dispense 0.1 cc of 1-Bromobutane liquid onto a hot plate. Injection time varied from 2 seconds to 155 seconds.

A NUCON[®] F-1000 BBD detector was used to measure the concentration continuously. This instrument has a threshold sensitivity of 1 VPPB and the response is linear over the range of 1 - 450 VPPB. A single point sample was taken and pulled through the instrument by the internally mounted pump. A YOKOGAWA analog recorder recorded the concentration curves and a Hewlett-Packard integrator was used to analyze the output signal from the detector. The points on PPB curve represent the maximum concentrations recorded while the points on the integral curve are proportional to the mass of injected 1-Bromobutane.

Results and Interpretation

The test results shown on Figure 1 proved that if a constant volume of 1-Bromobutane is injected in the air stream, an open diode continuous halide detector will detect a constant integral value with less than $\pm 10\%$ error although the injection and dispersion time is varied between 2 second and 155 seconds. With pulses shorter than 2 second, larger error is expected, since the open diode response time is in the 1 second range.

Conclusion

1. When using a single downstream continuous Halide detector with calculated upstream injection, the integral value under the detected curve should be used for leak calculation rather than the highest peak concentration.
2. If the mass (or volume) of injected halide is proportional to the air flow rate, a single downstream continuous detector using pulse integration will display the leakage as ratio of masses, even if the pulse height and shape are varied by the injection time. Using this method, the detector can be calibrated to display the leak rate, for fast, easy and accurate operation.

Acknowledgment

The authors wish to thank Miss Luanne Armstrong as well as Mr. Gyorgy Kovacs, Mr. Joseph C. Enneking and W. Peter Freeman for technical support during the experiments and interpretation of the results.


24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

References

- (1) Bela J. Kovach, Robert R. Sommer II, Eric M. Banks, Field Test Results of In-Place Charcoal Adsorber Leak-Testing by Pulse Mode Halide Injection, 20th DOE/NRC Nuclear Air Cleaning Conference Boston, MA 1988
- (2) E. M. Banks, W. P. Freeman, B. J. Kovach, R. R. Sommer, Halide Test Agent Replacement Study 23rd DOE/NRC Nuclear Air Cleaning and Treatment Conference Buffalo NY 1994
- (3) E. Smith, The Adsorption of Pulses of Vapor Through Charcoal beds. Master Thesis, work sponsored by the Chemical Defence Establishment, UK. 1983
- (4) S. J. Taylor. Nonactive In-situ Freon Leak Test for Charcoal Filter Installation

Proceedings of a European Conference, Luxembourg 14—18 October, 1985, on Gaseous Effluent Treatment in Nuclear Installations

Constant Volume vs Time & Integral of Injection

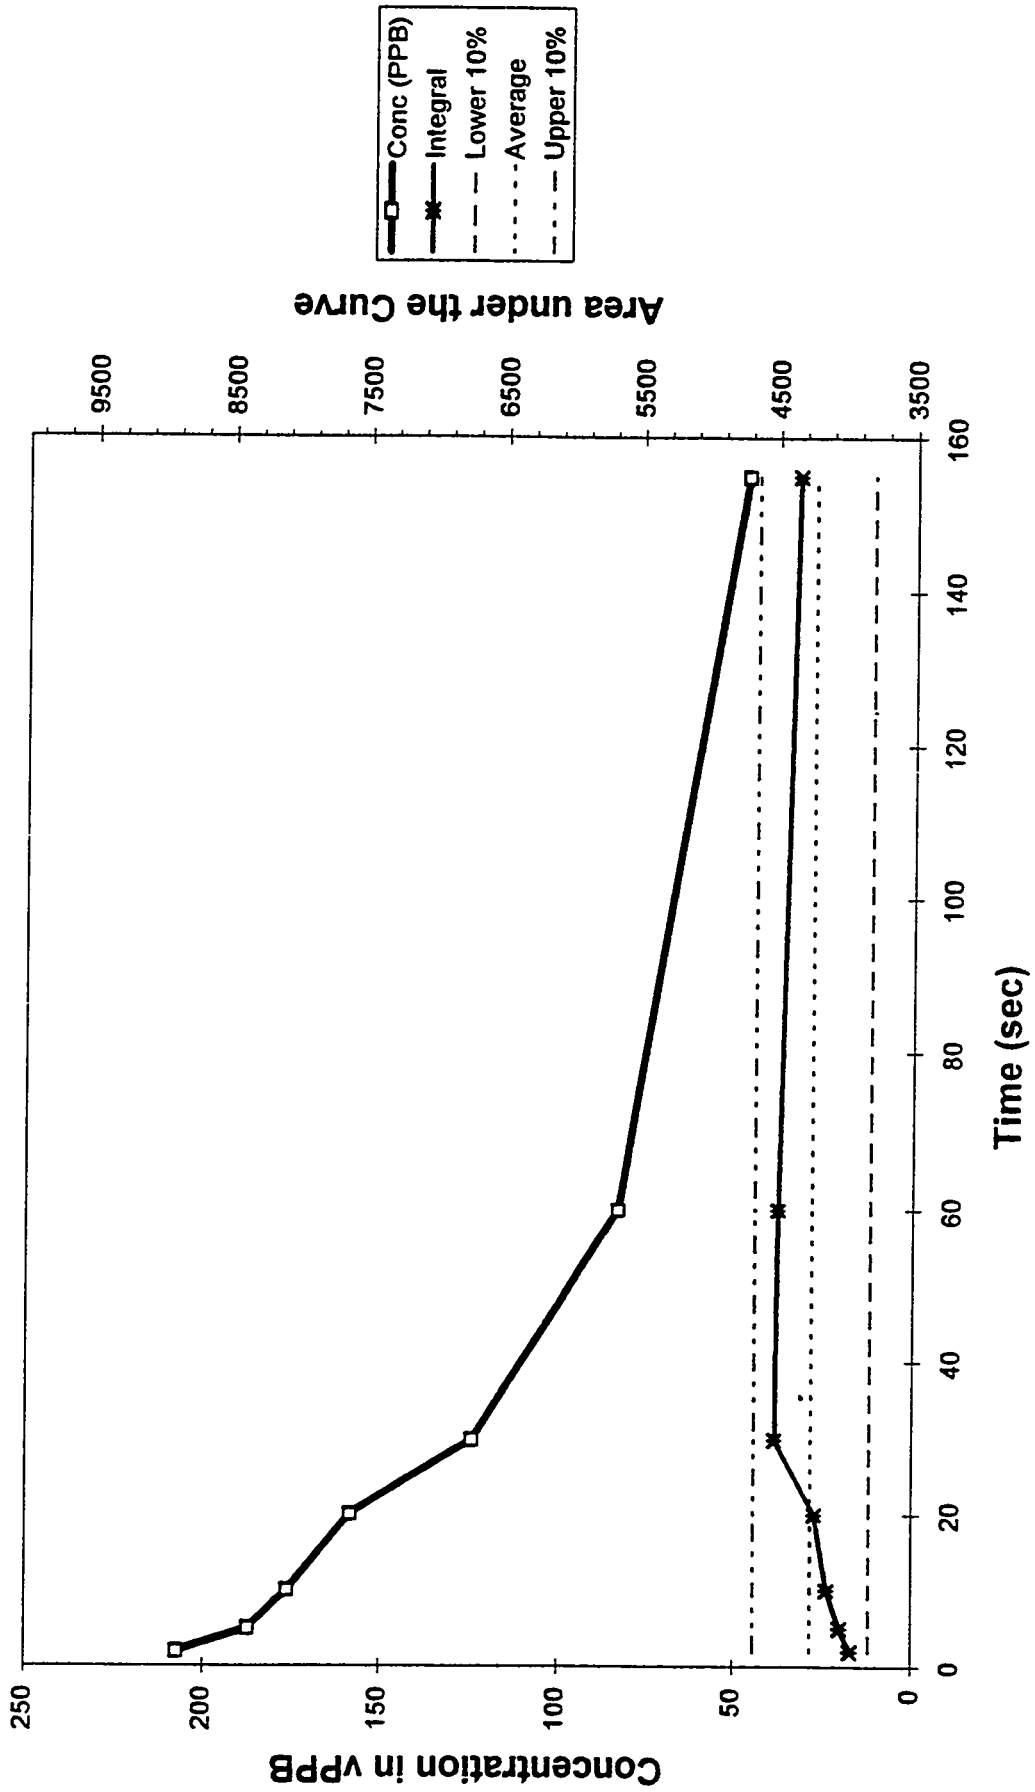

DISCUSSION

ANON: Is this replacement for R-11 a problem?

B. KOVACH: This is a R-11 replacement solution rather than a problem.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TESTING THE SAMPLING EFFICIENCY OF A NUCLEAR POWER STATION STACK MONITOR*

Lars H Ström
Instrumentinvest
S-611 63 Nyköping, Sweden

Abstract

The test method comprises the injection of known amounts of monodisperse particles in the stack air stream, at a suitable point upstream of the sampling installation. To find a suitable injection point, the gas flow was mapped by means of a tracer gas, released in various points in the stack base. The resulting concentration distributions at the stack sampler level were observed by means of an array of gas detectors. An injection point that produced symmetrical distribution over the stack area, and low concentrations at the stack walls was selected for the particle tests.

Monodisperse particles of 6, 10, and 19 μm aerodynamic diameter, tagged with dysprosium, were dispersed in the selected injection point. Particle concentration at the sampler level was measured. The losses to the stack walls were found to be less than 10 %. The particle concentrations at the four sampler inlets were calculated from the observed gas distribution. The amount calculated to be aspirated into the sampler piping was compared with the quantity collected by the sampling train ordinary filter, to obtain the sampling line transmission efficiency.

Introduction

Installations for the monitoring of ventilation stack releases of radioactive gases and particles should be tested periodically. This report describes experiments with a relatively simple method to investigate the relation between particles passing in the stack and particles collected on a monitoring filter. The stack sampler employed for the experiments was of the normal Swedish design, consisting of four isokinetic probes connected to a 100 mm diameter transport pipe, and filters and radiation detectors, sampling from the transport pipe. Figure 1 shows the stack and the room below the stack where the ventilation air flows come together, the stack base chamber. At the stack sampler level, four isokinetic probes sample the stack air, and a 100 mm pipe conducts the combined air flows (64 l/s) to the monitor room. Assuming equal flows in the probes, the inlet concentration is

$$C_{in} = \left(\sum_{i=1}^4 C_i \right) / 4$$

The mean concentration of particles in the stack over the time can be expressed as

$$C_{mean} = M / Q t$$

where M is the quantity of particles passing the stack in the time interval t. Q is the air flow in the stack, 164 m^3/s . If the particle concentration varies over the stack area, C_{in} and C_{mean} will generally differ by a factor f

$$C_{in} = f C_{mean}$$

f is called the "form factor" to indicate that it depends on the shape of the concentration profile and the disposition of the sampler probes.

*Funding was provided by the Swedish Radiation Protection Institute, Project SSI P 870.95.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In the monitor room several secondary samples are drawn isokinetically from the transport pipe into filters and other monitoring devices (0.5 - 0.7 l/s each). Particle concentration in the air reaching the filters is generally lower than in the stack air, due to losses in the pipes etc. This is expressed by the transmission efficiency η

$$C_{out} = \eta C_{in}$$

The purpose of the work reported here was to test a method to determine the sampling efficiency, which includes the form factor as well as the transmission efficiency. By means of these factors the stack release is calculated as

$$M = C_{mean} Q t = \frac{C_{in}}{f} Q t = \frac{C_{out}}{\eta f} Q t$$

Due to the strong dependence on particle size the investigation could also be called determination of upper size limit of the sampling installation.

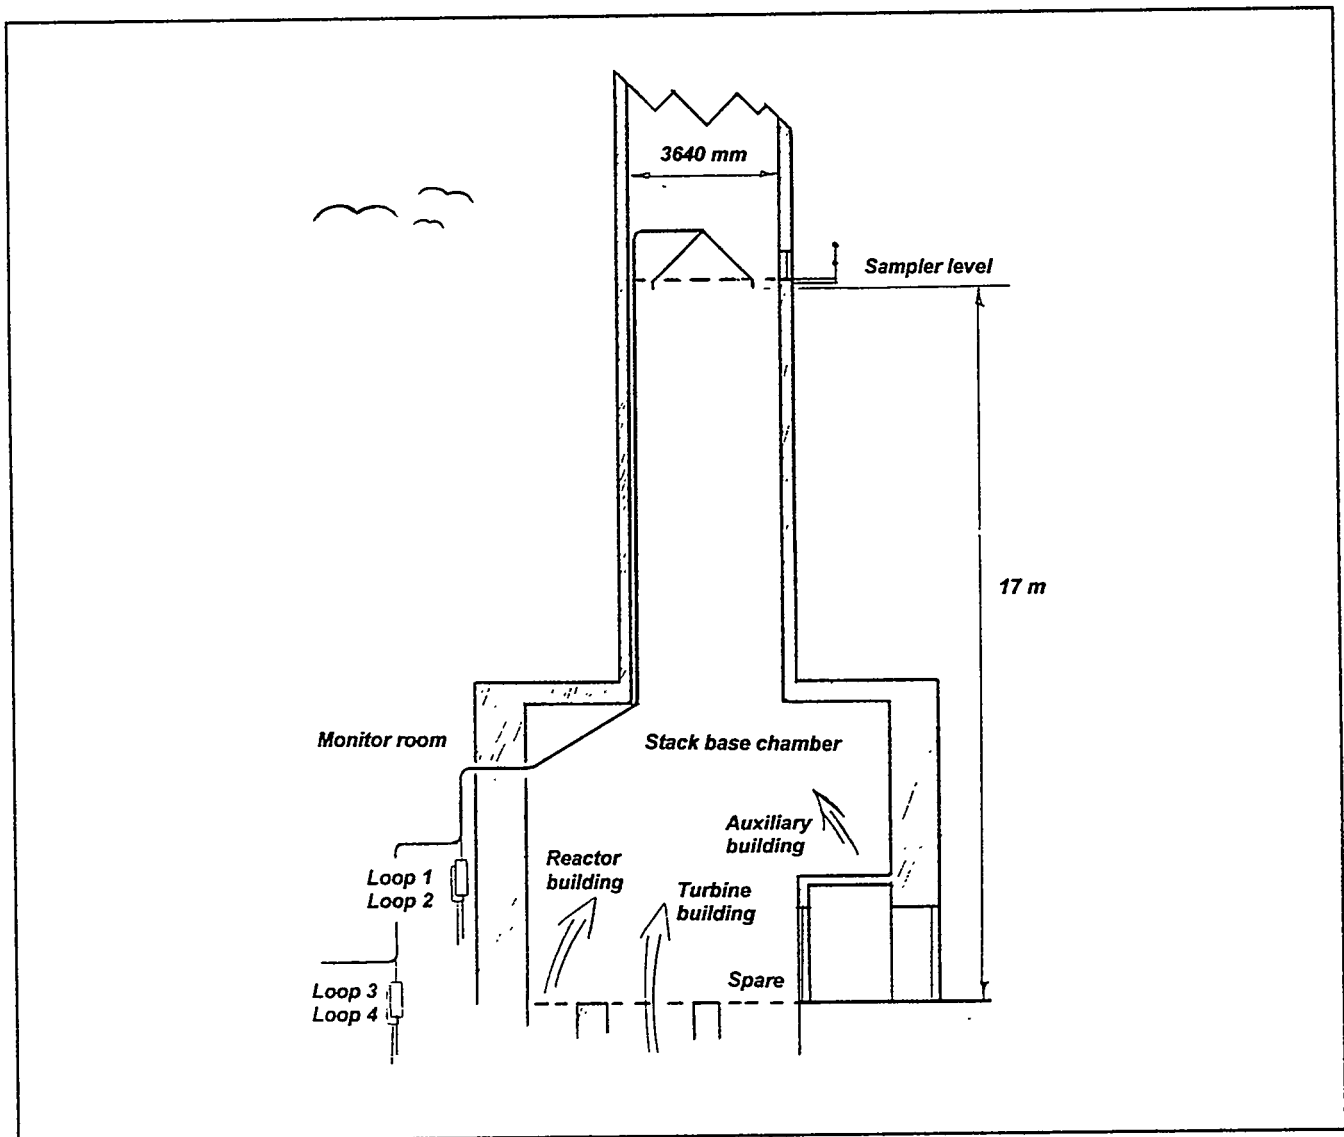


Figure 1. The stack base chamber, the stack, and the installation for air sampling.

The flow pattern

To find the form factor the air flow in the stack was mapped by means of a tracer gas. It was equally important to find a suitable injection point for the subsequent tests with particles. Suitable means in this context that at most a small fraction of the test aerosol is lost on the way from the injection point to the sampler section in the stack, but at the same time it is reasonably well distributed over the sampling section.

Ethanol was chosen as the tracer gas, for which simple solid state sensors are available, sensitive down to the ppm level (Scimarec AF 63, Japan). These sensors are no precision devices, but they are small, rugged, easy to apply, and cheap. 9 sensors were mounted on a cross-shaped frame, connected to a data logger, and hoisted to the sampler level. Ethanol was then injected by means of a compressed air atomizer in a number of points in the stack base chamber. Each injection consumed 1 litre of ethanol and took 10 minutes. Figure 2 shows some of the concentration patterns observed at the sampler level. The three ventilation air streams are evidently not well mixed when they reach the sampler. The arithmetic mean of the observed concentrations was calculated, to be used as a substitute for C_{mean} , and by interpolation also the concentrations at the four sampler inlets, and C_{in} (C_{mean} should not be taken from the injection rate, because of drift in sensor calibration). From this the form factor for the different injection points is obtained. These are provided in the key to Figure 2. In spite of the uneven distributions, the form factor is confined to the range 0.74 - 1.24.

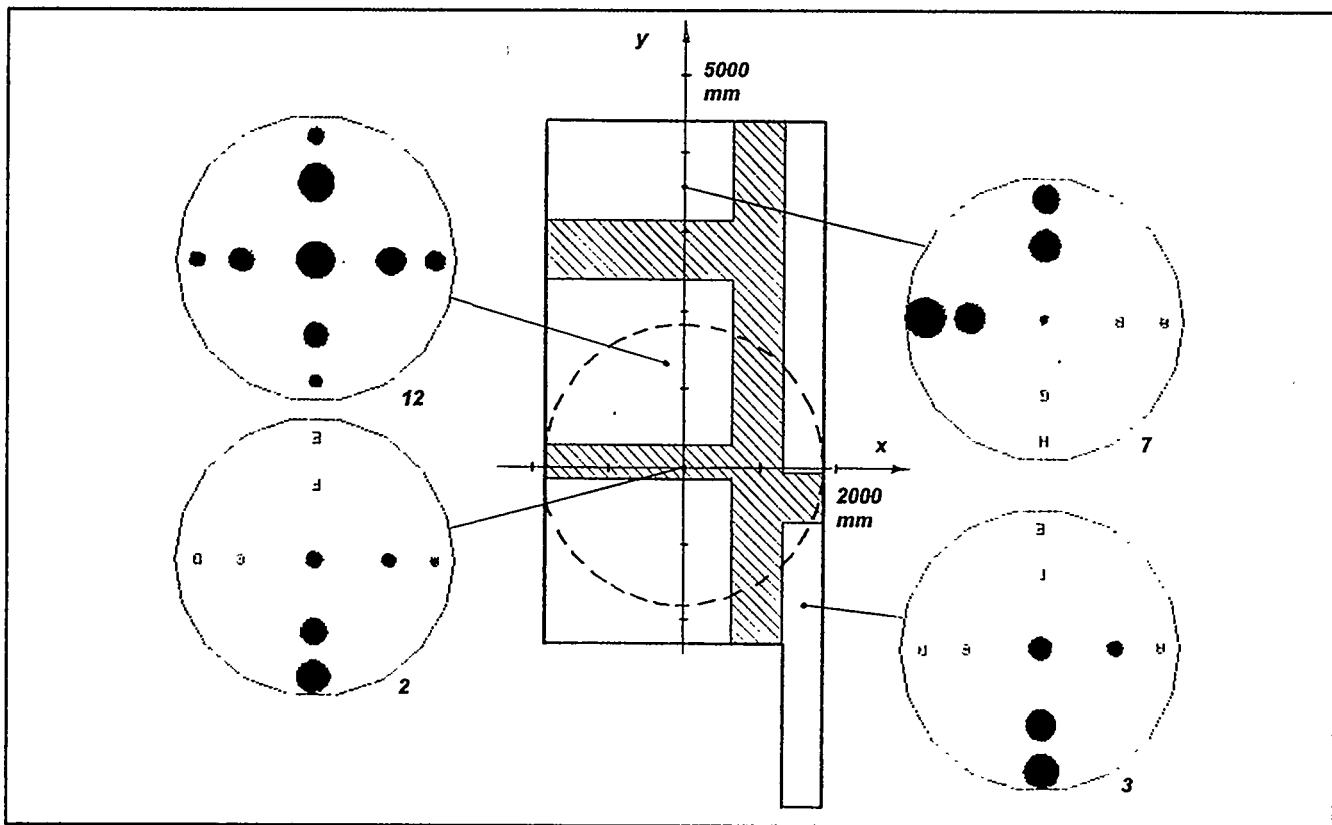


Figure 2. Observed tracer gas concentrations in the 9 measurement points at the sampler level, and the calculated form factors f for the sampler installation. The dot areas are proportional to concentration.

	x, mm	y, mm	f
Injection 2: On the centerline of the stack	0	0	0.74
Injection 3: In ventilation channel Auxiliary Building	1575	-1800	0.82
Injection 7: In ventilation channel Reactor Building	0	3500	1.00
Injection 12: In ventilation channel Turbine Building	-250	1300	1.24

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The particle tests

Monodisperse styrene - divinylbenzene particles were obtained from DYNO Particles, Norway. The particles were sulfonated and tagged with dysprosium, as a preparation for activation analysis. Three different sizes were employed, with the following properties:

Particle properties

Manufacturer's designation	Q-673	Q-501	Q-851
As received:			
Diameter, μm	4.6	8.6	15.3
Standard deviation, %	1.1	0.9	1.8
After sulfonation:			
Diameter, μm	4.9	9.1	16.3
Density, kg/m^3	1595	1316	1300
Dysprosium, g/kg of particles	109	39.5	35.6
Aerodynamic diameter, μm	6.2	10.4	18.6

The dysprosium was very strongly connected to the particles, with less than 1 % in the liquid phase of the particle suspension.

The particles were to be dispersed from a methanol suspension, and it was feared that the particles would acquire an electrical charge in the process. The charge of the smallest particles after dispersion in a test chamber was therefore measured. With pure methanol (conductivity $0.15 \times 10^{-3} \text{ 1}/\Omega\text{m}$) a mean charge of about 300 electrons was observed. By adding a small amount of potassium chloride solution to the suspension the conductivity was increased about 10 times, which decreased the particle charge by a similar factor. Such a low charge is not expected to influence particle deposition.

From the droplet spectrum of the atomizer it was calculated that if the particle concentration in the dispersion was $10^{14} \text{ particles}/\text{m}^3$ then only about 1 % of the particles generated would be duplets or higher combinations. This was confirmed by measurements. The atomizer was a Lechler 156.330.30.16, the dispersion gas carbon dioxide, the gas pressure 300 kPa, and the methanol flow 8 g/s.

One of the objectives of these tests was to demonstrate that it is possible to conduct the test aerosol to the sampler level without significant losses. With the tracer gas tests it had been observed that injection at the coordinates $x=-250 \text{ mm}$, $y=1300 \text{ mm}$ (Figure 2) gave a symmetrical pattern at the sampler level, with lower concentration at the walls. These conditions would favour low particle losses to the stack walls, and the above coordinates were used for the particle injections.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Particles were dispersed in the stack base chamber, and the particle flow at the sampler level measured by means of eight filter samplers. The form factor for these extra samplers and the chosen injection point was estimated at 0.92. An "injection efficiency" can be calculated as

$$H = \frac{\text{Concentration at sampler level}}{\text{Injected concentration}} = \frac{C_{A..H} / 0.92}{M_{inj} / t Q}$$

where

$C_{A..H}$	Mean concentration measured by the eight samplers
M_{inj}	Injected amount
Q	Stack flow
t	Injection time in seconds

The following results were obtained. The (rather uncertain) results from a calculation of the losses by means of turbulent deposition theory are also provided in the table.

Injection efficiency

Injection number	1	2	3	4	5	6
Particle size, μm	6.2	6.2	10.4	10.4	18.6	18.6
Dy injected, mg	27	33	54	53	191	190
Efficiency, measured	1.10	1.13	1.03	1.12	0.85	0.97
Efficiency, calculated	1	1	1	1	0.96	0.96

The measurements indicate that the particles are overrepresented in the filter samples. The reason could be an incorrect form factor, or non-isokinetic sampling. The important conclusion of this test is, that the injection losses are no greater than 10%, even for the largest particles. The calculation of deposition indicated that the reduced deposition velocity, k^+ , for the largest particles had its maximum value, 0.2. Still larger particles, currently considered in connection with new monitor installations, might not deposit faster in the stack.

Sampling line transmission efficiency

During the six injections mentioned above particles were also collected with the ordinary filter of the sampling installation. The transmission efficiency is calculated as

$$\eta = \frac{C_{out}}{C_{in}} = \frac{1}{f} \frac{C_{out}}{C_{mean}} = \frac{Q}{q} \frac{1}{f} \frac{1}{H} \frac{\text{Collected amount}}{\text{Injected amount}}$$

where

f	Form factor C_{in}/C_{mean}
Q	Stack flow
q	Filter flow
H	Injection efficiency

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The following results were obtained

Transmission efficiency

Injection number	1	2	3	4	5	6
Particle size, μm	6.2	6.2	10.4	10.4	18.6	18.6
Efficiency η , %						
Loop 2	13*	62	7	8	2	4
Loop 3	47		8		3	
Loop 4	45		7		6	
DEPOSIT calculation	65	65	16	16	0.2	0.2

*probably a gross error

In the table above is also cited the particle transmission calculated with the computer program DEPOSIT 2.0, ref 1. The computer program predicts reasonably well the particle size dependence, considering that the sampling system might be rather dirty, and that the adhesion at contact with the pipe surfaces might be incomplete for the largest particles.

Conclusions

It was demonstrated that in a simple but real geometry a test aerosol could be brought to the sampling section of the monitor installation with only small losses. The mean concentration can then be calculated from the injected quantity of particles, and separate sampling in the stack is not necessary. This simplifies testing considerably. Instead flow mapping with a tracer gas must be performed, to determine a suitable injection point for the test aerosol, and to find the form factor. But it is much easier to measure a gas than to measure particles.

Reference

1. Fan, B J et al. Aerosol particle losses in sampling systems. Paper 6-3, 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference. Denver, Colorado, USA, August 1992.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

BARLOW: My question is, if you had field conditions where the number of very large particles was very small, would you get any statistical effects which would render that 2-3% penetration (that you observed in your experiments using similar amounts in each particle size) very variable so that on some days you might get, say, 50% through?

STRÖM: One or two large particles may well be responsible for the bulk of the radioactivity in the sample under real conditions. The statistical nature of the sampling process in the stack will produce variations in the sample. Penetration through the sampling line is strongly size dependent, and statistical variation will only be added in the narrow transition range.

DUVALL: In your last slide you showed poor transmission for large particle sizes, i.e., those over 10 μm . I think it is a very important point because it illustrates the limitation of extractive sampling and a need to assure that large particles are not slipping through cracks in HEPA filters that develop between the filter medium and frame and so go undetected by extractive sampling. These large particles carry a large contribution of the radioactivity in the stack effluent to atmosphere. This illustrates a linkage of requirements for emission monitoring with requirements for air cleaning.

STRÖM: Particles from damaged filters are especially difficult to monitor, because such particles can be parts of the dust cake or the filter, and consequently very large. Sampling for filter damage requires special techniques.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

THE INFLUENCE OF SALT AEROSOL ON ALPHA RADIATION DETECTION BY WIPP CONTINUOUS AIR MONITORS

William T. Bartlett and Ben A. Walker
Environmental Evaluation Group
7007 Wyoming Boulevard, N.E., Suite F-2
Albuquerque, New Mexico 87109

Abstract

Waste Isolation Pilot Plant (WIPP) alpha continuous air monitor (CAM) performance was evaluated to determine if CAMs could detect accidental releases of transuranic radioactivity from the underground repository. Anomalous alpha spectra and poor background subtraction were observed and attributed to salt deposits on the CAM sampling filters. Microscopic examination of salt laden sampling filters revealed that aerosol particles were forming dendritic structures on the surface of the sampling filters. Alpha CAM detection efficiency decreased exponentially as salt deposits increased on the sampling filters, suggesting that sampling-filter salt was performing like a fibrous filter rather than a membrane filter. Aerosol particles appeared to penetrate the sampling-filter salt deposits and alpha particle energy was reduced. These findings indicate that alpha CAMs may not be able to detect acute releases of radioactivity, and consequently CAMs are not used as part of the WIPP dynamic confinement system.

I. Introduction

This paper discusses how aerosol particle collection on alpha continuous air monitor (CAM) sampling filters influences the reliability of CAM measurements. As a consequence of this study, the design of the Waste Isolation Pilot Plant (WIPP) radioactive confinement system was reevaluated, and a number of additional facility safeguards were added to reduce risks to workers and the environment.

Alpha CAMs were installed to monitor for transuranic radionuclides in the WIPP mine exhaust air. Mine exhaust air is normally unfiltered and flows at a rate as high as 425,000 cubic feet per minute (CFM). If radioactive aerosol were detected, then air flow would be diverted to high efficiency particulate (HEPA) filters and lowered to 60,000 CFM. At the lower air flow rate, some underground operations are not allowed; at high air flow, full underground operations are allowed. Thus, effluent CAMs are important in monitoring unfiltered air flow.

The 1990 WIPP Safety Analysis Report (SAR) required CAMs to be operational whenever unfiltered air was vented.⁽¹⁾ If an effluent CAM was non-operational for an hour, then operations were to be curtailed. Because of the importance of effluent CAMs, the Environmental Evaluation Group (EEG) recommended laboratory and in-situ testing to establish the reliability and detection efficiency of alpha CAMs.⁽²⁾

The WIPP repository is located in a bedded-salt formation 655 m (2150 ft) below the surface. The exhaust air contains high-salt-aerosol concentrations during mining, backfilling and other underground operations. It was assumed that alpha particle detection efficiency would not be significantly affected by the salt aerosol. Aerosol particles were expected to impact on the surface of the CAM sampling filters, or on the surface of sampling-filter salt deposits. Because radioactivity would be on the surface of the filter or salt deposit, alpha particle energy would not be reduced before

interacting with the CAM detector. For chronic radioactive releases, it was suggested that a saturation plutonium count rate would occur when sampling-filter-salt-deposit thickness exceeded the range of the alpha particles.⁽³⁾

The EEG reviewed CAM operational data and found that alpha spectra and radon-thoron daughter background subtraction were significantly affected by the magnitude of sampling-filter salt deposits.⁽²⁾ These problems were persistent, once a salt deposit accumulated on the sampling filter. The Waste Isolation Division (WID) of the Westinghouse Electric Corporation, located at the WIPP site, addressed this problem by modifying the alpha CAM detector-filter chamber design, but spectral anomalies and poor background subtraction were still observed.⁽⁴⁾ It became apparent that aerosol was not collecting on the surface of sampling-filter salt deposits.

In the following discussion, the alpha CAM design is reviewed, particle collection mechanisms discussed, and operational data are presented. From this information, it was concluded that CAMs could not perform their intended function, as required in 1990 SAR. Changes in the facility operations and safeguards were instituted.

II. WIPP Alpha CAM Design, Location and Particle Collection Efficiency

The WIPP alpha CAMs are modified Eberline Model Alpha-6 CAMs and are designed to account for the limited range of alpha particles. Sampled air passes through a membrane filter of either 25 mm (1 in) or 47 mm (1.8 in) in diameter, and when present, salt dust collects on the surface of the sampling filter. The sampling filter is juxtaposed approximately 5 mm (0.2 in) from a 25-mm (1 in) diameter alpha detector (Figure 1). The Figure 1 filter-detector geometry allows alpha particle detection efficiency as high as 11% of the particles emitted (4π efficiency).

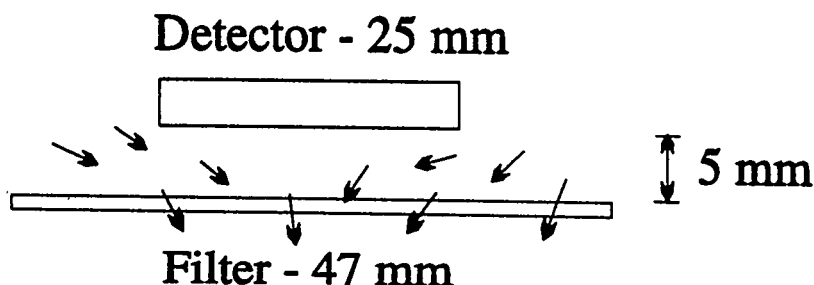


Figure 1 Detector-filter geometry (arrows indicate air-flow path).

The Alpha-6 monitor has a 256-channel spectrometer capable of discriminating ^{239}Pu and ^{238}Pu (5.1 and 5.5 MeV) alpha particles from naturally occurring alpha radiation, particularly alpha peaks from ^{218}Po and ^{212}Bi (6.0 to 6.09 MeV), ^{214}Po (7.69 MeV) and ^{212}Po (8.78 MeV). Net plutonium channel counts are derived by using a fixed region-of-interest (ROI) subtraction method⁽⁵⁾ as shown below:

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

$$Pu_{net} = (ROI-1) - [k * \{(ROI-2) * (ROI-3)\} / (ROI-4 + 1)] \quad (1)$$

where

- Pu_{net} = Net counts in plutonium region
- ROI-1 = Counts in region 1, plutonium (channels 92-126)
- k = k-factor, constant
- ROI-2 = Counts in region 2, ^{218}Po , ^{212}Bi (channels 136-143)
- ROI-3 = Counts in region 3, ^{214}Po (channels 148-178)
- ROI-4 = Counts in region 4, ^{212}Po (channels 179-186)

Figure 2 shows a typical alpha background spectrum, and designated ROIs. If the subtraction method is working properly, the average Pu_{net} count rate will be zero. If the alpha spectrum is anomalous or degraded, ROI-4 may be disproportionately low and cause Pu_{net} to be negative.

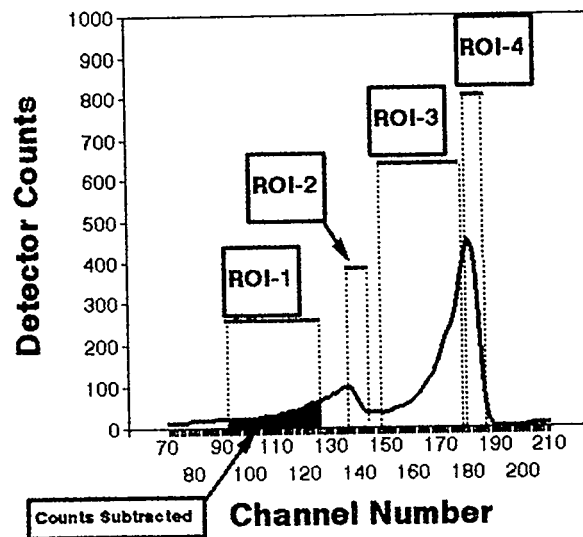


Figure 2 ROIs for alpha background subtraction.

There are four WIPP test CAMs discussed in this report. Three CAMs (153, 157 and an in-line prototype) are located in an above-ground sampling station (Station A) directly above the air exhaust shaft (see Figure 3). All mine air vents through the air exhaust shaft, and consequently, any salt aerosol produced underground can potentially affect the Station-A CAMs. A fourth CAM (129) is at the north end of room 1, panel 1 of the underground repository (Figure 3). The repository horizon is approximately 655 m (2150 ft) below the surface. There is usually little salt aerosol in room 1, panel 1 and the performance of CAM 129 in a low aerosol location was compared to the CAMs at Station A where salt aerosol is most likely.

Station-A CAMs are off-line monitors. Sample lines equipped with specially-designed shrouded probes extend from the Station-A sampling room into the exhaust shaft and can continuously sample the underground air effluent at a free stream velocity range of 2 to 14 m s⁻¹ (6.5 to 46 ft s⁻¹) and at a rate of 170 L min⁻¹ (6 CFM).⁽⁶⁾ The sampled air is pulled into three separate collection ports at 56 L min⁻¹ (2 CFM). The transmission ratio of particle sizes up to 10 μm AD (aerodynamic diameter) through the shrouded probe is expected to be 0.93 to 1.11.⁽⁶⁾

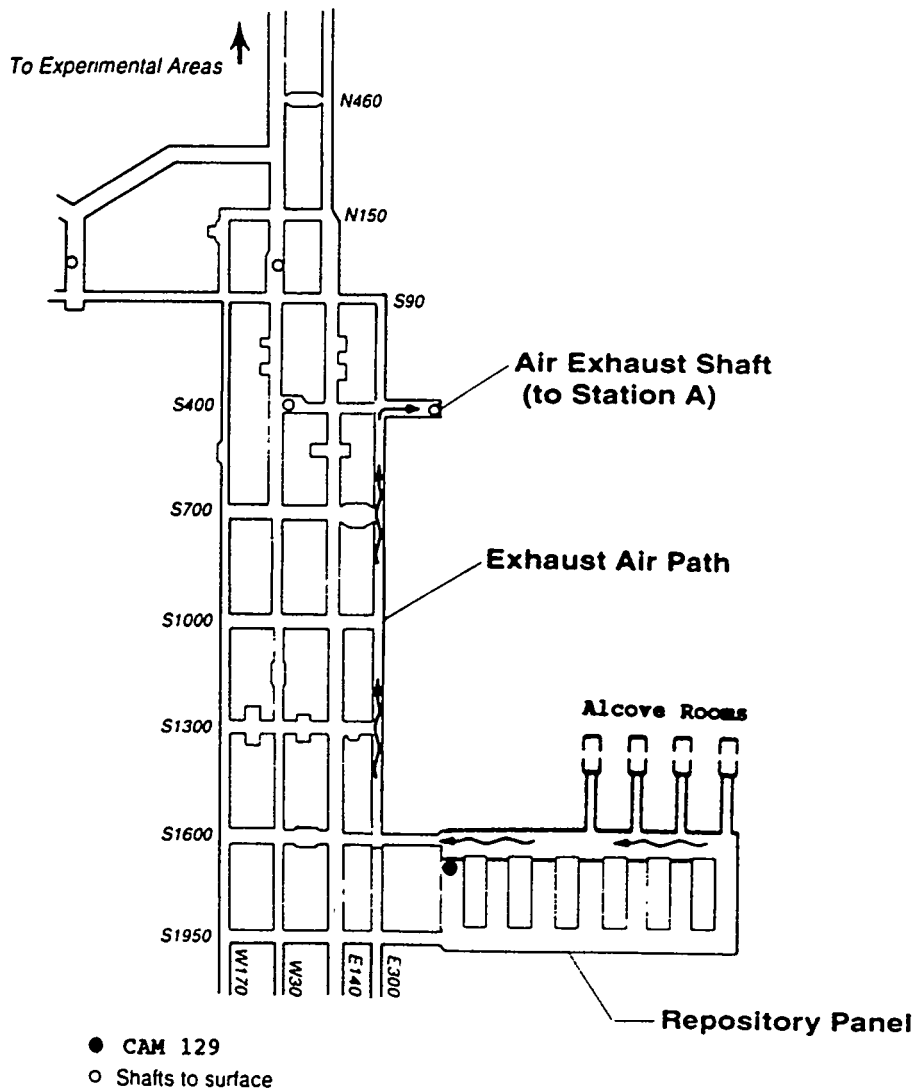


Figure 3 Main areas of underground repository (CAM 129 is located in room 1, panel 1, and station-A CAMs are located at ground level above the air exhaust shaft.)

CAM 129 is equipped with a radial annulus sample head in which aerosol enters the head from any direction around the rim at 28 L min^{-1} (1 CFM). The radial annulus sampler allows essentially 100% collection of particle sizes up to 6 to $8 \mu\text{m}$ AED (aerodynamic equivalent diameter) at 28.3 L min^{-1} to 85.0 L min^{-1} (1 to 3 CFM) and wind speed of 1 m s^{-1} (3.28 ft s^{-1}).⁽⁷⁾

In diesel-equipped mining operations similar to the WIPP, a bimodal distribution of airborne particles of $0.2 \mu\text{m}$ and $5 \mu\text{m}$ average aerodynamic diameter is typical.⁽⁸⁾ WIPP measurements indicated a similar distribution and that the aerosol is primarily NaCl.⁽⁹⁾

The ratio of radon-thoron progeny attached to WIPP salt-diesel aerosol is unknown. The NCRP⁽¹⁰⁾ states that mine aerosol concentrations would have to be extremely low to allow unattached fractions to exist. Other investigators suggest that the unattached fraction in diesel-equipped mines

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

is much less than 1%.⁽¹¹⁾ The WIPP is primarily a day-shift operation, and aerosol concentration may vary widely over a 24-hr period. Alpha spectra shown in this report are primarily from day-shift operations when aerosol concentrations are expected to be high.

III. Potential for Degraded Alpha Spectra

CAM sampling-filter mass loading is as high as 2 to 3 mg cm⁻² for underground operations, but can be in the range of 15 to 20 mg cm⁻² during backfilling or some mining operations.⁽²⁾ Twenty-four hour average air concentrations are as high as 0.3 to 0.5 mg m⁻³, and up to 2.5 to 3.3 mg m⁻³ in extreme conditions.

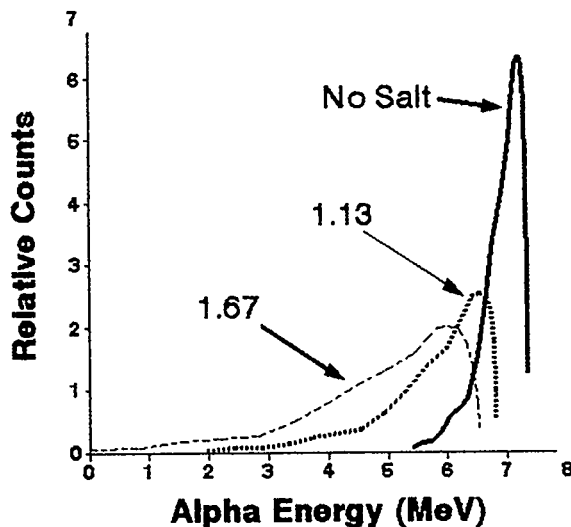


Figure 4 Theoretical reduction a ²¹⁴Po alpha spectrum with 1.13 and 1.67 mg cm⁻² salt interposed between the source and detector.

Alpha measurements are dependent on the CAM filter-detector geometry (Figure 1). Radioactivity on the sampling-filter surface will emit alpha particles isotropically. Using the filter surface as the source, alpha particle direction, path length and kinetic energy were predicted and calculated, considering the influence of air and varying salt thicknesses.⁽⁴⁾ Figure 4 shows a calculated ²¹⁴Po (7.69 MeV) alpha spectrum and the effect of interposing as little as 1 mg cm⁻² of

Table 1 Theoretical ²³⁸Pu and ²³⁹Pu Alpha Efficiencies*.

Depth in Salt mg cm ⁻²	Efficiency, % (4π)			
	²³⁹ Pu (5.1 MeV)		²³⁸ Pu (5.5 MeV)	
	ROI 92-126	ROI 65-126	ROI 92-126	ROI 65-126
0	10	12	11	12
0.56	6	10	5	11
1.13	1	6	2	10

*Efficiencies are relative to a 10% no-load 5.1 MeV efficiency.

salt between the source and detector. The spectral effects of interposed salt are more pronounced when less energetic ^{238}Pu (5.5 MeV) and ^{239}Pu (5.1 MeV) alpha particles are the source. The theoretical efficiency of the Alpha-6 was calculated as shown in Table 1.⁽⁴⁾ Changing the lower ROI-1 discriminator setting from 92 to 65 improves theoretical plutonium efficiency, but the overall CAM performance may be affected by other factors such as false alarm rates or background subtraction.

IV. Particle Collection Mechanisms

The EEG collects fixed-air sampling filters each day at the above ground sampling site, Station A. Salt particles ranging in physical size up to $7\ \mu\text{m}$ in diameter were observed using a scanning electron microscope. Microscopic analyses also revealed numerous dendritic structures on the sampling-filter surface. If exposed to high humidity the dendritic structures tend to collapse and form a confluence.⁽²⁾ Sputtering the sampling-filter surface, as a preparation for electron microscopic analysis, also disrupted the dendritic structures, as did viewing with a scanning electron microscope for long periods. In general, the sampling-filter salt deposits appeared loosely formed and porous. If observed with a light microscope, the dendritic structures remained stable.

The microscopic observations strongly indicated that the aerosol particles are electrostatically bound. The dry, hygroscopic nature of the WIPP salt repository favors electrostatic buildup, and particle-to-particle interactions were evident in our observations. There are no pressure drop measurements across the sampling-filter, but air flow is maintained relatively constant by flow control devices. Data from 1993 indicated only 2 days during the year when air-flow rate decreased by more than 10% during a 24-hour sampling period. The lack of filter clogging suggested that the particle packing fraction was low and that air easily passed through the sampling-filter salt deposit.

Because of these observations, it was hypothesized that the sampling-filter salt deposits may behave more like a fibrous filter than a membrane filter. If so, aerosol would penetrate differentially into the salt deposit. As the salt layer becomes thicker, more particles penetrate deeper into the salt deposit. The deeper the aerosol penetrates into the sampling-filter salt deposit, the greater the potential exists for reduced alpha particle energy and poor alpha spectra.

It was suggested that a monodisperse particulate aerosol will collect differentially on a fibrous filter with the fewest particles penetrating to the greatest depth in the filter,⁽¹²⁾ and particle penetration was described by a simple differential equation with the following solution:

$$N(x) = N(o) e^{-\alpha x} \quad (2)$$

where $N(x)$ = particle concentration at depth x
 $N(o)$ = particle concentration at surface, $x = 0$
 α = layer efficiency ($\text{cm}^2\ \text{mg}^{-1}$)
 x = layer thickness ($\text{mg}\ \text{cm}^{-2}$)

and $P = N(x) / N(o) = e^{-\alpha x} \quad (3)$

where P = penetration fraction

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

A plot of a hypothetical, monodisperse aerosol penetrating a fibrous matrix appears in Figure 5. A polydisperse aerosol was described as having a more complex penetration pattern and for a bimodal distribution was characterized as follows.⁽¹²⁾

$$P = (1-\beta) e^{-\alpha_1 x} + \beta e^{-\alpha_2 x} \quad (4)$$

where

- P = penetration fraction
- α_1 = layer efficiency of first aerosol fraction ($\text{cm}^2 \text{mg}^{-1}$)
- α_2 = layer efficiency of second aerosol fraction ($\text{cm}^2 \text{mg}^{-1}$)
- β = fraction of the α_2 aerosol particles
- x = layer thickness (mg cm^{-2})

A plot of a typical monodisperse aerosol penetrating a matrix is represented by either line 1 or 2 in Figure 6. Line 1 shows a highly penetrating fraction while line 2 shows a less penetrating fraction. Line 3 is a combination of two monodisperse aerosol fractions and is characteristic of a bimodal or polydisperse aerosol.

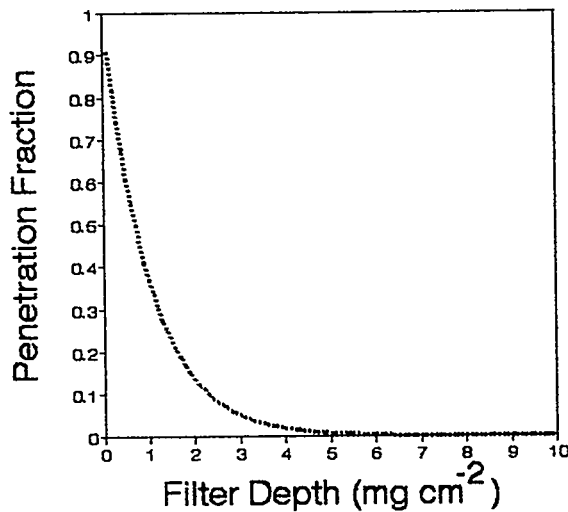


Figure 5 Monodisperse penetration of aerosol into a filter.

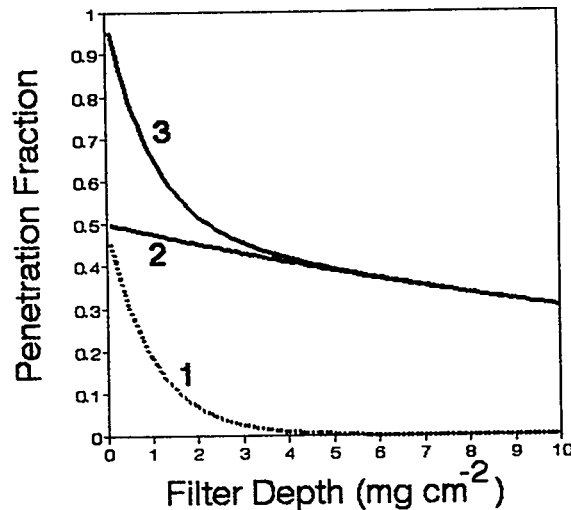


Figure 6 Polydisperse penetration of aerosol into a filter.

IV. Operational Data

Early in 1991, the maximum ^{214}Po peak height at the end of a 12-hour sampling period was evaluated as a function of sampling-filter salt loading, and a declining relationship was found (Figure 7). Following extensive CAM modifications in 1991 and 1992, a similar analysis was performed for a 24-hour sampling period, and a declining relationship was again found (Figure 8). These simple analyses indicated that sampling-filter salt loading was affecting alpha spectra and suggested the need for additional analyses.

CAM sampling filters are changed each morning before underground activities begin, and with a clean filter in place, well resolved spectra begin accumulating. Spectra typically become degraded mid-morning when underground operations begin. The poor spectra persist until filters are changed.

An example of the effects of sampling-filter salt loading occurred on January 25, 1994 when

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

backfill demonstrations were conducted in the alcove rooms (Figure 3). Hourly spectra from 9:00 a.m. to 1:00 p.m. are shown for the underground CAM 129 and Station A CAMs (153, 157, and in-line) in Figure 9. The Station A CAMs accumulated 11 mg cm^{-2} during this sampling period, whereas CAM 129 was out of the salt aerosol air flow and accumulated very little salt deposit. The Station A CAM spectra became severely degraded after 9:00 a.m. and continued to be degraded until the sampling filters were changed the next day. CAM 129 spectra remained well resolved.

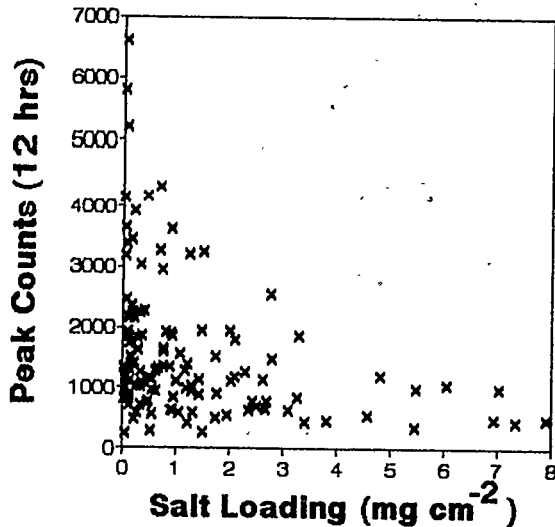


Figure 7 Maximum peak height of ^{214}Po , CAM 153, 1991, 12-hr sampling period.

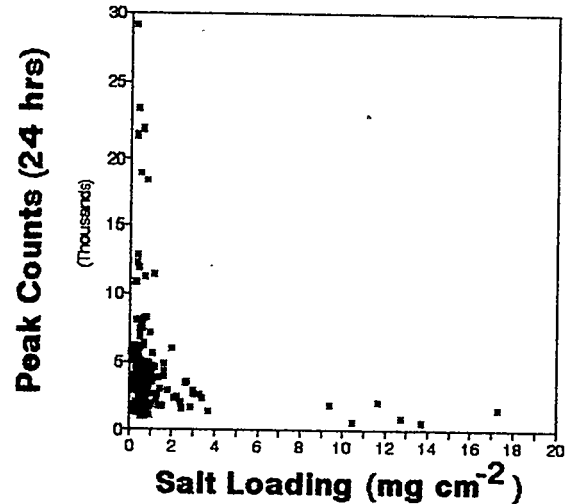


Figure 8 Maximum peak height of ^{214}Po , CAM 157, 1992-3, 24-hr sampling period.

In addition to maximum peak height, the full-width-at-half-maximum (FWHM) of ^{214}Po alpha peaks was used as a performance indicator for alpha spectra. ^{214}Po peak resolutions were calculated for days in January through March 1994 when salt loading varied from near zero to as high as 17 mg cm^{-2} . The average FWHM during a 5-hour afternoon period was calculated and graphed as shown in Figure 10. The FWHM is normally in the range of 14 to 20 channels. The data indicate that as little as 1 to 2 mg cm^{-2} salt loading causes the FWHM to be greater than 20. The increase in FWHM and loss in ^{214}Po resolution at relatively low sampling-filter salt loading (1 to 2 mg cm^{-2}) is consistent with theoretical calculations in Figure 4.

The net counts in the plutonium ROI (Pu_{net} from Equation 1), were also plotted in Figure 10 as a function of filter salt loading. The data indicated periods of very negative Pu_{net} counts (< -100 CPM) for 3 to 5-hour periods. Compared to an effluent alarm setting of 40 CPM, these negative excursions are significant. At relatively low salt loading (0 to 2 mg cm^{-2}), the background subtraction appears reasonably good. At salt loading above 2 mg cm^{-2} , there was consistent oversubtraction of plutonium region counts. At very high salt loading (18 mg cm^{-2}), the oversubtraction was not as pronounced, but alpha peaks were essentially non-existent. Pu_{net} was not a consistent CAM performance indicator, but at times, the oversubtraction of plutonium background counts was so extreme that the monitor could not be considered operational.

The total spectrum counts in each of the Station-A CAMs were compared to total counts from CAM 129 during the same time period. The results were graphed as a ratio shown in Figure 11. When salt loading was low, all CAMs had similar total counts. As salt load increased, efficiency dropped quickly. These data are indicative of the quantitative reduction of CAM efficiency as salt

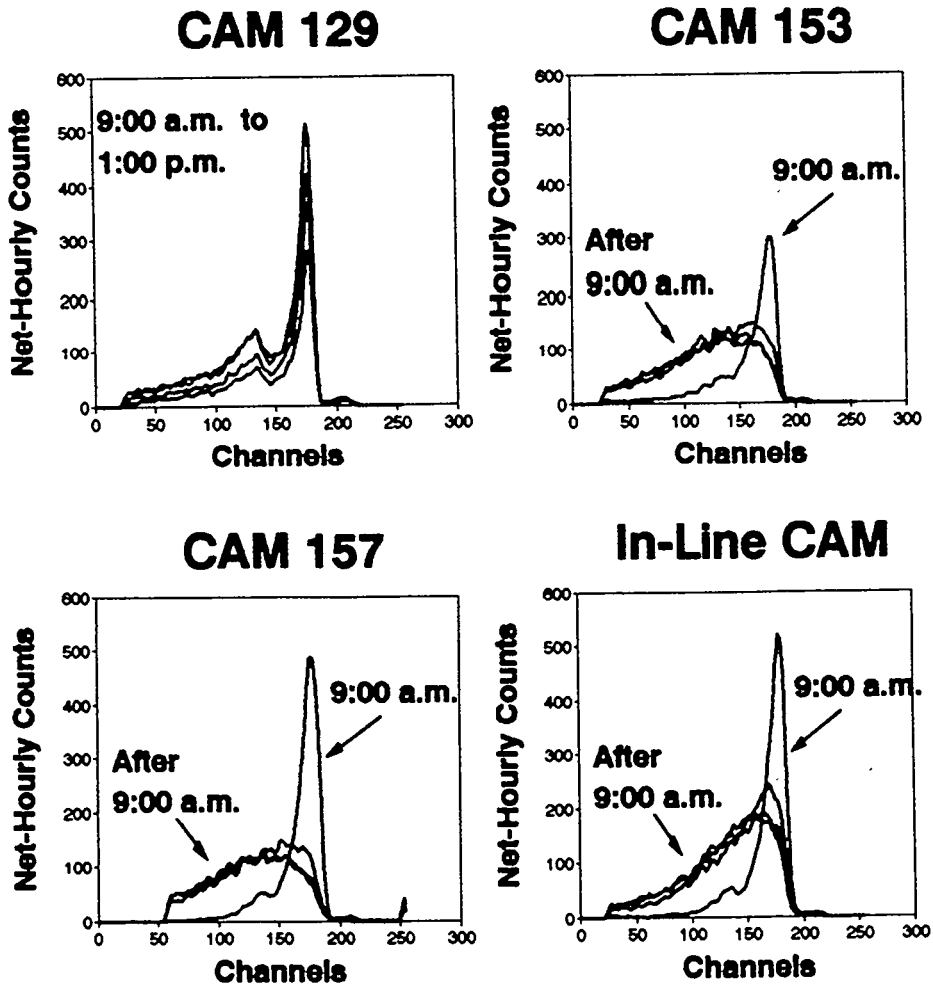


Figure 9 CAM alpha spectra on January 25, 1994.

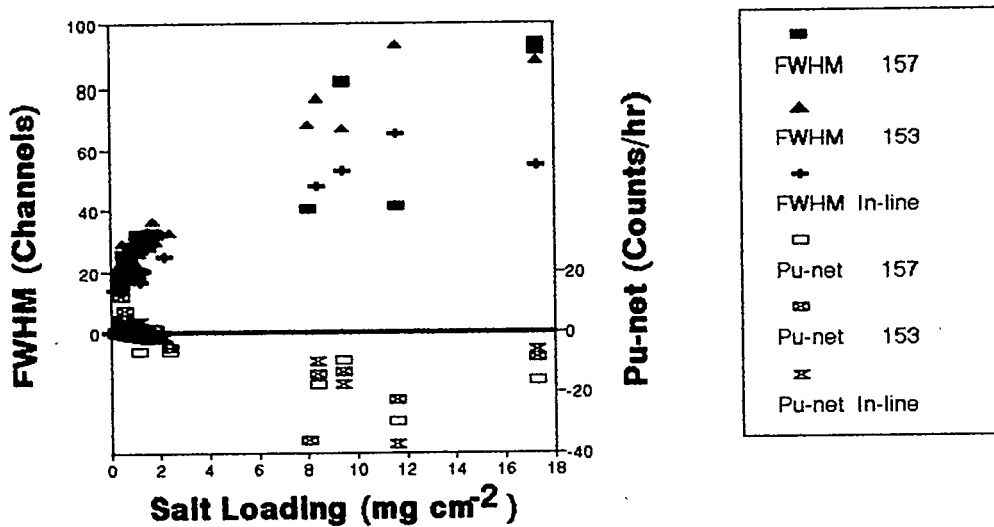


Figure 10 FWHM and Pu_{net} as sampling-filter salt deposits increase.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

deposits become greater. The most straightforward explanation is that aerosol particles are penetrating the sampling-filter salt deposit, and alpha particle energy is reduced by interaction with the salt deposits.

If aerosol penetrates a fibrous filter and the sampling-filter salt deposit in a similar manner, then it would be expected that alpha detection efficiency would decrease exponentially as salt deposits increase. The observed relative efficiency data was fit to the exponential equation, e^{-bx} (Figure 12). At the 95% confidence level, data up to 17 mg cm^{-2} yielded a goodness of fit of 0.97. Because previous empirical data⁽⁹⁾ and information⁽⁸⁾ suggest that the WIPP mine aerosol is a bimodal distribution, data below and above 2 mg cm^{-2} were fit independently with the same exponential equation. The data below 2 mg cm^{-2} yielded a goodness of fit of 0.89, the data above 2 mg cm^{-2} were fit at 0.99. Each of the analyses indicates an exponential loss of counts on CAMs with salt-laden filters. The data suggest that a bimodal distribution is probable, but additional work is needed to confirm this hypothesis.

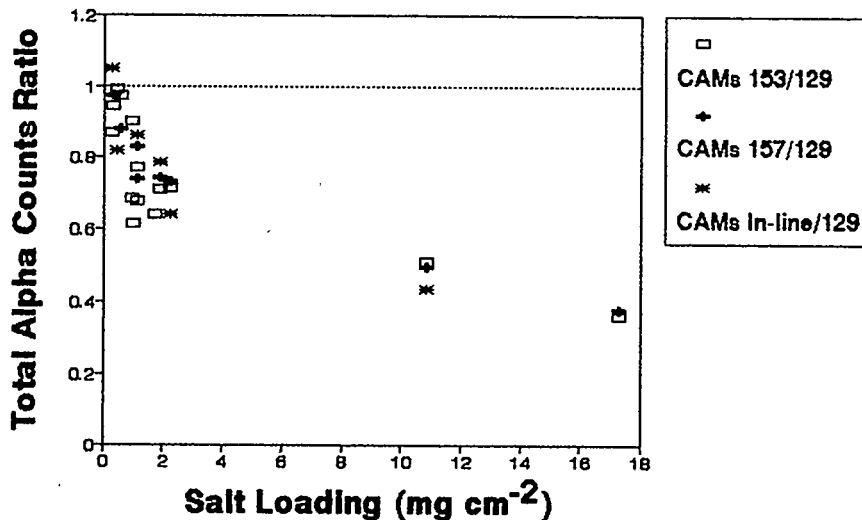


Figure 11 Relative efficiency of station-A CAMs to CAM 129 as a function of salt loading at Station A.

V. Discussion and Conclusions

The operational data and fibrous-filter collection theories suggest that degraded alpha spectra and poor background subtraction are attributed to penetration of aerosol particles into preestablished sampling-filter salt deposits. A number of variables were correlated with sampling-filter salt loading, and each case, there were direct correlations with salt loading. Electron micrographs revealed porous salt deposits and dendritic structures on the surface of the sampling filters. It appeared that once a significant level of salt deposit built up on the surface of a membrane filter, then the filter performed like a fibrous filter, rather than a membrane filter.

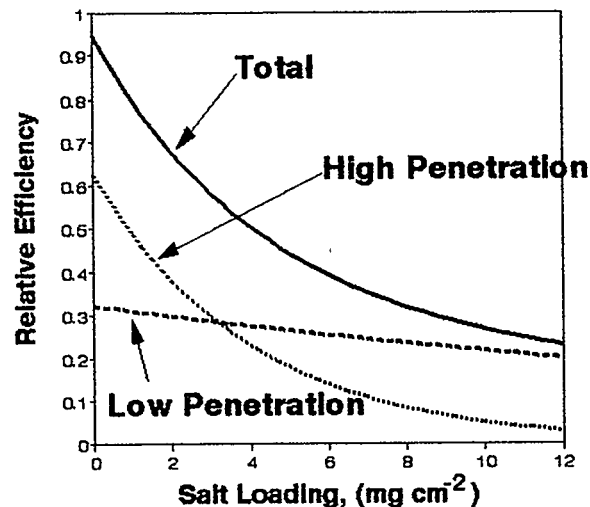


Figure 12 Best fit analysis of relative efficiency data.

If sampled aerosol collected strictly as layers on the surface of the sampling filter, then acutely released radioactive aerosol could be measured, regardless of the sampling-filter salt mass. Neither the reviewed data nor the fibrous-filter collection theories support such a limited mechanism for particle collection. In fact, more questions are raised about the complexity of the aerosol collection mechanism than are resolved. For example, it is generally thought that radon-thoron progeny are attached to ambient salt aerosol, but there are no empirical data to substantiate this assumption. It is not known whether radioactive progeny will preferentially attach to small or large dust particles. If radioactivity were found to attach only to the small particle fraction, then the collection mechanism of small particles would need to be studied. Although it is suspected that aerosol particles are predominantly collected by an electrostatic mechanism, other mechanisms can not be ruled out. And most importantly, it is not known whether transuranic aerosols would behave similarly to those of radon-thoron progeny.

The amount of salt on a sampling filter appears to be a much more important variable than the average-salt-aerosol concentration. Because of this finding, the mass of sampling-filter deposits should be carefully documented, and CAMs ideally should alarm when sampling-filter deposits become significant. Depending on the CAM location and function, the data indicate that sampling filters should be changed when salt deposits are in the range of 0.5 to 2.0 mg-cm⁻² (Table 1, Figures 11).

Effluent alpha CAMs are no longer a part of the limiting conditions of operations or the dynamic confinement system at the WIPP. Instead, WIPP will reduce potential radioactive uptake risks to workers and the environment by eliminating the operational backfill, restricting radioactive content of waste drums, using underground barriers to control potential releases and fires, modifying ventilation, relocating critical CAM monitors, and changing sampling filters when significant salt buildup is likely.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

References

1. Westinghouse Electric Corporation, Waste Isolation Division. "Final safety analysis report (FSAR)." WP 02-9, Rev. 0. Waste Isolation Pilot Plant, Carlsbad, NM (1990).
2. Bartlett, W. T. "An evaluation of air effluent and workplace radioactivity monitoring at the waste isolation pilot plant." Report No. 52. Environmental Evaluation Group, Albuquerque, NM (1993).
3. Seiler, F. A., Newton, G. J., Guilmette, R. A. "Continuous monitoring for airborne α emitters in a dusty environment," Health Phys 54:503-515 (1988).
4. Bartlett, W. T. and Walker, B. A. "The influence of salt aerosol on alpha radiation detection by wipp continuous air monitors." Report No. 60. Environmental Evaluation Group, Albuquerque, NM (1995).
5. Eberline Instrument Corporation. "Model alpha-6-1, alpha air monitor technical manual." Eberline, Santa Fe, NM (1991).
6. McFarland, A. R., Ortiz, C. A., Moore, E. M., DeOtte Jr., R. E., Somasundaram, S. "A shrouded aerosol sampling probe." Environ. Sci. Technol. 23:1487-1492 (1989).
7. McFarland, A. R., Rodgers, J. D., Ortiz, C. A., Moore, M. E. "A continuous sampler with background suppression for monitoring alpha-emitting aerosol particles," Health Phys. 62:400-406 (1992).
8. Cantrell, B. K.; Williams, K. L.; Watts, Jr., W. F.; Jankowski, R. A. "Mine aerosol measurements." In Aerosol measurement, ed. Willeke, K. and Baron, P.A.. Van Nostrand Reinhold, New York, NY, 591-611, 1993.
9. Newton, G. J., Cheng, Yung-Sung, Wong, B. A., Boecker, B. B. "Aerosol measurements in the partially completed underground waste isolation pilot plant: final report." Inhalation Toxicology Research Institute, Albuquerque, NM (1983).
10. National Council on Radiation Protection and Measurements. "Control of radon in houses, 16." NCRP Report No. 103. National Council on Radiation Protection and Measurements, Bethesda, MD (1989).
11. National Research Council. "Comparative dosimetry of radon in mines and homes." Report 90-136 by the Panel on Dosimetric Assumptions Affecting the Application Radon Risk Estimate. National Academy Press, Washington, D.C. (1991).
12. Brown, R. C. Air filtration. Pergamon Press, New York, NY, 1993.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

BRESSON: I thought I heard you say that when you were making measurements and mining operations were being conducted there was a period of enhanced salt concentration in the air. Is that correct?

BARTLETT: That is correct.

BRESSON: Do you have any data that show how the alpha CAM spectrometer system functions when there isn't that kind of activity going on? I would expect such activity would be typical of operations at WIPP. The question is, how do alpha CAMs function when you are not disturbing the environment and creating the particles?

BARTLETT: That's a good question. Figure 2 shows a typical alpha spectrum that you would see at Station A. When there is no salt, the instrument has good resolution, as shown in Figure 2. Your question is interesting because we have been asked this before. Some people think we can not do alpha spectroscopy in a mining environment, but we have five years' worth of electronic data to the contrary. The monitors work well when there is no salt aerosol.

BRESSON: So it is possible to come up with an operational scheme whereby you can rely on the air monitoring system to do its job except during periods when you are deliberately adding contaminants.

BARTLETT: That is very true. In fact, that has been one of our recommendations. The problem is determining when you are going to have salt aerosol collecting on the filter. Rather than manually determining when spectra are poor, it would be advisable to have the monitor automatically recognize poor spectra. Ventilation air could then be diverted to HEPA filters, or other operational options could be considered.

BRESSON: Does the particle size of the salt seem to be several micrometers in diameter?

BARTLETT: Yes, in electron micrographs the largest sized particle we have seen is about $7\mu\text{m}$ in diameter. There have been other studies by ITRI Research in Albuquerque, NM, in the mid-80's, and they reported particle sizes in the $3\text{-}5\mu\text{m}$ range.

BRESSON: Would a prefilter on the detector system filter out the larger salt particles but allow passage of PuO_2 particles?

BARTLETT: It is not known whether the Pu particles would be attached to the salt.

ENGLEMANN: What is the size distribution of the salt, and of the anticipated plutonium? The geometry you show suggests that salt may deposit around the periphery of the detector, on the filter, and the smaller plutonium makes it hard to get under the detector. Have you considered or tried a cascade impactor?

BARTLETT: There could be a wide range of Pu particle sizes. As mentioned previously, salt particle sizes range up to about $3\text{-}5\mu\text{m}$.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

ENGLEMANN: And larger for the salt?

BARTLETT: That is for the salt.

ENGLEMANN: Now it occurs to me to ask if you have tried the cascade impactor where you would get the activity in the final stage.

BARTLETT: I think that is a good recommendation. That is one of our recommendations, too.

ENGLEMANN: Another question is concerned with the geometry in which the detector is close to the filter. One would expect the salt and the larger particles to be peripheral to the detector. Are they able to make the turn and head toward the center of the filter? I wonder to what extent you are sure that you have a problem, and whether it can be corrected with the geometry.

BARTLETT: Perhaps I have given the wrong impression. Let me go back a bit. The question of geometry and uniform deposition of particles across the filter has been the subject of other studies. As a result of the studies, the collection chamber was redesigned to preclude this problem. I showed you two CAM spectra from station A. One was an older design. Another one was a new design that gives a much more uniform distribution of the particles across the face of the filter. Am I addressing your question?

ENGLEMANN: Perhaps if the fix isn't to correct uneven distribution across the filter, you can collect your large particles around the outside and let the rest go to the center.

BARTLETT: That is difficult.

ENGLEMANN: At any rate, I assume you have studied it?

BARTLETT: Those are questions that have been considered. We have not studied it *per se*, because others have looked at it. I believe these concerns have been addressed by the WIPP project.

SESSION 4

PANEL SESSION: TESTING AIR AND GAS CLEANING SYSTEMS

- A) ACCEPTANCE TESTING: PROPOSED AG-1 CODE TA**
- B) IN-SERVICE TESTING: PROPOSED NUCLEAR
STANDARD N511**

Tuesday July 16, 1996

Co-Chairmen: S. Banton

M.E. Pest

Panel Members: P. Burwinkel

C. Graves

V. Kluge

L. Leonard

PANEL DISCUSSION

SECTION TA ACCEPTANCE TESTING, DRAFT REVISION 03/06/96

ASME N511-19XX, STANDARD FOR PERIODIC IN-SERVICE
TESTING OF NUCLEAR AIR TREATMENT, HEATING,
VENTILATING AND AIR CONDITIONING SYSTEMS, DRAFT
REVISION 07/09/96

SECTION TA ACCEPTANCE TESTING

DRAFT
REVISION 03/06/96

Note: This is a draft document. An approved code section may differ in many respects. This draft version is made available for discussion purposes only.

SECTION TA
DRAFT
FIELD TESTING OF NUCLEAR AIR TREATMENT, HEATING,
VENTILATING, AND AIR CONDITIONING SYSTEMS

TA-1000	Introduction.....	7
TA-1100	Scope.....	7
TA-1110	Purpose.....	7
TA-1120	Applicability.....	7
TA-1130	Definitions and Terms.....	7
TA-2000	Reference Documents.....	9
TA-3000	General Inspection and Test Requirements.....	10
TA-3010	General.....	10
TA-3100	Test Instruments.....	10
TA-3110	Range Requirements.....	10
TA-3120	Instrument Fluctuation	11
TA-3130	Evaluation Following Test Instrument Loss, Damage or Calibration Failure.....	11
TA-3140	Specific Instrument Accuracy Requirements.....	11
TA-3141	Vibration Instrument.....	11
TA-3142	Challenge Aerosol Measuring Instrument.....	11
TA-3143	Challenge Gas Measuring Instrument.....	11
TA-3200	Reference Values.....	11
TA-3210	Establishment of Reference Values.....	11
TA-3300	Inspection and Test Requirements.....	12
TA-3310	Inspection and Test Parameters.....	12
TA-3320	System Operating Conditions.....	13
TA-3330	Procedure Requirements.....	13
TA-3340	Test Reports.....	13
TA-3400	Generic Tests.....	13
TA-3410	Visual Inspections (VT).....	13
TA-3420	Pressure Boundary Tests.....	13
TA-3421	Hydrostatic Tests (HYD).....	13
TA-3422	Structural Capability Tests (PS).....	14
TA-3423	Leak Test, Duct, Housing, and Frames (PL).....	14
TA-3424	Leak Test, Refrigerant Piping and Coils (PL).....	14
TA-3430	Functional Tests (F).....	14
TA-3431	Test Conditions.....	14
TA-3432	Restoration of Function Following Testing.....	14
TA-3433	Vibration Test (Vb).....	14
TA-3500	Acceptance Criteria.....	15
TA-3510	Visual Inspection.....	15
TA-3520	Pressure Boundary Tests.....	15

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-3530	Functional Tests.....	15
TA-4000	Field Acceptance Tests.....	16
TA-4010	General.....	16
TA-4100	Fan Acceptance Tests.....	16
TA-4101	Acceptance Test Requirements.....	16
TA-4110	Visual Inspection (VT).....	17
TA-4120	Pressure Boundary Tests.....	17
TA-4121	Structural Capability Test (PS).....	17
TA-4122	Leak Test, Fan Housing (PL).....	17
TA-4123	Leak Test, Fan Shaft Seal (PL).....	17
TA-4130	Component Functional Tests.....	17
TA-4131	Electrical Prerequisites.....	17
TA-4132	Control System Prerequisites.....	17
TA-4133	Startup Prerequisites.....	17
TA-4140	System Functional Tests.....	18
TA-4141	System Flow Balance Test (F).....	18
TA-4142	Mechanical Run Test (F).....	18
TA-4143	Flow Rate Test (Qf).....	18
TA-4144	Static Pressure Test (DP).....	18
TA-4145	Electrical Tests (AMP).....	18
TA-4146	Rotational Speed Test (N).....	18
TA-4147	Vibration Test (Vb).....	18
TA-4148	Bearing Temperature Test (Tb).....	19
TA-4149	Fan Performance Test (F).....	19
TA-4150	Acceptance Criteria.....	19
TA-4151	Air Flow Capacity Test Acceptance Criteria.....	19
TA-4152	Fan Performance Acceptance Criteria.....	19
TA-4200	Damper Acceptance Tests.....	19
TA-4201	Acceptance Test Requirements.....	19
TA-4210	Visual Inspection (VT).....	19
TA-4220	Pressure Boundary Tests.....	20
TA-4221	Structural Capability Test, Damper Housing (PS).....	20
TA-4222	Structural Capability Test, Damper Blades (PS).....	20
TA-4223	Leak Test, Damper Housing (PL).....	20
TA-4224	Leak Test, Damper Shaft Seal (PL).....	20
TA-4225	Leak Test, Damper Seat (PL).....	21
TA-4230	Component Functional Tests.....	21
TA-4231	Electrical Prerequisites.....	21
TA-4232	Pneumatic Prerequisites.....	21
TA-4233	Control System Prerequisites.....	21
TA-4234	Position Indication Test (F).....	21
TA-4235	Exercise Test (F).....	21
TA-4236	Static Timing Test (F).....	21
TA-4240	System Functional Tests.....	21
TA-4241	Flow Control Damper Functional Test (F).....	21
TA-4242	Fire Damper Test (F).....	22
TA-4243	Dynamic Timing Test (F).....	22
TA-4244	Interlock Test (F).....	22

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4300	Duct, Housing, and Mounting Frame Acceptance Tests.....	22
TA-4301	Acceptance Test Requirements.....	22
TA-4310	Visual Inspection (VT).....	22
TA-4320	Pressure Boundary Tests.....	23
TA-4321	Structural Capability Test, Duct and Housing (PS).....	23
TA-4322	Leak Test, Duct and Housing (PL).....	23
TA-4323	Leak Test, Mounting Frame (optional) (PL).....	23
TA-4400	Refrigeration Equipment Acceptance Tests.....	23
TA-4401	Acceptance Test Requirements.....	23
TA-4410	Visual Inspection (VT).....	23
TA-4420	Pressure Boundary Tests.....	23
TA-4421	Leak Test, Refrigerant Piping and Coil (PL).....	23
TA-4422	Hydrostatic Test, Hydronic Piping and Coils (HYD).....	24
TA-4430	Component Functional Tests.....	24
TA-4431	Electrical Prerequisites.....	24
TA-4432	Control System Prerequisites.....	24
TA-4433	Valve Position Indication Test (F).....	24
TA-4434	Valve Exercise Test (F).....	25
TA-4435	Valve Timing Test (F).....	25
TA-4436	Startup Prerequisites.....	25
TA-4440	System Functional Tests.....	25
TA-4441	Flow Control Valve Test (F).....	25
TA-4442	Mechanical Run Test (F).....	25
TA-4443	Performance Test (F).....	25
TA-4444	Electrical Tests (AMP).....	25
TA-4445	Rotational Speed Test (N).....	25
TA-4446	Vibration Test (Vb).....	26
TA-4447	Bearing Temperature Test (Tb).....	26
TA-4500	Conditioning Equipment Acceptance Tests.....	26
TA-4501	Acceptance Test Requirements.....	26
TA-4510	Visual Inspection (VT).....	27
TA-4520	Pressure Boundary Tests.....	27
TA-4521	Hydrostatic Test, Hydronic Piping and Coils (HYD).....	27
TA-4530	Component Functional Tests.....	27
TA-4531	Electrical Prerequisites.....	27
TA-4532	Control System Prerequisites.....	27
TA-4533	Electric Heater Step Controller Test (F).....	27
TA-4534	Electric Heater Coil Resistance Test (F).....	27
TA-4535	Electric Heater Resistance to Ground Test (F).....	27
TA-4536	Valve Performance Tests (F).....	27
TA-4537	Startup Prerequisites.....	28
TA-4540	System Functional Tests.....	28
TA-4541	Hydronic System Flow Balance Test.....	28
TA-4542	Flow Control Valve Test.....	28
TA-4543	Mechanical Run Test (F).....	28
TA-4544	Performance Test (F).....	28
TA-4545	Electrical Tests (AMP).....	28
TA-4546	Rotational Speed Test (N).....	28

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4547	Vibration Test (Vb).....	28
TA-4548	Bearing Temperature Test (Tb).....	29
TA-4549	Electric Heater Performance Test (F).....	29
TA-4550	Hydronic System Heating and Cooling Performance Test(F).....	29
TA-4551	Air Washer, Evaporative Cooler Performance Test (F).....	29
TA-4560	Acceptance Criteria.....	29
TA-4561	Electric Heater Ground Resistance Acceptance Criteria.....	29
TA-4600	Moisture Separator, Pre-Filter, HEPA Filter	
	Bank Acceptance Tests.....	29
TA-4601	Acceptance Test Requirements.....	29
TA-4610	Visual Inspection (VT).....	30
TA-4620	System Functional Tests.....	30
TA-4621	Differential Pressure Test (DP).....	30
TA-4622	Airflow Distribution Test (AD).....	30
TA-4623	Air-Aerosol Mixing Test (AA).....	30
TA-4624	In-Place Leak Test (IP).....	30
TA-4630	Acceptance Criteria.....	31
TA-4631	Airflow Distribution Test Acceptance Criteria.....	31
TA-4632	Air-Aerosol Mixing Test Acceptance Criteria.....	31
TA-4700	Type II and Type III Adsorber Bank Acceptance Tests.....	31
TA-4701	Acceptance Test Requirements.....	31
TA-4710	Visual Inspection (VT).....	32
TA-4720	Component Functional Tests.....	32
TA-4721	Electric Heater Step Controller Test (F).....	32
TA-4722	Electric Heater Coil Resistance Test (F)	32
TA-4723	Electric Heater Resistance to Ground Test (F).....	32
TA-4730	System Functional Tests.....	32
TA-4731	Differential Pressure Test (DP).....	32
TA-4732	Airflow Distribution Test (AD).....	32
TA-4733	Air-Aerosol Mixing Test (AA).....	32
TA-4734	In-Place Leak Test (IP).....	32
TA-4735	Test Canister Flow Rate Test (Qf).....	33
TA-4736	Electric Heater Performance Test (F)	33
TA-4740	Acceptance Criteria.....	33
TA-4741	Airflow Distribution Test Acceptance Criteria.....	33
TA-4742	Air-Aerosol Mixing Test Acceptance Criteria.....	33
TA-4743	Test Canister Flow Rate Test Acceptance Criteria.....	33
TA-4800	Adsorbent Acceptance Tests.....	33
TA-4801	Acceptance Test Requirements.....	33
TA-4810	Laboratory Analysis of Adsorbent (LAB).....	34
TA-4900	Integrated System Tests.....	34
TA-4910	Fan Integrated System Test Requirements (F).....	34
TA-4920	Damper Integrated System Test Requirements (F).....	34
TA-4930	Refrigeration and Conditioning Integrated System Test Requirement (F).....	34
TA-4940	HEPA and Adsorber Bank Integrated System Test Requirement(F)..	35

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-5000	Corrective Action Requirements.....	36
TA-6000	Quality Assurance.....	37
TA-6100	General.....	37
TA-6200	Personnel.....	37
TA-6300	Documentation.....	37
TA-6310	Procedures.....	37
TA-6320	Reports.....	37

Tables

TA-3000-1	Instrument Accuracy Requirements.....	10
TA-3000-2	Test Designations.....	12
TA-4000-1	Fan Acceptance Tests.....	16
TA-4000-2	Damper Acceptance Tests.....	20
TA-4000-3	Duct, Housing, and Frame Acceptance Tests.....	22
TA-4000-4	Refrigeration Equipment Acceptance Tests.....	24
TA-4000-5	Conditioning Equipment Acceptance Tests.....	26
TA-4000-6	Moisture Separator, Prefilter & HEPA Filter Acceptance Tests.....	30
TA-4000-7	Type II and Type III Adsorber Bank Acceptance Tests.....	31

Mandatory Appendices

TA-I	Visual Inspection Checklists.....	39
TA-II	Structural Capability Test Procedure.....	45
TA-III	Duct and Housing Leak Test Procedure.....	49
TA-IV	Airflow Distribution Test Procedure	55
TA-V	Air-Aerosol Mixing Test Procedure.....	59
TA-VI	HEPA Filter In-Place Leak Test Procedure.....	63
TA-VII	Adsorber Bank In-Place Leak Test Procedure.....	67
TA-VIII	Refrigerant Piping and Coil System Leak Test Procedure.....	71

Non-Mandatory Appendices

TA-A	Mounting Frame Pressure Leak Test Procedure.....	75
TA-B	Corrective Action Guidance.....	79
TA-C	Challenge Gas Substitute Selection Criteria.....	83

ARTICLE TA-1000 INTRODUCTION

TA-1100 SCOPE

This section provides requirements for the field acceptance testing of nuclear safety-related air treatment, heating, ventilating, and air conditioning systems in nuclear facilities.

TA-1110 PURPOSE

The purpose of this section is to provide requirements for field acceptance testing, the results of which are used to verify that nuclear air treatment, heating, ventilating, and air conditioning systems perform their intended function.

TA-1120 APPLICABILITY

This section applies to acceptance testing of nuclear safety-related air treatment, heating, ventilating, and air conditioning systems which are assembled, installed and ready for use. Included are requirements for integrated system performance testing under simulated conditions of operation. It is the Owner's responsibility to meet each of the applicable requirements in this section.

TA-1130 DEFINITIONS AND TERMS

The definitions provided in this section supplement those listed in AA-1000.

Abnormal Incident -- any event or condition which may adversely affect the functionality of the nuclear air treatment, heating, ventilating, and air conditioning system.

Acceptance Test -- a test to verify system or component design function following initial field installation, an abnormal incident, replacement, repair, or modification affecting a test reference value.

Adsorbent -- a solid having the ability to concentrate other substances on its surface.

Adsorber -- a device or vessel containing adsorbent.

Adsorber Bank or Filter Bank -- one or more filters or adsorbers secured in a single mounting frame, or one or more side by side panels containing poured or packed air treatment media, confined within the perimeter of a duct, plenum, or vault cross section, sometimes referred to as a stage.

Aerosol -- a stable suspension of particles, solid or liquid, in air.

Challenge -- to expose a filter, adsorber, or other air treatment device to an aerosol or gas of known characteristics, under specified conditions, for the purpose of testing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Challenge Gas -- a gas of known characteristics, under specified conditions, used for the purpose of testing. For in-place testing of adsorbers, the challenge gas is to be Refrigerant-11 or an acceptable substitute.

NOTE: For Challenge Gas Substitution Selection Criteria, refer to Non Mandatory Appendix TA-C.

Challenge Aerosol--poly-disperse droplets of dioctyl phthalate, (di(2-ethyl hexyl) phthalate), used as challenge aerosol for testing HEPA filter banks for leaks. The challenge aerosol for in-place leak testing of HEPA filter systems, in accordance with this section, is poly-disperse DOP liquid aerosol having an approximate light scattering droplet size distribution as follows:

99% less than 3.0 micrometer diameter
50% less than 0.7 micrometer diameter
10% less than 0.4 micrometer diameter

NOTE: The poly-disperse aerosol used for in-place leak testing of systems differs from the 0.3 micrometer mono-disperse DOP aerosol used for efficiency testing of individual HEPA filters by manufacturers.

HEPA Filter -- (High Efficiency Particulate Air) a disposable, extended- media, dry type filter enclosed in a rigid casing, that has a minimum efficiency of 99.97% when tested with an essentially mono-disperse 0.3 micrometer test aerosol.

In-Service Test -- A periodic test to verify that a system or component continues to meet its intended design function after being placed into operation.

Pressure, Maximum Operating -- The maximum pressure the system components will be subjected to while performing their function. The allowable pressure during abnormal operating conditions which will not physically damage the system (e.g. sudden closure of dampers or registers), shall be considered maximum operating pressure.

Pressure, Operating -- the pressure that corresponds to the normal design operating mode of the system. This pressure is less than or equal to the maximum operating pressure.

Pressure, Structural Capability -- the pressure to which the designer specifies the component or system can be safely operated without permanent distortion.

Reference Value -- one or more achieved values or test parameters that are measured, observed, or determined when the equipment or system is known to be operating acceptably within its design basis range.

System -- An assembly of components, including associated instruments and controls, required to perform the safety-related function of a nuclear air treatment, heating, ventilating, and air conditioning system.

Test Boundary -- the physical limits of the component, system, or device being subjected to a specified test.

Test Canister -- a specially designed sample holder containing adsorbent for laboratory tests that can be removed from an adsorber bank, without disturbing the remainder

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

of the adsorber, to provide representative samples for laboratory testing.

ARTICLE TA-2000 REFERENCE DOCUMENTS

The reference documents listed below shall supplement those listed in AA-2000.

AMERICAN CONFERENCE OF GOVERNMENT INDUSTRIAL HYGIENISTS (ACGIH) INDUSTRIAL VENTILATION:
A Manual of Recommended Practice.

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)
ASTM D 3803-1989, Standard Test Method for Nuclear Grade Activated Carbon.

AMERICAN NUCLEAR SOCIETY (ANS)
ANS 3.1 , Selection Qualification and Training of Nuclear Power Plant Personnel.
(latest edition)

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)
ANSI/ASME NQA-1-1989
Quality Assurance Program Requirements for Nuclear Facilities.

ANSI/ASME NQA-2-1989
Quality Assurance Requirements for Nuclear Facility Applications.

SHEET METAL AND AIR-CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION, INC (SMACNA)
HVAC Systems Testing, Adjusting, and Balancing 1983.

ASSOCIATED AIR BALANCE COUNCIL (AABC)
National Standard of Total System Balance 1989.

DEPARTMENT OF ENERGY, DOE Proceedings
16th DOE Nuclear Air Cleaning Conference, page 125, "Size Distribution of Aerosols
Produced from Substitute Materials by the Laskin Cold DOP Aerosol Generator", February
1981, NTIS Springfield, VA. (W. Hinds, J. Macher, M. First).

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)
Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems
1991.

(**REFERENCES WILL BE UPDATED TO LATEST ADDITION PRIOR TO PUBLICATION**)

ARTICLE TA-3000 GENERAL INSPECTION AND TEST REQUIREMENTS

TA-3010 General

All inspections and tests shall be conducted in accordance with these requirements and the specific requirements of TA-4000.

NOTE: Activities in this section may involve the use of hazardous materials, operations and equipment. This section does not purport to address all of the safety requirements associated with their use. It is the responsibility of the user of this section to establish appropriate safety and health practices and determine the applicability of regulatory requirements prior to use.

TA-3100 TEST INSTRUMENTS

A calibration program shall be established in accordance with the Owner's Quality Assurance Program. All permanent and temporary test instruments used in the conduct of tests required by TA-4000 shall be in calibration. Instrument accuracy shall meet or exceed the requirements of Table TA-3000-1.

TABLE TA-3000-1
INSTRUMENT ACCURACY REQUIREMENTS

MEASUREMENT	RANGE	ACCURACY
Pressure	>1.0 psig (>7.0 kPa(gage))	+/- 2.0 %
Pressure	from 1.0 in wg to 1.0 psig (0.25 to 7.0 kPa(gage))	+/- 0.1 in wg (+/-0.025 kPa)
Pressure	from 0.1 in wg to 1.0 in wg (2.5 to 250 Pa(gage))	+/- 0.01 in wg (+/-2.5 Pa)
Temperature	variable	+/- 2.0 °F (+/- 1.0 °C)
Temperature*	variable	+/- 0.5 °F (+/- 0.25 °C)
Vibration	variable	Per TA-3141
Flow	variable	+/- 5.0 %
Velocity (airflow)	variable	+/- 3.0 %
Speed	variable	+/- 2.0 %
Time	variable	+/- 1.0 sec
Electrical voltage	variable	+/- 1.0 %
Electrical resistance	variable	+/- 1.0 %
Challenge aerosol concentration		Per TA-3142
Challenge gas concentration		Per TA-3143

* Required for pressure testing in mandatory Appendix TA-III.

TA-3110 Range Requirements

The full scale range of instruments shall be limited as necessary to ensure that

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

the readings are within the accuracy requirements of Table TA-3000-1.

TA-3120 Instrument Fluctuation

Symmetrical damping devices or averaging techniques may be used to reduce random signal fluctuations. Hydraulic instruments may be damped by using gauge snubbers or by throttling valves in instrument lines.

TA-3130 Evaluation Following Test Instrument Loss, Damage or Calibration Failure

When a test instrument is lost, damaged, or otherwise fails to meet the requirements of Table TA-3000-1 during calibration, all test results obtained using the instrument shall be evaluated, dating back to the time of the previous calibration. If the evaluation does not confirm that the instrument met the acceptance criteria for the test(s) in question, the test(s) shall be repeated with calibrated instruments.

TA-3140 Specific Instrument Accuracy Requirements

TA-3141 Vibration Instrument

Vibration instrument accuracy shall be at least +/- 10%. The minimum frequency response range of the vibration measuring instrument shall be approximately one third of the minimum shaft speed. For rotating components, the maximum frequency response range shall be at least two times the rotational shaft speed of the component being measured. For reciprocating components, the maximum frequency response range shall be at least two times the speed of the crankshaft, times the number of unique planes occupied by a piston throw.

TA-3142 Challenge Aerosol Measuring Instrument

The Challenge Aerosol Measuring Instrument shall be verified to have a linear range of at least 10^5 times the threshold sensitivity of the instrument with an accuracy in accordance with the Facility Project Specifications and Owner's Quality Assurance Program.

TA-3143 Challenge Gas Measuring Instrument

The Challenge Gas Measuring Instrument shall be verified to be capable of distinguishing challenge gas from background and measuring challenge gas over a linear range of at least 10^5 times the threshold sensitivity of the instrument with an accuracy in accordance with the Facility Project Specifications and Owner's Quality Assurance Program.

TA-3200 REFERENCE VALUES

TA-3210 Establishment of Reference Values

Reference values shall be determined from results achieved during acceptance testing (TA-4000), when a component or system is proven to be operating within the acceptable

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

limits of the Owner's Design Specification. Operating tests and inspections specified in TA-4000 shall be observed, measured, or calculated under conditions readily reproducible during subsequent in-service tests to allow for direct comparison of test results. All test results and associated analyses shall be included in the test procedure documentation (TA-6300).

TA-3300 INSPECTIONS AND TESTS

Acceptance tests shall be conducted following initial component installation but prior to releasing the system for normal operations. Applicable acceptance tests shall also be used to obtain new reference values and verify design function following component replacement, repair, modification, or maintenance. Equipment shall be evaluated as separate components and as functioning parts of an integrated system. The Owner shall define system test boundaries and evaluate system performance with respect to system functional requirements in accordance with the Owners Design Specifications. Field acceptance tests shall be implemented as applicable and in accordance with this section.

Test designations associated with tests required by TA-4000 are listed in Table TA-3000-2. Within the context of TA-4000, when a test is not associated with a Designator it shall be considered a prudent action and not a test requirement.

TABLE TA-3000-2
TEST DESIGNATIONS

TEST	DESIGNATOR
Air-Aerosol mixing test	AA
Airflow distribution test	AD
Differential pressure test	DP
Differential temperature test	DT
Flow rate test	Qf
Functional test*	F
Hydrostatic test	HYD
In-place leak test	IP
Laboratory analysis (adsorbent methyl-iodide penetration)	LAB
Electrical performance test	AMP
Leak test	PL
Structural capability test	PS
Rotational speed test	N
Bearing temperature test	Tb
Vibration test	Vb
Visual inspection	VT

* Functional tests consist of various mechanical actuation and performance verifications and are detailed separately in each test article.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-3310 Inspection and Test Parameters

Parameters which need to be observed, calculated and recorded in order to meet the requirements of this section shall be identified for each system based on the functional requirements of the Owner's Design Specification and shall be included in the test procedure documentation (TA-6300).

TA-3320 System Operating Conditions

Operating conditions required for acceptance testing shall be determined for each system. These conditions and acceptance criteria shall be based on the requirements of the Owner's Design Specification and shall be included in the test procedure documentation (TA-6300).

TA-3330 Procedure Requirements

The Owner shall be responsible for the development and implementation of written test procedures that meet the requirements of this section. Each equipment test section consists of generic (TA-3400) and specific (TA-4000) test requirements and acceptance criteria which apply to each of the systems in the facility. The Owner shall document which requirements are applicable in the test procedure documentation (TA-6300).

TA-3340 Test Reports

Test reports shall be prepared in accordance with TA-6300.

TA-3400 GENERIC TESTS

Generic tests as specified in TA-3410 through TA-3433 shall be used in Article TA-4000 where applicable.

TA-3410 Visual Inspection (VT)

Visual inspections shall be conducted in accordance with AA-5000 and the applicable portions of mandatory Appendix TA-I. Field acceptance visual inspections, required in TA-4000, shall include verification of component installation in accordance with the Owner's Design Specification and the applicable sections of this Code. Acceptance inspections shall be conducted prior to releasing the equipment for normal operation.

TA-3420 Pressure Boundary Tests

Pressure boundary tests consist of hydrostatic (or pneumatic) tests for hydronic systems, leak tests for refrigerant systems, and structural capability and leak tests for ducts and housings, including fan and damper housings.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-3421 Hydrostatic Tests (HYD)

Hydrostatic tests shall be conducted at the hydrostatic pressure defined by the Owner and shall verify that the component will not rupture, leak or be permanently deformed under design pressure loads. Testing shall be conducted in accordance with the design codes used in the Owner's Design Specification (e.g. ANSI/ASME B31.1). Pneumatic testing may be used in lieu of water where allowed by the applicable codes and in the Owner's Design Specification.

TA-3422 Structural Capability Test (PS)

Structural capability tests shall be conducted at the structural capability pressure defined by the Owner's Design Specification and shall verify that the component will not rupture or be permanently deformed under design pressure loads. Testing shall be conducted in accordance with mandatory Appendix TA-II.

TA-3423 Leak Test, Duct, Housing, and Frames (PL)

Leak tests for duct and housing sections shall be conducted using either the pressure decay method or the constant pressure method to verify that the leak rate for duct or housing does not exceed the allowable limit established for the system. Testing shall be conducted in accordance with mandatory Appendix TA-III. Leak testing performed to satisfy Section SA of this Code may be used to meet these test requirements when the test method is compatible with mandatory Appendix TA-III.

An optional leak test for HEPA filter and adsorber mounting frames is authorized to be conducted in conjunction with the housing leak test by blanking off the frame openings and pressurizing the isolated test boundary. This procedure is useful for detecting small leaks in the mounting frame during acceptance testing. This test is used to verify that there are no defects in a frame that may cause failure of the in-place leak test. Testing should be conducted in accordance with non-mandatory Appendix TA-A.

TA-3424 Leak Test, Refrigerant Piping and Coils (PL)

Leak tests of refrigerant piping and coils shall be conducted in accordance with mandatory Appendix TA-VIII.

TA-3430 Functional Tests (F)

A functional test shall be used to verify mechanical and system performance parameters of equipment. Functional tests include component and system tests as required in Article TA-4000. Component functional tests are used to verify the operational readiness of individual components. Integrated system functional tests are used to verify that all of the system components will operate together under normal operating or simulated conditions and will meet all of the performance requirements of the Owner's Design Specification.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-3431 Test Conditions

Equipment shall be tested within the normal operating range specified in the Owner's Design Specification except as otherwise specified in TA-4000.

TA-3432 Restoration of Function Following Testing

Mechanical and electrical equipment status shall be restored as required by plant conditions and according to approved procedures following completion of any test.

TA-3433 Vibration Test (Vb)

Vibration measurements shall be taken on the accessible motor, fan, compressor and pump bearing housings in at least two different orthogonal planes approximately perpendicular to the line of the rotating shaft. When the bearing housing is not accessible, the frame of the component may be used if it will be representative of bearing housing vibration. When portable vibration instruments are used, reference points shall be clearly identified on the component being measured to permit duplication in both location and plane.

TA-3500 ACCEPTANCE CRITERIA

Results of tests described in Article TA-4000 shall be subject to the acceptance criteria in TA-3510 through TA-3530 and to the applicable operating and design criteria specified by the Owner's Design Specification. Test results are considered acceptable if the component or system is not impaired or degraded to the point that it cannot perform its intended function. Acceptance criteria are specified in TA-4000 only when they affect the quality of other tests. When test results do not meet the applicable acceptance criteria, the corrective actions required by TA-5000 shall be initiated.

TA-3510 Visual Inspection

Visual inspections are acceptable when there are no visual indications of improper installation, physical damage, structural distress or degradation that would impair the ability of a component or system to perform its intended function.

TA-3520 Pressure Boundary Tests

Pressure boundary tests are acceptable when there is no permanent structural deformation or leaks in excess of the limits specified in the applicable sections of this Code and the Owner's Design Specification.

TA-3530 Functional Tests

Functional tests are acceptable when they meet the requirements of the applicable sections of this Code and the Owner's Design Specification.

ARTICLE TA-4000 FIELD ACCEPTANCE TESTS

TA-4010 General

Field acceptance tests shall be conducted following initial system installation but prior to releasing the equipment for normal operation. Applicable inspections and tests shall be conducted to verify compliance with the Owner's Design Specifications following equipment replacement, repair, modification, maintenance, or abnormal incident. Within the context of Article TA-4000, a test not associated with a test designator is considered to be a prudent action and not a test requirement.

TA-4100 FAN ACCEPTANCE TESTS

This section provides the field acceptance test requirements for fans, motors, and related accessories. Integrated system testing shall be conducted in accordance with TA-4900.

TA-4101 Acceptance Test Requirements

Acceptance tests shall be conducted with the fan operating at a flow rate within the normal operating range for the system. The tests listed in Table TA-4000-1 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Section BA of this code, and as required in TA-3500 and TA-4150. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison during periodic in-service tests.

**TABLE TA-4000-1
FAN ACCEPTANCE TESTS**

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Structural capability test	PS	*	
Leak tests	PL	*	
System flow balance test	F	*	
Mechanical run test	F		*
Flow rate test	Qf	*	
Differential Pressure test	DP	*	
Electrical test	AMP	*	
Rotational speed test	N	*	
Vibration test	Vb	*	
Bearing temperature test	Tb	*	
Fan performance test	F	*	

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4110 Visual Inspection (VT)

A visual inspection of the fan and associated components shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1100).

TA-4120 Pressure Boundary Tests

TA-4121 Structural Capability Test (PS)

When a fan housing is part of the system pressure boundary, a structural capability test shall be conducted to verify structural capability of the fan housing and connections in accordance with TA-3422 and mandatory Appendix TA-II. The fan housing may be tested concurrent with the duct and housing structural capability test specified in TA-4321.

TA-4122 Leak Test, Fan Housing (PL)

When a fan housing is part of the system pressure boundary, a pressure boundary leak test shall be conducted to verify the leak tightness of the fan housing and attached interfaces in accordance with TA-3423 and mandatory Appendix TA-III. The fan housing may be tested concurrent with the duct and housing leak test specified in TA-4322.

TA-4123 Leak Test, Fan Shaft Seal (PL)

When a fan shaft seal is part of the system pressure boundary, a pressure boundary leak test shall be conducted to verify the leak tightness of the shaft seal in accordance with TA-3423 and mandatory Appendix TA-III. The shaft seal may be tested concurrent with the duct and housing leak test specified in TA-4322. However, the shaft seal leakage rate shall be evaluated (qualitatively) independent of the overall system leak rate. The qualitative evaluation of the leakage shall be included in the test report.

TA-4130 Component Functional Tests

The following prerequisites shall be conducted on the fan and motor assemblies prior to the system functional tests specified in TA-4140.

TA-4131 Electrical Prerequisites

Prior to the initial energizing of the fan, the electrical power circuits shall be checked for installation, circuit continuity, voltage capacity and protective relay device settings.

TA-4132 Control System Prerequisites

Prior to the initial energizing of the fan, controls shall be calibrated and verified operational.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4133 Startup Prerequisites

Prior to the initial energizing of the fan, the fan and motor shaft shall be manually rotated to verify moving parts are free of interference. The motor shall be momentarily energized to verify correct rotational direction. The fan shall be restarted and stable operation (no surging) verified. Fan and motor vibration, bearing temperature, motor electrical amperage and phase balance, fan speed, differential pressure, and airflow shall be monitored. Following one hour of operation, or immediately after observation of unusual performance (i.e. unstable performance), the fan shall be secured and a detailed visual inspection for signs of damage or degradation shall be conducted.

TA-4140 System Functional Tests

This section provides the system level field acceptance test requirements for fan systems.

TA-4141 System Flow Balance Test (F)

A system flow balance shall be conducted. Recommended procedures include SMACNA, NEBB, ACGIH, OR AABC (reference TA-2000).

System flow balancing may be conducted using artificial resistance in lieu of filters. However, final component reference values shall be obtained with clean system components installed.

TA-4142 through TA-4149 shall be conducted in the same time frame.

TA-4142 Mechanical Run Test (F)

Prior to conducting the tests specified in TA-4143 through TA-4149, the fan shall be operated at the design flow rate for at least 15 minutes and stable system operation (no surging) verified.

TA-4143 Flow Rate Test (Qf)

The fan flow rate shall be measured. Recommended procedures include ACGIH "Industrial Ventilation" or equivalent.

TA-4144 Static Pressure Test (DP)

The fan inlet and outlet static pressure and velocity pressure shall be measured and the overall fan static pressure determined.

TA-4145 Electrical Tests (AMP)

The fan motor supply voltage and amperage shall be measured for each phase.

TA-4146 Rotational Speed Test (N)

The rotational speed of the fan shall be measured.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4147 Vibration Test (Vb)

The vibration of each fan and motor bearing shall be measured in accordance with TA-3433.

TA-4148 Bearing Temperature Test (Tb)

Following bearing temperature stabilization, the fan and motor bearing temperatures shall be measured. Stabilization occurs when temperature changes are less than or equal to ± 3 °F (1.5 °C) in a 10 minute period.

TA-4149 Fan Performance Test (F)

For systems with filter or adsorber banks, the fan performance shall be measured under maximum design dirty filter conditions. This may be done by increasing the system resistance to the design dirty filter differential pressure, (design basis maximum dirty filter condition), using artificial resistance. The measurement procedures in TA-4142 through TA-4148 shall be used.

TA-4150 Acceptance Criteria

The following acceptance criteria are in addition to the requirements of TA-3500.

TA-4151 Airflow Capacity Test Acceptance Criteria

Airflow capacity shall be within $\pm 10\%$ of design when tested in the normal clean and maximum dirty filter conditions.

TA-4152 Fan Performance Acceptance Criteria

Fan performance (flow, static pressure, horsepower) shall meet the specifications of the manufacturer's fan performance curve and the Owner's Design Specification.

TA-4200 DAMPER ACCEPTANCE TESTS

This section provides the field acceptance test requirements for dampers and related accessories. Integrated system testing shall be conducted in accordance with TA-4900.

TA-4201 Acceptance Test Requirements

Acceptance tests shall be conducted with the dampers installed in the system. The tests listed in Table TA-4000-2 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Section DA of this code, and as required in TA-3500. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4210 Visual Inspection (VT)

A visual inspection of the damper and associated components shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1200).

**TABLE TA-4000-2
DAMPER ACCEPTANCE TESTS**

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Structural capability tests	PS	*	
Leak tests	PL	*	
Position indication test	F	*	
Exercise test	F		*
Static timing test	F	*	
Flow Control test	F		*
Fire Damper test	F		*
Dynamic time test	F	*	
Interlock Test	F		*

TA-4220 Pressure Boundary Tests.

TA-4221 Structural Capability Test, Damper Housing (PS)

When the damper housing and actuator shaft seal are part of the system pressure boundary, a structural capability test shall be conducted to verify the structural capability of the damper housing, shaft seal, and interfaces in accordance with TA-3422 and mandatory Appendix TA-II. The damper housing may be tested concurrent with the duct and housing structural capability test specified in TA-4321.

TA-4222 Structural Capability Test, Damper Blades (PS)

Isolation dampers shall be tested to verify the structural capability of the damper blade and seat in accordance with TA-3422 and mandatory Appendix TA-II. The damper blades and seat may be tested concurrent with the duct and housing structural capability test specified in TA-4321.

TA-4223 Leak Test, Damper Housing (PL)

When a damper housing is part of the system pressure boundary, a pressure boundary leak test shall be conducted to verify leak tightness of the damper housing and interfaces in accordance with TA-3423 and mandatory Appendix TA-III. The damper housing may be tested concurrent with the duct and housing leak test specified in TA-4322.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4224 Leak Test, Damper Shaft Seal (PL)

When a damper shaft seal is part of the system pressure boundary, a pressure boundary leak test shall be conducted to verify leak tightness of the shaft seal in accordance with TA-3423 and mandatory Appendix TA-III. The shaft seal may be tested concurrent with the duct and housing leak test specified in TA-4322. However, the shaft seal leak rate shall be evaluated (qualitative) independently of the overall system leak rate. The qualitative evaluation of the leakage shall be included in the test report.

TA-4225 Leak Test, Damper Seat (PL)

When dampers have seat leakage limits, a leak test shall be conducted in the direction the damper is expected to function, in accordance with TA-3423 and mandatory Appendix TA-III. The seat leak rate shall be tested by blanking off or otherwise isolating a duct section upstream of the damper. The leak test shall be performed with the damper cycled closed using its normal closing mechanism (without any additional manual assistance).

TA-4230 Component Functional Tests

Component functional tests shall verify that the damper is operational prior to conducting the system functional tests specified in TA-4240.

TA-4231 Electrical Prerequisites

Prior to the initial energizing of the damper operator, the electrical circuits shall be checked for proper installation, circuit continuity, voltage capacity and protective relay device settings.

TA-4232 Pneumatic Prerequisites

Prior to the initial pressurizing of the damper control system, pneumatic systems shall be checked for proper installation and leak tightness.

TA-4233 Control System Prerequisites

Prior to the initial energizing of the damper operator, control instrumentation shall be calibrated and verified to be operational.

TA-4234 Position Indication Test (F)

Dampers having remote position indicators shall be observed during operation to verify that the mechanical damper position corresponds to the remote indication.

TA-4235 Exercise Test (F)

Power operated dampers shall be fully cycled using a control switch or other actuating device to verify operation. Manual dampers, including balancing dampers, shall

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

be fully cycled to verify operation. Fire Dampers shall be tested in accordance with TA-4242.

TA-4236 Static Timing Test (F)

Power operated dampers (electrical or pneumatic), that are required to operate within a specified time limit, shall be tested by measuring time for the damper to fully open or fully close (as required by the Owner's Design Specification).

TA-4240 System Functional Tests

TA-4241 Flow Control Damper Functional Test (F)

Power operated dampers that control air flow shall be observed under throttled (throughout its anticipated operating range) flow conditions to verify free movement and stable operation.

TA-4242 Fire Damper Test (F)

Fire dampers shall be tested, using a normal or simulated actuation signal, to verify activation under design airflow conditions.

TA-4243 Dynamic Timing Test (F)

Isolation dampers having a required actuation response time shall be timed to the fully open or fully closed position (as required by the Owners Design Specification) under design airflow conditions.

TA-4244 Interlock Test (F)

Dampers that have an opening or closing function interlocked with other components (e.g. fans, other dampers) shall be tested to verify interlock action.

TA-4300 DUCT, HOUSING, AND MOUNTING FRAME ACCEPTANCE TESTS

This section provides the field acceptance test requirements for ducts, housings and mounting frames.

TA-4301 Acceptance Test Requirements

Acceptance tests shall be conducted with the ducts, housings and mounting frames installed in the system. The tests listed in Table TA-4000-3 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Section SA of this Code, and as required in TA-3500. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4310 Visual Inspection (VT)

A visual inspection of ducts, housings, and mounting frames, shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1300).

TABLE TA-4000-3
DUCT, HOUSING AND FRAME ACCEPTANCE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Structural capability test	PS	*	
Leak tests	PL	*	

TA-4320 Pressure Boundary Tests

Pressure boundary tests apply to all ducts, housings and interface connections that are parts of the system. Individual components may be tested at separate times provided that all system pressure boundaries are ultimately tested prior to the system being placed into service.

TA-4321 Structural Capability Test, Duct and Housing (PS)

A structural capability test shall be conducted to verify structural capability of ducts and housings in accordance with TA-3422 and mandatory Appendix TA-II.

TA-4322 Leak Test, Duct and Housing (PL)

A pressure boundary leak test shall be conducted to verify leak tightness of the ducts and housings in accordance with TA-3423 and mandatory Appendix TA-III.

TA-4323 Leak Test, Mounting Frame (optional) (PL)

A mounting frame pressure leak test may be used to detect leaks in the HEPA filter and adsorber mounting frames that could affect the results of the in-place leak tests in TA-4600 and TA-4700. This test is optional and may be conducted in accordance with non-mandatory Appendix TA-A.

TA-4400 REFRIGERATION EQUIPMENT ACCEPTANCE TESTS

This section provides the field acceptance test requirements for refrigeration equipment. Integrated system testing shall be conducted in accordance with TA-4900.

TA-4401 Acceptance Test Requirements

Acceptance tests shall be conducted with the refrigeration equipment in service

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

under normal operating conditions. The tests listed in Table TA-4000-4 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, applicable portions of Section RA of this Code, and as required in TA-3500. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

TA-4410 Visual Inspection (VT)

A visual inspection of the refrigeration equipment components shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1400).

TA-4420 Pressure Boundary Tests

TA-4421 Leak Test, Refrigerant Piping and Coil (PL)

Refrigeration systems, including piping, coils, and pressure vessels, shall have a pressure test conducted to verify structural integrity and leak tightness. Testing shall be conducted in accordance with TA-3424 and mandatory Appendix TA-VIII.

TABLE TA-4000-4
REFRIGERATION EQUIPMENT ACCEPTANCE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Leak test	PL		*
Hydrostatic test	HYD		*
Valve position indication test	F		*
Valve exercise test	F		*
Valve timing test	F	*	
Flow Control valve test	F		*
Mechanical run test	F		*
Performance test	F	*	
Electrical test	AMP	*	
Rotational speed test	N	*	
Vibration test	Vb	*	
Bearing temperature test	Tb	*	

TA-4422 Hydrostatic Test, Hydronic Piping and Coils (HYD)

Hydronic piping, coils and pressure vessels, shall have a hydrostatic test conducted to verify structural integrity and leak tightness. Testing shall be conducted in accordance with TA-3421.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4430 Component Functional Tests

The following component functional tests and prerequisites shall be conducted to verify that the refrigeration system equipment is operating acceptably prior to conducting the system functional tests specified in TA-4440. Fans shall be tested in accordance with TA-4100.

TA-4431 Electrical Prerequisites

Prior to the initial energizing of the refrigeration system components, the electrical circuits shall be checked for installation, circuit continuity, voltage capacity, and protective relay device settings.

TA-4432 Control System Prerequisites

Prior to the initial energizing of the refrigeration system components, the system controls shall be calibrated and verified operational.

TA-4433 Valve Position Indication Test (F)

Valves having remote position indicators shall be observed during valve full stroke operation to verify that the valve position corresponds to the remote indication.

TA-4434 Valve Exercise Test (F)

Power operated valves shall be fully cycled using a control switch or other actuating device to verify operation. Manual valves shall be fully cycled to verify operation.

TA-4435 Valve Timing Test (F)

Power operated valves that are required to operate within a specified time limit shall be tested by measuring the time to fully cycle.

TA-4436 Startup Prerequisites

The compressor motor shall be momentarily energized and correct direction of rotation verified. restart the compressor motor, verify stable operation and monitor the compressor motor electrical supply voltage, amperage and phase balance, vibration, bearing temperatures, and rotational speed, as applicable. Following one hour of operation, or immediately after observation of unusual performance (unstable operation), the equipment shall be secured and a detailed visual inspection conducted for signs of damage or degradation.

TA-4440 System Functional Tests

The refrigeration equipment shall be tested to verify mechanical component integrity and design cooling function. TA-4441 through TA-4447 shall be conducted in the same time frame.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4441 Flow Control Valve Test (F)

Power operated valves, controlled by flow instrumentation, shall be observed under throttled (throughout its anticipated operating range) flow conditions to verify freedom of movement, stable operation, and ability to maintain required flow.

TA-4442 Mechanical Run Test (F)

The refrigeration compressor shall be operated with the system in the normal heat load range for at least 15 minutes and stable system operation verified.

TA-4443 Performance Test (F)

The refrigeration compressor inlet and outlet pressure and temperature shall be measured with the equipment operating at achievable load points.

TA-4444 Electrical Test (AMP)

The compressor motor electrical supply voltage and amperage shall be measured for each phase.

TA-4445 Rotational Speed Test (N)

The rotational speed of the compressor shall be measured when accessible.

TA-4446 Vibration Test (Vb)

The vibration of each accessible bearing on the compressor and compressor motor shall be measured in accordance with TA-3433.

TA-4447 Bearing Temperature Test (Tb)

Following compressor and compressor motor bearing temperature stabilization, the accessible bearing temperatures shall be measured. Stabilization occurs when temperature changes are less than or equal to ± 3 °F (1.5 °C) in a 10 minute period.

TA-4500 CONDITIONING EQUIPMENT ACCEPTANCE TESTS

This section provides the field acceptance test requirements for forced circulation air cooling and heating coils, air washers, evaporative coolers, and electric heating coils. Integrated system testing shall be conducted in accordance with TA-4900.

TA-4501 Acceptance Test Requirements

Acceptance tests shall be conducted with the conditioning equipment in service under normal operating conditions for the system. The tests listed in Table TA-4000-5 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Section CA of this Code, and as required in TA-3500 and TA-4560. These test results shall be documented

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

TABLE TA-4000-5
CONDITIONING EQUIPMENT ACCEPTANCE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Hydrostatic test	HYD		*
Electric heater step controller test	F		*
Electric heater coil resistance test	F	*	
Electric heater resistance to ground test	F	*	
Valve performance tests	F	*	*
Performance test	F	*	
Electrical test	AMP	*	
Rotational speed test	N	*	
Vibration test	Vb	*	
Bearing temperature test	Tb	*	
Electric heater performance test	F	*	
Hydronic system flow balance	F	*	
Hydronic system heater and coil performance test	F	*	
Air washer, evaporative cooler performance test	F	*	

TA-4510 Visual Inspection (VT)

A visual inspection of the conditioning equipment components shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1500).

TA-4520 Pressure Boundary Tests

TA-4521 Hydrostatic Test, Hydronic Piping and Coils (HYD)

Hydronic piping, coils and pressure vessels shall have a hydrostatic test conducted to verify structural integrity and leak tightness. Testing shall be conducted in accordance with TA-3421.

TA-4530 Component Functional Tests

The following component functional prerequisites and tests shall be conducted to verify that the conditioning system equipment is operating acceptably prior to conducting the system functional tests specified in TA-4540. Fans shall be tested

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

in accordance with TA-4100. Refrigeration components shall be tested in accordance with TA-4400.

TA-4531 Electrical Prerequisites

Prior to the initial energizing of the conditioning system equipment, the electric circuits shall be checked for proper installation, circuit continuity, voltage capacity, and protective relay device settings.

TA-4532 Control System Prerequisites

Prior to the initial energizing of the conditioning system components, the controls shall be calibrated and verified operational.

TA-4533 Electric Heater Step Controller Test (F)

Electric heater step controllers shall be tested by initiating a simulated demand signal to verify the heater circuit step controller is operational.

TA-4534 Electric Heater Coil Resistance Test (F)

The electrical resistance shall be measured across each heater circuit in accordance with CA-5440.

TA-4535 Electric Heater Resistance To Ground Test (F)

The electrical resistance to ground shall be measured on each heater circuit.

TA-4536 Valve Performance Tests (F)

Conditioning system valves shall be tested in accordance with TA-4433, TA-4434, and TA-4435.

TA-4537 Startup Prerequisites

Prior to starting the conditioning system pumps, the pump shaft shall be manually rotated to verify freedom of movement. The motor shall be momentarily energized and the correct direction of rotation verified. restart the pump motor and verify stable operation and monitor the pump motor electrical supply voltage, amperage and phase balance, bearing vibration, bearing temperatures, rotational speed, pump differential pressure, and fluid system flow rate, as applicable. Following one hour of operation, or immediately after observation of unusual performance (unstable operation), the pump shall be secured and a detailed visual inspection for signs of damage or degradation conducted.

TA-4540 System Functional Tests

The conditioning equipment shall be tested in conjunction with the system to verify mechanical component integrity and design cooling or heating function. TA-4541

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

through TA-4546 shall be conducted in the same time frame.

TA-4541 Hydronic System Flow Balance Test (F)

A hydronic system flow balance shall be conducted. Recommended procedures include SMACNA, NEBB, or AABC (reference TA-2000).

TA-4542 Flow Control Valve Test (F)

Power operated valves, controlled by flow control instrumentation, shall be observed under throttled (throughout its anticipated operating range) flow conditions to verify freedom of movement, stable operation, and the ability to maintain required flow.

TA-4543 Mechanical Run Test (F)

The conditioning system pumps shall be operated with the system operating in the normal operating range for at least 15 minutes and stable system operation (no surging) verified.

TA-4544 Performance Test (F)

The conditioning system pump differential pressure and flow rate shall be measured with the pump operating at achievable flow rates.

TA-4545 Electrical Tests (AMP)

The conditioning system pump supply voltage and amperage shall be measured for each phase.

TA-4546 Rotational Speed Test (N)

The rotational speed of the pump shaft shall be measured.

TA-4547 Vibration Test (Vb)

The vibration of each bearing on the pump and motor shall be measured in accordance with TA-3433.

TA-4548 Bearing Temperature Test (Tb)

Following pump and motor bearing temperature stabilization, the bearing temperature shall be measured. Stabilization occurs when temperature changes are less than or equal to +/- 3 °F (1.5 °C) in a 10 minute period.

TA-4549 Electric Heater Performance Test (F)

With design airflow (+/- 10%) through the heater bank, the electrical supply voltage, amperage, and phase balance of each heater circuit, and differential temperature

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

and air flow across the heater bank shall be measured. Following one hour of continuous operation, the heater shall be secured and a detailed visual inspection shall be conducted for signs of damage or degradation.

TA-4550 Hydronic System Heating and Cooling Performance Test (F)

With the conditioning system operating at design airflow (+/- 10%) and design hydronic flow (+/- 10%) and at achievable heat load conditions, the air-side flow, differential temperature and differential pressure, and the hydronic side flow, differential temperature and differential pressure shall be measured.

TA-4551 Air Washer, Evaporative Cooler Performance Test (F)

A performance test for the conditioning system air washers and evaporative coolers shall be conducted in accordance with CA-5000, Appendix CA-II.

TA-4560 Acceptance Criteria

The following acceptance criteria are in addition to TA-3500.

TA-4561 Electrical Heater Ground Resistance Acceptance Criteria

Conditioning system electric heater resistance to ground shall be greater than 50,000 Ohms.

TA-4600 MOISTURE SEPARATOR, PRE-FILTER, HEPA FILTER BANK ACCEPTANCE TESTS

This section provides the field acceptance test requirements for installed moisture separator, pre-filter and HEPA filter banks.

TA-4601 Acceptance Test Requirements

Acceptance tests shall be conducted with clean moisture separator, pre-filter and HEPA filter banks installed in the system. The tests in Table TA-4000-6 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Sections FA, FB and FC of this Code and as required in TA-3500 and TA-4630. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TABLE TA-4000-6
MOISTURE SEPARATOR, PREFILTER AND HEPA FILTER
ACCEPTANCE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Differential pressure test	DP	*	
Airflow distribution test	AD	*	
Air-aerosol mixing test	AA	*	
In-place leak test [Ⓒ]	IP	*	

[Ⓒ] In-place leak tests are not required on systems used for 100% recirculation (e.g. Reactor containment cleanup units) unless the atmospheric cleanup rate is time dependent.

TA-4610 Visual Inspection (VT)

A visual inspection of the installed moisture separator, prefilter and HEPA filter banks shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1600).

TA-4620 System Functional Tests

TA-4621 Differential Pressure Test (DP)

With the system operating at design flow rate (+/- 10%), the differential pressure across each moisture separator, pre-filter, and HEPA filter bank shall be measured.

TA-4622 Airflow Distribution Test (AD)

With the system operating at design flow rate (+/- 10%), the airflow distribution shall be measured downstream of each moisture separator, prefilter, and HEPA filter bank in accordance with mandatory Appendix TA-IV.

TA-4623 Air-Aerosol Mixing Test (AA)

With the system operating at design flow rate (+/- 10%), the air-aerosol mixing upstream of each HEPA filter bank shall be measured in accordance with mandatory Appendix TA-V.

TA-4624 In-Place Leak Test (IP)

With the system operating at design flow rate (+/- 10%), the challenge aerosol leak rate of each HEPA filter bank shall be measured in accordance with mandatory Appendix TA-VI.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4630 Acceptance Criteria

The following acceptance criteria are in addition to the requirements of TA-3500.

TA-4631 Airflow Distribution Test Acceptance Criteria

With the system operating within +/-10% of design flow rate, the variation in velocity measurements across the HEPA filter banks shall be limited to +/-20% of the average, when measured in accordance with mandatory Appendix TA-IV. Airflow distribution across the moisture separator and prefilter banks shall be in accordance with the Owner's Design Specification.

TA-4632 Air-Aerosol Mixing Test Acceptance Criteria

With the system operating within +/-10% of design flow rate, the variation in concentration of the air-aerosol mixture immediately upstream of the HEPA filter bank shall be limited to +/-20% of the average when measured in accordance with mandatory Appendix TA-V.

TA-4700 TYPE II and TYPE III ADSORBER BANK ACCEPTANCE TESTS

This section provides the field acceptance test requirements for installed type II and III adsorber banks.

TA-4701 Acceptance Test Requirements

Acceptance tests shall be conducted with the adsorbent media installed and in service under normal operating conditions for the system. The tests listed in Table TA-4000-7 shall be conducted and test results verified to be within the acceptance limits of the Owner's Design Specification, the applicable portions of Sections FD and FE of this code, and as required in TA-3500 and TA-4730. These test results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

TABLE TA-4000-7
TYPE II AND TYPE III ADSORBER BANK ACCEPTANCE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE
Visual inspection	VT		*
Differential pressure test	DP	*	
Airflow distribution test	AD	*	
Air-aerosol mixing test	AA	*	
In-place leak test @	IP	*	
Test canister flow rate test	Qf	*	
Air heater performance test	F	*	

@ In-place leak tests are not required on systems used for 100% recirculation (e.g. Reactor containment cleanup units) unless the atmospheric cleanup rate is time dependent.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4710 Visual Inspection (VT)

A visual inspection of the type II and type III adsorber banks shall be conducted in accordance with TA-3410 and mandatory Appendix TA-I (I-1700).

TA-4720 Component Functional Tests

TA-4721 Electric Heater Step Controller Test (F)

Electric heater step controllers shall be tested by initiating a simulated demand signal to verify the heater circuit step controller is operational.

TA-4722 Electric Heater Coil Resistance Test (F)

The electrical resistance shall be measured across each heater circuit in accordance with CA-5440.

TA-4723 Electric Heater Resistance To Ground Test (F)

The electrical resistance to ground shall be measured on each heater circuit.

TA-4730 System Functional Tests

TA-4731 Differential Pressure Test (DP)

With the system operating at design flow rate (+/- 10%), the differential pressure across each adsorber bank shall be measured.

TA-4732 Airflow Distribution Test (AD)

With the system operating at design flow rate (+/- 10%), the airflow distribution across each adsorber bank shall be measured in accordance with mandatory Appendix TA-IV.

TA-4733 Air-Aerosol Mixing Test (AA)

With the system operating at design flow rate (+/- 10%), the air-aerosol mixing immediately upstream of each adsorber bank shall be measured in accordance with mandatory Appendix TA-V. This test is not required when it can be determined that the air-aerosol test conducted on a HEPA bank immediately upstream of the adsorber bank also provides equivalent challenge to the adsorber bank.

TA-4734 In-Place Leak Test (IP)

With the system operating at design flow rate (+/- 10%), the challenge gas leak rate of each adsorber bank shall be measured in accordance with mandatory Appendix TA-VII.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4735 Test Canister Flow Rate Test (Qf)

When the system is equipped with test canisters used for obtaining adsorbent samples for laboratory analysis, the velocity through each test canister shall be measured (or calculated from flow measurements) with the system operating at design airflow rate. Alternatively, when access is limited and measurements cannot be performed, the design documentation shall be verified to assure that the installed canisters meet the performance requirements, (differential pressure / flow rate), of canisters used during shop testing of the test canister sampling system.

TA-4736 Electric Heater Performance Test (F)

With design airflow (+/- 10%) through the heater bank, the electrical supply voltage, amperage, and phase balance of each heater circuit, and differential temperature and air flow across the heater bank shall be measured. Following one hour of continuous operation, the heater shall be secured and a detailed visual inspection shall be conducted for signs of damage or degradation.

TA-4740 Acceptance Criteria

The following acceptance criteria are in addition to the requirements of TA-3500.

TA-4741 Airflow Distribution Test Acceptance Criteria

With the system operating within +/- 10% of design flow rate, the variation in velocity measurements across the face of the adsorber banks shall be limited to +/-20% of the average, when measured in accordance with mandatory Appendix TA-IV.

TA-4742 Air-Aerosol Mixing Test Acceptance Criteria

With the system operating within +/-10% of design flow rate, the variation in the challenge gas or aerosol concentration readings immediately upstream of each adsorber bank shall be limited to +/-20% of the average when measured in accordance with mandatory Appendix TA-V.

TA-4743 Test Canister Flow Rate Test Acceptance Criteria

The test canister velocity shall be within +/- 10% of the average adsorber design velocity as specified by the Owner's Design Specification.

TA-4800 ADSORBENT ACCEPTANCE TESTS

This section provides the Laboratory acceptance test requirements for radioactive iodine penetration of the adsorbent used in adsorber systems.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4801 Acceptance Test Requirements

A laboratory acceptance test shall be conducted using representative samples of adsorbent from the adsorber system. This test measures the radioiodine penetration of the adsorbent. Laboratory test results shall be evaluated to the acceptance limits of the Owner's Design Specification. Sample locations shall be documented to ensure they are not reused in periodic in-service testing. Test Results shall be documented in accordance with TA-6300 and shall be retained as reference values for comparison to periodic in-service test results.

TA-4810 Laboratory Analysis of Adsorbent (LAB)

New adsorbent installed in the adsorber banks shall be certified in accordance with the manufacturers test data for radioiodine penetration (ref. FF-5000). Adsorbent stored more than 50 percent of manufacturer's assigned shelf life shall have a laboratory test conducted in accordance with ASTM D-3803-89 prior to installation. The test bed depth, air temperature, humidity, and flow rate, used in the laboratory test, shall be the same as adsorber bank conditions required by the Owner's Design Specification. Adsorbent installed in the adsorber bank shall be sampled and tested in accordance with the procedures in ASTM D-3803-89 prior to system operation.

TA-4900 INTEGRATED SYSTEM TESTS

Each system shall be tested to verify the functional performance at achievable design operating conditions. Integrated system tests shall be conducted to challenge all integrated control functions including interlocks and manual or automatic actuation circuits, (damper position changes, fan starts and stops, compressor and pump starts or stops, valve position changes, heater energization or de-energization). Actuators can be from a number of different sources including radiation sensors, temperature sensors, chlorine sensors, pressure sensors, manual controls and emergency safeguard signals. Sensor operation shall be verified in addition to control circuitry. Integrated testing shall also include an overall system leak test to verify that there are no unacceptable bypasses of the HEPA filter or adsorber banks. Integrated system testing shall verify that the intended design function of the system is achieved in accordance with the Owner's Design Specification. Test results shall be documented in accordance with TA-6300.

TA-4910 Fan Integrated System Test Requirements (F)

Fans designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of starts, stops and speed changes shall be conducted utilizing an actual or simulated actuation signal.

TA-4920 Damper Integrated System Test Requirements (F)

Dampers designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of damper position changes shall be conducted utilizing an actual or simulated actuation signal.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TA-4930 Refrigeration and Conditioning Integrated System Test Requirements (F)

Refrigeration and Conditioning equipment designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of equipment operation (starts, stops, speed changes, valve operations or isolation, heater operation) shall be conducted utilizing an actual or simulated actuation signal.

TA-4940 HEPA and Adsorber Bank Integrated System Test Requirements (F)

All potential HEPA filter and adsorber bank bypass flow paths shall be challenged to verify that leak rates are within the Owner's Design Specification. Bypass flow paths may be challenged during the in-place leak test specified in TA-4624 and TA-4734, by ensuring that the challenge aerosol or gas injection and sample ports encompass all potential bypass flow paths (reference mandatory appendix TA-V, step V-1100). If a potential bypass flow path within the system is not challenged during these in-place tests, a separate test shall be performed using mandatory appendix TA-VI or TA-VII to verify that the HEPA or adsorber banks are not being bypassed in excess of the limits specified in the Owner's Design Specification.

ARTICLE TA-5000 CORRECTIVE ACTION REQUIREMENTS

Corrective action is required when test results do not meet the acceptance criteria specified in the applicable section or in the Owner's Design Specifications. For equipment that is replaced, modified, repaired, or has undergone maintenance, such that reference values may change, a new set of reference values shall be obtained in accordance with the requirements of Article TA-3200. Additional guidance for corrective actions is included in non-mandatory Appendix TA-B.

ARTICLE TA-6000 QUALITY ASSURANCE

TA-6100 General

Field testing of nuclear air treatment, heating, ventilating, and air conditioning systems shall be conducted in accordance with the quality assurance requirements of Article AA-8000, ANSI/ASME NQA-1, and ANSI/ASME NQA-2.

TA-6200 Personnel

Tests shall be conducted by personnel who have demonstrated competence to perform the specific tests, as evidenced by documented experience and training. Personnel shall be certified in accordance with ANSI/ASME NQA-1 or ANS 3.1, and in accordance with the Owner's Requirements.

TA-6300 Documentation

TA-6310 Procedures

Written acceptance test procedures shall document the field acceptance testing performed and test results obtained as specified in Article TA-4000. These records shall be maintained for the life of the facility.

TA-6320 Reports

A written report shall be provided to document the acceptance testing performed in accordance with Article TA-4000. The report shall contain the following as a minimum:

- (a) The system name, test/inspection procedure(s) used, date of test results and the test performer's signature;
- (b) Identification of instruments, equipment, tools and documents to the extent that they or their equivalents can be identified for future examinations;
- (c) Observations and dimensional checks specified by the respective test data and reports developed during inspection and testing;
- (d) Conclusions and recommendations by visual examination and testing personnel;
- (e) Reference to previous reports if this report is for reinspection and testing.

**APPENDIX TA-I
MANDATORY
VISUAL INSPECTION CHECKLIST**

I-1000 General

A specific inspection checklist for each component in the system shall be included in the acceptance test procedures. This Appendix lists typical items for each component that need to be inspected visually in Article TA-4000 (Acceptance tests). As a minimum, the lists of items indicated below shall be checked for compliance with the Owner's Specifications. The inspection shall be conducted in accordance with TA-3410. The acceptance criteria for these inspections shall be in accordance with TA-3500 and TA-3510.

I-1100 Fan Inspection Checklist

- a. Housing and duct interface
- b. Fan belt and shaft guards
- c. Interferences with moving parts
- d. Fan shaft seal
- e. Belt adjustment and condition
- f. Lubricant levels
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections
- m. As built configuration in accordance with design drawings
- n. Fan nameplate
- o. Access for tests and maintenance

I-1200 Damper Inspection Checklist

- a. Housing and duct interface
- b. Actuator linkage, motor, controller
- c. Interferences with moving parts
- d. Damper shaft seal
- e. Blade edge seals, damper seat
- f. Limit switches
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Pneumatic connections
- l. As built configuration in accordance with design drawings
- m. Damper nameplate
- n. Access for tests and maintenance

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

I-1300 Duct, Housing and Mounting Frame Inspection Checklist

- a. Housing and duct connections (no caulking)
- b. Provision for opening access doors from both inside and outside
- c. Access door seals, gaskets
- d. Access door latches
- e. Housing internal access ladders and platforms
- f. Sample and injection ports, location and caps
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation, connections
- j. Electrical connections
- k. Housing/duct penetration seals
- l. Loop seals (water level), drain connections
- m. Lighting conduits, socket housing seals (flush mounted)
- n. HEPA/adsorber mounting frame continuous seal welds
- o. Mounting frame penetrations seal welded
- p. Mounting frame seating surface (weld splatter, flatness, scratches)
- q. Sample canister installation
- r. Mounting frame clamping devices
- s. As built configuration in accordance with design drawings
- t. Access for tests and maintenance
- u. Lighting for test and maintenance available

I-1400 Refrigeration Equipment Inspection Checklist

- a. Housing or duct interface with refrigeration equipment
- b. Fan, pump, compressor belt and coupling guards
- c. Interferences with moving parts
- d. Belt adjustment and condition
- e. Fluid leaks
- f. Lubricant levels
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections and tubing (No crimping)
- m. As built configuration in accordance with design drawings
- n. Fan, pump, compressor nameplate
- o. Access for tests and maintenance

I-1500 Conditioning Equipment Inspection Checklist

- a. Housing or duct interface with conditioning equipment
- b. Belt and coupling guards
- c. Interferences with moving parts
- d. Belt tightness
- e. Fluid leaks
- f. Lubricant levels
- g. Supports and attachments

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections and tubing (No crimping)
- m. Drains and spray nozzles not plugged
- n. As built configuration in accordance with design drawings
- o. Fan, pump, compressor nameplate
- p. Access for tests and maintenance

I-1600 Moisture Separator Bank, Prefilter Bank, HEPA Filter Bank Inspection Checklist

- a. Moisture separator media, frame, clamps and gaskets
- b. Moisture separator water collection system and drains
- c. Prefilter media, frame, clamps and gaskets
- d. HEPA filter media, frame, clamps and gaskets
- e. Sealant or caulking (none allowed)
- f. Moisture separator, prefilter, HEPA orientation (vertical)
- g. Bolting and fasteners.
- h. As built configuration in accordance with design drawings
- i. HEPA filter nameplate
- j. Access for tests and maintenance

I-1700 Type II, Type III Adsorber Bank Inspection Checklist

- a. Type II media, frame, screen, clamps and gaskets
- b. Sealant or caulking (none allowed)
- c. Type III media, screens, frame
- d. Test canisters
- e. Bulk loading equipment
- f. Fire protection system piping, nozzles, instrumentation
- g. Bolting and fasteners
- h. As built configuration in accordance with design drawings
- i. Adsorber nameplate
- j. Access for tests and maintenance

**APPENDIX TA-II
MANDATORY
STRUCTURAL CAPABILITY TEST PROCEDURE**

II-1000 General

This procedure is used to test the structural capability of ducts and housings.

II-1100 Summary of Method

Ducts, and housings which form the pressure boundary of the system shall be pressure tested, with air, to the structural capability pressure to verify that there is no breach of integrity or unacceptable distortion. Fans, dampers and other components which form parts of the pressure boundary shall be installed and tested with the ducts and housings to verify the interface connection integrity.

NOTE: This test procedure is written as if the operating pressure were positive, but it would be identical for negative pressure systems with appropriate signs used in data collection and calculations.

II-2000 Prerequisites

Construction, modifications or repairs affecting the test boundary shall be complete and inlet and discharge openings of the duct or housing sealed before the test is started. Electrical, piping, and instrument connections shall be complete and all permanent seals installed before the test is started.

II-3000 Test Equipment

- a. Pressurization source
- b. Covers to seal test boundaries.
- c. Pressure indicating device accurate to +/- 0.1 in.w.g. (0.025 kPa(gage)).

II-4000 Procedure

- a. Connect the pressurization source to the duct or housing.
- b. Install instrumentation to indicate the pressure inside the duct or housing being tested.
- c. Start the pressurization source and operate until the structural capability pressure is achieved. Maintain pressure for the duration of the inspection.
- d. Inspect the test boundary for breach of integrity or distortion.
- e. Release pressure and inspect for permanent distortion.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

II-5000 Acceptance Criteria

All distortion shall be measured and compared to the acceptance limits of the Owner's Design Specification.

**APPENDIX TA-III
MANDATORY
DUCT AND HOUSING LEAK TEST PROCEDURE**

III-1000 General

This procedure is used to test the leak tightness of the ducts and housings including installed fan housings, damper housings and fan and damper shaft seals.

III-1100 Summary of Method

Ducts and housings that form the pressure boundary of the system shall be leak tested, with air, using one of the methods listed in this procedure. Either method may be used and will produce a similar test result. The constant pressure method is useful for testing small volumes and is conducted at the maximum operating pressure for the system. The pressure decay method is useful in testing large volumes and is conducted by pressurizing to 1.25 times the maximum operating pressure, then allowing the pressure to decay for a fixed period of time, or until the pressure decreases to 80% of the maximum operating pressure, whichever occurs first. Fans, dampers, and other components that are part of the pressure boundary shall be installed and tested with the pressure boundary to verify interface connection leak tightness. If the measured leak rate is in excess of the acceptance criteria, the leaks shall be located by one of the methods listed in this procedure. After leaks are repaired, the duct and housing shall be re-tested to verify leak tightness.

NOTE: This test procedure is written as if the operating pressure were positive, but it would be identical for negative pressure systems with appropriate change in signs used in the data collection and calculations.

III-2000 Prerequisites

Construction, modifications and repairs affecting the test boundary shall be complete and the inlet and discharge openings of the duct or housing sealed before the test is started. All electrical, piping, and instrument connections shall be complete and all permanent seals shall be installed before the test is started. For pressure decay testing, the volume of the pressure test boundary must be calculated.

III-3000 Test Equipment

- a. Pressurization source
- b. Covers to seal test boundaries.
- c. Clock or timer accurate to +/- 1.0 second.
- d. Pressure indicating device accurate to +/- 0.1 in.w.g. (0.025 kPa(gage)).
- e. Flowmeter or Totalizing Gas Volume meter accurate to +/-5% (constant pressure method).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- f. Temperature indicating device accurate to ± 0.5 °F (0.25°C).
- g. Bubble solution for detecting air leaks (bubble method).
- h. Optional portable electronic sound detection equipment (audible leak method).
- i. Barometer

III-4000 Procedure

III-4100 Constant Pressure Test

- a. Connect the pressurization source to the duct or housing.
- b. Connect the flowmeter or totalizing gas volume meter between the pressurization source and the housing (downstream of the throttling valve, if used).
- c. Install temperature and pressure indicating devices so that they will indicate representative temperature and pressure inside the duct or housing being tested.
- d. Seal test boundaries and close access doors in the normal manner. Do not use temporary sealants, duct tape, or similar temporary materials except for sealing the temporary blank-off panels.
- e. Start the pressurization source and operate it until the maximum operating pressure is achieved. Maintain pressure constant with the flow control device until temperature remains constant within ± 0.5 °F (0.25 °C) for a minimum of 10 minutes. Record the initial stabilized pressure, temperature, and barometric pressure.
- f. Measure the flow rate of the air being added to or removed from the duct or housing while maintaining the maximum operating pressure within ± 0.1 in. w. g. (0.025 kPa(gage)). When using the flow meter, record flow readings once a minute for a 5 minute continuous period and average the readings to calculate the measured leak rate. When using a totalizing gas volume meter, measure the total volume of air for a 10 minute continuous period and divide the measured volume by time (10 minutes) to calculate the measured leak rate. Record final pressure, temperature and barometric pressure.
- g. Convert the final calculated leak rate to standard cubic feet per minute (cubic meters per second) in accordance with the method illustrated in "Industrial Ventilation" (ref. TA-2000).

III-4200 Pressure Decay Test

- a. Connect the pressurization source (with a leak tight shutoff

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

valve) to the duct or housing.

- b. Install the temperature and pressure indicating devices where they will indicate representative temperature and pressure inside the duct or housing being tested.
- c. Seal test boundaries and close access doors in the normal manner. Do not use temporary sealants, duct tape, or similar temporary materials except for sealing the temporary blank-off panels.
- d. Start the pressurization source and operate until the pressure is 1.25 times the maximum operating pressure (but not to exceed the structural capability pressure). Maintain this pressure constant with a flow control device until temperature remains constant within +/- 0.5 °F (0.25 °C) for a minimum of 10 minutes. Close shutoff valve.

NOTE(1): If the structural capability pressure for the duct or housing is less than 1.25 times the maximum operating pressure, the final test pressure shall be calculated as follows to achieve an average test pressure equal to the maximum operating pressure:

$$P_f = 0.8(OP_{max}) + (1.25(OP_{max}) - SCP)$$

where: P_f = final test pressure
 OP_{max} = maximum operating pressure
 SCP = structural capability pressure

- e. Record the initial time, pressure, temperature, and barometric pressure.
- f. Record pressure readings once a minute until pressure decays to 80% of the maximum operating pressure, or for a minimum of 15 minutes (see NOTE(1) in step d above).
- h. Record final time, pressure, temperature, and barometric pressure.
- i. Calculate leak rate from the following equation in English Units:

$$Q_{ave} = \left(\frac{P_i}{T_i} - \frac{P_f}{T_f} \right) * \frac{V}{R * \Delta t * 0.075}$$

Metric Units:

$$Q_{ave} = (1.39 * 10^{-5}) * \left(\frac{P_i}{T_i} - \frac{P_f}{T_f} \right) * \frac{V}{R * \Delta t}$$

where:

Q_{ave} = Average leak rate, scfm (sm^3/s). (air density 0.075 lb/ft³)

V = Volume within test boundary, ft³ (m^3).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

P_i = Initial pressure within test boundary, lb/ft² ABS (Pa(absolute)).
 P_f = Final pressure within test boundary, lb/ft² ABS (Pa(absolute)).

T_i = Absolute Temperature at start of test, °R (°K).

T_f = Absolute Temperature at end of test, °R (°K).

Δt = $t_i - t_f$ Time difference (minutes).

t_i = Time at start of test (minutes).

t_f = Time at end of test (minutes).

R = Gas Constant for Air; $53.35 \frac{\text{ft-lb}}{\text{lb-}^\circ\text{R}}$, $(0.286 \frac{\text{kJ}}{\text{kg-}^\circ\text{K}})$

III-4300 Acceptance Criteria

If the calculated leak rate exceeds the Owner's acceptance criteria, locate leaks in accordance with one of the techniques outlined in III-4400 or III-4500.

III-4400 Bubble Leak Location Method

- a. Pressurize the test boundary to the maximum operating pressure for the system.
- b. With the test boundary under continuous pressure, apply bubble solution to areas to be tested. Identify places where bubbles are found and perform corrective actions.
- c. Following corrective actions, retest in accordance with III-4100 or III-4200.

III-4500 Audible Leak Location Method

- a. Pressurize the test boundary to the maximum operating pressure for the system.
- b. With the test boundary continuously pressurized, locate audible leaks (electronic sound detection equipment optional) and perform corrective actions.
- c. Following corrective action, retest in accordance with III-4100 or III-4200.

**APPENDIX TA-IV
MANDATORY
AIRFLOW DISTRIBUTION TEST PROCEDURE**

IV-1000 General

This procedure is used to measure the air flow distribution across the face of moisture separator, prefilter, HEPA filter, and adsorber banks. Uniform air velocity distribution ensures maximum air treatment efficiency and uniform loading of air treatment components.

IV-1100 Summary of Method

The system is operated at design flow rate. Airflow velocity readings are measured downstream of each moisture separator, prefilter, and HEPA filter in the bank. For adsorbers, readings shall be taken in line with the flow slots. Each reading is compared to the average for the bank.

IV-2000 Prerequisites

System operating within +/- 10% design flow rate.

IV-3000 Test Equipment

Rotating vane, heated wire or heated thermocouple anemometer, pitot tube, or other suitable air velocity measuring device as appropriate for the anticipated velocities.

IV-4000 Procedure

- a. For each moisture separator, prefilter, and HEPA filter, measure the air velocity at the approximate centers of equal areas with at least one measurement per each moisture separator, prefilter and HEPA filter, and a minimum of 9 measurements per bank. Adsorber velocity measurements shall be made in the approximate center of the flow slots. For flow slots greater than 24 inches long (60 cm), measurements shall be nominally every 12 inches (30 cm) along the length of the slot.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- b. Calculate the average velocity (V_{ave}) using the following formula:

$$V_{ave} = \frac{\sum_1^n V_i}{n}$$

where:

\sum_1^n = sum of readings from 1 to n

V_i = individual velocity readings

n = number of readings

- c. Identify the highest and lowest velocity readings and calculate the percentage they vary from the average calculated above.

**APPENDIX TA-V
MANDATORY
AIR-AEROSOL MIXING TEST PROCEDURE**

V-1000 General

This procedure is used to ensure that the challenge aerosol or gas injection ports, used for the in-place leak tests of mandatory Appendix TA-VI and TA-VII, provide a uniform challenge across the entire face of the HEPA filter or adsorber banks. Uniform air-aerosol mixing ensures that all areas of the bank are challenged during these in-place tests. Once an injection port is qualified by this procedure, it shall be used in all subsequent in-place leak tests as outlined in the acceptance tests of TA-4600 and TA-4700.

V-1100 System Test

Injection and sample port location shall be located so that the entire system is challenged for inadvertent bypass flow paths around the HEPA filter or adsorber banks. If this cannot be accomplished, an integrated system test shall be included in addition to the bank tests outlined in appendix TA-VI, TA-VII and TA-4940.

V-1200 Summary of Method

The system is operated at design flow rate. Challenge aerosol or gas is injected through an injection port upstream of the bank. Challenge aerosol or gas concentration readings are obtained at equal cross-sectional areas in front of the HEPA filter or adsorber bank. Each reading is then compared to the average for the bank. DOP aerosol is the preferred challenge agent for this test. However, use of a challenge gas may be useful in some cases.

V-1300 Injection Port Selection Criteria

Injection ports should be located upstream of a flow disturbance to maximize mixing. The challenge gas will pass through the HEPA bank and challenge the adsorber bank. For systems with two or more HEPA filter banks in series, or two or more adsorber banks in series, separate injection ports must be qualified for each bank. Use of injection manifolds may be necessary when there is insufficient room between banks to provide adequate mixing.

V-2000 Prerequisites

The system is operating within +/- 10% of design flow rate. The airflow distribution has been verified in accordance with Appendix TA-IV.

V-3000 Test Equipment

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- a. Challenge aerosol or gas generator.
- b. Challenge aerosol or gas measuring instrument.

V-4000

Procedure

- a. Connect challenge aerosol or gas generator to the injection port to be tested.
- b. Place the challenge aerosol or gas measuring instrument sample probe upstream of the bank to be tested with adequate hose length to reach all areas of the bank.
- c. Start the challenge aerosol or gas injection and establish a constant injection rate.
- d. Take a concentration reading upstream of and at the approximate centers of equal areas, with at least one reading per HEPA filter and a minimum of 9 readings per HEPA bank. For type II and type III adsorbers, readings shall be taken upstream of and in the approximate center of each flow slot. For flow slots greater than 24 inches (60 cm) in length, a reading shall be taken nominally every 12 inches (30 cm) along the length of the slot.
- e. Calculate the average concentration (C_{ave}) readings using the following formula;

$$C_{ave} = \frac{\sum_1^n C_i}{n}$$

where:

\sum_1^n = sum of readings from 1 to n

C_i = individual readings.
n = number of readings.

- f. Identify the highest and lowest concentration readings and calculate the percentage it varies from the average above.

**APPENDIX TA-VI
MANDATORY
HEPA FILTER BANK IN-PLACE LEAK TEST PROCEDURE**

VI-1000 General

This procedure is used to leak test HEPA banks.

VI-1100 Summary of Method

The system is operated at design flow rate. Challenge aerosol is injected upstream of each bank through injection ports qualified in Appendix TA-V. The concentration of the challenge aerosol is measured upstream and downstream of the HEPA bank. The ratio of the downstream and upstream concentrations represents the HEPA filter bank leak rate.

VI-2000 Prerequisites

Airflow distribution shall be verified in accordance with Appendix TA-IV. The injection port shall be qualified to provide uniform air-aerosol mixing in accordance with Appendix TA-V.

VI-3000 Test Equipment

- a. Challenge aerosol generator.
- b. Challenge aerosol measuring instrument.
- c. Flow measuring device.

VI-4000 Procedure

- a. Connect challenge aerosol generator to the qualified injection port.
- b. Place the challenge aerosol measuring instrument sample probes upstream and downstream of the bank to be tested. The sample tubing shall be of equal bore and approximately equal lengths and as short as possible to minimize the measuring instrument response time. The upstream sample probe shall be located in approximately the center of the bank. The downstream sample probe shall be located in a downstream sample manifold or downstream of a mixing source such as a turbulent fan discharge.
- c. Start the system and verify stable flow rate within +/-10% of design flow rate.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- d. Measure the upstream and downstream aerosol background concentration. The pre-injection background levels shall be stable to ensure correct instrument response and shall not interfere with the detector's ability to detect leaks in excess of the maximum allowed by the acceptance criteria.
- e. Start the challenge aerosol injection.
- f. Record the upstream and downstream concentrations. Repeat until at least three of the readings are stable.
- g. Stop the injection.
- h. Using the final set of readings meeting the stability and tolerance criteria, calculate the bank leak rate using the formula below:

$$L = (100) \frac{C_d}{C_u}$$

L = % Leak

C_d = Downstream concentration

C_u = Upstream concentration

**APPENDIX TA-VII
MANDATORY
ADSORBER BANK IN-PLACE LEAK TEST PROCEDURE**

VII-1000 General

This procedure is used to leak test adsorber banks.

VII-1100 Summary of Method

The system is operated at design flow rate. Challenge gas is injected upstream of each bank through the injection port qualified in Appendix TA-V. The concentration of challenge gas is measured upstream and downstream of the bank. The ratio of the downstream and upstream concentrations represents the bank leak rate.

VII-2000 Prerequisites

Airflow distribution shall be verified in accordance with Appendix TA-IV. The injection port shall be qualified to provide uniform air-aerosol mixing in accordance with Appendix TA-V.

VII-3000 Test Equipment

- a. Challenge gas generator.
- b. Challenge gas measuring instrument.
- c. Flow measuring device.

VII-4000 Procedure

- a. Connect challenge gas generator to the qualified injection port.
- b. Place the challenge gas measuring instrument sample probes upstream and downstream of the bank to be tested. The sample tubing shall be of equal bore and approximately equal lengths and as short as possible to minimize the measuring instrument response time. The upstream sample probe shall be located in approximately the center of the bank. The downstream sample probe shall be located in a downstream sample manifold or downstream of a mixing source such as a turbulent fan discharge.
- c. Start the system and verify stable flow rate and within +/-10% of design flow rate.
- d. Measure the upstream and downstream challenge gas background concentration. The pre-injection background levels shall be stable to ensure correct instrument response and shall not interfere with the detector's ability to detect challenge gas leaks less than the maximum allowed by the acceptance criteria.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- e. Start the challenge gas injection.
- f. Record the upstream and downstream concentrations, as rapidly as instrument response time allows, until sufficient data have been recorded to allow calculation of adsorber bank leak rate. Care must be taken to obtain sufficient readings quickly after injection.
- g. Terminate challenge gas injection.
- h. Using the upstream and downstream concentration data, calculate the adsorber bank leak rate using the formula below.

$$L = (100) \frac{C_d}{C_u}$$

L = % Leak

C_d = Downstream concentration

C_u = Upstream concentration

**APPENDIX TA-VIII
MANDATORY
REFRIGERANT PIPING AND COIL SYSTEM LEAK TEST
PROCEDURE**

VIII-1000 General

This procedure is used to test the leak tightness of refrigerant system piping and coils. The system will be pressurized with a test mixture to identify any leaks. After all identified leaks are repaired a vacuum will be drawn on the system to prove that there are no remaining leaks and to remove any contaminants from the system.

VIII-1100 Summary of Method

The pressure method consists of admitting a test gas, which is usually a mixture of refrigerant and inert gas, into the pressure vessel, coils and piping system and checking for leaks. The vacuum method consists of drawing a vacuum in the closed system and watching for a rise in pressure on a pressure indicator.

VIII-2000 Prerequisites

- a. All flare, flange, solder, braze, weld or thread fittings mechanically tight.
- b. All seals, packing glands and service valve packing nuts mechanically tight.
- c. All service, purge and charging valves closed to the atmosphere.
- d. Wire brush and wipe flux and oxides from all heated joints.

VIII-3000 Test Equipment

- a. Refrigerant gas.
- b. Inert gas (Nitrogen or carbon dioxide).
- c. Pressure indicating device.
- d. Pressure regulating device with relief valve.
- e. Electronic refrigerant leak detector.
- f. Leak detection bubble solution.
- g. Vacuum Pump.
- h. Vacuum indicating device (thermocouple vacuum indicator or other

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

suitable vacuum indicating device).

VIII-4000 Procedure

VIII-4100 Leak Test Procedure

- a. Open all interconnecting manual system valves, solenoid and expansion valves to ensure access to the complete system volume.
CAUTION: Do not exceed the safe test pressure limits established by the unit manufacturer.

NOTE: It is advantageous and less costly to use an inert gas (Nitrogen or carbon dioxide), to back up the refrigerant vapor pressure. Only about 5 to 10% of the total mixture need be refrigerant vapor for this method to work.

- b. Pressurize the entire system to the manufacturers recommended test pressure with the test mixture.

NOTE: Allow time for the refrigerant and inert gas to mix before checking for leaks.

- c. Leak test the entire system, including factory joints, seals, and insulated lines with an electronic leak detector. Usually a one inch (2.5 cm) per second movement of the detector probe is sufficient to pick up leaks. Soap solution may also be used to locate leaks.

- d. Mark or identify any leaks located.

CAUTION: Use appropriate reclaim equipment to prevent release of refrigerant gas to the atmosphere.

- e. Leak testing is complete when all leaks have been repaired and the system has been re-pressurized and retested to verify that there are no leaks.

VIII-4200 Evacuation and Dehydration Procedure

Evacuate and dehydrate after leak testing per step VIII-4100. Proper evacuation and dehydration prove system tightness, expel non-condensables, and assure a dry system before charging with refrigerant.

VIII-4210 Deep Vacuum Method

- a. Vent all system pressure.

CAUTION: Use appropriate reclaim equipment to prevent release of refrigerant gas to the atmosphere.

- b. Connect a temporary connection between the system high and low pressure sides. Connect the vacuum pump, vacuum indicator, and refrigerant cylinder to the system.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- c. Open the vacuum pump suction and start the evacuation.
- d. When the system reaches less than 500 micrometers (Hg) absolute, it is isolated from the vacuum pump.
- e. When the system holds 500 micrometer (Hg) absolute for at least 15 minutes, with the vacuum source isolated, the system is free of moisture and leaks and the vacuum should be released by charging with refrigerant.

**APPENDIX TA-A
NON-MANDATORY
MOUNTING FRAME PRESSURE LEAK TEST PROCEDURE**

A-1000 General

This optional test is used to identify leaks through seal welds of the HEPA filter or adsorber mounting frames. The presence of these leaks may be evident when conducting the in-place leak tests on the HEPA filter and adsorber banks. A good visual verification per Appendix TA-I, steps I-1600 and I-1700, is usually adequate. This procedure is provided for use when the frame leaks need to be located.

A-1100 Summary of Method

Temporary blanks, with gaskets, are installed in place of the HEPA filters or adsorbers on the mounting frame in the system. The pressure boundary is then secured by blanking off upstream of the mounting frame in the housing or associated ducts. This modified pressure boundary is then pressurized using the techniques outlined in Appendix TA-III and any leaks in the mounting frame welded interface is detected using the techniques in Appendix TA-III, steps III-4400 or III-4500.

A-2000 Prerequisites

Construction, modifications, and repairs affecting the test boundary shall be completed and temporary blanks (with gaskets) installed on the gasket side of the mounting frame. The opening of the duct or housing upstream of the mounting frame shall be blanked off to form a modified pressure boundary.

A-3000 Test Equipment

- a. Pressurization source.
- b. Covers to seal test boundaries.
- c. Pressure indicating device accurate to +/- 0.1 in. w.g. (0.025 kPa(gage)).

A-4000 Procedure

- a. Connect the pressurization source to the duct or housing pressure boundary.
- b. Install pressure indicating device so that it will indicate the pressure inside the duct or housing being tested.
- c. Close access doors.
- d. Start the fan and operate until the pressure is greater than

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

or equal to the maximum operating differential pressure for the filter bank (not to exceed the structural capability pressure for the duct and housing assembly). Maintain pressure for the duration of the inspection.

- e. Inspect the mounting frame welds and attachments for leaks using the methods outlined in Appendix TA-III, steps III-4400 or III-4500.

**APPENDIX TA-B
NON-MANDATORY
CORRECTIVE ACTION GUIDANCE**

Corrective action may consist of replacement, repair, modification, maintenance, or analysis to demonstrate that the equipment will fulfill its design function. A revised set of reference values, as described in TA-3200, should be established after the corrective action has been taken.

Results of a failed test should not be resolved simply by a successful repetition of the test. A successful repetition of the test should be preceded by corrective action.

If the cause of the test failure cannot be determined by inspection or analysis, corrective action may consist of re-calibration of test instruments and subsequent re-testing. If it is determined that the test failure is due to an equipment malfunction, instead of difficulties with the test equipment, or test procedure, the equipment should be declared unavailable for service until the specific cause has been determined and the condition corrected.

APPENDIX TA-C
NON-MANDATORY
CHALLENGE GAS SUBSTITUTE SELECTION CRITERIA

Alternative test agents (challenge gas) may be used to perform In-Place Leak Testing of Adsorbers, as required in Mandatory Appendix TA-VII, when their selection is based on meeting the following characteristics:

1. The test agent gives the same In-Place Leak Test results as one of the following: R-11, R-12, R-112 or R-112a.
2. The test agent has similar retention times on activated carbons, at the same concentration levels, as one of the following: R-11, R-12, R-112 or R-112a.
3. The test agent has similar lower detection limit sensitivity and precision in the concentration range of use as one of the following: R-11, R-12, R-112 or R-112a.
4. The test agent exhibits chemical and radiological stability under the test conditions.
5. The test agent causes no degradation of the carbon and its impregnant(s) or of the other Nuclear Air Treatment System components under the test conditions.
6. The test agent is listed in the Environmental Protection Agency "Toxic Substance Control Act" (TSCA) inventory for commercial use.

ASME N511-19XX

Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilating and Air Conditioning Systems

For ASME AG-1 Systems

**ASME Committee on Nuclear Air and Gas Treatment
(CONAGT)**

Note: This is a draft document. An approved standard may differ in many respects. This draft version is made available for discussion for discussion purposes only.

**Draft Revision
07/09/96**

DRAFT
PERIODIC IN-SERVICE TESTING OF
NUCLEAR AIR TREATMENT, HEATING,
VENTILATING, AND
AIR CONDITIONING SYSTEMS

1 SCOPE

 1.1 Purpose.....

 1.2 Applicability.....

 1.3 Use of this Standard.....

 1.4 Definitions and Terms.....

2 REFERENCE DOCUMENTS.....

3 GENERAL INSPECTION AND TEST REQUIREMENTS.....

 3.1 Test Instruments.....

 3.1.1 Range Requirements.....

 3.1.2 Instrument Fluctuation

 3.1.3 Evaluation Following Test Instrument Loss,
 Damage or Calibration Failure.....

 3.1.4 Specific Instrument Accuracy Requirements.....

 3.1.4.1 Vibration Instrument.....

 3.1.4.2 Challenge Aerosol Measuring Instrument.....

 3.1.4.3 Challenge Gas Measuring Instrument.....

4 REFERENCE VALUES.....

 4.1 Establishment of Reference Values.....

 4.2 Re-establishment of Reference Values Following
 Component Replacement, Repair, Modification or
 Maintenance.....

5 INSPECTION AND TEST REQUIREMENTS.....

 5.1 Inspection and Test Parameters.....

 5.2 System Operating Conditions.....

 5.3 Procedure Requirements.....

 5.4 In-Service Tests.....

6 GENERIC TESTS.....

 6.1 Visual Inspections (VT).....

 6.2 Pressure Boundary Tests.....

 6.2.1 Leak Test, Duct, Housing, and Frames (PL).....

 6.3 Vibration Test (Vb).....

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

7	ACCEPTANCE CRITERIA.....	13
7.1	Visual Inspection.....	14
7.2	Pressure Boundary Tests.....	14
7.3	Functional Tests.....	14
8	IN-SERVICE TEST REQUIREMENTS.....	14
8.1	GENERAL.....	14
8.2	FAN IN-SERVICE TESTS.....	14
8.2.1	In-Service Test Requirements.....	14
8.2.2	Visual Inspection (VT).....	15
8.2.3	Pressure Boundary Test.....	15
8.2.3.1	Leak Test (PL).....	15
8.2.4	System Functional Tests.....	15
8.2.4.1	Mechanical Run Test (F).....	15
8.2.4.2	Flow Rate Test (Qf).....	15
8.2.4.3	Static Pressure Test (DP).....	16
8.2.4.4	Rotational Speed Test (N).....	16
8.2.4.5	Vibration Test (Vb).....	16
8.3	DAMPER IN-SERVICE TESTS.....	16
8.3.1	In-Service Test Requirements.....	16
8.3.2	Visual Inspection (VT).....	16
8.3.3	Pressure Boundary Test.....	16
8.3.3.1	Leak Test Damper Seat (PL).....	16
8.3.4	Component Functional Tests.....	17
8.3.4.1	Position Indication Test (F).....	17
8.3.4.2	Exercise Test (F).....	17
8.3.4.3	Static Timing Test (F).....	17
8.3.5	System Functional Tests.....	17
8.3.5.1	Flow Control Test (F).....	17
8.3.5.2	Fire Damper Test (F).....	17
8.3.5.3	Dynamic Timing Test (F).....	18
8.3.5.4	Interlock Test (F).....	18
8.4	DUCT AND HOUSING IN-SERVICE TESTS.....	18
8.4.1	In-Service Test Requirements.....	18
8.4.2	Visual Inspection (VT).....	18
8.4.3	Pressure Boundary Test.....	18
8.4.3.1	Leak Test (PL).....	18
8.5	REFRIGERATION EQUIPMENT IN-SERVICE TESTS.....	19
8.5.1	In-Service Test Requirements.....	19
8.5.2	Visual Inspection (VT).....	19
8.5.3	Pressure Boundary Tests.....	19
8.5.3.1	Leak Test, Refrigerant Piping and Coil (PL).....	19

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.5.3.2	Leak Test, Hydronic Piping and Coils (PL)
8.5.4	Component Functional Tests
8.5.4.1	Valve Position Indication Test (F)
8.5.4.2	Valve Exercise Test (F)
8.5.4.3	Valve Timing Test (F)
8.5.5	System Functional Tests
8.5.5.1	Flow Control Valve Test (F)
8.5.5.2	Mechanical Run Test (F)
8.5.5.3	Performance Test (F)
8.5.5.4	Vibration Test (Vb)
8.5.5.5	Rotational Speed Test (N)
8.6	CONDITIONING EQUIPMENT IN-SERVICE TESTS
8.6.1	In-Service Test Requirements
8.6.2	Visual Inspection (VI)
8.6.3	Pressure Boundary Test
8.6.3.1	Leak Test, Hydronic Piping and Coils (PL)
8.6.4	Component Functional Test
8.6.4.1	Valve Performance Tests (F)
8.6.5	System Functional Tests
8.6.5.1	Hydronic System Flow Balance Verification (Qf)
8.6.5.2	Flow Control Valve Test (F)
8.6.5.3	Mechanical Run Test (F)
8.6.5.4	Performance Test (F)
8.6.5.5	Rotational Speed Test (N)
8.6.5.6	Vibration Test (Vb)
8.6.5.7	Electric Heater Test (AMP)
8.6.5.8	Hydronic Heating and Cooling Performance Test (F)
8.7	MOISTURE SEPARATOR, PREFILTER, HEPA FILTER BANK IN-SERVICE TESTS
8.7.1	In-Service Test Requirements
8.7.2	Visual Inspection (VI)
8.7.3	System Functional Tests
8.7.3.1	Differential Pressure Test (DP)
8.7.3.2	In-Place Leak Test (IP)
8.8	TYPE II and TYPE III ADSORBER BANK IN-SERVICE TESTS
8.8.1	In-Service Test Requirements
8.8.2	Visual Inspection (VI)
8.8.3	System Functional Tests
8.8.3.1	Differential Pressure Test (DP)
8.8.3.2	In-Place Leak Test (IP)
8.8.3.3	Electric Heater Performance Test (F)
8.9	ADSORBENT IN-SERVICE TESTS
8.9.1	In-Service Test Requirements
8.9.2	Laboratory Analysis (LAB)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.10	INTEGRATED SYSTEM TESTS.....
8.10.1	Fan Integrated System Test Requirements (F).....
8.10.2	Air System Flow Balance Verification (Qf).....
8.10.3	Damper Integrated System Test Requirements (F).....
8.10.4	Refrigeration and Conditioning Integrated System Test Requirement (F).....
8.10.5	HEPA Filter and Adsorber Bank Integrated System Test Requirement (F).....
9	TESTING FOLLOWING AN ABNORMAL INCIDENT.....
10	CORRECTIVE ACTION REQUIREMENTS.....
11	QUALITY ASSURANCE.....
11.1	General.....
11.2	Personnel.....
11.3	Documentation.....

TABLES

3-1	Instrument Accuracy Requirements.....
3-2	Test Designations.....
3-3	In-Service Test Intervals.....
8-1	Fan In-Service Tests.....
8-2	Damper In-Service Tests.....
8-3	Duct and Housing In-Service Tests.....
8-4	Refrigeration Equipment In-Service Tests.....
8-5	Conditioning Equipment In-Service Tests.....
8-6	Moisture Separator, Prefilter, HEPA Filter Bank In-Service Tests.....
8-7	Type II, Type III Adsorber Bank In-Service Tests.....

MANDATORY APPENDICES

I	Visual Inspection Checklist.....
II	Duct and Housing Leak Test Procedure.....
III	Airflow Distribution Test Procedure.....
IV	HEPA Filter In-Place Leak Test Procedure.....
V	Adsorber Bank In-Place Leak Test Procedure.....

NON-MANDATORY APPENDICES

A	Mounting Frame Pressure Leak Test Procedure.....
B	Corrective Action Guidance.....
C	Challenge Gas Substitute Selection Criteria.....
D	Test Program Development Guidance.....

IN-SERVICE TESTING OF NUCLEAR AIR TREATMENT, HEATING, VENTILATING, AND AIR CONDITIONING SYSTEMS

1 SCOPE

This Standard covers the requirements for Periodic In-Service testing of nuclear safety-related air treatment, heating, ventilating, and air conditioning systems in nuclear facilities.

1.1 Purpose

The purpose of this Standard is to provide requirements for periodic in-service testing, the results of which are used to verify that nuclear air treatment, heating, ventilating, and air conditioning systems continue to perform their intended function. Such in-service testing is conducted for the purpose of:

- (a) Monitoring the performance of the equipment and system(s) to provide assurance that they continue to function within their specified design basis limits;
- b) Providing test results which are compared to Acceptance Test Reference Values and to previous in-service test results to establish system performance trends.

1.2 Applicability

This Standard applies to periodic in-service testing of nuclear safety-related air treatment, heating, ventilating, and air conditioning systems which have been designed, built, and acceptance tested in accordance with ASME AG-1. Sections of this Standard may be used for technical guidance for testing air treatment, heating, ventilating, and air conditioning systems designed to other standards. It is the Owner's responsibility to meet each of the applicable requirements in this Standard.

1.3 Use of This Standard

This Standard provides a basis for the development of test programs and does not include acceptance criteria, except

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

where the results of one test influence the performance of other tests. Acceptance criteria shall be developed by the Owner based on the system design and function(s) in accordance with ASME AG-1.

This Standard is arranged so that users may select those portions (tests) which are relevant to their facility. The users must specify which tests shall be employed in their test programs and the acceptance criteria for those tests. The Non-Mandatory Appendices provide additional information and guidance.

1.4 Terms and Definitions

The definitions provided in this section supplement those listed in ASME AG-1 Section AA-1000.

Abnormal Incident -- any event or condition which may adversely affect the function of the nuclear air treatment, heating, ventilating, and air conditioning system.

Acceptance Test -- a test to verify system or component design function following initial field installation, abnormal incident, replacement, repair, or modification, that may affect a test reference value.

Adsorbent -- a solid having the ability to concentrate other substances on its surface.

Adsorber -- a device or vessel containing adsorbent.

Adsorber Bank or Filter Bank -- one or more filters or adsorbers secured in a single mounting frame, or one or more side by side panels containing poured or packed air treatment media, confined within the perimeter of a duct, plenum, or vault cross section, sometimes referred to as a stage.

Aerosol -- a stable suspension of particles, solid or liquid, in air

Challenge -- to expose a filter, adsorber, or other air treatment device to an aerosol or gas of known characteristics, under specified conditions, for the purpose of testing.

Challenge Gas -- a gas of known characteristics, under specified conditions, used for the purpose of testing. For in-place testing of adsorbers, the challenge gas is Refrigerant-11, or an acceptable substitute. (Refer to Non-Mandatory Appendix C for alternate challenge gas selection criteria)

Challenge Aerosol -- poly-disperse droplets of dioctyl phthalate, (di(2-ethyl hexyl) phthalate), used as challenge aerosol for testing HEPA filter banks for leaks. The challenge aerosol used for in-place leak testing

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

of installed HEPA filter systems, in accordance with this section, shall be a poly-disperse liquid aerosol having an approximate light scattering droplet size distribution as follows:

99% less than 3.0 micrometer diameter
50% less than 0.7 micrometer diameter
10% less than 0.4 micrometer diameter

NOTE: The poly-disperse aerosol used for in-place leak testing of systems differs in size from the 0.3 micrometer mono-disperse DOP aerosol used for efficiency testing of individual HEPA filters by manufacturers. For potential substitutes for DOP, reference ASME AG-1 paragraph TA-2000. (reference DOE Nuclear Air Cleaning Conference proceedings "Size Distribution of Aerosols Produced From Substitute Materials by Laskin Cold DOP Aerosol Generator")

HEPA Filter -- (High Efficiency Particulate Air) a disposable, extended media, dry type filter enclosed in a rigid casing, that has a minimum efficiency of 99.97% when tested with an essentially mono-disperse 0.3 micrometer test aerosol.

In-Service Test -- a periodic test to verify that a system or component meets its intended design function.

Pressure, Maximum Operating -- The maximum pressure the system components will be subjected to while performing their function. The allowable pressure during abnormal operating conditions which will not physically damage the system (e.g. sudden closure of dampers or registers), shall be considered maximum operating pressure.

Pressure, Operating -- the pressure that corresponds to the normal design operating mode of the system. This pressure is less than or equal to the maximum operating pressure.

Pressure, Structural Capability -- the pressure to which the designer specifies the component or system can be safely operated, including transient conditions, without permanent distortion.

Reference Value -- one or more achieved values or test parameters that are measured, observed, or determined when the equipment or system is known to be operating acceptably within its design basis limits.

System -- An assembly of components, including associated instruments and controls, required to perform the safety-related function of a nuclear air treatment, heating, ventilating, and air conditioning system.

Test Boundary -- the physical limits of the component, system, or device being subjected to a specified test.

Test Canister -- a specially designed sample holder containing adsorbent for laboratory tests which can be removed from an adsorber bank, without disturbing the remainder of the adsorber, to provide representative

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DOE Proceedings 16th DOE Nuclear Air Cleaning Conference, page 125, "Size Distribution of Aerosols Produced from Substitute Materials by the Laskin Cold DOP Aerosol Generator", February 1981, NTIS Springfield, VA. (W. Hinds, J. Macher, M. First).

3 GENERAL INSPECTION AND TEST REQUIREMENTS

All inspections and tests shall be conducted in accordance with these requirements and the specific requirements of Sections 6 and 8.

NOTE: Activities in this Section may involve the use of hazardous materials, operations and equipment. This Section does not purport to address all of the safety requirements associated with their use. It is the responsibility of the user of this Section to establish appropriate safety and health practices and determine the applicability of regulatory requirements prior to use.

3.1 TEST INSTRUMENTS

A calibration program shall be established in accordance with the Owner's Quality Assurance Program. All permanent and temporary test instruments used in the conduct of tests required by this Standard shall be in calibration. Instrument accuracy shall meet or exceed the requirements of Table 3-1.

TABLE 3-1
INSTRUMENT ACCURACY REQUIREMENTS

MEASUREMENT	RANGE	ACCURACY
Pressure	>1.0 psig (>7.0 kPa(gage))	+/- 2.0 %
Pressure	from 1.0 in wg to 1.0 psig (0.25 to 7.0 kPa(gage))	+/- 0.1 in wg (+/-0.025 kPa)
Pressure	from 0.1 in wg to 1.0 in wg (25 to 250 Pa(gage))	+/- 0.01 in wg (+/-2.5 Pa)
Temperature	variable	+/- 2.0 °F (+/- 1.0 °C)
Temperature*	variable	+/- 0.5 °F (+/- 0.25 °C)
Vibration	variable	(per para. 3.1.4.1)
Flow	variable	+/- 5.0 %
Velocity (airflow)	variable	+/- 3.0 %
Speed	variable	+/- 2.0 %
Time	variable	+/- 1.0 sec
Electrical voltage	variable	+/- 1.0 %
Electrical resistance	variable	+/- 1.0 %
Challenge aerosol concentration		(per para. 3.1.4.2)
Challenge gas concentration		(per para. 3.1.4.3)

* Required for pressure testing in Mandatory Appendix II.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

samples for laboratory testing.

2 Reference Documents

The following documents supplement this Standard and are a part of it to the extent indicated in the text. The issue of the referenced document noted below shall be in effect. If no date is listed, then the issue of the referenced document in effect at the time shall apply.

2.1 AMERICAN CONFERENCE OF GOVERNMENT INDUSTRIAL HYGIENISTS (ACGIH)

INDUSTRIAL VENTILATION: A Manual of Recommended Practice.

2.2 AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

ASTM D 3803-1989, Standard Test Method for Nuclear Grade Activated Carbon.

2.3 AMERICAN NUCLEAR SOCIETY (ANS)

ANS 3.1 , Selection Qualification and Training of Nuclear Power Plant Personnel. (latest edition)

2.4 American Society of Mechanical Engineers (ASME)

ASME AG-1-1994, Code On Nuclear Air And Gas Treatment

ANSI/ASME NQA-1-1989, Quality Assurance Program Requirements for Nuclear Facilities.

ASME N509-1989, Nuclear Power Plant Air Cleaning Units and Components

ASME N510-1989, Testing of Nuclear Air Treatment Systems

2.5 SHEET METAL AND AIR-CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION, INC (SMACNA)

HVAC Systems Testing, Adjusting, and Balancing 1983.

2.6 ASSOCIATED AIR BALANCE COUNCIL (AABC)

National Standard of Total System Balance 1989.

2.7 NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)

Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems 1991.

2.8 DEPARTMENT OF ENERGY, (DOE)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

3.1.1 Range Requirements

The full scale range of instruments shall be limited as necessary to ensure that the readings are within the accuracy requirements of Table 3-1.

3.1.2 Instrument Fluctuation

Symmetrical damping devices or averaging techniques may be used to reduce random signal fluctuations. Hydraulic instruments may be damped by using gauge snubbers or by throttling valves in instrument lines.

3.1.3 Evaluation Following Test Instrument Loss, Damage or Calibration Failure

When a test instrument is lost, damaged, or otherwise fails to meet the requirements of Table 3-1 during calibration, all test results obtained using the instrument shall be evaluated, dating back to the time of the previous calibration. If the evaluation does not confirm that the instrument met the acceptance criteria for the test(s) in question, the test(s) shall be repeated with calibrated instruments.

3.1.4 Specific Instrument Accuracy Requirements

3.1.4.1 Vibration Instrument

Vibration instrument accuracy shall be at least +/- 10%. The minimum frequency response range of the vibration measuring instrument shall be approximately one third of the minimum shaft speed. For rotating components, the maximum frequency response range shall be at least two times the rotational shaft speed of the component being measured. For reciprocating components, the maximum frequency response range shall be at least two times the speed of the crankshaft, times the number of unique planes occupied by a piston throw.

3.1.4.2 Challenge Aerosol Measuring Instrument

The Challenge Aerosol Measuring Instrument shall be verified to have a linear range of at least 10^5 times the minimum detectible quantity of the instrument with an accuracy in accordance with the Facility Project Specifications and Owner's Quality Assurance Program.

3.1.4.3 Challenge Gas Measuring Instrument

The Challenge Gas Measuring Instrument shall be verified to be capable of distinguishing challenge gas from background and measuring challenge gas over a linear range of at least 10^5 times the minimum detectible quantity of the instrument with an accuracy in accordance with the Facility Project Specifications and Owner's Quality Assurance Program.

4 REFERENCE VALUES

4.1 Establishment of Reference Values

Reference values are determined during acceptance testing (ASME AG-1 Section TA-4000), when the equipment or system is proven to be operating within the acceptable limits of the Owner's Design Specification. Operating tests and inspections specified in ASME AG-1 Section TA-4000 are performed under conditions readily reproducible during subsequent in-service tests to allow for direct comparison of test results. All test results and associated analyses are included in the test procedure documentation.

4.2 Re-establishment of Reference Values Following Component Replacement, Repair, or Modification

Following component replacement, repair, or modification requiring disassembly, an analysis shall be conducted to determine the effect on current reference values. Whenever the analysis indicates any of the reference values have been affected, new reference values shall be established in accordance with paragraph 4.1 or the previous reference values re-verified. Analysis of the new reference values shall verify that the component conforms to acceptance criteria prior to accepting it as fully operational. The analysis to determine the effect on reference values shall be documented.

5 INSPECTIONS AND TEST REQUIREMENTS

Equipment shall be evaluated as separate components and as functioning parts of an integrated system. The Owner shall define system test boundaries and evaluate system performance with respect to system functional requirement in accordance with the Owners Design Specifications. The following categories of tests shall be implemented as applicable and in accordance with this Section.

- (a) Periodic in-service tests (Section 8).
- (b) Tests following an abnormal incident (Section 9).
- (c) Tests following component replacement, repair, modification or maintenance (paragraph 4.2).

Test designations associated with tests required by this Standard are listed in Table 3-2.

TABLE 3-2
TEST DESIGNATIONS

TEST	DESIGNATOR
Differential pressure test	DP
Differential temperature test	DT
Flow rate test	Qf
Functional test*	F
In-place leak test	IP
Laboratory analysis (adsorbent methyl-iodide penetration)	LAB
Electrical performance test	AMP
Leak test	PL
Rotational speed test	N
Bearing temperature test	Tb
Vibration test	Vb
Visual inspection	VT
Flow Distribution Test	Qf

* Functional tests consist of various mechanical actuation and performance verifications and are detailed separately in each test section.

5.1 Inspection and Test Parameters

Parameters which need to be observed, calculated and recorded in order to meet the requirements of this Section shall be identified for each system based upon the functional requirements of the Owner's Design Specification.

5.2 System Operating Conditions

Operating conditions required for in-service testing shall be determined for each system. These conditions and acceptance criteria shall be based upon the requirements of the Owner's Design Specification.

5.3 Procedure Requirements

The Owner shall be responsible for the development and implementation of written test procedures that meet the requirements of this Standard. Each equipment test Section consists of generic (Section 7) and specific (Section 8) test requirements and acceptance criteria which apply to each of the systems in the facility. The Owner shall document which requirements are applicable.

5.4 In-Service Tests

In-service tests shall be conducted at intervals not to exceed those specified in Section 8 or the Owners Design Specification, whichever is most limiting. When a test is not practical during facility operation or cannot be conducted due to excessive personnel hazard, the justification

for postponement shall be documented and the test shall be completed after entering a condition in which the test can be conducted. When the in-service test interval expires during a period in which the component or system is not required for standby or normal operation, the test shall be conducted prior to returning equipment to normal operation. In-service test intervals are defined in Table 3-3.

TABLE 3-3
IN-SERVICE TEST INTERVALS

INTERVAL	TEST FREQUENCY	SYMBOL
Monthly	Once per 31 days	M
Quarterly	Once per 92 days	Q
Yearly	Once per 366 days	Y

6 GENERIC TESTS

Generic tests as specified in Sections 6.1 through 6.3 shall also be used in Section 8 where applicable.

6.1 Visual Inspection (VT)

Visual inspections shall be conducted in accordance with ASME AG-1 Section AA-5000 and the applicable portions of Mandatory Appendix I. The periodic in-service visual inspections listed in Section 8 shall verify that no unacceptable damage or degradation, which could impair function, has occurred to the equipment or system since the last inspection.

6.2 Pressure Boundary Tests

Pressure boundary tests consist of leak tests for ducts and housings, including fan and damper housings.

6.2.1 Leak tests for duct and housing sections shall be conducted using either the pressure decay method or the constant pressure method to verify that the leak rate for the duct or housing does not exceed the allowable limits established for the system. Testing shall be conducted in accordance with Mandatory Appendix II. Leak testing performed to satisfy ASME AG-1 Section SA may be used to meet these test requirements when the test method is compatible with Mandatory Appendix II.

An optional leak test for HEPA filter and adsorber mounting frames may be conducted, in conjunction with the housing leak test, by blanking off the frame openings and pressurizing the isolated test boundary. This procedure is useful for detecting small leaks in the mounting frame following repair or modification of a mounting frame or mounting frame interface. This test is used to verify that there are no defects in a frame that may cause failure of the in-place leak test. Testing

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

shall be conducted in accordance with Non-Mandatory Appendix A.

6.3 Vibration Test (Vb)

Vibration measurements shall be taken on the accessible motor, fan, compressor and pump bearing housings in at least two different orthogonal planes approximately perpendicular to the line of the rotating shaft.

When the bearing housing is not accessible, the frame of the component may be used if it will be representative of bearing housing vibration. When portable vibration instruments are used, reference points shall be clearly identified on the component being measured to permit duplication in both location and plane.

7 ACCEPTANCE CRITERIA

Results of tests described in Section 8 shall be subject to the acceptance criteria in Section 7 and to the applicable operating and design criteria specified by the Owner's Design Specification. Test results are considered acceptable if the component or system is not impaired or degraded to the point that it cannot perform its intended function. Acceptance criteria are specified in Section 8 only when they affect the quality of other tests. When test results do not meet the applicable acceptance criteria, the corrective actions required by Section 10 shall be initiated. In-service test results shall be compared to the acceptance test reference values and previous in-service test results. Comparison shall include a trend analysis designed to predict degradation rates of the components under test. Projected degradation rates that indicate probable loss of intended design function prior to the next scheduled in-service test shall require corrective action prior to the predicted loss of intended design function in accordance with Section 10.

7.1 Visual Inspection

Visual inspections are acceptable when there are no visual indications of improper installation, physical damage, structural distress or degradation that would impair the ability of the equipment or system to perform its intended function.

7.2 Pressure Boundary Tests

Pressure boundary tests are acceptable when there is no permanent structural deformation or leaks in excess of the limits specified in the applicable Sections of ASME AG-1 and the Owner's Design Specification.

7.3 Functional Tests

Functional tests are acceptable when they meet the requirements of the applicable Sections of ASME AG-1 and the Owner's Design Specification.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8 IN-SERVICE TEST REQUIREMENTS

8.1 General

In-service tests shall be conducted at the required time intervals after the completion of the field acceptance tests outlined in ASME AG-1 Article TA-4000. These tests shall be conducted at intervals not to exceed those stated in each Section of this Standard. When the in-service test interval is exceeded, the affected equipment shall be unavailable for service until the required in-service test can be successfully completed. In-service tests are not required to be maintained during periods when the equipment is not required to be available for operation as specified by the Owner's Design Specification. However, these in-service tests are required to be successfully completed prior to returning the equipment to normal or standby service.

8.2 FAN IN-SERVICE TESTS.

This Section provides the in-service test requirements for fans and related accessories. Integrated system testing shall be conducted in accordance with Section 8.10.

8.2.1 In-service Test Requirements

In-service tests listed in Table 8-1 shall be conducted at the specified interval and test results verified to be within the acceptance limits of the Owner's Design Specification and Section 7 and compared to the reference values obtained in acceptance tests in ASME AG-1 Article TA-4100.

TABLE 8-1
FAN IN-SERVICE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	Q
Leak test	PL	*		10Y
Mechanical run test	F		*	Q
Flow rate test	Qf	*		2Y
Static pressure test	DP	*		2Y
Rotational speed test	N	*		2Y
Vibration test	Vb	*		Q

8.2.2 Visual Inspection (VT)

A visual inspection of the fan and associated components shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1100).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.2.3 Pressure Boundary Test

8.2.3.1 Leak Test (PL)

When a fan housing is part of the system pressure boundary, a pressure boundary leak test shall be conducted to verify the leak tightness of the fan housing, shaft seal and attached interfaces in accordance with paragraph 6.2.1 and Mandatory Appendix II. The fan housing, shaft seal and attached interfaces may be tested concurrent with the duct and housing leak test specified in paragraph 8.4.3.1. However, the shaft seal leak rate shall be evaluated (qualitative) independently of the overall system leak rate.

8.2.4 System Functional Tests

Sections 8.2.4.1 through 8.2.4.5 shall be conducted in the same time frame.

8.2.4.1 Mechanical Run Test (F)

The fan shall be operated at the design flow rate for at least 15 minutes and stable system operation (no surging) verified.

8.2.4.2 Flow Rate Test (Qf)

The fan flow rate shall be measured. Recommended procedures include "ACGIH Industrial Ventilation" or equivalent.

8.2.4.3 Static Pressure Test (DP)

The fan inlet and outlet static pressure and velocity pressure shall be measured and the overall fan static pressure determined.

8.2.4.4 Rotational Speed Test (N)

When a fan does not have a direct drive coupling to the motor, the rotational speed of the fan shaft shall be measured.

8.2.4.5 Vibration Test (Vb)

The vibration of each fan and motor bearing shall be measured in accordance with Section 6.3.

8.3 DAMPER IN-SERVICE TESTS

This Section provides the in-service test requirements for dampers and related accessories. Integrated system testing shall be conducted in accordance with Section 8.10.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.3.1 In-service Test Requirements

In-service tests listed in Table 8-2 shall be conducted at the specified interval and test results verified to be within the acceptance limits of the Owner's Design Specification and Section 7, and be compared to the reference values obtained in the acceptance tests in ASME AG-1 Article TA-4200.

8.3.2 Visual Inspection (VT)

A visual inspection of the dampers and associated components shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1200).

8.3.3 Pressure Boundary Tests.

8.3.3.1. Leak Test, Damper Seat (PL)

When dampers have seat leak rate limits, a dynamic pressure boundary leak test shall be conducted in the direction the damper is expected to function, in accordance with paragraph 6.2.1 and Mandatory Appendix II. Seat leakage shall be tested by blanking off or otherwise isolating a duct Section upstream of the damper. The leak test shall be performed with the damper cycled closed using its normal closing mechanism (exclusive of any additional assistance).

**TABLE 8-2
DAMPER IN-SERVICE TESTS**

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	2Y
Leak test	PL	*		2Y
Position indication test	F		*	2Y
Exercise test	F		*	2Y
Flow Control test	F		*	2Y
Static timing test	F	*		Q
Fire damper test	F		*	2Y
Dynamic time test	F	*		2Y
Interlock test	F		*	2Y

8.3.4 Component Functional Tests

Component functional tests shall verify that the damper is operational prior to conducting the system functional tests specified in Section 8.3.5.

8.3.4.1 Position Indication Test (F)

Dampers having remote position indicators shall be observed during operation to verify that the damper position corresponds to the remote

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

indicator.

8.3.4.2 Exercise Test (F)

Power operated dampers shall be fully cycled using a control switch or other actuating device to verify operation. Manual dampers, which have a shut off function shall be fully cycled to verify operation. Fire dampers shall be tested in accordance with paragraph 8.3.5.2.

8.3.4.3 Static Timing Test (F)

Power operated dampers that are required to operate within a specified time limit shall be tested by measuring the time to fully open or fully close (as required by the Owners Design Specification).

8.3.5 System Functional Tests

8.3.5.1 Flow Control Test (F)

Power operated dampers that control airflow shall be observed under throttled flow conditions to verify freedom of movement and stable operation.

8.3.5.2 Fire Damper Test (F)

Fire dampers shall be tested, using a normal or simulated actuation signal, to verify activation under design flow.

8.3.5.3 Dynamic Timing Test (F)

Isolation dampers having a required actuation response time shall be timed to the fully open or fully closed position (as required by the Owners Design Specification) under design flow rate conditions.

8.3.5.4 Interlock Test (F)

Dampers that have an opening or closing function interlocked with other components, (e.g. fan, other dampers), shall be tested to verify interlock action.

8.4 DUCT AND HOUSING IN-SERVICE TESTS

This Section provides the in-service test requirements for ducts and housings.

8.4.1 In-service Test Requirements

In-service tests listed in Table 8-3 shall be conducted at the specified interval and test results verified to be within the acceptance limits of the Owner's Design Specification and Section 7. Test results shall be compared to the reference values obtained in the acceptance tests

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

in ASME AG-1 Article TA-4300.

TABLE 8-3

DUCT AND HOUSING IN-SERVICE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	2Y*
Leak test	PL	*		10Y

* Loop seal water level in duct or housing drain lines shall be maintained to ensure the integrity of the system pressure boundary at all times. More frequent inspection of the water level in the loop seal may be required, depending on the system design.

8.4.2 Visual Inspection (VT)

A visual inspection of the ducts, housings, and associated attachments shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1300).

8.4.3 Pressure Boundary Tests

8.4.3.1 Leak Test (PL)

A pressure boundary leak test shall be conducted on filter housings in accordance with Section 6.2 and Mandatory Appendix II.

8.5 REFRIGERATION EQUIPMENT IN-SERVICE TESTS

This Section provides the in-service test requirements for refrigeration equipment. Integrated system testing shall be conducted in accordance with Section 8.10.

8.5.1 In-service Test Requirements

In-service tests listed in Table 8-4 shall be conducted at the specified interval and test results verified to be within the acceptance limits of the Owner's Design Specification and Section 7. Test results shall be compared to the reference values obtained in the acceptance tests in ASME AG-1 Article TA-4400.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TABLE 8-4
REFRIGERATION EQUIPMENT IN-SERVICE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	Q
Leak tests	VT	*		Q
Valve position indication test	F		*	2Y
Valve exercise test	F		*	2Y
Valve timing test	F	*		Q
Flow Control valve test	F		*	Q
Mechanical run test	F		*	Q
Performance test	F	*		Q
Vibration test	Vb	*		Q
Rotational Speed test	N	*		2Y

8.5.2 Visual Inspection (VT)

A visual inspection of the refrigeration equipment components shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1400).

8.5.3 Pressure Boundary Tests

8.5.3.1 Leak Test, Refrigerant Piping and Coils (VT)

With the refrigerant system under normal operating pressure, refrigerant fluid levels shall be monitored to verify no unacceptable refrigerant leaks.

8.5.3.2 Leak Test, Hydronic Piping and Coils (VT)

Hydronic piping and coils shall be observed to verify no unacceptable fluid leaks. Testing shall be conducted by inspecting the fluid system, under normal operating pressure, for evidence of leaks.

8.5.4 Component Functional Tests

Fans shall be tested in accordance with Section 8.2.

8.5.4.1 Valve Position Indication Test (F)

Valves with position indicators shall be observed during valve full stroke operation to verify that the valve position corresponds to the remote indication.

8.5.4.2 Valve Exercise Test (F)

Power operated valves shall be fully stroked using their remote control

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

switch or other actuation device to verify operation. Manual valves shall be fully stroked to verify freedom of movement.

8.5.4.3 Valve Timing Test (F)

Power operated valves that are required to operate within a specified time limit shall be tested by measuring the stroke time.

8.5.5 System Functional Tests

8.5.5.1 Flow Control Valve Test (F)

Power operated valves, controlled by flow instrumentation, shall be observed under throttled flow conditions to verify freedom of movement and stable operation.

8.5.5.2 Mechanical Run Test (F)

The refrigeration compressor shall be operated with the system operating in the normal heat load range for at least 15 minutes and stable system operation verified.

8.5.5.3 Performance Test (F)

The refrigeration compressor inlet and outlet pressure and temperature shall be measured with the refrigeration equipment operating at achievable load points.

8.5.5.4 Vibration Test (Vb)

The vibration on each accessible bearing of the compressor and associated motor in the refrigeration system shall be measured in accordance with Section 6.3.

8.5.5.5 Rotational Speed Test (N)

For refrigerant compressors that have variable speed drives, or that do not otherwise have direct drive operations, the rotational speed of the compressor shaft shall be measured (not required for hermetically sealed compressors).

8.6 CONDITIONING EQUIPMENT IN-SERVICE TESTS

This Section provides the in-service test requirements for conditioning equipment. Integrated system testing shall be conducted in accordance with Section 8.10.

8.6.1 In-Service Test Requirements

In-service tests listed in Table 8-5 shall be conducted at the specified interval and test results verified to be within the acceptance limits

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

of the Owner's Design Specification, Section 7 and compared to the reference values obtained in the acceptance tests in ASME AG-1 Article TA-4500.

TABLE 8-5
CONDITIONING EQUIPMENT IN-SERVICE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	Q
Leak test	VT	*		Q
Valve performance tests	F		*	2Y
Mechanical run test	F		*	Q
Performance test	F	*		2Y
Rotational speed test	N	*		2Y
Vibration test	Vb	*		Q
Elect heater performance test	AMP	*		2Y
Hydronic heating and cooling performance test	F	*		2Y

8.6.2 Visual Inspection (VT)

A visual inspection of the conditioning equipment components shall be conducted in accordance with Section 6.1 and Mandatory Appendix (I-1500).

8.6.3 Pressure Boundary Test

8.6.3.1 Leak Test, Hydronic Piping and Coils (VT)

With the conditioning system at normal operating pressure, hydronic piping, coils, and pressure vessels shall be observed to verify no unacceptable fluid leaks.

8.6.4 Component Functional Test

Fans shall be tested in accordance with Section 8.2. Refrigeration components shall be tested in accordance with Section 8.5.

8.6.4.1 Valve Performance Tests (F)

Conditioning system valves shall be tested in accordance with Sections 8.5.4.1, 8.5.4.2 and 8.5.4.3

8.6.5 System Functional Tests

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.6.5.1 Hydronic System Flow Balance Verification Test

A verification of the hydronic system flow balance shall be conducted. Recommended procedures include SMACNA, NEBB, AABC, or equivalent.

8.6.5.2 Flow Control Valve Test (F)

Power operated valves, controlled by flow instrumentation, shall be observed under throttled flow conditions to verify freedom of movement, stable operation, and ability to maintain the required flow rate.

8.6.5.3 Mechanical Run Test (F)

The conditioning system pumps shall be operated, at the reference flow rate, for at least 15 minutes and stable system operation verified.

8.6.5.4 Performance Test (F)

With the conditioning system pump operating at the reference flow rate, pump differential pressure and flow rate shall be measured.

8.6.5.5 Rotational Speed Test (N)

For conditioning system pumps that have variable speed drives, or that do not otherwise have direct drive operations, the rotational speed of the pump shaft shall be measured.

8.6.5.6 Vibration Test (Vb)

The vibration of each bearing on the pump and associated motor in the conditioning system shall be measured in accordance with Section 6.3.

8.6.5.7 Electric Heater Test (AMP)

With design flow rate through the heater bank, the electrical supply voltage, amperage, phase balance, and differential temperature shall be measured.

8.6.5.8 Hydronic Heating and Cooling Performance Test (F)

With the conditioning system operating at design air and hydronic flow rate, at the available heat load conditions, the air side flow, differential pressure and differential temperature, and the hydronic side flow, differential temperature and differential pressure shall be measured.

8.7 MOISTURE SEPARATOR, PREFILTER, HEPA FILTER BANK IN-SERVICE TESTS

This Section provides the in-service test requirements for installed moisture separator, pre-filter, and HEPA filter banks.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.7.1 In-Service Test Requirements

In-service tests listed in Table 8-6 shall be conducted at the specified interval and test results verified to be within the acceptance limits of the Owner's Design Specification, Section 7 and compared to the reference values obtained in the acceptance tests in ASME AG-1 Article TA-4600.

**TABLE 8-6
MOISTURE SEPARATOR, PREFILTER, HEPA FILTER BANK
IN-SERVICE TESTS**

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	2Y
Differential pressure test	DP	*		M
In-place leak test	IP		*	2Y*

*In-place leak tests are not required on systems used for 100% recirculation (e.g. Reactor containment cleanup units).

8.7.2 Visual Inspection (VT)

A visual inspection of the installed moisture separator, prefilter and HEPA filter banks shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1600).

8.7.3 System Functional Tests

8.7.3.1 Differential Pressure Test (DP)

With the system operating at design flow rate (+/- 10%), the differential pressure across each moisture separator, prefilter, and HEPA filter bank shall be measured.

8.7.3.2 In-Place Leak Test (IP)

With the system operating at design flow rate (+/- 10%), the challenge aerosol leak rate of each HEPA filter bank shall be measured in accordance with Mandatory Appendix IV.

8.8 TYPE II and TYPE III ADSORBER BANK IN-SERVICE TESTS

This Section provides the in-service test requirements for installed type II and type III adsorber banks.

8.8.1 In-service Test Requirements

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In-service tests listed in Table 8-7 shall be conducted at the specified interval and verified to be within the acceptance limits of the Owner's Design Specification, Section 7, and compared to the reference values obtained in the acceptance tests in ASME AG-1 Article TA-4700.

TABLE 8-7
TYPE II, TYPE III ADSORBER BANK IN-SERVICE TESTS

TEST	DESIGNATOR	MEASURE	OBSERVE	INTERVAL
Visual inspection	VT		*	2Y
Differential pressure test	DP	*		M
In-place leak test*	IP	*		2Y
Electric Heater Performance Test	F	*		2Y

*In-place leak tests are not required on systems used for 100% recirculation (e.g. Reactor containment cleanup units).

8.8.2 Visual Inspection (VT)

A visual inspection of the type II and type III adsorber banks shall be conducted in accordance with Section 6.1 and Mandatory Appendix I (I-1700).

8.8.3 System Functional Tests

8.8.3.1 Differential Pressure Test (DP)

With the system operating at design flow rate (+/- 10%), the differential pressure across each adsorber bank shall be measured.

8.8.3.2 In-Place Leak Test (IP)

With the system operating at design flow rate (+/- 10%), the challenge gas leak rate of each adsorber bank shall be measured in accordance with Mandatory Appendix V.

8.8.3.3 Electric Heater Performance Test

With design air flow (+/- 10%) through each heater bank, the electrical supply voltage, amperage, phase balance of each heater circuit, and differential temperature and air flow across the heater coil shall be measured.

8.9 ADSORBENT IN-SERVICE TESTS

This Section provides the in-service laboratory test requirements for radioactive iodine penetration of the adsorbent bed used in carbon

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

adsorber systems.

8.9.1 In-service Test Requirements

In-service laboratory tests shall be conducted, using representative samples of adsorbent, at least every 2 years, or 720* hours of accumulated service time, whichever is sooner. This test measures the penetration of radioiodine through adsorbent. Laboratory test results shall be evaluated to the acceptance limits of the Owner's Design Specification. Sample locations shall be selected to assure samples are representative of the overall condition of the adsorbent in the adsorber bank.

*NOTE: A documented history of adsorbent degradation may be used as a basis for review of the Design Specification or Technical Specification to establish a longer adsorbent sample interval.

8.9.2 Laboratory Analysis (LAB)

A laboratory analysis of the adsorbent shall be conducted in accordance with ASTM D-3803-89, to measure the ability of the adsorbent to remove radioiodine. Test bed depth used in the laboratory test shall be the same as the nominal adsorber depth in the adsorber bank being tested. Samples shall be representative of the oldest adsorbent in the bank and drawn from the bank test canisters, or from the bank itself. An in-place leak test of the bank shall be conducted following sample removal in accordance with Section 8.8, unless it can be demonstrated that the removal of the sample does not create a potential leak path around or through the adsorber bank. Sample adsorbent loaded in replacement test canisters shall be representative of the oldest adsorbent in the bank. If new adsorbent is used to replace the adsorbent removed for sampling, it shall not be used in future samples.

8.10 INTEGRATED SYSTEM TESTS

Each system shall be tested to verify that the functional performance at design operating conditions is achieved. Integrated system tests shall be conducted to challenge all integrated control functions including interlocks, and manual, or automatic actuation circuits, (damper position changes, fan starts and stops, compressor and pump starts or stops, valve position changes, heater energization or de-energization). These actuations can be from a number of different sources including radiation sensors, temperature sensors, chlorine sensors, pressure sensors, manual controls and emergency safeguard signals. Sensor operation shall be verified in addition to control circuitry. Integrated testing shall also include an overall system leak test to verify there are no unacceptable bypasses of the HEPA filter or adsorber banks. Integrated system testing shall verify that the intended design function of the system is achieved in accordance with the Owner's Design Specification. The maximum test interval for integrated system tests shall be 2 years.

8.10.1 Fan Integrated System Test Requirements (F)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Fans designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of starts, stops and speed changes shall be conducted utilizing an actual or simulated actuation signal.

8.10.2 Air System Flow Balance Verification Test (Qf)

A verification of the system airflow balance shall be conducted. Recommended procedures include SMACNA, NEBB, ACGIH, AABC, or equivalent.

8.10.3 Damper Integrated System Test Requirements (F)

Dampers designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of damper positions shall be conducted utilizing an actual or simulated actuation signal.

8.10.4 Refrigeration and Conditioning Integrated System Test Requirements (F)

Refrigeration and Conditioning equipment designed to respond automatically to a process or emergency actuation signal shall be tested. Sequencing of equipment operation (start, stop, speed change, valve operation or isolation heater operation) shall be conducted utilizing an actual or simulated actuation signal.

8.10.5 HEPA Filter and Adsorber Bank Integrated System Test Requirements (F)

All potential HEPA filter bank and adsorber bank bypass flow paths shall be challenged to verify that leak rates are within the Owner's Design Specification. Bypass flow paths may be challenged during the in-place leak testing, specified in Sections 8.7.3.2 and 8.8.3.2, by ensuring that the challenge aerosol or gas injection and sample ports encompass all potential bypass leak paths (reference Mandatory Appendix IV, step V-1100). If a potential bypass flow path is not challenged during these in-place tests, a separate test shall be performed, using the techniques outlined in Appendix IV or V, to verify that the HEPA or adsorber banks are not being bypassed in excess of the limits specified in the Owner's Design Specification.

9 TESTING FOLLOWING AN ABNORMAL INCIDENT

Following an abnormal incident in which the system has been challenged at or near its design capability, the applicable acceptance tests in ASME AG-1 Article TA-4000 shall be conducted to verify that the system is fully operational. Examples of abnormal incidents include a Design Basis or severe accident exposure of the HEPA filter or adsorber banks to radioactive particles or iodine (that may saturate the HEPA filter or adsorber banks), exposure to smoke, or chemical contaminants, flooding, fire, seismic event or over-pressurization. This requirement shall

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

apply only to those components that may have been affected by the incident. An evaluation shall be conducted and documented to determine the extent of testing required.

Following exposure to smoke, solvent, paints, or other organic fumes or vapors, which could degrade the performance of the adsorbent, the adsorbent shall be replaced or verified functional by a laboratory test in accordance with Section 8.9.2.

10 CORRECTIVE ACTION REQUIREMENTS

Corrective action is required when test results do not meet the acceptance criteria specified. For equipment that is replaced, modified, or repaired, such that the reference values may change, a new set of reference values shall be obtained in accordance with the requirements of Section 4.2 and ASME AG-1 Article TA-4000. Additional guidance for corrective actions is included in Non-Mandatory Appendix B.

11 QUALITY ASSURANCE

11.1 General

Field testing of nuclear air treatment, heating, ventilating, and air conditioning systems shall be conducted in accordance with the quality assurance requirements of ASME AG-1, Article AA-8000, ANSI/ASME NQA-1, and NQA-2.

11.2 Personnel

Tests shall be conducted by personnel who have demonstrated competence to perform the specific tests, as evidenced by documented experience and training. Personnel shall be certified in accordance with ANSI/ASME NQA-1 or ANS 3.1, and in accordance with the Owner's Quality Assurance Program Requirements.

11.3 Documentation

In-service test procedures shall document the test results specified in Section 8 and include a record of test failures with subsequent corrective actions and analysis of test data trends. These records shall be maintained for the life of the facility.

11.3.1 Procedures

Written test procedures shall document the in-service testing performed and the test results obtained in accordance with Section 8 of this Standard.

11.3.2 Reports

A written report shall be provided to document the in-service testing performed in accordance with Section 8 of this Standard. The report shall contain, as a minimum, the following:

- (a) The system name, test/inspection procedure(s) used, date of test results and the test performer's signature;
- (b) Identification of instruments, equipment, tools and documents to the extent that they, or their equivalent, can be identified for future examinations;
- (c) Observations and dimensional checks specified by the respective test data and any reports developed during the inspection and testing;
- (d) Conclusions and recommendations by visual examinations and testing personnel;
- (e) Reference to previous reports, if this report is for reinspection and testing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX I MANDATORY VISUAL INSPECTION CHECKLIST

I-1000 General

A specific inspection checklist for each component in the system shall be included in the in-service test procedures. This Appendix lists typical items for each component to be visually inspected in Section 8 (In-service Tests). The inspection shall be conducted in accordance with Section 6.1. The acceptance criteria for these inspections shall be in accordance with Section 7 and Section 7.1.

I-1100 Fan Inspection Checklist

- a. Housing and duct interface
- b. Fan belt and shaft guards
- c. Interferences with moving parts
- d. Fan shaft seal
- e. Belt adjustment and condition
- f. Lubricant levels
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections
- m. Access for tests and maintenance

I-1200 Damper Inspection Checklist

- a. Housing and duct interface
- b. Actuator linkage, motor, controller
- c. Interferences with moving parts
- d. Damper shaft seal
- e. Blade edge seals, damper seat
- f. Limit switches
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Pneumatic connections
- l. Access for tests and maintenance

I-1300 Duct, Housing and Mounting Frame Inspection Checklist

- a. Housing and duct connections (no caulking)
- b. Provision for opening access doors from both inside and outside
- c. Access door seals, gaskets
- d. Access door latches
- e. Housing internal access ladders and platforms

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- f. Sample and injection ports, location and caps
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation, connections
- j. Electrical connections
- k. Housing/duct penetration seals
- l. Loop seals (water level), drain connections
- m. Lighting conduits, socket housing seals (flush mounted)
- n. HEPA/adsorber mounting frame continuous seal welds
- o. Mounting frame penetrations seal welded
- p. Mounting frame seating surface (weld splatter, flatness, scratches)
- q. Sample canister installation
- r. Mounting frame clamping devices
- s. Access for tests and maintenance
- t. Lighting for test and maintenance available

I-1400 Refrigeration Equipment Inspection Checklist

- a. Housing or duct interface with refrigeration equipment
- b. Fan, pump, compressor belt and coupling guards
- c. Interferences with moving parts
- d. Belt adjustment and condition
- e. Fluid leaks
- f. Lubricant levels
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections and tubing (No crimping)
- m. Access for tests and maintenance

I-1500 Conditioning Equipment Inspection Checklist

- a. Housing or duct interface with conditioning equipment
- b. Belt and coupling guards
- c. Interferences with moving parts
- d. Belt tightness
- e. Fluid leaks
- f. Lubricant levels
- g. Supports and attachments
- h. Bolting and fasteners
- i. Instrumentation
- j. Electrical connections
- k. Control system components
- l. Pneumatic connections and tubing (No crimping)
- m. Drains and spray nozzles not plugged
- n. Access for tests and maintenance

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

I-1600 Moisture Separator Bank, Prefilter Bank, HEPA Filter Bank Inspection Checklist

- a. Moisture separator media, frame, clamps and gaskets
- b. Moisture separator water collection system and drains
- c. Prefilter media, frame, clamps and gaskets
- d. HEPA filter media, frame, clamps and gaskets
- e. Sealant or caulking (none allowed)
- f. Moisture separator, prefilter, HEPA orientation (vertical)
- g. Bolting and fasteners.
- h. Access for tests and maintenance

I-1700 Type II, Type III Adsorber Bank Inspection Checklist

- a. Type II media, frame, screen, clamps and gaskets
- b. Sealant or caulking (none allowed)
- c. Type III media, screens, frame
- d. Test canisters
- e. Bulk loading equipment
- f. Fire protection system piping, nozzles, instrumentation
- g. Bolting and fasteners
- h. Access for tests and maintenance

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX II MANDATORY DUCT AND HOUSING LEAK TEST PROCEDURE

II-1000 General

This procedure is used to test the leak tightness of the ducts and housings including installed fan housings, damper housings and fan and damper shaft seals.

II-1100 Summary of Method

Ducts and housings that form the pressure boundary of the system shall be leak tested, with air, using one of the methods listed in this procedure. Either method may be used and will produce a similar test result. The constant pressure method is useful for testing small volumes and is conducted at the maximum operating pressure for the system. The pressure decay method is useful in testing large volumes and is conducted by pressurizing to 1.25 times the maximum operating pressure, then allowing the pressure to decay for a fixed period of time, or until the pressure decreases to 80% of the maximum operating pressure, whichever occurs first. Fans, dampers, and other components that are part of the pressure boundary shall be installed and tested with the pressure boundary to verify interface connection leak tightness. If the measured leak rate is in excess of the acceptance criteria, the leaks shall be located by one of the methods listed in this procedure. After leaks are repaired, the duct and housing shall be re-tested to verify leak tightness.

NOTE: This test procedure is written as if the operating pressure were positive, but it would be identical for negative pressure systems with appropriate change in signs used in the data collection and calculations.

II-2000 Prerequisites

Construction, modifications and repairs affecting the test boundary shall be complete and the inlet and discharge openings of the duct or housing sealed before the test is started. All electrical, piping, and instrument connections shall be complete and all permanent seals shall be installed before the test is started. For pressure decay testing, the volume of the pressure test boundary must be calculated.

II-3000 Test Equipment

- a. Pressurization source (Pneumatic, test fan with flow control, etc.).
- b. Covers to seal test boundaries.
- c. Clock or timer accurate to +/- 1.0 second.
- d. Pressure indicating device accurate to +/- 0.1 in.w.g. (0.025

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

kPa(gage)).

- e. Flowmeter or Totalizing Gas Volume meter accurate to +/-5% (constant pressure method).
- f. Temperature indicating device accurate to +/- 0.5 °F (0.25°C).
- g. Bubble solution for detecting air leaks (bubble method).
- h. Optional portable electronic sound detection equipment (audible leak method).
- i. Barometer

II-4000 Procedure

II-4100 Constant Pressure Test

- a. Connect the pressurization source to the duct or housing.
- b. Connect the flowmeter or totalizing gas volume meter between the pressurization source and the housing (downstream of the throttling valve, if used).
- c. Install temperature and pressure indicating devices so that they will indicate representative temperature and pressure inside the duct or housing being tested.
- d. Seal test boundaries and close access doors in the normal manner. Do not use temporary sealants, duct tape, or similar temporary materials except for sealing the temporary blank-off panels.
- e. Start the pressurization source and operate it until the maximum operating pressure is achieved. Maintain pressure constant with the flow control device until temperature remains constant within +/- 0.5 °F (0.25 °C) for a minimum of 10 minutes. Record the initial stabilized pressure, temperature, and barometric pressure.
- f. Measure the flow rate of the air being added to or removed from the duct or housing while maintaining the maximum operating pressure within +/- 0.1 in. w. g. (0.025 kPa(gage)). When using the flow meter, record flow readings once a minute for a 5 minute continuous period and average the readings to calculate the measured leak rate. When using a totalizing gas volume meter, measure the total volume of air for a 10 minute continuous period and divide the measured volume by time (10 minutes) to calculate the measured leak rate. Record final pressure, temperature and barometric pressure.
- g. Convert the final calculated leak rate to standard cubic feet per minute (cubic meters per second) in accordance with the method

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

illustrated in "Industrial Ventilation" (ref. Section 2).

II-4200 Pressure Decay Test

- a. Connect the pressurization source (with a leak tight shutoff valve) to the duct or housing.
- b. Install the temperature and pressure indicating devices where they will indicate the representative temperature and pressure inside the duct or housing being tested.
- c. Seal test boundaries and close access doors in the normal manner. Do not use temporary sealants, duct tape, or similar temporary materials except for sealing the temporary blank-off panels.
- d. Start the pressurization source and operate until the pressure is 1.25 times the maximum operating pressure (but not to exceed the structural capability pressure). Maintain this pressure constant with a flow control device until temperature remains constant within +/- 0.5 °F (0.25 °C) for a minimum of 10 minutes. Close shutoff valve.

NOTE(1): If the structural capability pressure for the duct or housing is less than 1.25 times the maximum operating pressure, the final test pressure shall be calculated as follows to achieve an average test pressure equal to the maximum operating pressure:

$$P_f = 0.8(OP_{max}) + (1.25(OP_{max}) - SCP)$$

where: P_f = final test pressure
 OP_{max} = maximum operating pressure
 SCP = structural capability pressure

- e. Record the initial time, pressure, temperature, and barometric pressure.
- f. Record pressure readings once a minute until pressure decays to 80% of the maximum operating pressure, or for a minimum of 15 minutes (see NOTE(1) in step d above).
- h. Record final time, pressure, temperature, and barometric pressure.
- i. Calculate leak rate from the following equation in English Units:

$$Q_{ave} = \left(\frac{P_i}{T_i} - \frac{P_f}{T_f} \right) * \frac{V}{R * \Delta t * 0.075}$$

Metric Units:

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

$$Q_{ave} = (1.39 * 10^{-5}) * \left(\frac{P_i}{T_i} - \frac{P_f}{T_f} \right) * \frac{V}{R * \Delta t}$$

where:

Q_{ave} = Average leak rate, scfm (sm³/s). (air density 0.075 lb/ft³)

V = Volume within test boundary, ft³ (m³).

P_i = Initial pressure within test boundary, lb/ft² ABS (Pa(absolute)).

P_f = Final pressure within test boundary, lb/ft² ABS (Pa(absolute)).

T_i = Absolute Temperature at start of test, °R (°K).

T_f = Absolute Temperature at end of test, °R (°K).

Δt = $t_i - t_f$ Time difference (minutes).

t_i = Time at start of test (minutes).

t_f = Time at end of test (minutes).

R = Gas Constant for Air; $53.35 \frac{\text{ft-lb}}{\text{lb-}^\circ\text{R}}$, $(0.286 \frac{\text{kJ}}{\text{kg-}^\circ\text{K}})$

II-4300 Acceptance Criteria

If the calculated leak rate exceeds the Owner's acceptance criteria, locate leaks in accordance with one of the techniques outlined in II-4400 or II-4500.

II-4400 Bubble Leak Location Method

- a. Pressurize the test boundary to the maximum operating pressure for the system.
- b. With the test boundary under continuous pressure, apply bubble solution to areas to be tested. Identify places where bubbles are found and perform corrective actions.
- c. Following corrective actions, retest in accordance with II-4100 or II-4200.

II-4500 Audible Leak Location Method

- a. Pressurize the test boundary to the maximum operating pressure for the system.
- b. With the test boundary continuously pressurized, locate audible leaks (electronic sound detection equipment optional) and perform corrective actions.
- c. Following corrective action, retest in accordance with II-4100 or II-4200.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX III MANDATORY AIRFLOW DISTRIBUTION TEST PROCEDURE

III-1000 General

This procedure is used to measure the air flow distribution across the face of moisture separator, prefilter, HEPA filter, and adsorber banks. Uniform air velocity distribution ensures maximum air treatment efficiency and uniform loading of air treatment components.

III-1100 Summary of Method

The system is operated at design flow rate. Airflow velocity readings are measured downstream of each moisture separator, prefilter, and HEPA filter in the bank. For adsorbers, readings shall be taken in line with the flow slots. Each reading is compared to the average for the bank.

III-2000 Prerequisites

System operating within +/- 10% design flow rate.

III-3000 Test Equipment

Rotating vane, heated wire or heated thermocouple anemometer, pitot tube, or other suitable air velocity measuring device as appropriate for the anticipated velocities.

III-4000 Procedure

- a. For each moisture separator, prefilter and HEPA filter, measure the air velocity at the approximate centers of equal areas with at least 1 measurement per each moisture separator, prefilter, and HEPA filter, and a minimum of 9 measurements per bank. Adsorber velocity measurements shall be made in the approximate center of the flow slots. For flow slots greater than 24 inches long (60 cm), measurements shall be nominally every 12 inches (30 cm) along the length of the slot.
- b. Calculate the average velocity (V_{ave}) using the following formula:

$$V_{ave} = \frac{\sum_1^n V_i}{n}$$

where:

$$\sum_1^n = \text{sum of readings from 1 to } n$$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

V_i = individual velocity readings
n = number of readings

- c. Identify the highest and lowest velocity readings and calculate the percentage they vary from the average calculated above.

APPENDIX IV
MANDATORY
HEPA FILTER BANK IN-PLACE LEAK TEST PROCEDURE

IV-1000 General

This procedure is used to leak test HEPA banks.

IV-1100 Summary of Method

The system is operated at design flow rate. Challenge aerosol is injected upstream of each bank through the injection ports qualified in Acceptance Testing in ANSI/ASME AG-1 Appendix TA-V. The concentration of the challenge aerosol is measured upstream and downstream of the HEPA bank. The ratio of the downstream and upstream concentrations represents the HEPA filter bank leak rate.

IV-2000 Prerequisites

Airflow distribution shall be verified in accordance with Appendix III. The injection port shall be qualified to provide uniform air-aerosol mixing in accordance with ASME AG-1 Appendix TA-V.

IV-3000 Test Equipment

- a. Challenge aerosol generator.
- b. Challenge aerosol measuring instrument.
- c. Flow measuring device.

IV-4000 Procedure

- a. Connect challenge aerosol or gas generator to the qualified injection port.
- b. Place the challenge aerosol or gas measuring instrument sample probes upstream and downstream of the bank to be tested with adequate hose length to reach all areas of the bank.
- c. Start the system and verify stable flow rate within +/- 10% of design flow rate.
- d. Measure the upstream and downstream aerosol background concentration. The pre-injection background levels shall be stable to ensure correct instrument response and shall not interfere with the detector's ability to detect leaks in excess of the maximum allowed by the acceptance criteria.
- e. Start the challenge aerosol injection.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- f. Record the upstream and downstream concentrations. Repeat until at least three of the readings are stable.
- g. Stop the injection.
- h. Using the final set of readings meeting the stability and tolerance criteria, calculate the bank leak rate using the formula below:

$$L = (100) \frac{C_d}{C_u}$$

L = % Leak

C_d = Downstream concentration

C_u = Upstream concentration

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX V MANDATORY ADSORBER BANK IN-PLACE LEAK TEST PROCEDURE

V-1000 General

This procedure is used to leak test adsorber banks.

V-1100 Summary of Method

The system is operated at design flow rate. Challenge gas is injected upstream of each bank through the injection port qualified in ASME AG-1 Appendix TA-V. The concentration of challenge gas is measured upstream and downstream of the bank. The ratio of the downstream and upstream concentrations represents the bank leak rate.

V-2000 Prerequisites

Airflow distribution shall be verified in accordance with Appendix III. The injection port shall be qualified to provide uniform air-aerosol mixing in accordance with ASME AG-1 Appendix TA-V.

V-3000 Test Equipment

- a. Challenge gas generator.
- b. Challenge gas measuring instrument.
- c. Flow measuring device.

V-4000 Procedure

- a. Connect challenge gas generator to the qualified injection port.
- b. Place the challenge gas measuring instrument sample probes upstream and downstream of the bank to be tested. The sample tubing shall be of equal lengths and bore and as short as possible to minimize the measuring instrument response time. The upstream sample probe shall be located in approximately the center of the bank. The downstream sample probe shall be located in a downstream sample manifold or downstream of a mixing source such as a turbulent fan discharge.
- c. Start the system and verify stable flow rate and within +/-10% of design flow rate.
- d. Measure the upstream and downstream challenge gas background concentration. The pre-injection background levels shall be stable to ensure correct instrument response and shall not interfere with the detector's ability to detect challenge gas leaks less than the maximum allowed by the acceptance criteria.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- e. Start the challenge gas injection.
- f. Record the upstream and downstream concentrations, as rapidly as instrument response time allows, until sufficient data has been recorded to allow calculation of adsorber bank leak rate. Care must be taken to obtain sufficient readings quickly after injection.
- g. Terminate challenge gas injection.
- h. Using the upstream and downstream concentration data, calculate the adsorber bank leak rate using the formula below.

$$L = (100) \frac{C_d}{C_u}$$

$L = \% \text{ Leak}$
 $C_d = \text{Downstream concentration}$
 $C_u = \text{Upstream concentration}$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX A NON-MANDATORY MOUNTING FRAME PRESSURE LEAK TEST PROCEDURE

A-1000 General

This optional test is used to identify leaks through seal welds of the HEPA filter or adsorber mounting frames. The presence of these leaks may be evident when conducting the in-place leak tests on the HEPA filter and adsorber banks. A good visual verification per Appendix I, steps I-1600 and I-1700, is usually adequate. This procedure is provided for use when the frame leaks need to be located.

A-1100 Summary of Method

Temporary blanks, with gaskets, are installed in place of the HEPA filters or adsorbers on the mounting frame in the system. The pressure boundary is then secured by blanking off upstream of the mounting frame in the housing or associated ducts. This modified pressure boundary is then pressurized using the techniques outlined in Appendix II and any leaks in the mounting frame welded interface is detected using the techniques in Appendix II, steps II-4400 or II-4500.

A-2000 Prerequisites

Construction, modifications and repairs affecting the test boundary shall be complete and temporary blanks, with gaskets, installed on the gasket side of the mounting frame. The opening of the duct or housing upstream of the mounting frame shall be blanked off to form a modified pressure boundary.

A-3000 Test Equipment

- a. Pressurization source (test fan with flow control).
- b. Covers to seal test boundaries.
- c. Pressure indicating device accurate to +/- 0.1 in. w.g. (0.025 kPa(gage)).

A-4000 Procedure

- a. Connect the pressurization source to the duct or housing pressure boundary.
- b. Install pressure indicating device so that it will indicate the pressure inside the duct or housing being tested.
- c. Close access doors.
- d. Start the fan and operate until the pressure is greater than or equal

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

to the maximum operating differential pressure for the filter bank (not to exceed the structural capability pressure for the duct and housing assembly). Maintain pressure for the duration of the inspection.

- e. Inspect the mounting frame welds and attachments for leaks using the methods outlined in Appendix II, steps II-4400 or II-4500.

APPENDIX B
NON-MANDATORY
CORRECTIVE ACTION GUIDANCE

Corrective action may consist of replacement, repair, modification, maintenance, or analysis to demonstrate that the equipment will fulfill its design function. A revised set of reference values, as described in Section 4, shall be established after the corrective action has been taken.

Results of a failed test shall not be resolved simply by a successful repetition of the test. A successful repetition of the test shall be preceded by corrective action.

If the cause of the test failure cannot be determined by inspection or analysis, corrective action may consist of re-calibration of test instruments and subsequent re-testing. If it is determined that the test failure is due to an equipment malfunction, instead of difficulties with the test equipment, or test procedure, the equipment shall be declared unavailable for service until the specific cause has been determined and the condition corrected.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX C NON-MANDATORY CHALLENGE GAS SUBSTITUTE SELECTION CRITERIA

Alternative test agents (challenge gas) may be used to perform In-place testing of adsorbers, as required in Mandatory Appendix V, when their selection is based upon meeting the following characteristics:

1. The test agent gives the same In-place Leak Test results as one of the following: R-11, R-12, R-112, or R-112a.
2. The test agent has similar retention times on activated carbons, at the same concentration levels, as one of the following: R-11, R-12, R-112, or R-112a.
3. The test agent has similar lower detection limit sensitivity and precision in the concentration range of use as one of the following: R-11, R-12, R-112, or R-112a.
4. The test agent exhibits chemical and radiological stability under the test conditions.
5. The test agent causes no degradation of the carbon and its impregnant(s) or of other Nuclear Air Treatment System components under the test conditions.
6. The test agent is listed in the Environmental Protection Agency "Toxic Substance Control Act" (TSCA) inventory for commercial use.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX D NON-MANDATORY TEST PROGRAM DEVELOPMENT GUIDANCE

D-1000 OVERVIEW:

The scope of the periodic in-service test program for nuclear safety-related air treatment, heating, ventilating, and air conditioning systems should be developed commensurate with the safety significance of the system performance function(s). The overall depth of the performance monitoring effort should be flexible, with various tests being added, modified, or deleted as results and industry experience warrant. This Appendix will attempt to provide the user with guidance in developing a test program which will meet the requirements of the Standard.

D-2000 DEFINITIONS:

The following definitions are applicable to this Appendix:

Analyzed System Configuration: The alignment and condition (on or off) of various components, handswitches, controls, valves, piping, etc., that have been analyzed as being capable of accomplishing a specific system function.

Analyzed System Performance: The predicted performance as determined in the appropriate analysis (safety, system, or component analysis) or the acceptable limit as defined in the Technical Specification Basis. This value is in the conservative direction when related to the design limit, with the difference between the two defining the analysis margin.

Design Basis: "That information which identifies the specific functions to be performed by a structure, system, or component of a facility, and the specific values or range of values chosen for controlling parameters as reference bounds for the design. These values may be (1) restraints derived from generally accepted "state of the art" practices for achieving functional goals, or (2) requirements derived from analysis (based on calculation and/or experiment) of the effects of a postulated accident for which the structure, system, or component must meet its functional goals". (REF: 10CFR50.2)

Parameters: The variables or measurable qualities of a system or component that define acceptable operation or can be restricted to ensure that performance remains within design limits.

System Performance Function: The goal or task which the system is required to accomplish or support.

Examples of System Performance Functions, which might be applicable to nuclear air treatment, heating, ventilating and air conditioning systems include:

- I. Provide a habitable environment (temperature, humidity, filtration, ventilation) for facility personnel.
- II. Provide an acceptable environment (temperature, humidity, ventilation) to support equipment operability and Environmental Qualification requirements.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- III. Prevent the uncontrolled release of airborne radioactivity and limit offsite dose in accordance with 10CFR50 Appendix I, 10CFR20 and 10CFR100.

D-3000 TEST PROGRAM DEVELOPMENT:

The Owner should perform a detailed review of all design basis documentation applicable to each safety-related system. Subsequent to this review, a Test Basis Document should be prepared for each nuclear safety-related air treatment, heating, ventilating, and air conditioning system in the facility to identify the following:

1. System safety-related performance function(s)
2. Analyzed system configuration for each identified performance function.
3. The critical performance parameters which will define acceptable system operation for each performance function.
4. The Parameter design limits. These are the design or analysis limits which govern the system performance and bound the system.

NOTE: The Nuclear Management and Resources Council, Inc (NUMARC) sponsored document "Design Basis Document Guidelines", NUMARC 90-12, October 1990 and USNRC NUREG-1397, "An Assessment of Design Control Practices and Design Reconstitution Programs in the Nuclear Power Industry", February 1991, can provide further detail on methods for determining the various design basis functions.

D-4000 SAMPLE TEST PROGRAM:

Given a sample Control Room Complex Emergency HVAC System, consisting of a fan, ductwork, dampers, chilled water cooling coils, nuclear air filtration unit (electric preheater, prefilter, HEPA filters, Adsorber), controls, etc., the System Test Basis Document might be structured as follows:

A. System Performance Functions:

1. Provide a habitable environment for control room complex personnel in the event of a design basis accident
2. Maintain the control room complex environment to ensure equipment operability.
3. Limit radiological dose to control room complex personnel in accordance with GDC-19 requirements

B. Analyzed System Configuration:

To achieve Performance Functions A1, A2 and A3:

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

One Essential Air Filtration unit in service, normal ventilation system isolated and an essential chilled water system in service.

C. Critical Performance Parameters and Parameter Design Limits:

<u>Performance Function</u>	<u>Performance Parameters</u>	<u>Parameter Design Limit</u>
A1 and A2	Heat Removal:	850,000 Btuh
	* Total System Airflow	30,000 SCFM (min)
	* Air Temperature at coil outlet	60 °F (Max)
	* Chilled Water Flow to coil	114 GPM (Min)
	* Chilled Water Supply Temperature	45 °F (Max)
	* Control Room Ambient Air Temperature	80 °F (Max)
A3	Radiation Protection:	
	* Outside Airflow (pressurization)	400 SCFM (Min)
	* Outside Airflow	900 SCFM (Max)
	* HEPA Filter Bypass Leakage	1% (Max)
	* Adsorber Bypass Leakage	1% (Max)
	* Adsorbent Methyl Iodide Removal Efficiency	99% (Min)
	* Humidity Control At Adsorber	70% (Max)
	* Control Room Complex Pressure	+0.25 in. wg (relative to all adjacent areas)
	* Isolation Damper Leakage	Bubblight @ 15 in wg
	* Isolation Damper Closure Time	25 seconds (Max)
	* Filter Unit Total Pressure Drop	8.0 in. wg (Max)

Based upon the identified Critical Performance Parameters for the sample Control Room Complex Emergency HVAC System, the following periodic in-service test program would be appropriate:

<u>Test Section</u>	<u>Test Description</u>	<u>Test Applicable to System?</u>	<u>Test Frequency</u>
8.2	FANS	YES	
8.2.2	Visual Inspection (VT)	YES	Q
8.2.3	Pressure Boundary Test		
8.2.3.1	Leak Test (PL)	YES	10Y
8.2.4.1	Mechanical Run Test (F)	YES	Q

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.2.4.2	Flow Rate Test (Qf)	YES	2Y
8.2.4.3	Static Pressure Test (DP)	YES	2Y
8.2.4.4	Rotational Speed Test (N)	YES	2Y
8.2.4.5	Vibration Test (Vb)	YES	Q
8.3	DAMPERS	YES	
8.3.2	Visual Inspection (VT)	YES	2Y
8.3.3.1	Leak Test Damper Seat (PL)	YES	2Y
8.3.4.1	Position Indication Test (F)	YES	2Y
8.3.4.2	Exercise Test (F)	YES	2Y
8.3.4.3	Static Timing Test(F)	YES	Q
8.3.5.1	Flow Control Test (F)	YES	2Y

<u>Test Section</u>	<u>Test Description</u>	<u>Test Applicable to System?</u>	<u>Test Frequency</u>
8.3.5.2	Fire Damper Test (F)	YES	2Y
8.3.5.3	Dynamic Timing Test (F)	YES	2Y
8.3.5.4	Interlock Test (F)	YES	2Y
8.4	DUCT AND HOUSING	YES	
8.4.2	Visual Inspection (VT)	YES	2Y
8.4.3.1	Leak Test (PL)	YES	10Y
8.5	REFRIGERATION EQUIPMENT	NOTE 1	
8.5.2	Visual Inspection (VT)		
8.5.3.1	Leak Test, Refrigerant Piping and Coil (PL)		
8.5.3.2	Leak Test, Hydronic Piping and Coils (PL)		
8.5.4.1	Valve Position Indication (F)		
8.5.4.2	Valve Exercise Test (F)		
8.5.4.3	Valve Timing Test (F)		
8.5.5.1	Flow Control Valve Test (F)		
8.5.5.2	Mechanical Run Test (F)		
8.5.5.3	Performance Test (F)		
8.5.5.4	Vibration Test (Vb)		
8.5.5.5	Rotational Speed Test (N)		
8.6	CONDITIONING EQUIPMENT	NOTE 2	
8.6.2	Visual Inspection (VT)		
8.6.3.1	Leak Test, Hydronic Piping and Coils (PL)		
8.6.4.1	Valve Performance Tests (F)		
8.6.5.1	Hydronic System Flow Balance Verification (Qf)		
8.6.5.2	Flow Control Valve Test (F)		
8.6.5.3	Mechanical Run Test (F)		

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

8.6.5.4	Performance Test (F)		
8.6.5.5	Rotational Speed Test (N)		
8.6.5.6	Vibration Test (Vb)		
8.6.5.7	Electric Heater Test (AMP)		
8.6.5.8	Hydronic Heating and Cooling Performance Test (F)	YES	2Y
8.7	MOISTURE SEPARATOR, PREFILTER, HEPA FILTER BANK		
8.7.2	Visual Inspection (VT)	YES	2Y
8.7.3.1	Differential Pressure Test (DP)	YES	M
8.7.3.2	In-Place Leak Test (IP)	YES	2Y
8.8	TYPE II and TYPE III ADSORBER BANK		
8.8.2	Visual Inspection (VT)	YES	2Y

<u>Test Section</u>	<u>Test Description</u>	<u>Test Applicable to System?</u>	<u>Test Frequency</u>
8.8.3.1	Differential Pressure Test (DP)	YES	M
8.8.3.2	In-Place Leak Test (IP)	YES	2Y
8.8.3.3	Electric Heater Performance	YES	2Y
8.9	ADSORBENT		
8.9.2	Laboratory Analysis (LAB)	YES	2Y
8.10	INTEGRATED SYSTEM TESTS	NOTE 3	
8.10.1	Fan Integrated System Tests (F)	YES	2Y
8.10.2	Air System Flow Balance Verification (Qf)	YES	2Y
8.10.2	Damper Integrated System Test (F)	YES	2Y
8.10.3	Refrigeration and Conditioning Integrated System Test (F)	NOTE 1	
8.10.4	HEPA Filter and Adsorber Bank Integrated Test (F)	YES	2Y

NOTES:

1. Refrigeration Equipment is scoped and tested with the Essential Chilled Water System.
2. Conditioning Equipment, with the exception of the Control Room Complex Essential Cooling Coil, is scoped and tested with the Essential Chilled Water System.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

3. Measurements for Control Room Complex pressure and ambient room temperature are incorporated into 8.10, Integrated System Testing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

PEST: I am a member of the ASME Committee on Nuclear and Gas Treatment and serve as vice-chairman of the Subcommittee on Field Test Procedures, and chairman of the Subgroup of the same name. I am employed at the Palo Verde Nuclear Generating Station, operated by Arizona Public Service Co., the nation's largest electrical power producing site. At this session we will be discussing the proposed AG-1 Code, Section TA, Acceptance Testing, and the proposed Standard N511, Periodic In-Service Testings of Nuclear Air Treatment, Heating, Ventilating and Air Conditioning Systems. I plan to give a brief history of the two documents, why they are needed., and familiarize you with the development process. After a brief review of the contents of the documents, I will ask the panel for comments.

In 1971, a group was organized to develop standards for high reliability air cleaning equipment and a performance test. The result was ANSI/ASME N510, published in 1975 and ANSI/ASME N509, published in 1976. These two standards were updated in 1980, again in 1989, and reaffirmed recently. It appears that they will live on for some time as they are now considered international standards.

The scope was expanded to include ancillary components and systems and the development of an equipment code. The first edition of the code, AG-1, was issued in 1986 and reapproved in 1988 and 1994. Section TA has been in preparation for a number of years. Approximately three years ago, draft Section TA covering acceptance and in-service testing was approved by the CONAGT Main Committee but rejected by the Board of Nuclear Codes and Standards with instructions to make Section TA cover acceptance testing, only. CONAGT resolved to provide a separate standard for in-service testing. Section TA, revision 03-06-96, was sent to the Main Committee for letter ballot but was not approved. It is the subcommittee's intent to prepare responses to negative ballots, and submit a redraft to the Main Committee for approval by August 2, 1996. This means that it could be in print by late 1997.

The proposed in-service testing standard, designated N511-19XX, has just completed the first subcommittee ballot and some changes are needed. The subcommittee intends to prepare responses to all comments, review newly-derived issues, and distribute a new draft for subcommittee ballot by approximately August 15. We believe that the information gained from this session will help us prepare a quality document in a short time. N511 is intended for application to systems built according to provisions of the AG-1 code. This is the same relationship as N510 to N509.

As we review these documents together I am going to read certain paragraphs and tell you what is going to be changed. To TA 2000 we will be adding the latest edition of the references. For TA 3500, the second sentence which reads, "Test results are considered acceptable if the component or system is not impaired or degraded to the point that it cannot perform its intended function" will be deleted. The consensus was that the phrase did not give the correct emphasis. To TA 4010, a note will be added that repairs or maintenance procedures that do not affect test acceptance values will not require a retest. For TA 4436, the first sentence will read, "Correct direction of rotation shall be verified for compressor motors." Because it is not wise to start and stop a compressor motor just to see if it is rotating in the correct direction and because some compressor motors are hidden within the system, verification will have to be performed by electrical means. In the second sentence, we will change restart to start. A caution note will be added to TA 4736 to require monitoring air temperature leaving the heater to avoid challenging the fire protection systems and causing automatic actuations. To TA 4740, acceptance criteria, will be added paragraph 4744, Electrical Heater Performance Test Acceptance Criteria. For TA 4940 after the words "flow path" will be added the words, "housing, by-pass ducts, and associated dampers." In

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Appendix TA-1, page 41, a sentence will be changed to read, "provisions for access for performing tests and maintenance." These are all the changes to the balloted Section TA document.

The copy of N511 in your hands is about two revisions old. We have had several word smithing sessions. Appendix A will be deleted. In Section 8.10.2, there will be further work on air balance verification. This was brought up this week in our subcommittee meeting. There was a lot of discussion about what you have to do to certify that the system is balanced. Do you do a traverse at the fan or do you have to go back through the branch ducts and the diffusers? Do you perform temperature surveys? We also need to consider test requirements for medium efficiency filters in N511 and the matter of the test designators that were transferred from Section TA. Through this session, we can smooth out the document before it gets to the Main Committee.

Panel Members are Curt Graves, NUCON, International, Paul Burwinkel, Georgia Power, Vince Kluge, Palo Verde Nuclear Generating Station, and Len Leonard, Leonard Designs. Now, we will open the session for discussion.

SCRIPSICK: I am not certain I have reviewed the entire document. There are sections in N509 that pertain to testing HEPA filter systems. An example is the mandatory appendix for qualification of injection and sampling manifolds. Does that topic appear in either of the two documents, or are there still going to be some provisions in N509 for testing?

PEST: The housing group will try to include some information on locations for sample manifolds.

KLUGE: I think that section TA can only address the sections of AG-1 that have been approved. Manifolds are within the housing group, and that section has not been issued. But when it is, it will be addressed.

SCRIPSICK: It seems to me that considerations for sampling downstream should be an essential part, just as aerosol mixing is included in a mandatory appendix.

PEST: As I see it, N509 would continue to contain acceptance criteria for injection points but the in-service document would describe how you test it.

SCRIPSICK: There is a requirement of $\pm 20\%$ for air flow distribution and air/aerosol mixing on the upstream side but not for sampling downstream, I don't see any reason to treat it differently.

GRAVES: This document is still a work in progress, as other code sections are developed this group will take over the testing portion for them. Until a code section is developed that addresses the component that needs to be tested, this group does not produce anything, although they can anticipate. Did I hear you say sampling manifolds are in the housing section?

KOVACH, L: The basic idea is that the qualification requirements for mixing and test manifolds are in the TA section because if you qualify them on the original system, as it was built, it is not expected that they will change in use. TA requires you redo the qualification procedure if you make changes. Therefore, after you qualify the injection and test locations, N511 gives you the surveillance tests that you need thereafter. It is not expected that it would change as long as you maintain the same flow rate and configuration. But if you change the configuration, you would have to do the TA-type acceptance testing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

This will make N511 less free-standing, because it could be applied to systems that are already qualified according to TA.

SCRIPSICK: My point is that TA does not consider the downstream side, once you qualify the downstream sampling location, you do not have to do it again. That is a major modification. I was not involved and do not know the history, but it seems to me that this is a good point to bring in all the considerations of downstream sampling. I do not understand the reason for treating the two differently.

KOVACH, L: TA covers everything relating to sampling locations that was in N509.

SCRIPSICK: But the qualification criteria for downstream sampling are not in TA.

KOVACH, L: I am not sure, I think it may be in there.

SCRIPSICK: Traditionally, it has been in N509.

KOVACH, L: It is not in N511 because it is expected that it will have already been taken care of.

SCRIPSICK: So it should be in TA, but I do not see it in TA. The concentration profile has to be $\pm 5\%$ to qualify a standard probe and the in-service probe or manifold has to be within $\pm 5\%$ of the standard probe.

KOVACH, L: What you have to understand is that there is segmentation now. Some of the things that you saw in N509 may now be in three or four different AG-1 sections. Now, when you build a housing, you will qualify the various injection ports and sampling locations with the housing. That is how it should be done, not after you build the unit. You do not start drilling holes in the housing like Woody Woodpecker to try to find the best location to test.

SCRIPSICK: I think that same logic should apply to the selection of the injection port.

KOVACH, L: You have to be careful because the manufacturer of the housing may not construct the whole system, someone else may put in the HEPA filters, *etc.* Therefore, you must have enough flexibility to allow for commercial practice and make sure that you do not put in any code section specifications that belong to another manufacturing or supply step.

WILHELM: What are the results of the tests done up till now? What is the percentage of reactor filters or systems that really failed? Around twenty years ago, a paper was given that showed 15% of filters failed the test. I do not know the current percentage of failed filters. The in-place test is rather complicated and expensive. Is it really necessary, judging from the results you have today?

GRAVES: The point of the in-place test is to verify that after filter change-out or some other event the system still functions properly and there is no leak. In any case, NRC dictates that tests be performed at nuclear power plants. It is not a test of individual filters, it is a system test to make sure there is no bypass leakage or potential contamination path. It is assumed that the filters left the factory in good shape, and that they looked good when they were installed. After they are installed you want to know that the system does not have bypass leakage. I do not have any idea what percentage of filters failed as a result of the performance of these tests.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

HAYES: Can you tell me whether section TA or N511 has any test associated with the integrity of a particular building or area boundary, such as a control room, auxiliary building, shield building, annulus reactor building? If they are included, what are the tests?

KLUGE: That would occur under integrated system testing, but currently, there is nothing specific as far as identifying such items as control room pressure envelope testing, or auxiliary building testing. However, in non-mandatory Appendix C, there is guidance on developing your own in-house program. N511 gives the levels of testing required and then you have to adapt it to your own facility, using your own design basis and the critical functions of your system. We identified pressure envelope testing as one of the things that should be addressed.

WEIDLER: I would like to hear some discussion from the panel regarding the benefits of Section TA and N511 versus the requirements of N509 and N510.

LEONARD: As we see it, TA and N511 will perform the same function for AG-1 systems that N510 performs for N509 systems. You have a design document, AG-1, and an acceptance test, TA, and an in-service test, N511.

BURWINKEL: A benefit of the TA section is that it addresses a large number of components of the overall systems in addition to the filter housing, as N510 tended to do just filter housing. There are sections on refrigerating equipment, there are sections on system performance, not just filtration.

PEST: I may add that when you are using N510 and N509 you are usually testing or building a flange-to-flange component, whereas Section TA, being an in-service testing document, encompasses the ancillary and working parts of the entire system, including any systems that may interact with your air conditioning unit. The advantage of N511 over N510 is that it will help when the NRC maintenance rule takes effect. Some people had thought the maintenance rule only applied to highly important systems, but we are finding out that it is not so. N510 is too restrictive, so we see that we have some room to grow with N511.

FIRST: We have heard a lot through the years about the difficulties of applying the latest versions of N510 and AG-1 to existing power plants that have Technical Specifications based on earlier documents; even in some cases predating the establishment of codes and standards. How are we going to adapt these new versions to the older plants? How are we making them user-friendly so that they can bring their testing procedures into the 1996 era from, say, 1976? This is always a matter of great concern to the users of these documents. Has some thought been given to how they will be made more adaptable than prior documents?

BURWINKEL: For years we have hidden behind the excuse that our Tech. Specs. have out-of-date parameters that conflict with the latest standards and codes. A couple of things ought to be done, first, I think it is the utilities' responsibility to modify their Tech. Specs. so that they are accurate and current. When that is done, the Tech. Specs. are usually brought up to the latest codes and standards. Second, there is an initiative for utilities to adopt improved tech. specs. that coincide with the latest codes and standards.

GRAVES: I think what Dr. First was asking was, how do you use the new documents with old equipment, and what headaches will you run into there? You will always have those headaches. Some of

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

the older equipment that was not designed to N509 requirements, and certainly not to the AG-1 code, is not easily testable in accordance with the latest versions of these documents. Careful thought is required to meet the intent, but there may be cases where you can not meet the letter of the test requirements. Tech. Spec. fixes might be helpful, but we are sometimes just stuck.

SCRIPSICK: One of the reasons I am interested in downstream sampling is that I see the uncertainty in test results from HEPA filter in-place testing as having several components. One is the air/aerosol mixing test requirement, $\pm 20\%$. Another is air flow uniformity, a third is an error associated with downstream sampling. Combine all those uncertainties and you come up with an overall uncertainty that is related to the test result, what I call testing geometry effects, poor mixing upstream or downstream and non-representative sampling. Instead of looking independently at specific criteria of $\pm 20\%$ for concentration profile, $\pm 20\%$ for air flow across the bank, and criteria for downstream distribution, why not combine them and come up with an estimate of overall uncertainty? For non-standard systems this has the benefit that should you be out of specification for one or two items, or even three, you may be within your performance acceptance limit, by an increment that is related to the uncertainty because of offsetting effects. Instead of having a test result of 0.05% for non-standard systems that determines that the system performance is acceptable, it might be 0.01 or 0.02%. By having that offset, you account for some of the differences relative to the specifications. That is a plug for my paper tomorrow, but I would appreciate any reaction on that kind of an approach.

BURWINKEL: I do not believe that we can look at the errors in the sampling procedure and the errors in the challenge agent, and balance them off. If you do not have good air/aerosol mixing you may very well not be challenging a part of the bed that is not leak-tight. When I am not challenging part of the bed, I am not getting any test agent downstream. Because of that I do not see a ready relationship to not challenging part of the bed and having fewer errors in the sample. I do not really see a relationship between the two.

GRAVES: It is clear that for the test to mean something you have got to challenge the filtration device in question. If you can't do it correctly, you need to do something about how you are testing it. You need to make corrections there.

SCRIPSICK: I agree. One of the things our analysis has brought out is that $\pm 20\%$ for air/aerosol mixing is an extremely important criterion. On the other hand, $\pm 20\%$ for air flow uniformity distribution over the bank does not seem to make much difference in our analysis. I can understand that from the error propagation analysis that we have done. I also understand it from the context that the tests are performed in. When you have a non-uniform air-flow distribution for your test, the challenge is going to be non-uniform so that contributes to the uncertainty of your test result.

GRAVES: Not necessarily. You may have a non-uniform distribution because of where you are injecting.

SCRIPSICK: No, I am referring to the air flow distribution, not the air/aerosol mixing. It is quite likely that when your test aerosol is not completely mixed you are going to have a difference between the test aerosol distribution over the bank and your air distribution over the bank. That is a serious problem. In the algorithm that we have developed, air/aerosol uniformity comes out to be extremely important. When you do a very good job on that you are going a long way in reducing the uncertainty in your test result measurement. But airflow distribution over the bank does not play as important a role.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

KOVACH, L: Please remember that we are dealing not only with particulate filters in these systems, but adsorption systems, also. In adsorption systems, $\pm 20\%$ flow does have a significant effect. Remember that these requirements are based on the MPP system tests that are in MPP-type air cleaning systems, most of which do contain adsorption units that are very strongly affected by airflow velocity and the capacity of the total test. If we are applying the requirement solely for the aerosol filtration test, your comment that the air/aerosol mixing is far more important than the airflow velocity uniformity through the HEPA filters is certainly correct. But when we are dealing with adsorption systems, airflow velocity becomes very important also.

PORCO: From what I understand your code sections address qualification testing of equipment. It also addresses initial installation testing of the equipment and in-service testing. Can we have a discussion on what are the differences and how your code sections address those differences?

KLUGE: The individual sections of AG-1 have their own requirements for factory qualification tests for individual components. What we are addressing in TA is the installed system, and the acceptance tests required to verify that it meets design requirements. N511 covers periodic retesting to verify the system continues to meet design requirements. You will find factory testing in the individual sections of the code, not within TA.

PEST: N511 will have surveillance requirements. When you do your TA acceptance testing you establish your baseline test reference values for acceptability. Requirements for a trending program are in N511 so you will be able to balance new test values against those in the past. When you have a degrading trend, you know that corrective actions have to take place. We looked at all the acceptance tests in TA and tried to include them in N511 for periodic reverification.

FRETTHOLD: Will N511 be any more user-friendly than the N510? We are being asked to comply with N510 but we are saying we use it as a guide.

KLUGE: We hope N511 will be more user-friendly. We are including guidance for development of individual test programs, adapted to facility requirements. Because we are looking at a much larger user group than just the nuclear power plants, we could not mandate a hard and fast test program that everyone must follow. It would not be practical, we would have a document that no one could use. So we addressed the types of tests that should be looked at based on the equipment you have in your own facility. And we have added guidance for developing the necessary level of testing. We are very open for further comments that can be incorporated into the document as it goes through the development stage.

WEIDLER: I would like to get to the bottom line, when these documents are issued, how do they help or change the testing program at McGuire Nuclear Station?

KLUGE: I believe that would depend on whether the individual utility changes its commitment to the new documents. It is not mandatory. I believe it would require a change to Tech. Specs., if the plant is specifically committed to testing in accordance with N509 and N510. Is that what you are asking?

WEIDLER: That is it. Given the current regulatory climate we still have to do the tests in the Tech. Specs. We would be doing additional tests unless we changed the Tech. Specs., which, as everybody knows, is a fairly lengthy and difficult process.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

KLUGE: Under the new improved Tech. Specs., the process is easier because the specific surveillance requirements have been taken out of the body of the Tech. Specs. and put under a filter ventilation test program. This would be like a basis document and it is much easier to make changes in that portion than it was in Tech. Specs. If one adopts improved Tech. Specs., it would be much easier to commit to the new documents with your own level of testing.

GHOST: One of the things that I came across while doing a life extension study was a requirement for housing leak testing every ten years. Most of the plants in the US are over ten years old. 324 Does it mean that we have to leak test all the housings?

BURWINKEL: Today, a lot of housings are pressure tested once and never again. We felt this was not adequate to assure that the housings were not leaking. At my site, it has been ten years since we have leak tested housings. We have found a few minor problems, not by testing, but by visual inspections. The subcommittee felt that a pressure test on a filter housing at ten-year intervals was not an unreasonable requirement. It would give us greater confidence that our housings were leak-tight.

GHOST: The older plants are not really set up to do housing leak testing. Is there a basis, besides experience, for ten years? Are we looking at a few plants and saying yes, we did testing on so many plants, and ten years is a realistic basis?

PEST: In other words, is it an arbitrary number that we just selected, or was there some mathematical basis?

BURWINKEL: Ten years was arrived at out of the experience of people on the subcommittee and it seems to have been accepted favorably by the people balloting.

GHOST: Is it possible to make it variable, ten to fifteen years, instead of a finite number? This is a suggestion.

GRAVES: You might prepare expansion of what you are saying and give it to this committee to look at. They will address your comment and get back to you.

GHOST: HEPA filters have a finite life, anywhere from five to fifteen years, by test. Invariably, in-place testing has shown that they are acceptable, but structurally they are weak and they can fail. Have we addressed it by requiring a visual inspection program, to say that even at fifteen years we need to do something prior to testing?

PEST: That would come under the HEPA filter section and filter qualification. If you are performing a visual inspection prior to doing a leak test and notice that the filters have been there for ten years and the glass media appears to be cracking at the base of the units because of high humidity you would want to replace them.

GHOST: That calls for an inspection on a frequency basis?

PEST: Yes, but I do not think we have anything right now that says that after testing a hundred HEPA filters we found that after five years they need to be changed even though the gasket is seal and the media is fine. One of the other committees is looking at HEPA filter aging, and something should

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

coming out about it.

GHOST: Will it be addressed in the TA section?

PEST: It would be addressed in AG-1, I believe.

KOVACH, L: I was involved in coming up with the ten year interval and the way we came up with it was that the proposal was between nine and eleven. So we hired a few statisticians and came up with a reasonable average, that is how we got to ten years. It took several years to resolve and it delayed issuance of the code for some time, but finally we were assured that ten years is reasonable. The reason for retesting housings is not because the structure itself fails, but because of door gaskets and flexible connections deteriorating. Not too long ago I had a chance to walk by a relatively new system. The housing was also used as an air organ, in various places, air was being sucked in at the doors and it was whistling different tunes. The requirement is real. Whether ten years is too long or too short, is certainly subject to question. It relates to how and how often you perform your visual inspections. I have seen systems where the latches float, instead of locking the door; they just hang in the gravity-dictated position rather than in a locked position. It is a question of how to care for the little failures; you do not have to go in for a general repair as often. Certainly 10 years is arbitrary, most requirements are arbitrary, but I believe it is quite reasonable. If anything it may be worthwhile to reduce it. If some old systems do not meet the test requirement, these old systems do not meet their purpose, either. I mean, if they are leaking air, how can we be assured that they are meeting their requirements? Let me comment also on the second question. I do not think that visual inspection alone can tell you that HEPA filters have aged to the point that structurally they may not be able to meet expected pressure, droplet, and thermal challenges. The F sections have to come up with an estimated life for a retest of media strength, etc. I think it is a weak point of the code, at the present time, and it is a weak point of a lot of HEPA filter installations, all over the world, because people assume that as long as the filter passes an in-place test it will perform its intended function in case of an accident challenge.

PORCO: I would like to comment also on the housing leakage issue, and the HEPA filter life issue. AG-1 has a requirement for environmental qualification of safety systems, and that qualification also includes environmental maintenance requirements. For instance, if you are looking at door gaskets when addressing the life of housings, you need to determine the useful environmental life of that component. Using a data base and the Ardenius equation, the gasket life can be predicted. Also, there are requirements on environmental qualification of the HEPA filters that should be addressed. The environmental conditions are going to change for each application. You must address high temperature, you must address all your environmental conditions, address all your materials, and make sure that either the materials last the life of the plant, normal maintenance life, or an environmental maintenance change-out must be established. That is in the standards now. There was environmental qualification on older plants, but possibly the environmental maintenance cycle did not get into the normal plant cycle. I am not sure, but I think that might be where you come up with the ten years. But if you are following your environmental qualification reports, you should be replacing gaskets and other materials before they wear out.

SCRIPSICK: I think the remarks about age are very important. The in-place test, as we perform it, is a snapshot. It tells you what the system is doing that day under normal conditions. It does not provide any information on how the system is going to perform when it is stressed or how it might perform under normal conditions the next day. I see two opportunities to help get some idea of the capability of the components under normal and off-normal conditions. One, is to take some of the filters we have in service

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

now, knowing their exposure histories and their service life histories, and put them back through the qualification test to see how much their performance has degraded compared to the requirements of the design qualification. That is, when you subject them to a heated air test, do they degrade more than three percent or how much is performance changed when you take them up to ten inches of differential pressure. Another opportunity is for careful interpretation of results and, maybe, modification of the tests we are doing. Bergman is going to give a paper tomorrow about the efficiency of filters in-place. I think careful examination of tests like these can provide information about the remaining structural strength of HEPA filter units. As a future development, I think we should look in that direction to garner as much information as we can from the in-place test. One end-point is to try to determine whether the bank we are testing can withstand off-normal conditions.

BATTERSBY: I have a question about retesting existing duct work that has been in service ten years or so. If you do the recommended pressure test would you be in danger of spreading contamination through any leaks that may exist from duct work up stream of the filter bank? Perhaps the retest should be done under negative pressure, rather than positive.

LEONARD: Normally, leak tests are performed on a system in the pressure mode in which they operate, a negative pressure system would be subjected to negative pressure tests. Positive pressure systems (I can't think of any that operate that way) would be the only ones that would be tested under positive pressure. It would require a careful survey by the radiation control people and the whole HVAC engineering group to verify that it would not spread contamination. One thing that the committee looked at, and the basis, I think, for the ten year test interval, was the experience of people on the committee looking at systems in the plants that have been in operation for five, ten, fifteen years. When you look at a system after five years, it does not take a rocket scientist to determine that it is not in the same condition that it was when it was installed and tested.

BERGMAN: I want to add to some comments that Ron Scripsick made about aging. Last conference, John Fretthold, Humphrey Gilbert, and I presented a paper on aging effects of HEPA filters. We searched manufacturers and facilities around the US and attempted to do an aging study. We found that, after ten years, a filter has about half the strength it had initially and it has no water repellency left, things of that nature. We found from some manufacturers basically brand new filters that had strengths that were a fraction of some of the filters that were over ten years old. Through a laboratory analysis we found out there was insufficient binder in the medium to hold the fibers together, and that these filters were practically falling apart. Instead of worrying about setting age limits, let's take a real hard look at the test standards we have. I would like to put in a plug in for Dr. Ricketts' paper, later on this week, about qualification tests. I am not an expert on QA, but to me any QA system that is based on a manufacturer hand picking the best filters to bring them to a qualification test every five years, with no checks in between, is insanity. To expect any reliability under this kind of procedure is nuts. All you have to do is refer to our paper from the last Air Cleaning Conference to see the insanity of the present qualification program.

PEST: The rest of this panel session will be on testing air and gas treatment systems. We have the floor open for questions to the panel on any of the topics of the N511 in-service testing document, and Section TA on acceptance testing, from the AG-1 Code.

How much benefit do you think a utility or a nuclear facility owner would get by moving to AG-1 and N511 as opposed to remaining with N509 and N510? I am trying to learn if there is any benefit as far as

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

clarity goes, because regulatory officials rely on the Regulatory Guide 1.52 that cites ANSI N510-1975 and N509-1976. Since 1976 there have been many changes, yet the Regulatory Guide fails to reflect them. Do you think that moving to N511 will cause the NRC to re-evaluate their position?

GRAVES: For a utility to move to any of these documents from N509 and N510 involves technical, political, and financial considerations. A lot of the N509 built equipment is already difficult to test by N510 methods and it might be that a more particular TA or N511 would cause more problems and people might resist changing. I think TA and N511 will be more particular and more helpful, but there will be less margin, less wiggle room, about what should or shouldn't be done. If the equipment is marginal, these documents are not going to be well received. But they ought to be evaluated as best for equipment. It is going to end up being a political and economic question, I think. We encourage everyone to look at these documents, because they are going to be a lot more helpful and there will be less chance to miss something important in testing and operability of equipment.

LEONARD: I think that they would be better off because they would have a better integrated package than they now have with N509 and N510. I think the package is tied together better. As Curt pointed out, they supplement one another better than N509 and N510 do now.

PEST: Does the panel think that N511 may, in the future, be expanded with an appendix to address the testing of portable filtration systems? I would like to get some guidance because there is not very much available on portable HEPA filters. Do you think some clarification should be made in N511?

KLUGE: N511 is currently set up just to look at permanently installed systems that are designed according to AG-1 requirements. It would be possible to have a non-mandatory appendix that gives guidance on testing such systems. I do not know how much demand there would be for it, or if it would be better to put out some other kind of guidance document specifically addressing those types of systems.

GRAVES: In the absence of a well-designed fabrication document for that equipment, folks could probably use some guidance. Hard and fast testing requirements are not going to help the manufacturers of portables and vacuum cleaners because there is such a variety of equipment out there. Some suggestions might be in order, but hard and fast rules are going to be a problem for them.

KRANZ: I am going to change gears here and start talking about adsorber testing, in-place leak testing. As of January 1, 1997 Freon will not be allowed into our facility. My question to the panel and the audience is, what challenge gases are people using now? What challenge gases are people looking to use? I did not notice in N511 specific challenge gases mentioned. Did I miss it?

PEST: I believe it is in there.

KLUGE: There is an appendix in both TA and N511 which spells out the critical characteristics that have to be met for an alternative challenge agent. But no specific agents are mentioned by name in those documents.

KRANZ: What are people using or looking at using? We are between a rock and a hard place if our facilities are not going to allow us R11 in 1997. The bottom line is, if we use a different challenge gas, will the tests be accepted by the NRC?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

GRAVES: Some people are using HCFC123. At the last Air Cleaning Conference, Bela Kovach, of our organization, gave a paper on it. Some are using a compound called 1-Bromo butane. I do not know if it will be widely accepted in the nuclear business, but HCFC123 looks like a good candidate that meets the list of criteria in appendix TA-C. It is always risky to speak for the NRC (there are representatives here who can do that) but my understanding is that when the industry standards people recognize a compound, it is acceptable as far as the NRC is concerned. When N510 is the required, or appropriate, standard, whatever N510 says is okay with the NRC.

LEONARD: The appendix that is in TA and N511 was the basis for a code question response on N510. So it is applicable to N510, also.

HAYES: The guide for any facility is their technical specifications. If you have a problem you need to request a Tech. Spec. change and give the basis for the change. As many of you know, we had a problem with verbatim compliance with the test methods for laboratory testing of charcoal. So it is imperative that we determine what your technical specifications say. If they require you to test a particular way and there is no flexibility, then you need a technical specification change.

FIRST: Further to this same discussion, I am a member of the committee and urged that certain compounds be named as those that have been found acceptable, without indicating that they are the only ones that could be used. Certainly, the criteria that have been published clearly define the characteristics. But few people are able to make this judgement on their own or have the facilities to do so. It seems to me that the standard should provide some guidance in terms of acceptable compounds as examples of what will work. I hope that change can be made, because I, among others, get calls from people wanting to know what is a representative compound that they can use. I do not see why we make a mystery out of it. I want to ask the panel a question. We hear a great deal about international standards and how the international standards organization operates. Having documents approved as international standards is often discussed by code and standard writing committees. Variations of our codes and standards have been adopted by other countries. How can we go about making U.S. standards international standards? And is this highly desirable?

WEIDLER: It is my understanding from ASME that if it can be shown that our standard is being used in countries other than the United States, they are designated international standards. ASME itself is now called ASME International and their boiler code is used in countries other than the US.

PORCO: The code section you have prepared addresses primarily systems for commercial nuclear power plants. Did you take into consideration other systems used at DOE sites and military installations, and can they be easily adapted for those systems?

LEONARD: Insofar as we had input from those sites, we did try to make the document broad enough to cover them. We have representation from DOE on the testing subgroup and subcommittee. We hope we have managed it.

PEST: Yes, we do try to make the code and standard all-inclusive and not be tied down to a specific function.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

SCRIPSICK: I have just tracked the history of these standards for my office. The '75, '76 and '80 versions of N509 and N510 were for "nuclear facilities." There was a change in '89, they were now for "nuclear power facilities." This was a change in scope. Now, I am not certain what AG-1 says. It looks like it has been broadened to include all nuclear facilities.

PEST: That is true. There has been some switching around of names, and we try to emphasize that the documents can go across barriers. It might even work out that they can be used in the general commercial area, not just nuclear facilities.

KLUGE: I would like to add that the current scope statement for both Section TA and N511 refers to nuclear facilities, and not specifically to nuclear power facilities.

SCRIPSICK: The speaker was very careful to point out that TA is a code and N511 is a standard. The difference is that one is for acceptance testing, and the other for in-service testing. Why is in-service testing a standard? Is a standard a lesser requirement than a code, or a law? Why was the distinction made?

PEST: When we took all the in-service testing material out of Section TA, and began composing N511, the first thing that we did was to change all the "shall"s that we could, and make them "should"s since a standard is better cast in a more generic overview of what is going on. However, you have to remember that it is the facility's design basis that really dictates what you have to do in the testing. Technical Specifications are spelled out.

KLUGE: The original draft of Section TA addressed both acceptance testing and in-service testing. However when that got up to the level of the BNCS we had to separate acceptance testing from surveillance testing. I do not know what was involved behind it, but that is where the split took place.

GRAVES: Part of the requirement was to make the documents more user-friendly. A document covering both was very confusing. This makes it much simpler.

PEST: I do not know whether I agree. I think Section TA could have handled both rather than make a whole new document. But I am glad that we didn't have to undertake a massive reconstruction of N510.

WEIDLER: One of the driving forces behind the Board's decision to split TA into two documents is that in-service testing is in one section of the code and acceptance testing is in another. In order to follow the format guidelines that ASME has adopted for the overall code, we had to split the TA draft into two different documents.

GHOSH: In the last sentence of section 8.10 in N511 it says that the integrated system test should be once every two years. Under the sub-heading you have air system flow balance verification tests. Is it implied that the flow balance is being tested every two years?

KLUGE: We have had some heated discussions at the committee level on that particular subject. The document will not require a full-blown air balance, such as would be done at start-up. Guidance will be developed that will allow the user to verify system balance by looking at the end functions. For example, if temperature is the critical function, temperature surveys will serve to verify a balanced

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

condition. If pressure is the critical function, non-ducted airflow testing could be utilized. Guidance will be provided, and there will not be a requirement for a full re-balancing of the system.

GHOSH: Will that section be expanded?

KLUGE: That section will be revised, and there will probably be a non-mandatory appendix that will give detailed guidance.

DEVENA: Section 8.6 of N511 covers hydraulics. This is in somewhat the same light as the previous question, are we looking at a complete flow balance of the water systems? To what depth do we go with that? Originally, the whole system was aligned and balanced in the emergency flow mode, quite exhausting and quite extensive. I am not sure that you could come up with the same type of conditions by looking at individual components within the water system. If this is going to be a requirement, I think it goes far beyond just a component that will be looking at water balance. It is like a whole ESW system. You change the flow one place and you might not be able to get it at the other place unless it is lined up like it normally is for the emergency flow condition.

KLUGE: I think we will need additional guidance on the level of hydraulic balance within the document. The bottom line is, can you meet your design basis for heat rejection? If you are never doing any kind of verification of what your flows are, there has to be some kind of test data you can look at to see if you can meet your design basis. Also in Table 8-5, there is a two-year requirement for a cooling coil performance test. I believe the two years came from a recommendation by the maintenance rule that everything seems to go on a twenty-four month cycle. The maintenance rule that became law on the 9th of July will directly affect this type of testing. That is where the twenty-four month recommendation came from.

KRANZ: Did you say N509 and N510 are going to be reissued?

PEST: They have been reaffirmed.

PORCO: ASME N510 has been reaffirmed. When you receive your copy from ASME it will have the reaffirmation sticker. N509 has not been formally issued as reaffirmed, but it will be shortly.

SCRIPSICK: What is the distinction in TA and N511 about test requirements being observed or measured? What is the distinction? Maybe it is defined in sections of AG-1. Why is the acceptance test for HEPA filters a measurement requirement, whereas the in-service test is an observation requirement with a two-year period?

KLUGE: You made a good catch, that is a measured requirement.

SCRIPSICK: So there is a mistake in Table 8-6?

KLUGE: Yes.

SCRIPSICK: What is the distinction between measured and observed? I do not understand how they contrast.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

KLUGE: The distinction between observed and measured is that a visual inspection is observed whereas anything that has a definite acceptance value would be a measured test.

GHOST: Previously, the requirement for personnel qualification was to be certified according to ANSI 45.2. Now you have NQA-1 and ANS standard 93.1. Is there a reason for not including 45.2?

KLUGE: The qualification criteria in this section came directly from section AA of the AG-1 code.

PEST: ANSI 45.2 is an old document, I am not sure it is still valid.

KLUGE: The specific wording is from Section AA 7220 regarding personnel qualifications. It states that all personnel performing on-site inspections and testing of AG-1 equipment shall be qualified in accordance with ANSI-ASME NQA1-1, supplements 2S-1 and 2S-2. So we just brought down the personnel qualification requirements from the code.

PEST: Is NQA-1 as stringent as N45.2?

GRAVES: I think they are about the same.

ORZECHOWSKI: Your scope is changed to include all nuclear facilities. What is your definition of nuclear facilities?

GRAVES: I think we mean any place that has fissionable material. We define nuclear facility as any facility that operates under radiological conditions. I imagine that would encompass just about all facilities that are licensed. We mean this for nuclear power plants, plutonium facilities, waste handling facilities, or any facility like that has air cleaning equipment, or the need for air cleaning equipment. We hope the standard will address the kinds of needs they all have. I do not know what guidance BNCS or ASME gave on this, so we may have weasel-worded it a little bit by using the term nuclear facility.

ORZECHOWSKI: I am working at the Nordion facility where we produce radio isotopes using an accelerator. Are we a nuclear facility? What do we base this on, how can we define ourselves? Going even further, I can ask whether nuclear medicine departments in hospitals are nuclear facilities. Now you are shifting from a very specific application to power plants to all nuclear facilities. There has to be some definition of what is covered. I do not know that such a definition exists. If you rely on the issuance of a license, hospitals have a license, but are they nuclear facilities? I do not know.

GRAVES: That is a good point. You could say, yes, they are, because they are regulated by NRC and follow other requirements. They would be welcome to use this document. It might not do them much good because they may be covered elsewhere. The regulating bodies may dictate to them something that precludes their use of the AG-1 code. But there is no reason why, for any given application, the AG-1 code could not be used. There is nothing to rule it out as applicable to that kind of facility. If there is a chance of airborne contamination, this code would apply, or it could apply.

PYLE: What is the intention for the air/aerosol mixing test procedure when you have a small facility where you might have a single HEPA filter as a HEPA filter bank? Would it be applied to a single

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

GRAVES: I am on the ventilation air cleaning committee, and may disagree with others. I think there should be some evaluation of air/aerosol uniformity, even for a single HEPA filter. That is an opinion that may not reflect what the TA group would say.

LEONARD: In a change from N510, where single HEPA filter systems are exempt, the exemption has been taken away in TA and N511.

PYLE: Therefore, you are saying it would apply?

PEST: You would have to make an air/aerosol mixing uniformity test for a single HEPA filter. Due to system configuration, the distribution may not be uniform and that would necessitate performing the test.

PYLE: Self-contained units would probably fail this test. Is this correct?

LEONARD: Yes, they almost surely will fail.

ANON: There is action in the committees to designate another category for this type of filter. And removing the exemption in N510 makes it necessary to address this issue. I think we are going to let the filter committee see if it warrants bringing out a new classification of filters.

SCRIPSICK: I agree with Curt Graves that there should be testing requirements for acceptance of single-filter systems. Some are being accepted by exemption because the procedures for air/aerosol mixing and for air flow distribution for filter banks at the center of each filter requires a measurement. Therefore, when you have only one filter you just take one measurement, even though that procedure does not apply. If we eliminate the single-filter exemption, we will have to make allowances in the procedure. I propose that we look at it.

BURWINKEL: Currently TA has a requirement for a minimum of nine readings, with the exemption for testing a single filter removed. It would require you to take nine readings in front of a single filter.

LEONARD: That is in mandatory Appendix 4, Section 4-4000.

DEVENA: Prior in-service testing documents contain a distinction between air cleaning equipment totally contained inside a containment, where it does not exhaust to the atmosphere. Does this new document allow the same exemption for filtration systems inside containment?

PEST: You mean, exempt from in-place testing?

DEVENA: Yes.

GRAVES: Are you talking about a Tech. Spec. issue? If your Tech. Spec. does not require it, you do not need to do it. These documents are not intended to supersede your Tech. Specs., just help to test, design, and manufacture equipment. If you are not required in your Tech. Spec. to test them, you could still use this document, but you might use it in a somewhat different way, and you might establish acceptance criteria that would be a little bit different.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DEVENA: Our Tech. Specs. presently reference R.G.1.52, which references the two ANSI standards where you get the exemption on units that are totally enclosed inside the containment. It is not specifically the Tech. Spec. that addresses it, it refers to it by reference. The same exemption is not referenced in the new documents.

BURWINKEL: If your system is entirely inside a containment, is it safety related?

DEVENA: No.

BURWINKEL: These documents refer to safety-related systems. Because we did not find any examples where there was a safety-related system fully contained inside containment, we did not see any reason to carry that provision forward.

KLUGE: In Table 8-7, in the current version of N511, there is the caveat that in-place leak tests are not required for systems used for 100% re-circulation. An example is a reactor containment clean-up system. That is why the exemption is in N511.

GRAVES: N511 is directed to once-through types of equipment.

KLUGE: I would like to encourage everyone to take home the copy of the N511 document, read it over, and provide us with feedback so we can make it an industry-useful document.

GRAVES: Does TA go back to the Main Committee after addressing negatives?

PEST: Yes. Section TA will be ready to go to the Main Committee by August 2. We are looking to October to get the results. If the Main Committee approves, it will go to the BNCS. I do not know how long the BNCS usually takes to make a decision. Last time it was pretty fast.

This Panel Session was an opportunity for our Committee to let you have a look at these documents. We got some very interesting comments and questions which we appreciate. We are looking for your support and contributions to make these documents user-friendly and to provide the help you and your neighbors need.

SESSION 5

WORKING LUNCH

Tuesday July 16, 1996

Co-Chairmen: M.W. First
J.L. Kovach

Invited Speaker: **John D. Wagoner**, Manager
Department of Energy, Richland

PROGRESS AND CHALLENGES IN CLEANING UP HANFORD

J.D. Wagoner

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE


INTRODUCTION

FIRST: On my extreme left is Lou Kovach of NUCON International. You have heard from him previously during this conference, I think most of you know him. I mentioned yesterday morning that he has been very intensively involved in certain of Hanford's innovative operations. Because he has been so intimately involved in Hanford for the past couple of years, I thought it would be appropriate if he would introduce our luncheon speaker.

KOVACH, L: Ladies and gentlemen, I have a Department of Energy biography on John Wagoner, but I would like to start off by ignoring it for a minute and just tell you that I have seen John facing pronuclear civilians, antinuclear civilians, Native American tribe representatives, and then some people even worse, technical staff at Hanford, some of the contractors, National Laboratory representatives, headquarters people, and common folks like us. And there were always a lot of people who were trying to complain about something that the Department of Energy was doing at Hanford. And he always managed very graciously to field the questions and not get mad. And, really, what I admire about him the most is keeping cool in talking about things that sometimes are totally off the wall, and sometimes highly technical. And I know that I could not do that. I'm sure most of you are aware of my temperament. But John has been manager of the US Department of Energy's Richland Operations Office since July of 1990. He is responsible for the Department's mission at the 560 square mile Hanford Site reservation. The Hanford mission is to clean up the environmental legacy from the defense production of the cold and the warm wars of the past. He has worked on many different activities, starting with the Schenectady Naval Reactor's Office through various projects at Oak Ridge. At one time, it looked like, he had managed to escape the nuclear business for a while, and he was project manager for the strategic petroleum reserve. I am sure, John, you think back to those days as more peaceful than some of the nuclear activities. He was deputy manager of the Savannah River Operations Office and worked in the US Navy supply corps. Again, I am not sure if he is happy that he made the decision, but he resigned his lieutenant commander's commission in '71 to accept a civilian appointment at the AEC. In 1983 John got the Secretary of Energy's meritorious service award, and received superior performance awards from the Secretary of Energy in 1990 and 1991. He is from my neighbor state, (not from Serbia or Austria), Indiana and is a good boilermaker from Purdue University. It is a pleasure for me to introduce John D. Wagoner.


WAGONER: Thank you very much. This is a special privilege for me. This is the first Nuclear Air Cleaning Conference I have ever addressed. My talk will not be about nuclear air cleaning, but maybe you will see some parallels and some areas of interest, as we go talk about what I like to talk about, which is the Hanford Project, or Project Hanford, as we are now calling it. The talk that I'll give today will try to get across a few simple key points. I will describe, of course, what the job is that we are doing at Hanford. And those of you who are working there either all the time or part of the time, I hope you will bear with me if it is redundant with what you already know. The message that I want to get across about that is that the job is getting done. One of the other important parts of it is most of it, I believe, will be complete within ten years. And in order to complete that ten-year vision, we have an awful lot of very difficult problems to resolve. I am sure that a number of you can contribute to doing that. So we'll start with the next slide to try to put things in perspective. I understand that a few of you have signed up for a Hanford site tour, I certainly encourage you to do that. One of the things I believe we have been able to do to better communicate with the public is to make the site accessible.

**24th DOE/NRC Nuclear Air Cleaning
and Treatment Conference**

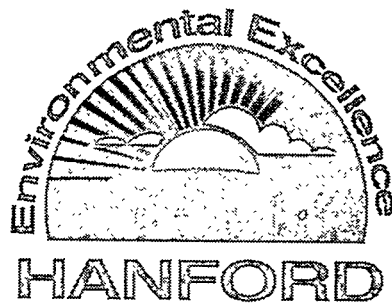


John D. Wagoner, Manager
Richland Operations Office
U.S. Department of Energy


July 16, 1996

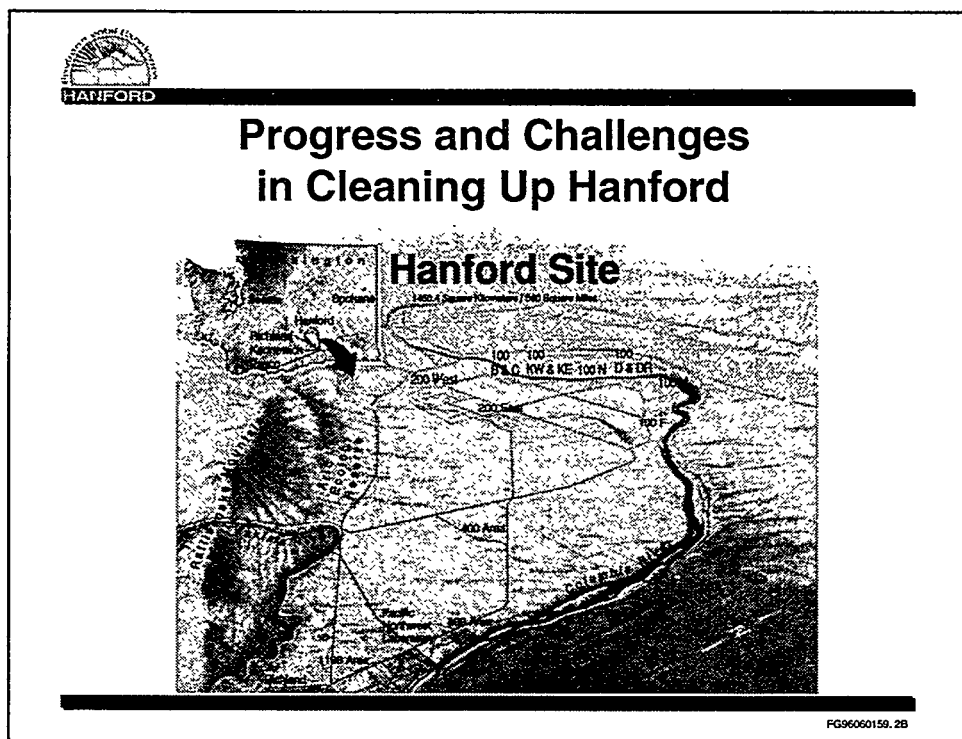

Hanford was established in secrecy during the Second World War to produce plutonium for America's nuclear weapons. Peak production years were reached in the 1960's when 9 production reactors were in operation at the Site. All weapons material production was halted in the late 1980s and the Site is now engaged in the world's largest environmental cleanup project.

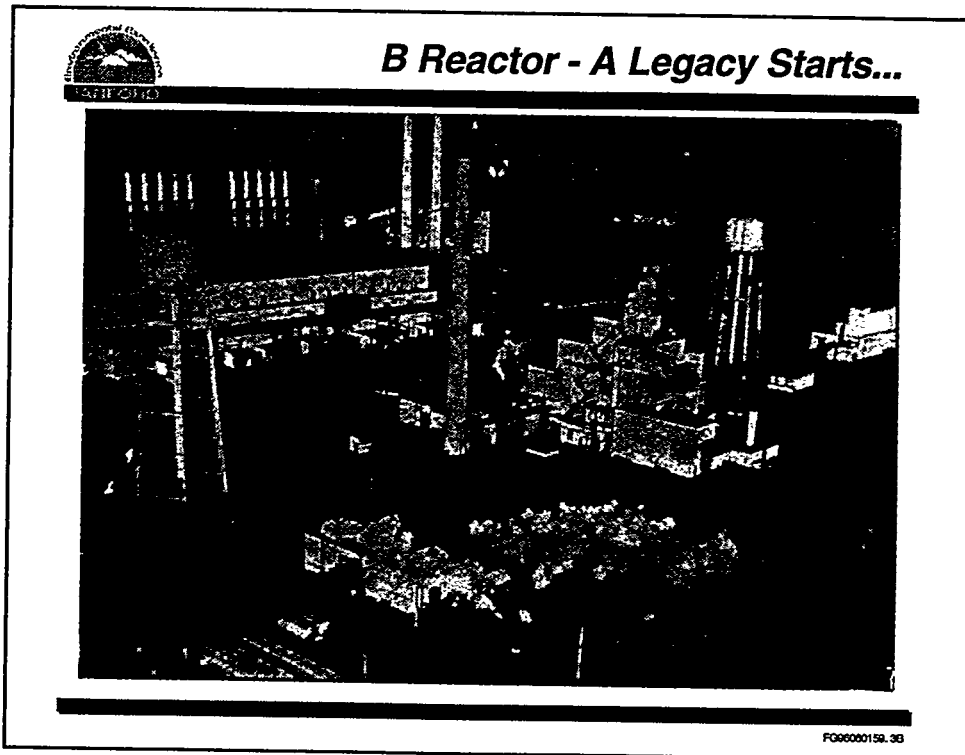


The famous 'B' Reactor along the Columbia River on the Hanford site where plutonium was produced for the Atomic bomb dropped on Nagasaki, Japan. The world's first nuclear reactor, it was constructed and operational within 14 months in 1944.

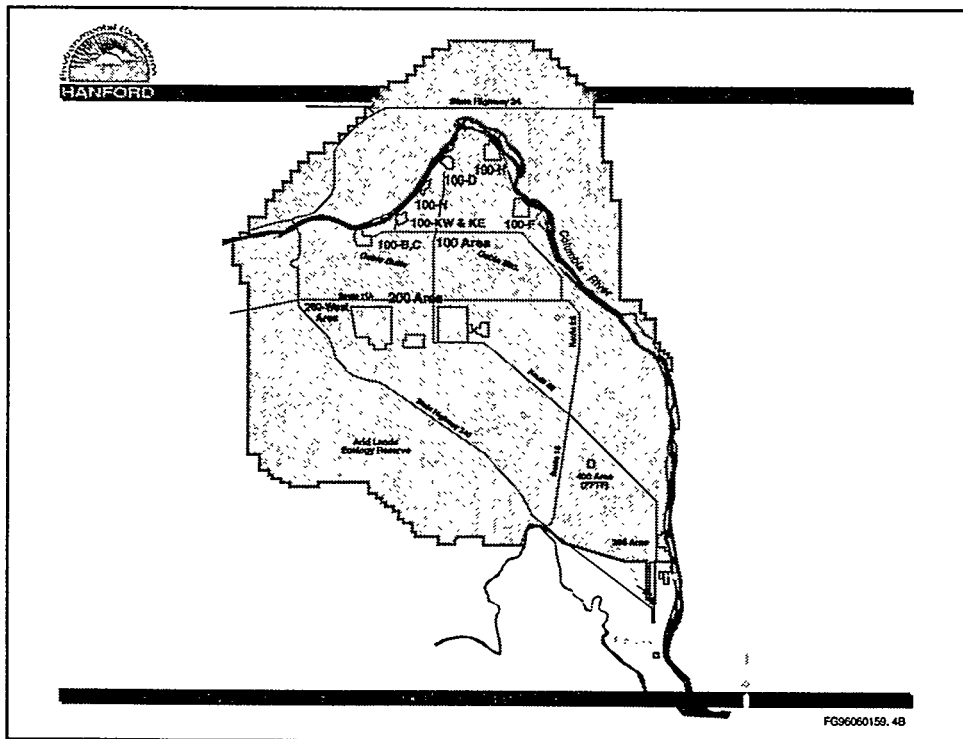

Approximately half the size of the state of Rhode Island, the 560 square mile Hanford Nuclear Reservation played a key role in bringing World War II to a close. In decades to follow through 1989, during the Cold War, Hanford produced most of the nation's plutonium for defense purposes. The year 1989 marked a turning point in the Hanford's mission from defense production to environmental cleanup.

The image shows a logo for the U.S. Department of Energy Richland Operations Office. At the top left is a circular seal with the word "HANFORD" below it. The main title "U.S. Department of Energy Richland Operations Office" is centered in a large box. Below this, the organizational structure is shown in three columns. The left column is headed "(Site Management & Transition)" and lists "Westinghouse Hanford Company" with sub-contractors "ICF Kaiser Hanford Company" and "BCS Richland, Inc.". The right column is headed "(Environmental Restoration)" and lists "Bechtel Hanford, Inc.". A central black box separates the two columns. At the bottom right of the slide is the code "FG96060159.58".

Today our cleanup challenge is managed by Westinghouse Hanford Corporation and its subcontractors. A site wide environmental restoration project is managed separately by Bechtel Hanford, Inc. Supporting both Westinghouse and Bechtel, as well as DOE nationwide programs, is the Pacific Northwest National Laboratory with scientific research and technology development.




Progress...

Our Priorities...

- **Urgent Risks**
 - ◆ Tanks
 - ◆ Spent Fuel
 - ◆ Plutonium
- **Mortgages**
 - ◆ PUXEX
 - ◆ B-Plant / WESF
 - ◆ FFTF
- **Waste Management**
- **Environmental Restoration**

FG06060159, 6B


The U.S. Department of Energy and its contractors have tackled the environmental cleanup challenge within the framework of set priorities.


Progress...Urgent Risks

Tanks

177 Underground Waste Tanks


- ◆ 55 MGals High Level Waste
- ◆ 67 Single Shell Tanks Leaked or Suspect
- ◆ Cross Site Transfer Line (West Tanks to East Tanks)
 - + Remove Liquids From Single Shell Tanks
 - + Consolidate Waste For Vitrification
- ◆ Evaporator Campaigns Reduced Waste by 8 1/2 MGals
- ◆ Award Contracts for Treatment of Tank Waste (Vitrification)

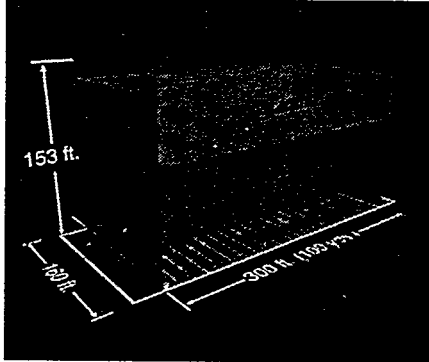

FG96060150.7B

Formidable challenges in our underground waste storage tanks cleanup effort are being met with innovative approaches and technology. With the construction of a cross-site transfer line we will be able to remove liquids from tanks known to leak to more reliable double-shell tanks.


Additionally, our 'Evaporator Campaigns' have freed-up additional space to receive waste, thereby saving \$600 million in otherwise needed new tank construction. Since 1994 eight million gallons of liquids have been evaporated.


Progress...Urgent Risks

Spent Nuclear Fuel

An Urgent Risk on the Columbia River

- ◆ Fuel Corrosion Continues
- ◆ K Basins 20 Beyond Design Life (recent leakage in 1993)
- ◆ Seismic barriers in Place
 - + Mitigate Leakage
- ◆ Canister Storage Building Design Complete
 - + Construction Started
 - + Fuel Transfer 12/97

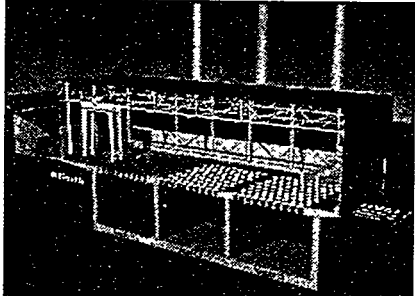


2,100 MT/53.8 MCI
105,000 Elements

FG96060159, 88

Based in part on advice from our stakeholders, we have identified spent fuel stored in basins near the Columbia River as a priority project to reduce urgent risks at Hanford. The basins in which the 2100 tons of spent fuel reside are 20 beyond their design life and one has a history of leakage of some 15 million gallons.


In a very creative way DOE and its contractors have come up with an accelerated plan to remove the spent fuel from the basins and place it in dry storage on the central plateau. One creative way we were able to speed up the project was by using an existing foundation for a cancelled project for the new Canister Storage Building needed to house the spent fuel rods when they are removed from the basins.

Meanwhile we have mitigated the leakage problem with the installation of seismic barriers.

 *Progress...Urgent Risks*

Plutonium Finishing Plant


- ◆ 3.9 Metric Tons of 11 Tons Site Total
- ◆ Completed Stabilization EIS
- ◆ Issued Record of Decision
- ◆ Developed Solutions Stabilization Process
- ◆ Complete Stabilization of All Other High-Risk Materials

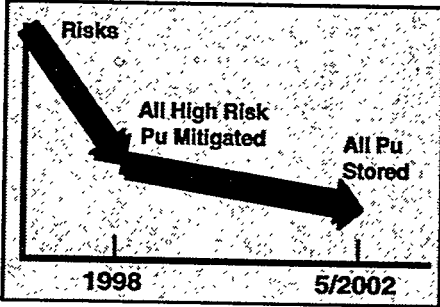

FG96000150, 98

We have made significant progress in deactivating this facility. We have completed the plutonium stabilization EIS, issued a Record of Decision, and began a stabilization campaign for all high-risk materials in the facility which will stabilize liquids in FY98 and all material by 2002.


This puts us in a position to mitigate plutonium risks at PFP in 1998 and have all plutonium stored by 2002.


Progress...Mortgages

PUREX


Plutonium URanium EXtraction

- ◆ Major hazards disposition/stabilization
 - + Pu/U solutions (6,000 Gals)
 - + Organic solvents (21,000 Gals.)
 - + Nitric acid (187,000 Gals.)
 - + Residual Pu Qxides (Glove Box)

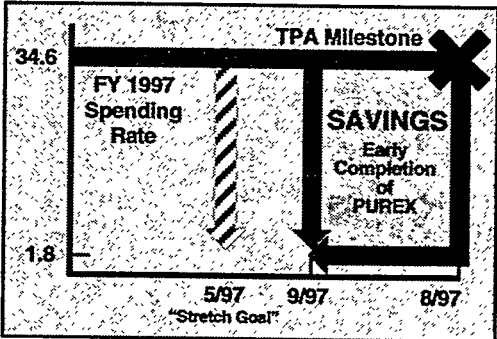


FG96000159.100

At PUREX we have successfully removed major hazards from the facility in preparation for proceeding with final decontamination and decommissioning. Among the materials dispositioned are: 6,000 gallons of plutonium/uranium solutions; 21,000 gallons of organic solvents, 187,000 gallons of slightly contaminated nitric acid; and residual plutonium oxides from glove boxes.

 *Progress...Mortgages*

B-Plant / WESF (*Waste Encapsulation Storage Facility*)

- ◆ Retrieve remaining Cesium from Private Facilities
- ◆ Plan for FY 1998 B-Plant Deactivation "Breakthrough"




B-Plant 1 MCi
WESF Capsules 149 MCi

FG96060159, 11B

We successfully recovered 25 cesium capsules from a commercial facility in Virginia thus completing the recall of more than 700 capsules which had been leased to commercial companies.


Work on decoupling WESF and B-Plant continued at an aggressive pace and we are poised for a "breakthrough" in B-Plant Deactivation in FY 1998.


Progress...Mortgages

FFTF


Fast Flux Test Facility

- ◆ **Transition: Operational to Safe Shut Down Condition**
 - ✦ 375 Fuel Rod Assemblies
 - ✦ 260,000 gallons of liquid sodium (coolant)
- ◆ **63 Fuel Assemblies processed to Interim Dry Storage (Complete in 2001)**
- ◆ **Preparing Sodium Storage Facility (4 Tanks) - October '96**

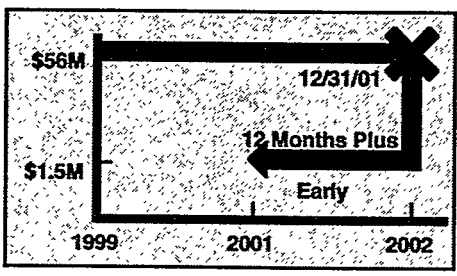


FG96060159, 12B

The FFTF continues to be transitioned to a safe shutdown condition in preparation for final decommissioning and decontamination. Work that is not irreversible, such as fuel washing, continues as we await the Secretary of Energy's decision as to whether or not FFTF will be considered as a tritium producer.

 **Progress...Waste Management**

Waste Management

- ◆ **Billions of Liters Untreated Liquid Wastes to Soil (Over 45 Yrs - 200 sq.mi. contaminated groundwater)**
- ◆ **300 Area Treated Effluent Disposal Facility (TEDF)**
 - + Discharge clean water to Columbia River (Standard 1000 times more stringent than City's)
- ◆ **200 Area Effluent Treatment Facility**
 - + National Pollution Discharge Permit (ID'd as one of nation's most stringent)
- ◆ **Ceased discharge of all liquid effluents to groundwater - 6/95**

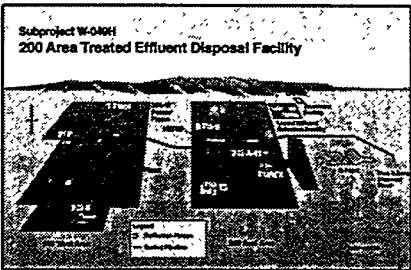

Subproject W-0406
200 Area Treated Effluent Disposal Facility


FG96060159, 139

Exceptional progress has been achieved in the treatment of liquid effluents at Hanford. We brought on line the 300 Area Treated Effluent Disposal Facility and 200 Area Effluent Treatment Facility.


We ceased all unpermitted discharge of effluents to groundwater in June, 1995.

Our discharges to the Columbia River from the 300 Area meet standards 1,000 times more stringent than city requirements.


Our National Pollution Discharge Permit is one of the most stringent in the nation.

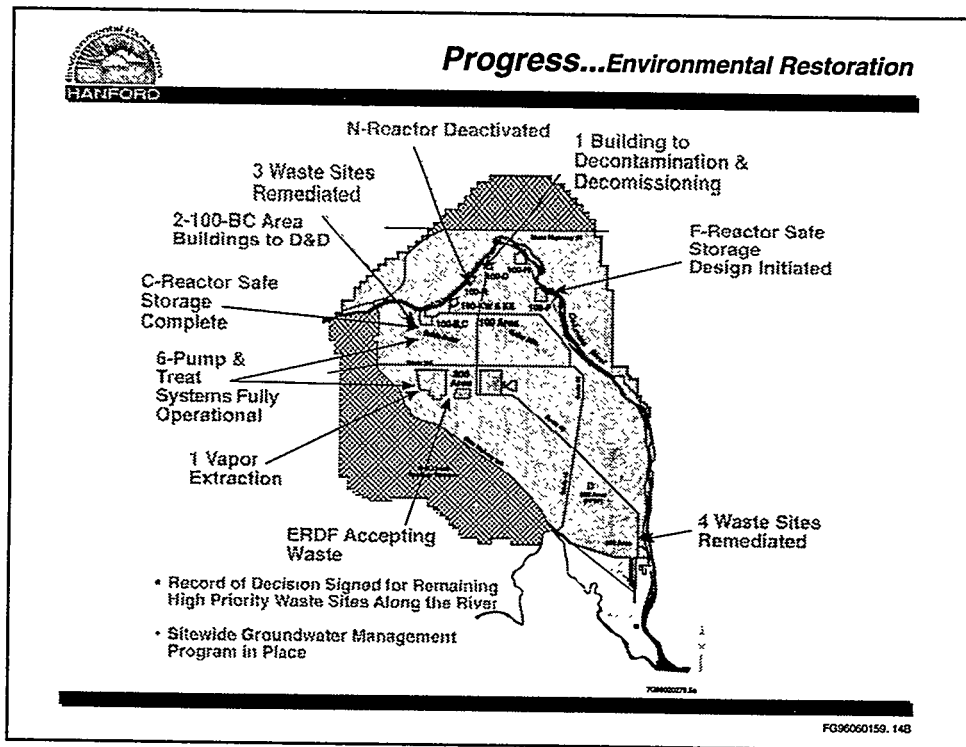


BHI, our Environmental Restoration contractor, is responsible for cleanup of groundwater, contaminated soils, and inactive nuclear facilities. A major focus of the ER program is protecting the Columbia River by cleaning up contamination along a 20-mile stretch of land along the river where nine nuclear reactors are located.

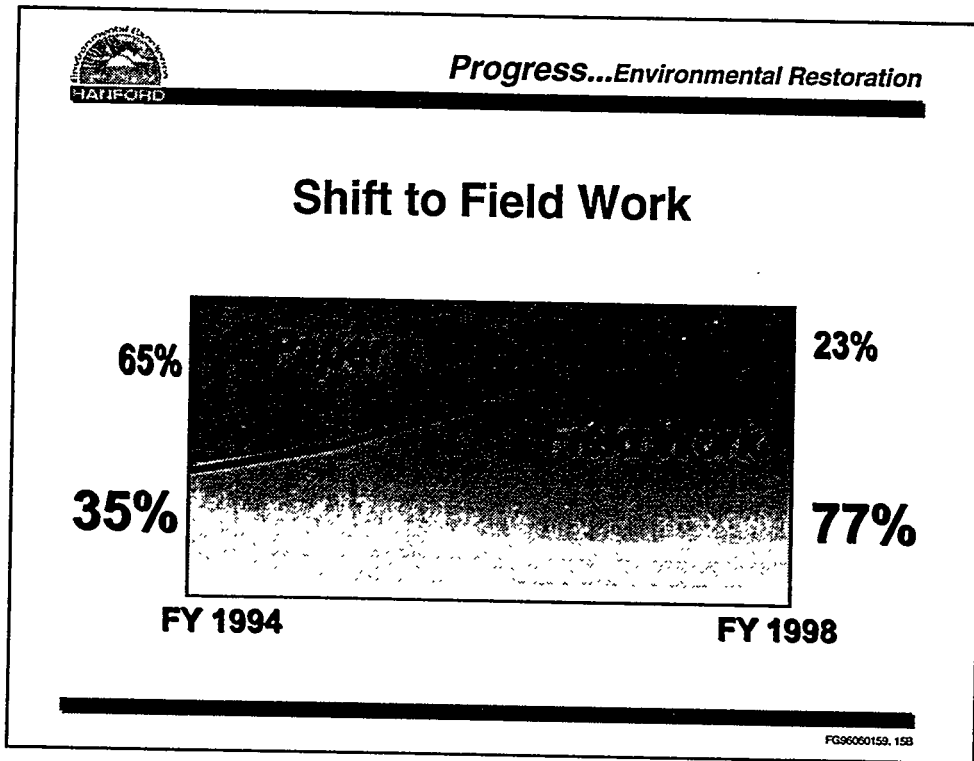

Since the start of ER cleanup activities in July, 1994, cleanup dollars expenditures have shifted from 65% paperwork to 77% actual field work.

 **Progress...Environmental Restoration**


Waste Sites Remediated

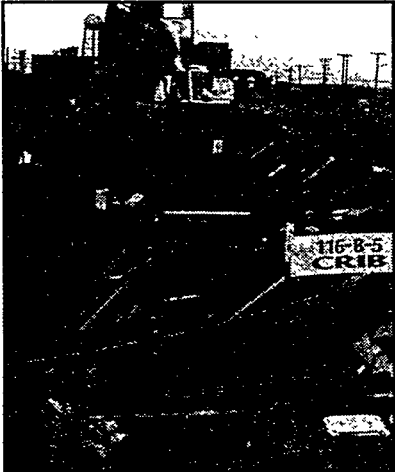


■ FY 1997	- 10
■ FY 1998	- 12
	<hr/>
	22

FG96060159.168


And with more dollars spent on cleanup, we see an increase in progress of actual waste sites remediated. Uncovered cribs and trenches and other waste sites along the Columbia River have produced 37,000 tons of contaminated soils and materials.

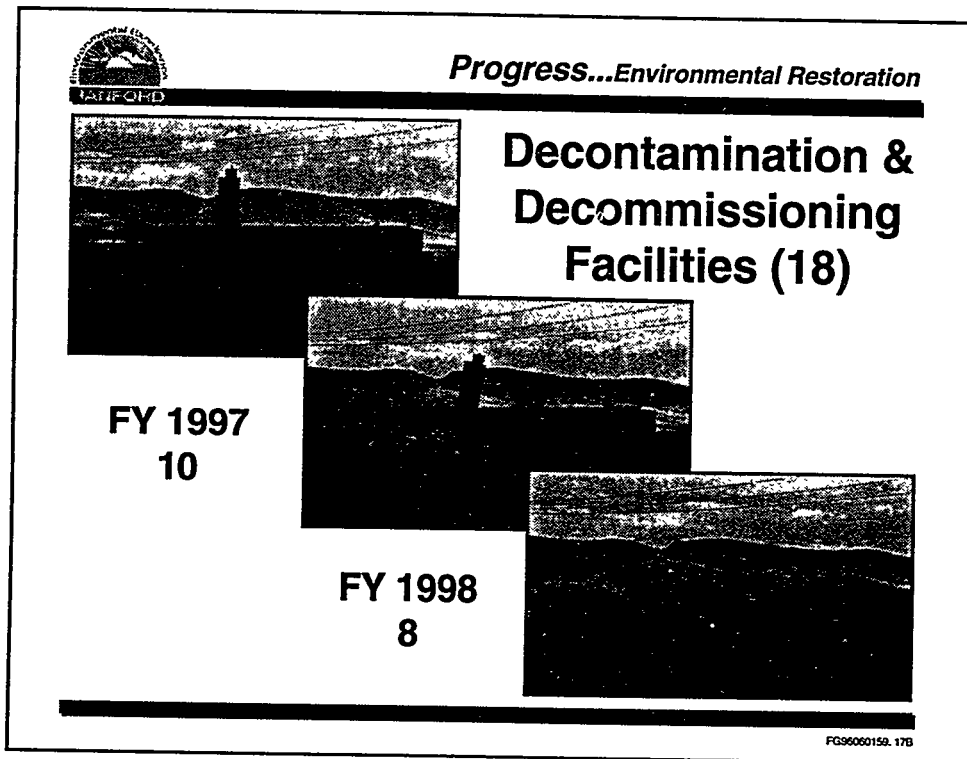


Removing Hanford's aging surplus nuclear facilities is the ultimate goal of the D & D program. Here we see the demolition of the 190-D Pump House remaining framework after decontamination.

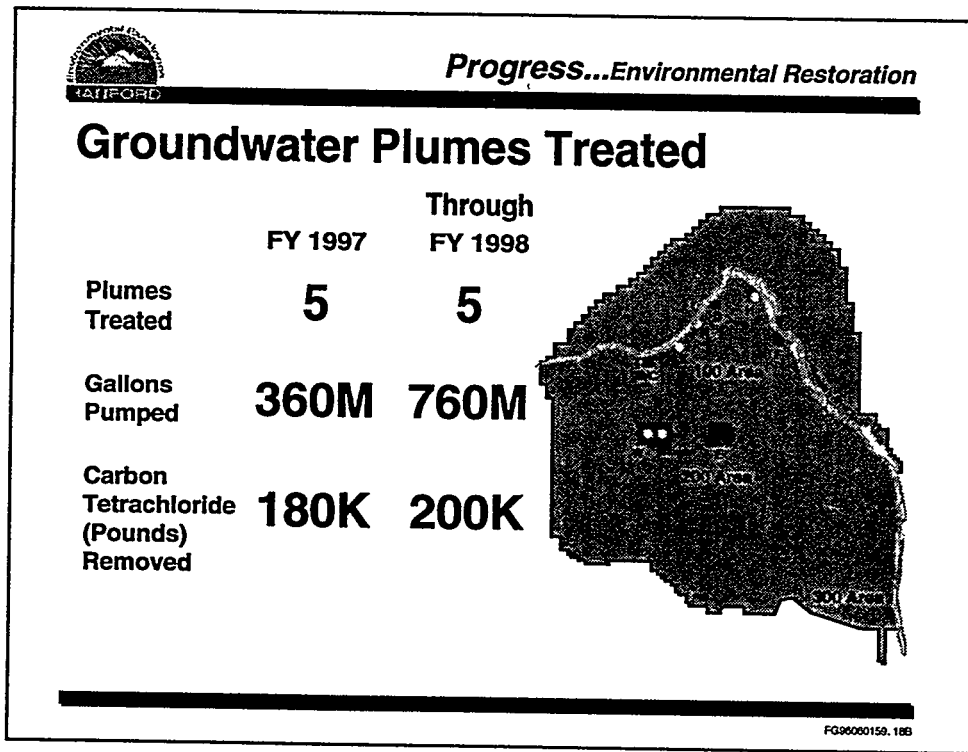

Containing and preventing the spread of contaminated groundwater, while removing contaminants from aquifers, are major objectives of the ER Groundwater Remediation project. In 1996 the project pumped and treated 83 million gallons of groundwater and removed 159,000 lbs. Of carbon tetrachloride by vapor extraction.

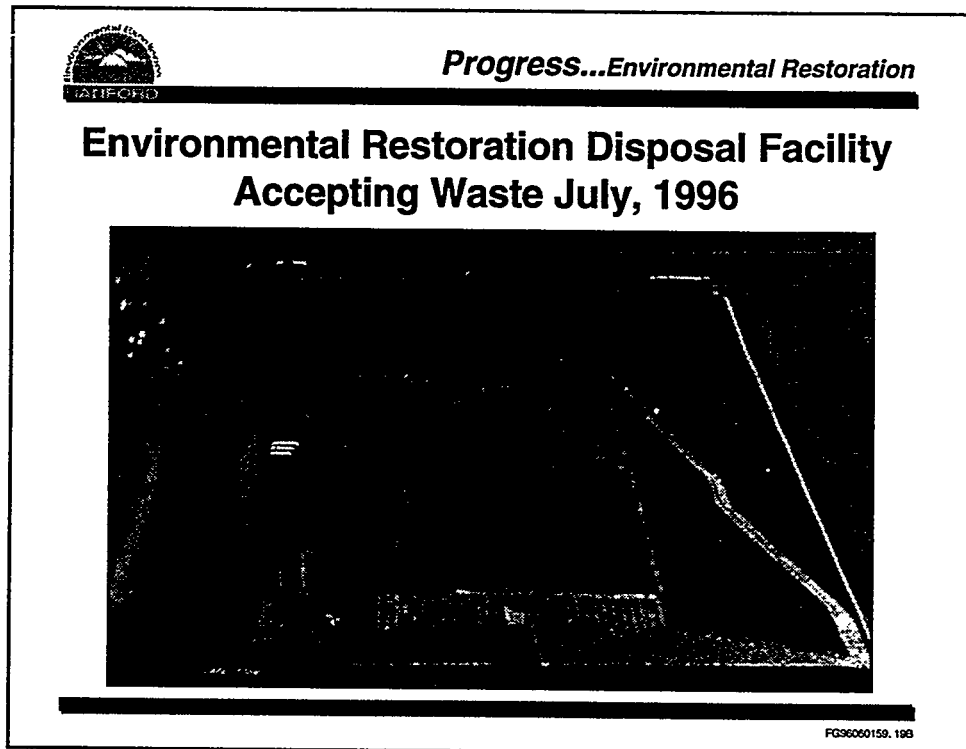


Designed to receive low level waste from site cleanup projects, ERDF is operating 3 months ahead of schedule and roughly \$80 million under budget. These first two `cells' of a possible 12 can safely hold 1.2 million cubic yards of material, equivalent in size to 95 Goodyear blimps.

 *Progress...Environmental Restoration*

N Reactor Deactivated FY 1997

- 67 ancillary facilities also deactivated
- N Basin cleaned

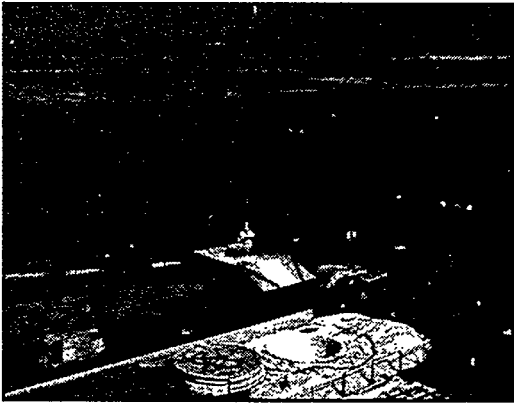

FG9600159.203


Deactivation of the 'N' Reactor and its supporting facilities is in the DOE spotlight. This effort presents a challenge as to how similar work will be conducted at other DOE weapons sites.



Progress...Environmental Restoration


C Reactor Safe Interim Storage FY 1998

- Long Term Safe Storage
 - ◆ Low Risk
 - ◆ No Maintenance
- Demonstration Platform for Technology Transfer

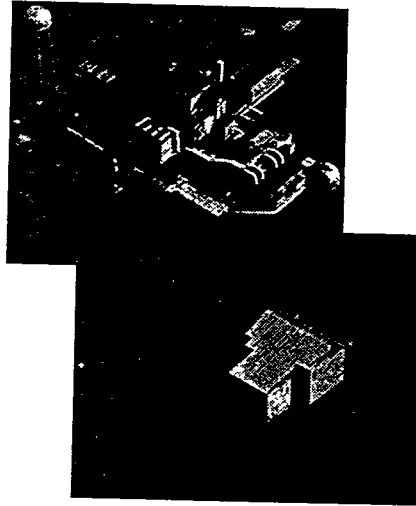

FG96000159, 21B

Placing the 'C' Reactor's core in an Interim Safe Storage mode for up to 75 years, pending final disposition, is a DOE pilot project that will demonstrate 19 technologies in the process. The concept and successfully demonstrated technologies may be duplicated at other sites.



Challenges...

- ***“My primary goal in managing this program is to reduce most of the risks and most of the mortgages over a ten-year period... Most important, we need to move this program toward completion... We have an opportunity to show that a ten-year effort to reduce risks and mortgage costs can substantially reduce obligations and risk on future generations.”***

Al Alm, Assistant Secretary
Environmental Management
U.S. Department of Energy
(From All Employee Message, May 10th, 1996)

- **Hanford Vision 2006: Safe Interim Status**

FG96000159.22B

Mr. Al Alm, our new Assistant Secretary for Environmental Management, has presented a challenge to all DOE sites. Within the next 10 years, a majority of cleanup projects throughout the DOE complex is to be completed. D & D, soil remediation, and groundwater cleanup are targeted categories for this deadline.




Challenges...

ongoing/daily...


- **Worker and public safety**
- **Waste Management**
 - ◆ **Storage**
 - ◆ **Disposal**
 - ◆ **Transportation**
- **Budget uncertainties**
- **Tri-Party Agreement**
 - ◆ **Commitments**
 - ◆ **Working with Stakeholders/
Regulators**

FG0000150.238

Of prime concern in meeting that challenge is the safety of the workers and the public. Cleanup operations must be conducted in a manner that eliminates or minimizes risk to our workforce and the community. Companion to that ongoing challenge is the transportation, storage, and disposition of waste, dealing with varying budgets, and meeting our obligations to regulators and stakeholders.

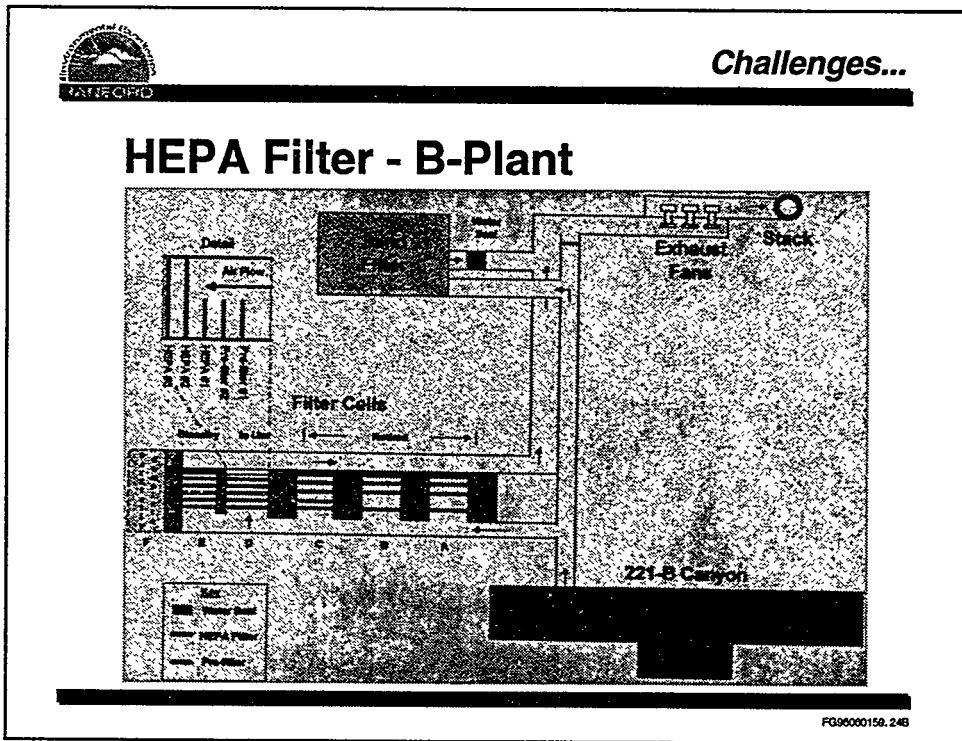

As an example of our worker safety focus, we currently are using the main HEPA Filter System to remove any radionuclides from the air in facilities. Currently, a new HEPA system is being designed with a target installation of September, 1998.



Challenges...Vision 2006


Hanford's "Vision 2006"

All Urgent Risks Mitigated:


- ◆ SNF (2001)
- ◆ Plutonium (2001)
- ◆ Tanks (2003)

FG0000158, 258

Our answer to Mr. Alm's challenge is Hanford's "Vision 2006".
Within the first three years of the plan all urgent risks will be
mitigated...

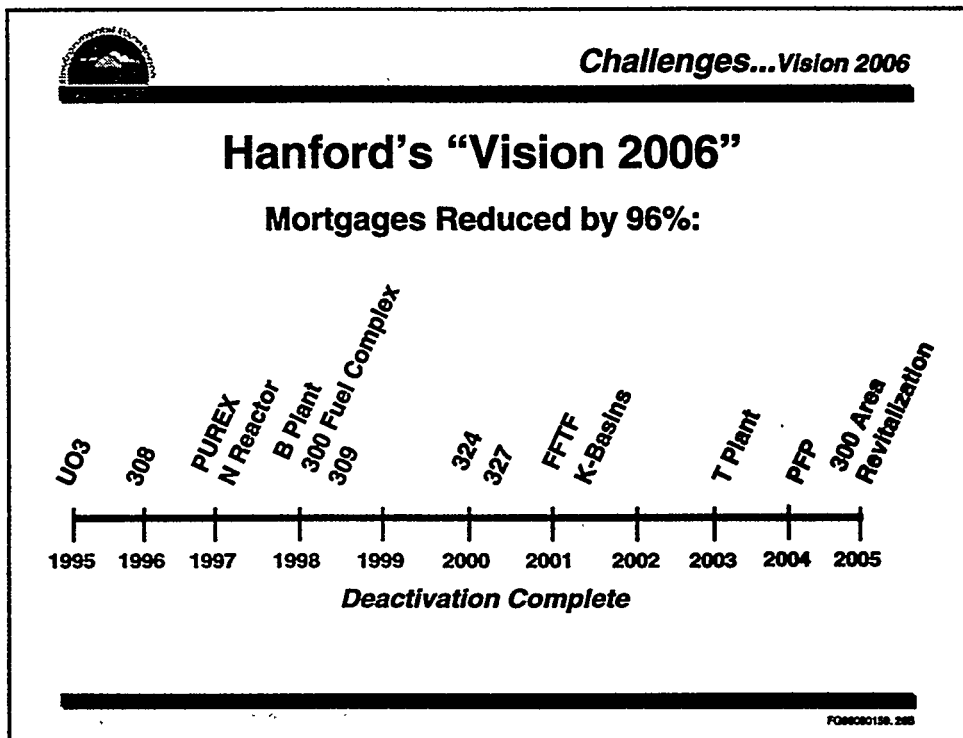

... our mortgages on major facilities will be reduced by 96%,
and ...



Challenges... Vision 2006

Hanford's "Vision 2006"

Significant Percentage of Current Waste Inventories Treated/Disposed/Stored:

- ◆ **HLW (Tanks): 3 Million Gallons**
- ◆ **TRU: 50% Shipped to WIPP**
- ◆ **Mixed Waste: 50%**
- ◆ **LLW: 100%**

FOI0000158.278

... significant impact will be made on our current waste inventories.



Challenges...Vision 2006

Hanford's "Vision 2006"

Environmental Restoration:

- ◆ **7 Reactor Facilities Cocooned**
- ◆ **150+ Waste Sites Remediated**
- ◆ **Complete Remediation of all 100 Areas (Except N)**
- ◆ **Begin Characterization Work in the 200 Area**

FG00000150.203

Our ER efforts will have placed 7 reactors in Interim Safe Storage and remediated more than 150 waste sites.

Questions



HANFORD

and Answers

As we have seen, our past progress is notable, but our future challenge is just as noteworthy. I am very confident that our excellent contractors workforce will not only meet the challenge over the next ten years, but will exceed expectations in the process.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FIRST: Mr. Wagoner, I've heard all kinds of numbers for when this clean up is going to take place and how much it's going to cost. I recall about five years ago we had thirty years and thirty billion. And then it went up to fifty years and a hundred billion. And now I just heard ten years, but I didn't hear how many billions. But it would be, I'm sure, of interest for us to know how firm the ten year commitment is, and some idea of what the financial implications are.

WAGONER: For Hanford we have requested for the 1997 budget year just under one point four billion dollars. And for fiscal '98, including the financing of the privatized tank waste contracts, that would be a little over one point five billion. So it would run in that range between one and one point five billion per year, between now and 2006.

WEBER: I am curious to know what is the magnitude of the TRU waste, which is in suspense awaiting whether WIPP opens or not. Of that figure, are you able to estimate what proportion of the material has already been drummed?

WAGONER: I should have, but I do not have the figure off the top of my head in terms of the total volume. Most of it is going to have to be repackaged. And for that purpose we built the waste receiving and packaging facility. We are just now completing construction. I think it's essentially complete. And there we will be able to bring the waste in that's retrieved. The TRU waste of Hanford, for the most part, is buried in shallow pits that are retrievable. That will be brought into the facility, it will go through examination, characterization, depending upon what is seen through the non-destructive evaluation. Glove boxes are there to repackage the material and put it into suitable drums, meeting WIPP's acceptance criteria, whenever those get finalized. Bar-coded and then put in a position ready to load for shipment to WIPP. But I do not have the overall figure. If you are interested I can get that for you. On the TRU waste also, in all fairness, it's important to distinguish that we are talking about the so-called retrievable waste, which was placed there after 1970.

BELLAMY: The congressional mandate to complete the DOE/West Valley project would suggest to me that the vitrification of the tank waste that you have proposed, could be done at West Valley at a very significant savings to the taxpayer, if I understood your answer to Dr. First's question properly. Why isn't West Valley being used for that purpose?

WAGONER: I am not sure that the life of the melter at West Valley would be able to handle the Hanford waste. My understanding is that it will have a limited life. It's only got one tank to process, basically, at West Valley. It is the same basic design concept as DWPF, and that melter will have to be replaced periodically. Then you have the issue of transportation, what would be the suitable container for transportation to West Valley. We only need to treat in the high-level waste melter the high level fraction of the waste, so it would suggest you need a pre-treatment facility to separate the high level and low level fractions that would have to be at Hanford anyway. So it's difficult to see that you would find sufficient economy to overcome all those problems to ship it across the country. What we are doing in our approach to privatization is to ask instead for industry to show what they could provide using the technologies that have been previously developed, a lot of it outside of this country. So those are the proposals we are currently evaluating.

SESSION 6

**INTERNATIONAL PANEL REPORTS ON
NUCLEAR AIR AND GAS CLEANING ACTIVITIES
FROM AROUND THE WORLD**

Tuesday July 16, 1996

Co-Chairmen: R. Weidler

J.G. Wilhelm

Panel Members: R.R. Bellamy

J. Dymont

T. Fukasawa

R. Lee

R. Porco

J. Slawski

J.G. Wilhelm

PANEL DISCUSSION

INTRODUCTION

WEDLER: Welcome to the International Panel session. We have a very distinguished panel today. We have Mr. Fukasawa from Hitachi Limited, Mr. Rich Porco from Ellis and Watts, Dr. Ronald Bellamy from the US Nuclear Regulatory Commission. Dr. Juergen Wilhelm, consultant from Germany, Mr. James Slawski, US Department of Energy, Mr. John Dymont, the Atomic Weapons Establishment in the UK, and Dr. Richard Lee from the US Nuclear Regulatory Commission. Each of these gentlemen has something to say, then we will open the floor to questions.

BELLAMY: I have three very brief comments that I would like to make concerning regulatory issues that could be interpreted to have an international flavor. And then Dr. Lee will follow me with some very specific international issues that the regulatory agency is involved in. The first I'd like to mention is an issue that has become of great importance to us over the last year, with our change in chairman. The present chairwoman of the Nuclear Regulatory Commission is a firm believer in verbatim compliance. Whatever the technical specifications or the regulations say, it is the way to do it, and it is the only way to do it. She is not a believer in waivers or exemptions. The present philosophy is that if there is something of such importance that it requires a waiver and exemption, then it must be something that you need to take a look at in the regulation. Maybe the regulation or the actual basis for what you're doing needs to be changed. The second issue has to do with a lot of the work that's been on-going over the past several years with respect to source terms, with respect to changes in the regulatory requirements, and the potential for, I don't want to use the term back-fit, but the potential for modifications to existing filter systems. There's been some discussion on can we remove components, can we remove some HEPA filters, can we remove some activated carbon. I'm not going to stand here and give you any of the answers to those questions, but simply to point it out to you that is an issue that will need to be addressed. And perhaps there's some lessons to be learned from some of the international experience that we will be discussing this afternoon. The third and final issue that I will very briefly mention is the topic of one of the open end papers this afternoon, and that has to do with the criteria for laboratory testing of carbon that has been in-place. The Nuclear Regulatory Commission has, contrary to what I started this brief remarks with, has approved some emergency tech spec changes and waivers over the past several months. And Mr. Lyons will be discussing that issue in great detail this afternoon. So perhaps there is some international experience that we can learn and gain from. And we can use that as we move forward in this area.

LEE: Let me tell you something on the international scene, what the agency is doing, plus the emphasis based on the office of research of the NRC. Since the NRC was formed in 1975, after we split from the AEC, the agency has maintained many bi-lateral agreements with European countries, Asian countries, and most recently the so-called former Eastern European Countries, in cooperative research. And I think there are some areas that will be of interest to the participants of this conference, in the area of aerosol treatment (*i.e.*, before you can treat it you need to know more about the sources and so forth). And I think after the TMI accident in the early 80's, the Office of Research initiated a whole series of bi-lateral agreements with European countries, and Asian countries, in cooperative research and focus on so-called severe accident research. Severe accidents are beyond design-based accidents, and we are dealing in an area where current filters are designed for design base accidents, to handle severe accidents. We know that under severe accident conditions, the aerosol loading on these filters will render them useless. Now, with the revision of the source term, we have not (because the agency is busy addressing other issues) gone back to look at the performance of filters. And I don't know, Ron, whether Region I is looking into it or not. Instead of assuming 95% of gaseous iodine (that filters have to treat), now our new source terms set iodine at 95% aerosol. So this has implications on the operating plants. And as Ron pointed out, the utilities may come in and ask for different things (related to filter performance requirement), and some of the proposals are actually in-house now. So we will be discussing with the Office of Nuclear Reactor Regulation, how to deal with these proposals. Now back to the international arena, under the severe accident agreements, we have been doing a lot of research with Japan, basically with JAERI, the Japan Atomic Energy Research Institute. It started with thermal-hydraulics cooperative research, basically looking at design base loss-of-coolant accidents; now we have extended it into severe accident research. In the severe accident research area, we also have joint agreement with NUPEC, another research organization in Japan, which we deal directly with on hydrogen issues. On hydrogen issues, we are basically dealing with failing the containment very early, very quickly, and not necessarily looking into what the hydrogen burn would do to the aerosols. In Germany, of course, we have a lot of cooperative research agreement with KfK, which now has been renamed as FZK. We also deal with GRS, *etc.* In the late 80's, we started to cooperate with France. That was the first time the agency started to cooperate with France, basically with the CEA (the French Atomic Energy Commission). And I want to point out that there is a lot of activity now going on in France in the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

source term area (such as aerosol research in the Grenoble research center). The one major project that the agency is tracking now is the PHEBUS-FP project, located in the Cadarache Nuclear Center in the south of France. In '93, they ran the first test, using fresh fuel. In that test, initially the test results showed that 10% of the iodine coming out was gaseous iodine. That caused concern to us, because at that time a Commission paper was pending to revise the source term and we said 5% (gaseous iodine) was the maximum. The preliminary results turned out to be not true, because the initial measurement has error and it is somewhere between two and less than ten percentage gaseous iodine. The next test is going to be run some time this month, actually within a week. And that test is going to be using spent fuel from the BR3 Belgium reactor; fuel is three feet long, and there are about twenty-one rods (one control rod and twenty fuel rods). Of course, if the test doesn't run by July, it will start to conflict with the vacation schedules so it will be postponed until September. I have to tell you that Korea is launching a very ambitious program for the next ten years, spending close to a billion dollars in research to get itself in a position to compete with Japan and the US in future reactors. And the research they started ranges from thermal-hydraulics to severe accidents. So there are a lot of activities going on internationally. I think some of the results from these activities should be of interest to this conference. The agency is also faced with a very important decision, that is on the maintenance of expertise. There's a lot of dialogue now, not just within the US, but with the Europeans, concerning how we can maintain expertise. Another reason we have all these cooperative research agreements is because the budgets are decreasing, so we need to share the research knowledge. And this expertise maintenance is directly related to how we're going to fund, what type of program we will fund in different national laboratories, and what scientists we need to maintain in case there is an accident in a plant, and we need to call upon these people to address the problem. With these remarks, I would like to turn the podium back to the Chairman.

DYMENT: I'm going to try, in the space of 10 minutes to give you a very quick overview of the British Nuclear Industry, where it's come from and where it's going, as a background to the air cleaning problems. In trying to do this I feel a bit like the man on the radio who does a Shakespeare play in 30 seconds.

WORLD SCENE:

This micro-history slide of UK and world nuclear power (from the Nuclear Engineering Handbook, 1995) shows the numbers of reactor units commissioned in first power in various countries during the four decades starting 1956/65. As you see the UK was virtually the sole player in the first decade with around 20 units. In the second decade the rest of the world commissioned over 100 while the UK dropped back to 6. In step with the rest of the world, the UK increased again (second generation reactors) in the 76/85 decade to 10 or so units and dropped back again in the last 10 years.

UK SCENE:

The current UK situation is that 10% of inland energy consumed comes from nuclear power, and 25% of electrical energy generated is nuclear. The generating plant consists of 8 Magnox stations (uranium metal fuel clad in alloy), 7 AGR stations (enriched uranium oxide fuel clad in stainless steel), both types with carbon dioxide coolant. Finally, we have 1 PWR station. Reprocessing of these various fuels takes place largely at the Sellafield sites of British Nuclear Fuels. Some reprocessing also takes place at the Dounreay site of AEA. A "drystore" option for the long-term storage of spent fuel has been considered as an alternative to reprocessing.

DECOMMISSIONING:

Various strategies for decommissioning obsolete generating stations are under discussion; the issues centre largely on the (duration of the) delay before dismantling and the safe encapsulation of the installation meanwhile. Decommissioning of redundant nuclear facilities other than power reactors is well advanced within several organizations, e.g. decommissioning of the Capenhurst diffusion enrichment plant is complete and the bulk of the metals has been recycled.

WASTE:

Low level nuclear waste is currently disposed of at the Drigg repository, operated by BNFL. Intermediate level waste is currently stored at the sites where it is generated, pending construction of a deep disposal facility by NIREX, the Nuclear Industry Radioactive Waste Executive. The commissioning date for this facility is still some 15 years away. High level waste is currently stored on the site of origin pending vitrification which is in progress.

PROGRESS TOWARDS DISPOSAL:

NIREX is investigating the hydro geological characteristics of a proposed disposal site near Sellafield by means of a "Rock Characterization Facility" (RCF) which is currently being designed. Authority to proceed with construction has not yet been obtained.

NUCLEAR AIR CLEANING:

Many or most UK nuclear air cleaning installations employ HEPA filters. The majority of these use the square deep-pleat format mounted in bag-change housings. There are some plenum chamber mounted installations but they are perceived to present greater problems at changeout and *in situ* testing. Circular (cylindrical) format HEPA filters are now being used to a large extent in new plants. They have 950litre/sec airflow capacity (>2000CFM) and will fit into a standard waste drum. They are also acknowledged to be much more compatible with remote changeout requirements than square format units. In-place or *in situ* testing of HEPA filters is routine at all nuclear sites.

UK NUCLEAR POLICY:

The UK government has published two documents on nuclear policy in the last year, one relating to nuclear power, the other to nuclear waste. The former, the Nuclear Review, had 3 key conclusions:

Firstly, that nuclear power will continue to play a key role in meeting UK energy needs. Secondly, that public sector intervention in the electricity market is unwarranted. Thirdly, that as many UK Nuclear Stations as practical should be moved to the private sector.

Accordingly, the more modern AGR and PWR stations have now joined the fossil fuel generators in the private sector as "British Energy", with only the older Magnox stations remaining in the public sector as "Magnox Electric".

The key findings of the second policy statement, the Waste Management Review, were as follows:

1. Deep disposal of ILW continues to be Government policy; Nirex should implement plans for the repository without delay.
2. Deep disposal of vitrified HLW is a favored option.
3. A range of potentially acceptable decommissioning strategies is recognised, including "Safestore" concepts.
4. In general, radioactive wastes should not be imported/exported to/from the UK.
5. Waste substitution is an acceptable option provided there is environmental neutrality for the UK.

WEIDLER: Our next speaker Richard Porco from Ellis & Watts, Richard is going to talk about developments in China and Korea.

PORCO: One of the questions that I am asked very often is why do we, on the ASME code committees, work so diligently to develop standards, when in the US we're not working on any new nuclear power plants. We put a lot of effort into our work, and other than the DOE, commercial power plants are mainly working on retrofits or upgrades. The amount of work that goes into the codes and standards seems phenomenal to support that effort. Why we work on the codes that diligently and what we're supporting is a very vibrant commercial nuclear power industry in the Orient. I think most of you are aware of Korea's aggressive nuclear program. The key to Korea, China, and other emerging countries is to develop an infrastructure to support the rapid growth necessary. Parts of that infrastructure would be would be

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

communications, another is the road systems. The main part is energy. This is a slide of Korea's operating plants. They currently have eleven operating plants that generate more than 9,100 megawatts. The first unit Kori Unit was brought online for commercial operation in 1978, and over the period of the next sixteen years, KEPCO brought on ten more reactors with the last one, YGN Unit 4, coming online this year. KEPCO also plans on bringing another nine reactors online within the next seven years. At least 6 more are planned, including a reactor for North Korea. This pace seems phenomenal compared to the pace the U.S. built reactors in the 70's and 80's. Korea is actually supporting this effort, and it has helped their economy grow quite rapidly. Other countries that are looking at this rapid growth and trying to imitate Korea are Turkey, Thailand, India, and Pakistan. Japan has always had an aggressive nuclear program, and I think Dr. Fukasawa will also talk about Japan.

I'm going to discuss nuclear energy in the People's Republic of China. Since the 1970's China started to talk to the world about its civilian nuclear power applications. So far, China has three reactors. The 300MWe indigenous pressure water reactor at Qinshan and the two 950MWe French PWRs at Guangdong near Daya Bay supply less than 1% of China's electricity. The successful entry of the three reactors into commercial service in 1994 has stimulated a sense of confidence in nuclear power within China. China's gross national product has increased more than 400% since 1980. Shortages of electricity estimated to average around 20% are blamed on China's new industrial enterprises operating below their potential capacity. To achieve GNP annual growth at the projected rate of 7-10% per year for the rest of the 1990's and the first decade of the twenty-first century, the increase in the electrical production will be required. Right now there are four additional plants under construction in China. Qinshan Units 2 and 3 are under construction and construction of two more plants at Guangdong, LINGAO Units 1 and 2, has begun. In addition, reactors are planned for Qinshan Units 4 and 5, these are Canadian CANDU 6 reactors. And two more at Wufangding, and these are PWR's. They are Russian UVER-type under an agreement with the St. Petersburg Atomic Energy Development Company. Korea has also entered into agreements with the China National Nuclear Corporation, and they are working on what they consider the Korean standardized nuclear power plant, which is similar to Bechtel's Standard Nuclear Unit Power Plant (SNUPPS) and other standardized nuclear power plants we had in the 80's. The Korean standardized plant is based on UGN 3 and 4 and ULCHIN 3 and 4 plants. Proposed sites are Shangdong and Fujian Provinces. Each site is different enough to affect the design of most of the equipment. The same thing will be true when they are adapted for the China market. In addition, there are seven additional sites under consideration. The whole area along the coast of China is looking to support and finance a nuclear reactor in their Province. There is a possibility for thirty to forty reactors. The problem here is obviously financing. Even if China achieves 50% of its projections, it would still be a major accomplishment. The purpose of showing you all this is that there is a commercial nuclear market out there. And there is also a major need for our codes, standards, developments and equipment.

WEIDLER: Thank you Mr. Porco. Our next speaker will be Dr. Wilhelm.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Provisions for Containment Venting in Germany.

J.G. Wilhelm, Consultant

Abstract.

In this short paper an overlook is given of the systems developed in Germany for filtered containment venting and their implementation in nuclear power plants. More information on the development can be found in the Proceedings of the DOE/NRC Aircleaning Conferences (1, 2, 3)

In Germany, 28.8 % of the electric energy is produced by 19 nuclear power reactors. No new power reactor is expected to be built at least within the next ten years, but France and Germany cooperate in the development of a future European Power Reactor (ERP). This reactor type will be fitted with a core catcher and passive cooling in order to avoid serious consequences of a hypothetical core meltdown accident so that provisions for containment venting are not required.

In May 1990, the German Reactor Safety Commission specified the requirements on removal systems for filtered containment venting. Some data for LWRs are given in Tab. 1.

Reactor Type	PWR	BWR
Total mass of particles to be removed (kg) (including a safety factor of 50 %)	60	30
Decay heat (kW)		
Aerosols	2	180
Gaseous iodine	5	7
Content of steam in off-gas (%)	< 100	<100
Droplet aerosol by condensation (g/m ³) *	< 5	< 5
Beginning of venting after core meltdown	2 -3 d	> 4 h
End of containment venting	7 d	7d
Removal efficiency (%)		
Aerosols	≥ 99,9	≥ 99,9
Iodine, elemental	≥ 90,0	≥ 90,0
Iodine, organic	0,0	0,0

* in tubes, fittings and containment

Tab. 1 Requirements and conditions for filtered containment venting in Germany

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Backfitting measures allowing filtered containment venting have already been taken in the existing German power reactors. For the removal of droplets, mist and particles in the μm and submicrometer ranges, filter units were developed on the basis of packs of metal fiber fleeces with decreasing fiber diameters. These filter units were designed on the basis of experience first gained in droplet and mist removal with a metal fiber droplet separator of extremely high efficiency, to be installed upstream of HEPA filters of conventional design. When the factory producing the fiber fleeces from a special stainless steel was able to reduce the fiber diameter down to $2 \mu\text{m}$, the target of the original development was extended to build a droplet-, mist- and particle filter unit, completely made from stainless steel. The tests with aerosols of droplets, mist and particles showed that removal efficiencies $> 99,99 \%$ could be reached by the proper selection of the fiber diameters and the depth and arrangement of the different fleeces. Also it could be demonstrated that, even under extreme droplet and mist loading of the atmosphere to be filtered, no water reached the final section of the filter unit provided to remove dry aerosol particles with diameters in the submicron range. The design of the combined metal filter units allows to transfer the mechanical strength from the fiber media to perforated sheet metal or heavy wire mesh. Organic material is not used. In this way, the problems connected to the decreasing tensile strength of the HEPA filter media due to pleating and effects of wetting and heating, primarily challenging the organic binder of the media, could be avoided.

Filter units of the metal fiber type described were built to clean up the containment venting off-gas both by dry and wet filter methods. The "dry filter method" has been developed in two versions, named the Krantz/RWE system and the Krantz/KfK system. The Krantz/RWE system is shown in Fig. 1. The filter unit for aerosols is installed inside the containment and upstream of the pressure relief throttling valve for the off-gas. The dimensions of a typical module are given in Fig. 2 which includes also data on the required and proved performance. The loading capacity for particle aerosols is tested with a plasma torch generated tin dioxide of $0.5 \mu\text{m}$ MMD. Uranine is used for the final test of the removal efficiency of each unit fabricated. The decontamination factors are normally above 10,000. The expected diameters of particles, airborne in a PWR containment atmosphere at the start of filtered venting, are much larger when calculated with the NAUA-Code. In terms of the removal efficiency and pressure drop of the filter unit, the test aerosols are much harder to trap.

In Fig. 3 the dimensions and data are given for an iodine sorption filter module. The iodine sorbent is a zeolite, used in form of ball shaped granules with diameters between 1 and 3.5 mm. To prevent potential catalytic reactions between hydrogen and oxygen on the surface of the sorbent, a binary doped zeolite named Baylith ID 625 is used. The iodine is trapped mainly in the form of silver iodide. The iodine filter module is situated in the auxiliary building behind the pressure relief throttling valve. The isentropic expansion of the vented hot gas-steam mixture on the pressure relief valve down to nearly atmospheric pressure will result in a dry off-gas, containing overheated steam. During the first operational period of the originally cool iodine filter, condensation is avoided by the heat of adsorption of steam on the dry zeolite sorbent. Three German PWRs are fitted with the filter systems shown in Fig. 1.

In Fig. 4 the Krantz/KfK dry filter system for the filtered containment venting is represented. In this version of the dry filter method, the droplet separator and aerosol filter modules are combined with the iodine filter modules and the whole filter unit is arranged in the auxiliary building downstream of the pressure relief valve. The dimensions and the required and proved data of a filter unit, built for a volumetric flow rate of $18,000 \text{ m}_n^3/\text{h}$, are given in Fig. 5. Again, three German PWRs are equipped with this dry filter system. The advantages of both dry filter systems are mainly a result of the exclusive use of passive components. Emergency power and the supply of cooling water and chemical additives are not needed and an extremely high stability at different temperatures and radiation levels can be achieved

Also a "wet filter method" to clean the vented off-gas during a core meltdown accident was developed in Germany. This removal system includes a Venturi scrubber and a metal fiber droplet-, mist- and particle filter unit, in principle the same as mentioned before. The Venturi nozzels, scrubbing solution and the filter unit are inside of a pressure vessel. Because the scrubber is arranged upstream of the pressure relief valve (Fig. 6), it is working at a pressure near the containment pressure. During venting, the scrubber is operating in a sliding pressure mode. A large exchange area of the scrubbing solution, sucked into the throats of the Venturi nozzels, is generated by a very high difference of the velocity between the vented gas-steam mixture and the fine droplets of the entrained scrubbing solution. Another scrubber version can be operated close to atmospheric pressure and was developed for containments with a low design pressure. To remove iodine, the scrubbing solution contains sodium hydroxide and sodium thiosulfate. To reach a high removal efficiency for organic iodine, a dry iodine filter can be integrated in the final assembly. Removal efficiencies for aerosols of $> 99.95 \%$ and $> 99 \%$ for elemental iodine have been published (3). Thirteen nuclear power reactors in Germany are already equipped with the scrubber-filter system.

The Multiway Sorption Filter is a shaft type filter housing built to pass the exhaust air stream to be cleaned two times through the same sorption material, saving up to around 50% of the material needed to operate with a high decontamination factor during a long time of operation. It was originally developed for radioiodine removal. The activated carbon, contained in the lower part of the filter housing and previously used as long as possible for iodine removal in the upper part of the housing, is still good enough for pre-adsorption of air pollutants. The construction of this counter current filter guarantees an exact bed depth and stay time. It is now widely used in German power reaktor stations and, as a fall out of a nuclear development, in the conventional industry. In a radioactive waste burning plant, the MWS filter is used in the off gas system to reduce the dioxine to less than 0.5 nanogram per cubicmeter. No change of the charcoal layer was necessary during an operation period of more then three years.

References:

- (1) H.-G.Dillmann, J.G. Wilhelm, "Investigations into the design of a filter system for PWR containment venting", CONF-900813, Vol. 2, p. 898 (1990).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

(2) H.-G. Dillmann, H. Pasler, J.G. Wilhelm, "Off-gas cleaning devieces for containment venting", CONF-880820, Vol. 2, p. 709 (1988).

(3) B. Eckardt," Containment venting sliding pressure venting process for PWR and BWR plants - process design and test results", CONF-900813, Vol. 2, p. 876 (1990)

Filtered Containment Venting

The Dry Filter Method


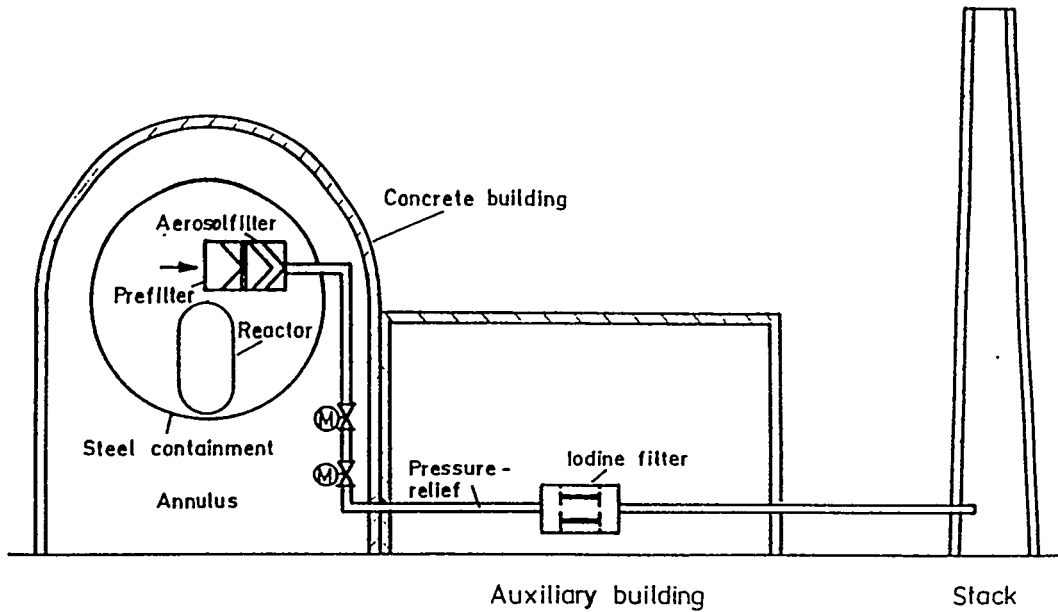


Fig. 1 The Krantz/RWE System

Metal fiber filter module

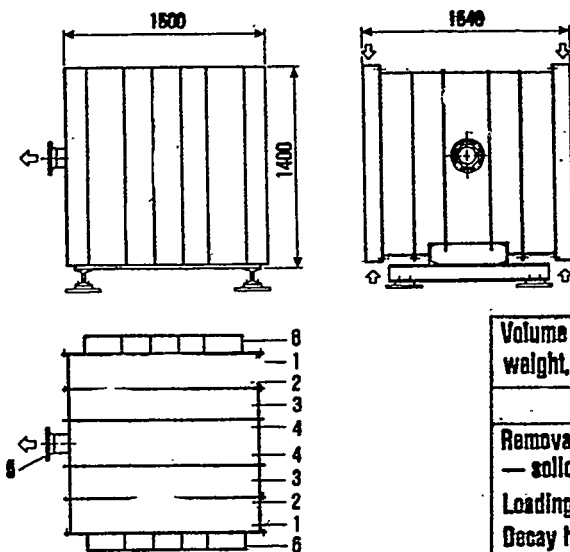

Legend

- 1 Droplet separator
- 2,3 Prefilter
- 4 Finefilter
- 5 Exhaust pipe
- 6 Inlet

Volume flow rate weight, approx.	m ₃ ³ /h kg	9333 2000	
		Required	Proved
Removal efficiency — solid particle	%	99.9	99.99
Loading capacity, SnO ₂	kg	60	80
Decay heat power	kw	2	20

Fig. 2

Filtered Containment Venting

The Dry Filter Method

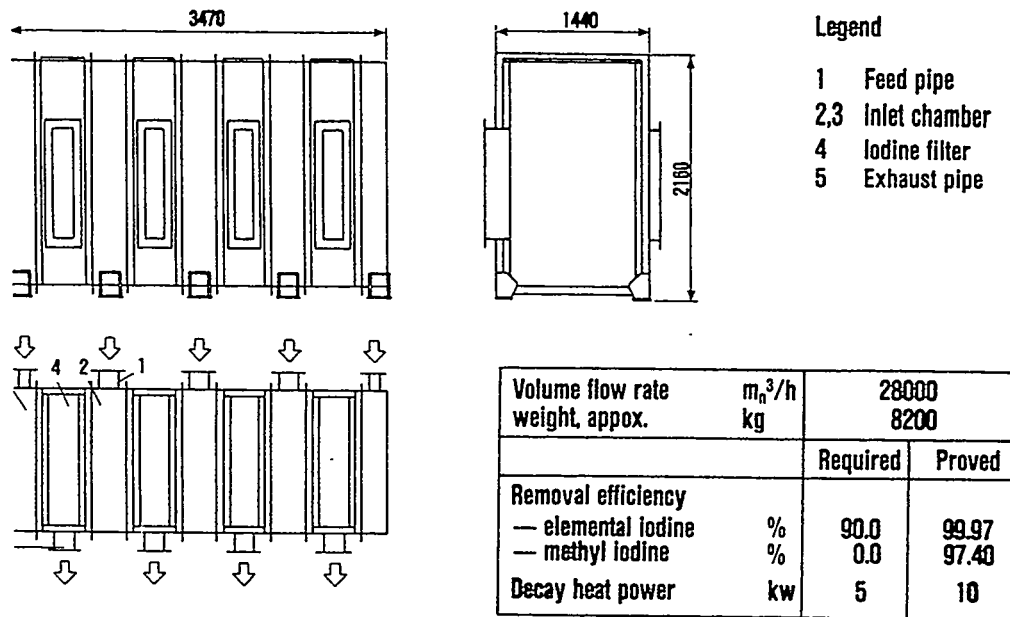


Fig. 3

iodine sorption filter module

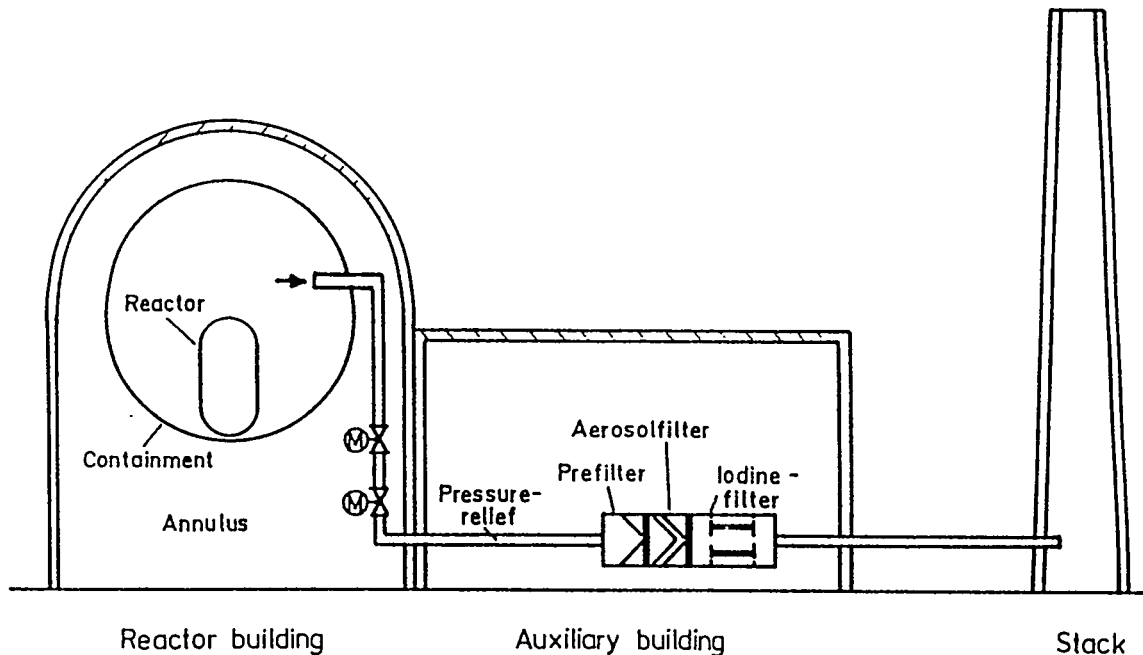


Fig. 4 The Krantz/KfK System

Filtered Containment Venting

The Dry Filter Method

Combined metal fiber and zeolite iodine filter module

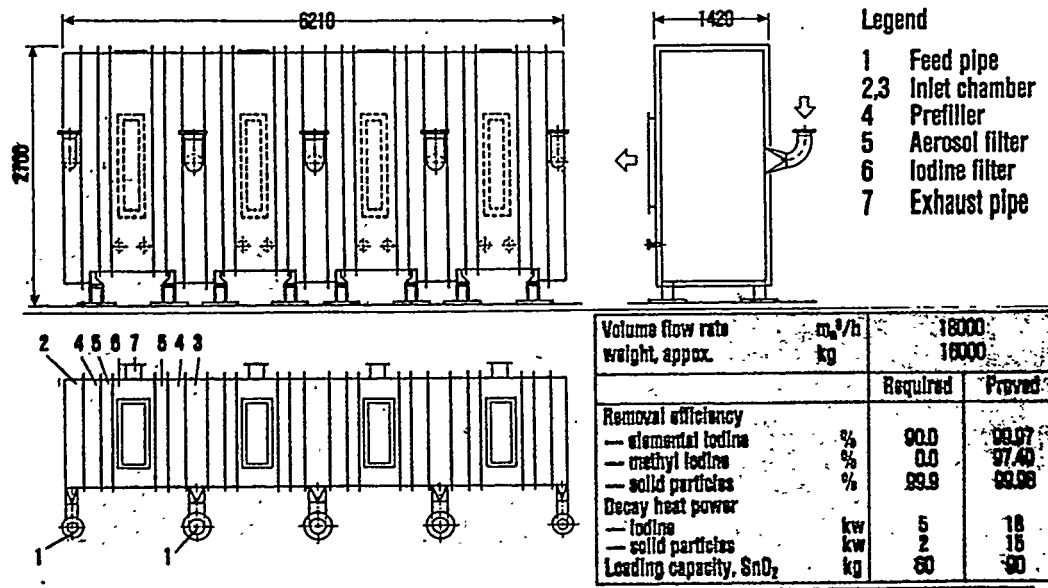


Fig. 5

The Wet Sliding Pressure Venting Process

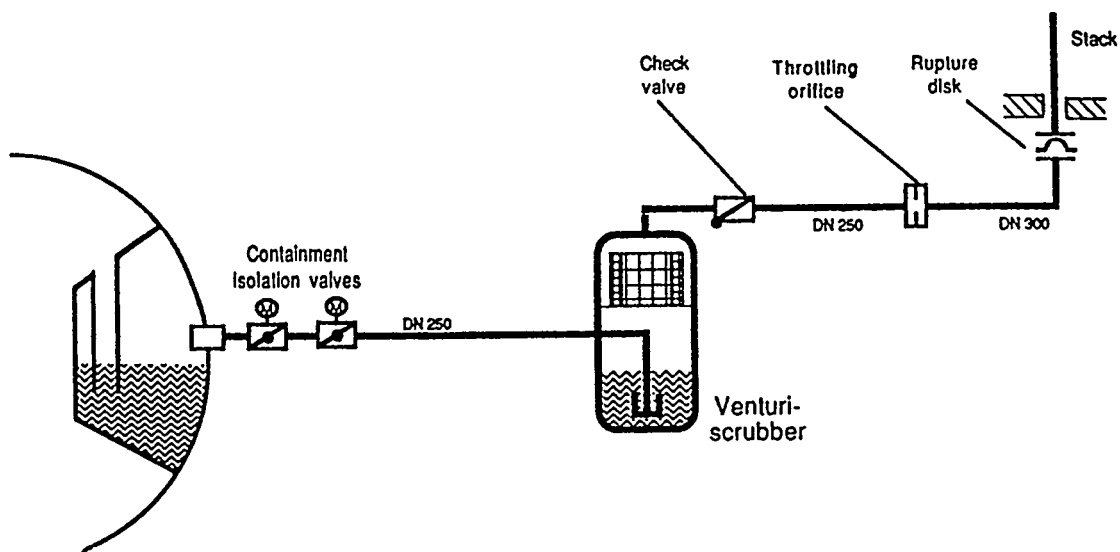


Fig. 6 Flow Diagram of One Version by Siemens

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FUKASAWA: The title of my talk is the present status of the Japanese nuclear industry. This includes off-gas treatment activities, but is mainly about nuclear power generation on these items written here. This figure shows you the capacity and operation data for nuclear power units in the world, on which I would like to show you Japan's nuclear position in the world. For plant capacity, Japan is in the third position in the world. These data I explain here are nuclear electricity share and average capacity factor. For both data, Japan is in the thirteenth position in the world. For plant capacity factor, Japan exhibited 80.2% in fiscal year 1995, excluding 18.3% periodical inspection stop. So 1.5%, or 0.3 events per unit per year, is unplanned outage frequency, which I think the smallest value in the world. This figure shows nuclear power plants in Japan. Fifty operation units include 26 BWR's in green color, twenty-two PWR's in blue color, and one gas cooled reactor in Tokai-one unit, and one prototype ATR, Fugen here. Among 4 nuclear units under construction there is one prototype FBR, Monju here, and 2 advanced BWR's here, Kashiwazaki-Kariwa-6 and 7 units. Two units are on order, and an additional fourteen units are being considered now. Fuel cycle facilities are operated or under construction at the very northern part of Japan's main island Honshu. The facilities are centrifugal uranium enrichment, Purex reprocessing, low-level waste shallow disposal, and high level vitrified waste storage. I will show you briefly the status of the Fugen, Monju, advanced BWR's, GCR, and fuel cycle facilities. This is the Japanese prototype advanced thermal reactor Fugen of PNC, which has U or MOX fuel, a heavy water moderator and the light water coolant. I think ATR is useful for Pu consumption before FBR, but no further ATR development was decided last August. Hitachi was one of the main contractors of ATR, so I was so sad to hear this news. This is the Japanese prototype fast breeder reactor Monju. Because of the lack of energy resources, Japan is proceeding FBR project. Monju achieved initial criticality in April 1995. But six months later a leak of non-radioactive sodium occurred. The leak portion was just part of the secondary loop. The leak portion is here, and the missing part was found at the bottom of the super heater. The sodium leak occurred exactly on December 8, 1995. I cited these figures from Nuclear News. The leak position was about one meter from the concrete wall of the containment vessel room. The leaked sodium amount was seven hundred kilograms, and four hundred fifty kilograms have been recovered by now, two hundred kilograms were dispersed to the environment, and twenty kilograms are still in the ducts. Sodium flow vibration and repeated thermal stress broke the thermocouple tube and caused the sodium leakage. This missing part was found in this distributor at the bottom of the super heater. Now the public concern is focused on this subject. I hope Japan can continue the FBR development program. This is the world's first advanced BWR's Kashiwazaki-Kariwa-6 and 7 units. The schedule is shown here. This month, the first one will become full power and this winter commercial operation. The characteristics of ABR are the internal pump, the fine motion control rod drive, and the reinforced concrete primary containment vessel. This is the joint venture of General Electric, Toshiba and Hitachi companies. The decommissioning program for nuclear reactors is also proceeding in Japan. For Japan power demonstration reactor of JAERI, the decommissioning was finished this March after testing such a device for remote removal of in core components. For the first commercial reactor, Tokai-1 of JAPCO, Japan Atomic Power Company, the decommissioning was decided last month. Among a hundred and sixty thousand tons of generated waste, they think eighty-five percent can be treated as non-radioactive. This figure shows the progress in fuel cycle facilities. The uranium enrichment plant started operation in 1992. Final capacity will be fifteen hundred tons SWU per year. The low level waste disposal center started operation in 1992. Final capacity will be three million drums disposal. One drum is two hundred liters or fifty-five gallons. The high level waste management center started operation in 1995. Final capacity will be three thousand canisters storage. The reprocessing plant will start operation in 2003. Final capacity will be three thousand tons heavy metal for spent fuel pool and eight hundred tons of heavy metal per year for the reprocessing. I show you two R&D activities in the field of nuclear fuel cycle. The partitioning and transmutation program aims at reducing toxicity of high level waste by recovering long-lived nuclides and converting them into short-lived nuclides. We call this the Omega Project which has been done for about ten years now. PNC presented the actinides recycle program two years ago. The concept of actinides recycle is described here which aims at the effective use of minor actinides such as neptunium, americium, and curium in the future FBR cycle. Finally, I will explain the systems and recent activities for off-gas treatment in Japan. For nuclear power plants, the United States is our teacher. We are also looking for the leak test method without using Freon for standby gas treatment system. Source term evaluation is also being done with non-volatile cesium iodide. For reprocessing plants, the Rokkasho processing plant

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

will adopt German silver adsorbent of iodine removal. In this case, Germany is our teacher. For the recycle equipment test facility for FBR fuel reprocessing of PNC, they will also adopt silver adsorbent. Tokai reprocessing plant now in operation removes iodine by the alkaline scrubbing method, and is now considering the iodine removal from the solution by silver precipitate. Crypton evolved removal is also being considered by PNC. For enrichment and fabrication plants, uranium recovery from HEPA is considered by vibration and acid leach methods.

WEIDLER: Thank you Mr. Fukasawa. Our next speaker is James Slawski from US Department of Energy and then we will open the floor to questions.

SLAWSKI: I think I need to say that anything I say at this meeting is my thoughts and I do not speak officially for the Department of Energy. That should cover what Ron said earlier this week in so many words. I have been focusing my work in this area on standards, picking up some old DOE standards and revising them and now working with ASME, the CONAGT Committee on working on their standards, specifically the one on HEPA filters. We are proceeding at this time with the resolution of the DOE draft standard for specifications. We have redlined strike out or revision one of the draft that we put out last year. After our meeting earlier this week we will be doing revision two of that. From that time we will be going through on a line by line comparison between that and the FC Section of AG-1. I am quite aware that there is a Federal Law that where it is practicable we adopt a non-government standard and I am working to head in that direction for the department. At this time, I'm aware that the Department of Energy does not have a driver, it does not have a mandatory requirement on filters. We seem to be operating on inertia based on work that people like Humphrey Gilbert started years ago. We are talking about having a shell statement which could be a DOE order, a policy statement. We could get something added in to 10CFR830, the Quality Assurance Rule. Other considerations are 10CFR834, Radiological Protection for the Public, and 10CFR835, Radiological Protection for Occupational Safety and Health. These are just things that we are considering at this point. We are aware also that we need a technical basis for maximum life of filters and we are concerned about those factors that I hear from people in this meeting. Our interest, we have radiological as well as non-radiological concerns in this area. On the radiological side, the overwhelming driver, my understanding is, the binder on the media as it's exposed to radiation. We also have other organic compounds, the plywood and the box itself, the glues that hold the plys together, the glues that hold the filter pack to the case and then the seal to the edge of the case, the gasket. We are looking for a technical basis to evaluate those for the life expectancy or maximum life that we might derive. Rocky Flats has been funded to do some studies on aging and we are very interested to see the outcomes of that. We are finally we are working on getting out the draft for the air cleaning handbook, and our target is to get that out for review by the end of this calendar year. And Werner Bergman is getting optimistic that will happen. Those are my comments at this point.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

WEIDLER: Thank you very much. Now I open the floor to questions.

FIRST: I do not want to sound repetitive, I asked this same question this morning, but what is the panel's view of the of prospects for international standards with regard to nuclear air and gas cleaning, particularly, and other aspects of nuclear constructions in general?

PORCO: I can only speak from certain countries but Korea has adopted the ASME codes and ASME AG-1 in a requirement in their equipment specifications. China has adopted them on certain projects, very cautiously. In other words they will invoke codes and standards and then depending on how much money they really cost they may reduce the qualification requirements. Taiwan has adopted the ASME requirements. The proposed plants in Thailand and Turkey have either ASME requirements or Canadian standards which are, in my opinion, based on the ASME standards. Some of the other panel members may want to comment.

WILHELM: Well in Europe, we have the Eurotome and Eurotome is in charge of all the regulations that should be the same. It is not at the moment with respect to filter testing also, but it continues to unify Europe with respect to health physics with respect to radioactive material or not. I see a good future for a generation over Europe because as I told before France and Germany together developed a pressurized reactor. And if you start this way you will also unify your air cleaning systems, and what you ask for the air cleaning system. At the moment it is not the case. At the moment Germany has its own regulation, France has its own regulation, too.

DYMENT: Looking at what has happened in the past on standards in filter testing, one can look for example at the ASHRAE standard which started out as 52-68. Over the years it has gradually become adopted very widely, and two or three years ago it was accepted as a European standard. So it seems that if a standard works and continues to be accepted, it will become more widely used. Eventually it may become *de facto* an international standard. I think that for nuclear structures and testing procedures, it could be that the regulatory frameworks in different parts of the world would require differing standards to be applied. I think therefore that it would be difficult for standard documents from one country to be applicable in another without modification or adaptation. Looking at what we were discussing this morning on *in situ* testing standards, in the UK our *in situ* procedures are not national standards. Various organizations and sites have developed their own procedures for these tasks; they may ultimately come together as a national standard or more likely as a European standard. Whether it would grow from there to be an ISO standard remains to be seen, but it is going to be a long term process and we can just wait and see.

FUKASAWA: As I said to you, Japan deferred US standard for orchestration in nuclear facilities. But in general I think Japan's rule is more severe because, for example, Japan has many earthquakes, small, large and so on.

WEIDLER: As you can see, Dr. First, that is a difficult question to answer. Not impossible, but it will take a lot of work in the years ahead.

RICKETTS: I wonder if I might change the topic of conversation a little bit. I'd like to address several questions to representatives of the NRC, either Dr. Bellamy or Dr. Lee, or whomever else might be able to answer. I'm asking in the context of using regulatory guidelines to drive changes in component performance standards that would be documented in the form of codes and standards, in particular, HEPA filters. And I'm wondering what timetable the NRC has for updating, revising and releasing their regulatory guidelines. I'm thinking in terms of Regulatory Guides 1.52, 1.14, and maybe 1.76.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

BELLAMY: To be very honest with you, I had hoped beyond my wildest dreams that question would not come up at this conference. I have no clue as to when, or even if, the agency will be revising Reg. Guide 1.52. I would hazard to say that it's not even on the active working list as far as I'm aware of. So I think the direct answer to your question is we're not working on it and not in the near future. That was the second part of your comment. My personal opinion on the first part of your comment would be that I wouldn't look to the regulatory agencies to drive what the criteria should be for the components. I would turn that around and I would say that the ASME committee, other industry groups, such as NHUG, should be coming up with those criteria, and then coming to us and saying here is the industry consensus, here is what we think is appropriate. Since we are working actively on those committees and on those groups we should then say yeah, verily, and endorse it. I would turn the first part around that way and throw the onus back on the industry as a whole. I am speaking for four people, anybody disagree or have any....unless Dr. Lee knows something else about revising Reg. Guide 1.52, I don't believe that's on our agenda.

WEIDLER: I would just have one comment, Dr. Bellamy. I would love to see the NRC review and adopt AG-1. Is there any plan in that future?

BELLAMY: Not that I am aware of. My understanding of the situation is that we would take a look at specific sections of that and if the need arose we would endorse them in individual regulatory guides. But again, we're discussing an area that does not have a very high priority right now with the agency. Jim Lyons, please...bail me out.

LYONS: With respect to AG-1, in the improved standard Tech. Specs., it is one of the options that you can use to reference it, instead of other standards. So, in a sense, the staff, by issuing the improved standard Tech. Specs. says this is an option, it's something that we would accept.

RICKETTS: I wonder if I could follow up a little bit. Doesn't the NRC essentially in the end carry the ultimate responsibility for the public health and safety with regard to nuclear facilities? In that respect, don't they really need to take the lead on something like this in their guidelines?

BELLAMY: Obviously the answer to your first question is yes, our charter is to protect public health and safety. But I think before I would be comfortable in recommending to our management that we take that step of generating any new criteria or revised criteria, I think we first have to make the case that what we now have out there is not adequate to protect public health and safety. And I know that I would not be able to justify such a statement at this present time. When the Atomic Energy Commission was split back in 1975, the purpose of that split was very clearly to separate the promotion arm of the nuclear industry from the regulatory arm of the nuclear industry. And I personally would have a difficult time somewhat justifying why the generation of new components, so to speak, would not be more in the lines of promotion of nuclear power. And therefore I would probably try to turn your question around to let the Department of Energy address it.

RICKETTS: While we have you up there, I wonder if you could address one last question. Could you clarify the relationship between NRC and DOE regarding whether DOE is subject to NRC guidelines as far as facility operation goes?

BELLAMY: Jim, I think you are probably better to address that than I am. I could answer it but, please, try first.

SLAWSKI: I am not sure I know the answer to that because it is really far outside my turf.

BELLAMY: Then I guess my answer to that would be, I am not aware that the Department of Energy takes the NRC criteria, regulations, regulatory guides, standard view plans, whatever, and implements them on a one-to-one basis. My experience has been that they take the criteria and they use whatever they think is appropriate. When it fits it fits, and when it doesn't, it doesn't.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

HAYES: I am aware that at the present time I believe we have two resident inspectors, one at the Portsmouth facility and one at the Paducah facility. I don't know exactly how that originated but it's my understanding that we do have some people there. It is similar to having resident inspectors at power plants. And I also know that there has been under discussion in the Congress the question of having the NRC oversee certain activities at DOE facilities, but that is still in the formative stages at this point.

BELLAMY: Jack is correct, there are four residents at the two GDP facilities. When these resident inspectors come up with findings or violations, there is a major discussion going on now as to exactly what they would be called and how the Department of Energy addresses them.

ANON: Did you say Portsmouth and Paducah? Aren't those United States Enrichment Corporation facilities?

BELLAMY: That is correct.

KOVACH: I always like to come to these meetings and try to explain to DOE and NRC what they are really doing. We do not have enough time to explain to them what is it that they should be doing, because that takes a long time and they will not listen. Again, US Enrichment Corporation is in the process of privatization. The DOE philosophy and the DOE interagency agreement is that privatized facilities will be phased over to NRC for regulation. I think I mentioned it in my ramblings the first day that the tank waste remediation system privatization initiative, that John Wagoner talked about also, is, except for the early demonstration phase 1A, proposed to be under NRC regulation and not DOE regulation. In the meantime DOE will be in charge of only radiological safety regulation. All other regulations will be turned over in the privatized sites to OSHA, Ecology, or Department of Health, as an example, in Washington, just like any other private organization. So that is the reason why you start seeing NRC residents at some of the facilities. There is an interagency group composed of NRC Headquarters, DOE headquarters, and some of the DOE site operations offices, trying to streamline the phase-in of the new NRC regulations. That is also the reason for some of the discrepancies as to who is doing what. As far as revisions of regulatory guides or making changes in the regulatory guides, I think it was pointed out several times in the past, that there are mistakes in them. Basically, they are unenforceable as they are, and really, if the Chairman of the Nuclear Regulatory Commission is interested in a verbatim enforcement of everybody who claimed Regulatory Guide 1.52 compliance she would probably have to shut down half of the operating nuclear power plants immediately. So we still have discretionary enforcement of some of the regulations. I am greatly troubled, though, when both in public meetings and in an open forum, like the conference here, or in not closed meetings, but open to the public in discussions with NRC personnel, you hear statements, "well, yes this is technically indefensible but this is what we are doing." I think once we get to this point the technical basis of this whole industry is going down hill real fast. This is an area where I feel we definitely have to change. As far as international cooperation, I think in some areas in standardization it will be difficult, in some areas not so difficult. A few years ago we had an OECD group that started to recommend common standards, at least common test conditions, for testing iodine adsorbents (temperature, humidity and so on). I think most European countries went along with the recommendations. In the US, however, we still have about fifteen different test conditions and that's just on Tuesdays; on Wednesdays we have a few more. And some of these are realistic and some of them have absolutely nothing to do with reality. When we are talking about international standardization it also means that we have to give up some of our stupid US standards here, and accept some of the foreign ones that are good, and vice versa. You do not realize how difficult it is until you start supplying the same material to different countries, and you look at the test methodologies and it's relatively easy to find that one of them is really, really good and easy to consistently perform, you don't need two lawyers to interpret it, you don't need a lawyer for yourself and one for the regulatory agency. It's clearly written, it's readable and that's the one that really should be adopted, instead of everybody trying to come up with a slightly different one, often without understanding the basic technical concepts on which the particular test procedure is based. So this is just a little additional rambling relating to standards and how we are interpreting some of the wording of these standards and codes. And I hope you forgive me for the repetition that you heard in some areas.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CAMPBELL: I would like to know if other countries have documents similar to the DOE Air Cleaning Handbook? And if they do, would it be possible to get copies?

DYMENT: We do not have an Air Cleaning Handbook. We have spent quite a lot of time looking at your Air Cleaning Handbook. We do have various other documentation, though. In particular we have a nuclear industry purchasing specification for HEPA filters, which was arrived at after a consensus over many years. And there are various other documents as I've said earlier, which taken together would form the seeds of a handbook but that process has not yet occurred.

PORCO: In China and also in Korea you will find the DOE Air Cleaning Handbook.

CAMPBELL: What I hear is that, there is no equivalent to the DOE Air Cleaning Handbook anywhere else, from what we know?

PORCO: They are currently using the DOE handbook as a reference, and as you know it is out of date and is being revised.

WEIDLER: A quick summary. I would say that what we heard in our tour of the nuclear world for this afternoon is that we have a lot of pleas for international standards, that we have a plea for redeveloping our technical expertise, at least in the United States, and that we have a lot of concern for the regulations. The one on the standards I will convey to the Board of the Nuclear Codes and Standards and I know they are interested in this subject. I want to thank this panel, we've enjoyed it.

SESSION 7

OPEN END

Tuesday July 16, 1996

Co-Chairmen: K. Duval

M.W. First

STANDARDIZED METHODS FOR IN-PLACE FILTER TESTING

M. Dykes, J.K. Fretthold, and J. Slawski

CHARCOAL FILTER TESTING

J. Lyons

INTRODUCTION

FIRST: This is the Open End session. It is intended for short presentations and presentations on projects that are in progress but the information that has been gathered so far is interesting enough to present it to this audience. The Open End is also intended for people who have serious questions about issues or equipment and who wish to ask the audience if anyone has a solution or can suggest one from basic principles. This session contains a variety of topics. We have two speakers. My Co-Chairmen on this session is Kenneth Duvall from the Department of Energy. He is with the Office of Environmental Guidance. You may recall Ken was the DOE representative at the 23rd Conference.

DUVALL: Our first speaker is Jan Fretthold. He is affiliated with the Rocky Flats Environmental Technology Safe Sites of Colorado and his discussion is going to focus on the standardized methods for in-place filter testing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

STANDARDIZED METHODS FOR IN-PLACE FILTER TESTING

M. Dykes, *Westinghouse Savannah River Co.*
J.K. Fretthold, *Safe Sites of Colorado, Rocky Flats Environmental Technology Site*
J. Slawski, *US Department of Energy*

Complex - Wide Conference on In-Place filter testing

Monday, March 25 - Friday, March 29, 1996

Westinghouse Savannah River Company, Aiken, SC

As a response to the Defense Nuclear Facilities Safety Board (DNFSB) staff's suggestion on the sharing of testing technology, a conference has been scheduled at the Savannah River Site to begin exchange of information.

Who Should Attend:

- Field in-place test personnel and their management
- Purchasing Representative familiar with blanket-type subcontracting
- Technical Representative familiar with HEPA Filter requirements and specification

Conference Participants Will Share Information For The Following Objectives:

- Work together to develop and standardize a complex-wide procurement specification for HEPA Filters
- Develop an in-place test procedure that will include all requirements that each particular site may have
- Develop a training for future test personnel
- Develop a guide for in-place tests of Non-ASME N509 Systems

As part of the conference, if available, please bring copies of the following documents:

- In-Place test method/procedures
- Purchase specification for HEPA filters for your site
- Receiving inspection procedures/description
- Storage procedure/methods
- In-Place personnel training methods
- Certification requirement for test personnel
- Form of documentation of In-Place test
- Description or photographs of testing equipment
- Test of vacuum, air movers, exhausters

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- Information on aerosol generators
- Information on your site's use of different aerosol agents (e.g. EMERY, DOP, DOS)
- Information on your use of private test company (contracting out the in-place testing)
- Respirator testing...documentation of the technical basis for method used

COMPLEX-WIDE CONFERENCE ON IN-PLACE FILTER TEST

CONFERENCE MINUTES

Monday, March 25, 1996

Meeting began at 9:00 a.m. Welcome was given by Maynor Dykes, SRS.

This week's agenda was reviewed and all attendees (28) were introduced.

Purchase Requisitions

Maynor Dykes reviewed the procurement specification used by the Savannah River Site. This was a detailed review to show how current standards are used to control supplier quality. The group was told that this was the specification that will be used in the formation of BOA (Basic Ordering Agreement) to provide HEPA filters on a "as needed" basis to government owned/contractors operated (GOCO) facility throughout the Department of Energy complex. Seven GOCO facilities will participate in the BOA.

Other areas highlighted in this review were:

- All HEPA filters are Level 1 procurement and require Level B storage.
- All HEPA filters receive a visual inspection by qualified trained inspectors prior to storage.

Meeting was adjourned at 11:30 p.m. For lunch.

Jon Fretthold, Rocky Flats, reviewed his company's Procurement Specification. A lengthy discussion was raised of shelf life of a filter. This is a problem were there is no technical guidelines. Jon stated that his company used ten (10) years with a five (5) year requalification. Reasoning behind the use of 10 years explained. Other area discussed by Jon were:

- Level B storage, controlled by filter systems personal
- Filter Inspections are performed by the FTF test personal

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

V. Martinez, Los Alamos National Laboratory, described his company's procurement specification. Victor stated basically all of the specification and purchase requisitions included the same information. Purchase requisitions are written, then forwarded to purchasing and bids go out. At receiving, QA and visual inspection are performed. Filters are reinspected after received from Rocky Flats. Filters are stored in warehouses and installed as needed. Victor indicated that 1-2% of their filters are rejected each year at receiving. Most of these are administrative problems.

J. Kriskovich, Westinghouse Hanford, stated they were in the process of updating their specification. They are using AG-1 as a base. Jim feels that all filters should not be tested. There is a 1-3% failure rate of Hanford filters at the Rocky Flats test station. At Hanford, visual and beach tests are performed. Receiving personnel do all inspections. Hanford has a 1% defective rate at receiving. Most damage is caused by shipping and forklift.

Meeting adjourned at 4:00 p.m.

Tuesday, March 26, 1996

Maynor Dykes, SRS gave opening remarks and introduced Roger Zavadoski, DNFSB.

Roger described the DNFSB and its purpose. "The board consists of 100 members. Roger is the technical staff member that deals with filtered ventilation systems. Roger discussion included the following:

- Protection of the public.
- The role of HEPA filters in D&D.
- Safety Class sys. reduced to Safety Significant - loss of margin of safety.
- The role of the Filter Test Facility; filter QPL; effects of aging, wetting, radiation.

In-Place Testing

Maynor Dykes described the SRS test program highlighting test procedures and test personnel training. He answered questions from the group concerning test frequencies of portable air movers and fixed exhaust systems.

There was a full conference discussion with each GOCO site describing their In-Place test program, procedures and training. There were many differences in training of test personnel. Some sites had no classroom training and depended on "on-the-job" training. There were several problems seen in using Union personnel as testers.

Each site discussed the instrumentation used in their test programs. All sites basically used the same type penetrometer with exception of Los Alamos. There was a long discussion on aerosols with no decision being reached on which was best DOP was being used at Rocky Flats, INEL & SRS; Emery 3004 was being used at LANL and

LLNL; Emery was used at Hanford. ASME N510 was discussed and the conference thought a rewrite was in order.

Wednesday, March 27, 1996

Instrumentation

- NIST Calibration
- Bench Test

It appeared that all sites were using the same photometer with the exception of Los Alamos was using the laser field testing.

Questions were asked concerning calibration of the photometer. Do we require NIST calibration? Do we bench test the photometer on regular intervals, how often do we calibrate to NIST requirement? Do we use a NIST transfer method on our contaminated instruments?

Oak Ridge reviewed these calibration methods stating the Instrumentation Control Division on-site performs calibration to an ATI procedure and it is good for one year. They seldom send their field instruments off-site because of the potential contamination problem. They do not perform bench tests. The FTF instruments are sent off-site for calibration. Oak Ridge uses Thompson's Calibration Laboratory for their off-site calibration.

LLNL described their calibration procedure stating their instruments are sent to ATI for NIST calibration. They have four sets of instruments and a small test station with a known aerosol source. When an instrument gives a suspect reading, it is taken through a bench test procedure.

Hanford requires annual calibration. The Instrument Tech. Group maintains their test equipment and test instrument are sent off-site for recalibration. Hanford uses PNL (Pacific Northwest Laboratory), which is at Hanford, for recalibration. Hanford performs bench testing.

Los Alamos requires annual calibration on their lasers. Sizing is performed on a quarterly basis.

SRS required annual calibration. Instruments are sent to ATI for NIST certifications. SRS maintains two NIST calibration instrument for bench test and calibration transfer on the highly contaminated instruments. When instruments are returned from calibration, the documentation is reviewed, particularly the "As Found" section. If a problem is seen in this section, retests are performed on systems where this instrument was used.

Rocky Flats has personal trained by ATI to calibrate and rebuild their instruments. This is performed on an annual basis.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

SRS asked if anyone was checking the penetrometer flow. SRS had discovered a problem with flow on new instruments. All sites indicated they did perform flow checks.

The group agreed that we need to know more about calibration. They wanted to know if their instruments were calibrated to a known traceable concentration of aerosol. Maynor Dykes, SRS, agreed to investigate this problem.

There was a long discussion on penetrometer failure while in service. Hanford stated that they had problems with motors freezing. Some sites had problems in movement and handling. One site leaves instruments in the building where tests are performed to prevent damage. One site stated it was rare to have damage to an instrument from transportation by their group.

All sites have the required documentation in their record keeping.

Thursday, March 28, 1996

In-Place Test Personnel

There was a great deal of discussion on training. Training problems were seen as one of the major problems in HEPA filter testing. Some facilities do not have in-house training programs. Others have full classroom training followed by on-the-job and JPM (Job Performance Measures). Testing was required at each level of training. Off-site training at Harvard or NUCON was the only requirement by some. Most sites considered off-site training as "basic" and feel that they could not provide much help in testing their systems. Most sites do not use ASME N510 criteria since they could not test their system to standards. The use of Union personnel as testers was reviewed and seen as a problem since supervision has no control over the people or who received the test assignment. The conference group thinks we should have DOE assistance in development of a training policy. Since test requirements are basically the same at all sites, there was no reason why training should not be alike. At the present time, there is no certification for in-place test personnel.

Site Training Program Qualifications:

- Oak Ridge - Has no in-house training program. Requires training from Harvard or NUCON and on-the-job training.
- Rocky Flats - Requires two-four days supervisor administered training for Union people then on-the-job training for each system.
- Livermore - Requires Harvard training with one year on-the-job.
- LANL - Requires 39 hours classroom, 9 JPMS and 2 years on-the-job.
- SRS - Requires 39 hours classroom, 9 JPMS and 2 years on-the-job. Requalification is required every two years after qualification.
- Hanford - Union tech. OJT by supervisor, Qual. cards.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Test of Air Mover, Vacuum and Portable Exhausters

No one knew of any technical specification for testing portable equipment. Most sites perform tests alike and require qualified HEPA filters.

SRS requires qualification of all portable equipment before purchase. All equipment failing qualification testing will not be purchased. The SRS Filters Test Group has final approval of all portable air movers.

At all other sites, the test personnel have no say in procurement of equipment. Problems arise in this policy because some of the equipment can not be tested or altered so that basic testing can be performed. One site had to alter a vacuum cleaner to eliminate carbon fibers getting into the test instrument.

Private Test Companies

A very short discussion. No one had experience with private companies. Problem areas include security clearances and training on special filtration systems.

Friday, March 29, 1996

Conference Review

The positive response to this conference was outstanding. Everyone agreed that the conference was a great success and should continue. The indicated it was long overdue. All agreed this was the best method to transfer technical in-place testing knowledge throughout the DOE complex. A large number stated this was a training experience where they learned how to better perform their job function as a tester or supervisor.

The group saw the need for better standards, procedures and training of test personnel. It was very evident that most sites are basically doing business alike but with different approaches. It is now known that procedures common to all sites can be written and used effectively.

Many problems were identified at this conference. The one most common to all sites was, the test groups have no authority even though their job function is required by DOE. They cannot require correction of deficiencies and are not included in designs or procurement.

Everyone agreed that DOE should provide direction and support to the test groups. It was agreed that the FTF groups should continue to function. Every site saw a cost savings (waste reduction) in their programs by requiring retest at these facilities.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

During the conference, participants were asked to write some of their major concerns. Given below are these concerns:

- Lack of official DOE policy regarding testing at FTF's.
- Lack of DOE or Site specification for portable HEPA systems or filters for these systems.
- Lack of minimum training requirements for filter testing personnel; no DOE guidance.
- Referencing of ASME N510 for the testing of DOE filter systems results in auditing confusion and problems demonstrating compliance with referenced requirements.
- Lack of DOE guidance document or standard for testing of filter systems unique to DOE sites.
- Procurement of HEPA filters by personnel not knowledgeable of requirement for Nuclear Air Cleaning Components.
- Systems have old filters, >20 years. They are routinely tested and pass but the quality of media is in question. Testers have no authority to require replacement.
- Lack of DOE policy concerning shelf and service life of a HEPA filter.
- There is no formal DOE policy that requires facility managers to correct deficiencies found by the test groups.
- How will QPL be handled?
- If testing stations go away, who will perform a calibration efficiency (versus a leak test) tests.
- When will the whole filtration area stop being the unwanted step child at DOE?
- Will the conference continue? How Often? Where?
- There is a large disparity on how you meet or not meet an OSR (TSR, BIO, etc.) requirement.

The conference adjourned at 11:30 a.m.

Future Actions:

Establish a Complex wide (DOE) policy on :

- Training requirements for filter test tech.
- Test tech. certification
- Test aerosol
- In-place test procedure - mandatory / optional requirements.
- Receiving inspection / QA
- Filter specification (ASME / DOE)
- QPL requirements for filters
- Use of FILTER TEST FACILITIES
- Filter service life

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

List of attendees:

Maynor Dykes	WSRC	Greg Helland	LANL
Ernest R. Brinkley	WSRC	J.C. "Tony" Gross	Lockhead Martin/OR
Gary Mullis	WSRC	George M. May	Lockhead Martin/OR
Dave Simpson	WSRC	David L. Monroe	Lockhead Martin/OR
Kurt Breitinger	WSRC	Gary N. Norman	ORNL
Richard Proctor	WSRC	Terry Schubert	Lockhead Martin/OR
Jim Kriskovich	WHC	Jim Slawski	DOE DP-45 (GTN)
Charles DuPré	Kaiser Hill/Rocky Flats	Jack Jacox	Jacox Associates
Brian Mokler	LANL	Micheal Brandon	RMRS/Rocky Flats
Lawrnel Harrison	INEL	Richard A. Caufield	Dyn Corp/Rocky Flats
John Comer	WHC	J.K. Fretthold	SSOC/Rocky Flats
Roger Zavadoski	DNSFB	Werner Bergman	LLNL
Bruce Bettencourt	LLNL	Victor A. Martinez	LANL
Wayne R. Krause	LLNL		

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

DUVALL: Some time ago at Rocky Flats it was reported that there was significant plutonium discovered in the ventilation system on the walls downstream from the HEPA filters. And I am wondering what was concluded as to how that happened and did it have any bearing on the testing of the filters after that?

FRETTHOLD: Downstream from the filters?

DUVALL: Yes, there was a significant amount of plutonium that was lining the ventilation walls and there was some concern about criticality. In fact, I think that subsequently there were liners put on the ducts.

FRETTHOLD: That was upstream from the filter system between the glove boxes and the final filter plenum entrance. And here again it was a build up that had occurred because of the different processes. The basic systems are designed to move air, not particles. The original concept was, let's stop the particles at the glove box. Unfortunately, not every glove box operation had a filter at that point. Consequently, depending on the type of material, there was a migration into the duct work. Usually there was a reasonable velocity to carry the material, but as soon as any change in direction occurs or where you had a change in velocity you would have material fall out. They went through the system with an external counting device and identified where they had roughly the material. I won't say it was accurate because of background, reflections, and everything else that they were dealing with. But from that point on they could identify the worst locations and they went in with various small vacuum cleaners, scrapers, various other things and removed material from the worst locations. I do not have the numbers handy but I believe they removed one-tenth of what they estimated was there. It was a very successful operation.

BERGMAN: I want to add a comment to yours. I have not seen a report but I have had personal communications with people who know the major sources for this buildup. Regarding the question by Ken Duvall on Pu accumulation in the ventilation ducts at Rocky Flats let me offer the following: The HEPA filters used in glove boxes would plug rapidly and restrict the air flow into the box. This caused insufficient vacuum within the box and occasionally allowed Pu to escape from the box. To prevent this from happening, some workers would punch holes in the glove box HEPA filters to allow air to pass through the plugged HEPA filters.

FRETTHOLD: This took place during the early 60's, and then it stopped. The glove box filter was used as a pre-filter but was not a filter for which credit was taken from a testing standpoint. We had a lot of production going on, so the filters would load up fairly fast. There was a butterfly valve just downstream from the filter which could be opened to a certain point to maintain a negative pressure on the glove box. What you reported was early practice. It was definitely stopped and better maintenance instituted for filter systems and glove boxes.

DERDERIAN: In defense of DOE management, I would like to say that we are beginning to move in a direction that will resolve some of these important issues. Tip Rollins' group in EM is now tasked with coming through with a comprehensive report that will address the filter testing facilities. It will address QPL testing, it will address a number of technical issues that have not been addressed before. I find myself defending management, a very awkward position to be in for an engineer.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FIRST: I was very much interested in your exposition, particularly the aspect of training and certification of personnel. My first introduction to the Committee on Nuclear Air and Gas Treatment standards was to prepare a standard for personnel who did in-place testing. I spent six or seven frustrating years revising that document, because every time I revised it, the utility industry found good reasons why it was not sufficient. We finally had a conference with industry representatives who told us all the things that they wanted to have changed. We dutifully made the changes but then they told us they would not accept the standard under any circumstance. This remains a real problem. I did get the proposed personnel standard published, not in the air cleaning conferences, but in a special conference that took place in France on the subject of high efficiency filtration. If your group ever wants a personnel standard for certification, we have a good start and you can fight with the utility industry from now on.

DUVALL: Our next speaker is from NRC. He is James Lyons, section chief of the plant systems branch. His discussion will be on charcoal filter testing.


CHARCOAL FILTER TESTING

James Lyons
US Nuclear Regulatory Commission
Washington, DC

Yesterday Dr. Kovach was saying that he could count on two fingers the number of NRC personnel who had experience in air cleaning. I will admit that I am not one of those two, this is certainly not my field of expertise. I have been involved in this for about a year. At Plant Systems Branch we are in charge of the systems aspects of all the ventilation systems. We have inherited the issue of charcoal filter testing and have been working closely with Jack Hayes, who has been involved with it for a number of years. Earlier this year a couple of plants went through this process. If you start stepping through the standard Tech Specs, and a lot of plants only reference Reg. Guide 1.52, Rev 2, what you end up doing is taking yourself there. Figure 1 is somewhat confusing. In fact, I tried to make it this way because as I go forward to talk to my management, one of the things that I want to do is convince them that this is a confusing process. When you go to Reg Guide 1.52, section C.6.a, it says perform the test according to Table 2. When you go to Table 2, it says to do your laboratory test per Test 5.B of Table 5.1 of ANSI N-509-1976. When you go there, it says an acceptable test method is RDT-M16-1T, paragraph 4.5.3, except that 80°C and 95% RH is required for the test, but the pre- and post-loading sweep is at 25°C. That leads you to a test as we all know, that is going to fail. This problem has been around for quite a while. As Ron Bellamy discussed earlier, one of the problems we have is that in the current climate at the NRC verbatim compliance with Tech. Specs. is required. It does not matter that the tests you are performing actually give you a better picture of what your charcoal can do than the test that would be required by your Tech. Specs. This is what I am trying to correct. That is my goal, or one of my goals, right now and I have a couple of other issues that I am working on, too. Basically, what I am going forward with to my management is that, because of the confusion that surrounds the requirement for testing carbon, it takes you through this torturous path, and some plants are not in verbatim compliance with their Tech. Specs. However, in most cases, the tests that people are doing, (I think in all cases, but I have not been able to go through and actually check this to make sure) are more accurate than if they did the test in accordance with their Tech. Specs. We processed emergency Tech. Specs. changes for three plants, Davis Besse, Onconee, and Summer. Summer was the first. Also, Brunswick, in order to restart, flew a test sample up to Ohio to be tested in accordance with their Tech. Specs., because they wanted to be able to start up. We are trying to get around that. There is a second issue here, as far back as '87, through work that CONAGT and INEL did for the NRC, it was determined that there were some problems with the testing protocol of the '79 version of ASTM D 3803. We put out an informational notice that recommended that when the revision to D 3803 came out, which was the '89 revision, that people should start using that test protocol. We see that some people have gone to that test protocol, but a number have not. I see two issues that I would like to correct. One, is this verbatim compliance with Tech. Specs. and, two, is to get everybody testing to D 3803 - 1989. I am working on a paper that will tell the Commission what is going on and to see which way the wind is blowing when that floats up there. Eventually, what I want to do is put out some sort of generic communication, either a generic letter, or an administrative letter. I really think a generic letter is probably the best way to go. That would give the agency's position on this issue. As part of the generic letter process we would have to issue it for public comment. When you see the generic letter you will have an opportunity to comment on it. Your first indication of where we are going will be when the Commission paper is issued; it will probably be within the next month. As we worked on how to resolve this issue, we met with NHUG in April. They provided some good

information and were very supportive of going to the D 3803-1989 standard. It has been really good to work with a group that is proactive in trying to solve some of the problems we are having in this area. Maybe utility representatives that are here that are not part of NHUG, or not supporting their meeting, which is next week, might want to think of trying to support that group. It is a very good group. Another thing that I am working on is improved standard Tech. Specs. We are going to add a reviewer's note that will explain this issue very briefly to the Tech. Spec. reviewer at the NRC and, at the same time, will tell industry that we would like to see people go to D 3803-1989. One of the things we are looking at doing is to change the safety factor of 5-7 to determine the penetration, back down to a safety factor of about two. That may help people go to the standard. A lot of talk has been about fixing Reg. Guide 1.52 Rev 2, why we don't update it and put out Rev 3. There was a draft Rev 3 that the NRC put together a few years ago, but it did not go very far because of priorities. I do not know what it takes to get it to a higher level of priority. Maybe, as a result of this Commission paper and the actions that I am working on the effort might be able to be revived and we might be able to move forward on it. I can not guarantee anything, but I would hope to get out an updated version of the Reg. Guide, so that we do not have an agency position that is not right.

Figure 1

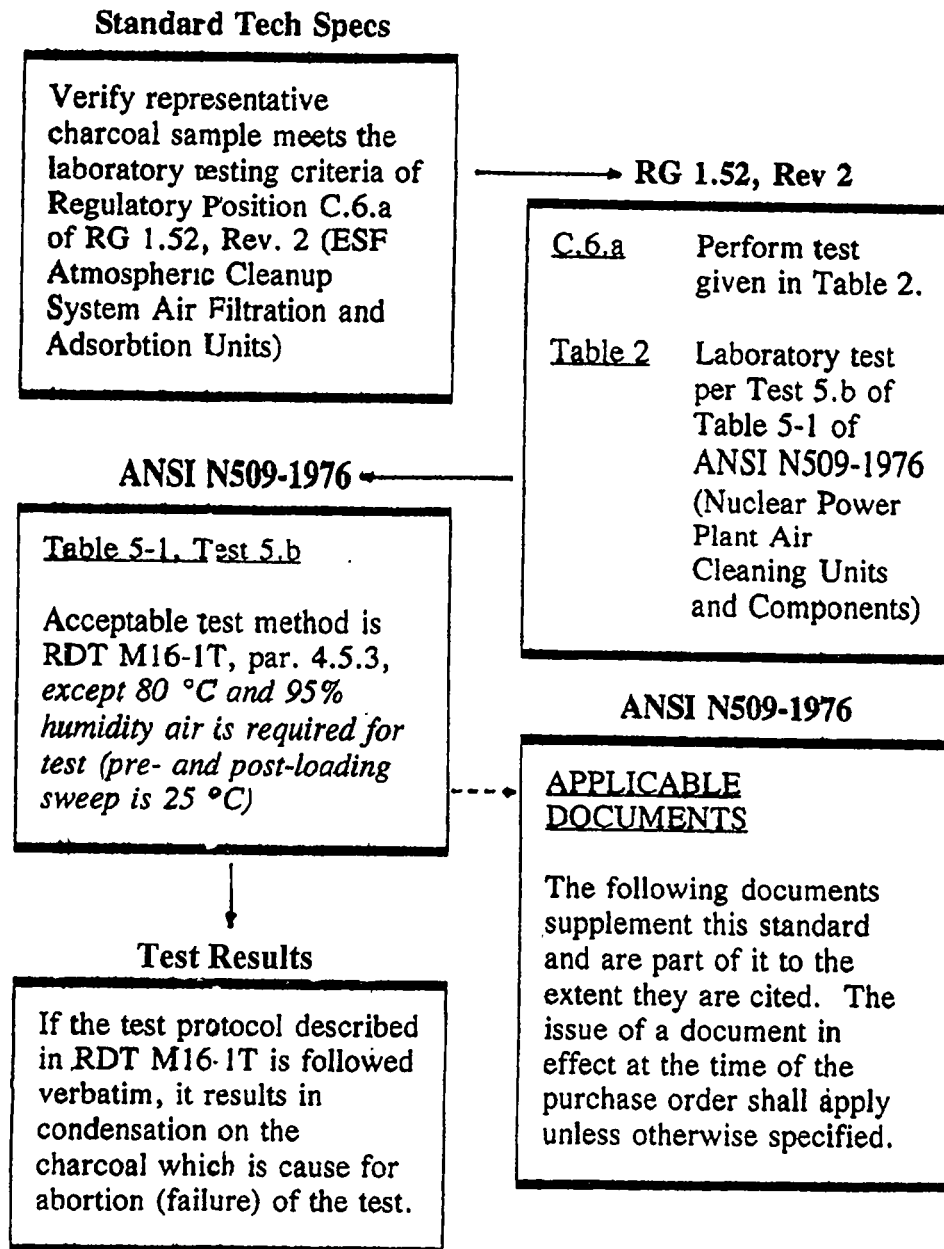

DISCUSSION

KOVACH: One of the reasons why I was upset with the hassle that we went through on charcoal testing was not the question of violating technical specifications. I expect that when you set technical specifications, people should be paying attention to them and they should be following them, I have no argument with that aspect of it. My major technical heartache related to the regulatory guide changing the standards and values for temperature and humidity, and therefore the NRC expecting that a temperature change from 80°C to 25°C, at the exact same relative humidity, would be technically feasible. Certainly you can run a test at 25°C and 95% RH but you have to have the carbon come to thermal and humidity equilibrium and maintain them throughout the test period. But I can't see why anybody who has a basic physical chemistry understanding of relative humidity and its dependence on temperature, would expect an instantaneous change from 25°C, 95% RH to 80°C, 95% RH and then back again to occur without condensing water in the bed. This is where I have a problem. Certainly you can run tests under three different conditions, but there has to be a time for change of equilibrium in between, you can't just make a turn on a switch and suddenly change from 25°C to 80°C and back to 25°C while maintaining the same relative humidity. This is a physical impossibility.

LYONS: I agree with that. In defense of the NRC we were referencing the standard.

KOVACH: But the standard does not tell you that you have to do it instantaneously.

LYONS: The words are directly out of the table in the standard.

KOVACH: I understand that, but how can you end up with the intent of the latest version of D3803 if you start interpreting the wording in your own way. Even though there is a code of federal regulation that contains an acceptable test, that does not exclude other acceptable tests that are more appropriate from a scientific standpoint than the exact wording as it reads now.

LYONS: It does not. In fact, people that have Tech. Specs., that either call for specific temperatures or cite other standards are the ones that don't get involved with D-3803. It is a problem with the wording that then becomes involved with a legal interpretation. N-509 leaves you with 80°C and 95% RH with a pre- and post- setting of 25°C. We have to fix it.

KOVACH: Another thing the industry's regulations writers have to understand is that when you cite standards that are in draft form, such as RDT M161-T, the T stands for tentative, because it is still evolving. There may be technical mistakes that have not been corrected. It is very hazardous to cite draft documents and then enforce them years later. The last issue of RDT M161-T looks very different from the original issue.

LYONS: What I have learned as I walk myself through some of these documents is that both the industry's and the staff's position on what is an appropriate test, and what conditions produce the most conservative results, have changed over the years. We have tended to flip-flop and that got us into this problem. When we issued Information Notice 87-32, the staff was trying to correct the problem. However, I do not think we were able to correct it as forcefully as we would have liked to have done and even then we would have been in the same predicament that you are pointing out. However, it would have probably worked out okay at that point.

SESSION 8

HVAC & DECOMMISSIONING

Wednesday July 17, 1996

Co-Chairmen: J.D. Paul
R. Porco

HVAC

CONTROL ROOM ENVELOPE UNFILTERED AIR INLEAKAGE TEST
PROTOCOLS

P.L. Lagus and R.A. Grot

VARIABLE PATTERN CONTAMINATION CONTROL UNDER
POSITIVE PRESSURE

H.M. Philippi

AEROSOL DEPOSITION IN BENDS WITH TURBULENT FLOW

A.R. McFarland, H. Gong, W.B. Wente, N.K. Anand, and A. Muyschondt

DECOMMISSIONING

ATMOSPHERIC DISCHARGES FROM NUCLEAR FACILITIES
DURING DECOMMISSIONING: GERMAN EXPERIENCES AND
CONCEPTS

H. Braun, R. Görtz, and L. Weil

HEATING, VENTILATING, AND AIR CONDITIONING
DEACTIVATION THERMAL ANALYSIS OF PUREX PLANT

W.W. Chen and R.A. Gregonis

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
CONTROL ROOM ENVELOPE UNFILTERED AIR INLEAKAGE TEST PROTOCOLS

Peter L. Lagus, Ph.D., CIH
Lagus Applied Technology
San Diego, CA 92121

Richard A. Grot, Ph.D.
Lagus Applied Technology
Olney, MD 20832

ABSTRACT

In 1983, the Advisory Committee on Reactor Safeguards (ACRS) recommended that the US NRC develop a control room HVAC performance testing protocol. To date no such protocol has been forthcoming. Beginning in mid-1994, an effort was funded by NRC under a Small Business Innovation Research (SBIR) grant to develop several simplified test protocols based on the principles of tracer gas testing in order to *measure* the total unfiltered inleakage entering a CRE during emergency mode operation of the control room ventilation system. These would allow accurate assessment of unfiltered air inleakage as required in SRP 6.4.

The continuing lack of a standard protocol is unfortunate since one of the significant parameters required to calculate operator dose is the amount of unfiltered air inleakage into the control room. Often it is *assumed* that, if the Control Room Envelope (CRE) is maintained at +1/8 in. w.g. differential pressure relative to the surroundings, no significant unfiltered inleakage can occur it is further assumed that inleakage due to door openings is the only source of unfiltered air.

The specific technical objectives of the effort were:

- 1) to define three simple tracer gas tests that would allow accurate measurement of CRE unfiltered air inleakage,
- 2) to define those additional engineering parameters knowledge of which would be required for each basic type of emergency ventilation system to allow measurement of unfiltered inleakage,
- 3) to provide a thorough error analysis of the inleakage measurement technique(s) so that defensible bounds could be placed on any resulting data, and
- 4) to generate test protocols based on the above three objectives that would allow measurement of unfiltered air inleakage by responsible plant personnel.

This paper summarizes the test protocols that were developed and discusses the accuracy to be expected from each of them.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

1.0 INTRODUCTION

In 1983, the Advisory Committee On Reactor Safeguards (ACRS) provided a series of recommendations to the NRC regarding control room habitability (Hayes, et al., 1984). One of the ACRS concerns was that NRC did not have a protocol for testing control room heating ventilating and air conditioning (HVAC) systems. It was recommended that the NRC develop such a protocol. Writing in the 18th DOE Nuclear Airborne Waste Management & Air Cleaning Conference, members of the ACRS observed "The NRC staff needs to expedite its efforts to develop a protocol for testing control room HVAC and air cleaning systems. Such tests should be conducted under realistic operating conditions.....all parts of the systems including dampers, ducts, etc. should be tested simultaneously as an integral unit.....particular attention should be given to assure that sections of such systems that are under negative pressure will not bring in contaminants which later can be transferred to the control room." (Moeller and Kotra, 1984).

As of early 1995, no control room HVAC performance testing protocol has been put forward by NRC. This lack of a standard test protocol is particularly unfortunate in light of the methodology used to calculate control room staff doses (Murphy and Campe, 1974, Stage, 1995). One of the significant parameters contained within either formalism is the amount of unfiltered air leakage into the control room.

Present practice appears to assess leakage based on models of air flow through cracks combined with assumed pressure differences. Often it is *assumed* that if the CRE is maintained at +1/8 in. w.g. differential pressure relative to the surroundings, no significant unfiltered leakage can occur and that leakage due to door openings is the only source of unfiltered air. Theoretically this can be true *only* if no portion of the return leg (or legs) of the CRE emergency ventilation system lies outside the CRE.

Negative differential pressure portions of return ducting, fan shaft seals, expansion boots, control dampers, ventilation fan or filter access panels, actuator shaft seals, and miscellaneous unsealed penetrations that lie outside the CRE can contribute substantial unfiltered air leakage. Other sources of unfiltered air leakage include improperly seated low leakage intake dampers and leakage from HVAC supply ductwork that traverses the CRE, but provides airflow to non-CRE portions of the building.

Sometimes, unfiltered air leakage is extrapolated from simple fan pressurization test data. Such an extrapolation is usually unwarranted since the pressure conditions that exist in a ventilation system/control room envelope under emergency operating conditions may not be the same as those generated by a fan pressurization test. ASTM Standard E779-87 (ASTM, 1992) which covers fan pressurization testing provides an explicit warning that extrapolation of fan pressurization data to actual operating conditions *is not feasible*.

It is often claimed that unfiltered air leakage can be discerned by visual inspection coupled with a ventilation system walkdown. Sometimes this walkdown is augmented by use of smoke tracing to identify leakage pathways. Since visual inspection is not quantitative, it can only discover obvious (open) leakage pathways and cannot deduce the magnitude of

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

potential leakage due to any pathway so discovered. For leakage sites that are hidden from view, visual inspection cannot discern their existence much less quantitatively assess the magnitude of any air leakage into a CRE.

Smoke testing was originally developed for use in visualizing airflows in mines and has proven to be useful in following airflow patterns within a limited volume. However, it provides no *quantitative* estimate of actual unfiltered leakage. In addition, care must be exercised in the interpretation of smoke flow patterns since the results often respond to localized airflows occurring at specific points within the CRE. Frequently, false indications of flow are caused by temperature gradients or transient atmospheric conditions that have nothing to do with actual leakage.

In light of the above enumerated deficiencies of existing CRE leakage testing techniques, a protocol based on the principles of tracer gas ventilation testing was felt to be appropriate. Tracer gas ventilation tests directly respond to the volumetric ventilation performance in the structure under test and hence do not possess the intrinsic drawbacks of the other methods.

The specific technical objectives of this effort were:

1. to define three simple tracer gas tests that would allow accurate measurement of control room emergency ventilation system operating characteristics, specifically unfiltered air leakage, on a reconnaissance basis,
2. to categorize the various types of emergency ventilation systems and, having done so, to define those additional engineering parameters that may be required in addition to tracer gas data to allow interpretation of tracer gas data in terms of unfiltered leakage,
3. to provide a thorough error analysis of the leakage measurement technique(s) so that defensible bounds may be placed on any resulting data, and
4. to generate test protocols based on the above three objectives that would allow the performance by responsible plant personnel of a simple tracer test to measure unfiltered air leakage.

Note that the test protocol developed in this effort would not, in general, disclose the actual location(s) of unfiltered leakage, but only the total amount. For a reconnaissance measurement, this quantity is sufficient to decide if the unfiltered leakage presents a problem in terms of compliance with GDC 19. To provide quantitative information as to leak location and magnitude requires more sophisticated testing than is being discussed in this paper.

2.0 TECHNICAL BACKGROUND

Tracer gases have been used to measure air infiltration and ventilation characteristics of buildings for over 30 years. Tracer gas techniques have been successfully used in other areas of ventilation engineering and industrial hygiene to provide accurate characterization of HVAC performance under actual operating conditions (Lagus and Persily, 1985, Grot and Lagus, 1991).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Within the nuclear power community, tracer gas techniques have been used since the early 1980's to measure, for instance, airflow patterns to investigate health and safety monitor locations (Hickey, et al., 1991) as well as to understand potential gaseous radioactive contaminant migration within selected buildings (Vavasseur, 1985, Lagus et al., 1988). Recently the results of a series of tracer gas measurements designed to measure total unfiltered inleakage into a nuclear power plant control room have been published (Lagus et al., 1992).

2.1 MEASURING BUILDING AIR FLOWS USING TRACER GASES

There are three principal tracer gas techniques for quantifying air flow rates within a structure; namely, the tracer dilution method, the constant injection method, and the constant concentration method. All are based on applying the conservation of mass equation to a tracer gas concentration established in a test volume. The tracer dilution method is a direct way of measuring the air flow rate extant within a test volume under ambient flow conditions by measuring the decay in tracer concentration within the volume as a function of time. The constant injection method is an indirect method, i.e., it measures the equilibrium tracer concentration within a ventilated area. This concentration can be related to the air flow rate if the tracer release rate is known. The constant concentration method is primarily a research method at this time and will not be discussed further. All three of these techniques are incorporated in the most recent revision of ASTM Standard E741-93 "Standard Test Method for Determining Air Change Rate in a Single Zone by Means of a Tracer Gas Dilution" (ASTM, 1993).

The mass balance equation and its various solutions that lead to the tests described above, have been provided in previous papers (Lagus and Persily, 1985, Grot and Lagus, 1991) and hence will not be reproduced here. These methods allow determination of either A or q . The air exchange or infiltration rate, A , is given by $A(t) = q(t)/V$ where A is in air changes per hour (h^{-1} or ACH), V is the test volume, and $q(t)$ is the volumetric airflow rate into (or out of) the test volume. In the simplest case, the value of A represents the flowrate of "dilution air" entering the volume during the test interval. Note that this "dilution air" can be actual outside fresh air or, more generally, it can be air whose origin is not within the test volume.

2.2 TRACER GAS MEASUREMENT TECHNIQUES

Instrumental techniques used to measure tracer gas concentrations are listed in Table 2.1, along with some of the gases appropriate to each measuring instrument. All of the gases listed have been used for airflow measurements either within buildings or within individual rooms. Several characteristics of nuclear power plant CREs influence the manner in which tracer techniques are applied. First, because of the large volumes, the quantity (and therefore cost) of tracer gas required for a test becomes important. The expense depends on the cost per unit volume of tracer gas, the CRE volume, and the magnitude of the lowest tracer concentration measurable. Table 2.2 shows the range of maximum volumes that can be measured for one dollars worth of tracer gas (1994 prices). These volumes range from about 9000 Ft^3 for helium to about $5.6 \times 10^{10} \text{ Ft}^3$ for SF₆.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Carbon dioxide exhibits an atmospheric background of approximately 350 ppm and is also generated by both combustion sources and human metabolism. Accordingly, it is difficult to assure that a non-variable background of CO₂ is maintained during a particular testing interval. In fact, detailed review and studies undertaken by the National Institute for Standards and Technology (NIST) have concluded that except for a limited set of circumstances, the use of CO₂ as a ventilation tracer gas is inappropriate (Persily, 1993).

Nitrous oxide has been used as a tracer gas primarily by European researchers. However, N₂O exhibits a Threshold Limit Value (TLV) of 50 ppm and hence may not be an appropriate choice for control room testing where test duration may approach eight hours. In the United States, health concerns related to the TLV of N₂O have resulted in little use of N₂O as a tracer.

The fact that SF₆, some halocarbons and some perfluorocarbons can be measured to levels of 10 parts per trillion and below yields maximum measurable volumes in the range of 5×10^8 to 5.6×10^{10} Ft³ per dollars worth of tracer gas. From Table 2.2 it is apparent that these gases (analyzed at the five to ten part per trillion level or even the part per billion level) are most appropriate for the large volumes encountered in Control Room Envelopes.

2.3 TRACER GAS MIXING

Because of the relatively large volume of the CRE, mixing of tracer gas is an important issue. Mixing by molecular diffusion is a slow process; however, even in naturally ventilated enclosures, there are significant convective mixing mechanisms. In mechanically ventilated environments, the air distribution system has been shown to be effective at mixing of the tracer gas (Grot and Persily, 1986). Experimentally, portable fans have been used to augment mixing of tracer at the expense of altering internal air movement patterns. The attainment of a uniform concentration can also be assisted by injecting tracer gas at several locations.

The issue of mixing of tracer gas in the CRE volume is of critical importance to the measurement and interpretation of concentration decay measurements in the determination of unfiltered inleakage. In order for the solutions to the mass conservation equation to be valid for the *entire* CRE volume it is required that the tracer be well mixed, i.e., the measured concentration anywhere in the volume is only a function of time. In practice, concentration homogeneity is taken to be +/- 10 % or better throughout the test volume (as specified in ASTM Standard E741).

A number of selected references in the published literature provide data supporting the feasibility of attaining "good mixing" of tracer within a test volume. In general, these references provide experimental tracer concentration data which show that mixing occurs fairly rapidly (within thirty minutes to, at most, one hour) in ventilated rooms or entire buildings ranging in volumes from 76 m³ up to over of 10⁵ m³ (Alevantis and Hayward, 1990, Evans and Shaw, 1988, Shaw et al., 1993, Reardon et al., 1994).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Previous measurements by the authors in two control rooms (one a single story CRE with a volume of approximately 1700 m³ and the other a two story CRE with a volume of approximately 4000 m³) that were mechanically ventilated, demonstrated that it was possible to attain concentration variations of less than +/- 2% in the single story CRE and less than +/- 5% in the two story CRE, by including of a number of auxiliary mixing fans at various points with the volumes.

ASTM Standard E741 suggests that inleakage can be measured using a tracer gas technique with an error of 10% or less of the measured value. The experimental conditions considered in the examples of this study suggest that errors of half (i.e. approximately 5%) of this value are attainable.

Note that most of the instrumental techniques utilize electron capture detector gas chromatography for measurements in large volumes primarily due to tracer gas cost considerations. However, measurements have been performed in large buildings using other techniques such as infrared absorption (Potter et al., 1983, Zeurcher and Feustel, 1983) and flame ionization gas chromatography (Prior et al., 1983).

3.0 CONTROL ROOM ENVELOPE TEST METHODS

Four basic types of CRE emergency ventilation systems were considered:

1. Isolation of normal ventilation with filtered pressurization,
2. Isolation of normal ventilation with filtered recirculation,
3. Isolation of normal ventilation with filtered pressurization and recirculation,
4. Bottled Air for Pressurization.

All four basic ventilation types are amenable to a tracer gas decay test to determine unfiltered inleakage. Type 2 above can be measured by a simple tracer decay test, while types 1, 3, and 4 require both a tracer decay test and an independent measure of the pressurization flowrate.

3.1 TRACER DECAY TEST

The tracer decay test method requires only the measurement of relative tracer gas concentrations, as opposed to absolute concentrations, and the analysis required to determine A is straightforward. Equation (1) serves as a starting point for an actual test .

$$A = 1/t \ln (C_0/C) \quad (1)$$

In practice one obtains a series of concentration versus time points and then performs regression analysis on the logarithm of concentration versus time to find the best straight line fit to the form of the equation given by equation (7).

The slope of this regression yields the air exchange rate, A. Knowledge of the volume, V, allows calculation of the leakage flowrate q since

$$q = A*V.$$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In the case of a CRE with makeup flow, the value of q (or A) determined is the total air leakage rate. This will consist of the unfiltered leakage and the actual makeup flow rate. For this case an independent determination of the makeup (or pressurization) flowrate, q_{makeup} , is required. The unfiltered leakage is then determined as follows;

$$q_{\text{unfiltered}} = q - q_{\text{makeup}} \quad (2)$$

where q is the rate determined from the tracer concentration decay measurement (and is equal to $A \cdot V$) and now represents the total "fresh air" leakage rate into the CRE. Equation (2) can be written

$$q_{\text{unfiltered}} = A \cdot V - q_{\text{makeup}} \quad (3)$$

In the case of a CRE with recirculation only (no makeup) then q (or A) measures the unfiltered leakage *directly* and q_{makeup} would be identically equal to zero.

Standard statistical arguments applied to equation (3) lead to the following estimate of the uncertainty in the determination of $q_{\text{unfiltered}}$:

$$S_{qu} = \text{SQRT}\{ (S_A)^2 + (S_V)^2 + (S_{qm})^2 \} \quad (4)$$

where S_{qu} = Probable error in the value of $q_{\text{unfiltered}}$

S_A = Probable error in the value of A

S_V = Probable error in the value of V

S_{qm} = Probable error in the value of q_{makeup}

In Figures 1 to 5 the probable error in a given value of unfiltered leakage for several assumed error values in measured concentration, CRE volume and leakage rate. The assumed measurement errors attendant to each case are described below:

- CASE I Error in $V = 2\%$, Error in $q_{\text{makeup}} = 3\%$, Error in $A = 2\%$
- CASE II Error in $V = 3\%$, Error in $q_{\text{makeup}} = 5\%$, Error in $A = 5\%$
- CASE III Error in $V = 3\%$, No Makeup flow, Error in $A = 5\%$
- CASE IV Error in $V = 5\%$, Error in $q_{\text{makeup}} = 10\%$, Error in $A = 10\%$
- CASE V Error in $V = 5\%$, No Makeup flow, Error in $A = 10\%$

As can be readily seen, the error in the measured value of $q_{\text{unfiltered}}$ is never very large. The error in the measured value of unfiltered leakage is smaller for those cases having recirculation only (no makeup air). For relatively modest measurement errors in the variables needed to obtain unfiltered leakage, the error in the resulting unfiltered leakage

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

remains moderate. Note that the measurement errors in Cases I, II, and III above are considered more representative of actual practice than those in Cases IV and V.

It is possible to use equation (1) to estimate the length of time required for a given measurement error. Taking differentials of C and A and rearranging, one arrives at

$$\text{TEST TIME} = \{2*(dC/C)\}/\{(dA/A)*A\} \quad (5)$$

where (dC/C) = Concentration measurement error

(dA/A) = Total air exchange rate measurement error

Note that the test times calculated from equation (5) use the *end* points of the measured concentration decay, i.e. the calculation assumes that only two points are used to determine the slope of the line. By performing a regression analysis on a number of concentration data points as described above, it is possible to reduce the probable error in the measured value of A or the time required to achieve a given value of probable error.

To illustrate this, a number of regression analyses were undertaken on simulated concentration decay data to calculate the probable error in the "measured" value of A as a function of elapsed time. Two series of calculations were performed for several leakage rates (corresponding to makeup rates from 100 to 800 CFM) assuming one data point every thirty minutes and also one every fifteen minutes. An additional series of calculations was undertaken in which the leakage rate was fixed and the number of data points sampled at each measurement time was systematically increased.

Figures 6 and 7 show probable error for various leakage rates as a function of total test time. For a sampling interval of thirty minutes, for all cases considered, the probable error does not drop below 15% in less than six hours. Decreasing the sampling time to fifteen minutes decreases the probable error to less than fifteen percent in a four hour test. Note also that as the leakage rate *increases*, the probable error for a given test time *decreases*. For these simulations the measurement error was assumed to be +/- 2%.

Figure 8 demonstrates the effect of increasing the number of concentration data points taken at each sampling interval. This plot illustrates calculations for $A = 0.125$ ACH. For higher air leakage rates, the corresponding test times to attain a given probable error will decrease. Based on this calculation it appears that sampling at eight points every half hour will ensure that the probable error will lie below 5% within four hours assuming that the uncertainty in concentration is +/- 2%.

Figure 9 provides a similar calculation assuming the concentration measurement uncertainty is +/- 5%. In this case, by taking eight concentration data points per measurement interval, the probable error in the leakage rate will be less than 10% for test times of four hours or more.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

To assure that good mixing has been achieved, a careful experimenter should obtain at least four spatially separated samples at each sampling time. Based on the above examples, a four hour test will generate an inleakage value that is precise to within +/- 10% if the individual concentration data points differ by less than +/- 5%. Higher precision is possible if the scatter in the concentration data points at each time interval is less (i.e. mixing is better).

During the actual testing, ingress and egress to the CRE should be kept to an absolute minimum. Any necessary ingress and egress should be through a single door and accomplished as rapidly as possible. No more than two door openings should be allowed during each hour of testing. At no time during a test should *two* doors to the CRE be opened simultaneously. **If two doors to the CRE are opened simultaneously, any test results should be considered invalid.**

All internal ventilation fans (such as bathroom and kitchen ventilators) in the CRE should be turned off unless they remain in operation during an emergency. These fans should be disabled in such a way as to ensure that the fans will not be accidentally energized during a test.

To assist in attainment of a well mixed volume within the CRE, one auxiliary mixing fan should be provided for each 1,000 to 2000 ft² of CRE floor area. Fans should be arranged throughout the CRE area to enhance air movement within the CRE. For CREs having drop ceilings, experience has shown that removal of a small fraction (5% to 10%) of the ceiling panels coupled with the placement of several of the required mixing fans above the drop ceiling will enhance air flow across the drop ceiling boundary and hence, overall air mixing within the CRE. Air samples from above the drop ceiling should be analyzed to demonstrate that good mixing has been achieved.

3.1.1 TRACER DECAY TEST PROCEDURE

Tracer gas is injected into a CRE emergency ventilation supply duct at a rate calculated to achieve a desired concentration. Experience has shown that for mechanically ventilated structures, injection of a diluted mixture of tracer gas over approximately thirty minutes enhances the mixing of gas with the test volume.

Air samples from at least four, and as many as eight, spatially diverse locations within the CRE, should be obtained at thirty minute intervals. For most conditions likely to be encountered in testing unfiltered inleakage a maximum test duration of four hours should be used. Note that it is possible to terminate a test in less than four hours if the actual regression data indicate that a 95% probable error of less than 10% (5%) has been achieved in less time.

If the CRE incorporates makeup flow in its emergency operating mode, then this makeup flowrate should be measured using a pitot tube or hot wire traverse or a tracer flow technique both *before* and *after* the tracer decay test, and the results averaged.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

3.1.2 CALCULATIONS

If the CRE does not provide makeup flow in the emergency ventilation mode, the value of A calculated by regression of the tracer concentration decay data is also the *unfiltered leakage*.

If the CRE does provide makeup flow in the emergency mode, then the values of makeup flow measured Pre and Post test are averaged:

$$q_{\text{makeup}} = (\text{Pretest Makeup Flow} + \text{Post Test Makeup Flow})/2 \quad (6)$$

The unfiltered leakage is then given by equation (3) rewritten here as equation (7):

$$q_{\text{unfiltered}} = A * V - q_{\text{makeup}} \quad (7)$$

Note that regression analysis should be performed after the first three sampling intervals and should be continued for each subsequent sample interval. When then 95% probable error calculated in the regression drops below 10% (or 5%), air sampling and analysis may be discontinued. As noted above, the maximum test interval contemplated in the tracer decay test is approximately four hours.

3.2 CONSTANT FLOWRATE TEST PROCEDURE

The constant flowrate test is an alternate technique that avoids the requirement for accurate knowledge of the CRE volume. Uncertainty in the accurate knowledge of CRE volume can contribute to the uncertainty in the final measured result. Also, for CRE's that exhibit high makeup air flowrates (values of A greater than approximately 1.5, or makeup flows of 2500 CFM for a 100,000 cubic foot CRE), tracer concentration decay may occur very quickly. Also, the tracer gas analyzer may not possess a sufficiently broad measurement range to encompass data taken over a four hour interval.

Accordingly a tracer test that uses a constant flowrate injection of tracer gas into the CRE while measuring the resulting concentrations at selected locations can be used. For the following derivation the return air system is included in the CRE volume. If it is assumed that the volume is well mixed, one can apply conservation of mass to the elements of a CRE shown in Figure 10, and arrive at equation (8):

$$Q_{\text{in}} = Q_{\text{sup}} ((C_{\text{sup}}/C_{\text{T}}) - 1) \quad (8)$$

where Q_{in} = Inleakage (anywhere into CRE)
 Q_{sup} = Total Supply Flowrate
 C_{sup} = Equilibrium Concentration in Supply duct
 C_{T} = Equilibrium Concentration at end of return duct

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In deriving equation (8) it is assumed that tracer is injected at a constant flowrate into the supply duct.

Note that this expression does not require knowledge of the control room volume. Standard statistical arguments applied to equation (8) lead to the following estimate of the uncertainty in Q_{in} :

$$S_{inleak} = \text{SQRT} \{ (S_{qsup})^2 + (S_{csup})^2 + (S_r)^2 \} \quad (9)$$

where S_{inleak} = Probable error in the value of Q_{in}
 S_{qsup} = Probable error in the value of Q_{sup}
 S_{csup} = Probable error in the value of C_{sup}
 S_r = Probable error in the value of C_r

Note that there are the same number of terms in equation (9) as in equation (4), but two of them are related to the gas analyzer measurement error and one to the error in flowrate measurement. These errors are intrinsically more amenable to statistical treatment than is the control room envelope volume.

Figures 11 and 12 provide a graphical illustration of the uncertainty in the measured leakage value using this technique. Note that what is plotted is the minimum measurable leakage as a function of total supply flowrate (Makeup flowrate plus return flowrate). Any value of leakage greater than the minimum shown can be determined reliably by this method. The fact that there is a minimum value of leakage measurable by this technique arises from the ability of the measurement device to discriminate between two concentrations that are close in value. This technique is complementary to that provided in Section 3.1 and is provided as a way to eliminate the uncertainty engendered by imprecise knowledge of the control room envelope volume and to allow testing in CREs possessing a high value of makeup air flowrate.

3.2.1 CONSTANT FLOW TEST PROCEDURE

Tracer gas is injected into a CRE emergency ventilation supply duct at a rate calculated to achieve a desired concentration. For this test the target tracer gas concentration should lie in the middle of the measurement range of the gas analyzer.

An approximate value of the total air change rate is calculated based on a measured or assumed value of the makeup flowrate. This value, A_A , can be used to estimate the length of time that must elapse before concentration equilibrium will occur within the CRE. If one starts with a zero initial concentration and injects at a constant rate, it can be shown that the tracer gas will reach 95% of the equilibrium concentration within the CRE volume after a time equal to $3/A_A$.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Air samples from at least four spatially diverse locations within the CRE should be obtained at thirty minute intervals. Air samples must also be taken from the supply duct as well as the beginning and end of the return duct of the control room emergency ventilation system. For most conditions likely to be encountered in testing unfiltered inleakage, a maximum test duration of four hours should be used.

The total mechanical air supply flowrate (makeup plus recirculation) into the CRE should be measured using a pitot tube or hot wire traverse or a tracer flow technique.

3.2.2 CALCULATIONS

Tracer gas concentration data are treated by forming the mean of five measurements for each of the two concentration values, C_{sup} and C_r . The CRE Supply Rate is calculated by averaging the Pre and Post Test Supply Flowrates as follows:

$$Q_{sup} = (\text{Pretest Supply Flow} + \text{Post Test Supply Flow})/2 \quad (10)$$

The unfiltered inleakage is then given by inserting these concentration values and flowrate into equation (8) to obtain Q_{in} .

3.3 DIRECT TRACER GAS INLEAKAGE TEST

Direct measurement of leakage (leak testing) using a tracer gas (usually helium and, less frequently, sulfur hexafluoride) is a powerful technique that is used extensively in the micro-electronics and defense/aerospace industries. In this technique, an object to be tested is either filled with tracer gas and the periphery monitored for leaking tracer, or the exterior is flooded with tracer gas and the interior is sampled for the presence of tracer gas. The measurement of non-zero quantities of tracer gas in either of these situations provides unambiguous evidence for the existence of leakage. The resulting tracer gas concentration can be used to infer leakage rate for a suitably designed experiment.

It is possible to apply this same reasoning to nuclear power plant CRE's. If one imagines a ventilated test volume surrounded by tracer gas as shown in Figure 13, leakage into the volume can be determined using conservation of mass. For this case;

$$Q_{in} = (C/C_0) \times Q_{makeup} \quad (11)$$

where

- Q_{in} = unfiltered inleakage rate
- Q_{makeup} = makeup flowrate
- C = tracer concentration in CRE
- C_0 = tracer concentration outside CRE.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In practice it is possible to challenge one boundary of the CRE at a time (if necessary for experimental convenience) with a concentration of tracer gas. Any tracer measured within the CRE would provide unambiguous evidence of inleakage through that boundary. Furthermore, by measuring the challenge concentration and the makeup flowrate within the CRE it is possible to calculate an inleakage rate across this boundary using equation (11) above.

An experimental complication to this technique is the potential for exhaust reentrainment to occur. If air containing tracer gas is exhausted from the CRE, it may reenter the CRE from the outside via the makeup fan. This reentrainment would render the results of any calculation based on equation (11) meaningless.

For those CRE's that possess filtered makeup air (i.e. filtered pressurization emergency ventilation system), it is possible to use a perfluorocarbon tracer and eliminate the possibility of reentrainment into the CRE. It has been documented that perfluorocarbon vapors exhibit exceptionally long hold-up times on carbon. Perfluordimethylcyclobutane (PDCB) exhibits at least thirty minutes hold-up in a nuclear industry standard two inch bed, while perfluoromethylcyclohexane (PMCH) exhibits a hold-up that is easily six times this value (Pearson et al., 1992). These vapors also possess a high detection sensitivity (approaching that of SF₆) when analyzed using the techniques of electron capture gas chromatography.

Accordingly, if one were to challenge the exterior of a CRE with a moderate concentration of PMCH, one could sample inside the CRE for up to three hours without any concern about reentrainment of tracer gas. Measurement of PMCH within the CRE would provide unambiguous evidence of inleakage. Use of equation (11) above would allow a calculation of inleakage to be made.

For CREs that are wholly located within a plant building, it may be possible to seed the HVAC system that supplies the regions surrounding the CRE directly with tracer gas. Injection of a constant, known flowrate of tracer gas into the supply systems coupled with measurement of the resulting concentration in the regions surrounding the CRE would allow use of equation (8) to infer unfiltered inleakage.

Note that it is possible to use builders plastic (Visqueen) mounted on a lightweight wooden or metal framework to create a test volume surrounding some of the boundary walls of the CRE. This could be useful if one of the boundaries was, for instance, an outside wall or a roof. Mixing of the tracer gas within this plastic tent could be easily accomplished using several oscillating fans. The structure itself would not have to last longer than a few days. Using a combination of injection into rooms adjacent to the CRE and into fabricated plastic tents that enclose adjacent regions not contained within rooms, allows tracer inleakage testing to be performed on many CREs that rely on filtered pressurization during emergency operation.

3.3.1 DIRECT INLEAKAGE TEST PROCEDURE

Tracer gas is injected into the supply that provides ventilation air to the region surrounding the CRE (or into a specially fabricated plastic tent) at a rate calculated to achieve a desired concentration. For this test the target tracer gas concentration within the region(s) surrounding the CRE should be approximately 1 ppm. Anticipated concentrations within the CRE should lie in the middle of the measurement range of a second gas analyzer.

An approximate value of the total air change rate is calculated based on a measured or assumed value of the makeup flowrate. This value, A_A , can be used to estimate the length of time that must elapse before concentration equilibrium will occur within the CRE. If one starts with a zero initial concentration and injects at a constant rate, it can be shown that the tracer gas will reach 95% of the equilibrium concentration within the CRE volume after a time equal to $3/A_A$.

Air samples from at least four spatially diverse locations within the CRE should be obtained at thirty minute intervals. Air samples must also be taken from each region surrounding the CRE as well as on the delivery side of the charcoal filter in the control room emergency ventilation system. If significant breakthrough of tracer is detected at this point, the test must be terminated. For most conditions likely to be encountered in testing unfiltered inleakage a maximum test duration of three hours should be used.

The makeup flowrate supplied to the CRE should be measured using a pitot tube or hot wire traverse or a tracer flow technique.

3.3.2 CALCULATIONS

Tracer gas concentration data are treated by forming the mean of the final CRE concentration measurements and the final surrounding region concentration measurements to provide values of C and C_0 as required in equation (11).

The CRE Makeup Rate is calculated by averaging the Pre and Post Test Makeup Flowrates as follows:

$$Q_{\text{makeup}} = (\text{Pretest Makeup Flow} + \text{Post Test Makeup Flow})/2 \quad (12)$$

The unfiltered inleakage, Q_{in} , is then calculated from equation (11).

4.0 CONCLUSIONS AND RECOMMENDATIONS

The preceding has provided a brief introduction to the principles of tracer gas ventilation measurements. Three different methods that allow assessment of unfiltered inleakage into a nuclear power plant Control Room Envelope (CRE) using

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

tracer gas techniques have been described. It has been shown that unfiltered inleakage within a CRE *can* be measured in a straightforward manner to better than +/- 10% in periods of less than eight hours.

The ability to measure actual inleakage in an operating ventilation system relates directly to the entire issue of safety and habitability of operating nuclear power plants during accident conditions as specified in GDC 19. An experimental method (or methods) to measure inleakage will result in more reliable estimates of Control Room Envelope integrity, and hence operator safety, in the event of a toxic gas release or radiological accident. The ability to reliably demonstrate the safety of control room occupants under accident conditions will provide immeasurable benefits both to the federal government and to the nuclear power generating industry.

5.0 ACKNOWLEDGMENT

This work was supported in part by a US Nuclear Regulatory Commission Small Business Innovation Research (SBIR) Grant, number NRC-04-94-070.

6.0 REFERENCES

Alevantis, L.E., and S.E. Hayward, "The Feasibility of Achieving Necessary Initial Mixing when using Tracer Gas Decays for Ventilation Measurements," in *Proceedings of the Fifth International Conference on Indoor Air Quality and Climate*, Toronto Canada, 1990.

American Society for Testing and Materials, ASTM Standard E779-87 "Standard Test Method for Determining Air Leakage by Fan Pressurization," Philadelphia, 1992.

--ASTM Standard E741-93 "Standard Test Method for Determining Air Change Rate in a Single Zone by Means of a Tracer Gas Dilution," Philadelphia, 1993.

Evans, R.G., and C.Y. Shaw, "A Multiposition Tracer Gas Sampling System for Building Air Movement Studies," in *AIVC Technical Note 24*, Air Infiltration and Ventilation Centre, University of Warwick, England, 1988.

Hayes, J.J., D.R. Moeller, and W.P. Gammill, "NRC Study of Control Room Habitability," in *Proceedings of the 18th DOE/NRC Air Cleaning Conference*, August, 1984.

Grot, R.A., and P.L. Lagus, "Application of Tracer Gas Analysis to Industrial Hygiene Investigations," in *Proceedings of the 12th Air Infiltration and Ventilation Centre Conference*, Ottawa, 1991.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Grot, R.A., and A.K. Persily, "Measured Infiltration and Ventilation Rates in Eight Large Office Buildings," in *Measured Air Leakage of Buildings*, ASTM STP 904, H.R. Trechsel and P.L. Lagus, Eds., ASTM, Philadelphia, 1986.

Hickey, E.E., G.A. Stoetzel, P.C. Olsen, and S.A. McGuire, "Air Sampling in the Workplace," *NUREG-1400*, USNRC, Washington, 1991.

Lagus, P.L., and A. Persily, "A Review of Tracer Gas Techniques for Measuring Airflows in Buildings," *ASHRAE Trans.* Vol. 91, 1985.

Lagus, P.L., V. Kluge, P. Woods, and J. Pearson, "Tracer Gas Testing Within the Palo Verde Nuclear Generating Station," in *Proceedings of the 20th DOE/NRC Air Cleaning Conference*, Boston, 1988.

Lagus, P.L., L. DuBois, K. Fleming, and J. Brown, "Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station," in *Proceedings of the 22nd DOE/NRC Air Cleaning Conference*, Denver, 1992.

Moeller, D.W. and J.P. Kotra, "Commentary on Nuclear Power Plant Control Room Habitability," in *Proceedings of the 18th DOE/NRC Air Cleaning Conference*, August, 1984.

Murphy, K.G. and K. M. Campe, "Nuclear Power Plant Control Room Ventilation System Design for Meeting GDC 19," in *Proceedings of the 13th AEC Air Cleaning Conference*, August, 1974.

Pearson, J.P., K.M. Fleming, J.R. Hunt, and P.L. Lagus, "Replacement Tracer Agents for the In-place Testing of Adsorbers in NATS," in *Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference*, Denver, 1992.

Persily, A.K., "Ventilation, Carbon Dioxide and ASHRAE Standard 62-1989," *ASHRAE Journal*, September, 1993.

Persily, A.K., and L.K. Norford, "Simultaneous Measurements of Infiltration and Intake in an Office Building," *ASHRAE Trans.*, Vol. 93, Pt. 2, 1987

Potter, N., J. Dewsbury, and T. Jones, "The Measurement of Air Infiltration Rates in Large Enclosures and Buildings," in *Air Infiltration Reduction in Existing Buildings*, proceedings of the Fourth Air Infiltration Centre Conference, Elm Switzerland, 1983.

Prior, J., J. Littler, and M. Adlard, "Development of Multi-tracer Gas Technique for Observing Air Movement in Buildings," *Air Infil. Rev.*, Vol. 4, No. 3, 1983.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Reardon, J.T., C.Y. Shaw, and F. Vaculik, "Air Change Rates and Carbon Dioxide Concentrations in a High Rise Office Building," *ASHRAE Trans.*, No. 100, Pt. 2, 1994.

Shaw, C.Y., J.S. Zhang, M.N. Said, R.J. Magee, and F. Vaculik, "Effect of Air Diffuser Layout on the Ventilation Conditions of a Workstation," *ASHRAE Trans.*, No.99, Pt.2, 1993.

Stage, S.A., "Computer Codes for Control Room Habitability (HABIT), NUREG/CR6210, US NRC, Washington, 1995

Vavasseur, C., "Application of Tracer Gas Methods to the Measurement of Ventilation Parameters in Nuclear Power Plants and Various Industrial Sectors," in *1st International Symposium on Ventilation for Contaminant Control*, Toronto, Canada, 1985.

Zuercher, C.H. and H. Feustel, "Air Infiltration in High-rise Buildings," in *Air Infiltration Reduction in Existing Buildings*, proceedings of the Fourth Air Infiltration Centre Conference, Elm Switzerland, 1983.

TABLE 2.1

TRACER GASES AND MEASUREMENT DEVICES

<u>Techniques</u>	<u>Gases</u>
Thermal Conductivity Detector	H ₂ , He, CO ₂
Electron Capture Gas Chromatograph	SF ₆ , Refrigerants, Perfluorocarbons
Flame Ionization Gas Chromatograph	C ₂ H ₆
Infrared Absorption Continuous Analyzer	CO, CO ₂ , SF ₆ , N ₂ O, C ₂ H ₆ , CH ₄

TABLE 2.2

RELATIVE GAS COSTS
TAKING DETECTABILITY INTO ACCOUNT*

Gas	Detectable Concentration (ppm)	Maximum Measurable Volume per Dollar	
		Ft ³	m ³
He	300	9.3 x 10 ³	2.6 x 10 ²
CO ₂	350**	3.2 x 10 ⁴	8.9 x 10 ²
N ₂ O	1	2.8 x 10 ⁶	7.9 x 10 ⁴
SF ₆	5 x 10 ⁻⁶ (a)	5.6 x 10 ¹⁰	1.6 x 10 ⁹
SF ₆	1 (b)	5.6 x 10 ⁴	1.6 x 10 ³
CBrF ₃	5 x 10 ⁻⁵	5.0 x 10 ⁸	1.4 x 10 ⁷
PDCB (c)	10 x 10 ⁻⁶	1.3 x 10 ⁹	3.7 x 10 ⁷

* Based on 1994 Gas Prices for Size 1A Gas Cylinders. (1 Kgm liquid for PDCB)

** Average Background Concentration in the atmosphere.

(a) Detection by Electron Capture Gas Chromatography.

(b) Detection by Continuous IR Monitor.

(c) Perfluorodimethylcyclobutane

UNFILTERED INLEAKAGE UNCERTAINTY-WITH MAKEUP (dV=2%, dQ=3%, dA=2%)

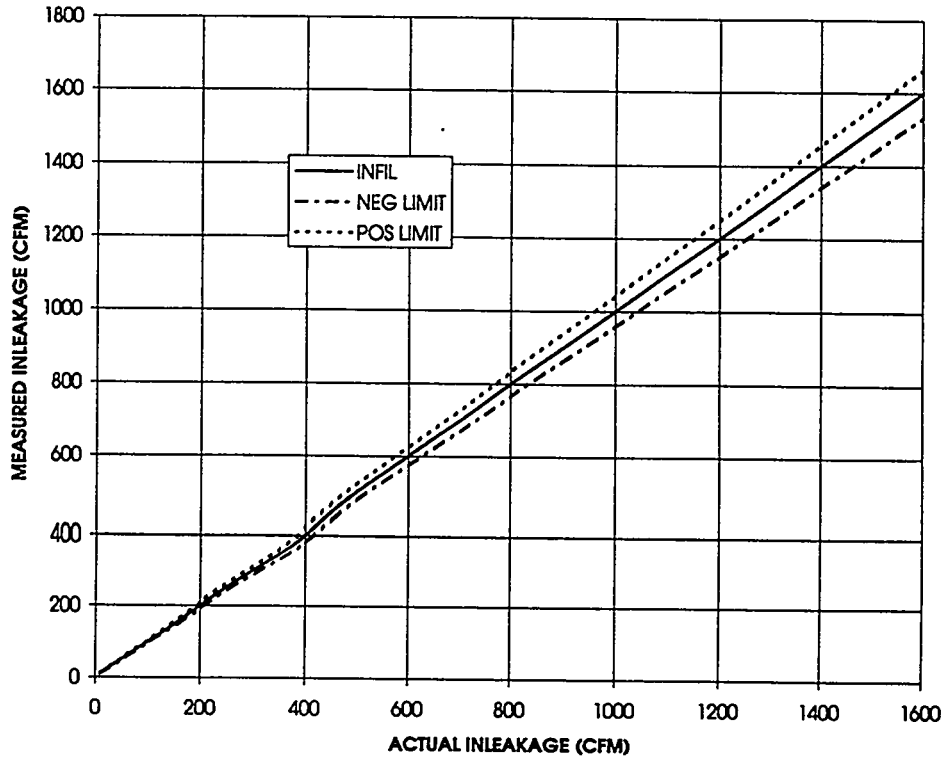


Figure 1. Unfiltered Inleakage with Makeup-Case I

UNFILTERED INLEAKAGE UNCERTAINTY-WITH MAKEUP (dV=3%, dQ=5%, dA=5%)

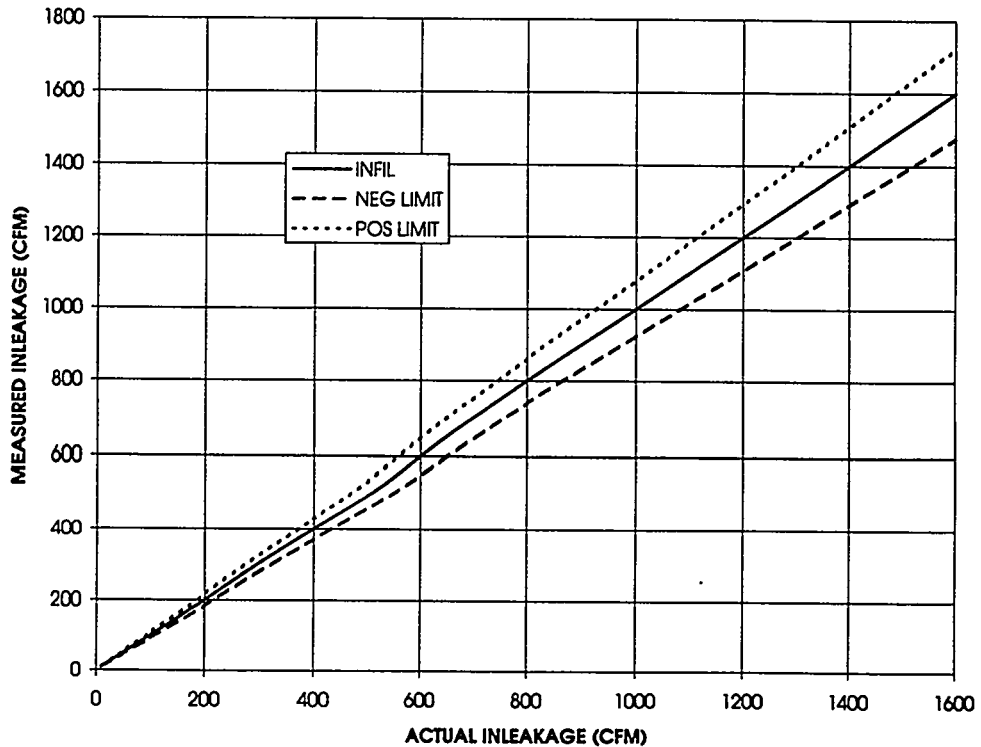


Figure 2. Unfiltered Inleakage with Makeup-Case II

UNFILTERED INLEAKAGE UNCERTAINTY-NO MAKEUP($dV=3\%$, $dA=5\%$)

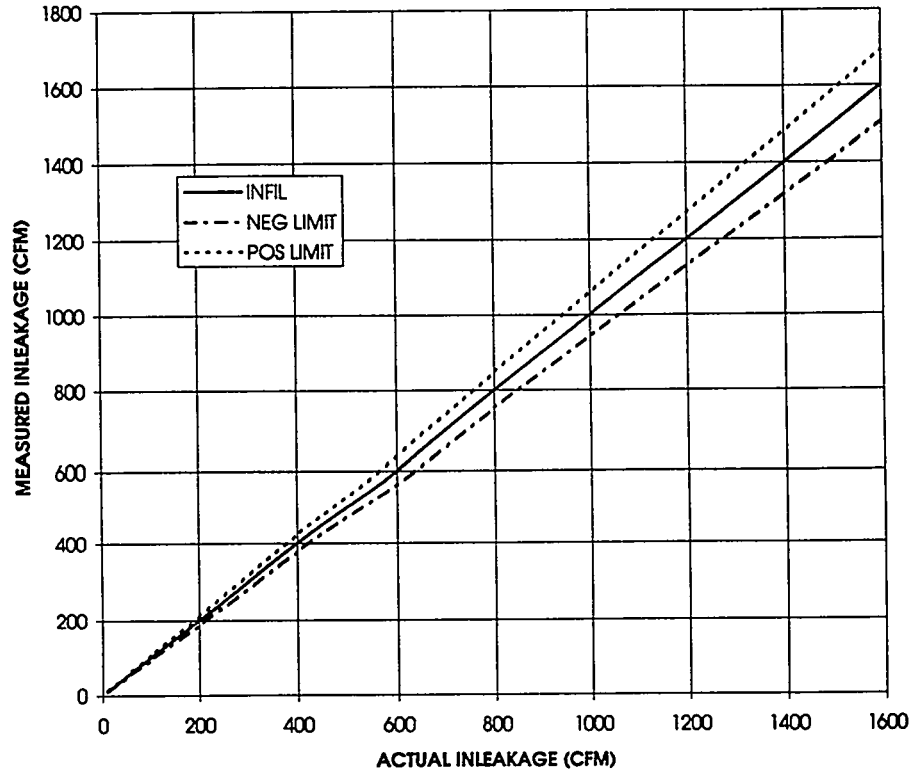


Figure 3. Unfiltered Inleakage no Makeup-Case III

UNFILTERED INLEAKAGE UNCERTAINTY-WITH MAKEUP
($dV=5\%$, $dQ=10\%$, $dA=10\%$)

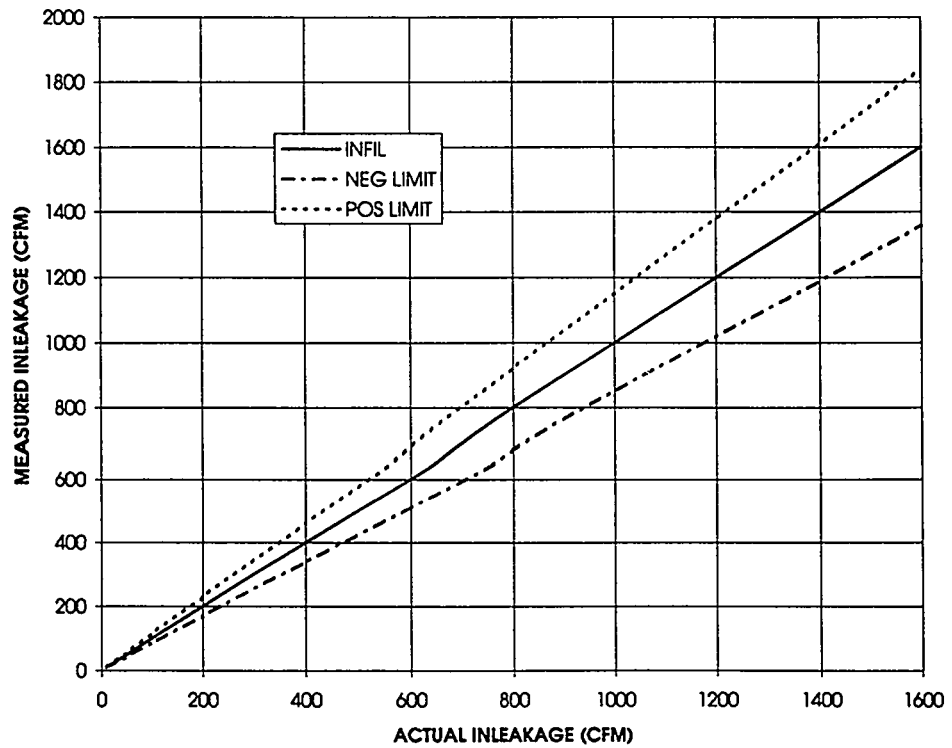


Figure 4. Unfiltered Inleakage with makeup-Case IV

UNFILTERED INLEAKAGE UNCERTAINTY-NO MAKEUP (dV=5%,dA=10%)

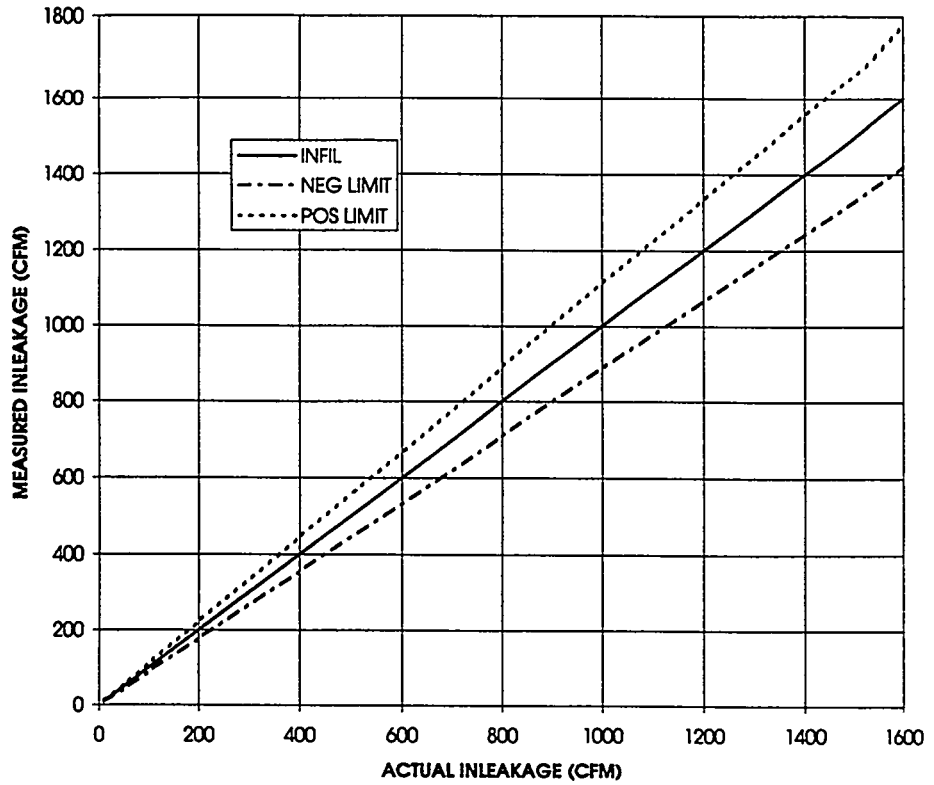


Figure 5. Unfiltered Inleakage no Makeup-Case V

95% PROBABLE ERROR FOR VARIOUS INLEAKAGE RATES (DATA POINT EVERY THIRTY MINUTES, dC=0.02)

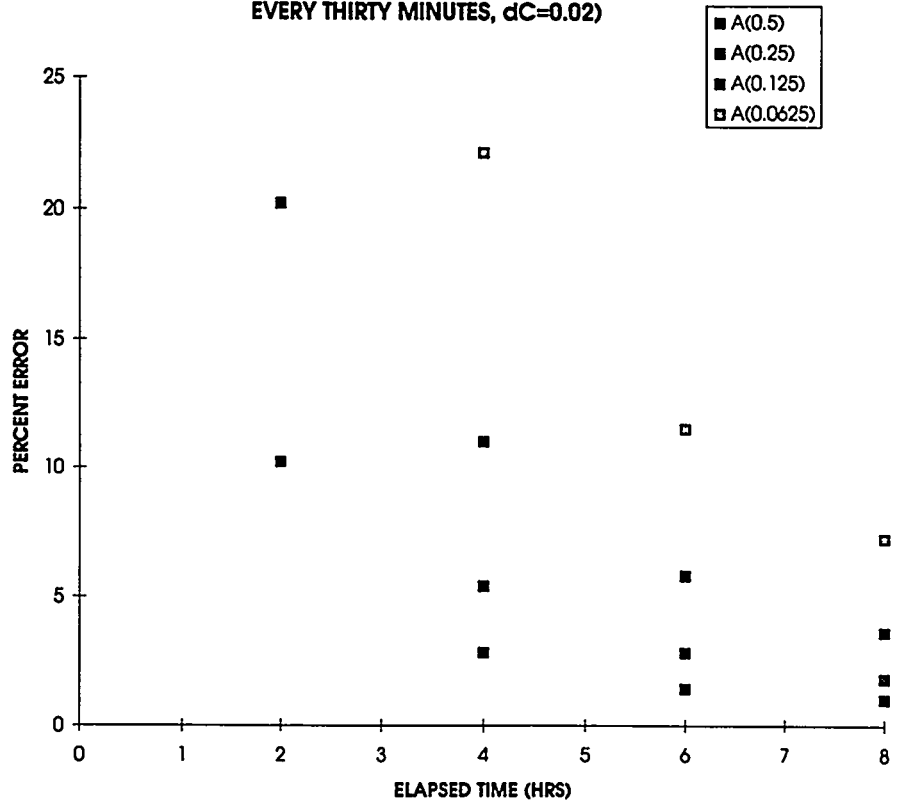


Figure 6. Probable Error-Data Point Every Thirty Minutes

95% PROBABLE ERROR FOR VARIOUS INLEAKAGE RATES (DATA POINT EVERY FIFTEEN MINUTES, $dC=0.02$)

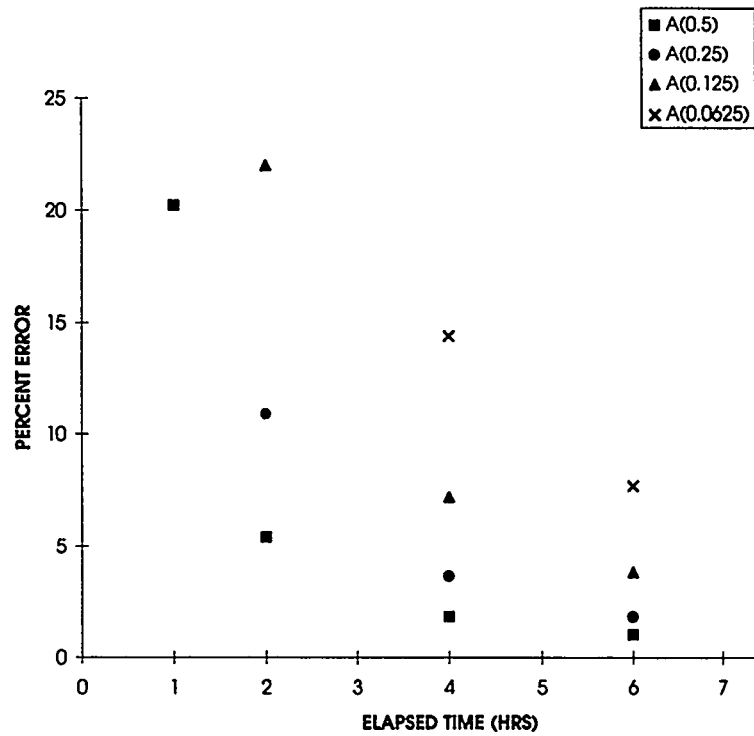


Figure 7. Probable Error-Data Point Every Fifteen Minutes

95 % PROBABLE ERROR FOR A=0.125 (1 PT, 4 PTS, AND 8 PTS EVERY 30 MINUTES, $dC=0.02$)

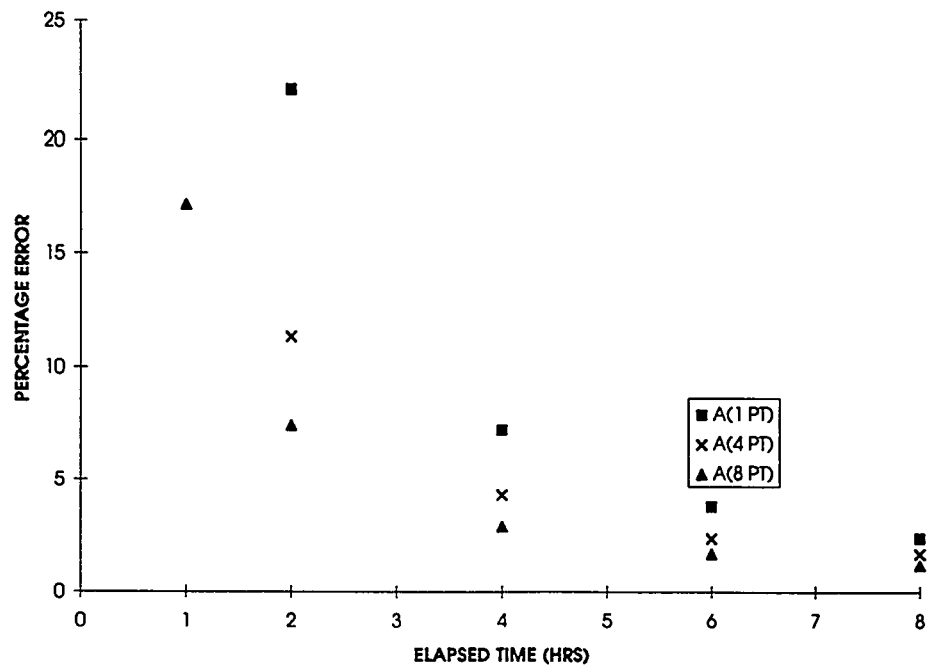


Figure 8. Probable Error-Multiple Points, $dC=0.02$

95% PROBABLE ERROR FOR A=0.125 (1PT, 4 PTS, AND 8 PTS EVERY 30 MINUTES, dC=0.05)

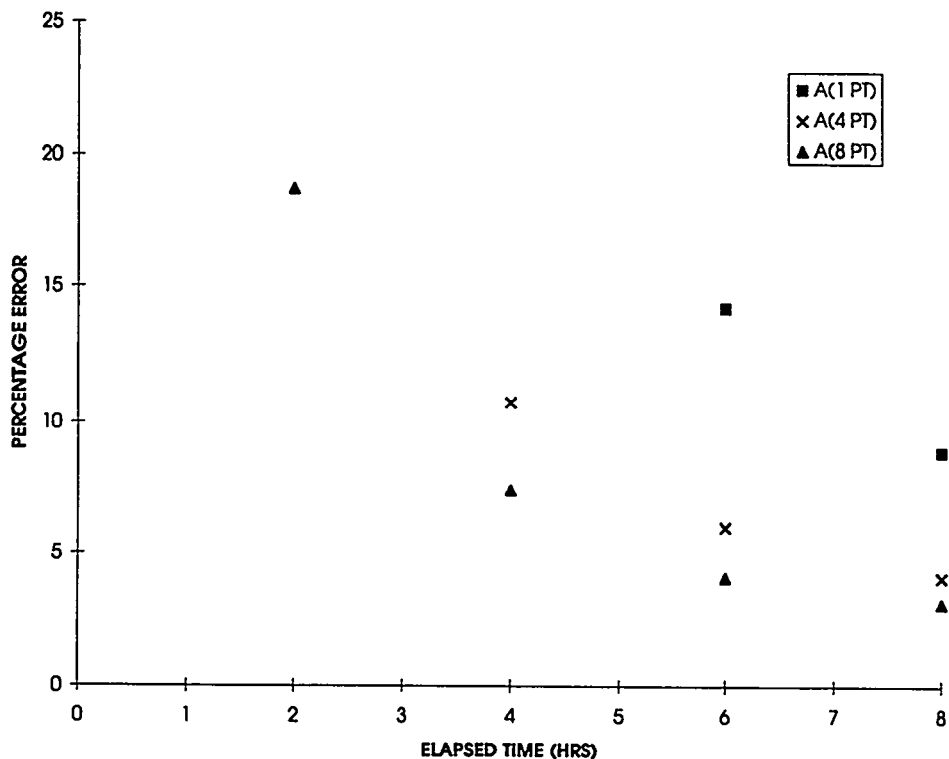


Figure 9. Probable Error- Multiple Points, dC=0.05

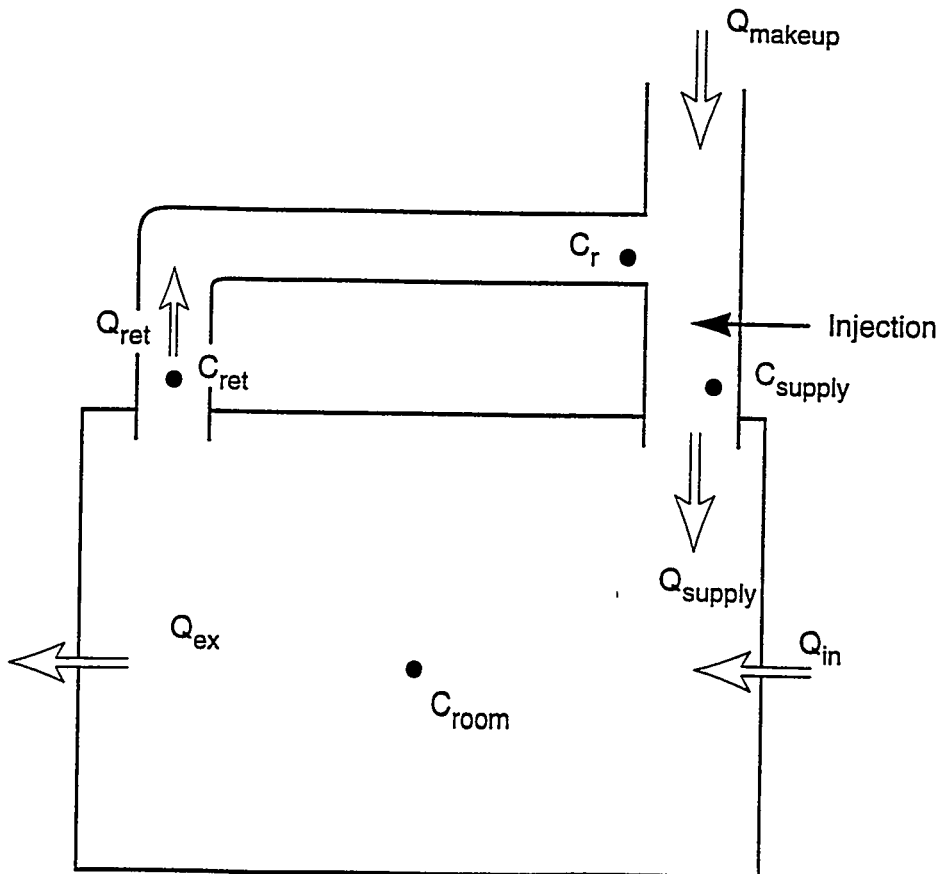


Figure 10. Control Room Envelope Test Parameters

MINIMUM MEASURABLE INFILTRATION (dC=0.01,dQ=0.05)

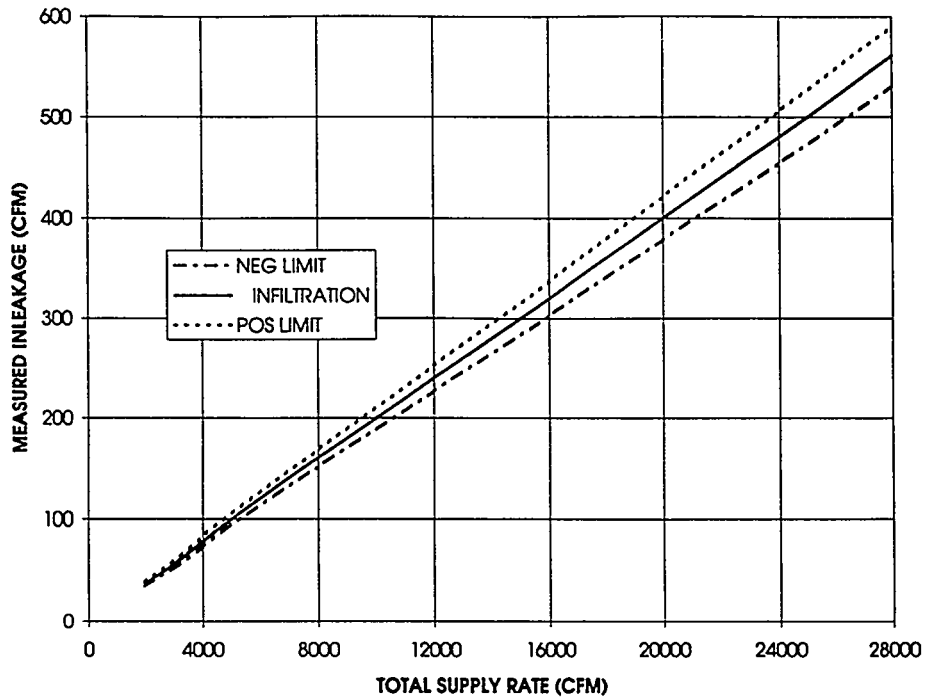


Figure 11. Minimum Measurable Inleakage, dC=0.01, dQ=0.05
MINIMUM MEASURABLE INFILTRATION (dC=0.005,dQ=0.02)

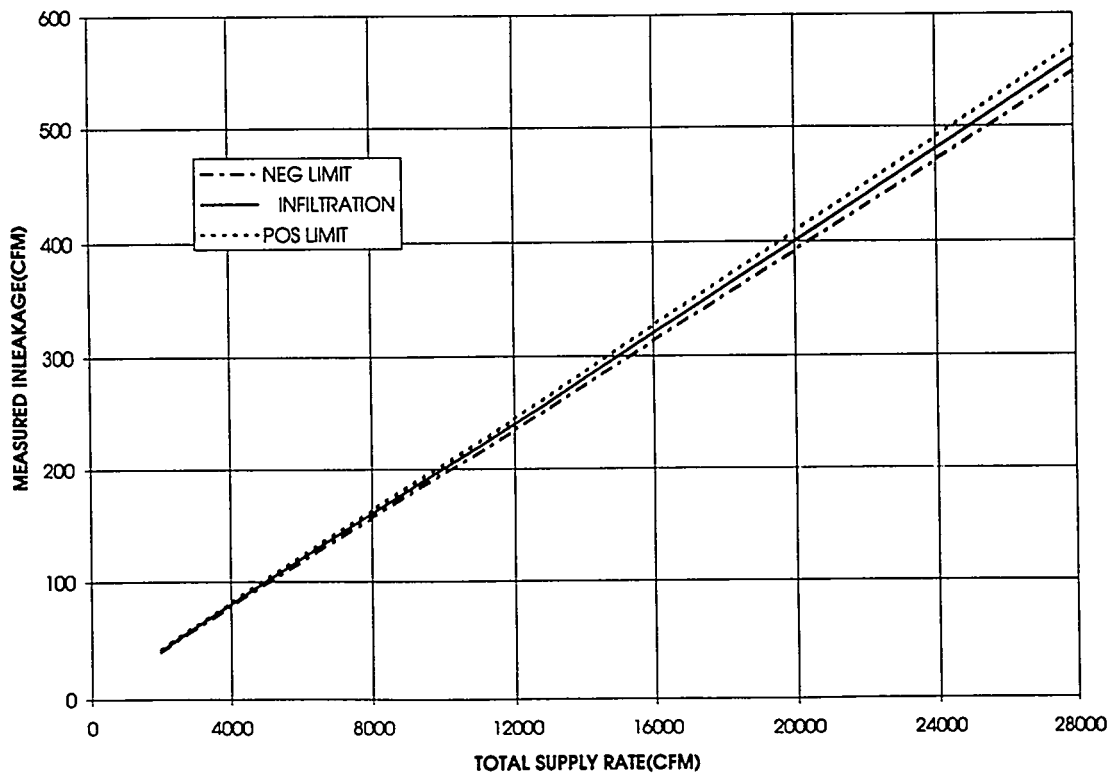


Figure 12. Minimum Measurable Inleakage, dC=0.005, dQ=0.02

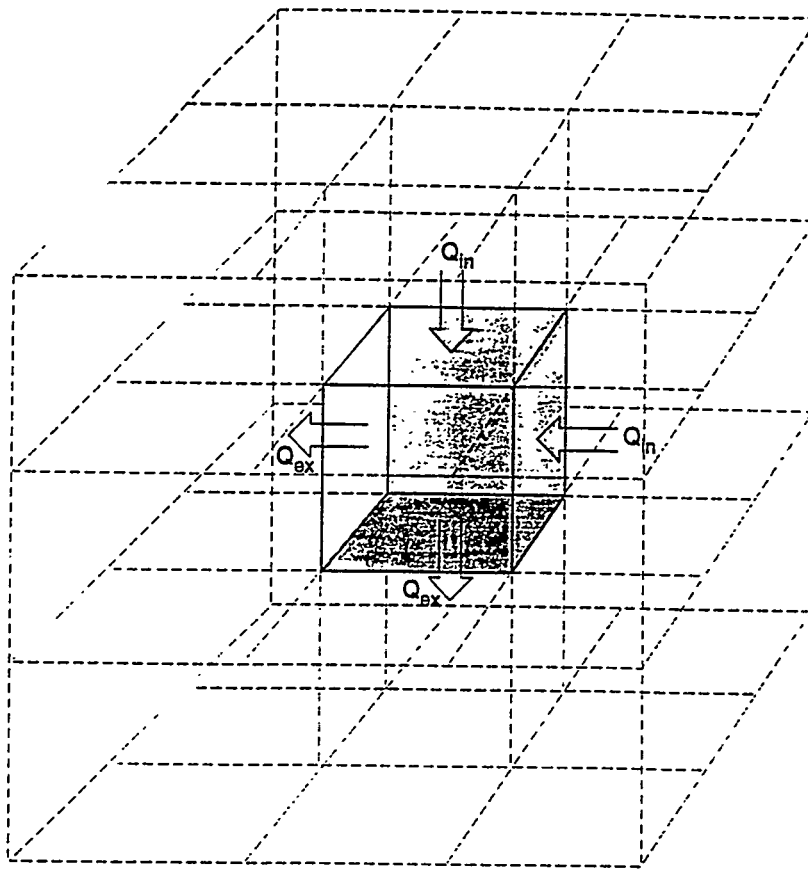


Figure 13. Control Room Envelope and Surrounding Regions

DISCUSSION

PORCO: I will exercise the chairman's prerogative and ask you a couple of very quick questions. How many control rooms has your protocol been applied to? How good was the data correlation? If you would, also mention how you achieved the good mixing that you mentioned in your paper.

LAGUS: We have done three plants, two systems in two of them and one in one of them including a control room. In terms of the uniformity test protocols, we were getting mixing of better than about 3%.

PORCO: What was your correlation between plants?

LAGUS: I do not understand what you mean by correlation between the plants.

PORCO: Was your inleakage consistent at different plants?

LAGUS: Very different from plant to plant.

PORCO: By about how much?

LAGUS: By a factor of six.

PORCO: The last part of my question was about mixing, how do you achieve good mixing of the tracer gas?

LAGUS: We achieved mixing by careful placement of the rather large twenty-four inch diameter mixing fans. We used six or eight of them in conjunction with the control room recirculation system to provide additional mixing. We would make measurements at a minimum of six or eight points at diverse locations and then run standard deviations on the numbers. In a single source control we were able to obtain mixing with relative standard deviations on the order of 3%. We did one at a two story control room where we got mixing of about 5%.

PHILIPPI: How does the control room leakage measurement protocol accommodate wind pressure changes from the outside, or pressure excursions in adjacent rooms? How do they affect the leakage of your control room?

LAGUS: On these tests we normally measure the control room envelope differential pressure between the inside and the outside, however that happens to be defined for a particular plant. Instead of accommodating, we basically measure it. What we are asking is, how does the system perform as it is being used? We have no control over the wind. What we have to do is be a) aware of the wind, b) be aware of the pressure characteristics, and then c) measure the performance of the system as it is being affected by the external variables. For instance, we try to minimize ingress and egress and things like that, but naturally occurring variables are the same variables that a plant is going to be subjected to. So, we are much more interested in finding out how it behaves under those circumstances than trying to make calculations or allowances for it. What you are going to find is that the effects of wind are certainly going to be a secondary effect, simply because, for most of the winds, you are not going to have wind pressures that are comparable to the kinds of pressures that one actually tries to generate inside a control room.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

ENGELMANN: We know that there is in-leakage into ventilation systems when operating even in recirculation mode. Also, the air exchange of the room is enhanced with fans or recirculation are operating. Will you please discuss how you account for this?

LAGUS: The tracer technique incorporates all inleakage paths into the control room envelope (CRE), even those due to the CRE ventilation system, if that system or part of it is located outside the CRE boundary. Since the tracer technique allows one to measure the inleakage under actual operating conditions, if air exchange (unfiltered inleakage) is enhanced by operation of fans or recirculation, the data will reflect that. In fact we have undertaken a test in one control room in which the difference in inleakage was measured between the case of the pressurizing fan operating and not operating.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

VARIABLE PATTERN CONTAMINATION CONTROL UNDER POSITIVE PRESSURE

Hardy M. Philippi
Chalk River Laboratories
Atomic Energy of Canada Limited
Chalk River, Ontario, Canada K0J 1P0

Abstract

Airborne contamination control in nuclear and biological laboratories is traditionally achieved by directing the space ventilation air at subatmospheric pressures in one fixed flow pattern. However, biological and nuclear contamination flow control in the new Biological Research Facility, to be commissioned at the Chalk River Laboratories in 1996, will have the flexibility to institute a number of contamination control patterns, all achieved at positive (above atmospheric) pressures. This flexibility feature, made possible by means of a digitally controlled ventilation system, changes the facility ventilation system from being a relatively rigid building service operated by plant personnel into a flexible building service which can be operated by the facility research personnel. This paper focuses on and describes the application of these unique contamination control features in the design of the new Biological Research Facility.

I. Introduction

Airborne contamination control in nuclear and biological laboratories is traditionally achieved by directing the space ventilation air at subatmospheric pressures in one fixed flow pattern. However, in the new Biological Research Facility (BRF) to be commissioned at the Chalk River Laboratories in 1996, the ventilation system will have the flexibility to effect a number of contamination control patterns at positive (above atmospheric) pressures. This pattern flexibility feature, made possible by means of a digitally controlled ventilation system, provides the researcher with the ability to design contamination control patterns which serve the unique requirements of each research program and to accommodate abnormal ventilation system conditions. The ventilation system is therefore no longer a relatively rigid building service operated by plant personnel, but it can become the direct responsibility of the research personnel who are intimately aware of animal welfare and the research program requirements. The requirement to pressurize the facility arises from the fact that the animal housing rooms, laboratories which may temporarily house animals and the animal care support rooms must be pressurized with High-Efficiency Particulate Air (HEPA) filter ventilation air in order to minimize the intrusion of air-borne contamination (viruses and bacteria) from the outside.

This paper focuses on and describes this unique contamination control approach as it is applied in the BRF. (Ref. Figure 1 Main Floor Plan & Figure 2 Upper Floor Plan). The BRF classification, hazards, special requirements and a brief ventilation system description are given to provide a facility overview and an appreciation of its contamination control issues.

II. Facility Usage, Hazards, Classification & Requirements

The new BRF will be used to conduct animal-based biological research work on rodents using carcinogens, radiation and radioisotopes. The research is primarily to study the carcinogenic effects of ionizing radiation separately and in combination with other materials and the facility is intended to support these studies at the molecular, cellular and whole-animal levels.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Hazardous materials used in the research laboratories are limited to small quantities of:

- carcinogenic tumor initiators (DMBA and MNNG) and promoters (TPA and Mezerein);
- Radioisotopes (Tritiated water, tritiated organic compounds, C-14 amino acid or other C-14 compounds); and
- uranium oxide (dust).

The external beam radiation facilities utilizes Co-60 and Sr-90. ⁽¹⁾

The facility is classified as CRL Category 2, that is, one where the potential for a significant hazard is limited to the facility and its operators. ⁽²⁾

The BRF specification included the following requirements to provide

- animal housing and care to meet and exceed current Canadian Council on Animal Care standards ⁽³⁾;
- a research environment consistent with quality-assured research programs;
- effective, predictable and flexible contamination control means under both normal * and abnormal ** operating conditions;
- a safe, licensable laboratory; and
- ALARA working conditions for the facility operating and research staff.

III. Ventilation System Description

Ventilation System:

The supply side of the ventilation system consists of two parallel roof-mounted draw-through air-handling and air-conditioning units, each rated at 50% of the total building ventilation air supply rate. Each unit has means to prefilter, heat, cool/dehumidify, reheat, supply and final filter the building fresh air supply to meet the building space air change and environmental conditioning requirements. Supply air terminal reheat is provided to meet the specific temperature requirements of each room and laboratory. The ventilation exhaust side consists of the following six main exhaust systems:

- E-1/2/3 General Building Exhaust ***
- E-4/5/6 Fumehood and BSC Exhaust ***
- E-7/8/9 Carcinogen Area Exhaust ***
- E-10 Janitor and Washroom Exhaust,
- E-12/13 Scavenger and Solvent Storage Exhaust and
- E-14/15 Cage Washer Exhaust

* Normal operating conditions are day-to-day operations when all electrical power demands are met from the local electrical power utility, all ventilation system equipment is functioning or available and all ventilation and contamination control requirements are achieved.

** Abnormal operating conditions are when the facility is on limited standby diesel-generated electrical power or when vital ventilation equipment is not available because of failure or maintenance outage.

*** Any two fans can achieve full system exhaust rate.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Due to severe budget limitations this project could not support the provision of 100% standby boilers, diesel generated electrical power and ventilation system redundancy. Alternative design features, described in Section VII, were therefore provided to ensure continuous normal operating condition ventilation rates to all rooms housing animals under both maintenance outage and power-failure abnormal condition scenarios.

Ventilation System Control:

Ventilation system supply and exhaust flow control is by Direct Digital Control (DDC). The DDC system to operator interface is by means of a central computer unit (CCU), which is basically a personal computer complete with a keyboard, screen and various in/output devices. The CCU directs and monitors a number of remote processing units, which in turn regulate the terminal equipment controllers.

The system is programmed to automatically regulate the ventilation system variable volume ventilation (VAV) boxes, equipment start/stop and damper or valve open/shut functions to one specific contamination control pattern until it is manually or automatically told to change to another pattern. Each pattern is a memorized number of ventilation system VAV box-flow-rate set points together with preset start-stop functions for several lesser ventilation systems. Pattern changes are initiated automatically when an abnormal condition is detected or manually to suit a different research program requirement. The system continually monitors specific system conditions and will automatically change to a suitable abnormal conditions pattern.

The facility operator can automatically or manually monitor and record facility environmental conditions, select preprogrammed operational scenarios or manually adjust individual system parameters and receive system annunciation and failure alarms. The remote processing units will stand alone and provide local system control even though they are disconnected from the CCU.

IV. Ventilation System Balancing

Balancing the BRF ventilation system supply and exhaust flow rates is vital to understanding, developing and documenting the various ventilation air flow patterns required to meet the normal and abnormal facility operations requirements. A basic spread sheet was prepared to account for and balance the supply, exhaust and in/out leakage for each of 68 spaces in the facility. Spaces varied in size from a 37 m-(120') long irradiation room to a 1 m-(3.3') deep janitor's closet under normal conditions. This basic normal operations ventilation system balance pattern is the starting point for the development alternative normal and abnormal operations patterns. All patterns have to be checked against the capabilities of the fan systems and the 110 space supply and exhaust VAV boxes. It should be noted that the accuracy and control range of VAV boxes is ± 24 L/s (50 cfm) of their set point down to about 20% of their rated flow. A number of VAV boxes serving nonanimal related spaces may be shut off under abnormal conditions. Figure 3 is a typical balancing spread sheet for rooms Y144, Y146 and Y148. Note that all the exhaust, transfer, out-leakage, supply and in-leakage rates are rigorously accounted for. It is through this form of accounting that any room rate changes being considered for a new pattern can be assessed for their impact on the whole building ventilation system capability.

V. Facility Contamination Control Features:

A broad range of contamination control features that affect all aspects of facility operations, covering all contamination routes into, within and out of the facility were incorporated into the BRF design. All rooms are color-coded denoting the space usage, contamination potential and appropriate material and personnel traffic limitations. Special consideration was taken in the design of ventilation, mechanical and electrical services for each color-coded area so that their peculiar requirements were met.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The main features are:

Facility Personnel and Material Traffic Contamination Control:

The BRF is connected to an adjacent Biology Laboratory Building by a second floor bridge. Entry is electronically controlled and research personnel entering the facility shower and change into appropriate clothing on the second floor level before proceeding to the main floor.

Shipping and receiving entrances, at the main floor level, are equipped with fumigation, sterilization and storage facilities to control the entry and exit of contaminated materials.

Facility Contamination Arising from Maintenance Operations:

The facility building upper level plan (Figure 2) shows that an area almost as large as the entire building plan is provided for mechanical and electrical services. A considerable effort has gone into separating service equipment and piping from the animal and laboratory spaces. The location of ventilation equipment, ducting, dampers, piping, valves, power supplies, electrical panels, controls and instrumentation outside of the animal and laboratory spaces minimizes the probability that maintenance personnel will have to enter them.

Airborne Contamination Entry from Outside:

The number of window and door penetrations in the facility exterior building wall have been kept to a minimum and, by keeping the building at above atmospheric pressure with an over-supply of HEPA-filtered and temperature/humidity-conditioned air, out-leakage at the building perimeter minimizes the entry of airborne contaminants from outside the building.

Airborne Contamination Movement Within the Building:

The uncontrolled movement of facility ventilation air is minimized by placing great emphasis on sealing all wall, ceiling and floor penetrations. The controlled movement of facility ventilation air is effected by regulating the relative rates of room supply and exhaust. This regulation of room ventilation air supply and exhaust rates is used to produce directional air flow patterns and air change rates customized for the specific research program requirements. For example, in Figure 4 the animal holding rooms, Y144 and Y148, are over-supplied to leak ventilation air into the adjacent ante room, Y146, which in turn leaks it to an adjacent corridor.

Airborne Contamination Movement When a Door Between Adjacent Rooms is Opened:

There is a relatively small contingent of personnel (3 to 5 people) in charge of the facility. Entry into the facility by other research, operating and maintenance personnel is very restricted. Facility operating personnel are trained to work to formal procedures and are aware of the special requirements of the animal based research facility. Room-to-room traffic is kept to a minimum: thus doors between adjacent spaces are closed most of the time and only opened for very short periods throughout a typical work day for very specific purposes. It is recognized that the rate of flow through an open door is too small to prevent upstream contamination movement. However, adjacent spaces such as the ante rooms, serve as air-locks that minimize/restrict the spread/flow of contamination to areas that are beyond the immediate attention of the trained personnel entering or leaving the area.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Work Station Airborne Contamination Control:

Work stations such as Class II B2 Bio-safety cabinets (BSC) and fume hoods, located inside the above atmospheric pressure rooms and laboratories, serve to control the spread of contamination from the stations by maintaining inflow velocities consistent with proper cabinet and fume-hood operation practices.

Animal Cage Airborne Contamination Control:

Recent developments in small animal cages rack designs, Figure 5, have included a means of connecting each rack of cages directly to the building HVAC system, thereby isolating each animal cage from the ones adjacent to it and providing each cage with a known ventilation supply and exhaust rate. As this development becomes the norm for up-to-date animal care, this facility will be able to accommodate the change from room supply and exhaust ventilation to a combination of room and direct cage rack ventilation. An additional complexity is introduced here in that the number of racks in each animal holding room is a variable that must be accommodated by the room ventilation supply and exhaust control system. The BRF animal housing room and laboratory ventilation systems have the ability to divert room ventilation air to and from one to six cage racks in each housing room.

VI. Normal Operations Contamination Control Pattern Variations

Typical Pattern With Direct Room Ventilation

The Figure 4 Normal Operations #1a Pattern Diagrammatic Flow Sheet shows Rooms Y144, Y146 and Y148 with direct room ventilation. The excess supply air is shown as out-leakage and is added to the exhaust total to create a supply and exhaust balance in the room. The out-leakage of course becomes part of the supply balance in the adjacent Y146 room. Any number of Normal Operations ventilation patterns can be devised to suit current research programs. For example, Room Y144 could be balanced to leak inwards from Room Y146.

Typical Pattern with Direct Cage Ventilation

Figure 6 shows the Normal Operations #1b Pattern Diagrammatic Flow Sheet for Animal Housing Room Y144 when it is equipped with six directly ventilated cage racks rated at 28 L/s (60 cfm) supply and exhaust. The total animal housing room rack exhaust and supply rates of 170 L/s (360 cfm) are diverted from the direct room supply and exhaust ventilation rates. The room ventilation air change rate is however not allowed to drop below a prescribed value. A number of contamination control patterns with direct cage ventilation for from one to six cage racks to suit current research programs will be required for each room equipped with ventilated cage rack supply and exhaust services.

VII. Abnormal Operations Contamination Control Pattern Variations

The ability to provide flexible ventilation/contamination control patterns provides a method of dealing with abnormal power and equipment outage conditions. Figure 7 shows the Abnormal Conditions Pattern #2 diagrammatic arrangement for Animal Housing Rooms, Y144, Y146 and Y148, where the fume-hood exhaust rate in Room Y146 is reduced to conserve supply air for the animal related spaces. The DDC-controlled ventilation system is thereby able to provide normal contamination control patterns in animal-related rooms, and rooms that can tolerate ventilation changes are either shut down or their rates are significantly reduced during the abnormal condition.

VIII. Conclusion

Variable contamination control pattern capability provides facility operations flexibility that meets current and future animal welfare and research program environmental requirements. It takes facility ventilation systems from being a relatively rigid building service operated by plant operating personnel and gives facility research personnel the responsibility for and means to provide quality-assured animal, personnel and program environments.

IX. References

- 1 NSN-ESRSD-140 AECL, CRL Environmental Safety & Regulatory Services,
Safety Analysis Report of the Biological Research Facility (BRF)
- 2 SRC-R-1 AECL Safety Review Committee Requirements for Review
and Approval of New Facilities
- 3 CCAC Canadian Council on Animal Care Guideline

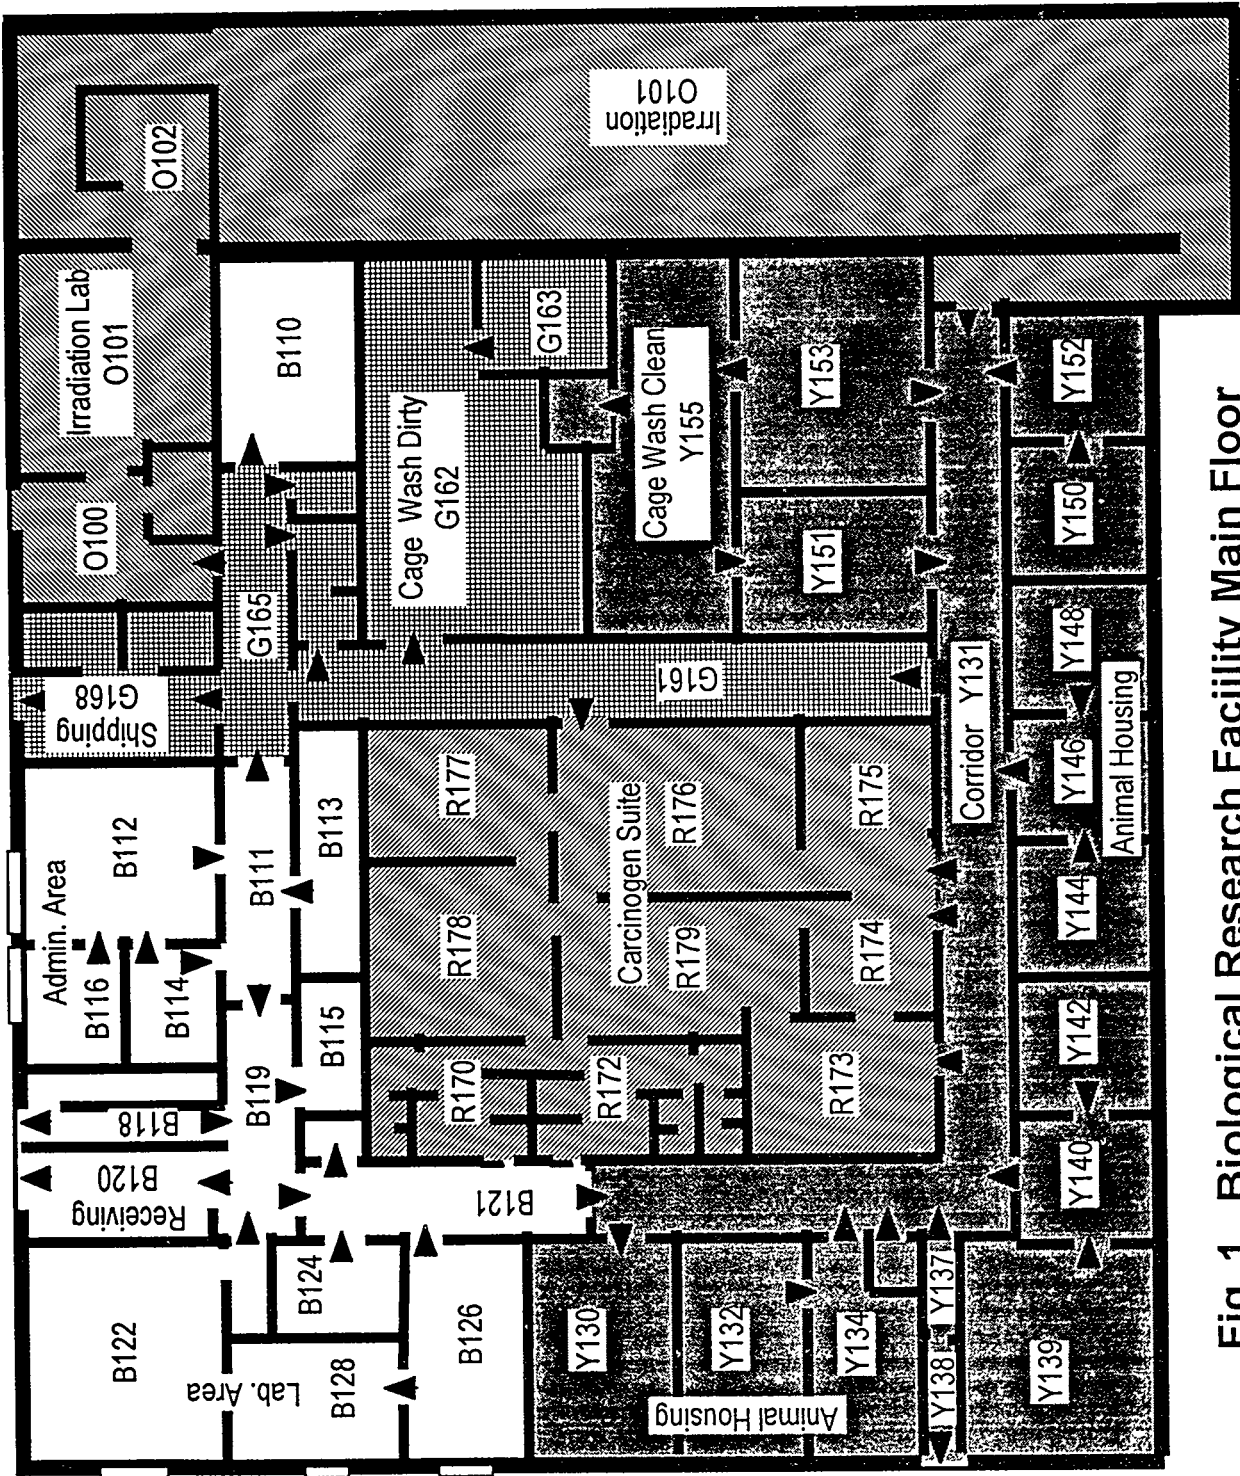
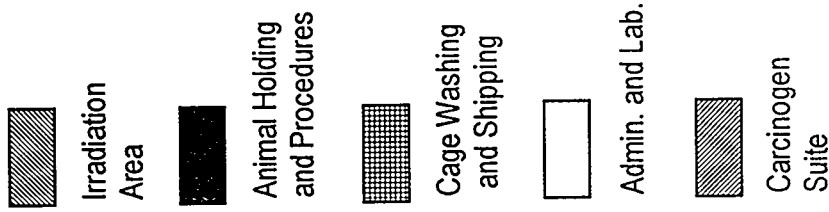


Fig. 1 Biological Research Facility Main Floor

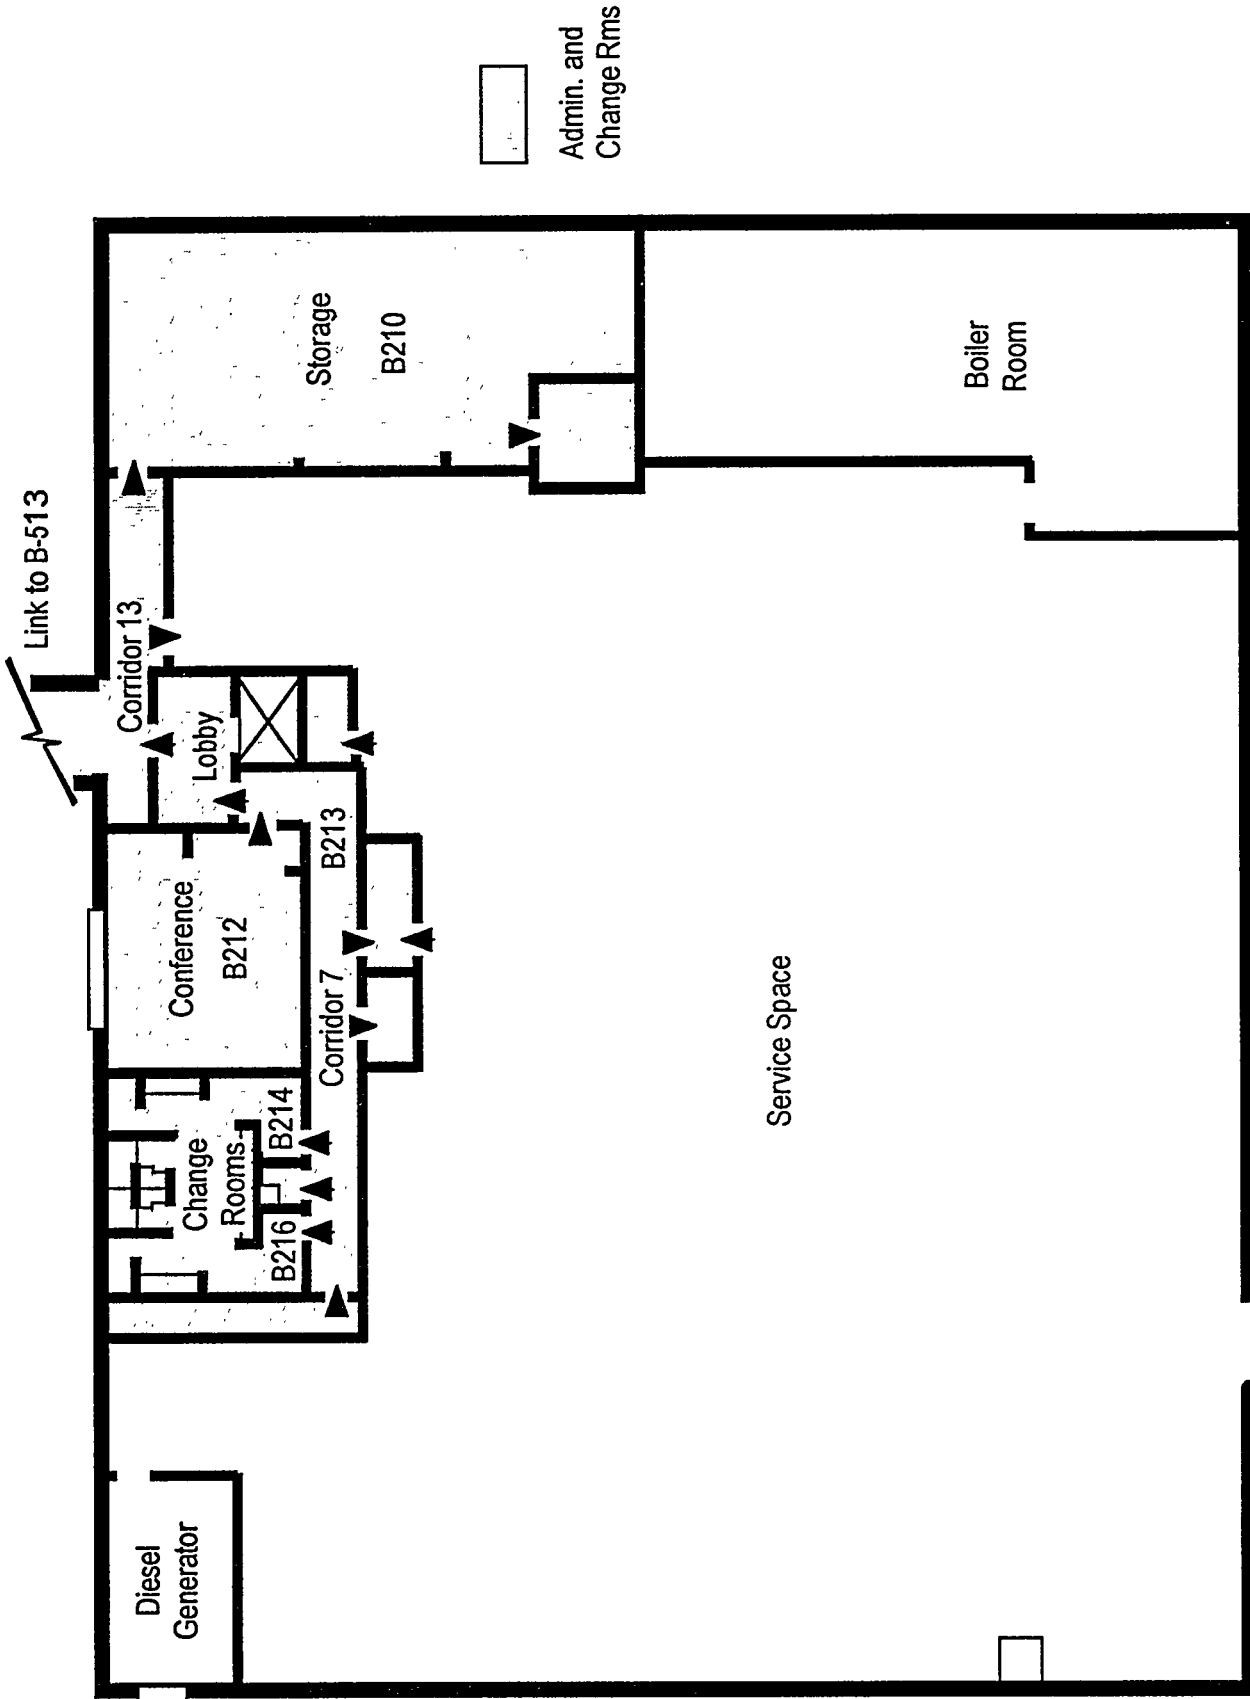


Fig. 2 Biological Research Facility Upper Floor

Rm Y144 Housing AB	Exhaust Fan System (litres / sec.)										OUTFLOW (litres / sec.)			INFLOW (litres / sec.)		
	VAV #	E-123	E-456	E-789	E-10	E-1213	E-14	E-15	Transf	Exh.	Transf	Exfilt.	VAV #	Supply	Transf	Infilt.
	Room	Y144EB1	198											Y144SB1	245	
Length (m)	4.0															
Doors																
Width (m)	146															
Height (m)	4.0															
Vol. (m3)	2.6												Y144SB2	0		
Room																
Chg./Hr	21.2															
Room Totals		198	0	0	0	0	0	0	0	0	198	0	47	245	0	0

Rm Y146 AnteRoom AB	Exhaust Fan System (litres / sec.)										OUTFLOW (litres / sec.)			INFLOW (litres / sec.)		
	VAV #	E-123	E-456	E-789	E-10	E-1213	E-14	E-15	Transf	Exh.	Transf	Exfilt.	VAV #	Supply	Transf	Infilt.
	Room													Y146SB1	496	
Length (m)	4.0															
Doors																
Width (m)	147															
Height (m)	3.6															94
Vol. (m3)	2.6												Y146SB2	0		
Room																
Chg./Hr	37.4															
Room Totals			543	0	0	0	0	0	0	0	543	0	47	496	0	94

Rm Y148 Housing AD	Exhaust Fan System (litres / sec.)										OUTFLOW (litres / sec.)			INFLOW (litres / sec.)		
	VAV #	E-123	E-456	E-789	E-10	E-1213	E-14	E-15	Transf	Exh.	Transf	Exfilt.	VAV #	Supply	Transf	Infilt.
	Room	Y148EB1	198											Y148SB1	245	
Length (m)	4.0															
Doors																
Width (m)	148															
Height (m)	4.0															
Vol. (m3)	2.6												Y148SB2	0		
Room																
Chg./Hr	21.2															
Room Totals		198	0	0	0	0	0	0	0	0	198	0	47	245	0	0

FIG. 3 BRF - Normal Contamination Control Pattern #1a (No Ventilated Racks)

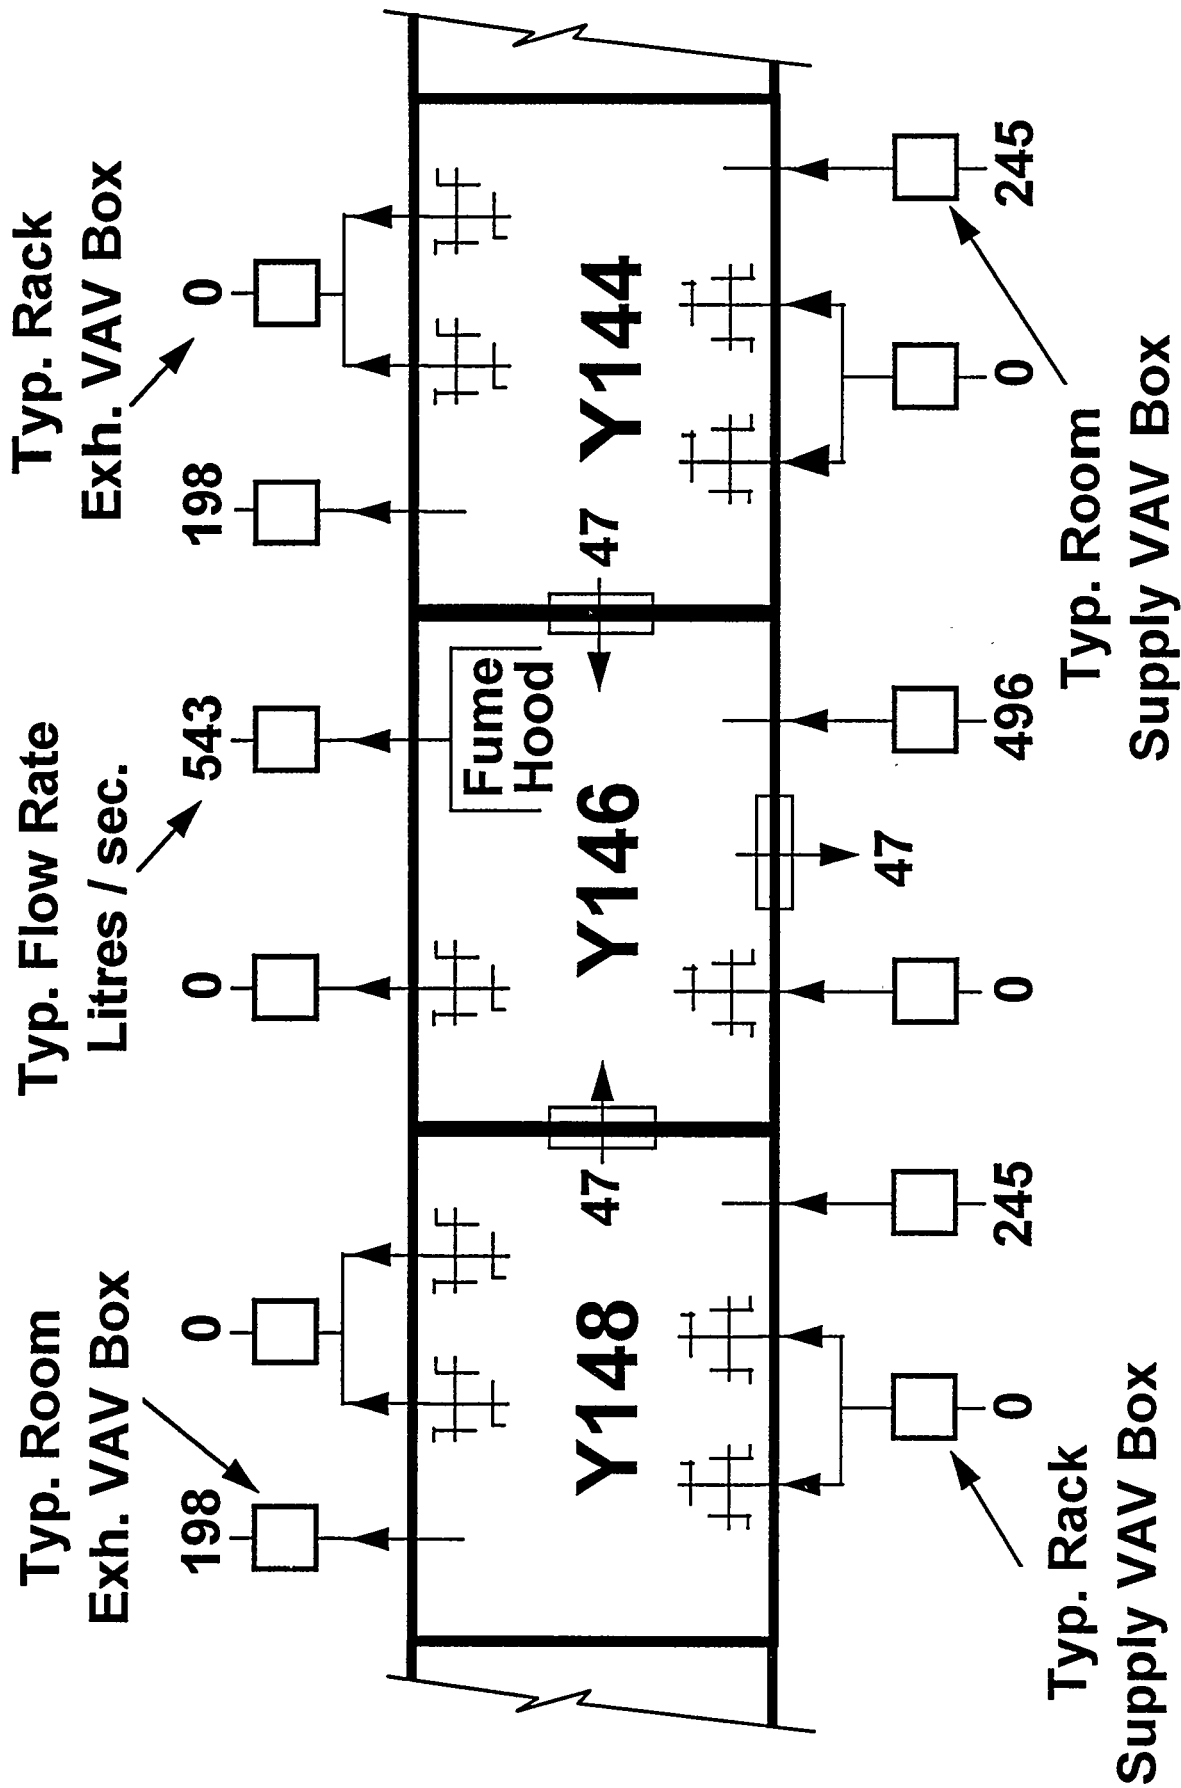


FIG. 4 Biological Research Facility Normal Conditions Pattern #1a Rooms. Y144, Y146 and Y148 Flow Sheet Diag.

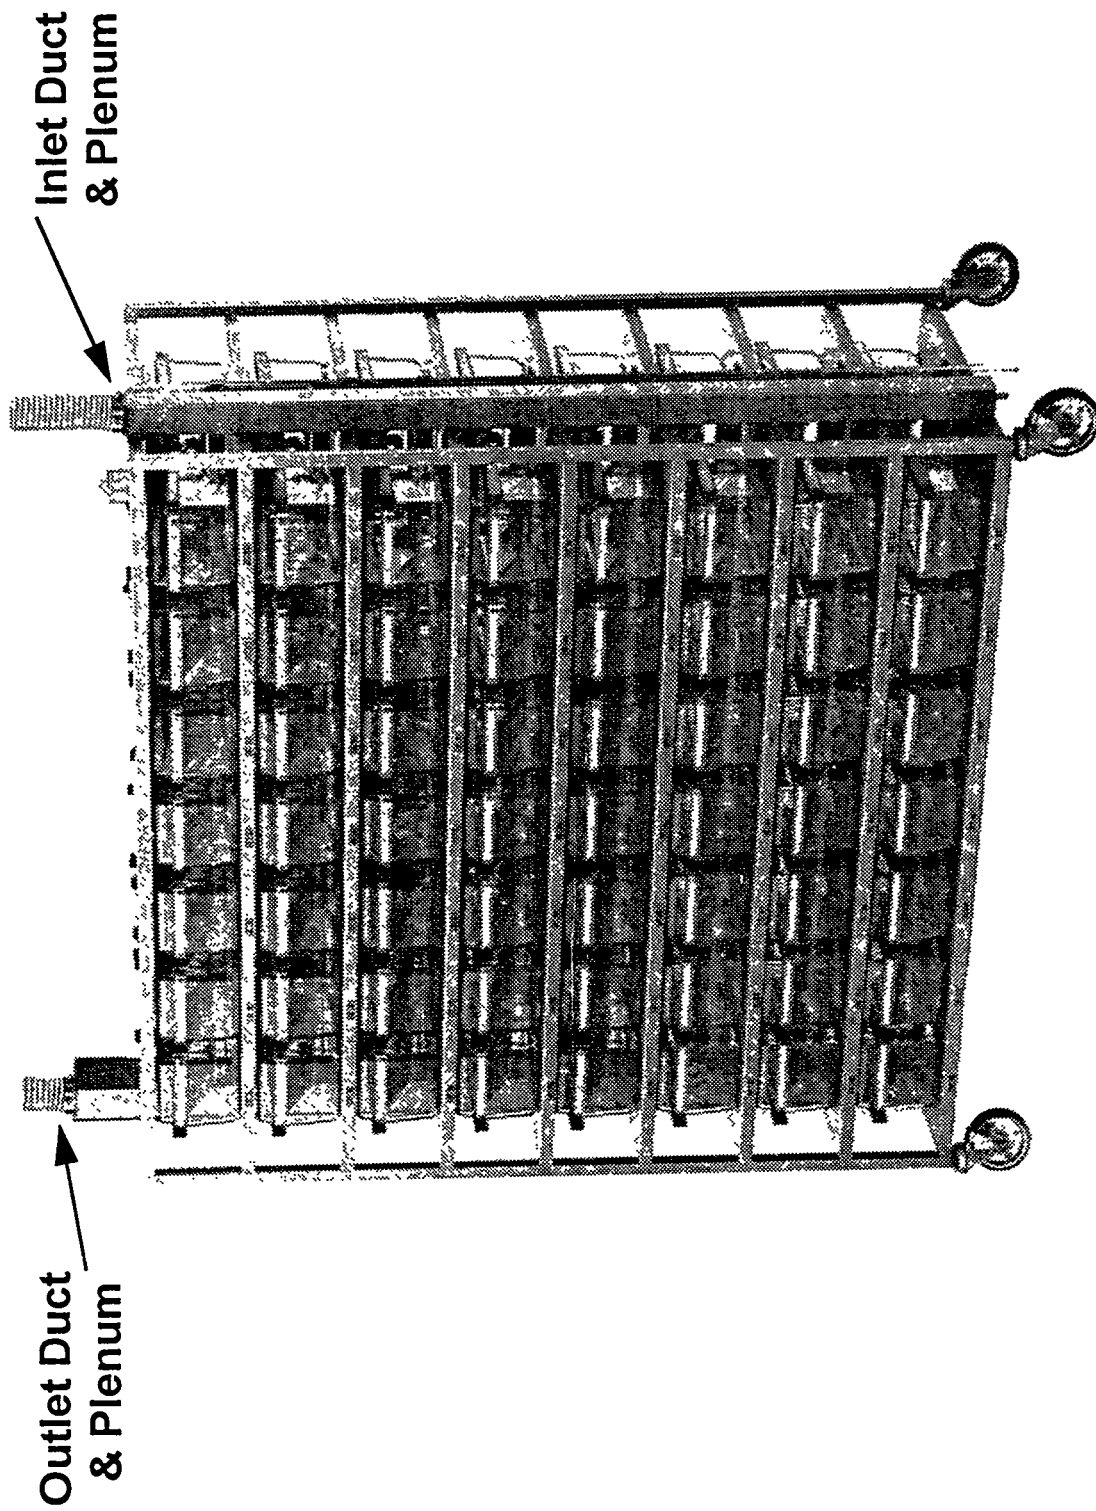


FIG. 5 Biological Research Facility Directly Ventilated Animal Cage Rack

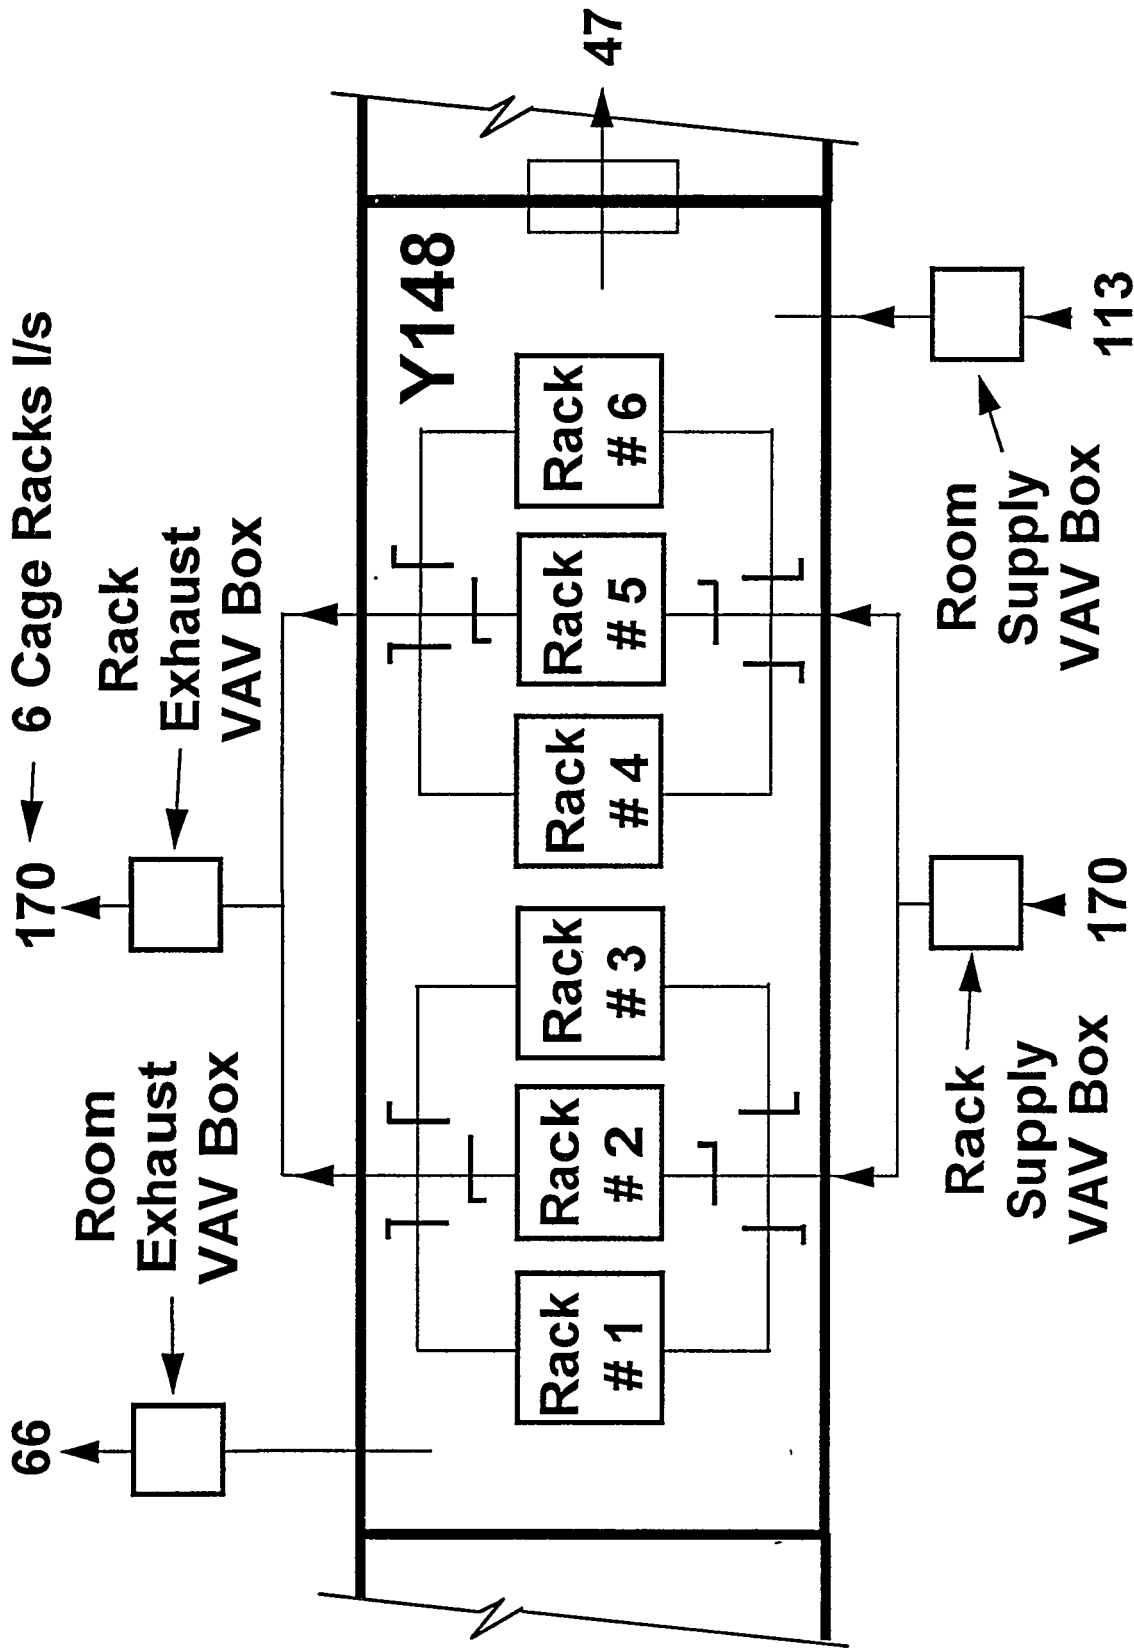


FIG. 6 Biological Research Facility Normal Conditions Pattern #1B Room. Y144 Flow Sheet Diag.

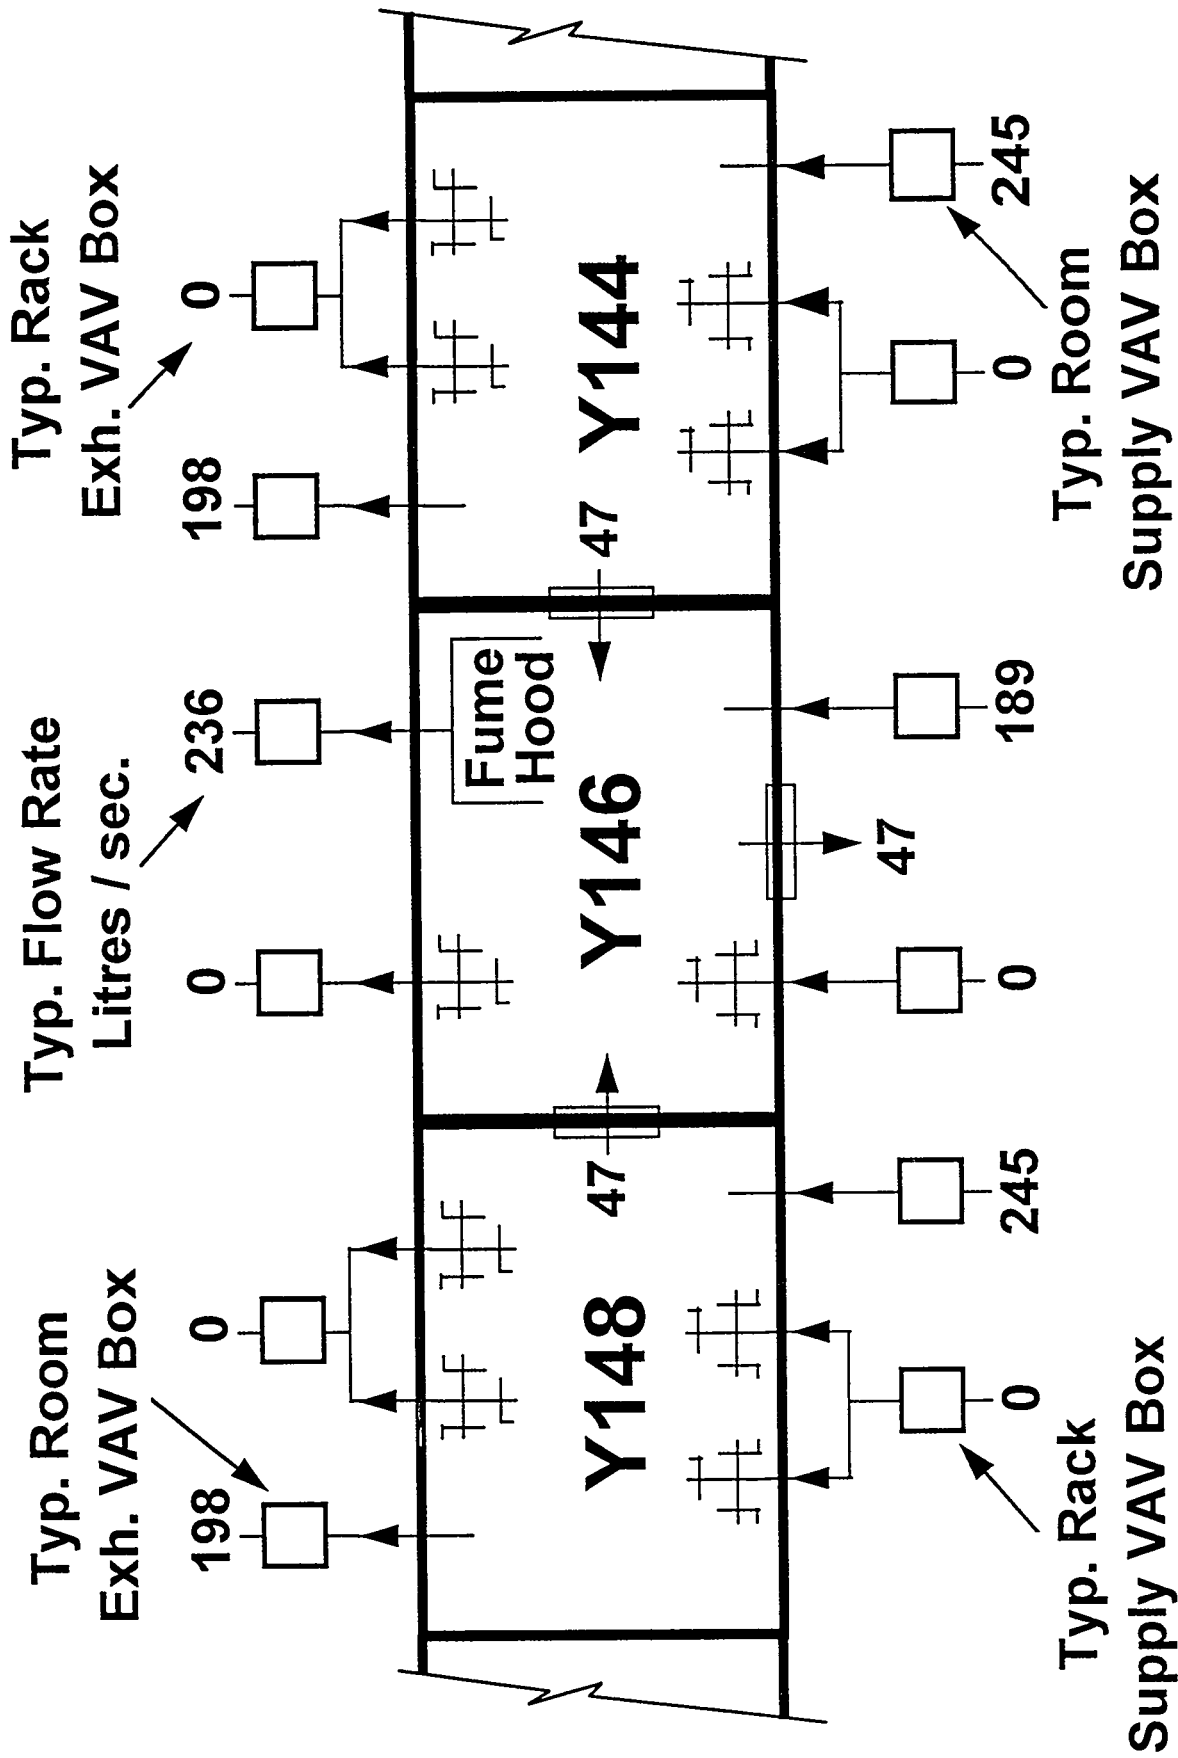


FIG. 7 Biological Research Facility Abnormal Conditions Pattern #2 Room. Y144 Flow Sheet Diag.

AEROSOL DEPOSITION IN BENDS WITH TURBULENT FLOW¹

A.R. McFARLAND^{2*}, H. GONG*, A. MUYSHONDT[†], W.B. WENTE*, and N.K. ANAND*

*Department of Mechanical Engineering
Texas A&M University
College Station, TX 77843

[†]Department of Mechanical Engineering
University of Arkansas
Fayetteville, AK 72701

Abstract

The losses of aerosol particles in bends were determined numerically for a broad range of design and operational conditions. Experimental data were used to check the validity of the numerical model, where the latter employs a commercially available computational fluid dynamics code for characterizing the fluid flow field and Lagrangian particle tracking technique for characterizing aerosol losses. Physical experiments have been conducted to examine the effect of curvature ratio and distortion of the cross section of bends. If its curvature ratio ($\delta = R/a$) is greater than about 4, it has little effect on deposition, which is in contrast with the recommendation given in ANSI N13.1-1969 for a minimum curvature ratio of 10. Also, experimental results show that if the tube cross section is flattened by 25% or less, the flattening also has little effect on deposition. Results of numerical tests have been used to develop a correlation of aerosol penetration through a bend as a function of Stokes number (Stk), curvature ratio (δ) and the bend angle (θ).

I. Introduction

Aerosol losses in bends can be significant. For example, the wall loss of 10 μm aerodynamic diameter aerosol particles in a 25.4 mm (1-inch) diameter 90° bend at a flow rate of 57 L/min (2-cfm) is calculated to be 9.5% by the DEPOSITION code (Anand et al., 1993). The code predicts the same losses would occur in 95 m of vertical tubing of the same size at the same flow rate. A typical system that continuously extracts a sample from a stack or duct will have at least one bend, which is generally needed to change the flow direction of the sampled stream from parallel to the duct axis to perpendicular to the axis. For batch sampling applications, such as US Environmental Protection Agency (EPA) Methods 5 and 17 (US EPA, 1995a and 1995b), the losses of aerosol particles in a transport system are of little consequence because the inside walls are washed at the completion of a

¹ Funding for this study provided by the U.S. NRC under Grant NRC-04-94-099 and by the Amarillo National Resource Center for Plutonium (ANRCP). ANRCP funding was awarded through the University of Texas under Contract UTA95-0278. Dr. Stephen A. McGuire is the Project Officer for the NRC Grant, and Dr. Howard Liljestrand is the Principal Investigator for the ANRCP Grant.

² Corresponding author. E-mail address: ARM9136@acs.tamu.edu

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

batch test to recover inadvertently deposited aerosol sample. In contrast, for continuous emission sampling (CES), the system must operate for extended time periods and may be required to provide samples for near-real time data on aerosol concentration in the stack or duct (continuous emission monitoring, CEM). Any losses on the internal walls of a sampling system degrade the quality of emission or concentration data. For sampling potentially significant nuclear sources, EPA requires that methodology for CES must follow the protocol of the American National Standards Institute N13.1-1969 (ANSI, 1969), which stipulates that an evaluation shall be made of aerosol losses in a sampling system. However, EPA also permits US Department of Energy facilities (DOE) to use Alternate Reference Methodologies (EPA, 1994). The Alternate Reference Methodologies require that at least 50% of 10 μm aerodynamic diameter (AD) aerosol particles must penetrate through a transport system from the free stream in a stack or duct to the collector or analyzer. Use of the DEPOSITION software for determining compliance with this requirement is part of the Alternate Reference Methodologies.

The DEPOSITION software includes submodels for predicting losses in probes, straight transport lines, bends, and expansion and contraction fittings. For the bends, the software currently uses the model of Cheng and Wang (1981) for laminar flow and the model of Pui et al. (1987) for turbulent flow. Because most flows in sample transport systems are turbulent, the model of Cheng and Wang is not generally applicable. The model of Pui et al. only takes into account the effect of the Stokes number, and as it shall be shown herein, the curvature ratio and bend angle also affect deposition in turbulent flow. In this study, we established a numerical base for penetration of elbows and used that data base to develop a correlation model to predict particle penetration. Such a model could be used in the DEPOSITION software.

In the numerical modeling effort, we have assumed that geometrical extent of the a bend encompasses only the region where the centerline of the bend is curved, Figure 1a. On the other hand, tests with physical models involved geometries where the extent of the bends reached the same two points in space, Figure 1b. The reason for using different geometries is that the purpose of the numerical work is to establish a data base for the correlation model. When a user employs the correlation model, deposition in any straight tubing attached to the bend will be analyzed separately from the bend itself. But, when we seek to compare the effects of curvature ratio on deposition, it is necessary to add straight tubing onto bends with small values of δ to provide a common basis of comparison, so that a bend with a short curvature ratio will not have an apparent advantage over a curve with a large curvature ratio as a result of the smaller distance that the flow travels in the bend.

Flow Considerations.

Flow through straight tubes is generally characterized by the Reynolds number, with the flow being considered laminar when the Reynolds number, $Re = \rho U d_t / \mu$, is less than about 2300, turbulent when the flow is greater than about 3000 and transitional between those values. Here: ρ = fluid density; U = average (spatial) fluid velocity; d_t = tube diameter; and, μ = fluid viscosity. On the other hand, flow through bends of circular tubing depends upon both the Reynolds number and the curvature of the bend and can be characterized the Dean number, De , which is:

$$De = \frac{Re}{\delta^{1/2}} \quad (1)$$

where: $\delta = R/a$; R = radius of curvature of the bend; and $a = d_t/2$ = tube internal radius. The parameter δ is the curvature ratio of the bend. Flow is considered laminar for $De \leq 370$, which

corresponds to a Reynolds number of 1170 for a curvature ratio of 10; however, the secondary flow in a bend causes the overall flow to be more stable. The critical Reynolds number can be as large as 7800 for a curvature ratio of 7 (Soh and Berger, 1984).

In general, flow through a bend is developing, so aerosol particle deposition should vary with length along the bend. For this reason, angle of the bend was treated as a variable in this investigation.

Particle deposition.

Landahl and Herrmann (1949) proposed a model for deposition of aerosol particles in a bend, where the deposition depended only on Stokes number (Stk). The Stokes number is defined as:

$$Stk = \frac{C \rho_p D_p^2 U}{9 \mu d_c} \quad (2)$$

where: C = Cunningham's slip correction (Fuchs, 1964); ρ_p = particle density; D_p = particle diameter; and, μ = dynamic viscosity of air. Davis (1964) used aerosol particles to visualize the secondary flow patterns due to laminar flow in pipes with a bend angles ranging from 30° to 180°; however, no data on the particle loss in the pipe were gathered. Cheng and Wang (1975) developed a model for the impaction efficiency of aerosol particles in 90° bends. Their model was based on an analytical laminar flow solution and the correlation they developed gave penetration as a function of the Stokes number, curvature ratio, and bend angle. Crane and Evans (1977) performed numerical calculations to predict the behavior of aerosol particles in laminar flow in 90° bends. They examined curvature ratios ranging from 4 to 20 and their results showed reasonable agreement with those of Cheng and Wang (1975). Chen and Wang (1981) re-examined the deposition of particles in pipe bends. They concluded that in the laminar flow regime, the aerosol particle deposition was mainly a function of Stokes number and flow Reynolds number for curvature ratios between 4 and 20. Pui et al. (1987) experimentally evaluated the deposition of aerosol particles in a 90° bends for Reynolds numbers of 100, 1000, 6000, and 10,000; and curvature ratios of 5.7 and 7. They suggested the penetration does not depend on either curvature ratio or Reynolds number and offered the following correlation for predicting the aerosol particle penetration in 90° elbows:

$$P = 10^{-0.963 Stk} \quad (3)$$

where: P is the aerosol particle penetration. Tsai and Pui (1990) used a three-dimensional numerical procedure to examine the aerosol particle deposition for laminar flow in a pipe with a 90° bend. They found significant variation in the deposition efficiency as a function of curvature ratio. They also noticed an influence of the inflow velocity profile on the deposition efficiency. Their results using a parabolic inlet velocity profile agree well with the results of Cheng and Wang (1981).

Goals of the Present Study

There have been significant recent developments in numerical predictions of three dimensional flow fields and in particle tracking. For example, FLUENT, which is a commercially-available finite volume code (Fluent, Inc., Lebanon, NH) accommodates prediction of three dimensional turbulent flow fields using advanced turbulence models. Abuzeid et al. (1991) developed a numerical scheme for particle tracking in turbulent flows. Gong et al. (1993) used the Abuzeid approach to model aerosol sampling by a shrouded probe in an axi-symmetric (two-dimensional) turbulent flow field. Good agreement was

obtained with experimental data. In the present study, that model was extended to particle tracking in three-dimensional flows, and it was used in combination with a three-dimensional flow field to predict particle losses in bends. At the present time, the only model for predicting aerosol particle penetration in turbulent flow through bends is the empirical correlation of Pui et al. (1987). A goal of this study was to evaluate the effects of bend angle, curvature ratio, Reynolds number and Stokes number, and to develop a correlation that would taken into account the necessary parameters. Also, we sought to determine experimentally the effects of curvature ratio and flattening of the cross section of a bend, and to generalize those results as design criteria.

II. Methodology

Physical experiments.

The bends were fabricated by milling the correct curvature ratio into a split block of wax, then adding tube stubs to either end of the bend. Care was taken that the transitions between the bends and the tube stubs were smooth. For all bends, tube diameter was 16 mm and the distance from the entrance plane of the bend to the centerline of the exit tube was 151 mm. The layout was setup so a bend with a value of $\delta = 20$ would require no additional straight sections; whereas, for all other bends, with smaller values of δ , straight tube stubs were added. To investigate the effect of flattening of the bend cross section, we fabricated six identical 90° bends from 16 mm diameter tubing that had curvature ratios of 10. At the 45° location, the bends were pinched to reduce the diameter in the radial direction.

The apparatus used in testing bends is shown in Figure 2. Monodisperse aerosols were generated with a vibrating orifice aerosol generator (Berglund and Liu, 1973) from a solution of a non-volatile oil (oleic acid) and an analytical tracer (sodium fluorescein) dissolved in a volatile solvent (isopropyl alcohol). A particle size of 10 μm aerodynamic diameter (AD) was used for all tests. The monodisperse aerosol was drawn into a mixing chamber plenum with a blower. A clean-up filter, which was placed in front of the blower, collected the excess aerosol.

An upstream aerosol sample was collected by replacing the bend with a sampling filter. The bend was then inserted into the flow system and an aerosol sampling filter was used to collect a downstream sample. Analytical tracer was eluted from the filters and quantified. The penetration, P , was determined from:

$$P = \frac{c_e}{c_i} \quad (4)$$

where: c_e = aerosol concentration at the exit section of the elbow; and, c_i = aerosol concentration at the inlet section. The flow rate through the system was measured with a calibrated rotameter and corrected for the actual pressure level in the system. Four replicate experiments were conducted for each set of experimental conditions.

Numerical Calculations.

Flow fields were setup through use of FLUENT. Because the flow in bends can be turbulent, with swirl, the traditional engineering κ - ϵ turbulent closure model is not adequate. Instead, a more accurate model, the Reynolds stress model (RSM), was used to describe the turbulent behavior of the flow. In the RSM, each Reynolds stress component, the turbulence dissipation rate and the velocity components

are calculated. An example of the flow field in a bend is shown in Figure 3, where the velocity vectors are illustrated for a location that is two tube diameters downstream of the bend exit plane.

Particle trajectories in bends were calculated by solving the particle equations of motion as affected by the gravitational force, particle inertial force and fluid drag. In the equation for particle motion, the instantaneous fluid velocity is needed, which consists of mean and turbulent components. The mean velocity is available from the flow field computation, and the fluctuating component is generated from Gaussian random sampling of Reynolds stresses. The duration of interaction between particle and turbulence eddy is determined by the eddy lifetime, which, in turn is determined by the turbulent kinetic energy and the dissipation rate. The penetration of aerosol through a bend is calculated by tracking a large number of simultaneously released particles and determining which are deposited on the walls and which penetrate the bend.

A series of numerical experiments were conducted to establish a grid independent solution. Based on these studies, a grid size of $103 \times 21 \times 25$ was used. A similar set of numerical experiments was used to establish the time steps for particle tracking. A time step of 10^{-5} s was selected, which ensures that a particle travels at least 5 steps within a turbulence eddy.

Computations were carried out for bends with curvature ratios of 2, 4, and 10; and for bend angles of 45° , 90° and 180° at a Reynolds number of 8210. The effect of varying the Reynolds number was investigated by maintaining the Stokes number constant and varying the Reynolds number over the range of 3200 to 19,800.

III. Results

Validation of the Numerical Model. Initially, we attempted to use a particle tracking model that is imbedded in the FLUENT software; however, the agreement with experiment was not satisfactory. As a consequence we developed the three dimensional extension to the model of Gong et al. (1993). A comparison of the numerical predictions with experimental results is given in Table 1. Results are shown for different bend angles, curvature ratios and mean flow velocities. For a given set of conditions, the relative difference between the experimental value and the numerical prediction is 5%. The numerical value is higher, and the standard error of the estimate is 4%. For example, if the numerically predicted penetration is 50%, the experimental value will be about 52.5%, with an error of $\pm 2\%$.

Effect of Turbulence on Particle Deposition

A flow field was setup for a 45° bend with a curvature ratio of 10, and for a Reynolds number of 8210. The penetration of particles of 5, 10 and 15 μm AD was then determined with and without the turbulence model for particle tracking. The results, which are shown in Table 2, illustrate the need for including the effects of turbulence on particle motion. For example, at a particle size of 10 μm AD, the predicted penetration is 80% without including turbulence and 62% with turbulence. Neglecting the effect of turbulence on particle motion would cause unacceptable errors in the analyses.

Effect of Reynolds Number on Aerosol Penetration

Numerical predictions were made of the effect of flow Reynolds number on aerosol penetration through a 90° bend that has a curvature ratio of 10. In the calculational procedure, the Stokes number was held constant and the Reynolds number varied from 3200 to 19,800. The results, which are shown in Figure 4, suggest that the effect of Reynolds number is sufficiently small such that it can be

neglected. Over the range of Reynolds numbers tested, at a Stokes number of 0.67, the penetration ranges from 22% to 27%; and, at a Stokes number of 0.074, the penetration varies from 87.5 to 89.5%.

Experimental Results Showing the Effect of Curvature Ratio on Penetration

With reference to Figure 5, results are shown on the effect of curvature ratio on penetration for a range of Stokes numbers. The Stokes number was varied by changing the flow rate through a bend. Bends were designed as illustrated in Figure 1b to allow direct comparisons on the effect of curvature ratio, i.e., tube stubs were added to bends with short radii of curvature. The results show that increasing the curvature ratio improves the aerosol penetration. For example, at a Stokes number of 0.3, a bend with a curvature ratio of unity has a penetration of 32%, a bend with $\delta = 2$ has $P = 42\%$, and if $\delta = 4$, $P = 50\%$. However as δ is increased from 4 to 20, the penetration only changes from 50% to 58%. Also, there is very little difference in penetration between bends with curvature ratios of 4 and 10. These results suggest that a bend with a curvature ratio of 4 should be satisfactory for aerosol transport. The curvature ratio of 10 recommended in ANSI N13.1-1969 is probably too conservative.

Experimental Study of the Effect of Flattening of the Bend Cross Section

Test conducted on pinched bends provided the results shown in Figure 6. The degree of flattening is the amount by which a diameter was reduced, divided by the original tube diameter. The bends used in these tests had initial diameters of 16 mm with curvature ratios of 10. The data show that the penetration decreases with flattening; however, if the flattening is less than about 25%, the effect is quite small. For example, at a Stokes number of 0.3, the penetration decreases from 52% to 45% as the degree of flattening is increased from 0% to 25%. On the other hand, as the flattening is increased from 25% to 50%, the penetration decreases from 45% to 16%. These data suggest that if a bend is somewhat flattened (less than 25%) during the fabrication process, the aerosol penetration characteristics would not be significantly impacted.

Numerical Modeling of Aerosol Penetration

Computational results were generated for a range of Stokes numbers ($0.07 \leq Stk \leq 1.2$); for bend angles of 45°, 90° and 180°; and for curvature ratios of 2, 4 and 10. The results are presented in Figures 7a, 7b, and 7c in the form of penetration as a function of Stokes number for constant values of the curvature ratio. With reference to Figure 7a, which is for a bend angle of 45°, it appears that curvature ratio has a pronounced effect on penetration; however, that is illusionary because of the smaller path length through which the aerosol must flow in the smaller curvature ratio bends. The experimental data shown in Figure 5 present a more appropriate view of the effect of curvature ratio, where those data are based on all bends starting and ending at the same points in space.

The data shown in Figures 7a, 7b and 7c have been used to generate a correlation of aerosol penetration as a function of Stokes number, curvature ratio and bend angle. We chose a functional form for the correlation that would have the appropriate limiting conditions over the range of the correlation of $P \rightarrow 0$ for large Stokes number, and $P \rightarrow 1$ for small Stokes number. The functional form that we selected is:

$$\ln P = \frac{c_1 + c_2 \ln Stk + c_3 \ln^2 Stk + c_4 \theta}{1 + c_5 \ln Stk + c_6 \ln^2 Stk + c_7 \theta} \tag{5}$$

where each c_i is a function of the curvature ratio, δ . A three-dimensional surface fitting program (TableCurve 3D, Jandel Scientific, San Rafael, CA) was used to generate least squares fits of the data for each curvature ratio. The results are shown in Figures 8a, 8b and 8c for curvature ratios of 2, 4 and 10, respectively. Values of the coefficients as functions of the curvature ratio were then obtained by using a two dimensional curve fitting program that was based on use of least squares (TableCurve 2D, Jandel Scientific). The results are:

$$\begin{aligned}c_1 &= 6.77 - 12.8 \exp(-\delta) \\c_2 &= -9.18 + 62.4 \exp(-\delta) \\c_3 &= 11.3 - 66.3 \exp(-\delta) \\c_4 &= -0.00393 + \frac{0.0277}{\delta} \\c_5 &= -2.23 + \frac{8.49}{\delta^2} \\c_6 &= 2.39 - 13.94 \exp(-\delta) \\c_7 &= 0.0055 - 0.0609 \exp(-\delta)\end{aligned}$$

A comparison of predictions from the correlation model (Equation 5) with those from Pui et al. model (Equation 3) is shown in Figure 9. Good agreement is obtained between the two models for the case of $\delta = 10$; however, the model of Pui et al. under predicts the correlation model for the case of $\delta = 2$.

The need for inclusion of bend angle into the correlation model can be demonstrated by reference to Figure 10, where computational results are shown for the average deposition of aerosol per radian of bend angle, as a function of Stokes number. The developing nature of the flow causes the aerosol loss/radian to be less in a 45° bend than in a 90° bend for most Stokes numbers, although at a Stokes number of 1.2, the deposition/radian for a 45° bend is somewhat larger than in a 90° bend. For Stokes numbers less than 0.3, the aerosol particle loss/radian is about the same in either a 90° bend or a 180° bend; however, for larger Stokes numbers, the aerosol losses/radian can be considerably less in a 180° bend than in a 90° bend. This suggests that in most cases, the penetration of aerosol through a 180° bend cannot be treated as the product of the penetration of two 90° bends in series, nor can the penetration through a 45° bend be treated as the square root of the penetration through a 90° bend. Rather, the bend angle needs to be considered as a variable.

IV. Summary and Conclusions

This study employed a combination of numerical and experimental techniques to characterize aerosol penetration through bends. Agreement was achieved between numerical and physical experiments when the numerical approach was based on use of a specially developed three dimensional particle tracking technique. It was also demonstrated that turbulence needs to be included in a particle tracking model.

The effect of Reynolds number upon particle deposition was examined numerically through calculations made with the Stokes number and curvature ratio held constant. Based on experimental evidence, Pui et al. (1987) stated that there is no Reynolds number effect. Although the numerical results show some dependency of penetration upon flow Reynolds number, the effect does not seem to be sufficiently significant to warrant its inclusion in any correlation model. For Stokes numbers of 0.07 to 0.7 and a

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

curvature ratio of 10, the aerosol penetration does not change by more than 5% when the Reynolds number is varied from 3200 to 19,800.

Physical experiments were conducted to investigate the effect of curvature ratio on aerosol penetration. The bends were constructed such that each bend had the same initial and final spatial co-ordinates, regardless of the curvature ratio. There is a continuum of change of penetration with bend angle, where the aerosol penetration increases with the curvature ratio. However, the change is much greater for curvature ratios less than 4 than it is for the larger curvature ratios. ANSI N13.1-1969 recommends that the curvature ratio should be at least 10, but the results of this study suggest that the value could be four.

When bends are fabricated from straight tubing, there is a tendency for the tubing to flatten. The flattening can be minimized by filling a tube with oil prior to bending it, and maintaining the oil at a high pressure during the bending operation. Because that approach is expensive as compared with simpler techniques (that can cause flattening) we experimentally evaluated the effect of flattening upon aerosol penetration. Ninety degree bends were pinched at the 45° location and tested for aerosol penetration. The degree of flattening of the bends was from 0% to 50%, where the degree of flattening is the ratio of the change in diameter (caused by the pinching) divided by the initial diameter. If the degree of flattening is less than about 25%, it does not have a substantial impact on aerosol penetration.

Numerical experiments were carried out to characterize the penetration of aerosols through bends. The geometrical extent of the bends covered only the region of tubing where the radius of curvature is non-zero. Calculations were conducted for a range of Stokes numbers, curvature ratios and bend angles. Results were used to generate a correlation model that designers and users of aerosol transport systems can employ to predict aerosol penetration. The correlation is valid for $0.07 \leq Stk \leq 1.2$; $45^\circ \leq \theta \leq 180^\circ$; and $2 \leq \delta \leq 10$. Of immediate interest to us is the use of such a model in DEPOSITION software. A comparison of the correlation model with the empirical model of Pui et al. shows good agreement for $\delta = 10$; however, the model of Pui et al. under predicts the present correlation for $\delta = 2$. Also, the model of Pui et al. is limited to 90° bends..

References

- American National Standards Institute, ANSI. (1969). Guide to sampling airborne radioactive materials in nuclear facilities. ANSI N13.1-1969. New York: American National Standards Institute.
- Abuzeid, S.; Busnaina, A.A.; Amadi, G. (1991). Wall deposition of aerosol particles in a turbulent channel flow. *J. Aerosol Sc.* 22:43-62.
- ANAND, N.K., A.R. McFarland. (1993). *DEPOSITION: Software to calculate particle penetration through aerosol transport lines*. NUREG/GR-006. Washington D.C.: Division of Regulatory Applications, U.S. Nuclear Regulatory Commission. (1993).
- Berglund, R.N.; Liu, B.Y.H. (1973). Generation of monodisperse aerosol standards. *Env. Sc. Technol.* 7:147-153.
- Cheng, Y.S.; Wang, C.S. (1975). Inertial deposition of particles in a bend. *J. Aerosol Sc.* 6:139-145.
- Cheng, Y.S.; Wang, C.S. (1981). Motion of particles in bends of circular pipes. *Atmos. Env.* 15:301-306.
- Crane, R.I.; Evans, R.L. (1977). Inertial deposition of particles in a bent pipe. *J. Aerosol Sci.* 8:161-170.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- Davis, R.E. (1964). The visual examination of gas flow round pipe bends using a new aerosol technique. *Int. J. Air Wat. Pollut.* 8:177-184.
- Fuchs, N.A. (1964). *The Mechanics of Aerosols*. New York: The Macmillan Company.
- Gong, H.; Anand, N.K.; McFarland, A.R. (1993). Numerical prediction of the performance of a shrouded probe sampling in turbulent flow. *Aerosol Sci. and Technol.* 19:294-304
- Langdahl, H.D.; Herrmann, R.G. (1949). Sampling of liquid aerosols by wires, cylinders and slides, and the efficiency of impaction of the droplets. *J. Colloid Sci.* 4:103-136.
- Pui, D.Y.H.; Romay-Novas, F.; Liu, B.Y.H. (1987). Experimental study of particle deposition in bends of circular cross section. *Aerosol Sci. Technol.* 7:301-315.
- Soh, W.Y.; Berger, S.A. (1984). Laminar entrance effects in a curved pipe. *J. Fluid. Mech.* 148:109-135.
- Tsai, C.J.; Pui, D.Y.H. (1990). Numerical study of particle deposition ion bends of a circular cross-section - Laminar flow regime. *Aerosol Sci. Technol.* 12:813-831.
- U.S. Environmental Protection Agency. (1994). Letter from Mary D. Nichols, Assistant Administrator for Air and Radiation, U.S. Environmental Protection Agency, Washington, DC to Raymond F. Pelletier, Director, Office of Environmental Guidance, U.S. Department of Energy, Washington, DC.
- U.S. Environmental Protection Agency. (1995a). Determination of particulate emissions from stationary sources. 40CFR60, Appendix A, Method 5. *Code of Federal Regulations*. Washington, DC: U.S. Government Printing Office.
- U.S. Environmental Protection Agency. (1995b). Determination of particulate emissions from stationary sources (in stack filtration method. 40CFR60, Appendix A, Method 17. *Code of Federal Regulations*. Washington, DC: U.S. Government Printing Office.

Table 1. A comparison of experimental data and numerical predictions of aerosol penetration through bends. Additional length was added to the inlet and outlet sections of the numerical configurations so the geometries would be similar for both numerical and experimental testing.

Elbow Angle	Curvature Ratio, $\delta = R_i/a$	Velocity, m/s	Numerically Predicted Penetration	Experimentally Observed Penetration ¹
45°	10	7.7	62.7%	61.8±2.1%%
90°	10	7.7	51.0%	58.3±1.7%
180°	10	7.7	27.7%	28.5±0.9%
90°	2	7.7	42.9%	39.8±1.1%
90°	4	7.7	47.2%	54.1±0.6%
90°	10	18.6	12.2%	12.1±0.3%

¹The value following the ± sign is one standard deviation.

Table 2. A comparison of numerically predicted aerosol penetration through a 45° bend with and without the turbulence in the particle tracking model. The curvature ratio is 10 and the flow Reynolds number is 8210. Inlet and outlet tube sections were added to the geometrical configuration to make it similar to that shown in Figure 1b rather than Figure 1a.

Particle Diameter, μm AD	Penetration without Turbulence in the Particle Tracker	Penetration with Turbulence in the Particle Tracker
5	97%	82%
10	80%	62%
15	46%	35%

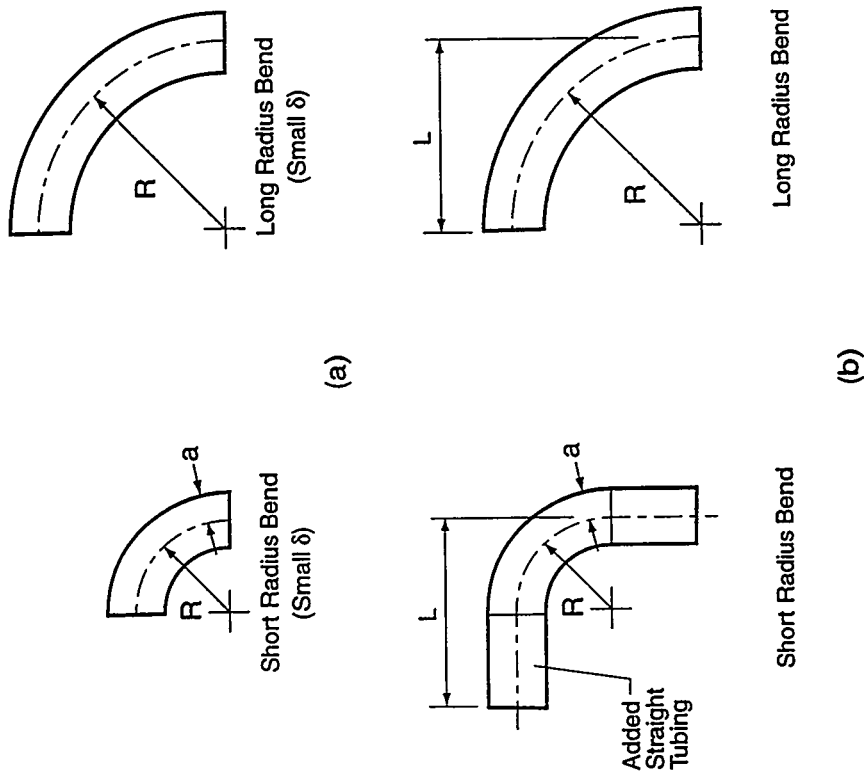


Figure 1. Geometries of bends used in a) numerical modeling, and b) physical testing.

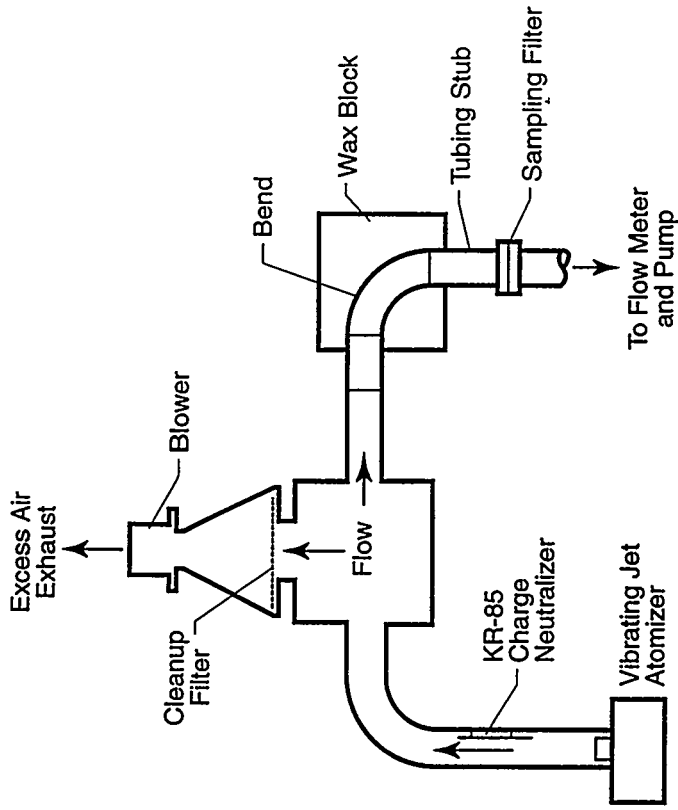


Figure 2. Experimental apparatus used in testing aerosol losses in bends.

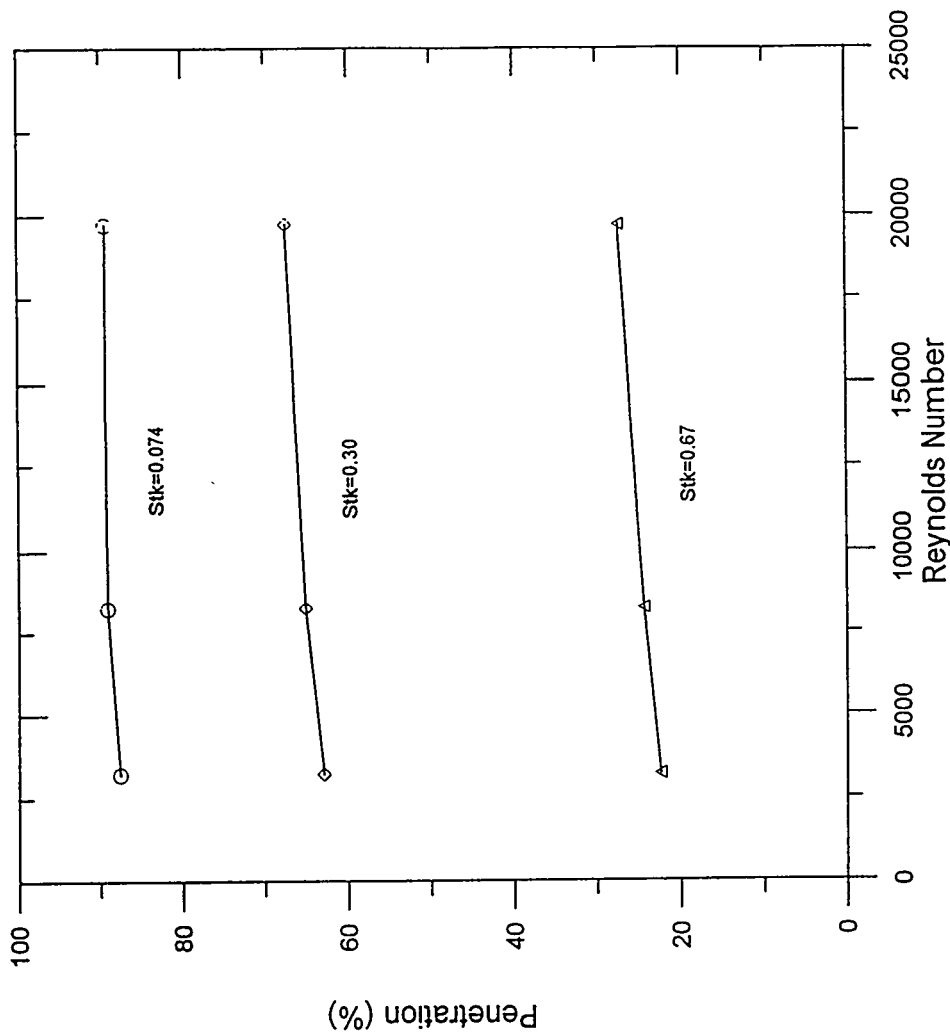


Figure 4. Numerical prediction of the effect of flow Reynolds number on aerosol penetration through a 90° bend with a curvature ratio of 10.

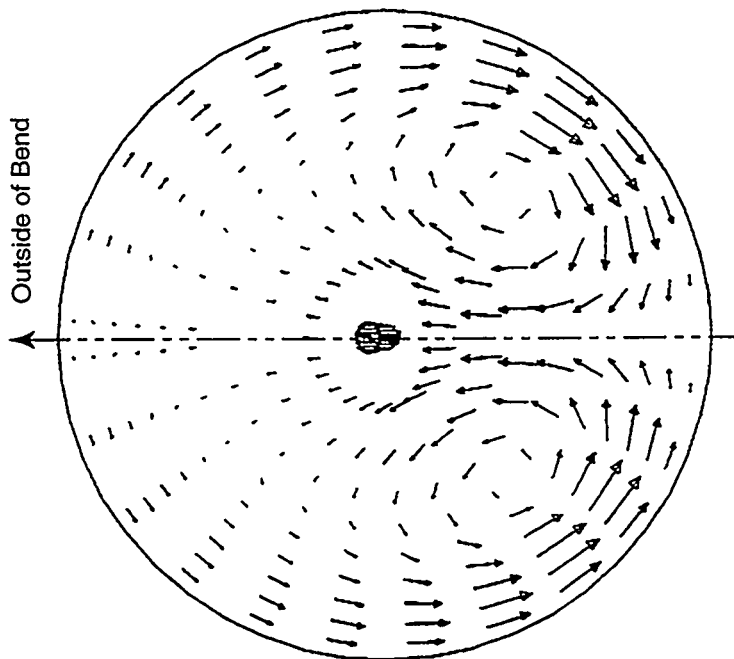


Figure 3. Secondary flow field at a distance of two diameters downstream from the exit plane of a 90° bend. The tube size is 16 mm, the Reynolds number is 8210, and the curvature ratio is 10.

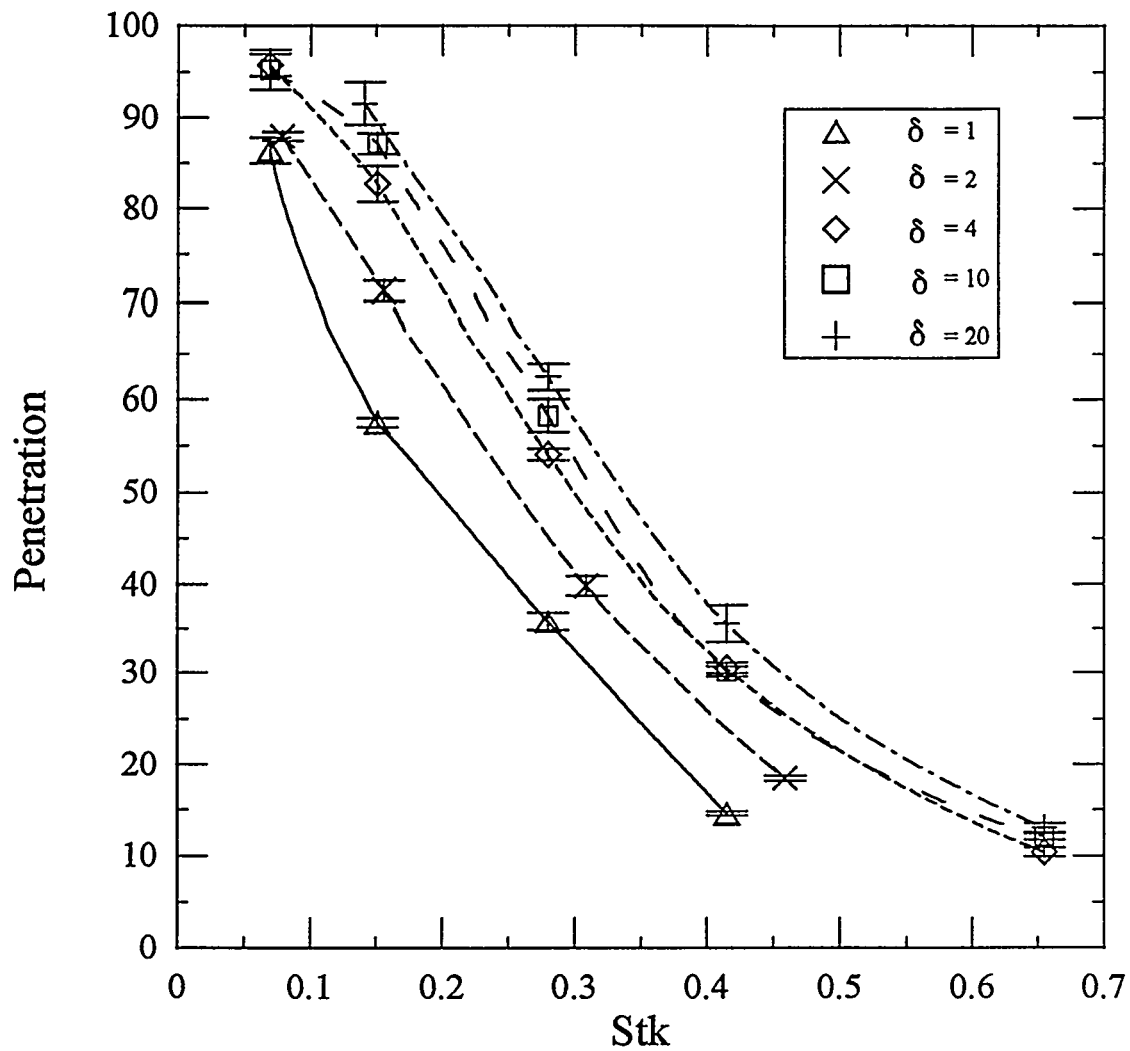


Figure 5. Experimental results showing the effect of curvature ratio on aerosol penetration through bends. The bends were designed as illustrated in Figure 1b, i.e., tube stubs were added to the bends with short radii of curvature.



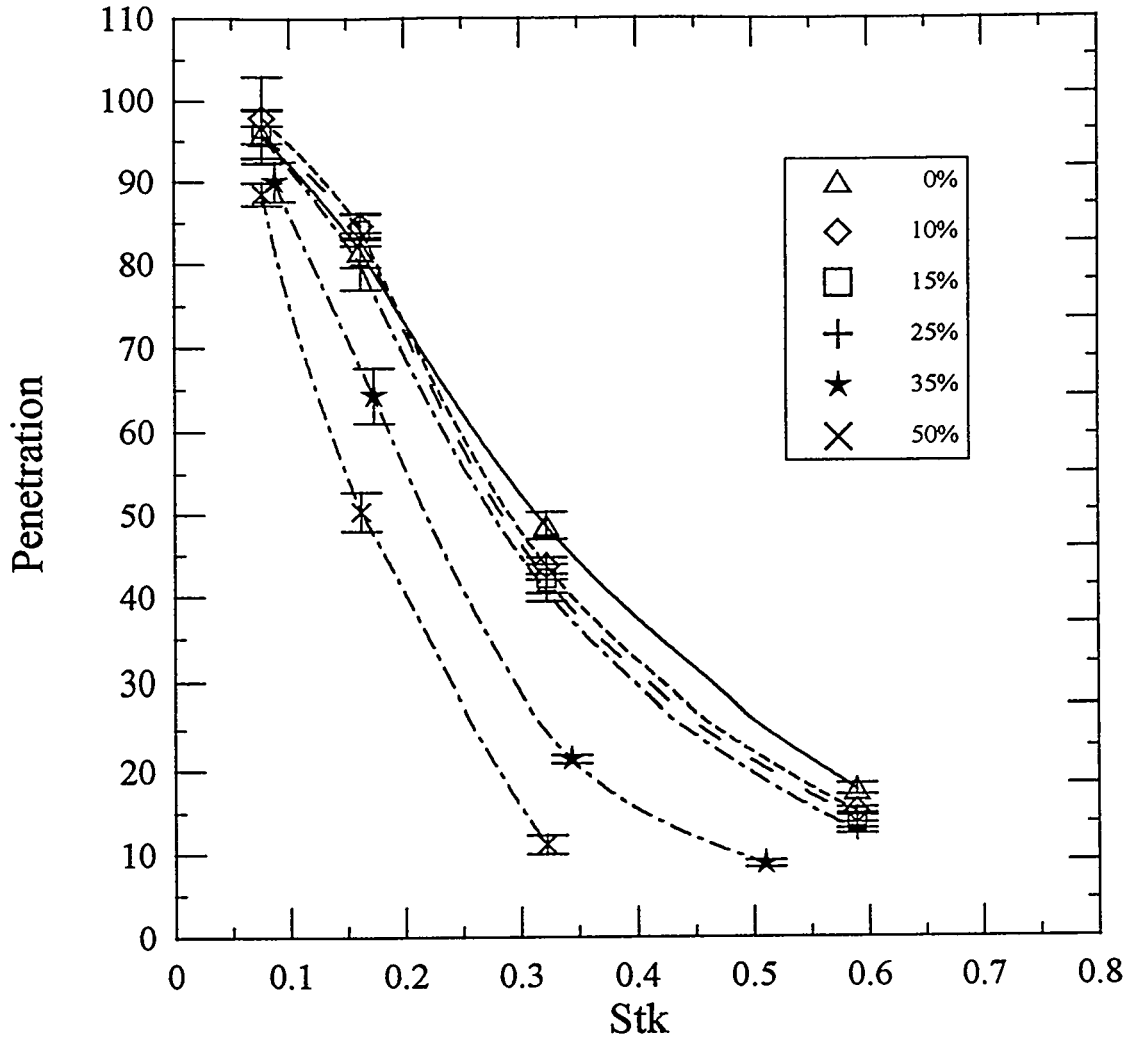



Figure 6. The effect of flattening the cross section of a bend. A 90° bend was pinched at the 45° location. The degree of flattening is the amount by which the tube diameter was reduced divided by the initial diameter. Data are for a tube that was initially 16 mm diameter with a curvature ratio of 10. Particle size used in the testing was 10 μm AD.

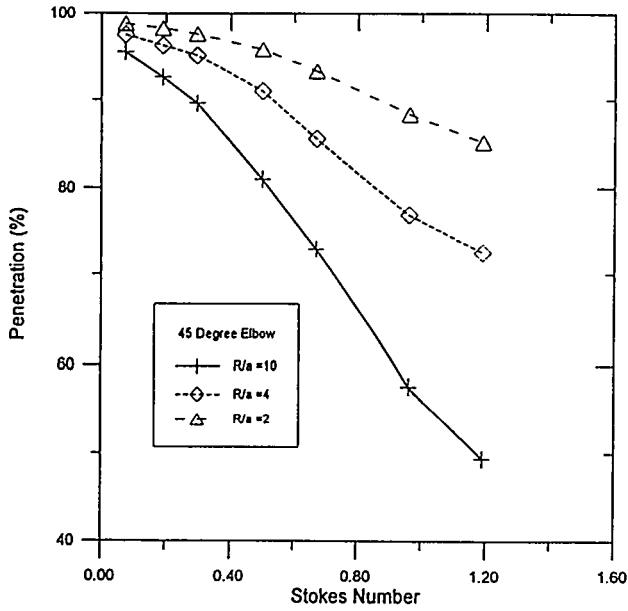

a)

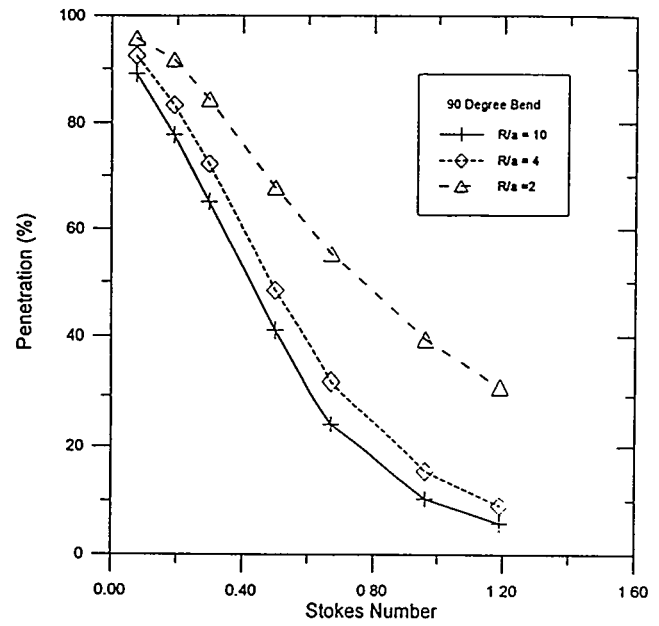


b)

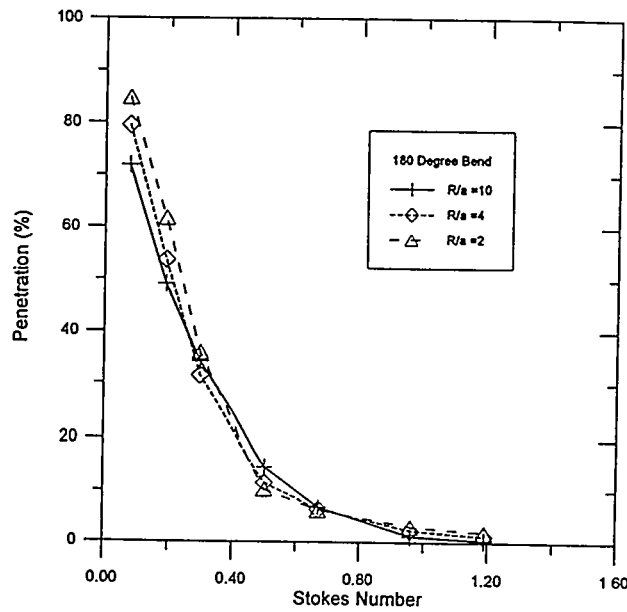


c)


Figure 7. Numerical results that show penetration as a function of Stokes number for constant values of curvature ratio and $Re = 8210$. a) Bend angle of 45° b) Bend angle of 90° . c) Bend angle of 180° .

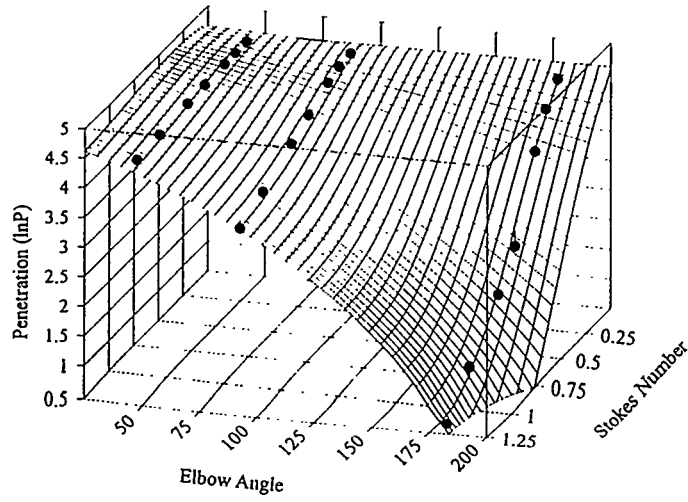

a)

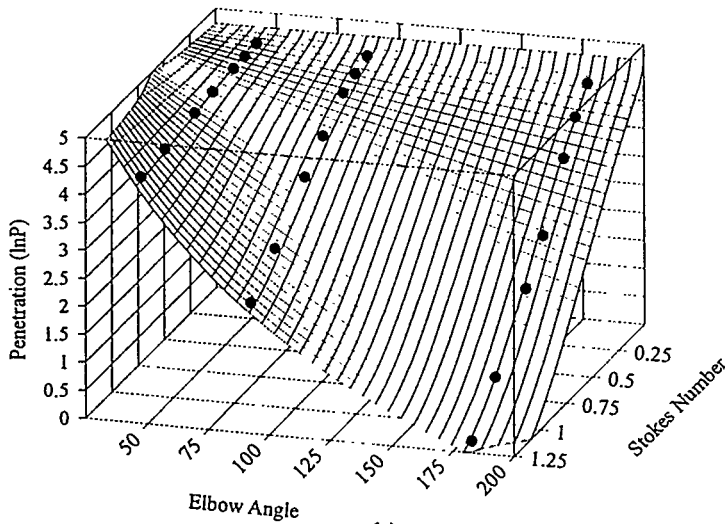

b)

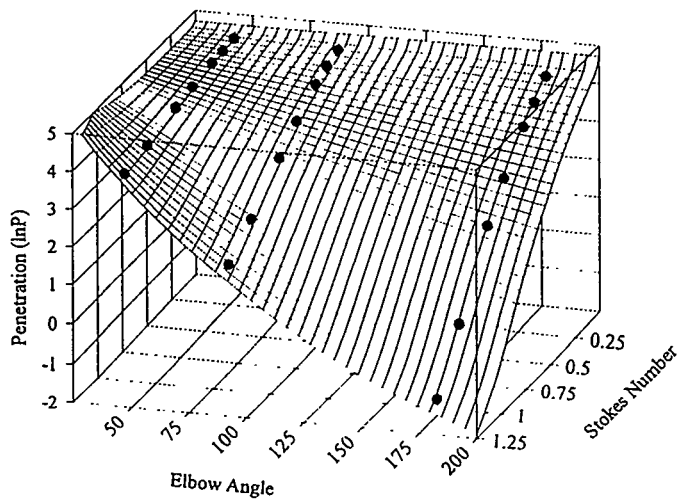

c)

Figure 8. Surface fitting of penetration as a function of Stokes number and bend angle, for constant values of curvature ratio. a) $\delta = 2$, b) $\delta = 4$, and c) $\delta = 10$.

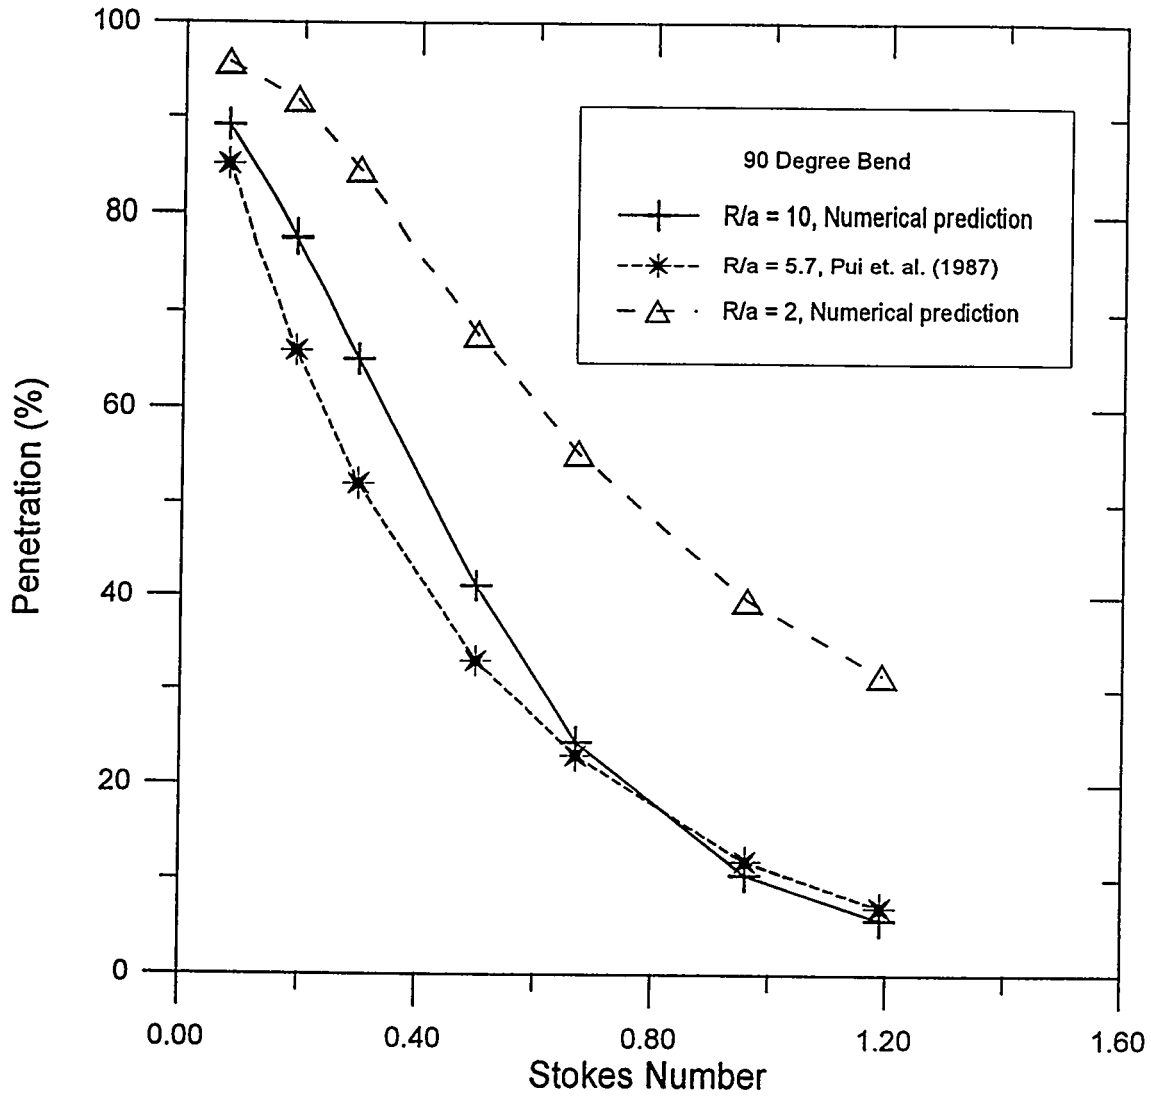


Figure 9. A comparison of the predictions of the correlation model (Equation 5) and the model of Pui et al. (1987).

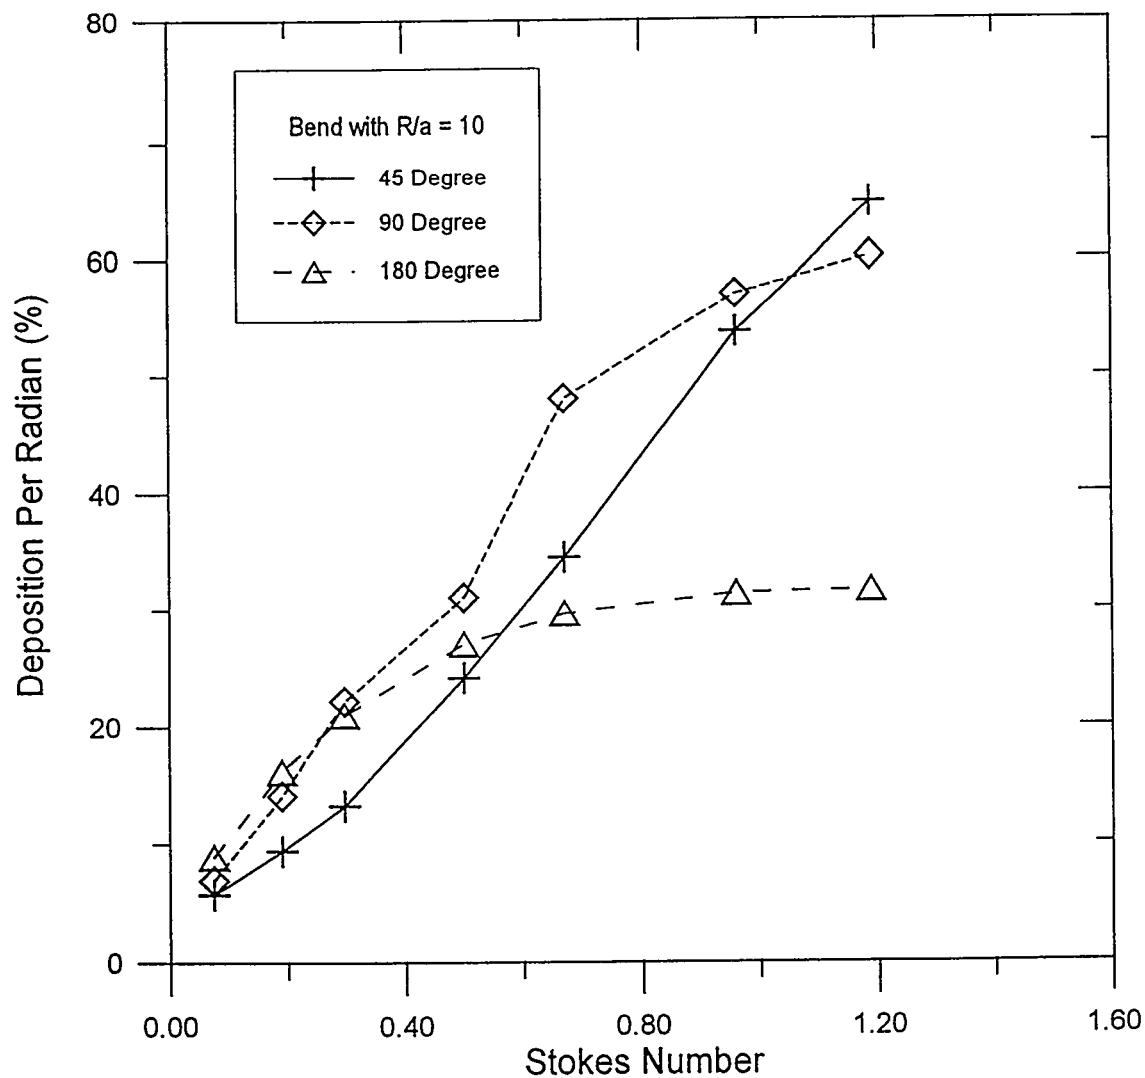


Figure 10. Effect of bend angle on deposition rate. The deposition per radian is the total aerosol lost to the internal wall of a bend divided by the bend angle.

DISCUSSION

FLEMING: How do you account for the effects of your filter sampling on your flow patterns in the downstream portion of the tube? How does that affect your flow patterns through the tube, and how do you sort that out?

MCFARLAND: What we do is assume that the sample transport line ends where the filter starts. Therefore, we make our predictions up to and including any sort of a transition, for example, an expansion or a contraction right ahead of the filter. However, the transport of aerosol from the free stream excludes the filter itself.

ADAMS: As most filter lines are lined and heated, would that have an effect on any of the data collection?

MCFARLAND: If a sample transport line was heated, I assume it is to prevent condensation of reactive gases or of water. In the code that we developed, the DEPOSITION code, we have built into it a sampling temperature and sample line pressure. The sample line pressure does not have a great impact on particle sampling transmission through a line. On the other hand, the temperature can have an effect. The temperature will influence the viscosity, which in turn will influence the particle DEPOSITION. But that is built into the deposition code, or at least into codes numbered 3.1 or higher. I am going to add that we have developed a Windows version of the DEPOSITION code. Those of you who have used the DEPOSITION code have a version which is DOS-only. The code in Windows-form is currently being reviewed by the sponsors of the work. I assume that we should be ready to release it within a couple months. If there is anyone that is interested in a copy, at no charge, leave a card with me and I will send you a free copy at the time that we do the release.

ENGELMANN: If you used the Reynolds number at the pinched bend, would you then find the deposition to be dependent upon Reynolds number? Have you any data on deposition downstream of the pinched bend? One might think it to be greater than deposition in straight tubes without bends.

MCFARLAND: In answer to the first question, we have not examined the effect of Reynolds number on a pinched bend. The data that we have on pinched bends is experimental, whereas our data on the effect of Reynolds numbers on un-pinched bends is numerical. With respect to the second question, the losses in a pinched bend are the sum of those in the pinched region and the regions of circular cross section in the bend. No experiments were conducted to directly compare losses downstream of pinched bends with the losses downstream of un-pinched bends; however, the data in Figure 4 show there are similar overall losses in bends that are pinched $\leq 25\%$, which suggests there may not be much difference between the losses downstream of pinched and un-pinched bends. Your comment on the losses in bends being greater than losses in straight tubes is well taken. Often the losses in bends are a couple of orders of magnitude greater than the losses in an equal length of straight vertical tubing.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

ATMOSPHERIC DISCHARGES FROM NUCLEAR FACILITIES

DURING DECOMMISSIONING: GERMAN EXPERIENCES

AND CONCEPTS

H. Braun, R. Görtz, L. Weil
Federal Office for Radiation Protection, Germany

Abstract

In Germany, a substantial amount of experience is available with planning, licensing and realization of decommissioning projects. In total, a number of 18 nuclear power plants including prototype facilities as well as 6 research reactors and 3 fuel cycle facilities have been shut down finally and are at different stages of decommissioning. Only recently the final „green field“ stage of the Niederaichbach Nuclear Power Plant total dismantlement project has been achieved.

From the regulatory point of view, a survey of the decommissioning experience in Germany is presented highlighting the aspects of production and retention of airborne radioactivity. Nuclear air cleaning technology, discharge limits prescribed in licences and actual discharges are presented. As compared to operation, the composition of the discharged radioactivity is different as well as the off-gas discharge rate. In practically all cases, there is no significant amount of short-lived radionuclides. The discussion further includes lessons learned, for example inadvertant discharges of radionuclides expected not to be in the plants inventory. It is demonstrated that, as for operation of nuclear power plants, the limits prescribed in the Ordinance on Radiological Protection can be met using existing air cleaning technology. Optimization of protection results in public exposures substantially below the limits.

In the frame of the regulatory investigation programme a study has been conducted to assess the airborne radioactivity created during certain decommissioning activities like decontamination, segmentation and handling of contaminated or activated parts. The essential results of this study are presented, which are supposed to support planning for decommissioning. For LWRs, Co-60 and Cs-137 are expected to be the dominant radionuclides in airborne discharges.

I. Introduction

During the operational phase of nuclear installations radioactive substances are discharged to the environment in liquid and airborne form. These discharges are subject to licensing and to surveillance and control.

When operation is terminated the transition to decommissioning takes place. This implies in general that plant states are essentially modified, media no longer required are removed and new systems for decommissioning purposes installed. Along with the technical changes, regulatory conditions change. In many cases, a new license is required. As the dominant mechanisms of discharge are different from operation as well, discharge limits or more general criteria for discharges prescribed in the license for decommissioning are in most cases different from those valid for operation.

In this paper, information is provided on German experiences and insights with the assessment, control and regulation of airborne discharges from nuclear installations in the phase of decommissioning. The discussion comprises an overview on plants being shut down permanently, the mechanisms leading to airborne radioactivity inside the plant, technology of discharge control, discharge limits, actual discharges and further regulatory aspects.

II. Nuclear Power Plants in Germany

II.I Overview

The situation concerning the use of nuclear power in the Federal Republic of Germany (early 1995) is as follows ⁽¹⁾:

19 nuclear power plants with a capacity of 21,824 MWe gross (20,735 MWe net) are in operation,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- 1 nuclear power plant unit with 1,302 MWe (gross capacity) is shut down for an undefined period, following court order,
 - 1 nuclear power plant unit with 806 MWe gross was out of operation in 1993 and 1994 for hot repair works and adaptations,
 - 15 nuclear power plant units with 3,330 MWe (gross) in total are finally shut down, i.e. decommissioning has been started, applied for or planned,
- for
- 6 nuclear power plant units, the construction and assembly works have been stopped or the application for construction and operation has been revoked.

II.II Plants finally shut-down in Germany

The decommissioning of the first nuclear power plant of the Federal Republic of Germany, **Versuchsatomkraftwerk Kahl (VAK Experimental Reactor)** was decided in 1985. The decommissioning concept provides the total dismantling of the plant. The first two decommissioning licences for decommissioning allow the dismantling of internal and external systems of the controlled area, the handling with contaminated tools and equipment and with low activity secondary radioactive waste. Furthermore, procedures and equipment for the dismantling, disassembling, and packaging of contaminated and activated parts of the facility were tested. On 25th September 1993, the third licence for decommissioning according to section 7 of the Atomic Energy Act (Atomgesetz, AtG) was issued. Action against this third licence was dismissed by the Higher Administrative Court of the State of Bavaria on 17th August 1994, which means that the disassembling of the reactor pressure vessel and the biological shield as well as the clearance for reuse or disposal, of non-hazardous substances which have been authorized as non-radioactive waste has been approved. It is planned to finish decommissioning, including site restoration, by the year 2000.

For the **Mehrzweckforschungsreaktor (MZFR Research Reactor)**, which was finally shut down in 1984, it was decided in 1989, after comparison of various decommissioning options, to perform the immediate and complete dismantling of the installation. The dismantling of the MZFR takes place stepwise, each step requiring a licence according to Atomic Energy Act. On the basis of the five issued decommissioning licences for MZFR, the decontamination of the heat removal system and the moderator system, the dismantling of equipment, such as equipment of the turbine building, electric installations, reactor auxiliary and supporting systems, water treatment system as well as the dismantling of the cooling tower was performed or initiated. The dismantling including restoration of the site should be finished by the year 2001 after altogether 6 partial steps. On 15th April 1994, the fourth, on 30th May 1994, the fifth partial licence for the decommissioning of the MZFR were issued, approving further dismantling works.

Rheinsberg Nuclear Power Plant (KKR) with a gross capacity of 70 MWe (reactor WWER) was finally shut down in 1990. Application for decommissioning of the plant was made on 30th March 1992. The first licence for decommissioning was granted on 28th April 1995. Demolition work has been started.

Total dismantling is planned for **Gundremmingen Nuclear Power Plant Unit A (KRB-A)** which was shut down in 1977. Dismantling is taking place in several project phases which are based on the corresponding atomic energy law licences. Phase I, in which lowly contaminated components and the steam- and feedwater circuits in the turbine building were dismantled, was finished in 1989. In phase II, the disassembling of higher contaminated reactor coolant contacted components and systems from the reactor building was performed. In phase III, the last dismantling step, the disassembling of the reactor pressure vessel and its equipment including the reactor shield, will be provided. Based on the licence for phase III issued on 12th August 1992, the disassembly of the reactor equipment was partly achieved in 1994 (e. g. 2 steam dryer units).

The **Jülich Atomversuchskraftwerk (AVR-Reacto**r, an experimental high temperature gas-cooled reactor with pebble bed), shut down in 1988, shall be transferred to safe enclosure after disassembly of equipment parts such as turbine, generator, condenser and condensate treatment system. The competent regulatory authority has approved the decommissioning concept and the safe enclosure in 1991. In the period from April to June 1992, the available 5,704 unused fresh fuel spheres balls were removed from the AVR-facility. The licence for decommissioning, unloading of the reactor core, dismantling and disassembling of equipment and safe enclosure of the AVR was issued on 9th March 1994.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The unloading of the spherical fuel elements out of the reactor into the central interim storage facility in the Jülich Research Centre was started.

The **Lingen Nuclear Power Plant (KWL)** was decommissioned in 1977 after 9 years of operation. Based on the licence of 21st November 1985, the facility was transferred to safe enclosure, which began in 1988. The safe enclosure involves the reactor building and the auxiliary building including the connecting building. All controlled areas situated outside this area were decontaminated, cancelled, and partly dismantled. The safe enclosure is monitored from the adjacent Emsland Nuclear Power Plant. After about 25 years of safe enclosure operation, it is planned to start the complete dismantling of the plant.

The **Heißdampfreaktor Großwelzheim (HDR, a nuclear superheated BWR)** finally shut down in 1971, was used after shut down for non-nuclear investigations and R&D on behavior of nuclear installations in the case of severe accidents. Decommissioning of the reactor was approved on 16th February 1983. The above-mentioned test programme was finished in 1991. Complete dismantling of the facility is planned until 1998. A second licence for decommissioning was granted on 29th December 1994 which also covers the disassembling of the reactor pressure vessel and parts of the primary circuit.

The **Niederaichbach Nuclear Power Plant (KKN, a heavy water moderated, gas cooled pressure tube reactor)**, which was decommissioned in 1974, is the first NPP in the Federal Republic of Germany being completely dismantled. The NPP was permanently shut down and transferred into safe enclosure in 1983, dismantling began in 1987. The dismantling of inactive and contaminated parts of the facility, except from activated areas near the core, was finished in 1990. The dismantling of the activated parts was finished at the end of 1993. Evidence taking measurements performed in the facility for clearance of the buildings were completed. The Ministry of State for Regional Development and Environmental Aspects of the State of Bavaria dismissed the KKN plant from the application of the Atomic Energy Act on 17th August 1994 and reported that the plant is released for conventional dismantling according to building law. Thus, the complete dismantling of a nuclear power plant was performed for the first time in Europe. The site restoration was celebrated on the 17th August 1995. The radioactive waste amounted to about 2% of the overall amount of decommissioning wastes.

The units 1 to 4 of the **Greifswald Nuclear Power Plant (KGR, WWER type, W-230 reactor)**, were shut down in 1990.

The dismantling of all five units will be achieved without preceding safe enclosure. An application for decommissioning and dismantling of plant units was submitted on 17th June 1994. The first licence for decommissioning was granted by 30th June 1995. Demolition of the facility has started.

Adjacent to the Greifswald site, an intermediate storage and waste treatment facility is under construction (Zwischenlager Nord, ZLN).

The **Kompakte Natriumgekühlte Kernreaktoranlage (KNK II, a sodium cooled Fast Breeder Research Reactor)** was finally shut down in 1991, after finishing its test programme. The shut-down was started with the removal of the fuel elements. The decommissioning concept provides for a stepwise disassembly up to the full dismantling of the plant. The first licence for decommissioning of the facility was granted on 26th August 1993, the second one on 30th May 1994. Since 26th May 1994, the nuclear fuel is completely removed. The third licence for decommissioning was granted on 21st February 1995 approving, among other points, the taking out of operation of the secondary coolant circuit as well as construction, operation and dismantling of a drumming station for the disposal of the secondary sodium. An application for granting the fourth licence for decommissioning has already been submitted.

The **Thorium Hochtemperaturreaktor (THTR-300, a gas cooled high temperature reactor)** was shut down for being decommissioned in 1989. For the facility a period of safe enclosure is planned. On 17th March 1992, the Federal Office for Radiation Protection granted the licence for the storage of irradiated fuel elements from THTR-300 in the **Ahaus Fuel Element Interim Storage Facility (BZA)**.

The first licence for decommissioning, unloading of the reactor core and dismantling of equipment components was issued on 22nd October 1993. Since then, the spherical fuel elements have continuously been removed from the core. The core content had fully been removed by the end of 1994. All 305 Castor containers with fuel elements have been stored in the Ahaus Interim Storage Facility until April 1995.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In 1995, it was decided to finally shut down the Würgassen NPP, a BWR with an electrical power of 670 MW, which had been in operation from 1971 to 1994. Planning for decommissioning is underway.

Obviously, there is a substantial amount of decommissioning experience in Germany. It covers all stages of decommissioning like immediate dismantlement, safe enclosure and dismantlement after safe enclosure and combinations of these basic patterns.

III. Decommissioning operations creating airborne radioactivity

III.I General

Before decommissioning commences, it is assumed that the nuclear fuel and other media not required during decommissioning are removed from the plant in the frame of the operating license. In real cases of decommissioning, however, this is not always fulfilled.

In a nuclear power plant, the remaining inventory of radioactivity is then given by activated RPV and RPV-internals, the activated part of the biological shield, contaminated systems and components and, finally, contaminated building structures.

Decommissioning operations can be roughly divided into dismantling, decontamination, handling and waste management. Each of these areas of activities consists of numerous subtasks characterized by technology and application. During practically all of them airborne radioactivity is created. Thermal cutting techniques like plasma arc cutting or oxy-acetylene cutting for example produce significant amounts of aerosols. Practically relevant examples of decommissioning operations and aspects of airborne radioactivity are discussed in chapter 4.

III.II Study results

In a study, ⁽²⁾ this has been assessed on a generic basis for the case of the total dismantlement of a modern 1300 MWe PWR. Essential results obtained for the atmospheric discharges and the resulting exposure to the public are summarized in table 1. Even if the variability in generically postulated methods and data is taken into account, the central finding that public exposure is substantially below the prescribed limits given in the next chapter remains valid.

Table 1: Dismantlement of a modern 1300 MWe PWR;
estimates of atmospheric discharges and dose calculations as given in a generic study ⁽²⁾

Radionuclide	Atmospherically discharged radioactivity (Bq)	Calculated effective dose (μ Sv)
Co-60	$5,4 \cdot 10^6$	$1,4 \cdot 10^{-2}$
CS-137	$1,7 \cdot 10^7$	$7,8 \cdot 10^{-2}$
Cs-134	10^4	$6,4 \cdot 10^{-5}$
Mn-54	10^5	$1,5 \cdot 10^{-5}$
Eu-152	10^4	$2,4 \cdot 10^{-6}$
Ni-59	10^3	$7,3 \cdot 10^{-9}$
Ni-63	10^5	$1,4 \cdot 10^{-6}$
Nb-94	10^3	$1 \cdot 10^{-5}$
Fe-55	$3 \cdot 10^5$	$4 \cdot 10^{-6}$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

IV. Regulatory aspects

According to section 7 para 3 of the Atomic Energy Act the decommissioning of a nuclear installation as well the safe enclosure of a finally decommissioned installation or the dismantling of the installations or of parts thereof require a license.

The level of protection against exposure of the public from discharges in air or water is defined in section 45 of the Ordinance on Radiological Protection (ORP). The dose limits per calendar year are:

- | | |
|--|---------|
| 1. Effective dose, partial body dose for gonads, uterus, red bone marrow | 0.3 mSv |
| 2. Partial body dose for all organs and tissues unless specified in 1. or 3. | 0.9 mSv |
| 3. Partial body dose for bone surface, skin | 1.8 mSv |

In section 28 of the ORP it is furthermore required to keep exposures even below these limits as low as practicable.

In the licensing procedure for decommissioning discharge limits are defined in compliance with these requirements.

V. Selected information on decommissioning projects

V.I. General Remarks

For the retention of the airborne radioactive particulates, which are released in dismantling operations in shut down nuclear power plants, firstly the filter systems installed during power operation and still operated at present are available⁽³⁾. These are filter trains of the vent air filter system, the system exhaust air filter system and the subatmospheric pressure maintenance system which, for particulate removal, are provided with a prefilter, two category C particulate air filters, and one high-efficiency particulate air (HEPA) filter. The effective removal efficiencies of these filter trains with respect to the spectrum of particulates reaching them are well above the decontamination factor of 3×10^3 which is guaranteed solely for the new HEPA filter for the particles of the most penetrating size. On account of the series connection with the prefilter, the two category C particulate air filters, growing dust loading as well as the actual spectrum of particulates taken into account, total decontamination factors $> 10^6$ can be anticipated. So, these filter systems alone offer an effective protection against inadmissible emissions of radioactive particulates arising in decommissioning operations.

In the course of dismantling work additional measures are taken with the goal to support the air filter systems mentioned above and to further reduce discharges to the environment. These measures consist in

- keeping as low as possible the source term,
- retaining the released particulates by exhausting them where they are produced, and
- removing most of them in filter units installed in addition.

the goal pursued is not only to minimize the emission of radioactivity, but, at the same time, to avoid the spread of contaminations from dismantling work and, besides, to reduce internal exposure of the dismantling staff resulting from inhalation. Attaining these goals justifies additional expenditure which, in some cases, might be quite considerable.

The extent of additional measures required is quite different in the three most important dismantling phases, namely dismantling of the contaminated primary system, of the activated reactor pressure vessel with internals, and of the reinforced concrete of building structures, especially the biological shield. A great volume of coarse dust with low specific activities and easily to manage arises in dismantling concrete structures, whereas the most stringent requirements have to be met in dismantling the reactor pressure vessel and its internals. In the latter case specific activities on the order of 10^8 Bq/g might have to be expected⁽⁴⁾. The requirements to be fulfilled in dismantling contaminated systems are on a level between the two cases mentioned above. It should be taken into account also that dismantling of the primary loops is often preceded by chemical decontamination as practiced for instance under the MZFR decommissioning project⁽⁵⁾. The primary objective pursued is to allow for manual dismantling with acceptable low radiation exposure of the staff. At the same time, smaller source terms will arise from dismantling work and hence a positive effect on the emissions to the atmosphere is

achieved as well.

V.II Engineering Measures for Minimizing Radioactive Particulate Emissions

Emission control starts already with the minimization of the source term resulting from cutting operations. This means that to the extent feasible by the respective dismantling work cutting techniques will be applied which will produce no or only very few aerosols. Thus, preference will for instance be given to techniques such as mechanical cutting, shearing, and abrasive cutting. In cases where the application of thermal cutting techniques cannot be avoided, the relevant parameters will be optimized such that the least possible amount of aerosols is produced ⁽⁶⁾.

In order to remove the radioactive particulates released, the atmosphere has to be exhausted and filtered. In standard cases it will be sufficient to install a hood above the workstation. However, in this way only about 90% of the particulates are normally safely retained which is equivalent to a decontamination factor of as little as 10. It is known that subsequent filtration produces much higher efficiencies. Consequently, in order to improve primary dust removal, the completest possible exhaust has to be aimed at. This is feasible by setting up a tent or housing around the workstation which is frequently practiced. This concept was implemented in a very sophisticated manner in the course of the meanwhile completed dismantling of the Niederaichbach Nuclear Power Plant (KKN). For remotely cutting up the pressurized tube reactor with its highly complex core structure an additional containment within the reactor containment was installed around the reactor tank ^(7, 8). Existing structures of the building were used for construction. In this additional containment kept at a negative pressure with respect to the containment atmosphere directed air flow was maintained. The vent air was cleaned in a purpose-built filter bench, 30,000 m³/h through-put, and then carried into the vent air system of the containment for secondary cleaning. This solution to the problem is represented schematically in Fig. 1. It allowed to avoid the very expensive dismantling under water and thus helped saving a considerable amount of costs. In this context, operations were facilitated by the fact that the maximum specific activations were on the order of 10⁵ Bq/g only due to the short operation period of the plant.

By contrast, the highly activated reactor pressure vessel with internals will normally be dismantled under water using remotely handled tools ⁽⁹⁾. This necessitates, as a rule, installation of a suitable water tank around the reactor pressure vessel. Water in that case does not only serve to remove the aerosols generated in the cutting operations but it acts also as a shield protecting the operating staff. Typical experiments have made evident that 10⁻³ to 10⁻⁴ of the kerf material removed in the cutting operations is released as aerosols above the water surface ^(10, 11). As a rule, these aerosols will be exhausted above the water surface and removed in particulate air filters as for instance practiced in the course of decommissioning of the Gundremmingen Nuclear Power Plant, Unit A ⁽¹²⁾.

A great variety of commercial filter techniques are suited for removal of the dusts and aerosols, respectively, released in cutting up operations. Experience accumulated in the recently completed demolition of the Niederaichbach Nuclear Power Plant proved that cleanable particulate air filters should be best suited for this purpose. They comprise two series-connected particulate air filters operated at reduced volume flow rate of approx. 1000 m³/h per standard sized filter element. The first filter is cleaned by cyclic backflushing whereas the second serves as a safety device. Since the late seventies the successful application of particulate air filters provided with cleanup device has been reported in Germany ^(13, 14). Cleanable particulate air filter systems are available on the market. Work on their improvement is under way ^(15, 16).

It is generally known that the outstanding feature of such a filter combination are extremely high decontamination factors. Besides, very great amounts of dust can be removed. Consequently, the operating costs are justified which are caused mainly by filter changeout and disposal of the loaded filters ⁽¹⁷⁾. Finally, cleanable particulate air filter systems are suited to remove all particles of the spectrum encountered in decommissioning work.

During decommissioning of KKN several small mobile particulate air filter systems were used as well as the already mentioned stationary system with a throughput of 30,000 m³/h. It was possible by these additional filter devices to keep extremely low the monthly emissions of particulate β -radioactivity during the whole period of decommissioning from July 1988 until June 1994. Figure 2 shows the respective values of releases ⁽¹⁸⁾. As a rule, they range from 10³ to 5 x 10⁴ Bq, with the maximum values measured during the phase of dismantling of the activated pressurized tube reactor. The radiation burdens resulting from these emissions at the point of maximum deposition are negligible compared with exposure to natural radiation, a finding that is consistent with the general estimate provided in chapter 3.2. This experience shows that particulate removal during dismantling of nuclear power plants can be very effectively controlled with the engineering tools presently available.

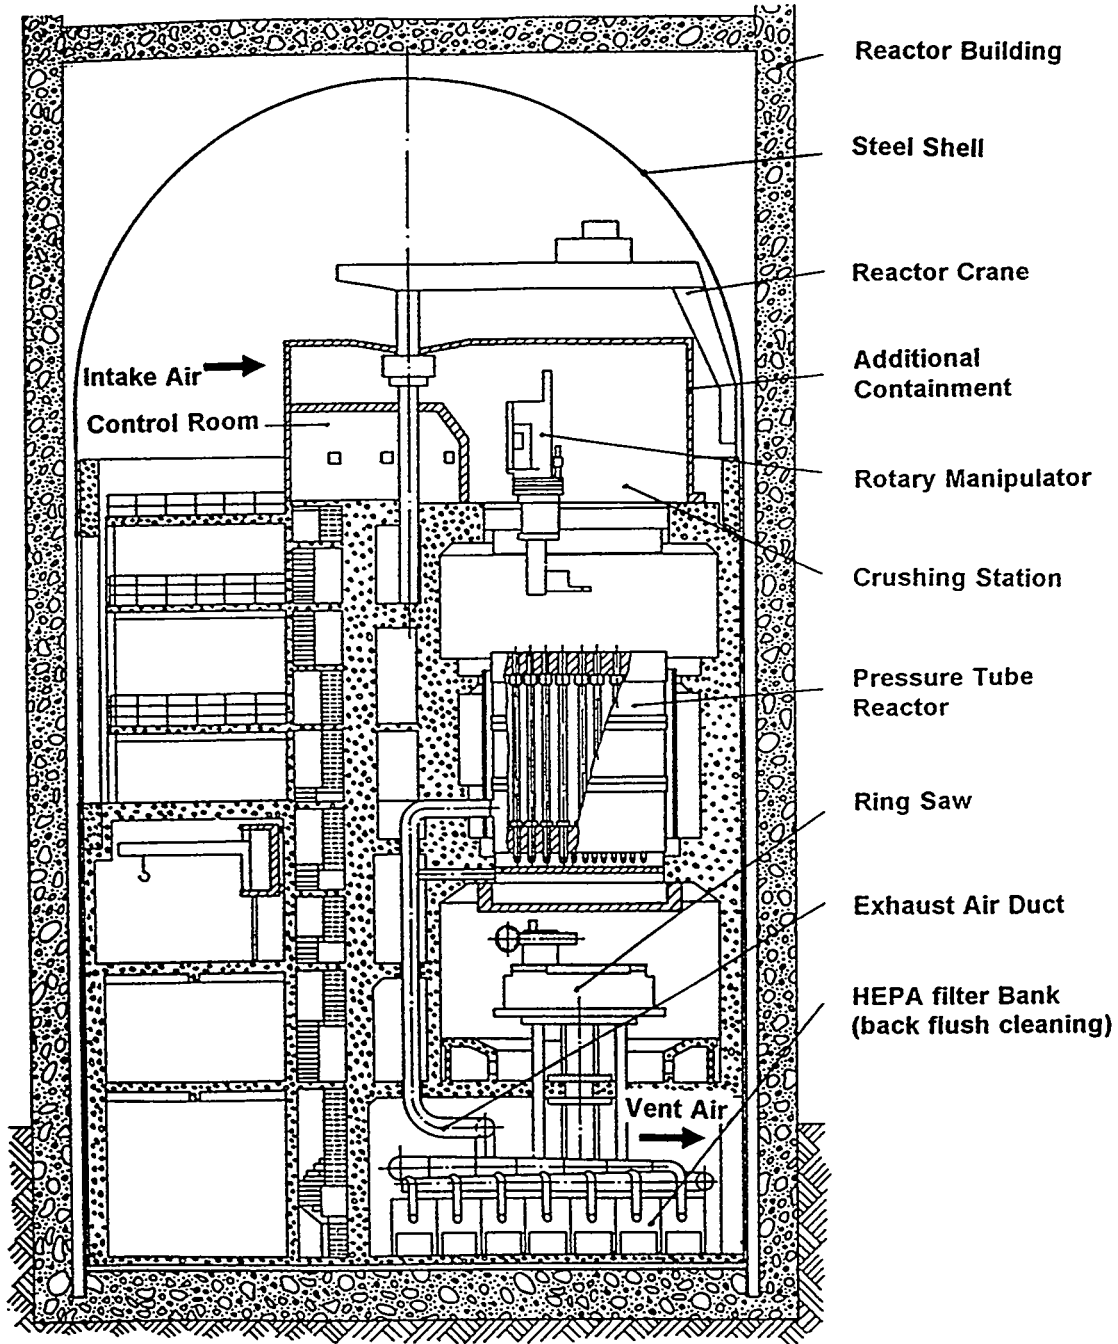


Fig. 1: Additional containment for the dismantling of the activated pressure tube reactor of KKN.

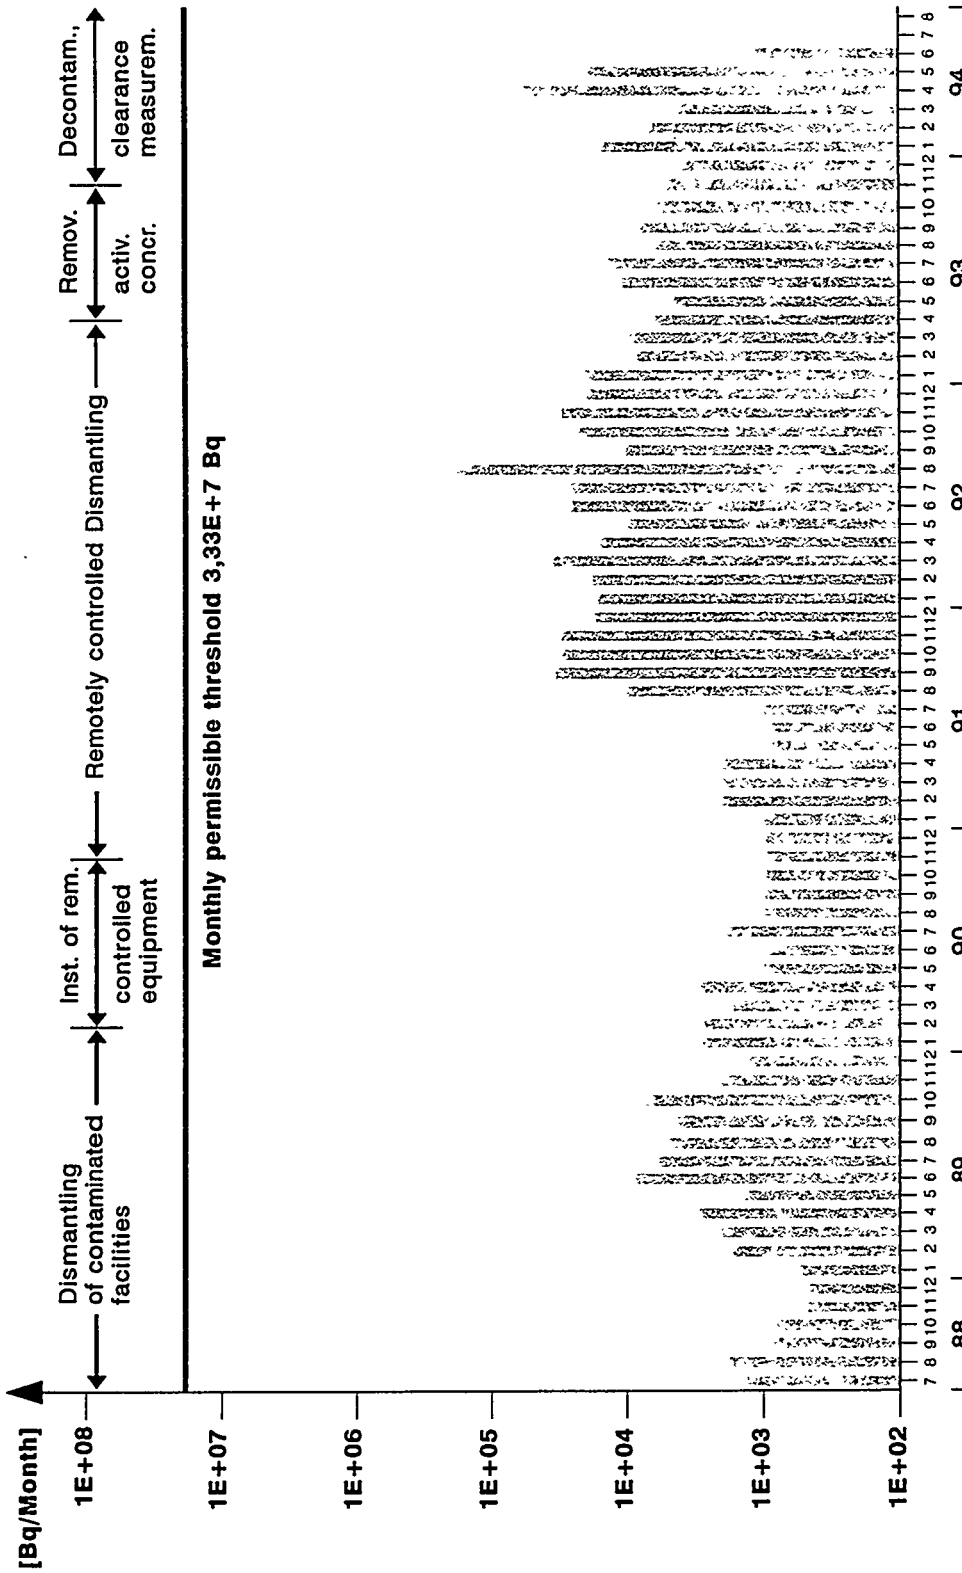


Fig. 2: Monthly emissions of particulate radioactivity during the decommissioning of KKN.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

VI. Summary and conclusions

Atmospheric discharges from nuclear facilities finally shut-down are subject to regulation and control as during operation.

The nature of the discharges during decommissioning are in general different. Short-lived radionuclides have decayed and media (nuclear fuel, coolant, operational waste) no longer required are removed from the site and treated or stored elsewhere. In general, long-lived radionuclides in aerosol form are the most relevant group governing the atmospheric discharges during decommissioning.

The processes that lead to the formation of airborne radioactivity during decommissioning operations are quite well known. Generally speaking, they are segmentation, decontamination, handling and conditioning of radioactive parts and components. Thermal cutting of metal components is of special relevance.

As confirmed by the substantial amount of decommissioning experience in Germany, the technology is available for control and retention of airborne radionuclides. It generally consists of a combination of in-situ exhaust with prefiltering and aerosol filters for the overall atmospheric discharges.

Experience shows that in actual decommissioning projects the legal requirements of observing dose limits and keeping exposures below these limits as low as practicable are met. Public exposure due to atmospheric discharges is negligible. Theoretical studies demonstrate that this can be achieved as well in the substantial amount of decommissioning work that will be faced in the decades ahead, when the modern nuclear power plants approach the end of their projected life time and might be taken out of service.

Acknowledgement

The authors gratefully acknowledge the support provided by Mr. V. Rüdinger from KBG (Kernkraftwerk Betriebsgesellschaft mbH) in terms of technical information on decommissioning projects.

References

- (1) F. Philippczyk, J. Hutter
"Stand und Entwicklung der Kernenergienutzung 1994 in der Bundesrepublik Deutschland" Bundesamt für Strahlenschutz/Fachbereich Kerntechnische Sicherheit (BfS-KT-10/95)
- (2) R. Görtz, R. Graf, S. Kistinger, A. G. Knaup
Genehmigungsrelevante Aspekte der Nachbetriebsphase kerntechnischer Anlagen
Schriftenreihe Reaktorsicherheit und Strahlenschutz
BMU-1991-324, ISSN 0724-3316
- (3) V. Rüdinger; C.I. Ricketts; J.G. Wilhelm;
HEPA Filters of High Structural Strength for Nuclear Air Cleaning Systems;
ASHRAE TRANSACTIONS V.95 (1989), Pt. 2.
- (4) V. Massaut; et al.;
Pilot Dismantling of the BR3 Pressurized Water Reactor;
in: R. Wampach et al (Editors), Decommissioning of Nuclear Installations, Luxembourg 1995, pp. 32.
- (5) W. Demant;
Stand der Stilllegungsaktivitäten des Mehrzweckforschungsreaktors;
3. Statusbericht Stilllegung und Rückbau kerntechnischer Anlagen,
Bad Dürkheim, 8.-10. November 1995, pp. 123.
- (6) H. Stoiber; G. Hammer; H. Schultz;

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Emissionsreduzierung bei der Anwendung thermischer Trennverfahren zur Zerlegung kerntechnischer Anlagen
- Autogen- und Plasmatrennen;
ibid. pp. 251.

- (7) V. Rüdinger; G. Engelhardt;
Beseitigung des Kernkraftwerkes Niederaichbach (KKN), Atw 36 (1991),
pp. 555.
- (8) G. Engelhardt; K. Grabenstätter; L. Valencia;
Über die prototypische Stilllegung des KKN - Ablauf, Erfahrungen und Stand der Arbeiten; KfK-Nachrichten 24
(1992), pp. 95.
- (9) G. Engelhardt;
Technische Lösungen zur RDB-Zerlegung; Atw 40 (1995), pp. 619 - 623.
- (10) B. Waldie; et al.;
Solid and Gaseous Secondary Emissions from Underwater Plasma Arc Cutting;
in: K. K. Pflugrad; et al. (Editors), Decommissioning of Nuclear Installations, EUR 12690 (1990), pp. 239.
- (11) J.P. Dufayet; et al.;
Underwater Thermal Cutting Techniques and Associated Remote-Controlled Manipulator Systems;
Ref. 2; pp. 227.
- (12) N. Eickelpasch; H. Steiner; A. Fischer;
Pilot Dismantling of the KRB A Boiling Water Reactor;
Ref. 2; pp. 47.
- (13) I. Gail;
Neues wirtschaftliches Verfahren zur Feinstaubabscheidung von staubbeladenen Gasströmen;
Staub Reinh. Luft 37 (1977), pp. 175.
- (14) W. Zwanzig;
Hochleistungsschwebstofffilter zur großtechnischen Feinstreinigung von Gasen;
Chem. Techn. 7 (1978), pp. 101.
- (15) H. Leibold; T. Leiber; I. Döffert; J.G. Wilhelm;
Grundlagen und Technik der Abreinigung von Schwebstofffiltern durch Rückspülung;
KfK-PEF 109 (1993).
- (16) M. Fronhöfer; H. Leibold;
Abreinigungstechnik für Schwebstofffilter zur Entstaubung großer Volumenströme bei hohen
Staubkonzentrationen;
FZK-PEF 135 (1995).
- (17) P. Böhm; V. Girod;
Effectiveness and Long-Term Behaviour of Automatically Cleanable High Efficiency Aerosol Filters;
EUR 15463 EN (1995).
- (18) L. Valencia;
Progress Report for the Niederaichbach Nuclear Power Plant (KKN);
OECD/NEA Co-operative Programme on Decommissioning;
18th. Meeting of the Technical Advisory Group, April 1995, Mito, Japan.

DISCUSSION

BERGMAN: What is the experience with the cleanable HEPA filter? Has there been any damage to the media? Is the media the reinforced type?

WILHELM: Often cleanable HEPA filters are used in Germany without prefilters to remove industrial dust in the g/m^3 range. On the downstream side the medium of the cleanable HEPA filters is reinforced with a glass fiber web, such as the medium of the Lydair 3255 LW 1, or with a web from organic fibers, for example of polycarbonate fibers. It is also important that the pleats be round at the edge. We tried cleanable HEPA filters in different factories including the production of cement. They operated well and had long services lives. Using optimized HEPA fillers and cleaning methods, even the loss of removal efficeincy down to around 99% after large numbers of cleaning cycles could be avoided

BERGMAN: A couple of conferences ago we presented a comparison of cleanable steel HEPA filters and standard glass HEPA filters. With a standard very gentle reverse pulse, we had dozens and dozens of holes; all the bottom pleats were blown out. Is the reason your filter survives the reverse air blast because it is a very, very slow and gentle reverse flow?

WILHELM: The method and the flow velocity during loading and cleaning of the HEPA filter are optimized. The flow velocity is not very slow during the reverse air blast. The larger particles should not be removed upstream of the HEPA filters because they produce the removable filter cake on the surface of the medium and thus prevent the very small particles from penetrating deeper into the medium. Small particles, deposited in the depth of the medium, normally will not cause the formation of a removable filter cake. Therefore, also the filtration speed should be limited. With a loading of particles only with diameters around $1\mu m$ we did not have good results with cleaning cycles.

FUKASAWA: Which nuclides were easy to be discharged to the atmosphere? Did you estimate the discharged ratio i.e., the discharged radionuclides/total amount of the facility?

WILHELM: According to the paper Co-60 and Cs-137 are the most important radionuclides for airborne discharge during decommissioning. The data for the ratio of discharged radionuclides in relation to the inventory are not available.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

HEATING, VENTILATING, AND AIR CONDITIONING DEACTIVATION THERMAL ANALYSIS OF PUREX PLANT

William W. Chen and Robert A. Gregonis
Westinghouse Hanford Company
Richland, Washington

ABSTRACT

Thermal analysis was performed for the proposed Plutonium Uranium Extraction Plant exhaust system after deactivation. The purpose of the analysis was to determine if enough condensation will occur to plug or damage the filtration components. A heat transfer and fluid flow analysis was performed to evaluate the thermal characteristics of the underground duct system, the deep-bed glass fiber filter No. 2, and the high-efficiency particulate air filters in the fourth filter building. The analysis is based on extreme variations of air temperature, relative humidity, and dew point temperature using 15 years of Hanford Site weather data as a basis. The results will be used to evaluate the need for the electric heaters proposed for the canyon exhaust to prevent condensation.

Results of the analysis indicate that a condition may exist in the underground ductwork where the duct temperature can lead or lag changes in the ambient air temperature. This condition may contribute to condensation on the inside surfaces of the underground exhaust duct. A worst case conservative analysis was performed assuming that all of the water is removed from the moist air over the inside surface of the concrete duct area in the fully developed turbulent boundary layer while the moist air in the free stream will not condense. The total moisture accumulated in 24 hours is negligible. Water puddling would not be expected. The results of the analyses agree with plant operating experiences.

The filters were designed to resist high humidity and direct wetting, filter plugging caused by slight condensation in the upstream duct is not a concern.

I. INTRODUCTION

This paper documents the results of a thermal analysis that was performed for the proposed Plutonium Uranium Extraction (PUREX) Plant exhaust system after deactivation. The analysis was performed to determine if enough condensation will occur in the concrete duct to raise a concern and to plug or damage the filtration components. A thermal and fluid flow analysis was performed to evaluate the temperature characteristics of the underground duct system, the deep-bed glass fiber (DBGF) filter No. 2, and the high-efficiency particulate air (HEPA) filters in the fourth filter building (Figure 1). The analysis is based on the extreme variations of air temperature, relative humidity, and dew point temperature using 15 years of Hanford Site weather data as a basis. The results will be used to evaluate the need for the electric heaters being considered for the PUREX canyon exhaust to prevent condensation.

The pressure drop of moist air through the filter media because of the Joule-Thomson effect is addressed. Calculations that demonstrate the effect are presented.

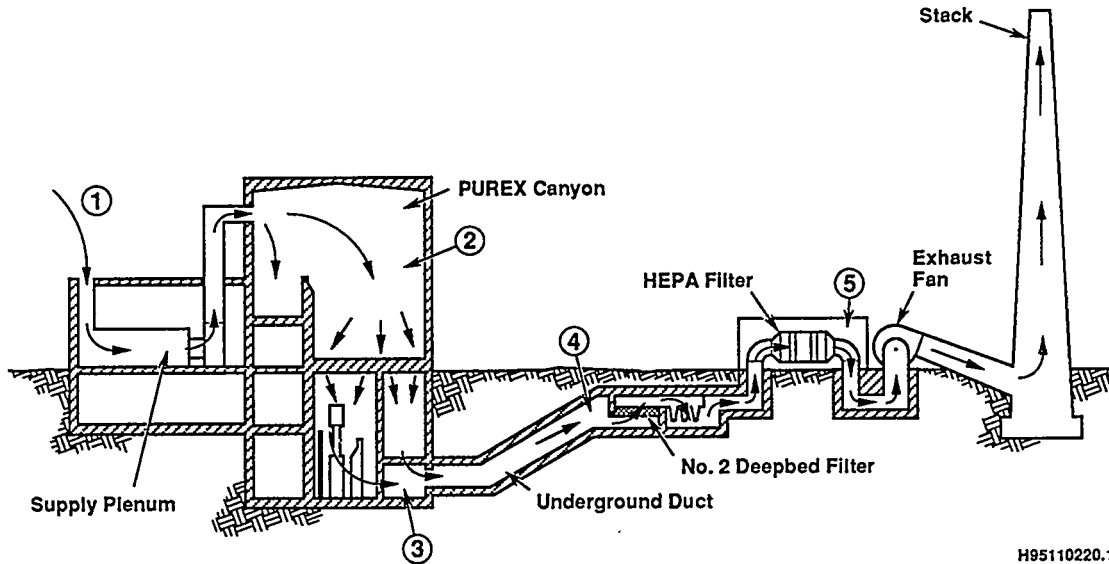


Figure 1. Operating System.

II. SYSTEM BACKGROUND

The ventilation system for the deactivated PUREX plant will consist of a draw-through system as shown in Figure 1. One of 3 canyon exhaust fans with a capacity of 40,000 ft³/min (18.88 m³/sec) will maintain negative pressure on the canyon, which provides the motive force to bring outside air into the plant. The proposed design cascades ventilation air through various zones within the plant to the PUREX canyon where it exits through the air tunnel to the underground duct work. The exhaust air passes through the DBGF filter No. 2, the fourth filter building containing HEPA filters, and the main stack to the atmosphere.

III. OPERATING EXPERIENCES

Before 1982, air washers in the supply air inlet plenums were used throughout the year. Large quantities of moisture were added to the air stream providing a mechanism for condensation far greater than what will occur during the surveillance and maintenance period. Available operating history shows no record of filter plugging or large accumulations caused by water condensation. Drains in the underground filter plenums eliminated condensate water that may have formed, but no water was entrained into the air stream to plug the deep bed or HEPA Filters.

The east and west sample gallery hood exhaust system exhausts to underground HEPA filter housings. The cover blocks of the filter housings are exposed to the ambient temperature. During HEPA filter replacements in 1987 and 1992, no high water marks or water damage were observed on any of the filters or plenum walls.

On several occasions in 1992, contamination was found to be dripping from the exhaust duct of the sample gallery hood when the spray washers were turned on. The dripping was attributed to a chemical compound in the ductwork that had an affinity for water. Since 1992, the spray washers have been left off from early spring until late fall. This eliminated the contamination dripping from the duct work. It also provided a 3-year spring/summer operating history that duplicates the sample gallery exhaust (SGE) ventilation during deactivation. No dripping or wetting of the ductwork, piping, and walls has been detected or reported.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

During the winter, the sample gallery reheat coil supplies 70 °F (21.11 °C) air to the sample gallery. The walls, which maintain a temperature of 55 °F (12.78 °C), because of the earth's insulating effect, have shown no condensation or dripping. This provides the confidence necessary to predict that the sample gallery will not experience any condensation throughout the year.

IV. ANALYSIS PROCEDURES

The thermal and fluid flow characteristics were evaluated to determine the worst case variations at different locations along the flow path from the PUREX canyon to the 291-AE building (Figure 1). The basic mechanisms for condensation and frost formation were evaluated. The effects of heating and cooling in the underground portions of the ductwork were also described and evaluated. The temperature variations between the duct and exhaust air are investigated to determine if condensation and/or frost formation are likely under these conditions.

Condensation or Moisture Formation

Condensation Principle

Condensation or moisture formation may occur from the humid air under certain flow and thermal conditions. When moist air is exposed to a surface that is colder than the dew point temperature of the air, a trace of moisture film will appear on the surface (McQuiston and Parker 1988). This phase change is called condensation. The dew point (DP) temperature on the wall surface is the controlling factor for condensation to occur. The following conditions prevent condensation from forming:

- The unsaturated air temperature equals the duct surface temperature.
- The unsaturated air temperature is colder than the duct surface temperature.
- The air dew point temperature is colder than the duct surface temperature.

The thermodynamic process of atmospheric air flowing through the PUREX exhaust system is essentially a heating and cooling process without changing the humidity ratio; only sensible heat is added or removed. Therefore, the moist air that flows through the cold duct does not necessarily produce condensation.

Condensation Rate

Based on the Hanford Site weather data for 24 hours on December 11, 1994, the data indicated the dry-bulb temperature in the range of 30 to 33 °F, while the relative humidity was between 95 and 99 percent. The cumulative condensate was calculated based on persistent air temperature of 33 °F (0.56 °C) and relative humidity of 98 percent, for 24 hours, while the duct wall temperature (32 °F or 0 °C) was assumed to fall below the air dew point temperature of 32.5 °F (0.28 °C).

Because the condensation rate was calculated based on the variation of the humidity ratio, a worse $\Delta w = 0.000325$ lb of H₂O per lb of dry air was calculated for 24 hours.

The average specific volume of the air was determined at 12.5 ft³/lb (0.78 m³/kg), the mass flow rate was calculated as 3,200 lb/min (1,451.5 kg/min).

Because moist air condensation occurs only during contact with the cool wall surface, most of the free-stream air flows through the duct without producing

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

condensation. The actual condensation occurs only for the moist air inside the laminar sublayer in a fully developed turbulent boundary layer. However, it is conservatively assumed that the moist air inside the fully developed turbulent boundary will be condensed.

For the fully developed boundary layer, the Reynolds number is calculated based on boundary layer length of 50 ft (15.24 m) at 3,787,698. The boundary layer thickness, δ , was calculated at 11 in. (27.94 cm). The total volume for condensation is 3,200 ft³ (90.6 m³). The total condensation rate for all the air moisture in 24 hours is 608 lb (275.8 kg).

The total surface area that this amount of condensate will cover in 24 hours is 1,600 ft² (148.6 m²). Therefore, the condensate rate over unit duct surface area is 0.016 lb of H₂O/hr-ft² (0.078 kg of H₂O/hr-m²) or a total of the moisture at 0.38 lb H₂O/ft² (1.85 kg H₂O/m²) per day on the duct wall surface.

The remaining non-condensed moist air outside the boundary layer will flow through the duct. The condensate on the wall surface causes no concern because the accumulated quantity is small; dripping or puddling is not expected.

If the Amercoat on the concrete has deteriorated or the concrete interior is not in a saturated state, the sorption characteristics, capillary suction, and moisture transfer capabilities of the concrete may be able to absorb a small amount of moisture (Jonasson 1985).

For the concrete surface in the air duct, this rate of condensation cannot produce dropwise condensation. The moisture will be spread over the concrete surface with a thin layer of film with no dripping or puddling.

As a result of the assumed condensation, the humidity ratio or moisture contents in the flowing air will be reduced when the air flows through the DBGF filter No. 2.

Fog and Frost Formation

Fog is a disperse system consisting of liquid drops suspended in a gas. The conversion of vapor to fog is a discontinuous process occurring under critical conditions when vapor reaches the supersaturation state (Amelin 1967). The air flow in this study has not experienced any isentropic expansion into the wet region in the enthalpy/entropy diagram (Obert 1960) and the supersaturation condition has never been attained. Thus, fog formation inside the air duct is not possible.

If the fog or gaseous suspensions are flowing from the environment into the plant with the moist air, the warming effect inside the building and air duct will evaporate the moist fog. The fog can be sustained only if a source within the plant continuously supplies the moisture and the temperature in the duct is much colder than the outside air. As the moist air flows through a complicated and winding path inside the plant, the moist drops may impact a surface and deposit along the pathway. Because the fog conditions at the Hanford Site lasted only few hours, a limited amount of moisture was deposited in the air duct.

Frost forms when the moist air is exposed to a surface that is colder than the dew point temperature of the air, which must be far below 32 °F (0 °C). Under this condition, the moisture content of the air passes directly from the gaseous state to the solid state forming a porous layer of frost on the cooled surface. The rates of increase of the frost thickness require a continuous cooler temperature and high-humidity environment. Otherwise, the frost begins to melt and evaporates into the air stream. When the air/frost interface temperature temporarily warms back to 32 °F

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

(0 °C), even in a high-humidity environment, the frost layer will occasionally undergo cycles of melting and refreezing (Trammell 1968). Considering the high affinity the air has for moisture, the frost melts and is evaporated by the dry air.

Air and Duct Temperature

The worst temperature variations contained in the Hanford Site weather data for the past 15 years were reviewed. The two wettest years, and the two coldest years, and the 1994 winter data were used as the basis for performing the heat transfer analyses. Heat transfer calculations and numerical examples for the conditions described are presented in the following paragraphs.

Transient Heat Conduction

Based on the weather data for the coldest and wettest years at the Hanford Site, transient heat conduction calculations were performed to determine the worse environmental temperature conditions and the depth the freezing layer penetrates into the soil resulting from the worst weather scenario (Schneider 1955).

Two examples are used to demonstrate the depth the frozen layer penetrates into the underground soil under extreme weather conditions.

Example 1: On a cold winter day, after a sudden change in weather conditions, the surface temperature of the plant environment drops to 18 °F (-7.8 °C). These cold conditions continue for 14 days. The temperature of the ground before the weather change is assumed to be 35 °F (1.7 °C). After this period, the temperature is calculated at different distances from the surface (Schneider 1955):

$$x = 4 \text{ ft (1.220 m)}, \quad T = 32.1^\circ\text{F (0.08 }^\circ\text{C)}.$$

$$x = 5 \text{ ft (1.524 m)}, \quad T = 33.6^\circ\text{F (0.89 }^\circ\text{C)}.$$

$$x = 6 \text{ ft (1.829 m)}, \quad T = 34.3^\circ\text{F (1.28 }^\circ\text{C)}.$$

Example 2: During the winter, a sudden cold wave reduces the ambient air temperature to 0 °F (-17.8°C). If the earth was at a uniform temperature of 40 °F (4.4 °C) before the onset of the cold wave, the freezing temperature penetrations were calculated to different depth after various hours,

$$6 \text{ hours, } x = 0.9 \times 2\sqrt{1.8 \times 6} = 5.9 \text{ in (14.98 cm)}.$$

$$12 \text{ hours, } x = 0.9 \times 2\sqrt{1.8 \times 12} = 8.4 \text{ in (21.34 cm)}.$$

$$24 \text{ hours, } x = 0.9 \times 2\sqrt{1.8 \times 24} = 11.8 \text{ in (29.97 cm)}.$$

This indicates that the frozen layer penetrates less than 1 ft (0.3048 m) in 24 hours.

Flowing Air Temperature

The winter atmospheric air flows from the PUREX canyon building and enters the inclined air duct system. The wall surface temperature of the air duct was assumed to be 55 °F (12.8 °C) at 30 ft (9.144 m) below grade and cooled to near the environment temperature at the upper section close to the grade level. Heat transfer calculations were performed to determine the temperature increase of the flowing air at the turbulent boundary layer because of the warmer wall.

This section calculates the moist air temperature change caused by the effect of the warm concrete duct wall. The underground concrete duct cross-section area varies from the lower portion of 11 ft x 5 ft-9 in. (3.35 m x 1.75 m) to the upper portion of 8 ft

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

x 8 ft (2.44 m x 2.44 m). The upper section is near the grade level, so its temperature is closer to the environmental temperature.

Consider a 40,000-ft³/min (1,132 m³/min) flow rate, the flow velocity through an 11 ft x 5 ft-9 in. (3.35 m x 1.75 m) duct is 10.54 ft/sec (3.21 m/sec). The equivalent hydraulic diameter is 90.6 in. (2.3 m). The Reynolds number is 578,529, which falls within the turbulent flow region. Assume that the Prandtl number is 0.7 for air. The heat transfer coefficient was calculated at 0.0196 Btu/hr-in²-°F (16.02 W/m²-K) using the correlation (Lancet 1959) $Nu = 0.042 (Re)^{0.8} (Pr)^{1/3}$.


Assuming that the moist air at 32 °F (0 °C) flows through the concrete duct section at 55 °F (12.8 °C), the heat balance equation may be applied to calculate the flowing-air temperature at 34.4 °F (1.33 °C). This demonstrates that the air temperature in the boundary layer will be warmed up to 34.4 °F (1.33 °C), while the air temperature outside of the thin boundary layer remains at 32 °F (0 °C).

Duct Wall Temperature

Another calculation shows the cooling effect on the wall surface if cool air is flowing continuously through the duct. The convective cooling from the wall requires temperature gradient in the concrete wall to initiate the conduction heat flow. Hand calculations appeared to be fairly involved. A transient heat transfer analysis using a simplified finite-element model (ANSYS 1993) was performed to determine the temperature distributions throughout a concrete section.

The warm wall surface of the underground duct may be cooled if air at 32 °F flows through continuously. However, at a great distance from the surface, the duct surrounding remains at 55 °F (12.8 °C).

The finite-element mesh denoting the node and element numbering is shown in Figure 2. The three-dimensional thermal solid elements (solid70) have eight nodes with a single degree of freedom, temperature, at each node was used. Convective boundary condition, with heat transfer coefficient of 0.0196 Btu/in²-hr-°F (16.02 W/m²-K), was applied at the inside wall surface. Concrete material properties were used.

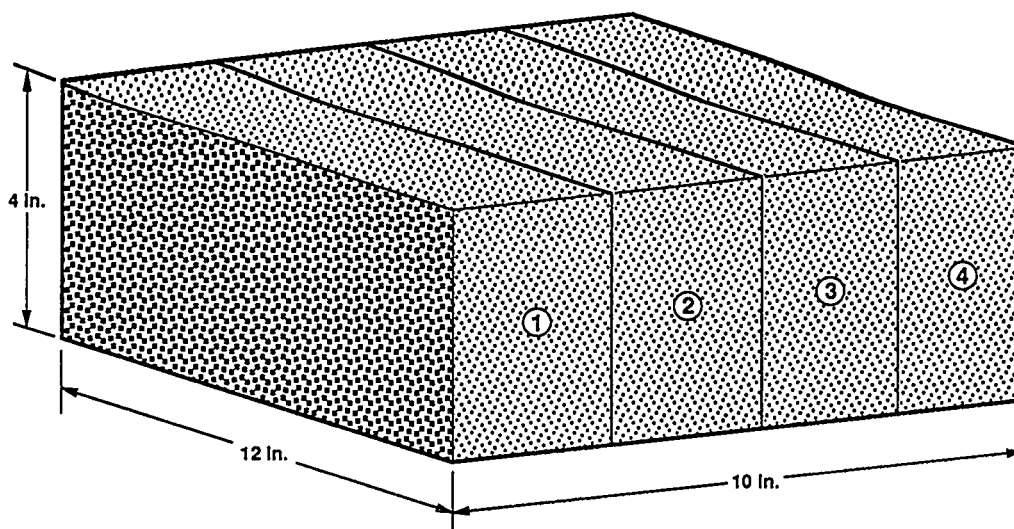

H98080171.1

Figure 2. ANSYS Finite-Element Model.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

A small initial temperature gradient was applied to start the transient solution. Results indicate that the temperature distribution throughout the section of the wall reached a steady-state temperature of approximately 42 °F (5.56 °C) after 4 hours.

Filter System Condensation

This section describes possible condensation and moisture effects on the filter systems.

Prefilter (Deep Bed Filter No. 2)

If condensation were assumed to have occurred at the cold wall surfaces in the upper portion of the inclined air duct system, the moisture content of the air would be reduced and further effect of condensation on the deep bed filter would be decreased because the air entering the filter is dryer.

Generally, sufficient moisture in droplet form is hazardous to a filter system. However, the filters are designed to resist moisture as long as plugging does not occur. Filtration is achieved by various mechanisms depending on the particle size and flow velocity (Davies 1973). The penetration mechanism is controlled by either molecular diffusion, interception, Brownian motion, or inertial impacting depending on the air flow velocity.

In good-quality filters with low resistance and high efficiency against submicron particles, the air flow obeys Darcy's law, which is usually considered to be valid for creeping flow with low Reynolds number. The low-Reynolds-number flow is dominated by viscous force. The viscous effect between the air particles and the filter fibers may keep the filter surface temperature from decreasing below the air temperature. As a result, the filter surface temperature is generally close to the air flow temperature.

High-Efficiency Particulate Air Filter

If condensation occurs in the underground duct work, the air flowing through the HEPA filters in the 291-AE building will be dryer.

Before the air reaches the HEPA filters, it has to flow through the concrete duct that has a wall surface temperature close to that of the inlet plenum wall located at the entrance to the HEPA filter. The temperature of the plenum wall should be the same as or colder than that of the HEPA filter. If the plenum wall temperature is at or colder than the dew point of the flowing air, condensation will occur at the plenum.

Condensation will not take place in the filters whether or not condensation occurs at the plenum. The air will simply flow through the filters. The HEPA filter media is treated with a water-resistant binder and will tolerate both high humidity and direct wetting (Flanders 1988). Several tests (First and Leith 1976) indicated that no degradation in filtering ability occurs after exposure to a steam-droplet atmosphere.

Joule-Thomson Effects

The Joule-Thomson experiment (Jones and Hawkins 1960, Kestin 1979) may resemble the moist air flowing through filter media and produce condensation. The basic condition for the Joule-Thomson effect to cause cooling is that the initial temperature of the gas must be below the maximum inversion air temperature, which is 628 °F (331 °C). The temperature of the flowing air is below the maximum inversion temperature.

If air is compressed to a pressure of 200 atm (2,940 psi or 20,265 KPa) and a temperature of 126 °F (52 °C), after throttling to a pressure of 1 atm (14.7 psi or

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

101.325 KPa), it will be cooled to 73 °F (23 °C). For a small pressure drop of few inches or centimeters, such as flow through porous media, the temperature drop and the air cooling effect of the Joule-Thomson phenomenon are negligible.

Frost Formation on HEPA Filters

The possible frost conditions in the HEPA filter building are evaluated under the assumed frozen temperature in the environment. Two conditions may subject a cool surface to frost formation: when the surface has been exposed to nocturnal radiation and when a surface that has cooled below 32 °F (0 °C) contacts the moist air with a dew-point temperature higher than the surface temperature.

The first condition is unlikely to occur because the HEPA filters are housed in a building and not exposed to nocturnal radiation. Therefore, the cooling will not be present inside the building.

The second condition becomes possible when a surface cools to a subzero temperature that is below the dew point of the moist air. If the wall surface temperature of the HEPA filter building is cooled down well below the freezing point, the concrete duct and inlet plenum surface temperature will be near or at the freezing point temperature. Under this condition, the water vapor leaving the air and attaching to the surface may pass directly from gaseous to solid state forming a porous layer of frost.

Tests (Brian et al. 1970) indicate that continuous frost formation requires a subzero temperature and high specific humidity. After the frost formation, frost growth requires a sustained cooling mechanism, a continuous temperature decrease of the cooled surface, and an increase of the specific humidity of the air stream. In the absence of this persistent cooling phenomenon, frost buildup is not possible (Trammell 1968). If at any time the surface temperature reaches 32 °F (0 °C), melting will occur (Jones and Parker 1975). Based on temperature fluctuations from the Hanford weather data, frost may have formed on cold surfaces as a transient condition.

If condensation has already occurred as the cold air flows through the concrete duct or inlet plenum, the same amount of air that flows into the HEPA filters would have reduced the moisture content or humidity ratio. With a reduced humidity ratio because moisture is lost in the duct, the effect on the filters is not a concern.

V. RESULTS AND DISCUSSIONS

The results of a transient heat conduction analysis show that the depth of frozen soil, resulting from a subfreezing surface temperature of 18 °F (-7.78 °C) penetrates 6 ft (1.83 m) below grade after 14 days. These results agree with the publications from the U.S. Weather Bureau map that show the average and maximum depths of frost penetration as 12 and 36 in. (30.48 and 91.44 cm), respectively, in southeastern Washington State (Strock 1965). This indicates that only a small upper section of the air duct perimeter near the grade level may temporarily come close to the freezing temperature under the possible worst environmental condition.

An extreme weather condition that may never occur at the Hanford Site also was analyzed. A plant environmental surface temperature of -27 °F (-32.8 °C) lasting for 60 days was assumed. Results indicate that the frozen layer may penetrate into the soil to a depth of 7 ft (2.134 m).

The earth has been shown to maintain a constant temperature of 55 °F (12.78 °C) throughout the year at the lower section of the air duct. Cool moist air at 32 °F (0 °C) flowing through the 55 °F (12.78 °C) air duct can warm up only 2 °F (1.11 °C)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

near the boundary layer, while a large quantity of air at the free stream remains at 32 °F (0 °C). A continuous flow of cold air at 32 °F (0 °C) may lower the wall temperature to 42 °F (5.56 °C) when reaching a steady-state condition in 4 hours. The 42 °F (5.56 °C) temperature is above the dew point of the air.

If the air flows at a velocity of 10.54 ft/sec (3.213 m/sec), the time for air to travel from the duct entrance to deep bed filter no. 2 takes approximately 25 seconds. The duct wall temperature cannot be cooled much lower than the steady-state temperature. Condensation in the lower section of the air duct during the winter is not possible.

A condition may exist in the underground ductwork where the duct temperature can lead or lag the changes in the ambient air temperature because of the thermal storage characteristics of the underground duct. This condition may contribute to condensation on the inside surfaces of the underground exhaust duct.

The coldest and wettest weather data for the past 15 years have shown that only short periods in the early spring and winter of 1994 could contribute to some slight condensation that is barely enough to dampen the duct wall surfaces.

However, the condensation rate was conservatively calculated based on the worst recorded data during the 1994 winter. The dry-bulb temperature occurred between 30 to 33 °F (-1.1 to 0.56 °C), while the relative humidity was between 95 and 99 percent for 24 hours, assuming that the moist air flowing through the boundary layer in the concrete duct is condensed during the 24 hours. Results indicated that only 0.38 lb (0.172 kg) of moisture may be accumulated on 1 ft² (0.093 m²) in 24 hours. A large amount of flowing air in the free stream does not condense.

This small amount of moisture may be evaporated under the condition of temperature variations without producing significant wetting. From the plant operating histories, no significant condensation has been observed, even when the water spray system was in operation.

If condensation occurs on the concrete duct-wall surfaces, the humidity ratio for the air downstream is reduced. As a result, the filter housing temperature is above the dew point temperature of the air; therefore, condensation does not take place. The potential for condensation on the HEPA filter housing surfaces will be less of a concern.

The pressure drop through the filter system is not sufficient to cause any temperature drop and condensation. In addition, the filters are designed to resist high humidity and direct wetting (Burchsted 1978, Flanders 1988), so a small amount of moisture would be of no concern.

Frost formation on the HEPA filters is not possible because frost forms only on much colder surfaces, such as the duct wall or inlet plenum, before the cold air flows into the filters. No enduring mechanisms, such as continuous cooling and a high-humidity environment, exist to build up such effects on the HEPA filters.

VI. CONCLUSION

Condensation heat transfer and fluid flow analyses were completed to evaluate the effects of condensate in the underground duct and filters in the PUREX plant. The results of the analysis indicate that the ductwork upstream of the DBGF filters bed No. 2 is the most likely place for condensation to form.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

A worst case conservative analysis was performed assuming that all of the water is removed from the moist air over the inside surface of the concrete duct area in the fully developed turbulent boundary layer while the moist air in the free stream will not condense. The total moisture accumulated in 24 hours is 0.38 lb H₂O/ft² (1.85 kg H₂O/m²), which is barely enough to dampen the concrete wall surfaces. Water dripping and puddling is not expected.

Turbulent heat transfer analysis has shown that 32 °F (0 °C) air flowing through the duct will be warmed to 34.4 °F (1.33 °C) inside the thin laminar sublayer, while the air in the free stream remains at 32 °F (0 °C). Further analysis has indicated that the surface of the duct wall may be cooled to 42 °F (5.56 °C) after reaching a steady state condition in 4 hours.

Based on an air flow velocity through the concrete duct at 10.54 ft/sec (3.213 m/s), the air has a resident time of approximately 25 seconds traveling from the underground duct entrance to the DBGF No. 2 filter. Therefore, the lead/lag temperature characteristics of the underground duct are of short duration allowing the duct to follow changes in air temperature rather closely. This reduces the condition for possible condensation. On the other hand, condensation occurring in the ductwork upstream of the DBGF No. 2 filter will provide dryer air in the downstream duct and filters.

If no condensation occurs before the deep bed filters, the same moist air flows through the concrete duct, the HEPA filter building, and the exhaust system without further condensation. The pressure drop through the filter system is not sufficient to cause any temperature drop that will initiate condensation. However, the filters were designed to resist high humidity and direct wetting (Burchsted 1978, Flanders 1988), filter plugging caused by condensation is not a concern. Tests (First and Leith 1976) indicated no degradation in filtering ability after exposure to a steam-droplet atmosphere. The results of the analyses also agree with the operating experiences. Therefore, it is concluded that no electrical heating system is required for the PUREX canyon exhaust to prevent condensation.

VII. REFERENCES

Amelin, A. G., 1967, *Theory of Fog Formation*, 2nd ed., Israel Program for Scientific Translation Ltd., Jerusalem, Israel.

ANSYS, 1993, "*Engineering Analysis Computer Program*," Version 5.0A, Swanson Analysis Systems, Inc., Houston, Pennsylvania.

Brian, P. L. T., and R. C. Reid and Y. T. Shah, 1970, *Frost Deposition on Cold Surfaces*, Ind. Eng. Chem. Fundamental, Vol. 9, No. 3, pp. 375-380.

Burchsted, C. A. and J. E. Kahn and A. B. Fuller, 1978, *Nuclear Air Cleaning Book*, ERDA 76-21, Oak Ridge National Laboratory, Oak Ridge, Tennessee.

Davies, C. N., 1973, *Air Filtration*, Academic Press, New York, New York.

First, M. W. and D. Leith, 1976, *Entrainment Separator Performance*, Paper No. 101, Proceedings of the 14th ERDA Air Cleaning Conference, pp. 694-710.

Flanders, 1988, *Nuclear Grade HEPA Filters*, Bulletin No. 812E, Flanders Filters Inc., Washington, North Carolina.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- Jonasson, J. E., 1985, *Moisture Fixation and Moisture Transfer in concrete*, Paper No. H5/11, 8th International Conference on Structural Mechanics in Reactor Technology, August 19-23, 1985, Brussels, Belgium.
- Jones, J. B., and G. A. Hawkins, 1960, *Engineering Thermodynamics*, John Wiley & sons, Inc., New York, New York.
- Jones, B. W. and J. D. Parker, 1975, *Frost Formation With Varying Environmental Parameters*, J. of Heat Transfer, May, 1975, pp. 255-259.
- Kays, W. M. and M. E. Crawford, 1993, *Convective Heat and Mass Transfer*, 3rd ed., McGraw Hill Book Company, New York, New York.
- Kestin, J., 1979, *A Course in Thermodynamics*, Revised Edition, Volume One, Hemisphere Publishing Corporation, New York, New York.
- Lancet, R. T., 1959, *The Effect of Surface Roughness on the Convection Heat-Transfer Coefficient for Fully Developed Turbulent Flow in Ducts With Uniform Heat Flux*, J. of Heat Transfer, May, 1959, pp. 168-174.
- McQuiston, F. C. and J. D. Parker, 1988, *Heating, Ventilating, and Air Conditioning, Analysis and Design*, 3rd ed., John Wiley & Sons, Inc.
- Obert, E. F., 1960, *Concepts of Thermodynamics*, McGraw Hill Book Company, New York, New York.
- Schneider, P. J., 1955, *Conduction Heat Transfer*, Addison-Wesley Publishing Company, Inc., Reading, Massachusetts.
- Strock, C and R. L. Koral, 1965, *Handbook of Air Conditioning Heating and Ventilating*, 2nd ed., Industrial Press Inc., New York, New York.
- Trammell, G. J., and D. C. Little and E. M. Killgore, 1968, *A Study of Frost Formed on A Flat Plate Held at Sub-Zero Temperatures*, ASHRAE Journal, July 1968, pp. 42-47.
- The Trane Company, 1977, *Trane Air Conditioning Manual*, 53rd Printing, The Trane Company, La Crosse, Wisconsin.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FRETTHOLD: Are you planning on changing out all of your filters prior to going into this condition, so you start with new filters?

GREGONIS: No, we are not. We test our HEPA filters annually and we have recently replaced up to five banks. Because the system for our filter building was built for 120,000 CFM we have ten banks. Five will be available on-line and five will be off-line. If we have a problem we will just valve in another bank and then replace them during that time.

FRETTHOLD: You are running your filters at your 40,000 CMF instead of 120,000?

GREGONIS: That is correct.

FRETTHOLD: You plan to down rate the filter by going to twice the number of filters?

GREGONIS: That is the plan. This system has been online since '83. Based on its' history has been pretty reliable. Have not had a major problem. So the thought is that it will continue.

FRETTHOLD: Where will supply air come from? It is not supplied with a fan, is it just drawn in through the supply?

GREGONIS: It is drawn through the system by the negative pressure in the canyon, basically it is infiltration. We will have prescribed paths for the air to enter.

BERGMAN: I was looking through your references and I did not see any reference to the excellent work done by Dr. Wilhelm and his group at KfK about moisture accumulation on filters. If I recall right, just a little bit of particle deposition will literally suck the moisture out of the air, even when it is below saturation and when you have a powerful enough fan it will suck the innards out of the filter. That is one thing. A second item is that we were shown at a prior conference that even when you leave a HEPA filter sit in storage, it loses all its water repellency after about ten years. In that case, the image of the filter is not that of a water repellent substance, but a sponge that will literally soak up the water. My question is, have you considered any of these facts from previous literature reports?

GREGONIS: We have a extensive list of research on that. There was a paper presented by Dr. First that showed a case where they were testing a droplet retractor, I believe, and that paper pretty much showed that water was not a problem. In addition, we go through a deep bed before we go through the HEPA filter. So the dust loading on the HEPA filters is basically nil.

BERGMAN: All studies before the KfK studies during the mid-80's had been done with brand new filters. Again I point out, it does not take a lot of dust, just a little bit of dust immediately changes the characteristics from a brand new filter to an aged filter. And again, the image is a sponge even though you have a very clean environment, the fact that you lose the organic water repellency characteristic transforms the filter into a sponge. And so I would recommend you to refer to some of the pioneering work in Germany, and include that in your references because by not doing so, you may have a little surprise.

GREGONIS: Just a comment based on our operating experience. They used to run the spray washers

year-round and the mechanism for condensation was that the filter housings are out in the ambient temperature. I have been in almost all the filter housings, and been involved in filter changes. We did not see any degradation or ruptures. Therefore, in our deactivation state, where we are not putting any water in, but are just taking ambient air and running it through the plant and out again, I feel we have a pretty good basis for utilizing these filters. However we will study the matter you presented.

ENGELMANN: Whether there can be condensation on the filter depends almost entirely upon the absolute humidity of the air and the filter temperature. A simple and adequate approach is to estimate or measure the absolute humidity within the building and that of the makeup air to calculate what is presented to the filter. A simple solution (if there is a problem) is to add more makeup air which at Hanford, has low humidity. Heating of the air did not merit consideration as a solution, unless there are expected to be major activities with much evaporation within the building.

SESSION 9

COMPUTER MODELING APPLICATIONS & ADSORPTION

Wednesday July 17, 1996

Co-Chairmen: R. Lee
D.W. Moeller

COMPUTER MODELING APPLICATIONS

FILTRATION THEORY USING COMPUTER SIMULATIONS

W. Bergman and I. Corey

STUDY ON COLLECTION EFFICIENCY OF FISSION PRODUCTS BY
SPRAY: EXPERIMENTAL DEVICE AND MODELING

D. Ducret, D. Roblot, J. Vendel, Y.

ADSORPTION

CHARACTERIZATION AND RESTORATION OF PERFORMANCE OF
"AGED" RADIOIODINE REMOVING ACTIVATED CARBONS

W.P. Freeman

EFFECTS OF WELDING FUMES ON NUCLEAR AIR CLEANING
SYSTEM CARBON ADSORBER BANKS

P.W. Roberson

FILTRATION THEORY USING COMPUTER SIMULATIONS*

by

Werner Bergman and Ivan Corey
Lawrence Livermore National Laboratory
Livermore, CA 94550

Abstract

We have used commercially available fluid dynamics codes based on Navier-Stokes theory and the Langevin particle equation of motion to compute the particle capture efficiency and pressure drop through selected two- and three-dimensional fiber arrays. The approach we used was to first compute the air velocity vector field throughout a defined region containing the fiber matrix. The particle capture in the fiber matrix is then computed by superimposing the Langevin particle equation of motion over the flow velocity field. Using the Langevin equation combines the particle Brownian motion, inertia and interception mechanisms in a single equation. In contrast, most previous investigations treat the different capture mechanisms separately. We have computed the particle capture efficiency and the pressure drop through one, 2-D and two, 3-D fiber matrix elements.

I. Introduction

Developing an accurate theoretical model of particle filtration is extremely difficult because of the complex nature of the filtration process, which involves particle transport in a fluid moving through a complex filter geometry. Figure 1 illustrates the complicated structure of a typical filter medium made from glass fibers. The fluid and suspended particles flowing through this fiber maze follow an extremely tortuous path controlled by the fluid dynamics and the particle equations of motion. Other type of filter structures such as spheres or granules and irregular porous structures are also frequently used in filtration.

The previous approach for modeling the particle filtration process has been to represent the complicated filter structure by a single element and then compute the fluid flow and particle transport around the one element.^(1,2) The particle transport was computed by separately adding the contributions due to diffusion and inertia to the integrated trajectory. More recently, investigators have begun to model filtration in terms of parallel fibers arranged in a symmetric two-dimensional configuration.⁽³⁾ Although this is an improvement over the single collector model, the filtration is still limited to 2-D flows through overly simplistic filter geometries.

*This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under contract no. W-7405-ENG.48.



Figure 1. Scanning electron micrograph of glass fiber media used in high efficiency particulate air (HEPA) filters.

The problem with these previous approaches is that only general trends can be obtained from the computations, and considerable amount of experimental studies are still needed to substantiate the computations for specific filter designs and operating parameters. For that reason, filter designs and operational parameters generally are established through extensive experimental studies. This approach is both costly and time consuming. Perhaps even more important, the previous theoretical models restrict the development of new filters to existing production designs and available materials rather than what is theoretically possible. To overcome these deficiencies we have developed a filter simulation model that can simulate the filtration of suspended particles through more realistic filter structures, although not yet as complicated as that shown in Figure 1. The complexity of the fluid flow and particle trajectories through the filter media shown in Figure 1 greatly exceed present computer hardware and software capabilities, even when using advanced mainframe computers.

II. Development of Filtration Simulation Model

We have used commercially available fluid dynamics codes, NEKTON version 2.85, (Fluent Inc. 10 Cavendish Ct. Lebanon, NH 03766) and FIDAP version 6.0, (Fluid Dynamics International, Inc. Evanston, Il, 60201) and the particle equation of motion to compute the particle capture efficiency and pressure drop through selected two- and three-dimensional fiber arrays. The approach we used was to first compute the air velocity vector field throughout a defined region containing the fiber matrix. This was the most difficult and time consuming task in our study. Each combination of inlet air velocity and fiber matrix required a significant effort to set up the fluid problem and to compute the velocity field. All of the air flow calculations in this report were conducted with a uniform inlet velocity directed at the fiber matrix, and we allowed the exit velocity to vary. We did not force the fluid to be periodic (equal velocity fields at the inlet and exit) through the fiber matrix because of the additional work required to establish periodic flow.

The most difficult and time consuming step of the simulation is computing the velocity and pressure fields using computational fluid dynamics (CFD) computations. We have used the commercial CFD solvers, NEXTON and FIDAP, which are based on Navier-Stokes equations. The large memory requirements (50MB) and the long processing times (20 hours) for the CFD computations limit the size of the filter model that can be studied to filter structures with about 100 fibers when using computer workstations. Using PCs would restrict the filter to about 10 fibers, while a supercomputer could compute structures with up to 1,000 fibers.

The filtration computer simulations require a UNIX based hardware platform with a minimum of 48MB of memory to run. We computed the filtration simulations that are shown in this report using the SGI Indigo platform from Silicon Graphics. The following are the software and hardware requirements:

Table 1. Hardware and Software Requirements For Computer Simulations

<u>COMPONENT</u>	<u>REQUIREMENT</u>
Graphics	Requires open/GL Graphics. 8 bit -planes is adequate
CFD Solver	A CFD solver is required. Any 3D CFD solver can be used, e.g. NEKTON or FIDAP. A mesh generator may also be required, e.g. TrueGrid.
Visualization	SGI's Explorer was used
Main Memory	48MB
Disk Storage	10MB minimum, primarily for flow fields

Figure 2 shows an example of the two-dimensional air flow calculations through a matrix of $2\mu\text{m}$ and $4\mu\text{m}$ diameter fibers. The inlet flow velocity was 20 cm/s . We were also able to compute the three-dimensional flow fields through the staggered hexagonal array in Figure 3 and the crossed fiber array in Figure 4. The direction of flow is in the X-direction. Once the air flow velocity field is determined, the differential pressure is also fixed and is read directly from the computer output.

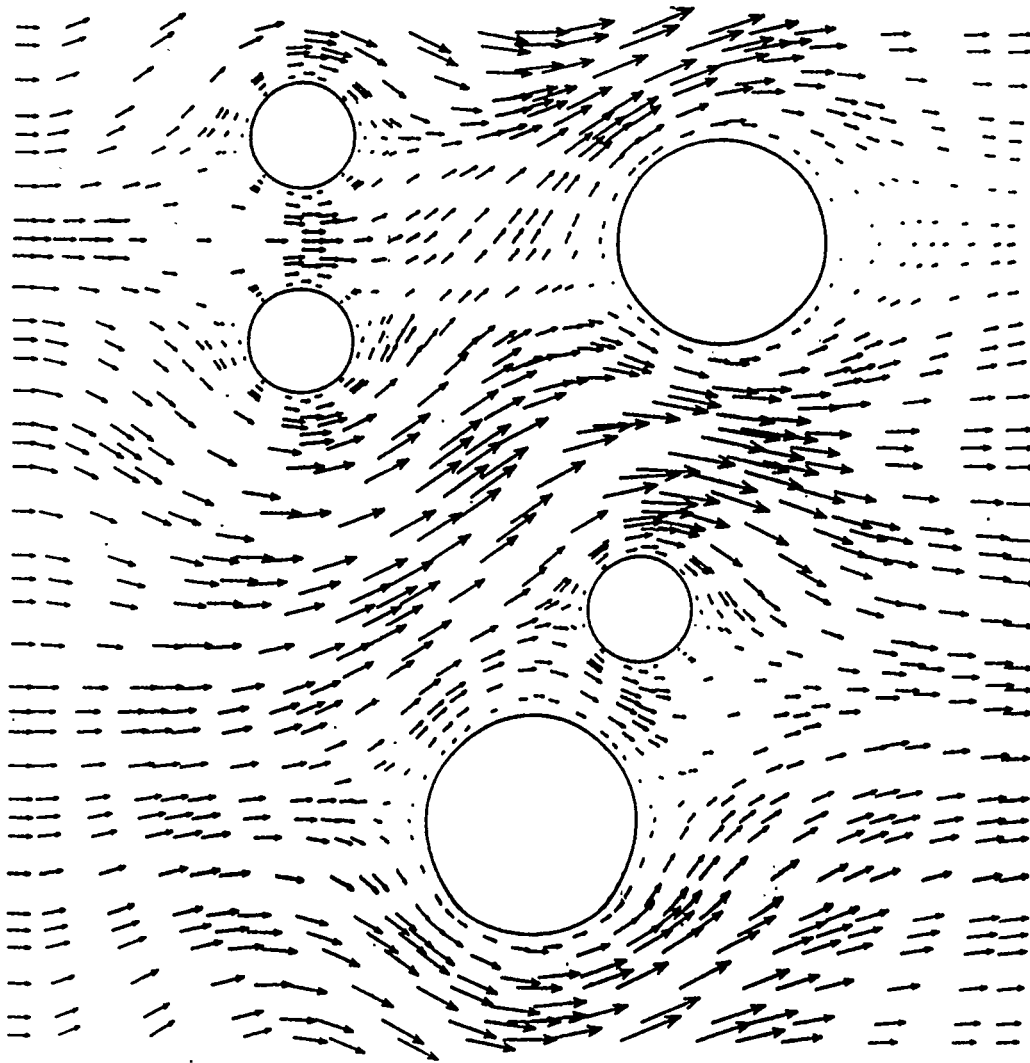


Figure 2 Air velocity vector field through 2-D fiber matrix at 20 cm/s initial velocity. The fiber matrix is $20\mu\text{m} \times 20\mu\text{m}$ with $2\mu\text{m}$ and $4\mu\text{m}$ diameter fibers. The fiber volume fraction is 0.0864 .

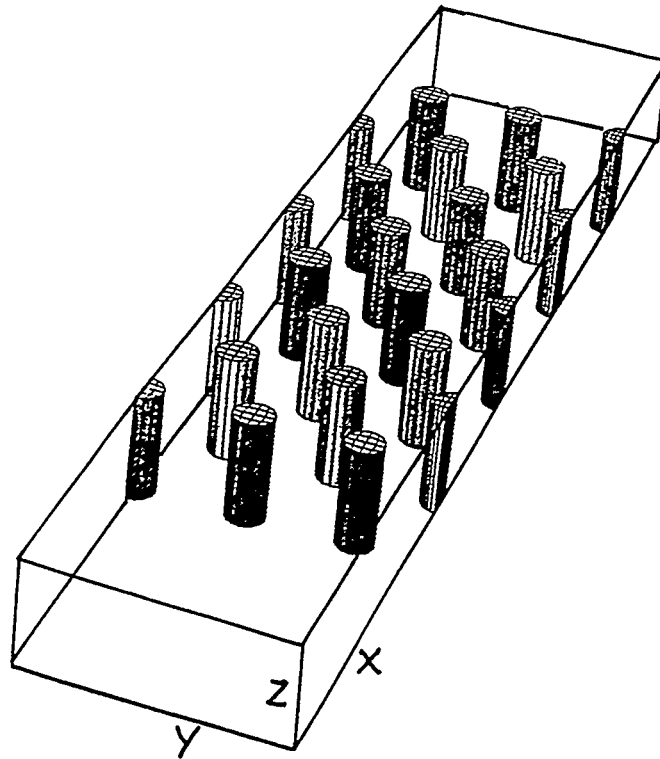


Figure 3 3-D fiber matrix with $1\mu\text{m}$ diameter fibers arranged in a staggered hexagonal array. The fiber matrix $L \times W \times H$ is $23.0\mu\text{m} \times 6.5\mu\text{m} \times 5.0\mu\text{m}$. The fiber volume fraction is 0.0825, and air flow is in X direction.

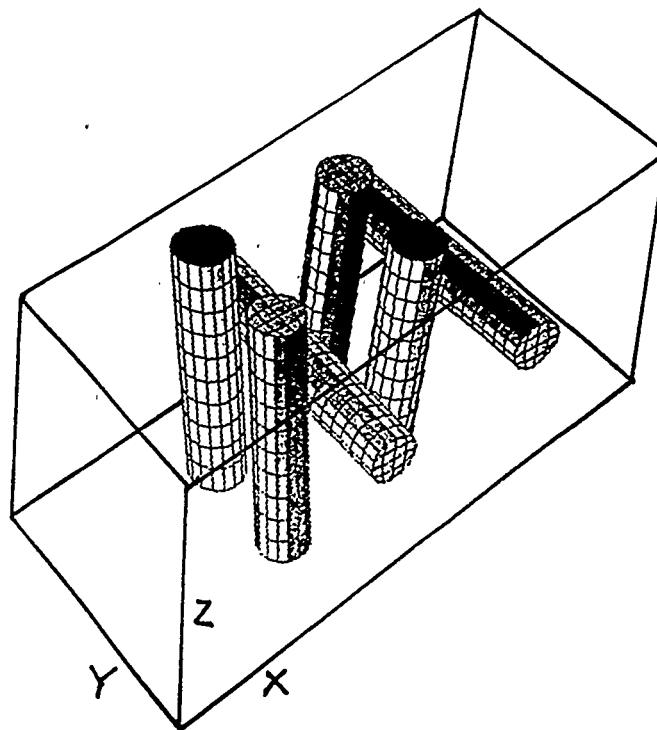


Figure 4 3-D fiber matrix with $1\mu\text{m}$ fibers arranged in a crossed fiber array. The fiber matrix $L \times W \times H$ is $11\mu\text{m} \times 5\mu\text{m} \times 5\mu\text{m}$. The fiber volume fraction is 0.0843 and air flow is in X direction.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The particle capture in the fiber matrix is then computed by superimposing the particle equation of motion over the flow velocity field. The resulting particle dynamics is given by:

$$\frac{d\mathbf{v}}{dt} = B(\mathbf{u} - \mathbf{v}) + \mathbf{A}(t) \quad (1)$$

where,

$$\begin{aligned} \mathbf{v} &= \text{particle velocity vector} \\ \mathbf{u} &= \text{fluid velocity vector} \\ B &= \text{friction coefficient} \\ \mathbf{A}(t) &= \text{random Brownian acceleration, time dependent} \\ t &= \text{time} \end{aligned}$$

The friction coefficient B is defined as

$$B = \frac{6\pi \mu a_p}{C_s m} \quad (2)$$



where,

$$\begin{aligned} \mu &= \text{fluid viscosity} \\ a_p &= \text{particle radius} \\ m &= \text{particle mass} \\ C_s &= \text{Cunningham slip correction factor} \end{aligned}$$

The solution of Equation 1, called the Langevin equation, can be obtained assuming a constant fluid velocity and a constant value of B .

Ramarao et al have solved Equation 1 using the method proposed by Chandrasekhar for two-dimensional particle trajectories.^(4,5) We have extended this method to three dimensions in the present study. The principle of superimposing particle motion over the flow field is illustrated in Figure 5, where the net particle motion is the sum of a deterministic term and a probabilistic term.

Figure 6 shows the results of three, two-dimensional particle trajectories computed for the flow field in Figure 2 using Equation 1. Figure 7 shows the results of three, three-dimensional trajectories computed for the crossed fiber matrix. The inlet air velocity in both figures is 20 cm/s. The particle size in each of the three trajectory calculations was chosen to represent what is generally treated as three separate particle capture mechanisms: Brownian motion, interception and inertia. This artificial separation is not required for the general approach in Equation 1. Particle capture by the filter fiber only occurs if the particle trajectory contacts the fiber surface. Once particle contact is made, we assume the particle is captured and held tight. This assumption is valid for particles smaller than 5 μm at lower air flows.

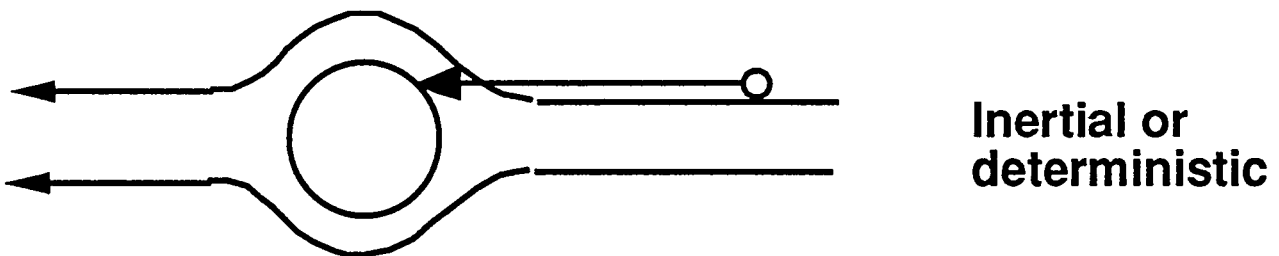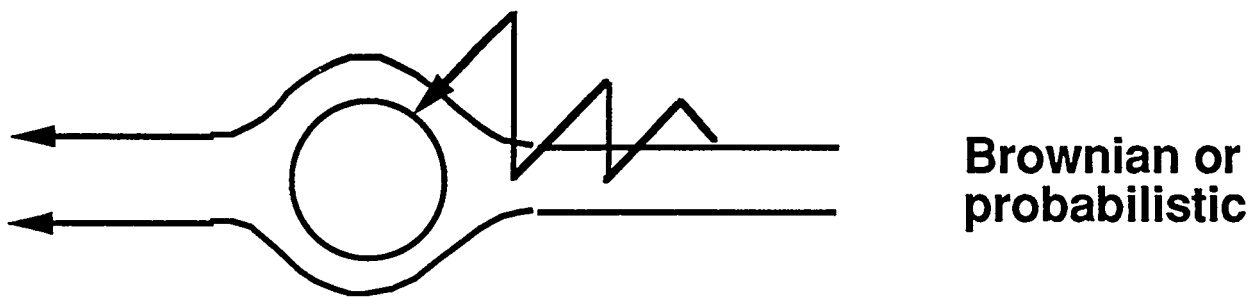

$$\underbrace{\frac{d\vec{u}}{dt}}_{\text{particle motion}} = \underbrace{B(\vec{v}-\vec{u})}_{\text{deterministic}} + \underbrace{\vec{A}(t)}_{\text{probabilistic}} \quad \text{Langevin eq.}$$

Figure 5. Particle motion is determined by the superposition of the Brownian (probabilistic) motion and the inertial (deterministic) motion over the flow field.

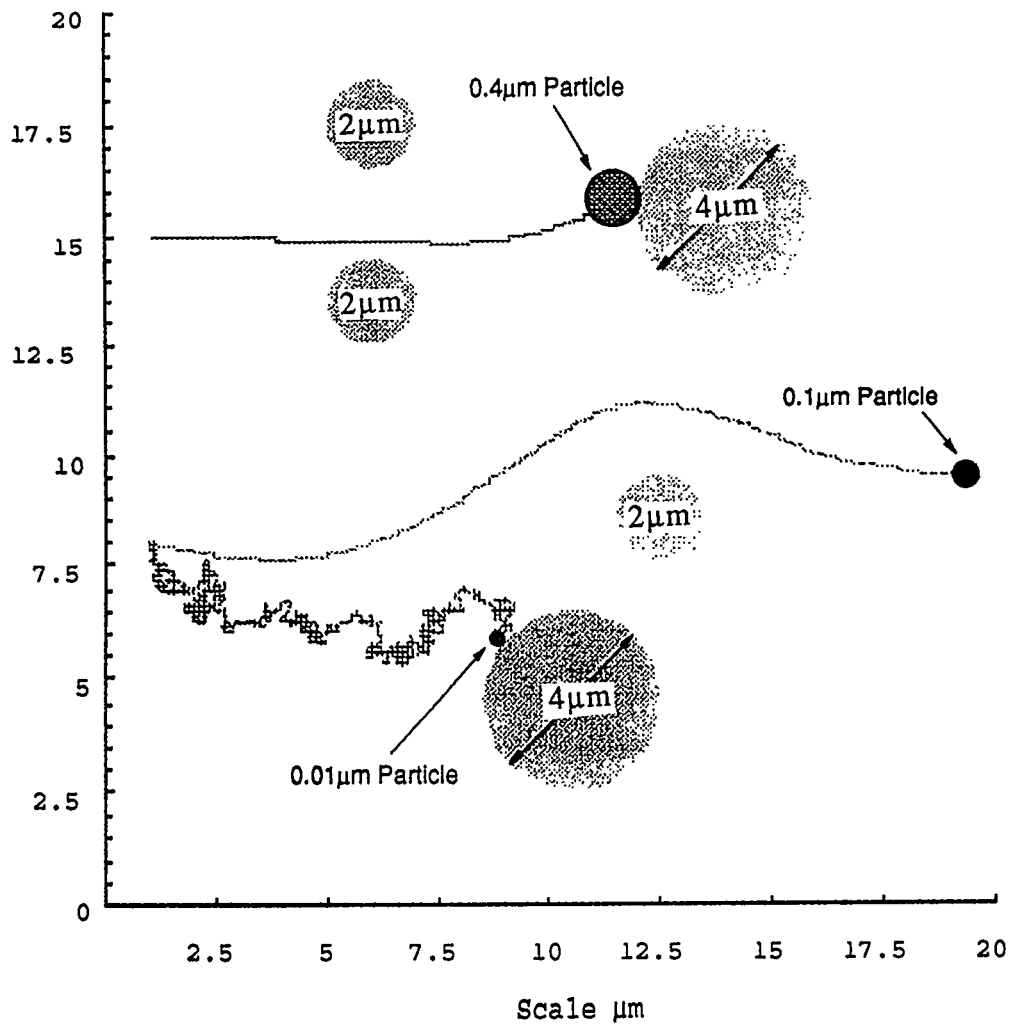


Figure 6 Trajectories of three different diameter particles through the fiber matrix in Figure 2. Particle diameters were selected to illustrate conventional mechanical collection mechanisms: $0.01\mu\text{m}$ for Brownian motion, $0.1\mu\text{m}$ for interception, and $0.4\mu\text{m}$ for inertia.

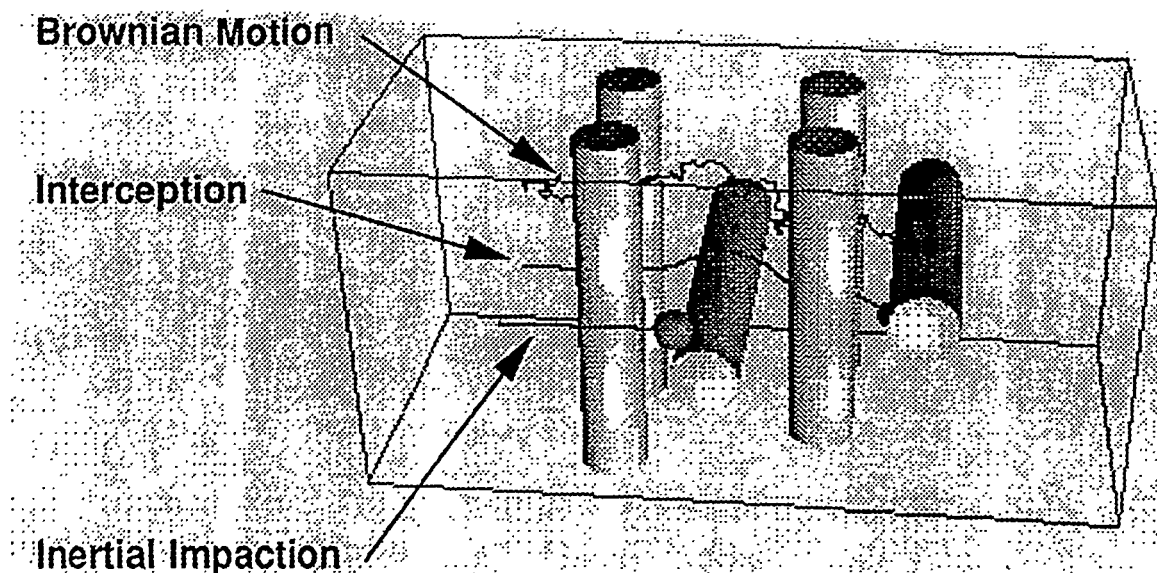


Figure 7 Trajectories of three different diameter particles through the fiber matrix shown in Figure 4 with the inlet air velocity at 20 cm/s. The diameter of the particles were selected to illustrate the conventional collection mechanisms due to Brownian motion, interception and inertial impaction. Note that the particle sizes are not to scale to allow visualization.

To determine the particle capture efficiency of a given fiber matrix for comparison with experimental measurements, it is necessary to compute thousands of trajectories for each particle size. For each trajectory calculation, the initial starting location is determined by a random number generation in the Y-Z plane. Figure 8 shows the cumulative efficiency of $0.3 \mu\text{m}$ diameter particles (density 1 g/cm^3) passing through the crossed fiber matrix as illustrated in Figure 7 with an inlet air velocity of 20 cm/s. Performing similar calculations at other particle sizes allows us to plot the efficiency versus particle size.

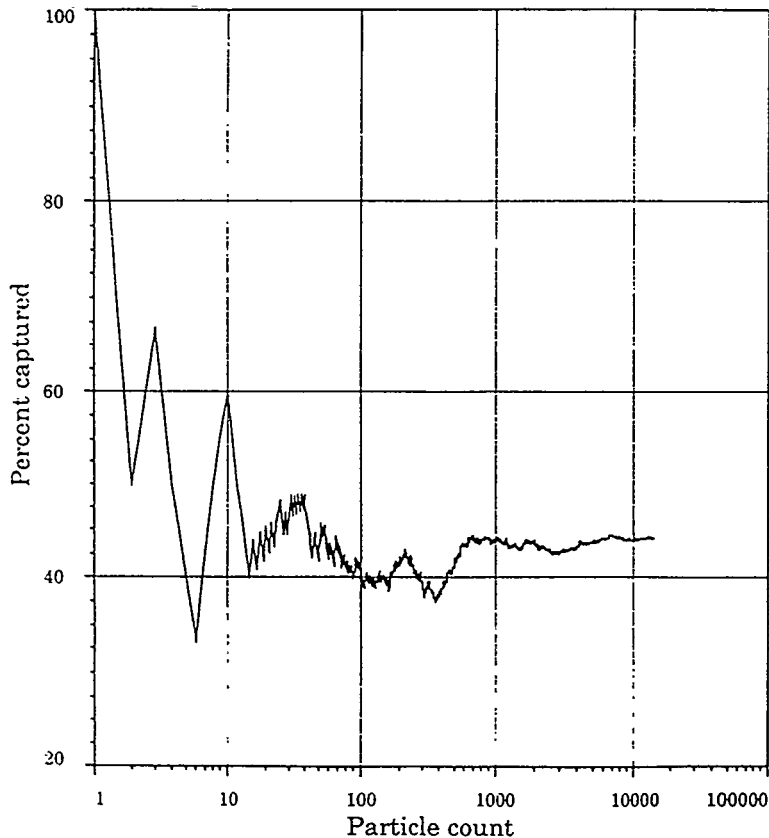


Figure 8 Cumulative efficiency of increasing number of $0.3\mu\text{m}$ diameter particles (density 1 g/cm^3) passing through the crossed fiber matrix in Figure 4 with a uniform inlet air velocity of 20 cm/s .

III. Sample Computations of Filter Efficiencies

The computation of the filter efficiency for a given fiber configuration and a given air flow requires three sequential steps: (1) compute the fluid flow field using CFD calculations, (2) compute the particle trajectory using Equation 1, and (3) compute the trajectories of many particles at random positions at the filter inlet to obtain an average efficiency. These calculations will yield the efficiency at a given particle size. For filter efficiency as a function of particle size, steps 2 and 3 must be repeated for each particle size. For efficiency at different air flows, all three steps must be computed.

Figure 9 shows the results of the efficiency calculations for the crossed fiber array at 20 cm/s . Figure 10 shows the efficiency of the same crossed fiber array at 2 cm/s . Note that the capture efficiency for the larger particles increases while the efficiency for the smaller particles decreases as the air velocity is increased. Figure 11 shows the particle capture efficiency for the staggered hexagonal array at 3 cm/s .

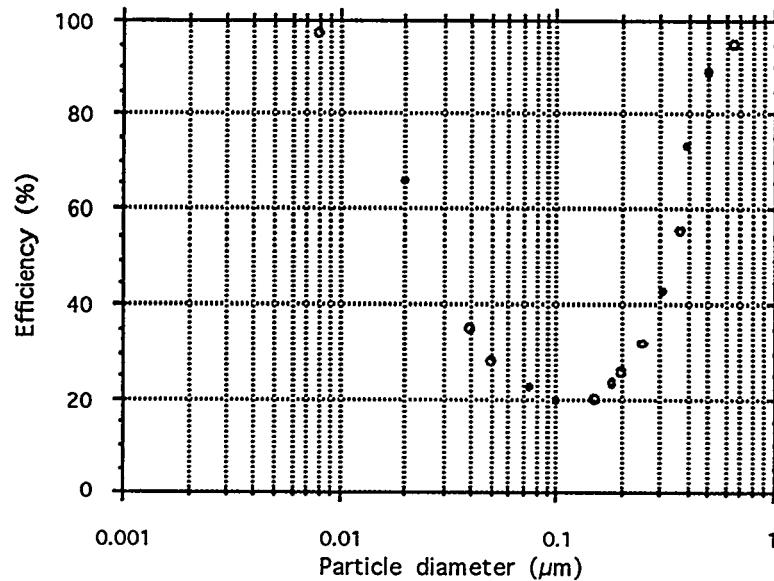


Figure 9 Filter efficiency computed for different particle diameters (density 1 g/cm³) passing through the crossed fiber matrix in Figure 4 with uniform inlet air velocity of 20 cm/s. The pressure drop across the fiber matrix element is 4.4×10^{-5} inches of water.

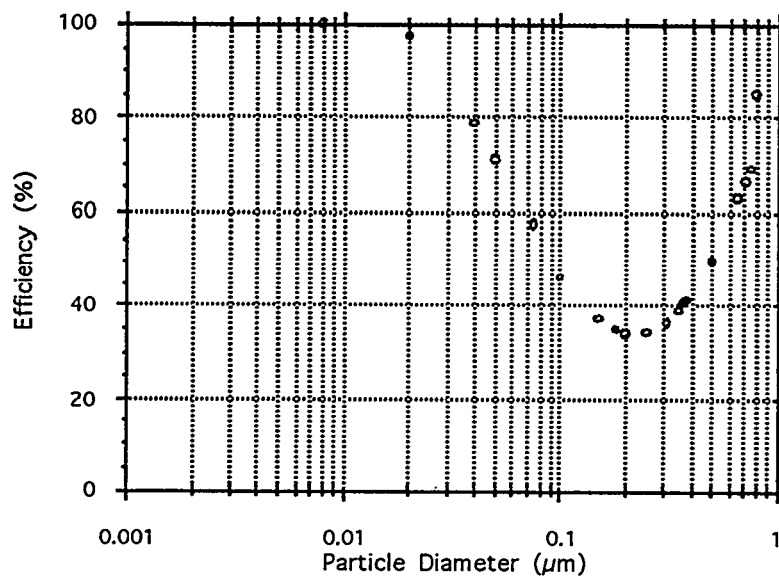


Figure 10 Filter efficiency computed for different particle diameters (density 1 g/cm³) through the crossed fiber matrix in Figure 4 with a uniform inlet air velocity of 20 cm/s. The pressure drop across the fiber matrix element is 4.4×10^{-6} inches of water.

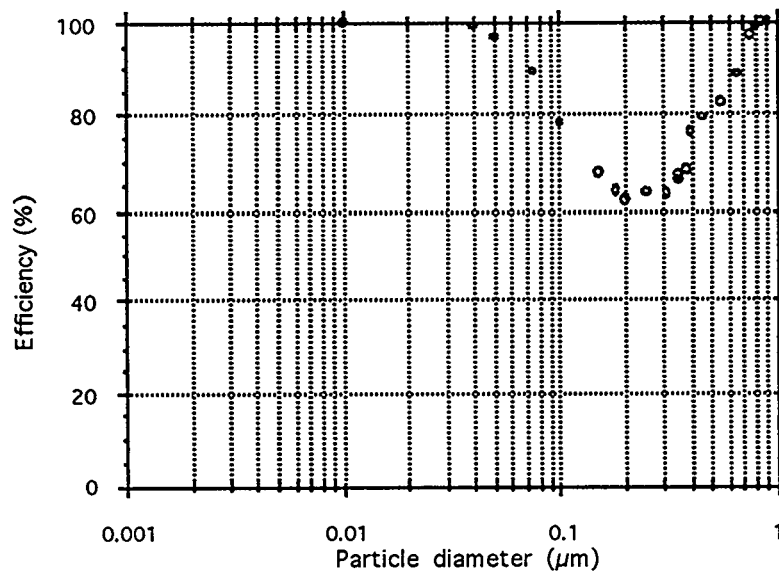


Figure 11 Filter efficiency computed for different particle diameters (density 1 g/cm^3) through the staggered hexagonal array in Figure 3 with a uniform inlet air velocity of 3 cm/s . The pressure drop across the fiber matrix element is 3.2×10^{-5} inches of water.

Although it is feasible to compute the particle capture efficiency and pressure drop across simple fiber matrices as shown in this report, we are a long way from computing the efficiency and pressure drop for commercially available filters. The primary limitation here is an efficient method for computing the fluid flow through the more complicated fiber matrix in real filters.

IV. References

1. Tien, C, Granular filtration of aerosols and hydrosols, Butterworths, Boston, (1989).
2. Brown, Air filtration; an integrated approach to the theory and applications of fibrous filters, Pergamon Press, New York,(1993).
3. Liu, ZG and Wang, PK, "Numerical investigation of viscous flow fields around multifiber filters" J. Aerosol Science and Technology, Vol 25, No. 4, pp 375-391, (1996)
4. Ramarao, BV, Tien, C, and Mohan, S "Calculation of single fiber efficiencies for interception and impaction with superimposed Brownian motion" J. Aerosol Sci., Vol 25, No. 2, pp 295-313, (1994).
5. Chandrasekhar, Rev. Modern Phys. Vol. 15, p 1 (1943).

DISCUSSION

WEBER: I think that the work that Werner is doing is a real service to the industry and I hope that he will be able to carry out his plan to bring it to full fruition. I have a couple of questions for the author. Do you have a way of measuring the fiber diameters in a large assembly?

BERGMAN: We determine fiber diameters from electron micrographs followed by computer scanning and generate histograms of the number of fibers versus size. For three dimensional analysis, we solidify the filter element with an epoxy, take slices of the element at increasing depths and then take SEM photos. For quicker, less expensive analysis, we simply took SEM pictures of the media surface.

WEBER: I noticed that the fiber diameters you cited were greater than $1\mu\text{m}$ yet we know that the glass fibers optimally used are less than that in many cases. Was there a particular reason for the choice of diameter in your calculations?

BERGMAN: Yes. Below $1\mu\text{m}$ you have non-continuum fluid dynamics that is often called "slip" flow. All of the conventional fluid dynamics codes are based on a continuum fluids. To address the slip flow, we first compute the flow using continuum mechanics and then close to the fiber, we introduce an empirical term. This approach is not rigorously correct, but it yields better results than ignoring slip. Using a noncontinuous fluid dynamics package in filtration modeling would greatly exceed the capacity of the largest computer.

WEBER: Finally, I am wondering how long through the useful life of a filter it would be until cake build-up or the presence of previously deposited particles would affect the result, or would start to dominate the result?

BERGMAN: We did not do these computations. From the pictures of particle trajectories, you can see that it is possible to model filter clogging. Let me illustrate how this can be done. For the initial particle capture and deposits, we assume the general fluid dynamics flow is not affected by the deposits. However, once the deposits become sizable, you have to recompute the fluid field with the altered filter geometry. Particle trajectories are then computed for the new fluid velocity field and a new increment of deposits formed. The cycle of forming particle deposits and computing new flow fields is repeated many times. Considering that it may take 20-40 hours of computer processing on a silicon graphics workstation to compute the flow field in a 100 fiber filter element, we are a long way from realistic filter clogging simulations.

KOVACH, B: The work you did is great but did you consider the influence of a vibrating fiber due to high velocity airflow? Would it increase or decrease the efficiency? Is your video movie available for use by others?

BERGMAN: As soon the work is finished we will make copies available. With regard to vibrating fibers, I am not aware of any studies. However, if you look at the period of vibration, I suspect the period would be much longer than the effective residence time of a particle in the vicinity of a fiber. I have a difficult time imagining a fiber vibrating at a speed that is comparable to the particle velocity, but then I've been surprised more times than not.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

THOMAS: Previously, I tried to use equations by Drs. Liu and Rubo to determine filter efficiency, but I ran into a problem trying to determine their parameter for collector diameter. I used an average fiber diameter, but I was wondering if you have determined any kind of average filter fiber diameter based on information from people that make filter papers?

BERGMAN: Although we can determine fiber size distribution precisely, the problem is that the paper is very heterogeneous. The fiber diameter distribution and fiber volume fraction can vary greatly depending on where the measurements are taken in the filter paper. The common practice is to use an "inhomogeneity factor" and an average fiber diameter derived from SEM pictures in a specific filter equation for pressure drop. The inhomogeneity factor is used to force agreement between the equation and experiment. Since all of the pressure drop theories (Karmen-Kozeny, Kuwabara, etc.) have pressure drop varying inversely proportional to fiber diameter squared, the most common average is the weighted average of diameter squared. The weighting factor generally is a function of the site distribution and the distribution of fiber volume fraction throughout the filter. A more practical approach is to use an "effective" diameter which is the diameter determined from the pressure drop equation with experimental pressure drop data.

DYMENT: Does the speaker consider an attempt should be made to include electrostatic forces? Can the techniques described be used to produce designs of filter media having extended dust capacity?

BERGMAN: We have added electrostatic forces in the computer models but have not run many cases. I should add that any number of additional capture mechanisms can be easily added to the code because once you have established the flow field and the mechanical trajectory, it is a minor step to add additional capture mechanisms. The current stage of computer simulation can be used to investigate extended life, but it is not practical because of the excessive time required to compute. The problem is that each time the morphology of the particle deposits changes it perturbs the air flow and therefore requires a new flow field computation. An entire series of flow computations would be required for each filter media structure. This would require an enormous amount of computation and is not practical at the present time.

DYMENT: I have been fascinated by your demonstration, I think it is a major step forward. Filtration is an extremely complex process. Do you imagine we use the filters that electrical effects are significant because you are studying what we call mechanical effects. Do you think that electrical effects can be important in real filters? That is my first question. My second question concerns the graded papers we were talking about at the last conference which have a somewhat higher dust holding capacity. Do you anticipate that you can use these techniques to give us target designs for filters which will hold larger quantities of particles before their resistance rises to the point at which we have to change them?

BERGMAN: If conditions are favorable for electrical effects, then they will be very important in filtration. Conditions that favor electrical effects are dry air, charged particles, and high filter electrical resistance. Thus I would expect electrical effects would enhance the performance of real filters in dry air powder handling or processing operations. Applications involving aqueous oil mists or ambient aerosols would have little electrical effects. The computer simulations can be used to answer performance and design questions, but only for very simple systems at the present time. Even the simple filtration problems illustrated in this paper require 3-4 days of work. Setting up the basic filter structure represents currently about 10% of the effort. Fluid dynamics represents 80% of the full

effort. The particle trajectories represent 9% and the remaining 1% is the electrostatics. The purpose of this presentation is to begin the process of developing a CAD/CAM system where engineers can sit at their computers and calculate the filter efficiency for graded efficiency filters, unusual structures, filter clogging, whatever it is you want. Major advances in both computer software and hardware will be required this goal.

**STUDY ON COLLECTION EFFICIENCY OF FISSION PRODUCTS
BY SPRAY : EXPERIMENTAL DEVICE AND MODELLING**

D. DUCRET*, Y. BILLARAND, D. ROBLOT*, J. VENDEL***

* Institut de Protection et de Sûreté Nucléaire
Département de Prévention et d'Etude des Accidents
DPEA/SERAC - CEA/Saclay, Bâtiment 383 - 91191 GIF-SUR-YVETTE Cedex, France

** ECCO Pharmacie et Chimie
5, Bd de Courbevoie - 92523 NEUILLY Cedex, France

ABSTRACT

Consequences of an hypothetical overheating reactor accident in nuclear power plants can be limited by spraying cold water drops into containment building. The spray reduces the pressure and the temperature levels by condensation of steam and leads to the washout of fission products (aerosols and gaseous iodine). The present study includes a large program devoted to the evaluation of realistic washout rates.

An experimental device (named CARAIDAS) was designed and built in order to determine the collection efficiency of aerosols and iodine absorption by drops with representative conditions of post-accident atmosphere. This experimental device is presented in the paper and more particularly :

- the experimental enclosure in which representative thermodynamic conditions can be achieved,
- the monosized drops generator, the drops diameter measurement and the drops collector,
- the cesium iodide aerosols generator and the aerosols measurements

Modelling of steam condensation on drops, aerosols collection and iodine absorption are described. First experimental and code results on drops and aerosols behaviour are compared.

NOMENCLATURE :

C	: concentration	(mol.m ⁻³)
C _p	: calorific capacity	(J.kg ⁻¹ .K ⁻¹)
C _{th}	: heat accomodation coefficient	(-)
C _u	: Cunningham correction coefficient	(-)
d	: diameter	(m)
Dif	: diffusion coefficient	(m.s ⁻¹)
dm	: drop mass increase	(kg)
E	: collection efficiency	(-)
h	: heat transfer coefficient	(W.m ⁻² .K ⁻¹)
H _v	: enthalpy of water vaporization	(J.mol ⁻¹)
k	: mass transfer coefficient	(m.s ⁻²)
L	: free path of gaseous molecules	(m)
m	: mass	(kg)
M	: molar mass	(kg.mol ⁻¹)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

N	: mass flux density	(mol.m ⁻² .s ⁻¹)
P	: pressure	(Pa)
Psat	: saturation vapor pressure	(Pa)
q	: heat flux density	(W.m ⁻²)
T	: temperature	(K)
v	: drop velocity	(m.s ⁻¹)
λ	: thermal conductivity	(W.m ⁻¹ .K ⁻¹)
ρ	: density	(kg.m ⁻³)
μ	: dynamic viscosity	(Pa.s)

Dimensionless numbers :

Knusend number :	$Kn = \frac{2L}{d_p}$	(-)
Nusselt number :	$Nu = \frac{h \cdot d_d}{\lambda}$	(-)
Prandtl number :	$Pr = \frac{C_p \cdot \mu}{\lambda}$	(-)
Reynolds number :	$Re = \frac{\rho_g \cdot v \cdot d_d}{\mu_g}$	(-)
Schmidt number :	$Sc = \frac{\mu}{\rho \cdot Dif}$	(-)
Sherwood number :	$Sh = \frac{k \cdot d_d}{Dif}$	(-)
Stokes number :	$Stk = \frac{d_p^2 \cdot \rho_p \cdot v}{9 \cdot \mu_g \cdot d_d}$	(-)

Subscripts :

d	: drop
g	: gaseous
i	: gas-drop interface
I	: iodine
p	: particle
pot	: potential
vis	: viscous
w	: water
diffu	: brownian diffusion
difph	: diffusiophoresis
imp	: impaction
int	: interception
therph	: thermophoresis
tot	: total

I. INTRODUCTION

Consequences of an hypothetical overheating reactor accident in a nuclear power plant can be limited by spraying cold water drops into the containment building. The spray reduces the pressure and the temperature levels inside the containment building by steam condensation on drops. With this thermalhydraulic function, spray leads to the washout of fission products (aerosols and iodine) emitted in the reactor building atmosphere. Today, this spray system is taken into account in different safety codes, using washout rates which have been determined during global experiments. These washout rates provide conservative assumptions. This present study integrates into a large program devoted to the evaluation of more realistic washout rates. First, we develop an experimental device and a modelling in order to determine aerosols collection efficiencies and iodine absorption in severe accident representative conditions.

II. EXPERIMENTAL DEVICE

In order to comply with experimental device design requirements⁽¹⁾, different devices have been developed, tested and set up on CARAIDAS (figure 1) :

- experimental enclosure in which representative thermodynamic conditions could be achieved,
- the monosized drops generator, the drops diameter measurements and the drops collector,
- the cesium iodide aerosols generator, concentration and size distribution measurements.

II.1. Experimental enclosure

Experimental enclosure is a five meters high cylinder with an inner diameter of 0.6 meter. The vessel is heated up by circulating a thermofluid through the double-wall unit. This system is split into three sections to ensure uniform temperatures overall the vessel height. The vessel has 8 windows (100 mm diameter) and several penetrations (50 mm diameter) for instrumentation purposes.

The thermofluid circuit comprises :

- a pump with a flow rate of 12 m³/h,
- an electric heater (40 kW) using a PID regulation can heat up the thermofluid at a maximum of 160°C. The temperature in the main pipe is monitored by two sensors (Pt100, class A),
- the thermofluid repartition into the three sections is ensured by one valve and one flow meter for each section.

Homogeneous thermodynamic working conditions are obtained by using an air-steam circulation with:

- a varying flow rate fan (0 to 50 m³/h),
- an electric heater (5 kW), using a PID regulation, can heat up air-steam mixture with a temperature range between 20 to 160°C ; the temperature is monitored by two Pt100 sensors (class A),
- an absolute pressure PID regulation in the range of 1 to 8 bars is carried out by using two valves (one for pressurized air alimentation and one for release),

The steam saturation rate in the vessel is also controlled by a PID regulator. Steam is produced by an electric generator and injected using a valve controlled by the regulator. Steam saturation rate range is between a few per cent and 95 %. Highest saturation limit is 95 % to avoid condensation particularly on windows.

This air-steam circulation ensures a good mixture in the vessel. When nominal working conditions (P, T, S) are reached, air-steam circulation is stopped and then the vessel is isolated by two valves. Several sensors are installed on the vessel to check air-steam mixture homogeneity :

- five gas temperature sensors (Pt100, class A),
- three inner vessel wall sensors (Pt100, class A),

- one pressure transducer (0-10 bars),
 - three steam saturation ratio measurements by dew point measurement,
 - one steam partial pressure measurement by sampling some gas and condensation by cooling.
- All of these experimental data are displayed and saved by using a PC supervisor.

II.2. Drops devices

Drops generator is above the experimental enclosure because this device must be at ambient temperature and this, whatever enclosure temperature. In order to produce monosized drops, the generator (figure 2) is based on a break-up process of a jet into drops by applying a periodic disturbance. This principle of generation induces a one drop diameter spacing. This small drops spacing is not large enough to avoid drops coalescence, so an electrostatic sorting out drops is set up. A stream of uniformly charged drops is shaped by applying a potential difference between a ring electrode and the feeding tube. When a negative impulsion is applied to the ring electrode, an uncharged drop is produced. The deflection plates placed downstream, which are under electrical potential difference, create an electric field. Charged drops passing through this electrical field are deflected and collected. Uncharged drops are not deflected and they are injected in the experimental enclosure. The rate of injection of uncharged drops is variable from 1 to 1/1000. This device is able to produce monosized water drops with a diameter between 100 and 500 μm . Drops injection temperature is measured by a Pt100 sensor on the feeding tube. Drops injection temperature can be set between 20°C to 80°C by a small electric heater.

After injection in the vessel, drops diameter is modified by steam condensation or evaporation as function of thermodynamic conditions. So, three drops diameter measurements are forecast for three falling drops heights: $z=0$, $z=2.51$ and $z=4.39$ meters. These measurements are based on drops shadows axial transmittance. A stroboscopic incoherent light source is placed in front of linear camera (CCD). When a drop comes in front of the CCD camera, analogic signals from photodiodes are obtained and then numerized. Numerical drop shadow is processing in order to calculate the real drop diameter.

At the end of the fall, drops must be collected to measure aerosols mass in drops, so a drops collector ensures three functions :

- drops collection,
- dynamic containment of drops collection surface,
- sample output.

Drops are collected on fiberglass filters, 80 mm diameter, 1.55 mm thickness and temperature proof under 200°C. These filters can soak up water drops volume (a few milliliters). The collected aerosols mass by drops during fall is dissolved in 10 ml of distilled water and measured by fluorimetric method. Aerosols sedimentation on collection surface is avoided by a dynamic containment : clean air is blown through collection filter and get back by a circular aspiration on the top of the dynamic containment device not to modify aerosols concentration in the experimental vessel. Extraction of several samples during test is been able by a pressure thruster which shifts drops collector from experimental vessel to the SAS where it can be brought out and put a new drops collector in place.

II.3. Aerosols devices

Aerosols generation is based on mechanical spraying by rotative disk, of cesium iodide solution tagged by soda fluorescein. Rotational device is an air turbine because high rotation speed is needful

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

(3000 rounds per second). Rotation speed is set by air pressure inlet the turbine and monitored by an electromagnetic indicator. Spraying disk (8 mm diameter) is fed up with cesium iodide solution with steady state flow rate. Sprayed droplets diameter which is function of rotation speed and solution flow rate, is about 20 μm . After evaporation, dry aerosols diameter is function of cesium iodide concentration :

$$d_p = d_{\text{droplet}} \left(\frac{[\text{ICs}]_{\text{solution}}}{\rho_{\text{ICs}}} \right)^{1/3} \quad \text{eq.1}$$

With this specific generator, it is possible to produce aerosols with temperature (20-160°C) and pressure (1-7 bars). Aerosols diameter range is between 0.5 and 5 μm with a geometric standard deviation lower than 1.7 and aerosols mass flow rate is roughly 0.1 g/h.

Four aerosols samples are set up on experimental enclosure to check homogeneity of concentration and particles size distribution. Aerosols concentrations are measured on fiberglass filters of 25 mm diameter. Each sample is going on one or two minutes with a 1 l/min flow rate. The filtered aerosols mass is measured by fluorimetric method.

Particles size distribution measurements are given by inertial impactor in vessel pressure and temperature conditions. Aerosols are discriminated among eight size ranges corresponding to aerodynamic diameters from 0.35 to 7.5 μm . Data processing is performed by a classical log-probability graph. This method gives aerosols mass median diameter and geometric standard deviation.

This experimental device allows to measure experimental drops diameter evolution and collected aerosols mass by drops as function of different experimental conditions representative of severe accident scenarios. At the same time we develop a modelling of this experimental device.

III. Modelling

Drops characteristics (temperature, size, iodine and particles concentration) are modified during the fall. Three phenomena of transfer between the gas and the monosized drops are to be modelled :

- heat and steam transfer,
- gaseous iodine transfer,
- particles collection.

Steam condensation, iodine absorption and particles collection are coupled together because some of collection mechanisms depend on steam condensation flow rate.

The basic assumption of these following models is that water drops are supposed independant.

III.1. Steam and heat transfer

Steam and heat transfer from the gaseous phase to the liquid one is modelled by the double film theory (figure 3). Steam mass transfer is located in the gaseous film and heat transfer takes place through the whole double film. Beyond this double film, temperatures and concentrations are supposed steady.

The steam flow rate is the following one : $N_w = k_{g,w} \times \left(\frac{P_w}{RT_g} - \frac{P_{\text{sat}}(T_i)}{RT_i} \right)$ eq.2

where $k_{g,w}$ is the ratio between the diffusion coefficient of steam in air and the thickness of the gaseous film. This transfer coefficient is computed thanks to a correlation given by BEARD and PRUPPACHER⁽²⁾: $Sh_{g,w} = 1.61 + 0.718 \times Re_d^{1/2} \times Sc_{g,w}^{1/3}$

The heat flow rate through the gaseous film is :

$$q = \underbrace{h_g \times (T_g - T_i)}_{\text{convective exchanges}} + \underbrace{N_w \times H_v}_{\text{condensation contribution}}$$

h_g is also computed by a correlation (BEARD and PRUPPACHER⁽²⁾) :

$$Nu_{g,w} = 2 + 0.69 \times Re_d^{1/2} \times Pr_g^{1/3}$$

This flow rate q is equal to the one of the drop side : $q = h_d \times (T_i - T_d)$

h_d is computed by HENDOU's correlations⁽³⁾.

Finally:
$$\underbrace{h_g \times (T_g - T_i)}_{\text{convective exchanges}} + \underbrace{N_w \times H_v}_{\text{condensation contribution}} = h_d \times (T_i - T_d) \quad \text{eq.3}$$

So coupling equation eq.2 and equation eq.3, T_i and N_w are determined by a numerical method (Newton-Raphson). The knowledge of the steam flow rate and of the convective exchanges value allows to compute the drops growth during a lapse of time called dt :

$$d_d(t+dt) = \left(d_d^3(t) + \frac{6 \times d_d^2(t) \times dt \times N_w \times H_v}{\rho_d} \right)^{1/3}$$

Then drop heating is computed using the heat balance on the drop between t and $t+dt$:

$$m \times Cp_d \times dT_d = h_g \times (T_g - T_i) \times \pi \times d_d^2 \times dt + dm \times H_v$$

$$\text{with: } dm = \frac{\pi \times d_d^2 \times dt \times N_w \times H_v}{\rho_d}$$

So :
$$T_d(t+dt) = T_d(t) + \frac{h_g \times (T_g - T_i) \times \pi \times d_d^2 \times dt + dm \times H_v}{m \times Cp_d}$$

III.2. Iodine transfer

The energetic iodine flow rate contribution is disregarded. Iodine transfer from the gaseous phase to the liquid one is firstable controlled by diffusion through the gaseous film, since by the thermodynamic equilibrium between the both phases which depends on the temperature at the interface, and at least by chemical reactions which take place into the drops.



At low steam flow rates, iodine transfer through the gaseous film is estimated as :

$$N_I = k_{g,I} \times (C_{g,I} - C_{g_i,I})$$

This flow is equal to the one through the liquid film : $N_I = k_{d,I} \times (C_{d_i,I} - C_{d,I})$

Finally :
$$k_{g,I} \times (C_{g,I} - C_{g_i,I}) = k_{d,I} \times (C_{d_i,I} - C_{d,I}) \quad \text{eq.4}$$

The unknown values are C_{gi} and C_{di} . They are linked by the thermodynamic equilibrium at the interface and by chemical reactions. Hydrolysis of molecular iodine and HOI dissociation are only considered. The other reactions are slow regarding to the fall time of drops (few seconds in CARAIDAS).



The concentration in protons is supposed to be a constant value. The reaction equilibrium constants are given by GAUVAIN and FILIPPI⁽⁴⁾.

Equations eq.5 and eq.6 allow to express $C_{di, I}$ (which is : $[HOI] + [OI^-] + [I^-] + [I_{2, liq}]$) as a function of $C_{gi, I}$:

$$C_{di, I} = K_i \times C_{gi, I} + 2 \times \frac{\sqrt{K_1 \times (K_2 + [H^+])} \times K_i \times C_{gi, I} \times 1000}{[H^+]}$$

This expression is used in the place of C_{di} in equation eq.4. Solving equation eq.4 provides C_{di} and so N_I . At least, the updated concentration in iodine into the drop is computed :

$$C_{d, I}(t + dt) = C_{d, I}(t) + \frac{\pi \times d_d^2(t) \times dt \times N_I}{\left(\frac{\pi \times d_d^3(t)}{6} \right)}$$

III.3. Particles collection

Aerosols collection models are completely different than those for iodine absorption. They are based on semi-empirical correlations to calculate collection efficiencies for different mechanisms. Collection efficiency is defined as the ratio of aerosol mass collected by a drop and the aerosols mass in swept out volume. Five mechanisms of particles collection are listed :

- impaction
- interception
- diffusiophoresis
- thermophoresis
- brownian diffusion

Mechanical effects

- *impaction* : drops fall induces fluid flow variations. High inertia particles turn off flow lines around the drop and then are collected on the drop. The efficiency of this mechanism increases with drop velocity and particle mass. POWERS and BURSON⁽⁵⁾ suggest :

$$E_{imp} = \frac{E_{vis,imp} + \frac{Re_d E_{pot,imp}}{60}}{1 + \frac{Re_d}{60}}$$

if $Stk \leq 0.0833$ then $E_{pot,imp} = 0$

if $0.0833 \leq Stk \leq 0.2$ then $E_{pot,imp} = 8.57 \left(\frac{Stk}{Stk + 0.5} \right)^2 (Stk - 0.0833)$

if $Stk \geq 0.2$ then $E_{pot,imp} = \left(\frac{Stk}{Stk + 0.5} \right)^2$

if $Stk \leq 1.214$ then $E_{vis,imp} = 0$

if $Stk \geq 1.214$ then $E_{vis,imp} = \left(1 + \frac{0.75 \ln(2 Stk)}{Stk - 1.214} \right)^{-2}$

- *interception*: this mechanism is only based on a geometric effect. If a particle on a flow line meet the drop, it is collected. POWERS and BURSON⁽⁵⁾ propose :

$$E_{int} = \frac{E_{vis,int} + \frac{Re_d E_{pot,int}}{60}}{1 + \frac{Re_d}{60}}$$

with $E_{vis,int} = \left(1 + \frac{d_p}{d_d} \right)^2 \left[1 - \frac{1.5}{1 + \frac{d_p}{d_d}} + 0.5 \left(1 + \frac{d_p}{d_d} \right)^3 \right]$

and $E_{pot,int} = 3 \frac{d_p}{d_d}$

Phoretic effects : the temperature gradient and the steam flow around drops respectively induce thermophoresis and diffusiophoresis.

- *diffusiophoresis* : steam condensation on cold water drops induces a steam flow towards drops. This flow drags along particles. WALDMANN and SCHMITT⁽⁶⁾ suggest a formula corrected by the ventilation coefficient of PRUPPACHER⁽⁷⁾:

$$E_{difph} = 4. f_v \frac{\sqrt{M_w}}{x_w \sqrt{M_w} + x_a \sqrt{M_a}} \frac{Dif_w}{V \times d_d} \ln \left(\frac{P - Psat(T_i)}{P - P_w} \right)$$

$$\text{if } Sc_{g,w}^{1/3} \cdot Re_d^{1/2} < 1.4 \text{ then} \quad f_v = 2 \cdot \left(1 + 0.108 \left(Sc_{g,w}^{1/3} Re_d^{1/2} \right)^2 \right)$$

$$\text{if } Sc_{g,w}^{1/3} \cdot Re_d^{1/2} \geq 1.4 \text{ then} \quad f_v = 2 \cdot \left(0.78 + 0.308 \left(Sc_{g,w}^{1/3} Re_d^{1/2} \right) \right)$$

- *thermophoresis* : it occurs when particles set in a temperature gradient. Impacts of gas on the warm side are more important than on the cold side of the particle. As a result, this difference creates a force which drags along particles towards cold drops.

$$E_{therph} = \frac{4 C_{th} \mu_g f_h (T_g - T_d)}{C_g T_g V \cdot d_d}$$

C_{th} is the dimensionless coefficient of TALBOT⁽⁸⁾ and f_h is the heat ventilation coefficient of PRUPPACHER⁽⁷⁾:

$$C_{th} = \frac{2 \times 1.147 \left(\frac{\lambda_g}{\lambda_p} + 2.2 Kn \right) Cu}{(1 + 3 \times 1.146 Kn) \times \left(1 + 2 \frac{\lambda_g}{\lambda_p} + 2 \times 2.2 Kn \right)}$$

$$\text{if } Pr_g^{1/3} \cdot Re_d^{1/2} < 1.4 \text{ then} \quad f_h = 2 \cdot \left(1 + 0.108 \left(Pr_g^{1/3} Re_d^{1/2} \right)^2 \right)$$

$$\text{if } Pr_g^{1/3} \cdot Re_d^{1/2} \geq 1.4 \text{ then} \quad f_h = 2 \cdot \left(0.78 + 0.308 \left(Pr_g^{1/3} Re_d^{1/2} \right) \right)$$

At least, we describe brownian diffusion collection by modelling efficiency as PRUPPACHER⁽⁷⁾ suggests :

$$\text{if } Re_d < 1 \text{ then} \quad E_{diffu} = \frac{4 \times Dif_p \times 2 \left(1 + 0.5 Re_d^{1/2} Sc_p^{1/3} \right)}{V \cdot d_d}$$

$$\text{if } Re_d \geq 1 \text{ then} \quad E_{diffu} = \frac{4 \times Dif_p \times 2 \left(1 + 0.3 Re_d^{1/2} Sc_p^{1/3} \right)}{V \cdot d_d}$$

The total efficiency is supposed to be the sum of the five elementary efficiencies :

$$E_{tot} = \sum_{i=1}^5 E_i(d_p)$$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The emitted particles are polydisperse. The efficiency is computed for each particle size class. So, for the whole distribution :

$$E = \sum_{d_p \text{ min}}^{d_p \text{ max}} E_{\text{tot}}(d_p) \times f(d_p) \times \log(\Delta d_p)$$

The collected particles mass during a lapse dt is :

$$M_p(dt) = \sum_{d_p \text{ min}}^{d_p \text{ max}} E_{\text{tot}}(d_p) \times f(d_p) \times \log(\Delta d_p) \times \frac{\pi d_d^2(t)}{4} \times v \times dt \times C_p$$

Finally, the mass collected during the drop fall is :

$$M_p = \sum_{t=0}^{t_{\text{fall}}} \left(\sum_{d_p \text{ min}}^{d_p \text{ max}} E(d_p) \times f(d_p) \times \log(\Delta d_p) \times \frac{\pi d_d^2(t)}{4} \times v \right) dt \times C_p$$

IV CODE RESULTS

From the modelling of the different phenomena involving in the washout of fission products by spraying water drops, the drops and particles behaviours in CARAIDAS are estimated.

IV.1. Drops behaviour

The different evolutions of drops diameter and drops temperature as function of falling height are plotted on the figures 4, 5 and 6. The thermodynamic conditions of gas are steady during the drop fall: 5 bars pressure, 140°C temperature and several steam saturation rates. The initial diameters are 100, 300, and 500 μm .

At the drop fall beginning, the steam flow rate and the heat flow rate induce growth and heating of drops. When the steam saturation rate is equal to 1, this condensation phenomenon occurs on a varying height (3, 20 and 60 centimeters) according to the initial diameter (100, 300 and 500 μm). When the steam saturation decreases, the condensation height also decreases. After, the diameter and temperature of the drops are steady if $S=1$. On the other hand, evaporation phenomenon appears if $S < 1$: there is an equilibrium between the heat flow brought to the drop by convective exchanges and the heat flow lost by the drop because of evaporation. Thus, drop temperature is steady but the diameter decreases. We consider that the drop completely disappears when its diameter is smaller than five micrometers.

All these computations show that thermodynamic equilibrium between the drops and the gaseous mixture is quickly reached when the steam saturation rate is equal to 1. On the other hand, when the gas is not saturated ($S < 1$), the temperature speedily becomes steady whereas there is no balanced size.

IV.2. Aerosols behaviour

The modelling of drops behaviour coupled with the correlations providing particles elementary collection efficiencies allows to compute the average efficiency on a 5 meters fall. Different experimental conditions and particles diameters are tested for 100 μm diameter drops :

- figure 7 : In this case of atmospheric conditions ($P=1$ bar and $T=20^\circ\text{C}$) with $S=1$, phoretic effects are negligible. Impaction and interception are the main mechanisms for the largest aerosols. For the smallest ones, brownian diffusion collection is the main mechanism. As a result, the average total efficiency is minimal (10^{-3}) for the aerosols which the diameter is around 0.5 μm .

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- figure 8 : For these conditions, characteristic of spray scenarios (5 bars, 140°C and S=1), phoretic effects are not any more negligible. Thermophoresis is always the minority effect whatever the particles diameter. Diffusiophoresis efficiency which does not depend on particles diameter is slightly higher than the other ones when the total efficiency is minimal. Impaction, interception and diffusion mechanisms efficiencies do not vary a lot as function of thermodynamic conditions.

- figure 9 : The conditions are the same than ones of figure 8 excepted the initial drop temperature which is 80°C in this case. These values square with a scenario of recirculation. Despite lower values, diffusiophoresis efficiency is always the higher effect when the total efficiency is minimal. The decrease is due to the lower difference between gas and drops temperatures at the top of the vessel. The steam flow rate is lower so phoretic effects decrease.

Similar calculations are plotted on figures 10, 11 and 12 for 500 μm diameter drops. For ambient conditions (figure 10), phoretic effects are also negligible. The minimal efficiency (10^{-3}) resulting from impaction, interception and brownian diffusion mechanisms, is placed for aerosols which the size is lower than 0.1 μm .

In conditions characteristic of spray scenarios (figure 11 and figure 12), diffusiophoresis is the main effect for aerosols which the diameter is lower than 1 μm . Thus, the minimal efficiency reached 10^{-2} thanks to the phoretic effects.

The previous curves represent the average efficiencies on a five meters fall. But these efficiencies change a lot as function of falling height because of the evolution of the steam flow rate and the temperature gradients around drops.

On figure 13 and figure 14, all the efficiencies and drops temperature are plotted for two particles diameters : 0.1 and 5 μm . We clearly observe that the phoretic effects are very important at the beginning of the fall but stop when temperature becomes steady.

Mechanical effects, do not depend a lot on temperature, are almost steady during the fall. The slight variations are only due to the changing drop size and to the drop velocity evolution. The temperature equilibrium is quickly reached so the efficiencies steady values are close to the average values dropped on figure 11.

V. EXPERIMENTAL RESULTS

Acquisition of experimental results on the device CARAIDAS allows to qualify the modelling of the different phenomena involved in the fission products washout by spray.

We only present the first experimental results. At the moment, an important campaign of tests is going on.

The three falling height drops diameter measurements and drop behaviour modelling are plotted on the figures 15, 16, 17 and 18 for different experimental conditions. Each experimental drops diameter is the average value of about fifty experimental points. Because of the slight decrease of diameter in some tests, the average values are accompanied with a confidence interval. If n is the number of experimental measurements, x_i a measurement i and x_a the average value on the measurements, we obtain :

the estimated standard deviation:
$$s = \sqrt{\frac{\sum_{i=1}^n (x_i - x_a)^2}{n-1}}$$

the confidence interval on x_a :
$$i = 2 \times \frac{2s}{\sqrt{n}}$$

(there are ninetyfive chances in a hundred that x_a is included in this interval)

Any confidence interval is drawn because it is very small (a few micrometers) in relation to the drops diameter decrease. So we can conclude that experimental measurement decreases are significant.

There is a good agreement between calculations and experiments whatever thermodynamic conditions (figure 15, 16, 17 and 18). Even when the drop evaporates a lot (dry warm air on figure 18), the divergences between the code and the experimental data are low.

More experimental results, with condensation thermodynamic conditions, will be getting but we can expected a good agreement also.

VI. CONCLUSION

The experimental device CARAIDAS is operational for aerosols experiments, so particles collection efficiencies as function of different working conditions representative of severe accident will be determined. Experimental aerosols tests are going on. In the same time, we have developped a model. Experimental collection efficiencies and code results will be used in order to propose qualified collection efficiencies correlations. At the end of this program more realistic washout rates could be computed as function of accident scenarios. Iodine experimental tests will be done after aerosols tests.

REFERENCES:

- (1) DUCRET D., VENDEL J. and VIGLA D.
«Etude préliminaire de l'aspersion»
report SERAC/LECEV/93-22, 1993
- (2) BEARD K. V. and PRUPPACHER H.R.
«A wind tunnel investigation of the rate of evaporation of small water drops falling at terminal velocity in air»
J. Atmos. Sci., vol. 28, pp 1455-1464, 1971
- (3) HENDOU M.
«Contribution à la modélisation des transferts simultanés lors de l'absorption de gaz traces par une pulvérisation»
ENSIGC thesis, TOULOUSE, FRANCE, 1992
- (4) GAUVAIN J. and FILIPPI M.
«Iodine transfer in the containment in the event of a severe accident»
Escadre System, Iode Code (release 2), CEA report, 1991
- (5) POWERS D.A. and BURSON S.B.
«A simplified model of aerosol removal by containment sprays»
U.S. Nuclear Regulatory Commission, Washington D.C., 1993
- (6) WALDMAN L. and SCHMITT Kh.
«Thermophoresis and diffusiophoresis of aerosols»
in «Aerosols Science» edited by C.N. DAVIES
- (7) PRUPPACHER H.R. and al.
«Microphysics of clouds and precipitation»
D. REIDEL publishing compagny, 1978
- (8) TALBOT L. and al.
«Thermophoresis of particles in a heated boundary layer»
J. Fluid Mech., 101, (4), 737-758, 1980

figure 1: Experimental device scheme

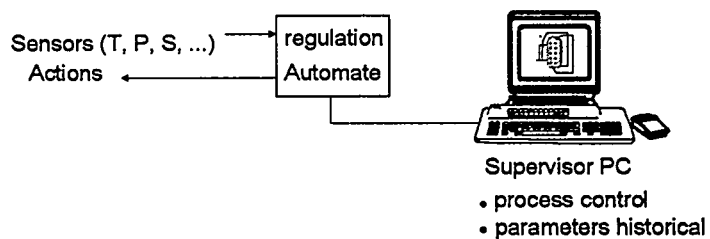
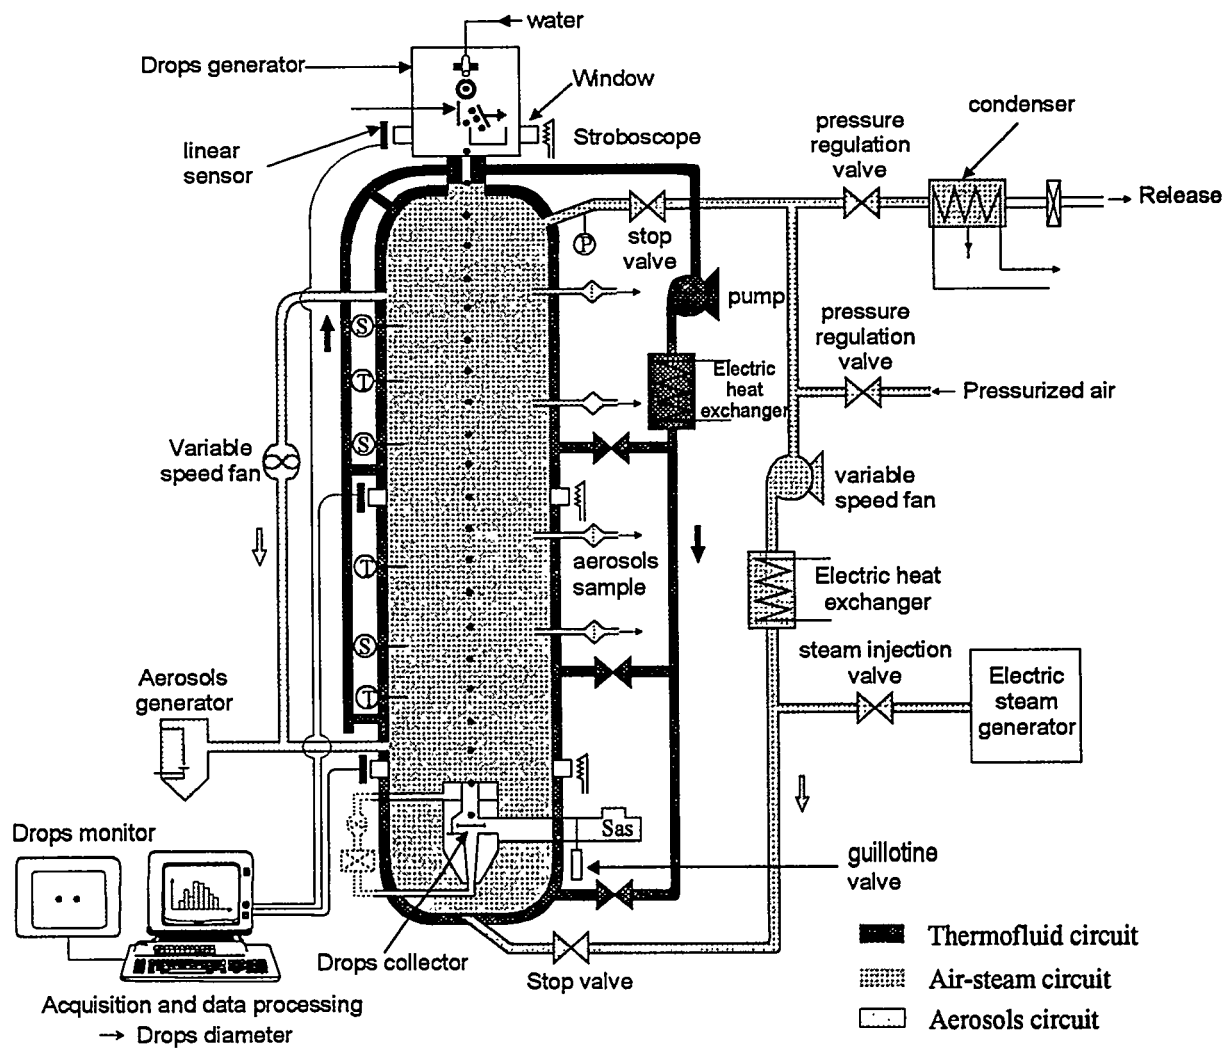


Figure 2 : Electrostatic sorting out drops generator

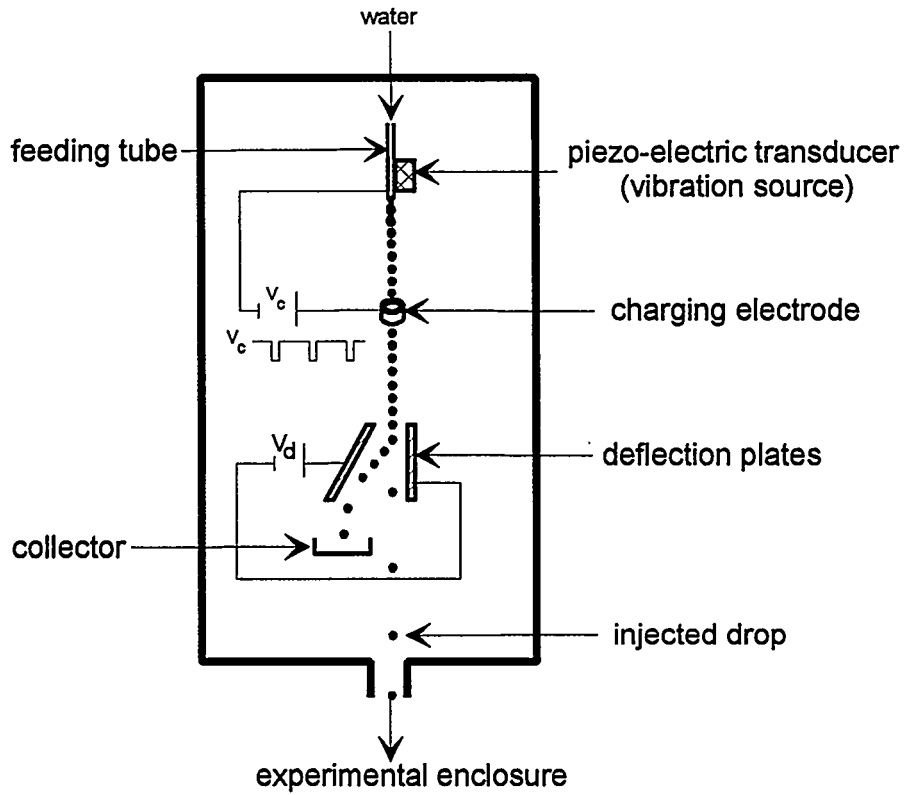


Figure 3: Double-film theory scheme

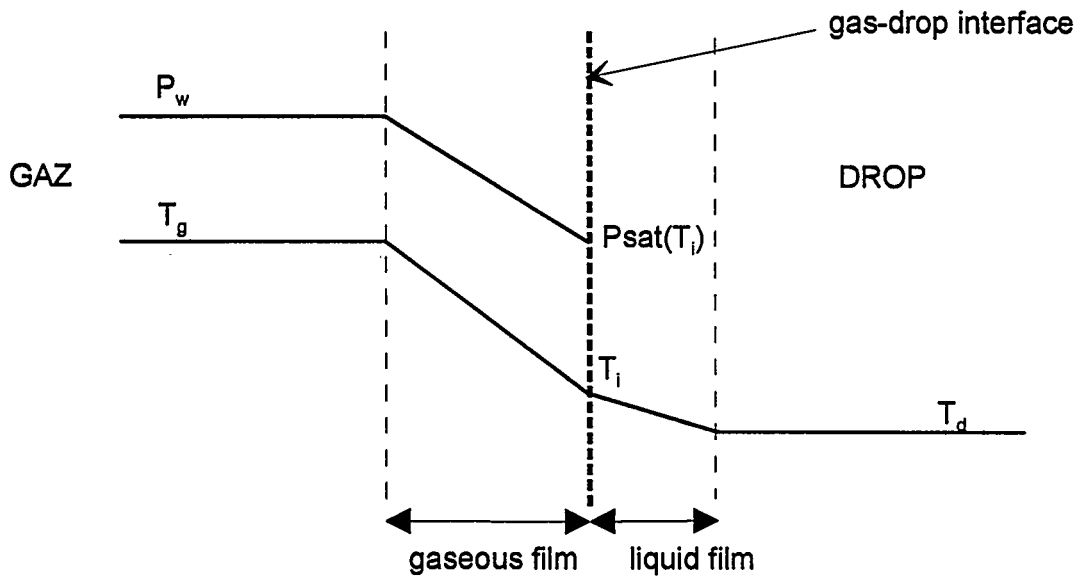


Fig. 4a: Drop diameter versus falling height - Initial drop diameter : 100 μm

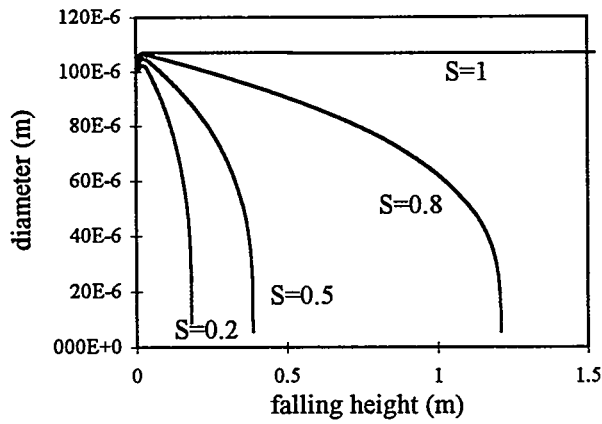


Fig. 4b: Drop temperature versus falling height - Initial drop diameter : 100 μm

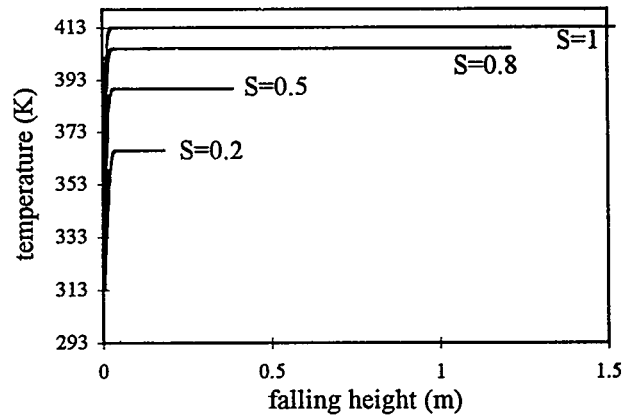


Fig. 5a: Drop diameter versus falling height - Initial drop diameter : 300 μm

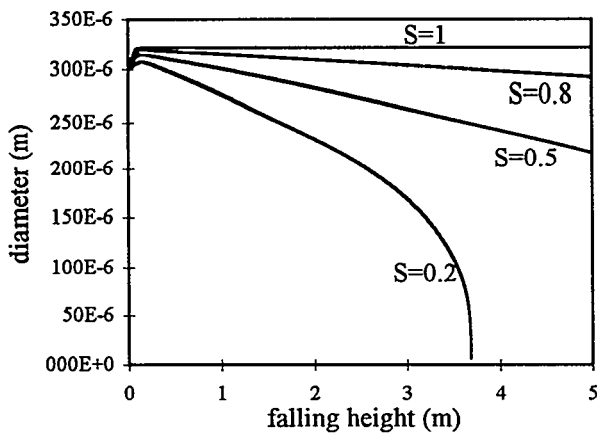


Fig. 5b: Drop temperature versus falling height - Initial drop diameter : 300 μm

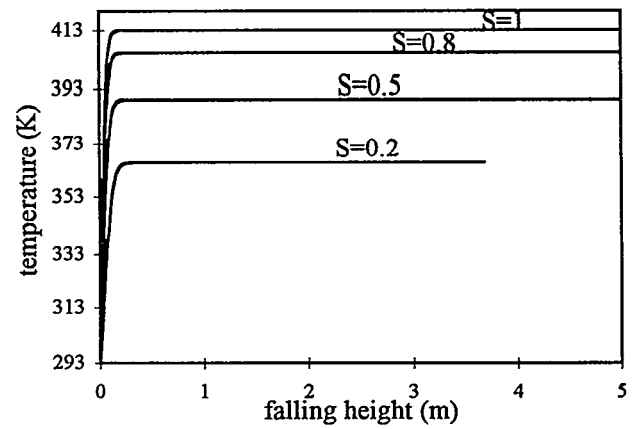


Fig. 6a: Drop diameter versus falling height - Initial drop diameter : 500 μm

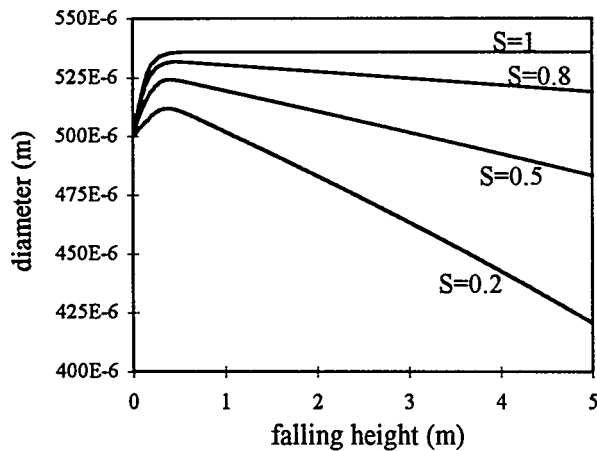


Fig. 6b: Drop temperature versus falling height - Initial drop diameter : 500 μm

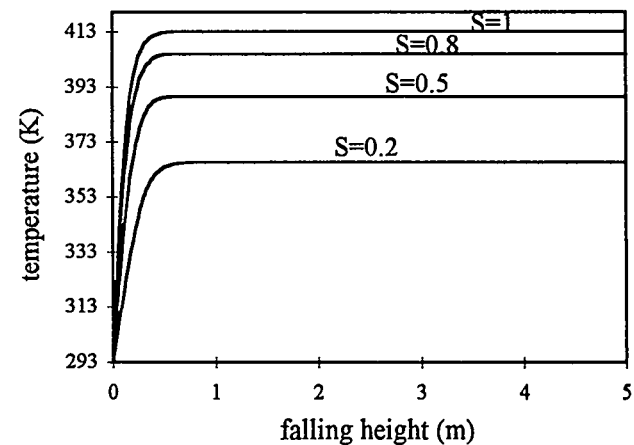


Figure 7: Collection efficiency versus aerosol diameter
 $P = 1 \text{ bar}, T_{\text{drop}} = T_{\text{gas}} = 20 \text{ }^\circ\text{C}, S = 1, D_{\text{drop}} = 100 \text{ } \mu\text{m}$

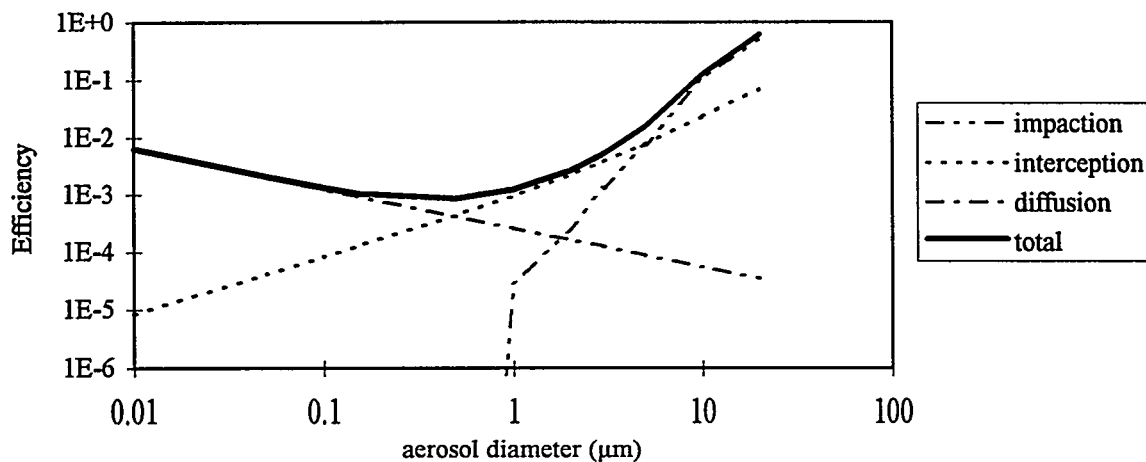


Figure 8: Collection efficiency versus aerosol diameter
 $P = 1 \text{ bar}, T_{\text{gas}} = 140 \text{ }^\circ\text{C}, T_{\text{drop}} = 20 \text{ }^\circ\text{C}, S = 1, D_{\text{drop}} = 100 \text{ } \mu\text{m}$

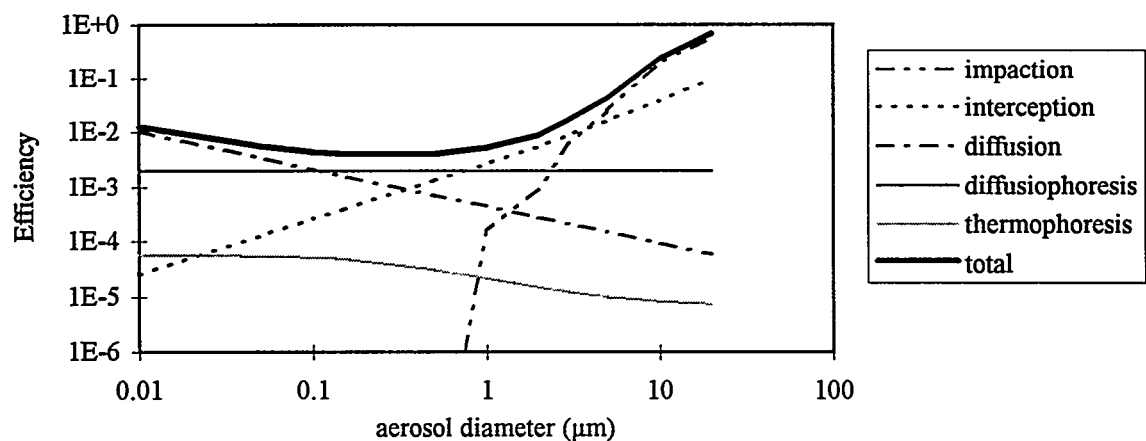


Figure 9: Collection efficiency versus aerosol diameter
 $P = 5 \text{ bars}, T_{\text{gas}} = 140 \text{ }^\circ\text{C}, T_{\text{drop}} = 80 \text{ }^\circ\text{C}, S = 1, D_{\text{drop}} = 100 \text{ } \mu\text{m}$

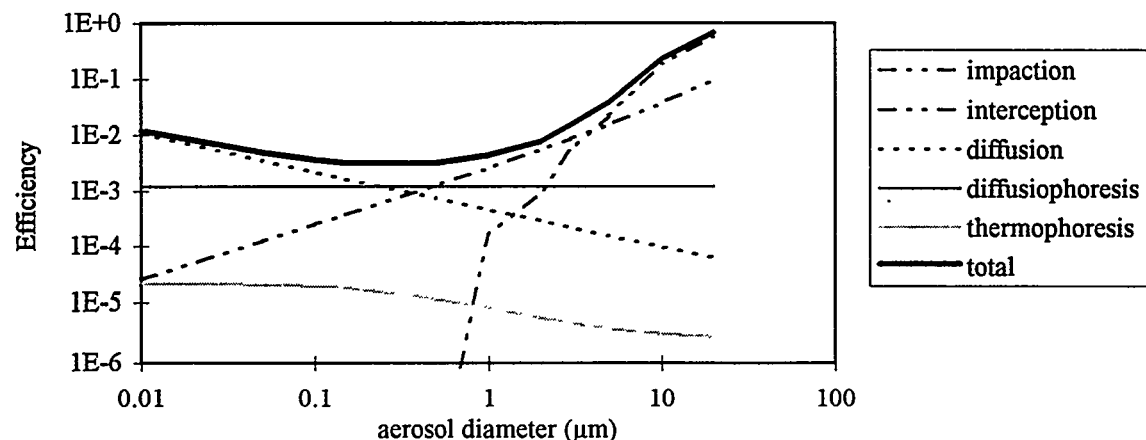


Figure 10: Collection efficiency versus aerosol diameter
P = 1 bar, T_{drop} = T_{gas} = 20 °C, S = 1, D_{drop} = 500 μm

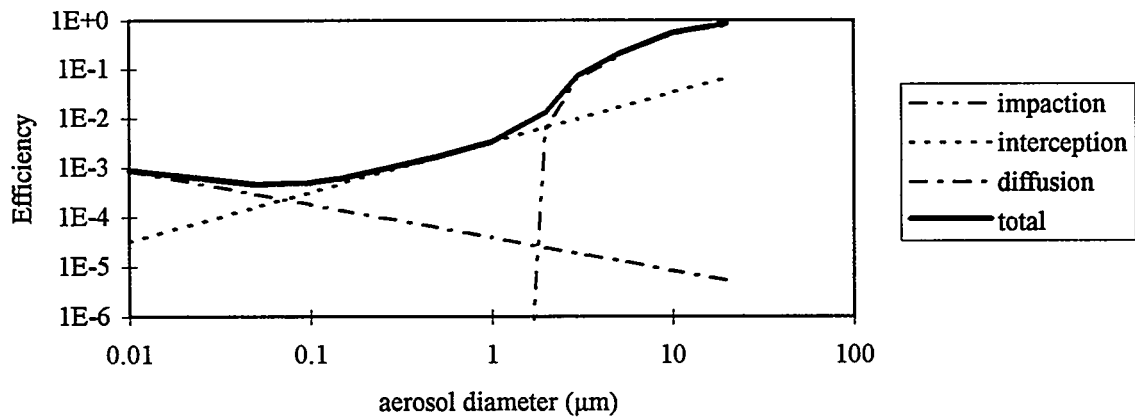


Figure 11: Collection efficiency versus aerosol diameter
P = 5 bars, T_{gas} = 140 °C, T_{drop} = 20 °C, S = 1, D_{drop} = 500 μm

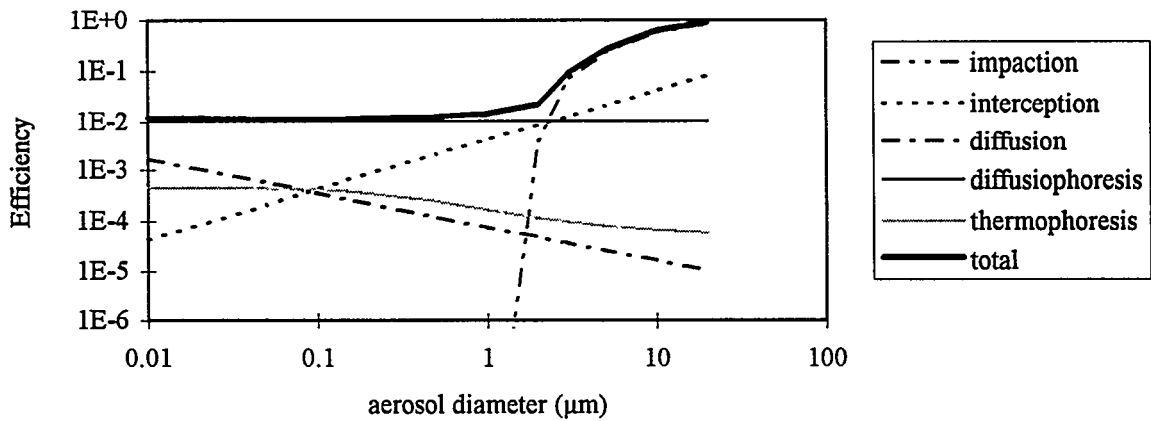


Figure 12: Collection efficiency versus aerosol diameter
P = 5 bars, T_{gas} = 140 °C, T_{drop} = 80 °C, S = 1, D_{drop} = 500 μm

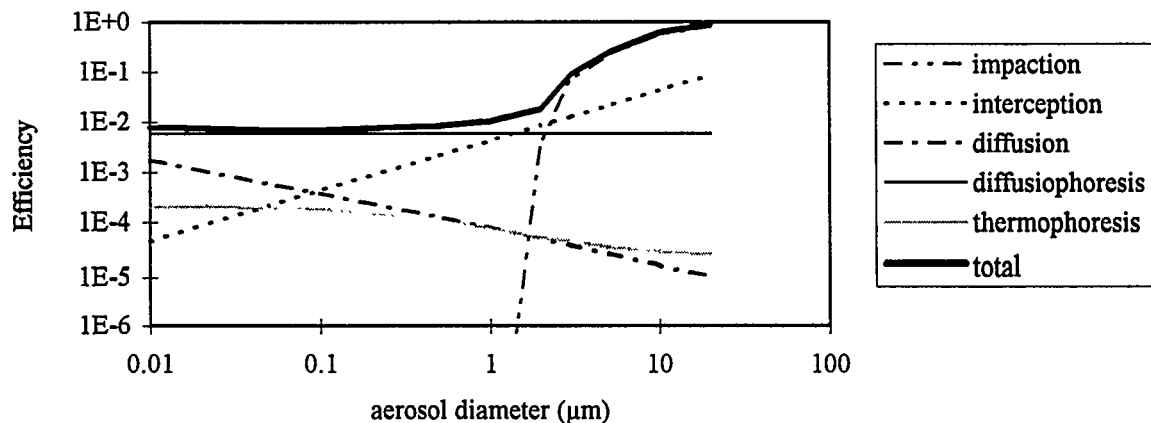


Figure 13: Elementary efficiency versus falling height
 $P = 5 \text{ bars}$, $T_{\text{gas}} = 140 \text{ }^\circ\text{C}$, $T_{\text{drop}} = 20 \text{ }^\circ\text{C}$, $S = 1$
 $D_{\text{drop}} = 500 \text{ } \mu\text{m}$, $D_{\text{aerosol}} = 0.1 \text{ } \mu\text{m}$

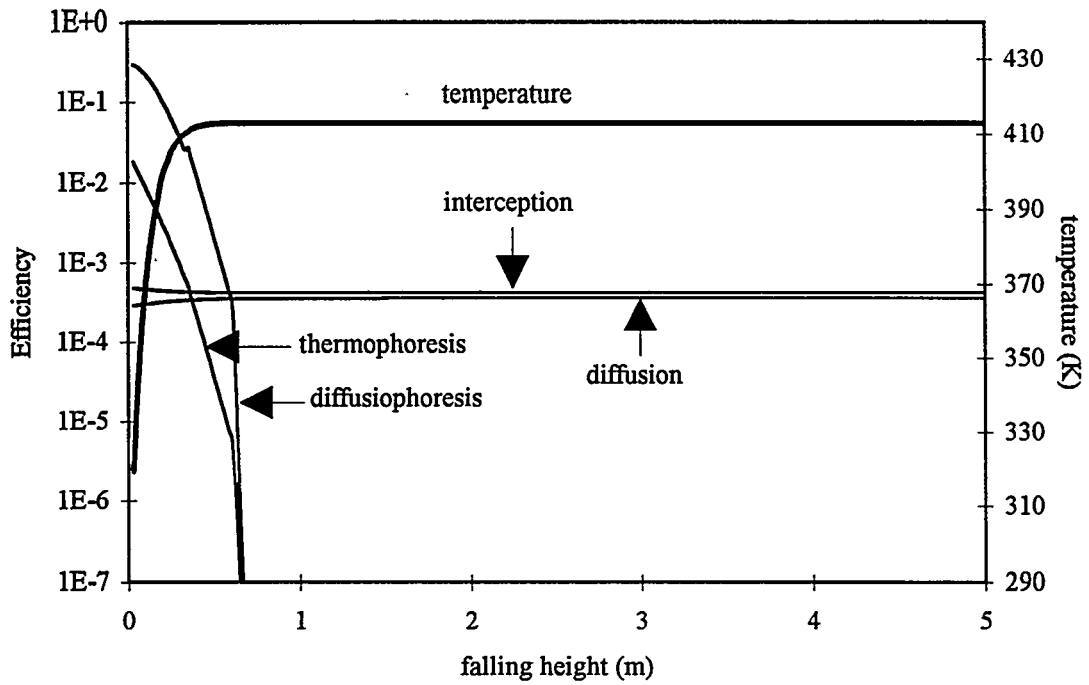


Figure 14: Elementary efficiency versus falling height
 $P = 5 \text{ bars}$, $T_{\text{gas}} = 140 \text{ }^\circ\text{C}$, $T_{\text{drop}} = 20 \text{ }^\circ\text{C}$, $S = 1$
 $D_{\text{drop}} = 500 \text{ } \mu\text{m}$, $D_{\text{aerosol}} = 5 \text{ } \mu\text{m}$

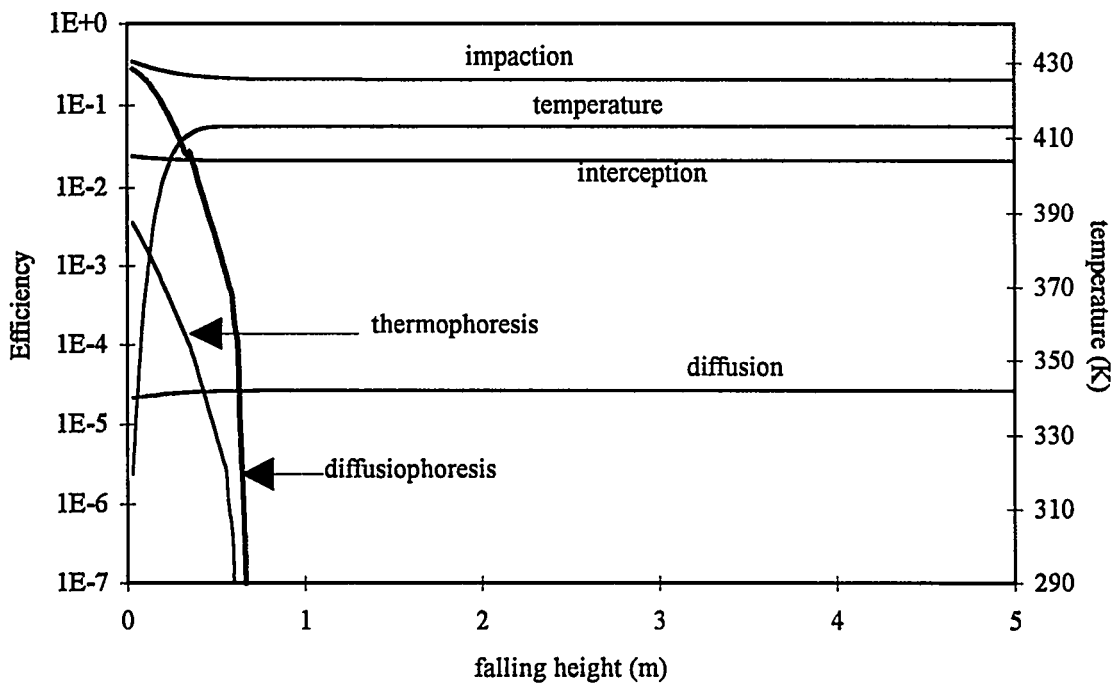


Figure 16: Drop diameter versus falling height
 S = 12 %, P = 1 bar, T_{gas} = 47 °C, T_{drop} = 20 °C

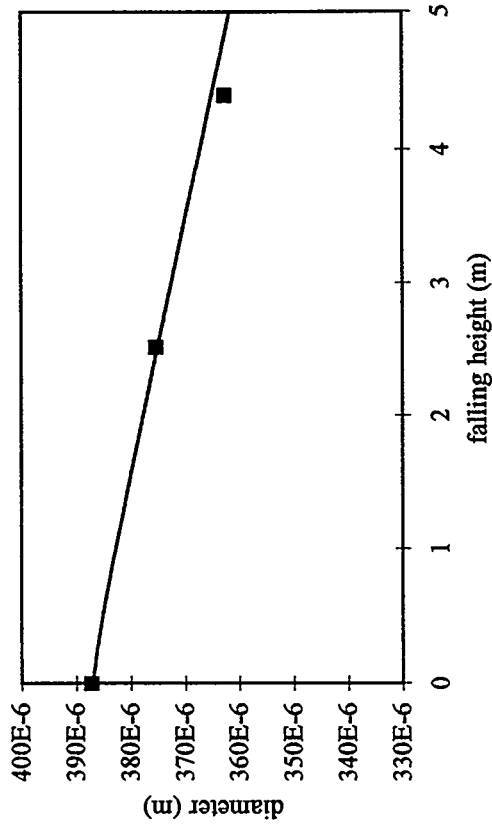


Figure 18: Drop diameter versus falling height
 S = 1 %, P = 1 bar, T_{gas} = 146 °C, T_{drop} = 30 °C

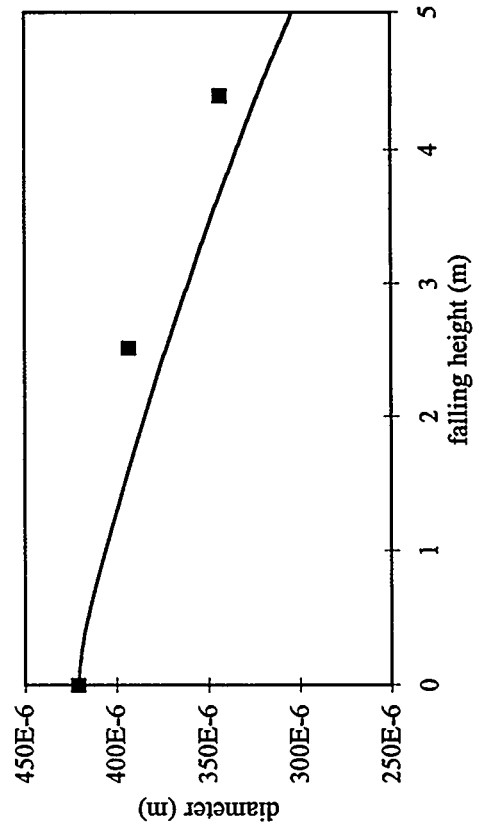


Figure 15: Drop diameter versus falling height
 S = 32 %, P = 1 bar, T_{gas} = 21 °C, T_{drop} = 20 °C


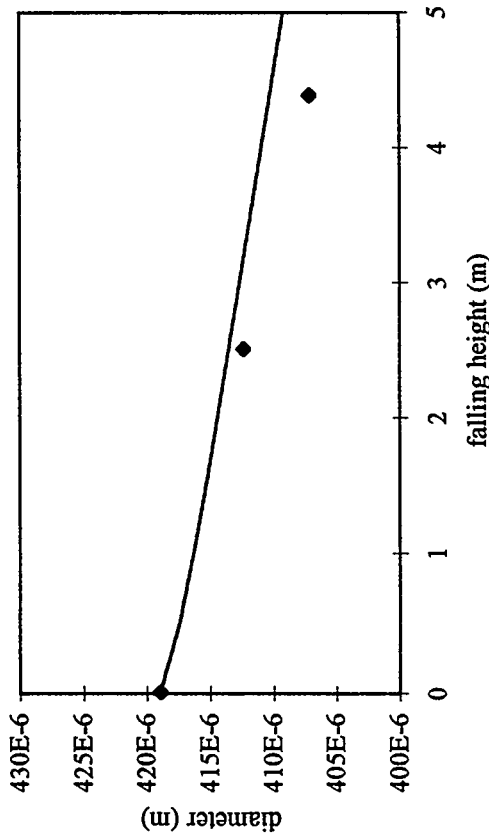


Figure 17: Drop diameter versus falling height
 S = 1 %, P = 1 bar, T_{gas} = 105 °C, T_{drop} = 30 °C

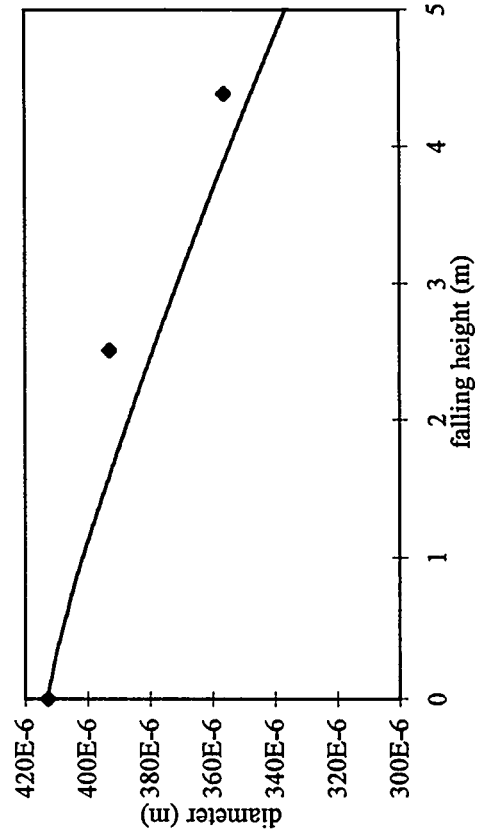

DISCUSSION

LEE: Are you aware that we requested the Phebus project at Cadarache to install a single drop aerosol experiment (instead of using a spray) during the test in the containment to assess current modeling of spray scrubbing of iodine?

DUCRET: I do not really know the answer because it is on another project.

LEE: Because the containment of Phebus is very small, if they are going to use a spray, the spray cone will practically cover everything in the containment. Therefore, if you look at the cross section (of the spray) versus the surface area and the volume (of the containment) it will be greatly distorted no matter what kind of spray is used, and the results will probably not be useful for validating the models for spray scrubbing of iodine. For this reason, we proposed to the CEA to use a single drop type experiment.

CHARACTERIZATION AND RESTORATION OF PERFORMANCE OF "AGED"
RADIOIODINE REMOVING ACTIVATED CARBONS

W. Peter Freeman
NUCON International, Inc.
Columbus, Ohio

Abstract

The degradation of radioiodine removal performance for impregnated activated carbons because of ageing is well established. However, the causes for this degradation remain unclear. One theory is that this reduction in performance from the ageing process results from an oxidation of the surface of the carbon. Radioiodine removing activated carbons that failed radioiodine removal tests showed an oxidized surface that had become hydrophilic compared with new carbons. We attempted to restore the performance of these "failed" carbons with a combination of thermal and chemical treatment. The results of these investigations are presented and discussed with the view of extending the life of radioiodine removing activated carbons.

Introduction

Experience has shown that the performance of activated carbons for radioiodine removal decreases with time by a process known as ageing. This ageing process can occur in storage and has lead to the recommended shelf life of five years currently accepted in the U.S. after which the carbon should be retested for radioiodine removal. Carbons that do not meet the retesting requirements and thus cannot be used though "new" have become known as "spinster" carbons. It is generally believed that these "spinster" carbons fail after prolonged storage due to a change in the surface oxides present on the carbon. NUCON[®] and others^{1,2} have used a combination of thermal and chemical treatments to restore the performance of these "failed" carbons. The results of these investigations are presented and discussed.

Methodology

Except where noted, ASTM D3803-89³ was used to determine the methyl iodide removal efficiency at 30°C and 95% relative humidity. Heat treatments were performed using a rotary kiln. Carbon impregnations were performed using the incipient wetness technique.

Presentation of Results

Results of tests performed in the NUCON[®] laboratory are shown in Table 1 for treatment of "spinster" carbon. Shown in Table 2 are results of treatments of a spent carbon from a German plant².

Discussion of Results

The German test results in Table 2 show the methyl iodide removal efficiencies after different types of treatment techniques performed on a spent (i.e., a carbon that has seen service) carbon sample. These treatments included; desorption with steam at 130 °C, with nitrogen at 200, 300 and 450 °C and with carbon dioxide at 180 °C; extraction with hexane and heptane at 25 °C and extraction with supercritical carbon dioxide at 40 and 60 °C; and desorption with nitrogen at 450 °C followed by potassium iodide impregnation. Although their radioiodine test method differs from the ASTM method, the success of their thermal treatment using N₂ at 450°C with or without a following impregnation, prompted similar treatments in our laboratory on “spinster” carbon samples.

The results of these tests with “spinster carbons”, shown in Table 1, indicate that desorption at 850°C with nitrogen followed by impregnation with TEDA restores the carbon to a greater than 99% efficiency. This is NUCON[®]s lower limit for an acceptable test result using ASTM D3803-89. Hydrazine treatment of spent carbons has also been suggested as a treatment to restore the performance of aged carbons¹. However, as shown in Table 1, hydrazine gave no improvement over TEDA impregnation.

This high temperature treatment with N₂ has been shown to drive surface oxides off the carbon⁴ and, following impregnation, restores the carbon to “new” carbon performance. This treatment method may be a cost-effective way to restore the performance of “spinster carbons” especially when compared with new carbon replacement costs.

References

1. Deitz, V. R., “ Charcoal Performance Under Accident Conditions in Light- Water Reactors”, NUREG/CR-3990, NRL Memo Rpt 5528 (March 1985)
2. Lasch, M., et al, “ Exhaustion of activated carbon for iodine retention in nuclear power plants”, VGB *Krartwerkstech*, 1994, 74(11) 988-90
3. ASTM D3803-89, “Standard Test Method for Nuclear-GRade Activated Carbon”, *Annual Book of ASTM Sandards*, Vol 15.01
4. Boehm, H. P., “Chemical Identification of Surface Groups”, *Institute of Inorganic Chemistry, University of Heidelberg, Germany*

TABLE 1		
Methyl Iodide Removal Efficiency After Treatment of "Spinster" Carbon		
Sample ID	Treatment	Methyl Iodide Removal Efficiency, %
4501	As Is	90.7
4501	N ₂ , 450 °C, KI+TEDA	98.0
4501	N ₂ , 700 °C, KI+TEDA	98.4
4501	N ₂ , 800 °C, KI+TEDA	98.6
4501	N ₂ , 850 °C, TEDA	99.3
I122	TEDA	97.1
I416	Hydrazine, TEDA	97.0

Radioiodine Test Conditions: ASTM D3803-89, 30 °C, 95% Relative Humidity

TABLE 2
German Studies of Depleted Carbon for Iodine Retention

Sample #	Treatment	Methyl Iodide Removal Efficiency, %
1	Steam, 130 °C	98.86
2	N ₂ , 200 °C	99.27
3	CO ₂ , 180 °C	98.86
4	Supercritical CO ₂ , 40 °C	99.97
5	Supercritical CO ₂ , 60 °C	99.87
6	n-Hexane, 25 °C	99.83
7	n-Heptane, 25 °C	99.90
8	N ₂ , 300 °C	99.978
9	N ₂ , 450 °C	99.999
10	N ₂ , 450 °C, KI	99.999+

Radioiodine Test Conditions: 30 °C, 0.42 m/s, 1.2 sec. Residence Time

DISCUSSION

RICKETTS: I wonder if you could comment about how long these regeneration processes take and whether there are any significant differences between the various processes as far as costs go?

KOVACH, L: Yes, certainly there are differences. I do not know how familiar everybody is with how activated carbon is made. You process activated carbon at high temperature and at best the residence time may be from 1-3 hours in rotary furnaces but you may also be dealing with 10 - 24 hours residence time at these temperatures for some products. In the case discussed in the paper residence times are much shorter, a half-hour at temperature for the nitrogen treatment. If we are looking at supercritical extraction with carbon dioxide it becomes more complicated because there has been a significantly more strict controlled pressure boundary on the system than just a straight rotary furnace with an inert gas. Organic extractions are again more expensive because you have to recover the organic from the material and then you have to dry it again. So the lowest cost products are still made by nitrogen treatment. I would say by almost an order of magnitude lower cost than any of the other ones. Temperature is nothing other than an energy cost, it is really not significant. It is just as easy to run at 850°C as at 450°C, the residence times would be the same for all cases. In the US, straight impregnation cost is probably somewhere in the neighborhood of \$0.50/lb for labor and material but excluding the cost of carbon used. The nitrogen treatment is the one that looks most promising, both from a cost and a benefit standpoint.

RICKETTS: Are you passing nitrogen through the carbon during the regeneration process?

KOVACH, L: It is not directly passed through, although we are currently doing some tests where we are passing it through the carbon. In a rotary furnace you are dealing with partial exposure, i.e., carbon is scattered up on the walls and it falls back so there is exposure partly to the nitrogen stream. But it is not continuous, so it is not like a fixed bed with hot nitrogen going through it, it is a rotating bed and it falls back in the tube while it is exposed to nitrogen.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

EFFECTS OF WELDING FUMES ON NUCLEAR AIR CLEANING SYSTEM CARBON ADSORBER BANKS

Philip W. Roberson
Duke Power Company
McGuire Nuclear Station, Huntersville, NC 28078

Abstract

Standard Technical Specifications for nuclear air cleaning systems include the requirement to perform a full battery of surveillance tests following "fire, painting, or chemical release" in areas communicating with the affected system. In order to conservatively implement this requirement, many plants have categorized welding as a chemical release process, and instituted controls to ensure that welding fumes do not interact with carbon adsorbers in a filter system.

After reviewing research data that indicated that welding had a minimal impact on adsorber iodine removal efficiency, McGuire Nuclear Station decided to pursue further testing with the goal of establishing a "welding threshold". It was anticipated that some quantity of weld electrodes could be determined that had a corresponding detrimental impact on iodine removal efficiency for the exposed adsorber. This value could then be used to determine a conservative sampling schedule that would allow the station to perform laboratory testing to ensure system degradation did not occur, without incurring the penalty of a full battery of surveillance tests.

A series of tests was designed to demonstrate carbon efficiency versus cumulative welding fume exposure. Three series of tests were performed, one for each of the three different types of commonly encountered weld electrodes (E7018, E308 and E309). Each test series used a test filter train with a freshly loaded carbon adsorber and 20 pounds of electrode. Welding was performed with all airborne welding by-products directed through the filter train. Carbon sampling was performed at baseline conditions, and every five pounds of electrode thereafter. Two different laboratory tests were performed for each sample; one in accordance with ASTM 3803/1989 at 95% relative humidity and 30 degrees C, and another using the less rigorous conditions of 70% relative humidity and 80 degrees C.

Review of the test data for all three types of electrodes failed to show a significant correlation between carbon efficiency degradation and welding fume exposure. Accordingly, welding is no longer categorized as a 'chemical release process' at McGuire Nuclear Station, and limits on welding fume interaction with ventilation systems have been eliminated.

Introduction

Historically, at McGuire Nuclear Station, the generation of welding fumes has been considered to have a potentially detrimental effect on the carbon adsorbers of nuclear air cleaning system filter packages. Accordingly, their communication with operating filter systems has been administratively controlled; if welding fume exposure for a given system is unavoidable, that system would conservatively be considered inoperable and subject to the full battery of surveillance tests to demonstrate its return to operability.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Normally, these administrative controls do not place an undue burden on coordination between work and system operation. However, upcoming steam generator replacement projects at two of Duke Power Company's nuclear sites led to a re-examination of the welding fume impact issue.

During an outage, the Containment Purge filter trains at McGuire are essentially under continuous operation, either in 100% (dual train), or 50% (single train) mode. There are no designed system bypasses, so it is anticipated that essentially ALL of the gases generated by welding processes in containment will communicate with the operating filters. In order to avoid unnecessarily declaring filter trains inoperable based on 'suspected impact,' a site project was undertaken by the System Engineering and Operations groups to attempt to establish a correlation between the amount of fumes generated by welding and the resulting degradation in filter system methyl iodine removal efficiency.

Project Goal and Scope

The original project goal was to determine the point at which filter system adsorber performance deterioration occurred in a small test system, and then correlate this point to the cumulative weld fume exposure. Conservative extrapolations of this small test filter package data to actual systems would then be developed. It was anticipated that a 'pounds of electrode consumed per filter system flow rate' limit could be devised. This would be analogous to the painting 'rule of thumb' of 100 sqft per 1000 cfm that is widely used in the nuclear industry to perform carbon sampling and laboratory testing.

It was recognized that many hundreds of pounds of welding electrode would be used during the steam generator replacements, (and in the preceding outage, which incorporated as much structural prestaging as possible). Much of this welding would be 'stick', or electrode welding, (more formally called 'shielded metal arc welding', or SMAW). Other welding processes using an inert gas purge (i.e., MIG, TIG) are comparatively insignificant fume producers, and are not generally considered to be 'chemical releases.' Electrode welding was the only issue considered unresolved, and therefore was the sole focus of the project.

Test Method, Execution and Observations

Test Parameter Determination

The McGuire Training Support division has a small test filter train which was made available for use in project. The system is a portable and self-contained filter package manufactured by Charcoal Service Corporation of Bath, NC. This package consists of:

- a) an 8" diameter intake duct (including flow orifice and manual throttle damper),
- b) a filter housing, containing:
 - one 24"x24"x2" prefilter,
 - one 24"x24"x12" HEPA filter, and
 - one carbon adsorber with approximately 75 pounds of carbon arrayed in 1 and 3/8" thick pleats, and
- c) a belt driven centrifugal fan with a 120 VAC, 1.5 HP motor.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The nominal flow rate through the system is 500 cfm; manufacturer's supplied data for the adsorber states a residence time of 0.125 seconds at a flow rate of 1000 cfm (or, 0.25 seconds at 500 cfm).

Each of the two containment purge filter package carbon adsorbers holds approximately 2200 pounds of activated impregnated carbon, and has a nominal individual train flowrate of 14,000 cfm and 0.25 second residence time. A conservative approximation of the actual amount of welding electrode that might be consumed during an outage was 500 pounds. Comparing sizes of the test filter package to an individual containment purge package (based on either flow rate or the roughly equivalent carbon weight ratio) led to the choice of 20 pounds of electrode as the appropriate challenge for the test filter package. This equates to subjecting a single containment purge package to the fumes of approximately 585 pounds of welding electrode. Added conservatism is given by the fact that containment purge train operation is normally rotated during an outage, and routine lab tests of representative carbon samples are required after every 720 hours of system operation..

At McGuire, three different types of electrodes are used in 'stick welding' applications. They are:

- 1) AWS Classification E7018 for carbon steel to carbon steel welding,
- 2) AWS Classification E308 for stainless steel to stainless steel welding, and
- 3) AWS Classification E309 for stainless steel to carbon steel welding.

Due to the questions about the varying chemical compositions of the fluxes and the possibility of differing carbon degradation trends, it was decided that all three types would be tested (20 pounds of each). The carbon adsorber would be reloaded prior to each test series to quantify individual impacts.

Carbon to be used in each test series was the same nuclear grade-adsorbent as used in McGuire's safety filter systems. Purchase specifications state that it shall be impregnated to a range of 4.8 to 5% TEDA, and conform to all the physical and test standards as required by ANSI N509-1980, Table 5.1. The supplier for the carbon used was Carbon Applications, Inc. of Columbus, Ohio.

In order to add further conservatism and fully allow for any interaction between the welding fumes and the adsorber bed, a maximum test filter package flow rate of 250 cfm was established, which translates into a residence time of at least 0.50 seconds. In order to trend and correlate carbon degradation versus welding exposure, a carbon sampling frequency of a) prior to exposing the carbon to fumes, as a baseline, and b) following the consumption of every five pounds of electrode was assigned.

Test Execution

The general approach for each of the three test series was the same. The adsorber was loaded with new carbon, a baseline sample was obtained, and the filter package was started. The flow rate was throttled to a nominal 240 cfm. Welding was performed in the inlet plenum of the 8" ductwork to ensure that all fumes were drawn into the test filter package. The full length of the electrode was used for welding, regardless of whether restriking was required (impurities in the weld beads being generated were of no consequence to the test program). Representative carbon samples were removed from the adsorber following the consumption of each 5 pounds of electrode.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

E308 Test Series: The original loaded carbon weight was 79 lbs. A gradually increasing prefilter differential pressure was observed during welding; its affect on flow was offset by adjusting the manual throttle damper in the inlet duct. Flow varied from 236 to 246 cfm. The total weight of E308 electrode was made up of 15 lbs. of 1/8" dia. and 5 lbs. of 3/32" dia.

E309 Test Series: The newly loaded carbon weight was 75 lbs. Prefilter differential pressure continued to rise during the test. Manual throttle damper adjustment was still sufficient to maintain nominal flow. Calculated flow for the series held steady at 242 cfm. E309 electrode weight was comprised of 16 lbs. of 1/8" and 4 lbs. of 3/32" dia.

E7018 Test Series: The test filter package prefilter was changed out along with carbon. Reloaded carbon weight was 80 lbs. The starting position for the throttle damper was further closed to account for the decreased D/P of the new prefilter. Flow varied from 229 to 239 while compensating for the initial particulate loading of the prefilter with damper adjustment. The breakdown of electrode sizes for the E7018 series was 5 lbs. of 3/32" dia., 7 lbs. of 1/8" dia., and 8 lbs. of 5/32" dia.

Test Results

Laboratory analysis of the carbon samples was performed by NCS Corporation of Columbus, Ohio. Each carbon sample was tested under two sets of conditions. The first was the Technical Specification dictated test of 80°C/95% Relative Humidity. The acceptance limit for this test is 99.00 % efficiency. The second test was the more conservative ASTM D3803-1989 test which incorporates a 16 hour pre-equilibration period and 30°C/95% RH test conditions.




The results of the laboratory testing performed at five pound intervals for the three types of electrodes are presented in the following table.

Welding Exposure (Lbs. of Electrode)	Carbon Laboratory Efficiencies (%): Electrode Type / Lab Test Conditions					
	E308		E309		E7018	
	(80C/95%RH)	(3803-1989)	(80C/95%RH)	(3803-1989)	(80C/95%RH)	(3803-1989)
0	99.99	99.59	99.99	99.58	99.99	99.81
5	99.99	99.72	99.99	99.55	99.99	99.72
10	99.98	99.70	99.99	99.59	99.99	99.76
15	99.99	99.68	99.99	99.66	99.99	99.75
20	99.99	99.63	99.99	99.73	99.99	99.79

Review of the above data shows that even under heavy exposure to welding fumes, the ability of the adsorber to filter methyl iodine was not significantly affected. This general observation is applicable to the test results of each of the three types of electrodes.

The graphical presentation of the same data is provided for each electrode test series on the facing page; Graphs 1, 2, and 3.

Graphs 1, 2, and 3

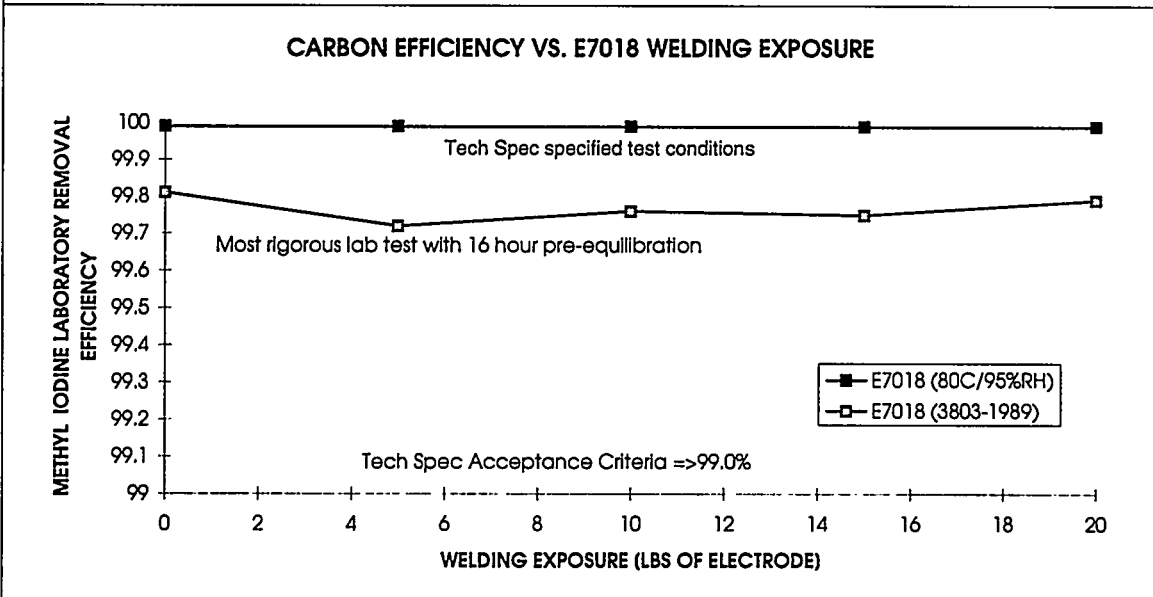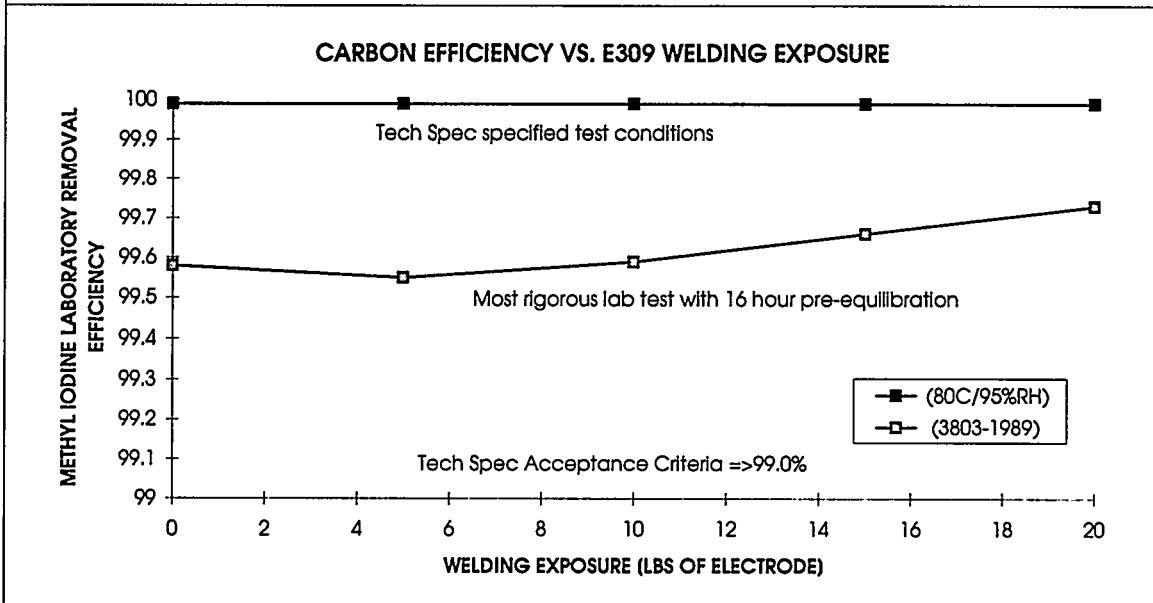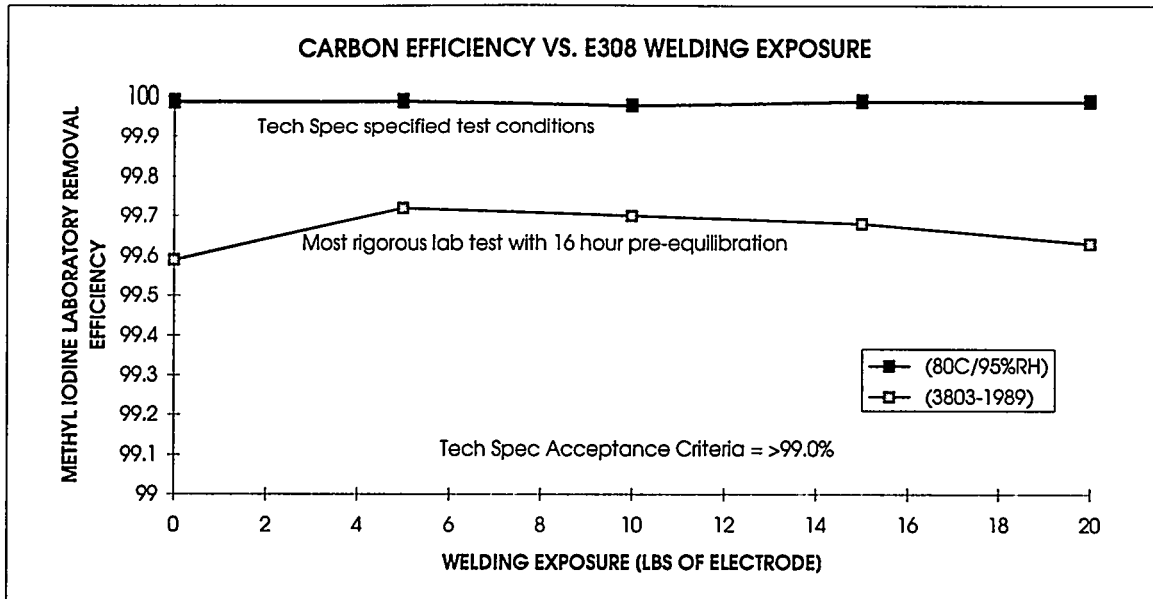

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Conclusions

Review of the laboratory test data for the three test series showed uniformly non-existent impact for the methyl iodine penetration tests performed at Tech Spec dictated conditions. With one exception (whose results were 99.98% efficient), all test results following increasing exposure to welding fumes showed the same performance as the baseline. This consistency, and lack of an identifiable deterioration trend, was a pleasant surprise.

Turning to the results for the carbon samples when tested according to ASTM 3803-1989, more variation was noted. An average efficiency for each test series was calculated, along with a standard deviation. For the 15 samples, 10 fell within a single standard deviation of the average, and for the remaining five, the worst "outlier" was 1.5 standard deviations off the average. It is interesting to note that this point (Series E309, Sample #5) showed an increase in efficiency over the baseline test.

Based on the trends established by the sampling and lab results for each test series, it does not appear that the airborne byproducts of electrode welding have a statistically significant impact on the performance of a filter package adsorber. No correlation of adsorber performance degradation vs. welding exposure was established. It was, however, noted that the visible smoke from electrode arcing is a particulate that does have a cumulative effect on prefilters, and therefore, potentially, on total system flow and/or HEPA filter D/P. The routine monitoring of operating filter systems at McGuire is considered adequate to identify any flow impacts of increasing D/P due to welding or other dust/particulate generating activities.

Accordingly, electrode welding is no longer considered a chemical release process at McGuire Nuclear Station.

Acknowledgments

The author would like to acknowledge and extend his appreciation to David G. Davenport for his leadership and coordination efforts in conducting this project. Additional thanks are also extended to John Pearson of NCS, for his usual excellent support.

References

ANSI-N509-1980, "Nuclear Power Plant Air Cleaning Units And Components"

ASTM D3803-1989, "Standard Test Method for Nuclear Grade Activated Carbon".

American Welding Society, "Characterization of Arc Welding Fumes", 1983.

Ghosh, D. "Effects on the efficiency of activated carbon on exposure to welding fumes"; Proceedings of the 23rd DOE/NRC Nuclear Air Cleaning Conference, Conf-940738, Pg. 639, (1994).

DISCUSSION

ADAMS: Was there an interval after you exposed the carbon to the electrode contaminants when there was free flow of air through it? For example, after you exposed it for five electrodes, after you exposed it for ten electrodes, etc. After you completed five electrodes, for example, how much air flowed, or how soon did you pull a sample before you began the next electrode exposure?

ROBERSON: Let me clarify the question; as opposed to five electrodes it is five pounds of electrodes. We are looking in the neighborhood of fifteen electrodes per pound, so it's a little heavier exposure than that. We did not allow any specified amount of time between when the welder finished and we were ready to open the package up and pull the adsorber sample. It did not exceed 15 min.

ADAMS: Did flow continue through the unit while you were pulling the sample?

ROBERSON: Flow continued for an unspecified but relatively insignificant amount of time. The overall consumption of the weld rod, i.e., the number of pounds of weld rod, would take several hours between each sample, but when the welding was completed, sampling was promptly scheduled right after that.

ADAMS: Was the charcoal and filter package unit that you used a qualified ANSI N-509 unit?

ROBERSON: Yes.

ADAMS: How long did air pass through the unit after pulling a sample and beginning the next loading set?

ROBERSON: Unspecified, but in general the run time did not exceed an additional 15 minutes.

HAYES: Was the charcoal that you utilized brand new charcoal?

ROBERSON: Yes.

HAYES: Can you estimate the impact of welding on the charcoal if the test charcoal had not been new but aged for a year or longer?

ROBERSON: Although I would not expect different behavior, the project scope did not focus on carbon age impact. On a practical level, we have applied this relaxed policy on welding through the past outage, which included significant structural pre-staging work for the upcoming S/G outage. Ages of the carbon beds for the two trains of containment purge are approximately one and eight years. Sampling and lab results based on system run time confirmed no degradation on either train, new or old.

HAYES: You indicated that there was a trend that once you got initial degradation the efficiency may have picked up slightly, although within the error that you are talking about, you might even say it was flat. I am wondering if the deterioration, once the charcoal has been exposed, caused the process to somehow speed up one way or the other.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

PEST: Can you elaborate on the sampling process? Did you use a grain thief, did you use a test canister?

ROBERSON: We used a grain thief and used a blended sample pulled from a number of pleats to obtain a standard sample.

FRANKLIN: Did you sample the air leaving the filter unit during or after welding?

ROBERSON: No, there was no attempt to quantify what kind of effluent came out of the filter package after all the weld fumes had passed through the pre-filter, HEPA filter, and adsorber.

HARRIS: There is a perceptible dust loading on the pre-filter. Was there an additional loading on the HEPA filter?

ROBERSON: It was minor. There was some but, I do not recall the exact number. From recollection, if the filter pressure drop started at 1.0 in. w., it was 1.1 in. w. at the conclusion.

GOLDEN: Regarding Jack Hayes' question on the aging of charcoal and how that was affected, I want to refer to a paper presented at the last air cleaning conference. The same conclusion was reached.

GHOSH: We did not check into the aging effects of the carbon in the test you are referring to. We used new carbon. We had test canisters and kept pulling the test canisters out. We did a combination of different tests and we tried to use the same type of carbon. The aging effect has not been addressed.

ROBERSON: At a practical level, we have been through one outage while constructing prestaging of structural steel with a lot of welding. We have done the required monthly sampling and continue to see good performance by the containment purge systems with five to seven year old carbon.

BARROW: In both units, we have reloaded carbon on "A" train but the Bravo train of each unit is approximately eight years old. Neither train has shown any degradation by carbon testing.

GHOSH: We use a test to validate that the building fumes had no effect on carbon. We have had two or three tests since we gave our paper and we did not show any degradation of the carbon. That confirms your results. In response to one of the questions somebody asked during my test, we monitored the gases in the inlet and outlet and found that the welding fumes were passing through the bed.

PEST: On the basis of the tests that you have done on your containment purge systems, do they seem to be operating well? What test parameters on your radioiodine test are you referring to, the regulatory required (80°C/70% RH, or the new D3803-1989?

ROBERSON: We do dual testing with all of our systems. D3803 is used for trending and predicting end-of-life.

CASS: How "clean" was the material that was used as the base for the welding? Burnished, sandblasted clean or oily, dirty, rusty, painted metal, as is usually found in operating plants? Could obscure fumes, i.e. burnt smoke, affect the carbon? Was this considered or evaluated?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

ROBERSON: Over the full range of the electrode test series (60#), a variety of welding “base metal” was used, some was painted, some rusty, and (for the stainless steel) some clean. Differences based on different base metal conditions was not specifically identified as a variable, but (by sheer coincidence), a range of base metal conditions was used. Specific documentation (or reconstruction) cannot be provided concerning which 5# increment of electrode consumption used which base metal.

BASIS FOR AND PRACTICAL METHODS OF CONTROLLING PAINTING ACTIVITIES
AT THE SEQUOYAH NUCLEAR PLANT

Robert R. Campbell
Tennessee Valley Authority (TVA)
Chattanooga, Tennessee 37402-2801

Abstract

Sequoyah Nuclear Plant (SQN) follows the guidance presented in Regulatory Guide (R.G.) 1.52, "Design, Testing, and Maintenance Criteria for Atmospheric Cleanup System Air Filtration and Adsorption System Units of Light-Water-Cooled Nuclear Power Plants" in protecting its charcoal filter trains from the effects of painting and other chemical releases. SQN, as well as other nuclear facilities around the country, have the problem of how to address the issue of protection of Engineered Safety Feature (ESF) filter systems from degradation due to communication with airborne hydrocarbons (i.e., primarily paints and solvents). R.G. 1.52 (and a similar statement from R.G. 1.140) states in part, "Testing should be performed ... following painting, fire, or chemical release in any ventilation zone communicating with the system...." and requires that a test be performed upon any kind of painting or chemical release. This is considered overly restrictive if the activity is minor and in a location remote from the charcoal filters.

Charcoal filters used in air cleaning systems are required to filter out radioactive iodine from an airstream before its release from the plant to the environment. Charcoal filters will age with time because of their ability to adsorb many different types of material. This aging affects the charcoal by lowering its iodine retention efficiency, and therefore the charcoal needs to be protected from the effects of chemicals such as paint fumes.

An integrated approach was used to determine a basis for and methods of controlling painting (and other chemical releases) for the protection of charcoal filters. The areas investigated were:

1. Test charcoal efficiency after exposure to known contaminants
2. Charcoal and its ability to adsorb contaminants
3. Other utility experience
4. Potential contaminants in paint and their release rates
5. Air change rates
6. Procedural and administrative controls

The TVA SQN testing results supported previous industry papers addressing hydrocarbon effects on charcoal. The results indicated charcoal (TVA uses TEDA and KI impregnated charcoal) can meet its required efficiencies after some exposure to hydrocarbons. Industry information indicates that charcoal may start having lowered efficiencies with as little as 5 percent, by weight, in contaminants absorbed by the charcoal. SQN has chosen 0.5 percent as its administrative limit for charcoal contaminants. The administrative controls, implemented as a result of this effort, have been well received by the plant (craft, operations, management, and engineers) and have not exposed the filters to any excessive amounts contaminants.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Background

SNQ follows the guidance presented in R.G. 1.52, "Design, Testing, and Maintenance Criteria for Atmospheric Cleanup System Air Filtration and Adsorption System Units of Light-Water-Cooled Nuclear Power Plants" in respect to the design, operation and maintenance of the installed air cleaning systems. Charcoal filters are an integral part of air cleaning systems and are used to filter radioactive iodine from an airstream before its release from the plant to the environment. Charcoal filters will age with time because of their ability to adsorb many different types of material. Additionally, contaminants such as paint fumes, cleaning solvent fumes, and sealing material offgases will damage and contaminate charcoal which lowers its iodine adsorption efficiency. This aging affects the charcoal by lowering its iodine retention efficiency, and therefore the charcoal needs to be protected from the effects of chemicals such as paint fumes. SNQ, as well as other nuclear facilities around the country, have the problem of how to address the issue of protection of Engineered Safety Feature (ESF) air cleaning and non-ESF air cleaning filter systems from degradation due to the effects of painting and other chemical releases (i.e., primarily paints and solvents). One method of addressing this problem is to strictly control painting activities in areas of the plant where such activities could jeopardize the efficiency of charcoal filters installed in air cleaning filter systems.

The NRC recognizes this ability of charcoal filters to adsorb materials and requires testing be performed when filters are exposed to chemicals. NRC R.G. 1.52 (and a similar statement from R.G. 1.140) states in part, "Testing should be performed ... following painting, fire, or chemical release in any ventilation zone communicating with the system...", and requires that a test be performed upon any kind of painting or chemical release. A strict interpretation of this statement requires that a test be performed upon any kind of painting or chemical release. This is considered overly restrictive if the activity that could release chemical fumes (i.e., painting) is minor and in a location remote from the charcoal filters. Therefore, an engineering basis is required addressing the effects of painting activities on charcoal.

SNQ has five installed filter systems that contain charcoal filters and hence the need for a process to control paints and other chemicals that may harm the installed charcoal filters. The following are descriptions of the systems affected at SNQ:

The Auxiliary Building Gas Treatment System (ABGTS) is used to filter radioactive particulates and iodine from the exhaust airstream and maintain the Auxiliary Building at a negative pressure with respect to outdoors. It is an ESF filter system in standby and only operated occasionally for testing. It performs its function following a LOCA, a fuel handling accident, and an Auxiliary Building isolation. The purpose of maintaining a negative pressure is to prevent unfiltered outleakage. The capacity of the system is 9000 CFM/train.

The Emergency Gas Treatment System (EGTS) is used to filter radioactive particulates and iodine from the exhaust airstream and maintain the Reactor Building annulus at a negative pressure with respect to outdoors. It is an ESF filter system in standby and only operated occasionally for testing. It performs its function following a LOCA. The purpose of maintaining a negative pressure is to prevent unfiltered outleakage. The capacity of the system is 4000 CFM/train.

The Containment Purge (CP) System is used to filter radioactive particulates and iodine from the exhaust airstream before it is released to the atmosphere. It is a non-ESF filter system that is operated continuously during outages and occasionally during plant power operation. It is required during purging activities while at power and during refueling operations although no credit is taken for the filters in calculations of offsite doses. The capacity of the system is 14000 cfm/train.

The Control Building air cleaning system is used to filter out radioactive particulates and iodine from the outdoor pressurizing airstream before its entry into the main control room. It is an ESF filter system in standby and only operated occasionally for testing. It is required for any event in which radioactive particulates and/or iodine can be released (i.e., Fuel Handling Accident, LOCA, and waste gas decay tank rupture). The capacity of the system is 4000 CFM/train.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The Post Accident Sampling Facility (PASF) Ventilation System is used when the sampling facility is utilized or following an accident. It is a non-ESF filter system and is operated for testing and when the sampling facility is being used. The PASF filters radioactive particulates and/or iodine from the exhaust airstream. The capacity of the system is 2000 CFM/train.

Investigation

The investigation utilized an integrated approach to providing an engineering basis. The six areas investigated were:

1. Test charcoal efficiency after exposure to known contaminants
2. Charcoal and its ability to adsorb contaminants
3. Other utility experience
4. Potential contaminants in paint and their release rates
5. Air change rates
6. Procedural and administrative controls

The purpose of the six areas is:

1. To corroborate charcoal's documented efficiency performance following exposure to contaminants
2. To determine the upper limit of contaminants charcoal can adsorb and still fulfill its safety function
3. To determine if the nuclear industry has a common approach
4. To determine the amount of contaminants which will become airborne in paint used
5. To determine minimum time required to purge areas of contaminants before operating ESF filter systems
6. To determine if existing controls are adequate

Test Charcoal Efficiency

Spare charcoal, at the plant site, was intentionally exposed to known quantities of paint to corroborate charcoal's documented efficiency performance following exposure to contaminants. The test setup consisted of a leak-tight enclosure (for the painting and sealing activities), a filter housing capable of containing one Type II charcoal adsorber tray (containing charcoal impregnated with TEDA and KI), and a fan. The test setup was interconnected with flexible ducting and the fan was equipped with a damper to adjust airflow.

The materials chosen for the testing were the two types of paint most commonly used at the plant and the RTV most commonly used at the plant. Five tests were performed with paints and two tests were performed with RTV. This charcoal was then tested in accordance with technical specifications requirements to determine the charcoal efficiency. Testing was conducted in early 1989 in accordance with ASTM D 3803-1979. Test results are contained in Table 1.

The acceptance criteria for charcoals at SQN varies from 90 percent for CP to 99.875 percent for EGTS. The test results show that the charcoal still met all acceptance criteria. The most severe test was PNT-4 using a highly volatile paint. This released approximately 8.76 lb. of volatiles onto the charcoal. Using 55 lbs. of charcoal per tray, this is a percentage of $(8.76/55) \times (100) = 15.93$ percent. Thus, the testing supports previous literature published and the present limits of the TVA procedure (1/2 of 1 percent by weight).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1 Testing Results

Test #	Material	Contaminants pounds	Charcoal pounds	Percent by Weight	Charcoal Efficiency percent
PNT 1	Low volatile paint	1.08	55	1.96	>99.9
PNT 2	Low volatile paint	2.16	55	3.93	>99.9
PNT 4	Highly volatile paint	8.76	55	15.93	>99.9
PNT 5	Low volatile paint	1.08	55	1.96	>99.9
Seal 1	RTV	0.01	55	0	>99.9
Seal 2	RTV	0.59	55	1.07	>99.9

Test PNT-3 was not performed.

The testing indicated that the charcoal met all acceptance criteria for iodine efficiency. The testing indicated that charcoal can still perform adequately after being exposed to fumes from painting and sealing activities.

Charcoal and Its ability to Adsorb Contaminants

Industry-issued papers were researched and used to determine the amount of material that a charcoal filter can adsorb and still meet its iodine efficiency requirements. Published information indicates that unimpregnated charcoal can handle approximately 6.8 percent to 11.5 percent of its weight, in contaminants, before it will fail its iodine retention test⁽⁹⁾. Other information indicates that charcoal will maintain its efficiency with contaminant loadings of 5 to 30 percent^(6, 7). The papers also indicated that water vapor in conjunction with the hydrocarbon contaminants degrades the charcoal at the highest rate⁽¹⁰⁾. It also indicated that charcoals impregnated with both TEDA and KI have the greatest resistance to the effects of water vapor and hydrocarbon contaminants⁽¹⁰⁾. SQN charcoal is purchased with both TEDA and KI. Thus, it follows that a conservative exposure level for known contaminants should be chosen at 5 percent or less by weight of the charcoal.

Other Utility Experience

Experience of utilities, other than TVA, was used in developing the direction and type of controls that are now in place at SQN. Engineers at other nuclear facilities around the country were contacted to determine how they address protecting ESF (and non-ESF) filters from contamination by hydrocarbons which are formed during painting^(1,5,11). It is interesting to note that in a 1989 survey 54 percent of the utilities contacted allowed some exposure of their charcoal filters to paint fumes before a test was required. A 1996 survey indicates that 75 percent of utilities now allow some exposure (some as much as 2500 square feet)⁽¹⁴⁾. Industry practices to protect charcoal adsorbers from contamination include the use of painting permits and coordination of use of cleaning solvents and sealing materials with the testing and running of air cleaning systems. No plant contacted allowed any intentional exposure of charcoal filters to paint or other hydrocarbon fumes. Other methods of controlling painting activities included:

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- a. Painting in tents using a portable sacrificial charcoal bed. The sacrificial charcoal was in service until the paint had cured.
- b. Run the normal ventilation system to remove paint fumes from the area prior to operation of a filter system.
- c. Allow painting and if the system is operated then test the system within the Technical Specification time limits.

Potential Contaminants in Paint and Their Release Rates

There are many different materials used at a nuclear plant. Material data sheets, supplied by the paint (or chemical) manufacturer were used to determine the amount of material that can offgas from paints as the paint cures. This information can be used to determine the level of exposure of a charcoal filter to contaminants. The materials that were evaluated were the paints and sealants that were most commonly used. The Material Safety Data Sheets (MSDS) for the most common materials used were then obtained as the amount of volatiles are shown in the MSDS. The paints and sealants used range from a high of about 60 percent volatile (8.76 pounds of solvent per gallon of paint) to a low of about 4 percent volatile (approximately 0.54 pounds of solvent per gallon of paint). The paints evaluated have short cure times, however some paints require cure times of approximately 20 hours.

Air Change Rates

Air change rates are useful in determining the time required to remove paint fumes from an area prior to operating a filter system that serves the area. Air changes are easily calculated by using building volumes and ventilation air flow rates. Air change rates for the various elevations of the auxiliary building ranged from 1.9 air changes per hour (ACH) to 6.6 ACH. The air changes for the reactor building were considerably less; however the ACH for the reactor building is moot as all ventilation air must be exhausted through the containment purge air filters.

The ACH can then be used to determine the minimum time for ventilation system operation following completion of paint curing (or other activity that releases hydrocarbons) to remove fumes. ASTM E741 - 83 can be used to determine the time frame. This ASTM standard uses the following equation ^(eq 1) to determine dilution of a gas:

$$C = C_0 \exp (-It) \quad (1)$$

where

C = fume concentration at time t
C₀ = fume concentration at time (t) = 0 percent
I = ACH, and
t = time, hrs.

Therefore to determine the time required to reduce the concentration of fumes (i.e., hydrocarbons) in the air by 95 percent, the following is calculated:

$$\begin{aligned} C &= 1.0 - 0.95 = 0.05 \\ C_0 &= 1 \text{ or } 100\% \\ I &= 1.9 \text{ ACH chosen as the most conservative value} \end{aligned}$$

solving for t renders

$$\begin{aligned} C &= C_0 \exp (-It) \\ 0.05 &= 1.00 \exp (-1.9t) \\ 1.58 \text{ hours} &= t \end{aligned}$$

For conservatism, the number is rounded to two hours and then a margin of two hours is added. This then results in a four hour run time for the ventilation system following completion of the activity.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Procedural and Administrative Controls

Procedures at the plant control activities by requiring permits for activities that can release airborne hydrocarbons into zones served by ESF (and non-ESF) air cleaning systems. Review of the earlier version of the TVA procedure, AI-29, "Aromatic and Ester Hydrocarbon Release Permit" indicated it was adequate for its intended function. The procedure prevented any activities whenever filter systems were operating or could potentially operate. This presented the plant with a multitude of scheduling and coordination problems for the smallest of activities. An example is the painting of a weld on a baseplate (approximate total area of one square foot). This activity would be required to be scheduled several weeks in advance and still may have been cancelled on the day it was scheduled. The permits are issued on a daily basis and require Operations notification prior to issuance. A 24-hour waiting period was required following any activity that released fumes prior to operating any filter system. Review of the permits indicated that the vast majority of permits issued were for areas approximately 10 square feet or less. The permit process did not allow for evaluations of the activity should a filter system be operated while a painting activity was ongoing. Other areas noted for improvement in the permit process were the need for:

- a. Clearer identification of the areas where permits were required
- b. Identification of areas outside the building that could have an effect on the filters (some filters took suction from the outside atmosphere)
- c. Identification of the vent systems operated during any activity

Results

Testing of Charcoal

Testing performed at SQN corroborated industry information on charcoals and the effects of contaminants. The tested charcoal was able to meet required efficiencies after being exposed to as much as 15.9 percent of its weight in contaminants. The tests were not all inclusive but did coincide with previous papers published.

Charcoal and Its ability to Adsorb Contaminants

Previously it was noted that a conservative level of contaminants is 5 percent by weight of charcoal. Based on a 5 percent by weight ratio, the following systems would then have the capacities indicated. Note that there is approximately 55 pounds of charcoal per charcoal tray and three trays per 1000 CFM. Each value is based on one train of equipment.

For conservatism, a safety factor of 10, below the maximum permissible level of contaminants, is used to assure that the charcoal shall not be exposed to amounts of contaminants that can degrade its performance. This accounts for normal aging and spurious system starts that may increase exposures of charcoal to contaminants. Also, with the potential questions of obtaining accurate test results using ASTM D 3803-79, the additional conservatism will help ensure that charcoal will not be exposed to excessive amounts of contaminants. Therefore, the maximum amount of documented exposure to a charcoal filter, conservatively chosen, is 0.5 percent of the weight of the charcoal.

A sample calculation to determine the amount of contaminants permitted on the PASF is:

$$\begin{aligned} \text{Procedural Limits, lbs} &= (2000 \text{ cfm}) (3 \text{ charcoal trays}/1000 \text{ cfm}) (55 \text{ lbs charcoal/tray}) (.05) (1/10) \\ &= 1.65 \text{ lbs} \end{aligned}$$

Results are contained in Table 2.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 2 Exposure Limits for Charcoal

System	Airflow CFM	Charcoal weight pounds	Maximum Amount of Contaminants pounds	Procedural Limits pounds
ABGTS	9000	1485	74	7.4
EGTS*	4000	660	33	3.3
CP	14000	2310	115	11.5
Cont. Purge	4000	660	33	3.3
PASF	2000	330	16	1.6

*Has two banks of charcoal. Calculation is based on one bank.

Other Utility Experience

The nuclear industry does have a consistent approach in that it does protect ESF charcoal filters in air cleaning systems. However, the degree of protection varies with the utility as seen by the fact that utilities will allow exposure of filters to fumes (some areas as much as 2500 square feet). Incorporated into the procedure is an allowance of up to 10 square feet of area which can be painted (or equivalent area for solvents or other chemicals) without the need for a permit. This is a consistent approach with other utilities in that a small amount of exposure (fumes equivalent to 10 square feet of painted surface area) does not automatically require an efficiency test be performed. Determination of this value (10 square feet) was based on an evaluation of the square foot areas designated on permits issued prior to this allowance. Another feature incorporated into the procedure is use of a tent with a sacrificial bed of charcoal. Painting or other activities are performed inside the tent. Air is exhausted from the tent and passed through the sacrificial charcoal filter to remove contaminants.

Potential Contaminants in Paint and Their Release Rates

It has been previously stated that 20 hours is required to cure paints. Many of the paints used cure in a time frame less than the 20 hours. Solvents evaporate immediately (i.e., in a few minutes) and would be removed from the area by the ventilation system. With the weight of solvents known, conservatively assuming that all solvents are released from the paints, and knowing the coverage area of the paints Table 3, "Permissible Level of Contaminants" is developed. The table shows the relationship between the maximum allowable contaminants and surface area for paints and sealants and the volume for solvents. The paint weights are based on weight of volatiles offgassed from paints. Sealants are taken to be the same as low volatile paints.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

TABLE 3 Permissible Level of Contaminants

System	Maximum Amount of Contaminants pounds	Maximum Area for Painting Highly volatile Paints, FT ² Note 1	Maximum Area for Painting Low Volatile Paints, ft ² Note 2	Maximum amount of solvent gallons Note 3
ABGTS	7.4	125	685	0.9
EGTS	3.3	55	300	0.4
CP	11.5	200	1050	1.4
Cont. Bldg	3.3	55	300	0.4
PASF	1.6	28	150	0.2

Note 1. Area = (lb. contaminants/8.76 lb/gal) (150 ft²/gal)

Note 2. Area = (lb. contaminants/0.54 lb/gal) (50 ft²/gal)

Note 3. Volume = (lb. contaminants/8 lb/gal)

Air Change Rates

The minimum time to run the Auxiliary Building ventilation is 24 hours. The 24 hours is based on 20 hours for the majority of hydrocarbons to offgas (95 percent) and 4 hours to purge the building. The minimum time to run the ventilation system for solvents is 4 hours after use of the solvent has been discontinued; however for simplicity, the air cleaning systems are not run for 24 hours following any activity. If the system is operated, an evaluation of the effects of the activity is required.

Procedural and Administrative Controls

The improvements in the administrative controls implemented in the work control process are:

- a. allowing up to 10 square feet of surface to be painted, cleaned, or weld inspected without the use of a permit
- b. clearly identifying areas that require permits for the protection of filters
- c. requiring an evaluation of the effects of the activity should a filter system be operated during the performance of that activity
- d. requiring that an exposure log be kept to record the cumulative amount of exposure for each system
- e. defined the use of tents for controlling activities that may release hydrocarbons
- f. establishing limits for exposure of the filters
- g. integrating Operators in the permit process

Filters are never intentionally exposed to hydrocarbon fumes. Activities are scheduled to operate systems at times when painting or other hydrocarbon releasing activities have ceased. For exposures above the acceptable levels, the unit (charcoal) will be tested, and any further exposure will be prevented or require additional charcoal tests. Prior to making the procedural changes, SQN was issuing approximately 900 permits a year. The number of permits issued per year has dropped to less than 100. An exception to never intentionally exposing filters to contaminants is the Containment Purge system. This system operates during refueling outages to ventilate containment. There is no practical way to protect the filters, and as a result, charcoal tests are scheduled following the outage. The current permit in use at SQN is contained in Attachment 1.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Conclusions

The TVA Sequoyah testing results supported previous industry papers addressing hydrocarbon effects on charcoal. The results indicated charcoal can meet its required efficiencies after exposure to hydrocarbons. Industry information indicates that charcoal may start having lowered efficiencies with as little as 5 percent, by weight, in contaminants absorbed by the charcoal. SQN has chosen 0.5 percent as its administrative limit for charcoal contaminants. The administrative controls, implemented as a result of this effort, have been well received by the plant (craft, operations, management, and engineers) and has not allowed any excessive exposures of contaminants with the filters.

References

1. Sequoyah Nuclear Plant Condition Adverse to Quality Report, CAQR SOP890064, Revision 0.
2. Administrative Instruction AI-29, "Aromatic and Ester Hydrocarbon Release Permit" (replaced by Site Standard Practice SSP-7.4, "Work Permits")
3. Regulatory Guide 1.52, "Design, Testing, and Maintenance Criteria for Atmospheric Cleanup System Air Filtration and Adsorption System Units of Light-Water-Cooled Nuclear Power Plants"
4. Regulatory Guide 1.140, "Design, Maintenance, and Testing Criteria for Normal Exhaust System Air Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power Plants"
5. "Diablo Canyon Power Plant Guidelines for Protection of Carbon Filters" by Ginter, W., paper submitted at the 19th DOE/NRC Nuclear Air Cleaning Conference.
6. "Manufacture, Structure, Properties, and Application in the Nuclear Industry A Presentation for ASTM-D33," April 1986, Aimsforth, D., Sutcliffe Speakman, Inc. Carbon has a capacity of 5 percent-30 percent weight before being exhausted (and therefore failing its test).
7. "Evaluation and Control of Poisoning of Impregnated Carbons Used for Organic Iodide Removal" by Kovach, J. L., and Rankovic, L., paper submitted at the 15th DOE Nuclear Air Cleaning Conference. One case of failed charcoal due to 5 percent by weight of organics present. Testing indicated charcoal can hold up to 260 mg/g (26 percent) organics and still pass testing.
8. Sequoyah Nuclear Plant Site Standard Practice (SSP) 7.4, "Work Permits"
9. KFK 2449 "Iodine Filters in Nuclear Power Stations," Wilhelm, J. G., April 1977. This report indicated that iodine efficiencies were lowered drastically with solvent loadings varying from 6.8 percent to 11.5 percent. The paper noted that impregnated charcoal maintains higher efficiencies when exposed to solvent vapors than does unimpregnated charcoal.
10. "Charcoal Performance Under Accident Conditions in Light-Water Reactors," NUREG/CR-3990 (NRL Memo Rpt 5528), March 1985. This report indicates that charcoal impregnated with TEDA and KI exhibit less penetration than other charcoals. This report also indicates the adverse synergistic effect of high moisture and hydrocarbon contaminants degrading the charcoal when exposed at the same time.
11. David Besse, Procedure ISG-15, Rev. 1. Procedure allows 50 ft² exposure. There must be three air changes before system runs.
12. ASTM E 741-83 "Standard Test Method for Determining Air Leakage Rate By Tracer Dilution"

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

13. Sequoyah Nuclear Plant Technical Specifications, T.S. 3.6.1.8, EGTS; 3.7.7, CREVS; 3.7.8 and 3.9.12, ABGTS
14. LIS Survey Regarding Charcoal Filters (#96077), June 10, 1996

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Attachment 1

SQN	WORK PERMITS	SSP-7.4 Rev 6 Page 18 of 25
-----	--------------	-----------------------------------

APPENDIX C
Page 1 of 7

**PAINTING, CLEANING, SEALING, AND OTHER VOLATILE
HYDROCARBON USE PERMIT [C.3]**

**Permit Number # _____
 **ISSUED BY _____ / _____ / _____ **Vent. System Affected _____
 Tech Support Date Time

NOTE: This permit is valid only for the date and location shown. The original permit is to remain with the work package. A copy of every permit is to be sent to Tech Support for exposure log entries after SOS signoff.

UNIT WORK LOCATION (BUILDING) _____ (ELEVATION) _____

Brief Description of Work: _____

Material: _____

***This permit starts: _____	*Volume of solvent used or area painted. Estimated _____ Actual _____
***This permit expires: _____	<input type="checkbox"/> Solvent <input type="checkbox"/> Sealant <input type="checkbox"/> Paint

Affected ventilation system operated during time this permit was in effect. YES NO
 If system operated, evaluation by System Engineer; otherwise, N/A.

_____/_____/_____
SOS or Designee Date System Engineer Date Evaluation Attached

NOTE: Touch up painting (less than 10 square feet) or weld inspections do not require a permit.

YES NO CERTIFICATION

_____/_____/_____
All material which may constitute a fire hazard has been removed from the area or adequately protected. Transient fire loads have been evaluated by Fire Operations and specified controls initiated per SSP-12.15, Appendix E. All firefighting equipment is available as required by the program for control of ignition sources and I have instructed my men on how a fire is to be reported.

_____/_____/_____
As the Foreman (supervisor), I recognize that work areas will require reinspection for fumes which may constitute a hazard and I will personally reinspect the area at least once during the shift for which this permit is valid.

_____/_____/_____
Responsible Foreman or Supervisor (Signed & Printed) Date

NOTE ONLY one permit is needed if using a tent. No exposure is assumed to occur to charcoal filters if a tent is used. The use of a tent still requires a permit.

- * Not required if enclosures and portable charcoal filters are used.
 - ** Completed by Tech Support. (See Table C-1)
 - *** The permit will be valid for one job at one location. It shall be valid for one day, three working shifts. Permits can be obtained up to three days in advance. (Exception see note)
- Posting Requirements: Retain with work document during and following work.

DISCUSSION

BARROW: Did you perform a D3803-89 test?

CAMPBELL: The test conditions are 80°C and 70% RH. 70% RH is used as we have humidity control. This is in accordance with the plant technical specifications.

GOLDEN: Prior to implementing this program did you have any failures of your charcoal system test that were directly attributed to painting?

CAMPBELL: No, we did not, but our management is conservative in some of their evaluations. We have had some events from exposure to welding fumes and we have had some small electrical equipment catch fire while running the systems. In each case, we would pull a sample. We would change out the charcoal but we would pull a sample on the charcoal that we were changing out and each time the charcoal that we discarded still passed our Tech. Spec. Test. So, we have not had any failures. The only reasons that we have replaced charcoal in the past eight years, that I know of, is because of permanent sets in the gaskets that prevent us from replacing the tray after we pull the charcoal sample. We cannot pass our bypass leakage test then we change out all the charcoal in the system to maintain the same lot number in the entire system.

ROBERSON: Does the "less than 10" non-permit criterion mean that these fume exposures are not cumulatively tracked?

CAMPBELL: One of the reasons that we chose 10 ft² is because of the 0.5% by weight that we allow on our filter systems. Because we are not controlling below 10 ft², there can be exposures that occur without knowing it. So we chose an order of magnitude below what has previously been published regarding charcoal failure to allow us a margin so that we will not have to worry whether or not we should test our charcoal. Also, we have looked at the run times when this has happened and we have an ability to call up run times on all our filter systems on our plant computer. If systems have run spuriously, it will be only for 15-30 min., rarely longer than an hour. That does not always happen with containment isolation so there are factors that go into whether or not the systems are exposed. In addition to choosing 10 ft² we looked at number of square feet that were allowed on previous permits and the vast majority were for 3 - 4 ft². We also talked to our maintenance department and our chemistry people. The result was that we chose 10 ft² as a reasonable value. It has been very well received.

ROBERSON: Does the paint accumulation log only update based on the system being in service?

CAMPBELL: Yes. The systems have isolation dampers and exposure can only occur when the system is running.

HARRIS: We have a painting program in which we track the volatile organic content of each of the coatings and adhesives on the filter beds. We have noticed that even when relying on only 10 ft² to be painted, very few coatings come out without a one gallon kit, or a five gallon kit. If that paint is still in the ventilation zone, do you still assume that the volatiles are coming out and tracking it on your charcoal loading as well?

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CAMPBELL: This is a good question. What we have implemented at in our Sequoia plants is a chemical control. Again, our Rad Con people will not allow anyone to take anything into the RCA's unless they are going to use that material. So we have controls over what is taken in. If they say they intend to paint a hundred square feet but when they give the permits back to us they report only painted ten square feet, the instructions given to our maintenance people is to show the total volume of paint they took in. We then consider making an adjustment, but as a rule, we do not. What you take in you use up because what is left is rad waste. There is no way you can really prove that it is not.

GOLDEN: You said you did your testing to the 1979 or 1980 standard. I assume, because that is what your Tech Specs called for, the 80°C test. Did you also do any parallel testing to the 1989 standard or anything more stringent like a 30°C test?

CAMPBELL: No. The testing we did was several years ago, and the ASTM 89 version was not available at that time. I was aware of the controversy around 1979 and that is another reason why we chose an order of magnitude less than what the lowest recorded values were. At every step along the way we tried to be conservative in what we were doing but maintain some flexibility. We did not have any flexibility to begin with, but we wanted something reasonable that we would not have to come back and change again in three or four years. Knowing the controversies, we tried to stay very conservative on what we are doing.

CASS: Did you considered different methods of application, roller, brush, or spray? Did you take in preparation; sandblasting, grinding, what have you?

CAMPBELL: No, we did not look at different application methods. As far as grinding or chipping away the paint, that is dust and we did not consider it.

GHOSH: Did you consider the drying time of the solvent? The solvent time varies exponentially, between two and four hours during which time most of the solvent may be reduced from 100 to 50%. In four hours it may go to 10 or 5%. Using that method, did you check how much loading is taken back from the carbons?

CAMPBELL: No, we did not check into that. The way we are looking at it is that the paints will cure exponentially. Most of the offgases will occur during the first hour and then it will decrease. We look at the run times at the end of the painting activity and we assume the paint is totally cured according to what the vendors tell us on the paint. At that point, everything that is going to offgas should have offgassed. We assume 100% for the purpose of calculating run time. We say 100% is still in the area and we run four more hours. In reality, the stuff is going to be removed continuously, it is going to be less and less over a period of time and probably at the time the paint cures there is probably very, very little fume in the area.

GHOSH: Yes, 24 hours is very safe.

CAMPBELL: Definitely. It is an easy value to remember.

GHOSH: One more thing, you use 10 square feet. Did you equate it in terms of limiting the amount in terms of gallons? That is what we did.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CAMPBELL: Yes we have, but that is not covered in the paper. We did equate it when we were talking to our maintenance people. We asked what do you want, and they said square feet. We looked at high and low volatile paints (we considered sealants the same as low volatile paints) and we agreed that 10 square feet was acceptable based on the paints we use at the plant.

GHOSH: It varies with how much thickness, how many mills.

CAMPBELL: It depends on the thickness. It doesn't show in the paper, but a low volatile paint that we use is a Keylor and Long 4500 paint, for example, that will cover 64 square feet per gallon, we say it will cover 50 square feet rather than the recommended 64 square feet and we base our calculations on that number.

SESSION 10

**IODINE TREATMENT: CHEMICAL OPERATIONS
AND REACTOR ACCIDENT SCENARIOS**

Wednesday July 17, 1996

Co-Chairmen: R.T. Jubin
T. Fukasawa

**BEHAVIOR OF IODINE IN THE DISSOLUTION OF SPENT NUCLEAR
FUELS**

T. Sakurai, K. Komatsu, and A. Takahashi

**INFLUENCES OF IMPURITIES ON IODINE REMOVAL EFFICIENCY
OF SILVER ALUMINA ADSORBENT**

T. Fukasawa, K. Funabashi, and Y. Kondo

**DIFFUSIONAL ANALYSIS OF THE ADSORPTION OF METHYL
IODIDE ON SILVER EXCHANGED MORDENITE**

R.T. Jubin and R.M. Counce

**REMOVAL EFFICIENCY OF SILVER IMPREGNATED FILTER
MATERIALS AND PERFORMANCE OF IODINE FILTERS IN THE
OFF-GASES OF THE KARLSRUHE REPROCESSING PLANT WAK**

F.J. Herrmann, B. Herrmann, V. Hoeflich, Ch. Beyer, and J. Furrer

**CONTROL OF RADIO-IODINE AT THE GERMAN REPROCESSING
PLANT WAK DURING OPERATION AND AFTER SHUT DOWN**

F.J. Herrmann, B. Herrmann, K.D. Kuhn, A. van Schoor, M. Weishaupt, J.
Furrer, and W. Knoch

OPENING COMMENTS OF SESSION CHAIRMAN

We have an important subject to discuss. This is a series of presentations on the treatment of iodine for the nuclear industry. It has been one of the mainstays of Air Cleaning Conferences in the past. A great deal of work has been reported in this area and we have five important papers that will contribute to the overall collection of literature on this subject.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

BEHAVIOR OF IODINE IN THE DISSOLUTION OF SPENT NUCLEAR FUELS

by

Tsutomu Sakurai, Kazunori Komatsu, and Akira Takahashi
Physical Chemistry Laboratory
Japan Atomic Energy Research Institute
Tokai-mura, Ibaraki-ken, 319-11, Japan

Abstract

The results of laboratory-scale experiments concerning the behavior of iodine in the dissolution of spent nuclear fuels, which were carried out at the Japan Atomic Energy Research Institute, are summarized. Based on previous and new experimental results, the difference in quantity of residual iodine in the fuel solution between laboratory-scale experiments and reprocessing plants is discussed. Iodine in spent fuels is converted to the following four states: (1) oxidation into I_2 by nitric acid, (2) oxidation into I_2 by nitrous acid generated in the dissolution, (3) formation of a colloid of insoluble iodides such as AgI and PdI_2 , and (4) deposition on insoluble residue. Nitrous acid controls the amount of colloid formed. As a result, up to 10% of iodine in spent fuels is retained in the fuel solution, up to 3% is deposited on insoluble residue, and the balance volatilizes to the off-gas. Contrary to earlier belief, when the dissolution is carried out in 3 to 4 M HNO_3 at $100^\circ C$, the main iodine species in a fuel solution is a colloid, not iodate. Immediately after its formation, the colloid is unstable and decomposes partially in the hot nitric acid solution through the following reaction:



For high concentrations of gaseous iodine, $I_2(g)$, and NO_2 , this reaction is reversed towards formation of the colloid (AgI). Since these concentrations are high near the liquid surface of a plant-scale dissolver, there is a possibility that the colloid is formed there through this reversal. Simulations performed in laboratory-scale experiments demonstrated this reversal. This phenomenon can be one reason the quantity of residual iodine in spent fuels is higher in reprocessing plants than in laboratory-scale experiments.

I. Introduction

Long-lived ($T_{1/2} = 1.57 \times 10^7$ y) and hazardous, radioiodine, ^{129}I , generated in the dissolution of spent nuclear fuels should be strictly controlled in reprocessing facilities. For gaseous iodine, various kinds of silver-impregnated adsorbents have been developed to very efficiently remove it from the off-gas. Therefore, it is desirable for environmental safety that all possible iodine be expelled from fuel solutions to the dissolver off-gas (DOG) where it will be fixed on an adsorbent such as silver-impregnated silica gel (AgS). The remaining iodine, that not expelled to the DOG, migrates into the Purex process which allows its escape to the environment. Therefore, understanding the chemical species and amounts of iodine in fuel solutions as well as developing a way of expelling it therefrom are important. Extensive work has been performed by many researchers.⁽¹⁾⁻⁽³⁾

Before our research, the main iodine species in fuel solutions was postulated to be iodate (IO_3^-) from the chemical reaction of iodine in

hot nitric acid solution or uranium-nitric acid solution or both. Sparging with NO_x has been recommended for iodate removal from these solutions. More than 99% of input iodine was expelled to the DOG in both laboratory- and plant-scale experiments.^{(1).(2).(4)} According to the reports from an actual reprocessing plant, however, considerable amounts of iodine (up to 5%) remained in spent-fuel solutions and migrated to the Purex process.^{(5).(6)} Although the causes were not clarified, this finding suggests the presence of other iodine species in spent-fuel solutions and/or the presence of some factors that influence the behavior of iodine between laboratory-scale experiments and actual reprocessing plants.

Japan has been constructing a commercial reprocessing plant having a throughput of 800 t/d. Since the release of ¹²⁹I into the environment is strictly regulated, we began to restudy the iodine species in spent-fuel solutions and the methods of expelling this iodine to the DOG. In beginning this study, we labeled other fission products (FPs) in spent-fuel solutions. The interactions of iodine with other FPs were examined for the first time with simulated spent-fuel solutions. These interactions had not been questioned by earlier researchers. It was found that colloids of such insoluble iodides as silver iodide (AgI) and palladium iodide (PdI₂) played an important role in the behavior of iodine in the dissolution stage.

This paper first summarizes the results of our laboratory-scale experiments. The difference in behavior of iodine in the dissolution stage between laboratory-scale experiments and the dissolution process that occurs in reprocessing plants is then discussed.

II. Main Iodine Species in Spent-Fuel Solutions

2.1 Preliminary Study with a Simulated Spent-Fuel Solution

To obtain preliminary information about iodine species in spent-fuel solutions, experiments were performed using a uranyl nitrate-nitric acid solution and a simulated spent-fuel solution that contained uranium and simulated FPs equivalent in composition to a solution of spent fuel with a burnup of 40 GWd/t. Varying amounts of potassium iodide labeled with ¹³¹I were added to these solutions (30 to 50 ml) at 100°C and the iodine species produced were analyzed using the carbon tetrachloride extraction method. This analysis determined the quantities of dissolved iodine (I₂(aq)), I⁻, IO₃⁻, and organic iodine using an analytical scheme and considered the remaining species in the aqueous phase as non-ionic submicroparticles.⁽⁷⁾ The following results were obtained concerning the main iodine species in the solutions.^{(8).(9)}

(1) The main iodine species in the simulated spent-fuel solution was submicroparticles, while iodate was the main species in uranium-nitric acid solution.

(2) The quantity of iodine in the submicroparticles increased with increasing concentrations of Ag⁺ and Pd²⁺. When heated in 3 to 4 M HNO₃, the submicroparticles released molecular iodine (I₂).



(3) When the simulated spent-fuel solution containing the submicroparticles was subjected to ultracentrifugation of 65,000 rpm, a decrease of ¹³¹I radioactivity was observed in the upper portion of the solution.

(4) A thermochemical calculation indicated that iodate cannot be the main iodine species because it is reduced to I₂ by NO_x produced in dissolution of fuels.⁽⁹⁾



24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

From these results, it was concluded that the submicroparticles, the main iodine species, were colloids of AgI and PdI₂. The measured solubilities of these iodides also supports this conclusion.⁽¹⁰⁾


The colloidal iodine is unstable in hot nitric acid solution immediately after its formation so it decomposes into molecular iodine:



Concurrently with this process, however, the remaining colloidal iodine ages and changes to stable species. For decomposition of the stabilized colloidal iodine, it was found that the addition of an excess amount of iodate (e.g., HIO₃) was effective:



These reactions are illustrated in Fig. 1 and essentially refer to the following reaction:



where the asterisk denotes radioactive iodine, ¹²⁹I. Based on these results, the following two-step process for expulsion of the iodine remaining in spent-fuel solutions was proposed.^{(10),(11)}


Step One - Heat the fuel solution without supplying NO_x to decompose the colloidal iodine. When aging of colloidal iodine has proceeded after dissolution, an excess amount of iodate should be added.

Step Two - Sparge (bubble) NO_x through the solution while heating to reduce the iodate(¹²⁹IO₃⁻) to form volatile I₂. This process is necessary because there is a possibility of formation of the iodate during Step One.

The same process was proposed by Boukis and Henrich for decomposition of non-volatile organic iodides that originated from organic impurities in nitric acid.⁽¹²⁾ In our experiments, however, the amounts of organic impurities were negligibly small.

2.2 Demonstration of the Main Iodine Species Using Actual Spent-Fuel Solutions

Expulsion of iodine from solutions of spent PWR-fuel with burnups of 21 to 39 Gwd/t was performed to identify the main iodine species in actual spent-fuel solutions. Two procedures were used and their efficiencies were compared.^{(8),(9)} One procedure was conventional NO_x sparging to reduce iodate to volatile iodine (I₂) through the following reaction:



The other procedure was as described above, viz., the addition of iodate to decompose colloidal iodine through Reactions (3) and (4). This process was also applied to the solution subjected to the NO_x sparging to determine the amount of iodine remaining after NO_x sparging.

The results showed that, while 27.4 to 45.7% of the initial iodine quantity in the solutions remained after NO_x sparging, the iodine was completely removed by the process of adding iodate. This clearly indicates that the main iodine species in actual spent-fuel solutions is colloidal iodine, not iodate.

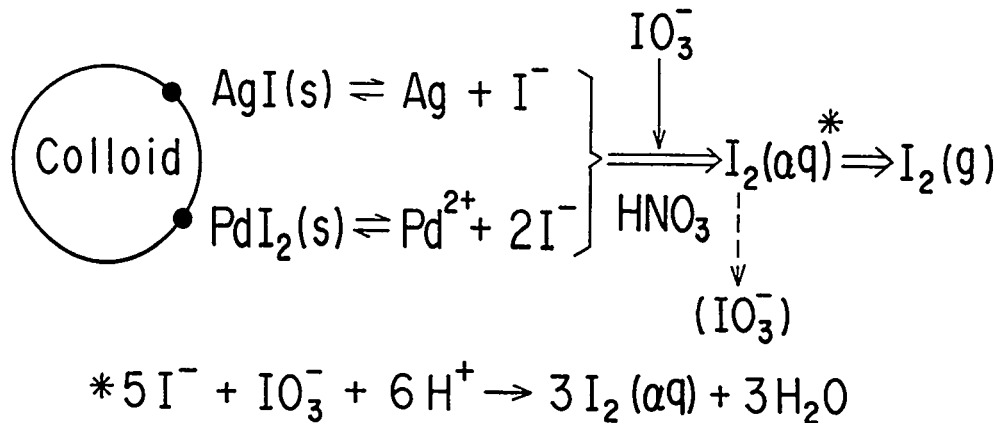


Figure 1 Mechanism for decomposition of colloids of AgI and PdI₂ by addition of iodate

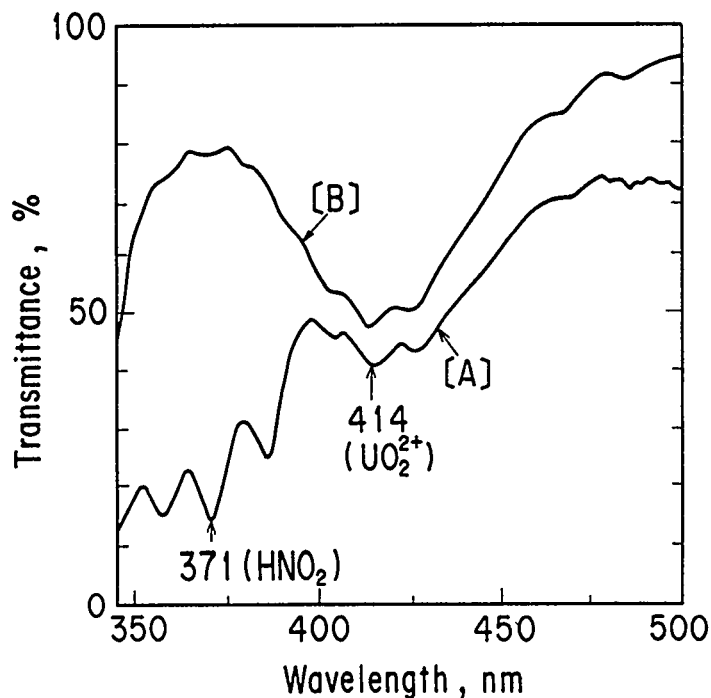


Figure 2 Influence of the dissolution rate of UO₂ on the concentration of HNO₂ produced during UO₂ dissolution in 3.5 M HNO₃ at 100°C
 Production of HNO₂ was observed spectrophotometrically. Dissolution rate was [A] about 2 min for 0.909 g UO₂ powder and [B] 2.5 h for a 0.9321 g UO₂ pellet.



24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

III. Distribution of Iodine in Spent-Fuel Dissolution


In the dissolution of spent fuels in laboratory-scale experiments, radioiodine in spent fuels (assumed as CsI) was distributed among the off-gas, fuel solution, and insoluble residue as follows.⁽¹¹⁾

3.1 Volatilization into DOG

The majority of the iodine (90% or more) was expelled to the off-gas through its oxidation by HNO₃ and by the nitrous acid (HNO₂) produced in the dissolution (Figure 2):



The dissolved iodine, I₂(aq), then volatilizes and is expelled to the off-gas, leaving a small fraction as iodate in solution:




Since the iodate is reduced to I₂ by the NO_x and HNO₂ produced in fuel dissolution, only small quantities of iodate can be produced in fuel dissolution occurring in 3 to 4 M HNO₃.

Of the iodine volatilized to the off-gas, 7% or less consisted of organic iodides, which were probably produced through the reactions of I⁻ or I₂ or both with organic impurities in the fuel solutions.⁽⁹⁾

3.2 Retention of Iodine Species in Spent-Fuel Solutions

Besides I₂ and a small amount of IO₃⁻, colloidal iodine is produced in spent-fuel dissolution by the following reaction:



Since this reaction competes with Reaction (8), the amount of colloids produced decreased for high dissolution rates, even with high burnup fuels.⁽¹¹⁾ This occurs because high dissolution rates result in high concentrations of NO_x and HNO₂. On the other hand, when the concentrations of NO_x and HNO₂ are too high, secondary formation of colloidal iodine may result. In high concentrations, NO_x and HNO₂ react with the iodine produced in Reactions (7) and (8) reversing Reaction (1) and forming AgI. Details are discussed below.

In experiments with simulated spent-fuel solutions, the iodine species in the solutions consisted of 60% colloidal iodine, 20% I₂, and 20% iodate.

3.3 Deposition onto Insoluble Residue or to a Precipitate or both

Part of the iodine in spent fuels is transferred to insoluble residue or to a precipitate or both via formation of colloidal iodine. Of the iodine in spent PWR-fuels, 3% or less was deposited onto insoluble residue.⁽¹⁰⁾

In dissolution of simulated spent-fuel pellets, an increase in UO₂²⁺ concentration in the solution beyond 170 g U/ℓ resulted in the precipitation of large quantities of metal molybdates on which iodine was deposited.⁽¹³⁾ The causes have not yet been clarified.

The behavior of iodine in the present laboratory-scale dissolution at JAERI (the Japan Atomic Energy Research Institute) with the results earlier researchers have reported is summarized in Fig. 3. The differences noted are partially attributed to differences in the concentration of nitric acid used.


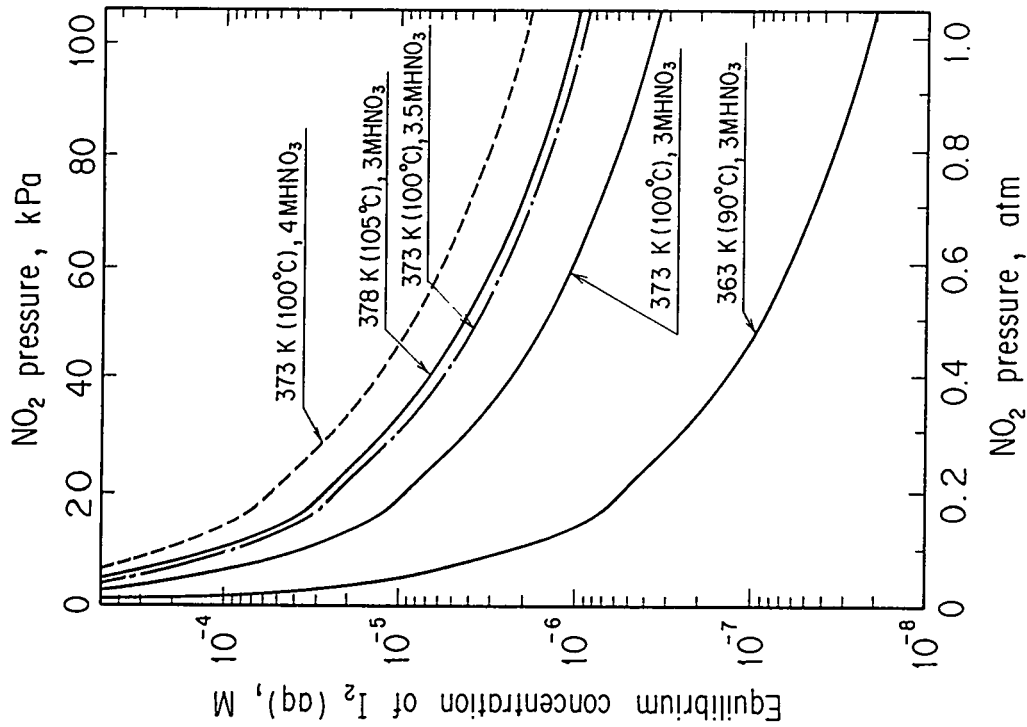


Figure 4 Relationship between dissolved iodine, $I_2(aq)$, and NO_2 in the chemical equilibrium, $AgI(s) + 2H^+ + NO_3^- = \frac{1}{2}I_2(aq) + Ag^+ + NO_2(g) + H_2O(l)$. Concentration of Ag^+ was assumed to be $2.37 \times 10^{-4} M$ for a spent-fuel solution with a burnup of 40 GWD/t.

A) Earlier studies^{(4), (12)}

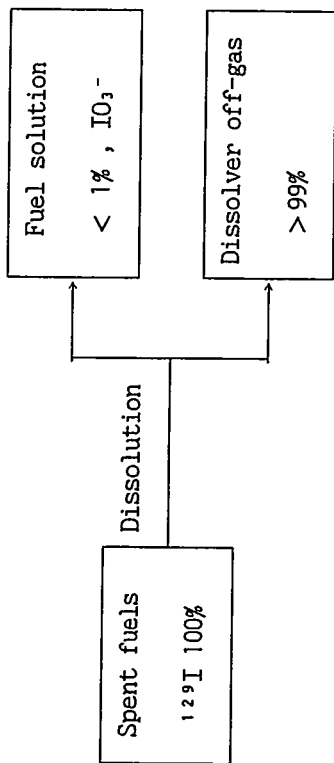

B) Present studies at JAERI

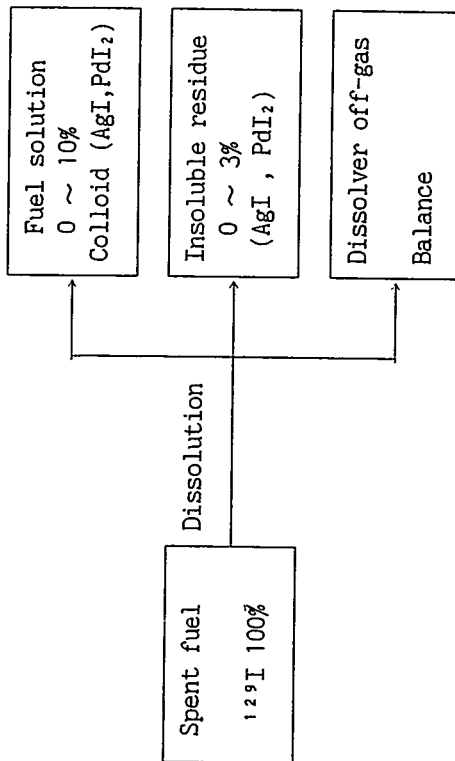


Figure 3 Distribution of iodine (^{129}I) from dissolution of spent fuels in laboratory-scale experiments

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1 Comparison of the amount of iodine in spent-fuel solutions

Scale	Literature	Burnup of fuel, GWd/t	Wt. of fuel dissolved	¹²⁹ I in the fuel solution, %	Conditions of the dissolution
Laboratory	N. Boukis and E. Henrich (1991) ^(1,2)	45	80 g	0.7	7.5 M HNO ₃ (0.22 ℓ), 97°C, 2h
	A. Leudet et al., (1983) ⁽⁴⁾	32	Half of a fuel pin	< 1	Boiling
Plant	F. J. Herrmann et al., (1993) ⁽⁵⁾		15 ~20t/y (WAK plant)	≤ 5	

Table 2 Calculation for secondary formation of colloid(AgI) at the liquid surface of an assumed plant-scale dissolver

Conditions of the dissolver: Size, 5 × 0.3 × 2 m;
 Liquid surface, 1.5 × 10⁴ cm² ; 3.5 M HNO₃ 3 m³(100°C);
 Bottom air supply, 40 Nm³/h;
 Throughput of spent fuels, 5 t/d (burnup 40 GWd/t).

Concentrations at the liquid surface	Chemical equilibrium concerned	Equilibrium concentration of I ₂ (aq)	
I ₂ (g) 88 ppm	I ₂ (g) = I ₂ (aq)	2.3 × 10 ⁻⁵ M ... (a)	Since (a) > (b), AgI will be formed.
NO ₂ 36%	AgI(S) + 2 HNO ₃ (aq) = 1/2 I ₂ (aq) + AgNO ₃ (aq) + NO ₂ (g) + H ₂ O(l)	7.2 × 10 ⁻⁶ M ... (b)	

IV. Iodine Behavior Differences between Laboratory-Scale Experiments and Reprocessing Plants

Table 1 cites an instance where the quantity of iodine remaining in a spent-fuel solution is greater in a reprocessing plant than in several laboratory-scale experiments. While laboratory-scale dissolution of high burnup fuels left only 1% or less of the iodine in spent-fuel, up to 5% of the iodine remained in spent-fuel solutions at the WAK reprocessing plant. Several factors may cause this difference. Through our studies, however, we noted the possibility that colloidal iodine (AgI) is formed secondarily at the liquid surface of a plant-scale dissolver. The reasons are discussed below.

4.1 Chemical Equilibrium

As already described, colloidal iodine is partially decomposed in hot nitric acid solution through Reactions (1) and (2). However, Reaction (1) can be reversed near the liquid-gas interface of a plant-scale dissolver. The liquid surface may have high concentrations of $I_2(g)$ and NO_2 because bubbles containing these gasses rise through the liquid after formation. When dissolution of fuel proceeds continuously at a constant rate, the concentrations of $I_2(g)$, $I_2(aq)$, NO_2 , Ag^+ , and HNO_3 remain constant with time at the liquid surface. This condition is regarded as a state of quasi equilibrium among these species; thus, an approximate chemical equilibrium treatment is appropriate for the system. Figure 4 shows the chemical equilibrium relationships of Reaction (1), in which the abscissa denotes NO_2 pressure and the ordinate represents the corresponding concentration of dissolved iodine, $I_2(aq)$. These relationships were derived from the following commonly accepted set of thermochemical equations:⁽¹⁴⁾

$$\ln (K(T_2)/K(T_1)) = \int_{T_1}^{T_2} (\Delta H_T^\circ / RT^2) dT, \quad (a)$$

$$H_T^\circ = H_{T_1}^\circ + \int_{T_1}^T \Delta C_p dT, \quad (b)$$


$$C_p = A + B 10^{-3} + C 10^5 T^{-2} + D 10^{-6} T^2, \quad (c)$$

where H_T° is the standard enthalpy of formation at T K, C_p is the heat capacity, and A, B, C, and D are constants specific to each substance. The equilibrium constant $K(T_1) = 298$ K; H_{298}° and C_p were adopted from the literature.⁽¹⁵⁾⁻⁽¹⁷⁾

In a fuel solution, when the concentration of $I_2(aq)$ increases beyond the curve corresponding to its temperature and HNO_3 concentration under a specific value of P_{NO_2} , colloidal AgI is formed through the reversal of Reaction (1). By assuming a simplified continuous dissolver, the concentrations of NO_2 and I_2 near the liquid surface were estimated (see below).

4.2 Concentrations of NO_2 and I_2 in a Plant-Scale Dissolver

The assumed dissolver, similar to a continuous dissolver in a reprocessing plant described in the literature,^{(2),(3)} is $5 \times 0.3 \times 2$ m with a liquid-gas interface of 1.5×10^4 cm². To stir the solution in this dissolver, 40 Nm³/h of air is fed from the bottom. Spent fuels with a burnup of 40 GWd/t are dissolved at a rate of 5 t/d in 3 m³ of 3.5 M HNO_3 at 100°C. The NO_x produced consists of 80% NO_2 and 20% NO for the chemical equilibrium



at 100°C. Fuel solution containing 250 g U/ℓ overflows toward downstream processes. Calculations indicate that gaseous iodine, $I_2(g)$,

and NO_2 volatilize at rates of 4.1×10^{-3} mol I_2/min and 16.6 mol NO_2/min , respectively. The bottom fed air increasingly collects these gasses as it rises through the solution. At the liquid surface, the air consists of 35.8% (0.358 atm) of NO_2 and 88.4 ppm of $\text{I}_2(g)$. The concentration of dissolved iodine, $\text{I}_2(aq)$, corresponding to 88.4 ppm $\text{I}_2(g)$, was calculated to be 2.3×10^{-5} M using the equilibrium constant

$$K(373) = P_{\text{I}_2} / [\text{I}_2(aq)] = 3.798$$

of Reaction (9) where P_{I_2} is in atm. Figure 4 shows that the concentration of $\text{I}_2(aq)$ (in 3.5 M HNO_3) in equilibrium with 0.358 atm NO_2 (36 kPa) is 7.2×10^{-6} M, which is lower than the foregoing value (2.3×10^{-5}) in equilibrium with 88.4 ppm $\text{I}_2(g)$. This excess $\text{I}_2(aq)$ causes the reversal of Reaction (1) and the secondary formation of colloids of AgI at the liquid surface of the plant-scale dissolver (Table 2).

4.3 Experiments to Reverse Reaction (1)

To verify the progression of the reversal of Reaction (1) under conditions similar to those at the liquid surface of the assumed dissolver, laboratory-scale experiments were performed using the apparatus shown in Fig. 5. A 30 ml volume of 3.5 M HNO_3 solution containing 7.5 g U/30 ml (250 g U/l) and 0.8 mg Ag^+ /30 ml was heated to 100°C and bubbled with nitrogen flow (22 ml/min) containing 88 ppm $\text{I}_2(g)$ labeled with ^{131}I and 36% NO_2 for 1 h (Run 1). After its radioactivity was measured, 20 ml of the solution was transferred to a centrifuge tube (solution depth, 4 cm) and subjected to centrifugation of 4,500 rpm for 5 min. The top 10 ml was then examined by gamma spectrometry. Table 3 lists the results. The radioactivity of the solution decreased to 8% of the initial value and a whitish yellow sediment was observed on the bottom of the centrifuge tube. This confirmed that supplying 88 ppm $\text{I}_2(g)$ and 36% NO_2 produced a colloid of AgI at 100°C ; that is, Reaction (1) was reversed. In Run 2, also listed in Table 3, a higher concentration of $\text{I}_2(l)$ (263 ppm) and 38% NO_2 was fed to 30 ml of 3.5 M HNO_3 solution containing 12 mg Pd^{2+} /30 ml, 7.5 g U/30 ml, and 0.8 mg Ag^+ /30 ml for 1 h. In this case, precipitate was observed on the bottom of the dissolver flask before centrifugation. The same sedimentation as in Run 1 was produced by the centrifugation.

The foregoing assumed dissolver is a simplified one. In actual (plant-scale) dissolvers, however, concentrations of I_2 and NO_2 would be higher near the liquid-gas interface because these gasses rise through the liquid after their formation. Due to the difference in fluid depth of spent-fuel solutions, the concentrations of these gasses at the liquid surface would be higher in a plant-scale dissolver than in a laboratory-scale dissolver. The experiments suggest that when their concentrations increase beyond the equilibrium conditions shown in Fig. 4, colloidal iodine is formed. This phenomenon can be one reason for the residual iodine quantity in spent-fuel solutions being greater in reprocessing plants than in laboratory-scale experiments.

V. Conclusions

(1) In the laboratory-scale dissolution of spent-fuels with burnups of 21 to 39 GWd/t, up to 10% of the ^{129}I in the spent fuel remains in fuel solutions, up to 3% deposits on insoluble residue, and the balance volatilizes and is expelled to the DOG.

(2) Of the iodine in the DOG, 7% or less is organic.

(3) The main iodine species in fuel solution are the colloids of

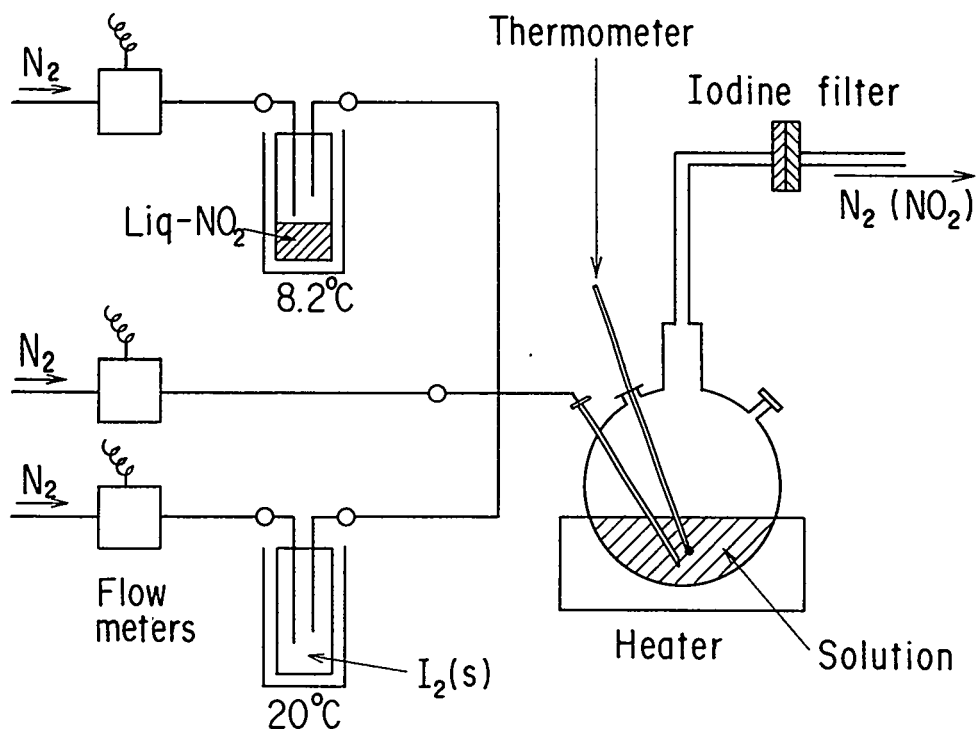


Figure 5 Experimental apparatus used for demonstrating the reversal of Reaction (1)

Table 3 Evidence of the formation of colloid by the reaction of $I_2(g)$ with NO_2 in simulated spent-fuel solutions at $100^\circ C$

[Run 1] 30 ml-3.5 M HNO_3 solution containing 7.5 g-U/30 ml and 0.8 mg- Ag^+ /30 ml

[Run 2] 30 ml-3.5 M HNO_3 solution containing 7.5 g-U/30 ml, 0.8 mg- Ag^+ /30 ml and 12 mg- Pd^{2+} /30 ml.

Time period of the supply of $I_2(g)$ and NO_2 , 1h

Centrifugation, 4,500 rpm for 5 mm.

Run No.	I_2 supplied	NO_2 supplied	N_2 flow rate	Iodine remaining in the solutions		
				① Before centrifugation	② After centrifugation	Ratio of the decrease, ②/①
1	88 ppm (1.8 mg)	36 % (12 ml/min)	22 ml/min	417 μg /30 ml ($1.1 \times 10^{-4} M-I$)	32 μg /30 ml ($8.4 \times 10^{-6} M-I$)	0.08
2	263 ppm (3.3 mg)	38 % (13 ml/min)	20 ml/min	216 μg /30 ml* ($5.7 \times 10^{-5} M-I$)	13 μg /30 ml ($3.4 \times 10^{-6} M-I$)	0.06


* Before centrifugation, precipitate was observed on the bottom of the dissolver flask.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

insoluble iodides, such as AgI and PdI₂.

(4) The amount of colloidal iodine tends to decrease with increasing concentrations of nitrous acid (HNO₂) and NO_x produced in the dissolution. So, for spent fuels with high dissolution rates, the amount of colloidal iodine is small, even if the fuel is high burnup fuel.

(5) High concentrations of I₂ and HNO₂ (or NO_x) cause formation of colloidal AgI. This is because the following reaction is reversed by conditions described above:



The reversal of this reaction has been confirmed experimentally.

(6) This reaction can also be reversed at the liquid surface of plant-scale dissolves where the concentrations of NO₂ and I₂ are higher than in laboratory-scale experiments. This phenomenon can be one reason the residual iodine in spent-fuel solutions is higher in a reprocessing plant than in laboratory-scale experiments.

Acknowledgements

The authors wish to express their thanks to Drs. Michio Hoshi (Director of the Department of Chemistry and Fuel Research) and Takeo Adachi (Head of Analytical Chemistry Laboratory), Japan Atomic Energy Research Institute (JAERI), for their advice and support. We also thank Mr. Haruka Shinohara (Physical Chemistry Laboratory of JAERI) for his assistance in preparation of this manuscript.

References

- (1) Henrich, E., Hufner, R., and Sahn, A., "Improved procedures for efficient iodine removal from fuel solutions in reprocessing plant," IAEA-SM-245/16, p. 139, International Atomic Energy Agency, Vienna (1989).
- (2) Auchapt, P., Patarin, L., and Tarnero, M., "Development of a continuous dissolution process for the new reprocessing plant at La Hague," Proc. Int. Topl. Mtg. Fuel Reprocessing and Waste Management, Jackson Hole, Wyoming, August 26-29, 1984, American Nuclear Society (1984).
- (3) Poncelet, F.J., Hugelmann, D., Saudray, D., Mukohara, S., and Cho, A., "Head-end process technology for the new reprocessing plants in France and Japan," Proc. 3rd Int. Conf. Nuclear Fuel Reprocessing and Waste Management, Sendai, Japan, April 14-18, 1991, Vol. 1, p. 55 (1991).
- (4) Leudet, A., Miquel, P., Goumondy, P.-J., and Charrier, G., "Balance and behavior of gaseous radionuclides released during initial PWR fuel reprocessing operation," Proc. 17th DOE Nuclear Air Cleaning Conf., Denver, Colorado, August 1-6, 1982, CONF-8208-33-V1, p. 639 (1983).
- (5) Herrmann, F.J., Motoi, V., Herrmann, B., Fang, D., Finsterwalder, L., Kuhn, K.D., van Shoor, A., Beyer, Ch., Furrer, J., and Knoch, W., "Minimizing of iodine-129 release at the Karlsruhe reprocessing plant WAK," Proc. 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conf., Denver, Aug., (1992); NUREG/CP-0130, CONF-902083-V1, p. 75 (1993).
- (6) Weinlaender, W., Huppert, K.L., and Weishaupt, M., "Twenty years of WAK reprocessing pilot plant operation," Proc. 3rd Int. Conf. Nuclear Fuel Reprocessing and Waste Management (RECOD' 91), Sendai, Japan, April 14-18, Vol. 1, p.55 (1991).
- (7) Castleman, A.W. Jr., Tang, I.N., and Mulkelwitz, H.R., "The chemical states of fission-product iodine emanating into a high

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- temperature aqueous environment," *J. Inorg. Nucl. Chem.*, **30**, 5 (1968).
- (8) Sakurai, T., Takahashi, A., Ishikawa, N., and Komaki, Y., "The behavior of iodine in a simulated spent-fuel solution," *Nucl. Technol.*, **85**, 206 (1989).
- (9) Sakurai, T., Takahashi, A., Ishikawa, N., Komaki, Y., Ohnuki, M., and Adachi, T., "Thermochemical and experimental consideration of NO_x composition and iodine species in the dissolution of spent PWR-fuel specimens," *J. Nucl. Sci. Technol.*, **30**, 533 (1993).
- (10) Sakurai, T., Takahashi, A., Ishikawa, N., Komaki, Y., Ohnuki, M., and Adachi, A., "The iodine species and their behavior in the dissolution of spent-fuel specimens," *Nucl. Technol.*, **99**, 70 (1992).
- (11) Sakurai, T., Takahashi, A., Ishikawa, N., Komaki, Y., Ohnuki, M., and Kato, K., "A study on the expulsion of iodine from spent-fuel solutions," *Proc. 23rd DOE/NRC Nuclear Air Cleaning Conf.*, NUREG/CP-0141, CONF-940738, 321 (1995).
- (12) Boukis, N., and Henrich, E., "Two-step procedure for the iodine removal from nuclear fuel solutions," *Radiochim. Acta*, **55**, 37 (1991).
- (13) Sakurai, T., Takahashi, A., Ishikawa, N., and Komaki, Y., "The interaction of iodine with insoluble residue in the dissolution of simulated spent-fuel pellets," *Nucl. Technol.*, **94**, 99 (1991).
- (14) Moore, W.J., "Physical Chemistry," 3rd ed., p. 167, Prentice-Hall, Englewood Cliffs, New Jersey, 1962.
- (15) Lemire, R.J., Paquette, J., Torgerson, D.F., Wren, D.J., and Fletcher, J.W., "Assessment of iodine behavior in reactor containment buildings from a chemical perspective," AECL-6812, Atomic Energy of Canada Limited, 1981.
- (16) Criss, C.M., and Cobble, J.W., "The thermodynamic properties of high temperature aqueous solutions. V. The calculation of ionic heat capacities up to 200°C. Entropies and heat capacities about 200°C," *J. Amer. Chem. Soc.*, **86**, 5390 (1964).
- (17) Pourbaix, M. "Atlas of electrochemical engineering in aqueous solutions," Pergamon Press, Oxford, 1966.

DISCUSSION

HERRMANN: I have a question about Point B . You have marked 0-10% in the fuel solution, 0-3% in insoluble residue. Is the value of 0% not too low? Does this mean that the rest, 87%, is in the offgas?

SAKURAI: In our laboratory-scale dissolutions, iodine quantities in the fuel solution and in the insoluble residue varied in the range of 0 to 10% and 0 to 3%, respectively, largely depending upon the rate of dissolution of the spent-fuel specimens. The fuel specimen with a burnup of 39GWd/t dissolved quickly, leaving little iodine in the solution and 0.6% in the residue. But the fuel-specimen with a low burnup of 21GWd/t took a long time to dissolve and 9.7% of the iodine remained in the fuel solution, and 2.3% in the residue. As a whole, the iodine quantity volatilized into the off-gas varied between 88 and 100%.

JUBIN: I found this very interesting and I have one additional question. In your laboratory studies, have you had an opportunity to try to identify the iodine in the dissolver solution? Have you identified through your centrifugation at the end a reduction in the iodine concentration? Have you been able to conduct any experiments using spent fuel to see if it does the same? Have you had an opportunity to look for the formation of iodine in the form of the colloid in actual dissolver solution?

SAKURAI: Not directly. However, iodine species in spent-fuel solution showed the same behavior in the expulsion process as the colloid of AgI and PdI₂ did. It is almost impossible to directly identify iodine species in spent-fuel solutions because of the extremely high radioactivity of the solution and the weak radioactivity of ¹²⁹I. We had to identify them through their behavior in separating from the fuel solution. The expulsion of iodine was performed in two different ways for the fuel solution. The insoluble residue had already been separated by centrifugation. From their behavior in the two expulsion processes, the main iodine species in the actual spent-fuel solution was concluded to be the colloidal iodine already mentioned.

INFLUENCES OF IMPURITIES ON IODINE REMOVAL EFFICIENCY
OF SILVER ALUMINA ADSORBENT

Tetsuo FUKASAWA*, Kiyomi FUNABASHI*, and Yoshikazu KONDO**

* Power & Industrial Systems R & D Division, Hitachi, Ltd.
7-2-1 Omika, Hitachi, Ibaraki, 319-12 Japan

** Hitachi Works, Hitachi, Ltd.
3-1-1 Saiwai, Hitachi, Ibaraki, 317 Japan

Abstract

Silver impregnated alumina adsorbent (AgA), which was developed for iodine removal from off-gas of nuclear power and reprocessing plants, has been tested laying emphasis on investigation of the influences gaseous impurities have on adsorbent chemical stability and iodine removal efficiency. The influences of the major impurities such as nitrogen oxides and water vapor were checked on the chemical state of impregnated silver compound (AgNO_3) and decontamination factor (DF) value.

At 150°C, a forced air flow with 1.5% nitrogen oxide ($\text{NO}/\text{NO}_2=1/1$) reduced silver nitrate to metallic silver, whereas pure air and air with 1.5% NO_2 had no effect on the chemical state of silver. Metallic silver showed a lower DF value for methyl iodide in pure air (without impurities) than silver nitrate and the lower DF of metallic silver was improved when impurities were added.

At 40°C, a forced air flow with 1.5% nitrogen dioxide (NO_2) increased the AgA weight by about 20%, which was caused by the adsorption of nitric acid solution on the AgA surface. AgA with 10wt% silver showed higher weight increase than that with 24wt% silver which had lower porosity. Adsorption of acid solution lowered the DF value, which would be due to the hindrance of contact between methyl iodide and silver.

The influences of other gaseous impurities were also investigated and AgA showed superior characteristics at high temperatures.

I. Introduction

Uranium and plutonium are important energy sources, and can be utilized more effectively by recycling them in the nuclear fuel cycle. In Japan, the first light water reactor started commercial operation in 1969. Now there are 47 reactors in operation and their total power generation capacity is 38 GW. Reprocessing of spent nuclear fuel is carried out at Tokai Reprocessing Plant

where 812.9 tons of uranium was treated by the end of FY 1994. Commercial reprocessing will start at Rokkasho Plant at the beginning of the next century.

The nuclear energy industry adopts multibarrier protection towards radioactivity exposure for human beings and the environment. In particular, radioactive iodine release to the atmosphere must be suppressed because iodine is volatile and apt to concentrate in the thyroid gland. Therefore nuclear facilities, such as nuclear power plants and reprocessing plants, remove radioactive iodine from their off-gas streams.

Iodine removal methods are generally classified into two types, wet ones which absorb iodine into a solution and dry ones which adsorb iodine onto a solid material.[1-3] Both wet and dry methods must take into account the effects of impurities. For example, wet scrubbing with an alkaline solution absorbs not only iodine, but also various impurities, which sometimes leads to drops in the pH value and iodine absorption capacity of the solution. Impurities also sometimes interfere with the reaction of iodine and solid adsorbent.

The authors have been developing an inorganic adsorbent, silver impregnated alumina (AgA) for about 15 years.[4-14] This adsorbent can be applied to off-gas systems of both nuclear power plants and spent fuel reprocessing plants. The influences of impurities were checked on AgA under the various conditions possible in the above systems. This paper reports experimental results of the investigation which laid emphasis on the changes of chemical stability and iodine removal efficiency of AgA in the presence of gaseous impurities. Iodine removal efficiency was evaluated using adsorption capacity and decontamination factor (DF) which is defined as the iodine concentration at the inlet of the adsorbent column divided by that at the outlet.

II. Off-Gas Systems

The adsorbent AgA is intended for application to the tank vent system for the waste solution of boiling water reactors (BWRs), standby gas treatment system (SGTS) of BWRs, and dissolver off-gas (DOG) system of reprocessing plants. A schematic and conditions of these systems are summarized in Fig. 1 and Table 1. Systems characteristics are as follows. The tank vent filter (adsorbent) removes iodine from the off-gas which contains many contaminants and has a high humidity. The SGTS filter removes iodine over a wide range of concentrations during an accident. The DOG filter removes high concentrations of iodine in the presence of nitrogen oxides. Stability of the adsorbed iodine is an important factor for the DOG system because the main radioactive iodine isotope is I-129 (half life: $1.57 \cdot 10^7$ y), whereas I-131 (8.02d) is the main radioisotope for the tank vent system and SGTS. Furthermore, iodine concentration is high (~30ppm) for the DOG, whereas it is below 0.1ppm for power plants (tank vent and SGTS). So two types of AgA were prepared, AgA with 24wt% Ag and 10wt% Ag for DOG and power plants, respectively. Operation temperatures differ for the

three systems. The most severe situation seems to be that of the tank vent because of the low temperature and high humidity. Water vapor clogs the adsorbent pores. Other systems may have low temperature conditions would be exist such as during storage before and after use, and at operation standby. Nitrogen oxides of high concentration also can interfere with the reaction of iodine and impregnated silver, and change the chemical form of impregnated silver. All these factors must be considered in order to apply AgA to actual systems.

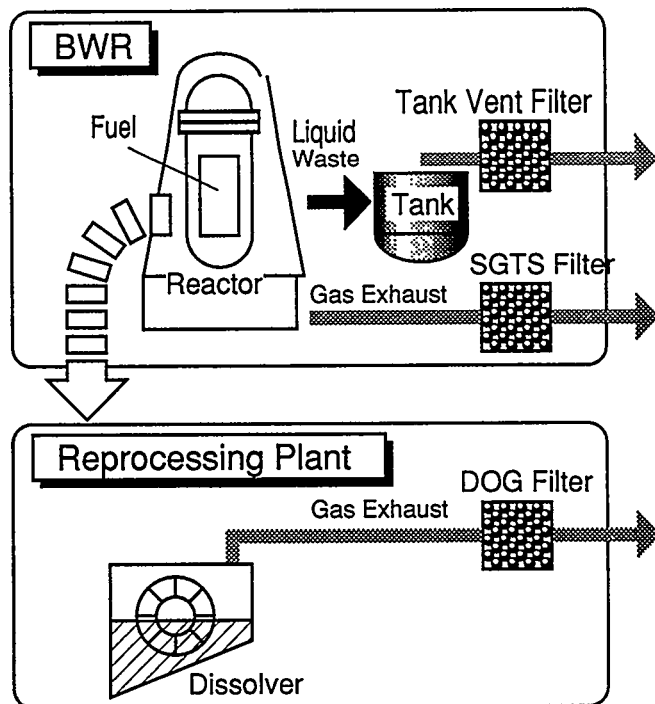


Fig. 1 Off-Gas Treatment Systems

Table 1 Off-Gas Conditions of Each System

System	Off-Gas Conditions				Requirement *filter bed depth
	Temp.	RH	[I]	[NOx]	
(1) Tank Vent 	30°C	50-90%	1ppb (10 ⁻³ ppm)	10ppb (10 ⁻² ppm)	• High removal efficiency (DF>10 at 5cm*)
(2) SGTS 	66°C	<70%	1ppt- 0.1ppm (10 ⁻⁶ -10 ⁻¹)	10ppb (10 ⁻²)	• High removal efficiency (DF>34 at 5cm*)
(3) Dissolver Off-Gas 	150°C	~1%	30ppm	1.5% (1.5×10 ⁴)	• High removal efficiency (DF>250 at >85cm*) • High adsorption capacity

III. Experimental

The preparation of AgA was described previously.[14] Both types of AgA tested here had particle diameter of about 2mm and pore diameter of from 10 to 100 nm. Specific surface areas of 24 and 10 wt% AgA were about 10 and 40 m²/g,

and bulk densities were about 1.5 and 1.2 g/cm³, respectively.

The test apparatus is schematically shown in Fig. 2. The iodine species were methyl iodide and molecular iodine. Concentrations of iodine and NO_x, ratios of NO to NO₂ of simulated off-gas, the gas temperature and adsorbent bed depth were adjusted to get a desired condition. Iodine concentrations at the inlet and outlet of the column were measured by three methods depending on the form and concentration of iodine, that is gas chromatography with an FID or ECD detector after gas sampling, spectrophotometry using ferric thiocyanate, and inductively coupled plasma mass spectrometry after absorbing the iodine in an alkaline solution.

In order to simulate the standby condition for the DOG system, pre-blow tests were carried out. Pre-blow meant blowing of simulated off-gas without iodine through the AgA column in this study. The weight change of AgA and chemical form of silver were measured during and after pre-blow. The tests of iodine removal were carried out after pre-blow. The breakthrough test was also conducted to confirm the adsorption capacity of AgA with the 10 cm bed depth.

The influences on AgA of other gaseous impurities such as SO₂, NH₃ and CO₂ were investigated with 10 wt% Ag at relatively low temperatures and long times.

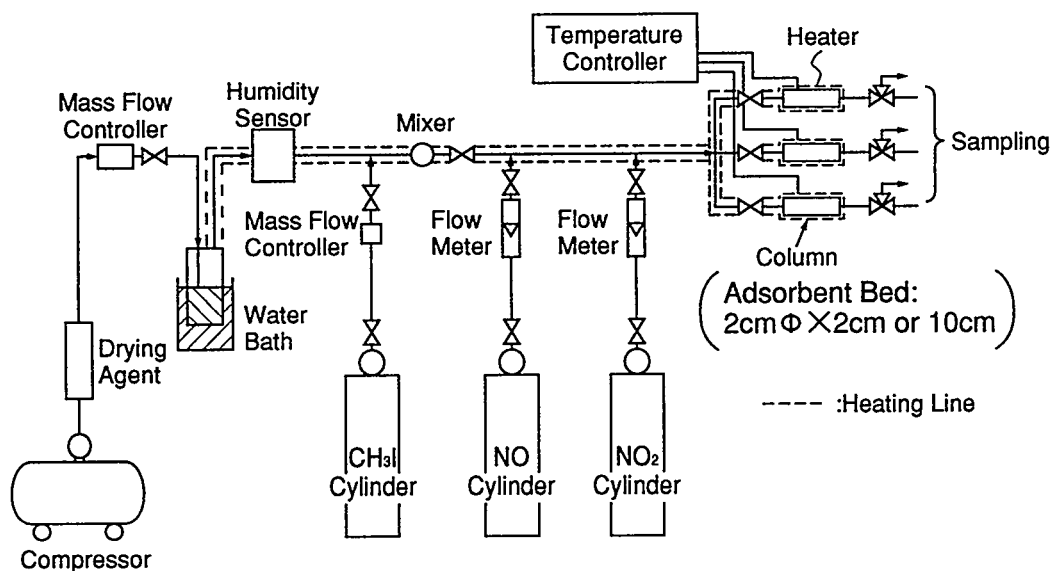


Fig. 2 Outline of the Test Apparatus

IV. Influence of NO_x and H₂O on AgA

Before the iodine removal tests, pre-blow tests without iodine were carried out to clarify the influence of only gaseous impurities on the chemical form of impregnated silver. Figure 3 shows the relative weight change of AgA when 1.5% NO_x (NO/NO₂=1/1) was blown in at 40 and 150°C. A forced air flow without NO_x was carried out as a reference. A slight increase at 40°C and a decrease at 150°C were observed in the reference data, which is due to adsorption of H₂O in

the air at 40°C and desorption of H₂O adsorbed on AgA before the test at 150°C. AgA with 10% silver showed a higher weight increase than AgA with 24% silver at 40°C, which is attributable to the higher surface area of the former. For the NO_x pre-blow, weight changes were more notable than the reference case. At 40°C, NO_x (NO₂) would be absorbed in the adsorbed H₂O, which would dissolve impregnated AgNO₃ and enhance the H₂O adsorption. Nitrate presence which was observed in the 1.5% NO₂ pre-blow supports this mechanism. At 150°C, the weight decrease could not be explained only by the H₂O desorption. In this case, NO_x (NO) reduced the impregnated AgNO₃ to Ag and decreased the AgA weight. X-ray diffraction (XD) patterns are shown in Fig. 4 for 24% AgA before and after the NO_x pre-blow, which indicated the conversion of AgNO₃ to Ag by Eq. (1).

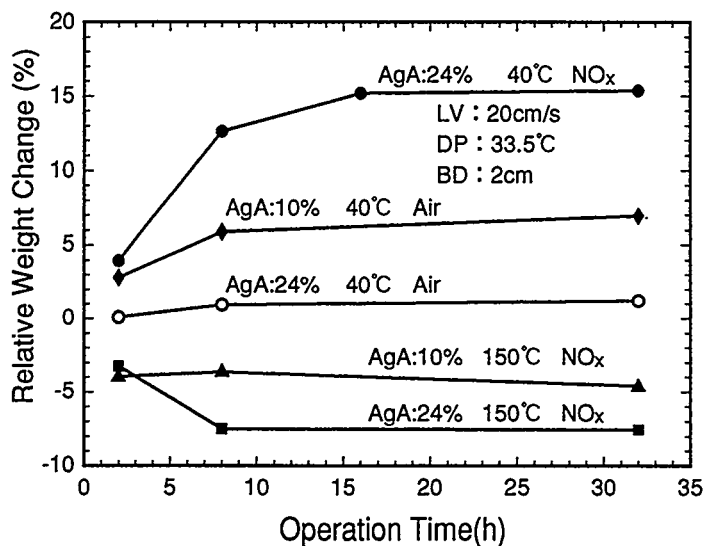


Fig. 3 Relative Weight Change of AgA during NO_x Pre-Blow

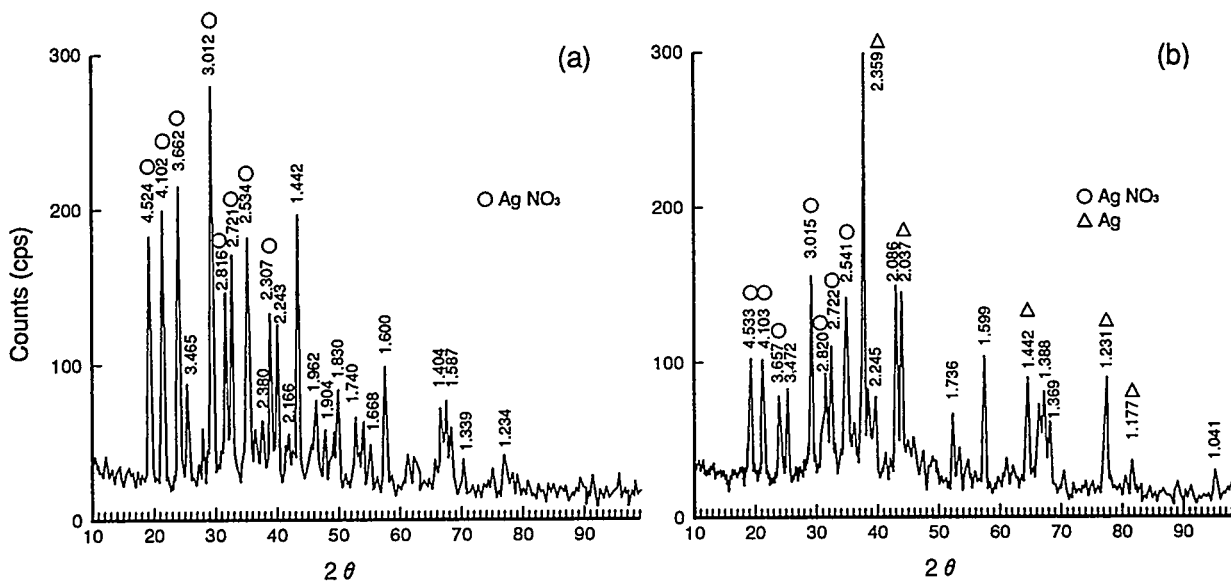


Fig. 4 XD Pattern of AgA before(a) and after(b) NO_x Pre-Blow at 150°C

Figure 5 shows the weight change ratio of AgA during the 1.5% NO₂ pre-blow. The data showed that a larger increase was observed for 10% AgA than 24% AgA due to the larger surface area of the former. Compared with the data for 24% AgA in Fig. 3, NO₂ pre-blow had a larger weight increase than NO_x pre-blow, which would be due to the easier solution of NO₂ into water than NO_x.

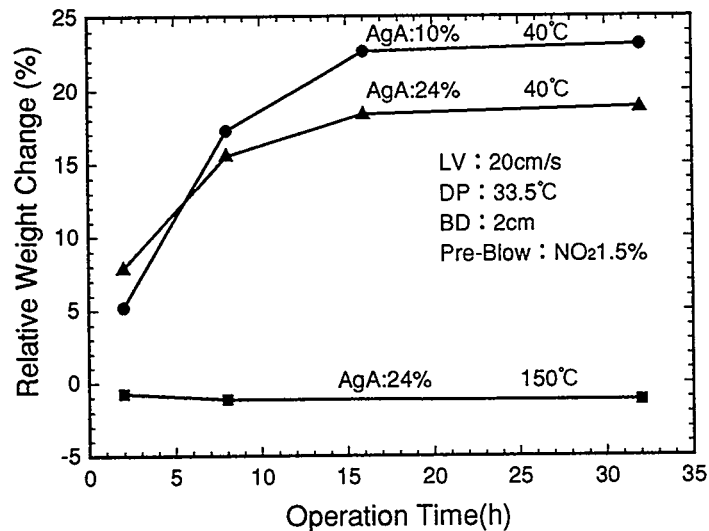





Fig. 5 Relative Weight Change of AgA during NO₂ Pre-Blow

V. Iodine Removal Efficiency after NO_x Pre-Blow

Iodine removal experiments were carried out after pre-blow of simulated off-gas without iodine. Iodine was mixed with air without and in some cases with impurities. Typical iodine forms selected here were methyl iodide (CH₃I) and molecular iodine (I₂). CH₃I is the most difficult species to separate from simulated off-gas among the major organic iodines, and I₂ is the main form in the dissolver off-gas of spent fuel reprocessing[1,13]. In the experiments done here, the bed depth was quite small (2cm) to allow sensitive assessment of the change in decontamination factor (DF). It is known that the iodine adsorption band is about 5cm for AgA and a bed depth of 5cm is necessary for good iodine removal. So some cases showed rather rapid iodine breakthrough due only to the insufficient bed depth.

The DF values for CH₃I with 24% AgA are shown in Fig. 6 after various gases were pre-blown as a function of operation time. When the iodine concentration at the column outlet was under the detection limit, a DF value was calculated by substituting the detection limit for the outlet iodine concentration; these values are indicated with an upward pointing arrow in Figs. 6 and 7. The DF value was high after 1.5% NO₂ and air pre-blows. No gaseous impurities were added during the iodine removal test in these two cases. The DF values were low after 1.5% NO_x (NO/NO₂=1) pre-blow (no NO_x during iodine removal), and they

were raised by the addition of NO_x during iodine removal. The reactions of CH₃I with silver impregnated on AgA could be written as follows.



Reaction (2) is the normal iodine adsorption reaction which has a high DF. As described in the previous section, NO_x pre-blow reduced AgNO₃ to Ag. It would be difficult for Reaction (3) to proceed because no counter ions are present for CH₃⁻, whereas gaseous impurities could act as counter ions as described in Reaction (4).

Figures 7 and 8 show the DF values of 10% AgA after 1.5% NO_x and air pre-blows, respectively. Iodine forms of CH₃I and I₂ were examined in both figures. Temperature dependency is summarized in Fig. 8. Molecular iodine (I₂) showed no apparent DF decrease with lower temperature because the reactivity of I₂ with silver would be high. Methyl iodide (CH₃I) showed a lower DF especially at low temperatures and after NO_x (NO/NO₂=1) pre-blow. This is because of the low reactivity of CH₃I with AgNO₃ and the much lower CH₃I reactivity with Ag metal at low temperatures. DF values of over 500 could be obtained for 30ppm CH₃I at 150°C with 10% AgA in a 2cm bed depth after air pre-blow. AgA with 24% silver showed DF of over 500 even after 1.5% NO_x pre-blow.

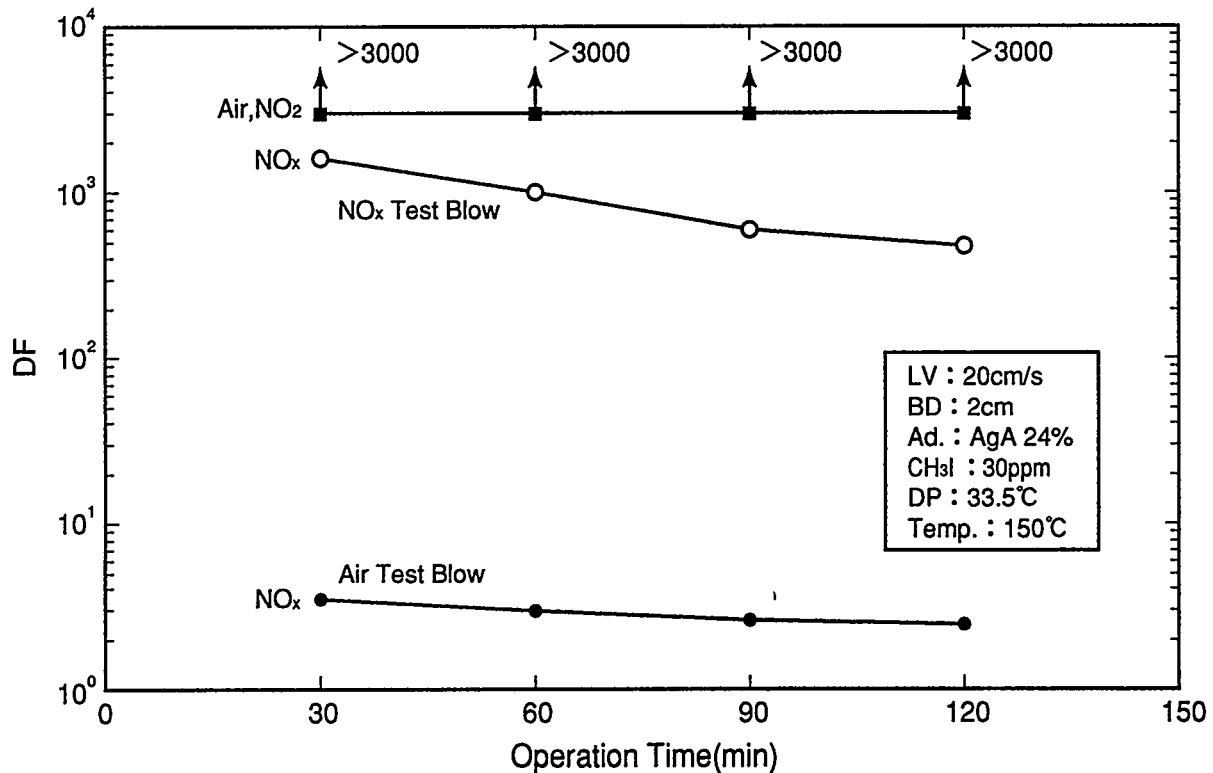


Fig. 6 DF of 24% AgA for CH₃I after Various Gases Were Pre-Blown

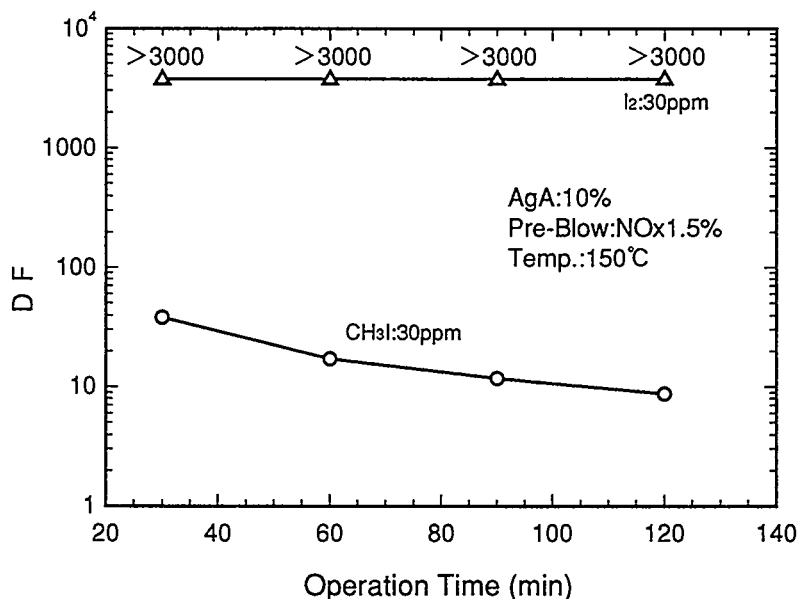


Fig. 7 DF of 10% AgA for CH₃I and I₂ after 1.5% NO_x Pre-Blow

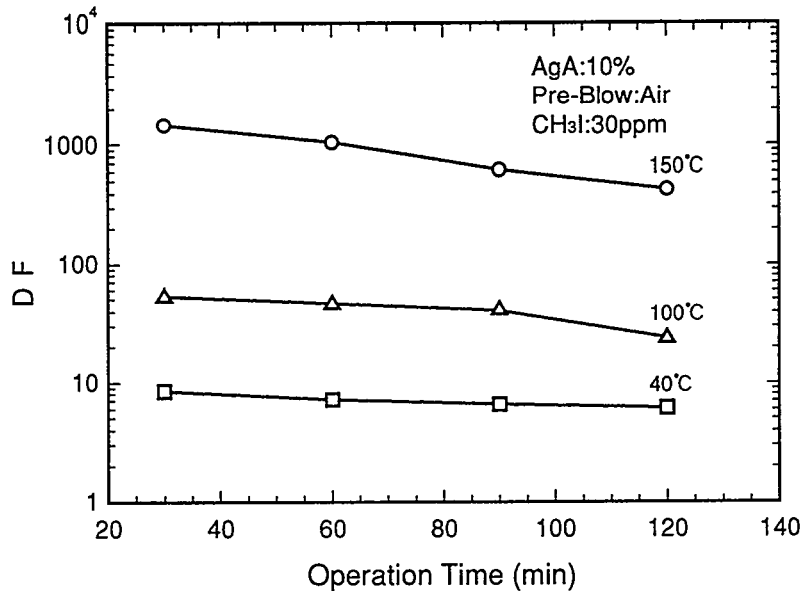


Fig. 8 DF of 10% AgA for CH₃I after Air Pre-Blow

VI. Breakthrough Property of AgA

Iodine breakthrough property was checked in order to get the iodine adsorption capability of AgA in a column. The results are shown in Fig. 9 for AgA with silver contents of 10wt% and 24wt% and CH₃I concentrations of 30 and 300ppm with air blowing. The bed depth of AgA was set at 10cm. Iodine concentration of 300ppm simulated an accelerated condition. AgA is known to show almost the same adsorption capacity for both CH₃I and I₂, and was expected to show a similar breakthrough curve.

The breakthrough point was defined in this study as the operation time

where the DF value decrease was first observed. The breakthrough point depends on the iodine flow rate, and bed volume and silver content of AgA. This could be qualitatively understood by the data in Fig. 9. Iodine adsorption capacity of AgA was about $0.12 \text{ g-I/cm}^3\text{-AgA(10wt\%)}$ and $0.35 \text{ g-I/cm}^3\text{-AgA(24wt\%)}$. Iodine reacts with the same number of moles of silver in AgA and capacity data obtained indicated about 80% silver utilization. As mentioned before, adsorption band length is around 5cm, so breakthrough point would be full adsorption to 5cm of AgA in this experiment. Calculated breakthrough points of 24% AgA were about 140h and 14h, and those of 10% AgA were about 50h and 5h for 30ppm and 300ppm CH_3I , respectively. Corresponding experimental breakthrough points were 90h, 24h, 48h and 4h, which were not so different from the calculated points. High DF values were obtained for AgA before the breakthrough points which could be predicted by iodine adsorption capacity.

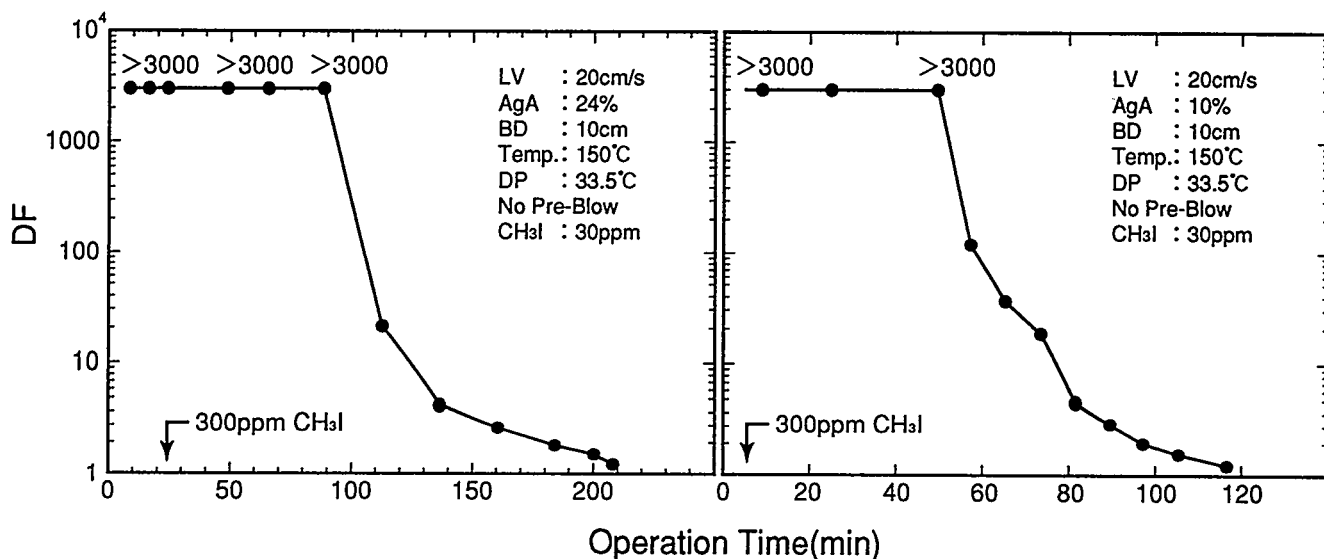


Fig. 9 Iodine Breakthrough Property of AgA

VII. Long Term Effect of Impurities at Relatively Low Temperatures

In order to check applications to the tank vent and standby gas treatment systems, long term experiments were carried out by blowing simulated off-gas containing various impurities. AgA with 10% silver was exposed for adequate time and iodine was added only at the time of the DF measurement. Impurities were removed from iodine gas to avoid their interference with the DF measurement.

The results are shown in Figs. 10 and 11 for simulated conditions of tank vent and standby systems, respectively. Simulated off-gas of the tank vent system included NO_x (5ppb), SO_2 (5ppb), H_2S (<1ppb), HCl (36ppb) and NH_3 (150ppb). Temperature and relative humidity were 30°C and 70%, respectively. Simulated off-gas of the standby system included NO_x (30ppb), SO_2 (<1ppb), H_2S (<1ppb), HCl (<1ppb) and NH_3 (17ppb). Temperature and relative humidity were 66°C and 70%, respectively. Bed depth of AgA and linear gas velocity were 5cm

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

and 20cm/s in both cases, respectively. The DF values in Fig. 10 were lower than in Fig. 11 due to the lower temperature for the former. Long term exposures of AgA decreased the DF values in both cases, which would indicate poisoning of AgA by gaseous impurities such as NH_3 , NO_x and SO_2 . The effects of NH_3 and SO_2 were realized by the separate experiments. Nitrogen oxide (NO) reduced AgNO_3 to Ag metal and hindered the smooth reaction of CH_3I with silver. The X-ray diffraction pattern showed peaks of Ag metal after exposure to simulated off-gas. But the required DF values were obtained in both cases after long exposure time.

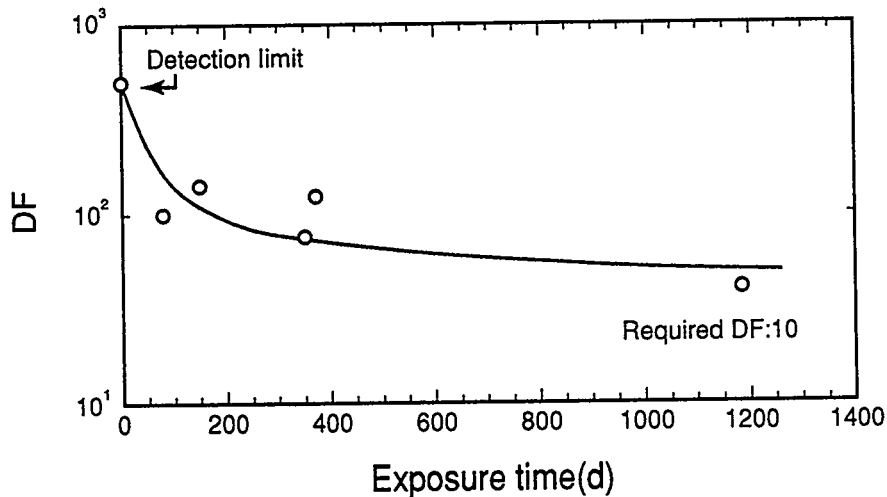


Fig. 10 Long Term DF Change for Simulated Conditions of Tank Vent System

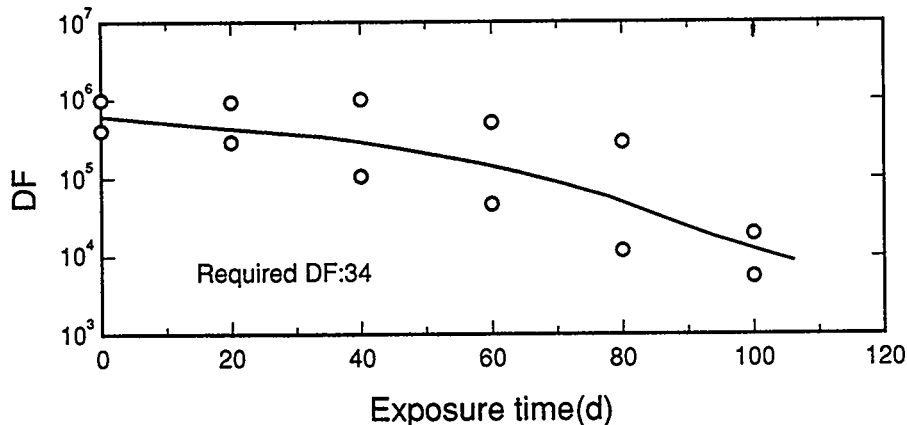


Fig. 11 Long Term DF Change for Simulated Conditions of Standby System

VIII. Conclusions

Silver impregnated alumina adsorbent (AgA), which was developed for iodine removal from off-gas of nuclear power and reprocessing plants, has been tested, placing emphasis on the investigation of influences of gaseous impurities on AgA chemical stability and iodine removal efficiency. Methyl iodide (CH_3I) and molecular iodine (I_2) were chosen as iodine forms for testing. Silver contents

of AgA were 10 and 24 wt%. The main impurities are nitrogen oxides and water vapor in the dissolver off-gas of a reprocessing plant. Their influence on the chemical state of impregnated silver compound (AgNO_3) and decontamination factor (DF) value was checked.

At 150°C , air pre-blow with 1.5% nitrogen oxide ($\text{NO}/\text{NO}_2=1/1$) reduced silver nitrate to metallic silver, whereas pure air and air with 1.5% NO_2 had no effect on chemical state of silver. Metallic silver showed a lower DF value for methyl iodide in pure air (without impurities) than silver nitrate and the higher DF value in the presence of impurities. These phenomena could be explained by the reactivity difference of methyl iodide with silver in the presence and absence of counter ions (NO_3^- , etc.) for methyl ion (CH_3^-). Iodine could easily react with silver while methyl ion could react with counter ion. Methyl iodide removal by metallic silver without gaseous impurities could not offer the counter ion for methyl ion and showed a relatively low DF value.

At 40°C , air pre-blow with 1.5% nitrogen dioxide (NO_2) increased the AgA weight by about 20%, which was caused by the adsorption of nitric acid solution on the surface of AgA. AgA with 10wt% silver showed a higher weight increase than that with 24wt% silver which had lower porosity. Adsorption of acid solution lowered the DF value, which would be due to the hindrance of contact between methyl iodide and silver. AgA showed a relatively high DF at high humidity than other iodine adsorbents by keeping high reactivity of dissolved iodine with dissolved silver nitrate, but nitric acid solution would suppress both dissolutions.

The long term influence of other gaseous impurities was also investigated on 10% AgA at 30°C and 66°C which simulated the conditions of the tank vent and standby systems, respectively. The impurities of NH_3 and SO_2 decreased the DF value at high humidity. But DF was still over the required value after a long time. AgA indicated superior characteristics at high temperatures.

References

[1]Goossens,W.R.A., Eichhoiz,G.G., Tedder,D.W., eds., "Treatment of Gaseous Effluents at Nuclear Facilities," Radioactive Waste Management Handbook, vol.2, Harwood Academic Publishers, Chur, Switzerland, 1991.

[2]Benedict,M., Pigford,T.H., Levi,H.W., "Nuclear Chemical Engineering, 2nd ed.," McGraw-Hill, Inc., New York (1981).

[3]Long,J.T., "Engineering for Nuclear Fuel Reprocessing," American Nuclear Society, La Grande Park, Illinois (1978).

[4]Kikuchi,M., Kitamura,M., Yusa,H., Horiuchi,S., "Removal of Radioactive Methyl Iodide by Silver Impregnated Alumina and Zeolite," Nucl. Eng. Design, 47,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

283(1978).

[5]Kikuchi,M., Funabashi,F., Yusa,H., Takashima,Y., "Adsorption of Radioactive Methyl Iodide by Silver-Impregnated Alumina," Radiochem. Radioanal. Lett., 45, 279(1980).

[6]Kikuchi,M., Funabashi,K., Kawamura,F., Yusa,H., Tsuchiya,H., Takashima,Y., "New Adsorbent, Silver-Alumina for Radioactive Iodine Filter," Proc. 17th DOE Nucl. Air Cleaning Conf., CONF-820833, 2, 626(1983).

[7]Hattori,S., Kobayashi,Y., Ozawa,Y., Kunikata,M., "Removal of Iodine from Off-Gas of Nuclear Fuel Reprocessing Plants with Silver Impregnated Adsorbents," Proc. 18th DOE Nucl. Airborne Waste Management and Air Cleaning Conf., CONF-840806, 2, 1343(1984).

[8]Fujiwara,K., Ohki,K., Siomi,H., Hiraga,Y., Funabashi,K., "The Study for the Confirmation of the Performance of Activated Carbon for Stand By Gas Treatment System," Proc. 1985 Annual Meeting of the Atomic Energy Soc. Jpn., J38(1985).

[9]Mizuno,T., Ito,R., Kobayashi,Y., Ozawa,Y., Funabashi,K., "Stability Study of Iodine Adsorbed on Silver Impregnated Adsorbent for Interim Storage," Eur. Conf. Gaseous Effluent Treatment in Nucl. Installations, Luxembourg, Oct. 14-18(1985).

[10]Kobayashi,Y., Kondo,Y., Hirose,Y., Fukasawa,T., "Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents," Proc. 21st DOE/NRC Nucl. Air Cleaning Conf., CONF-900813, 2, 594(1990).

[11]Sugimoto,Y., Kondo,Y., Hirose,Y., Fukasawa,T., Furrer,J., Herrmann,F.J., Knoch,W., "The Development of Ag-A for Radioactive Iodine Removal from Nuclear Fuel Reprocessing Plants," Proc. 3rd Int. Conf. Nucl. Fuel Reprocessing and Waste Management, RECOD '91, 1, 236(1991).

[12]Kondo,Y., Sugimoto,Y., Hirose,Y., Fukasawa,T., Furrer,J., Herrmann,F.J., Knoch,W., "Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents," Proc. 22nd DOE/NRC Nucl. Air Cleaning and Treatment Conf., CONF-9020823, 1, 118(1992).

[13]Fukasawa,T., Funabashi,K., Kondo,Y., "Separation Technology for Radioactive Iodine from Off-Gas Streams of Nuclear Facilities," J. Nucl. Sci. Technol., 31, 1073(1994).

[14]Funabashi,K., Fukasawa,T., Kikuchi,M., Kawamura,F., Kondo,Y., "Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams," Proc. 23rd DOE/NRC Nucl. Air Cleaning and Treatment Conf., CONF-940738, 352(1994).

DISCUSSION

JUBIN: When you examined the material and determined that you had metallic silver, did you have an opportunity to look at this material through an electron microscope and determine whether the silver was uniformly distributed over the material? Did it, perhaps, conglomerate into nodules of some sort?

FUKASAWA: We did not examine it by microscope in this case, but observed that the silver distribution was under the surface of the other adsorbent. Inside the adsorbent there was still silver nitrate.

HERRMANN: We agree with your experiences that elemental silver has good removal efficiency for iodine. We do not agree with your experience for the removal efficiency of elemental iodine with elemental silver. 85% of I in WAK offgas is organic iodine. With elemental silver on a carrier of silica we found better removal efficiency than with silver nitrate. I agree, we should compare plant and laboratory experiences. Laboratory experiences with I-131 indicate a higher iodine trapping performance than plant experience.

FUKASAWA: I don't know the exact conditions of your offgas, but in these cases the silver nitrate is converted to metallic silver. Without impurities during the iodine separation with metallic silver, this adsorber shows low DF. But with impurities, there should be impurities in the actual offgas, this adsorber showed high DF. So your case is, I think, the same as this case. You get high DF for I₂ with metallic silver with impurities like NO_x or humidity.

HERRMANN: The device for iodine removal is at 140° C. As impurities we have some percent of NO₂. It depends on the dissolution time. We measured it also in the effluent ventilation system where the concentration is much lower. The water content was always approximately 3% absolute, the offgas saturation after the scrubbing columns. This is what we know about the impurities we have.

FUKASAWA: In our case, NO_x concentration is 1.5%. NO is 0.75% and NO₂ is 0.75%. The minimum water content was about 1% in our iodine separation tests. With such an amount of coexisting impurities, you don't have to worry about the DF decrease in this case. In your case you can get high DF I think.

JUBIN: One other question, what is your dew point, is it 35° C?

FUKASAWA: Yes, dew point is 33.5° C at 150° C, humidity is about 1%.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
DIFFUSIONAL ANALYSIS OF THE ADSORPTION OF METHYL IODIDE
ON SILVER EXCHANGED MORDENITE

R. T. Jubin
Chemical Technology Division
Oak Ridge National Laboratory
Oak Ridge, Tennessee 37831

and

R. M. Counce
Department of Chemical Engineering
University of Tennessee
Knoxville, Tennessee 37916

Abstract

The removal of organic iodides from off-gas streams is an important step in controlling the release of radioactive iodine to the environment during the treatment of radioactive wastes or the processing of some irradiated materials. Nine-well accepted mass transfer models were evaluated for their ability to adequately explain the observed CH_3I uptake behavior onto the Ag°Z . Linear and multidimensional regression techniques were used to estimate the diffusion constants and other model parameters, which then permitted the selection of an appropriate mass transfer model.

Although a number of studies have been conducted to evaluate the loading of both elemental and methyl iodide on silver-exchanged mordenite, these studies focused primarily on the macro scale (deep bed) while evaluating the material under a broad range of process conditions and contaminants for total bed loading at the time of breakthrough. A few studies evaluated equilibrium or maximum loading. Thus, to date, only bulk loading data exist for the adsorption of CH_3I onto Ag°Z . Hence this is believed to be the first study to quantify the controlling mass transfer mechanisms of this process.

It can be concluded from the analysis of the experimental data obtained by the "single-pellet" -type experiments and for the process conditions used in this study that the overall mass transfer rate associated with the adsorption of CH_3I onto Ag°Z is affected by both micropore and macropore diffusion. The macropore diffusion rate was significantly faster than the micropore diffusion, resulting in a two-step adsorption behavior which was adequately modeled by a bimodal pore distribution model. The micropore diffusivity was determined to be on the order of $2 \times 10^{-14} \text{ cm}^2/\text{s}$. The system was also shown to be isothermal under all conditions of this study.

Introduction

One of the promising solid sorbent technologies for the removal and retention of iodine in terms of performance and simplicity is the adsorption on hydrogen-reduced silver mordenite (Ag°Z). This form of the sorbent has been reported by several researchers [Thomas et al. (1977), Jubin (1980, 1982), Scheele et al. (1983), and Sheele and Burger (1987)] to be more effective in trapping I_2 and CH_3I than the ionic silver mordenite (AgZ). Although a number of studies have been conducted to evaluate the loading of both elemental and methyl iodide on silver-exchanged mordenite, they focused primarily on the macro scale (deep bed) while evaluating the material under a broad range of process conditions and

contaminants for total bed loading at the time of breakthrough. Thus for the most part, only bulk loading data appear to exist in the literature for the adsorption of CH_3I onto AgZ or Ag°Z . The specific objective was to provide sufficient insight into the adsorption process to allow the determination of the primary controlling mechanisms and diffusion and/or reaction coefficients associated with the process.

Theory and Assumptions

The process of physical adsorption in porous adsorbent material is generally extremely rapid according to Kärger and Ruthven (1992). As a result, in most cases, mass or heat transfer resistances are the controlling factors for the overall rate of adsorption. Kärger and Ruthven (1992) provided an outstanding discussion on the diffusional resistances in zeolite pellets. What follows is a summary of that discussion as it applies to the problem at hand.

According to the International Union of Pure and Applied Chemistry (IUPAC) classification, pores with a diameter less than 20 Å are considered micropores while pores with a diameter greater than 500 Å are classified as macropores. The region between 20 and 500 Å is classified as mesopores (Kärger and Ruthven, 1992). The mass transport in each of these three size regions is controlled by different diffusion mechanisms. In the macropores, interactions between the pore walls and the diffusing molecule are minor and generally bulk diffusion is observed. Typically, the macropore provides only limited adsorption capacity but may significantly impact the mass transfer rates. As the size of the pore decreases, the interactions with the walls become increasingly important. In the mesopore region, diffusion control is generally associated with Knudsen diffusion; however, both surface diffusion and capillary effects may play significant roles. In the micropore region, surface forces are the most significant, as the diffusing molecule interacts with the wall more frequently than with other diffusing molecules. This form of diffusion is also known as "intracrystalline" diffusion. Micropore diffusion is also quite different from the diffusion processes in either the macropore or mesopore regions in that it is an activated process. This implies that the observed diffusion rate, if this mechanism could be isolated, would vary with temperature in accordance with an Arrhenius form equation:

$$D_c = D_\infty e^{-E_d/RT} \quad (1)$$

Kärger and Ruthven (1992) further indicate that the analysis of loading data obtained for zeolite crystals that are "sufficiently large" can generally be accomplished through the use of the simple single micropore diffusion resistance model. However, in the case of commercial pelleted adsorbents, there is often a continuous range of pore sizes, which includes micropores, mesopores, and macropores. The analysis of many commercially available zeolite adsorbents is a bit more tractable because these materials are formed from small microporous particles of the actual zeolite crystal to produce a macroporous pellet of a manageable size. In such pellets, the pore size distribution is reported to often exhibit a bimodal-type distribution. In this situation, it is possible that the mass transport is controlled by macropore and/or micropore diffusion resistances.

General Assumptions and Simplifications

In most cases, modeling of the diffusion processes in porous media requires some type of simplifying assumptions. These generally involve the definition of structure of the adsorbent material, the nature or order of the chemical reactions and thermal effects associated with the heat of reaction and adsorption, and finally the behavior of the diffusion coefficient.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Commercially available extruded adsorbents are not of uniform size. While the diameter appears to be nearly the same, the length varies greatly. It is generally accepted to use an equivalent spherical radius, \bar{r} , defined as the radius of a sphere having the same external surface-to-volume ratio. In the analysis of Kärger and Ruthven (1992), this is shown to be valid for small changes in conversion. In the case of an infinite cylinder and a material with the equivalent spherical radius determined as stated above, the dimensionless time required to reach 90% conversion is different by about 25%. At 50% conversion, the error is <5%.

The second assumption deals with the structure of the pellet itself, as this will in large part define the nature of the model. The structure of the solid pellet has been conceptualized in numerous ways (Ramachandran and Doraiswamy, 1982; and Kulkarni and Doraiswamy, 1986), ranging from the simplest approach of a spherical, homogenous, nonporous pellet to a porous pellet containing subparticles that may also be porous (Kärger and Ruthven, 1992). The introduction of some type of pore structure also requires an assumption concerning the pore behavior. The pore can either remain constant or change as a function of time.

A third assumption that must be validated is that the process can be considered to occur under isothermal conditions. The models described below assume that the system being studied is isothermal. However, when studying an adsorption/reaction process, the possibility that this assumptions might be invalid as a result of the heat effects from adsorption and/or reaction must be considered. In such a case, the heat effects, which may be significant, must be accounted for in the analysis used to examine the experimental data. The assumption of isothermal conditions is generally only valid when the sorption rates are relatively slow (Kärger and Ruthven, 1992).

Lee and Ruthven (1978) describe the three possible resistances to heat transfer. These are (1) the resistance to heat transfer from the external surface of the pellet to the surrounding fluid; (2) the resistance to heat transfer from the external surface of an individual particle within the pellet or, in other words, the internal heat transfer resistances; or (3) the resistance to heat conduction within the individual particle. It was shown that for all cases the heat transfer from the external surface will be slower than heat transfer between the crystals of the sample. Based on this analysis, the temperature throughout the sample was uniform.

To determine the significance of the potential nonisothermal behavior, an analysis of maximum temperature variation due to the heat of adsorption and chemical reaction was made. The analysis of this system by Jubin (1995), using conservative assumptions for all variables, indicated a maximum delta temperature between the pellet and the bulk fluid as a result of both the heat of adsorption and chemical reaction of 0.37°C. Based on this result, it clearly appeared that the assumption of isothermal adsorption was substantiated.

Finally assumptions about the stability of the process system used in the experimental determinations are generally made. One of the common process assumptions is that of constant bulk gas-phase composition. This is either based on the use of a very large system, a true constant pressure system, or by careful control of a flowing gas stream. If this assumption is not made, then the changing composition of the gas phase must be addressed in the model.

Shrinking or Unreacted Core Model

One of the classic models used to describe noncatalytic reactions of solid particles with a surrounding fluid is the shrinking or unreacted core model. This model, as described by Levenspiel (1972, 1979), was developed by Yagi and Kunii in 1955 and contains five sequential steps for the gaseous reactant and product components.

For the reactant gases:

1. Diffusion through a boundary layer gas film which surrounds the solid particle.
2. Diffusion through the particle to the surface of the unreacted core.
3. Reaction with the solid reactant at the surface of the solid core.

And for the product gases:

4. Diffusion back through the reacted portion of the particle to the outside surface of the particle.
5. Diffusion through the boundary layer gas film surrounding the solid particle.

It was noted by Levenspiel (1972) that there may be significant variations in the relative importance of these five steps, depending on the relative magnitude of the associated resistances to mass transfer. Furthermore, in some situations, some of these steps are not relevant. For example, in the case of an irreversible reaction, steps 4 and 5 do not contribute directly to the observed resistances to the reactions. The same is true of a reaction producing no gaseous products.

The basic conversion equations for the first three steps have been developed. For a gas-solid reaction of the general form



and constant-size spherical particles, the following conversion-time expressions are relevant for the first three resistances and can be used to compare the observed loading rate data with the theoretical uptake curve.

Individual Controlling Resistances

In terms of the flux, the equations describing film diffusion control can be written based on either the moles of the diffusing component, A , or the moles of the solid reactant, B , that is reacted with A according to Eq. (2):

$$-\frac{1}{S_{ex}} \frac{dN_B}{dt} = -\frac{1}{4\pi r_a^2} \frac{dN_B}{dt} = -\frac{b}{4\pi r_a^2} \frac{dN_A}{dt} = bk_g (C_{Ag} - C_{As}) \quad (3)$$

For the limiting case when there is only film diffusion control, C_{As} approaches 0. And the fractional conversion, X_B , can be expressed in terms of the unreacted core radius by

$$\frac{t}{\tau_{gasfilm}} = 1 - \left(\frac{r_c}{r_a}\right)^3 = X_B \quad (4)$$

where the time for total conversion is given by

$$\tau_{gasfilm} = \frac{\rho_B r_a}{3bk_g C_{Ag}} \quad (5)$$

In a similar manner, expressions can be written for the case of ash diffusion alone. The resulting expression in terms of fractional conversion is

$$\frac{t}{\tau_{ash}} = 1 - 3(1 - X_B)^{2/3} + 2(1 - X_B), \quad (6)$$

where the time to complete conversion is given by

$$\tau_{ash} = \frac{\rho_B r_a^2}{6bD_e C_{Ag}}. \quad (7)$$

For chemical reaction control (rxn), the relationship for the conversion vs time is given by

$$\frac{t}{\tau_{rxn}} = 1 - \frac{r_c}{r_a} = 1 - (1 - X_B)^{1/3}, \quad (8)$$

where k_s is the assumed first-order reaction constant. The time to complete conversion is given by

$$\tau_{rxn} = \frac{\rho_B r_a}{bk_s C_{Ag}}. \quad (9)$$

Full Shrinking Core Model

In many situations, more than one of these resistances is a factor in determining the observed rate of conversion of the particle. The three individual rate expressions can be combined into a single expression (Levenspiel 1972, 1979).

$$-\frac{1}{S_{ex}} \frac{dN_B}{dt} = \left[\frac{b}{\frac{1}{k_g} + \frac{r_a(r_a - r_c)}{r_c D_e} + \frac{r_a^2}{r_c^2 k_s}} \right] C_{Ag}. \quad (10)$$

This expression can easily be converted into a more usable form for the analysis of the gravimetric loading data by expressing the unreacted core radius, r_c , in terms of conversion, found in Eq. (4), yielding

$$-\frac{1}{S_{ex}} \frac{dN_A}{dt} = \left[\frac{b}{\frac{1}{k_g} + \frac{r_a(1 - (1 - X_B)^{1/3})}{(1 - X_B)^{1/3} D_e} + \frac{1}{(1 - X_B)^{2/3} k_s}} \right] C_{Ag}. \quad (11)$$

This is then an expression that can be used to determine the values of the three adjustable parameters through a process of curve fitting to minimize the error between experimentally obtained flux or loading data and the calculated values.

Alternately, it has been shown by Levenspiel (1972, 1979) that the total time to reach a given conversion is the sum of the times for the individual mechanisms to reach the same conversion. In other words,

$$t_{total} = t_{gasfilm} + t_{ash} + t_{rxn}. \quad (12)$$

Likewise, for the complete conversion, the time is given by

$$\tau_{total} = \tau_{gasfilm} + \tau_{ash} + \tau_{rxn}. \quad (13)$$

By replacing the expressions for the individual times to reach a set conversion given by Eqs. (4), (6), and (8) for the individual times into Eq. (12), an expression is obtained that allows the determination of the extent of the conversion for any value of time. It should be noted that the conversion is found as the root of the following equation:

$$t_{total} = X_B \tau_{gasfilm} + \left[1 - 3(1 - X_B)^{2/3} + 2(1 - X_B) \right] \tau_{ash} + \left[1 - (1 - X_B)^{1/3} \right] \tau_{rxn}. \quad (14)$$

Isothermal Models for Porous Media

The previous models do not consider the nature of the media, which in the case of zeolites may be important. Kärger and Ruthven (1992) summarize numerous studies which have focused on the adsorption from the gas phase into a porous zeolite-type structure. In general terms, these studies attempted to incorporate the porous nature of the zeolite pellets by addressing diffusional resistances arising from (1) the micropores, (2) the macropores, or (3) a combination of both macropore and micropore resistance. These models are further summarized as follows.

Micropore Diffusion Controlling

For the case of micropore diffusion alone, the following transient sorption expression is presented by Kärger and Ruthven (1992):

$$X_B = \frac{m_t}{m_\infty} = 1 - \frac{6}{\pi^2} \sum_{n=1}^{\infty} \frac{1}{n^2} \exp\left(-\frac{n^2 \pi^2 D_c t}{r_i^2}\right). \quad (15)$$

The two primary assumptions that must be noted are the use of constant diffusivity and that the change in the adsorbed phase concentration is small such that gas phase or surface composition remains constant (Ruthven, 1984).

This model reduces to

$$X_B = \frac{m_t}{m_\infty} = 1 - \frac{6}{\pi^2} \exp\left(-\frac{\pi^2 D_c t}{r_i^2}\right) \quad (16)$$

as the time term becomes large. Kärger and Ruthven (1992) point out that a plot of $\ln[1 - m_t/m_\infty]$ vs t should approach a straight line. This line will have a slope of $-\pi^2 D_c / r_i^2$ and an intercept of $\ln(6/\pi^2)$.

Macropore Diffusion Controlling

For macropore diffusion the solution is the same with the D_c/r_i^2 term replaced by

$$\frac{D_p}{r_a^2} \left(\frac{1}{1 + K^* (1 - \varepsilon_p) / \varepsilon_p} \right), \quad (17)$$

where K^* is an equilibrium constant which has an Arrhenius-type temperature dependence.

Combined Micropore and Macropore Diffusion Control

Dual-resistance systems in biporous media have been studied by several researchers. Ruckenstein et al. (1971), discussing the dissertation of Vaidyanathan (1971), pointed out that the macropore diffusivity and micropore diffusivity may, in many cases, be quite different by orders of magnitude. In such a case, the observed diffusion process may be significantly affected by the particular structure of the porous solid. The model developed by Vaidyanathan (1971) appears to be the first to address the analysis of transient sorption with the competing effects of macropore diffusion and micropore diffusion combined. The assumptions made in the development of this model are as follows:

1. The system is isothermal.
2. The particle is spherical and composed of small uniform spherical microporous particles.
3. The sorbent is exposed to an infinite source of sorbate such that the surface concentration is constant.
4. The sorbent is exposed to a step change in sorbate concentration at time zero.
5. Adsorption occurs at the walls of both the macropores and the micropores.
6. Linear isotherms apply.

Ma and Lee (1976) and Lee (1978) extended the original model to address the case of a finite quantity of sorbate. Of these, the model proposed by Lee appeared to be a bit simpler and faster in terms of computer time to apply as it contained only one double summation and the others contained the ratio of two double summations. In the case of constant gas-phase concentrations, the mathematical solution developed by Lee simplifies to

$$X_B = \frac{m_t}{m_\infty} = 1 - \frac{18}{\beta + 3\alpha} \sum_{m=1}^{\infty} \sum_{n=1}^{\infty} \left(\frac{n^2 \pi^2}{p_{n,m}^4} \right) \frac{e^{-p_{n,m}^2 D_c t / r_i^2}}{\left\{ \alpha + \frac{\beta}{2} \left[1 + \frac{\cot(p_{n,m})}{p_{n,m}} (p_{n,m} \cot(p_{n,m}) - 1) \right] \right\}}, \quad (18)$$

where

$$\alpha = \frac{D_c}{r_i^2} \frac{r_a^2}{D_p}, \quad (19)$$

$$\beta = \frac{3\alpha(1 - \varepsilon_p)q_\infty}{\varepsilon_p C_{A,0}}, \text{ and} \quad (20)$$

$p_{n,m}$ is given by the roots of the transcendental equation

$$\alpha p_{n,m}^2 - n^2 \pi^2 = \beta (p_{n,m} \cot(p_{n,m}) - 1) \quad (21)$$

Vaidyanathan (1971) discussed the physical significance of the α and β terms. α is the ratio of the time constants for macropore-to-micropore diffusion. For values of α less than 10^{-3} , macropore diffusion is much faster than micropore diffusion and the process can be considered to be a two-step process for all practical purposes. For values of α greater than 10^{+2} , macropore diffusion controls (Ruckenstein et al., 1971). In the range of α between these two limiting cases, both mechanisms are important. The term $\beta/3\alpha$ represents the ratio of sorption in the micropores to macropores at equilibrium. Thus a large value would indicate sorption primarily in the micropores.

Detailed description of other models that were evaluated for potential application to understand the behavior observed for this system may be found in Jubin (1995). These models include

- progressive conversion or volume reaction,
- nonisothermal micropore/macropore diffusion, and
- nonisothermal bed diffusion controlling.

Experimental Objectives

Conditions

As in numerous other studies [Jubin (1980, 1982), Burger and Scheele (1981), Scheele et al. (1983), and Scheele and Burger (1987)], methyl iodide was chosen as the chemical form for the iodine in this study because it is a more difficult form to retain in an adsorption process than elemental iodine. If CH_3I can be successfully retained on the silver mordenite, then the elemental iodine will also be retained (Scheele and Burger, 1987).

Experimental data were collected over a range of conditions selected to differentiate between the anticipated primary controlling mechanisms, and further data were collected to evaluate specific process behavior observed in the initial series of tests. The variables considered were (1) pellet diameter, (2) methyl iodide concentration, (3) gas velocity, (4) temperature, and, later in the study, (5) water vapor content of the carrier gas. The first four conditions were selected to examine the effects of these primary variables by varying each one while holding the others at a standard condition. Two duplicate tests were planned to allow a determination of the level of experimental error. Table 1 provides a listing of the ranges considered for each of the independent variables.

Following the completion of the initial series of tests, T3 to T13, 13 additional tests were conducted to explore specific aspects of this process and to gain further clarification on the behavior observed during the initial tests. Four specific avenues examined (1) the effects of either increasing or decreasing the water vapor content of the air, (2) further lowering of the gas velocity, (3) lower CH_3I concentration, and (4) lower operating temperatures. Two unique runs were also conducted, the first to determine the amount of water adsorbed from the instrument air and the second to determine the CH_3I loading on the zeolite media without chemical reaction occurring. Table 2 presents a listing of the conditions studied in each test.

Table 1 General test conditions.

Variable	Range or values considered
Pellet diameter (in.)	1/16 and 1/8
Gas velocity (m/min)	1, 2, 5, and 10
Methyl iodide concentration (mg/m ³)	250, 500, 1000 , and 1500
Temperature (°C)	125, 150 , and 200
Water content [dew point (°C)]	-40, -15 to -18 , -11

Note: Bold values were considered reference conditions.

Following the completion of the initial series of tests, T3 to T13, 13 additional tests were conducted to explore specific aspects of this process and to gain further clarification on the behavior observed during the initial tests. Four specific avenues examined (1) the effects of either increasing or decreasing the water vapor content of the air, (2) further lowering of the gas velocity, (3) lower CH₃I concentration, and (4) lower operating temperatures. Two unique runs were also conducted, the first to determine the amount of water adsorbed from the instrument air and the second to determine the CH₃I loading on the zeolite media without chemical reaction occurring. Table 2 presents a listing of the conditions studied in each test.

These supplemental tests specifically provided data on the impact of lower gas velocities (T15, T16, and T18) in an effort to resolve any effects of the gas film and lower CH₃I concentrations (T14) on possible reaction rate controlling conditions. The impacts of variations in the water vapor content of the gas stream were examined by adding a small additional amount of water vapor (T13) and by further drying the instrument air carrier gas (T18).

Test Equipment

Figure 1 is a schematic diagram of the process system showing the principal equipment components. The entire system was located inside a walk-in laboratory hood, with the exception of the dry air, hydrogen/argon and nitrogen cylinders, and the process control and data collection instrumentation.

To briefly describe the test system, a stream of dilute methyl iodide was fed into the test reaction chamber in which the bed containing the known quantity of selected sorbent material was located. The test bed, composed of a thin layer of Ag^oZ pellets, one to two pellets deep, was supported by a stainless steel wire basket, which was lowered into a glass gas reaction chamber. In this system, a thin layer of adsorbent media was exposed to the sorbate stream such that all pellets were exposed to a uniform gas composition. Thus the effects of a changing gas composition through the test bed were considered to be negligible. This method was selected to provide a constant pressure system and to allow for the direct measurement of the quantity of iodine adsorbed on the bed rather than monitor small changes in gas composition. This is also referred to as a "single pellet system."

The glass gas reaction chamber was connected to the feed gas header. The basket itself was suspended from a tripod device which rested on the pan of the electronic balance (Sartorius Instruments Model LC620P) used to measure the weight changes of the sorbent material. This configuration allowed the basket to be free floating within the reaction chamber. Thus it was possible to directly determine the weight change of the test material in a flowing system. Weight data were collected from the electronic balance via a serial connection to an adjacent personal computer.

Table 2 Summary of single-pellet tests.

Test No.	Size (in.)	Velocity (m/min)	CH ₃ I concentration (mg/m ³)		H ₂ O added	Temperature (°C)	Notes
			Planned	Actual ^a			
Initial series							
3	1/16	10	1000	1559		150	
4							Test aborted
5 ^b	1/8	10	1000	1275		150	
6	1/16	10	1000	1505		150	
7	1/8	10	1000	1523		150	
8	1/16	5	1000	1675		150	
9							Test aborted
10 ^c	1/16	10	1000	1190		200	
11	1/16	10	1500	1634		150	
12 ^c	1/16	10	500	837		150	
Supplemental tests							
13 ^c	1/16	10	1000	1367	yes	150	
14 ^c	1/16	10	250	355		150	
15 ^c	1/16	2	1000	1410		150	
16	1/16	1	1000	1124		150	
17	1/16	10	0	0		150	Air only
18	1/16	1	1000	1217	dry	150	
19	1/16	10	1500	2150		150	Short run
20	1/16	10	1500	1636		150	Short run
21 ^b	1/16	10	1000			200	
22	1/8	10	1500	1367		150	
23 ^b	1/16	10	1000		yes	150	Water data missing
24 ^b	1/8	15	1000			150	Data questionable
25	1/16	10	1000			150	NaZ loading
26	1/16	10	1000	1059		125	

^aActual CH₃I concentrations determined by pressure drop in the gas supply cylinder vs time measurements.

^bData from runs T5, T21, T23, and T24 not used in analysis due to equipment difficulties or questions of validity or conditions.

^cData quality may be impacted by possible temperature shift at balance.

ORNL-DWG 91-4804R

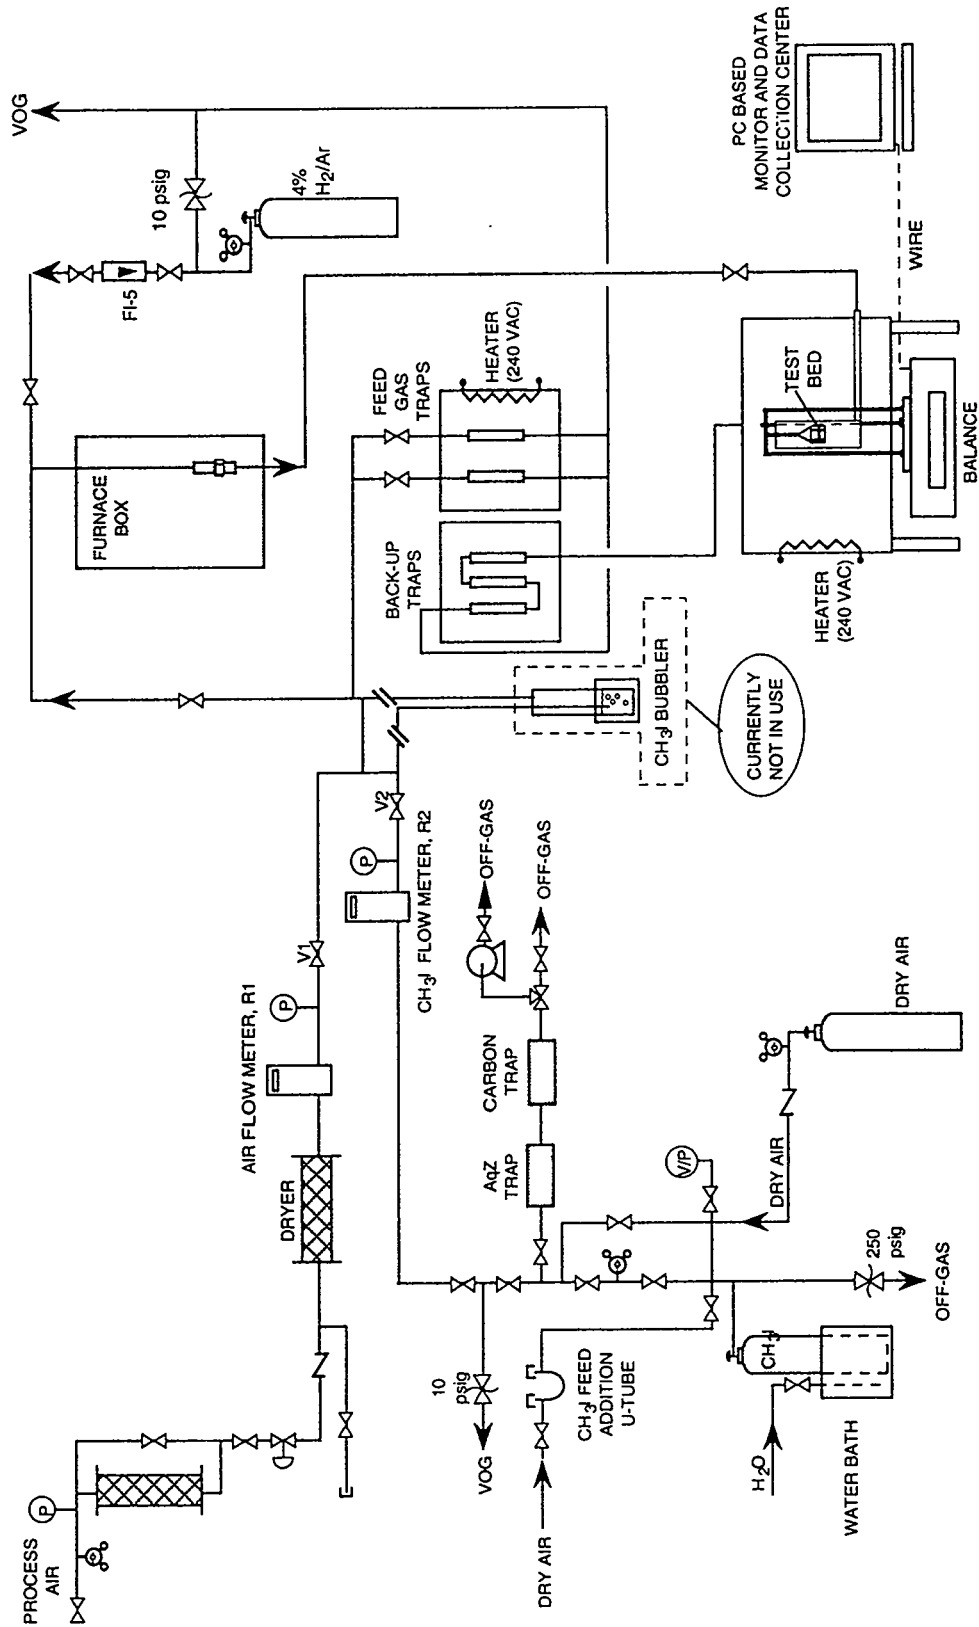


Figure 1 Schematic of experimental setup.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The glass reaction chamber was mounted in an electrically heated enclosure used to control process temperature. The heated enclosure was fabricated from a rigid insulating construction material. A secondary Plexiglas box was placed over this enclosure to prevent disturbances to the balance due to air currents in the hood. The gas that passed through the sorbent test material flowed through a series of 1-in.-I.D. backup filters loaded with either activated charcoal or silver-exchanged faujasite. The gas leaving the backup filters was discharged through the building vessel off-gas system.

The Sartorius Instruments Model LC620P poly-range electronic balance has a capacity of 120/240/620 g. Readability of the balance is 0.001/0.002/0.005 g, and standard deviation or reproducibility is $\leq \pm 0.001/0.001/0.003$ g. Gas flowrates were controlled by needle valves and standard gas regulators. Gas flowrates were monitored either by calibrated rotometers or electronic mass flow meters manufactured by Omega Engineering, Inc. The Omega flow meters have an accuracy of $\pm 2\%$ of full scale. Temperature control was accomplished by placing the entire bed in an electrically heated insulated enclosure. Temperature was controlled by a Barber-Coleman controller coupled with a type K thermocouple junction inserted directly into the flowing gas stream above the bed of adsorbent material.

Table 3 presents, in outline form, the sequence of steps used to pretreat the AgZ prior to loading with methyl iodide and the flush or post-treatment steps to flush CH_3I from the bed and thus determine the amount chemisorbed vs physisorbed. Each of these pretreatment, loading, and post-loading steps were monitored for weight changes, with the data being stored in a computer file.

Experimental Results

Optical and Supporting Characterization Studies

Five samples of the mordenite materials used in this study were analyzed for pore size distribution, density, and characterization of the uniformity of silver and iodine distribution where applicable. The samples analyzed were the 1/16-in. sodium mordenite, the 1/16- and 1/8-in. AgZ, and the 1/16- and 1/8-in. AgZ pellets from tests T19 and T20, respectively. The last two samples were analyzed only for silver and iodine distribution.

The topography of the material was shown in secondary electron images (SEI). Back-scattered electron images (BEI) showed variations in the image intensity across a portion of the pellet which is related to variations in the average atomic number in the region under examination. The specific distributions of silver, iodine, silicon, and aluminum across the specimen were shown by elemental maps.

In general, the BEI taken across the entire cross section of several fractured AgZ pellets showed no significant variation in the average atomic number (Walker, 1994). On one or two pellets, some localized accumulation of the silver was noted in a few small areas. Aside from these few areas, no silver gradient was noted within the pellets. Prior to hydrogen pretreatment, the pellets displayed uniform distribution of the silver. However, following pretreatment with 4.5% hydrogen and subsequent loading with methyl iodide (samples from tests T19 and T20), very small particles (< 1 or 2μ) were seen on the surfaces of the larger crystalline structure. An elemental map obtained through energy-dispersive X-ray analysis of one pellet showed that these fine particles contain a higher concentration of silver than the concentration in the surrounding material. In addition to the presence of these fine silver-containing particles, there remained a relatively uniform distribution of silver across the mordenite pellet cross section. No specific area of silver depletion was detected when compared with the silver distribution prior to hydrogen pretreatment and iodine loading.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

A low concentration of iodine was also observed to be uniformly distributed in the mordenite pellets analyzed from Test T19 (24% final conversion) and Test T20 (35% final conversion). Examination of the fine silver-containing particles showed that while these are rich in silver, they contained virtually no iodine. Using the same technique on the larger mordenite particles or crystals showed that they, on the other hand, contained a low concentration iodine that appeared to be uniformly distributed.

Table 3 Outline procedure for single-pellet CH₃I loading tests.

Bed pretreatment (standard for all tests)
Drying
24 h air
11.4 L/min of dry instrument air
Temperature: 150°C
Nitrogen temperature equilibration
4+ h N ₂
0.4 L/min
Temperature: 200°C
Silver reduction
8 to 20 h 4% H ₂ /Ar
0.4 L/min
Temperature: 200°C
Second nitrogen temperature equilibration
4+ h N ₂
Same flow rate as that to be used in CH ₃ I loading
Same temperature as that to be used in CH ₃ I loading
Loading conditions (specific test conditions listed in Table 2)
H ₂ O vapor content (dew point)
>-15°C (7.3×10^{-5} mol/L) or -40°C (5.6×10^{-6} mol/L)
Pellet diameters
1/16 or 1/8 in.
Gas velocities
1, 2, 5, or 10 m/min
CH ₃ I gas concentrations
250, 500, 1000, or 1500 mg/m ³
Bed temperature
125, 150, or 200°C
Air flush (standard for all tests)
24+ h air
11.4 L/min or dried instrument air
Temperature: 150°C

The SEI of the pellets examined showed the voids and macropores present in this material. The SEI also showed that there was the possibility for significant variation from pellet to pellet. These variations fell into two categories. First there was some variation in the general structure of the pellets. Some were observed to have substantial voids in the pellet interior, while other pellets appeared to contain separate cores. The second type of variation involved the crystalline particles that comprised the overall structure. Some were well formed, and others had very rough and irregular surfaces. In

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

addition, they appeared to vary in size and overall shape. Both the 1/16- and 1/8-in. pellets were composed of individual crystals estimated to be 4.0μ in equivalent spherical diameter.

What appears to be a shrinking core behavior, as shown by color changes in the pellets, was observed through unpublished optical photographs made during the deep-bed studies previously completed and reported by this author [Jubin (1980, 1982)]. The test from which these pellets were taken was conducted under the following conditions: a bed temperature of 200°C , a CH_3I concentration of 1000 mg/m^3 , and a gas velocity of 10 m/min at standard temperature and pressure. The loadings for the individual pellets were not determined, and only the average loading on each of the 2.54-cm-thick bed segments was measured by tracer analysis. At very low CH_3I loadings on the AgZ ($\sim 3\%$ average conversion) the pellet from the fourth or last bed segment shows no sign of any visible ring. As the average bed segment loading increases, a clearly developed ring around the core is apparent. This is shown in Fig. 2 at an average bed segment conversion of $\sim 19\%$. However, at higher average loadings ($\sim 40\%$ conversion), the color variation across the diameter of the pellet virtually disappears (Fig. 3). In Fig. 3, which shows several pellets from the first bed segment, it appears that only a very small core remains in one pellet while in the other pellet no core is visible.

Baseline Adsorption Data

Water Uptake by AgZ

One obvious concern in analyzing the CH_3I uptake data was the possible impact of concurrent weight gain by the adsorption of water from the flowing gas stream. Test T17 was performed to measure the quantity of water adsorbed as a function of time. After approximately the first 16 h that the bed was subjected to the flowing instrument air at 150°C , an observed gain of approximately 0.05 g had occurred on the 2.5416-g bed and the loading appeared to have leveled off. After 40 h the total had risen to about 0.07 g. Over the next 50 h, the loading appeared to stabilize at a total weight gain of about $0.075 \pm 0.005 \text{ g}$. These values must be compared with the total weight gains observed when CH_3I was present in the flowing gas stream to determine their significance and possible impact on the CH_3I loading data. The typical weight gain was on the order of 0.45 g in 60 h, as in the case of T10.

CH_3I Loading on NaZ

It was assumed at the start of this study that any weight gain on the mordenite pellet was primarily associated with chemical bonding with the silver contained in the pellet. Test T25 was conducted to determine the loading rate and quantity of CH_3I adsorbed on the unexchanged sodium form of the mordenite. In this run, 0.0807 g was loaded over the 22-h test period. Following the loading cycle, an air purge of 70 h was conducted. During this period, a net gain of 0.0353 g was observed that must be attributed to a water vapor. The total CH_3I loading should be compared with loading curves from tests such as T3, in which 0.335 g was gained over the same time period to examine the significance. Based on these data, it would appear relatively safe to assume that the observed weight gains on the beds that were measured during the CH_3I loading tests required a chemical reaction between the CH_3I and the silver.

CH_3I Adsorption Studies

Figures 4 and 5 are examples of the CH_3I loading curves that were obtained for all of the experimental runs. The air flush portions of the tests may also be included in the loading files as this phase of the tests was conducted as a continuation of the test conditions with only the CH_3I flow

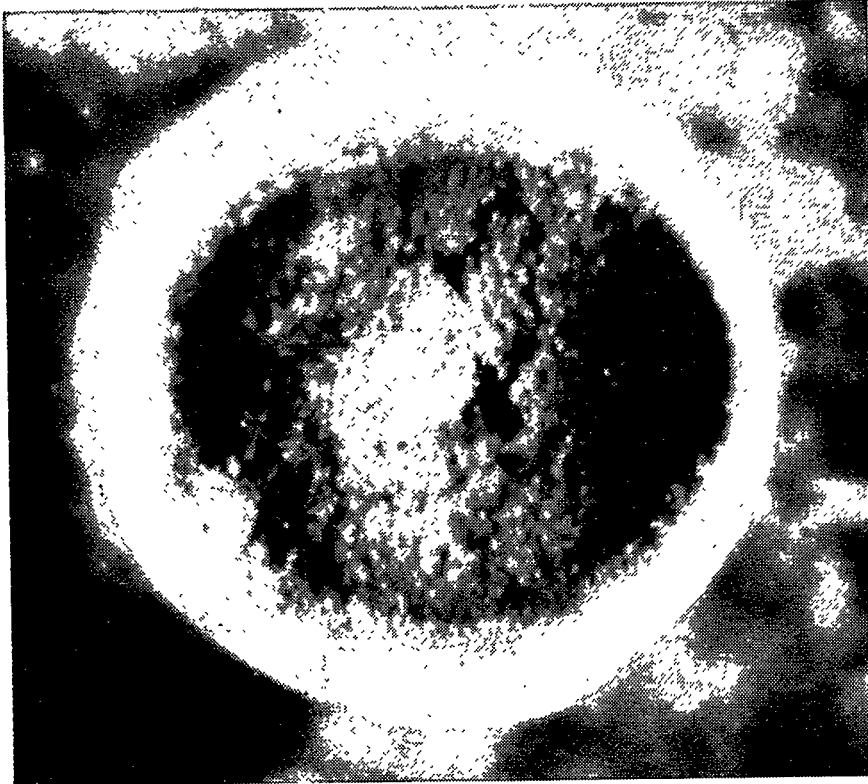


Figure 2 Optical image of 1/16-in. AgZ from bed with an average conversion of ~19%.



Figure 3 Optical image of 1/16-in AgZ from bed with an average conversion of ~40%.

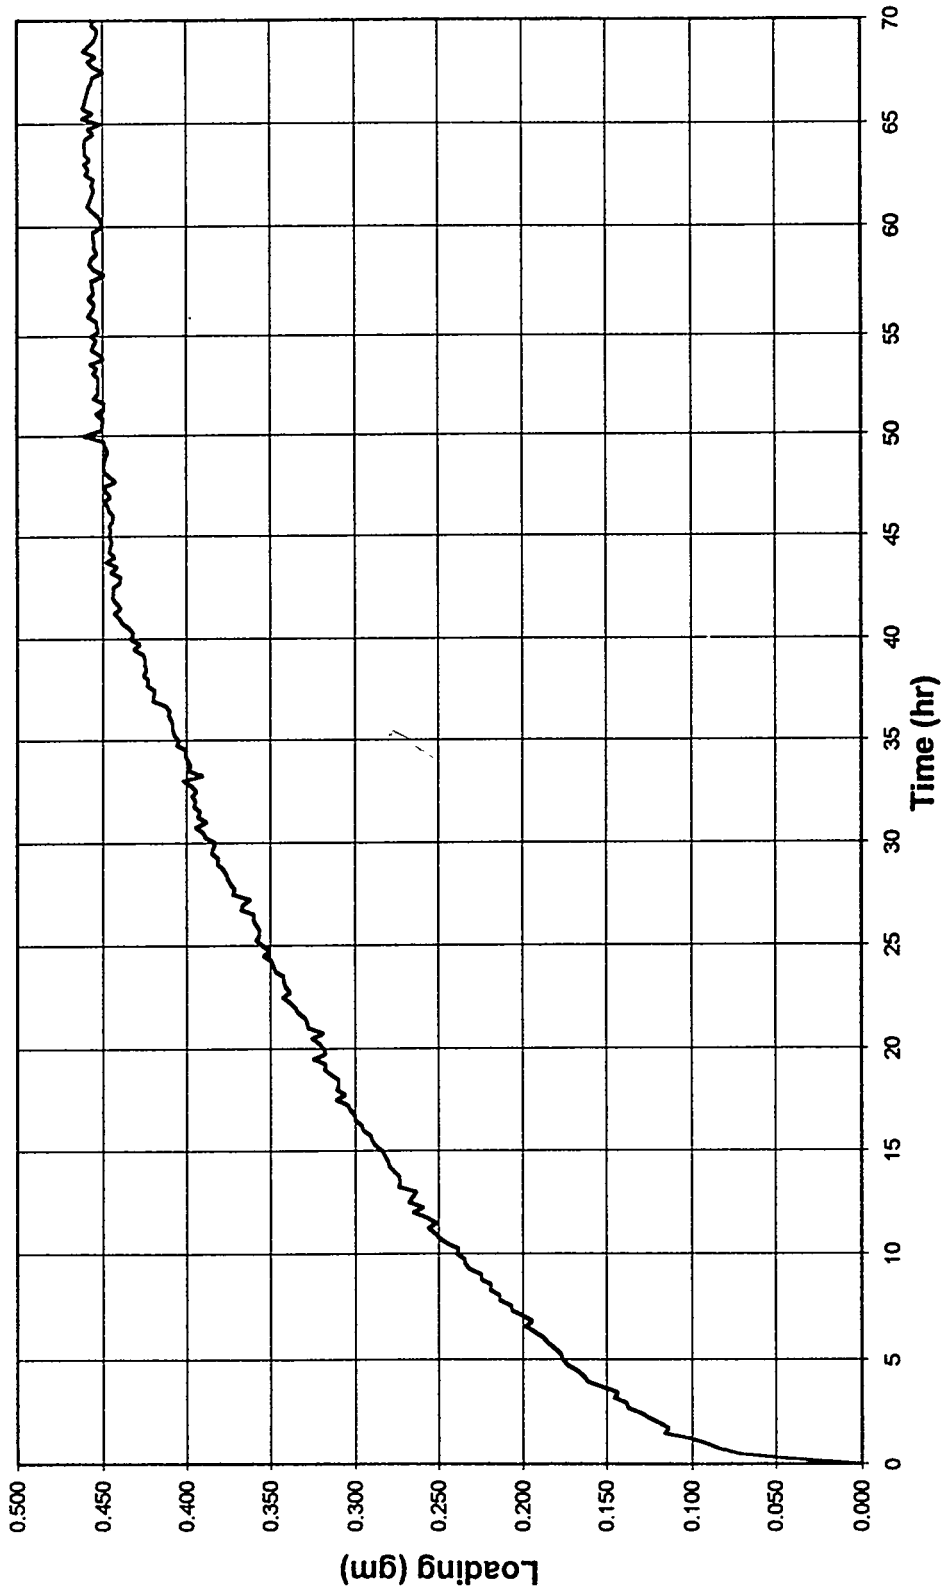


Figure 4 CH₃I loading curve from Test T3.

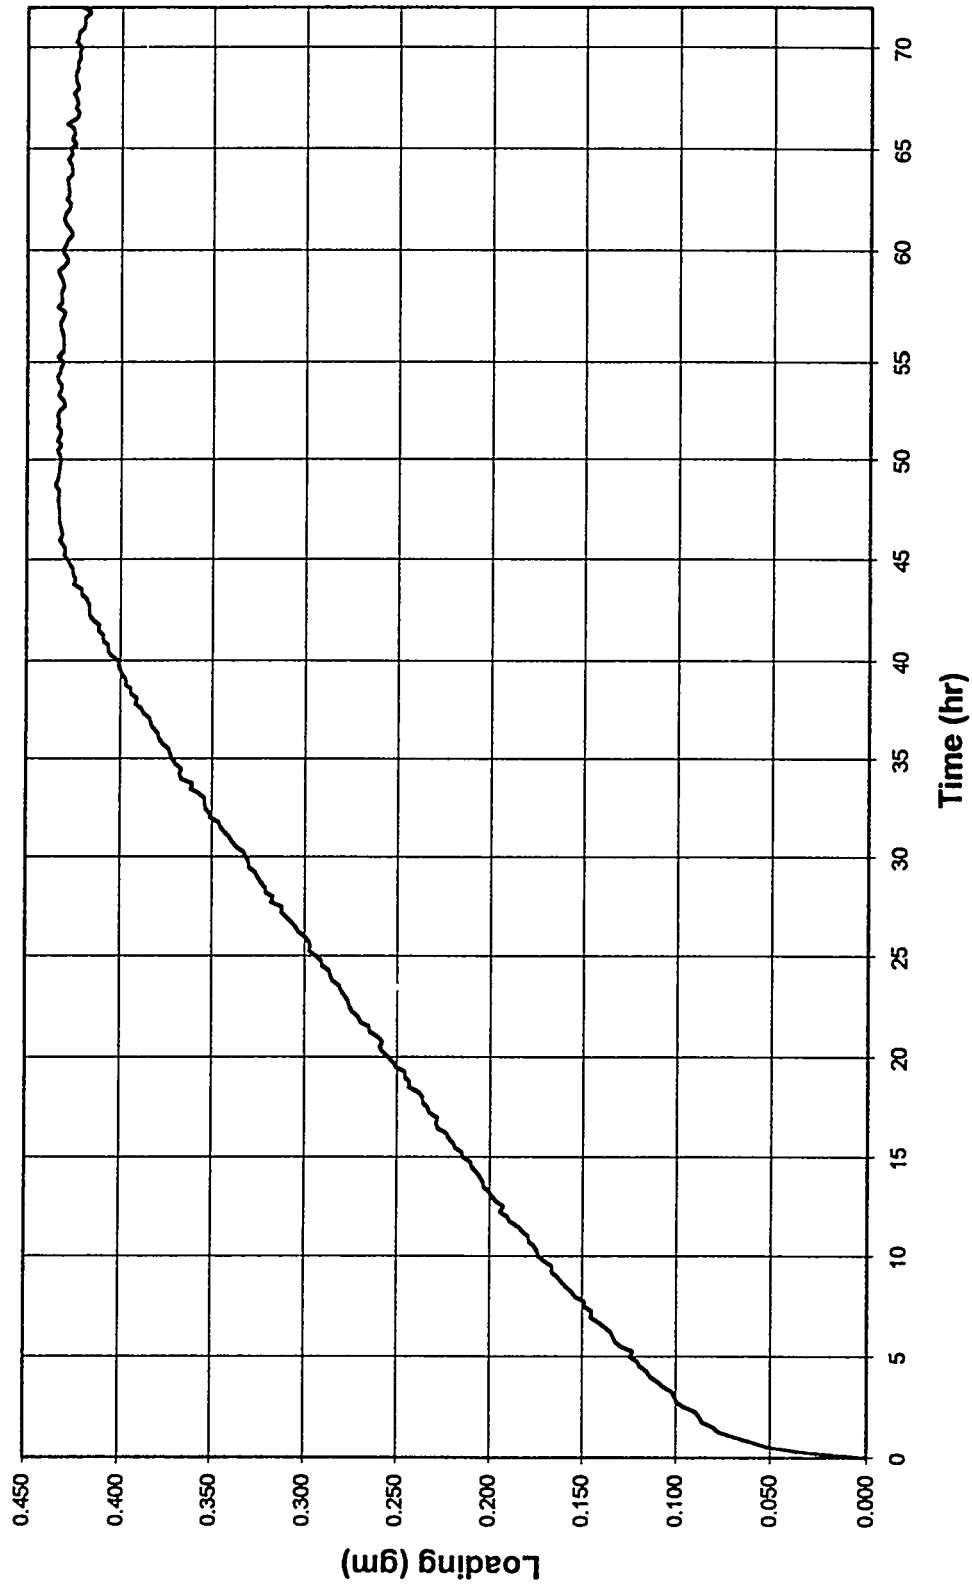


Figure 5 CH₃I loading curve from Test T22.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

stopped. The total weight loss from the pellets during the air flush was generally about 1 to 2% of the total iodine loaded. A summary of the actual test conditions is presented in Table 2.

Discussion

Analysis of Optimization Techniques and FORTRAN Implementation of Potential Models

To determine the mechanism(s) controlling the mass transfer of CH_3I onto the silver-exchanged mordenite, the experimentally obtained data were compared against widely accepted models of adsorption behavior. Each of the nine models from the literature was translated into appropriate FORTRAN code using Microsoft Corporation's Powerstation FORTRAN compiler, Version 1.0. In each case, the formulation of the model equations is such that given the appropriate rate-controlling parameters, the degree of conversion or a mass flux at a specific time can be directly or indirectly computed. The term "indirectly computed" means that the conversion cannot be directly computed but must be found by iteration or by some root-finding method. The potential models were evaluated against the observed adsorption uptake curves. The best values for the rate-controlling parameters were determined by linear or multidimensional regression techniques using the experimentally obtained loading data as the reference.

The two primary criteria applied to the selection of the appropriate model for this system were (1) the ability of the model to account for the systematic variation in operating parameters without arbitrary changes in the adjustable parameters and (2) the determination of consistent diffusion coefficients for the experimental conditions evaluated.

Two classes of data fitting models were employed in this study. The first, and by far the simplest, was the single parameter model. In this case, it was a relatively simple matter to find the minimum using any of a variety of minimization techniques. The FORTRAN function FMIN described by Forsythe et al. (1977) was used for all single parameter models. This function used a combination of a golden section search technique and successive parabolic interpolation. This provided a very robust function not requiring the determination of derivatives.

Several of the models required multidimensional minimization to extract the relevant parameters. These models included both the full shrinking core and the bimodal. The determination of "best fit" to the experimental data in the case of a multiparameter model was significantly more complex. Press et al. (1992), in discussing multidimensional minimization, recommend the POWELL method as being faster in most cases and state that it can be used when derivatives are not easy to calculate.

CH_3I Adsorption-Model Comparisons

General Model Requirements

In the identification of a model to describe the adsorption of CH_3I onto silver-exchanged mordenite, it was required that certain general observations be accounted for by the selected model. These were as follows:

1. The possible formation of a rapidly shrinking shell of reacted material as observed in Figs. 2 and 3, noting, of course, that the unreacted core was no longer visible once 30-50 % conversion was achieved.

Table 4 Comparison of the simple sum of the square of the error in the conversion terms for the shrinking core models.

Run No.	Gas film		Ash diff		Rxn control		Gas film + Ash + Rxn			
	k_g (cm/s)	Error ^a	D_c (cm ² /s)	Error	k_s (cm/s)	Error	k_g (cm/s)	D_c (cm ² /s)	k_s (cm/s)	Error
T3	7.44E-02	2.46E+00	1.05E-03	6.89E-03	1.05E-01	1.16E+00	9.90E+99	1.05E-03	1.02E+06	6.89E-03
T6	7.76E-02	3.44E+00	1.33E-03	4.52E-02	1.20E-01	1.16E+00	9.90E+99	1.56E-03	8.42E-01	1.73E-02
T7	1.14E-01	1.74E-01	1.70E-03	6.41E-01	1.36E-01	1.76E-01	9.18E+99	4.72E+11	1.36E-01	1.76E-01
T8	4.20E-02	1.93E-01	3.17E-04	8.44E-01	5.00E-02	2.27E-01	9.20E+99	4.74E+11	5.00E-02	2.27E-01
T10	1.13E-01	4.56E+00	2.75E-03	4.73E-01	2.08E-01	1.85E-01	9.90E+99	8.86E-03	2.99E-01	3.13E-02
T11	8.33E-02	5.30E-01	6.85E-04	4.50E-03	1.01E-01	3.49E-01	9.90E+99	6.85E-04	1.36E+06	4.50E-03
T12	4.74E-02	2.30E-02	1.87E-04	1.91E-01	5.20E-02	1.43E-02	9.90E+99	3.01E-03	5.59E-02	1.27E-02
T13	5.52E-02	3.94E-02	4.85E-04	9.70E-01	6.76E-02	6.93E-02	9.64E+99	4.22E+12	6.76E-02	6.93E-02
T14	1.61E-01	3.17E-01	9.94E-04	8.08E-02	1.86E-01	2.03E-01	9.90E+99	1.66E-03	4.95E-01	3.26E-02
T15	4.82E-02	2.55E-02	3.32E-04	1.19E+00	5.67E-02	9.42E-02	9.89E+99	9.13E+12	5.67E-02	9.42E-02
T16	5.80E-02	4.39E-01	6.59E-04	6.81E-01	7.63E-02	6.20E-02	9.90E+99	4.12E-03	9.24E-02	1.97E-02
T18	5.08E-02	3.32E-02	3.10E-04	4.93E-01	5.87E-02	2.43E-03	9.90E+99	1.35E-02	6.03E-02	1.87E-03
T19	1.14E-01	6.12E-02	5.08E-04	1.60E-04	1.27E-01	4.93E-02	9.90E+99	5.08E-04	6.11E+06	1.60E-04
T20	2.87E-01	2.11E-01	3.88E-03	1.87E-03	3.40E-01	1.44E-01	9.90E+99	4.19E-03	5.05E+00	1.21E-03
T22	9.21E-02	1.05E+00	2.16E-03	2.98E-01	1.23E-01	3.89E-01	9.90E+99	4.38E-03	2.54E-01	9.79E-02
T26	7.36E-02	9.91E-01	5.08E-04	9.40E-02	8.67E-02	7.95E-01	9.90E+99	5.08E-04	2.07E+13	9.40E-02
Total errors		1.46E+01		6.01E+00		5.08E+00				8.87E-01

^aError terms are the resultant sum of the square of the error between the experimental data and the proposed model.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

2. Fairly uniform iodine loading across the pellet diameter at 30 to 40% conversion of silver or greater.
3. Observation from past studies that higher loading was achieved prior to breakthrough with increased operation temperature.

Shrinking Core Model

The regression analyses for the shrinking core model is presented in Table 4. By examining this table, it is clear that the diffusion through the gas film was not the controlling mechanism. In virtually every case in which the parameters for three terms of the full shrinking core model were used as adjustable parameters in the minimization of the error between the model and experimental data, the computed value for k_g was on the order of 10^{100} cm/s. This value was the upper limit set in the search routines. In the few cases where it did not reach the upper bounds, the value is still above 10^{10} cm/s. The substitution of this value in the Eq. (5) for $\tau_{gasfilm}$ and the subsequent application into summation of the resistances showed that the resistance was mathematically negligible. Further, the values of k_g determined for the gas film alone were compared with the values of k_g as estimated by use of the Sherwood number and the molecular diffusivity D_{AB} . The values of k_g estimated by the Sherwood number were on the order of 3 to 9 cm/s. However, if the assumption was made that the controlling resistance was the gas film, then the values for k_g determined by the least-squares curve fitting method ranged from 0.04 to just over 0.3 cm/s. Finally, the shape of the uptake curve was not indicative of gas film resistance control.

Thus having ruled out gas-phase control and continuing with the shrinking core analysis, there appeared to be two distinct classes of behavior or types of loading curves. The first class may be described by diffusion control through the ash layer, which appeared to describe several of the cases (e.g., T3); however, in most of the runs, the loading curve appeared to have a "knee" which the shrinking core model cannot fit. These uptake curves tended to show a rapid weight gain followed by a slower rate of weight gain. This "knee" may also be an indicator that possibly two or more mechanisms were controlling the adsorption process and that there was a transition from one to the other.

If the ring observed on the pellets, as shown in the Fig. 3, was related to the loading of iodine on the pellet, then it was easily shown that at 40% utilization the radius of the unreacted core should be ~78% of the overall pellet radius. The observed radius in Fig. 3 was only ~27% of the pellet radius for the pellet that still shows a core. This 27% equates to ~93% conversion if a strict shrinking core model was correct. It should also be recalled that the BEI of the pellets from T19 and T20 showed no significant iodine gradient, which appeared to be relatively consistent with the photographic evidence at higher iodine loadings. These data tended to lead to the conclusion that while there may initially be the appearance of the shrinking core-type behavior, there was also a second slower process that accounted for the loading above some nominal level of loading associated with the shrinking core.

The effective diffusivity calculated from the data collected over the time periods of the first 40 data points (10 h) ranges from 1.84×10^{-4} to 3.91×10^{-3} cm²/s for the runs that did not exhibit any thermal upset in the balance. This effective diffusivity was also compared with that predicted by fundamental analysis of the zeolite pore structure and physical constants for the diffusing component. By comparison of the above effective diffusivities with the combined effective diffusivities for either the Knudsen diffusivity in the micropore/mesopore which are in the range of 5×10^{-5} to 5×10^{-4} cm²/s or the effective molecular diffusivity of $\sim 1.4 \times 10^{-2}$ cm²/s in the macropore range, it was observed that the value obtained by curve fitting falls between the two bounding cases. Using the shrinking core model, it was possible to find a set of parameters that seems to successfully model each individual loading curve. However, it was less obvious why some sets of data were diffusion controlled and other similar sets

appeared to be reaction controlled. This model by itself was unable to explain the apparent change in controlling mechanism. However, it provides strong evidence that

1. the mass transfer process was not controlled by the gas film resistance; and
2. there was a diffusional component, and the effective diffusivities in the first few hours of loading were in the range of 1.84×10^{-4} to 3.91×10^{-3} cm²/s for the runs in which the data showed no thermal upset in the balance during the initial period.

Macropore/Micropore Model

Mathematically, these two models are essentially the same. In the micropore diffusion case, the radius of the crystal is the dimensional term used, and in the macropore case, the pellet radius is the relevant term. In the case of the macropore model, the diffusivity term that is obtained from the curve fitting analysis is an effective diffusivity which contains an equilibrium constant. This equilibrium constant, under cases of a linear equilibrium, relates the adsorbed phase concentration q to the gas phase concentration C by

$$q = K^* C . \quad (22)$$

The results of both micropore and macropore models obviously yield the same error terms (Table 5) and were virtually the same as those obtained for the ash diffusion term of the shrinking core model by itself. It can be noted that neither model provided a particularly good prediction of the overall experimental behavior. However, as noted above, for large values of time, a plot of the term $\ln(1 - X_B)$ vs time should yield a straight line with a slope of $-\pi^2 D_c / r_{i2}$ and an intercept of $\ln(6/\pi^2)$ at a value of time equal to zero if micropore diffusion is the controlling mechanism.

An example of such a plot is shown in Fig. 6. Table 6 is a tabulation of the resulting micropore diffusion coefficients obtained from the slopes of this type analysis of all data sets. The correlation coefficient values, R^2 , showed very high correlation for the linear regression of this data. This indicated that after the initial portion of the loading process, the effective micropore diffusivity was constant and, based on the data from this study, fairly consistent over a significant range of operating conditions. All the slopes of the uptake curve plotted as the $\ln(1 - X_B)$ vs time were obtained for values of time greater than 10 h. For all runs except for T12, T14, T16, T18, and T26, the value of D_c was between 2.19×10^{-14} and 3.34×10^{-14} cm²/s. There was no notable distinction in the values of the determined micropore diffusivity between pellet size or by the addition of supplemental water vapor or any of the variations in the pretreatment steps.

T12 and T14, which utilized low CH₃I gas concentrations, exhibited lower values of D_c , 9.32×10^{-15} and 1.13×10^{-14} cm²/s, respectively. It has also been noted that both of these runs were subject to some thermal instability in the early readings.

The value of D_c for T26 is also somewhat lower than the rest of the data sets. The calculated value is 1.06×10^{-14} cm²/s, which in this case could be attributed to the lower bed temperature used in this run since D_c in theory follows an Arrhenius-type temperature response.

T18, which was conducted with a dry air stream, exhibited the same type behavior as the other runs and had a comparable value for D_c of 1.59×10^{-14} cm²/s, which seemed to indicate that in the long time period, the adsorption rate may also be controlled by micropore diffusion.

T16 yielded values for D_c of 2.98×10^{-14} or 5.39×10^{-14} cm²/s, depending on which portion of the loading curve is being analyzed. It was noted from the run log that there was some shift in the CH₃I feed rate that may have occurred and was not detected until after the weekend. This may have occurred about the time that the shift in the slope occurred.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 5 Micropore and macropore model parameters for the full data sets.

Run No.	Micropore		Macropore	
	D_c (cm ² /s)	Error ^a	D_p (cm ² /s)	Error
T3	1.82E-14	1.16E-02	4.50E-09	1.16E-02
T6	2.26E-14	7.44E-02	5.57E-09	7.44E-02
T7	6.73E-15	6.68E-01	6.23E-09	6.68E-01
T8	5.66E-15	8.75E-01	1.40E-09	8.75E-01
T10	3.43E-14	6.74E-01	8.45E-09	6.74E-01
T11	1.20E-14	5.32E-03	2.97E-09	5.32E-03
T12	1.65E-15	1.95E-01	4.07E-10	1.95E-01
T13	7.18E-15	1.02E+00	1.77E-09	1.02E+00
T14	3.72E-15	8.75E-02	9.17E-10	8.75E-02
T15	4.90E-15	1.22E+00	1.21E-09	1.22E+00
T16	1.17E-14	7.49E-01	2.88E-09	7.49E-01
T18	3.81E-15	5.10E-01	9.39E-10	5.10E-01
T19	1.16E-14	1.31E-04	2.85E-09	1.31E-04
T20	1.66E-14	2.13E-03	1.54E-08	2.13E-03
T22	1.24E-14	3.47E-01	1.15E-08	3.47E-01
T26	5.80E-15	8.86E-02	1.43E-09	8.86E-02
Error sum:			6.53E+00	6.53E+00

^aError terms are the resultant sum of the square of the error between the experimental data and the proposed model.

The value for the y-intercept, however, was somewhat scattered. This was attributed to other mechanisms controlling the initial portions of the uptake curve. In all cases the y-intercept was numerically greater than the expected value of $\ln(6/\pi^2)$. One explanation for this observation was that the observed uptake on the pellets was slower in the initial time periods than would have been observed if all microspheres in the pellet had been exposed to a uniform value of CH₃I at time zero. This could occur if there were a second diffusional process to control the CH₃I concentration profile across the pellet during the early time periods.

The X-ray fluorescence data indicated a fairly uniform distribution of iodine across the cross section of the pellet. A uniform distribution would not be observed in the case of a strictly shrinking core or in a macropore diffusion-controlled situation. This observation was consistent with micropore diffusion playing a role in the overall controlling mechanism.

Bimodal Model

By examination of Eqs. (18) through (20), it can be observed that the bimodal model is defined by three specific parameters in addition to the physical measurement of the particle sizes and porosities. These parameters are the macropore diffusivity, D_p , the micropore diffusivity, D_c , and an equilibrium

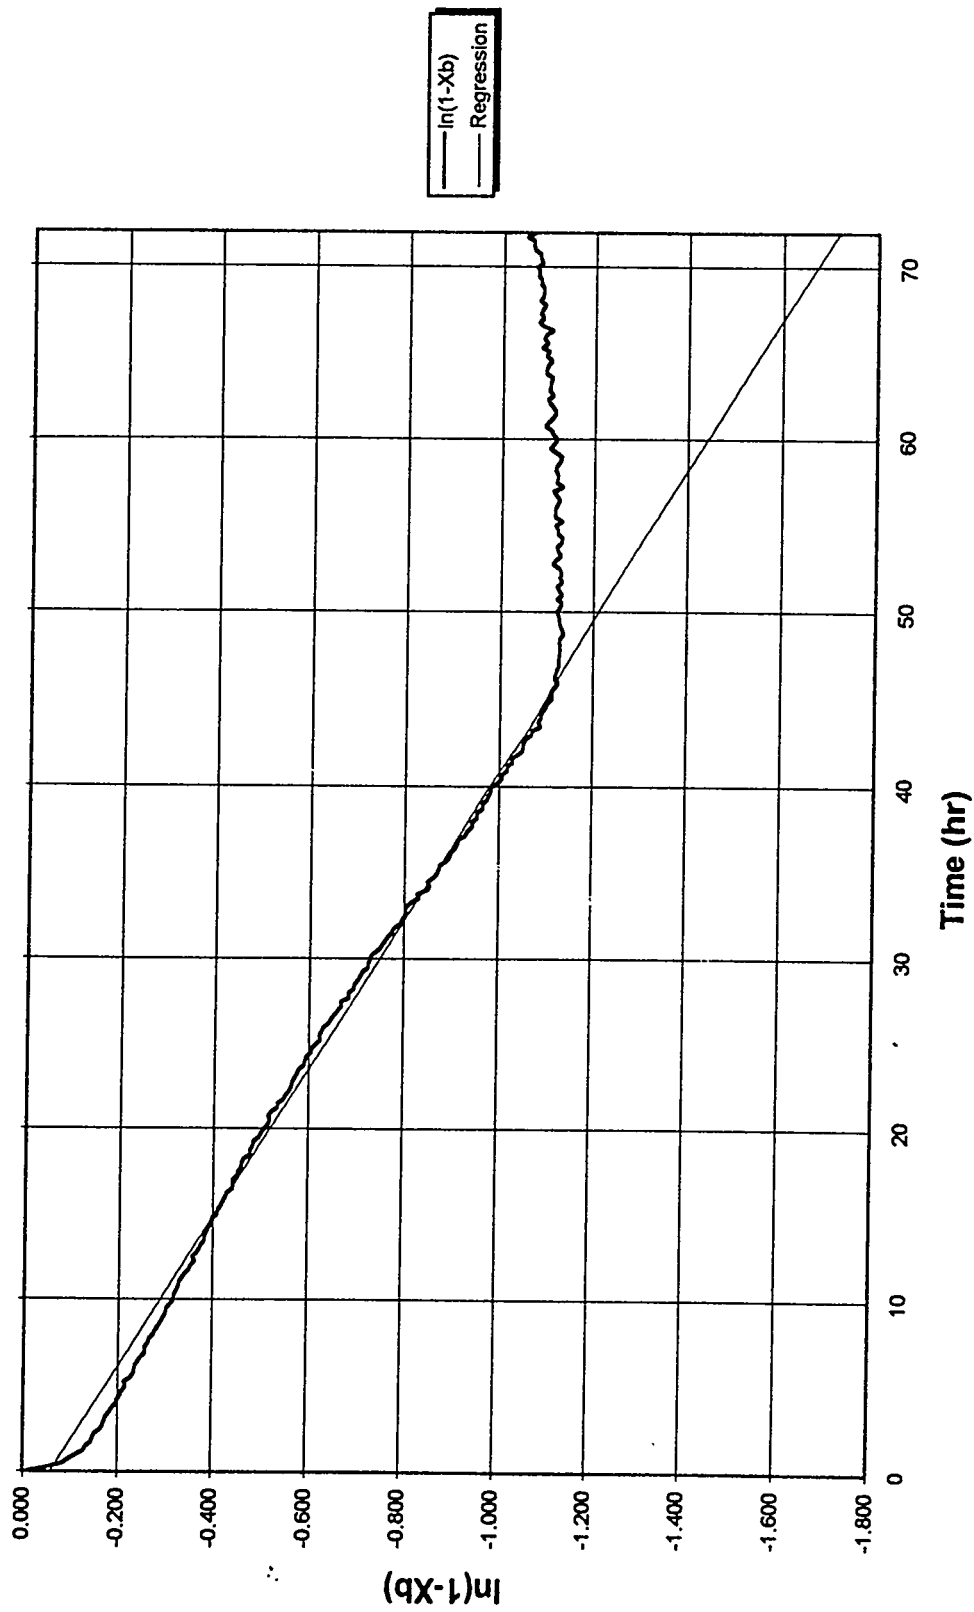


Figure 6 Determination of D_e from slope of the uptake curve plotted as $\ln(1 - X_b)$ vs time for Run T22.

Table 6: Micropore diffusivities calculated from slope of the uptake curve plotted as $\ln(1-X_B)$ vs time.

Run No.	Range considered		Weight adjustment		Linear regression of $\ln(1-X_B)$			Regressed D_e (cm^2/s)	
	Beginning time (h)	End time (h)	Beginning conv. (fraction)	End conv. (fraction)	Loading (g)	Slope	Intercept		Correlation coefficient (R^2)
T3	20	40	0.505	0.685		-5.98E-06	-0.275	0.99	2.42E-14
T6	10	40	0.393	0.744		-7.76E-06	-0.25	0.997	3.15E-14
T7	30	40	0.429	0.571		-8.21E-06	0.331	0.999	3.33E-14
T8	30	80	0.363	0.854		-8.23E-06	0.488	0.998	3.34E-14
T10	10	40	0.082	0.572		-7.10E-06	0.126	0.989	2.88E-14
T10	10	40	0.136	0.621	0.025	-7.73E-06	0.0953	0.991	3.13E-14
T10	10	40	0.185	0.67	0.050	-8.49E-06	0.0669	0.993	3.44E-14
T10	10	40	0.381	0.865	0.150	-1.40E-05	0.0478	0.999	5.67E-14
T11	10	24	0.313	0.475		-5.40E-06	-0.187	0.998	2.19E-14
T12	20	60	0.146	0.384		-2.30E-06	0.00906	0.998	9.32E-15
T13	20	47.25	0.214	0.566		-6.36E-06	0.226	0.997	2.58E-14
T14	10	60	0.159	0.491		-2.78E-06	-0.0698	0.999	1.13E-14
T15	30	80	0.356	0.794		-6.33E-06	0.264	0.998	2.57E-14
T16	30	70	0.525	0.896		-1.07E-05	0.53	0.976	4.34E-14
T16	30	45	0.525	0.678		-7.36E-06	0.0543	0.999	2.98E-14
T16	45	70	0.678	0.896		-1.33E-05	1.1	0.997	5.39E-14
T18	20	70	0.223	0.624		-3.93E-06	0.0409	0.999	1.59E-14
T19 ^a									
T20 ^a									
T21	45.45	60	0.635	0.772		-9.10E-06	0.454	0.99	3.69E-14
T22	10	40	0.271	0.626		-6.4E-06	-0.0585	0.995	2.57E-14
T26	10	35	0.273	0.428		-2.62E-06	-0.218	0.995	1.06E-14

^aNot determined due to short run length.

constant, q_{∞}/C_o . These parameters can be combined along with the physical measurements into the terms α and β . Clearly, however, a difficulty in this system is that α is a function of both D_p and D_c and β is a function of α . Ideally the solution to this model would be greatly simplified if D_c , D_p , and the equilibrium constant could be determined separately.

Determination of the three parameters of the bimodal model, D_c , α , and β , by a multidimensional minimization operation was initially attempted. It was noted during the early attempts to conduct the minimization operations that as the initial search point was varied, the same values of the "optimum" parameters were not always obtained. As a result, each of the data sets was evaluated over the range of anticipated values for α and β for which the full bimodal model must be utilized.

The ranges were selected to examine the behavior of the model between the bounding conditions and thus under conditions where both mechanisms are important. Values of α and β from 10^{-3} to 10^{+2} in six even steps on a logarithmic scale were used to create a "surface map" of the errors resulting from a one-dimensional minimization of the least-squares error with the experimental data by adjusting the micropore diffusion coefficient at each node on the map grid. It was noted in these surface plots that the determination of a "best fit" to the data was not always obvious from the surface formed as a function of α and β . It was observed that there could be numerous combinations of α and β , generated by adjusting D_c , that provided nearly the same sum of the squares of the error. The minimum values for the adjustable parameters of D_c , α , and β obtained from the surface mapping approach are summarized in Table 7. However, based on the surface contours, there could be several values of the adjustable parameters that provided good fits to the experimental data. Therefore, this method provided inadequate resolution to clearly identify any "correct" or "more correct" set of parameters to describe the adsorption process of CH_3I on Ag°Z .

The tables of D_c values determined from the surface mapping approach to locating the best fit to the experimental data were then examined for similarities with the values of D_c determined from the evaluation of the slope of the uptake curve plotted as $\ln(1 - X_B)$ vs time (Table 6). The closest values to the values of D_c determined by the slope method were selected based on the lowest sum of the squares of the errors from the tables of D_c values from the least-squares curve fitting method. As can be seen from Table 7, either the same point in terms of the adjustable parameters α and β or a nearby point yielded virtually the same error term. In most cases the selected values of D_c were associated with α values of 0.001, which indicated primarily micropore diffusion. β values were generally about 10. (Note, however, that an α value of 0.001 is the smallest value evaluated in the table.)

Ma and Lee (1976) reduced the bimodal-type curve fitting problem to one of a single parameter, the micropore diffusion coefficient, D_c , through the use of calculated values for the macropore diffusion coefficient and the use of experimentally determined values for the other parameters in α and β . For the $\text{CaX}(\text{Na})$ zeolite in their study, the macropore diffusivity was estimated based on the Knudsen and molecular diffusivities. A similar analysis was conducted with the data obtained in this study. The effective macropore diffusivity for the Ag°Z was calculated to be about $0.014 \text{ cm}^2/\text{s}$, and based on the effective Knudsen diffusivity in the mesopores, the overall macropore diffusivity was estimated to be about $5 \times 10^{-4} \text{ cm}^2/\text{s}$. Finally using the value of D_c obtained from the slope of the plot of $\ln(1 - X_B)$ vs time, the effective overall macropore diffusivity along with the physical dimensions, values of α on the order of 5×10^{-6} up to about 8×10^{-5} were obtained.

The value of β appeared to be more difficult to establish. Obviously from the definition of β , it was a function of α which in turn was a function of the macropore and mesopore diffusivities. One other significant unknown remained in the β term, which was the value of the adsorption equilibrium constant. This was estimated to be about 3.4×10^5 based on the gas-phase CH_3I concentration from run T16 and the highest loading observed on the Ag°Z . The resulting value of β was about 20. β was the least well-established value, and a third optimization approach was taken to determine if a

Table 7 Bimodal model minimums based on error surface mapping.

Run No.	Best fit by mapping surface					Best fit by using closest/best match to D_c calculated by slope							
	D_c (cm ² /s)	α	β	Error ^a	$\beta/3\alpha$	D_c (cm ² /s)	α	β	Error ^a	$\beta/3\alpha$	r_z (cm)	r_l (cm)	D_p^b (cm ² /s)
T3	2.95E-14	1.000	1.000	7.81E-03	0.333333	2.95E-14	1.000	1.000	7.81E-03	0.333333	0.09808	0.0002	7.09E-09
T6	3.22E-14	0.010	1.000	1.40E-02	33.33333	3.22E-14	0.010	1.000	1.40E-02	33.33333	0.09808	0.0002	7.74E-07
T7	4.23E-14	0.001	10.000	3.40E-01	3333.333	4.23E-14	0.001	10.000	3.40E-01	3333.333	0.19715	0.0002	4.11E-05
T8	3.59E-14	0.001	10.000	4.67E-01	3333.333	3.59E-14	0.001	10.000	4.67E-01	3333.333	0.09808	0.0002	8.63E-06
T10	1.49E-13	0.001	10.000	2.96E-01	3333.333	4.64E-14	0.001	1.000	3.54E-01	333.3333	0.09808	0.0002	1.12E-05
T11	2.00E-14	1.000	1.000	4.11E-03	0.333333	2.00E-14	1.000	1.000	4.11E-03	0.333333	0.09808	0.0002	4.81E-09
T12	1.45E-14	0.001	10.000	5.51E-02	3333.333	1.45E-14	0.001	10.000	5.51E-02	3333.333	0.09808	0.0002	3.49E-06
T13	4.23E-14	0.001	10.000	4.81E-01	3333.333	1.23E-14	0.001	1.000	4.81E-01	333.3333	0.09808	0.0002	2.96E-06
T14	2.60E-14	0.100	10.000	1.98E-02	33.33333	2.60E-14	0.001	10.000	2.21E-02	3333.333	0.09808	0.0002	6.25E-06
T15	3.26E-14	0.001	10.000	5.84E-01	3333.333	3.26E-14	0.001	10.000	5.84E-01	3333.333	0.09808	0.0002	7.84E-06
T16	6.27E-14	0.001	10.000	2.02E-01	3333.333	6.27E-14	0.001	10.000	2.02E-01	3333.333	0.09808	0.0002	1.51E-05
T18	2.70E-14	0.001	10.000	1.58E-01	3333.333	2.70E-14	0.001	10.000	1.58E-01	3333.333	0.09808	0.0002	6.49E-06
T19	1.95E-14	1.000	1.000	2.32E-04	0.333333	1.95E-14	1.000	1.000	2.32E-04	0.333333	0.09808	0.0002	4.69E-09
T20	2.18E-14	0.100	1.000	1.71E-03	3.333333	2.18E-14	0.100	1.000	1.71E-03	3.333333	0.19715	0.0002	2.12E-07
T22	6.50E-14	0.001	10.000	8.72E-02	3333.333	1.95E-14	0.001	1.000	1.31E-01	333.3333	0.19715	0.0002	1.89E-05
T26	6.50E-14	0.001	10.000	8.72E-02	3333.333	1.95E-14	0.001	1.000	1.31E-01	333.3333	0.09808	0.0002	4.69E-06
Error sum:											2.81E+00	2.95E+00	

^aError terms are the resultant sum of the square of the error between the experimental data and the proposed model.

^bCalculated from a by Eq. (19).

correlation existed between the observed behavior in the early time periods and the value of β with the operational or pretreatment conditions. Table 8 is a summary of the bimodal model parameters that were obtained through a one-dimensional least-squares optimization holding D_c to the values established by the slopes of the uptake curve plotted as $\ln(1 - X_B)$ vs time and α as calculated using D_c , the calculated effective macropore/mesopore diffusivity, D_p , the measured pellet diameter, and particle diameter determined from the electron microscope images as noted above. This in essence moved all of the unknowns and variabilities to the equilibrium term contained in the β expression.

Table 8 Optimized fit using bimodal model and fixed parameters of D_c based on the slope from the plot of $\ln(1 - X_B)$ vs time in the micropore model value and α based on theoretical computed values

	D_c (cm ² /s)	α	β	Error ^a
T3	2.42E-14	1.28E-05	5.52E-01	4.72E-02
T6	3.15E-14	1.67E-05	8.10E-01	1.77E-02
T7	3.33E-14	7.67E-05	6.80E+00	3.34E-01
T8	3.34E-14	1.77E-05	8.94E+00	4.64E-01
T10	5.67E-14	2.83E-05	1.88E+00	2.56E-01
T11	2.19E-14	1.16E-05	1.02E+00	3.88E-02
T12	9.32E-15	4.94E-06	4.96E+00	5.51E-02
T13	2.58E-14	1.37E-05	4.43E+00	4.70E-01
T14	1.13E-14	5.99E-06	2.46E+00	2.23E-02
T15	2.57E-14	1.36E-05	6.80E+00	5.74E-01
T16	2.98E-14	1.58E-05	2.92E+00	2.02E-01
T18	1.59E-14	8.43E-06	4.24E+00	1.58E-01
T19 ^b	2.42E-14	1.28E-05	8.26E-01	6.65E-03
T20 ^b	2.42E-14	5.57E-05	4.08E-01	6.41E-03
T22	2.57E-14	5.92E-05	1.98E+00	9.18E-02
T26	1.06E-14	5.81E-06	8.67E-01	2.42E-01
Total error:				2.99E+00

^aError terms are the resultant sum of the square of the error between the experimental data and the proposed model.

^bShort run D_c from Run T3 was used.

This approach produced relatively good fits to the experimental data. As can be seen by comparing the error terms contained in Table 8 with those in Table 7, the fits obtained by this method were as good as those obtained from the surface mapping approach to the locating of a global minimum. In several cases, notably T3, slightly higher errors resulted from this approach than from the approach in which multiple parameters were allowed to be adjusted, but the fit with the experimental data was still very good. The overall performance of this model using a single parameter was superior to the shrinking core model with all but one parameter fixed. There was, however, no obvious trend in the resulting values of β . These values ranged from 0.4 to about 9.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Further calculation of other parameters such as the equilibrium constant contained in the β term from the values of the parameters determined as described above was thought to be invalid for several reasons. First, when one parameter is determined from a second fitted parameter, the uncertainties tend to accumulate in the resultant value. Second, in this determination, since the value of D_c was determined from the slope of the uptake curve plotted as $\ln(1 - X_B)$ vs time and α was calculated from this value and other theoretical and measured terms, all of the uncertainties will be accumulated in the single adjustable parameter. Third, as noted from the photographs of the pellets, there can be significant variations in the structure, which in turn could impact the macropore diffusivity. Since the theoretical value of D_p was used, any variation from this value would end up being observed in the fitted value of β . It can also be shown that moderate variations in the theoretical values of D_p will not have an impact through α on the least-squares regression of the data to the proposed model (Jubin, 1995). And finally, the nature of the experiments conducted was not directed toward the determination of terms such as the equilibrium constant. Therefore, it is believed that any such secondary value would be of questionable validity.

Conclusions

This study has shown that there is a slow (micropore) diffusional process controlling the latter portion of the uptake curve. This was determined to be 2×10^{-14} cm²/sec, and that the value of the diffusivity associated with this phase of the uptake was consistent over a number of runs. Based on the value of α obtained for the bimodal model, it was also shown that the process can be considered to be occurring in two steps. The time constants for the two processes are such that the macropore diffusion was virtually complete prior to any significant micropore diffusion occurring. Thus there was a shift in time prior to the start of the micropore adsorption.

One measure of this time shift was the observed shift in the y-intercept of the line describing the uptake curve plotted as $\ln(1 - X_B)$ vs time in the long time period. If no macropore diffusional resistance was observed and all microspheres were subject to a bulk gas-phase concentration equal to the bulk gas phase at time = 0, then only the micropore diffusional rate would be observed. In this case, the y-intercept would be given by $\ln(6/\pi^2)$. However, with macropore diffusional resistance and adsorption occurring in the initial phase, there is some finite time period required before the concentration of the CH₃I becomes nonzero at any point in the pellet and even longer before it reaches the bulk equilibrium concentration. This delay shifts the start of the micropore diffusion and the associated micropore uptake. Thus for any given value of D_c obtained by the slope method, the actual conversion at a given time will be less than that predicted by micropore diffusion model alone using the derived value of D_c .

The quantity and rate at which iodine was adsorbed in the macropores is then a function of the available surface area, the nature of the macropore structure, and the quantity of available silver. Based on photographic evidence, the available surface area and the pore structure was quite variable and could not be predicted by any of the process measurements made during each of the test runs. The available silver may be related to the "nonframework" silver cations in the mordenite structure, to any silver on the surface of the mordenite crystals, and to the silver nodules that appear after the hydrogen pretreatment. This may also be quite variable and the magnitude of the variation was unknown for each run. This macropore diffusion control in the initial time period would also appear to explain the appearance of the shrinking core that vanishes by the time 20 to 30% conversion occurs. One other point on this topic is that the term macropore or bimodal, in the case of this material, is a significant simplification. The pore sizes range from 20 Å to 10 μ, with a peak in the macropore region occurring at about a pore diameter of about 1 μ. Thus a continuum of pore sizes existed.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

This study has determined a consistent "micropore diffusion" rate on the order of 2×10^{-14} cm²/s. It has also been shown that the bimodal model adequately explains the observed uptake behavior and the photographic as well as X-ray evidence. It has further been shown that the adsorption process described by this model can be considered a two-step process. This information is important since it is the rate of the second step that ultimately controls the final bed loading rate if high bed loadings are desired. There are, however, several questions concerning the impact of the many process and structural variables still remaining to be answered. But even without answers to every new question raised in this study, a significantly deeper fundamental understanding of the CH₃I adsorption processes onto Ag^oZ has been achieved.

In summary, considering the potential sources for experimental variation and the model sensitivity, the values determined for the bimodal model parameters, D_c , α , and β , are very consistent and clearly appear to adequately model the uptake of CH₃I on Ag^oZ over the longer time periods. In addition, the bimodal two-step process seems to explain the appearance of a "ring" or shrinking core in the pellets at low conversion and yet a uniform iodine distribution at higher loadings.

The specific conclusions drawn from this study are as follows:

1. It was shown based on both fundamental analysis and on the results of the least-squares curve fitting that the gas film resistance to mass transfer is negligible.
2. It was also shown that the system can be considered virtually isothermal. The maximum calculated temperature difference between the pellet and the bulk fluid was 0.37°C. This is an important determination in that it simplifies the modeling of the process.
3. The micropore diffusivity at 150°C as calculated from the slope of the $\ln(1 - X_B)$ vs time curve is in the range of 1.95×10^{-14} to 3.33×10^{-14} cm²/s. The error in these values as estimated from the duplicate run at the standard conditions is about 30%.
4. The bimodal model, which includes the uptake in both the macropores and the micropores, provides the most uniform ability to model the behavior of the adsorption of CH₃I onto Ag^oZ. The model parameters indicate that the uptake is occurring in a two-step manner, with the macropore uptake being much faster than the micropore uptake. This two-step process can account for the shrinking core observed at low conversions and the relatively uniform iodine concentration observed in the pellet at moderate to high concentrations.
5. The impact of the free silver observed in the mordenite structure could not be determined.

References

Burger, L. L., and Scheele, R. D., "Iodine Fixation Studies at the Pacific Northwest Laboratory," *Management Modes for Iodine-129*, W. Hebel and G. Cottone, eds., Harwood Academic Publishers, New York (1981).

Forsythe, G. E., Malcolm, M. A., and Moler, C. B., *Computer Methods for Mathematical Computations*, Prentice Hall, Inc., Englewood Cliffs, New Jersey (1977).

Jubin, R. T., "Organic Iodine Removal from Simulated Off-Gas Streams Using Silver-Exchanged Mordenite," *Proc. 16th DOE Nuclear Air Cleaning Conference*, CONF-801038, pp. 519-531 (1980).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- Jubin, R. T., "Organic Iodine Removal from Simulated Off-Gas Streams Using Partially Exchanged Silver Mordenite," *Proc. 17th DOE Nuclear Air Cleaning Conference*, CONF-820833, pp. 183–198 (1982).
- Jubin, R. T., "The Mass Transfer Dynamics of Gaseous Methyl-Iodide Adsorption by Silver Exchanged Sodium Mordenite," Ph.D. Dissertation, University of Tennessee, 1994; also, ORNL-6853 (1995).
- Kärger, J., and Ruthven, D. M., *Diffusion in Zeolites and Other Microporous Solids*, John Wiley & Sons, Inc., New York (1992).
- Kulkarni, B. D., and Doraiswamy, L. K., "Modeling of Noncatalytic Gas-Solid Reactions," in *Handbook of Heat and Mass Transfer, Volume 2: Mass Transfer and Reactor Design*, Nicholas P. Cheremisinoff, Editor, pp. 1107–1135, Gulf Publishing Company, Houston, Texas (1986).
- Lee, Lap-Keung, "The Kinetics of Sorption in a Biporous Adsorbent Particle," *AIChE Journal*, vol. 24, no. 3, pp. 531–533 (1978).
- Lee, Lap-Keung, and Ruthven, D. M., "Analysis of Thermal Effects in Adsorption Rate Measurements," *J. Chem. Soc. Faraday I*, vol. 75, pp. 2406–2422 (1978).
- Levenspiel, O., *Chemical Reaction Engineering, Second Edition*, John Wiley & Sons, Inc., New York (1972).
- Levenspiel, O., *The Chemical Reactor Omnibook*, OSU Book Store, Inc., Corvallis, Oregon (1979).
- Ma, Y. H., and Lee, T. Y., "Transient Diffusion in Solids with a Bipore Distribution," *AIChE Journal*, vol. 22, no. 1, pp. 147–152 (1976).
- Press, W. H., Teukolsky, S. A., Vetterling, W. T., and Flannery, B. P., *Numerical Recipes in FORTRAN: the Art of Scientific Computing, Second Edition*, Cambridge University Press, New York (1992).
- Ramachandran, P. A., and Doraiswamy, L. K., "Modeling of Noncatalytic Gas-Solid Reactions," *AIChE Journal*, vol. 28., no. 6, pp. 881–900 (1982).
- Ruckenstein, E., Vaidyanathan, A. S., and Youngquist, G. R., "Sorption by Solids with Bidisperse Pore Structures," *Chemical Engineering Science*, vol. 26, pp. 1305–1318 (1971).
- Ruthven, D. M., *Principles of Adsorption & Adsorption Processes*, John Wiley & Sons, Inc., New York (1984).
- Scheele, R. D., Burger, L. L., and Matsuzaki, C. L., *Methyl Iodide Sorption by Reduced Silver Mordenite*, PNL-4489, Pacific Northwest Laboratory (1983).
- Scheele, R. D., and Burger, L. L., *Evaluation of Silver Mordenite for Radioiodine Retention at the Purex Process Facility Modification*, PNL-6261, Pacific Northwest Laboratory (July 1987).
- Thomas, T. R., Staples, B. A., Murphy, L. P., and Nichols, J. T., *Airborne Elemental Iodine Loading Capacities of Metal Exchanged Zeolites and a Method for Recycling Silver Zeolite*, Idaho National Engineering Laboratory, ICP-1119 (July 1977).
- Vaidyanathan, A. S., *Theoretical and Experimental Investigation of Sorption in Bidisperse Porous Particles*, PhD Dissertation, Clarkson College of Technology (September 1971).
- Walker, L. R., personal communication to R. T. Jubin (March 14, 1994).

List of Symbols

b	= stoichiometric coefficient for B
C	= concentration (g/cm^3)
D_{AB}	= molecular diffusion coefficient (cm^2/s)
D_c	= intercrystalline or micropore diffusivity (cm^2/s)
D_e	= ash layer diffusion coefficient (cm^2/s)
D_p	= pore or macropore diffusivity (cm^2/s)
D_∞	= pre-exponential factor in Arrhenius expression for D
E_d	= diffusional activation energy (cal/mol)
K^*	= Henry's law constant based on q/C (cm)
k_g	= gas film mass transfer coefficient (cm/s)
k_r	= reaction rate constant for the gas solid reaction (cm/s)
m_t	= mass adsorbed at time t
m_∞	= mass adsorbed at time $t \rightarrow \infty$
N	= moles
p	= root to transcendental equations
q	= adsorbed phase concentration (g/cm^3)
R	= gas constant
R^2	= coefficient of determination
r_a	= pellet radius (cm)
r_c	= pellet core radius (cm)
r_i	= particle radius (cm)
S	= surface area (m^2/g) or (m^2/cm^3)
T	= temperature ($^\circ\text{C}$ or K)
t	= time (s)
X	= conversion

Greek Symbols:

α	= ratio of diffusional time constants $(D_c/r_i^2)/(D_p/r_a^2)$
β	= parameter defined by Eq. (20)
ε_p	= porosity of pellet
τ	= tortuosity factor
ρ_B	= molar density of B (gmol/cm^3)

Subscripts:

A	= component A (generally CH_3I)
B	= component B (generally silver, but in the D_{AB} term is air)
ex	= external
g	= bulk gas phase
0	= initial
s	= surface

Superscripts:

$^\circ$	= metallic form of silver
----------	---------------------------

Other Symbols and Notations:

$-$	= average value
-----	-----------------

DISCUSSION

BARLOW: What capacity do you believe you can be getting with your beds? From the knowledge you have now gained from your modeling, how much do you believe you could increase life? What is the typical utilization of the silver zeolite and does the information presented allow an estimate to be made of the maximum possible incorporation that might be achieved by an understanding of the controlling mechanisms?

JUBIN: In experimental tests with silver exchanged mordenite, loadings in the highest loaded segment of the bed have ranged from ~30% to ~60%, depending in large part on the operating conditions and bed depth. As can be observed from the thin bed loadings, completed as part of this test, silver utilizations of greater than 90% were achieved in numerous cases. The maximum loading that would be achieved in actual practice would be controlled by the bed design and by the operating conditions. By gaining an understanding of the controlling mechanisms through studies such as this one, the equipment and process conditions can be tailored to these mechanisms to achieve the highest practical utilization of the sorbent.

**Removal Efficiency of Silver Impregnated Filter Materials and
Performance of Iodine Filters in the Off-Gases of the
Karlsruhe Reprocessing Plant WAK**

F.J. Herrmann, B. Herrmann, V. Hoeflich, Ch. Beyer
Wiederaufarbeitungsanlage Karlsruhe

J. Furrer
Forschungszentrum Karlsruhe / Germany

Abstract

An almost quantitative retention of iodine is required in reprocessing plants. For the iodine removal in the off-gas streams of a reprocessing plant various sorption materials had been tested under realistic conditions in the Karlsruhe reprocessing plant WAK in cooperation with the Karlsruhe research center FZK. The laboratory results achieved with different iodine sorption materials justified long time performance tests in the WAK Plant. Technical iodine filters and sorption materials for measurements of iodine had been tested from 1972 through 1992. This paper gives an overview over the most important results.

Extended laboratory, pilot plant, hot cell and plant experiences have been performed concerning the behavior and the distribution of iodine-129 in chemical processing plants (Henrich 1980, 1981, 1988, 1996, and Herrmann 1992). In a conventional reprocessing plant for power reactor fuel, the bulk of iodine-129 and iodine-127 is evolved into the dissolver off-gas. The remainder is dispersed over many aqueous, organic and gaseous process and waste streams of the plant.

Iodine filters with silver nitrate impregnated silica were installed in the dissolver off-gas of the Karlsruhe reprocessing plant WAK in 1975 and in two vessel vent systems in 1988. The aim of the Karlsruhe iodine research program was an almost quantitative evolution of the iodine during the dissolution process to remove as much iodine with the solid bed filters as possible. After shut down of the WAK plant in December 1990 the removal efficiency of the iodine filters at low iodine concentrations had been investigated during the following years.

I. Introduction

In connection with iodine monitoring different methods for sampling iodine in the off-gas streams of the WAK plant were used.

Sampling with caustic scrubbers does not allow to catch the organic iodine. By this method in the off-gas of the Karlsruhe reprocessing plant WAK only 15 % of the total measured iodine could be trapped. Parallel measurements with a discriminating sampling system for inorganic iodine confirmed that only 10 to 20 % of the total iodine in this vessel off-gas stream was inorganic (Herrmann 1990).

It is well known that sampling and filtering of iodine with charcoal allows to detect organic and inorganic iodine species only at low humidity of the off-gas. Numerous publications in the past years and the following considerations demonstrate some problems encountered utilizing charcoal as sorption

material. Charcoal is the most exhaustively studied adsorbent for iodine. High removal efficiencies can be obtained with plain or impregnated charcoal for elemental iodine. However acid vapors, organic vapors, and moisture seriously affect the efficiency of impregnated charcoal. In either case the use of charcoal in off-gas systems containing more than 6 % nitrogen oxides is severely limited (Rodger 1969).

Results of laboratory experiences in the Karlsruhe research center (FZK) have demonstrated that during long-term measurements (about two months) the iodide impregnated charcoal loses most of the inactive iodide impregnation due to the oxidation of the iodide by the air. A break-through of active iodine cannot be excluded.

In the special case of the vessel off-gases of reprocessing plants which are currently saturated with water vapor from the scrubbing columns and kerosene from the solvent, sampling with charcoal is problematic. The influence of the humidity on the removal efficiency of iodine samplers is reported by many authors and quantified by H. Schüttelkopf. At a relative humidity of >90 % iodine sampling is not effective. If 90 % humidity in the off-gas has been overstepped once, the following measuring periods are distinctly influenced. It must be guaranteed that the measuring conditions have a security distance from the dew point of the gas to be measured (Schüttelkopf 1976).

Due to the problems of trapping iodine for measurements and removal of iodine in the off-gases of reprocessing plants, inorganic silver impregnated materials have been developed and were used as sampling and as filter materials in the off-gas streams of the WAK plant (Furrer 1979, Wilhelm 1976 and Herrmann 1995).

II. Testing of Silver Impregnated Iodine Sorption Materials and Iodine Filters

To optimize iodine sorption materials manufactured with different carrier materials and different silver contents, after the preliminary tests in the Karlsruhe research center, the sorption materials had been tested in by-pass streams of the WAK dissolver off-gas and the WAK vessel ventilation system, see figure 1 (Test conditions: temperature 140 °C, residence time 0.4 s; bed depth 0.1 m; gas flow rate 0.7 m³/h; linear gas velocity 0.24 m/s).

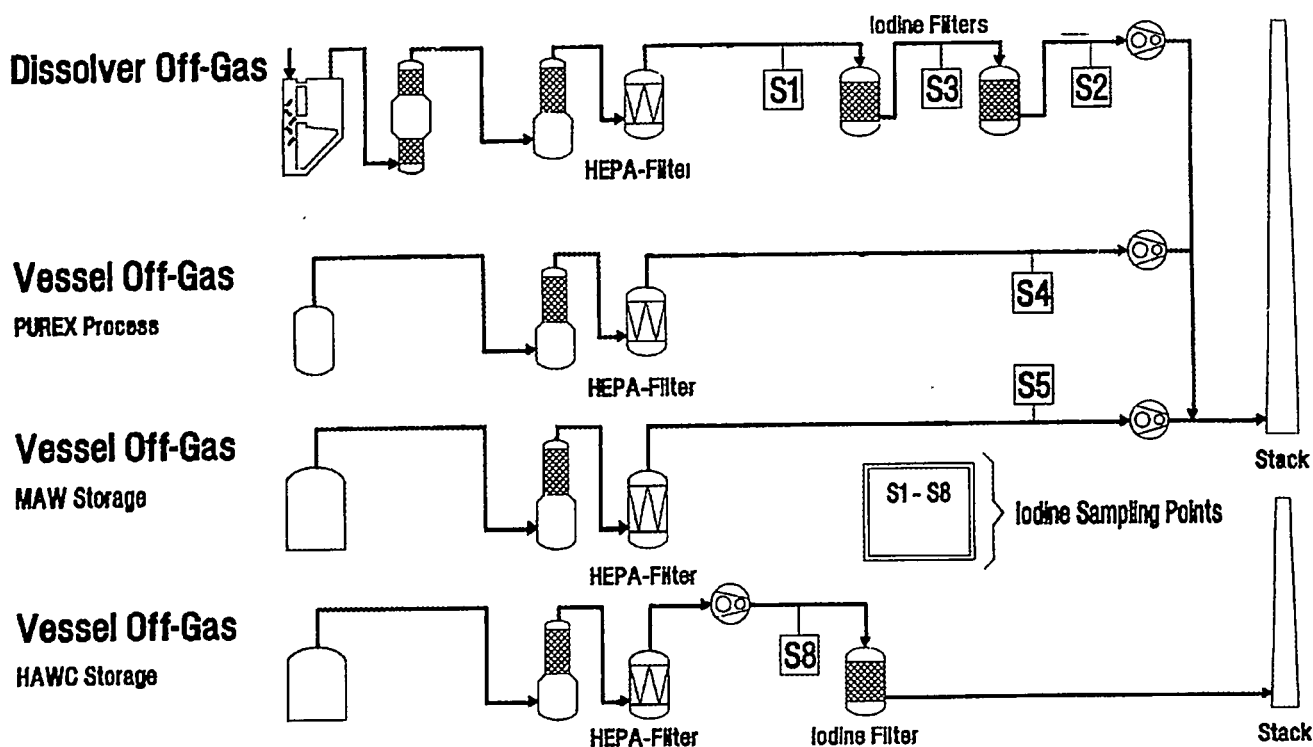


Figure 1 Offgas Cleaning of WAK with Iodine Filters and Iodine Sampling Points

For the investigations of the different sorption materials performed in the by-pass streams of the WAK dissolver off-gas (DOG) and the vessel off-gas (VOG), sampling points are located downstream the HEPA filters (upstream and downstream the iodine filters, see figure. 1). They allow to determine simultaneously the iodine concentration in the off-gas and the removal efficiency of the iodine filters). The gas stream is routed through absorption columns which are located in a heating cabinet. The internal diameter of the columns is 0.032 m. The gas flow rate through the columns is 500 l/h (STP). The column contains six successive beds consisting of the sorption material. Each bed is 0.05 m deep. The calculated residence time per bed is 0.2 s at 140°C. After different exposure times the columns were removed. The beds were emptied individually and the sorption materials were measured on a Intrinsic Germanium Planar Detector to determine its iodine-129 content.

III. Evaluation of Silver Impregnated Iodine Sorption Materials

Experiments concerning the influence of the silver content of the carrier material on the iodine removal efficiency in the vessel off-gas of WAK have shown that an impregnation with 12 % silver is the optimum. Higher silver contents (for example 20 %) increase the risk of the efflorescence of the silver nitrate impregnation taking place in off-gases with 3 to 4 % of water vapor (resulting from the vapor pressure of the scrubbing columns working at 25 to 30 °C).

The essential parameters of sorption materials which may influence the removal efficiency of iodine sorption materials had been investigated. All materials had been impregnated with 12 % silver in form of silver nitrate. The porosity and the inner surface of the carrier material are decisive for the iodine removal efficiency. The alpha alumina shows a lower removal efficiency than the AC 6120.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE


The properties of the sorption material and the retained removal efficiencies are listed in table 1.

Sorption material	AC6120 (Silica)	Alumina	Sinterglass
Grain size [mm]	1 - 2	2 - 4	1 - 2
Pore volume [ml/g]	0.62	0.45	0.5
BET surface [m ² /g]	65	7	0.15
Maximum of pore distribution [nm]	20 - 40	75	10,000 - 40,000
Silver content [%]	12	12	12
I-129 removal efficiency [%]			
- DOG of WAK	99.8	-----	90.0
- VOG of WAK	99.0	94.0	85.0 - 97.0

Table 1 Properties of sorption materials and iodine removal efficiencies in the off gas of WAK (Bed depth 10 cm, residence time 0.4 s; DOG = dissolver off-gas; VOG = vessel off-gas)

In an earlier paper it has been shown that it doesn't matter whether the carrier material is silica or alumina. A silver impregnated gamma-Al₂O₃ (JFM 1) having a BET surface comparable to the BET surface of AC 6120, showed the same high removal efficiency as AC 6120 (Herrmann 1995). Besides temperature, residence time, silver content, iodine species and concentration in the off-gas, the decisive parameters for iodine removal efficiency are the porosity and the BET surface.

IV. Transferability of the Removal Iodine Efficiency Obtained by Small Scale Filters and Technical Filters

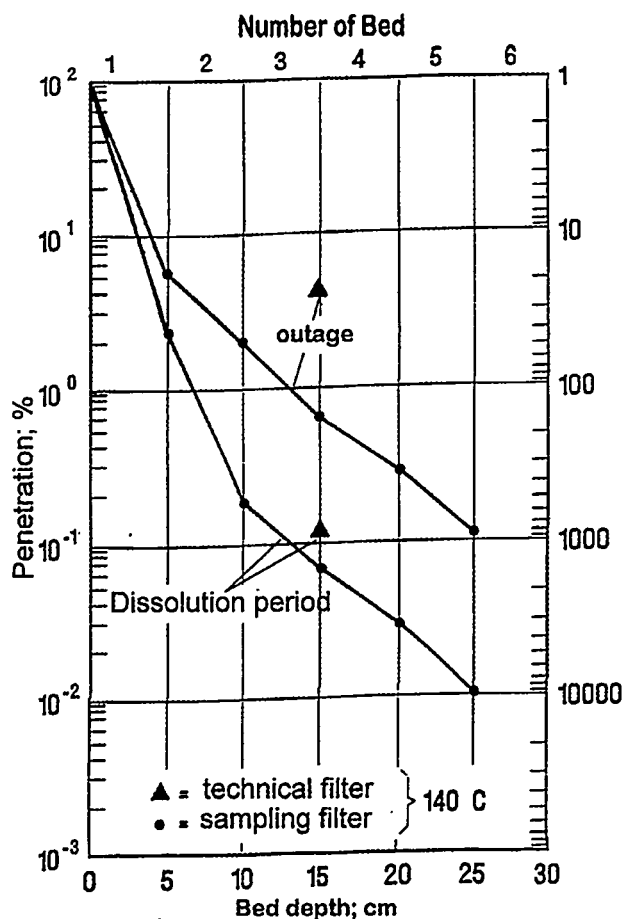

The decontamination factors obtained with the small scale columns (sampling filter: inner diameter 0.032 m, bed depth 0.15 m) and the technical iodine filter (annular cylinder with a bed depth of 0.15 m), are traced in figure 2. The small scale filters reveal a higher iodine removal performance than the technical iodine filter. These values result from 12 measuring periods between 1989 and 1991.

The data for the iodine removal efficiency obtained by small sampling tubes (diameter 0,032 m, bed depth 0,1 m) are not directly transferable to the iodine removal performance obtained by full size iodine filters. Table 2 shows the iodine removal efficiency of a small size filter (bed depth 0,15 m, residence time 1.0 s, sorption material 0,078 kg) and a full size filter (annular cylindrical filter with a bed depth of 0.15 m and a filter diameter of 0.4 m, sorption material 35 kg).

Figure 2 Removal efficiency of AC 6120 in a full size filter and in sampling filters.

	Small size filter	Full size filter
Mass of AC6120/12 % Ag	0.078	35
Bed depth [m]	0.15	0.15
Temperature [°C]	140	entrance: 130, exit: 110
Gas flow rate [m ³ /h]	0.5	80 to 120
Linear velocity [m/s]	0.25	0.15
Residence time [s]	0.6	1.0
Iodine removal efficiency [%]		
- during dissolution	99.9-99.95	99.8-99.9
- during outage	98.7-99.3	94-96

Table 2 Comparison of iodine removal efficiency of a small scale and a full size iodine filter with AC6120/12% Ag in the dissolver off gas of WAK

The iodine removal efficiency of the full size filter is distinctly lower than the removal efficiency of the small size filters. The lower removal efficiency of the technical filter can be explained by channeling effects. The differences between laboratory scale filters and full size filters must be taken into consideration for the design of iodine filters in the off-gases of reprocessing plants.

V. Performance of Iodine Filters in the Off-Gas Streams of the WAK Plant

V.1 Dissolver Off-Gas

Two silver impregnated iodine filters in series were in operation in the dissolver off-gas of the WAK plant from 1975 through 1993. The filter material was a silver nitrate impregnated silica (AC 6120/12 % Ag). The filters worked at 110° to 130°C.

The dissolver off-gas filters were annular filters with the following characteristics:

Outer diameter	400 mm
Inner diameter	106 mm
Thickness of annular section	147 mm
Active filter volume	54 l
Number of filters	2 filters in series
Sorption material	AC 6120, 35 kg per filter
Gas temperature	inlet 130 °C, outlet 110 °C
Dissolver off-gas flow rate	80 to 120 m ³ /h
Residence time (off-gas)	1.4 s

The sorption material of the first filter was changed when the iodine removal efficiency of the first filter dropped significantly. Under normal operation conditions the iodine filters worked two years without interruption.

During dissolution periods the highest removal efficiencies of 99 to 99.9 % for the first iodine filter had been measured. The average iodine concentrations in the dissolver off-gas upstream of the iodine filter was in the range between 1 and 5 mg/m³ obtained by discontinuous measurements. The peak values during dissolution were not measured because of the radiation power at the sampling points. They are in the order of 100 mg/m³. During outage periods the removal efficiency of the first iodine filter was 97 %.

The removal efficiency of the second iodine filter was 90 % during dissolution period and 50 % during outage periods. The average decontamination factor of the second filter between 1989 and 1991 (two years of operation and one year after shutdown) was 4.

Downstream of the two iodine filters iodine-129 concentrations of about 0.005 mg/m³ were observed during dissolution periods.

During the 15 years of operation a high stoichiometric loading up to 80 % of the first iodine filter had been achieved. The measured values of iodine loading were 17 GBq to 24 GBq. The corresponding service lives were 2 to 4 years for the iodine filter material.

V.2 Vessel Ventilation System of the PUREX Process

In 1987 a prototype iodine filter with a throughput of 35 m³/h and the following dimensions has been installed in a side stream of the vessel off-gas of the PUREX process:

Diameter	355 mm
Bed depth	150 mm
Sorption material	8.5 kg AC 6120 / 12 % Ag
Operating temperature	140°C
Gas velocity	14 cm/s
Residence time	1 s

The decontamination factor was determined by weekly measurements of the iodine concentration upstream and downstream the prototype iodine filter. The removal efficiency of the prototype filter in this off-gas stream was 90 to 95 %.

The decontamination factors are influenced by the iodine concentrations and by the nature of the iodine species present in the vessel off-gas. Iodine loading after 2.5 years of operation was 21.4 MBq (3.27 g of iodine-129) for the total filter. This corresponds to a stoichiometric loading of 0.33 %.

V.3 Vessel Ventilation System of the Liquid High Active Waste Storage

Up to now the iodine filter with AC6120/12 % Ag in the vessel vent system of the liquid high active waste storage is operating at about 40 °C and a gas flow rate of 180 m³/h up to now. An iodine removal efficiency of 90 % to 94 % is attained.

Literature

Furrer, J. 1979. Verfahrensentwicklung und Optimierung der Filter zur Auflöserabgas- reinigung. Report KfK 2750.

Henrich, E. and R. Hüfner. 1980 . Improved Procedures for Efficient Iodine Removal from Fuel Solutions in Reprocessing Plants, IAEA-SM-245/16.

Henrich, E., W. Roesch , F.Weirich. 1981. Improved Iodine and Tritium Control in Reprocessing Plants. 16th DOE Nuclear Air Cleaning Conference, San Diego, 1980 (Conf-801038), 1981.

Henrich, E., R. Grimm, L. Finsterwalder. 1988. Ioddesorption aus der Brennstofflösung, ein Vergleich von Theorie und Experiment. Report KfK 4476 pp.155-200 (1988).

Henrich, E. 1996. Control of Volatile Radionuclides in Reprocessing. To be published in Kerntechnik, 1996.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Herrmann, F. J., V. Motoi, B. Herrmann, A. van Schoor, D. Fang, H. Fies. 1990. Retention and Measurement of Iodine-129 and of Organoiodine in the Off-gas Streams of the Karlsruhe Reprocessing Plant WAK. 21st DOE/NRC Nuclear Air Cleaning Conference, San Diego 1990, CONF-900813. pp 222-233.

Herrmann, F.J., R. Grziwa, L. Finsterwalder, D. Fang, B. Herrmann, V. Motoi, Ch. Beyer. 1992. Iodverteilung in einer Wiederaufarbeitungsanlage am Beispiel der WAK. Annual Meeting on Nuclear Technology-Jahrestagung Kerntechnik 5.-7. Mai 1992, Karlsruhe Proceedings 0720-9207.

Herrmann F.J., V.Motoi, B. Herrmann, D. Fang, L. Finsterwalder, K.D. Kuhn, A. van Schoor, Ch. Beyer, J. Furrer, W. Knoch. 1992. Minimizing of Iodine-129 Release at the Karlsruhe Reprocessing Plant WAK. 22st DOE/NRC Nuclear Air Cleaning Conference, Denver 1992.

Herrmann, F.J., B. Herrmann, D. Fang, M. Weishaupt, J. Furrer, T. Engelhardt. 1995. 15 Jahre Erfahrungen mit Iodfiltern im Abgas der Wiederaufarbeitungs- anlage Karlsruhe WAK. Annual Meeting on Nuclear Technology, Nürnberg, 16. - 18. Mai 1995.

Rodger, W.A. and S. L. Reese. 1969. The Removal of Iodine from Reprocessing Plants Effluents. Reactor and Fuel-Processing Technology, Vol. 12, No. 2, pp. 173-180, 1969.

Schüttelkopf, H. and H. Fessler. 1976. Die Messung von Iod-131 in der Umgebungsluft kerntechnischer Anlagen. Report KFK 2350.

Wilhelm, J., J. Furrer, E. Schultes. 1976. Head End Iodine Removal from a Reprocessing Plant with a Solid Sorbent. 14th DOE Air Cleaning Conference, Idaho Falls.

DISCUSSION

JUBIN: A point of clarification concerning the difference between your technical filter and your sampling filter, you indicated that the sampling filter always had better performance than the technical filter. Was the technical filter exposed to other contaminants for a longer period of time than the sampling filter? The question is, did they have the same history? Can this be attributed to the length of time the sampling filters were in service or to other contaminants?

HERRMANN: The technical filter has always had distinctly lower removal efficiency than the sampling filter, even for the same experimental conditions and exposure times. Experiments performed with sampling filters of different sizes (diameter 25mm and 33mm) showed the same phenomena. The smaller the filter diameter, the better the removal efficiency. When sampling filters and technical filters had the same service life, the sampling filters always showed a better iodine removal efficiency.

SAKURAI: You use the two DOG filters in series at the WAK reprocessing plant. Why is the DF lower for the second filter than for the first one? Is it a commonly observed phenomenon?

HERRMANN: This has commonly been observed. The iodine concentration entering the second filter is by 3 orders of magnitude lower than the iodine concentration entering the first filter. The iodine species are probably different.

**Control of Radio-Iodine at the German Reprocessing Plant WAK
during Operation and after Shutdown**

F.J. Herrmann, B. Herrmann, K.D. Kuhn, A. van Schoor, M. Weishaupt
Wiederaufarbeitungsanlage Karlsruhe

J. Furrer
Forschungszentrum Karlsruhe/Germany

W. Knoch
Deutsche Gesellschaft für Wiederaufarbeitung von Kernbrennstoffen m.b.H.

Abstract

During 20 years of operation 207 metric tons of oxide fuel from nuclear power reactors with 19 kg of iodine-129 had been reprocessed in the WAK plant near Karlsruhe. In January 1991 the WAK Plant was shut down. During operation iodine releases of the plant as well as the iodine distribution over the liquid and gaseous process streams had been determined. Most of the iodine is evolved into the dissolver off-gas in volatile form. The remainder is dispersed over many aqueous, organic and especially gaseous process and waste streams.

After shut down of the plant in January 1991, iodine measurements in the off-gas streams have been continued up to now. Whereas the iodine-129 concentration in the dissolver off-gas dropped during six months after shutdown by three orders of magnitude, the iodine concentrations in the vessel ventilation system of the PUREX process and the cell vent system decreased only by a factor of 10 during the same period. Iodine-129 releases of the liquid high active waste storage tanks did not decrease distinctly.

The removal efficiencies of the silver impregnated iodine filters in the different off-gas streams of the WAK plant depend on the iodine concentration in the off-gas. The reason of the observed dependence of the DF on the iodine-129 concentration might be due to the presence of organic iodine compounds which are difficult to remove.

I. Introduction

Besides the optimization of the PUREX process particularly by an electrolytic uranium-plutonium separation, an important task for the WAK plant was to demonstrate low iodine releases in view of the project of the German industrial scale reprocessing plant.

In 1975 the yearly iodine-129 release limit of the WAK plant via the off-gas was fixed to 240 MBq (equivalent to 37 g iodine-129). By this reason silver impregnated iodine filters had been installed in the dissolver off-gas.

Main objective of the iodine management during operation of the WAK plant was to obtain a low residual iodine content in the fuel solution after the end of the dissolution process by evolving most of the iodine into the dissolver off-gas and an almost quantitative iodine removal on silver impregnated solid bed filters in the dissolver off-gas. At the beginning of 1988 silver impregnated solid bed iodine filters entered in operation in two vessel ventilation systems.

In the meantime, the licensing authorities had reduced the maximum permissible iodine release of the planned German industrial scale reprocessing plant in Bavaria from 7.4 GBq (200 mCi) to 1.85 GBq per year (50 mCi) for a throughput of 350 tons of uranium from light water reactor fuel (burnup 50,000 MWd/ton U). This value of 1.85 GBq signified that only 0.2 % of the iodine inventory could be released by all off-gas streams of the plant.

After some years of intensive work at the Karlsruhe reprocessing plant WAK in 1989 it was clear that this ambitious aim of 0.2 % release of the iodine inventory could not be demonstrated in the WAK plant. Because of the shortness of time before shut down there was no possibility to install iodine filters in all off-gas lines of the WAK plant. Meanwhile the project of the industrial scale reprocessing plant in Germany had been given up in 1989 after 15 years of intensive development work.

II. Iodine Distribution in the WAK Plant

During fuel dissolution the fission product iodine is present mainly in its volatile elementary form. From the point of view of radio ecology, iodine-129, with a half life period of $1.6 \cdot 10^7$ years and iodine-131 with a half life period of 8.02 days, are significant. If cooling times are > 1 year, as in the case of commercial reprocessing, practically all of the short life I-131 from uranium fission has decayed.

However, iodine-131 from fission of curium-244 in the fuel is detected and measured in all steps of the PUREX process: in the dissolver off-gas, in the vessel ventilation system, and particularly in the vessel ventilation of the storage tanks of the liquid high active waste (Herrmann 1994).

II.1 Residual Iodine Content in the Dissolver Solution

The chemical behavior of iodine in a nitric acid medium is complex. Particularly at low concentrations, iodine behavior is dominated by the redox potential in combination with unavoidable, mostly organic trace impurities in the solution. The species and the concentration of these impurities depend on the suppliers of nitric acid and on processing details. So the behavior of iodine may deviate largely from expected textbook behavior (Henrich 1996, Comor 1992).

The conditions for evolution of iodine into the off-gas have been examined in laboratory, in inactive pilot plant scale, in the hot cell facilities of the Karlsruhe nuclear research center as well as in the WAK reprocessing plant.

Henrich, Grimm and Boukis (1991) demonstrated with a high burnup fuel (50 GWd/T U) from the BIBLIS light water power reactor in laboratory scale dissolution experiments residual iodine contents between 1.1 % (1.2 mg/l) and 2.2 % (2.3 mg/l) of the inventory of the fuel after dissolution of 80 g of UO_2 fuel in 220 ml HNO_3 (7.5 M). The values of 1.2 mg/l and 2.3 mg/l have been obtained with nitric acid of p.a. quality respectively with recycled acid from the WAK plant (Henrich 1991). After filtration of the fuel solution, addition of iodate carrier, subsequent NO_x sparging and a second filtration of the fuel solution the residual iodine content decreased below 0.5 % (0.5 mg/l) of the iodine inventory of the fuel. The residual iodine concentration depends strongly on the quality of the nitric acid.

Because of the extraction behavior of the residual iodine in different extractants, Henrich (1991) and Boukis (1991) conclude that the residual iodine must be a mixture of many iodinated organic species

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

with different extractabilities. Henrich (1988) pointed out that the concentration of organic impurities in a pure nitric acid in a ppm range is by two orders of magnitude higher than the aspired residual iodine content in the dissolver solution ($2 \cdot 10^{-6}$ mol/l). Henrich's interpretation is supported by the results of Lieser (1989).

The WAK plant experiences (>8 hours boiling time, air sparging, addition of carrier iodine during the last 2 hours of dissolution) showed, that it is difficult to reach residual iodine values in the dissolver solution below 1 % of the inventory for a high burnup fuel (35,000 MWd/T U). This value corresponds to an iodine concentration of approximately 1 mg/l.

For dissolution in WAK lower iodine-129 concentrations than 1 % of the iodine inventory in the feed have been reported by Berg (1977). The discrepancy between the earlier WAK values and the recent values of the Karlsruhe research center and of the WAK plant is not connected with the evolving process but with the usual analytic iodine separation and determination procedure which took into account only the inorganic and soluble iodine compounds (Henrich 1996).

Depending on operation conditions in the WAK plant (8 hours boiling time, air sparging), the residual iodine concentrations in the dissolver solution generally were in the range of 1 to 4 mg iodine per liter. It seems that the residual iodine concentration [g/l] is not influenced by the burnup of the processed fuel; the fraction of the residual iodine in [%] is of course higher for the fuel with a low burn-up and with a low total iodine content. Fuel with a low burn-up of 7 to 14 GWd/t U yielded residual iodine contents of 4 % to 12 % (in average 6 %), whereas high burn-up fuel with 30 GWd/t U yielded average residual iodine contents of 2 to 3 % of the inventory of the fuel after the end of the dissolution. In both cases, high burn-up fuel and low burn up fuel, the range of the residual iodine concentration was 1 to 4 mg/l. (Fission product iodine-127 was taken into account with 25 weight % of the iodine-129 inventory).

Important parameters for the evolution of the iodine during the dissolution process are the quantity of water vapor generated during boiling of the dissolver solution (45 m³/h), the formation of the nitrous oxides (20 m³/h) and the duration of the dissolution process. For the standard dissolution conditions 8 hours are required. To obtain low residual iodine values in the dissolver solution it is important to have a high quantity of dissolver off-gas passing through the dissolver and the reflux condenser (80 to 120 m³/h). The addition of natural iodine as carrier and sparging of the dissolver solution with NO₂ during the last hour of the dissolution resulted in an average iodine content of 1 % (about 1 mg/l) of the iodine-129 inventory in the case of a high burnup fuel.

The percentages employed for the following considerations are average values resulting from the analyses of many liquid and many off-gas samples. These values cover the analyzed iodine fractions obtained by fuel with burn-up between 15,000 MWd/t U and 40,000 MWd/t U.

II.2 Iodine Concentration in the Dissolver Off-Gas

In the Karlsruhe reprocessing plant the bulk of the iodine inventory (in average 94 %) is evolved from the dissolver solution and is transported by the dissolver off-gas DOG through a reflux condenser and two subsequent acid scrubbers on two iodine filters in series. These filters contain a silver nitrate

impregnated silica material with a grain size of about 1 mm. The iodine concentration in the dissolver off-gas upstream the iodine filters undergoes big variations. Average values during dissolution periods are in the order of 1 to 5 mg/m³ with peak values up to 100 mg/m³.

After shut down of the WAK plant the iodine concentrations upstream the iodine filter in the dissolver off-gas dropped from average values of about 2 mg/m³ in December 1990 to 0.03 mg/m³ in January-February 1991 and further to 0.001 mg/m³ at the end of 1991.

II.3 Iodine Depositions in the Sampling Lines of the Dissolver Off-Gas

Iodine depositions in sampling lines have been studied by Glissmeyer and Sehmel (1991). They occur in the sampling lines because of the high surface/volume ratio of the sampling pipes and the relatively low linear velocity of the sampling gas streams. Iodine depositions in the sampling lines can potentially lead to erroneous results of radioiodine measurements and make dubious all short term measurements concerning the removal efficiency of iodine filters or scrubbers. One example may illustrate the problem of iodine depositions:

Iodine sampling in the dissolver off-gas of WAK is performed discontinuously all 4 to 5 dissolutions. At the beginning of a dissolution campaign in WAK after 5 dissolutions of a fuel with a burnup of 14,000 MWd/t U only about 34 % of the iodine inventory of the fuel could be measured in the dissolver off-gas upstream the iodine filters. (This value can lead to the conclusion that the scrubbers upstream the iodine filters had an iodine removal efficiency of 60 %, assuming an iodine evolution of 94 % of the iodine inventory in the dissolver). After 14 dissolutions about 76 %, and after 32 dissolutions about 84 % of the iodine inventory were found on the sampling filters. These delayed iodine concentrations result from iodine depositions formed in the sampling lines at the beginning of a campaign.

The above cited results had been obtained without heating the sampling lines. To overcome the errors due to iodine depositions in non heated sampling lines, long term measurements have to be performed. By heating the whole sampling lines to > 80 °C, it had been demonstrated that iodine depositions can be prevented and that short term measurements of the removal efficiency of the iodine filters yield reliable results.

After the end of a dissolution period iodine concentrations in the dissolver off-gas system drop slowly. Several days are necessary to attain iodine concentrations comparable to the iodine concentrations in the vessel ventilation system of the PUREX process (0.008 mg/m³).

II.4 Iodine Behavior in the PUREX Solvent Extraction Process

The percentages of iodine in the following considerations are average values resulting from the last five years of operation. They cover the analyzed iodine fractions obtained by fuel with burn-up between 15,000 MWd/t U and 40,000 MWd/t U (see chapter II.1).

The residual iodine species remaining in the fuel solution (in average about 5 % of the iodine inventory of the fuel; about 1 % is fixed on the dissolver residues) are distributed in the subsequent extraction process operations. About 2 % to 3 % of the iodine inventory of the dissolved fuel were found in the organic solvent (20,000 to 40,000 Bq iodine-129/l corresponding to 3 mg/l to 6 mg/l). The rest of about 2 % are spread over the high active waste and different off-gases. The organic iodine compounds

in the solvent contribute to the iodine emitted by the vessel vent system of the PUREX process and the vessel vent of the subsequent medium active waste treatment facility. During solvent wash the iodine content in the organic phase does not decrease considerably. Only about 0.3 % of the iodine inventory of the fuel was found in the alkaline solvent wash streams.

After shut down of the WAK plant the organic solvent, the organic and aqueous wastes have been transferred to the waste treatment facilities of the Karlsruhe Research Center. The iodine releases of this facility had been discussed by Amend (1990).

II.5 Iodine Concentration in the Vessel Ventilation System of the PUREX Process

After 8 hours of dissolution the residual iodine concentration in the dissolver solution is 1 to 4 mg/l. The residual iodine is routed to the extraction process. In 1990 detailed investigations over different reprocessing periods were carried out during reprocessing of about 9 tons of fuel from nuclear power plants (burnup 5.4 to 30 GWD/t) to determine the distribution of iodine in the PUREX process. From the iodine arriving in the separations process, about 50 % are evolved into the vessel vent system. The average iodine concentration in the vessel vent (270 - 330 m³/h) is between 0.008 and 0.018 mg/m³. Maximum values measured over a 14 days period attained about 0.03 mg/m³ (160 Bq/m³ Iodine-129).

Immediately after shut down the iodine release via this off-gas dropped from about 10 MBq (1.5 g of iodine-129) per month in December 1990 to 5 MBq per month in January 1991 and reached values of about 0.2 MBq/month (= 30 mg/month) after 10 months.

II.6 Iodine in the Vessel Ventilation System of the Medium Active Waste Storage Tanks

The iodine concentrations in this off-gas stream during operation was approximately 0.01 mg/m³. After shut down this concentration did not drop immediately. One year after shut down the iodine concentration was lower by a factor of 10. No iodine filter was in operation in this off-gas.

II.7 Iodine in the Vessel Ventilation System of the Liquid High Active Waste Concentrate (HAWC) Storage Tanks

Two storage tanks contain the high active waste concentrate of 20 years reprocessing history of the WAK plant (about 60 m³ HAWC).

During the operation period of WAK the iodine concentration measured in this off-gas stream was between 0.002 to 0.006 mg/ m³. (iodine-129: 10 to 30 Bq/m³).

After shut down of the plant in January 1991 the monthly amount of iodine-129 evolved by the HAWC has not decreased considerably during five years. In average 2 MBq of iodine-129 per month (0.3 g I-129) are evolved. Table 1 gives an overview over the iodine-129 evolved.

Year	1991	1992	1993	1994	1995
I-129 evolved [MBq/a]	16.9	16.1	23.7	25.8	26.5

Table 1 Iodine-129 evolution from the liquid high active waste concentrate (HAWC)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The amount of iodine-131 evolved by the HAWC solution in terms of Becquerel is in the same order of magnitude as the amount of Becquerel of iodine 129. Iodine-131 results mainly from the spontaneous fission of Curium-244. Whereas Cm-244 and Cm-246 in the waste solution are the main sources for the generation of iodine-131 by spontaneous fission (Herrmann 1994), the iodine-129 evolved by this off-gas results mainly from the residues of the dissolution processes from 20 years reprocessing, containing some hundred grams of iodine-129.

Up to now the evolution of iodine-129 from these storage tanks show no significant decrease. Due to the iodine filter in this vessel vent system the release values are about 10 % of the amount of the iodine evolved by these solutions.

II.8 Iodine in the Cell Ventilation System

In the cell vent system of the WAK plant during dissolution periods a fraction of 0.3 % of the iodine-129 inventory of the fuel was measured. Iodine monitoring devices in different ventilation systems revealed that the measured iodine (up to 30 mg per day) originated almost exclusively to the shear and dissolver cell. The measured iodine concentrations in this off-gas were $3 \cdot 10^{-5}$ mg/m³ and reached concentrations up to $18 \cdot 10^{-5}$ mg/m³ during plant operation. Such high release values have been observed exclusively during dissolution periods. The high releases of 20 to 30 mg of iodine per day had been measured by two independent monitoring systems over a period of 4 to 6 weeks. It can be excluded that the measured iodine was a result of the shearing process itself. Leudet and Leseur (1982) demonstrated that during shearing of high burnup fuel from power reactors fission product iodine release was not detectable.

Two reasons may be responsible for an iodine leaking out of the dissolver:

- A leakage of the dissolver cover seems to be possible at the beginning of dissolution when a high rate of nitric oxides are generated and the reduced pressure of the dissolver off-gas system goes to 0 (related to the pressure in the dissolver cell).
- The reduced pressure cannot be maintained during the opening of the dissolver cover when the fuel is loaded and iodine deposits may come into the cell.

After shut down the iodine-129 release values dropped from about one MBq/month in December 1990 to 0.1 MBq/month in November 1991.

III. Iodine Removal Devices

III.1 Acid Scrubbers and Caustic Scrubber in the Dissolver Off-Gas

Because of the presence of nitric oxides in the off-gases of a reprocessing plant the use of charcoal is prohibited.

Acid scrubbers: Concerning the two acid scrubbers in series located in the dissolver off-gas system of the WAK plant only 0.5 % to 1.5 % of the iodine inventory of the dissolved fuel had been measured in the nitric acid solution of the two packed columns after each dissolution charge. This fact of a low removal efficiency must be seen in connection with the relatively high dissolver off-gas flow rate of the WAK plant of about 100 m³/h.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Caustic scrubber: At the beginning of 1975 during WAK operation it has been tried to remove the iodine evolved from the dissolver by caustic scrubbing. An iodine removal efficiency of 53 % to 71 % could be attained in the dissolver off-gas (Schüttelkopf 1976). Because this iodine removal efficiency was too low, iodine filters with silver impregnated silica entered in operation mid 1975 in the dissolver off-gas. In the vessel ventilation system only 15 % of the total measured iodine could be removed by caustic scrubbing (Herrmann 1990).

III.2 Silver impregnated Iodine Filters in the Dissolver Off-Gas

During dissolution periods the highest removal efficiencies for the two filters in series of 99.5 to 99.9 % related to the iodine concentrations in the off-gas upstream the iodine filter had been measured, the iodine concentrations in the dissolver off-gas varying in average between 1 and 5 mg/m³. Downstream the two iodine filters in series iodine-129 concentrations of about 0.005 mg/m³ were observed during dissolution periods.

During outage periods and during the first six months after shut down, iodine concentrations of about 0.01 mg/m³ (65 Bq/m³) had been measured upstream the two iodine filters. Downstream the iodine filters iodine concentrations of about 0.0007 mg/m³ were measured. The removal efficiency of the two iodine filters in series dropped to 90 %.

One year after shut down the iodine-129 concentrations downstream the two iodine filters dropped to about 0.6 Bq/m³.

III.3 Silver Impregnated Iodine Filter in the Vessel Off-Gas of the PUREX Process

As shown above the iodine concentration in the vessel off-gas varied between 0.008 and 0.018 mg/m³. The measured removal efficiency of a prototype filter in a side stream of this off-gas has been 90 to 95 % of the iodine concentration in the off-gas upstream the iodine filter.

III.4 Iodine Filter in the Vessel Ventilation System of the High Active Waste Storage

This iodine filter with AC6120/12 % Ag is operating at about 40 °C and has a removal efficiency 90 % to 94 %. The gas flow rate is about 180 m³/h. The measured iodine contents in the off-gas upstream (evolved) and downstream (released) are shown in table 2.

Year	1990	1991	1992	1993	1994	1995
Iodine-129 evolved [MBq/a]	35.0	16.9	16.0	23.7	23.9	26.5
Iodine-129 released [MBq/a]	2.3	0.9	1.5	2.0	1.72	1.4

Table 2 Iodine contents upstream and downstream the iodine filter in the vessel ventilation system of the storage tanks of the liquid high active waste concentrate (HAWC)

IV. Iodine Release of the Reprocessing Plant WAK during Operation and after Shut Down

The iodine release fraction of a reprocessing plant is defined as the ratio of all iodine leaving the plant to the iodine processed in the plant. It is determined by the efficiency of the iodine removal devices.

Most of the iodine released resulted from the vessel ventilation systems. During the considered period the vessel ventilation system had no iodine filters. Although the iodine removal efficiency of the filter in the dissolver off-gas was high (about 99.5 %), the iodine overall release from the plant was in yearly average 1.8 % of the iodine inventory of the fuel during 14 years of reprocessing. The highest release fraction in one year was 4.1 % of the iodine processed. This high release fraction resulted from an experimental program with the aim of shortening the dissolution time of 7 dissolution charges from 8 hours to 5, 4 and 3 hours. It must be noted that this experimental program concerned only 7 from 25 dissolution charges in one month.

The values of iodine 129 releases during the last year of operation (1990) and the following years after shut down demonstrate clearly a decrease of the iodine-129 concentration by a factor of about 10 in the off-gases.

Table 3 shows the iodine-129 and iodine 131 releases of the WAK Plant from 1990 to 1995.

Year	1990 Operation	1991 shut down	1992	1993	1994	1995
Iodine-129 (MBq/a)	91	33	8.7	6.5	4.3	2.9
Iodine-131 (MBq/a)	12	3.7	4.5	4.5	4.1	2.5

Table 3 Iodine release of WAK Plant from 1990 through 1994 (shut-down January 1991)

After shut down most of the iodine releases is originated from the vessel vent system of the medium active waste storage tanks and the high active waste concentrate (HAWC) storage tanks. The HAWC evolves in average 25 MBq iodine-129 per year. Since this off-gas stream passes through an silver impregnated iodine filter, the releases are lowered by a factor of about 10.

The iodine 131 emissions after shut down result exclusively from the high active waste concentrate. The amount of iodine-131 evolved shows a slight tendency of decrease during the last five years due to the half life period of the nuclide Cm-244 (18 years), generating the iodine-131.

During the last year of reprocessing (1990) the release fraction of the WAK plant for iodine-129 was 2.1 % of the iodine-129 inventory processed. From this 2.1 % two thirds originated to the vessel ventilation system of the PUREX process, one fifth to the storage tanks of the medium active waste and one tenth to the cell ventilation system. Only a fraction of 0.028 of the 2.1 % originates to the iodine filtered dissolver off-gas and a fraction of 0.018 to the iodine filtered vessel ventilation system of the liquid high active waste concentrate storage tanks.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Literature

Amend, J., V. Motoi, F.J. Herrmann, J. Furrer. 1990. Iodine-129 Distribution and Retention during Evaporation of MLLW Solutions. 21st DOE/NRC Nuclear Air Cleaning Conference, San Diego 1990.

Berg, R., H. Schüttelkopf. 1977. Die Messung der Verteilung von Iod-129 in der WAK, Seminar on Radioactive Effluents from Reprocessing Plants. Karlsruhe, November 1977, pp. 81 f.

Boukis, N., and E. Henrich. 1991. Two-Step Procedure for the Iodine Removal from Nuclear Fuel Solutions. *Radiochimica Acta* 55, 37 - 42 (1991).

Comor, J.J., E. Henrich, R. Grimm, L. Stieglitz. 1992. Further Investigations on the Iodine Species Formed in the Nitric Acid/Nitric Oxide System. *Radiochimica Acta* 57 (1992) pp. 207-212.

Glissmeyer, J. A., and G. A. Sehmel. 1991. Line-Loss Determination for Air Sampler System. NUREG/CR-4757; PNL-5797.

Henrich, E., R. Grimm, L. Finsterwalder. 1988. Ioddesorption aus der Brennstofflösung, ein Vergleich von Theorie und Experiment. Report KfK 4476 pp.155-200 (1988).

Henrich, E., R. Grimm, N. Boukis, W. Zetzel, F. Leonhard, D. Ertel. 1991. Experimente zur Ioddesorption aus hochaktiven und simulierten Brennstofflösungen und Entwicklung der zugehörigen Iodanalytik. Primärbericht Kernforschungszentrum Karlsruhe PWA 29/91 (Okt. 1991).

Henrich, E. 1996. Control of Volatile Radionuclides in Reprocessing. To be published in *Kerntechnik* 1996.

Herrmann, F. J., V. Motoi, B. Herrmann, A. van Schoor, D. Fang, H. Fies. 1990. Retention and Measurement of Iodine-129 and of Organoiodine in the Off-gas Streams of the Karlsruhe Reprocessing Plant WAK. 21st DOE/NRC Nuclear Air Cleaning Conference, San Diego 1990, CONF-900813. pp 222-233.

Herrmann, B., F.J. Herrmann, W. Knoch, A. Stollenwerk. 1994. Iodine-131 in the Off-Gas of Karlsruhe Reprocessing Plant. RECOD '94, Vol. III. London

Leudet, A. and A. Leseur. 1982. Comportement des radionuclides gazeux dégagés pendant les opérations initiales de retraitement. Rapport EUR 7822 FR.

Lieser, K. H., et al., 1989. Radioiodine in Nitric Acid, *Radiochimica Acta* 48. 193-199.

Schüttelkopf, H. 1976. Jahresbericht 1975 - Abteilung Strahlenschutz und Sicherheit: Emissions- und Immissionsmessungen von I-129. pp. 142-146. Report KfK 2266 (Mai 1976).

DISCUSSION

SAKURAI: At the WAK reprocessing plant, was the expulsion of iodine from the spent-fuel solution performed by NO_x sparging? And what was the effect?

HERRMANN: It was an experimental program which took a lot of preparation because we must make the demand to the authorities. But we have already made ten dissolutions with additions of I-127 and NO₂. NO₂-sparging and simultaneous addition of iodine-127 to the dissolver resulted in a residual iodine content in the feed solution of 1 mg/l.

JUBIN: I have a question on the high active waste concentrate. Have you had a chance to analyze the iodine content in the HAWC?

HERRMANN: The problem with the iodine-129 analysis was the biggest problem we had because the analytical procedure, by extracting and reextracting the iodine from the high activity solutions did not catch the organic species. And as far as I remember, in the high active waste solutions, we found between 500 and 5,000 Bq/l before the concentration step (HAWC). But this was not compatible with the continuous evolution of iodine-129 tanks. (The measurement of iodine-129 in the offgases is reliable because after the HEPA filters, there is no other activity on these sampling filters.) The continuous evolution of I-129 from HAWC results from the solid residues in the HAWC containing iodine.

KNOCH: Iodine depositions can occur also in the main ducts of the offgas.

HERRMANN: In our case the linear velocity in the sampling lines is lower than the gas velocity in the main line. I agree, we cannot exclude depositions in the main pipes.

FUKASAWA: In Table 3 of your manuscript, I-129 release decreased more rapidly than I-131. (I-129: 91 MBq/y ('90) ⇒ 2.9 ('95); I-131: 12 ('90) ⇒ 2.5 ('95) What is the reason for this phenomenon?

HERRMANN: The rapid decrease of I-129 releases is conspicuous after shutdown of the plant in January, 1991. The I-131 releases after shutdown result from the spontaneous fission of Cm-244 present in the high level liquid waste HAWC.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CLOSING COMMENTS OF SESSION CHAIRMAN

I would like to thank all of the speakers for their effort in attending this conference and for the quality of their presentations. I think that iodine studies continue to be important. In the United States we are moving toward looking at waste. A number of the statements by Dr. Herrmann are relevant to the work that is going on in waste and most certainly in the iodine content of the tanks. As we look at adsorbents we find that they all have potential application when there is a significant quantity of iodine that has to be removed from the waste. Other countries are proceeding with reprocessing and adsorbents can become important in their applications.

In this session we have heard five papers describing very interesting work from around the world. I found the studies concerning the continued release of iodine from the waste tanks at WAK very interesting and in particular the data that indicated the continued generation of iodine 131 from the tanks. While I am not aware of other reports of similar observations, I certainly recognize this as relevant to activities currently underway in the U.S. and warranting further investigation. Clearly this could have impact on the processing of the millions of gallons of waste currently stored within the DOE complex. The first paper of the session provided an update on the research into the behavior of iodine in the dissolver solution. This work continues to shed light on some of the reported variations in the observed iodine evolution from dissolver solutions. The second paper is also a continuation of previously reported work on the silver impregnated alumina iodine sorbents. This paper focused on the impact of NO_x, water vapor, and pre-exposure times. Other off-gas impurities were also investigated. The third paper reported on a fundamental study into the controlling mechanisms of methyl iodide adsorption on silver exchanged mordenite. Micropore diffusion was identified as the rate controlling process for the adsorption of methyl iodide in the long term. The fourth paper looks back over an extensive experience base on iodine removal efficiencies in actual operations. I want to thank the speakers for their effort and interesting research and evaluations.

SESSION 11

FILTERS

Wednesday July 17, 1996

Co-Chairmen: R. Dorman
J. Slawski
J. Dymant

A REVIEW OF DOE HEPA FILTER COMPONENT TEST ACTIVITIES:
FY- 1994

J.W. Slawski, J.F. Bresson, and R.C. Scripsick

IN-PLACE HEPA FILTER EFFICIENCY TESTS

W. Bergman, K. Wilson, J. Elliot, and J.W. Slawski

METHOD FOR HEPA FILTER LEAK SCANNING WITH
DIFFERENTIATING AEROSOL DETECTOR

B.J. Kovach , E.M. Banks, and W.O. Wikoff

UNCERTAINTY IN IN-PLACE FILTER TEST RESULTS

R.C. Scripsick, R.J. Beckman, and B.V. Mokler

VALIDATION TESTING OF RADIOACTIVE WASTE DRUM FILTER
VENTS

L.D. Weber, R.S. Rahimi, and D. Edling

A GENERAL CORRELATION OF MPPS PENETRATION AS A
FUNCTION OF FACE VELOCITY WITH THE MODEL 8140 USING
THE CERTITEST 8160

N. Lifshutz, and M.E. Pierce

FURTHER DEVELOPMENT OF THE CLEANABLE STEEL HEPA
FILTER AND COMPARISON WITH COMPETING TECHNOLOGIES

W. Bergman, K. Wilson, and G. Larsen

THE EFFECT OF MEDIA AREA ON THE DUST HOLDING CAPACITY
OF DEEP PLEAT HEPA FILTERS

J. Dymont, and D. Loughborough

POTENTIAL FOR HEPA FILTER DAMAGE FROM WATER SPRAY
SYSTEMS IN FILTER PLENUMS

W. Bergman, J.K. Fretthold, and J.W. Slawski

SIMULATION TEST OF AEROSOL GENERATION FROM VESSELS IN
THE PRE-TREATMENT SYSTEM OF FUEL REPROCESSING

S. Fujine, K. Kitamura, and T. Kihara

EXTENDED-LIFE NUCLEAR AIR CLEANING FILTERS VIA
DYNAMIC EXCLUSION PREFILTERS

S.W. Wright, H.S. Crouch, and J.H. Bond

A REVIEW OF DOE HEPA FILTER

COMPONENT TEST ACTIVITIES

FY 1992-FY 1995

James W. Slawski, CIH, CSP¹

James F. Bresson²

Ronald C. Scripsick³

**¹Defense Programs (DP-45)
United States Department of Energy**

**²Informatics Corporation, Inc.
Albuquerque, New Mexico**

**³Industrial Hygiene and Safety Group (ESH-5)
Los Alamos National Laboratory**

ABSTRACT

The Department of Energy (DOE) HEPA Filter Test Facilities have continued to operate in a changing political and operational environment. All HEPA filters purchased for installation in DOE nuclear facilities are required to be tested at a DOE Filter Test Facility (FTF) prior to installation, but the program is changing. Due to changes in its primary mission, the numbers of HEPA filters purchased by DOE each year since FY 1991 have been substantially reduced, to the point where one of the FTFs (Hanford) was closed in FY 1995 due to lack of filters to test. During the period FY 1992 - FY 1994, DOE funding was not provided to support the FTF Technical Support Group at the Los Alamos National Laboratory. As a consequence, Round Robin Tests (RRTs), performed twice each year by the FTFs in order to assess constituency of test results among the FTFs, were not performed in FY 1992 and FY 1993. The Annual Reports, summary reports of FTF test activities reports prepared and statistically analyzed by the TSG, were not prepared for fiscal years 1992 - 1995. Technical support provided to the FTFs was minimal. Currently, there is talk of closing a second FTF, and there are ongoing discussions as to whether the DOE will continue to fund operation of one or more of the FTFs.

In FY 1994, DOE Defense Programs commenced funding the TSG. The Round Robin Test Program is again administered by the TSG. RRT data for the years FY 1994 and FY 1995 have been retrieved and entered into the RRT data base; the FY 1994 RRT report has been issued; and the FY 1995 RRT report is in progress. Data from Semi-annual reports prepared by the FTFs have been retrieved, and entered into the FTF data base at LANL. Standards related to HEPA filter test and procurement activities⁽¹⁻⁴⁾, which had been written, peer reviewed, and recommended for implementation by DOE (but never "officially" issued) are now scheduled for issuance by the end of CY 1996. Continuation of these activities, however, depends on whether DOE will continue to support the HEPA filter test program.

The history and activities of the FTFs and the Technical Support Group (TSG) at Los Alamos have been reported at previous Air Cleaning Conferences⁽⁵⁻¹³⁾. Data from the FY 1991 Annual Report of FTF activities was presented at the 22nd DOE/NRC Air Cleaning Conference in 1992⁽¹⁴⁾. Preparation of the Annual Reports was temporarily suspended in 1992. However, all of the FTF Semi-annual report data have been retrieved and entered into the Los Alamos data base. This paper focuses primarily on the results of HEPA filter tests conducted by the DOE FTFs during the period FY 1992 - FY 1995, and the possible effects of the DOE program uncertainties on the quality of HEPA filters procured for installation at the DOE sites.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

I. INTRODUCTION

Twice each year the DOE HEPA Filter Test Facilities (FTFs) must prepare a summary report of HEPA filter test activities. Each year, the Technical Support Group (TSG) at the Los Alamos National Laboratory is tasked with compiling the two Semi-annual Reports from the FTFs into an Annual Report. The objective of the annual report is to provide information on the performance and quality of High Efficiency Particulate Air (HEPA) filters being purchased and installed at DOE facilities. Current DOE policy requires that every HEPA filter be tested at one of the FTFs prior to acceptance and installation at a DOE user facility. With the exception of the summary data which appears in Section III, Table 1, below, this report focuses primarily on the period FY 1992 through FY 1995.

II. ORGANIZATION OF THE REPORT

The combined data from tests performed at the DOE FTFs for fiscal years FY 1983 - FY 1995 are presented in Section III A of this report. In Section III-B, summary data for the period FY 1992 - FY 1995 is presented, together with a general discussion of these data. In Sections IV-VII, in order to readily compare the test data with data in previous reports, and to analyze them accordingly, the test data is presented, analyzed and discussed by individual fiscal years. Results of a multi-year trend analysis are presented in Section VIII, and overall summary statements and conclusions regarding the HEPA filter test data appear in Section IX.

III. ANALYSIS OF THE FTF DATA

A. Summary of Overall DOE FTF HEPA Filter Test Activities

Annual reporting of DOE HEPA filter test data commenced in FY 1983. From the program's inception in FY 1983, through FY 1995, the DOE FTFs tested a total of 131,218 filters. The average number of filters tested per year during the period FY 1982-FY 1990 was 12,465. The total number of filters tested during the period FY 1992-FY 1995 was 23,948, an average of just under 6000 filters per year. A significant decrease in numbers of HEPA filters tested each year began in FY 1991, when the total number of filters tested was 7,551, which was a new annual low. The downward trend has continued, such that in FY 1995, only 3,758 filters were tested at the DOE FTFs. Table 1 presents the overall HEPA filter test history for the period FY 1983 - FY 1995.

In FY 1991 and FY 1992, the decrease in filter test activities was attributed primarily to cessation of weapons production activities at the Rocky Flats Plant, resulting in a significant decrease in numbers of HEPA filters procured for installation at Rocky Flats. However, the downward trend continued in the years FY 1993 - FY 1995, reflecting the general curtailment of nuclear activities at several DOE sites. The frequency of HEPA filter changes in facility air handling systems has, in some cases, been sharply reduced, perhaps compounded by the fact that HEPA filters in radioactively contaminated systems at several sites remained in place for extended periods. This latter practice has also caused a decrease in the numbers of HEPA filters procured by DOE sites and tested at the FTFs. In July, 1995, the DOE FTF located at Richland, Washington was closed, due to lack of filters to test. There have been recent discussions within DOE which could result in closing a second FTF, or both of them.

Possible actions which could reverse the downward trend in HEPA filter procurement and testing might include: 1) an increase in treatment operations for radioactive and mixed wastes at several DOE sites; 2) an increase in decontamination and deconstruction activities at DOE nuclear facilities; and 3) a commitment to comply with previously established frequencies for replacing filters in radioactively contaminated air handling systems.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1
Annual Filter Test Results- FY 1983 - FY 1991

Period	N ¹	NIA/% ²	NAW/% ³	NR/% ⁴
10/82-9/83	10,468 ⁵	9,811/94	291/2.8	366/3.5
10/83-9/84	12,223 ⁵	11,657/95	310/2.5	255/2.1
10/84-9/85	13,762 ⁷	12,141/88	1014/7.4	597/4.3
10/85-9/86	14,500 ⁵	13,263/91	847/5.8	392/2.7
10/86-9/87	13,656	13,161/96	235/1.7	260/1.9
10/87-9/88	11,822	10,847/92	745/6.3	230/1.9
10/88-9/89	12,538	12,042/96	139/1.1	347/2.8
10/89-9/90	10,750 ⁷	10,398/97	52/0.5	352/3.3
10/90-9/91	7,551	7,353/97	0/0.0	198/2.6
10/91-9/92	6,221	5,868/94	0/0.0	353/5.7
10/92-9/93	8,683	8,028/92	0/0.0	655/7.5
10/93-9/94	5,286	4,763/90	0/0.0	523/9.9
10/94-9/95	3,758	3,082/82	0/0.0	676/18
TOTALS	131,218	122,414/93	3,633/2.8	5,204/3.9

1. Number of Filters Tested
2. Number Initially Accepted/ %
3. Number Accepted with Waiver/ % (Category Deleted in FY 1991)
4. Number Rejected/ %
5. Does Not Include FY 1983 Data From Oak Ridge FTF
6. Does Not Include Oak Ridge FTF Data for the First Half of FY 1984
7. Disposition of One Filter was Not Given in FTF Reports
Disposition of 10 Filters was not given in the FTF Reports
8. Per DOE Direction, Two Filters were Reported as Both NAW and NR. The Sum of NIA, NAW and NR Exceeds N by 2.
9. Per DOE Direction, Fifty-Two Filters Were Reported as both NAW and NR. The Sum of NIA, NAW and NR Exceeds N by 52.

B. Summary of DOE HEPA Filter Test Activities: FY 1992 - 1995

Summary HEPA filter test data for the period 1992-1995 appears in Table III-2.

TABLE 2
HEPA FILTER TEST RESULTS FY 1992 - FY 1995

FY	# Rec.	# Acc./% ¹	Rejections			
			Penetration/% ²	Resistance/% ³	Other/% ⁴	Overall/% ⁵
1992	6,221	5,868/94.3	280/4.5	0/0	73/1.2	353/5.7
1993	8,683	8,028/92.4	145/1.7	0/0	510/5.9	655/7.5
1994	5,286	4,763/90.1	103/1.9	2/0.04	418/7.9	523/9.9
1995	3,758	3,082/82.0	68/1.5	479/12.8	129/3.6	676/18.0
TOT.	23,948	21,741/90.8	596/2.5	481/2.0	1130/4.7	2,2079.2

- 1 Number of Filters Accepted/% Accepted
- 2 Number of Filters Rejected for High Penetration/ % Rejected
- 3 Number of Filters Rejected for High Resistance to Airflow/% Rejected
- 4 Number of Filters Rejected for "Other" reasons/% Rejected
- 5 Overall Number of Filters Rejected for All Reasons/% Rejected

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Of the 23,948 filters tested during the period FY 1992 - FY 1995, 21,741 or 90.8% were initially accepted by the FTFs (NIA), 2,207 or 9.2 % were rejected (NR), and no filters were accepted with waiver or repair (NAW).

The overall rejection rate during the period FY 1992 - FY 1995 was 9.2%, ranging from a low of 5.7% in FY 1992 to a high of 18.0% in FY 1995. These results represent a marked increase over rejection rates for the three previous years, which ranged from 2.6 % to 3.3%, or for the overall period FY 1983 - FY 1991, in which the filters were rejected at a rate of 2.8%.

Review of the test data identified no single cause for the increasing rate of HEPA filter rejection. In FY 1992, high penetration constituted the highest component (4.5%) of the overall rejection rate (5.7%). In both FY 1993 and FY 1994, the highest failure rate was attributed to the general category called "Other" (5.9% and 7.9% respectively). The "Other" category includes but is not limited to: media damage, carrier damage, failure to comply with specifications in purchase orders, physical dimensions which are out of tolerance, and poorly installed or damaged gaskets. Specific details on why filters, or lots of filters, are rejected for "Other" reasons are recorded in the Semi-annual Reports submitted by the FTFs, but have not been specifically broken out in the LANL data base or in the Annual Reports. The specifics for "Other" rejection can be (and were) retrieved, if deemed necessary, from the Semi-annual reports.

In FY 1995, the highest cause for test failure was resistance to airflow (12.8%). More detailed discussion of these failure rates appears in Sections IV-VII of this report.

The category "Accepted with Waiver (NAW)" was abolished in FY 1991, following a revision to the DOE HEPA filter procurement standard⁽⁴⁾. From FY 1987 through FY 1990, filters Size 4 and above, which had been initially rejected for high resistance to airflow, were allowed to be tested at decreasing airflow rates until the resistance to airflow across the filter was equal to the applicable limit of 1" w.g.. Therefore, under this provision, every HEPA filter ultimately "passed" the resistance test. The downrated filters were to be installed in air handling systems which would not expose the filters to flow rates in excess of the established downrated test airflows. This technique was not successful; some downrated filters were installed in systems which exposed them to airflows in excess of their downrated airflow values. At an FTF managers meeting in 1990, it was agreed to eliminate both downrating and the "Accepted with Waiver" test category. From that point forward, HEPA filters tested at the DOE FTFs either must either meet the applicable limit of 1" w.g., at rated airflow or be rejected. The DOE Procurement Standard⁽⁴⁾ was revised to reflect this change in 1991. Commencing in FY 1992, the category "Accepted with Waiver" is no longer reported.

Strict adherence to the modified test standard for resistance to airflow did not immediately result in higher HEPA filter rejection rates. This was primarily because only one of the FTFs reported tests of HEPA filters Size 7 (1500 cfm) or Size 8 (2000) cfm) during the period FY 1992-FY 1994. Specifically, Rocky Flats reported testing one lot of 24 Size 7 filters in FY 1993, all of which were accepted. However, further review of the circumstances related to this test batch brought forth the information that the filters had been designated as "special" filters, not to be subject to the 1" w.g. test limit for resistance to airflow. None of the filters would have been accepted had the applicable standard for resistance to airflow been applied.

In FY 1995, the Oak Ridge FTF did test one lot of 506 Size 7 (1500 cfm) filters, and a total of 35 Size 8 filters. The Size 8 filters were designated as "special" filters, not subject to the applicable criterion of 1" w.g.. None of the Size 8 filters would have been accepted had the DOE criterion been applied. In fact, none of the Size 8 filters would have been accepted had the criterion of 1.3" w.g. which appears in a once-applicable Military Specification⁽¹⁴⁾, or its successor,⁽¹⁵⁾ been applied, because the measured resistances in all of the tests were either 1.7" w.g., or 1.8" w.g.. The test history of the 506 Size 7 filters is discussed in more detail in Section VII-C of this report.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

IV. FY 1992 HEPA FILTER TEST DATA

A. Summary of Test Results by FTF

FY 1992 test results, by individual FTF, appear in Table 3.

Table 3
FY 1992 HEPA Filter Test Results by FTF

FTF	N ¹	NIA ² %	NAW ³ %	NR ⁴ %
HANFORD	1,018	1,007/99	0/0.0	11/1.1
OAK RIDGE	3,217	3,056/95	0/0.0	161/5.0
ROCKY FLATS	1,986	1,805/91	0/0.0	181/9.1
TOTALS	6,221	5,868/94	0/0.0	353/5.7

- 1 Number of Filters Tested
- 2 Number Initially Accepted/% Accepted
- 3 Number Accepted With Waiver (Now 0)
- 4 Number Rejected for All Reasons/% Rejected

The overall rejection rate was 5.7%, which is more than twice the overall rejection rate of 2.8% for the period FY 1983-1991 (hereinafter the "Reference Rate"). Review of the results listed in Table 3 indicates a broad range of rejection rates, namely 1.1% at Hanford, 5.0% at Oak Ridge, and 9.1% at Rocky Flats. Review of additional test records indicates a rejection rate of 4.5% due solely to penetration, which by itself is about 1.5 times the "Reference Rate". This subject is further discussed Section IV-D of this report.

In FY 1992, the Oak Ridge FTF tested more filters (52% of the total tested) than the other two FTFs. This was only the second time since the filter test records data base program was initiated in FY 1983 that the Rocky Flats FTF was not the leader in total filters tested

B. Summary of Test Results by Manufacturer

Table 4 presents the overall FY 1992 HEPA filter test data by manufacturer. In FY 1992, Manufacturer # 7 supplied 4,995 of the 6221 (81%) HEPA filters tested by the FTFs; Manufacturer # 3 was second with 663 filters (10.6%); Manufacturer # 4 was third with 240 (3.8%); and Manufacturer # 19 was fourth with 137 (2.2%). The overall rejection rate for Manufacturer # 7 was 2.7%, compared to the overall FY 1992 rejection rate of 5.7%, however high rejection rates for filters supplied by Manufacturer # 3 (13%), Manufacturer # 4 (7.1%) and Manufacturer # 19 3M (75%) served to raise the overall rejection rate to 5.7%.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 4
FY 1992 HEPA Filter Test Results by Manufacturer

Manufacturer	N ¹	NI ² /%	NAW ³ /%	NR ⁴ /%
7	4,995	4,860/97	0/0.0	135/2.7
3	663	574/87	0/0.0	89/13
4	240	223/93	0/0.0	17/7.1
19	137	34/25	0/0.0	103/75
29	78	76/97	0/0.0	2/2.6
32	46	43/93	0/0.0	3/6.5
17	24	24/100	0/0.0	0/0.0
21	18	17/94	0/0.0	1/5.6
13	9	9/100	0/0.0	0/0.0
9	4	4/100	0/0.0	0/0.0
16	4	4/100	0/0.0	0/0.0
14	3	0/0.0	0/0.0	3/100
TOTAL	6,221	5,868/94	0/0.0	353/5.7

- 1 Number of Filters Tested
- 2 Number Initially Accepted/% Accepted
- 3 Number Accepted With Waiver (Now 0)
- 4 Number Rejected for all Reasons

C. Summary Discussion - FY 1992

The FY 1992 Semi-annual Report data was analyzed to identify statistically significant differences in HEPA filter test data among the FTFs, or among manufacturers. Statistical analysis was performed by use of an Analysis of Variance technique (ANOVA). When statistical differences are identified, the Semi-annual report data and/or individual test records are further reviewed to determine their cause and practical significance. Statistical analysis of FY 1992 test data identified several significant differences among manufacturers, but not among the FTFs. Chief among them were:

- An extremely low (64.3%) acceptance rate at the Oak Ridge FTF for Size 1 (25 cfm) filters supplied by Manufacturer # 3.
- An extremely low (17.6%) acceptance rate at the Rocky Flats FTF for Size 3 (125 cfm) filters supplied by Manufacturer # 19.
- Acceptance of only six of eleven Size 4 (500 cfm) filters supplied by Manufacturer # 4 at the Oak Ridge FTF.

The statistical analysis described above helped to focus further review on specific filter test data. This review confirmed a higher than usual rejection rate due to high penetration. Review of past test records indicates that although the rejection rates due to high penetration for the period FY 1983 - FY 1991 were typically less than 2.0%, the rejection rate due to high penetration in FY 1992 was 4.5%.

Review of the FY 1992 Semi-annual report data indicates that the high overall rejection rate was due chiefly to filters from four specific shipment lots. All the filters in these lots were rejected for high penetration. Three of the lots were tested by the Rocky Flats FTF; the fourth was tested by Oak Ridge.

Two of the lots tested at Rocky Flats were composed of Size 3 HEPA filters supplied by Manufacturer # 19. In one lot, 61 of 71 filters (85.9%) were rejected for high penetration; in the second lot, 42 of 54 filters

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

(77.8%) were also rejected for high penetration. This represents an average rejection rate of about 82% for the two lots. In the third lot tested by Rocky Flats, 45 of 242 Size 5 filters (19%) supplied by Manufacturer #7 were rejected for high penetration. In the fourth lot tested by Oak Ridge, 73 of 140 Size 1 HEPA filters (52.1%) supplied by Manufacturer # 3 were rejected for high penetration. The four lots in question accounted for 221 of the 280 (78.9%) filters rejected for penetration in FY 1992.

It is noteworthy that none of the 6,221 HEPA filters tested in FY 1992 failed the test for resistance to airflow. The rejection rate for "Other" causes in FY 1992 was 1.2%.

V. FY 1993 HEPA FILTER TEST DATA

A. Summary of Test Results by FTF

FY 1993 test results, by individual FTF, appear in Table 5.

Table 5
FY 1993 Test Results by FTF

FTF	N	NIA/%	NAW/%	NR/%
HANFORD	903	882/98	0/0.0	21/2.3
OAK RIDGE	3,564	3,330/93	0/0.0	234/6.6
ROCKY FLATS	4,216	3,816/91	0/0.0	400/9.5
TOTALS	8,683	8,028/92	0/0.0	655/7.5

The overall rejection rate for all causes was 7.5%, or about 2.6 times the "Reference Rate". The predominant reason for rejection in the FY 1993 tests was attributed to the "Other" category for which the rejection rate was 5.9%.

B. Summary of Test Results by Manufacturer

Table 6 presents the overall FY 1993 HEPA filter test results by manufacturer.

Manufacturer # 7 supplied 6,980 of the 8,683 HEPA filters (80.4%) tested at the FTFs in FY 1993. Of these, 570 (8.2%) were rejected, nearly three times the "Reference Rate". Manufacturer # 3 supplied 619 (7.1%) of the tested filters. Of these 12 (1.9 %) were rejected. Manufacturer # 32 provided 434 filters (5%), of which 51 (12%) were rejected. Manufacturer # 5 supplied 250 filters (2.9%), of which nine (3.6%) were rejected, and Manufacturer # 4 supplied 158 filters (1.8%) of which four (2.5%) were rejected. The remaining 242 filters (2.8%) were supplied by twelve different vendors, and nine of these (3.7%) were rejected.

Table 6
FY 1993 HEPA Filter Test Results by Manufacturer

Manufacturer	N	NIA/%	NAW/%	NR/%
7	6,980	6,410/92	0/0.0	570/8.2
3	619	607/98	0/0.0	12/1.9
32	434	383/88	0/0.0	51/12
5	250	241/96	0/0.0	9/3.6
4	158	154/97	0/0.0	4/2.5
11	72	72/100	0/0.0	0/0.0
19	60	60/100	0/0.0	0/0.0
10	29	26/90	0/0.0	3/10
23	20	18/90	0/0.0	2/10
21	18	17/94	0/0.0	1/5.6
29	11	11/100	0/0.0	0/0.0
14	9	6/67	0/0.0	3/33
16	8	8/100	0/0.0	0/0.0
33	6	6/100	0/0.0	0/0.0
17	6	6/100	0/0.0	0/0.0
9	2	2/100	0/0.0	0/0.0
25	1	1/100	0/0.0	0/0.0
TOTAL	8,683	8,028/92	0/0.0	655/7.5

C. Summary Discussion - FY 1993

The FY 1993 Semi-annual Report data was analyzed to identify statistical differences among the FTFs or the manufacturers. There were no statistically significant differences among the FTFs, however, there was a statistical difference identified among the manufacturers for Size 5 (1000 cfm) filters. It was determined that the acceptance rates for filters supplied by Manufacturer # 7 were lower than usual especially at Rocky Flats and Oak Ridge.

Further review of the FY 1993 test data indicates that the high rejection rates for the Size 5 filters occurred in the "Other" category, and were primarily related to two shipment lots. The first lot was tested at Rocky Flats. Of a shipment lot of 1,358 filters, 304 (22.4%) were rejected because of media damage. The second lot was tested by the Oak Ridge FTF. Of 930 tested filters, 80 were rejected because of missing extraction clips, 25 for defective fluid seal gaskets, and 1 for frame damage, a total of 106 rejects (11.4%). The overall rejection rate for the year FY 1993 was 7.5%, about 2.7 times the "Reference Rate", of which 5.9% was due to "Other" causes, and 1.7% was due to high penetration. No filters tested in FY 1993 were rejected for high resistance to airflow.

VI. FY 1994 HEPA FILTER TEST DATA

A. Summary of Test Results by FTF

FY 1994 HEPA filter test results by FTF appear in Table 7. The overall rejection rate for filters tested in FY 1994 was just under 10%. This rate is more than three times the "Reference Rate". The highest rejection rate component (8%) was the "Other" category.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

**Table 7
FY 1994 HEPA Filter Test Results by FTF**

FTF	N	NIA/%	NAW/%	NR/%
HANFORD	708	681/96	0/0.0	27/3.8
OAK RIDGE	1,371	1,175/86	0/0.0	196/14
ROCKY FLATS	3,207	2,907/91	0/0.0	300/9.4
TOTALS	5,286	4,763/90	0/0.0	523/9.9

B. Summary of Test Results by Manufacturer

Table 8 presents the overall FY 1994 filter test results by manufacturer.

**Table 8
FY 1994 HEPA Filter Test Results by Manufacturer**

Manufacturer	N	NIA/%	NAW/%	NR/%
7	3,752	3,616/96	0/0.0	136/3.6
3	937	718/77	0/0.0	219/23
32	313	229/73	0/0.0	84/27
19	111	52/47	0/0.0	59/53
4	54	52/96	0/0.0	2/3.7
29	41	41/100	0/0.0	0/0.0
5	20	0/0.0	0/0.0	20/100
10	20	19/95	0/0.0	1/5.0
23	13	12/92	0/0.0	1/7.7
16	11	11/100	0/0.0	0/0.0
13	9	9/100	0/0.0	0/0.0
21	4	4/100	0/0.0	0/0.0
6	1	0/0.0	0/0.0	1/100
TOTAL	5,286	4,763/90	0/0.0	523/9.9

Of the 5,286 filters tested, Manufacturer # 7 supplied 3,752 (71%); Manufacturer # 3 supplied 937 (17.7%); Manufacturer # 32 supplied 313 (5.9%); Manufacturer # 19 supplied 54 (0.1%); and various other manufacturers supplied 119 filters (2.3%). Of the 3,752 filters supplied by Manufacturer # 7, 136 (3.6%) were rejected. Of the 937 filters supplied by Manufacturer # 3, 219 (23.4%) were rejected. Of the 313 filters supplied by Manufacturer # 32, 84 (26.8%) were rejected. Of the 111 filters supplied by Manufacturer # 19, 59 (53.2%) were rejected. Of the 54 filters supplied by Manufacturer # 4, two (3.4%) were rejected, and of the 119 filters supplied by various other manufacturers, 23 (19.3%) were rejected. Of these, an entire shipment of 20 filters supplied by Manufacturer # 5, was rejected.

C. Summary of Test Results - FY 1994

The FY 1994 test data was analyzed to determine whether there were statistical differences among the FTFs or among the manufacturers. There were strong differences among the FTFs for Size 5 (1000 cfm) filters, and among manufacturers for Size 3 (125 cfm) filters.

The high rejection rates for both Size 3 and Size 5 filters were due primarily to the "Other" category and were related to two specific shipments. At Rocky Flats, an entire shipment of 200 Size 3 filters supplied by Manufacturer # 3 was rejected. There was no further explanation available from the Rocky Flats FTF regarding the specific problem or problems which led to rejection of the entire batch of filters. At Oak Ridge,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

100 filters of a shipment of 126 Size 5 filters (79.4%) supplied by Manufacturer # 7 were rejected because the gaskets had not been installed according to purchase specifications.

The rejection of all thirty-five filters in a lot of Size 6 filters for "Other" reasons is also noteworthy. The filters were supplied by Manufacturer # 33, and tested at Oak Ridge. Further review of the test records indicates that 34 of the filters had splintered frames and/or improperly seated gaskets. The remaining filter was rejected because it was not a "Nuclear Grade" filter. The cause of the splintered frames was not documented, and it is not known whether the filters were damaged during shipping and handling, or simply not properly inspected prior to shipment.

The overall rejection rate for HEPA filters tested in FY 1994 was 9.9%, more than three times the "Reference Rate". The overall rejection rate includes: 1.9% for high penetration, 2.0% for high resistance to airflow, and 7.9% for "Other" reasons. This was the first of the four years in which filters were rejected for high resistance to airflow.

VII. FY 1995 HEPA FILTER TEST DATA

A. Summary of Test Results by FTF

Table 9 presents the overall FY 1995 HEPA filter test data by FTF. 3,758 filters were tested, the lowest test total since LANL initiated the HEPA filter test data base in FY 1983. Of these, 2,471 (65.8%) were tested by Oak Ridge, 1,197 (31.9%) were tested by Rocky Flats, and 90 (2.4%) were tested by Hanford. Of the 2,471 filters tested by Oak Ridge, 62 (12.5%) were rejected; of the 1,197 filters tested by Rocky Flats, 46 (3.8%) were rejected; and of the 90 filters tested by Hanford, nine (10%) were rejected. FY 1995 was the first of the years covered in this report in which a significant number of filters was rejected for high resistance to airflow.

**Table 9
FY 1995 HEPA Filter Test Results by FTF**

FTF	N	NIA/%	NAW/%	NR/%
HANFORD	90	81/90	0/0.0	9/10
OAK RIDGE	2,471	1,850/75	0/0.0	621/25
ROCKY FLATS	1,197	1,151/96	0/0.0	46/3.8
TOTALS	3,758	3,082/82	0/0.0	676/18

B. Summary of Test Results by Manufacturer

FY 1995 HEPA filter test data by Manufacturer appears in Table 10.

Of the 3,758 filters tested by the FTFs, 2,794 (74.3%) were supplied by Manufacturer # 7; 751 (20%) were supplied by Manufacturer # 3; 56 (14.9%) were supplied by Manufacturer # 33; and 52 (13.8%) were supplied by Manufacturer # 32. Other manufacturers supplied smaller quantities of filters in FY 1995 as follows: Manufacturer # 19 supplied 26 filters (0.7%); Manufacturer # 23 supplied 22 filters (0.6%); Manufacturer # 12 supplied 14 filters (0.4%); Manufacturer # 29 supplied 12; Manufacturer # 21 supplied 12; Manufacturer # 25 supplied 8; Manufacturer # 1 supplied 7; Manufacturer # 14 supplied 2; Manufacturer # 4 supplied one; and Manufacturer # 9 supplied one. Of the 3,758 filters tested in FY 1995, 676 (18%) were rejected for all reasons.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 10
FY 1995 HEPA Filter Test Results by Manufacturer

Manufacturer	N	NIA/%	NAW/%	NR/%
7	2,794	2,233/80	0/0.0	561/20
3	751	712/95	0/0.0	39/5.2
33	56	39/70	0/0.0	17/30
32	52	37/71	0/0.0	15/29
19	26	12/46	0/0.0	14/54
23	22	10/45	0/0.0	12/55
12	14	14/100	0/0.0	0/0.0
29	12	12/100	0/0.0	0/0.0
21	12	12/100	0/0.0	0/0.0
25	8	0/0.0	0/0.0	8/100
1	7	0/0.0	0/0.0	7/100
14	2	0/0.0	0/0.0	2/100
4	1	1/100	0/0.0	0/0.0
9	1	0/0.0	0/0.0	1/100
TOTALS	3,758	3,082/82	0/0.0	676/18

Of the 2,794 filters supplied by Manufacturer # 7, 561 (20%) were rejected. Of the 751 filters supplied by Manufacturer # 3, 39 (5.2%) were rejected. Of the 56 filters supplied by Manufacturer # 33, 17 (30.4%) were rejected. Of the 52 filters supplied by Manufacturer # 32, 15 (28.8%) were rejected. Of the 26 filters supplied by Manufacturer # 19, 14 (54%) were rejected. Of the 22 filters supplied by Manufacturer # 23, 12 (54.5%) were rejected. All of the eight filters supplied by Manufacturer # 25, the seven filters supplied by Manufacturer # 1, the two filters supplied by Manufacturer # 14, and the single filter supplied by Manufacturer # 9 (a total of 18 filters) were rejected.

C. Summary Discussion - FY 1995

The overall rejection rate for FY 1995 was 18%, more than six times the "Reference Rate", and by far the highest rejection rate encountered in the test program. The FY 1995 Semi-annual report data was analyzed to determine whether there were statistical differences among the FTFs or the manufacturers. Statistically significant differences were identified among the FTFs and the manufacturers for Size 5 (1000 cfm) filters. For Size 7 (1500 cfm) filters, 518 of the 524 Size 7 filters tested in FY 1995 were rejected. The remaining six filters were accepted, but only because they were designated as "special case" filters. All six of these filters also exceeded the criterion for resistance to airflow.

Further review of the actual test data for Size 7 filters confirmed that high resistance to airflow was the largest contributor to the overall FY 1995 rejection rate of 18%; this category accounted for just under 13% of the rejected filters. The rejection rate due to high penetration was 1.8% (about average), and the rejection rate due to "Other" causes was 3.4%, which was higher than noted in previous years. Of a single lot of 506 Size 7 HEPA filters supplied by Manufacturer # 7, 476 were rejected for excessive resistance to airflow. In the same lot, seven additional filters (1.4%) were rejected for high penetration, 18 filters (3.6%) were rejected for defective fluid seals, four filters were rejected for shipping damage and one was "out of square". Thus, the entire lot of 506 filters was rejected.

This manufacturer's lot raises a serious question concerning purchase of HEPA filters at DOE sites in general, and at the Savannah River Site in particular. The purchase order for these filters specified a nominal airflow rating of 1500 cfm, but a limit for resistance to airflow of 1.3" w.g.. Procurement organizations at WSRC apparently do not recognize the applicable limit for resistance to airflow (1" w.g. for filters Size 4 and above) which appears in the DOE HEPA filter procurement standard⁽⁴⁾. Instead, WSRC chose to specify the limit of 1.3" w.g. which appears in the former Military Specification, MIL 51068F⁽¹⁴⁾ and the current specification (ASME AG-1 Code, Section FC)⁽¹⁵⁾.

24th DOE/NFC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The limit for resistance to airflow which appears in the DOE Standard was carefully considered and approved by consensus. Filter manufacturers were included in the Technical Review Committee which recommended that DOE adopt the standard. The DOE FTFs are directed to apply the DOE limit for resistance to airflow as a basis for HEPA filter acceptance/rejection. The operating contractor, when notified that the filters had been rejected, directed the testing FTF to place rejection labels on the shipping containers, but not on the individual filters (contrary to established policy), and to ship the 476 filters which had been rejected for high resistance to airflow to the contractor site. The request was complied with, under protest from the Oak Ridge FTF, the FTF Coordinator at Los Alamos, and the HEPA Filter Performance Assurance Program Manager at DP-45.

It should be noted that the filters in question are intended for use in the Defense Waste Processing Facility (DWPF), which is designed to process highly radioactive High Level Waste. It is suspected that the rejected filters have or will find their way into the safety class exhaust system(s) of the DWPF.

The statistically significant differences for the Size 5 (1000 cfm) filters, which were identified by the statistical analysis of the FY 1995 test data, did not appear to be traceable to one specific cause. A review of the test data produced the following information:

- Of 206 Size 5 filters supplied by Manufacturer # 3, 171 (83%) were rejected by Oak Ridge because of "Other" reasons. The gaskets did not meet specifications.
- Of 73 Size 5 filters supplied by Manufacturer # 7, six (8.2%) were rejected by Oak Ridge for "Other" reasons, in this case because of general deterioration due to long term storage, a situation not necessarily related to the manufacturing process.
- Of 24 Size 5 filters supplied by Manufacturer # 33, 12 were rejected by Oak Ridge because of "Other" reasons, related to splintering and rough edges of the plywood filter frames.
- The totals for these three batches are: 303 filters received with 189 (62.4%) rejected for "Other" reasons.

VIII. MULTI-YEAR TREND ANALYSIS

A statistical trend analysis of the consolidated Annual Report data for the five year period FY 1991-1995 (a slightly different time frame than that of this report) was performed. Data from these years were combined and then analyzed to identify statistically significant differences between FTFs and manufacturers for each filter size (Sizes 1-8. Following is a summary of the major conclusions from the Trends Analysis:

- There is a strong statistically significant difference among manufacturers for Size 1 (25 cfm) filters. This is caused primarily by the low acceptance rates for filters supplied by Manufacturer #3 (64%) and Manufacturer #4 (51%) by the Oak Ridge FTF. All three FTFs accepted Size 1 HEPA filters supplied by Manufacturer #1 at about the same rate (95-97%).
- There are statistically significant differences between among manufacturers and among FTFs for Size 3 (125 cfm) filters, caused primarily by the low acceptance rates for filters supplied by Manufacturer # 3 (59%) and # 19 (25%) at the Rocky Flats FTF. All three FTFs accepted Size 3 filters supplied by Manufacturer # 7 at about the same rate (98-99%).
- There is a statistically significant difference in acceptance rates for Size 5 (1000 cfm) filters, for the manufacturers and for the FTFs. The Oak Ridge FTF accepted a lesser percentage of filters supplied by Manufacturer #3 (92%) than the other two FTFs. The Oak Ridge FTF also tested far more filters from Manufacturer # 3 (1995) than the other two FTFs combined (253). Oak Ridge accepted a lower percentage of

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

filters from Manufacturer # 4 (85%) than did Rocky Flats (96%), however, in this instance, Oak Ridge tested only 26 filters from this manufacturer compared to 159 tested by Rocky Flats.

- The acceptance rate for Size 5 filters supplied by Manufacturer # 7 was fairly consistent among the FTFs, with Hanford accepting 99%, and Oak Ridge and Rocky Flats each accepting 95%. However, the 5% rejection rate for filters from Manufacturer # 7 at Oak Ridge and at Rocky Flats is significantly above the overall failure rate for HEPA filters (2.8%) noted during the period FY 1983 - FY 1991.

In order to further examine the history and trends of HEPA filters supplied to DOE in the recent past, Tables 11 - 13 were prepared to present the overall acceptance/rejection history for the three major suppliers of HEPA filters for the period FY 1992 - FY 1995. These three manufacturers supplied 94.9% of the filters tested in FY 1992, 91.5% of the filters tested in FY 1993, 92.3% of the filters tested in FY 1994, and 97% of the filters tested in FY 1995. Manufacturer # 7, with overall filter supply percentages ranging from 71% to 80.4%, is by far the major supplier. Manufacturer #3 supplied from 7.7% to 20% of the filters tested during the period covered by this report, and the third manufacturer, a combination of Manufacturers # 4 and # 33 (one bought the other during the report period), supplied from 2.7% to 3.9%.

Table 11
Overall FY 1992 - FY 1995 Acceptance/Rejection Rates for Manufacturer # 7

Fiscal Year	# Received	Number Accepted/%	Number Rejected/%
1992	4,995	4,860/97.3	135/2.7
1993	6,980	6,410/91.8	570/8.2
1994	3,752	3,616/96.4	136/3.6
1995	2,794	2,233/79.9	561/20.1
TOTALS	18,521	17,119/92.4	1402/7.6

Manufacturer # 7 is by far the largest supplier of HEPA filters to the DOE complex, and, in general, has had the best overall acceptance rate of the major filter suppliers. The 2.7% rejection rate for FY 1992 is similar to the "Reference Rate", and the rejection rate of 3.6% in FY 1994 is marginally (0.8%) higher. However the rejection rates for FY 1993 (8.2%) and FY 1995 (20.1%) further support the conclusion that the quality of HEPA filters supplied to DOE has diminished. In fairness to the manufacturer, it can be argued that the two lots of size 7 filters, in which 518 of 524 filters were rejected due to a disagreement over the applicable criterion for resistance to airflow, should be removed from the FY 1995 statistics, because rejection of these filters is not directly related to the manufacturing process. If this is done, then only 43 of the remaining 2270 filters (1.9%) were rejected. On the other hand, the manufacturers are well aware of the DOE specification for resistance to airflow, and know that the filters they provide do not meet the DOE specifications. It would appear that this issue should be resolved by further review of all the applicable filter performance specifications, leading to technical consensus, such that there is no longer a conflict among the applicable standards.

The decreasing numbers of Manufacturer # 7 filters tested at the DOE FTFs each year during the period covered by this report reflects the diminishing DOE market for HEPA filters.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 12
Overall FY 1992 - FY 1995 Acceptance/Rejection Rates for Manufacturer # 3

Fiscal Year	# Received	Number Accepted/%	Number Rejected/%
1992	663	574/86.6	89/13.4
1993	619	607/98.1	12/1.9
1994	937	718/76.6	219/23.4
1995	751	712/94.8	39/5.2
TOTALS	2,970	2,611/87.9	359/12.1

Manufacturer # 3 was the second largest supplier of HEPA filters to the DOE complex during the period FY 1992 - FY 1995. The acceptance rates for Manufacturer # 3 filters have been highly variable, and the overall rejection rate of 12.1% is more than four times the "Reference Rate". Of the 89 filters rejected in FY 1992, 84 were tested and rejected by Oak Ridge. Of the 84 filters rejected at Oak Ridge, 78 were rejected for high penetration. Seventy-three of these were from one lot of 140 25 cfm filters, which was discussed in the summary report section for the year FY 1992. Two hundred of the 219 Manufacturer # 3 filters which were rejected in FY 1994 constituted an entire batch which was rejected at Oak Ridge for "Other" reasons. This situation was earlier discussed in the summary report section for FY 1994. The test data for Manufacturer # 3 filters further support the conclusions that the quality of filters supplied to DOE during FY 1992 - FY 1995 has lessened, and that filter failures tend to occur in batches.

Table 13
Overall FY 1992 - FY 1995 Acceptance/Rejection Rates for Manufacturer # 4-33

Fiscal Year	# Received	Number Accepted/%	Number Rejected/%
1992	240	223/92.9	17/7.1
1993	298	251/84.2	47/15.8
1994	186	114/61.3	72/38.7
1995	103	71/68.9	32/31.1
TOTALS	827	659/79.7	168/20.3

Manufacturer # 4 became Manufacturer # 33 in 1993. This manufacturer combination accounts for the third highest total of filters supplied to DOE in the period FY 1992 - FY 1995. Individual records from the Semi-annual Reports were reviewed, and the combined totals were compiled and appear in Table 14. The combined test history for Manufacturer # 4-33 during the reporting period of FY 1992 - FY 1995 constitutes the highest rejection rate of the major suppliers. Review of the individual test reports again indicates batch, not random type failures, and further demonstrates the general lessening of HEPA filter quality.

IX. SUMMARY AND CONCLUSIONS

This combined Annual Report presents summary results of HEPA filter tests performed by the DOE Filter Test Facilities for the four year period FY 1992 - FY 1995. Test results for each year are discussed separately in specific sections (IV-VII) of the report, including a trend analysis. The test results for each fiscal year were analyzed in order to identify statistical differences, either among the FTFs by manufacturer and filter size, or by manufacturer. In Section VIII, a more general multi-year trend analysis for the four year period is presented.

The FTF program was instituted in the late 1960s and early 1970s when it became apparent that the HEPA filters supplied to the Department of Energy for installation in its nuclear facilities were not always of the high quality required to adequately protect workers, the environment, and the general public from the hazards associated with release of radioactive materials. The FTFs have been instrumental in identifying HEPA filters which do not meet required performance standards and preventing their installation in critical safety systems.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

IX. SUMMARY AND CONCLUSIONS

This combined Annual Report presents summary results of HEPA filter tests performed by the DOE Filter Test Facilities for the four year period FY 1992 - FY 1995. Test results for each year are discussed separately in specific sections (IV-VII) of the report, including a trend analysis. The test results for each fiscal year were analyzed in order to identify statistical differences, either among the FTFs by manufacturer and filter size, or by manufacturer. In Section VIII, a more general multi-year trend analysis for the four year period is presented.

The FTF program was instituted in the late 1960s and early 1970s when it became apparent that the HEPA filters supplied to the Department of Energy for installation in its nuclear facilities were not always of the high quality required to adequately protect workers, the environment, and the general public from the hazards associated with release of radioactive materials. The FTFs have been instrumental in identifying HEPA filters which do not meet required performance standards and preventing their installation in critical safety systems.

The changing nature of the Department of Energy's overall mission is apparent when the number of HEPA filters procured and tested is reviewed and compared to previous years. Review of the test records indicates a significant decline in the numbers of filters tested during the period addressed in this report. Prior to FY 1991, the numbers of HEPA filters tested each year were on the order of 10,000-14,000 filters. These numbers have declined steadily over the past four years, such that in FY 1995, only about 3,800 filters were tested. In FY 1995, one of the FTFs was closed, due to lack of filters to test. In FY 1996, there have been ongoing discussions concerning the future of the FTFs and the HEPA filter test program, and there have been recommendations to close one or both of the remaining FTFs.

The recent FTF test data verifies that the quality of the HEPA filters supplied to the DOE has diminished substantially. Review of the test data indicates that annual average rejection rates due to all causes, during the period FY 1992 - FY 1995 have increased from two to more than six fold. over the rejection rates observed during the period FY 1983 - FY 1991. Had there been no FTFs, the numbers of substandard filters installed in DOE's nuclear facilities could have increased significantly, leading to an increase in the probability that higher concentrations of radioactive materials could have been released to work stations, the on-site worker populations, or to the public and general environment.

References

1. DOE F 3-42, "Operating Policy of DOE Filter Test Programs" (1991).
2. DOE F 3-43, "Quality Assurance Testing of HEPA Filters" (1991).
3. DOE F 3-44, "DOE Filter Test Facilities Quality Program Plan" (1991).
4. DOE F 3-45, "Specifications for HEPA Filters Used by DOE Contractors" (1991).
5. Gilbert H., "The Filter Test Program, An Installation Manual, and Filter Research," published in the Proceedings of the 6th AEC Air Cleaning Conference, (July 7-9, 1959) United States Atomic Energy Commission Division of Technical Information, ed. TID 7593, October 1960, pp 161-181.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

6. Gilbert, H., and Hurwitz, G. J., "Filter Rating and Testing Program," published in the Proceedings of the 7th AEC Air Cleaning Conference, Brookhaven National Laboratory (October 10-12, 1961), United States Atomic Energy Commission Division of Technical Information, ed. TID-7627, pp 74-81.
7. Collins, J. T., Bellamy R. R., and Allen, J. R., "Evaluation of Data From HEPA Filter Quality Assurance Testing Stations," published in the Proceedings of the 15th DOE Nuclear Air Cleaning Conference, Boston, Massachusetts (August 7-10, 1978), M. W. First, ed., February, 1979, pp. 1159-1176.
8. Bresson, J. F., "DOE Filter Test Program-Policy for the '80s," published in the Proceedings of the 17th DOE Nuclear Air Cleaning Conference, Denver, Colorado (August 2-5, 1982), M. W. First, ed., February, 1983, pp 788-789.
9. Burchsted, C. A., "A Review of DOE Filter Test Facility Operations 1970-1980," published in the Proceedings of the 17th DOE Nuclear Air Cleaning Conference, Denver, Colorado, (August 2-5, 1982), M. W. First, ed., February 1983, pp. 775-787.
10. Bresson, J. F., "Department of Energy Filter Test Program Policy for the '80s," published in the proceedings of the 18th Nuclear Airborne Waste Management and Air Cleaning Conference, Baltimore, Maryland, (August 12-16, 1984) M. W. First, ed., March, 1985, pp. 1144-1148.
11. Bresson, J. F., "HEPA Filter Activities at the Department of Energy," published in the Proceedings of the 19th DOE/NRC Nuclear Air Cleaning Conference, Seattle, Washington, (August 18-21, 1986), M. W. First, ed., May 1987, pp. 852-862.
12. McIntyre, J. A., "Review of Department of Energy Filter Test Facility and Filter Test Facility Technical Support Group Activities FY 1986-1989," published in the Proceedings of the 21st DOE/NRC Nuclear Air Cleaning Conference, San Diego, California, (August 13-16, 1990), M. W. First, ed., February, 1991, pp. 385-393.
13. McIntyre, J. A., "Review of Department of Energy HEPA Filter Test Activities FY 1990-FY 1992," published in the Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference, Denver, Colorado, August 24-27, 1992, M. W. First, ed., March, 1993, pp 177-187.
14. MIL F 51068F "Military Specification, Filters, Particulate (High Efficiency, Fire Retardant)" April 1988.
15. American Society of Mechanical Engineers (ASME) AG-1 Code, Section FC, "HEPA Filters" December, 1995 [draft]).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

FRANKLIN: We sold a lot more filters to DOE facilities than were evidently tested. Is this a trend?

BRESSON: I think it has to do with whether they are procuring specification HEPA filters and the intended use. I hope that it is not a trend, but I suspect that procurement people at DOE sites are finding ways to get around testing of filters, and having to deal with rejected filters, the latter to avoid delays caused by replacing defective filters. There does not appear to be consistency any more among the DOE sites with respect to procurement activities. In addition, HEPA filters are often purchased for installation in non-nuclear facilities, and these filters do not have to be tested at a DOE FTF.

FRANKLIN: Some of our filters may have been rejected for not meeting specifications, but they met the user's purchase order. In those cases, we didn't even know they were rejected.

BRESSON: The records that I have reviewed indicate that when the filter test facilities perform their tests, they test all the filters the same way, regardless of whether they are specification filters or how they were procured. Consequently, the filter test data remain consistent.

FIRST: I listened to all your problems and now I am going to ask you the question that always gets asked at DOE, "What are the lessons learned here?"

BRESSON: I think the lesson that should have been learned is that air cleanup in nuclear facilities is a very important part of environmental and health protection activities at the sites. There is a move afoot, and I do not know how it is going to come out, within the Department of Energy, to do away with the DOE HEPA filter test facilities, and to rely instead on QA tests, QA inspections, manufacturers' data and in-place testing. To my mind, this would be a much different, less effective, and probably more expensive program than the current component assurance test program in which every filter is tested at the FTFs, and at a reasonable cost. I can not think of a better, more reliable QA program than the current test program, rather than one which relies on tests performed at the beginning of a QPL qualification cycle, followed by vendor inspections. One of the messages in my presentation is that, in recent years, the FTFs have rejected a higher percentage of HEPA filters, for all reasons. Given this fact, it makes little sense to me to back off on the quality test program.

SLAWSKI: I can add something to the discussion. We have a working group at DOE looking at this question explicitly. It looks like we will continue to test every filter. Where we will do it, we do not know at this time. We are considering other things. There are some people that are very emphatic that the QA/QC program should be placed exclusively on the manufacturers. We have considered that. I think we know how we are going to proceed on it but the decision has yet to be made.

GILLES: Over the past 4 years, what percentage of all the filters rejected were rejected due to flaws found visually?

BRESSON: Failures due to visual inspection are a part of the category called "Other" in the summary test data for the years FY 1992 - FY 1995. Failure reasons which are lumped together into the "Other" category include, but are not limited to, carrier damage, media damage, failure to comply with purchase specifications, dimensional problems, and improperly installed gaskets. With the exception of procurement specifications, some or all of these failure modes are detected by visual inspection. Note that

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 2 of my presentation shows that, for the years FY 1992 - FY 1995, filter failure rates due to "Other" category causes have ranged from about 1% to 8% per year, the average being nearly 5%. A cursory review of individual test records, which provide additional information on the causes for failures recorded in the "Other" category, leads me to conclude that the visual inspection process detects a high percentage of these failures, perhaps as high as 75-80% of them.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

IN-PLACE HEPA FILTER PENETRATION TEST*

by

W. Bergman, K. Wilson, J. Elliott, B. Bettencourt and J. W. Slawski¹
Lawrence Livermore National Laboratory
Livermore, CA 94550

Abstract

We have demonstrated the feasibility of conducting penetration tests on high efficiency particulate air (HEPA) filters as installed in nuclear ventilation systems. The in-place penetration test, which is designed to yield equivalent penetration measurements as the standard DOP efficiency test, is based on measuring the aerosol penetration of the filter installation as a function of particle size using a portable laser particle counter.⁽¹⁾ This in-place penetration test is compared to the current in-place leak test using light scattering photometers for single HEPA filter installations and for HEPA filter plenums using the shroud method. Test results show the in-place penetration test is more sensitive than the in-place leak test, has a similar operating procedure, but takes longer to conduct. Additional tests are required to confirm that the in-place penetration test yields identical results as the standard dioctyl phthalate (DOP) penetration test for HEPA filters with controlled leaks in the filter and gasket and duct by-pass leaks. Further development of the procedure is also required to reduce the test time before the in-place penetration test is practical.

I. Introduction

Before a HEPA filtration system can be used in a DOE nuclear facility, the ventilation system and the HEPA filters must pass acceptance tests described in ASME N510 or AG1, and the HEPA filter must pass the MIL-STD-282 penetration test.⁽¹⁻³⁾ The acceptance tests consist of leak tests of ducts and housings, airflow capacity and distribution tests, and air-aerosol mixing uniformity tests. The airflow distribution test is designed to insure that HEPA filters see a uniform air flow, while the air-aerosol mixing test is performed to insure that the concentration of aerosols challenging the filter is uniform. This will insure that representative samples can be obtained before and after the filter for computing the filter penetration.

¹ U.S. Department of Energy, Defense Programs(DP-45), Germantown, MD 20874

*This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under contract no. W-7405-ENG.45. The work was supported by DOE's Defense Program Office of Technical and Environmental Support, DP-45.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The HEPA filter penetration test is given in MIL-STD-282.⁽¹⁾ This test requires HEPA filters to have less than 0.03% penetration for 0.3 μm DOP aerosols as measured by a light scattering photometer. The 0.3 μm aerosols were originally selected because they were believed to be the most penetrating aerosols and would yield the most conservative penetration values for the HEPA filters. These aerosols were generated in a very large machine by a controlled condensation of DOP vapor and were thought to be monodisperse.

After the HEPA filter is installed in a certified ductwork, and once a year thereafter, the filter installation must be tested for leaks.⁽²⁻⁴⁾ This in-place leak test is performed to insure that the HEPA filter is properly installed and has not been damaged, that there are no leaks in the mounting frame or between the mounting frame and the housing, and that the system contains no bypassing that would reduce the system penetration. The in-place leak test is not a filter penetration test and can not be used in determining the penetration of HEPA filters. The difference between the two tests is the particle size and the type of aerosol generator used to challenge the filter: the DOP penetration test uses near monodisperse 0.3 μm particles generated by a very large vapor condensation generator, while the in-place test uses heterodisperse 0.7 μm particles generated by small portable air or thermal generators.⁽²⁻⁴⁾ ERDA 76-21 recommends an acceptance criterion of 0.03% maximum penetration for the in-place DOP test.⁽⁴⁾

The HEPA filter leak test was implemented in 1960 in the U.S. to verify that the installed filtration systems did not have leaks.⁽⁵⁾ This test represented a second-best choice at that time since it was not possible to conduct in-place penetration tests using the available test equipment. The problem was that the particle measuring instruments at that time could not distinguish between particle sizes, and monodisperse 0.3 μm aerosol generators were not portable. The available light scattering photometers were portable but could not distinguish between different particle sizes. To measure HEPA filter penetration at 0.3 μm diameter, it was necessary to have a monodisperse 0.3 μm diameter generator, which were not portable. The only portable aerosol generators at that time produced heterodisperse aerosols.

Now, a variety of instruments and aerosol generators are commercially available that can be used for measuring in-place filter penetration. Portable particle spectrometers are available that can measure specific particle sizes in heterodisperse aerosols. Portable aerosol generators are also available that can generate monodisperse aerosols. Thus it is now possible to measure in-place HEPA filter penetration at 0.3 μm using portable equipment consisting of either a particle size spectrometer and a heterodisperse aerosol generator or an integrated particle analyzer (e.g. photometer, condensation nuclei counter) and a monodisperse aerosol generator. We will only address the in-place penetration method using laser spectrometers and heterodisperse aerosols in this paper.

II. Difference Between Penetration, In-Place Leak, and In-Place Penetration Tests

The difference between the results of the penetration and the in-place leak tests can be illustrated with a typical HEPA filter penetration curve shown as a function of particle size in Figure 1. The penetration is a maximum at 0.15 μ m, decreases rapidly with increasing particle size and is negligible at 0.7 μ m for HEPA filters with no leaks. Although the penetration measurement at 0.3 μ m is significantly less than the maximum, it still provides a sensitive measurement of the filter penetration. In contrast to the in-tact HEPA filter installation in Figure 1, particle penetration through leaks is independent of particle size. Thus any penetration that is measured at 0.7 μ m diameter during the in-place leak test can be attributed to leaks.

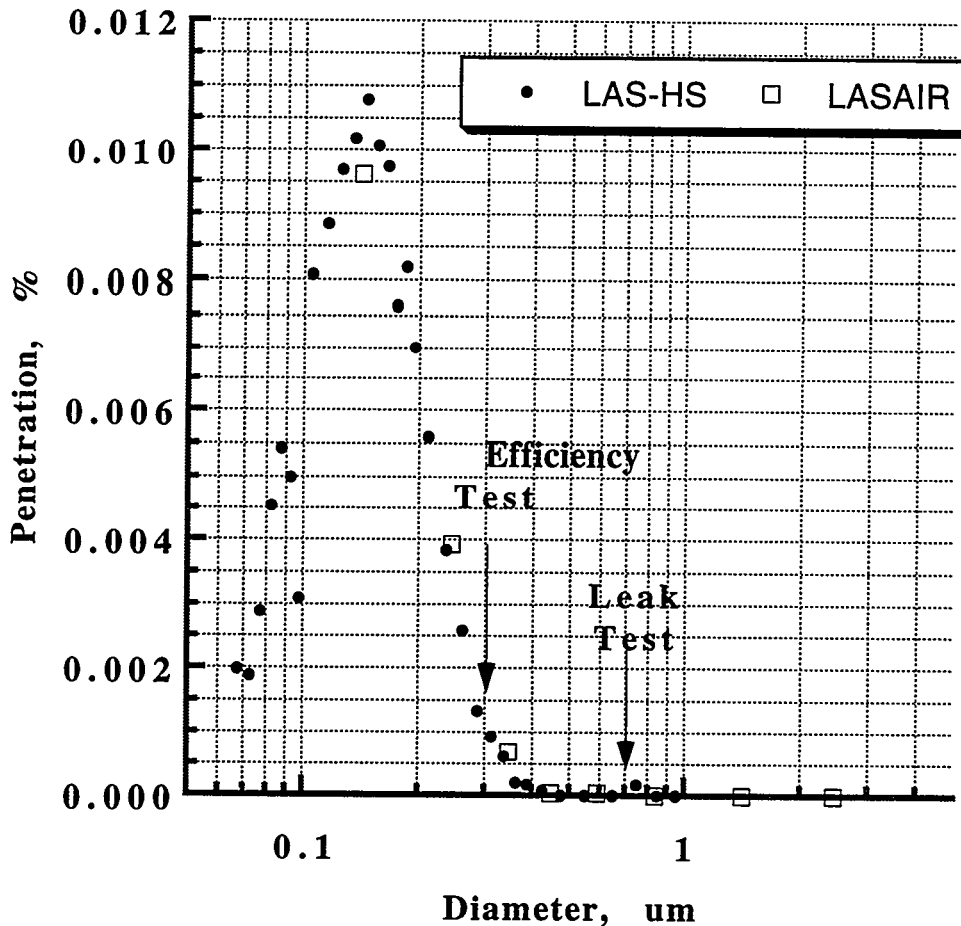


Figure 1. Plot of HEPA filter penetration measurements as a function of particle size for dioctyl sebacate (DOS) aerosols with two different laser spectrometers. Nuclear grade, 1,000 cfm HEPA filter.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Two different laser particle counters (Particle Measurement Systems, Bolder, CO) were used to generate the curve in Figure 1: the LAS-HS laser counter, which measures particles from 0.067 to 0.95 μm diameter and the LASAIR laser counter, which measures particles from 0.14 to 2.4 μm diameter. The diameter measurements are based on the logarithm midpoint of each of the counter channels. A 100:1 diluter (TSI, Minneapolis, MN) was used to dilute the upstream measurements to avoid coincidence counting. The dioctyl sebacate aerosols were generated with a Laskin nozzle aerosol generator (Virtis, Gardiner, NY). Details of the test procedure are described in previous reports.^(6,7) The agreement between the two instruments is good.

It is possible to conduct filter penetration tests as described in ASME N-510 and ASME AG-1 using a laser particle counter during in-place filter tests.^(2,3) If the laser counter is used for measuring the total number of particles without regard to particle size, then the filter test becomes another leak test. However, if the laser counter is used to discriminate between different particle sizes, such as 0.3 μm , then the laser test becomes an in-place penetration test. Using the laser particle counter also allows the maximum filter penetration, as shown in Figure 1, to be determined with the in-place penetration test. A description of the filter efficiency test using the laser particle counter is given by Bergman and Biermann and by Scripsick et al.⁽⁶⁻⁸⁾

The in-place penetration test using the laser particle counter is a measurement of the penetration of the total filtration system. This test incorporates the aerosol penetration from both the HEPA filter and leaks in the filter housing or gaskets. In separate filter penetration and leak tests, the total penetration of the filtration system is determined from the sum of the filter penetration and the leak penetration. In separate penetration and leak tests, once the filter is installed, it is only possible to determine system leaks with the light scattering photometer and assume the filter penetration remains the same. The in-place leak test using the light scattering photometer can only detect a major deterioration in filter penetration.

The increased sensitivity of the laser particle counter allows filter penetration measurements of two stages of HEPA filters for both the leak test and the penetration test. This capability, which is not possible for the standard photometer based leak test, is advantageous because of the reduced testing time and the difficulty in measuring the penetration of individual stages in systems having minimal space between stages. Schuster and Osetck were the first to use a laser particle counter to measure the filter penetration of one-stage and two-stage, size 1 HEPA filters.⁽⁹⁾ They found typical DOP penetrations of 0.003% for single stage and 0.000005% for two stage HEPA filters. However measurements of penetration versus particle size were only reported for the single stage HEPA filters.⁽⁹⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Ortiz determined the filter leaks in a number of 20,000 cfm two-stage HEPA filter systems.⁽¹⁰⁾ He did not discriminate between particle size, but rather used the total particle count before and after the filters to determine the system leaks. The test was therefore a leak test and not a penetration test. The leak measurements for ten systems varied from 0.0067% to 0.00000009%. The maximum allowable leakage for two stage HEPA filters is 0.000009%. This study was significant not only because the test system was demonstrated under field conditions, but also because it showed the laser particle counter detected filter system failures that were not seen with the standard single stage method described in ASME N510.⁽²⁾

Ortiz et al also conducted a round robin test of two-stage HEPA filtration system in which they measured filter penetration as a function of particle size using a laser spectrometer.⁽¹¹⁾ In this configuration, the filter test was an in-place penetration test. To avoid coincidence counting, the upstream concentration was diluted. The test apparatus and procedure were incorporated into an ASTM test method for evaluating HEPA filters.⁽¹²⁾

The Los Alamos National Laboratory (LANL) uses a laser spectrometer and heterodisperse aerosols as developed by Ortiz and incorporated in the ASTM standard for conducting in-place HEPA filter leak tests in all of their facilities.⁽¹⁰⁻¹³⁾ Since the particle measurements are made by adding all of the sizes into a single count, the LANL in-place filter measurements can not be used for determining filter penetration, but rather for leaks. Adding together the particle counts in the different particle size bins destroys the ability to measure filter penetration with heterodisperse aerosols. However, by keeping the particle counts in the different size bins separate, the LANL test procedure for leaks can be converted to a test of filter penetration test.

III. Correlation of In-Place Penetration Test With Standard Penetration Test

In order to claim that an in-place filter penetration test is equivalent to the standard HEPA filter penetration test at 0.3 μm , it is necessary to establish a correlation between the in-place penetration test with the standard penetration test specified in MIL-STD-282.⁽¹⁾ Such a correlation would include penetration measurements on HEPA filters with varying defects in the filter and the gasket as well as by-pass leaks in the ventilation ducting. These correlation tests have not yet been completed. However Scripsick et al conducted tests on 849 new HEPA filters using laser measurements at 0.31 μm and the standard Q-107 measurements at 0.3 μm .⁽⁸⁾ The correlation between the laser measurements at 0.31 μm and the Q-107 measurements at 0.3 μm is good, as shown in Figure 2.⁽⁸⁾ Note that the correlation becomes worse at smaller penetration values. This is not surprising considering the photometer in the Q-107 measurements is increasingly noisy below 0.01% penetration. We plan to conduct similar correlations using filters with controlled leaks in the media and gaskets and using controlled by-pass leaks in the ducting.

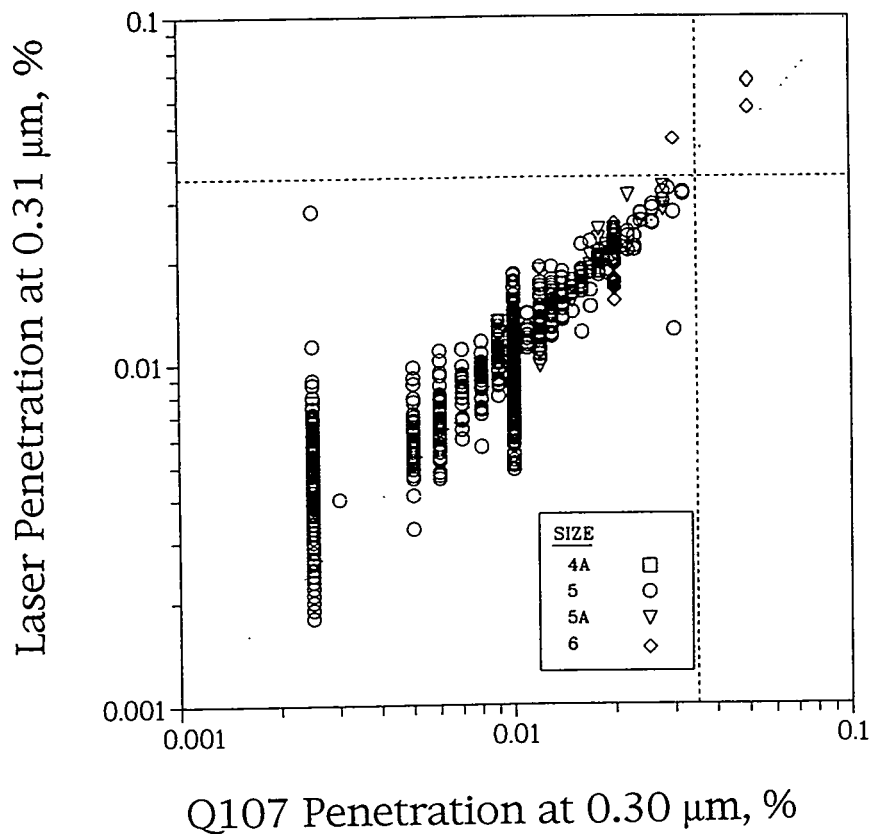


Figure 2. Correlation of HEPA filter penetration between laser spectrometer and Q107 photometer.⁽⁸⁾

For measurements of the maximum filter penetration, it is not necessary to conduct correlation tests with the Q107 tester because it only measures the penetration at 0.3 μm . The Q107 can not be used to determine the maximum filter penetration at 0.15 μm , as seen in Figure 1. In fact, there are no standard reference tests for the maximum filter penetration. The laser spectrometer can be used in a primary test standard for the maximum filter penetration if the particle size range is sufficient to clearly show a maximum as seen in Figure 1.

IV. Correlation of In-Place Penetration Test With Standard Leak Test

We have conducted a series of filter penetration tests on a HEPA filter with an increasing number of pin holes to establish a correlation between the in-place penetration test and the standard leak test. A nuclear grade, 1,000 cfm HEPA filter was used in these correlation tests. Two different laser spectrometers were used to

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

determine the in-place filter penetration as a function of size: the LAS-HS laser counter, which measures particles from 0.067 to 0.95 μm diameter and the LASAIR laser counter, which measures particles from 0.14 to 2.4 μm diameter. A 100:1 diluter (TSI, Minneapolis, MN) was used to dilute the upstream measurements to avoid coincidence counting. The dioctyl sebacate aerosols used in the in-place penetration tests were generated with a Laskin nozzle aerosol generator (Virtis, Gardiner, NY). Filter penetration was determined from the ratio of the downstream concentration divided by the upstream concentration after correcting for the upstream dilution and subtracting background aerosols. Figure 1 shows the penetration of the new HEPA filter as a function of particle size.

The standard leak test was conducted using a TDA-2GN light scattering photometer (ATI, Owings Mills, MD) to obtain aerosol measurements before and after the HEPA filter. A TDA-5B aerosol generator (ATI, Owings Mills, MD) was used to generate the alpha-olefin (Emery 3004) aerosols for the in-place leak tests. Filter leak measurements were made by electronically setting the photometer upstream concentration to 100% and reading the downstream concentration directly. The in-place leak test yielded a leak of 0.01% for the test shown in Figure 1.

Following the initial test on the new HEPA filter, we made a single pinhole in the filter medium using a 0.025 inch diameter needle and repeated the in-place penetration and in-place leak tests. Additional pin holes were then made in the filter, and the filter was retested each time for penetration and leakage. The test results for the in-place penetration measurements are shown in Figure 3 for the filter having 0, 1, 2, and 6 pin holes and in Figure 4 for the filter having 9, 13, 19, 27, and 40 pin holes. The photometer measurements for each of the filter tests are shown in Table 1 along with the designated number of pinholes. Table 1 also shows the filter pressure drop and the penetration measured at 0.15, 0.3, and 0.7 μm diameter. Note that the pressure drop is not affected by the pin holes, whereas the laser penetration and photometer leaks show large increases with increasing number of pin holes.

The agreement between the HS-LAS and the LASAIR laser counters is very good over the overlapping size range as seen in Figures 3 and 4. The HS-LAS and LASAIR data are indicated by the open and closed data points, respectively. Both laser counters also yield the same value at the maximum filter penetration. However, the maximum penetration for the LASAIR occurs in the first size channel (0.1-0.2 μm), which will not allow verification of maximum penetration when the LASAIR instrument is used alone. This is not a serious problem since the maximum penetration occurs at 0.15 μm diameter for filters with and without pin holes. The preferred laser counter should have several measurements between 0.1 and 0.2 μm to verify that the maximum filter penetration is bracketed.

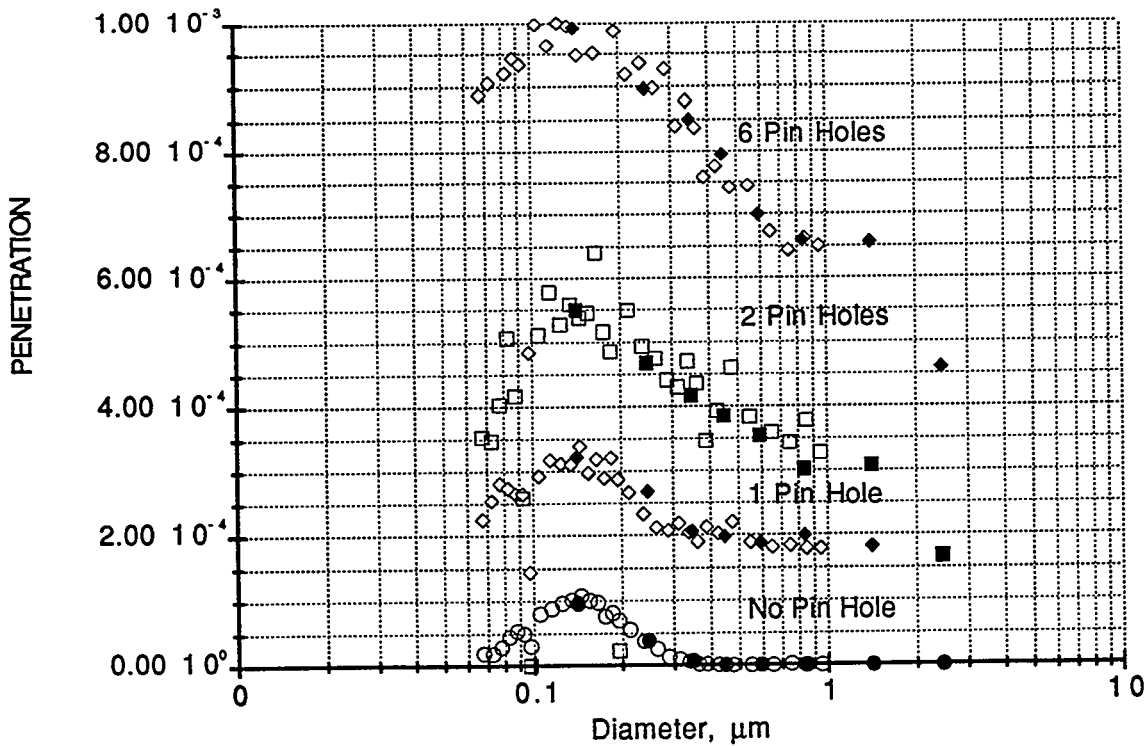


Figure 3. Penetration of DOS aerosols as a function of aerosol diameter for the same HEPA filter having 0, 1, 2, and 6 pin holes produced with a 0.025 inch needle. HS-LAS, open points, LASAIR, closed points.

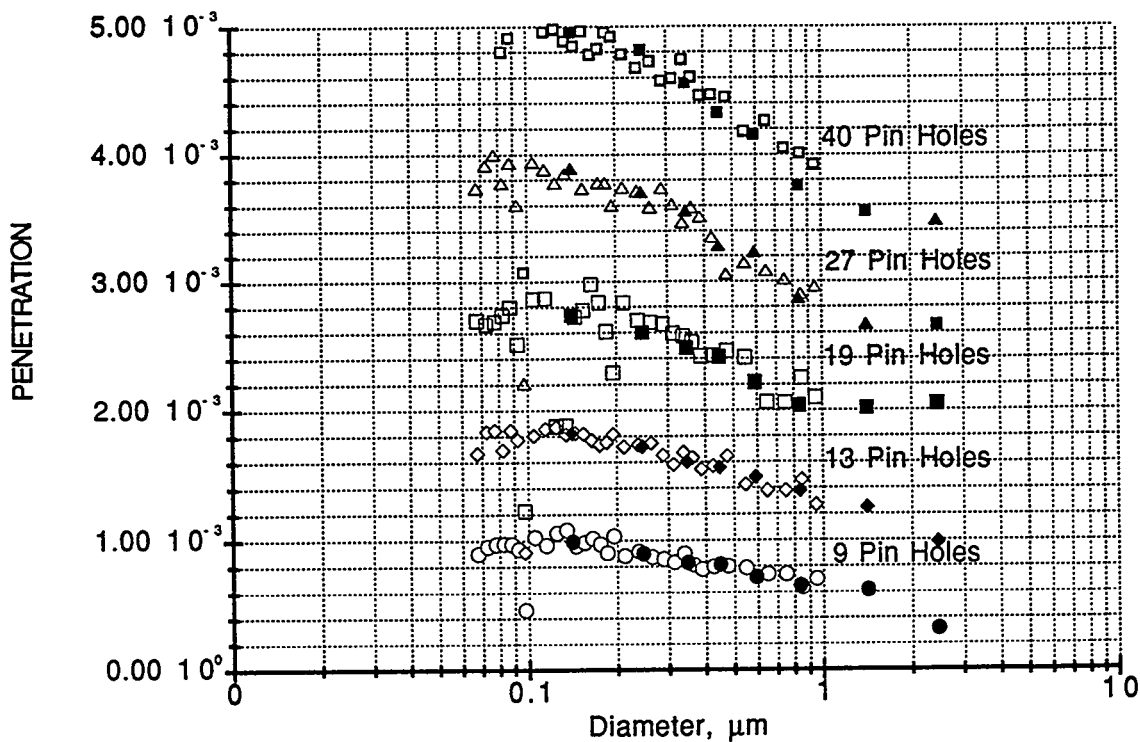


Figure 4. Penetration of DOS aerosols as a function of aerosol diameter for the same HEPA filter having 9, 13, 19, 27, and 40 pin holes produced with a 0.025 inch needle. HS-LAS, open points, LASAIR, closed points.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 1. Penetration and leak measurements on a HEPA filter with varying pin holes .

Pin Holes	ΔP , inches	Laser Penetration at Diameter			Photometer Leak
		0.15 μm	0.3 μm	0.7 μm	
0	1.06	1.5×10^{-4}	1.0×10^{-5}	1.0×10^{-6}	1×10^{-4}
1	1.06	3.2×10^{-4}	2.2×10^{-4}	1.8×10^{-4}	2×10^{-4}
2	1.06	5.8×10^{-4}	4.5×10^{-4}	3.5×10^{-4}	2×10^{-4}
6	1.06	1.00×10^{-3}	8.8×10^{-4}	6.5×10^{-4}	8×10^{-4}
9	1.07	1.03×10^{-3}	8.8×10^{-4}	7.5×10^{-4}	9×10^{-4}
13	1.07	1.85×10^{-3}	1.65×10^{-3}	1.40×10^{-3}	1.1×10^{-3}
19	1.06	2.9×10^{-3}	2.6×10^{-3}	2.3×10^{-3}	1.2×10^{-3}
27	1.06	3.8×10^{-3}	3.6×10^{-3}	3.0×10^{-3}	1.3×10^{-3}
40	1.06	4.9×10^{-3}	4.6×10^{-3}	4.1×10^{-3}	1.7×10^{-3}

We have plotted the three different penetration measurements versus the photometer measurements from Table 1 in Figure 5 to examine the correlation between the various measurements.

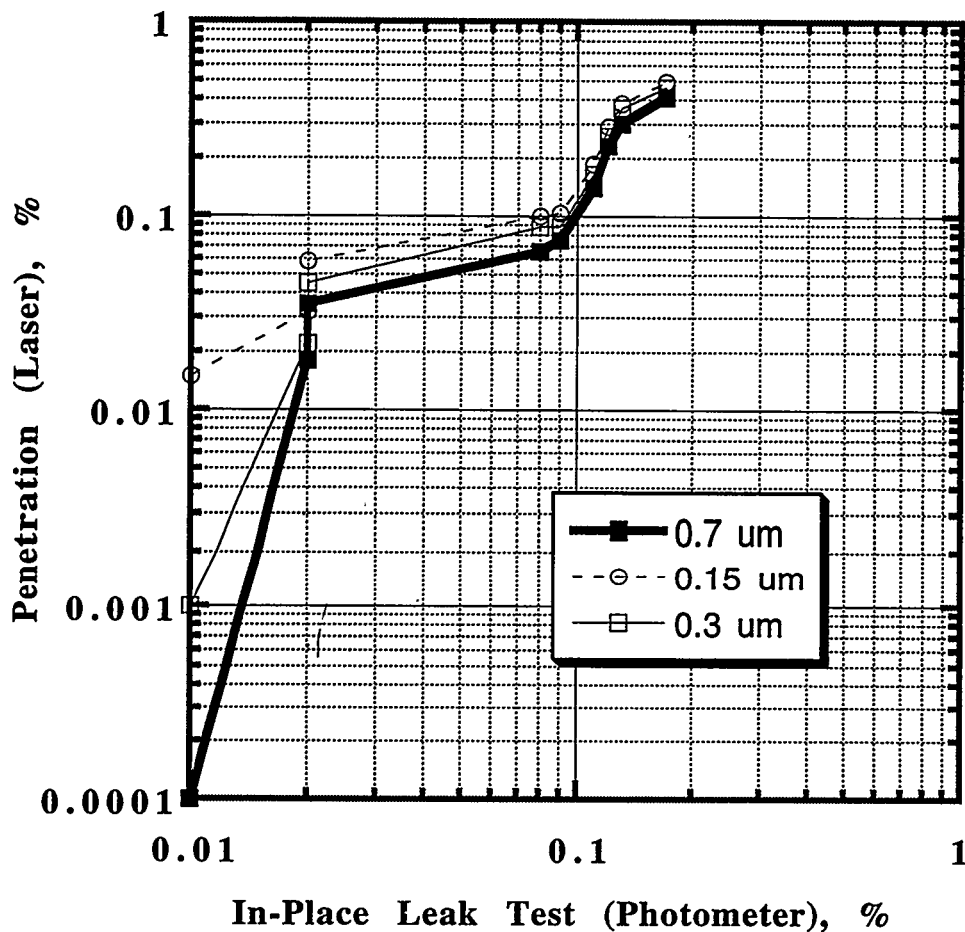


Figure 5. Correlation of laser penetration test with in-place leak test.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In general, there is poor correlation between the photometer leak and the laser penetration measurements, even for the $0.7\mu\text{m}$ data, which is supposed to represent the average size of the test aerosol in the photometer test. One of the reasons for the poor correlation is the lack of sensitivity of the photometer for penetration measurements less than 0.01%. However, the major reason for the poor correlation between the photometer leak and the laser penetration measurements is due to the fundamental difference between differential and integrated size measurements with heterodisperse aerosols. Bergman and Biermann have shown that large variations in the photometer measurements are possible compared to laser or condensation nuclei counters depending on the degree of aerosol heterodispersion and the extent of filter leaks.^(7,14) Figure 5 also shows that the photometer measurements, although still not satisfactory, correlate better with the maximum penetration measurements at $0.15\mu\text{m}$ than with the measurements at 0.3 or $0.7\mu\text{m}$. The lack of correlation between the in-place penetration test and the in-place leak test illustrates that the present leak test provides only an approximate measure of the system penetration.

V. Field Evaluation of In-Place Penetration and In-Place Leak Tests

We have conducted in-place penetration and leak tests on two typical HEPA filter installations at LLNL, a single HEPA filter system and a two-stage HEPA filter plenum, to evaluate the practicality of the in-place penetration test. The single HEPA filter system located on the roof of a LLNL building is shown in Figure 6 with the HS-LAS laser counter on the HEPA filter, the LASAIR laser counter on the blower, and the TSI aerosol diluter on the floor. The Laskin nozzle aerosol generator, not shown, was placed inside a ventilation hood in one of the building laboratories. After several in-place penetration tests were completed, the standard in-place leak test was performed using a TDA-2GN aerosol photometer (ATI, Owens Mills, MD) and a TDA-4A aerosol generator (ATI, Owens Mills, MD) with Emery 3004. The in-place leak test indicated the HEPA filter system had 0.006% leakage.

Several in-place penetration tests were conducted on the single HEPA filter system to determine the effect of challenge concentration and the repeatability of the test results. The challenge concentration is an important factor in the in-place penetration test because it affects the accuracy of the data and the duration of the test. Higher aerosol concentrations result in shorter and more precise tests but also result in instrument error due to coincidence counting. Counting errors due to coincidence occur at higher concentrations when two or more particles are counted as a single particle. Since filter penetration measurements involve two measurements at significantly different concentrations, one upstream and one downstream of the filter, separate optimizations are required for each measurement. In theory, the challenge concentration is adjusted so the downstream concentration after the filter is just below coincidence counting. The upstream concentration then has to be diluted to avoid coincidence counting. However, since the commercially available diluters have a fixed dilution ratio; e.g. 100:1 for one stage dilution, 10,000:1 for two stages of dilution; the challenge

concentration must be adjusted to avoid coincidence in both the upstream (challenge) and downstream measurements.

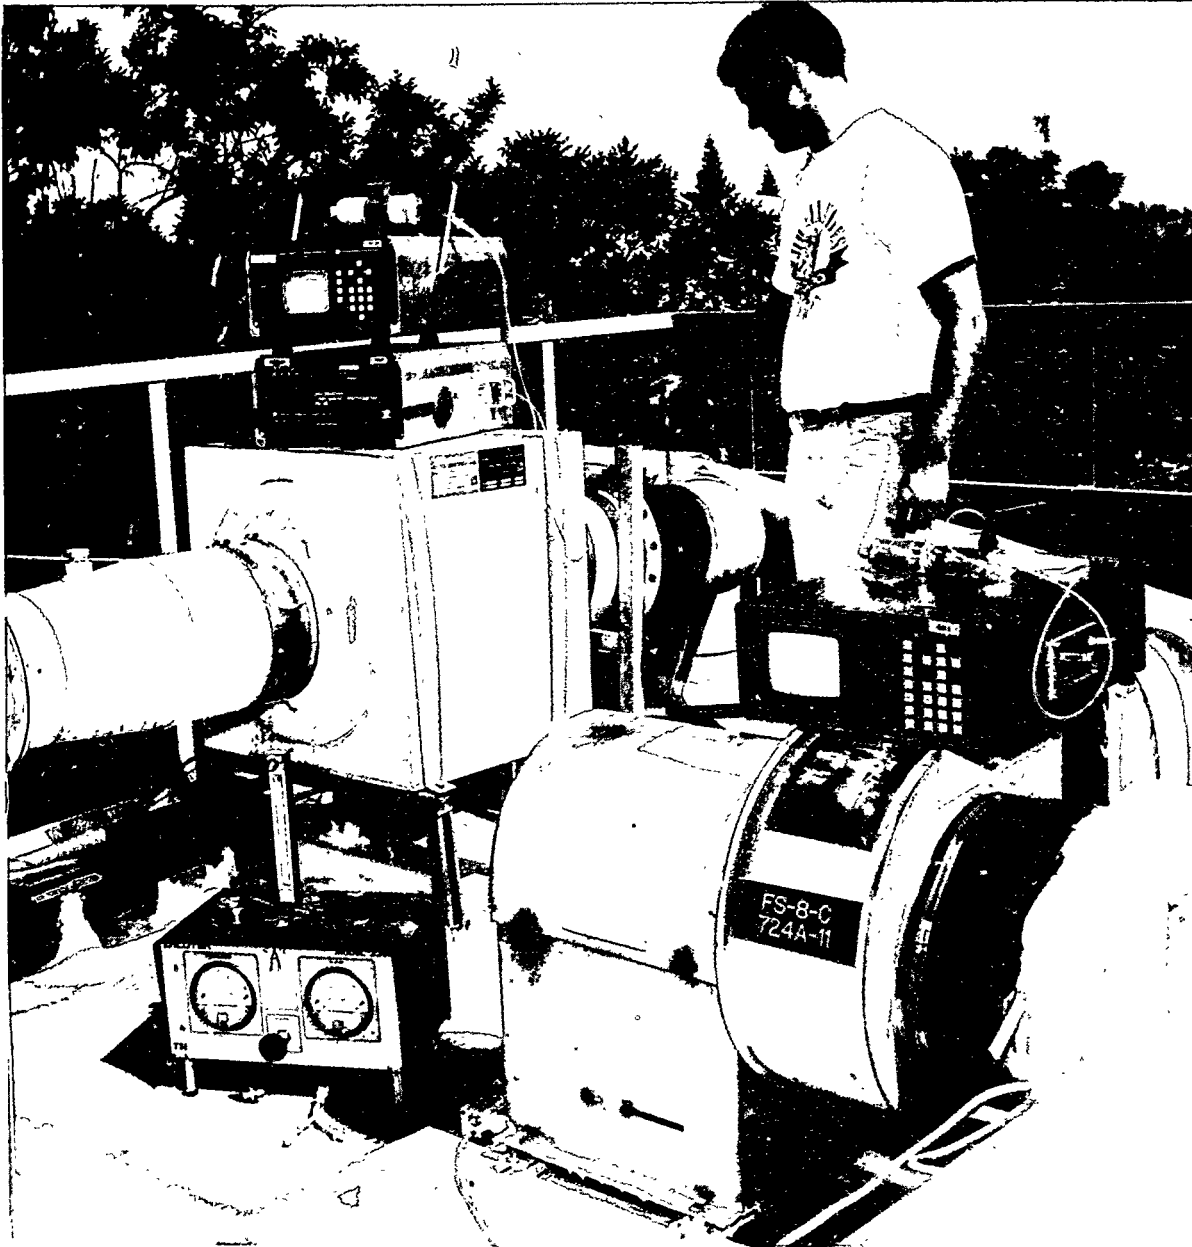


Figure 6. Photograph of the in-place penetration test apparatus on a single HEPA filter system using laser counters. The HS-LAS laser counter is on the HEPA filter, the LASAIR laser counter on the blower, and the TSI aerosol diluter on the floor.

The available dilution ratios did not allow for optimization of the concentration measurements as shown with the following illustration. Figure 7 shows the filter penetration curve derived from measurements using a 100:1 dilution of the upstream (challenge) aerosols for a single HEPA filter system which is similar to the system shown in Figure 6. The filter penetration curve is

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

extremely noisy, even with a 1 minute upstream and a 15 minute downstream sample, because the low downstream aerosol concentration is at the background level. This resulted from reducing the challenge concentration to avoid coincidence counting. Increasing the sampling time did not help in this case because the measurement of background aerosols also increased. Using a 10,000:1 diluter on the upstream sample significantly improved the precision of the data and also reduced the sampling time as seen in Figure 8. The upstream and downstream sample times for that test were 2 and 6 minutes, respectively. An optimized diluter between 1,000:1 and 2,000:1 would reduce the sample time to about 1 minute for each measurement. The optimized diluter and associated calibration procedure must be developed before the in-place penetration method is adopted for routine measurements.

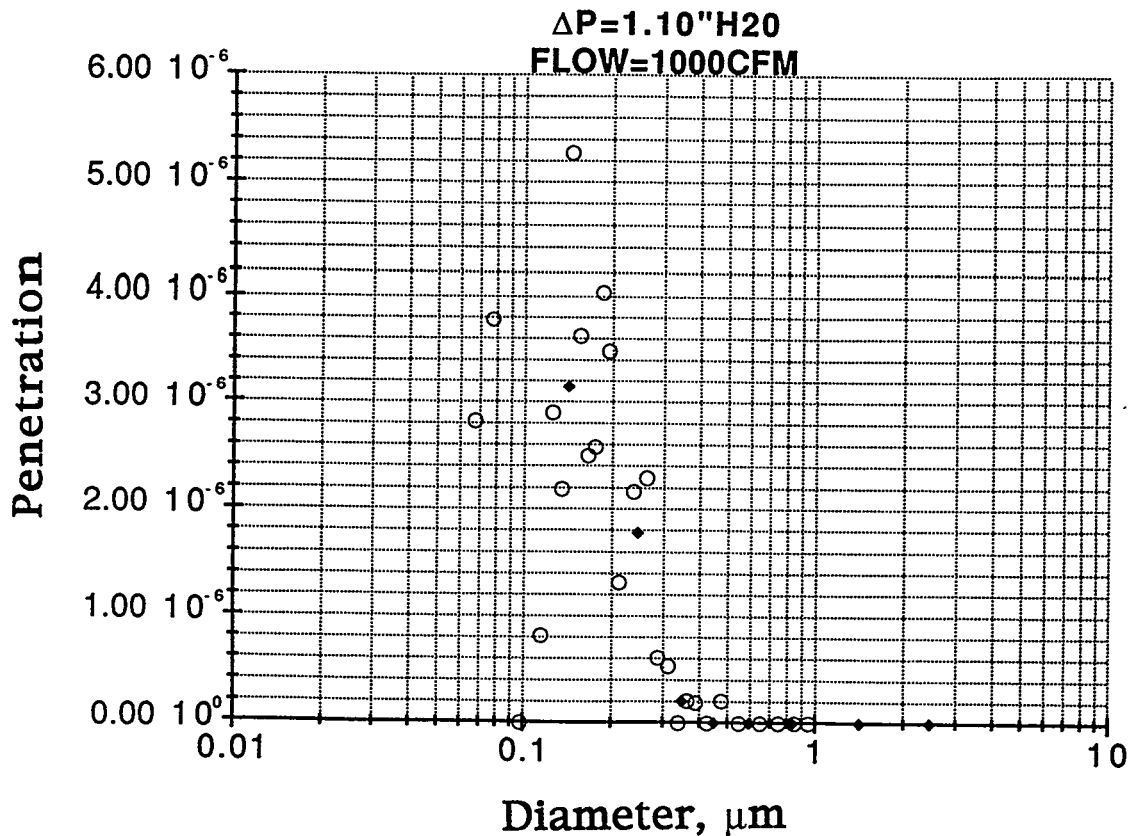


Figure 7. Filter penetration as a function of aerosol diameter for a single HEPA filter system using the in-place penetration measurement with a 100:1 diluter. Open data was generated with HS-LAS, closed data with LASAIR. In-place leak test with a photometer was 6×10^{-5} .

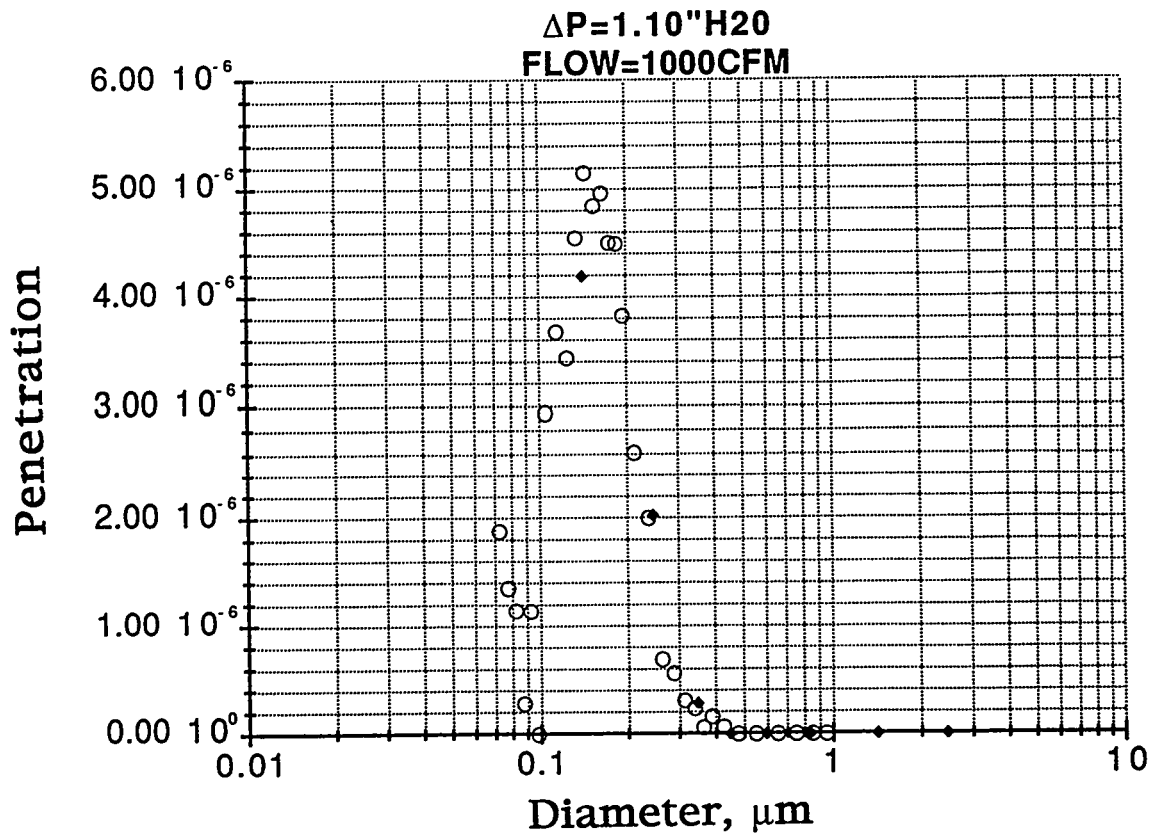


Figure 8. Filter penetration as a function of aerosol diameter for a single HEPA filter system using the in-place penetration measurement with a 1,000:1 diluter. Open data was generated with HS-LAS, closed data with LASAIR. In-place leak test with a photometer was 6×10^{-5} .

A detailed comparison of the time requirements for the in-place leak and the in-place penetration test is given in Table 2. The increased time to carry the penetration equipment was due to the additional laser counter, the diluter and pumps and miscellaneous items. After the in-place penetration equipment and procedure is finalized, the time for carrying the equipment will be the same for both in-place tests. The much longer test time for the penetration test can be reduced to be comparable to the leak test once the optimum diluter is developed.

Table 2. Comparison of time requirements for in-place leak and in-place penetration measurements on a single HEPA filter installation.

Task	Leak Test	Penetration Test
Carry equipment to roof	2 min.	10 min.
Set up equipment	2 min.	3 min.
Set up generator	8 min.	8 min.
Test filter	2 min.	12 min.
Total	14 min.	33 min.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We repeated the in-place penetration test two additional times to assess the repeatability of the test. Figure 9 shows the three in-place penetration tests on the single HEPA filter installation are very repeatable.


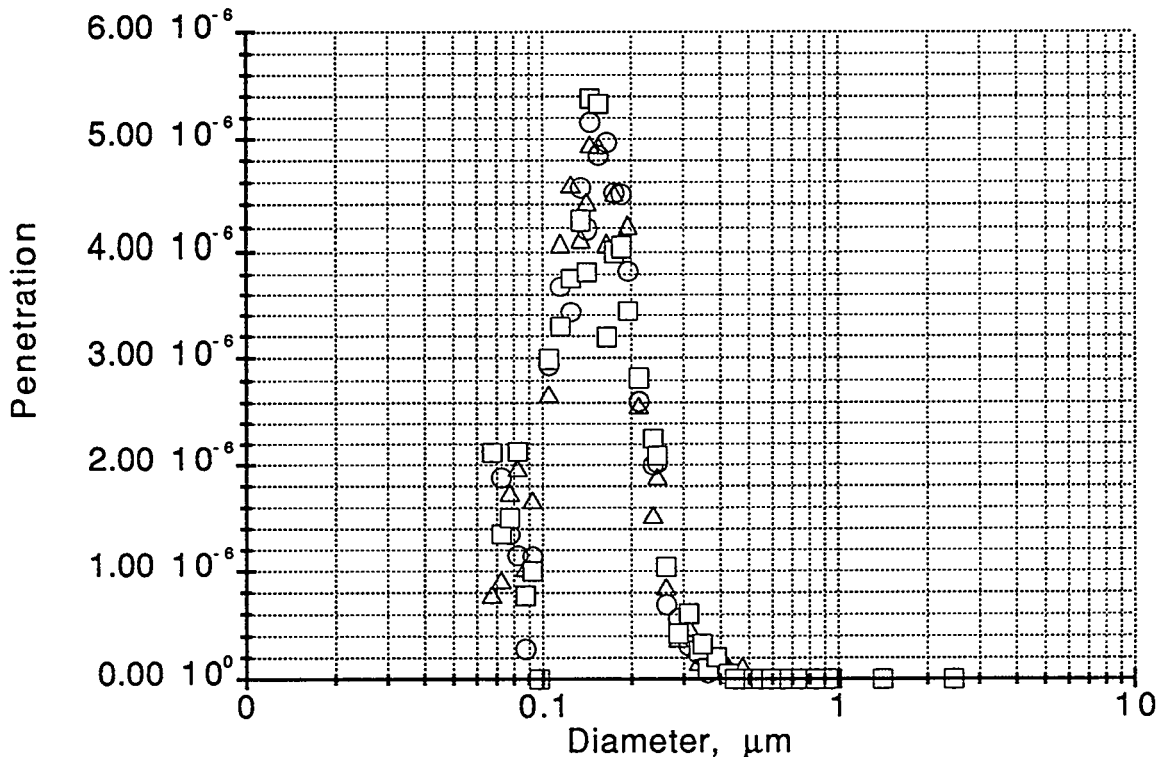


Figure 9. Measurements of the filter penetration obtained with the in-place penetration test apparatus shown in Figure 6 repeated three times.

The second field evaluation of the in-place penetration measurement was in a two-stage HEPA filter plenum using the shroud sampling method. The shroud sampling method allows individual HEPA filters to be leak tested independent of the other HEPA filters in a filter bank. This is done by placing shrouds on the upstream and the downstream side of individual HEPA filters to effectively isolate the HEPA filter from all others in the filter bank. Each shroud is a sheet metal duct that is held against the HEPA filter or frame on one end and has a reduced 1' x 1' section on the other end. The upstream shroud is used for injecting aerosols, and the downstream shroud is used for sampling the downstream aerosols. Figure 10 shows the front (A) and rear (B) sides of the upstream shroud, that is used to expose a HEPA filter to a uniform aerosol concentration. Figure 10 B shows the rear side of the upstream shroud with the 9 point aerosol injection manifold. The aerosols are then mixed by a baffle plate seen in Figure 10 A and B and further dispersed by a screen seen in Figure 10 B. The upstream shroud also has a sample

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

port for sampling the challenge concentration. The downstream shroud, shown in Figure 11, has a 9 point sampling manifold and no internal mixing devices. The filter leak or penetration is obtained by simultaneously placing the upstream and downstream shrouds against the HEPA filter or frame as shown in Figures 12 and 13 respectively.

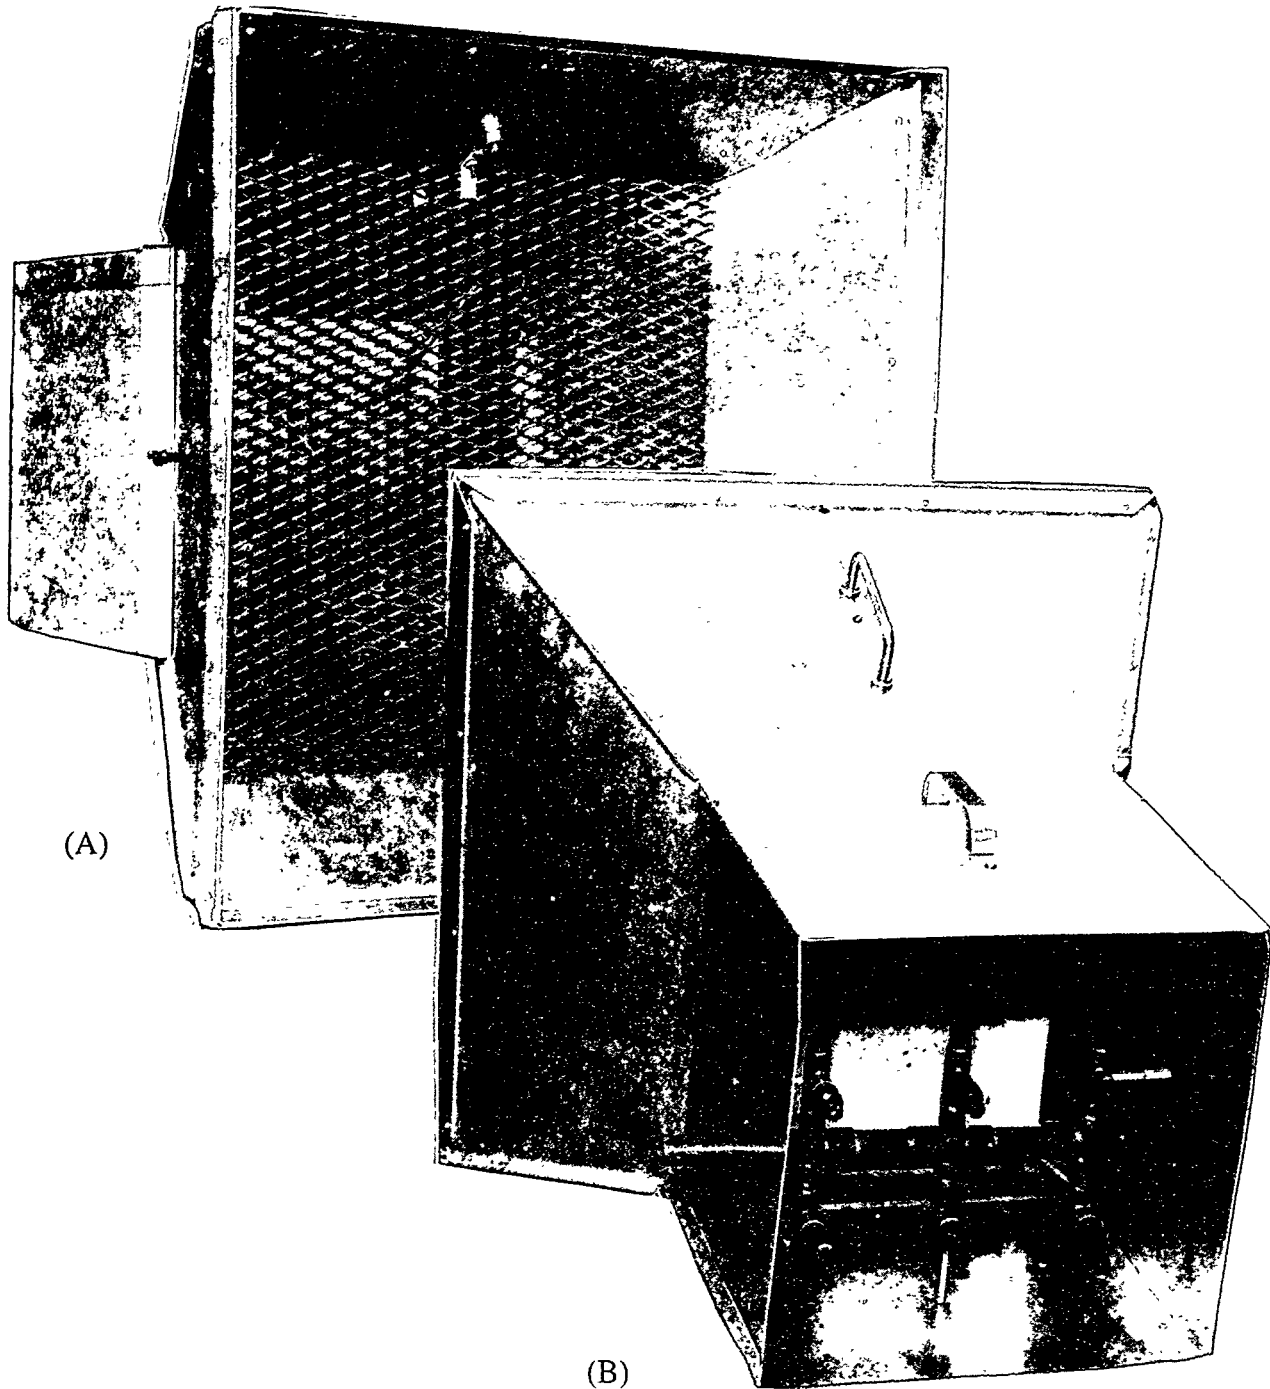

10. Upstream shroud for exposing individual HEPA filters in a filter plenum to challenge aerosols. (A) shows the front side, (B) shows the rear side.

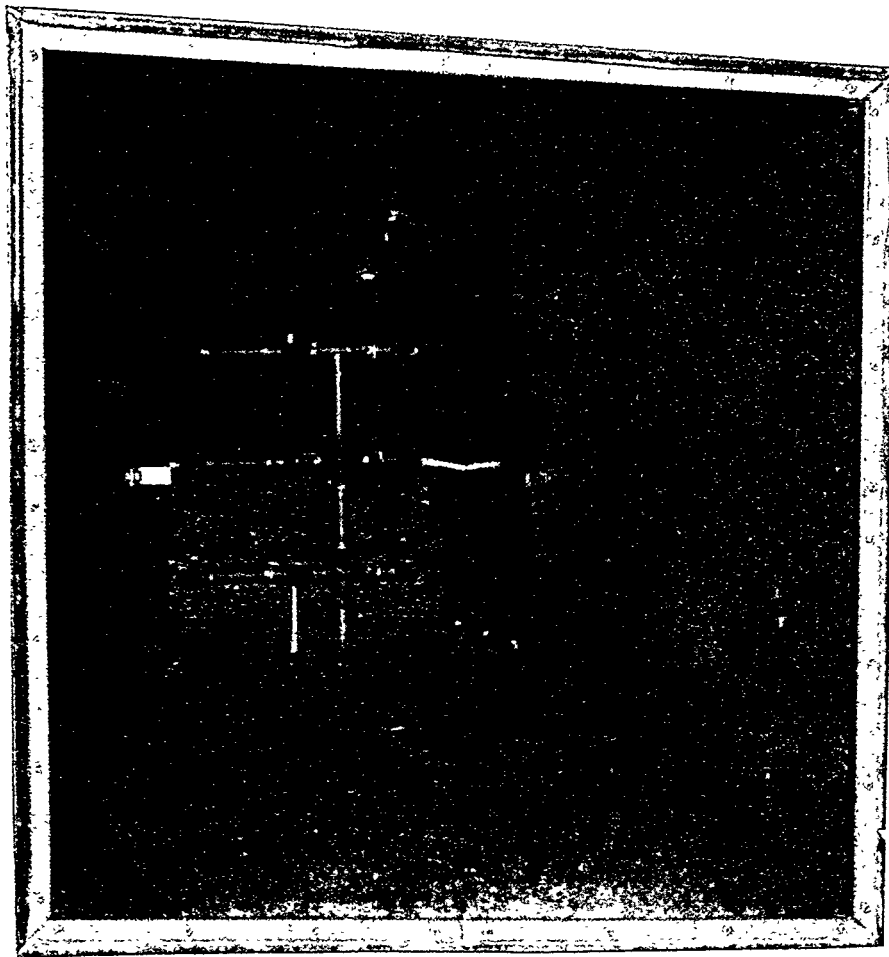


Figure 11. Downstream shroud for sampling filter penetration or leak. Nine point sampling manifold is seen from the inlet side facing the HEPA filter.

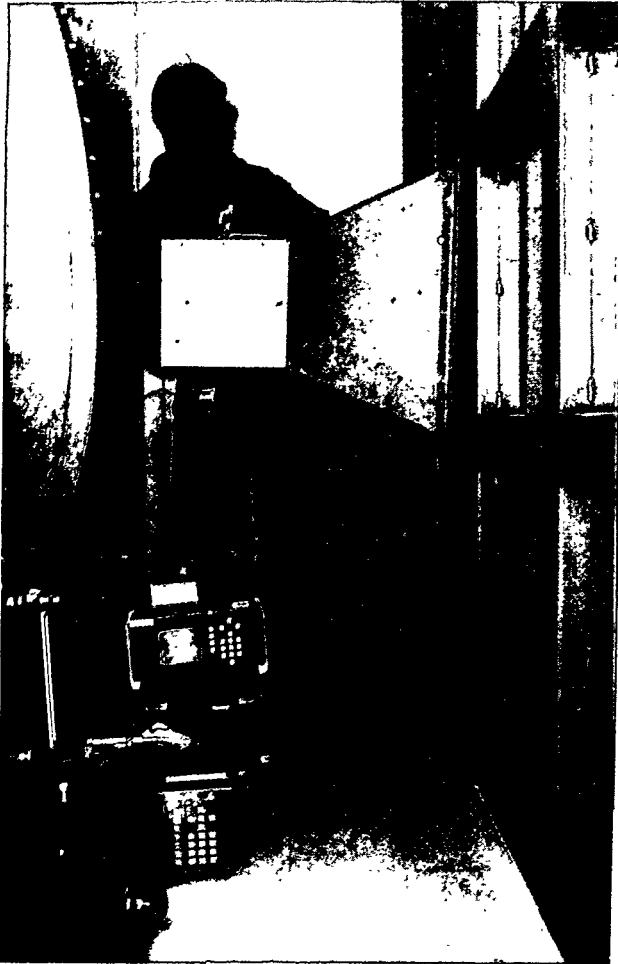


Figure 12. Downstream shroud for sampling aerosol penetration from individual filter. In-place penetration equipment used in this test.

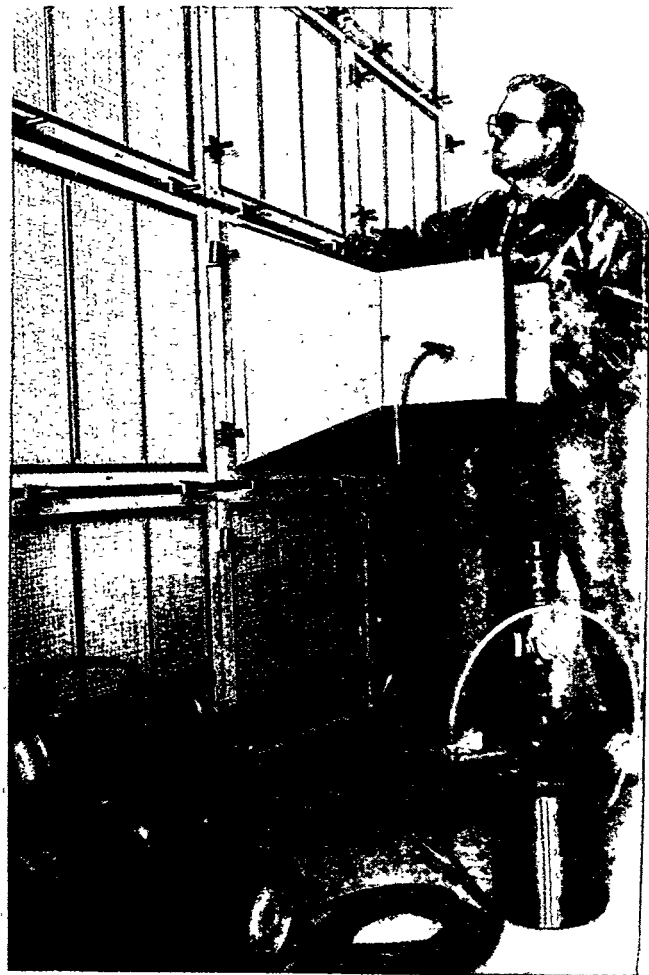


Figure 13. Upstream shroud for generating challenge aerosols. Laskin nozzle aerosol generator used in this test.

The result of the in-place penetration measurement on one filter in the plenum is shown in Figure 14. We were unable to generate the required high concentration of challenge aerosols to use the 10,000:1 diluter because the compressor shown in Figure 13 could not supply sufficient pressure to the Laskin nozzle aerosol generator. As a result, we used the 100:1 diluter with a lower aerosol concentration. This resulted in lower precision and a longer sampling time than would be required with a higher aerosol concentration and a 10,000:1 diluter. The upstream and downstream sample times were 2 and 8 minutes, respectively. The equipment used for the in-place penetration measurement using the shroud method was the same as previously described for the single filter test.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Since the shroud method only measures the penetration or leaks through the filter, and not around gasket leaks, a separate leak test is performed on each filter. This is done by directing a concentrated aerosol challenge around the perimeter of the upstream side of the filter using a long tube. Another person samples the perimeter of the downstream side of the filter using a long probe that is moved in synchronization with the upstream challenge tube. If the downstream leak is greater than 0.03% of the upstream concentration, then the filter is replaced. This traverse leak test is far more conservative than the leak or penetration measurement through the filter because no significant air volume passes through the leak compared to that flowing through the filter. Since the air flow through a gasket leak path is not known, the traverse leak test is not quantitative, but rather a qualitative test. When using the laser counter in this leak test, the counter output is set to the concentration mode and not the count mode.

The conventional in-place leak test indicated the filter in Figure 14 had a leak of 2×10^{-4} . We used a TDA-2EN photometer and a TDA-5B aerosol generator, both from ATI, for the in-place leak test. The test aerosol for the in-place leak test was Emery 3004.

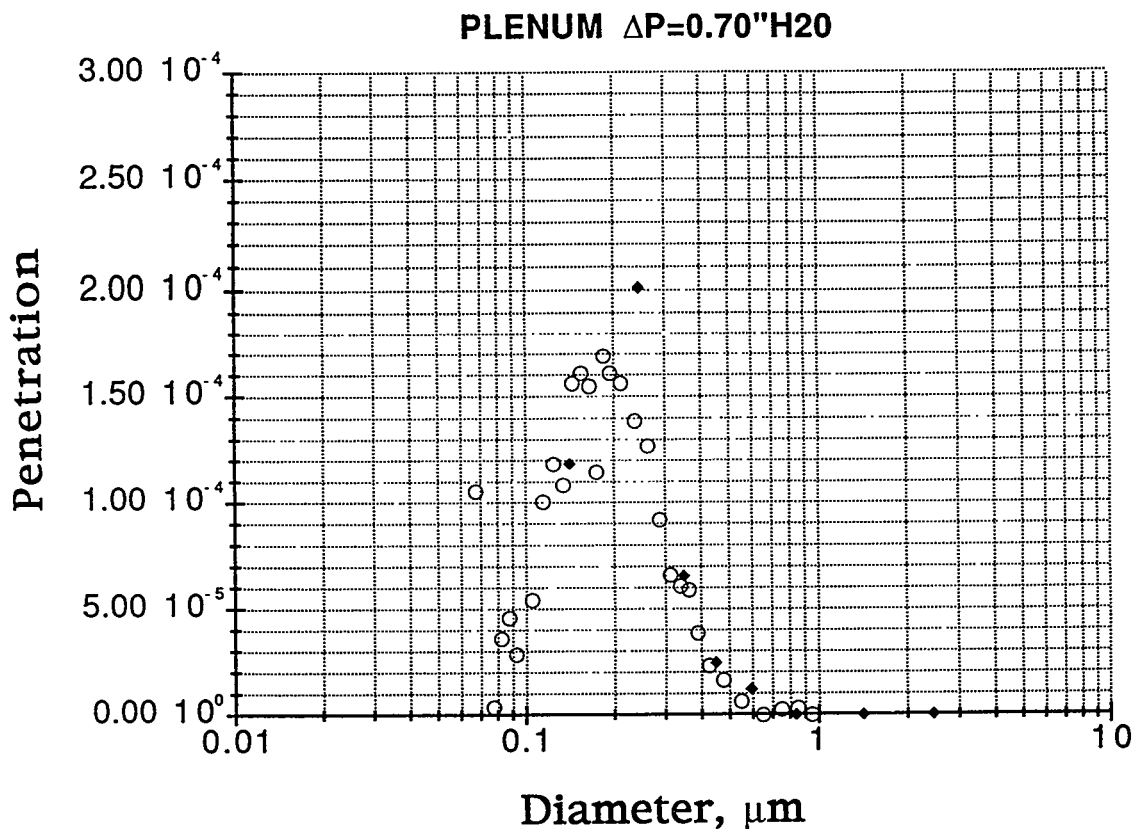


Figure 14. In-place penetration measurement of a HEPA filter in a plenum using the shroud sampling method. Open data obtained with HS-LAS, closed data with LASAIR.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We performed a detailed analysis of the time requirement for the in-place leak and the penetration test using the shroud method and tabulated the results in Table 3. The time requirements for all of the tasks except for the downstream measurements are comparable for the two in-place tests. As noted before, the long downstream sampling times were primarily due to the inability to generate a sufficient concentration. We anticipate that the in-place penetration measurement would not require much more time than the in-place leak test once the experimental test system is optimized.

Table 3. Comparison of time requirements for in-place leak and in-place penetration measurements on a HEPA filter bank using the shroud method.

Task	Leak Test	Penetration Test
Equipment set up	10 min.	15 min.
Equipment warm up	10 min.	10 min.
Upstream meas./filter	(5 min.)	(4 min.)
Upstream bank (16 filters)	80 min.	64 min.
Downstream meas./filter	(0.3 min.)	(10 min.)
Downstream bank(16 filters)	5 min.	160 min.
Tear down	30 min.	30 min.
Total	135 min.	279 min.

VI. Conclusions

We have demonstrated the feasibility of conducting in-place penetration tests on high efficiency particulate air (HEPA) filters as installed in nuclear ventilation systems. The in-place penetration test, which is designed to yield equivalent penetration measurements as the standard DOP penetraton test, is based on measuring the aerosol penetration of the filter installation as a function of particle size using a portable laser particle counter.⁽¹⁾ Additional tests are required to confirm that the in-place penetration test yields identical results as the standard DOP penetration test for HEPA filters with controlled leaks in the filter and gasket and duct by-pass leaks. Further development of the procedure is also required to reduce the test time before the in-place penetration test is practical.

VII. Acknowledgments

We gratefully acknowledge the assistance Mr. Wayne Krause and Mr. Donald Beason in the shroud tests.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

VII. References

1. MIL-STD-282 Filter Units, Protective Clothing, Gas-Mask Components and Related Products: Performance-Test Methods, Method 105.9, Military Standard MIL-STD-282, Commanding Officer, Frankford Arsenal, Navy Department, ATTN: SMUFA-N1100, Philadelphia, PA, 19137, (1974)
2. American Society of Mechanical Engineers, "Testing of Nuclear Air Treatment Systems", ASME Standard N510-1989, The American Society of Mechanical Engineers, 345 47th Street, New York, N.Y. 10017, (1989)
3. American Society of Mechanical Engineers, Code on Nuclear Air and Gas Treatment, ASME AG1-1994, The American Society of Mechanical Engineers, 345 47th Street, New York, N.Y. 10017, (1989)
4. Burchsted, CA, Kahn, JE, and Fuller, AB, "Nuclear Air Cleaning Handbook", ERDA 76-21, National Technical Information Service, 5285 Fort Royal Rd, Springfield, VA 22161, (1976).
5. Parrish, EC and Schneider, RW, "Review of inspection and testing of installed high-efficiency particulate air filters at ORNL", in Treatment of Airborne Radioactive Wastes, International Atomic Energy Agency, Vienna, pp 243-264, (1968)
6. W. Bergman, A. Biermann, W. Kuhl, B. Lum, A. Bogdanoff, H. Hebard, M. Hall, D. Banks, M. Mazumder, and J. Johnson, "Electric Air Filtration: Theory, Laboratory Studies, Hardware Development, and Field Evaluations", LLNL Report, UCID-19952. January 9, (1984)
7. W. Bergman and A. Biermann, "Effect of DOP Hetero-dispersion on HEPA Filter Penetration Measurements," in Proceedings of 18th DOE Nuclear Airborne Waste Management and Air Cleaning Conference, Baltimore, MD, Aug. 12-16, 1984, pp. 327-437, NTIS, Springfield, VA, CONF-840806, (1985)
8. Scripsick, R.C., Smitherman, R.L., and McNabb, S.A. "Operational evaluation of the High Flow Alternative Filter Test System" Proceedings of 19th DOE/NRC Nuclear Air Cleaning Conference, CONF-860820, National Technical Information Service, Springfield, VA 22161, pp 863-889, (1987).
9. Schusster, B and Osetek, D, "The use of a single particle intra-cavity laser particle spectrometer for measurements of HEPA filters and filter systems" 14th ERDA Air Cleaning Conference, p.528, CONF-760822, NTIS, Springfield, VA, (1977).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

10. Ortiz, J, "In-place testing of multiple stage filter systems without disruption of plant operations in the plutonium facility at Los Alamos, 18th DOE Nuclear Airborne Waste Management and Air Cleaning Conference, CONF-840806, NTIS, Springfield, VA, p. 209, (1985).
11. Ortiz, J, Biermann, A, and Nicholson, R, "Preliminary test results of a round robin test program to evaluate a multi-stage HEPA filter system using single particle size counts" in Advances in Filtration and Separation Technology, 4, 213, American Filtration Society, Gulf Publishing Co., Houston, Texas (1991).
12. ASTM Standard Test Method for "Air cleaning performance of a high-efficiency particulate air filter system", F-1471-93, ASTM, 1916 Race St. Philadelphia, PA, 19103, (1993).
13. Martinez, V. "Procedure for in-place filter testing" Los Alamos National Laboratory, Operating Manual, (1995).
14. Biermann, AH and Bergman, W, "Filter penetration measurements using a condensation nuclei counter and an aerosol photometer" J. Aerosol Sci., Vol. 19, No. 4, pp 471-483, (1988).

DISCUSSION

FRANKLIN: On the DOP feed of the sampler, was that downstream of the grid? I could not tell where you were sampling the concentration of the DOP feed.

BERGMAN: The upstream sample was measured through a single probe that was inserted through a porthole in the shroud just before the HEPA filter. A single probe is sufficient at this point because the Emory 3009 aerosols were well mixed. The aerosols are injected through a nine-port manifold within a one foot by one foot area. The aerosols then hit a baffle that covers about 70% of the open area and is further mixed by a grid. The sample is then taken after the grid.

KOVACH, B: I have one question . When you tested with the shroud method I understand how you calculated the average leak with the shroud, but how did you add the gasket leakage to the efficiency?

BERGMAN: The shroud method only allows you to measure the average leak if the HEPA filter is mounted on the upstream, dirty side of the frame. In this case, the shroud is placed against the frame on the downstream side. Penetrations through gasket leaks and the filter are measured together as a single measurement. If the HEPA filter is mounted correctly on the downstream, clean side of the frame, it is not possible to quantify the leak through the gasket. The shroud is placed over the HEPA filter and only measures the leak through the filter. Leaks through the gasket are determined in a separate test in which a probe is traversed around the perimeter of the gasket. If the aerosol penetration at any point exceeded 0.03% the filter was removed.

METHOD FOR HEPA FILTER LEAK SCANNING WITH DIFFERENTIATING
AEROSOL DETECTOR

Bela J. Kovach, Eric M. Banks, Walter O. Wikoff
NUCON International, Inc.
Columbus, Ohio

Abstract

While scanning HEPA filters for leaks with "Off the Shelf" aerosol detection equipment, the operator's scanning speed is limited by the time constant and threshold sensitivity of the detector. This is based on detection of the aerosol density, where the maximum signal is achieved when the scanning probe resides over the pinhole longer than several detector time-constants.

Since the differential value of the changing signal can be determined by observing only the first small fraction of the rising signal, using a differentiating amplifier will speed up the locating process. The other advantage of differentiation is that slow signal drift or zero offset will not interfere with the process of locating the leak, since they are not detected.

A scanning hand-probe attachable to any NUCON[®] Aerosol Detector displaying the combination of both aerosol density and differentiated signal was designed.

Introduction

The scanning of HEPA filters is described in numerous articles and the general conclusion is that the size of the smallest leak detected is the function of the threshold sensitivity, reduced by the photometer response time versus scanning speed of the operator. The explanation is that the bell shaped curve of the aerosol concentration behind the pinhole is the highest in the center of the hole. Consequently, while scanning, the probe should reside over the center of the hole long enough to build up the maximum aerosol concentration in the optical chamber of the photometer. Since this is seldom the case, the conclusion is that with any given photometer there is a compromise between "missing some of the holes or working unnecessary long hours." Instead of such compromising, a mathematical solution of "enhancing" the data by differentiation of the exponential response curve was suggested.

The Method of Measuring the Aerosol Density and its Limitations

An isokinetic sampling probe for 100 feet per minute (fpm) face velocity using the 1 CFM pump was designed with an opening of 3" long and 0.5" wide. At a scanning speed of 10 fpm., it passes the pinhole leak in 0.5 sec

The response curve of the aerosol detector to a sudden increase of the aerosol concentration is an exponential function. The time constant of this function is independent of the pulse height. ⁽³⁾ The time constant of the NUCON[®] aerosol detector used for our experiment on the sensitivity range of 0.1 microgram/ liter is 0.62 sec. The detected pulse, with previously mentioned scanning speed of 0.5 seconds, reached approximately 30% of the maximum value. Scanning over the pinholes where this

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

signal value is equal to the drifts generated by the detectors electrical system and/or drift of the aerosol concentration, no leaks were detected. To improve the threshold sensitivity, the following steps could be taken:

1. Slow the scanning speed
2. Decrease the time constant of the aerosol detector
3. Decrease the electrical drift

As neither of those should significantly improve the threshold sensitivity, the logical approach was to use a differentiating "enhancing" amplifier.

The Differentiating Method: Advantage and Limitations

The differentiating amplifier does not recognize the constant signal value; in our case it is the analog value of the background aerosol concentration combined with the slow electronic drift. The time constant chosen for this amplifier selectively enhances the functions, having the rise time similar to the optical chamber. This approach ensured the recognition of aerosol concentration increase in the optical chamber, while suppressing all other slow drifts signals.

The output signal of this amplifier is displayed on a 99 segment LCD display. The display is electrically preset to 50% value to allow movements in both positive and negative directions. When the scanner approaches the vicinity of the hole, the meter moves first in one direction, returns to zero and, as the probe is moved away from the hole, moves in the other direction. Due to the long sample line, this reading is delayed and the operator has to practice using the hand probe.

The Combination of Measuring the Aerosol Concentration and Differentiated Signal


As a final solution, a double display fast LCD meter was built in a hand-probe with two operational amplifiers. The first meter displays the aerosol concentration transferred from the aerosol detector meter. The second meter, adjusted to the 50% value, makes positive and negative movement only during changes of the aerosol concentration. The operator, observing this movement, returns on the same path to locate the hole and read the concentration on the first meter.

Conclusion

Tests performed using a NUCON[®] aerosol detector with the added differentiating hand-probe confirmed that the time spent scanning for leaks can be decreased by as much as 50-90% of the standard scanning method. The benefit of this is a reduction in the total time spent in radiation fields and confined spaces, and an increase in the total number of filters scanned in any given time.

References

1. Nuclear Aircleaning Handbook
ERDA 76-21
- 2- Procedure Standards for Certified Testing of Cleanrooms.
NEBB 1988
- 3- Scanning HEPA Filters with Photometers
Bruce McDonald, Donaldson Co., Inc. Minneapolis, Minnesota,
JOURNAL OF THE IES, Sept./Oct 1994

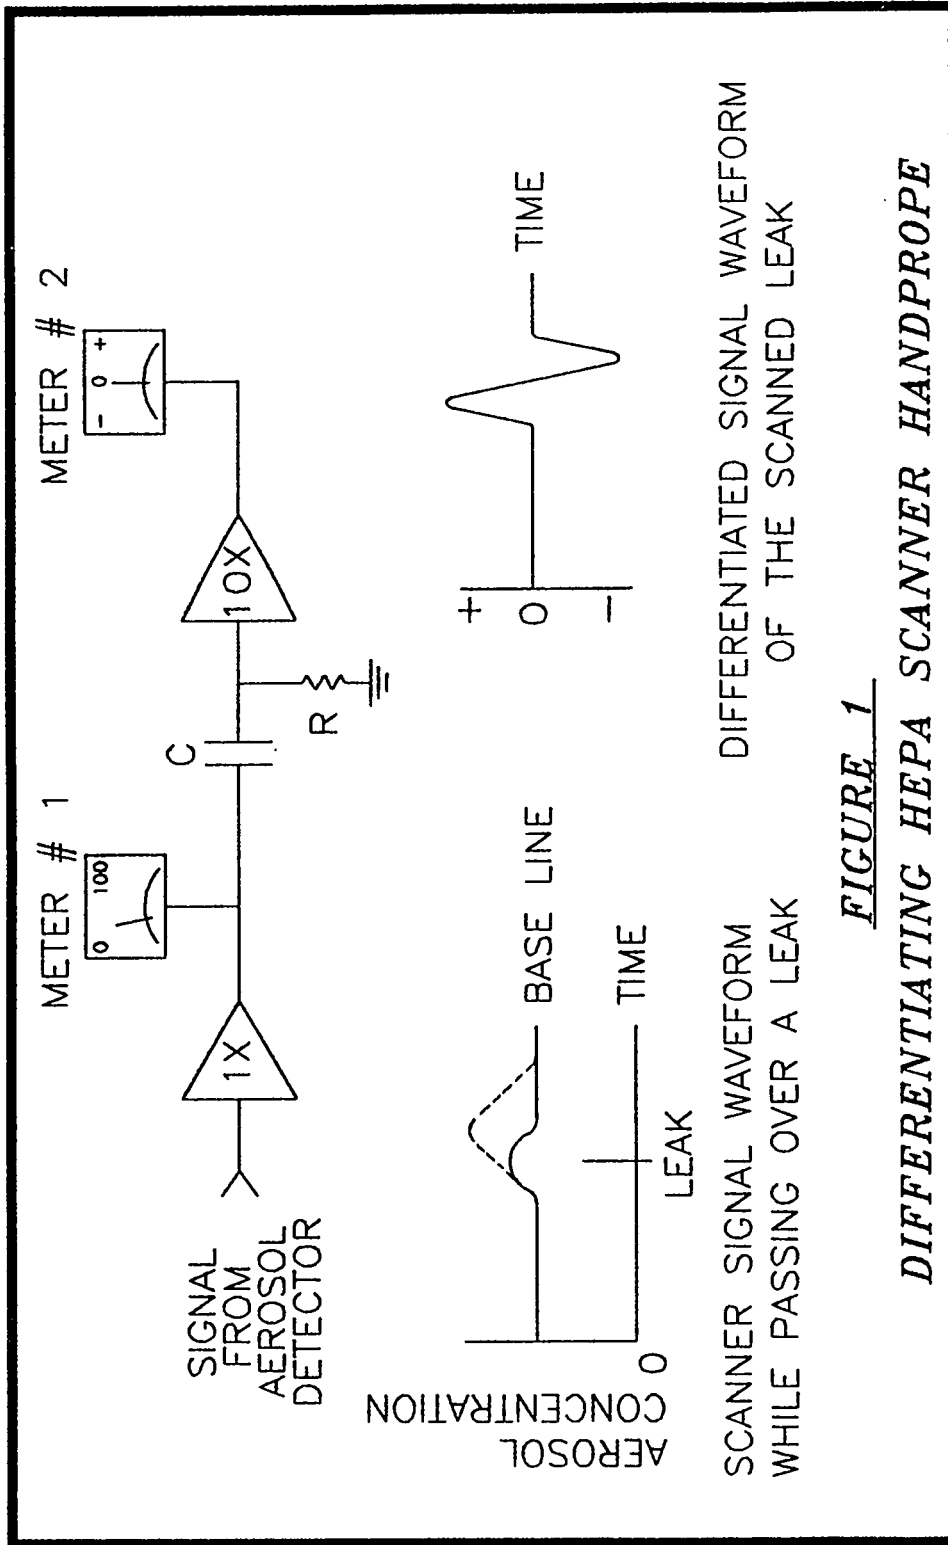

SCANNER SIGNAL WAVEFORM WHILE PASSING OVER A LEAK

DIFFERENTIATED SIGNAL WAVEFORM OF THE SCANNED LEAK

FIGURE 1
DIFFERENTIATING HEPA SCANNER HANDPROBE

DISCUSSION

RICKETTS: You mentioned that if you stay at the location of the leak long enough, after you have found it, that you can make an absolute measurement. Do you have to switch modes, somehow?

KOVACH, B: No, both instruments are on the same probe. You can see the display on both sides. One is a differential display which has the zero in the middle and the other is the number reading, the absolute value.

UNCERTAINTY IN IN-PLACE FILTER TEST RESULTS*

Ronald C. Scripsick¹, Richard J. Beckman², and Brian V. Mokler³

Abstract

Some benefits of accounting for uncertainty in in-place filter test results are explored. Information the test results provide relative to system performance acceptance limits is evaluated in terms of test result uncertainty. An expression for test result uncertainty is used to estimate uncertainty in in-place filter tests on an example air cleaning system. Modifications to the system test geometry are evaluated in terms of effects on test result uncertainty.

Introduction

In-place tests are performed on high efficiency particulate air (HEPA) filter systems to evaluate system performance. Test results are compared to system performance limits to judge acceptability of system performance relative to requirements of system design that assure health and environmental protection. In the absence test result uncertainty, acceptance limits on test results coincide with limits on system performance (see Figure 1). Uncertainty in test results has the effect of offsetting test result acceptance limits from acceptable system performance limits. Test results below test result acceptance limits provide clear evidence that system performance meets acceptance limits.

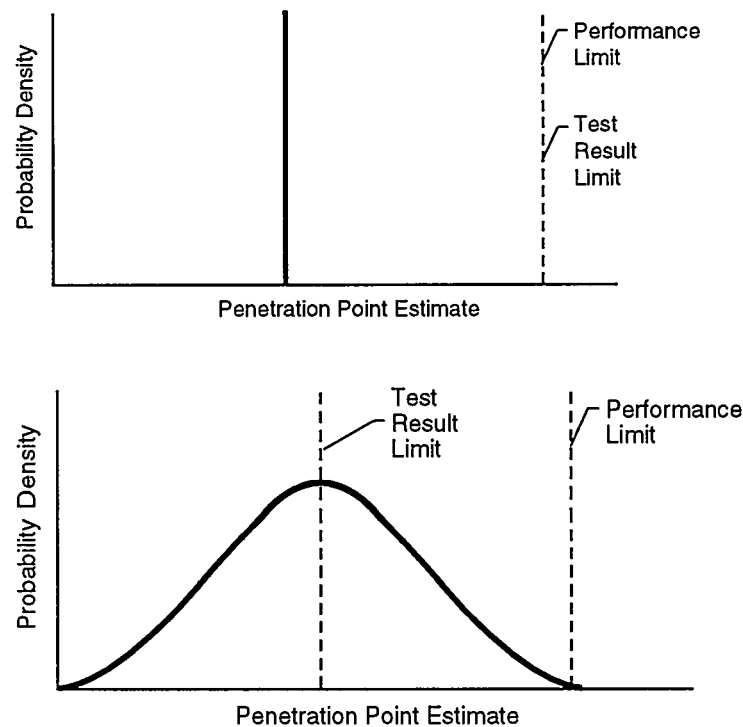


Figure 1 Two plots showing relation between system performance acceptance limit and test result acceptance limit for the case where test result uncertainty is zero and for the case where test result uncertainty is greater than zero.

¹ Los Alamos National Laboratory, Industrial Hygiene and Safety Group, Los Alamos, NM 87545

² Los Alamos National Laboratory, Statistics Group, Los Alamos, NM 87545

³ Consultant

*Support for this work comes from the US Department of Energy, the office of Defense Programs (DP-451) and the office of Nuclear Energy (NE-30). The program managers are James Slawski and George Sherwood.

Recently an expression for uncertainty in in-place filter test results for a single HEPA filter bank was developed using error propagation analysis¹. The expression uses indices of spatial variation of test aerosol concentration, flow velocity, and penetration to estimate test result uncertainty. These indices are referred to as heterogeneities and are defined in terms of relative standard deviations. In this paper, the uncertainty expression is used to evaluate the benefit modifications to test geometry might have in reducing uncertainty of in-place filter tests on a HEPA filter system.

An illustration of the geometry of in-place filter tests is presented in Figure 2. Test aerosol is injected into the ventilation system upstream of the HEPA filter bank at the injection plane. Aerosol concentration is sampled upstream of the filter bank in the challenge plane and downstream of the filter bank in the downstream sample plane. Concentration heterogeneity of the challenge aerosol is reduced by an upstream mixing factor, h_u , between the injection and challenge planes. Heterogeneity of aerosol penetrating the filter banks is reduced by a downstream mixing factor, h_d , between the downstream plane and the downstream sample plane.

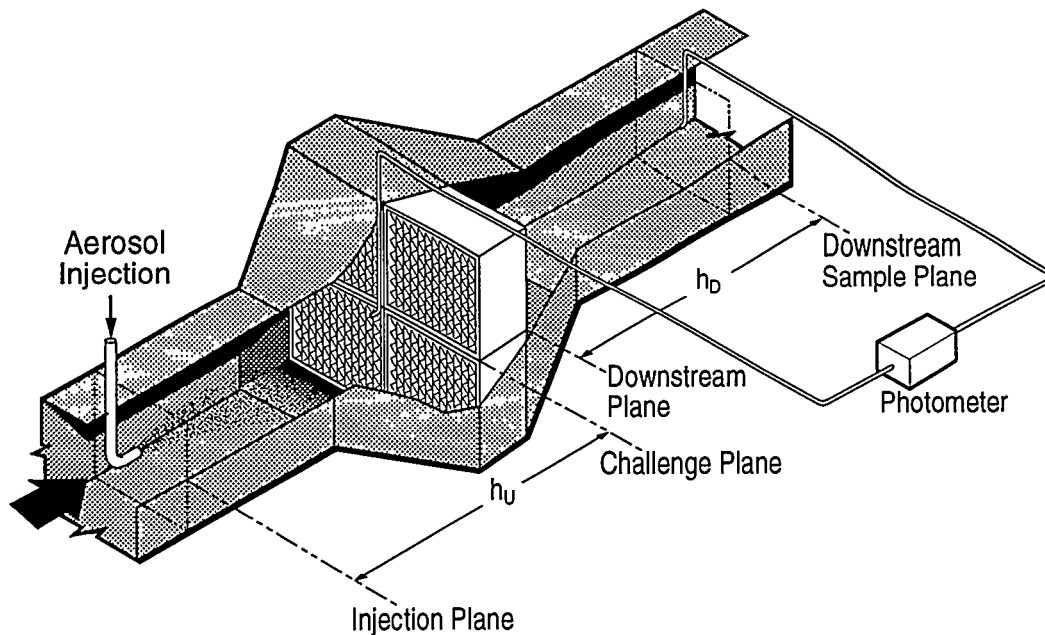


Figure 2 Generalized HEPA filter system showing in-place filter test geometry and mixing factors.

An estimate of aerosol penetration through the bank is given by:

$$\hat{P} = \frac{X_{DS}}{X_{US}} \tag{1}$$

where,

- \hat{P} = penetration point estimate,
- X_{DS} = the downstream sample concentration, and
- X_{US} = the upstream sample concentration.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Error propagation analysis yielded an approximate expression for the uncertainty in \hat{P}^1 :

$$H_{\hat{P}} = \left[\frac{\left(\frac{1}{X_U} - 1 \right)}{h_U^2} \left(\frac{1}{h_D^2} + 1 \right) + \frac{\left(\frac{1}{\hat{P}} - 1 \right)}{h_D^2} + \frac{H_Q^2}{h_D^2} \right]^{1/2} \quad (2),$$

where,

$H_{\hat{P}}$ = heterogeneity of the penetration point estimate or estimate of test result uncertainty,

X_U = dimensionless test aerosol challenge concentration, $= \frac{Q_{inj}}{Q}$,

Q_{inj} = volume flow rate of injected test aerosol,

Q = total HEPA filter system volume flow rate, and

H_Q = heterogeneity of the challenge flow velocity.

Analysis and Results

The expression for test result uncertainty (Equation 2) was used to estimate uncertainty in in-place filter tests on an example HEPA filter system. Example system design is based on an existing system at the Mound Facility in Miamisburg, Ohio². A diagram of the example system is shown in Figure 3. The system has two air flow entries immediately upstream of the HEPA filter bank. Test aerosol is injected in the primary entry. There is no aerosol injection in the secondary entry.

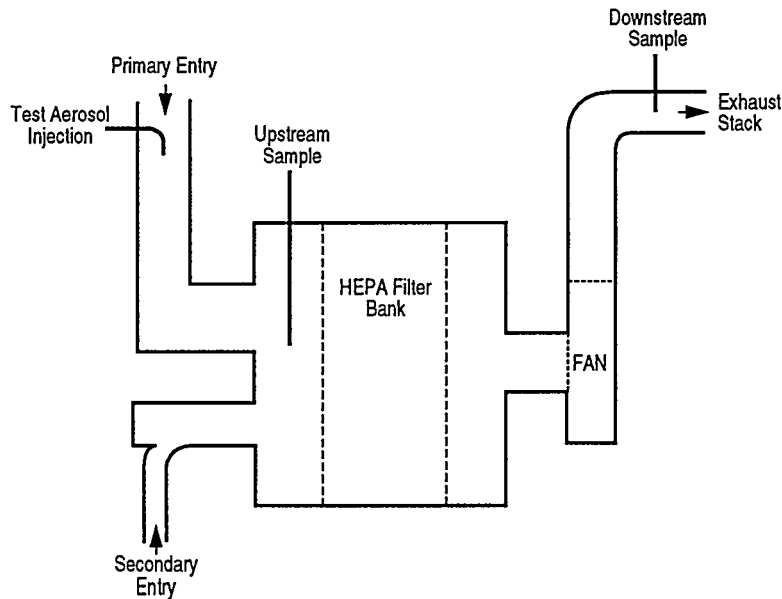


Figure 3 Example exhaust filtration system with two entries. In-place filter testing injection and sampling locations are shown.

For this analysis, Q_{inj} will be 2 cfm and Q will be 30000 cfm; both values are within the range of values observed for nuclear facility HEPA filter systems². Test aerosol is assumed to be well mixed in the primary entry to the filter plenum. However, because no aerosol is injected in the secondary entry, the challenge concentration is almost certainly not the same for all filters. Consequently, h_U for this analysis was estimated to be 150, which is a tenth of the value needed for this system to meet the ASME N510 'air-aerosol mixing uniformity' requirements³. Because flow downstream of the filter bank passes through a fan prior to being sampled, h_D is certainly much greater than h_U . For this analysis h_D was estimated to be 1500. The division of the air flow between the two entries is assumed to be balanced such that the system meets ASME N510 'airflow distribution' requirements³.

Values of test result uncertainty predicted from Equation 2 are shown in Figure 4 for test aerosol injected in the primary entry. At a typical system performance acceptance limit of 0.05% penetration, the predicted uncertainty was 0.82.

One potential method to reduce uncertainty in test results for this system is to inject aerosol into both entries. If aerosol injection rates are adjusted so that the average concentration is the same in both entries, the value of h_U would be increased, thus decreasing the uncertainty estimate. To illustrate this point, the analysis was repeated with test aerosol injection in both entries. This modification was assumed to increase h_U by a factor of five to 750. Uncertainty estimate predictions for this test aerosol injection configuration are shown in Figure 4. At the penetration point estimate of 0.05%, the uncertainty prediction is reduced to 0.17, almost a factor of five less than that for injection in the primary entry only.

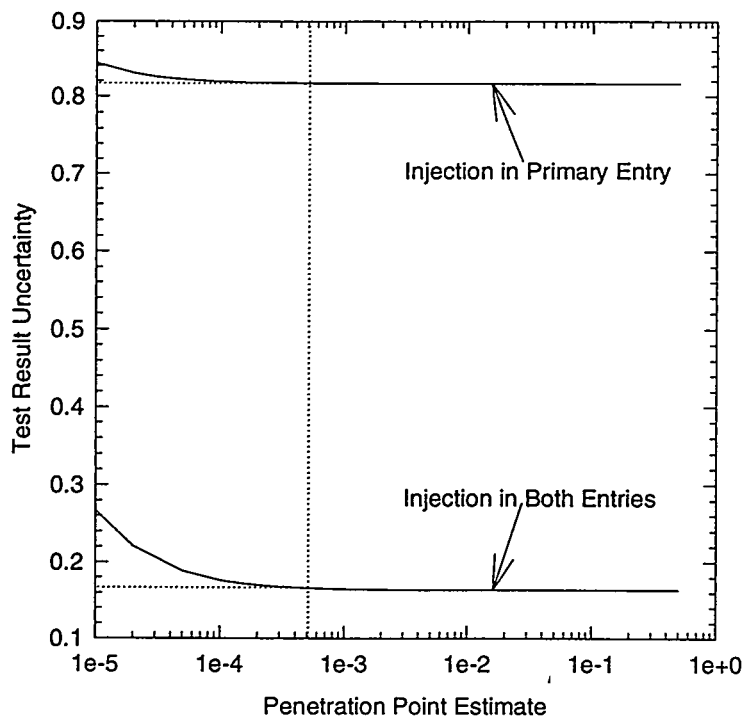


Figure 4 Values of test result uncertainty plotted against the penetration point estimate.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The uncertainty estimates were used to predict test result acceptance limits. The test result limits were determined using an offset below the system performance acceptance limit equal to three times the uncertainty estimate. Results of this analysis for both test aerosol injection configurations are shown in Figure 5. For injection in the primary entry, the test result acceptance limit was approximately 0.014% at the system performance acceptance limit of 0.05% penetration. The analysis indicates that test results below 0.014% provide clear evidence that system penetration is no greater than 0.05%. For test aerosol injection in both entries, this performance is assured by test results of 0.033% or less.

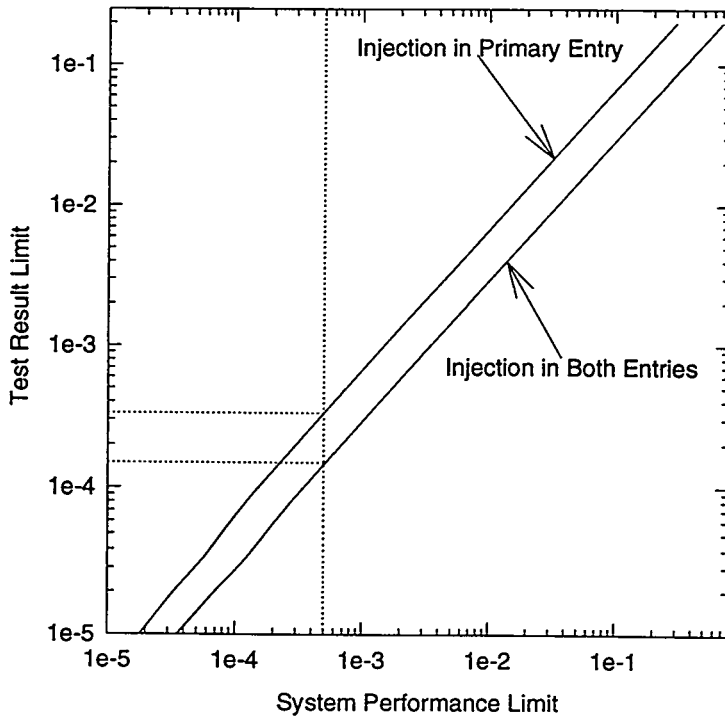


Figure 5 Test result acceptance limit plotted against system performance acceptance limit.

Discussion and Conclusions

The method presented here to account for uncertainty in in-place filter tests provides an objective rationale to judge whether tests results support the conclusion that system performance meets acceptance limits. Test result acceptance limits coincide with system performance acceptance limits only when there is no uncertainty in test results. Uncertainty in test results can be accounted for by offsetting test result acceptance limits below system performance acceptance limits by an increment related to the uncertainty. Here this increment was set equal to three times the test result uncertainty estimate. By this rationale, penetration point estimates below the test result acceptance limit are judged to provide clear evidence that limits on system performance are being met.

In addition to providing a rationale to judge acceptable HEPA filter system performance, test result uncertainty estimates can provide a metric to assess potential benefits of test geometry modifications. In the example described here, the test result acceptance limit could be increased by more than a factor of two through a modification in the test procedure. This metric provides facility managers a means to evaluate whether benefits from such modifications are cost effective. In this example, the facility manager could assess whether the extra cost of injecting test aerosol in both entries is offset by reducing the number of times system performance is rejected. If no test results have been reported in the 0.014% to 0.033% range, then the analysis indicates the modification would not be cost effective. However, if even a few test results are expected in this range, then the modification may be cost effective in delaying such costly system maintenance actions as filter replacement.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The utility of the uncertainty estimates may increase when ventilation system modifications are considered to reduce test result uncertainty. Such modifications can be costly, especially for systems contaminated with hazardous materials. Ventilation system modifications are among those being considered to establish compliance of existing systems with standards that post-date system design and construction. A number DOE nuclear air cleaning systems are in this category. The uncertainty estimates can help identify what system modifications might be needed to reduce overall test result uncertainty to levels that assure performance equivalent to that provided by tests on fully compliant systems. The estimates can also help identify costly modifications that contribute little to establishing this equivalency. Systems that pass these equivalent tests can be reasonably expected to provide levels of health and environmental protection equivalent to that provided by the fully compliant systems.

References

- ¹ R. C. Scripsick, Beckman, R. J., Mokler, B. V., Hinds, W. C., Martinez, V. A., "In-place filter testing geometry effects on test result uncertainty: Single stage systems", submitted to American Industrial Hygiene Association Journal, 1996.
- ² Los Alamos National Laboratory, "High efficiency filter systems-general observations, 1992-1993" by B.V. Mokler and R.C. Scripsick (LA-12763-SR), Los Alamos, New Mexico: Los Alamos National Laboratory, 1994.
- ³ The American Society of Mechanical Engineers, "Testing of nuclear air treatment systems: An american national standard" (ASME N510-1989), New York: The American Society of Mechanical Engineers, 1989.

DISCUSSION

DAUBER: I am intrigued by this method and I wonder if you have applied it to the testing of adsorbers as well as to HEPA filters and, if so, could you elaborate?

SCRIPSICK: I have not done it and did not think about it until you just asked. I do not see anything right off that would prevent it. I am not as familiar with the requirements of the adsorber test as I am with the in-place filter test. From a statistics point of view, I think that it could be applied.

GRAVES: The view graph you presented showed a two entry system. Why wouldn't you just qualify the system and inject in both places according to N-510 and be done with it?

SCRIPSICK: They have tested that system that way for a number of years. However, there is a cost associated with injecting in both systems but I would opt for injecting in both. The point I was trying to make is that this gives the cost-benefit information that a manager needs to have to justify a decision like that. There will be additional costs in injecting both because the injections are remote from the plenum. You would have to add at least one person to the test team. So there would be some costs, minor ones, I think.

GRAVES: Injecting at a single point, that is not even a test. There is a cost associated with a system that might leak because people get hurt, or contamination spreads, or something like that. But I do not see any guesswork in the one you showed. The single injection is not a test of that system, it is somebody doing an exercise, but it is certainly not a test.

DORMAN: I have some comments on in-place testing but I would not want to say my comments applied to bad testing or to Scripsick's or Bergman's presentations. They are general so I will make them in the chairman's including remarks

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

VALIDATION TESTING OF RADIOACTIVE WASTE DRUM FILTER VENTS

Lawrence D. Weber, Ph.D.
Scientific and Laboratory Services Department
Pall Corporation
25 Harbor Park Drive
Port Washington, NY 11050

Riazuddin S. Rahimi
Process Equipment Development Department
Pall Corporation
3669 Route 281
Cortland, NY 13045

Don Edling
Edling & Associates, Inc.
P.O. Box 1252
Russell Springs, KY 42642

ABSTRACT

The minimum requirements for Drum Filter Vents (DFV's) can be met by demonstrating conformance with the Waste Isolation Pilot Plant (WIPP) Truact II Safety Assessment Report (SAR), and conformance with U.S. Federal shipping regulations 49 CFR 178.350, DOT Spec 7A, for Type A packages.

These together address a number of safety related performance parameters such as hydrogen diffusivity, flow related pressure drop, filtration efficiency and, separately, mechanical stability and the ability to prevent liquid water in-leakage.

In order to make all metal DFV technology (including metallic filter medium) available to DOE sites, Pall launched a product development program to validate an all metal design to meet these requirements. Numerous problems experienced by DOE sites in the past came to light during this development program. They led us to explore enhancements to DFV design and performance testing addressing these difficulties and concerns.

The result is a patented all metal DFV certified to all applicable regulatory requirements, which for the first time solves operational and health safety problems reported by DOE site personnel but not addressed by previous DFV's. The new technology facilitates operations (such as manual, automated and semi-automated drum handling/re-drumming), sampling, on-site storage, and shipping. At the same time, it upgrades filtration efficiency in configurations documented to maintain filter efficiency following mechanical stress.

BACKGROUND

A great number of TRU radioactive waste packages have been generated throughout the DOE weapons complex. Condition of these packages varies widely. In addition, DOE sites continue to produce significant quantities of TRU waste, and will do so for the foreseeable future.

Hydrogen and other gasses are radiolysis products of several materials under alpha particle bombardment within the drums. This can result in flammable/explosive mixtures within the packages and/or their pressurization. The gasses must be vented while maintaining absolute containment integrity, in an environment also subject to fluctuating ambient temperature and weather conditions, and normal handling and transportation.

DOE's objective is to protect the public by consolidating these TRU waste packages in the WIPP underground repository. To meet this objective, DOE plans to ship packages in good condition, properly overpacked, with each container having at least one Drum Filter Vent (DFV), all conforming to regulatory requirements for transport and subsequent final storage. DFVs are required on all drums and boxes of TRU waste.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Several years ago, the Pall Corporation was asked by waste management personnel at the Idaho National Engineering Laboratory (INEL) to explore design possibilities of an all stainless steel DFV filter as an alternative to those in use, principally relying on a carbonaceous filter medium bonded to its mounting hardware. Availability of a qualified DFV with improved damage resistance was INEL's principal objective. Pall's stainless steel filter medium at HEPA grade efficiency had been certified to a number of MIL-F-51079 performance criteria⁽¹⁾. It was an obvious candidate technology for use in these new designs.

DFV RATIONALE

To guide the DFV development process, Pall engineers extensively contacted DOE TRU waste management personnel. During the ensuing site visits and discussions, a number of additional concerns about existing DFV's surfaced:

1. Preliminary testing at INEL indicated that reliable head gas sampling for VOC's could not be achieved through the carbon filter medium. This was investigated by INEL because representative sampling through the filter would significantly simplify the WIPP Waste Acceptance Criteria (WAC) certification process. In order to satisfy this component of the WAC, methods were adopted in certifying waste packages which required destruction/replacement of the carbon based DFV.
2. Questions were raised concerning the effective lifetime of adhesives used in manufacturing the carbon based DFV filter medium. Compounding this concern was the varied temperature, radiation, chemical, and climatic environments to which these TRU waste packages would be exposed, in conjunction with their intended lengthy periods of service.
3. In-leakage of water through DFV's with carbon based filter medium was reported at several DOE sites. At one site, over 4,000 drums were re-processed and de-watered because of concerns arising from up to 14 gallons of water having entered each drum. Mechanism of entry: ambient temperature cycling and associated temperature/pressure variations within TRU waste drums having accumulated water on their covers (e.g. rain, or melted snow).

This in-leakage and its potential to re-occur was of concern to criticality safety personnel due to water's properties as a neutron moderator.

Liquid water in-leakage also raised questions of unseen corrosion. This is important as these packages have to be "certified" safe for transport to WIPP.

4. There was a desire, common to all of the DOE contractor personnel contacted, to maximize hydrogen diffusivity, minimize pressure drop across the DFV, and to assure HEPA level filter efficiency ($\geq 99.97\%$ for heat-generated monodisperse 0.3 μ m DOP smoke).

Several sites, including Savannah River, were questioning whether to install more than one DFV per TRU package, in order to increase hydrogen dissipation rates and better prevent build-up to a flammable concentration.

HEPA level filter efficiency was referred to as the recognized standard for protecting public safety, and a level of performance desirable in DFV's. DFV's are not currently required by WIPP to perform to HEPA level efficiency. However, some DOE site specifications do require HEPA filter efficiency.

5. A very small fraction of existing drums at one DOE site were found with head gasses containing concentrations of HCl significant to stainless steel from a corrosion standpoint. Where encountered, this can be addressed by polymeric and/or higher alloy metallic DFV's. Our survey of DOE sites has not encountered any other drums where HCL would be expected to present a problem.

VALIDATION TESTING

Extensive DOE site survey also revealed current dimensional needs which Pall engineers effectively embodied in an assortment of hardware designs. A variety of these (below) have now been tested in accordance with the requirements, given in Table I, and shown under DOE witness and/or third party witness to meet or exceed them.

Table 1
DFV Validation Test Requirement and their Sources

<u>SOURCE</u>	<u>TEST</u>
<u>Basic Regulatory Requirements</u>	
1. Trupact-II SAR	Hydrogen Diffusivity Pressure Drop vs. Air flow DOP Efficiency
2. 49 CFR 178.350 DOT Spec 7A, Type A	Water Spray Drum Drop Compression Rod Penetration
<u>Functional Requirements Identified Through DOE Site Visits</u>	
3. Liquid Water in-leakage Prevention	
Pall Laboratories	In-leakage prevention limit
4. Representative Head Gas Sampling	
INEL	Hydrogen, methane, and VOC Transport Test (Formal Report recently completed.)

DFV'S SUBJECT TO VALIDATION TESTING

Pall all metal DFV's tested utilize the same filter medium, and comprise stainless steel filter medium and hardware. Models tested are depicted in Figure 1, attached.

DFV #1

The Standard Design (hexagonal body, 3/4 inch thread), intended for newly generated TRU waste packages. It is also employed on boxes and 85-gal drums used to repack or overpack damaged 55-gal TRU drums of retrieved waste. Also available in round body (#5R, Appendix A); choice made based on current equipment, handling fixtures and site procedures and practices.

Note: prior to commercial production this model DFV #1 was designated by its R&D code: "625exxx," where xxx is a three digit serial number. This code appears in this report where applicable.

DFV #2

This design arises from LANL's approach to remotely venting drums being retrieved from landfills on their site. The design mates with LANL equipment that remotely inserts a DFV into the retrieved drums.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DFV #3 & 4

These are INEL designs differing only in thread size, 7/16 inch and 1/2 inch self tapping. They arise from INEL's approach to remote venting of retrieved drums. These DFV's mate with the INEL equipment that inserts the DFV into a retrieved drum.

TEST METHODS AND RESULTS

All tests reported were conducted in compliance with indicated source (Table 1). What follows are functional descriptions of the tests, and test results.

Trupact-II SAR Requirements

Tests of hydrogen diffusivity and airflow resistance at between 1 and 10 psig were performed by an independent test facility, the Westinghouse Science and Technology Center, under contract by Pall Corporation (2). Methods were exactly as previously used in qualifying conventional carbon based DFV's.

Tests of DOP efficiency, and fixed flow rate pressure drop tests were performed under witness and certified by an independent third party, ETL Testing Laboratories, Inc., under contract by Pall Corporation. All DOP tests herein reported were performed using an ATI model Q127 DOP penetrometer, delivering heat-generated monodisperse 0.3um DOP smoke.

1. Hydrogen Diffusivity Test

Results are given in Table 2, below. The minimum acceptance criterion specified by WIPP is 1.90E-06 mole/sec/mole fraction.

Table 2
Diffusion Coefficients and Standard Errors for All Filters

<u>Filter</u>	<u>D'</u> <u>mol/mole%/sec</u>	<u>D'</u> <u>mole/mole%/sec</u> <u>standard error</u>	<u>D'</u> <u>mole/sec/mole</u> <u>fraction</u>	<u>D'</u> <u>mole/sec/mole</u> <u>fraction</u> <u>standard error</u>
625e016	5.13E-08	9.38E-10	5.13E-06	9.38E-08
625e046	5.33E-08	2.01E-09	5.33E-06	2.01E-07
625e010	4.96E-08	1.43E-09	4.96E-06	1.43E-07
Avg 625e's	5.14E-08	1.46E-09	5.14E-06	1.46E-07

2. Pressure Drop vs. Air Flow Test

Results are given in Table 3, below. The minimum specification established by WIPP is one LPM at one psi gauge pressure drop across the DFV (or 200 cc/min at one "H₂O gauge pressure drop; see also Table 5, below).

Table 3
Flows versus Pressure Drop at 1.0 psig

FLOW, SLPM AIR, at ΔP = 1.0 psid		
625e016	625e010	625e046
10	11	10

Plots of pressure drop across the filters vs. flow for all filters were prepared from a series of measurements up to 10 psig. These were linear with correlation coefficients greater than 0.99 for each filter. The relationship between

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

flow and pressure drop may also be expressed as the flow coefficient, $C_f = \text{flow}/\text{pressure drop}$, where flow is in standard liters per minute air and pressure drop is in psig. Since the graphs were linear, the flow coefficients are the slopes, shown in Table 4:

Table 4
Flow Coefficients for All Filters.

<u>Filter</u>	<u>C_f, slpm air/psig</u>
625e016	14.5
625e010	14.9
625e046	13.5

3. Pressure drop; DOP Efficiency.

The minimum flow capacity established by WIPP at one "H₂O gauge pressure drop across the filter is 200 cc/min. WIPP also specifies that each filter shall exhibit filtering efficiency >99.9% with 0.3 - 0.5 μm particles of DOP smoke.

Filter pressure drop and aerosol Penetration were measured at 200cc/min flow of hot-generated 0.3 μm monodisperse DOP, and certified under third party witness: ETL Testing Laboratories, Inc. The results are given in Table 5, below.

TABLE 5
DOP Penetration and Filter Pressure Drop at Fixed flow Rate

<u>Model</u>	<u>Filter</u> <u>Part Number</u>	<u>Flow Rate</u>		<u>Air ΔP, in. H₂O</u>	<u>% Penetration</u>
		<u>SCCM</u>	<u>ACCM</u>		
DFV #1	Log 916E #049	200	208	0.55	0.005-0.008
DFV #1	Log 916E #047	200	208	0.55	0.004-0.007
DFV #1	Log 916E #032	200	208	0.60	0.004-0.005
DFV #2	Log 180F #39	200	208	0.80	0.002-0.003
DFV #2	Log 180F #39	200	208	0.80	0.002-0.003
DFV #2	Log 180F #51	200	208	0.75	0.002-0.003
DFV #3	Log 216F #1	200	208	0.75	0.001-0.003
DFV #3	Log 216F #4	200	208	0.75	0.001-0.003
DFV #3	Log 216F #12	200	208	0.75	0.002-0.005
DFV #4	Log 215F #2	200	208	0.75	0.002-0.004
DFV #4	Log 215F #6	200	208	0.80	0.001-0.002
DFV #4	Log 215F #5	200	208	0.65	0.002-0.003

DOT Spec 7A.. Type A Requirements

DOP penetration testing is not specified as a DOT Spec 7A performance requirement, however, this was performed as added demonstration of DFV robustness before and after the mechanical tests specified for Type A packages, items 2, 3, and 4, below.

1. Water Spray Test, performed under witness by: INEL personnel, and Edling & Associates, Inc.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The purpose of this test is to demonstrate that "rain" will not adversely affect the containment integrity and that there will not be any in-leakage of liquid water under rainy out-door storage conditions. It probes in-leakage resistance of the filter medium, DFV construction, and seals. Note: Passing this test has no bearing on the ability of the DFV to allow the passage of water in its gaseous or vapor state.

Four DFV's, one each of the four types tested, were installed into a drum lid, 90° from one another. Blotter paper was placed under the DFV inlet (drum contents side of lid) so that should liquid water enter the drum it would be captured by the paper, providing an easily detected, visual indication of even small quantities of liquid in-leakage. The blotting paper was affixed to the inside surface of the lid securely with standard duct tape, and drum assembly then completed. All DFV's and the lid were affixed using applicable torque as specified in the "DOT Spec 7A Evaluation Documents."

Following drum assembly per above, shower heads were used to deliver "rain" uniformly over the drum lid for a period of an hour. Upon completion of the water spray, in further accordance with test requirements, the package was allowed to stand two hours without draining or other disturbance prior to examination for in-leakage or other detrimental effect. At this point, water was standing on the drum lid to its height of overflow. A rain gauge placed on the lid during the shower showed overflow beyond its 5.5" capacity, demonstrating that "rain" had been well beyond the 2" per hour minimum required.

The water was drained off the lid, the lid removed, and the blotting paper thoroughly inspected for evidence of water. To pass this test, there must be no water detectable. Duplicate trials were run, each utilizing different drums and DFV's. Results are given in Table 6, below.

Table 6
Water Spray Test Results

<u>DFV MODEL</u>	<u>PASS/FAIL</u>	
	<u>TEST 1</u>	<u>TEST 2</u>
DFV #1	PASS	PASS
DFV #2	PASS	PASS
DFV #3	PASS	PASS
DFV #4	PASS	PASS

2. Drum Drop Test, performed under witness by: INEL personnel, and Edling & Associates, Inc.

This tests the ability of DFV's and drums to maintain integrity/containment as an assembled unit in the aftermath of a defined free fall.

A new drum was loaded to 950 lb using a gravel (bottom) and sand (top) mixture, as verified by weighing. A layer of 1 - 2" of fluorescein:flour mixture at 1:20 by weight was leveled on top of the sand. The drum was now full. Prior to installation, DFV's were tested for DOP penetration. They were required by Pall to provide efficiency at $\geq 99.97\%$ for heat-generated monodisperse 0.3 μm DOP smoke at flow rate ≥ 200 sccm, producing $\Delta P \leq 1" \text{H}_2\text{O}$. The reason for selecting flow rates in some cases higher than 200 sccm is that the INEL site imposed a condition that DOP efficiency tests of DFV's for their site be run at the flow rate generating 1" H_2O . As this flow rate was higher than 200 sccm, it presented another parameter by which testing was more stringent than required by the Trupact II SAR.

After testing for DOP penetration, four DFV's, one each of the four types tested, were installed into a drum lid, 90° from one another. This lid was then sealed to the weighted drum, such that the closure ring bolt was adjacent to one of the DFV's. The drop test was repeated four times with new drums and DFV's. In each trial, a different DFV model was adjacent to the closure ring bolt.

Once filled and assembled together with the four DFV's, the drum was hoisted upward and suspended from a wire harness such that the central drum axis was at 60° to the floor. In this orientation, the closure ring bolt was at the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

lowest point, 40" in height from a thick steel plate bolted to the concrete shop floor. A bolt cutter with pneumatic drive was used to cut the central suspension rod of the wire harness to initiate free fall.

To pass this test, there must be "no loss of contents," as determined by a complete absence of fluorescein. A UV lamp was shown with a known sample of the flour: fluorescein mixture to cause fluorescence of the fluorescein. This lamp was used to inspect the weighted drum-DFV assembly before and after each drop. Inspection was conducted on the drum, drum lid and drop platform both directly and by the inspection of wet swipes.

Following this inspection, the DFV's were retested for DOP penetration at 200cc/min, or at $\Delta P = 1'' \text{ H}_2\text{O}$ where this pressure drop was produced at $>200\text{cc/min}$. Abrupt drum deformation on impact appeared to have caused inlet (drum) side challenge of several DFV's by a visually significant quantity of fluorescein:flour. For this reason the DFV's were reverse-flushed with filtered isopropanol and dried prior to post-drop DOP tests. Even with flushing, some loss of flow capacity generally remained. In one case, a DFV remained completely blocked to flow, despite attempted flushing. The average decrease in flow capacity not counting this DFV was of the order of 15%. The results are given in Table 7, below.

Table 7
Drum Drop Test Results

Each drum lid containing four DFV's at 90° separation.

<u>DFV Model</u>	<u>Drop Pass/Fail</u>	DOP Efficiency, Pass/Fail at 99.97%	
		<u>Before Drop</u>	<u>After Drop</u>
DFV #1	PASS	PASS	PASS
DFV #2	PASS	PASS	PASS
DFV #3	PASS	PASS	PASS
DFV #4	PASS	PASS	PASS
DFV #1	PASS	PASS	PASS
DFV #2*	PASS	PASS	PASS
DFV #3	PASS	PASS	PASS
DFV #4	PASS	PASS	PASS
DFV #1	PASS	PASS	PASS
DFV #2	PASS	PASS	PASS
DFV #3*	PASS	PASS	PASS
DFV #4	PASS	PASS	PASS
DFV #1	PASS	PASS	PASS
DFV #2	PASS	PASS	Blocked to flow
DFV #3	PASS	PASS	PASS
DFV #4*	PASS	PASS	PASS

*At closure ring bolt (impact) position.

3. Compression Test, performed under witness by: INEL personnel, and Edling & Associates, Inc.

After testing for DOP penetration, four DFV's, one each of the four types tested, were installed into a drum lid, 90° from one another. The lid was installed on a new drum, maintained empty. A steel plate weighing 5,000lb was placed upon the drum lid for 24 hours. The DFV's were visually inspected and tested again for DOP penetration. The results are shown in Table 8, below. To pass this test, there must be no visually detectable physical distortion of the DFV's.

Before and after Compression test, the DFV's were tested for DOP efficiency at flow rate $\geq 200 \text{ sccm}$, producing $\Delta P \leq 1'' \text{ H}_2\text{O}$.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table 8
Compression Test Results

<u>DFV Model</u>	<u>Compression Pass/Fail</u>	<u>DOP Efficiency, Pass/Fail at 99.97%</u>	
		<u>Before Compression Test</u>	<u>After Compression Test</u>
DFV #1	PASS	PASS	PASS
DFV #2	PASS	PASS	PASS
DFV #3	PASS	PASS	PASS
DFV #4	PASS	PASS	PASS

4. Penetration Test (Dropped Rod), performed under witness by: INEL personnel, and Edling & Associates, Inc.

DFV's were installed on a drum prepared as for the Drum Drop Test, above, and evaluated in the following manner for physical penetration (damage) under the mechanically localized impact of a free falling steel rod.

A steel bar weighing 13.2 pounds was dropped from a height of 40 inches so that it impacted in the center of the "rain hat" of the DFV. This impact point was chosen because it represents the weakest point, as required in the DOT regulations.

In each case only an insignificant dent resulted from impact. Dents ranged from visually undetectable to a maximum depth of approximately 0.060".

To pass the test, there must be no "loss of contents" through the DFV. This was assessed as in the Drum Drop Test, above.

As a test beyond DOT Spec 7a., Type A requirements, DOP efficiency was measured before and after this Penetration Test at a flow rate ≥ 200 sccm, producing $\Delta P \leq 1$ "H₂O. The results are shown in Table 9, below.

Table 9
Penetration Test Results

<u>DFV Type</u>	<u>Penetration Test (Dropped Rod) Pass/Fail</u>	<u>DOP Efficiency, Pass/Fail at 99.97%</u>	
		<u>Before Rod Drop</u>	<u>After Rod Drop</u>
DFV #1	PASS	PASS	PASS
DFV #2	PASS	PASS	PASS
DFV #3	PASS	PASS	PASS
DFV #4	PASS	PASS	PASS

Liquid Water in-leakage Prevention.

Pall Laboratories: In-leakage prevention limit.

The "rain hats" were removed from the DFV's to be tested, revealing an unobstructed view of the outside surface of the filter medium. The DFV being tested was installed filter throughput direction vertical at the bottom opening of a J-tube, the long leg of which extended upward for ready measurement of hydrostatic head. The J-tube was filled gradually with water to a hydrostatic head of 75"H₂O. After a 3 minute waiting period, if no liquid flow occurs, hydrostatic head is slowly increased to the first visual penetration. This is a sensitive test because once the liquid water in-leakage pressure is exceeded, flow is maintained and liquid droplet(s) accumulate on the filter medium.

The results are shown in Table 10, below.

Table 10
Liquid Water In-Leakage Prevention Test

<u>DFV Model</u>	No Leakage at 75" H ₂ O <u>Pass/Fail</u>	No Leakage at 85" H ₂ O <u>Pass/Fail</u>	Min. Pressure of Initial Flow, "H ₂ O
DFV #1	PASS	PASS	89*
DFV #2	PASS	PASS	N/A
DFV #3	PASS	PASS	89*
DFV #4	PASS	PASS	N/A

*Witnessed by INEL personnel.

INEL Selective VOC and other Gas transport.

INEL recently tested Pall all metal DFV's on the basis of hydrogen, methane, and VOC transport. A formal report is to be issued, soon. Personal communications indicate the report to confirm the all-metal filters as transparent to the cited compounds, consistent with non-adsorptive properties expected of stainless steel. Testing was performed consistent with requirements of the WIPP Quality Assurance Project Plan (QAPP).

DISCUSSION AND RECOMMENDATIONS

Test results show Pall all-metal DFV's to exceed Trupact II SAR requirements for hydrogen diffusivity, air flow ΔP , and DOP penetration. At the specified flow rate of 200cc/min, per Trupact II DOP test conditions, the all metal filters are at $\Delta P < 1"$ H₂O, and efficiency >99.97% for hot-generated monodisperse 0.3um DOP smoke. These results were documented and submitted to WIPP in October, 1995.

Test results also verify conformance of Pall all metal DFV's to DOT Spec 7A, Type A.

DOP penetration measurements were added before and after the DOT test sequences. Mechanical shocks or other stress to DFV-drum assemblies will affect the rate of radiolysis and other chemical processes within sealed drums by promoting remixure of their contents. The affect will be largely unpredictable, but hydrogen evolution and/or other pressure producing reactions could be accelerated. For this reason, we recommend pre- and post-DOT test DOP/pressure drop measurements in validating DFV designs. The test data support a conclusion that the mechanical stresses specified by DOT Spec 7A produced no breach in filter integrity of the all-metal DFV's.

Liquid water in-leakage prevention results indicate minimum ΔP required to produce water flow is reliably at >85" H₂O. Ideal gas law calculations show a ΔP of 85" H₂O as corresponding to a temperature swing of 123F^o in the waste drum environment (drum temperature at 130^oF dropping to +7^oF, lid flooded), well beyond that expected by DOE facilities. It is recommended that new DFV designs be certified to such a standard of liquid water in-leakage, as environmentally non-inducible.

INEL has completed testing of VOC transport through Pall all metal DFV's. We understand from personal communications that it validates the all metal DFV's as providing VOC transport representative of head gas concentrations. This will mean that head gas sampling can for the first time be performed through the filter non-destructively, including such sampling to meet WIPP QAPP requirements..

Another result of Pall's ongoing contact with DOE site personnel is further design refinement. We opted to revise the designs and increase the variety of models available that adapt to a tool facilitating easy, non-destructive head gas sampling through the DFV. While performing this design evolution, we also found ways to improve producibility of our all metal DFV's. The updated designs are described in Appendix A, and depicted in Figure 2, both attached. No change in filter medium has been made since the testing herein described and, in some cases, design is so similar that the new models (Appendix A) may prove certified by existing test results. Pall is pleased to perform validation testing of design variants, where required.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CONCLUSIONS

In comprehensive discussion with personnel at DOE sites, we confirmed the regulatory requirements for DFV validation, and further identified practical problems hampering daily site operation and generating additional costs. In the course of testing new DFV designs for certification, we responded both to current regulatory requirements and to the practical needs presented to us for more economic site operation while maintaining public/worker safety.

As a result of this test program, we are pleased to point out that for the first time a rugged, all metal DFV is available to DOE sites which will:

1. Meet all applicable WIPP Trupact II SAR, and U.S. government DOT requirements.
2. Provide HEPA efficiency and pressure drop at the rated flow
3. Reduce criticality risk by providing a new level of liquid water in-leakage prevention.
4. Enable direct head gas sampling non-destructively through the DFV (INEL testing, to be reported). This is expected to reduce both operating and DFV replacement costs.

ACKNOWLEDGMENT

The authors gratefully acknowledge the DOE and M&O Contractor engineers who contributed their comments and time to this effort, and thank the members of Pall's DFV Team and Support personnel for their many contributions.

REFERENCES

1. Report No. 529719, "Tests of Single Stage Metal Fiber HEPA Filter Media and Filter Elements, ETL Testing Laboratories, Inc., Rendered to Pall Corporation, June 18, 1993.
2. Report No. 95-2TD2-PFILT-R1, "Evaluation of Filters for Flow and Hydrogen Diffusion Characteristics," Westinghouse STC, April 24, 1995.

Appendix A Updated Designs of All Metal DFV's, Comprising Stainless Steel Filter Medium and Hardware

DFV #1H

The Standard Design (hexagonal body), intended for newly generated TRU waste packages. It is also employed on boxes and 85-gal drums used to repack or overpack damaged 55-gal TRU drums of retrieved waste. Also available in round body (#5R, below); choice made based on current equipment, handling fixtures and site procedures and practices.

DFV #2L

This design arises from LANL's approach to remotely venting drums being retrieved from landfills on their site. The design mates with LANL equipment that remotely inserts a DFV into the retrieved drums.

DFV #3R & 4R

These are INEL designs differing only in thread size. They arise from INEL's approach to remotely venting retrieved drums. These DFV's mate with the INEL equipment that inserts the DFV into a retrieved drum.

DFV #5R

This round body design is intended as standard design for newly generated TRU waste packages. It is also used on boxes and 85-gal drums used to repack or overpack damaged 55-gal TRU drums of retrieved waste. Also available in hexagonal body as #1H, referenced above.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The round body designs (suffix "R") mate with a sampling fixture allowing head gas samples to be taken non-destructively through the stainless steel DFV, as often as needed.

Pall's Stainless Steel Drum Filter Vents Subject to Validation Testing


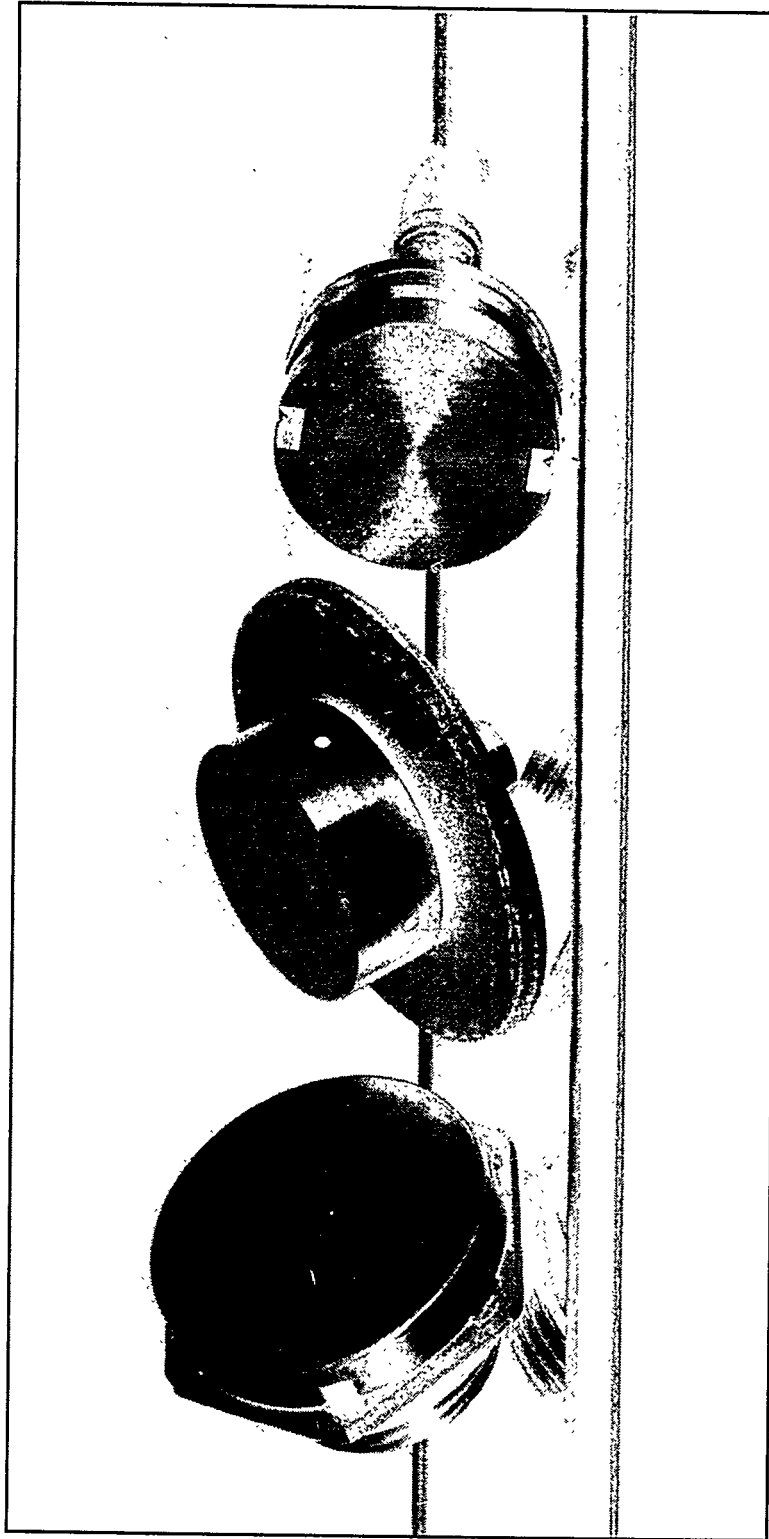


Figure 1

Pall Corporation's Family of All Stainless Steel HEPA Efficiency Drum Filter Vents for DOE Rad Waste Containers

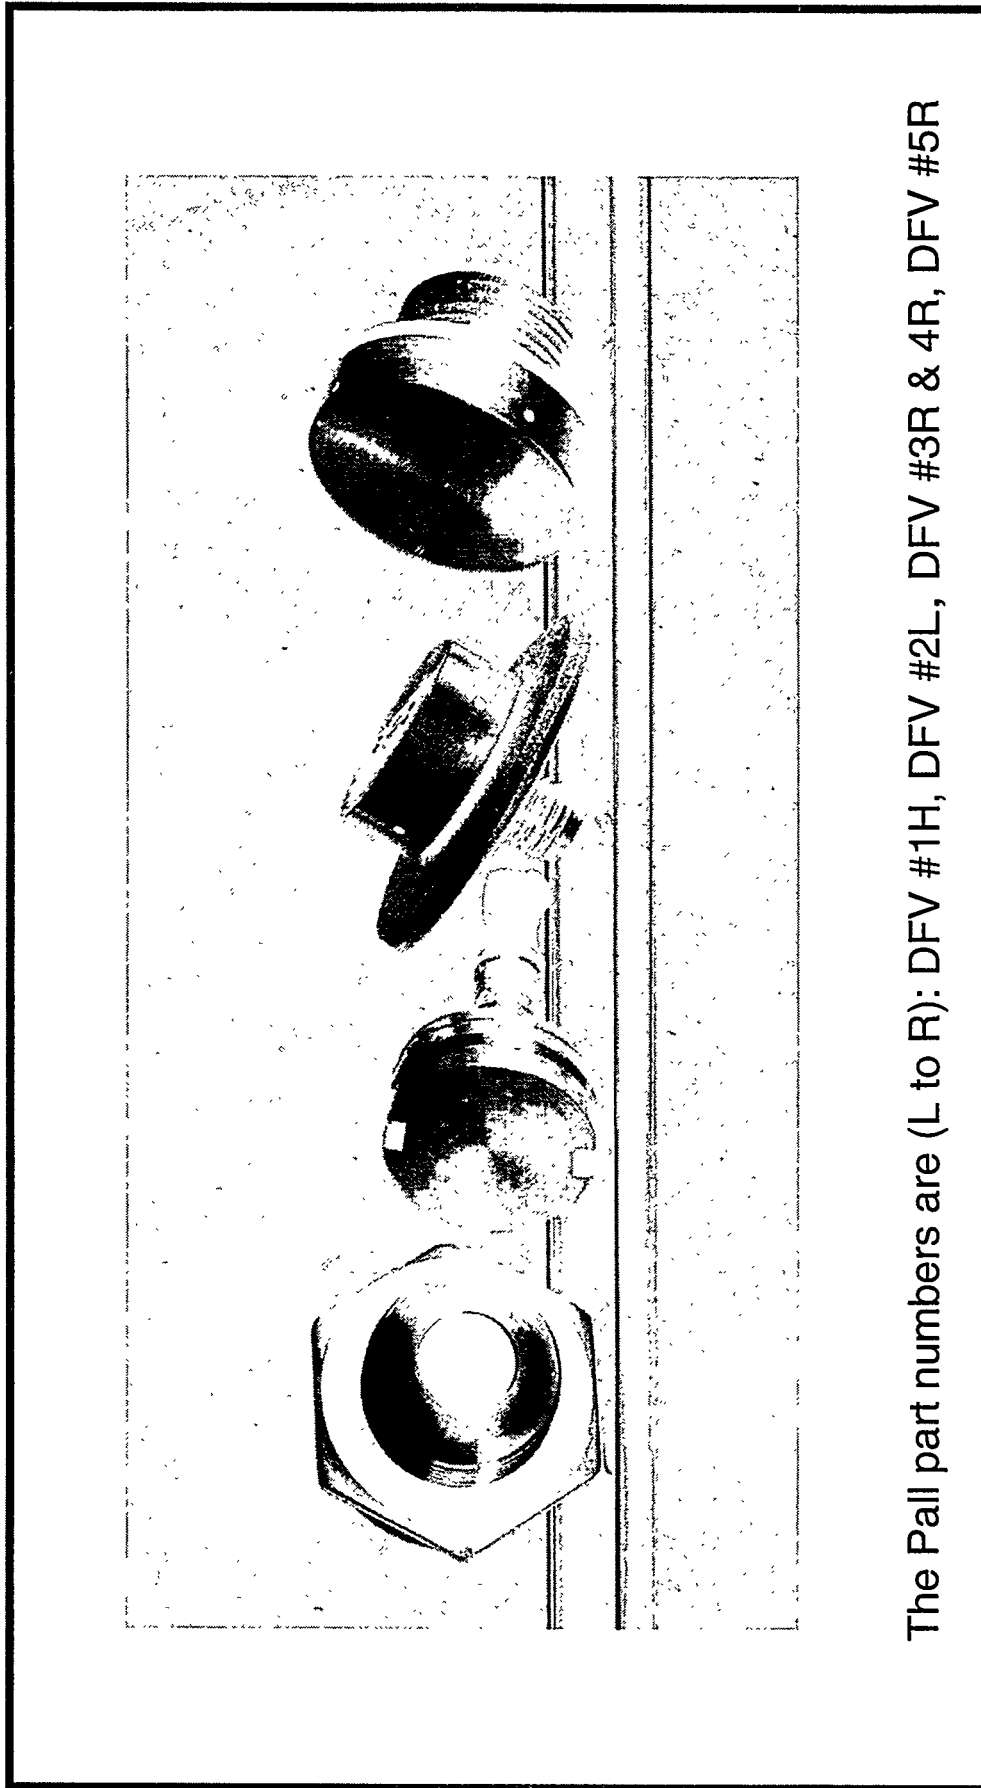

The Pall part numbers are (L to R): DFV #1H, DFV #2L, DFV #3R & 4R, DFV #5R

Figure 2

DISCUSSION

DERDERIAN: Would you discuss the simulant that you use to pressurize the drum contents?

WEBER: The simulant is specified by the DOT and the applicable CFR. It is one part fluorescein to twenty parts cooking flour by weight. The flour serves to dilute the fluorescein because there is plenty there for ultraviolet light to pick up.

DERDERIAN: But it does not pressurize the inside of the drum, is that correct or not?

WEBER: By itself, no, but when you drop the drum from a height the impact momentarily gives you quite a burst of pressure.

SCRIPSICK: Did you look at airborne fluorescein in the test? The test procedure calls for you to look on the floor. It is quite possible the dust hasn't settled yet. If you go back a week later you might find some.

WEBER: That is an interesting thought. The DOT standard used to certify the filter does not address that possibility. The DFV itself is mounted so close to the lid of the drum that you would see evidence of it from inertial impaction if it were to be true. We did not.

SCRIPSICK: On the upstream side? I assume the upstream side of the filter was coated with fluorescein.

WEBER: Yes, very much so. We saw it there and we also saw some increased resistance to flow after the test. You could also look inside to the part of the DFV that faces the contents of the drum and you could see the stuff in there. There were no measurable amounts outside.

SCRIPSICK: One of the things we found was that it is very difficult to seal up pipe threads. I wonder if the tests that you did considered that seal because it would be part of the in-place test.

WEBER: The tests were done in conformance with the existing specifications so what was tested was the assembled unit of the DFV, the drum lid, and the drum. The fact that there was no loss of contents by that test indicates that the pipe joint was not a weak point. That could be an area for additional investigation. The main seal to the drum lid is by a gasket. A lot has to do with the strength that you need to make a seal and not rip the drum lid.

MONROE: Have you done any studies on the plugging rate during normal service of these filter vents?

WEBER: We do not yet have any normal service experience with the filter vents because we have just gotten them certified. That will be a very important parameter to follow. Service does not call for extended periods of flow so I am predicting a very low plugging rate. The primary function of the filter is to dissipate by diffusion and pressure the hydrogen that is generated thermally from radiolysis inside the drum.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CONKLIN: In Washington State, drum vents that are used at Hanford must meet HEPA efficiency requirements according to Washington State regulations.

WEBER: What regulation in particular?

CONKLIN: The Washington State Clean Air Act that requires best available radionuclide control technology.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

A GENERAL CORRELATION OF MPPS PENETRATION AS A FUNCTION OF FACE VELOCITY WITH THE MODEL 8140 USING THE CERTITEST 8160

Norman Lifshutz and Mary Pierce
Hollingsworth & Vose Company
West Groton, Massachusetts

Abstract

The CertiTest 8160 is a Condensation Nucleus Counter (CNC) based filtration test stand which permits measurement of penetration as a function of particle size. The Model 8140 is also a CNC based filtration test stand which provides a single penetration measurement for a fixed particle distribution aerosol challenge. A study was carried out measuring DOP penetration on a broad range of flat filtration media at various face velocities to compare these two instruments. The tests done on the CertiTest 8160 incorporated a range of particle sizes which encompassed the most penetrating particle size (MPPS).

In this paper we present a correlation between the MPPS penetration as measured by the CertiTest 8160 and the penetration values obtained on the Model 8140. We observed that at the lowest air face velocities of the study the Model 8140 tended to overpredict the MPPS penetration as measured by the CertiTest 8160. We also present a correlation of MPPS penetration with face velocity which may be of use for extrapolation purposes.

1. Introduction

It is a well-known phenomenon that the penetration of aerosol particles through a fibrous filtration medium is a sensitive function of the particle diameter, peaking at the most penetrating particle size (MPPS). Over the years there has been increasing emphasis by both filter element manufacturers and filter media manufacturers on measurement and specification of filter media penetration performance at the MPPS. Two recent documents that have referenced reporting the MPPS and its penetration at application velocity are IES-RP-021⁽¹⁾ and CEN/TC 195⁽²⁾. While this can readily be carried out using a flat sheet test stand such as the CertiTest 8160, it is a relatively slow, time-consuming process, requiring tests at a number of particle sizes. These tests are not suitable as real time quality control tools in a media manufacturing environment. An alternative is the use of a flat sheet test stand such as the Model 8140 which uses a fixed challenge aerosol having a mean particle size diameter of 0.18 micrometers and geometric standard deviation of 1.6. The test time of the 8140 is a fraction of the test time of the 8160. Thus, the first objective of this study was the comparison of the penetration performance reported by these two test instruments.

The "Holy Grail" of filtration is the simultaneous achievement of lower particle penetrations at lower filter resistance. This has led filter manufacturers to design elements operating at lower air face velocities relative to media area, with greater emphasis on measurement and specification of filter media penetration performance at these low velocities. This is again a challenge to the penetration measuring stands because the low face velocities frequently involve flow rates at the measurement limit of the equipment, and because the particle count rates require longer and longer sample times for statistical confidence. It would be desirable to measure penetration performance at higher face velocities and be able to extrapolate to the lower face velocities of interest. Thus the second objective of this study was the establishment of a correlation between MPPS penetration and face velocity which might be used for such an extrapolation.

2. Experimental

Two different flat sheet test stands were used for this study. The more sophisticated is the TSI CertiTest 8160⁽³⁾ which is shown schematically in Figure 1. A fine particle aerosol of dioctylphthalate (DOP) is generated by atomization and evaporation of a dilute solution of DOP in isopropyl alcohol. This aerosol then encounters an electrostatic classifier, which permits only a tunable monodisperse aerosol of the desired particle size to proceed to challenge the test media. Samples of aerosol are withdrawn upstream and downstream of the test media and fed to

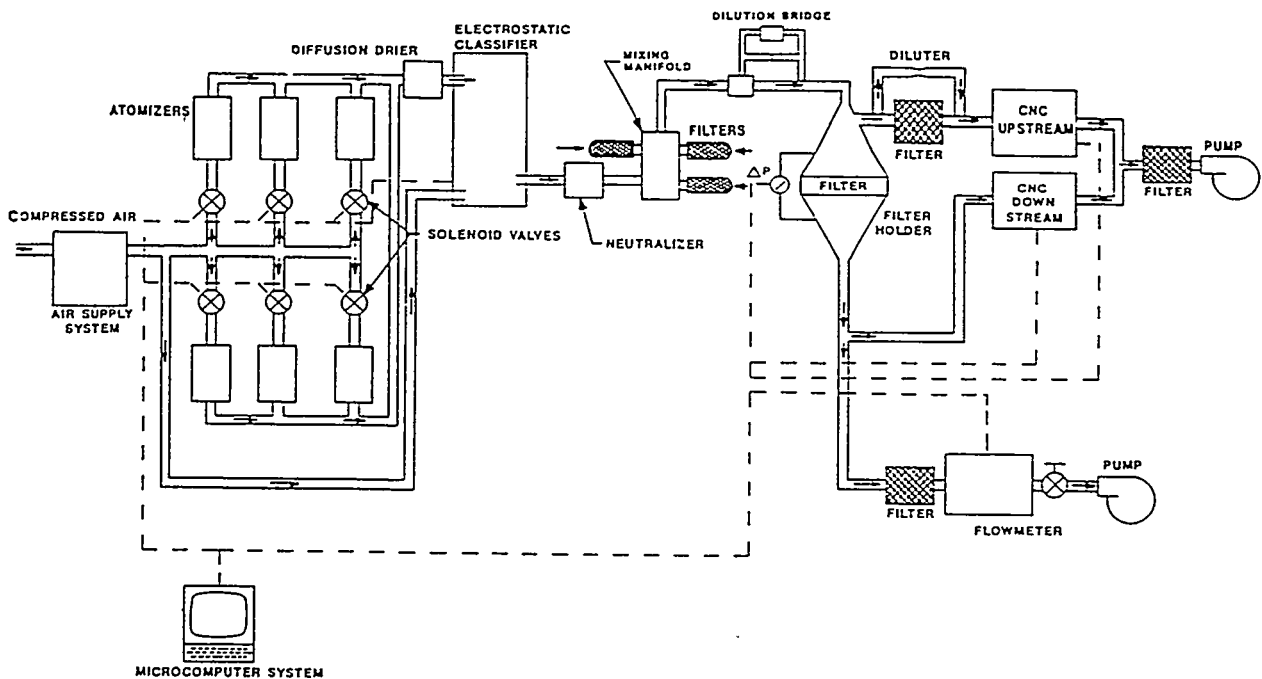


Figure 1.
Schematic of TSI Model 8160 Automated Filter Tester

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

separate CNC's for determination of the penetration for that particle size. To obtain a full curve of penetration for a range of particle sizes encompassing the maximum penetration, a series of particle sizes is selected and the individual penetration measurements are determined sequentially. With this equipment penetration can be reported to a precision of 10^{-8} percent over a particle size range from 0.015 to 0.40 micrometers at flow rates from 5 to 100 liters per minute.

The less sophisticated test stand is the TSI Model 8140, which is shown schematically in Figure 2⁽⁴⁾. This instrument generates a polydisperse aerosol of DOP by atomization. This aerosol then passes through a coarse fibrous prefilter intended to narrow the particle size distribution. The aerosol then proceeds to challenge the test media. Samples of the aerosol are withdrawn upstream and downstream of the test media and fed to CNC's for determination of penetration. With this equipment penetration can be reported to a precision of 10^{-7} percent at flow rates from 15 to 100 liters per minute.

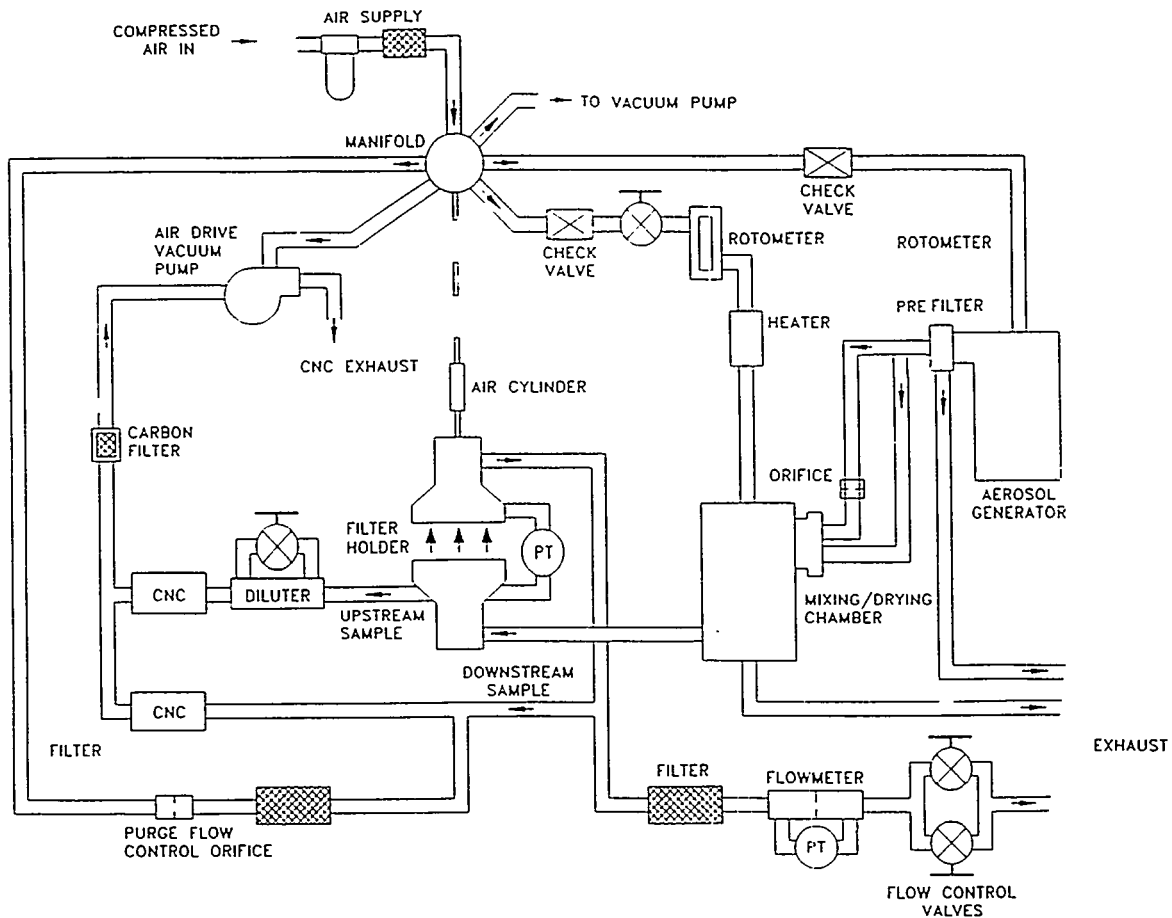


Figure 2.
Schematic of TSI Model 8140 Automated Filter Tester

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

With both instruments it is necessary to use purge times long enough to guarantee achievement of steady state, and sampling times long enough to provide satisfactory counting statistics. The normal sample area for both instruments is 100 cm², but on the 8140 we use a 333 cm² sample area for face velocities below 1.8 cm/sec in order to maintain flow rate accuracy.

Multiple samples of ULPA, HEPA, Sub-HEPA, and 95% DOP efficiency media were obtained. These were first tested in the 8160 using face velocities of 1.0, 1.2, 1.8, 2.5, 3.5, and 5.35 cm/sec for 0.075, 0.10, 0.12, 0.15, 0.18, 0.22, 0.26, 0.30, and 0.35 micrometer particle diameters. The same area of each sample was then retested at the same velocities using the 8140 tester. Each 8160 data set was subjected to regression analysis to fit the data to the model:

$$\ln(\text{Pen}) = A(\ln D)^2 + B(\ln D) + C \quad (1)$$

Where Pen = Penetration fraction

and D = Particle diameter

The MPPS is then easily determined by setting the derivative equal to zero, so that:

$$\ln(\text{MPPS}) = -B/2A \quad (2)$$

where MPPS = Most penetrating particle size

and substituting back into the model we get:

$$\ln(\text{Pen}_{\text{MPPS}}) = C - (B^2/4A) \quad (3)$$

3. Results and Discussion

Figures 3, 4, 5, and 6 are typical 8160 curves for the ULPA, HEPA, Sub-HEPA and 95% DOP efficiency media along with the 8140 results for the same samples. In general the quality of the fit to this simple model is quite good, with an average R² value of 0.98 for roughly 72 data sets of six points apiece. Thus the model provides a simple objective way of treating such a data set in order to abstract an MPPS value and a Pen_{MPPS} value.

It is clear from these graphs that the curves are tangent to or just below the 8140 lines shown. It is noted that at the lower test velocities the 8140 values tend to overpredict the 8160 MPPS values by an appreciable percentage. Since the particle size distribution in the 8140 is certainly not monodisperse, one would expect that the 8140 should give penetration values somewhat below the Pen_{MPPS}, but our experimental results do not confirm this. From a media specification point of view, however, the 8140 penetration is a conservative estimate of the MPPS penetration. Areas we suspect to be possible causes for these results are diluter

FIGURE 3
PENETRATION CURVES OF ULPA MEDIA

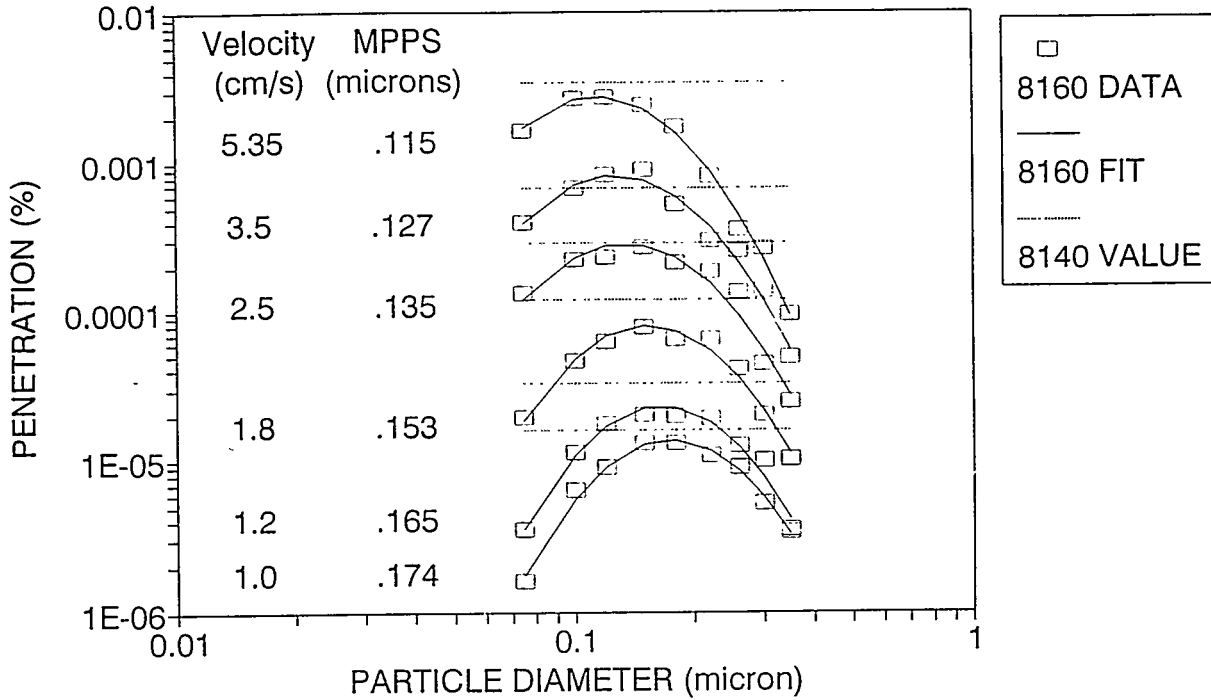


FIGURE 4
PENETRATION CURVES OF HEPA MEDIA

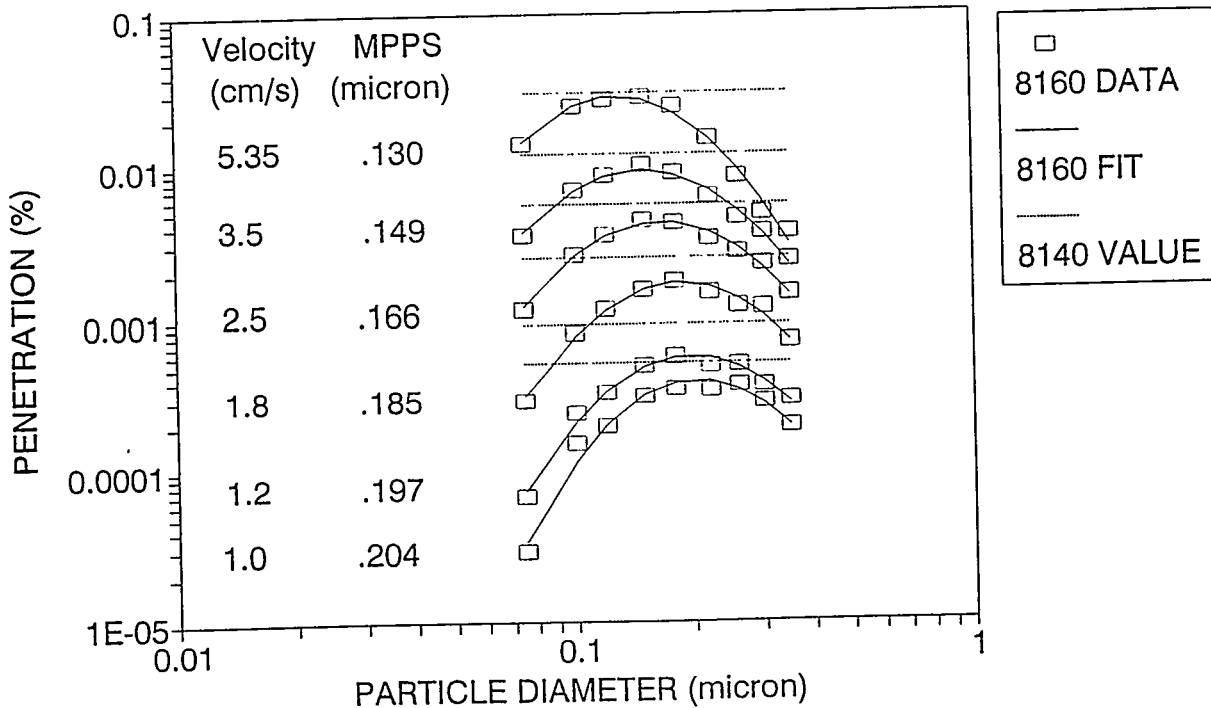


FIGURE 5
PENETRATION CURVES OF SUB-HEPA MEDIA


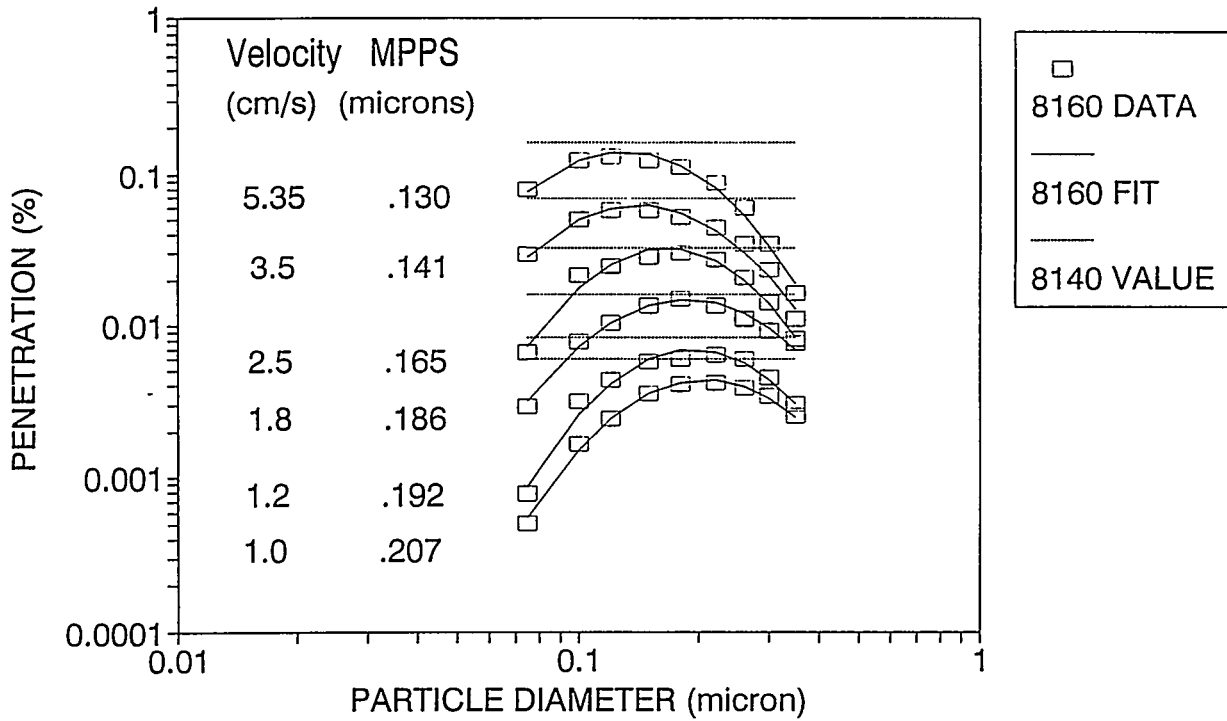


FIGURE 6
PENETRATION CURVES OF 95% DOP MEDIA

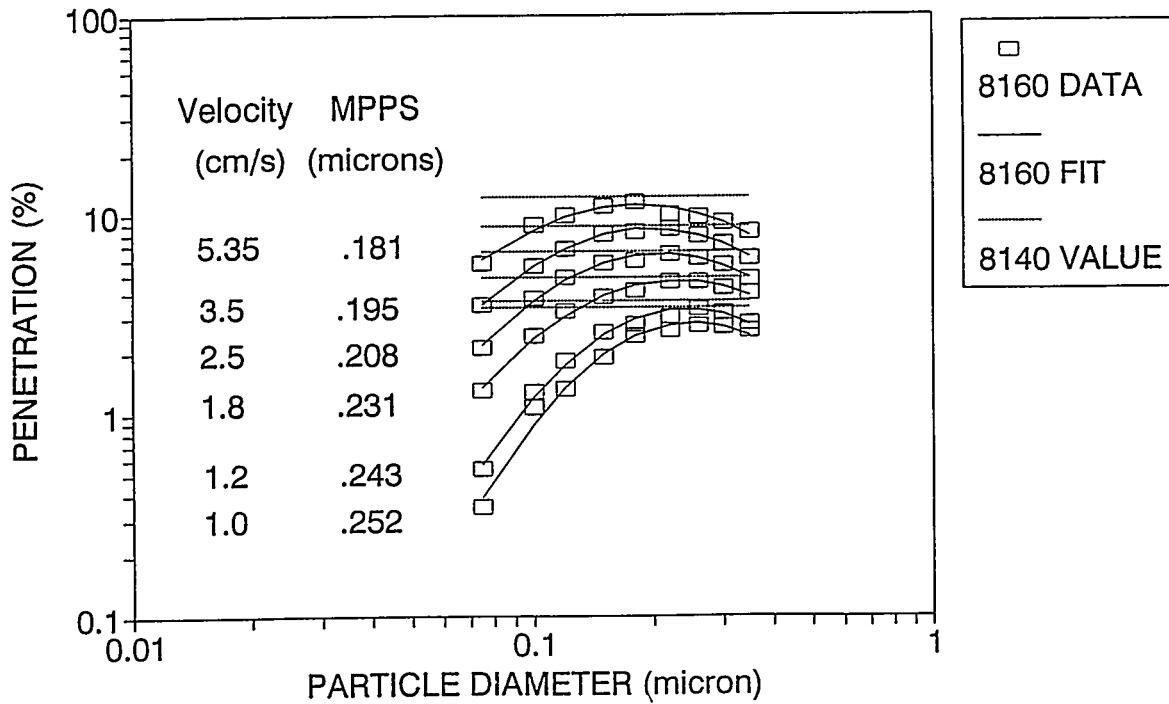

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

differences between the instruments, individual CNC response differences, adequate purge time at low velocity, and flow measurement precision at low velocity.

Figure 7 is a plot of Pen_{8140} values against Pen_{MPPS} values obtained from the fits to the 8160 data. Over seven orders of magnitude the two measures of penetration agree very well.

Since the 8140 gives penetration values that correlate so well with the MPPS penetration, a correlation of 8140 penetration with velocity would be useful. The 8140 data for each sample was fit to the power model for filter media penetration previously presented at this conference⁽⁵⁾:

$$\ln Pen = \ln Pen_r (V/V_r)^N \quad (4)$$

Where Pen = Penetration fraction at face velocity, V

and Pen_r = Penetration fraction on the same sample at the reference velocity, V_r

The R^2 values obtained from these regressions were all above 0.98. Figure 8 is a graph showing the velocity dependence of 8140 penetration for the typical media samples shown earlier. The ULPA, HEPA, and Sub-HEPA curves are parallel having N values equal to -0.24. The 95% DOP media is different, however, having a slope of -0.28.

The determination of the N value for a filter medium or filter media family allows for measurement of penetration at a reference velocity within reasonable operating parameters of the test equipment and estimation of the penetration at the low application velocities which will be encountered.

Conclusions

A comparison of the penetration performance values between the TSI CertiTest 8160 and the TSI Model 8140 has shown that the penetration value obtained from the 8140 correlates very well to the MPPS penetration obtained from the 8160 penetration curve for penetrations spanning several orders of magnitude.

The 8140 penetration is related to face velocity by a power law model. This can be a useful tool for specifying media penetration performance at reasonable test equipment operating parameters.

FIGURE 7
8140 PENETRATION VS MPPS PENETRATION


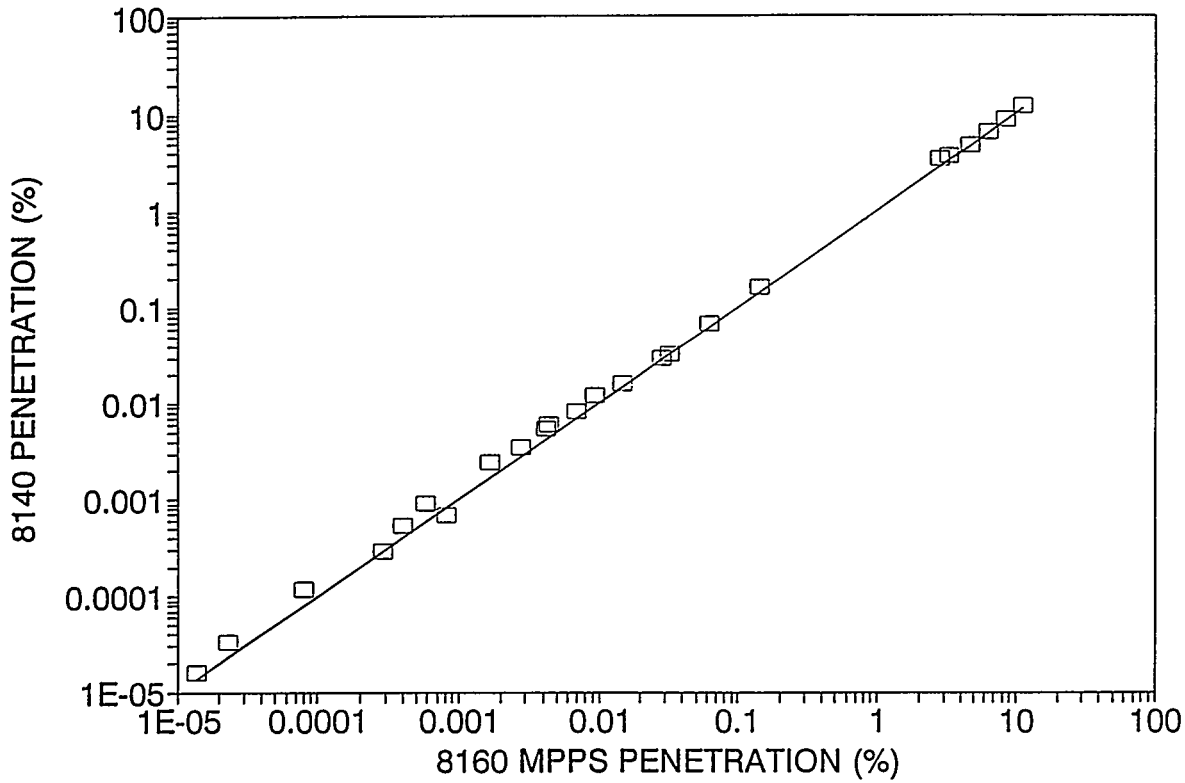


FIGURE 8
EFFECT OF VELOCITY ON PENETRATION

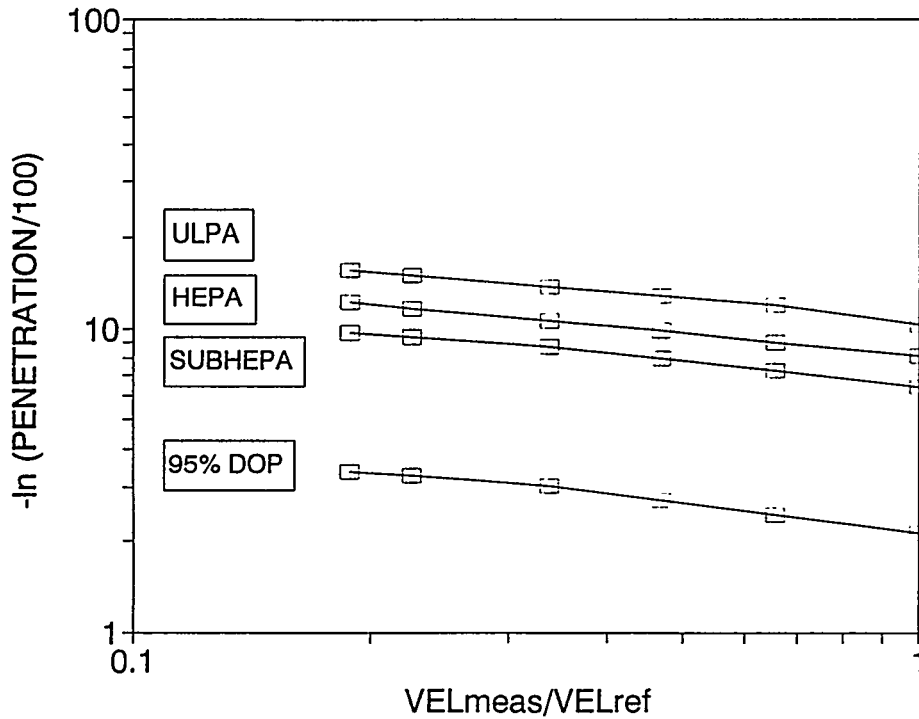

Bibliography

- (1) IES-RP-CC021.1, "Testing HEPA and ULPA Filter Media", 1993. Institute of Environmental Sciences, 940 East Northwest Highway, Mount Prospect, IL 60056.
- (2) CEN/TC 195/WG 1/N 023, "Final Draft Specifications for Particulate Air Filters for General Ventilation", 1991. Institute Belge de Normalisation, C/o INIEX-ISSEP - Division de Colfontaine, Sec. of CEN/TC 195/WG-1 - rue Grande, 60 - B-7340 Colfontaine, Belgium.
- (3) TSI Incorporated, 500 Cardigan Road, St. Paul, MN, "CertiTest Model 8160 Automated Filter Tester Operation and Service Manual", 1993.
- (4) TSI Incorporated, 500 Cardigan Road, St. Paul, MN, "Model 8140 Automated Filter Tester Operation and Service Manual", 1992.
- (5) Pierce, M., Guimond, R., Lifshutz, N. "A General Correlation of DOP Penetration With Face Velocity as a Function of Particle Size Using the FTS-200", CONF-880822, pp. 973-982, Proceedings of the 20th DOE/NRC Nuclear Air Cleaning Conference, Boston, MA (1988).

DISCUSSION

SCRIPSICK: How does the particle size at maximum penetration and the penetration curve compare to theory? Did you look at that? We have seen that theory predicts much greater slope values than measurements on filters.

PIERCE: We have not compared our laboratory flat sheet results to any computer models of what the theoretical penetration would be. As a general comment, we have observed that the theoretical penetration curves tend to have steeper slopes on either side of the most penetrating particle size than test data.

DYMENT: Please comment on the relationship between the MPPS and efficiency of the different media which you chose to use.

PIERCE: Theory dictates that as face velocity is decreased, penetration will increase and the most penetrating particle size will increase. I believe this is because diffusional effects are more pronounced and inertial effects are less pronounced at lower and lower velocities, so that larger particles become more penetrating. Also, it is generally observed that as efficiency between media samples is reduced, effectively increasing the mean fiber diameter within the media samples, the MPPS increases.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FURTHER DEVELOPMENT OF THE CLEANABLE STEEL HEPA FILTER, COST/BENEFIT ANALYSIS, AND COMPARISON WITH COMPETING TECHNOLOGIES*

by

W. Bergman, G. Larsen¹, R. Lopez, K. Wilson, C. Witherell and M. McGregor
Lawrence Livermore National Laboratory
Livermore, CA 94550

ABSTRACT

We have made further progress in developing a cleanable steel fiber HEPA filter. We fabricated a pleated cylindrical cartridge using commercially available steel fiber media that is made with 1 μm stainless steel fibers and sintered into a sheet form. Test results at the Department of Energy (DOE) Filter Test Station at Oak Ridge show the prototype filter cartridge has 99.99% efficiency for 0.3 μm dioctyl phthalate (DOP) aerosols and a pressure drop of 1.5 inches. Filter loading and cleaning tests using AC Fine dust showed the filter could be repeatedly cleaned using reverse air pulses. Our analysis of commercially optimized filters suggest that cleanable steel HEPA filters need to be made from steel fibers less than 1 μm , and preferably 0.5 μm , to meet the standard HEPA filter requirements in production units.

We have demonstrated that 0.5 μm steel fibers can be produced using the fiber bundling and drawing process. The 0.5 μm steel fibers are then sintered into small filter samples and tested for efficiency and pressure drop. Test results on the sample showed a penetration of 0.0015 % at 0.3 μm and a pressure drop of 1.15 inches at 6.9 ft/min (3.5 cm/s) velocity. Based on these results, steel fiber media can easily meet the requirements of 0.03 % penetration and 1.0 inch of pressure drop by using less fibers in the media.

A cost analysis of the cleanable steel HEPA filter shows that, although the steel HEPA filter costs much more than the standard glass fiber HEPA filter, it has the potential to be very cost effective because of the high disposal costs of contaminated HEPA filters. We estimate that the steel HEPA filter will save an average of \$16,000 over its 30 year life. The additional savings from the clean-up costs resulting from ruptured glass HEPA filters during accidents was not included but makes the steel HEPA filter even more cost effective.

¹ Present address: Kennerley-Spratling, Inc., 2116 Farallon Dr., San Leandro, CA 94577-6694

*This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under contract no. W-7405-ENG.45 and is based on the reports cited as references 1 and 2.

We also present the results of our evaluation of competing technologies with metallic and ceramic powder filters, ceramic fiber filters, and reinforced glass fiber filters. In general, the metallic and ceramic powder filters have pressure drops in excess of 25 inches of water for HEPA grade efficiencies and are therefore not viable candidates. The ceramic fiber filters cannot meet the HEPA efficiency because the fiber diameters are too large. The reinforced glass fiber filter is a promising candidate for the cleanable HEPA filter but requires additional development and testing to confirm its potential to be repeatedly cleaned.

This report is based upon material extracted from a DOE technical review of the Mixed Waste Integrated Program and from the final report of a systems analysis of cleanable steel HEPA filters.^(1,2)

I. Introduction

Cleanable steel filters have been used for many years by various industries, including the nuclear industry, to provide high efficiency filtration with minimal maintenance. These filters were made from steel powder that was sintered together and formed into a hollow cylinder. Compressed air pulses were directed into the interior of the cylinder to dislodge particle deposits that had formed on the outside of the cylinder. Figure 1 illustrates the basic concept of the cleanable steel filter having multiple filter elements in a single housing, a blow-back gas for cleaning, and a hopper for collecting the particles.

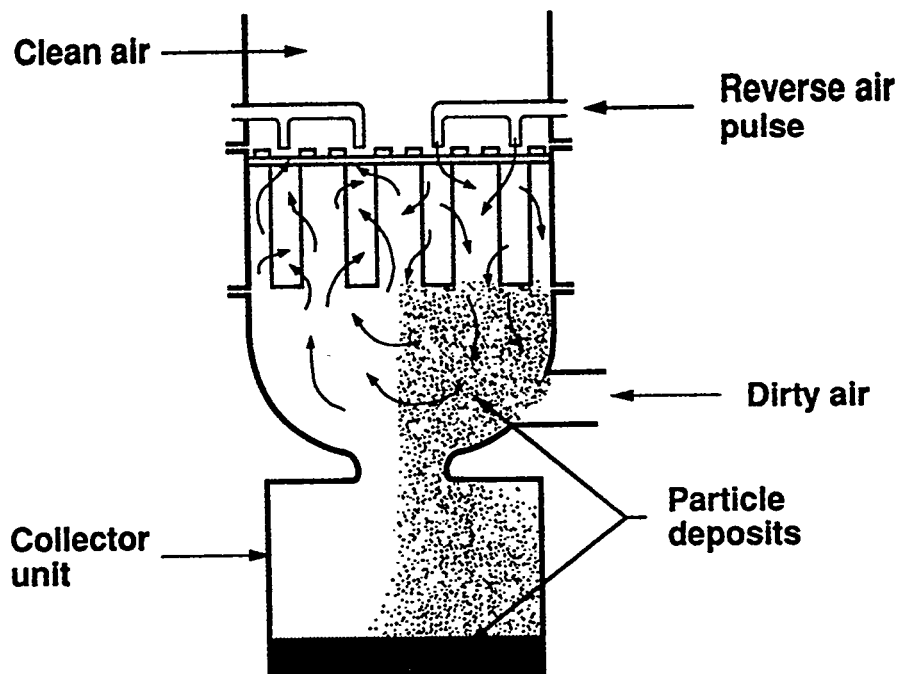


Figure 1. Typical cleanable filter with multiple cartridges and a blow-back cleaning apparatus.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The cleanable filter shown in Figure 1 is a well established design used with many other filter elements such as cloth bags, ceramic tubes, and polymeric tubes. Design variations include other filter shapes than cylinders such bayonets, stacked plates, hollow panels, etc. All filter elements have an exterior surface for collecting the deposited particles and an interior volume through which the cleaned gas exits and through which a blow-back gas is used to dislodge the deposited particles.

The applications for these filters range from recovery of catalysts in petroleum refineries to off-gas filtration in incinerators. Rocky Flats had used sintered metal filters to remove the suspended particulate from a fluidized bed incinerator that burned transuranic waste contaminated with plutonium.⁽³⁾ The sintered metal filters were repeatedly cleaned by reverse air pulses. Kirstein et al also showed that sintered metal filters had excellent performance in both removal efficiency and reverse air-pulse cleaning for applications in another incinerator.⁽⁴⁾ The filters are robust and require minimal maintenance. Despite the excellent performance of the sintered metal filters, they only had about 60% DOP efficiency when clean and had relatively high pressure drops.⁽⁵⁾

In the early 1980s, researchers in Europe had developed high efficiency air filters using the new filter media from Bekaert that was made from 2 μm steel fibers. Dillmann et al described the use of 2 μm stainless steel fibers to make deep bed filters for use as vent filters in nuclear power reactors.^(6,7) The deep bed filters had efficiencies comparable to the glass HEPA filters but were much larger and could not be cleaned. Klein and Goossens showed major improvements in filter efficiency with decreasing diameter of the steel fibers from 12 to 4 μm .⁽⁸⁾ However, the efficiencies were far below HEPA grade. They also showed that deposits of methylene blue aerosols could be efficiently cleaned from a cylindrical filter by washing with a water spray.

By the late 1980's, Pall Corp. had developed cylindrical filter elements using steel media having separate layers of sintered steel fibers and sintered steel powder. Randhahn et al described a stainless steel filter from Pall Corp.⁽⁹⁾ that had efficiencies comparable to a HEPA filter, but they did not report any pressure drops. The filter consisted of two layers of 5 μm fiber media and one layer of fine powder metal. Our tests showed that the filter had a pressure drop of 2.2 psi (61 inches of water) at 13 cfm, which corresponds to 1,000 cfm through a standard size HEPA filter.⁽¹⁰⁾ A variation of the Pall filter with lower pressure drop and lower efficiency was installed as a prefilter in all of the French nuclear power plants.⁽¹¹⁾

In 1990 Bergman et al showed that by eliminating the use of steel powder and using the smallest available steel fibers, filters could be made that had the same efficiency as a HEPA filter and a pressure drop only three times as great.⁽¹²⁾ Bergman then used this new filter to begin developing a cleanable steel HEPA filter.⁽¹³⁾

Two designs of the cleanable steel HEPA filter have been developed to date: an assembly of multiple cartridges housed in a standard 2' x 2' x 1' frame and multiple cartridges housed in a pressure vessel. We developed the basic design

parameters for the steel filter that can be retrofitted into the standard HEPA housing.⁽¹⁴⁾ This filter design consists of 64 individual filter cartridges housed in a standard HEPA filter frame of 2' x 2' x 1'. We were only able to use 150 ft² of media in the filter instead of the minimum 200 ft² found in glass HEPA filters. This limitation was due to the cylindrical cartridge design, that prevented more media from being used. The cleanable steel filter, shown in Figure 2, consists of 64 cartridges assembled into the HEPA filter housing.

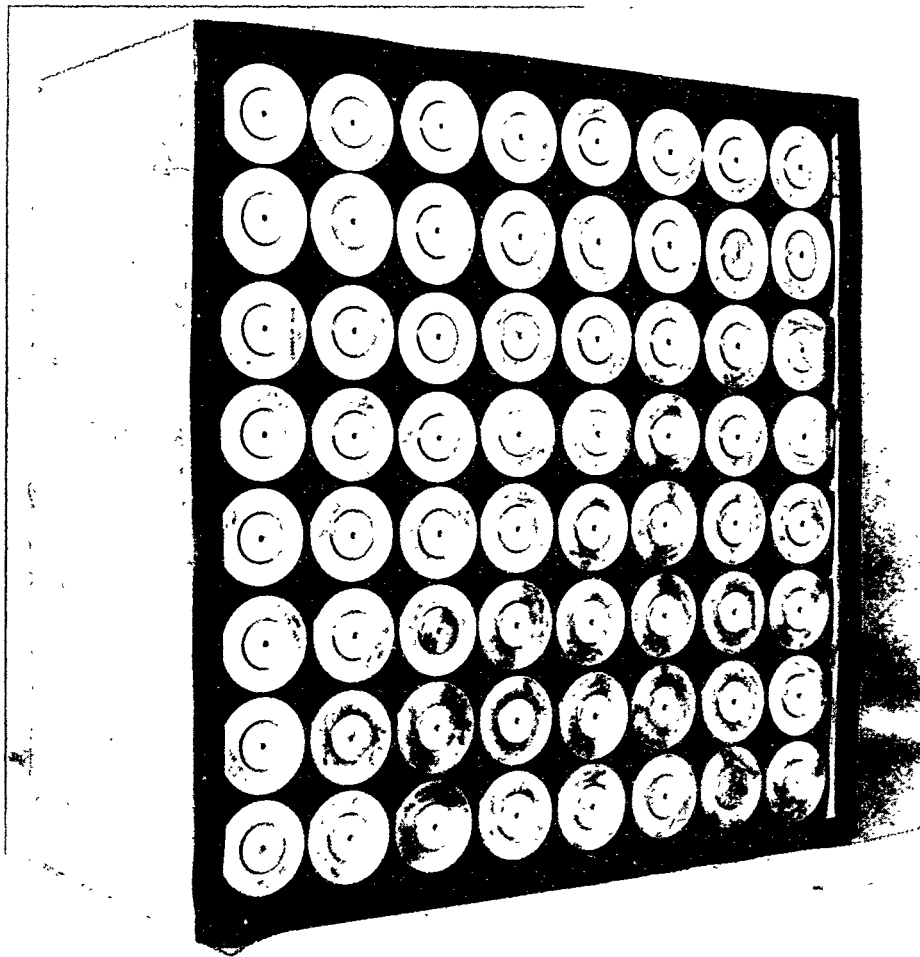


Figure 2 Photograph of the assembled cleanable steel filter using the flat panel design with 64 cartridges

We made two cleanable steel filters like that shown in Figure 2 using filter cartridges from Pall Corporation and Memtec Corporation and evaluated their performance.⁽¹⁴⁾ The filter media used to make the filter cartridges was made from 2 μ m steel fibers sintered into sheets and pleated to increase the surface area. Both filters met the required 0.03 % DOP penetration, but had a pressure drop of 3 inches and weighed over 200 pounds. After a successful laboratory demonstration

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

that the filters could be repeatedly cleaned by reverse air pulses and reused, both filter units were evaluated in the exhaust stream of a uranium oxide grit blaster at the Y-12 Plant in Oak Ridge, TN.⁽¹⁵⁾ The field evaluation was not completed because water accumulation in the exhaust system caused excessive pressure drop and interfered with the filter cleaning studies.⁽¹⁵⁾ Since additional funds were not available to dry the wet exhaust, the field evaluation was prematurely terminated.

In addition to the panel filter design shown in Figure 2, the cleanable steel filter can be designed as a pressure vessel for use in applications that do not require retrofitting into existing housings. Pall Corp. has built several units in which multiple cartridges are housed inside a pressure vessel as shown in Figure 3. This is the design that was to be used in the vitrification plant at Hanford.^(16,17) The filter in Figure 3 is cleaned using a reverse water flush. Tests by Pall using Arizona road dust show that fully loaded filters can be efficiently cleaned using the water wash.^(18,19)

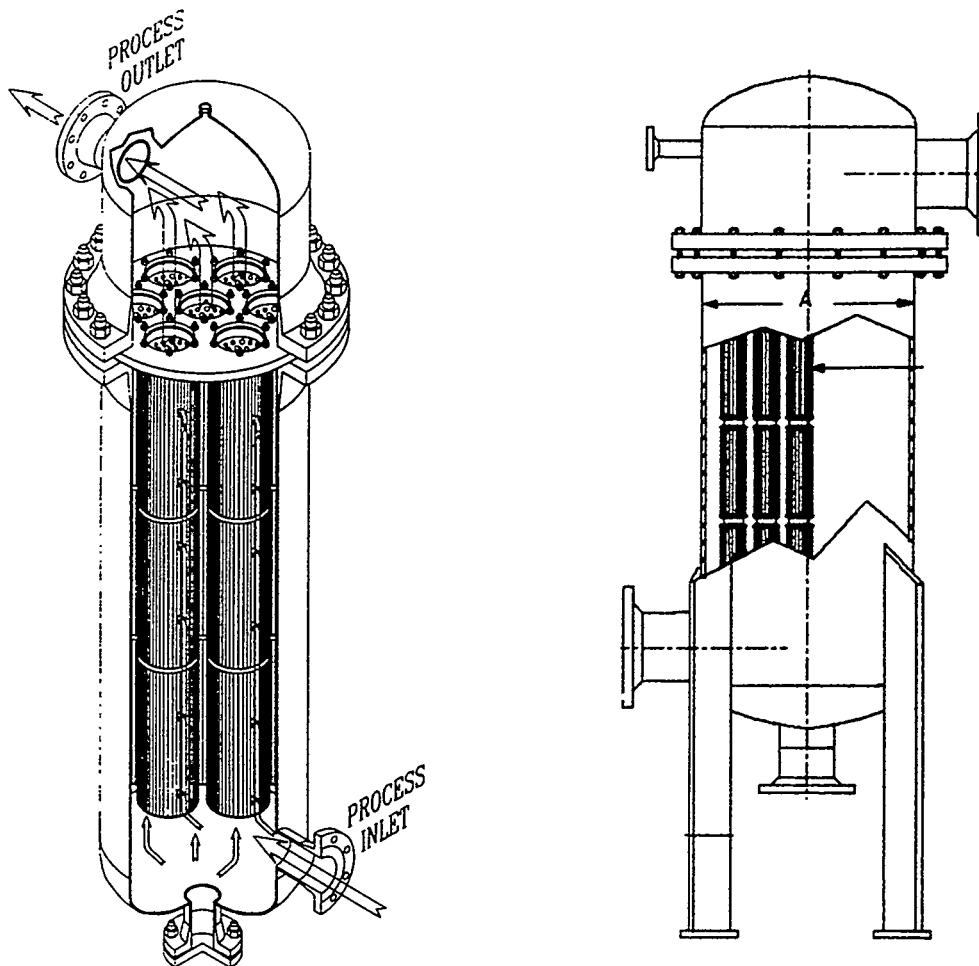


Figure 3. Drawing and schematic of the cleanable steel filter with filter cartridges housed in a pressure vessel.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Neither of the two steel HEPA designs shown in Figures 2 and 3 have been accepted by the nuclear industry as replacement for the glass HEPA filter. The cleanable steel filter shown in Figure 2, which is designed for both new and retrofit applications, has the overall dimensions of a standard glass HEPA filter, but has an unacceptable high pressure drop and weighs too much. Installing more powerful blowers to overcome the high resistance is not acceptable because of the extra cost and the misbalance introduced into existing building and system ventilation systems. In addition, special lifting and positioning equipment would be needed to install and remove the 200 pound filters. In our field demonstration of the cleanable filter, we built a specially designed alignment table and mounted it on a scissors lift in order to install the steel filter.⁽¹⁵⁾ Unfortunately, this type of equipment could not be used in most existing HEPA filtration systems due to space limitations. The high pressure drop, high weight and special lifting equipment are only a problem in existing filtration systems and not in future systems that can be designed to accommodate the special requirements.

The pressure vessel design in Figure 3, which is intended for new filtration systems, also has high pressure drop, high weight and requires special lifting equipment. This design had been selected for use in a waste vitrification plant at Hanford prior to the cancellation of the plant.^(16,17) The pressure vessel design was selected over a deep-bed sand filter for that application.⁽¹⁶⁾ The initial cost of the steel HEPA filter was also less than the cost for the deep bed sand filter. However, both the steel HEPA and the sand filters cost far more than the conventional HEPA filter.

Another major reason why steel HEPA filters are not selected over glass HEPA filters in the nuclear industry is their high cost. The current steel HEPA filter shown in Figure 2 costs about \$70,000 compared to \$300 for the glass HEPA filter.⁽²⁰⁾ The cost for the pressure vessel design shown in Figure 3 is estimated at \$109,000.⁽²⁰⁾ These costs are for current prototype steel HEPA filters. We have estimated that the cost of the panel filter in Figure 2 could be reduced to \$5,000 with further development and with production efficiencies.⁽¹⁴⁾

Despite the much higher costs for the steel HEPA filters compared to the glass HEPA filters, the high cost of disposing of contaminated HEPA filters made the steel HEPA filters appear economically attractive. Our previous cost analysis shows that a \$5,000 steel filter would save \$54,000 over its life compared to glass HEPA filters.⁽¹⁴⁾ This cost saving is due to the average cost of \$4,450 for handling and disposing of glass HEPA filters.⁽²¹⁾ Implicit in the cost estimate was that the glass filter had a 3 year life while the steel HEPA filter had a 45 year life.⁽¹⁴⁾ If the assumptions were significantly in error, then the potential cost savings could disappear. Although no additional data on the assumptions was available since our last estimate, we have performed a sensitivity analysis of the potential cost savings as a function of the assumed input parameters.⁽²⁾ That analysis, which will be summarized in this report, shows that the cleanable steel HEPA filter is still cost effective under a wide range of assumptions.⁽²⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

In order to overcome the identified deficiencies in performance and the high cost, further development of the steel HEPA filter is required before it can replace the glass HEPA filter. We will summarize the recent developments of the cleanable steel fiber HEPA filter and compare the performance with competing technologies.

II. Reduction in Pressure Drop Achieved With Smaller Diameter Fibers

The most important parameter that controls the efficiency and pressure drop of fibrous filters is the diameter of the fibers used in the filter medium. To illustrate this point, we have plotted the minimum efficiency and the filter pressure drop in Figure 4 for typical commercial glass fiber filters as a function of the average fiber diameter used in the filter media. The minimum efficiency, pressure drop and fiber diameter for each of the filters identified in Figure 4 represent typical values for each class of filter. The filters are normalized to the same dimensions (2' x 2' x 1') and flow rate (1,000 cfm). As seen in Figure 4, the efficiency increases much faster than the pressure drop with decreasing fiber diameter. Since the filters used to generate the curve in Figure 4 represent typical commercial products, we assume that the filters have been optimized to maximize the efficiency and minimize the pressure drop. Thus filter media with smaller diameter fibers are needed for higher efficiency filters.

Using Figure 4, we can illustrate that reducing the fiber diameter is more effective than alternative approaches such as increasing the amount of fibers or the thickness of the media to obtain filters with the desired efficiency and pressure drop. For a filter medium having a fixed fiber diameter, higher efficiencies are obtained by adding more layers of media. For example two layers of a 95% efficient ASHRAE filter with 1 μm fiber media will yield a filter with a combined efficiency of 99.75% ($E = 1 - (1 - 0.95)(1 - 0.95) = 0.9975$). The pressure drop for the combined layers is twice the single layer (0.5 inch), or 1.0 inch. Alternatively, Figure 4 shows that by using a filter media with 0.7 μm diameter fibers, we can reach the same efficiency but only have a pressure drop of 0.7 inches.

We applied the principle of reducing the fiber diameter to improve the performance of the steel filters. The commercially available steel filters shown in Figure 2 meet the HEPA filter efficiency requirement but have a pressure drop of 3 inches of water. In order to reduce the pressure drop to the required 1 inch, the steel fiber media must be made from fibers having diameters about 0.5 μm instead of the present 2.0 μm diameter.

We have fabricated and tested a filter cartridge element using steel media obtained from Tomeogawa Inc. that was made from 1 μm diameter, 316L stainless steel fibers.^(1,22,23) An electron micrograph of the sintered media sheet is shown in Figure 5. Tests on the flat sheet are shown in Figure 6 where the penetration is plotted as a function of particle diameter. The face velocity is 3.5 cm/s, which corresponds to the velocity that would be obtained with 150 ft² of media in a full

scale filter. Figure 6 shows that the 1 μm media has a penetration of 0.004% at 0.3 μm aerosol diameter and a pressure drop of 1.05 inches. Thus, the 1 μm media represents the threshold for achieving HEPA filter performance.

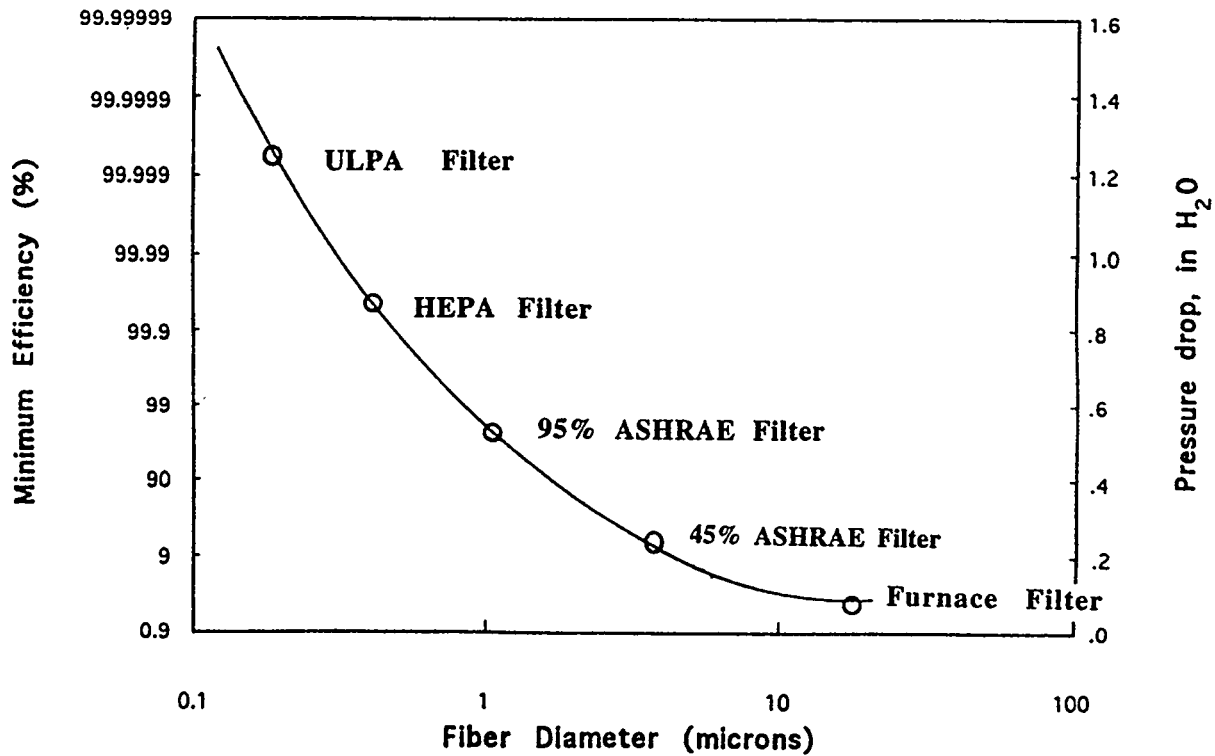


Figure 4. Relationship between the minimum efficiency, pressure drop and fiber diameter in commercial filters.

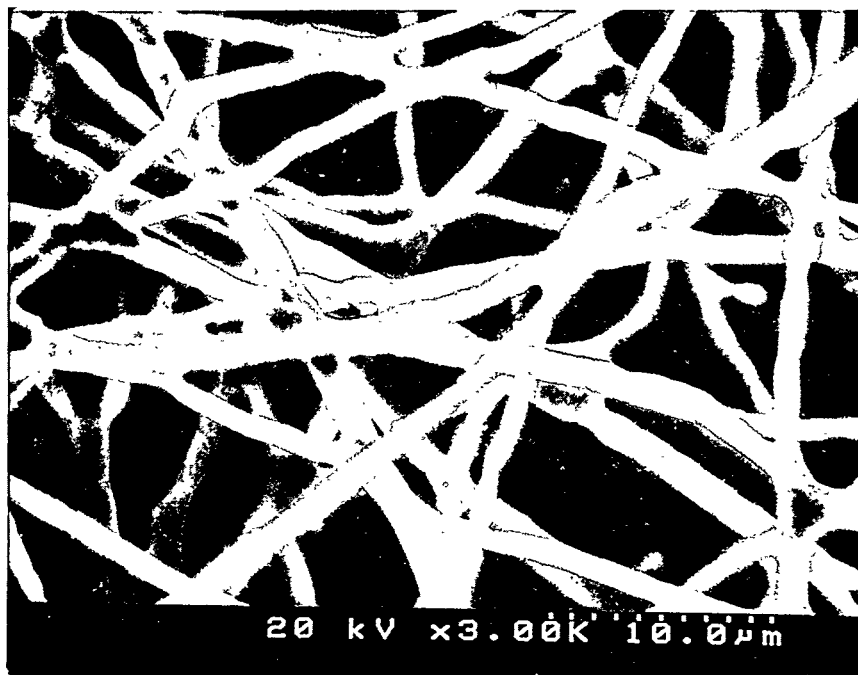


Figure 5. Electron micrograph of Tomeogawa steel fiber media made from 1 μm diameter, 316L stainless steel fibers.⁽²³⁾

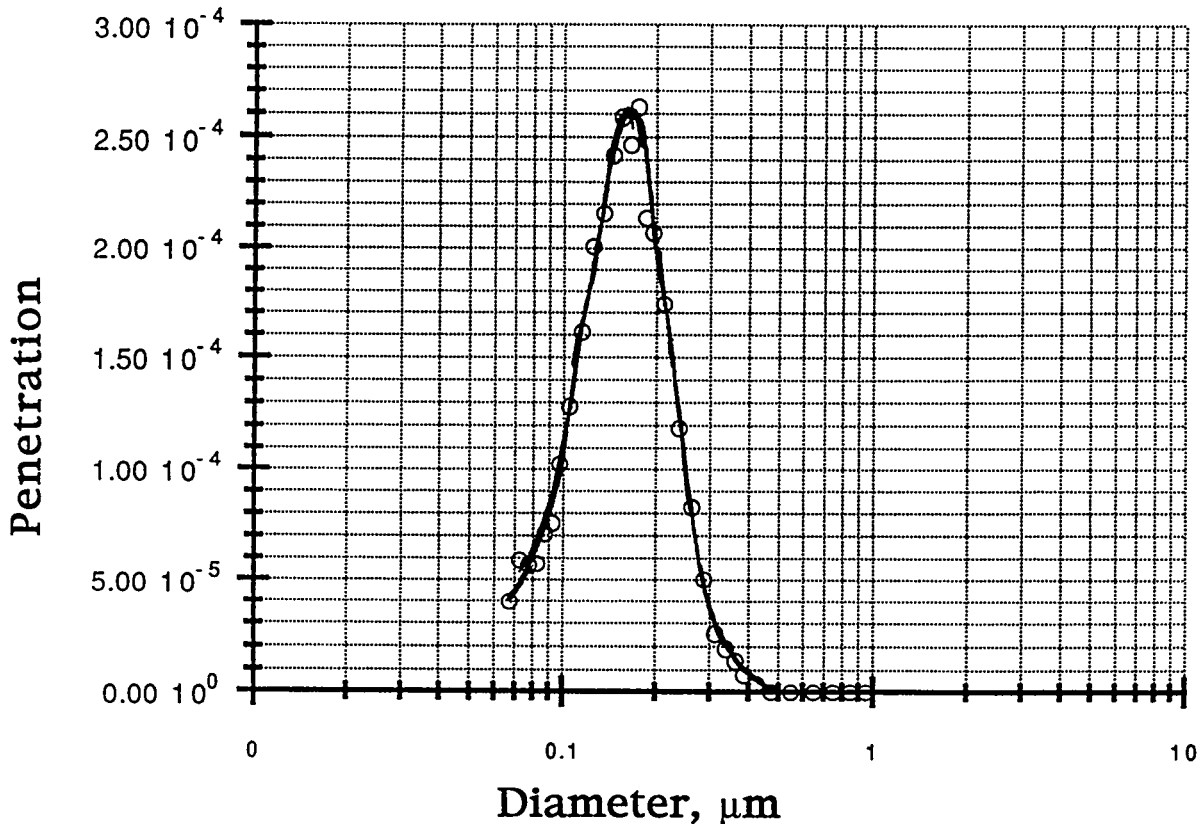


Figure 6. Penetration of DOS aerosols through 1 μm fiber media from Tomeogawa at 3.5 cm/s. Pressure drop was 1.05 inches.

The filter cartridge, shown in Figure 7, was made by sandwiching the media between support screens, pleating the composite layers, welding the composite sheet ends to form a pleated cylinder, and sealing the two, pleated, cylindrical ends in a potting compound. The pleated, cylindrical ends also could have been sealed by brazing to end caps. We used the test method and apparatus described in our previous report to evaluate the filter cartridge at 15.6 cfm to correspond to a full-scale HEPA filter.⁽¹⁴⁾ Figure 8 shows the penetration of dioctyl sebacate (DOS) aerosols as a function of aerosol diameter. Although the penetration at 0.3 μm diameter is satisfactory at 0.002%, the pressure drop is 1.5 inches of water and exceeds the maximum allowable 1 inch. The major reason for the higher pressure drop in the cartridge than in the filter media shown in Figure 6 is the variability in the media properties. The cartridge in Figures 7 and 8 was made from a different media batch having 50% higher pressure drop than the media in Figure 6. This variation was due to the small sample size in the media production and should not occur with larger samples. Thus, we have approached the threshold for achieving a HEPA filter using 1 μm media. Steel media having fiber diameters less than 1 μm is needed for making steel HEPA filters with production variability.

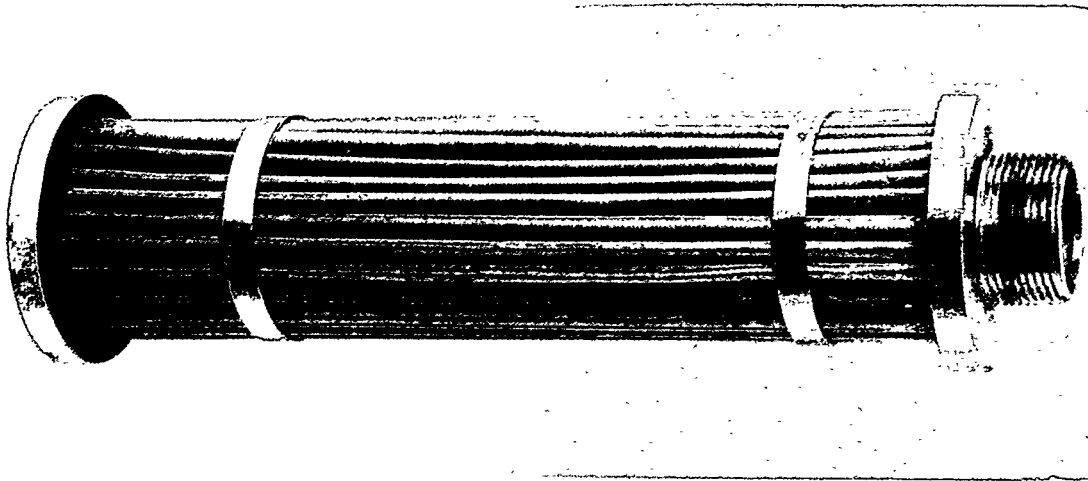


Figure 7. Pleated filter cartridge made from 1 μm steel fiber media.

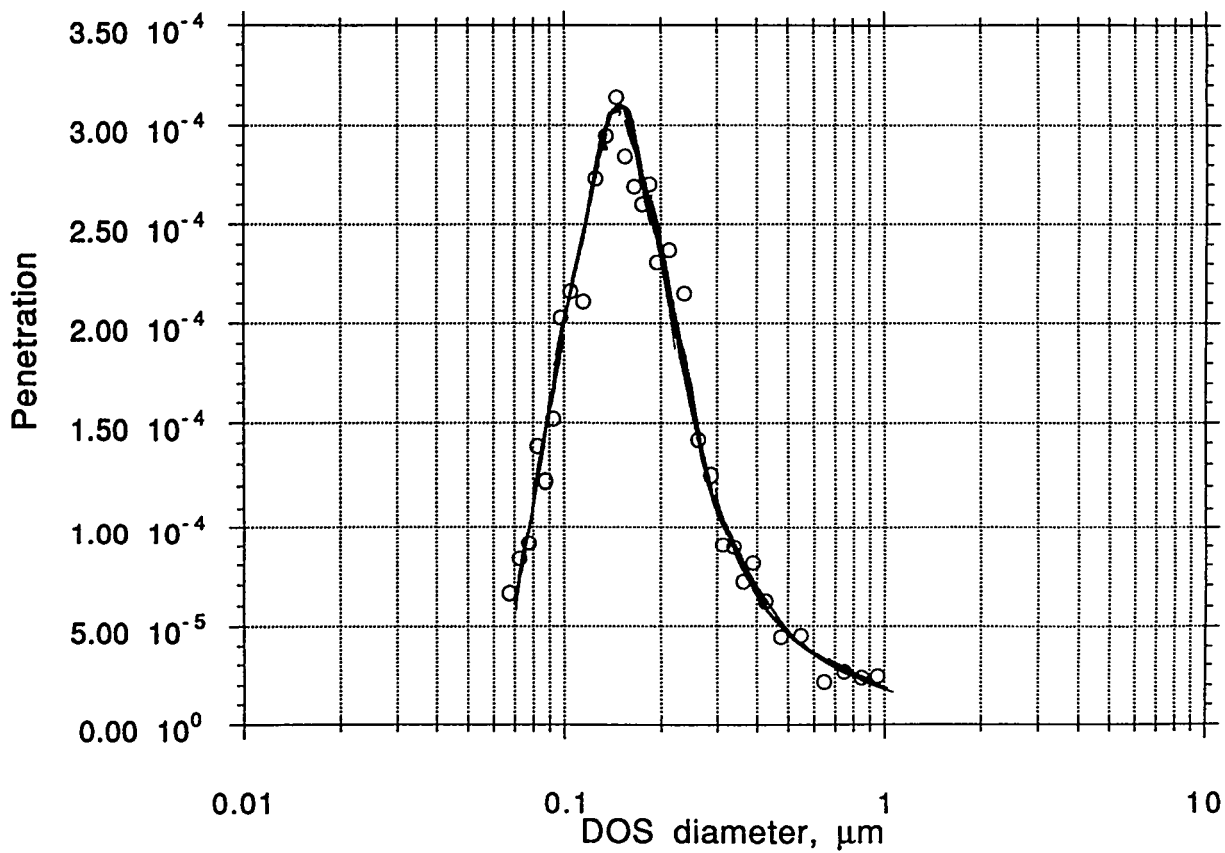


Figure 8. Aerosol penetration through filter cartridge shown in Figure 7 as a function of aerosol diameter. Pressure drop is 1.5 inches at 15.6 cfm flow.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Since the ability to clean and reuse the steel HEPA filter is an important property of the cleanable steel HEPA filter, we conducted a series of filter clogging and cleaning tests on the filter cartridge shown in Figure 7. We used AC Fine dust (Powder Technology Inc, Burnsville, MN) to load the filter and compressed air pulses to remove the particle deposits. The test system is described in our previous publication.⁽¹⁴⁾ Figure 9 shows the results of loading and cleaning the filter cartridge 10 times. The test shows that the filter can be repeatedly cleaned and reused. Note that there is a small increase in the baseline pressure from 1.5 to 2.0 inches up to the fifth cleaning. Beyond that point the residual deposits in the filter remain constant.

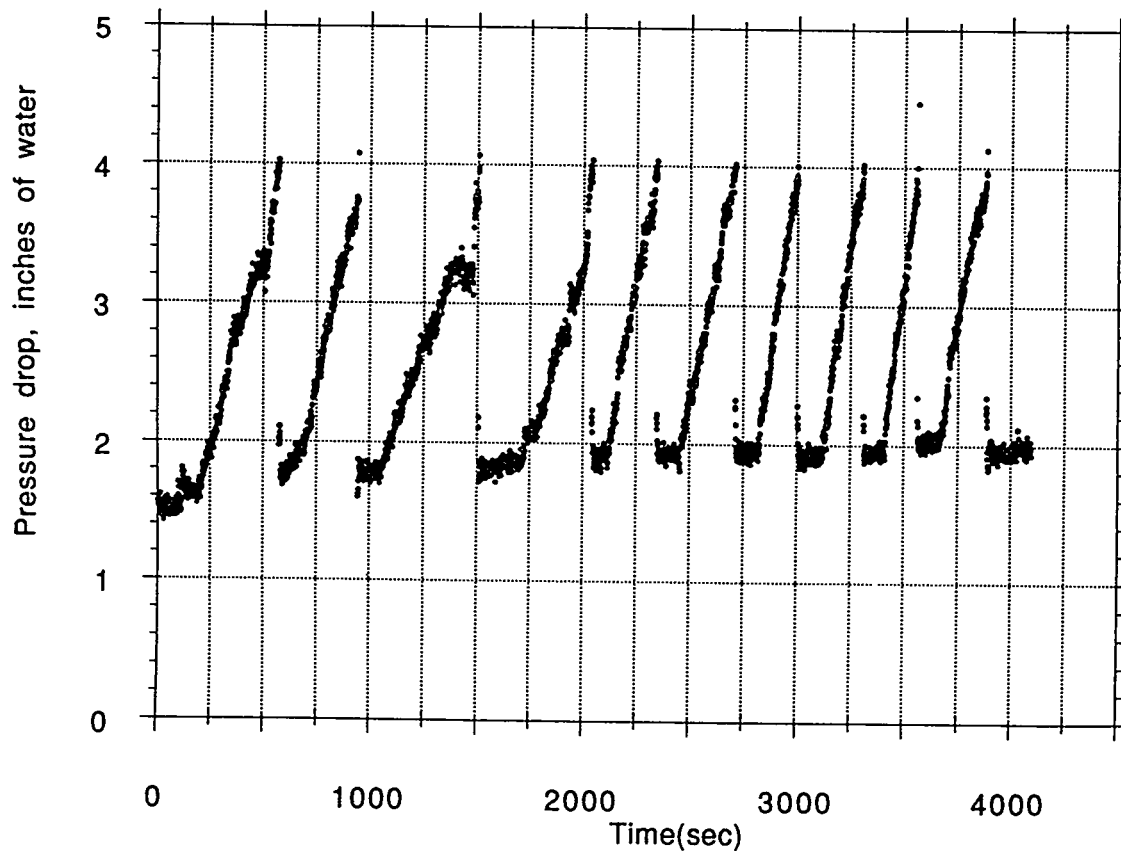


Figure 9. Filter loading and cleaning cycles using AC Fine test dust and compressed air pulses on the filter cartridge in Figure 7.

Since there are no commercial sources that can make 0.5 μm steel fibers, we used fundamental laboratory techniques based on the wire bundling and drawing process to make a small quantity of these steel fibers. The process, which is extremely labor intensive and not suitable for prototype development, involves a series of repetitive steps in which wires are bundled together into a rod and then reduced in diameter by drawing through progressively smaller dies. The starting point is a stainless steel rod that is snugly fitted inside a copper tube. We then reduced the diameter of the rod by swaging until the resulting rod could be drawn through a standard wire drawer for further size reduction. The wire drawing process was periodically interrupted to heat treat the rod to reduce the hardness induced by the drawing process. The reduced wire was then cut into fixed lengths which were then inserted into a new copper tube and the process repeated. Figure 10 shows a rod consisting of a bundle of wires being reduced in diameter through progressively smaller dies. The individual wires have a copper coating from the initial cladding operation to prevent sticking to the other wires. Figure 11 shows a cross section of the rods, starting with the original rod and going through the first, second and nth bundling. When the desired fiber diameter is reached, the copper cladding is dissolved in nitric acid and the fibers dispersed.

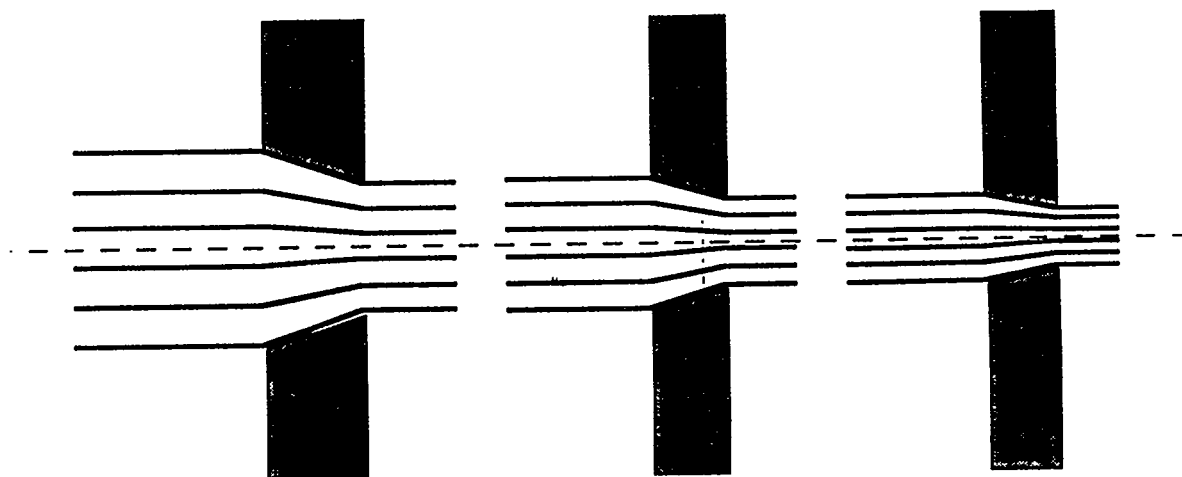


Figure 10. Wire drawing is used to produce smaller diameter steel fibers.

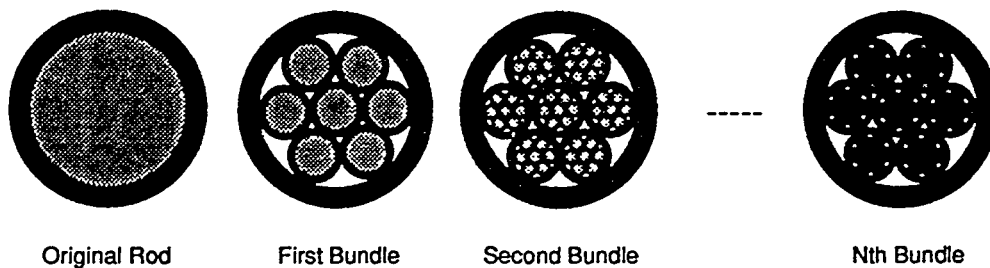


Figure 11. Cross section of steel rods from the original to increasing iterations of bundling and drawing

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We then made a small sample of stainless steel fiber media from the 0.5 μm steel fibers using the paper making process followed by sintering.⁽¹⁾ Figure 12 shows an electron micrograph of the media. Laboratory tests at 3.5 cm/s face velocity yielded an efficiency of 99.998% for 0.3 μm dioctyl sebacate (DOS) aerosols.

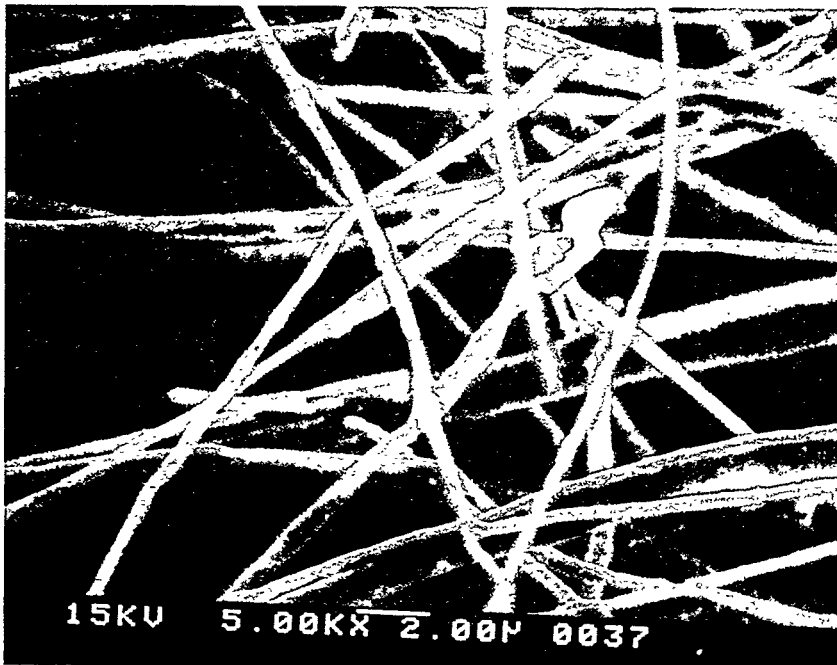


Figure 12. Electron micrograph of the steel fiber media made from 0.5 μm steel fibers.

Figure 13 shows the penetration (1-efficiency) measurement of the media as a function of particle size. The pressure drop was 1.15 inches. The media had a greater quantity of fibers than was needed to achieve the desired efficiency value. We estimate that reducing the quantity of fibers to yield an efficiency of 99.97% will result in a media pressure drop of 0.8 inches. Unfortunately, we did not have sufficient fibers to optimize the media formulation. Nevertheless, our tests have demonstrated that filter media made from 0.5 μm steel fibers will yield the desired HEPA filter performance.

We have shown the feasibility of developing a steel HEPA filter that meets the efficiency and pressure drop requirements for HEPA filters. However, the laboratory bench scale process must be scaled up in order to produce a sufficient quantity of fibers and media to make several prototype HEPA filters. This represents the next step in the development of the cleanable steel HEPA filter.

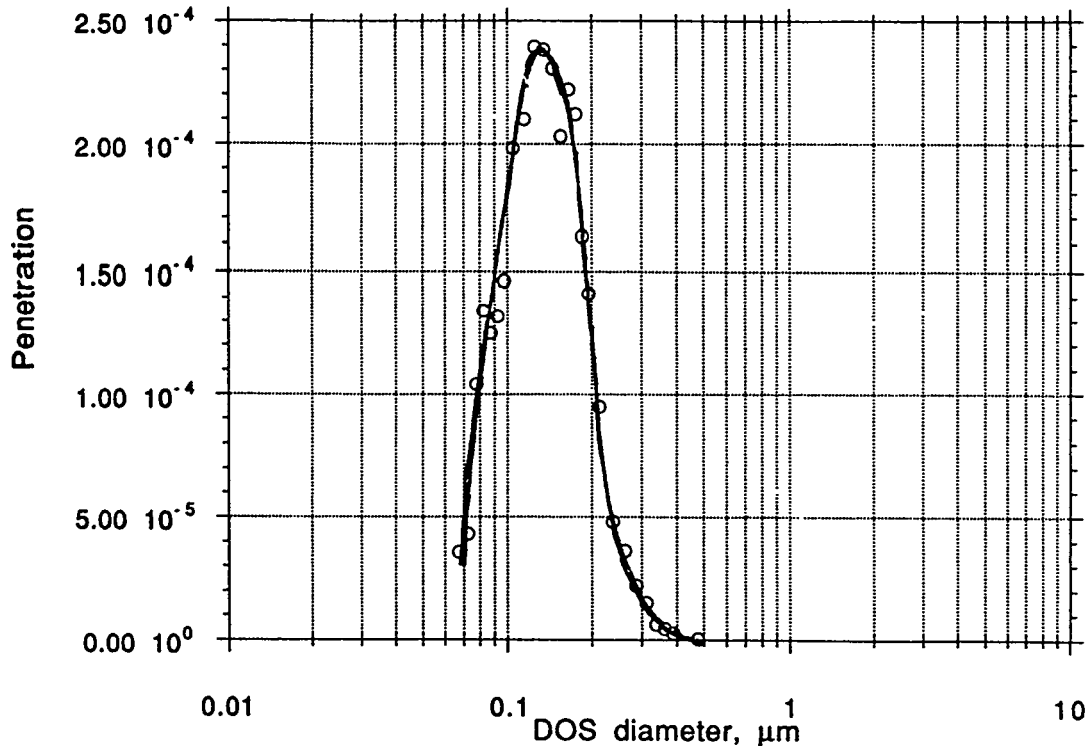


Figure 13. Aerosol penetration measurements at 3.5 cm/s face velocity through steel fiber media shown in Figure 12. Pressure drop was 1.15 inches.

III. Reduction in Weight Achieved by Using Conventional HEPA Design

Since the filter media for the steel HEPA is expected to weigh about 10 pounds for 200 square feet (glass fiber media would weigh 3.3 pounds), most of the weight is due to the support structure. The filter design that consists of multiple pleated cylinders as shown in Figure 2 would require a considerable amount of heavy metallic support elements and end plates on which to attach the cylinders. This design can not be used to fabricate a steel HEPA filter that has a comparable weight to the steel-framed HEPA with glass fiber media. To achieve the weight objective, it will be necessary to use a similar design as used for glass fiber HEPA filters. Figure 14 shows a design using corrugated separators. Since the steel media is much stronger than the glass media, it also is possible to eliminate the separators. Other designs such as the mini-pleat and Dimple PleatTM design are also possible.^(14,24) The assembly of such filters is very similar to that used for the present glass HEPA filters except that organic sealants would be replaced with a brazing compound. Any of a variety of different brazing or welding techniques can be used to seal the pleated media pack into a steel frame. The final weight of the filter is expected to be less than 60 pounds, compared to the 200 pounds for the commercial units.

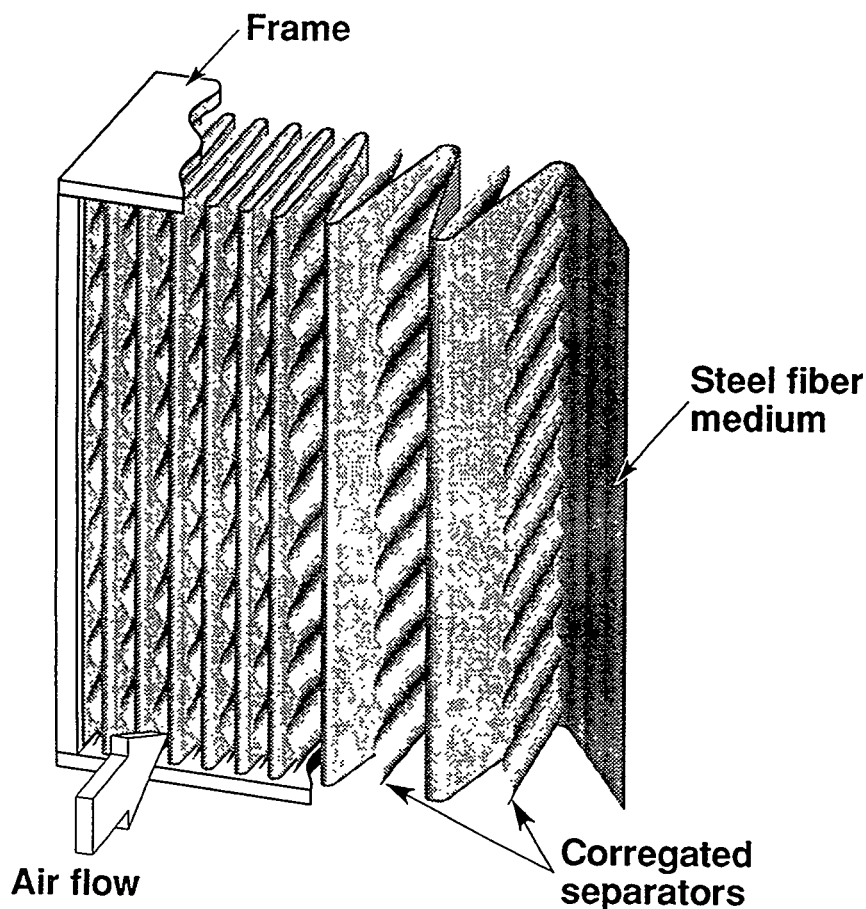


Figure 14 Cleanable steel HEPA filter with the deep pleat and separator configuration.

IV. Sensitivity Analysis Shows Cleanable Steel HEPA Filters Are Cost Effective

The initial driver that was responsible for the early development work of the filter was the cost saving that resulted from reducing the large waste disposal costs by cleaning the filter and reusing it.^(13,14) We found that during the 1987-1990 period, DOE facilities used an average of 11,478 HEPA filters per year and had an annual estimated cost of \$55 million.⁽²¹⁾ We estimated that replacing all of the glass HEPA filters with steel HEPA filters would reduce the annual costs to \$13 million and save \$42 million per year.⁽¹⁴⁾

Since the number of HEPA filters used by DOE facilities have decreased dramatically in recent years and the parameters used in the cost estimates are uncertain, we have performed a sensitivity analysis of the cost parameters to reevaluate the potential cost savings.⁽²⁾ The annual number of HEPA filters used by DOE facilities dropped from about 12,000 in 1990 to 4,000 in 1995 as a consequence of the end of the Cold War.⁽²⁾ The other major factors that determine the total cost savings from using cleanable steel HEPA filters are the average filter life for the glass and steel HEPA filters, the initial purchase price for the glass and steel HEPA filters,

the installation, test, removal and disposal cost for a glass or steel HEPA filter, and the cost for cleaning the steel HEPA filter.

The average filter life for the glass-paper HEPA was estimated to be 3 years from a study of filter usage during 1977-1979.⁽²¹⁾ If we assume that the number of facilities and operations remain constant during this period, then it is possible to estimate the total number of filters in DOE facilities by multiplying the number of filters tested each year by the average life. For the period between 1977-1979, DOE tested an average of 10,352 filters and therefore had 31,055 filters in its facilities.

Once we have the total number of filters, we can estimate the average filter life by dividing the total number of filters by the annual number tested. Assuming the total number of active filters is still about 31,000, we estimate that the average filter life is $(31,000/4,000 = 7.8)$ 7.8 years. This estimate is reasonable based on the filter age data from Lawrence Livermore National Laboratory as of 10/13/94 that is shown in Figure 15. However, the 4,000 annual filters reflect a relatively idle DOE undergoing a major redirection following the end of the Cold War, and a large fraction of DOE operations, such as environmental clean-up, waste processing and weapons manufacturing are not yet in full operation. The number of HEPA filters used is expected to significantly increase with a corresponding decrease in the average HEPA life as DOE begins to process its radioactive waste and decontaminate and decommission its facilities. For our analysis, we will assume the average filter life will fall within the range of 3 years for full production and 7.8 years for primarily idle operation. The average is 5 years. In addition, there is a growing trend for DOE facilities to impose a 5 year life time on glass HEPA filters because of deterioration with age.⁽²⁵⁾

The life of the steel HEPA is another uncertain parameter in the potential cost savings from using steel HEPA filters. The life of the cleanable steel HEPA filter, assumed to be 45 years in our original cost savings estimate, is probably much less.⁽¹⁴⁾ The 45 year life estimate assumed that the steel HEPA filter would last the life of a typical facility, hence 45 years. However, the life of the steel HEPA depends on the environment to which the filter is exposed. For a relatively clean, non-corrosive environment, this is probably still a good estimate. However, if 304 or 316 stainless steel filters are exposed to a halide salt or acid environment, then the filter will rapidly degrade due to chemical attack. In fact, these filters should not be used in those environments. For applications in corrosive environments, the fibers should be made from Hastelloy or Inconel. Unfortunately, these fibers are only available in diameters greater than 8 μm , which are not suitable for HEPA filters as seen in Figure 4.

In addition to chemical attack on the fibers, the filter life is also determined by the ability to clean the filter. If the filter cannot be effectively cleaned, then the filter life will be shortened. In our cost analysis, we have assumed a life of 30 years. This is based on having a minimum of six cleanings (i.e. six equivalent glass HEPA filters, each having a 5 year life). In our laboratory tests, we were able to repeatedly clean the steel HEPA for an equivalent of 15 glass HEPA filters.⁽¹⁴⁾

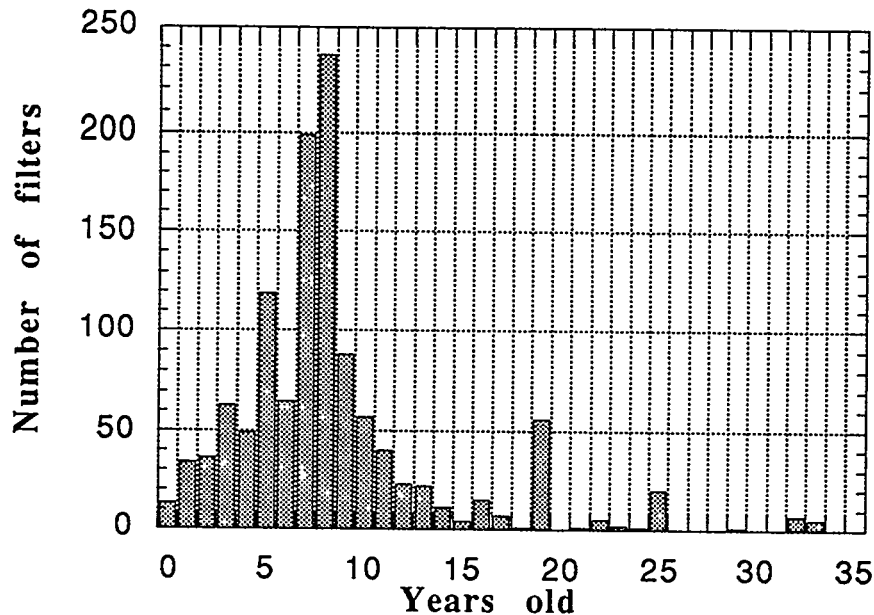


Figure 15. Distribution of HEPA filter age at LLNL as of 10/13/94. The filters are size 5.

Another uncertain parameter in the cost analysis is the final cost of the cleanable steel HEPA filter after it is completely developed and in production. We have assumed that the cost of the steel HEPA filter can be reduced to \$5,000 through further development work and with efficiencies in mass production. The present cost of a cleanable steel filter with 3 inches pressure drop and weighing 200 pounds is about \$70,000.⁽²⁰⁾ In contrast a standard glass HEPA filter, which weighs about 40 pounds, costs about \$300.

The cost for the installation, test, removal, and disposal was \$4,450 as obtained from a survey of life-cycle costs of glass HEPA filters for the period 1987-1990.⁽²¹⁾ We assumed that this cost would be the same for both the prototype and the steel HEPA filter. The prototype steel filter would have a slightly higher cost because of its greater weight, but we have ignored that in our analysis.

The final parameter to be considered in our cost analysis is filter cleaning costs. We have assumed reverse pulse air cleaning or filter removal and off-line washing would be the primary cleaning methods. Pall has also developed and successfully tested an on-line water cleaning method for their pressure vessel design.^(18,19) We have estimated that each cleaning cycle would cost \$500 based on labor costs. The associated capital costs for the cleaning hardware (e.g. blow back tubes) would be lumped into the initial cost for the filter element housing or in the initial cost of the steel HEPA filter.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

We have summarized the various costs and parameters for the glass HEPA filter, the commercially available steel filter, and the fully developed cleanable steel HEPA filter in Table 1. We have also computed the total filtration cost for a given HEPA filter installation over 30 years. The total filtration cost for the HEPA filters are given by:

$$C_{GT} = (30/L_{GF})(C_{GF} + C_M) \quad (1)$$

$$C_{ST} = (30/L_{SF})(C_{SF} + C_M) + N_C(C_C) \quad (2)$$

where C_{GT} = total filtration cost for glass HEPA in a single installation over 30 years.

C_{ST} = total filtration cost for steel HEPA filter in a single installation over 30 years.

L_{GF} = Life of glass HEPA filter, years

L_{SF} = Life of steel HEPA filter, years

C_{GF} = Initial cost of glass HEPA filter

C_{SF} = Initial cost of steel HEPA filter

C_M = Maintenance cost of installation, test, removal and disposal

C_C = Cleaning cost of filter

$N_C = 30/L_{GF}$ = Number of cleanings

Equation 2 incorporates the assumption that the steel HEPA is cleaned prior to disposal at the end of its useful life. The cost of the cleaning system that is required for retrofit applications is included in the cost of the cleanable steel HEPA because it is small compared to the cost of the filter. The cleaning system would either consist of an in-duct reverse air pulse jet or the filter would be removed for off line cleaning in a liquid bath.

Once the costs for glass and steel HEPA filters are determined from Equations 1 and 2 respectively, a variety of other cost figures can be computed such as annual costs per filter location, total and annual cost savings for steel HEPA filters compared to glass HEPA filters, and total DOE filter costs and total savings. We have made these computations in Table 1.

As seen in Table 1, the commercially available steel filter is not cost effective because of the high purchase cost of \$70,000 and the few cleaning cycles for

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

applications having an average HEPA life of 5 years. This explains why these filters are not being used in applications where conventional glass HEPA filters are used. The steel HEPA filter becomes more cost effective with increasing cleaning cycles because of the \$4,450 in handling and waste disposal costs that are saved with each cleaning. Table 1 also shows that the steel HEPA filter costing \$5,000 is very cost effective for the given assumptions. We believe that this cost reduction is achievable with additional development and improvements in production methods.

To assess the sensitivity of the filtration costs and cost savings to variations in the key parameters in Table 1, we used Equations 1 and 2 to determine the total cost as a function of the glass HEPA life (or cleaning frequency), the purchase cost of the steel HEPA filter, and the service life of the steel HEPA. Details of the sensitivity study are presented in our previous report.⁽²⁾

Table 1. Comparison of costs and parameters for glass HEPA and cleanable steel HEPA filters.

Filter element	Glass-paper HEPA	Stainless steel HEPA	
		Commercial	After Development
(1000 ft ³ /min)	\$300	\$70,000	\$5,000
Installation, test, removal, and disposal	\$4,450	\$4,450	\$4,450
Cleaning	\$0	\$500/cleaning	\$500/cleaning
Average filter life	5 years	30 years	30 years
life costs for one location(30 years)	\$28,500	\$77,450	\$12,450
life savings per location	\$0	-\$48,950	\$16,050
cost per location per year	\$950	\$2,648	\$415
annual savings per location	\$0	-\$1,698	\$535
total DOE cost per year (31,055 filters)	\$29.5M	\$82.2M	\$12.9M
total DOE savings per year (31,055 filters)	\$0	-\$52.7M	\$16.6M

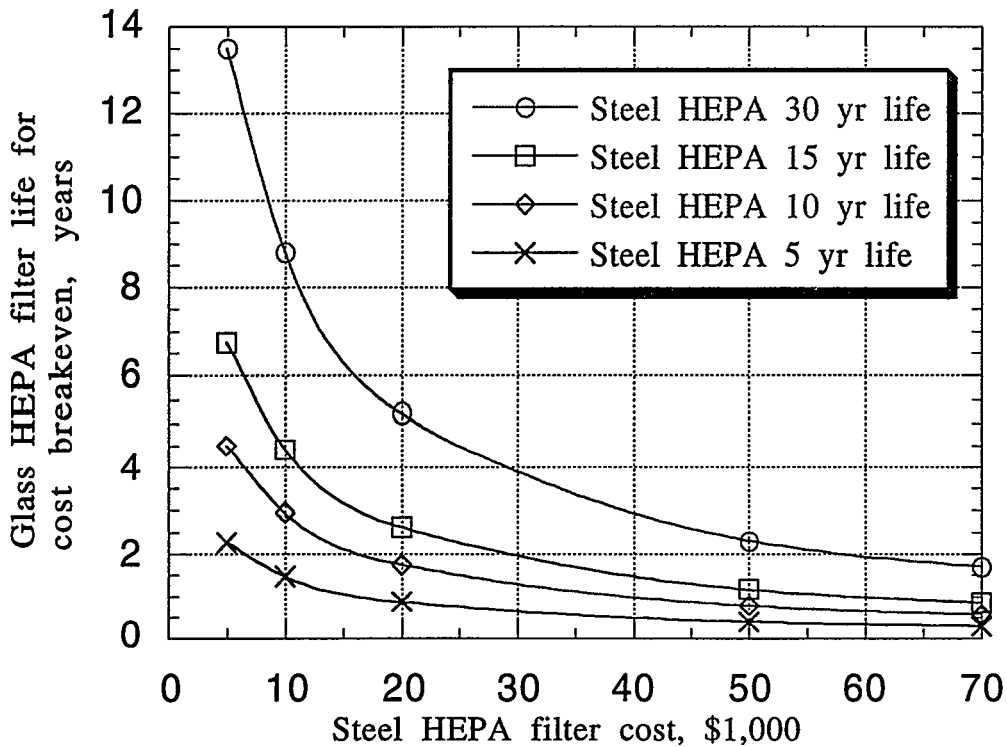


Figure 16 Break-even costs for cleanable steel HEPA filter having different filter lives as a function of purchase cost.

The results of our sensitivity analysis are summarized in Figure 16 which defines the break-even costs as a function of glass HEPA life, steel HEPA cost, and steel HEPA life. Using a cleanable steel HEPA filter will be cost effective for any combination of glass HEPA life and steel HEPA cost that lies below the curve defining a given steel HEPA life. Figure 16 shows that more expensive steel HEPA filters are only cost effective with long steel filter life and short glass HEPA life. Conversely, lower cost steel filters can be cost effective with higher glass HEPA filter lives and lower steel HEPA lives.

In addition to the direct cost savings shown in Table 1, there are additional cost savings due to the increased reliability of the steel HEPA filters. Steel HEPA filters have a much higher reliability than the present glass HEPA filter, which can be damaged or destroyed under a number of operational and accident conditions involving fires, explosions, tornadoes, or water exposure.⁽²⁶⁾ When the HEPA filters are damaged, radioactive contaminants can escape and cause environmental contamination. The typical consequence of an accidental release is a facility shut down and an environmental clean-up operation, both of which are very expensive.

V. Evaluation of Competing Technologies for Cleanable HEPA Filter

The major competitors of the sintered steel fiber filter are the metal and ceramic sintered powder filters and the reinforced glass fiber HEPA filter. In fact, the early high efficiency metal filters used in nuclear air cleaning applications were sintered steel powder filters.^(3-5,9) Currently, both steel and ceramic sintered powder filters are used extensively in high efficiency filtration applications in which the filters are repeatedly cleaned and reused. Most of the applications involve filtering gas and liquid process streams at relatively low flow rates and have high pressure drops across the filters.

We have evaluated sintered metal and ceramic powder filters and concluded that these filters have much higher pressure drops than fibrous filters with the comparable efficiency. Figure 17 illustrates the general structure of a sintered powder filter which consists of several layers of different size powders that are sintered together.⁽²⁷⁾ The layer having the smallest size particles performs the basic filtration, while the intermediate layers and substrate provide structural support to the filtration layer. In order to minimize the pressure drop, the thickness of the filtration layer is made as small as possible.



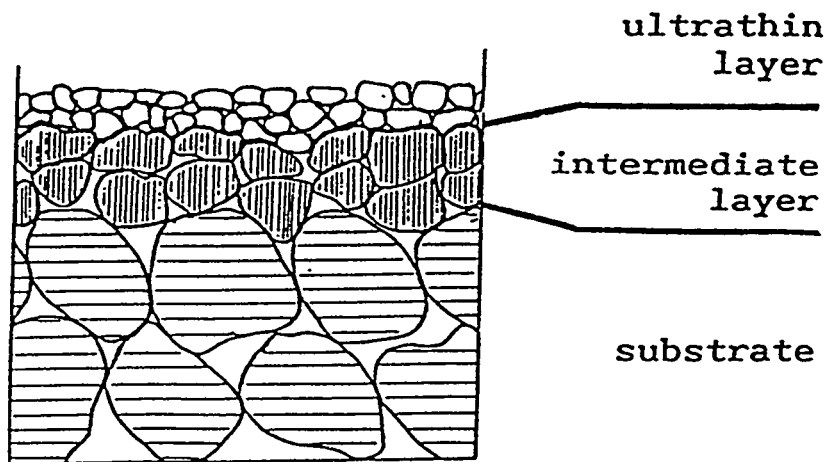


Figure 17. Typical structure of a ceramic powder filter having multiple layers of different size powder.⁽²⁷⁾

An example of a typical ceramic powder filter is illustrated in Figure 18 which shows electron micrographs of the cross section of the French KERASEP filter.⁽²⁸⁾ The substrate layer of 5 μm aluminum and titanium oxide powder and the surface layer of 0.8 μm zirconium or titanium oxide powder are seen in the two photographs. In addition to the filter with a surface layer of sintered 0.8 μm powder, we also obtained KERASEP filters with a surface layer of 1.4 μm powder and one filter having only the substrate with no surface layer. This filter was used by the French Atomic Energy Agency for isotope separation.

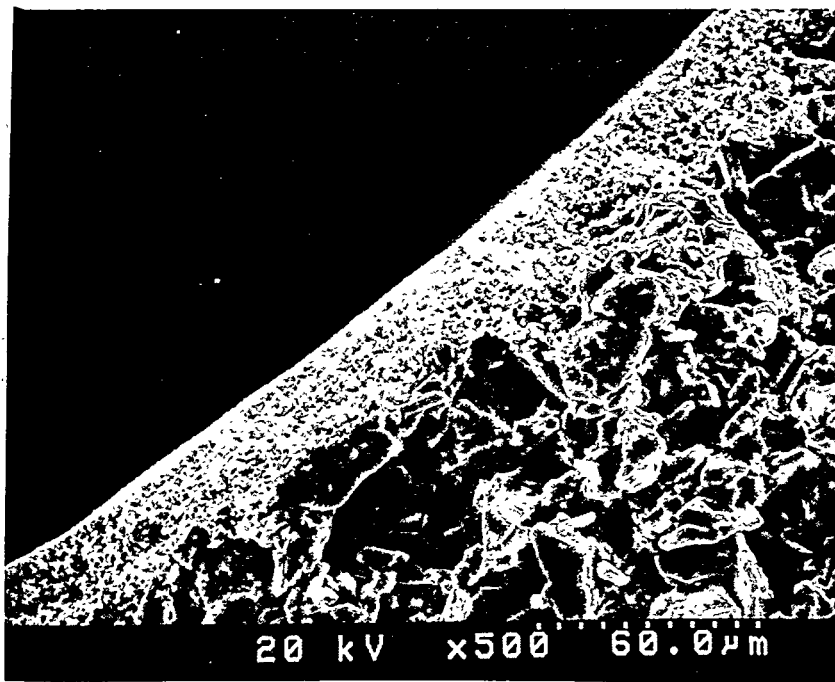

(A)

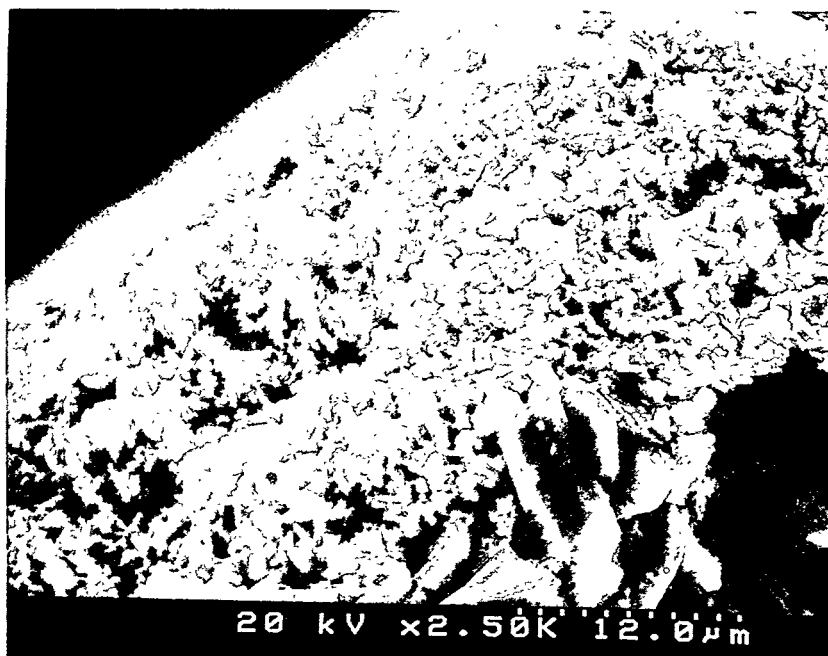

(B)

Figure 18. Electron micrographs of the cross section of the KERASEP ceramic powder filter having a surface layer of 0.8 μm powder. B is a magnification of A.

We measured the penetration of DOS aerosols and the pressure drop of the three different KERASEP filter elements at 1.3 cfm, which corresponds to a flow rate of 1,000 cfm if the maximum number of KERASEP elements were packaged into the standard HEPA frame of 2' x 2' x 1'. The KERASEP filter elements are cylinders with multiple interior channels that are parallel to the cylindrical element. Figure 19 shows the KERASEP filters have an excessive pressure drop, even with only the pure substrate. The filter with a layer of 1.4 μm powder meets the HEPA penetration requirements but has an excessive pressure drop of 25 inches of water.

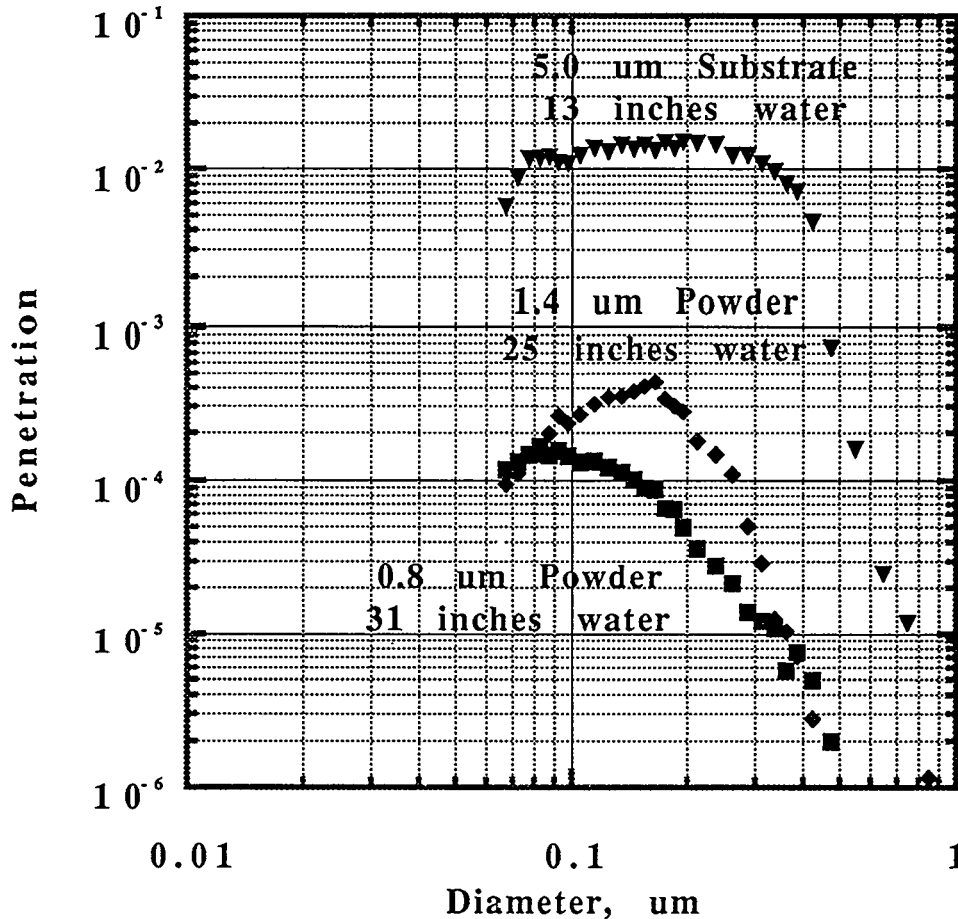


Figure 19. Penetration of DOS aerosols as a function of diameter for three different KERASEP ceramic powder filters.

Another multi-layer ceramic filter that we evaluated was a honeycomb ceramic monolith with a surface layer of fine ceramic powder deposited by a slurry and sintered.⁽²⁹⁾ This filter element from the CeraMen Corporation had high efficiency and relatively low pressure drop. We tested the filter sample at 50 cfm to correspond to the 1,000 cfm flow for a 2' x 2' x 1' standard HEPA filter. Figure 20 shows that the penetration at 0.3 μm was 0.06, and the pressure drop was 4.0 inches. These values are not close to the HEPA filter requirements.

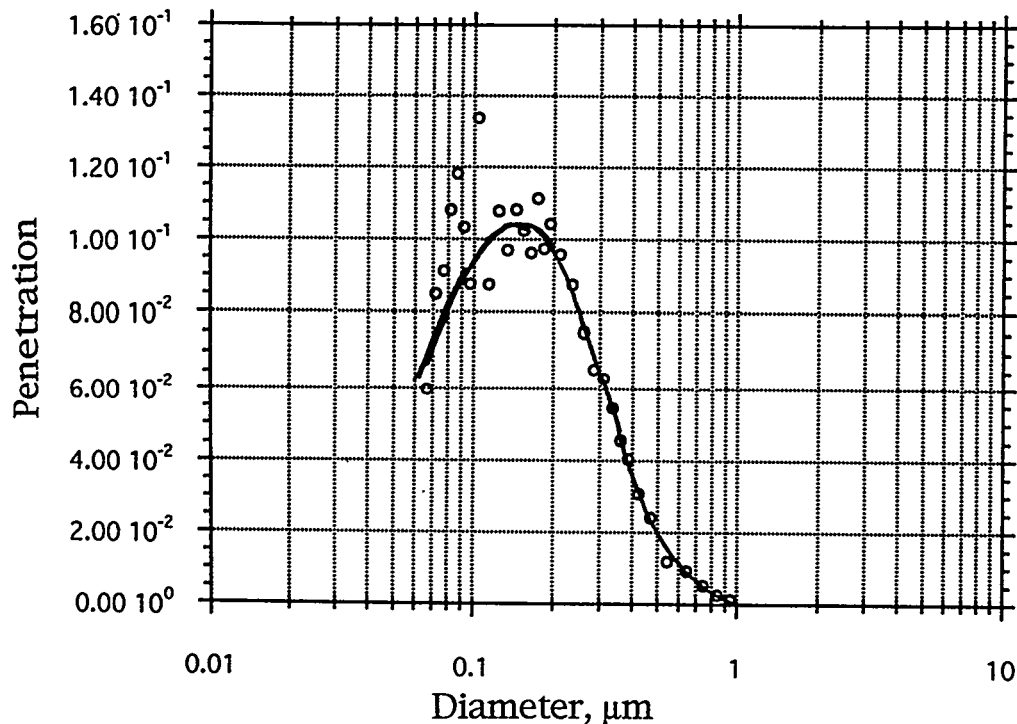


Figure 20. Penetration of DOS aerosols through CeraMen ceramic filter at 50 cfm. The pressure drop was 4.0 inches.

Sintered powder metal filters have a similar performance as the powder ceramic filters because the basic structure of the medium is the same. The powder metal filters are made with either multiple layers of graded powder as in Figure 17 or with uniform size powder throughout. The configuration of the powder metal filters is generally as tubes or other rigid shapes because once the powder is sintered, the filter medium cannot be bent sharply, as required for making filter pleats, without cracking. This is true even for relatively thin sheets. An example of a powder steel filter (Mott Metallurgical, Farmington, Conn.) having 85 tubes with a nominal pore size of 0.2 μm mounted together is shown in Figure 21. We attempted to determine the aerosol penetration through the multi-tube filter, but the pressure drop was too high for our test equipment. The pressure drop across the filter at 1.9 cfm was 8 psi (222 inches). This flow corresponds to the equivalent flow through the small element that a full-scale HEPA filter would see. The full scale filter would have more than 3,800 tubes within the 2' x 2' x 1' filter housing.

Fain has developed a powder nickel filter using the tube design for potential applications as a HEPA filter.⁽³⁰⁾ The filter has 4 layers of decreasingly smaller powder diameter arranged as in Figure 17: a substrate layer of 55 μm powder, first intermediate layer of 15 μm powder, second intermediate layer of 5 μm powder, and a top layer of 0.5 μm powder. The filter technology for making the multi-layer filter was used in the U.S. gaseous diffusion process for separating radioactive isotopes (analogous to the French using the KERASEP filter in the French isotope separation process). We evaluated a prototype module consisting of 10 tubes approximately 11 inches long and that represented 1/64 the capacity of a standard HEPA filter. The full scale HEPA filter would have 676 tubes.

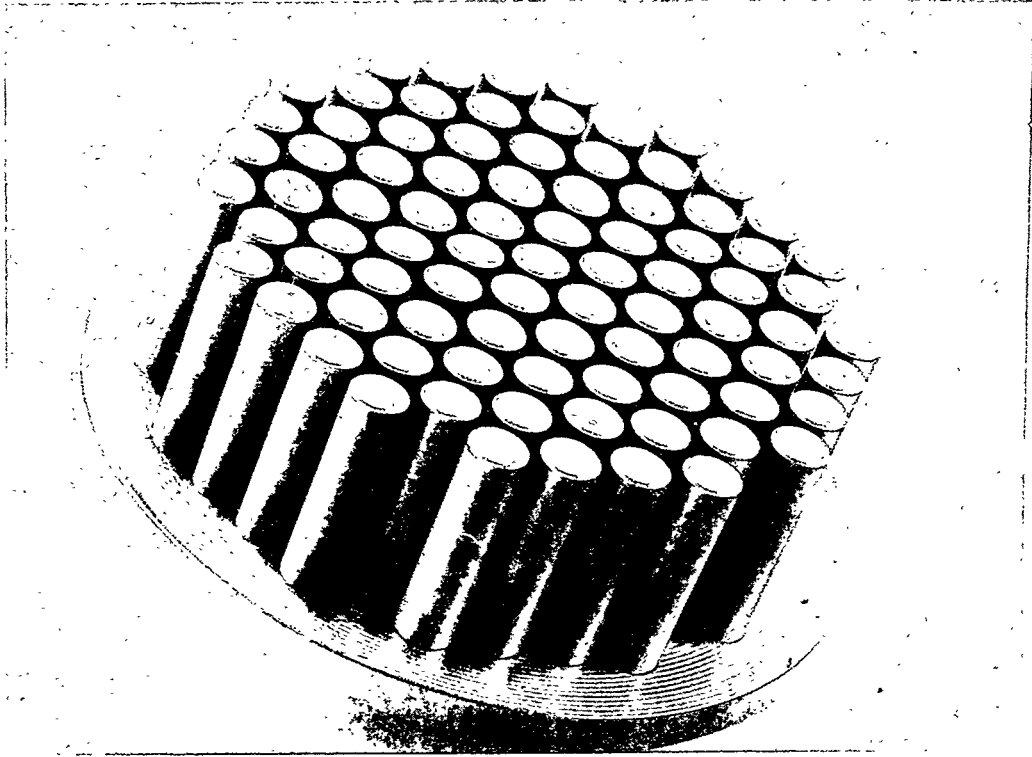


Figure 21. Photograph of sintered stainless steel powder filter from Mott Metallurgical consisting of 85 tube elements. Each tube has a diameter 0.31 inches and is 1.2 inches high.

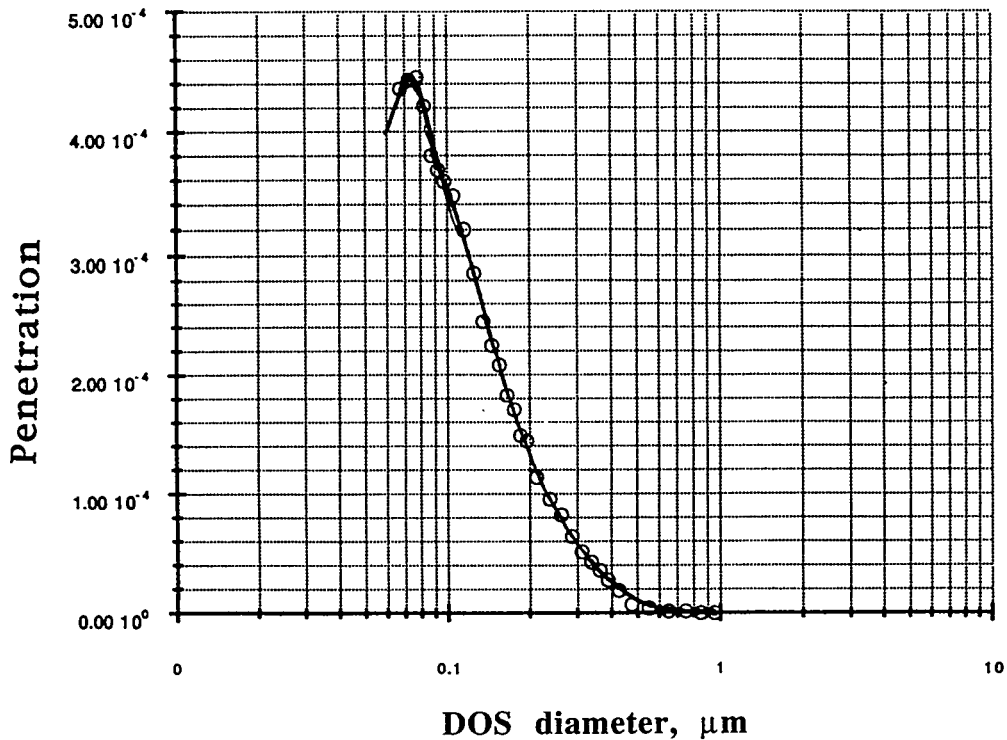


Figure 22. Penetration of DOS aerosols through sintered nickel powder filter consisting of 10 tubes. Pressure drop at 15.6 cfm was 38 inches.⁽³⁰⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Our test results showed the powder nickel filter had very high pressure drop and plugged rapidly with aerosols. Figure 22 shows the penetration of DOS aerosols through the filter as a function of particle size. The penetration at $0.3\ \mu\text{m}$ is 0.00006, which meets the requirements for a HEPA filter. However the pressure drop at 38 inches greatly exceeds the maximum 1 inch. Since the filter pressure drop increased from 38 to 45 inches within 5 minutes of aerosol exposure, we were careful to measure the aerosol penetration for the clean filter within the first 60 seconds before the particle loading could affect the filter penetration. Attempts to reduce the pressure drop by reducing the powder layers is futile as seen with the French KERASEP filter in Figure 19 because the aerosol penetration will increase beyond the maximum 0.0003 at $0.3\ \mu\text{m}$. Thus we conclude that the sintered powder filters are not a viable competitor of the steel HEPA filter.

The reason why the sintered powder filter cannot compete with the sintered steel fiber filter is the more restrictive structure of the powder filter. Figures 23 and 24 show cross sections of a steel fiber and a steel powder filter respectively. These cross sections are perpendicular to the air flow and represent the environments particles would see at the fixed depth within the filter. Figure 23 shows the fibers occupy a small volume fraction of the filter and result in relatively open region for air and particles to pass. In contrast, Figure 24 shows the powder occupies a large volume fraction and results in a relatively closed region for air and particles to pass.

This difference in fraction of occupied space accounts for the observed differences in filtration performance between the fibrous and powder filters. Because of the open space in a fibrous filter, the average internal air velocity is not much greater than the external air velocity. Particles therefore have a long residence time within the filter and result in high particle capture due to Brownian motion. The relatively few restrictions to the air flow also result in a low pressure drop for the fibrous filter. In contrast, the small volume of open space in the powder filter forces the air to flow at very high velocities through the powder filter matrix. The high velocity forces the particles through the filter very quickly with little residence time for Brownian motion to capture the particles. A high pressure drop is also required to force the air flow through the small open areas of the filter.

We have measured the aerosol penetration and the pressure drop through a sintered powder and fiber filter having the same powder or fiber dimension to illustrate the difference between the two filters. Figure 25 shows the resulting penetration of DOS aerosols and the pressure drop through a sintered powder filter made from $5\ \mu\text{m}$ steel powder and a sintered fiber filter made from $5\ \mu\text{m}$ steel fibers. We see that the powder filter has a much higher aerosol penetration and a higher pressure drop than the fiber filter. Note also that the peak aerosol penetration occurs at $0.17\ \mu\text{m}$ for the fiber filter and at $0.11\ \mu\text{m}$ for the powder filter. The shift in maximum penetration to smaller particle sizes with increasing filtration velocity is well known in the field and occurs because of lower residence time and the resulting decrease in Brownian capture.

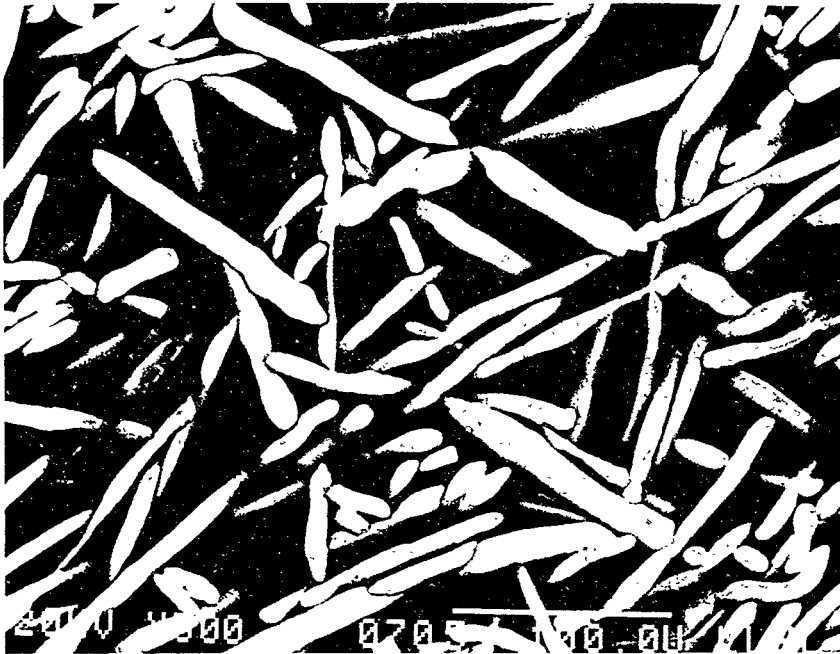


Figure 23. Electron micrograph of a cross section of a steel fibrous filter in a plane perpendicular to the air flow.

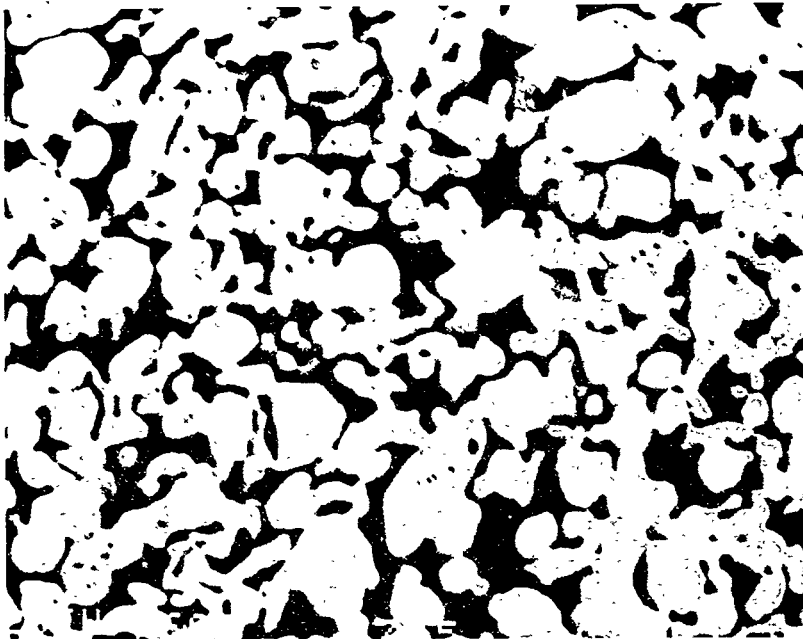


Figure 24. Electron micrograph of a cross section of a steel powder filter in a plane perpendicular to the air flow.

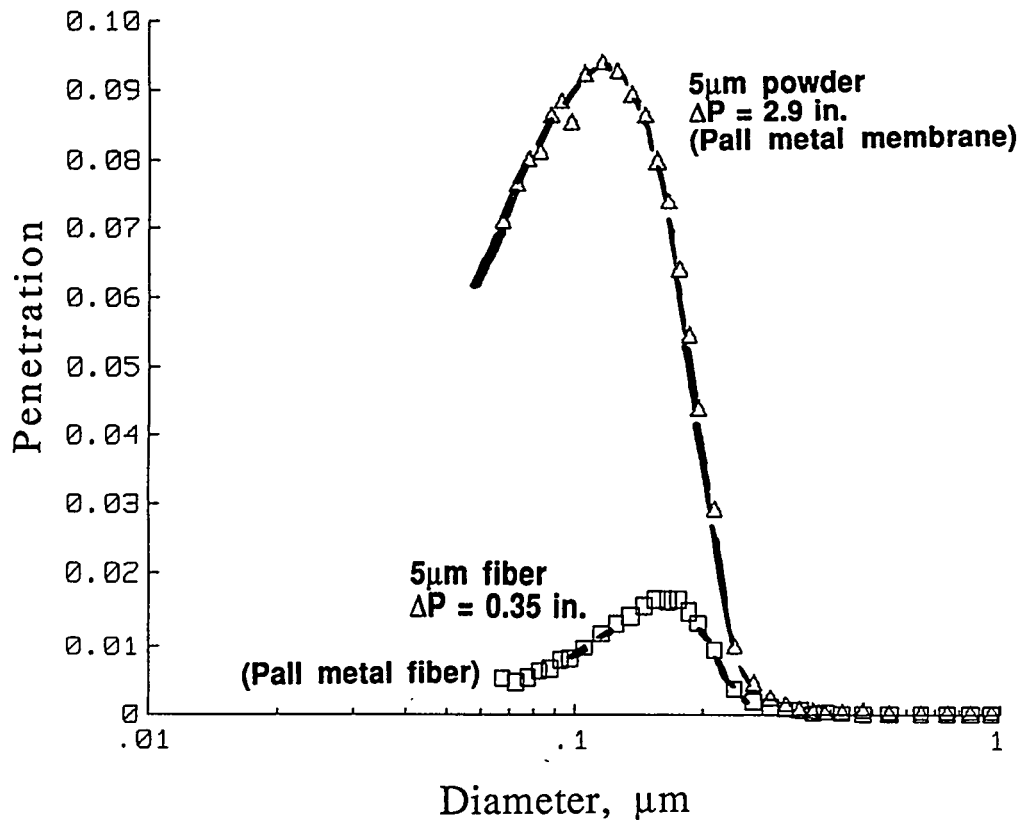


Figure 25. Penetration of DOS aerosols through sintered fiber filter made from 5 μm steel fibers and sintered powder filter made from 5 μm steel powder tested at 1.25 cm/s.

Another technology that we reviewed for potential application as a cleanable HEPA filter was ceramic fiber filters. These filters would have the same geometry advantages as the steel fiber filter. However ceramic fiber filters do not appear promising as a candidate for cleanable HEPA filters for several reasons. One of the major problems is the large diameters of most ceramic fibers. As seen in Figure 4, it is necessary to have fibers substantially less than 1.0 μm diameter to be considered for use as a HEPA filter. One of the smallest diameter ceramic fibers are the Saffil (ICI, England) alumina fibers shown in Figure 26. These fibers range from 2-4 μm and are available in felts, although sheets could be made in the wet paper making process. We measured the penetration of DOS aerosols on the Saffil felt and found the filter has an unacceptable high penetration for consideration as a HEPA filter. Figure 27 shows the penetration at 0.3 μm is 0.33 and the pressure drop is 0.49 inches at a velocity of 4 cm/sec. Even with two layers, the penetration would only drop to 0.10 while the pressure drop increases to 0.98 inches.

Assuming that ceramic fibers smaller than 1 μm become available, the resulting filter media would be too brittle to be used as a cleanable HEPA filter. The fibers would have to be either sintered together or bonded together with a ceramic glue, both of which would result in easily fractured media. Using an organic binder as

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

done with glass HEPA filters would allow the media to be flexible for pleating, but would not withstand the high temperature. We do not believe that the ceramic fiber media in flat sheets would have the required strength to survive repeated cleanings.

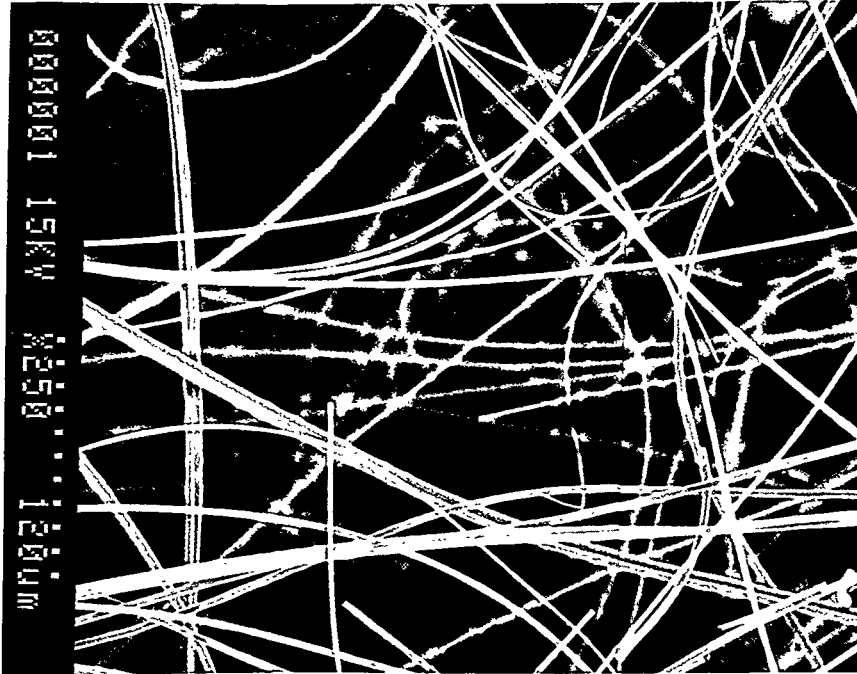


Figure 26 . Electron micrograph of Saffil alumina fiber media.

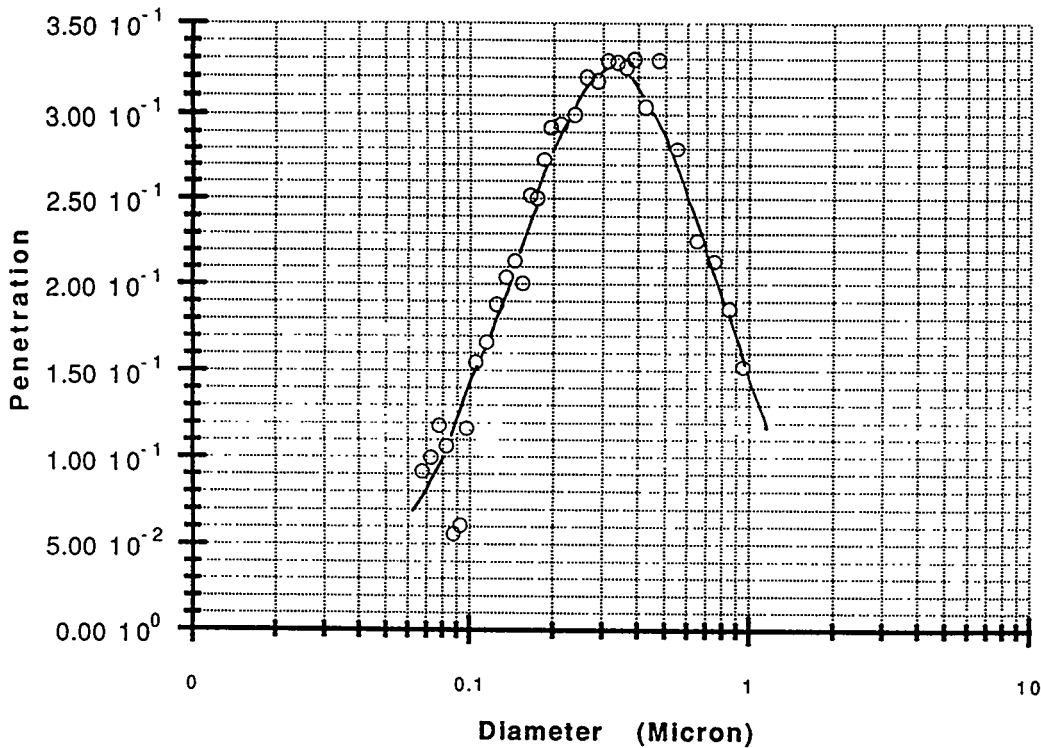


Figure 27. Penetration of DOS aerosols through Saffil alumina fiber medium at 4 cm/s. Pressure drop was 0.49 inches.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The final potential candidate for a cleanable HEPA filter that we reviewed is the reinforced glass fiber HEPA filter.⁽³¹⁾ This filter has a glass scrim laminated on the back of the HEPA media to provide extra strength to the medium. Test results have shown the reinforced media is very effective in preventing filter blow out during heated air and water exposure tests.⁽³¹⁾ However, the filter was designed to withstand a single accident condition and not for repeated cleanings by reverse air pulses. To survive repeated reverse air pluses, the glass HEPA medium should have glass scrim laminated on both sides of the medium. Without this reinforcement, the glass fiber medium could be blown out. Although a HEPA filter with a single layer of reinforced medium can meet the one inch pressure drop requirement, it is not known whether the same holds for two layers. In addition, tests need to be conducted to establish that the reinforced glass fiber filter can be repeatedly cleaned as was demonstrated for the steel fiber filter in Figure 9 for the single cartridge and in our previous report for the full scale HEPA filter.⁽¹⁴⁾ Other cleaning methods such as liquid washings also have to be evaluated for those applications where reverse air pulses are not effective. Since a cleanable glass HEPA filter is expected to cost about \$500 compared to \$5,000 for a cleanable steel HEPA filter, the reinforced glass HEPA filter has the potential to be a viable candidate for the cleanable HEPA filter.

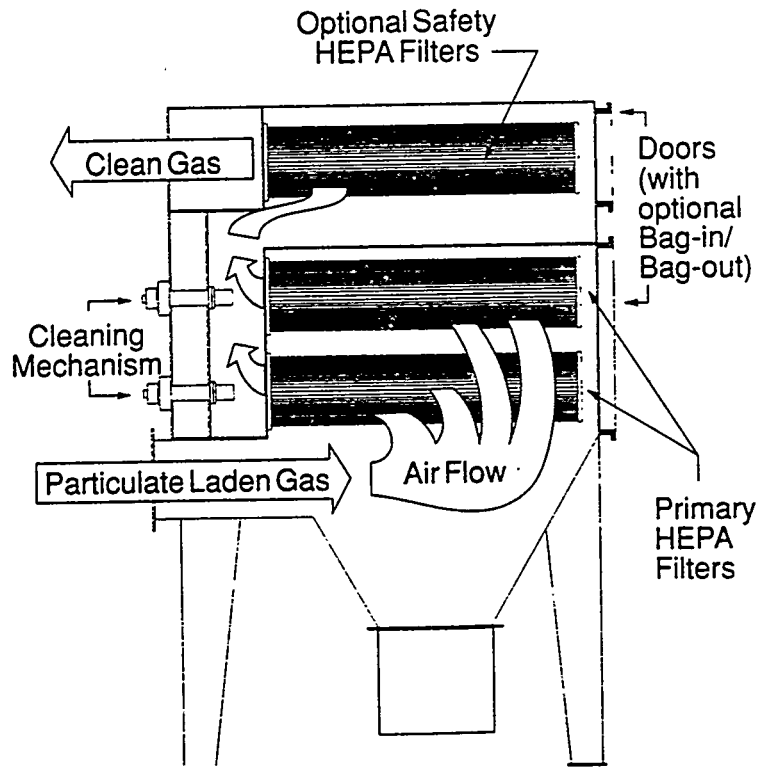


Figure 28. Cleanable HEPA filter using reinforced glass HEPA medium and manufactured by MAC Environmental.⁽³³⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Cleanable HEPA filters using the standard and the reinforced glass fiber HEPA medium and a gentle reverse air pulse are being developed for various applications.^(32,33) Leibold et al have described the use of reverse air flows in the pockets of deep pleated HEPA filters to dislodge particle deposits for renewing clogged HEPA filters.⁽³²⁾ They were able to clean standard, deep-pleated HEPA filters using several different dusts. Morgan described a cleanable HEPA filtration system using HEPA filters with reinforcement scrim on both sides of the HEPA media.⁽³³⁾ The commercially available unit uses cylindrical cartridge HEPA filters in a conventional blow-back air cleaning unit. Figure 28 shows the commercially available cleanable HEPA filter system manufactured by MAC Environmental (Kansas City, MO). This system functions in a similar to the cleanable steel HEPA filter system shown in Figure 1.

VI. Conclusion

We have made further progress in developing a cleanable steel fiber HEPA filter. We fabricated a pleated cylindrical cartridge using commercially available steel fiber media that is made with 1 μm stainless steel fibers and sintered into a sheet form. Test results at the DOE Filter Test Station at Oak Ridge show the prototype filter cartridge has 99.99% efficiency for 0.3 μm dioctyl phthalate (DOP) aerosols and a pressure drop of 1.5 inches. Filter loading and cleaning tests using AC Fine dust showed the filter could be repeatedly cleaned using reverse air pulses. We also produced 0.5 μm steel fibers using the fiber bundling and drawing process and sintered the fibers into small filter samples. Test results on the sample showed a penetration of 0.0015 % at 0.3 μm and a pressure drop of 1.15 inches at 6.9 ft/min (3.5 cm/s) velocity. Based on these results, steel fiber media can easily meet the requirements of 0.03 % penetration and 1.0 inch of pressure drop by using less fibers in the media.

A cost analysis of the cleanable steel HEPA filter shows that, although the steel HEPA filter costs much more than the standard glass fiber HEPA filter, it has the potential to be very cost effective because of the high disposal costs of contaminated HEPA filters. We estimate that the steel HEPA filter will save an average of \$16,000 over its 30 year life. The additional savings from the clean-up costs resulting from ruptured glass HEPA filters during accidents was not included but makes the steel HEPA filter even more cost effective.

We also present the results of our evaluation of competing technologies with metallic and ceramic powder filters, ceramic fiber filters, and reinforced glass fiber filters. In general, the metallic and ceramic powder filters have pressure drops in excess of 25 inches of water for HEPA grade efficiencies and are therefore not viable candidates. The ceramic fiber filters cannot meet the HEPA efficiency because the fiber diameters are too large. The reinforced glass fiber filter is a promising candidate for the cleanable HEPA filter but requires additional development and testing to confirm its potential to be repeatedly cleaned.

VII. References

1. Bergman, W, Larsen, G, Lopez, R, Wilson, K, Witherell, C, and McGregor, M, "Feasibility demonstration of a steel HEPA filter," in Mixed Waste Integrated Program, Mid-Year Technical Review, Volume 5, Off-Gas Treatment, Available from DOE, EM-50, 1000 Independence Ave, Washington, DC 20585, Document WPI.94-0159-5, April 21, (1994).
2. Bergman, Werner "Requirements for a cleanable steel HEPA filter derived from a systems analysis" Lawrence Livermore National Laboratory Report UCRL-ID-125048, Available from NTIS, 5285 Port Royal Rd, Springfield, VA 22161, June (1996).
3. Ziegler, D.L., and Johnson, A.J., "Disposal of HEPA filters by fluidized bed incineration" in Proceedings of 15th DOE Nuclear Air Cleaning Conference, CONF-780819, NTIS, Springfield, VA 22161, pp.111-116, (1979).
4. Kirstein, B.E., Paplawsky, W.J., Pence, D.T., and Hedahl, T.G., "High efficiency particulate removal with sintered metal filters" in 16th DOE Nuclear Air Cleaning Conference, CONF-801038, pp. 719-744, (1981).
5. Bergman, W., "Comments to paper by Kirstein" in 16th DOE Nuclear Air Cleaning Conference, CONF-801038, pp. 742-744, (1981).
6. Dillmann, H.G., and Pasler, H., "Experimental investigations of aerosol filtration with deep bed filters" in Proceedings of 17th DOE Nuclear Air Cleaning Conference, pp. 1160-1174, CONF-820833, (1983).
7. Dillmann, H.G., and Pasler, H., "A filter concept to control airborne particulate release due to severe reactor accidents and implementation using stainless-steel fiber filters" in Proceedings of 18th DOE Nuclear Air Cleaning Conference, pp. 1417-1428, CONF-840806, (1985).
8. Klein, M., and Goossens, W.R., "Aerosol filtration with metallic fibrous filters" in Proceedings of 17th DOE Nuclear Air Cleaning Conference, pp 504-522, CONF-820833, (1983).
9. Randhahn, H., Gotlinsky, B., and Tousi, S., "The development of all metal filter for use in the nuclear industry" in Proceedings of 20th DOE/NRC Nuclear Air Cleaning Conference, CONF-880822, pp 726-748, (1989).
10. Bergman, W., "Evaluation and modification of commercial sintered metal filters" LLNL memorandum, July 7, (1989).
11. Kaercher, M.V., "Design of a prefilter to improve radiation protection and filtering efficiency of the containment venting system" in Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference, pp 443-452, CONF-9020823, (1993).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

12. Bergman, W., Conner, J., Larsen, G., Lopez, R., Turner, C., Valha, G., Violet, C., and Williams, K., "High efficiency steel filters for nuclear air cleaning" , in Proceedings of 21st DOE/NRC Nuclear Air Cleaning Conference, CONF-900813, pp. 733-761, (1991).
13. Bergman, W., "Cleanable steel HEPA filters" in Environmental Technology Program Annual Report FY90, pp.44-47, Lawrence Livermore National Laboratory report UCRL-LR-105199, January 2, (1991).
14. Bergman, W., Larsen, G., Weber, F., Wilson, P., Lopez, R., Valha, G., Conner, J., Garr, J., Williams, K., Biermann, A., Wilson, K., Moore, P., Gelner, C., Rapchun, D., Simon, K., Turley, J., Frye, L., and Monroe, D., "Development and Evaluation of a Cleanable High Efficiency Steel Filter" in Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning Conference, CONF-9020823, PP586-616, July (1993).
15. Bergman, W., Larsen, G., Lopez, R., Wilson, K., Simon, K., and Frye, L., "Preliminary field evaluation of high efficiency steel filters" in Proceedings of the 23rd DOE/NRC Nuclear Air Cleaning and Treatment, CONF-940738 , pp 195-213, February , (1995).
16. Kruger, O.L., "Hanford Waste Vitrification Plant Applied Technology Plan", WHC-EP-0417, January (1992).
17. Procurement Specification, Filter, High Efficiency Metal, W-320-P3, January 24, (1995).
18. Weber, L., "Pall Technical Brief: HEMF-5, Demonstration of efficiency measurements and in-situ cleaning" Pall Corporation report, December 31, (1992).
19. Weber, L., "Pall Technical Brief: HEMF-6, Study to investigate backwash regenerability and maintenance of integrity by ASHRAE test", Pall Corporation report, December 31, (1992).
20. Dittman, P., "Cost estimate for steel HEPA filters", Pall Corporttion, Cortland, NY, May 28, (1996).
21. Moore, P., Bergman, W., and Gilbert, H., "Survey of Life-Cycle Costs of Glass-Paper HEPA Filters" in Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning Conference, Denver, Co, August 24-27, 1992. UCRL-JC-109768, December, (1992).
22. Stepuszek, D and Hirose, J "High performance functinal paper for use as filter media" in Advances in Filtration and Separation Technology, Vol. 7, System Approach To Separation and Filtration Process Equipment. W.W-F Leung, Editor, pp. 111-114, The American Filtration Society, P.O. Box 6269, Kingwood, Texas 77325, April (1993).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

23. Tomeogawa High-Performance Sheet, SS, Specification brochure for sintered stainless steel sheet, Tomeogawa (U.S.A.) Inc., 742 Glenn Avenue, Wheeling, IL 60090 (1993).
24. Flanders Filters Catalog showing separatorless filters likethe Dimple Pleat™ and Super-Flow™ HEPA filters. Bulletins 812 and 871.
25. Air Filter Specifications, Manual No. 5Q1.10, Section 7, Westinghouse Savannah River Company, Savannah River Site, Health Protection Department, (1995).
26. Bergman, W., First, M.W., Anderson, W.L., Gilbert, H., and Jacox, J.W., "Criteria for calculating the efficiency of deep-pleated HEPA filters with aluminum separators during and after design basis accidents" in Proceedings of the 23rd DOE/NRC Nuclear Air Cleaning and Treatment Conference, NTIS, Springfield, VA, CONF-940738 , pp 563-598, February , (1995).
27. Gerster, D. "State of mineral membranes in the world" in the 1986 Fourth Annual Membrane Technology/Planning Conference, W. Shoemaker, Editor, Business Communications Co., Inc., Norwalk, CT 06855, pp152-159, (1986).
28. Kientz, G "Industrial use of inorganic membranes in the food industry" in Advances in Filtration and Separation Technology, Vol. 8, Filtration and Separation Processes and the Environment, S.K. Sharma, Editor, American Filtration and Separations Society, PO Box 1530, Northport, AL 35476, pp 49-55, (1994).
29. Abrams, R, "High temperature filtration using ceramic membranes" in Advances in Filtration and Separation Technology, Vol. 8, Filtration and Separation Processes and the Environment, S.K. Sharma, Editor, American Filtration and Separations Society, PO Box 1530, Northport, AL 35476, (1994)
30. Fain, DE "Inorganic membrane cleanable HEPA filter" in Mixed Waste Integrated Program, Mid-Year Technical Review, Volume 5, Off-Gas Treatment, Available from DOE, EM-50, 1000 Independence Ave, Washington, DC 20585, Document WPI.94-0159-5, April 21, (1994).
31. Gilbert, H., Bergman, W., and Fretthold, J. "Development and evaluation of a HEPA filter for increased strength and resistance to elevated temperature." in Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning Conference, Denver, Co, August 24-27, 1992. LLNL report UCRL-JC-110582, January, (1993).
32. Leibold, H., Doffert, I., Leiber, T., and Wilhelm, J.G., "The application of HEPA filter units in gas streams of high dust concentrations" in Proceedings of the 22nd DOE/NRC Nuclear Air Cleaning Conference, Denver, Co, August 24-27, 1992, pp 540-553, CONF-9020823, NTIS, Springfield, VA, July, (1993).
33. Morgan, L, "Ultra high efficiency dust collection" pp 30-32, in Filtration News, Vol, 12, No. 4, July/August (1994).

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

DISCUSSION

WILHELM: Who is producing $1\mu\text{m}$ diameter metallic fibers and what is the form in which it is delivered?

BERGMAN: Tomeogawa, a Japanese firm, produces the $1\mu\text{m}$ stainless steel fiber media in sintered sheets. We obtained our supply from Tomeogawa (USA), Inc., Wheeling, IL.

TSENG: With any fiberized material there will be a lower limit to diameter based on practical considerations of material stability. What would be the smallest diameter in stainless steel, and how would you compare it to glass?

BERGMAN: I thought that when we had reached $2\mu\text{m}$ that we were getting close to the limit, but at this point I do not know the lower limit. We made $0.5\mu\text{m}$ fibers, and $0.1\mu\text{m}$ is not unreasonable. Glass fibers are commercially available at $0.1 - 0.2\mu$ diameters.

TSENG: With metals there is a crystalline structure and once you get down to a fiber diameter of the order of a grain boundary, you have problems. I do not know where the limits are, I was hoping you could enlighten me.

BERGMAN: I do not have the answer. As far as I am concerned, there is no limit except for time, money, and effort.

WEBER: What about glass fiber diameter?

BERGMAN: You can buy glass fibers down to $0.1\mu\text{m}$.

BLACKLAW: What are the other important parameters in development of alternatives; for example, strength and corrosion?

BERGMAN: The strength of the steel media is due to inherent strength of the steel fibers plus the fiber-to-fiber bonds from sintering. In contrast, glass fiber media is not as strong because the fibers are held together with an organic binder, which is not only weaker, but also subject to more failure modes. However, corrosion in the 300 series steels is a serious concern and one of the areas we have not studied. Corrosion resistant steels such as Hastalloy and Inconel would work, but they are only available in diameters greater than $8\mu\text{m}$. The diameter of the Hastalloy and Inconel fibers would have to be reduced to less than $1\mu\text{m}$ for use as HEPA filter media.

ENGELMANN: How flammable is it?

BERGMAN: The loose steel fibers are extremely flammable and will ignite spontaneously when dispersed in air. However, the sintered steel fiber media will not burn even with a flame directed on it. Direct flames will destroy the media by converting the steel alloy to oxides, which flake and crumble.

THE EFFECT OF MEDIA AREA ON THE DUST HOLDING CAPACITY
OF DEEP PLEAT HEPA FILTERS

J Dymont AWE plc Aldermaston RG7 4PR United Kingdom
D Loughborough AEAT Harwell Oxford OX11 0RA United Kingdom

ABSTRACT

The high potential cost of storage, treatment and disposal of radioactive wastes places a premium on the longevity of installed HEPA filters in situations in radioactive processing facilities where dust capacity is a life determining factor.

Previous work investigated the dust holding capacity v pressure drop characteristics of different designs of HEPA filter and also the effect of using graded density papers.

This paper records an investigation of the effect of media area variation on the dust holding capacity of the "deep-pleat" design of HEPA filter. As in the previously reported work two test dusts (carbon black and sub micron sodium chloride in the range $0.15 - 0.4\mu\text{m}$) were used. Media area adjustment was effected by varying the number of separators within the range 60 - 90.

Results with the coarser dust allowed an optimum media area to be identified. Media areas greater or smaller than this optimum retained less dust than the optimum for the same terminal pressure drop. Conversely with the finer sodium chloride aerosol the dust holding capacity continued to increase up to the maximum area investigated.

INTRODUCTION

The prime concerns of facility operators (and regulators) in the nuclear industry in respect of HEPA filter systems are their efficiency (DF) and reliability in accident conditions.

Considerations of economy in conjunction with the high potential cost of storage, treatment and disposal of radioactive wastes mean that the longevity of installed HEPA filters (in situations where dust capacity is a life determining factor) is also an important consideration.

Earlier investigations^{1,2} looked at the influence of filter design viz deep-pleat vs minipleat and the use of graded papers³ on dust holding capacity.

This paper describes an investigation into the effect of variable media area on the dust holding capacity of a particular design (the 1000cfm deep-pleat design) of HEPA filter. The media area was varied by varying the number of pleats/separators.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

SCOPE OF WORK

Dust holding capacity of filter units is influenced by a number of factors, related to the nature of the airborne dust and its mode of deposition within the filter structure.

An ideal study procedure would freeze all parameters other than the one under investigation. Resource limitations constrained the present work to a limited practical investigation of real filters; procurement logistics dictated the use of filters from 3 different sources employing 2 different papers (of equivalent grade) in their construction.

In real operating situations HEPA filters encounter a whole range of conditions where they can be subject to widely varying dust burdens, both in terms of concentration and size distribution.

As in the graded media investigation³ reported at the previous (23rd) Air Cleaning Conference, this work was carried out using two test dusts, one a fine thermally generated condensation aerosol of sodium chloride and the other a carbon black aerosol generated by dispersion of powder using a standard ASHRAE dispenser.

These two aerosols were selected partly on the basis of technology availability as established test dusts and partly on the basis of simulating widely differing operational conditions.

This approach utilised available technology to carry out a viable programme capable of producing an indicative if not a totally rigorous and comprehensive answer to the question of HEPA filter optimal dust holding capacity.

TEST EQUIPMENT AND FILTERS

Test Rig

The test rig consisted of circular ductwork with an open inlet to enable dust to be dispensed into the airstream, a filter housing and downstream ductwork connected to an extract fan. Volume flowrate was measured by BS orifice plate and controlled by adjustable damper. Filter resistance was measured using a micromanometer. The rig was identical with the one described in the graded paper work³.

Test Filters

The deep-pleat filters were supplied by 3 manufacturers and conformed to the requirements of the British Nuclear Industry Specification⁴ with media area varying from 18.8 m² up to 28 m². All filters were rated and tested at 1700m³/h (1000 cfm) and had a minimum efficiency of 99.95% when tested by the sodium flame test⁵. They were all manufactured using either Hollingsworth and Vose Grade F39ZAE/R ("HV" in data) or Lydall grade L3255 ("L" in data). (Grades of paper currently in use in the UK nuclear industry).

Test Aerosols

The test aerosols used to load the filters were:-

- (a) Sodium chloride with a MMD of $0.14\mu\text{m}^0$. A thermal generator was used in this work producing a condensation aerosol by vaporisation of sticks of solid sodium chloride in an oxy-propane flame; this equipment is capable of generating particulate material at rates between 0.32 and 6.7 g/min.
- (b) Carbon black, acetylene, 50% compressed, with a nominal MMD of $0.6\mu\text{m}$. Measurements carried out with an Anderson Mk III impactor⁷ on airborne material dispersed with the standard ASHRAE dispenser gave an aerodynamic MMD of $2\mu\text{m}$ (35% below $1\mu\text{m}$). These measurements are in accordance with the view that dispersion of this material by this method is far from complete. The standard ASHRAE dispenser is suitable for dispersing carbon black aerosols at rates between 0.3 and 2.4 g/min.

Test Procedure

All filters were tested at their rated flow of 1700 m³/hr (1000 cfm). The mini-pleat filter although rated at 3000 m³/hr (1760 cfm) was tested at 1700 m³/hr (1000 cfm).

Dust holding capacity determinations were carried out with each filter mounted in the appropriate housing and subjected to a dust challenge at a uniform feed rate. For carbon black aerosol the feed rate to the deep-pleat filters was 2.4 g/min and to the mini-pleat unit, 1.2 g/min. For sodium chloride aerosol the feed rate was 3.6 g/min. The filter resistance was recorded against the known quantity of dust.

For purposes of comparison it is assumed that filters are changed out at a terminal resistance of 4"wg (1000 Pa), although operating practice may vary depending on other installation parameters.

CARBON BLACK LOADING RESULTS


Deep-pleat Filters

The results, (Figures 1 & 2), indicate the extent to which the carbon black dust holding capacity of this design varies with varying media area.

The current standard deep-pleat filter which has an average media area of 19 m² and approximately 66 media pleats (132 single sheets of media) can absorb some 470 g of carbon black before its resistance increases to 4"wg (1000Pa).

As the number of pleats increased from 66 to 80 the weight of carbon black absorbed rose to approximately 660 g for the same final resistance. Further increases in the number of pleats to


**FIGURE 1 - DUST LOAD v RESISTANCE
(DEEP PLEAT FILTERS)**
Carbon Black Loading

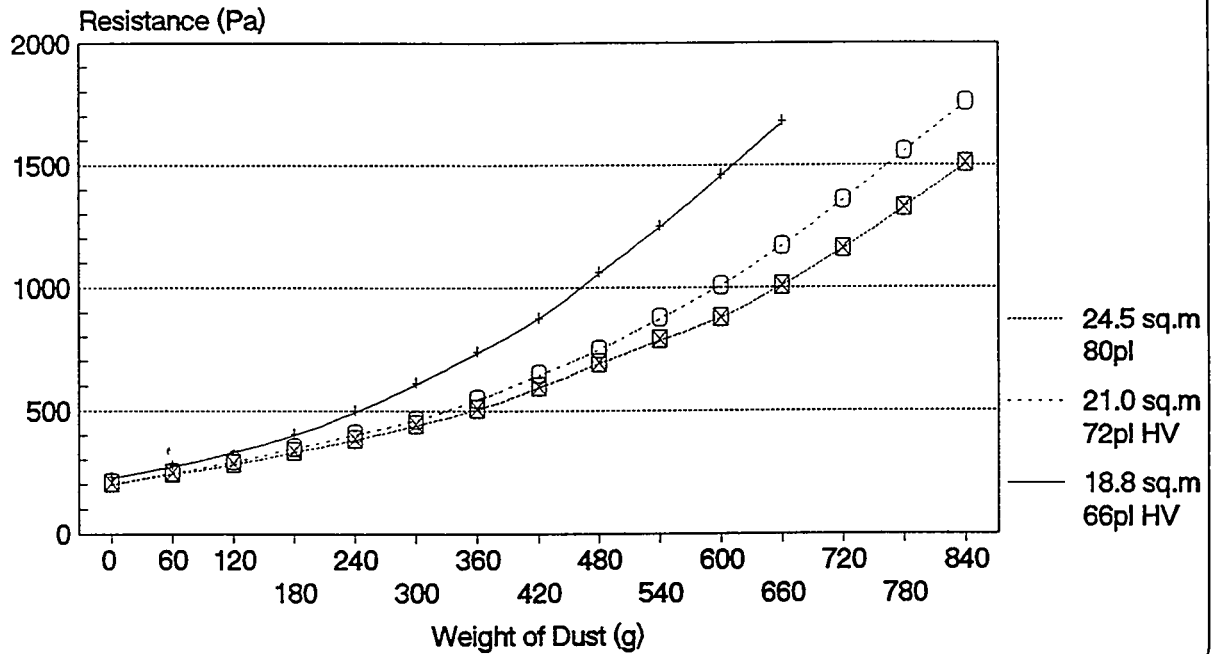

PAPER No.

DUST1

**FIGURE 2 - DUST LOAD v RESISTANCE
(DEEP-PLEAT & MINIPLEAT UNITS)**
Carbon Black Loading

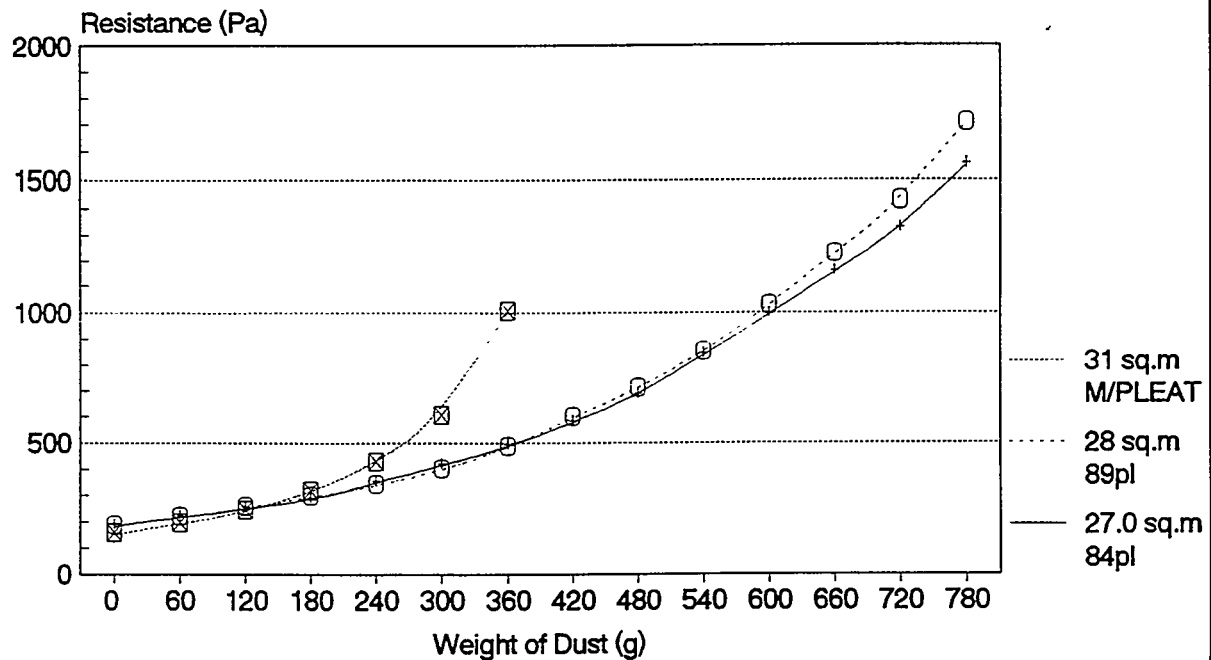


PAPER No.

DUST2

**FIGURE 3 - DUST LOAD v RESISTANCE
(DEEP-PLEAT UNITS)**

Sodium Chloride Loading

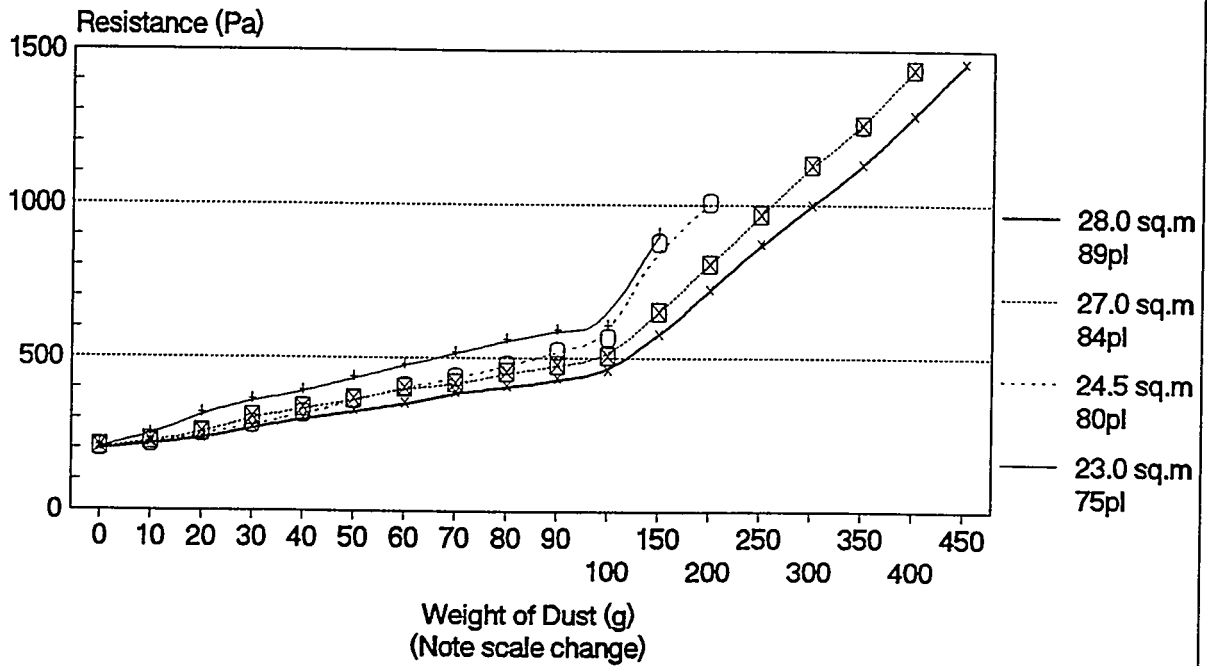


PAPER No.

DUST3

**FIGURE 4 - DUST CAPACITY v No OF PLEATS
(DEEP-PLEAT UNITS)**

Sodium Chloride and Carbon Black

DUST CAPACITY (g)
at 1000Pa, 1700m³/hr

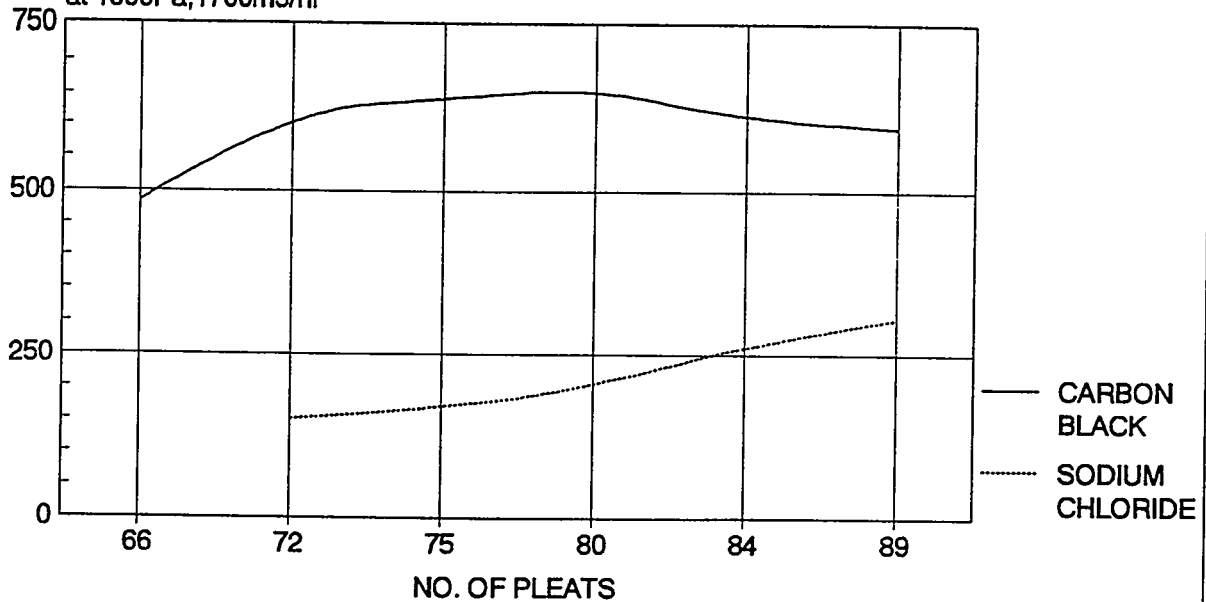

PAPER No.

DUST4

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

84 and 89 pleats resulted in a (small) apparent reduction in carbon black capacity.

Discussion of Results

As the number of pleats varies, different mechanisms interact to affect the filter resistance. Channel cross-sectional areas will decrease both individually and overall, so that the increased air velocity at the channel entrance will cause increased pressure losses.

The increased velocity may also in the latter stages of loading encourage a build-up of dust at the channel entrance thus further reducing the entrance cross sectional area.

It appears these effects are cumulative and more than counterbalance the advantages of the larger media area as may be seen in the results for 84 and 89 pleats, where the dust capacity of the unit is less than for 80 pleats.

This result suggests that HEPA filters having a paper area of 24-25m² will have an optimum capacity for dust having properties equivalent to those of carbon black.

Deep-Pleat v Minipleat Capacity (Carbon Black) at 1700 m³/h

Figure 2 shows carbon black dust loading results obtained with a minipleat filter having some 31 m² of media. Although its initial resistance was well below those of all of the deep-pleat units, it rose to the terminal value, (1000Pa), with a dust load of only 360 g, approximately 55% of that obtainable (660g) with the 80 pleat deep-pleat unit. This result, which was for comparative purposes only was in line with the results of earlier tests² carried out on minipleat filters at a higher flowrate.

SODIUM CHLORIDE LOADING RESULTS

The results of loading the range of deep-pleat filters with the sub-micron sodium chloride aerosol are shown in Figure 3. The capacities are lower (in terms of weight) than those obtained using carbon black by a factor of about 3. As the basic particle density is similar it may be deduced that the difference relates to the greater drag engendered by the finer particle deposits.

The sodium chloride dust holding capacity of the range of deep-pleat filters increased steeply with increase in media area, in line approximately with (number of pleats)^{3.5}; considering that the average thickness of a continuous the dust layer would be in the region of only 5-10μm, it is apparent that a "cake" filtration regime will not have been established; thus the changes in resistance will be accounted for by a combination of increase in fibre drag from the adhering particles on the one hand and on the other by increased local velocities where the flow passages between the surface fibres are restricted.

DISCUSSION OF RESULTS

Results obtained for the two dusts vary significantly but do not necessarily represent the extremes of the whole range of operational situations.

It will be seen that the advantages of larger area HEPAs in terms of dust holding capacity are realisable principally when "fine" aerosols are involved. For aerosols having properties equivalent to carbon black there is a significant advantage in an increased area up to say 24 m². Increasing the area further can be counter productive.

Should a dust be coarser and even more cohesive than carbon black then the chances of covering the channel entrances become greater. The optimum HEPA design in such a case would be likely to shift towards fewer (and wider) channel entrances.

Such observations fit with the thesis that HEPA filters are far from ideal as economic collectors for significant quantities of dusts, particularly coarse and/or "sticky" dusts. They perform best as "final polishers", or the ultimate guarantee of the effective removal of airborne particulate material, when the residual airborne concentrations involved are very low.

When filter disposal costs become a major operating cost as may be the case with radioactive processing facilities it is relevant to note that the weights of dust collected (of the order 150 - 600g in the present work) are a small percentage fraction (say ~1-2%) of the total weight (20 - 30 kg) of a typical HEPA element.

Economic use of HEPAs where significant concentrations of airborne particulates are involved requires that consideration be given to the use of renewable (eg cleanable) devices to remove coarse cohesive material and thus minimise the number of HEPA changouts during the life of a system.

Enhancement of HEPA life by using increased areas of filter media within the same envelope is therefore most effective when fine well dispersed aerosols are involved; this is also reflected in the findings for graded papers³ when optimum enhancement was obtained in the collection of the finer aerosol.

CONCLUSIONS

- 1 For operational situations/conditions where the challenge is predominantly a "fine" aerosol which is collected evenly throughout the whole effective media area and where there is a premium on disposal costs there would appear to be significant potential advantage in using filters with larger areas of filter media. Such conditions also favour the use of filters having "graded" paper media, and the dust characteristics conferred by a combination of such features remains

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

to be explored.

- 2 When there is a relatively cohesive and/or coarse particulate challenge to the HEPA filters, uneven dust deposition may lead to restriction and partial closure of the channel entrances. Such phenomena may cause premature resistance rises resulting in under-use of much of the media area (and consequent higher frequency of change out and accompanying elevated disposal costs).

REFERENCES

- 1 First, M. W., Performance of 1000cfm and 1800cfm HEPA filters on Long Exposure to Low Atmospheric Dust Loadings. 17th Air Cleaning Conference (1982) p909
- 2 Loughborough, D., The Dust Holding Capacity of HEPA Filters. 21st Air Cleaning Conference (1990) p
- 3 Dymont, J. & Hamblin, C., Development of a HEPA Filter with Improved Dust Holding Characteristics. 23rd Air Cleaning Conference (1994) p
- 4 AECS 30/93402
- 5 British Standard 3928:1969
- 6 Poynting, R., Comparisons of the Sodium Chloride Aerosols used by the CDE for Air Filter Tests. (U) June 1979. CDE Tech. Note No. 393
- 7 Hamblin, C., UKAEA, Unpublished work.

ACKNOWLEDGMENTS

Acknowledgement is due to AAF Ltd, MC Air Filtration Ltd and Trox Brothers Ltd who supplied filters for this work. The work was carried out by AEAT Harwell under contract to the MoD.

(c) British Crown Copyright 1996/MOD

Published with the permission of the controller of Her Britannic Majesty's Stationery Office

DISCUSSION

DORMAN: Carbon black is notorious for forming long chains and is therefore more likely to cause "bridging" than small single particles. I am, however, somewhat surprised that relatively coarse particles size (conclusion 2) may have the effect of closing channel entrances. Could you give a size to "relative" and also say how uneven the deposits were?

DYMENT: The aerodynamic MMD of the airborne carbon black as measured by cascade impactor was $2\mu\text{m}$, with 35% below $1\mu\text{m}$, with 35% below $1\mu\text{m}$. The phenomenon of "uneven deposition" of test dust related to its observed tendency to accumulate more rapidly near the entrances to the pleats, causing eventual flow restriction. We are not able to quantify the degree of unevenness but we assume it results from increased local inertial deposition favored by the local flow pattern and the known cohesiveness of the dust.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

POTENTIAL FOR HEPA FILTER DAMAGE FROM WATER SPRAY SYSTEMS IN FILTER PLENUMS*

by

Werner Bergman, Jan K. Fretthold¹, and James W. Slawski²
Lawrence Livermore National Laboratory
Livermore, CA 94550

Abstract

The water spray systems in high efficiency particulate air (HEPA) filter plenums that are used in nearly all Department of Energy (DOE) facilities for protection against fire was designed under the assumption that the HEPA filters would not be damaged by the water sprays.⁽¹⁾ The most likely scenario for filter damage involves filter plugging by the water spray, followed by the fan blowing out the filter medium. A number of controlled laboratory tests that were previously conducted in the late 1980s are reviewed in this paper to provide a technical basis for the potential HEPA filter damage by the water spray system in HEPA filter plenums.

In addition to the laboratory tests, the scenario for HEPA filter damage during fires has also occurred in the field. A fire in a four-stage, HEPA filter plenum at Rocky Flats in 1980 caused the first three stages of HEPA filters to blow out of their housing and the fourth stage to severely bow. Details of this recently declassified fire are presented in this paper.⁽²⁾ Although these previous findings suggest serious potential problems exist with the current water spray system in filter plenums, additional studies are required to confirm unequivocally that DOE's critical facilities are at risk.

I. Introduction

One of the most serious issues dealing with HEPA filters in DOE nuclear facilities is the potential for HEPA filter rupture during accidental fires and the resulting release of radioactive smoke. This potential is not addressed in most Safety Analysis Reports (SARs) and Environmental Impact Statements (EISs) prepared for DOE facilities. The common practice in SARs and EISs is to use the HEPA filter efficiencies stated on page 22 of the Elder Report:

1 Rocky Flats Safe Sites of Colorado, P.O. Box 464, Golden, CO 80402

2 U.S. Department of Energy, Defense Programs(DP-45), Germantown, MD 20874

*This work was performed under the auspices of the U.S. Department of Energy by Lawrence Livermore National Laboratory under contract no. W-7405-ENG.45. The work was supported by DOE's Defense Program Office of Technical and Environmental Support, DP-45.

99.9% efficiency for the first stage HEPA filter and 99.8% efficiency for every filter stage thereafter under every accident condition.⁽³⁾ Elder obtained these values from unpublished minutes of a meeting held in Albuquerque on December 9, 1971 to discuss HEPA filter efficiency values to be used under normal and accident conditions.⁽⁴⁾ The selected values have no technical support and were based on the personal opinions of the twelve people attending the meeting (representatives from the Atomic Energy Commission (AEC) and the Albuquerque Operations Office). One stipulation on the use of the efficiency values, not included in the Elder report, was that "SARs show that the integrity of the filters will be maintained throughout the duration of the accident."⁽⁴⁾ Unfortunately, most SARs and EISs use the Elder HEPA efficiency values without establishing that the filter integrity will be maintained. In contrast to the current practice of using a constant 99.9% or 99.8% efficiency for all conditions, more recent guidance recommends that the HEPA filter efficiency should be determined on a case-by-case basis and can have 0% efficiency in some cases.⁽⁵⁾

The use of water sprays inside HEPA filter plenums was the engineering solution to fires that had occurred at the Rocky Flats Plant. On September 11, 1957 a fire had spread through the ventilation system and threatened the final HEPA filter bank of 700, 1,000 cfm HEPA filters.⁽⁶⁾ Firefighters used 2 1/2 inch hose lines to put out the fire. The HEPA filters were combustible and used media made from cellulose and asbestos fibers. Over 400 of the 700 HEPA filters in the final bank burned through, and almost every filter was ruined.⁽⁶⁾ Following this fire, all combustible HEPA filters in AEC facilities were replaced with non-combustible glass fiber filters. A second major fire occurred at Rocky Flats on May 11, 1969.⁽⁶⁾ The fire engulfed many glove boxes, burning many tons of plastic windows, and spread through the ventilation system. The fire broke through the glove box HEPA filters, intermediate filter banks, and the first stage of the final HEPA filter bank. Firemen were able to put out the fire within four hours and before the final stage was breached.⁽⁶⁾ This fire was the most expensive (\$27 million) in AEC and DOE history. Following this fire, studies were conducted to evaluate various fire protection systems for HEPA filters. These studies, which are reviewed in this paper, led to the use of water sprays inside HEPA filter plenums. However, another fire occurred at Rocky Flats on July 2, 1980 in which sprinklers were used, but the fire still resulted in extensive HEPA filter damage. An analysis of this fire in this report raises questions about the use of water sprays for protecting HEPA filters from fires.

II. Typical Water Spray System in Filter Plenums

DOE has prepared a standard on Fire Protection Design Criteria in which the water spray system shown in Figure 1 is recommended for use in HEPA filter plenums.⁽⁷⁾ The Design Criteria document formalizes a design that has been used extensively throughout DOE facilities for many years since the 1969 Rocky Flats fire. The fire protection system consists of a heat detector at the plenum inlet, an automatic deluge spray head followed by a demister stage, and manual spray nozzles directed at the first of a two-stage HEPA filter bank. The function of the

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

automatic deluge spray is to provide a uniform sheet of water over the entire cross section of the plenum in order to cool hot intake air. Figure 2 shows the typical spray nozzles used for the deluge spray (Figure 2A) and for the HEPA filter spray (Figure 2B). The deluge nozzle directs a flat, 180° fan-shaped spray pattern toward the floor where the water enters a drain, whereas the HEPA filter spray nozzle directs a 360° cloud of fine mist against the face of HEPA filters. Figure 3 shows a photograph of a deluge spray nozzle mounted on the ceiling of a 4x4 HEPA filter plenum and located close to the inlet of the metal mesh demisters. A second deluge spray nozzle is not seen in the photograph. The deluge spray is generated at 0.25 gpm per square foot of filter area, or 16 gpm for the 16 2'x2' demisters in Figure 3. Any water droplets carried in the air stream are removed by the demisters.

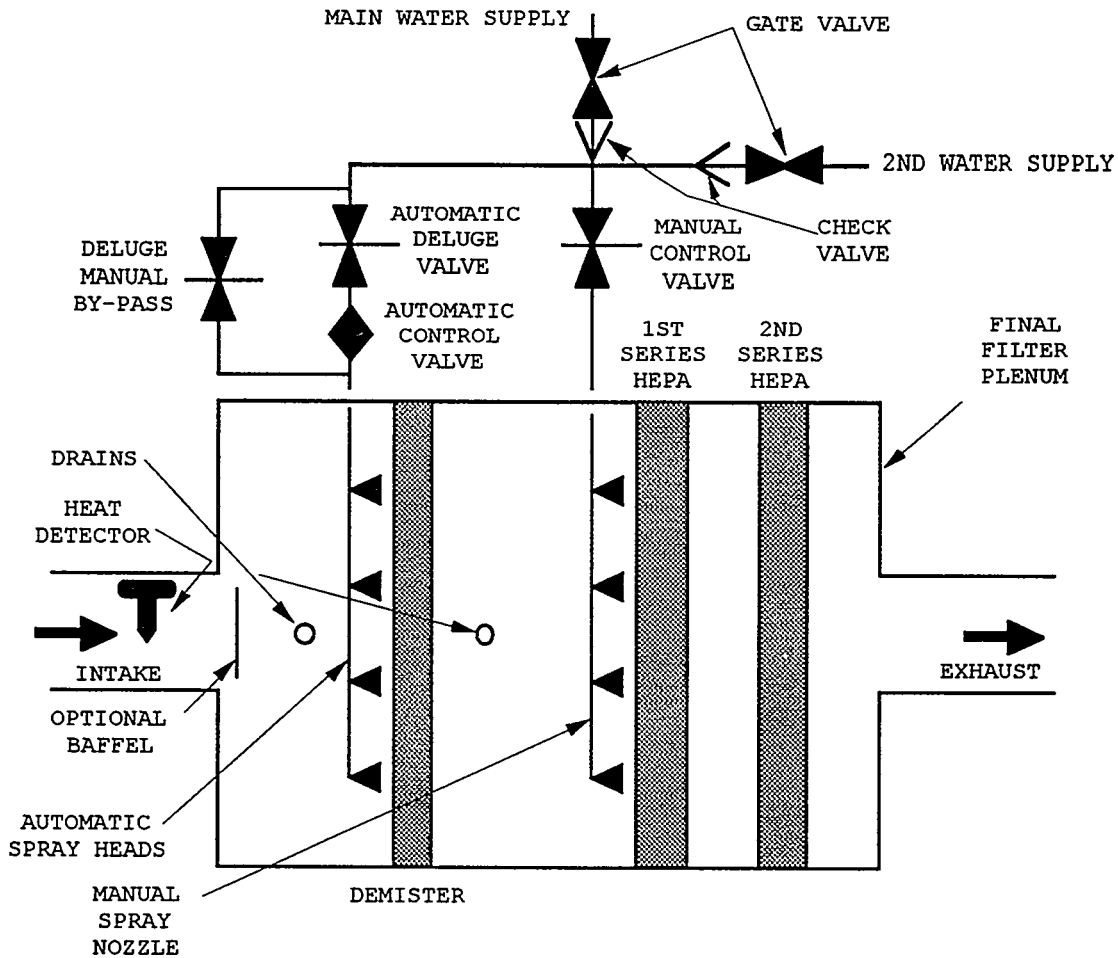


Figure 1 Diagram of the fire protection system for HEPA filter plenums widely used in DOE facilities and specified in DOE Standard on Fire Protection Design Criteria, DOE-STD-1066-XX ⁽⁷⁾

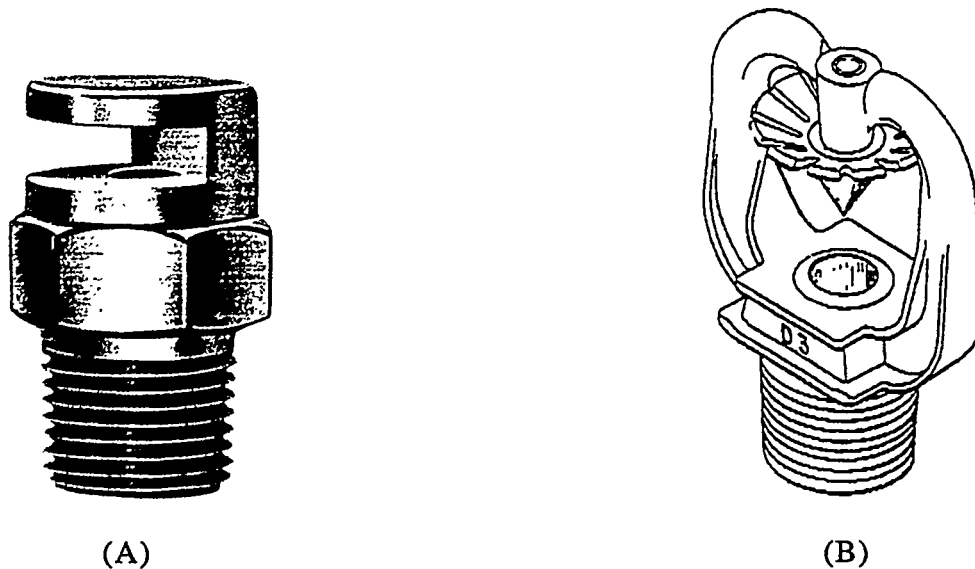


Figure 2. Drawings of typical spray nozzles used for (A) the deluge spray and (B) the HEPA filter spray. The deluge spray nozzle generates a flat, 180° fan-shaped spray pattern. The HEPA filter spray nozzle generates a 360° cloud of fine mist.

Manual spray nozzles, like the one shown in Figure 2(B), are directed at the first stage HEPA filters to put out potential fires should they occur. However, since the HEPA filters are easily damaged by direct water sprays, the selected nozzles must generate a fine water mist. Figure 4 shows a photograph of a manual spray nozzle mounted on the ceiling of the filter plenum with the spray nozzle directed against the first stage HEPA filters. A second spray nozzle is not seen in the photograph. The water flow through both nozzles is 0.25 gpm per square foot of filter area, or 16 gpm for the 16, 2'x2' HEPA filters. Some facilities periodically test the water spray and unavoidably wet the HEPA filters. This practice reduces the strength of the HEPA media as described later in this report and should be avoided.

In preparing the Fire Protection Design Criteria, the DOE fire protection engineers recognized the potential of the water sprays to damage the HEPA filters.⁽⁷⁾ To mitigate this potential, the standard recommends throttling back the fan controls or providing redundant filters. Unfortunately, there are no studies to support these recommendations.

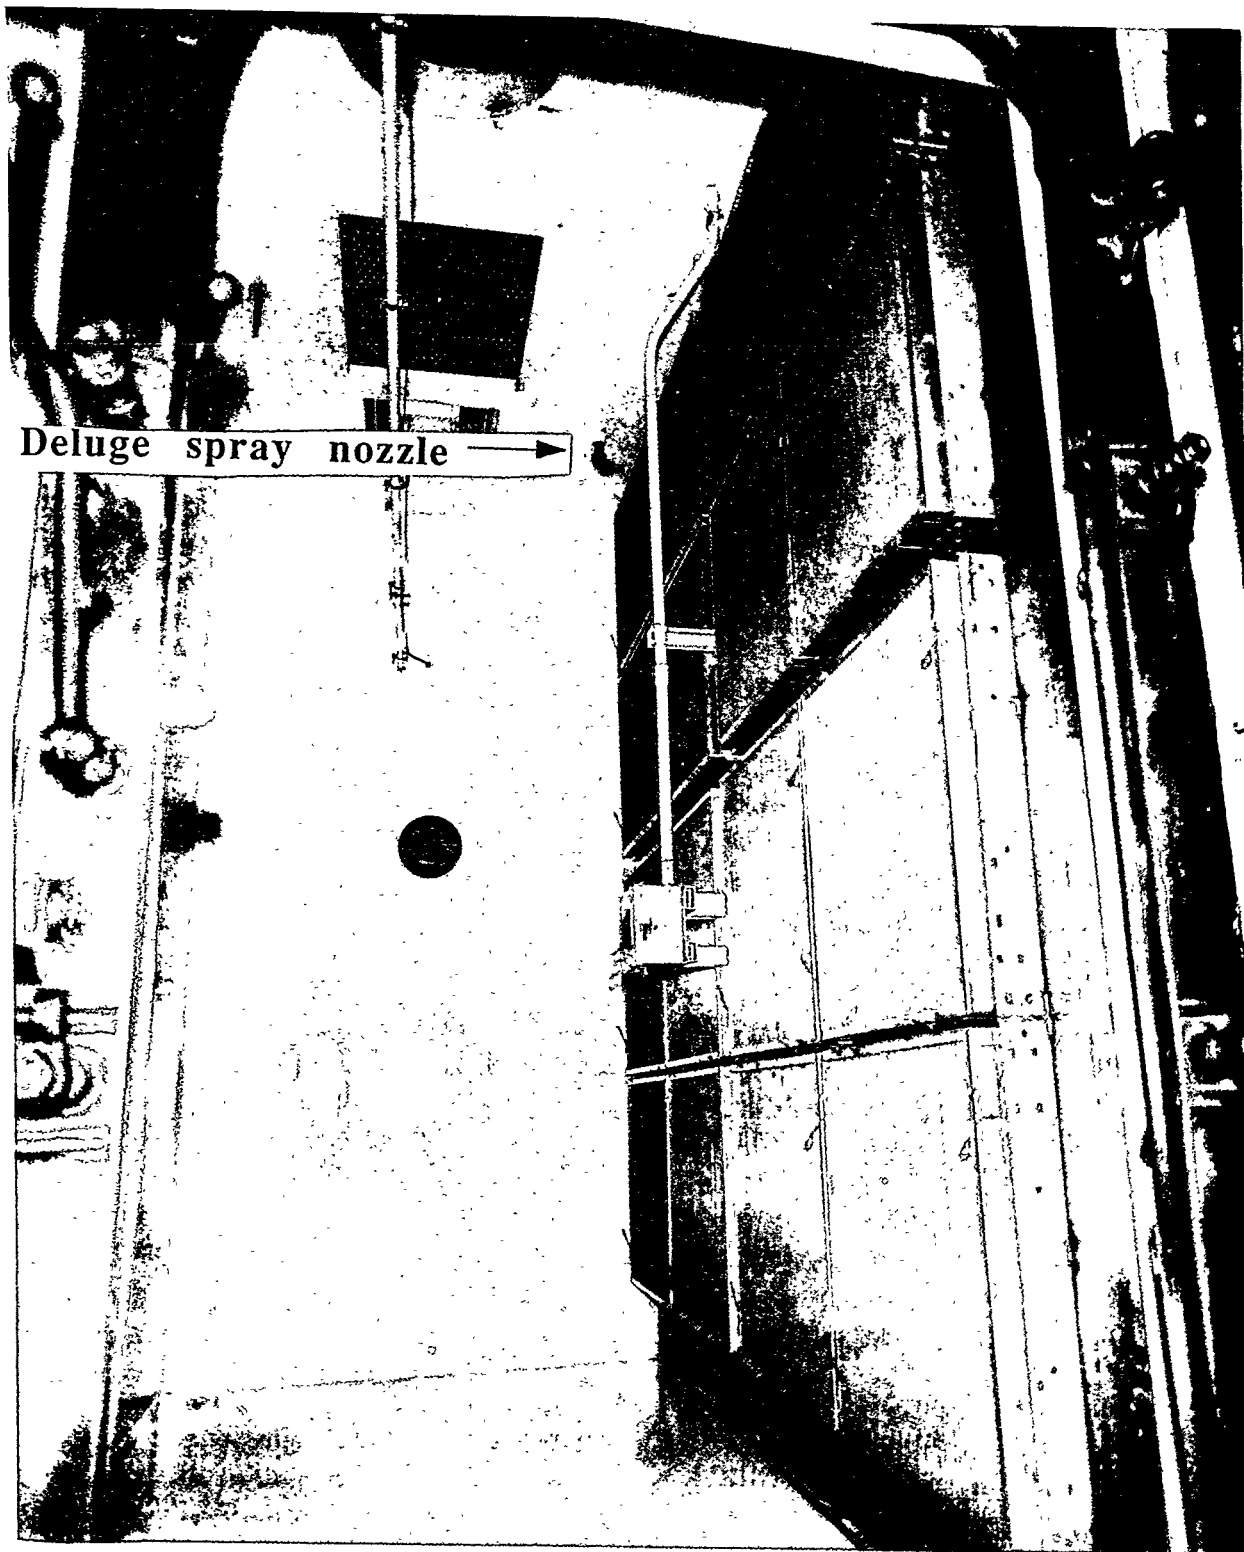


Figure 3. Photograph of a deluge spray nozzle mounted on the ceiling of a 4x4 HEPA filter plenum and located close to the inlet of the metal mesh demisters. The access door to the demister stage was opened for the photograph.

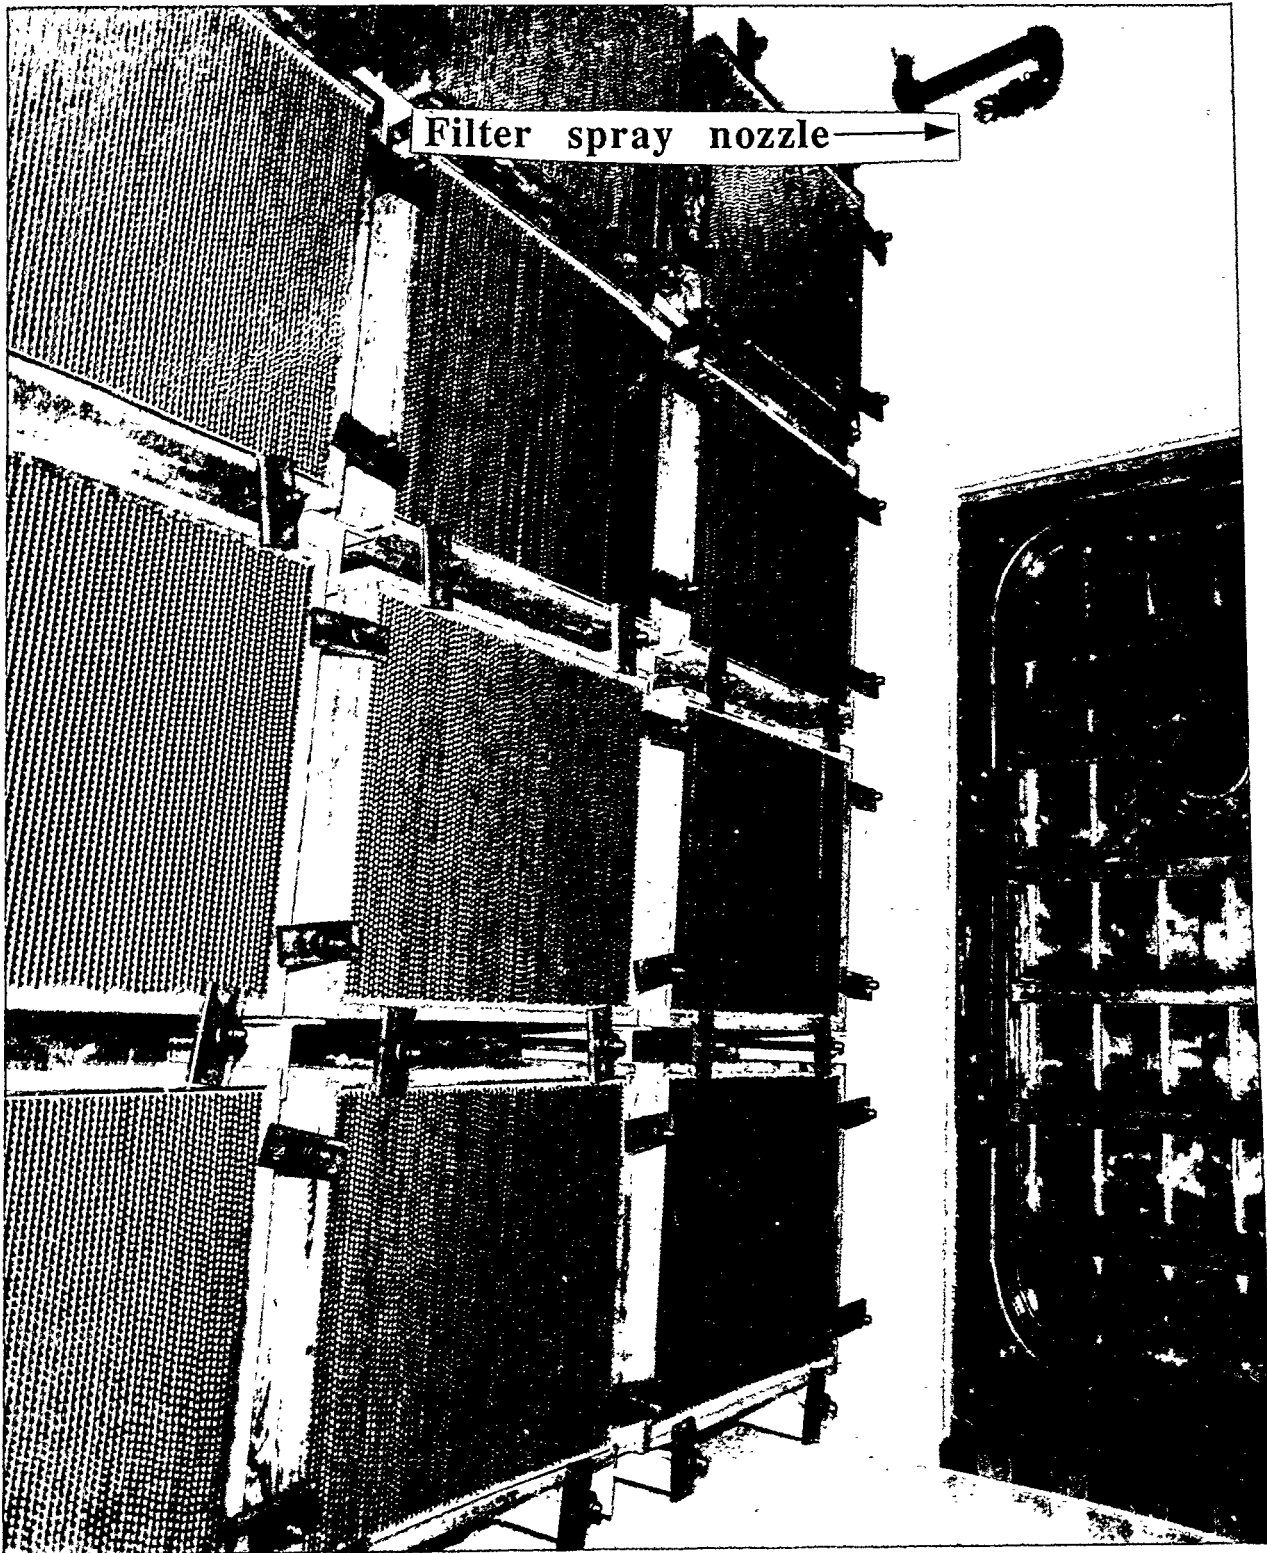


Figure 4. Photograph of a manual spray nozzle mounted on the ceiling of the filter plenum with the spray nozzle directed against the first stage HEPA filters.

III. Studies Conducted in 1970s On Water Spray Systems Were Incomplete

Several studies were conducted after the 1969 Rocky Flats fire to develop engineering solutions that prevent or mitigate the destruction of HEPA filters in filter plenums during ventilation fires. Although these studies demonstrated the performance of various technologies such as water sprays and demisters, no baseline studies were performed to attempt to destroy the HEPA filters under fire conditions that simulated the 1969 Rocky Flats fire. Thus, it was not possible to assess what benefit the fire protection counter measures had on the HEPA filters.

Cartwright et al conducted 13 full-scale tests on a 2-stage, 3x4 HEPA filter plenum (12 HEPA filters per stage) that was specially built for this study at Rocky Flats.⁽⁸⁾ A separate structure was built to house an incinerator that injected hot exhaust into the filter plenum. Only new 2'x2'x1' HEPA filters were used in that study. The authors found that using water sprays directly on HEPA filters would soak the filter and create holes in the media and therefore recommended that direct water sprays be controlled manually and only used under extreme emergencies. They also found that a deflector plate on the inlet pipe and a water curtain followed by a prefilter reduced the gas temperature and prevented most of the sparks and water spray from reaching the HEPA filters. Unfortunately the test conditions in that study were very mild and not representative of potential, worst case conditions. The pressure drop across the HEPA filters in this study was quite low (values ranged from 0.3-0.7 inches) and could not cause any structural damage. No baseline tests were conducted to see the effect of the fire tests on HEPA filters alone.

Domning conducted full scale tests to evaluate water spray heat exchanges for protecting HEPA filters under fire conditions.⁽⁹⁾ He conducted two tests using water sprays on a filter plenum consisting of a single stage of 12 new HEPA filters for each test. In one test, the water spray was directed against an inlet deflection plate and in the second, directly on the 12 HEPA filters. The water flow rate was 0.25 gpm per square foot of filter area. The analysis of the test results showed that the added water spray increased filter plugging compared to plugging by smoke alone. The pressure drop across the HEPA filters was so low (0.3-0.4 inches) that no structural damage was seen.

Gaskill and Murrow conducted 13 tests in which they studied cooling hot gases with various water spray and demister configurations upstream of single, new HEPA filters.⁽¹⁰⁾ They used a propane burner to generate the high temperature air stream. Although they showed that a water spray with demister was effective in reducing the gas temperature, they had no baseline tests with HEPA filters without the water spray/demister system. Moreover, none of the tests showed filter plugging by water because the temperature at the HEPA filter was above the boiling point of water. In addition, since new HEPA filters were used in the study, the filters had the factory treatment of water repellency, which prevents them from plugging with water.

Based on these early studies, fire protection engineers incorporated water sprays and demisters into HEPA filter plenums to protect the HEPA filters against fires. These fire protection systems have remained essentially constant over the years and now represent the standard in DOE facilities.⁽¹⁾ The main attention in these early studies was focused on the high temperature aspects of the fire. Domning's finding that water sprays increased the plugging effect of smoke aerosols was not seen as an important factor for fire protection.⁽⁹⁾ Even after Alvares et al completed an extensive study of HEPA plugging by smoke aerosols, the major concern was still high temperatures inside the filter plenum.⁽¹¹⁾ Alvares et al showed that smoke aerosols can rapidly plug HEPA filters and that water sprays accelerate and exacerbate the effect. However, the primary result of a plugged HEPA filter is the loss of ventilation. Since the plugged HEPA filter prevented radioactive particles, as well as air, from passing through, the plugged HEPA filter produced a passive containment system. Passive containment is presently used in some DOE facilities. Thus, the concerns about HEPA failures during fire conditions seemed to be generally resolved until the mid 1980s when German researchers demonstrated that water sprays and even high humidity can cause HEPA filters to rupture.⁽¹²⁻¹⁴⁾

IV. German Studies in 1980s Show Water Sprays Damage HEPA Filters

Ruedinger et al showed that high humidity can result in high filter pressure drop and decreased media strength, the combination of which can lead to structural damage and loss of filter efficiency.⁽¹²⁾ They built a special test facility to study moisture effects on full-scale HEPA filters under various temperature and flow conditions. They found that the 11 deep pleated HEPA filters with an elastomeric sealant had structural failures at an average differential pressures of 20 inches and as low as 10 inches under wet conditions. The most frequent failure mode is the rupture of the downstream media pleats.

The filters with stainless steel frames and a glass fiber sealant were significantly weaker. The three filters tested failed at an average of 9.5 inches, and as low as 6.8 inches. The failure mode in these filters was the filter pack being pushed out of the frame, since the glass fiber sealant held the filter pack in place by friction.

For both filter types, there was no significant difference in the break pressure whether the filter was clean or had particle deposits. However, with particle deposits, the filter would absorb water at lower relative humidities and would rupture even with a demister to protect the HEPA filter. Ruedinger et al also showed that a new HEPA filter with no particle deposits would not rupture if a demister were used because not enough water would accumulate on the filter to raise the pressure drop to the failure point.⁽¹²⁾ The filter failure under the humid air conditions occurred at differential pressures that were about 1/3 to 1/4 the comparable values for filter failure under dry conditions.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Ruedinger et al confirmed that the decreased strength of the wet HEPA filters is due to the decreased tensile strength of the glass HEPA media.⁽¹²⁾ They showed that the tensile strength of a new filter paper is reduced by a factor of three due to humidity exposure. Ruedinger et al also conducted tests on new HEPA filters made from polycarbonate microfiber media and showed no structural damage up to the maximum pressure of 32 inches of water.⁽¹²⁾ Although these filters do not meet the UL 586 requirements for the spot flame test, they are very resistant to water and acid exposure.⁽¹⁾

Ricketts et al evaluated the structural limits of a variety of different HEPA types under high humidity conditions.⁽¹³⁾ Ricketts et al tested 29 HEPA filters having the conventional US design (deep pleat with adhesive sealant) and found many filters failing at lower pressures than previously reported by Ruedinger et al.⁽¹²⁾ Ricketts et al also showed that the primary failure mode is the rupture of the downstream pleats.⁽¹³⁾ This mechanism is facilitated by the loosening of the filter pack and a ballooning of one or more pleats due to the pressure. Another failure mechanism is the tearing of the media near the sealing edges of the frame and results from a loosened filter pack. They found that the average failure pressure for the deep pleated filter with an adhesive sealant is 16 inches. Of the 29 filters tested, only three had failures less than 10 inches of water; one failed at 3.6 inches and two at 7 inches. In separate tests on HEPA filters using glass fiber sealants, they found that the breaking point was one half (8.8 inches) the breaking strength of the standard deep pleat filter with an adhesive sealant. The weakest filter design was the mini-pleat, where the structural failure occurred at an average pressure of 3.6 inches and a minimum of 1.6 inches.

Ricketts et al noted that particle deposits cause HEPA filters to fail at relative humidities less than 100%.⁽¹³⁾ Although the average HEPA failure occurred at 97% relative humidity, two deep-pleated HEPA filters failed after exposure to 80% relative humidity for two hours. In contrast, clean filters require a water content greater than 100% relative humidity to induce structural failures. They found that the failure pressures were the same for filters with and without particle deposits as previously found by Ruedinger et al.⁽¹²⁾

Ricketts et al pointed out that the humidity causes HEPA filters to have structural failures at differential pressures that are 60% to 90% lower than the failure under dry conditions.⁽¹³⁾ For example, a deep pleated, clean HEPA filter is structurally damaged at 13.7 inches under humid conditions and at 92 inches (3.3 psi) under dry conditions.

An important finding by Ricketts et al is that the combination of factors leads to an even greater filter deterioration than the cumulative effect of the individual factors alone.⁽¹³⁾ Tests on the filter media showed that moisture causes a 60% decrease in tensile strength, creases cause a 45% decrease, moisture exposure with subsequent drying causes a 40% decrease, and dust loading on creased samples cause a 5% decrease. A cumulative effect of these factors would predict a residual

tensile strength that is 13% of the value of a new, uncreased HEPA media. Experimental values for filter media subjected to the combination of exposures showed a residual tensile strength that was only 7% of its original value.

Ricketts et al extended their previous studies to show the effect of filter design, particle deposits, and the quantity and time of water exposure on the pressure drop of HEPA filters.⁽¹⁴⁾ They showed that the standard, deep pleated HEPA filter loaded with dust to 4 inches, would reach a pressure drop of 10 inches in 8 minutes and 14 inches in 30 minutes when exposed to humid air with relative humidity between 96% and 99%. The major findings of this study were: (1) particle deposits greatly accelerate the increase in pressure drop due to moisture, (2) the greater the water content, the faster the rise in pressure drop for both clean and dust loaded filters, and (3) mini pleat filters have more rapid increases in pressure drop than deep pleat filters for the same moisture exposures.

The results of these German studies suggest that the water spray systems in filter plenums in DOE facilities may result in HEPA filter rupture during actual fire conditions. Surprisingly, the German studies did not stir much concern with fire protection engineers in the U.S.. Although the controlled laboratory studies were quite convincing, there were no examples of fires in any of the DOE facilities where the water spray caused HEPA filter failures. However, in 1995 Fretthold had issued a recently declassified report that described a 1980 fire at Rocky Flats involving water sprays and blown out HEPA filters.⁽²⁾ That report confirmed the predictions of the German laboratory studies.

V. 1980 Filter Plenum Fire at Rocky Flats Caused Extensive Filter Damage

Fretthold described the results of a fire in a HEPA filter plenum at Rocky Flats that occurred on July 2, 1980.⁽²⁾ The fire occurred in a HEPA filter plenum that filtered the exhaust from an incinerator shown in the drawing in Figure 5. The exhaust from the incinerator is treated in an off-gas system in which the hot exhaust gas is first sprayed with a caustic solution to cool the gas and to neutralize the acid gases and then passed through a wet cyclone to remove suspended particles. Figure 6 shows the off-gas system. The treated exhaust then passes through a booster blower and into the incinerator filter plenum, as shown in Figure 7. A deflector cone at the plenum inlet deflects the incoming air to distribute the air more uniformly over the HEPA filters mounted 3 high and 4 across. Note that only 600 cfm passed through the plenum that had a filter capacity of 12,000 cfm. Although the filter plenum contained 4 stages of HEPA filters, the stages were incorrectly mounted back-to-back. The incinerator plenum did not have an automatic deluge spray system or a demister stage in front of the first HEPA bank. The exhaust from the incinerator plenum then enters the main building plenum.

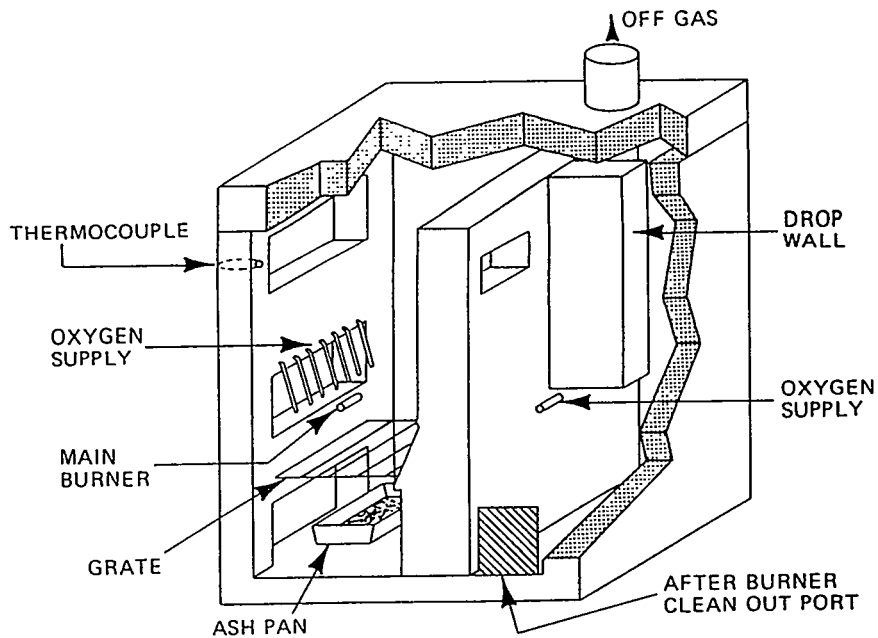


Figure 5. Drawing of the Rocky Flats incinerator.

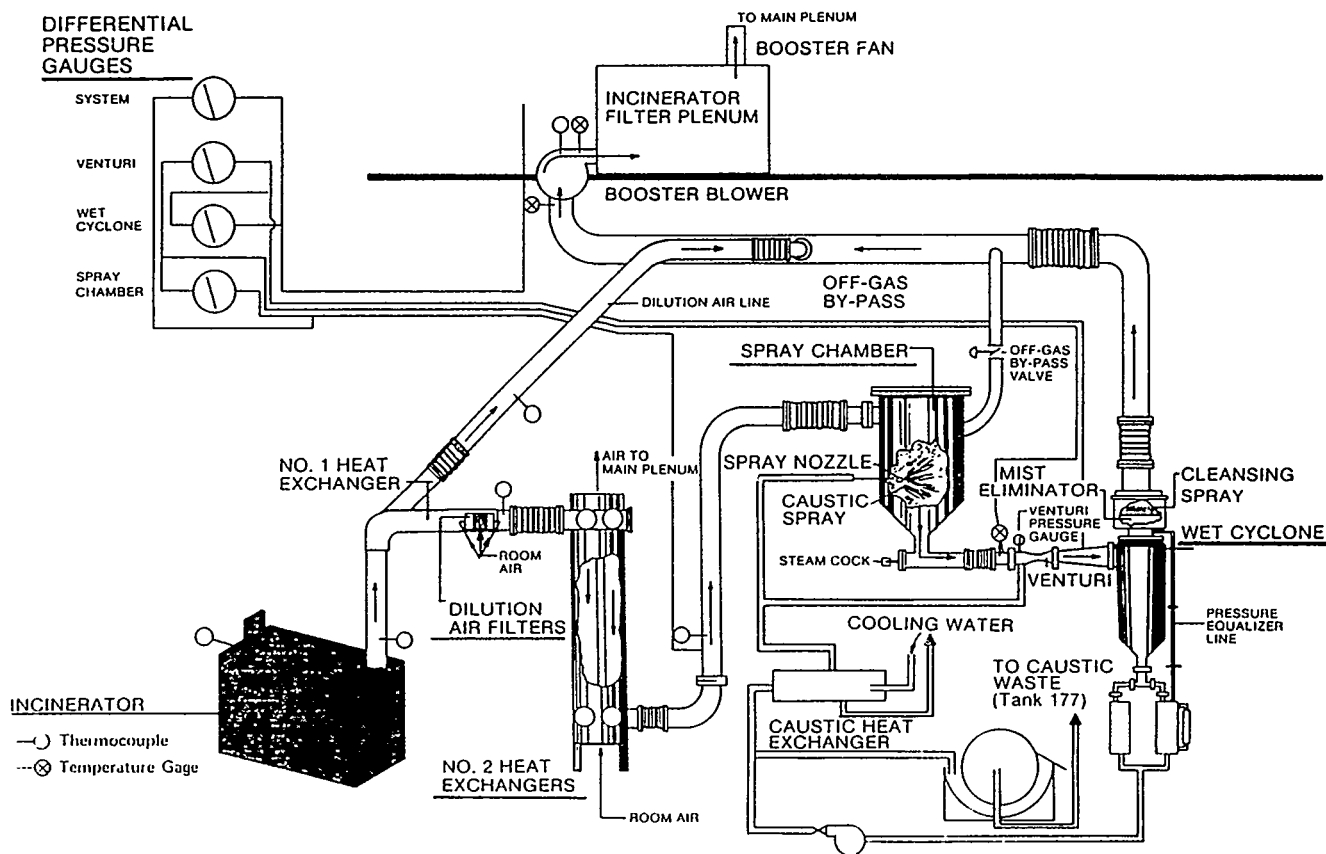


Figure 6. Schematic of the incinerator off-gas treatment system

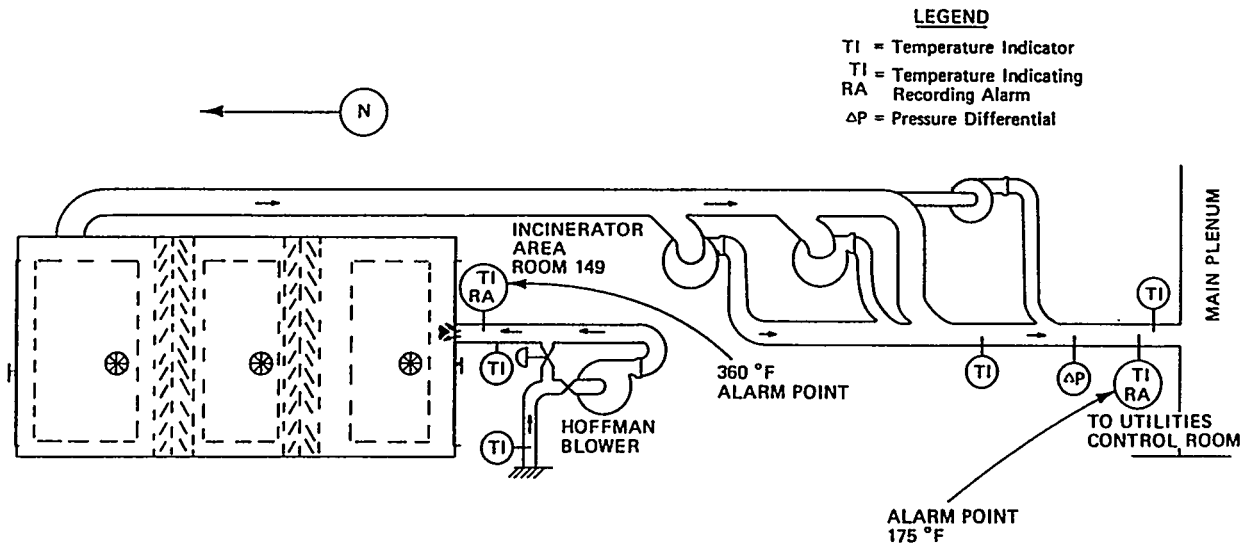


Figure 7. Incinerator filter plenum system

On July 2, 1980, a fire had occurred in the incinerator filter plenum and had extensively damaged the first three stages of HEPA filters and caused the fourth stage to severely bow.⁽²⁾ A continuous recording of the plenum inlet temperature showed the temperature was constant at 100°C for several hours prior to 11:00 A.M.. At that time the inlet temperature increased linearly with time until it reached a maximum 180°C at about 12:40 A.M.. At 11:30 A.M., the production foreman inspected the filter plenum and noted the plenum inlet temperature was 70° C, the differential pressure across the HEPA filters was 0.7 inches of water, and the plenum vacuum was 7 inches of water. These were normal readings. (The automatic temperature recording at 11:30 A.M. showed the inlet temperature was 110°C, not 70°C.) At 12:34 P.M., the alarm for the incinerator filter plenum sounded as well as the main filter plenum. The deluge spray also was automatically activated in the main plenum. Responding to the incinerator fire alarm, the utilities manager observed a red glow within the incinerator plenum and then activated the manual deluge sprinklers. Shortly thereafter, firemen arrived and also noticed a red glow in the plenum and that the manual water spray had been activated. They then attempted to enter the plenum with building water hoses, but could not open the airlock doors due to the high vacuum. After reducing the air flow, the firemen entered the incinerator plenum and sprayed the HEPA filter banks with a fine water mist. Photographs of the filter plenum in Figures 8-14 showed extensive HEPA damage.

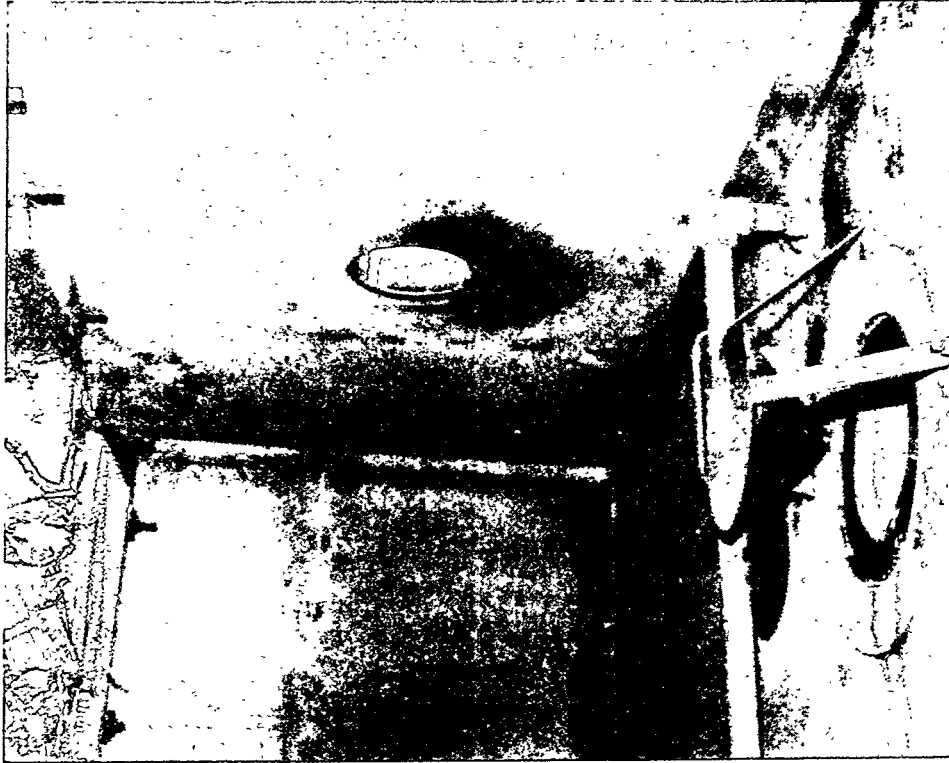


Figure 8. Photograph inside the front chamber of the filter plenum showing the air inlet with deflector cone and the damaged first stage HEPA filters.



Figure 9. Photograph showing the front side of the first stage HEPA filters.



Figure 10. Photograph inside the middle chamber of the filter plenum showing the rear side of the 2nd stage HEPA filters.



Figure 11. Photograph inside the middle chamber of the filter plenum showing the front side of the 3rd stage HEPA filters.



Figure 12. Photograph of the front side of a 3rd stage HEPA filter.



Figure 13. Photograph inside the second chamber of the filter plenum between the 2nd and 3rd HEPA stages. Note the partially melted plastic light fixture on the ceiling of the plenum.



Figure 14. Photograph of the rear side of the 4th stage HEPA filters.

The investigation following the fire concluded that the primary cause of the fire was the deteriorated off-gas bypass valve on the spray chamber shown in Figure 6.⁽²⁾ The untreated hot exhaust was able to bypass the off-gas treatment and enter directly into the HEPA filter plenum. This raised the gas temperature at the plenum inlet to a maximum 180°C (356°F). In addition the investigators speculated that nitric and hydrochloric acids in the exhaust may have reacted with the urethane foam sealant used on the HEPA filters and raised the temperature even further.⁽²⁾ The investigators also found metal oxide powders consisting of Cr, Fe, and Ni and as well as chlorates and nitrates on the filter media. Because the metal on the filter suggest their origin was stainless steel, the investigators concluded "This is an indication that the stainless steel duct work is being corroded by the acidic environment." From this, the investigators concluded that "All of these very fine metal particles collected on the filter media are capable of supporting combustion" and was responsible for igniting the HEPA filters.⁽²⁾

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

VI. Reevaluation of the Filter Plenum Fire Shows Water Sprays Caused the HEPA Filter Blow-out

Unfortunately, the investigators did not correctly assess the cause of the fire based on the evidence. They had assumed that acid had corroded the stainless steel ducting and somehow released unoxidized metal particles that were transported in the air to the HEPA filters. The problem with the investigators' assumption is that it is not possible for acid (or oxygen, salt, or any chemical) to corrode the stainless steel and release unoxidized metal particles. If acid or oxygen reacts with the stainless steel, it quickly oxidizes the iron. The oxidized iron is seen as the typical "rust powder" on the surface of steel. The "rust" will eventually ablate from the steel surface and be carried in the air stream to the HEPA filters. This is a common observation in the off-gas from incinerators.⁽¹⁵⁾ In fact, so much rust had accumulated in the prefilters at the Savannah River incinerator that the prefilters had turned an orange brown color.⁽¹⁵⁾ Once the metal has oxidized, it cannot be oxidized further and therefore will not support combustion.

The only combustible component in the HEPA filters used in the Rocky Flats incinerator plenum was the sealant that held the media pack to the frame. All other components were non-flammable as recognized by the fire investigators.⁽²⁾ The HEPA used metal frames, aluminum separators and the standard glass fiber paper. None of these components will support combustion. Although not seen in Figures 9-14, the sealant was burnt and charred in all of the HEPA filters. However, the sealant was only exposed to the hot air flow on the top and the bottom portions of the frame. The sealant on the two sides is protected by a layer of filter media. Thus any combustion of the sealant would be confined to the upper and lower portions of the frame. This is seen in Figures 9-11, where the sides of the filter media are still attached to the frame, but the top portion of the media pack is completely separated from the frame.

We have previously shown that the urethane sealant in current HEPA filters will char and in some cases burn during the heated air qualification test.⁽¹⁶⁾ Figure 15 shows a photograph of a new HEPA filter similar to widely used HEPA filters in DOE facilities following the standard heated air and overpressure test.^(16,17) The urethane sealant had completely burned through from the inlet to the exit face of the HEPA filter during the heated air test. In this test, the HEPA filter is exposed to the rated air flow heated to 700 °F (371°C) for five minutes.⁽¹⁷⁾ During the test, the burning urethane was seen as a red glow with only a small flame. Following the heated air test, the burnt filter had a DOP penetration of 1.24% and therefore passed the qualification test. However with the sealant burnt through, the filter pack was loose within the frame and could easily move forward or backward. The burnt filter was then placed in the overpressure test apparatus where the pressure drop across the HEPA filter was ten inches of water.⁽¹⁷⁾ That pressure had displaced the HEPA filter pack about one inch in Figure 15 and was very close to blowing out the entire pack.

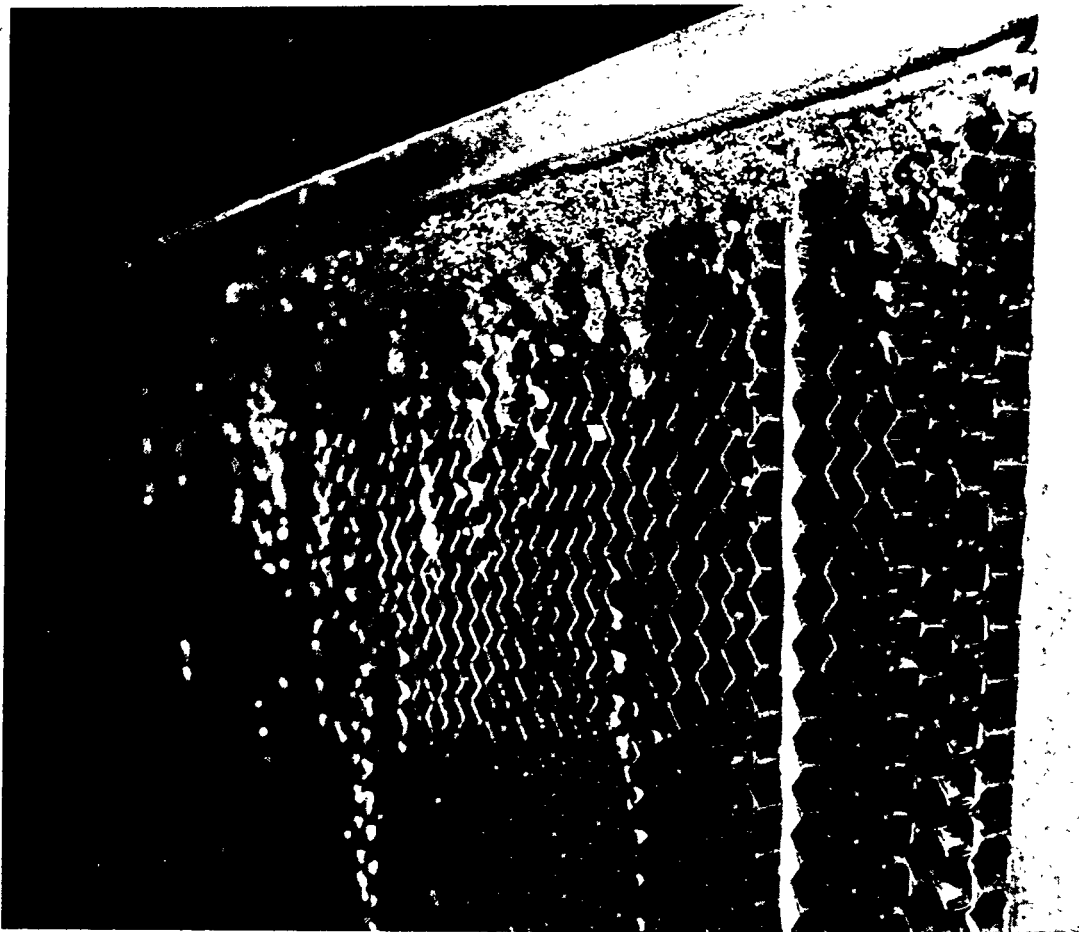


Figure 15. Photograph of the exit side of a new HEPA filter after the heated air and overpressure test. The burned urethane sealant created a separation between the filter pack and the filter frame.⁽¹⁶⁾

It is possible to reconstruct the sequence of events leading to the HEPA destruction shown in Figures 8-14 from an analysis of the photographs and the findings in previous studies. The initial step was raising the temperature of the air to a sufficient level to burn the urethane sealant. This was due to the defective by-pass valve in the off-gas treatment system. An added temperature increase may have come from the exothermic reaction between the acids and the urethane. Once the urethane sealant reached its ignition temperature, the sealant would burn. At this point, the HEPA filters would still be relatively intact. Based on our previous study, even a HEPA filter in which the sealant had burned completely through still had 99% DOE efficiency.⁽¹⁶⁾ However, when the area foreman saw the red glow inside the filter plenum and turned on the water spray, the water caused

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

the HEPA filters to plug. The effect of water plugging of HEPA filters was well documented in the German studies.⁽¹²⁻¹⁴⁾ Domning and Alvares et al also showed that water sprays greatly enhance the normal filter plugging from smoke aerosols.^(9,11) Bergman et al also showed that temperature or age will remove the water repellency treatment in HEPA media and thereby also result in HEPA plugging when exposed to moisture.⁽⁵⁾ The high temperature in the filter plenum would be sufficient to drive off the water repellency treatment and result in HEPA plugging with water.

Once the filters were plugged or partially plugged, the pressure on the filters from the air flow was greatly increased and pushed against the filter pack (Recall that the firemen could not open the doors because of the negative pressure). For those filters in which the filter pack was loose from the burned urethane sealant, the pressure would cause the weakest part to be deflected. From Figures 9-12, the HEPA filter deflection began at the top of the filter where the filter pack had separated from the frame. Once the filter pack lost its integrity, blowing out the central part of the filter was easy. Note that not all of the filters suffered the same extent of destruction. Some filters showed no structural damage. The key to the filter damage was whether the filter pack was loose in the filter frame as a result of the urethane burning. Once some of the filters were blown out, the remaining filters were spared because the pressure on the filter bank was relieved when most of the air passed through the open paths.

The final filter bank was not destroyed, although some of the HEPA filters had severely bowed, as shown in Figure 14. The final HEPA stage would have experienced a lower temperature and far less water exposure than the first three banks. If the urethane sealant on the bowed HEPA filter in Figure 14 were burned out, then it would take less force to push out the HEPA pack because the top portion would be loose and not attached to the filter frame. The fact the filter pack is not blown out, but bowed, indicates the top urethane sealant was still holding the media pack to the filter frame.

Although the above scenario is consistent with the observations and previous studies, the report on the filter plenum fire stated that "the first three stages were sprayed and cooled" with fire hoses. To verify that the HEPA filter damage seen in Figures 8-14 was not due to firemen blowing out the filters with high pressure hoses, we interviewed two firemen who entered the plenum and sprayed the HEPA filters.⁽¹⁸⁾ The first fireman stated that he looked through the viewing port on the inlet side of the first bank of HEPA filters and saw that the first bank was on fire, and that the HEPA filters showed large structural damage.⁽¹⁸⁾ He also saw part of one HEPA filter on fire lying on the floor of the plenum. No one had entered the plenum at that time. After the air flow was turned down, he entered the downstream plenum door with a water hose having a fog nozzle. The hose was connected to the building water supply. He saw that the HEPA filters were on fire and sprayed them with the water mist, although none of the downstream HEPA filters were breached (See Figure 14). He also stated that the HEPA filter damage could not be caused by the water mist that he used.⁽¹⁸⁾

The second fireman arrived later and stated that he had entered the upstream plenum room (Figures 8 and 9) and saw the entire filter bank had been destroyed.⁽¹⁸⁾ He did not spray any water on the first stage filters because there was no remaining fire. On entering the second door (Figures 10-13), he saw HEPA filters on fire and sprayed them with the water fogger. He stated that his spraying caused no further structural damage to the filters. He then entered the exhaust plenum, but since there was no fire and the HEPA filters were not damaged (Figure 14), he did not spray the filters.⁽¹⁸⁾

VII. Conclusions

The greatest damage to the HEPA filters in the 1980 filter plenum fire was due to the water spray. The high temperature from a defective by-pass valve in the incinerator exhaust was responsible for burning the urethane sealant in the HEPA filters. This, in turn, had weakened the physical strength of the filter pack because there was no longer a mechanical bond between the filter pack and the upper side of the filter frame. We speculate that the HEPA filters in this condition would have been fully operational with minimal deterioration (some filters may have reduced efficiencies to 99%). However, when the water spray was turned on, the filter began to plug with water, which raised the filter pressure drop. This increased pressure was applied to the structurally weakened filters and blew out the filter pack in several of the HEPA filters. Most of the exhaust would then pass through the blown-out HEPA filters and result in close to 0% efficiency for that filter stage. Three of the four filter stages had blown-out HEPA filters, and the fourth stage had some filters severely bowed and ready to rupture. There was no environmental contamination from the fire since the exhaust from the incinerator filter plenum was directed into the building filter plenum, which was not damaged.

The water spray inside the filter plenum was not able to put out the fire as designed. Firemen had to enter the filter plenum with spray nozzles to extinguish the flames. The ineffectiveness of the plenum water spray is due to the inaccessibility to the burning urethane sealant. Once the urethane sealant begins burning, it is not possible to extinguish the fire with ceiling mounted spray nozzles because the water cannot make contact with the burning sealant. The HEPA filter and frame protect the burning sealant from the water spray, especially on the upper side of the HEPA filter. Figures 9-12 show the complete separation of the HEPA pack from the upper frame due to the burnt out sealant.

The 1980 filter plenum fire and the German studies on filter plugging with water sprays raise serious questions about the effectiveness of the water spray system shown in Figure 1 for protecting HEPA filter plenums from fires. The omission of key experiments in the early studies that led to the present fire protection system for filter plenums have perpetuated the belief that the system will work as designed. The early studies showed that water sprays followed by

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

demisters are very effective in lowering the air temperature, but they did not show the system could protect HEPA filters from structural damage. No baseline studies were conducted showing damaged HEPA filters. Laboratory studies show that the current HEPA filters in DOE facilities can be structurally damaged by filter plugging from moisture and/or smoke. Once a HEPA filter is plugged, it is prone to blow-out by the pull of the system blower, especially when the filter is wet.

Although the use of a metal demister, as shown in Figures 1 and 3, improves the reliability of the fire protection system by cooling the air and removing water droplets, the HEPA filters can still be blown out because of smoke and water plugging. Ruedinger et al showed that HEPA filters can rupture due to absorbed water even when protected by demisters.⁽¹²⁾ Ricketts et al demonstrated that if a HEPA filter has particle deposits, it can rupture at relative humidities less than 100%.⁽¹³⁾ Since smoke aerosols can easily pass through demisters, the smoke and high humidity can result in rapid HEPA plugging and subsequent rupture.

The available studies on HEPA filter performance under fire conditions suggest there are problems with the current fire protection systems in filter plenums. Unfortunately there are no studies to confirm that the current fire protection system shown in Figure 1 will prevent the extensive filter blow-out seen in the 1980 Rocky Flats fire. German studies on filter blow out suggest that smoke and moisture can rapidly plug the filter plenum system in Figure 1 and result in filter rupture. We recommend an experimental study to confirm that the existing water spray system will work in protecting HEPA filters from rupturing during fires. Until this study is completed, we recommend that 0% efficiency be assumed for each filter stage exposed to a water spray if the blower has at least 10 inches of vacuum, disregarding the presence of a demister. This recommendation had been previously made in our guide for determining HEPA filter efficiency under accident conditions.⁽⁵⁾

Instead of building an elaborate system to protect the fragile HEPA filters, an alternative approach would be to build high strength HEPA filters. Germany and France have installed high efficiency steel filters in the exhaust of their commercial power plants for increased reliability.^(19,20) Bergman et al have developed a cleanable high efficiency steel filter for use in DOE facilities.⁽²¹⁾ With further development, a steel HEPA filter can replace the existing glass fiber HEPA filters. Modest incremental improvements to the existing HEPA filter can also be made such as using a non-combustible sealant and reinforced glass paper.⁽²²⁾

VIII. References

1. DOE (DRAFT) STANDARD : FIRE PROTECTION DESIGN CRITERIA, September 1995, DOE-STD-1060-XX.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

2. Fretthold, J.K. "Summary Report of Incineration Plenum Fire, Building 771, July 2, 1980", Rocky Flats Plant Report 4969, May 31, 1995.
3. Elder, J., Graf, J., Dewart, J., Buhl, T., Wenzel, W., Walker, L., and Stoker, A. "A guide to radiological accident considerations for siting and design of DOE nonreactor nuclear facilities" , Los Alamos National Laboratory Report, RFP-3650, June 25, 1984.
4. Atomic Energy Commission, "HEPA Filtration Guidelines," AEC unpublished meeting notes, Albuquerque Operations Office, Albuquerque, NM, 1971.
5. Bergman, W, First, MW, Anderson, WL, Gilbert, H, and Jacox, JW, "Criteria for calculating the efficiency of deep-pleated HEPA filters with aluminum separators during and after design basis accidents" in Proceedings of the 23rd DOE/NRC Nuclear Air Cleaning and Treatment Conference, CONF-940738, NTIS, Springfield, VA, pp. 563-597, 1995.
6. Keightler, D. J. "The fire and explosion experience in filters and ventilation in U.S. nuclear facilities: a 1945-1980 review" , paper presented at CSNI Specialist Meeting on Interaction of Fire and Explosion with Ventilation Systems in Nuclear Facilities, Los Alamos, NM, April 25, 1983.
7. DOE (Draft) Standard, Fire Protection Design Criteria, DOE-STD-1066-XX, May 1996.
8. Cartwright, DR, Johnson, CM, and Thompson, MA, "Filter plenum fire tests" Dow Chemical Company Report CRD 940330-109, Dow Chemical Company, Rocky Flats Division, September 3, 1970.
9. Domning, WE, "Water spray heat exchangers for HEPA protection in accidents (heat removal requirements and the effect of smoke and water on HEPA filters), in Proceedings of 12th AEC Air Cleaning Conference, CONF-720823, NTIS, Springfield, VA, pp 755-769, January 1973.
10. Gaskill, JR and Murrow, JL, "Fire protection of HEPA filters by using water sprays" in Proceedings of the 12th AEC Air Cleaning Conference, CONF-720823, NTIS, Springfield, VA, pp 103-122, January 1973.
11. Alvares, N., Beason, D., Bergman, W., Ford, H., and Lipska, A. "Fire protection countermeasures for containment ventilation systems" in Proceedings of 16th DOE Nuclear Air Cleaning Conference, NTIS Springfield VA, CONF-801038, pp 1213-1277, 1981.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

12. Ruedinger, V., Ricketts, C., and Wilhelm, J., "Limits of HEPA-filter application under high-humidity conditions", Proceedings of the 18th DOE Nuclear Airborne Waste Management and Air Cleaning Conference, NTIS Springfield VA, CONF-840806, pp 1058-1084, 1985.
13. Ricketts, C. Ruedinger, V., and Wilhelm, J. "HEPA -filter behavior under high humidity airflows" in Proceedings of the 19th DOE/NRC Nuclear Air Cleaning Conference, NTIS Springfield VA, CONF-860820, pp 319-352, 1987.
14. Ricketts, C, Ruedinger, V, and Wilhelm, J, "The flow resistance of HEPA filters in supersaturated airstreams, 20th DOE/NRC Nuclear Air cleaning Conference, CONF-880822, NTIS Springfield VA, pp 668-694, 1989.
15. Burns, DB, Wong, A, Walker, BW, and Paul, JD, "Testing cleanable/reusable HEPA prefilters for radioactive waste incinerator air pollution control systems" 24th DOE/NRC Nuclear Air Cleaning and Treatment Conference" . Portland, OR, July 15-18, 1986,
16. Gilbert, H., Fretthold, J.K., Rainer, F., Bergman, W., and Beason, D. "Preliminary studies to determine the shelf life of HEPA filters " in Proceedings of 23rd DOE/NRC Nuclear Air Cleaning and Treatment Conference, CONF-940738, NTIS Springfield, VA, pp 613-638, 1995.
17. ASME AG-1-1994, Code on Nuclear Air and Gas Treatment, The American Society of Mechanical Engineers, 345 East 47th Street, New York, NY, December 29, 1995.
18. Record of telephone conversations between Werner Bergman and Rocky Flats firemen who entered the filter plenum and sprayed the HEPA filters on July 2, 1980, September 16 and 18, 1996.
19. Kaercher, MV, "Design of a prefilter to improve radiation protection and filtering efficiency of the containment venting system" 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference", CONF-9020823, NTIS Springfield, VA, pp 443-452, July 1993.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

20. Dillmann, HG and Pasler, H, "A filter concept to control airborne particulate releases due to severe reactor accidents and implementation using stainless-steel fiber filters" in 18th DOE Nuclear Airborne Waste Management and Air Cleaning Conference, CONF-840806, NTIS Springfield VA, pp 141701428, March 1985.
21. Bergman, W. et al, "Development and evaluation of a cleanable high efficiency steel filter", 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference", CONF-9020823, NTIS Springfield, VA, pp 586-616, July 1993.
22. Gilbert, H, Bergman,W, and Fretthold, JK, "Development and evaluation of a HEPA filter for increased strength and resistance to elevated temperature" 22nd DOE/NRC Nuclear Air Cleaning and Treatment Conference", CONF-9020823, NTIS Springfield, VA, pp 617-634, July 1993.

DISCUSSION

PORCO: Did the filters have face guards on them?

BERGMAN: No.

PORCO: Does that mean they were not qualified filters?

BERGMAN: I must assume that the HEPA filters were qualified to be used at Rocky Flats. The ones in Rocky Flats in 1980 did not have face guards.

PORCO: I think at that time, as well as now, the QPL requires you to have face guards.

BERGMAN: Even if you had face guards, I think the filters would still suffer significant damage. At the 1984 Nuclear Air Cleaning Conference, Ron Pratt showed a nearly complete filter collapse even with face guards after high temperature exposure. You might prevent total collapse of the entire filter pack but you would still have 50-60% penetration. To me, 60% and 100% penetration results in similar contamination.

PORCO: Face guards would add structural integrity. With high temperature you are aging the filter. Whether it is a rapid or a slow rise, binders will leave the paper and volatiles will leave the sealant. When you add a water spray, you blind the filter, increasing pressure drop, so you would expect a failure.

BERGMAN: I agree. The culprit here is the pressure drop more than the temperature. Indeed, you cause damage from the temperature but not nearly as much damage as the overpressure.

PORCO: I think the point to be made here is, if they were not qualified filters you lose your baseline of comparison.

BERGMAN: I assume that since the Rocky Flats filter test facility certifies HEPA filters for use in nuclear facilities, that the 1980 HEPA filters met all of the requirements including QPL.

FRETTHOLD: The filters were used in a system that had nitric acid in it and the galvanized face guards were literally disintegrating. Consequently, the filters were purchased minus face guards.

PYLE: Did the heated air hitting the HEPA filters exceed the temperature necessary to burn out the organic binder in the medium?

BERGMAN: Yes, the organic binders burned out immediately. Every nuclear grade HEPA filter must pass a heated air test at 750°F. At about 400°F you see a big plume of smoke in the exhaust. That is the binder, but most HEPA filters still have better than the required 97% efficiency.

WILHELM: A dust-loaded HEPA filter failed at a spray rate of around 50g H₂O/m³ air, within 20min. A high strength HEPA filter with the Lydair medium did not fail within 20h. under the same conditions.

DERDERIAN: What is the basis of this 700°F±50°F test of the MIL Specification, and how does it represent fire vulnerability? There is a need for greater dialogue between fire protection and HEPA filter designers.

BERGMAN: That is an excellent suggestion and I recommend everyone attend Dr. Ricketts lecture tomorrow in which he addresses that very subject. I do not know the basis for the 700°F test.

DERDERIAN: I think there is also room for dialogue between the fire protection community, certainly, and the HEPA filter community in the sense that the fire people have always been concerned with deep-seated fires because in most cases they are not amenable to quenching by gaseous agents. That is a generalization that they tend to make. I am not sure it applies in this case but I think there is definitely room for dialogue between the two communities.

BERGMAN: A lot of dialogue.

ENGELMANN: Why did not the emergency response plans call for shutting down the ventilation fans before turning on the water spray?

BERGMAN: I do not know. However, the most recent draft of a DOE fire protection standard recommends limiting the pressure drop across HEPA filters by turning down the ventilation fans.

SIMULATION TEST OF AEROSOL GENERATION FROM VESSELS
IN THE PRE-TREATMENT SYSTEM OF FUEL REPROCESSING*

Sachio FUJINE, Koichiro KITAMURA, and Takehiro KIHARA

Department of Fuel Cycle Safety Research
Japan Atomic Energy Research Institute(JAERI)
Tokai-mura, Naka-gun, Ibaraki-ken, JAPAN 319-11

Abstract

Aerosol concentration and droplet size are measured in off-gas of vessel under various conditions by changing off-gas flow rate, stirring air flow rate, salts concentration and temperature of nitrate solution. Aerosols are also measured under evaporation and air-lift operation.

I. Introduction

Non-volatile radioactive elements such as Pu, Np, Am, Tc, Ru, Sr, Cs and other FPs are confined in the process under normal operation of reprocessing. Almost all radioactive non-volatile fission products are actually confined in highly radioactive liquid waste. However, there are pathways for release of these non-volatile elements to the environment through off-gas and/or aqueous effluents. Radioactivity migration of non-volatile elements takes place in the facility primarily by aerosols. Aerosol generation under normal operation are caused by liquid aeration, evaporation, transportation and other handling of radioactive solutions⁽¹⁻³⁾. Important area of facility for the radioactivity migration is particularly pre-treatment process which contains highly radioactive solutions in vessels. Not only decontamination factor of filters but also radioactivity behaviors in the process play the important role in assessment of source terms of environmental releases from large scale reprocessing plant⁽⁴⁾. Role of aerosol behavior is significant especially for the migration of non-volatile nuclides. Influences of operation condition of vessels are studied on the concentrations and droplet size of particles of aerosols in off-gas.

II. Experimental

Experimental facility(Fig.1) is composed of a slab-type vessel, a condenser, an air-lift and an exhaustive blower, those are connected with pipes and valves. The slab-type vessel is aerated with air

* Work performed under contract with Science and Technology Agency(STA), JAPAN.

nozzle submerged in the liquid of vessel. Liquid in vessel can be heated with two 5kW electric heaters. Liquid can be circulated outside by air-lift attached to the vessel. Aerosols are sampled on off-gas pipes (Inner diameter 28mm) with Andersen sampler (AS-500). Standard sampling time is 5 hours. Nitrate aqueous solutions, listed in Table 1, are used as the simulated radioactive solution of reprocessing. Salts concentration of sodium, lithium, and nitrate ions are total 100 and 350 g/L. Lithium is added as tracer of the solution. Li in aerosols is analyzed by ICP.

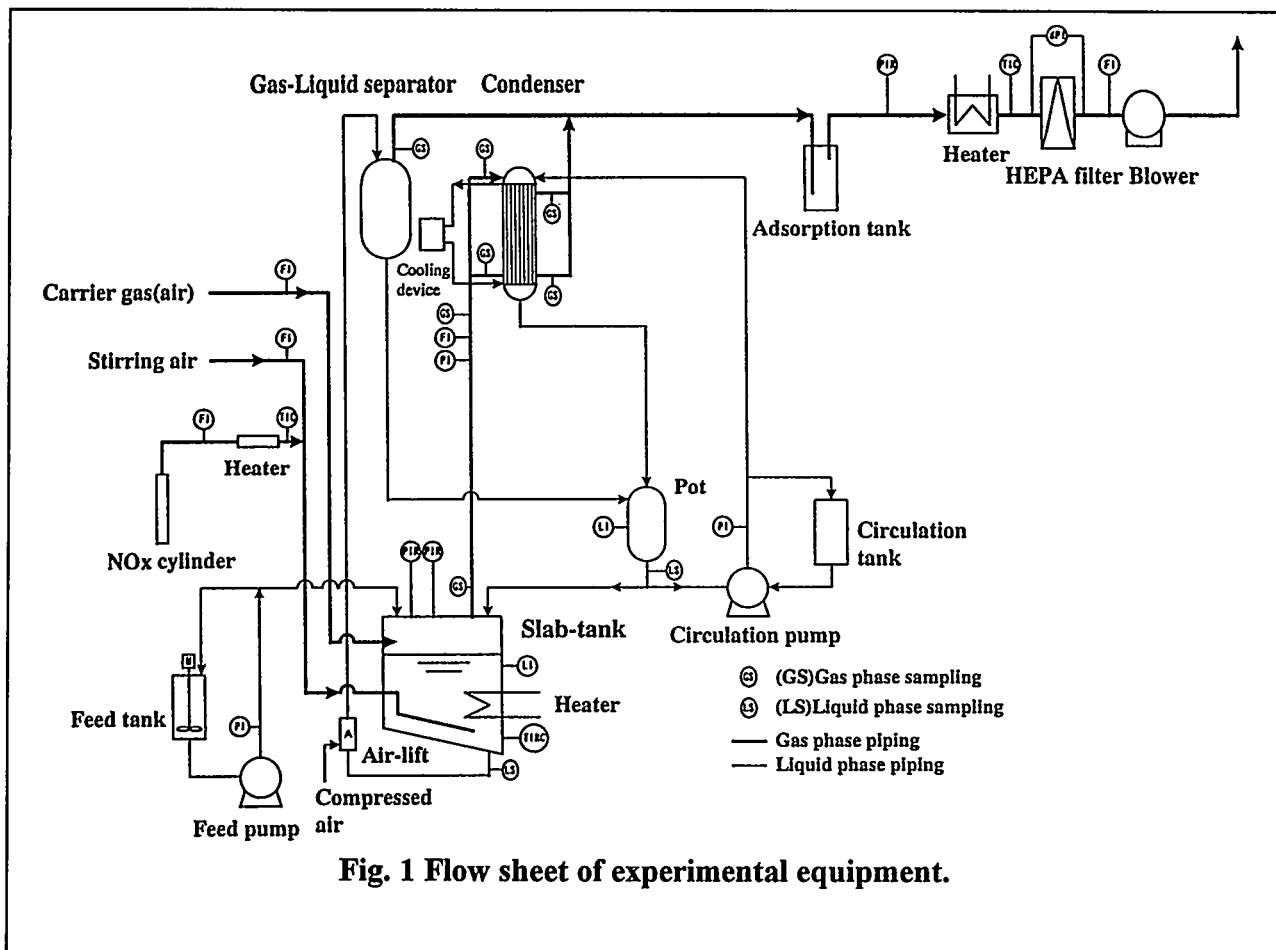


Fig. 1 Flow sheet of experimental equipment.

Liquid volume in vessel is 30L under standard condition of experiment. Distance from air nozzle submerged in solution to liquid free surface is 44cm. Distance from free surface to vessel ceiling is 55cm. Standard air stirring flow rate is 10 m³/hm²-free surface area of vessel which corresponds to a weak stirring condition of chemical process. Linear flow velocity of off-gas is in the range from 2 to 10 m/s. Required off-gas flow rate is adjusted by controlling sweeping air flow rate of the volume above the liquid free surface in vessel.

Aerosols in off-gas are measured at the outlet of vessels under aeration by changing the sweeping air flow rate or stirring air flow rate as operation parameters. Properties of solutions in vessel are changed in some cases. In the case of evaporation operation, aerosols in off-gas are measured at the outlet of condenser of vessels. In the case of air-lift operation, aerosols in off-gas are

measured at the outlet of air-liquid separator.

Table 1 Properties of salt solutions used in the experiment.

solution	concentration g/L	density g/cm³	viscosity cP	surface tension dyn/cm
NaNO₃+LiNO₃ in water	100	1.065	1.17	60.0
NaNO₃+LiNO₃ in 3N-nitric acid	350	1.290	2.33	50.3
NaNO₃+LiNO₃ TBP 100ppm in water	100	1.065	1.12	36.9

III. Results


Off-gas Flow Rate

Aerosol concentrations in off-gas decreases inverse proportionally to off-gas flow rate, as shown in Fig.2. Required off-gas flow velocity is adjusted by changing the sweeping air flow rate on the liquid free surface. Stirring air flow rate is 10 m³/hm² per free surface area of liquid in slab-tank. Aerosol concentrations are observed in the range from a few to a dozen mg/m³ under the experimental conditions. Numerical values near plots are 50% mean diameters. It is observed that mean particle size decreases from 5.3 to 2.3 μ m by increasing off-gas flow rate. There must be the bigger possibility of trapping for the larger aerosol particles near outlet of slab-tank to off-gas pipe under the higher off-gas flow rate. The outlet is located at ceiling of the tank. Saturation by humid of sweeping air influences to reduce both aerosol concentration and particle size, that is shown in Fig.2 as well.

Stirring Air Flow Rate

Aerosol concentrations in off-gas increases roughly proportionally to stirring air flow rate, as shown in Fig.3. This figure shows the relations between aerosol concentration at off-gas outlet of tank and stirring air flow rate for several kind of solutions. As for NaNO₃ 3M-nitric acid solution,

aerosol concentrations are less than 10 mg/m^3 in the range of less than $30 \text{ m}^3/\text{hm}^2$ stirring air flow rate. A separate peak of the smaller particle size in addition to the main peak of the bigger particle size is observed in the aerosol size distribution for the higher range of stirring air flow rate in the experiment.

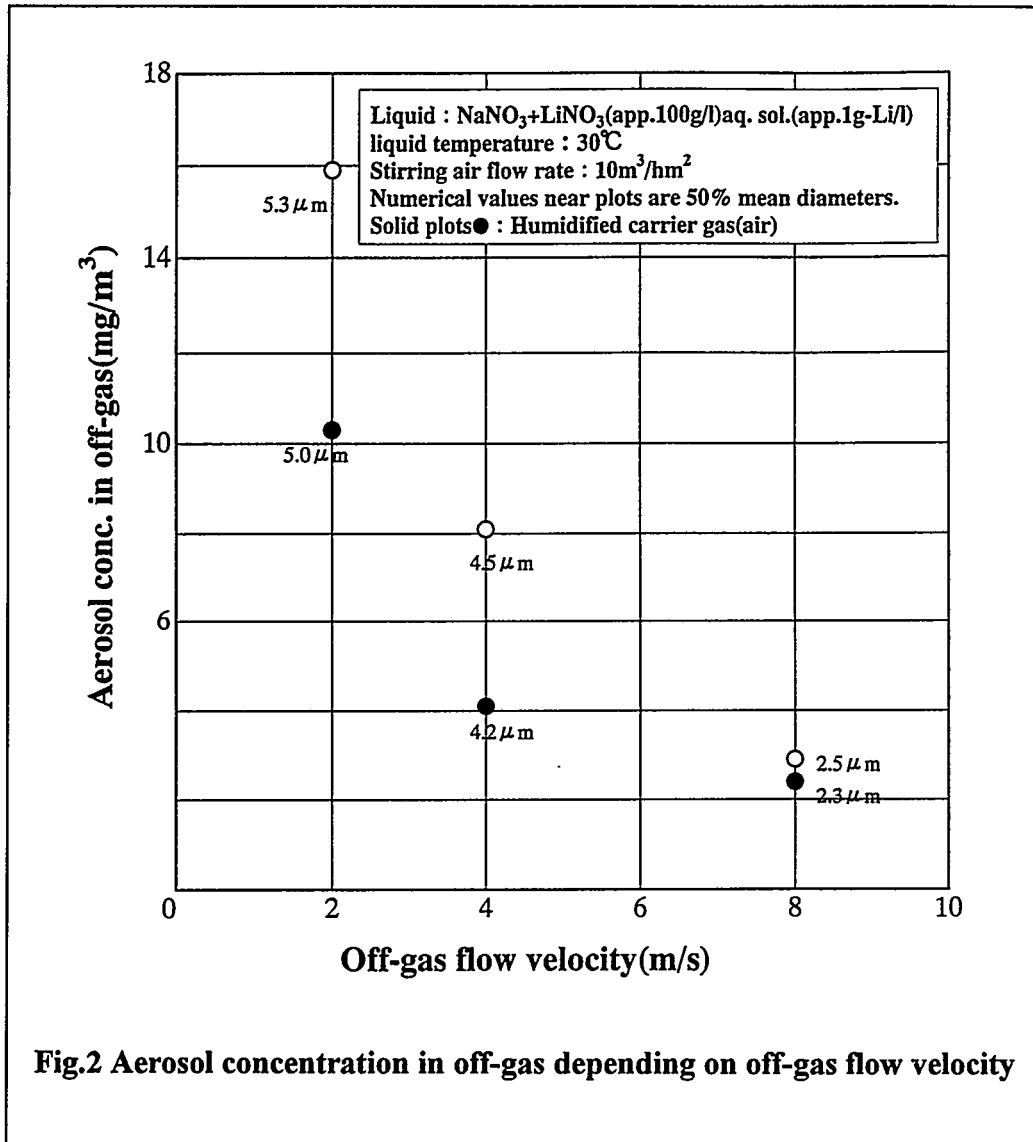


Salts Concentration

Figure 3 shows that a solution of 350 g/L NaNO₃+LiNO₃-3M nitric acid gives the smaller aerosol concentrations in off-gas approximately by half than a 100 g/L NaNO₃+LiNO₃ aqueous solution does. Both viscosity and density are bigger for 350 g/L NaNO₃+LiNO₃-3M nitric acid solution. Viscosity is 2.33 cP and density is 1.290 g/cm³ for the solution. On the other hand, viscosity is 1.17 cP and density is 1.065 g/cm³ for 100 g/L NaNO₃+LiNO₃ aqueous solution. Two peaks size distribution are more often observed for the higher salts concentration.

TBP Addition

Extractant TBP is added by 100 ppm to a 100 g/L NaNO₃+LiNO₃ aqueous solution. Surface tension of the solution is decreased to 36.9 dyn/cm from 60.0 dyn/cm of 100 g/L NaNO₃+LiNO₃ aqueous solution. **Figure 3** shows that aerosol concentration in off-gas increases significantly by 2 to 5 times by TBP addition.

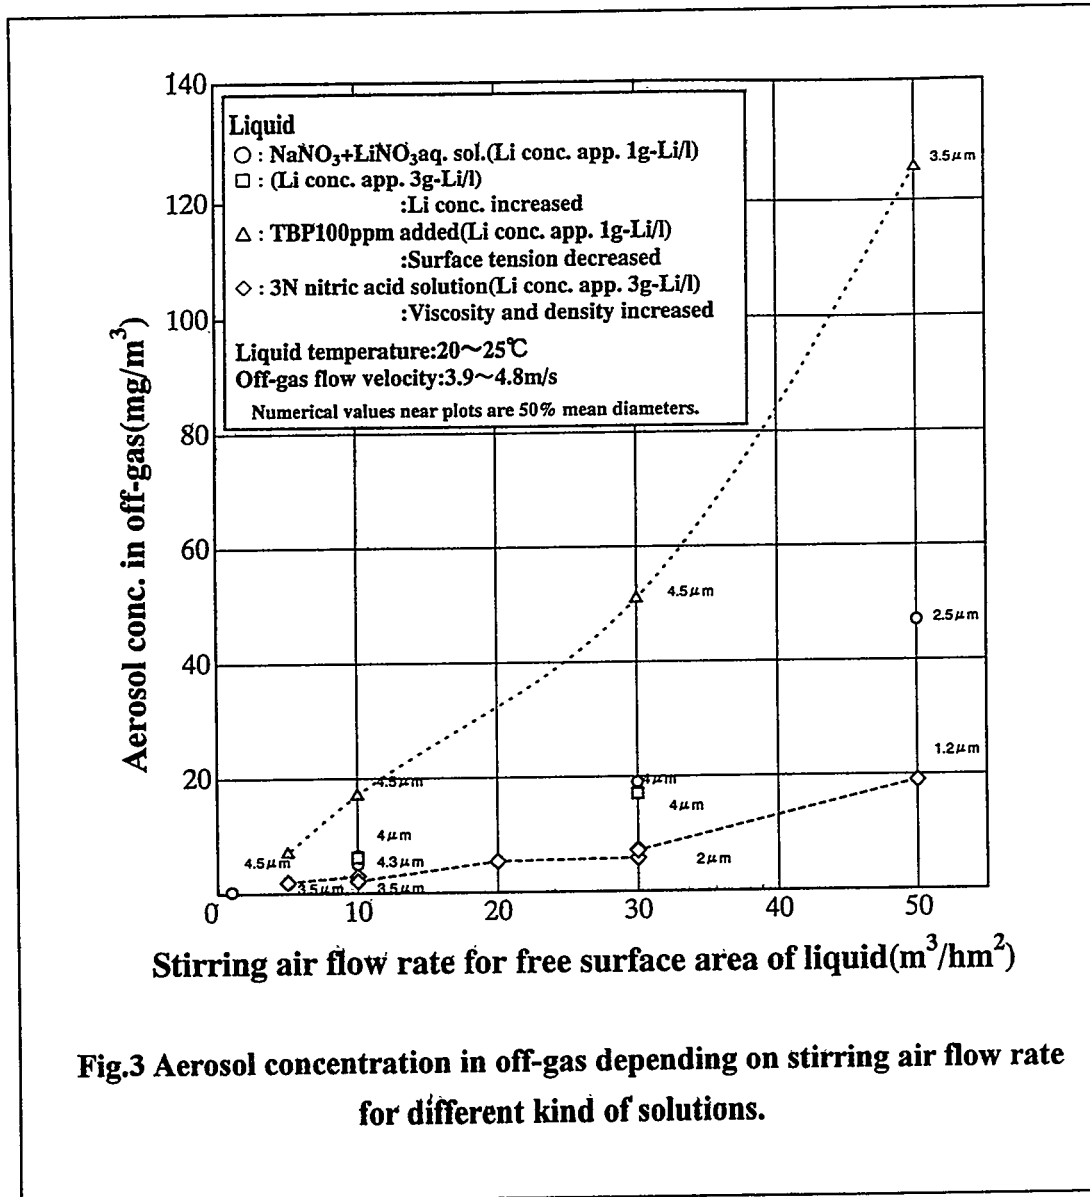

Temperature Increase

Liquid temperature in slab-tank was changed in the range from 20 to 60°C by using two 5kW electric heaters submerged in the solution.

Aerosol concentrations in off-gas are increased by increasing temperature, as shown in **Fig.4**. Surface tension decrease by increasing temperature must be primary cause for the aerosol increase.

Significant aerosol increase is observed at 60°C in particular. More particles of smaller size are observed for the higher temperature.

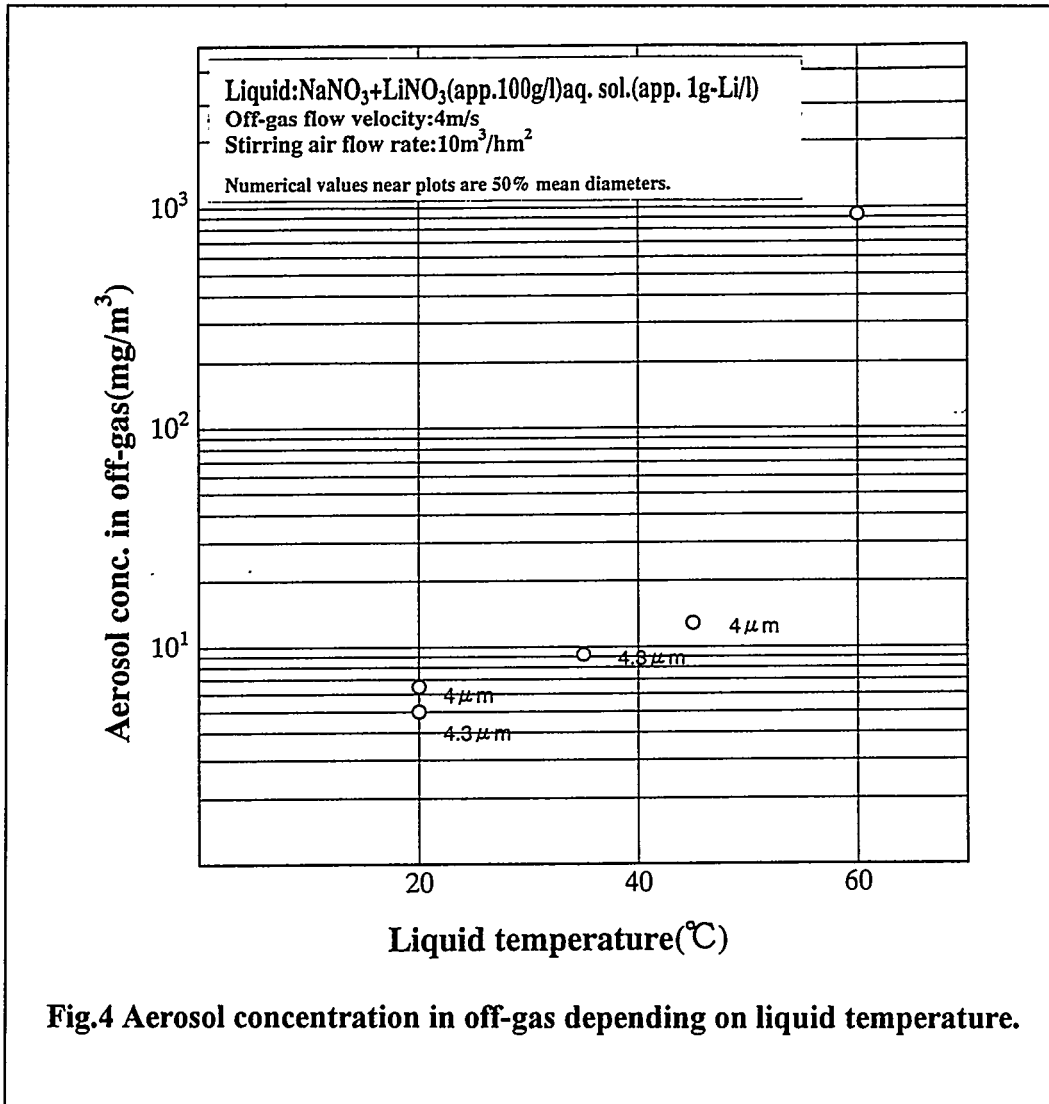


Fig.4 Aerosol concentration in off-gas depending on liquid temperature.

Air-lift Operation

Characteristics of air-lift depends on submergence ratio. Submergence ratio is defined as the ratio of depth of air-lift submergence beneath free surface to total head of lifting liquid. Air-lift was operated by adjusting submergence ratio at 0.3 by keeping app. 30L solution volume in slab-tank. Solution was recycled through air-liquid separator and pot to slab-tank. Diameter of air-lifting pipe is 12.7 mm. Aerosol sampling was carried out for 5 hours on vent pipe from air-liquid separator.

Aerosol concentration in off-gas from air-liquid separator are related to linear velocity of air in air-lifting pipe, as shown in Fig.5. Lifted liquid velocity is also shown in the figure. Aerosol concentrations are roughly proportional to air velocity. And it is observed that aerosol concentrations are in the range from a few to several hundreds mg/m³ in this experimental range. Air-liquid separator

actually has no function to remove aerosol from off-gas. Demister should be applied to reduce aerosol migration to the downstream of off-gas from air-liquid separator.

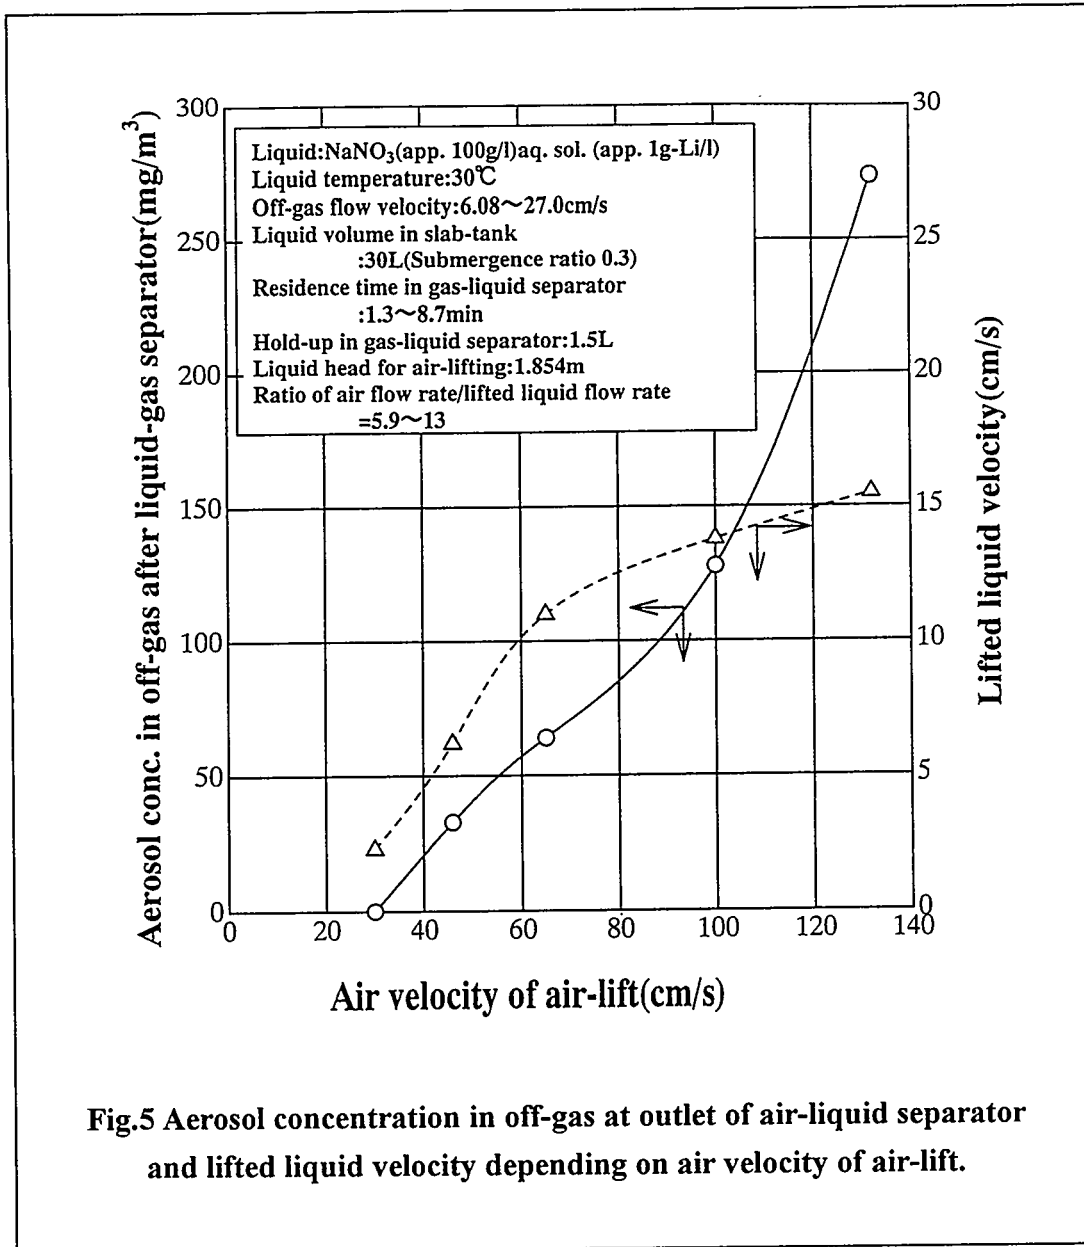


Fig.5 Aerosol concentration in off-gas at outlet of air-liquid separator and lifted liquid velocity depending on air velocity of air-lift.

Evaporation

Evaporation of solution in slab-tank was carried out at the evaporation rate in the range from 1.4 to 7 L/h. Standard evaporation rate is assumed to be 10% liquid volume in one hour, this rate corresponds to 3 L/h in this experiment. Evaporation rate was controlled by heater output and measured by condensate level increase in pot. Inner pressure of slab-tank was adjusted in the range of app. -80 to -200 mmH₂O by exhaustive blower operation. Off-gas flow velocity was adjusted at 4 m/s at off-gas outlet of condenser by controlling carrier air which sweeps the volume above free surface in

slab-tank. Aerosol sample was collected at the off-gas outlet of condenser for one hour.

Aerosol concentration and migration rate to outlet of condenser are related to evaporation rate, as shown in Fig.6. Dependence of aerosol migration rate on evaporation rate is not apparently clear in this experiment. Aerosol concentrations are observed in the range from 2 to 7 mg/m³ in off-gas. Hourly migration ratios are calculated in the range from 6.2x10⁻⁴ to 1.7x10⁻³. Hourly migration ratios are defined by the ratio of migration rate to outlet of condenser divided by total amount of solution in slab-tank.

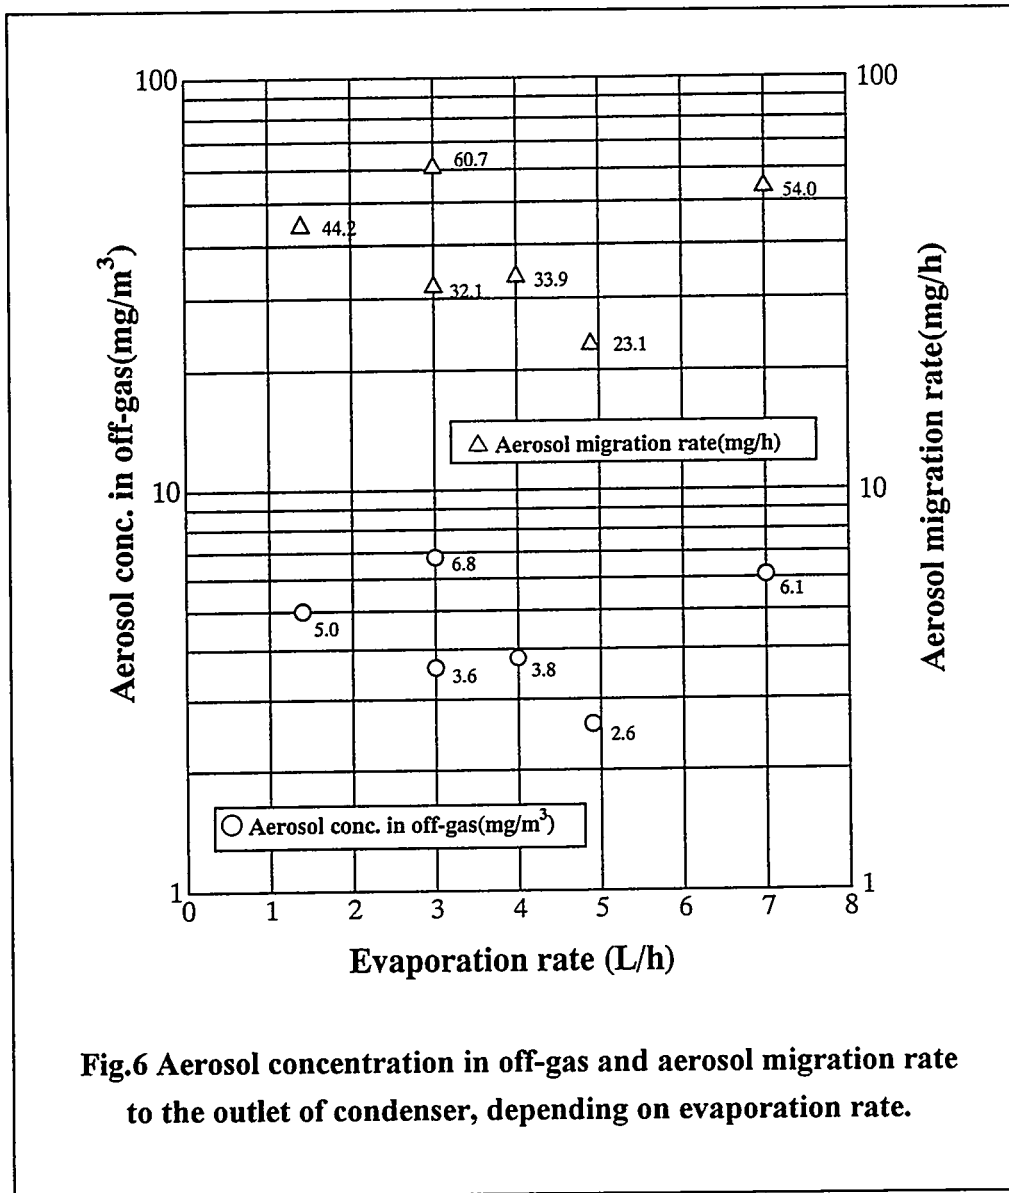


Fig.6 Aerosol concentration in off-gas and aerosol migration rate to the outlet of condenser, depending on evaporation rate.

IV. Conclusion

Aerosols in off-gas are measured at outlet of vessel under various operation condition using

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

simulated nitrate solutions to understand the behavior of non-volatile radioactive elements under normal operation of reprocessing. Experimental results show the following conclusions.

- (1) Aerosol concentrations in off-gas at outlet of vessel are observed in the range from a few to 20 mg/m³ in the range of off-gas flow rate 2 to 10 m/s, stirring air flow rate up to 50 m³/hm², liquid temperature 20 to 45 °C. Aerosol concentration of less than 10 mg/m³ is observed at stirring air rate less than 30 m³/hm² for 350 g/L NaNO₃+LiNO₃-3M nitric acid solution.
- (2) Decrease of liquid surface tension by adding trace amount of TBP increases aerosol concentration in off-gas by 2 to 5 times that of nitrate solution without organic additives.
- (3) Aerosol concentrations in off-gas from air-liquid separator are observed in the range from a few to several hundreds mg/m³. Aerosol removal should be applied to reduce aerosol migration to the downstream of off-gas from air-liquid separator.
- (4) Aerosol concentrations in off-gas from condenser of vessel under evaporation operation are observed in the range less than 10 mg/m³.

Acknowledgements

Authors are grateful to Dr.Y.Naito(Director of the Department of Fuel Cycle Safety Research), Dr.M.Maeda(Director of the Department of NUCEF project) and Mr.G.Uchiyama(Process Engineering Lab.) for technical discussion and guidance.

References

- (1) J.Furrer, K.Jannakos, A.Linek, J.Wilhelm, H.Braun, ANS Inter.Meet.Fuel Rep. Waste Manag. Vol.II. p. II-319(1984).
- (2) K.Nagel, J.Furrer, 19th DOE/NRC Nucl. Air Clean. Conf. NUREG/CP-0086, p.706(1986).
- (3) J.Furrer, A.Linek, R.Krissel, K.Jannakos, 19th DOE/NRC Nucl. Air Clean. Conf. NUREG/CP-0086, p.688(1986).
- (4) JNFS R-91-001(1991).

DISCUSSION

DORMAN: One would expect fairly rapid evaporation of some of the aerosols so size would depend markedly on position of sampling. Did you carry out size measurements at more than one point?

FUJINE: Yes, we measured the aerosol sizes at different points, namely, different distances less than 2 m from the vessel in which aerosols are generated. Average sizes of aerosols observed were not different markedly. Regarding evaporation, we made measurements on the size distribution of aerosols in humidified and non-humidified carrier air. Aerosols in humidified air consist of smaller sizes than those in non-humidified air. However, the difference is not big, approximately 10%. Sampling point was just at the outlet of the vessel. I think the non-humidified air was partially humidified to some extent in our experiment.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

EXTENDED-LIFE NUCLEAR AIR CLEANING FILTERS VIA DYNAMIC EXCLUSION PREFILTERS

Steve R. Wright, Ph.D., Vice President of Research and Development

H. Steven Crouch, MBA, President

Jeffrey H. Bond, M.S., P.E., Applications Engineer and Manager of Business Development

Micro Composite Materials Corporation

4608-D Industry Lane

Durham, North Carolina 27713

Abstract

The primary objective of this feasibility investigation was to ascertain whether a dynamic, self-cleaning particulate exclusion pre-cleaner, previously designed for relatively large dust removal (2 to 100+ μm diameter particles) from military helicopter turbine inlets, could be extended to **submicron** filtration capabilities. If successful, the improved device could then be utilized as a prefilter for many types of HEPA filtration systems, significantly increasing their service life. In applications such as nuclear air cleaning, its use would reduce the amount of nuclear particulate matter that would otherwise be entrapped in the HEPA filter cartridge/panel, causing fouling and increased back pressure, as well as requiring subsequent disposal of the contaminated media at considerable expense.

A unique (patent-pending) mechanical separation device has recently been developed to extract particulate matter from fluid process streams based on a proprietary concept called **Boundary Layer Momentum Transfer (BLMT)**. The device creates multiple boundary layers that actively exclude particles from entering the perimeter of the device, while allowing air to traverse the boundaries relatively unimpeded. A modified two-dimensional (2-D) computerized flow simulation model was used to assist in the prototype design. Empirical results are presented from particle breakthrough and ΔP experiments obtained from a reduced-scale prototype filter. Particles larger than 0.23 μm were actively excluded by the prototype, but at a higher pressure drop than anticipated.

Experimental data collected indicates that the filter housing and the inlet flow configuration may contribute significantly to improvements in device particle separation capabilities. Furthermore, preliminary experiments have shown that other downstream pressure drop considerations (besides those just across the spinning filtration disks) must be included to accurately portray the ΔP across the device. Further detailed quantitative investigations on a larger scale (1,000 CFM) prototype are warranted.

Introduction

High efficiency particulate air (HEPA) cleaning systems perform an important function in nuclear facilities - removal of very fine airborne nuclear particulate matter from the installation. Since nuclear HEPA systems have been proven extremely safe over the years, their extensive use in all major nuclear installations will continue to provide adequate safety margins, but at a high cost of disposal of contaminated filter media. The market for nuclear HEPA systems has been estimated at over a million units annually just in the U.S.¹ Assuming a cost of contaminated HEPA cartridge/panel disposal of

many thousands of dollars per unit, millions of taxpayer dollars could be saved each year by simply extending the service life of these conventional HEPA filters. Environmental benefit would result from reductions in the amount of nuclear contaminated media targeted for high- and low-level radwaste sites.

The use of a medialess (dynamic) *submicron prefilter* would be an expedient solution to this problem. Until recently, an effective medialess prefilter (i.e., such as a high efficiency cyclone or vortex separator) did not exist that could discriminate submicron particle matter. However, a recent development in *supermicron* medialess particulate separators, developed by **Micro Composite Materials Corporation (MCMC)**, was believed to be extendible to the submicron regime. The patent-pending device is currently being developed for the Army to mitigate erosion damage due to sand ingestion in helicopter turbine engines. The mechanical separation/extraction of particulate matter from air or process gas streams, which requires no barrier filter media, is based on a proprietary concept called **Boundary Layer Momentum Transfer (BLMT)**. Boundary layers, generated on multiple closely-spaced rotating disks, actively "*exclude*" particles from entering the 360° perimeter of the filter. Conceivably, a BLMT device designed to have submicron discrimination could be effectively used as a nuclear HEPA prefilter. If operated upstream of a conventional HEPA panel, submicron contaminated particulate matter could be extracted from the air stream, collected and disposed or reprocessed without contaminating the HEPA media. The downstream HEPA panel(s) would still provide the added margins of safety that the nuclear industry demands, but would last much longer due to reduced particulate loading from the BLMT prefilter upstream. The degree to which service life could be extended would be dependent upon the extent of BLMT submicron discrimination. Separation of smaller submicron sizes (down to 0.3 μm) with the BLMT prefilter would lead to longer HEPA service life. Conversely, BLMT discrimination of only larger particle sizes (micron or larger) would lead to shorter downstream HEPA lifetime enhancements.

Theoretical Development

The basic concept of BLMT filtration is to transfer inertia from the boundary layer of a rotating disk to entrained particulate matter; centrifugal force is used to expel particles. This is accomplished by spinning the fluid between each disk pair in solid body rotation: the boundary layers that extend from the sides of each rotating disk must thick enough to touch or overlap. If boundary layer overlap does not occur, either because the disks do not rotate fast enough or because the spacing between disks is too great, the device does not function as a filter.

There are three different means of by which particles are addressed by the BLMT device:

- Particles that are too small to be excluded follow a spiral path through the device and eventually pass through to the exit,
- Particles that are small enough to enter the device but large enough to keep them from passing through to the exit spiral into orbit around the device somewhere between the disks (these particles are eventually excluded from airflow based on secondary effects), and
- Particles that are large enough to be excluded from flow prior to entering the BLMT device.

This paper presents the theory associated with particles that are large enough to be excluded from flow prior to entering the BLMT device. Radial airflow velocity into the BLMT device is small compared to the tangential airflow velocity that circulates outside the rotating disk assembly. Other airflow

characteristics in the radial and tangential directions differ greatly, including Reynold's number and pressure drop.

Theoretical Particle Size Exclusion

The particle size discrimination ability of the BLMT filter device is derived by equating the inertial force developed by the particle to the drag force imposed on the particle. The inertial force developed by the particle is the direct result of being captured in a disk boundary layer. The drag force on a particle is due to the upstream airflow pressure or downstream suction.

Particle Centrifugal Force Development

The basic assumption made in particle centrifugal force development is that a boundary layer rotates with each surface of a disk when it is rotated. The strength, depth, and profile of the boundary layer is related to the rotational velocity of the disk and the physical properties of the fluid surrounding it. Under appropriate conditions, a particle will rotate with the boundary layer at the same speed as the disk. With this assumption, the beginning step in theoretical development is to make use of Newton's second law, where the force, **F**, on a particle is:

$$\mathbf{F} = \mathbf{ma} \tag{Equation 1}$$

Where: **m** is the mass of the particle, and
a is the acceleration of the particle.

From this starting point, a number of substitutions are made to relate acceleration to rotational speed and the relative position of the particle on the disk, and mass of the particle based on density and assumed spherical volume. The result is a solution for the centrifugal force, **F_C**, in terms of known particle and disk parameters:

$$F_C = \frac{4\pi\rho_p R_p^3 \omega^2 R_o}{3} \tag{Equation 2}$$

Where: ρ_p is the particle density,
 R_p is the particle radius,
 R_o is the outside radius at the perimeter of the disk.
 ω is the angular velocity of the particle, and

Equation 2 describes the centrifugal force acting to eject a particle as it attempts to enter the flow field outside the disk. The centrifugal force acting on a particle at this point is:

- Directly proportional to the particle location, or radius (relative to the center of the disk pack), and the particle density,
- Directly proportional to the square of the angular velocity of the disks, and
- Directly proportional to the cube of the particle radius.

Particle Drag Force Development

Drag forces serve to counteract the centrifugal forces due to either downstream suction at the filter exit or pressure at the inlet. In conditions where flows permit low Reynolds' Numbers, the drag force, F_D , on a spherical particle can be approximated by Stoke's Law:

$$F_D = 6\pi R_p V_g \mu_g \tag{Equation 3}$$

Where: R_p is the particle radius,
 V_g is the gas velocity, and
 μ_g is the gas dynamic viscosity.

Substituting known relationships involving gas/fluid mass flow rate, density, cross sectional area, and velocity, the equation can be rearranged to provide a closed-form solution for particle drag force in terms of known gas properties, BLMT filter device attributes, and particle geometry:

$$F_D = \frac{3\mu_g R_p \dot{M}}{R_o d n \rho_g} \tag{Equation 4}$$

Where: \dot{M} is the gas mass flow rate,
 R_o is the outside radius of the BLMT device disk,
 ρ_g is the gas (e.g., air, process flow, or otherwise filtered medium) density,
 d is the distance between disks, and
 n is the number of disks

Equation 4 describes the drag force acting to push a particle in as it enters the perimeter flow field. The drag force acting on a particle in the flow field is:

- Directly proportional to the particle size and mass flow rate,
- Inversely proportional to the radius of the disks, inter-disk spacing, and the number of disks, and
- Directly proportional to the gas kinematic viscosity ($\nu = \mu / \rho$).

When Drag Force Equals Centrifugal Force

Equating the centrifugal force expression, Equation 2, to that for the drag force, Equation 4, results in an expression to be used for identification of particle size cutoff.

$$\frac{\rho_p 4\pi R_p^3 \omega^2 R_o}{3} = \frac{3\mu_g R_p \dot{M}}{R_o d n \rho_g} \tag{Equation 5}$$

Rearranging and substituting particle diameter, D_p , for $2 \cdot R_p$, results in:

$$D_p = \frac{3}{R_o \omega} \sqrt{\frac{\nu_g \dot{M}}{d n \pi \rho_p}} \tag{Equation 6}$$

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The analytical solution for particle size exclusion, Equation 6, varies according to two different sets of parameters: BLMT device parameters and airflow parameters. The device parameters include disk outer radius, angular velocity, disk spacing, and number of disk spaces. The airflow parameters include mass flow rate, gas dynamic viscosity, and particle density.

For filter parameters, the critical particle diameters is:

- Inversely proportional to disk outer radius and angular velocity, and
- Inversely proportional to the square root of the disk spacing and number of disk spaces.

For airflow parameters, the critical particle diameter is:

- Proportional to the square root of mass flow rate and dynamic viscosity, and
- Inversely proportional to the square root of the particle density.

The above equations define, for a given set of BLMT device and airflow parameters, a critical particle diameter (and anything larger) that will “orbit” outside the BLMT device. The following figure schematically illustrates the conceptual BLMT device, showing airflow, particulate matter in orbit, and critical BLMT components.

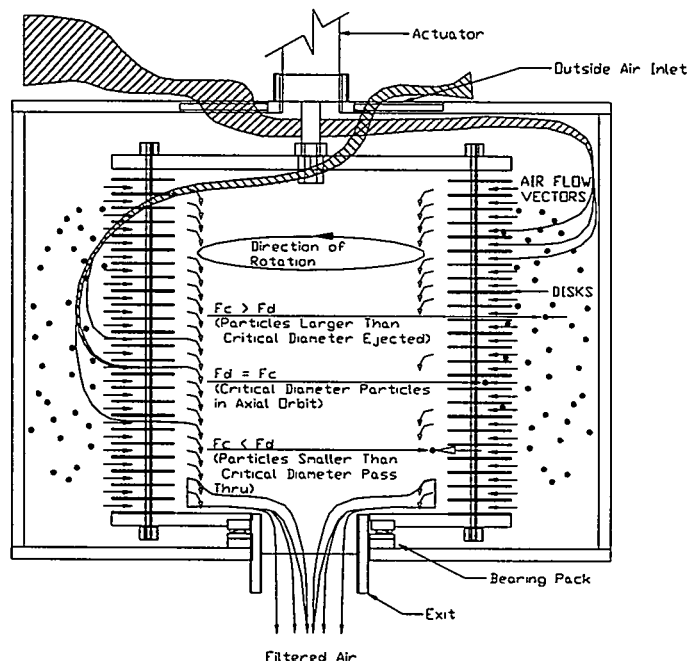


Figure 1. Schematic Representation of the BLMT Filter

Theoretical Pressure Drop

The pressure differential developed in the filter is due to several different factors, primarily including:

- Decreasing flow area,
- Centrifugal forces acting on the rotating gas, and
- Frictional drag along the disk surfaces.

Pressure Loss Due to Decreasing Flow Area

According to Bernoulli's Law, pressure loss is defined as:

$$\Delta P = \frac{\rho_g}{2} (V_o^2 - V_i^2) \quad \text{Equation 7}$$

Where: Subscripts *i* and *o* designate the position at the inside and outside radius, respectively, and all other variables have been previously defined.

Substituting relationships for gas velocity as a function of available flow area and mass flow rate yields:

$$\Delta P_A = \frac{\rho_g}{2} \left(\frac{\dot{M}}{2\pi\rho_g dn} \right)^2 \left(\frac{1}{R_o^2} - \frac{1}{R_i^2} \right) \quad \text{Equation 8}$$

Due to the inverse relationship to the square of the inner and outer radii, this component of the total pressure loss is small, and rapidly decreases in importance as the outside radius increases in size.

Pressure Loss Due to Centrifugal Forces on the Rotating Gas

The pressure loss for flow from the disk outside radius to the disk inside radius is inversely proportional to the differences between their respective flow areas. Starting again with Bernoulli's Law and substituting the relationship of acceleration to rotational speed and the relative position of the particle on the disk yields:

$$\Delta P_B = \frac{\rho_g \omega^2}{2} (R_o^2 - R_i^2) \quad \text{Equation 9}$$

Due to the direct relationship to the square of the inner and outer radii, this component of the total pressure loss dominates the total pressure loss expression, and will increase in importance as the outside radius increases in size.

Pressure Loss Due to Frictional Drag Along the Disk Surfaces

The pressure loss due to frictional drag, *D*, at the boundary layer surface area, *A*, can be expressed as:

$$\Delta P_C = \frac{D}{A} = \frac{C_f \rho_g V_o^2}{2A} \quad \text{Equation 10}$$

Where: *C_f* is the coefficient of friction.

The effect of friction has little or no meaning at these flow rates. This term is considered to be negligible.

Total Pressure Loss

The total pressure loss through the BLMT filter is expressed through the combination of Equations 8 and 9.

$$\Delta P = \frac{\rho_g}{2} \left(\left(\frac{\dot{M}}{2\pi\rho_g dn} \right)^2 \left(\frac{1}{R_o^2} - \frac{1}{R_i^2} \right) + \omega^2 (R_o^2 - R_i^2) \right) \quad \text{Equation 11}$$

BLMT Gas Velocity

The equation defining the air velocity, V , entering the perimeter of the BLMT device is:

$$V = \frac{\dot{M}}{2\pi\rho_g R_o dn} \quad \text{Equation 12}$$

Relationship Between Reynolds Numbers for BLMT Tangential and Radial Flows

To evaluate the ratios of the Reynolds Numbers of flow between the individual disks and circling the BLMT disk pack, the relationship with previously developed equations defined. The Reynolds Number for tangential flow circling the BLMT device is:

$$Re_\omega = \frac{\rho_g R_o \omega h}{\mu_g} \quad \text{Equation 13}$$

The Reynolds Number for radial flow between the individual disks is:

$$Re_h = \frac{\rho_g V_g h}{\mu_g} \quad \text{Equation 14}$$

Using Equation 6, substituting Equation 12, and rearranging terms it can be seen that the following is true:

$$D_p^2 \geq \left(\frac{18}{R_o \omega^2} \right) \left(\frac{\mu_g V_g}{\rho_p} \right) \left(\frac{\rho}{\rho_g} \right) \left(\frac{\mu}{\mu_g} \right) \left(\frac{h}{h} \right) = \left(\frac{18\mu_g}{\rho_p \omega} \right) \left(\frac{\rho_g V_g h}{\mu_g} \right) \left(\frac{\mu_g}{\rho_g R_o \omega h} \right)$$

So the relationship linking particle diameter (to be excluded from flow) to the ratio of radial to tangential BLMT Reynolds Numbers is:

$$D_p^2 \geq \left(\frac{18\mu_g}{\rho_p \omega} \right) \left(\frac{Re_h}{Re_\omega} \right) \quad \text{Equation 15}$$

Future BLMT research involves the scale-up from small-scale and prototype models of the BLMT filter. This relationship will be important in the scale-up to larger models.

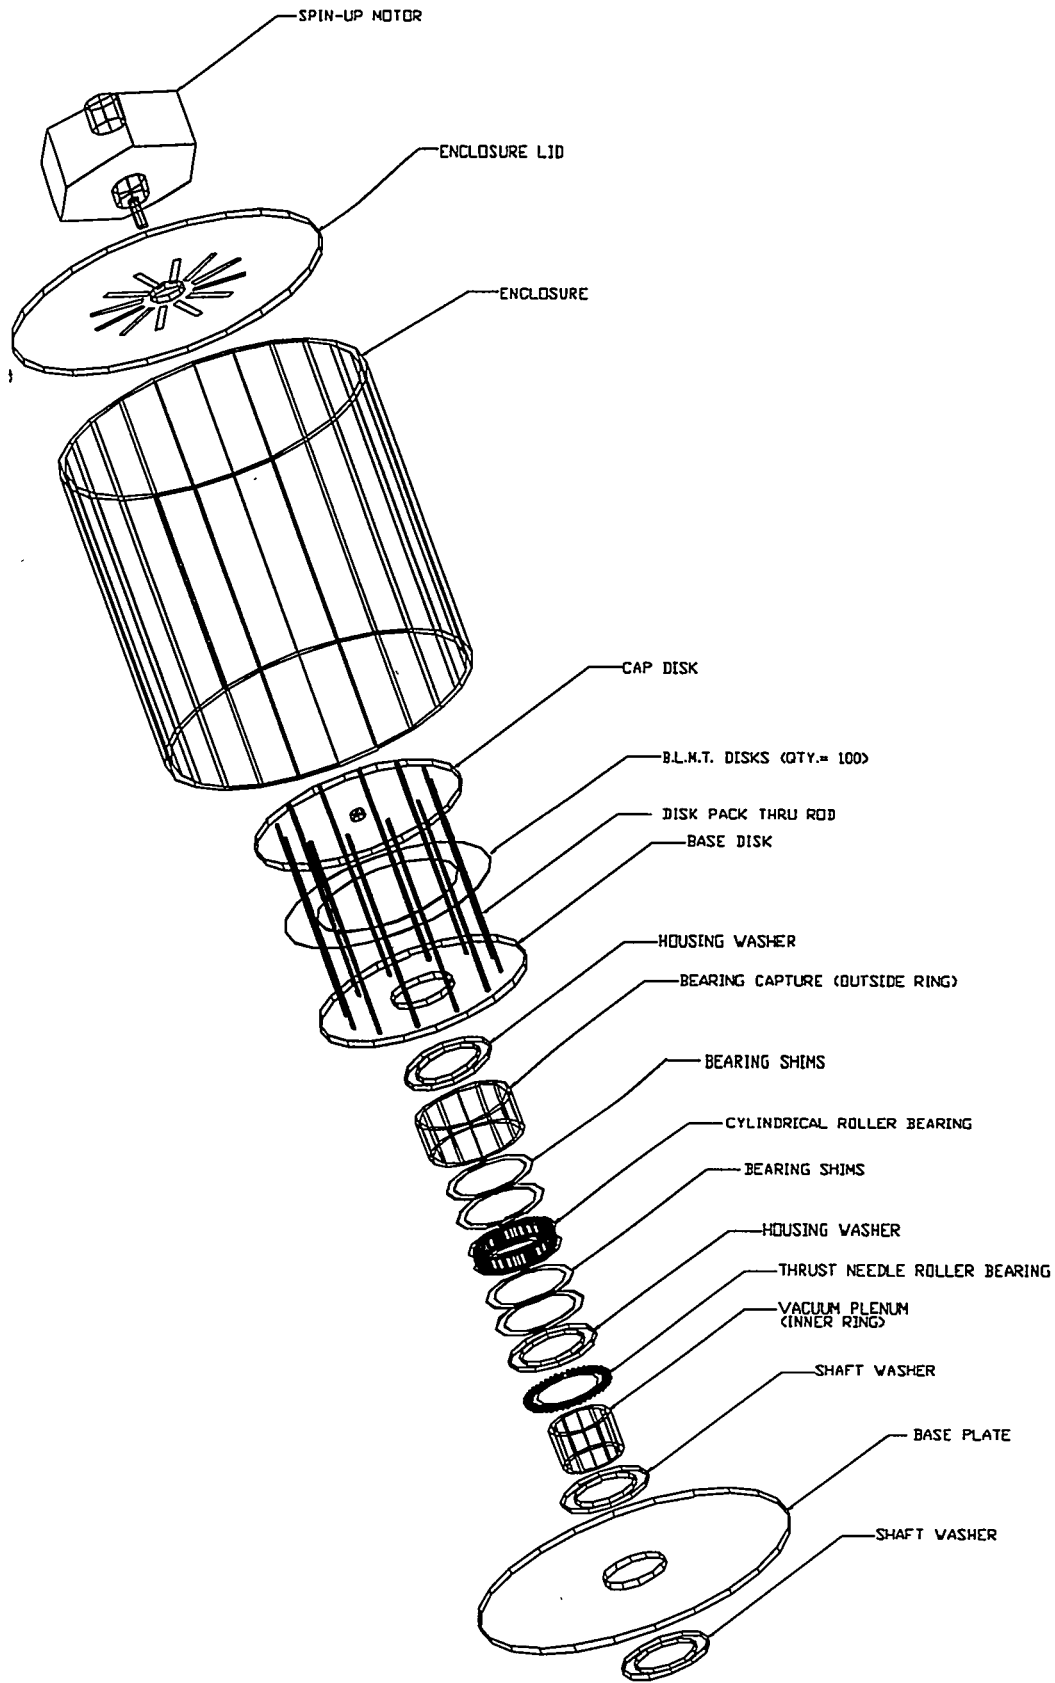


Figure 2 Exploded View of the BLMT Filter

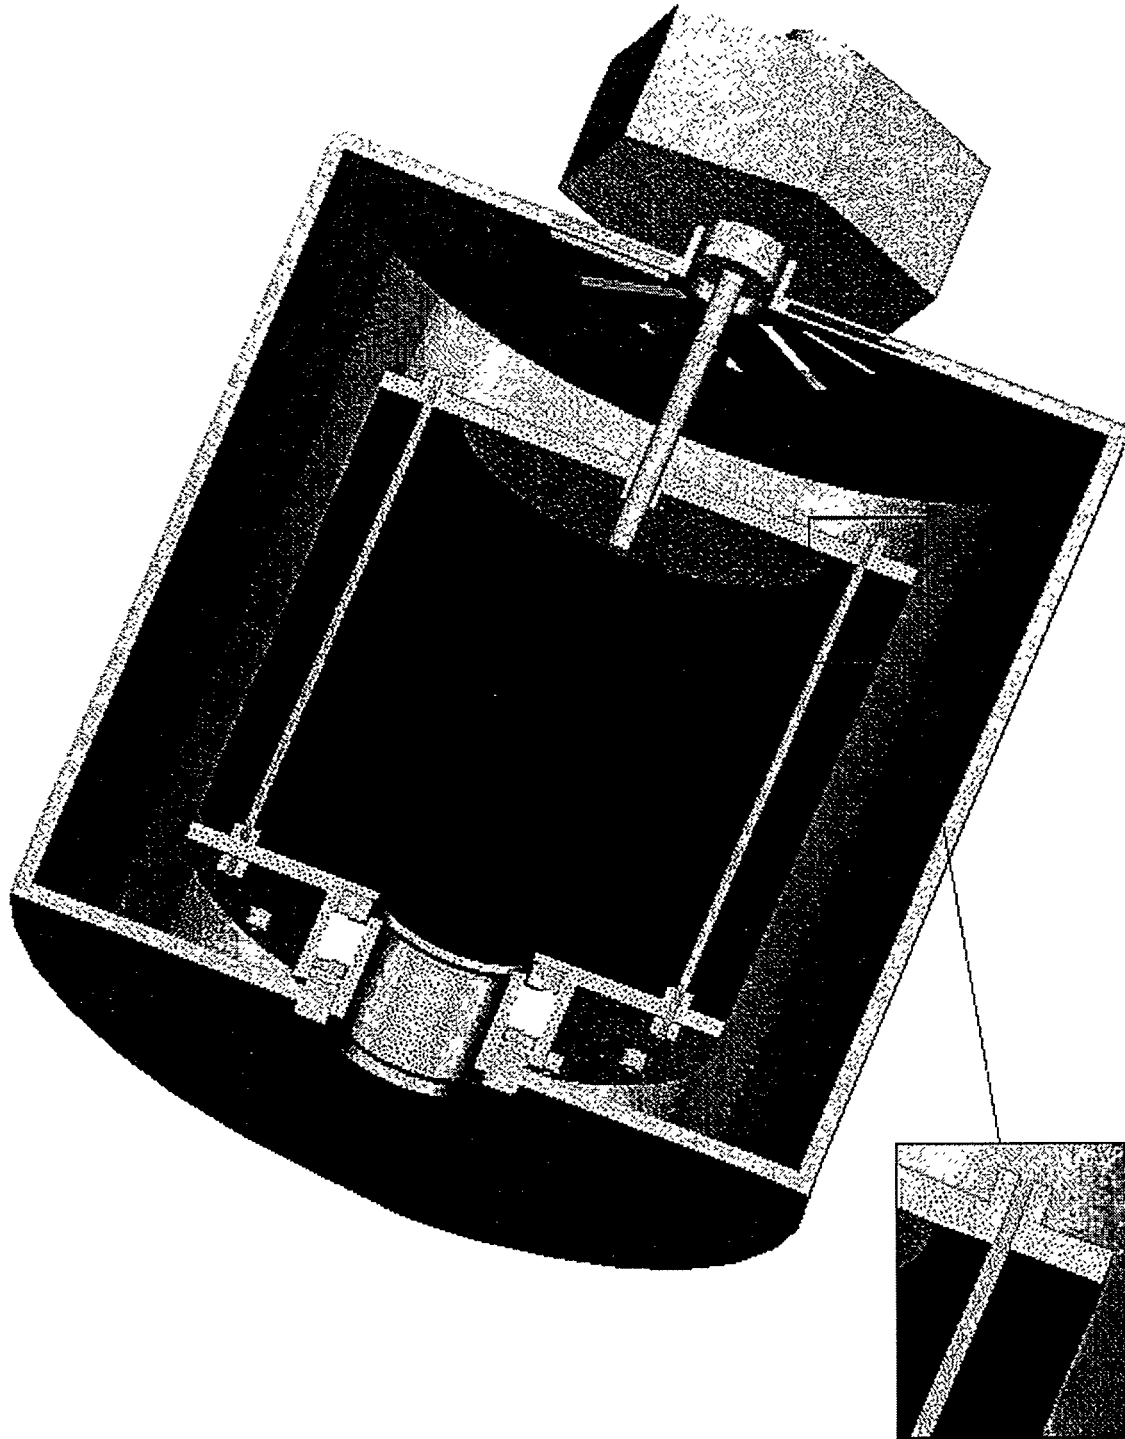


Figure 3 Cut-Away CAD Rendering of the BLMT Filter

Results of BLMT Testing

Bench testing was performed in accordance with our DOE SBIR Phase I program. Figures 1, 2, and 3 illustrate the general arrangement of the BLMT filter. Powdered aluminum oxide, Al_2O_3 , was added to the air intake of the reduced-scale BLMT filter to test filtration efficiency. Results of the testing exceeded expectations, as no particulate was observed to pass through the BLMT device. The chosen particulate is pure white in color and is made-up of particle diameters ranging from 0.1 micron to 10 micron, with a median value of 0.46 micron. Density is $3,965 \text{ kg/m}^3$. Figure 4 illustrates the particle size distribution provided by the supplier.

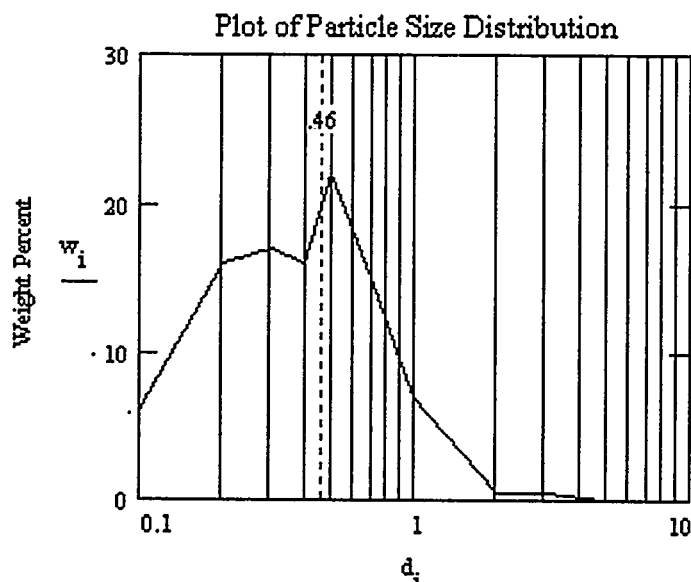


Figure 4 Al_2O_3 Particle Size Distribution

The initial test parameters were as follows:

- Disk pack rotating speed: 1500 rpm
- Flow rate: approximately 12 cfm
- Particulate: approximately 60 cc's of aluminum oxide

The test results were both impressive and successful. With extremely high particulate loading inside a 12-inch diameter, 12-inch high filter housing, none of the particulate was observed to pass into the exhaust chamber. The pressure drop across the prototype filter was higher than expected, at approximately 5-1/2 inches of water. To provide some perspective, the military defines "zero visibility" for larger dust sizes as 0.025 gram/ft^3 . During this test run, particulate loading was approximately 0.0043 gram/cm^3 , a factor of 4800X higher than zero visibility conditions (assuming all particles remain suspended).

In an attempt to force "breakthrough" on the filter, the gas flow rate was increased. This parameter variation increases drag on particles as they circulate the BLMT device. At a flow rate of approximately 60 cfm there was no observed particulate loss into the exhaust chamber. In another attempt to overload the filter, the flow rate was increased to the maximum capacity of the laboratory blower (approximately 90 cfm) and an additional 60 cc's of aluminum oxide were added to the filter

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

intake. Although the circulation inside the filter (but outside the BLMT device) was essentially “blinded” with particulate matter, still no breakthrough was observed.

The next step taken was to reduce the rotating speed of the disk pack. This parameter variation decreased the centrifugal force (resistance) imparted to particles attempting to enter the BLMT device. With all other parameters maintained, the speed was reduced to 1000 rpm. Once again, no breakthrough was observed. Testing was concluded at this point as the exhaust blower used to develop the flow through the filter shut down on thermal overload.


The filter housing was a clear acrylic tube, allowing observation during the test. Several different vortex patterns developed during the test, seemingly dependent upon a combination of flow rate, particulate loading, and disk pack rotating speed. It was observed that the vortex action within the housing may have contributed to the efficiency of the filter by keeping particulate matter away from the periphery of the BLMT device. This is a “second order” effect that deserves additional study, most likely in combination with tasks associated with housing design and particulate collection. Taking advantage of naturally occurring particulate behavior in addition to the intended action will yield a more efficient filter.

Upon disassembly of the prototype filter and test setup, a light coating of extremely fine powder was found on the inside of the ductwork exiting the prototype filter. The filter had experienced breakthrough of the aluminum oxide material, but the small size and volume of the breakthrough made visual identification during the test impossible. A sample of the material was collected for measurement under a scanning electron microscope (SEM). The material sample was prepared for inspection by sputtering with a conductive material and placing it in an appropriate inspection crucible. The SEM inspection revealed the material that achieved breakthrough was sized below the 0.3 μm cutoff normally associated with HEPA filtration requirements. A photograph of the SEM results is presented in Figure 5. The magnification of the SEM was $0.91 \times 15,000 = 13,650X$. The average maximum particle size in the SEM viewfinder was determined to be approximately 0.32 μm . Therefore the average maximum particle size is: $0.32/13,650 \approx 2.3 \times 10^{-5} \text{ cm} \approx 2.3 \times 10^{-7} \text{ m} \approx 0.23 \mu\text{m}$.

Based on the known test parameters (summarized in Table 1, below) and making use of the equations previously developed, the anticipated filter performance can be calculated.

Type of Parameter	Parameter	Parameter Value
Design Parameters	Flow Rate (\dot{M})	90 cfm = 0.0467 kg/sec
	Kinematic Gas Viscosity (ν_g)	$1.636 \times 10^{-5} \text{ m}^2/\text{sec}$
	Gas Density (ρ_g)	1.1 kg/m^3
	Particle Density (ρ_p)	$3.96 \times 10^3 \text{ kg/m}^3$
BLMT Filter Parameters	Number of Disks	100
	Number of Disk Spaces (n)	99
	Disk Spacing (d)	0.001 m
	Disk Outside Radius (R_o)	4 in = 0.1016 m
	Disk Inside Radius (R_i)	2.75 in = 0.0699 m
	Angular Velocity (ω)	1,000 rpm = 104.7 rad/sec

Table 1 Summary of Design and Filter Parameters

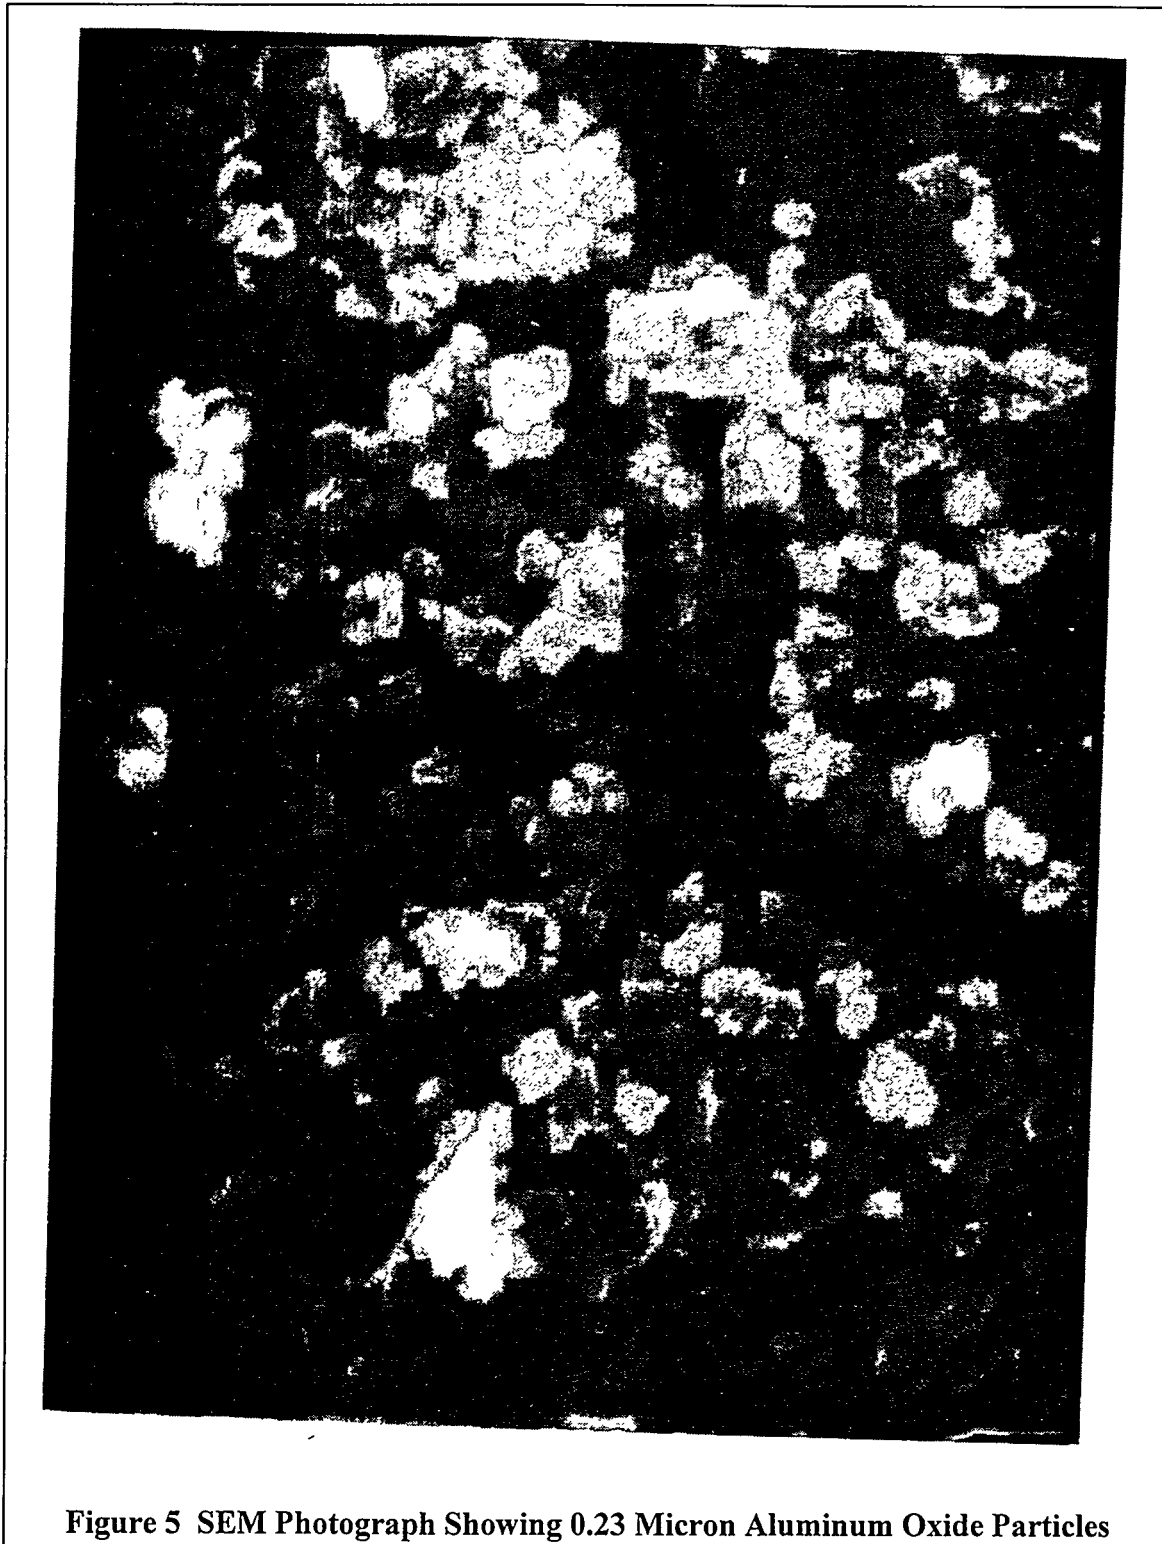

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Substituting into Equation 6, the expected critical diameter for the filter and design parameters is:

$$D_p = \frac{3}{R_o \omega} \sqrt{\frac{v_g \dot{M}}{dn \pi \rho_p}}$$

$$D_p = \frac{3}{(0.1016)(104.7)} \sqrt{\frac{(1.636 \times 10^{-5})(0.0467)}{(0.001)(99)\pi(3.965 \times 10^3)}} \approx 7 \mu\text{m}$$

The anticipated pressure differential across this filter is determined by substituting into Equation 11:

$$\Delta P = \frac{\rho_g}{2} \left(\left(\frac{\dot{M}}{2\pi \rho_g dn} \right)^2 \left(\frac{1}{R_o^2} - \frac{1}{R_i^2} \right) + \omega^2 (R_o^2 - R_i^2) \right)$$

$$\Delta P = \frac{1.1}{2(6895)(14.7)} \cdot \left(\left(\left(\frac{0.0467}{2\pi(1.1)(0.001)(99)} \right)^2 \left(\frac{1}{(0.1016)^2} - \frac{1}{(0.0699)^2} \right) \right) + \left((104.7)^2 ((0.1016)^2 - (0.0699)^2) \right) \right) \cdot 100 \approx 0.032\%$$

The airflow velocity entering each individual disk space is based on Equation 12:

$$V = \frac{\dot{M}}{2\pi \rho_g R_o dn}$$

$$V = \frac{0.0467}{2\pi(1.1)(0.1016)(0.001)(99)} = 0.67 \text{ m / sec}$$

The following table summarizes the differences between the analytical (expected) and empirical (actual) results.

Result Description	Expected Results	Actual Results
Critical Diameter	7 μm	0.23 μm
Differential Pressure	0.032% (0.0089 in. of H ₂ O)	approx. 5-1/2 in. of H ₂ O
Airflow Velocity Between Disks	0.67 m/sec	not measured

Table 2 Summary of Expected and Actual Test Results

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The difference between the expected and actual critical diameter was substantial, and likely due to the following:

- The boundary layers effect airborne particles before they enter the BLMT device.
- Vortices and airflow patterns within the housing contribute to inertial effects that prevent particle passage into the BLMT device (i.e., the device housing acts similar to a cyclone in that particle density is suspected to be highest closest to the inside wall and falls off rapidly as it approaches the BLMT device).
- The analytical models predict that there is a third size range of particle, those that enter, but do not exit the BLMT device. They settle into and orbit within the device, and particle interaction and other second-order effects eventually eject the particle.

The difference between the expected and actual pressure differential is also substantial, and is probably due to one or more of the following:

- Reduced exit port size (cross-sectional area) in relation to the disk pack inside radius. The diameter of the suction line from the filter assembly was approximately 2 inches. The inner diameter of the disk pack was 5.5 inches. This transition alone, at 90 cfm, generates a pressure differential of as much as 1.7 inches of H₂O.
- Inefficient placement of pitot tubes for pressure differential measurement.
- Measurement of pressure differential attributable to the BLMT device combined with that for other system components.
- Vortices and airflow patterns within the housing contribute to inertial effects that increase the pressure differential.

Conclusion

The empirical data collected to date establish that it is feasible to extend the BLMT filtration concept to the submicron size range for prefilter applications. Significantly more data, however, must be gathered in subsequent experiments for accurate quantification. The SEM microphotographs of the breakthrough particles (the particulate matter that passed through the filter when operational parameters were minimized) definitively show that, at the filter parameters reported, sub-HEPA particle sizes (i.e., less than 0.3 μm) were not excluded, but at conditions (purely from theoretical considerations) that would normally reject particles 7 μm and larger. In other words, there is a discrepancy between the particle size empirically rejected (0.23 μm) and that theoretically predicted to be excluded (7 μm).

A hypothesis has been suggested to explain this “better than predicted” particle exclusion phenomena (still to be definitively ascertained). Note that the equations used to describe the particle size rejection and ΔP across the filter do not take into account any contribution due to the housing size, shape or configuration. Logically, both the housing geometry/flow conditions (e.g., involute design) and the input flow characteristics (i.e., tangential rather than normal) will influence the BLMT filtration efficiency, as well as the pressure drop. The magnitude to which the housing affects the separation efficiency will be the subject of further R&D over the next several years.

This feasibility investigation has demonstrated the merit in proceeding with a full-scale prototype BLMT prefilter, in which far more sophisticated submicron particle generation and detection equipment can be used to accurately quantify the prefilter. Since only approximately 90 CFM flow rate

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

through the device was measured to demonstrate feasibility, nearly 11 times this flow rate (or 1,000 CFM) will be required for demonstration of the full-scale BLMT device in the next phase of experimentation. From a scale-up perspective, the least risky alternative for full-scale demonstration of the prefilter is simply to have multiple (10 to 11) reduced-scale units operate in parallel. However, the scale-up criteria suggested by the Reynold's numbers analysis offers another alternative - use of larger disks (both outside and inside diameters) and more of them. This would result in a larger prototype design with perhaps three or four parallel units operating simultaneously to achieve the desired submicron cut-off size and flow rate.

Acknowledgments

MCMC would like to acknowledge the support of the Department of Energy (DOE) for this research effort under grant number DE-FG02-95ER82026. Indirect research and development support for this technology was previously received from the Department of Defense (DoD) under contract number DAAJ02-93-C-0015, as well as from the Environmental Protection Agency (EPA) under contract number 68D50106. Complimentary research support for development of the BLMT is currently being received from DoD under contract number DAAJ02-95-C-0009.

References

1. Bellamy, R.R., 1994, "Nuclear Air Cleaning," Advances in Filtration and Separation Technology, American Filtration & Separations Society, Vol. 9, pp. 37-43.
2. Wright, S.R., et al., 1996, "Self-Cleaning, High-Efficiency Dynamic Particle Exclusion Filter," Advances in Filtration and Separation Technology, American Filtration & Separations Society, Volume 10, pp. 68-73.
3. Bond, J.H., Shaughnessy, E.J., and Wright, S.R., 1996, "Boundary Layer Momentum Transfer (BLMT) Theory as it Applies to Dynamic Particle Separation," Advances in Filtration and Separation Technology, American Filtration & Separations Society, Volume 10, pp. 83-88.

DISCUSSION

ENGELMANN: It is very difficult when one collects particles in chains at the end of a system to know just what size particle one is dealing with, whether the chain agglomerated afterwards or during the process, or was created that way. Do you have any plans to determine this with a moving filter paper or something else at the end of the system?

WRIGHT: For phase two we are acquiring \$100,000 worth of test equipment. We will have a standard DOP generator ahead of the filter. We have not been set up to do filter work, and that is why we were using indirect methods. When we ran this particular experiment we were expecting a large plume of material to come through, and had a flow visualization chamber ahead of the fan, but we never saw anything. We increased flow to push material through and we added another 60cc of material. At the end of the test we had 120cc in the unit. This corresponded to 0.029g/m^3 , which is a fairly heavy loading. At the end of this test, we increased the STET rate of the unit to about 100CFM. When you increase flow rate and reduce spin rate particles should go through. Since we did not have a filter downstream, we had a fairly clean system to start off with. We had noticed there was a small amount of dusting and dust was what we ended up taking over to the SEM. I admit this was a very crude method but it was just to show feasibility. In phase two we will be able to do a lot more to quantify it.

WEBER: Did you have a chance to examine the condition of the disks at the end of the tests and the gap between the disks?

WRIGHT: The gap does not change. We have a dozen bolts running through them with spacers. The disk thickness was 30mils. We saw no effects due to erosion, but the test was not long enough to establish any kind of erosion pattern, we would not expect to see erosion except over a very long period of time.

WEBER: Any residual particles?

WRIGHT: We were trying to push particles through but we had quite a bit of material that stuck to the inside part of the chamber. All we were able to do was get some extremely light dusting at the very end that we ran through the SEM. We did a number of samples and the average particle size that had gone through was around $0.2\text{-}0.3\mu\text{m}$. Other than that we did not have enough to measure.

DAUBER: Given that the particle size that you found was more than an order of magnitude smaller than you had predicted, is it possible to bring it down another order of magnitude by some refinement so as not to have a prefilter, but a HEPA filter?

WRIGHT: We would like to get to that point. Some of our early modeling showed that if we had tangential inflow rather than coming in radially, or perpendicularly, to our inflow, that we would get about an order of magnitude increase in terms of our separation efficiency. What we are trying to do is achieve solid body rotation between the disks. As long as our disk spacing is such that we can make sure that there is no core flow going through there, then this thing will continue to act as a filter. Yes, we are trying to look at this. We can envision a truncated cone housing design so that we have a natural pressure distribution that forces the particles to the outside so that you could extract them from the lower portion. You have a large particle concentration toward the outer edge of the filter housing and therefore you are

only literally filtering a fairly clean core of air inside. That gives us hope that we will be able to get further down in terms of particle size and also increase our flow rate, to get into a more industrial size.

DAUBER: Then all you have to do is add another concentric ring.

WRIGHT: Exactly. There is a lot of additional work that needs to go on and we need to look at what else we can incorporate. We have quite a bit of surface area and we could add catalysts or other things on to the surface of the plates themselves. It is a fairly simple design. We have to protect the motor (which could be hermetically sealed) and the bearing, they are our critical parts.

CLOSING COMMENTS OF SESSION CHAIRMAN

Yesterday, Dr. First referred to a meeting (1985) in Aix-en-Provence where he made a plea for operators to be certified to conduct in-place tests. As Convenor until 2 years ago of a European Committee on a new method for testing HEPA filters I also said then that once a laboratory/factory test had been decided upon, the next step was to attend to in-place tests. I think that one can make fairly definite decisions on the types of equipment to be used for in-place tests but it is less easy to decide on how the equipment can be used for in-place testing because of different designs of ducts, available injection and sampling points, mixing devices, and so on. I believe that results of many in-place tests are greatly in error. There is likely to be considerable scope for operators to use experience and common sense in test layout. In other words, operators should be trained and themselves tested before being let loose on in-place tests. I do not suggest that laboratory tests should be abandoned but there is no doubt that the really important test is that after installation and during use. If a successful session is measured by the number of questions asked, I think we have done very well.

SESSION 12

CODES & STANDARDS FOR FILTERS AND ADSORBERS

Thursday July 18, 1996

Co-Chairmen: J.J. Hayes, Jr.
R.D. Porco

THE FIRST TWENTY YEARS OF THE ASME COMMITTEE ON
NUCLEAR AIR AND GAS TREATMENT- A RETROSPECTIVE
BY A FOUNDING MEMBER

J. Jacox

PERFORMANCE TESTING OF HEPA FILTERS: PROGRESS
TOWARDS A EUROPEAN STANDARD PROCEDURE

J. Dymant

THE CASE FOR IMPROVED HEPA-FILTER MECHANICAL
PERFORMANCE STANDARDS REVISITED

C.I. Ricketts and P.R. Smith

**PANEL SESSION: CHANGES TO ASME
CODE AG-1, SECTION FC, HEPA FILTERS**

Co-Chairmen: J.J. Hayes, Jr.
R.D. Porco

Panel Members: J. Slawski
R. Rown
B. Franklin
S. Klocke

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

THE FIRST TWENTY YEARS OF THE ASME COMMITTEE ON NUCLEAR AIR AND GAS TREATMENT - A RETROSPECTIVE BY A FOUNDING MEMBER

Jack Jacox
Jacox Associates
Columbus, Ohio

Abstract

Since the 1996 Winter Meeting of CONAGT was the twentieth anniversary of CONAGT a review of the Committee and its members seems in order.

This Paper will cover the background and formation of CONAGT as well as the history to date.

This history will include not only the basic accomplishments but some of the less successfully met goals and a look at some of the personalities involved in the Committee work. General future plans will be included.

The intent of the Paper is less a formal history than a personal recollection of the Committee and those who worked so hard to create the best possible Codes and Standards for the industry to use.

Introduction

The Committee On Nuclear Air and Gas Treatment (CONAGT) grew from a basic industry need. In the 1960s there was an unprecedented growth in building nuclear power plants. Since these were unique in history, there was no historical base of industry or governmental standards to use to build them. The only technical information was from the military programs that initiated the nuclear age. These were of considerable assistance but far from what was required for an industry that had to meet the twin needs of safety and profitability, while growing many fold. To meet this need in the area of gas treatment a group of technical experts met under the auspices of the American National Standards Institute (ANSI) Nuclear Technical Advisory Board (NTAB). The American Society of Mechanical Engineers was the direct sponsor of the effort. This group met in the early 1970s and produced the first editions of N509 "Nuclear Power Plant Air-Cleaning Units and Components" ¹ and N510 "Testing of Nuclear Air Treatment Systems" ². These two documents in their latest editions are still the most widely used Nuclear Air treatment System (NATS) standards in use. I was fortunate to have participated as a guest at some of these meetings.

Discussion

As productive as this first effort was there was one defect. The writing group was an ad hoc group that dissolved upon completion of the Standards. The need for revision and expansion of these milestone Standards had been recognized even before they were published. ASME was chosen to be the sponsoring society for an ongoing Code committee to be responsible for NATS equipment Codes and Standards. This effort was, at the time, to include noble gas delay carbon beds and hydrogen

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

recombiners. The first meeting of the ASME "Committee on Nuclear Air and Gas Treatment" (CONAGT) was held at ASME Headquarters in New York on 26 February 1976. This meeting was organizational in nature and set the initial structure and membership for a permanent ASME Code Committee. The attendees at this meeting were largely those who had been on the ad hoc NTAB committee but a few of us were new comers. While a relatively brief meeting it was the critical first step in creation of what is now a maturing Code Committee recognized internationally. Minutes of this first meeting are reproduced as Appendix A along with our first organization chart.

Our second meeting was held on 6 May of 1976 where we continued to work on more detailed organizational matters. I find it interesting that organizational considerations have continued to be on the Committee's agenda throughout it's life. Continued shifting of Subcommittee and Subgroup structure appears to be a life long effort. In the early 1980's we had a major restructuring of all our Subcommittees after special Executive Committee meetings and long Main Committee discussion. As we expand to include DOE facility needs our organizational structure is still evolving. This ability to adapt to both changing industry needs and our recognition of existing weakness in our internal organization for which we provide solutions is one of our greatest strengths.

It is very important to note that the initial mandate of CONAGT was limited to nuclear power plants, more specifically in practice, United States designed light water reactors. The presence of an NRC representative and the membership of the Committee at all levels reflects this as, much as it reinforces it. In retrospect it is perhaps well that we started with a limited scope so as not to be overwhelmed by our mission. However, this limitation has become a weakness we are just now starting to overcome. In our first two decades CONAGT had become too focused on USNRC Regulatory Guides 1.52 "Design, Testing and Maintenance Criteria for Atmospheric Cleanup System Air Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power plants" ³ and 1.140 "Design, Testing and Maintenance Criteria for Normal Ventilation Exhaust System Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power plants" ⁴. In recent years we have found that there is far more to Nuclear Air Treatment Systems than these two Regulatory Guides.

As a newcomer to Code and Standard writing I had a great deal to learn. Not the least of which was the time required to bring a consensus document to publication. I vividly recall talking to Jim Fish, our first Chairman, just after the decision was made to revise N510. I told him I saw no reason it should take more than six months. Five years later when the revision was published I had become much more knowledgeable about the process. Jim was kind enough not to remind me of my earlier comment.

Another early learning experience was when we were working on the Housing and Frame Leak Tests in N510. The Pressure Decay calculations seemed very simple and straight forward. They are, but the sensitivity of the calculated Leak rate to temperature was not recognized by most of us. Paul Estrieche spent nearly a year educating the rest of the Subcommittee on this critical point. We held probably four meetings devoted to trying to avoid the limitations this sensitivity creates to a Leak Test. Unfortunately as the saying goes, "You can't fool Mother Nature" so we had to admit to the limitations and revise the testing limits and acceptance criteria. There has been continued refinement of Pressure Decay Leak Testing Procedures and Calculations through out the revisions of N510. The Code and Standards are better for this exercise and many of us who participated are wiser for it.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Throughout our work we have had major success and as well as some failures, as is true in all endeavors. There are two efforts that did not result in success I would like to mention as they are of considerable personal interest to me.

In our original planning Boiling Water Reactor Off Gas Systems were included in our scope. Specifically the hydrogen/oxygen recombiners as "Safety" systems and the carbon delay beds as "Non-safety". A Subcommittee was formed to write the equipment and testing standards. Subgroups for Equipment and Testing worked for years on these tasks. Work went slowly since these groups of experts were starting from zero. There was nothing in existence to build on as N509 and N510 provided in NATS area. More importantly one of the Subcommittee members who was also a member of the Gas Processing Equipment Subgroup, and later the Subcommittee Chairman and Main Committee member, had a different agenda than we had thought. This individual had a specific goal. That was to see that there would not be any new requirements published for BWR Off Gas Systems. He worked for a major nuclear utility with two large BWR plants. By using the CONAGT rules he was able to block the efforts of the Subcommittee for enough years that the effort was dropped. I guess this individual's political expertise was proven valuable to him since he became a very young vice president of the utility.

Fortunately this original goal has recently been put back on track and work on a variety of gas processing systems is again well underway. This time the Subcommittee is under a strong leader and there is no obstacle to completion of the work.

One of the initial goals of the Testing Subcommittee (of which I was chairman for over a decade) was to publish a standard for Personnel Qualification. Dr. Melvin First was the Subgroup Chairman. We worked for years to develop technical requirements to compliment and expand on the existing time based experience requirements in ANSI N45.2.6 "Qualifications of Inspection, Examination, and Testing Personnel for Nuclear Power Plants" ⁵ and ANS 3.1 "Selection, Qualification and Training of Personnel for Nuclear Power Plants" ⁶. These documents specify periods of time necessary to be qualified at various levels for testing but do not specify what the technical experience must be during these periods. This has allowed some organizations to qualify personnel who know all the bureaucratic requirements but none of the technical requirements. The Testing Subcommittee, with the Main Committee's initial endorsement, wrote a draft of a Personnel Qualification Standard to provide technical guidance for the specific types of education and experience required to test NATS. After the draft was developed by the Subcommittee it was submitted to the Main Committee. Many of the utility members objected to any additional training requirements at all. Over a period of a year or more the Subcommittee met with many utility representatives at two special meetings hosted by the utilities. We wrote and rewrote the draft in accordance with the utilities requests until it became obvious that no additional training requirements would ever be accepted. The final draft of this standard was published for the record as "Proposed Appendix to ANSI/ASME N510-1986" ⁷ in the Proceedings of the 20th Air Cleaning Conference in 1988. I still believe it is a very valuable document and should be used for guidance in planning a training and certification program for testing to N 510. At least one DOE facility has done so, that I know of.

I could say that CONAGT's greatest accomplishment is that after twenty years we are alive and still growing. Certainly this is a major achievement, but that we have established the ASME "Code AG-1, Code On Nuclear Air and Gas Treatment" ⁸ is indeed our major accomplishment. There are too many success stories to try to relate them all. In fact there are so many I am not qualified to do so. I will

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

mention a few that I find significant. Not all are official CONAGT activities. Some are simply the result of the extraordinary efforts of CONAGT's members.

In the early 80s many CONAGT members recognized that there were serious deficiencies in the radioiodine testing of carbon used in nuclear power plants. All currently operating power plants then and now require, through their license, testing of the carbon used in the plant NATS. This testing is required for new carbon and periodically for in service carbon. The results from the commercial testing laboratories appeared to vary much more than made sense to the experts in the field. At that time these tests were performed to an old government standard that had not been subject to consensus peer review. The testing Subcommittee arranged for a series of round robin tests with all the laboratories performing this testing in the U.S. and a number of international facilities. Again Dr. First again took the lead in this special effort. Used carbon was provided by the NRC. When the results were received and analyzed they were found to vary up to three orders of magnitude for the same sample and set of test parameters. Clearly a serious problem existed. The NRC used the CONAGT results as the basis for a major program to improve the accuracy of required radioiodine efficiency testing. A number of meetings of technical experts were hosted by the NRC to determine why the results varied so much and how to improve the situation. The Idaho National Engineering Laboratory was contracted to hold additional round robin tests and suggest how to improve the test protocol and instrumentation. The results of this multi year effort include ASTM a new radioiodine test standard D3803-89 "Standard Test Method for Nuclear-Grade Activated Carbon" ⁹, an excellent INEL report on the technical background of this test (INEL EGG-CS-7653, "Final Technical Evaluation Report for the Nuclear Regulatory Commission/Idaho National Engineering Laboratory Activated Carbon Testing Program" ¹⁰) and NRC recommended laboratories. Given the sensitivity of this type of test, research and improvements still continue but the CONAGT testing Subcommittee round robin is the basis for today's vastly improved radioiodine efficiency test results.

For many years those of us who have enjoyed and benefited from these Air Cleaning Conferences had discussed an industry organization on Nuclear Air Treatment Technology. In the late 1980s a group of us from CONAGT took the step of incorporating a non-profit organization to bring this idea to reality. The "International Society of Nuclear Air Treatment Technologies" (ISNATT) was formed. As you see at this Conference ISNATT is a cosponsor of the Conference, has a commercial exhibit and Professional Development courses. While not an official development of CONAGT it certainly exists due to the efforts of CONAGT members and their dedication.

Based on technical inquiries about N509 and N510, CONAGT decided to hold two public meetings to learn what the users of these documents thought of them, learn where there were weaknesses and how to improve them. These were exceptionally valuable exercises. From them grew the idea of "short courses" where CONAGT members could both teach the attendees about the CONAGT documents and obtain user input to improve them. A number of these Professional Development courses have been held under the auspices of ASME and are now offered by ISNATT. The scope of the courses and seminars has broadened from N509 and N510 to include AG-1 and DOE facility cleanup subject matter.

These accomplishments are not the only ones CONAGT has provided the industry but are significant to me in that they are beyond the scope of simply writing codes and Standards.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Summary

AG-1 is CONAGT's major achievement. It has greatly extended the scope of equipment covered by N509, it has significantly improved the depth of coverage of the equipment included and is in the process of a major expansion to include DOE facility needs. During our twenty years of existence there has been nearly 100% turnover of Committee personnel but CONAGT remains as strong or stronger as ever. The structure and composition of the various levels of committees continues to evolve to meet ever changing industry needs and technological advances.

CONAGT will provide support Nuclear Air Treatment and Gas Processing Systems for the worlds nuclear industry for the next millennia as well as it has for the one now ending.

In closing I want to say what an honor and delight it has been to work on this Committee and to be associated with such excellent people for the past twenty years.

Dedication

I would like to dedicate this paper to the memory of three founding members who contributed so greatly to our success; Jim Fish, Cliff Burchsted and Paul Estriech

References

1. "Nuclear Power Plant Air-Cleaning Units and Components, N509", 1976, 1980 , 1989, ASME, 345 East 47th Street, New York, NY, 10017
2. "Testing of Nuclear Air Treatment Systems, N510", 1975, 1980, 1989, ASME. 345 East 47th Street, New York, NY 10017
3. USNRC, Regulatory Guide 1.52, "Design, Testing and Maintenance Criteria for Atmosphere Cleanup System Air Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power Plants", 1978
4. USNRC, Regulatory Guide 1.140, "Design, Testing and Maintenance Criteria for Normal Ventilation Exhaust System Air Filtration and Adsorption Units of Light-Water-Cooled Nuclear Power Plants", 1979
5. N45.2.6, "Qualifications of Inspection, Examination, and Testing Personnel for Nuclear Power Plants", 1978, ASME, 345 East 47th Street, New York, NY 10017
6. ANS 3.1, "Selection, Qualification and Training of Personnel for Nuclear Power Plants", 1981, American Nuclear Society, 555 North Kensington Avenue, La Grange, IL 60525

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

7. USDOE, CONAGT, "Proposed Appendix to ANSI/ASME N510-1986", 20th Conference, CONF880822, 1989

8. ASME, CONAGT, AG-1, "Code On Nuclear Air and Gas Treatment", 1994

9. ASTM D3803-89 "Standard Test Method for Nuclear-Grade Activated Carbon", 1989, American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959

10 EGG-CS-7653, "Final Technical Evaluation Report for the Nuclear Regulatory Commission/Idaho National Engineering Laboratory Activated Carbon Testing Program", April 1987,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

APPENDIX A

Attached are a reproduction of the minutes of the meeting that created CONAGT along with our first draft organization chart. My thanks to ASME and Mr. William Miller for permission to reproduce this document.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

SARGENT & LUNDY
ENGINEERS
CHICAGO

Subject:
Notes of Meeting of
ASHE Ad Hoc Task Group
On Organization of the Committee
on Air and Gas Treatment Equipment
Held in New York at United Engineering Center
On February 26, 1976

THOSE PRESENT:

G. Beasley)	Tennessee Valley Authority
C. Burchsted)	Oak Ridge National Laboratory
P. Estriech)	EBASCO
J. Fish)	American Air Filter
J. Jarcocox)	Nuclear Consulting Services
A. Silverman)	United Engineers
H. Smith)	Duke Power
C. Thompon)	Bechtel-Gaithersburg
W. Woollacott)	ASME STAFF
W. Miller)	Sargent & Lundy

Purpose

This was an organizational meeting for creation of a new ASME committee to oversee preparation of codes for air and gas treatment equipment. The stated meeting objectives were as follows:

1. Review previous scope of ANSI N-45.8.
2. Prepare scope for new committee.
3. Prepare outline of activities.
4. Review potential membership.
5. Develop working organization.

Background

ASME is reorganizing the former ANSI N-45 effort into ASME Committees under the "Accredited Organization Method" for preparing American

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Notes of Meeting
ASHE Ad Hoc Task Group
February 27, 1976

March 2, 1976
Page 2

National Standards. One of the parts of this reorganization is to convert the N-45.8 effort* into the ASME Committee on Nuclear Gas Treatment Equipment.

Meeting Report

As a prelude to the meeting, Mr. W. Woollacott explained that ASME now has approved procedures to develop standards that will be recognized by ANSI. The new committee on Air and Gas Treatment Equipment (AGTE) must prepare and submit a scope statement to ANSI for distribution to public and other societies to identify any potential scope infringements. Representatives of ASHRAE, IEEE, ANS and NRC will be invited to join the committee.

The new standards should be written like codes ("shalls" not "shoulds") and be unified into a single book with many chapters, as opposed to "white paper" issue. The addenda issue basis should be used. Only mandatory requirements should be contained in body of the standard with non-mandatory sections referenced as appendicies.

A long discussion ensued on the scope of this endeavor. It was generally agreed that the standard should cover only equipment for nuclear power generating stations. As to what constitutes air and gas treatment equipment, the task group decided to include offgas equipment, post LOCA hydrogen mixing fans and blowers, recombiners, and the full contingent of HVAC equipment. While the primary concern of the Standard should be safety related equipment, the overall objective should be to define and possibly upgrade the quality and reliability of all equipment associated with the power generation objective.

The task group unanimously approved the following scope and title for the committee:

Title: Committee on Air and Gas Treatment Equipment

Scope: TO DEVELOP, REVIEW, MAINTAIN AND COORDINATE CODES AND STANDARDS FOR DESIGN, FABRICATION, INSTALLATION, TESTING, AND INSPECTION OF EQUIPMENT FOR GAS TREATMENT FOR NUCLEAR POWER PLANTS. AS USED HEREIN "GAS TREATMENT" INCLUDES BOTH HVAC AND GAS PROCESSING

* Prepared ANSI 510-1975, Standard for Testing of Nuclear Air Cleaning Systems

ANSI 509-T, Standard for Nuclear Power Plant Air Cleaning Units and Components

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

SARGENT & LUNDY
ENGINEERS
CHICAGO

Notes of Meeting
ASHE Ad Hoc Task Group
February 27, 1976

March 2, 1976
Page 3

- a) HVAC - the moving and conditioning of air which is supplied, exhausted, or recirculated into or from enclosed spaces to maintain prescribed ambient conditions. Conditions include pressure, temperature, humidity, and contaminant.
- b) Gas Processing - transport of gas and separation, isolation, and disposal of its constituents by physical, mechanical, chemical, delay, electrical and thermodynamic means.

The task group attempted to develop a list which may not be all inclusive of equipment standards as follows:

Conveying & Transport

Fans
Dampers
Ducts (incl. Hangers & Supports)
Compressors
Blowers
Pumps
Vessels
Pipes
Housings

Processing

Recombiners
Heaters
Coils
Filters
Humidifiers
Moisture Separator
Adsorber
Refrigeration Units

Mr. W. Woollacott explained that tentatively the committee should consist of approximately 30 members. Representatives of utilities, constructors, A/E's, manufacturers, societies, regulatory agencies should be included. No more than 33% of total committee membership may be from any single group. The tentative committee membership was read and commented on. Mr. Woollacott will forward solicitations for committee membership in the near future.

The first committee meeting will be held on April 22, 1976, at ASME Headquarters in New York. Members of task group were asked to forward their ideas on organization of working groups to Mr. Woollacott by March 15, 1976. An executive committee, which performs administrative and staff functions must be elected at the first meeting. Future committee meetings would be held quarterly.

The Ad Hoc Task Group was unanimously disbanded, its function fulfilled.

Side Notes

1. ORNL NSIC-65 will be published and available in May 1976.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE


Notes of Meeting
ASHE Ad Hoc Task Group
February 27, 1976

March 2, 1976
Page 4

2. Regulatory Guide 1.52 Rev. 1 will be subject of a closed ACRS meeting on March 2, 1976. Formal issue expected shortly thereafter.
3. ERDA has budgeted \$35,000,000 to initiate a waste handling and disposal management program at Oak Ridge, Tennessee. Initially ten people will be involved to study and acquire 10 sites suitable for disposing of radioactive waste.
4. Mr. C. Zitek (CECo), executive director of ANSI N-18 wanted to have ANSI N-509 balloted. This is being resisted.

W. H. Miller, Jr.

AIR AND GAS TREATMENT COMMITTEE PLAN OF ORGANIZATION*

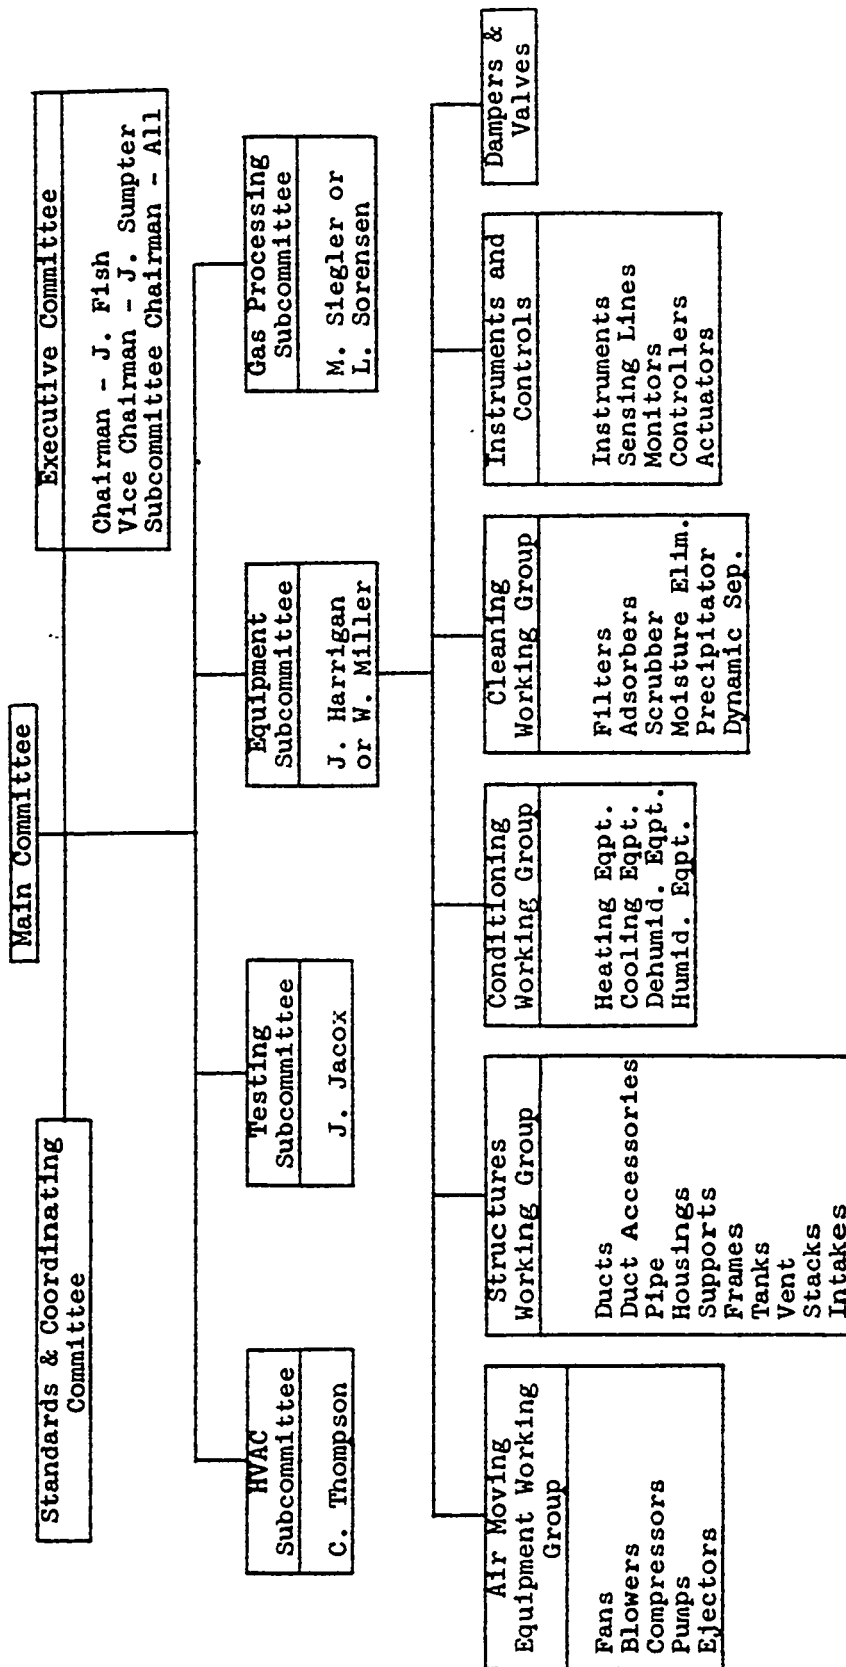

*Names of Subcommittee Chairmen are ASME nominations and are subject to the respective member's management approval.

PERFORMANCE TESTING OF HEPA FILTERS: PROGRESS TOWARDS A EUROPEAN STANDARD PROCEDURE

J Dymont (AWE plc, UK)

SUMMARY

Proposals for a future European testing procedure for "High Efficiency Particulate Air Filters (HEPA and ULPA)" are being developed by CEN (Comité Européen de Normalisation). The new standard will be given the status of national standard in participating countries, conflicting national standards being withdrawn.

The standard will comprise 5 parts covering the grouping and classification of HEPA and ULPA filters according to their efficiency, fundamental principles of testing, marking etc (in part 1). Part 2 will cover aerosol production, measurement principles, counting equipment and statistics. Parts 3-5 will cover testing flat sheet media, leak testing of filter elements and the efficiency testing of filter elements respectively.

The efficiency test methods allow the use of either homogeneous monodisperse or polydisperse aerosols for the determination of particulate filtration efficiencies as a function of particle size. The particle size at which maximum penetration occurs is first determined in flat sheet media tests; tests on filter elements (constructed using the same filter medium) may be carried out using either a homogeneous monodisperse aerosol of the size at which maximum penetration occurs (MPPS) or a polydisperse aerosol whose median size is close to the MPPS. Tests with monodisperse aerosols may be conducted using condensation nucleus counting equipment; tests using polydisperse test aerosols require the use of optical sizing particle counters.

When determining the efficiency of filter elements the downstream aerosol concentrations may be determined from air samples obtained using either an overall method (single point sampling after mixing) or a scan method. The scan method also allows "local" efficiency values to be determined.

INTRODUCTION

The standardization body involved is the Comité Européen de Normalisation, (CEN) which has its headquarters in Brussels.

Technical committees of CEN comprise delegations from European national

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

standardization bodies(Figure 1) including British Standards Institute (BSI) for the UK, AFNOR (France) and DIN (Germany). Technical committees usually appoint working groups from individual experts nominated by the national bodies. The drafting process consists of a number of stages after production of the initial draft. Separate opportunities are given for changes to be proposed by individual experts, by national standardization bodies and by the general public in all participating countries before the final voting process.

REQUIREMENT FOR NEW STANDARD

Requirements for a future European test standard were initially compared with/against the characteristics of existing standard methods, both the national standards eg BS 3928, AFNOR X44011, DIN 24184 etc, as well as relevant trade association standards such as Eurovent 4/5.

Filtration performance testing requirements continue to advance as the technology of micro miniature electronic devices advances; by and large the nuclear industry filtration efficiency requirements are not subject to the same upward pressure; the availability of the improved performance potential of ULPA filters could in some circumstances be beneficial.

It was concluded that the existing standard methods did not provide an adequate technical basis to meet these requirements. Deficiencies in existing procedures were in the following areas:-

- (a) the need to adopt a generally acceptable continuous classification system for HEPA and ULPA filters.
- (b) the need for a test method capable of covering the whole range of efficiency from 85% to 99.999999%, a range of DF over $10E07$.
- (c) the requirement to test at the MPPS (particle size for maximum penetration).
- (d) the need to express test results in terms of particle numbers rather than particulate mass.
- (e) the need to include leakage measurements in the testing arrangements and to relate them to the overall efficiency and classification of the filters.
- (f) the need to include particle size efficiency measurements within the overall procedure.
- (g) the need to establish correlation between results from test-rigs operated by

different organizations.

TECHNICAL BASIS FOR THE NEW TEST PROCEDURES

The technical basis for the new procedures are rooted firmly in existing advanced particle generation and measurement technology. It allows the use of laser optical particle counters (OPC), continuous condensation nuclei counters (CNC), differential mobility particle analysers (DMA) and computer controlled scanning and data processing.

Descriptions of the new procedures have evolved gradually over the last 3 years and have appeared as 5 separate parts; these reflect the fact that the complete standard comprises a number of procedures with options depending the classification of the unit and the purpose for which the test procedure is being carried out.

The requirements to be met and the procedures to be employed are prescriptive but the equipment to be used is not, provided it has the appropriate measurement capabilities, accuracy and consistency.

One main aim of the procedure is to be able to provide sufficient filtration efficiency data on a HEPA or ULPA filter to enable its suitability and adequacy for a particular purpose or purposes to be ascertained. Thus the procedures include a "single-point" efficiency test which may be used as a production control test for filters to be used in gas cleanup applications. Where filters for use in ultraclean-rooms are to be tested the procedures include scanning at specified traverse rate, and particle size sensitivity. For all cases the procedures include a specified method for determining the MPPS (Maximum Penetrating Particle Size) for the filter medium being used at the face velocity used in the filter.

CONTENTS OF THE DOCUMENTATION (denoted prEN 1822)

The documentation has been developed in 5 parts:-

Part 1: Requirements, Testing and Marking.

This includes extensive definitions, establishes groups and classes of HEPA and ULPA filters according to their performance as measured by the procedures in this standard. It sets out testing options available and the steps to be followed according to the filter class and the purpose for which the testing is to be conducted. It also specifies the data to be recorded in test certificates and the information to be marked on the filter itself. It specifies that the test aerosol will be a liquid with a vapour pressure $< 20 \mu\text{Pa}$ at 20°C with an index of refraction between 1.45 and 1.60 at 630 nm.

Part 2: Aerosol Production, Measuring Equipment and Statistics.

The aerosol material is not specified but physical data of DEHS (diethylhexylsebacate), DOP (dioctylphthalate) and paraffin oil (low viscosity) are tabulated. Principles of the methods for producing monodisperse aerosols (Sinclair LaMer and Rapaport & Weinstock) by heterogeneous condensation are outlined. The principle of homogeneous condensation is also described together with the use of a differential mobility analyser as a classifier with the capability of extracting a monodisperse component from a polydisperse aerosol. The use of nebulisers for polydisperse aerosol production is described. The requirements for electrical neutralisation of aerosols is covered. Other necessary parameters for aerosol generators are defined.

Essential performance parameters for measuring instrumentation such as optical particle sizers and counters (OPC), condensation nucleus counters (CNC), differential mobility analysers (DMA), dilution systems and other measuring equipment are defined, explained and quantified.

Part 3: Testing Sheet Filter Media. The main purpose of the procedures in this part of the standards to measure the efficiency of the filter medium as a function of particle size. This enables the MPPS to be determined, and also provides initial guidance on the eventual classification of the filter.

The recommended procedure employs a monodisperse challenge aerosol generated by separation of a monodisperse "cut" from a polydisperse aerosol source using an electrical mobility analyser; CNCs may be used to count the particle streams both upstream and downstream. Alternatively a polydisperse challenge aerosol may be used directly, with OPC(s) to assess the particle content in each size channel, both upstream and downstream.

The procedure requires a minimum of six determinations of efficiency at particle sizes spaced uniformly either side of the MPPS; at least 5 samples of filter medium of diameter not less than 200 mm must be tested.

Part 4: Scan Method for Leak Testing and Efficiency Testing of Filter Elements.

This procedure may be carried out using either monodisperse or polydisperse aerosols; the particle size used must be close to the MPPS as determined by the procedures of part 3. When a monodisperse or quasi-monodisperse aerosol is used a condensation nucleus detector may be used (as an alternative to OPC) for assessing particle concentration.

The standard defines a monodisperse aerosol as having $\sigma_g < 1.15$, a quasi-monodisperse aerosol having $1.15 < \sigma_g < 1.5$, and a polydisperse aerosol as having $\sigma_g > 1.5$. The median size of a monodisperse aerosol should not deviate from the MPPS by more than 10% and that of a polydisperse aerosol by not more

than 50%.

The aerosol sampling probe geometry, velocity of traverse and flowrates for the scanning process are defined; calculation procedures to be followed to determine the presence or otherwise of significant leakage are also defined; these are based on the statistical premise of 95% confidence. Examples of calculated parameters are given for filter classes H13 to U17.

An annex gives a short description of the "oil thread" test which may be used to confirm the absence of leakage in filters of class H12 - H14.

Part 5: Testing the Efficiency of Filter Elements. This part gives requirements for rig testing of HEPA and ULPA filters when scanning is not a requisite, ie it gives an average or overall "single-point" efficiency. As in the case of the scanning test either a monodisperse or polydisperse challenge aerosol may be used in conjunction with CNC(s) or OPC(s) as appropriate. Detailed test-rig requirements are given together with statistical procedures for calculation of results. Examples of calculated parameter values are given for the range of filter classes from H10 - U17.

Cross-checking of Techniques.

Results of "round-robin" tests between European test laboratories using the techniques outlined above have been published by Wepfer¹. Although at the time of the test programme the test equipment assemblies were by no means standardised the comparative performance values obtained had at least as good a degree of correspondence and consistency as has been encountered in the past with other exercises of a similar nature.

Progress Towards Implementation of the New Standard.

CEN Technical committee 195 (TC/195) in 1990 instructed its working group 2 to develop a European standard test procedure for HEPA and ULPA filters. Preliminary work began immediately but was limited to the assessment of existing standards and underwriting the decision to develop a new standard rather than adapt an existing one. An early draft of Part 1 was available in 1993 and parts 2 & 3 appeared shortly afterwards. Parts 1, 2 & 3 have now passed through several editing stages and are ready for a formal voting procedure. Parts 4 & 5 are somewhat less advanced. The target date for voting on the complete document is June 1997. Implementation in accordance with the results of the voting process will take place after that time.

(c) British Crown Copyright 1996/MOD

Published with the permission of the controller of
Her Britannic Majesty's Stationery Office

REFERENCES

- (1) Filtration and Separation 1995

FILTER GROUP	FILTER CLASS	MAX. OVERALL PENETRATION(%)	MAX. "LOCAL" PENETRATION(%)
H	10	15	--
H	11	5	--
H	13	0.5	2.5
H	13	0.05	0.25
H	14	0.005	0.025
U	15	0.0005	0.0025
U	16	0.00005	0.00025
U	17	0.000005	0.0001

TABLE 1: CLASSIFICATION OF HEPA AND ULPA FILTERS ACCORDING TO FILTRATION PERFORMANCE: (Penetration values refer to performance against MPPS aerosol)

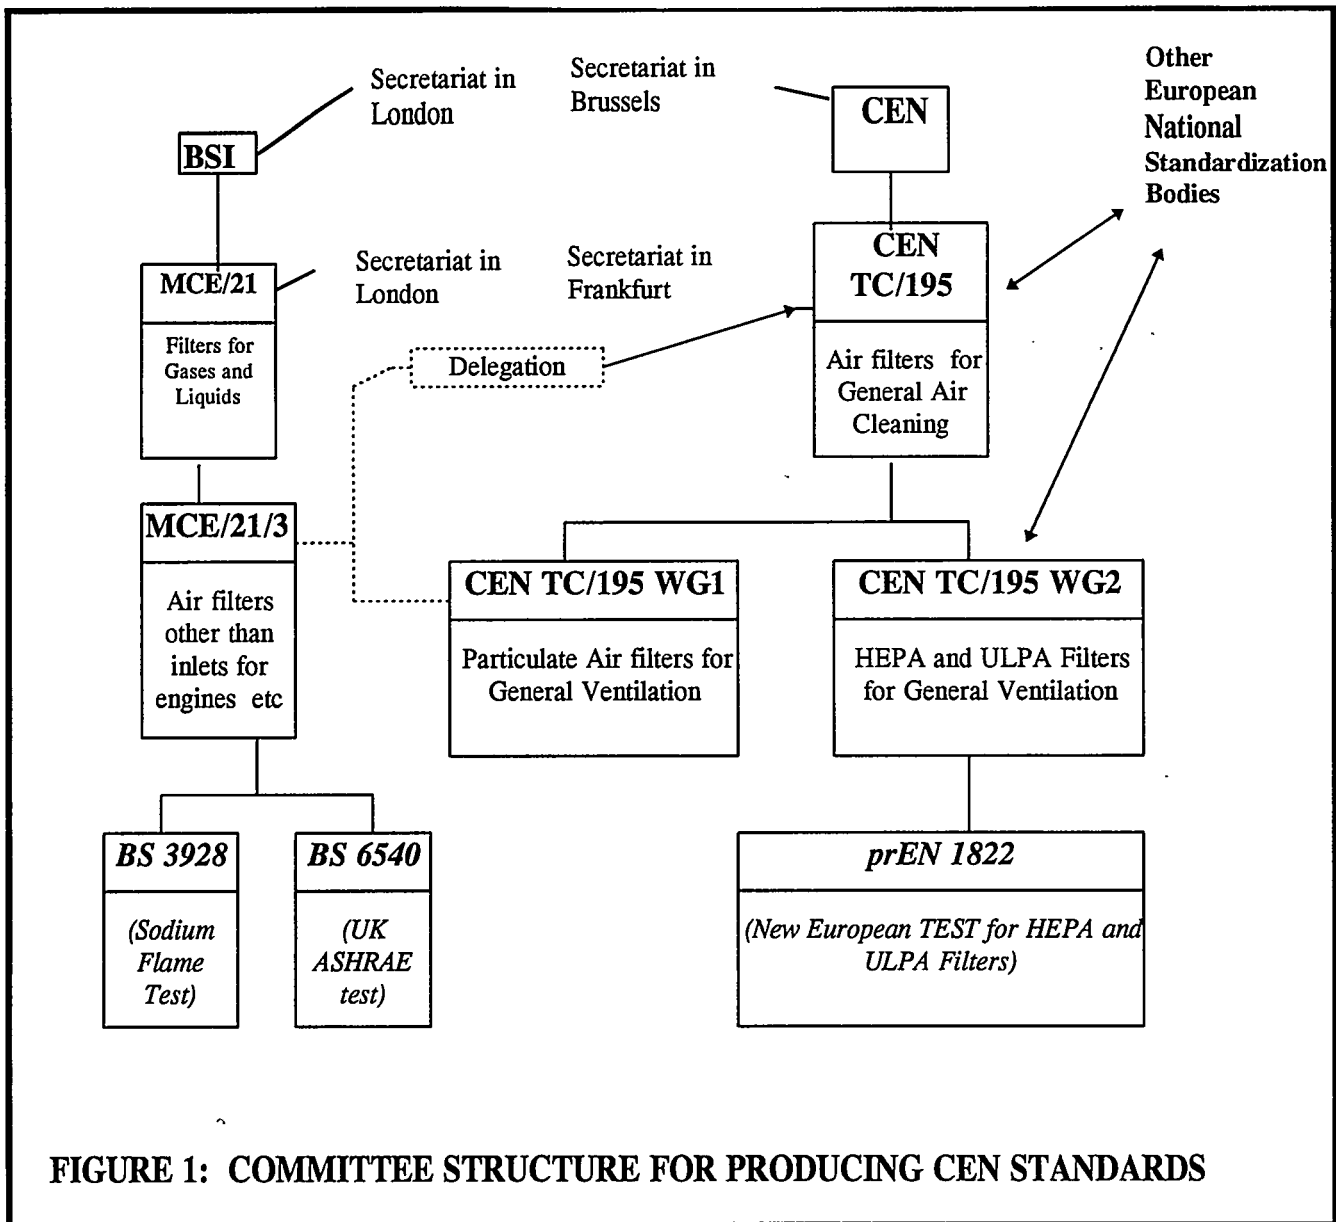


FIGURE 1: COMMITTEE STRUCTURE FOR PRODUCING CEN STANDARDS

DISCUSSION

BERGMAN: I have a question about very high efficiency filter testing. There comes a point where you no longer have a non-destructive test, where, when you try to measure the initial efficiency, you need a sufficient number of particles upstream to get enough particles downstream. About six years ago, in the Proceedings, there was a description of very high efficiency steel filters that had a minimum efficiency of eight or nine times. It took us about half-a-year to verify that the number was correct because the filter would plug up while we were trying to get enough downstream counts. I do not know what others' experience is on these more efficient filters, but you have to be very cautious in terms of filter clogging in order to get the filter efficiency. Just one recommendation, or caution: back-to-back efficiency tests can tell you quickly whether or not you are clogging. People have used pressure drop as a reference to indicate clogging, but we have observed practically zero change in the pressure drop over several orders of magnitude change in the efficiency. That is one caution for measuring very high efficiency filters. Another thing is selection of aerosols, whether you pick a solid or a liquid test aerosol makes a big difference. For example, when you test the same filter with liquid particles you lose at least three orders of magnitude of efficiency relative to filter efficiencies with solid particles. In this area of very high efficiency filters, using particle counting and statistical analysis, plus all of the other factors, it is very difficult.

DYMENT: Efficiency testing procedures, particularly for the highest efficiency filters, include the use of liquid aerosols in preference to solid particles. I think there is an awareness of the problems you mentioned, particularly for the highest efficiency filters.

SCRIPSICK: I was glad to hear what John Dymant presented today, it parallels a number of the activities that are going on in this country. It is good to see that people are coming independently to some of the same general conclusions about assuring performance of filters. I was confused by the distinction between leak testing and efficiency testing. My understanding is that leak testing is done to look at systems where you have particle size independent leaks, that is, $0.1\mu\text{m}$ particles might penetrate as easily as $1.0\mu\text{m}$ particles. If leak testing is referring to that, I think it is a step backward. Or does it just refer to scan testing? One of the later slides linked leak testing to scan testing and it is a qualitative rather than a quantitative test.

DYMENT: The aim is to integrate a scan testing result with an overall efficiency result. One has to take into account the fact that all the very high efficiency filters have a scan test. It is the test we carried out for the U16 and U17 filters and the procedure does specify that the scan test shall be carried out. The aim is to use the results of the scans to produce an overall efficiency result.

SCRIPSICK: So your test is associated with scan testing. In-place testing is sometimes referred to as leak testing, where you test a whole bank.

DYMENT: Yes, I think we have a slight difficulty in terminology here. This work I am discussing does not relate to in-place testing, a separate area.

SCRIPSICK: It is component testing, that is what it is.

DYMENT: We are talking about qualification of filters and filter elements, not installations.

FRANKLIN: Is the CEN vote of approval of a standard by consensus?

DYMENT: I wish it was possible to give a yes or no answer on that. There is more than one international standardization body. ISO is worldwide, it has the disadvantage of being a voluntary system. If people do not want to adopt it, they do not, whereas when a CEN standard is voted in by a majority vote, everyone is obligated to implement it within a certain period of time, that is, everyone within the umbrella of CEN is obligated to do so.

FRANKLIN: It sounds like it needs to be approved only by a majority, not by everybody.

DYMENT: Approved by a majority, yes. The voting system is not just a straight yes or no, there are many shades of reservation, approval subject to technical change, subject to editorial change, and so on. And not all nations have the same status of voting. The answer is yes, but maybe.

PORCO: How long does the cycle take from inception of a working group to issuance of a standard? Approximately how many years are there in your cycle?

DYMENT: So far, it is about seven years. The first couple of years were taken up determining which way to go. Once having got moving, the process was on the order of five years. I think the official timetable allocation is a shorter period than that. If one was starting on a new standard today, one would not be allocated five years, it would be less.

WILHELM: The test that has been performed until now is the mass test, on the basis that a certain amount of mass on the downstream side compared to the upstream side gives you the decontamination factor. The decontamination factor is very important for health physics calculations. If you now count particles, then we have to know how many electrical charges are on one particle. Therefore, I do not see how this test could work in a way that fits the needs of the nuclear industry. It will fit the needs of the electronic industry because they always ask for particle counts. Clean room technology is related to particle numbers, but the decontamination factor is not.

DYMENT: I agree with you. The main driving force for this particular standard has been the microelectronic industry, they are particularly interested in particle numbers. But as the test is focused on a particular size of particle, the most penetrating particle, it is possible to calculate effective mass penetration. In fact, if one could obtain a strictly monodisperse aerosol, the answer would be the same whether you are interested in particle number, particle surface area, particle mass, it would give the same answer.

HAYES: You indicate that the European countries have been progressing toward a common standard. What do you believe is the feasibility of CEN and the United States reaching a common standard for HEPA filters?

DYMENT: I know that some members of the technical committee belong to international filter corporations which do have affiliations in the United States. I think there is a fair amount of interchange of views and knowledge of what is going on. As I said earlier, I do not know whether standardization is going to be driven entirely by manufacturers. It is also driven by regulation as far as the nuclear industry is concerned. For the microelectronic industry regulation is not a concern, the standard will have the requirements of the customers. I think the two areas are somewhat different, but, in the end, I think if there is a commercial incentive for an internationally-accepted standard, I am certain it will come.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

HAYES: You indicated that you have a copy of that standard with you. Is it a possibility that we could get a copy of that standard and maybe include it in the Proceedings?

DYMENT: I think we would not wish to include it in the Proceedings. As I said, it is a discussion document. I have discussed a summary of each of the five sections in my presentation, but for permission to print the full document I would have to consult with the chairman of the technical committee.

HAYES: If you do not want to include it in Proceedings, perhaps you could exchange it with the ASME Code Section FC committee. We are willing to provide you with a draft of our standards for a draft of yours, maybe we can cooperate a little bit. I have two more questions. I noticed your paper includes all filters. Are you currently using ULPA filters in nuclear facilities?

DYMENT: Not that I am aware of.

HAYES: Your testing requirements use laser particle counters. Are you planning on requiring all production filters to be tested using a laser particle counter? How much time is required for a statistically valid test?

DYMENT: For a very high grade filter such as an ULPA, U16 or U17, you need quite an appreciable length of time. For the H14, normally used in nuclear applications, the time would be much less.

HAYES: Do you know what that time is?

DYMENT: I am afraid I do not.

**THE CASE FOR IMPROVED HEPA-FILTER
MECHANICAL PERFORMANCE STANDARDS REVISITED**

C. I. Ricketts and P. R. Smith

Department of Mechanical Engineering

New Mexico State University

P. O. Box 30001 MSC 3450

Las Cruces, NM 88003-8001

U. S. A.

Abstract

Under benign operating conditions, High Efficiency Particulate Air (HEPA) filter units serve as reliable and relatively economical components in the air cleaning systems of nuclear facilities worldwide. Despite more than four decades of filter-unit evaluation and improvements, however, the material strength characteristics of the glass fiber filter medium continue to ultimately limit filter functional reliability. In worst-case scenarios involving fire suppression, loss-of-coolant accidents (LOCA's), or exposure to shock waves or tornado induced flows, rupture of the filter medium of units meeting current qualification standards cannot be entirely ruled out. Even under so-called normal conditions of operation, instances of filter failure reported in the literature leave open questions of filter-unit reliability.

Though developments of filter units with improved burst strengths have been pursued outside the United States, support for efforts in this country has been comparatively minimal. This despite user requests for filters with greater moisture resistance, for example. Or the fact that conventional filter designs result in not only the least robust component to be found in a nuclear air cleaning system, but also the one most sensitive to the adverse effects of conditions deviating from those of normal operation.

Filter qualification-test specifications of current codes, standards, and regulatory guidelines in the United States are based primarily upon research performed in a 30-year period beginning in the 1950's. They do not seem to reflect the benefits of the more significant developments and understanding of filter failure modes and mechanisms achieved since that time. One overseas design, based on such knowledge, has proven reliability under adverse operating conditions involving combined and serial challenges. Its widespread use, however, has faltered on a lack of consensus in upgrading filter performance standards.

One basis of the approach taken here is the premise that filter-unit mechanical failure needs to be prevented in humid airflow and at pressure drops as large as those which the system blower is capable of generating. To this end, improvements to current US filter codes and standards dealing with qualification testing are suggested. The introduction of a filter-unit factor of safety is viewed as indispensable, for example. Overall, recommendations are based upon more recently established failure modes and mechanisms of filters under adverse conditions of operation.

Though the focus is on guaranteeing the integrity of wet filter units for blower generated flows of humid air, reliability under more adverse operating conditions would also be increased. The realization of high-strength filter units overseas illustrates that the widespread implementation of more reliable filter designs can be driven only by more stringent performance standards. In particular, ones initiated by independent regulatory entities and resulting from close cooperation on the part of both filter users and manufacturers, working together with representatives of national codes and standards organizations.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Introduction

Ventilation and air cleaning systems provide for the health safety and the thermal comfort of personnel in facilities that contain hazardous or toxic radioactive materials. The air cleaning systems (ACS's) also prevent the release of contaminated airborne particulate and gases to the surrounding environment. The required high particle removal efficiencies at relatively low pressure drops are made possible by the use of High Efficiency Particulate Air (HEPA) filter units.

As part of the containment barrier between contaminated zones and the environment, HEPA filters must perform reliably not only during normal facility operations but also under possible abnormal or so-called accident conditions. Filter units may be called on to withstand individual or combined challenges of elevated temperature, pressure drop, or high air humidity: ideally without performance decreases that would result in a loss of containment or confinement. In addition, filters must be free of leaks and nonflammable, as well as resistant to the effects of high radiation fields, rough handling, mildew, and vibrations caused by blowers, airflow, or earthquakes. Some applications also demand a degree of resistance to corrosion, shock waves, or degradation by organic solvents.

To fulfill the wide range of requirements and the high levels of performance expected from contemporary filter units has taken decades of improvements in filter construction materials and their manufacturing processes, particularly in the case of the filter medium. Brittle as well as fragile, and thus easily torn, the filter medium has invariably been, and remains yet, the weakest construction material in filter design. Only slight physical damage to it can cause substantial decreases in filter medium removal efficiency resulting in filter functional failure. It is above all due to media strength characteristics that conventional filter units in the United States retain a susceptibility to damage, not only during manufacture, shipment, and installation, but also in service.

The testing of filter units under conditions intended to simulate those anticipated in nuclear facilities during various types of accidents dates back to the 1950's. After the necessity for requiring nuclear grade filters to be nonflammable became evident, for example, investigations during the mid 1950's led to the widespread use of aluminum separators and glass-fiber filter media ⁽¹⁾. These replaced separators of kraft paper and media of cellulose and asbestos fibers. Wooden frames began then also to be made fire retardant by impregnation with salt solutions.

During the development of filter units resistant to fire and corrosive fumes, pressure drop increases with resultant decreases in flow were first reported for filters exposed to an airflow saturated with water vapor ⁽²⁾. Tearing of the filter medium at low pressure drops was also observed. A search began for measures to counter the detrimental effects of moisture on filter-unit integrity and performance.

Evaluations were initially carried out to determine the effects of fog-entrained air at elevated temperatures and higher than design flows on filter-unit performance. Test conditions simulated those associated with loss-of-coolant accidents in water-cooled power reactors. Later studies dealt with the adverse effects of water sprays proposed to protect filter units from hot combustion gases and high soot-particle concentrations in the event of fires. Results of the investigations of the 1960's and 1970's into the effects of moisture exposure led to the realization of important countermeasures: some intended to prevent the exposure of filter units to high humidity air, others to mitigate any adverse effects of water on filter-unit construction materials in cases of inadvertent exposure. Droplet separators and air heaters upstream of HEPA filter and iodine adsorption filter stages typify exposure prevention countermeasures.

Those oriented toward damage mitigation during unintentional exposure are, for example, water-repellant filter media and the so-called "resistance to pressure test", specified to help qualify new, clean filter units as nuclear grade ⁽³⁾. The latter is essentially a proof test conducted at an elevated pressure drop under extended exposure to the flow of air laden with fine water droplets. The minimum function of this test should be to simulate the magnitude of the mechanical loadings that the wet, fatigued filter medium and the pack adhesive of aged, dust-loaded filter packs could have to sustain without damage under normal operating conditions.

As illustrated by the examples noted above, test results for a number of adverse operating conditions have found direct applications in the development of the codes and standards that set minimum filter performance characteristics. These, in turn, have led to numerous and significant performance improvements. Such cases exemplify successful application of research results to nuclear safety practice, via performance specifications in codes and standards.

In other instances, published test results remain yet to be exploited in furthering development of codes and standards in the United States. Such information has potential application for additionally improving filter reliability in US nuclear facilities. Relevant to filter mechanical performance in this context are results obtained during the 1970's for pressure pulses simulating tornados ⁽⁴⁾ and explosions ⁽⁵⁾. Understanding gained from tests carried out in the 1980's under hot dynamic conditions ⁽⁶⁾ or high air humidity ⁽⁷⁾, or more recently those into aging effects ⁽⁸⁾ and serial-challenge qualification testing ⁽⁹⁾ also falls into this category. Full implementation of this knowledge could engender relatively extensive revisions of some US filter standards, a potentially arduous if not impossible endeavor if not well planned.

For example, developers of improved filter units overseas made use of more recently established modes and mechanisms of filter failure documented in the open literature for a range of adverse operating conditions ⁽¹⁰⁾. The resulting high-strength filters were then prescribed in purchasing specifications by the particularly safety-conscious filter user responsible for their realization ⁽¹¹⁾. Nevertheless, it has not yet been possible within the country of the filters' origin to build consensus for revisions to national codes and standards that reflect the full potential of the actual improvements achieved. Both the opposition of filter manufacturers and users and the variations in regulatory policies and inspectorates by region have limited widespread implementation of the improved filter units. This illustrates the need for independent national regulatory entities, as well as close cooperation on the part of both filter users and manufacturers, working together with representatives of national codes and standards organizations.

Intended functions of codes and standards pertinent to HEPA filter performance

The intended function of codes and standards dealing with hardware is to provide minimum requirements covering all component-related aspects - from design through maintenance - that will ensure proper operation of the given component throughout its service lifetime. The fundamental performance characteristics of nuclear-grade filter units can be considered to number six. One, dust holding capacity, though much investigated ⁽¹²⁾, is generally not directly safety related and therefore not dealt with in codes and standards. Typically addressed are particle removal efficiency, pressure drop at rated flow, and some measure of minimum burst strength, usually in the form of a proof test ⁽³⁾. Also in this group are nonflammability and resistance to the effects of moisture. For practical reasons, requirements are specified solely for new filter units in a clean state.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Codes and standards covering performance characteristics of filter-units and their construction materials

For HEPA filter units in the United States alone, there exists a plethora of codes and standards that partially overlap each other⁽¹³⁾. Even for the estimated 5% of the total market for glass fiber filters represented by the nuclear industry⁽¹⁴⁾, duplication of standards has been noted⁽¹³⁾. The code with the most promise of long term viability for nuclear applications, nationally as well as internationally, appears to be ASME AG-1-1994^(3, 15).

In addition, regulatory guidelines exist that address some of the service conditions to which air-cleaning system components could be exposed in systems designed for normal operation⁽¹⁶⁾ and those for atmosphere cleanup following postulated accidents⁽¹⁷⁾ in nuclear power plants. Moreover, users of filter units or owners of facilities typically have their own set of standards⁽¹⁸⁾. These rely heavily upon commonly accepted predecessors to AG-1, AG-1 itself, and military standards for filter media and units, as examples.

Characterization of filter-unit mechanical failure

Filter-unit mechanical failure can be said to take place when the particle removal efficiency irreversibly falls below the minimum value specified for new, nuclear grade units. This can result from physical damage to, or deterioration in, almost any of the components making up a filter unit. Though tears in the filter medium constitute the most likely potential cause, functional failure of the frame, the gasket, or the pack sealant can also cause unacceptable decreases in filtration efficiency.

The prevention of filter mechanical failure, however, does not rule out malfunctions of air cleaning systems and filter units due to other potential causes^(7, 19, 20). In the case of humid airflow, for instance, these include increases in filter flow resistance that restrict airflow such that the distribution of facility subatmospheric pressures is adversely affected. Another example involves decreases in particle removal efficiency involving phenomena other than macroscopic physical damage to the filter medium. These can encompass penetration of the filter medium by liquid water or moisture-induced changes in conditions affecting the filtration properties of the particles or the filter medium.

The above examples indicate that in some cases, maintaining the physical integrity of filters, by itself, will ensure proper functioning of neither the units nor the air cleaning system within which they are located. Nevertheless, ensuring physical integrity under normal operating conditions would constitute an overdue first step toward improving filter unit reliability for all adverse conditions of operation. It would also address not only user requests for filters with greater moisture resistance⁽²¹⁾ that have gone unheeded in this country for more than a decade, but also more general concerns⁽²²⁾.

Mechanical loadings on filter units

The maximum pressure loading that might occur for a HEPA filter operating under normal conditions can be assumed to be the maximum pressure drop that the blower supplying the airflow to the filter can generate. For a nuclear air-cleaning system in a US facility, a pressure drop at the upper end of the range is 3.8 kPa (15 in w.g.)⁽²³⁾, but in other countries the pressure drop can be higher, for example 10 kPa (40 in w.g.)⁽⁷⁾.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Under adverse operating conditions, pressure loading can be much higher. For example, a maximum pressure drop of 20.7 kPa (83 in w.g.) is specified for a NRC Region I tornado ⁽²⁴⁾. In the contiguous United States, tornado passage over a nuclear facility has a fairly high probability of occurring. For ACS's not equipped with flow limiting devices, expanding steam, combustion heat, or damper-actuated diversion of airstreams could also generate transient flows and pressures above those capable of being produced by the blowers at steady-state conditions. Estimates of filter loadings for such instances can be obtained from computer simulations of air-cleaning system operation during nuclear facility accident conditions. In the case of earthquakes, loadings are specified in terms of ground acceleration ⁽²⁵⁾ rather than pressure drop.

It is more difficult to pin down the loadings on HEPA filters that might occur due to explosions. Pressure impulses caused by shock waves generated by explosions depend upon the location of the explosion relative to the location of the filters ^(5,26). However, one might specify a range of 3.4 to 34 kPa (13.8 to 138.0 in w.g.), which is equivalent to the specifications for the strength of single-pane window glass and frame walls, respectively, typically stipulated in building structural codes. Actual explosive overpressures can be much higher than these.

Burst Strengths of filter units

Actual burst strengths of HEPA filter units have been reported by numerous investigators for various adverse operating conditions and well summarized by Bergman et al. ⁽²⁷⁾ in the form of threshold values required to damage deep-pleat filters. The burst strength is highly dependent upon design, manufacturer, and filter medium tensile strength, as well as the parameters defining the test conditions. For pressure change rates equivalent to the NRC Region I tornado ⁽²⁴⁾, burst pressures have been found to range from about 6.9 to 20.7 kPa (27.7 to 83.0 in w.g.) ^(5,26), one baseline datum of the compilation and comparisons made by Bergman et al. According to their summary, five of the six factors addressed can reduce filter burst strength by more than 50%, acting individually.

The burst strength of HEPA filter units challenged by the sixth, shock waves, depends upon impulse per unit area rather than simply upon shock overpressure. However, explosive shock waves have very short duration, so overpressures reported for the shortest shock duration give a good estimate of the explosive overpressure needed to tear the medium of HEPA filters. For units from six manufacturers, the damage overpressure was reported to range from 6.9 to 17.5 kPa (28 to 70 in w.g.) ^(5,26).

New, clean filter units have been documented to sustain respective peak accelerations above 1 g ⁽²⁸⁾ and above 10 g ⁽²⁹⁾ without notable decreases in filtration efficiencies. Yet, earthquake related damage to aged filter units during service has been reported to occur for estimated peak ground accelerations of less than 0.3 g ⁽²⁵⁾.

Deteriorations in construction materials related to mechanical failure of filter units

Aging of the filter medium during normal operations has been implicated in explaining decreases in tensile strength ⁽³⁰⁾ and filter-unit burst strength ⁽³¹⁾, not to mention losses in water repellency ⁽⁷⁾. During long-term service, the outgassing of volatiles from some prospective pack adhesive/sealants of the elastomeric type has the potential for causing shrinkage and resultant adverse effects on the filter medium or the adhesion of the filter pack to the frame.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Exposure to humid air, as another example, can degrade the performance characteristics of HEPA filter units through detrimental changes in the properties of the filter construction materials. High air humidity fosters the corrosion of aluminum separators and metal frames. Moisture can also work to reduce the adhesion forces between the filter pack and frame or leach the fire retardant salts from wooden frames. The filter medium is particularly liable to deteriorations in performance. The presence of liquid water in the glass fiber microstructure can effect significant and partially irreversible decreases in tensile strength, the rigidity of the pleats, and the tightness of deep-pleat filter packs. All of these result in decreased filter-unit burst strength.

Decreases in filter medium tensile strength ⁽³²⁾ and elongation at rupture (see Table III in Appendix) resulting from elevated temperature involving sublimation or burn-out of the binder can also be very significant.

Modes of mechanical failure (deep-pleat designs)

The modes of mechanical failure for deep-pleat filter designs have been noted to be very similar for greatly differing, adverse conditions ⁽⁷⁾. Each of the three frequently documented modes that involve tearing of the filter medium has been observed to result from filter exposure to most, if not all, of the numerous single challenges investigated. These include high air velocities, elevated temperatures, shock waves, and flows of high humidity air; not to mention handling and shipment. The many causes of such similar failures point to locations of inherent weakness or maximum stress in the filter pack.

Mechanisms that contribute to mechanical failure

Many of the mechanisms responsible for filter-unit mechanical failure are also common to failures caused by different adverse conditions. This implies that known failure mechanisms have not been sufficiently well addressed in current filter designs.

A summary of the primary underlying failure mechanisms would include the following. First, the inherent weakness and brittleness of glass fiber filter media lacking reinforcement: typical characteristic values are 1 to 2 orders of magnitude below those of other construction materials as indicated in Fig. 1 and Table I of Appendix. Equally relevant are the additive decreases in filter medium tensile strength and elongation at rupture; due to the effects of pleating, aging, and fatigue in normal service, or exposure to moisture or to elevated temperature. A relative comparison of the respective decreases is given in Fig. 2 and Table II in the Appendix.

Of no less significance is the loosening of conventional filter packs that leads to increased stresses and fatigue in the filter medium, as well as to mechanical interaction between filter medium and separators. Though of secondary nature, the nonuniform distribution of pressure drop induced stresses in the filter medium of deep-pleat designs, nonetheless explains the failure modes and weaknesses of certain deep-pleat geometries and why they should be avoided ⁽¹⁰⁾.

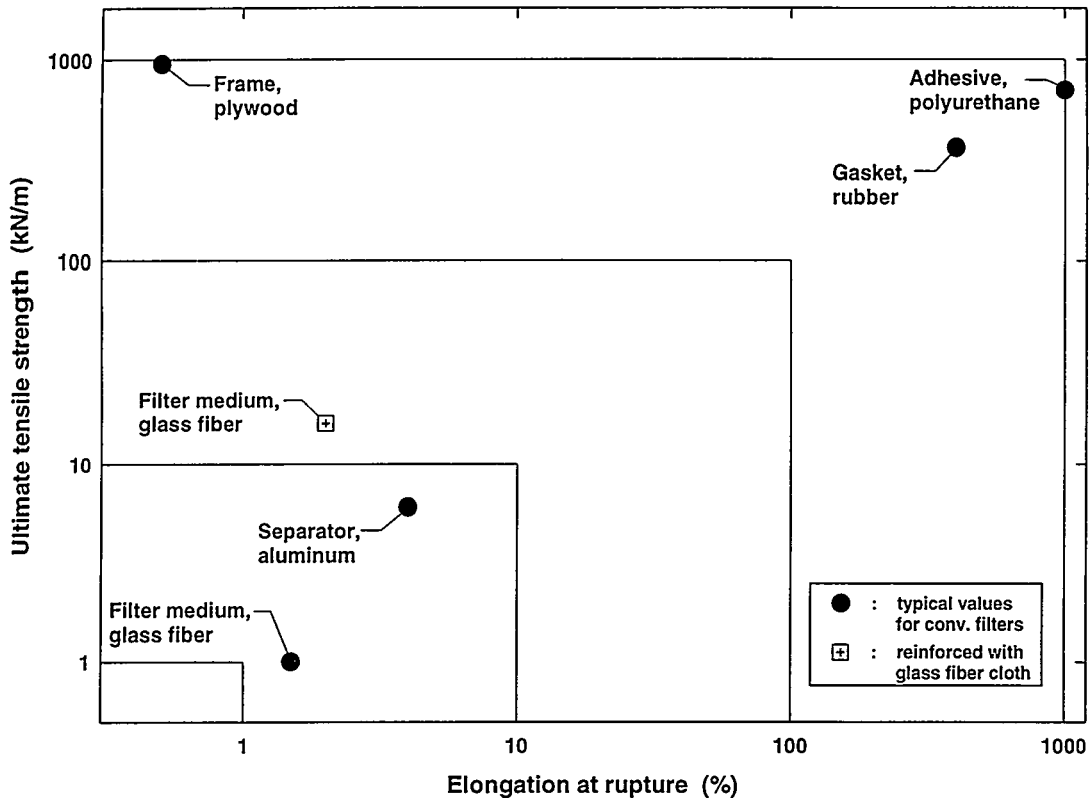


Figure 1: Strength characteristics for the fabrication materials employed in the designs of conventional deep-pleat HEPA filter units.

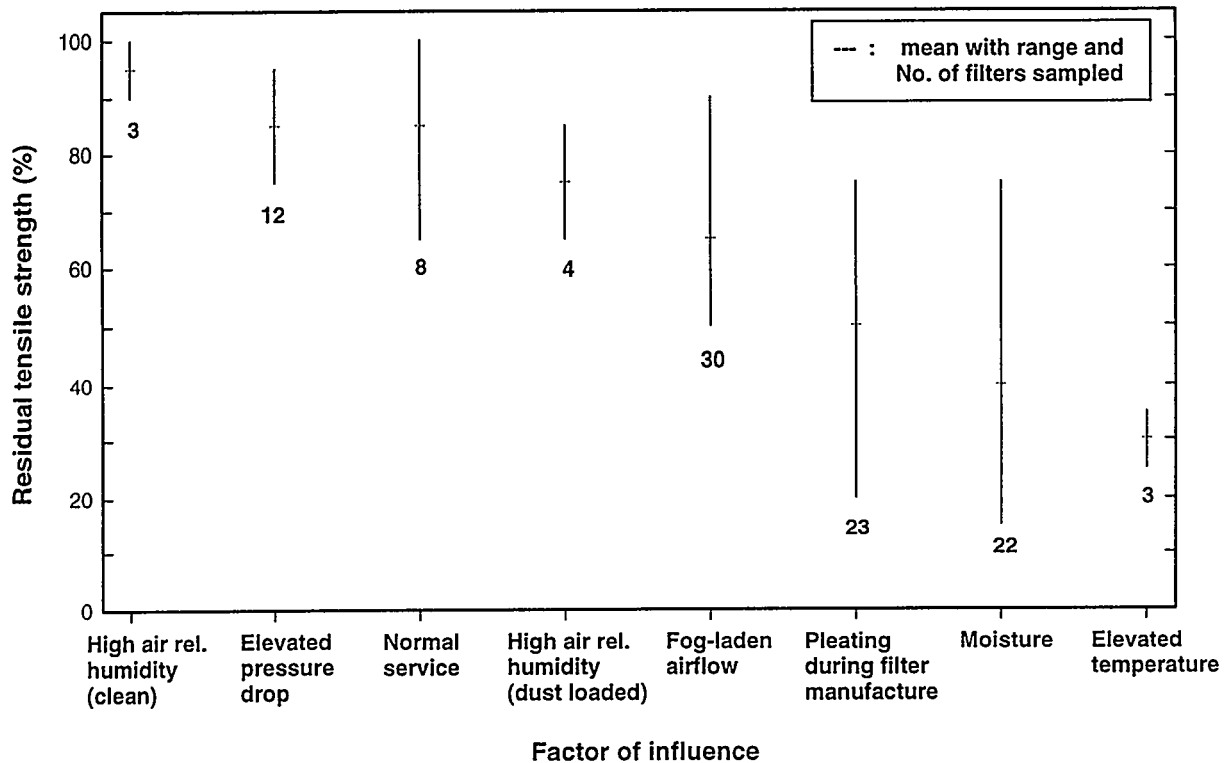


Figure 2: Comparison of the residual ultimate tensile strengths for non-reinforced, conventional HEPA filter media of nuclear grade, resulting from various factors of influence.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Suggested approaches toward eliminating the risk of filter-unit mechanical failure during normal operations and reducing it during other than normal operations

It is to be expected that glass-fiber filter media will continue to play a dominant role in nuclear applications for the midterm future. Moderate cost, high filtration efficiency, low flow resistance and density, reasonable degree of chemical inertness, fair resistance to radiation, elevated temperature, and fire constitute a set of characteristics that other materials cannot presently match. Similarly, the deep-pleat design with separators has proven itself superior in strength to separatorless and mini-pleat designs under most operating conditions. Hence, it has been assumed that the filter-unit design of the following discussion is one characterized by deep pleats, separators and a glass fiber medium. An additional premise is that the prevention of filter structural failure in humid airflow generated solely by the system blower needs to be absolutely ensured. Though the following recommendations focus on guaranteeing filter-unit reliability during exposure to moisture at pressure drops up to the blower maximum, their implementation would also increase reliability under more adverse operating conditions.

With the shortcomings of current deep-pleat filter-unit designs identified, solutions for addressing them can be proposed. For instance, increasing the initial tensile strength of the filter medium and its residual strength under pertinent adverse conditions should have the highest priority. To minimize mechanical interaction between the filter medium and separators, filter pack tightness and stability need to be ensured, particularly under relevant adverse conditions. The concept of a factor of safety for filter-unit mechanical strength needs to be implemented.

Calculation of a safety factor requires knowledge of two values. One is a measure of minimum filter mechanical strength for a given set of operating conditions as compiled by Bergman et al. ⁽²⁷⁾, for example. The other, a measure of the maximum conceivable mechanical loading under the same conditions, possibly obtained from computer simulations, preferably ones verified experimentally. The ideal safety factor would be based upon values for the most adverse conditions anticipated. In practice, however, the economics of enhancing the strength of this weakest of all air-cleaning system components to the level of other ACS components would be prohibitive for the most adverse conditions. This is primarily due to the need for periodic filter-unit disposal. Only for nondisposable, or reusable components, or those with extremely long service lives could the greatly increased costs be justified.

At a bare minimum the safety factor could then, for instance, more advisably be one based upon the maximum pressure drop of the air-cleaning system blower and a proof strength for filter units in a wet condition. A proof strength that should be demonstrated after extended exposure of filter units to elevated temperature, as a separate part of a multi-step test sequence that comprises a qualification test process for nuclear-grade filter units. This should essentially eliminate the risk of filter-unit mechanical failure during normal operations and reduce it during other than normal operations. One overseas high-strength filter design, for example, has a demonstrated safety factor of 1.5 for new units under extended exposure to fog at design flow, after sustaining 23 h at 120 °C in still air ⁽¹⁰⁾. This is based upon a typical maximum blower pressure drop of 10 kPa and a filter burst strength > 15 kPa when wet ⁽⁷⁾.

The above approaches fall into the category of counter-measures aimed at mitigating the adverse effects of moisture. An additional measure, aimed at preventing moisture exposure in power plant ACS's, would involve specifying droplet separator and air heater performance characteristics in detail. This should be based upon experimentally-verified, combined effectiveness of droplet separators and heaters in protecting aged, dust-loaded filters from condensing steam under the transient temperature and flow conditions that simulate a severe LOCA.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

The importance of experimental verification is emphasized by two sets of preliminary test results reported for aged, dust-loaded filter media. One indicated that increasing temperatures above 20 °C can, for at least one dust type, shift the relative humidity, at which moisture-induced, peak filter pressure drops occur, to values below 70% RH ⁽⁷⁾. In such cases the intended protection offered by heaters in limiting air relative humidity to < 70% could be viewed as ineffectual. A second data set demonstrated proportionally greater increases in pressure drop with decreasing values of constant airflows at lower than design levels ⁽²⁰⁾. Given filter units of sufficiently high burst strength, such increases in pressure drop could become irrelevant with respect to filter mechanical failure. The potential ramifications of decreased airflows and resultant redistribution of air-cleaning system pressure drops would, however, remain to be evaluated.

Selected recommendations for augmenting current US codes and standards

Prerequisite to any implementation of the above suggested approaches in actual practice would be revisions to existing codes, standards, and regulatory guidelines. Based upon known failure modes and mechanisms and the authors' interpretation of them, consideration should be given to adding the following functions to specifications presently lacking them. These relate, for the most part, to typical requirements in current documents considered to be in need of change or augmentation.

Filter medium specifications should

- reflect the large differences (1 to 2 orders of magnitude) between typically low tensile strength values of unreinforced, glass-fiber filter media and those of the other filter construction materials
- adequately reflect the potentially adverse and cumulative effects of pleating, aging, fatigue, elevated temperature, and moisture exposure on filter medium tensile strength
- reflect the commercial availability of filter media reinforced with a scrim or cloth of glass fiber
- require a minimum tensile strength in a folded condition
- require a minimum tensile strength in a wet condition.

Filter-unit specifications should

- require that the allowable continuous, peak operating temperature be indicated on the filter label
- require the same test filter units to sustain as many of the stipulated qualification tests as possible

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- include extended static exposure of filter units to a temperature at the upper limit of the design range of operation; in order to induce artificial aging effects in the form of accelerated off-gassing of volatiles from the filter medium, the adhesive/sealant, the gasket, and the frame
- include a resistance to overpressure test that simulates the magnitude of the mechanical loadings that the wet, fatigued filter medium of aged, dust-loaded filter packs could have to sustain without damage under normal operating conditions: this to be performed after the extended static exposure of filter units to a temperature at the upper limit of the design range of operation
- include stipulations of adhesive/sealant performance, e.g., nonflammability, thermal stability, and resistance to: shrinkage, relaxation, cracking, and moisture effects
- include a resistance to overpressure test that simulates the magnitude of the mechanical loadings that the wet, aged adhesive/sealant of aged, dust-loaded filter packs could have to sustain without damage under normal operating conditions: this to be performed after the extended static exposure of filter units to a temperature at the upper limit of the design range of operation
- include stipulation of a minimum value for a factor of safety: at the very least, one based upon the maximum pressure drop of the air-cleaning system blower and a proof strength of filter units in a wet condition; after extended static exposure of filter units to a temperature at the upper limit of the design range of operation
- include a stipulation for deep-pleat pack tightness in a new condition such as ⁽³³⁾ does
- address the potential loosening of deep-pleat filter packs that can result from exposure to moisture, high air velocities, or elevated temperature.

Droplet separator and air heater specifications should

- stipulate droplet separator and air heater performance characteristics in detail; based upon the experimentally-verified, combined effectiveness of droplet separators and heaters in protecting aged, dust-loaded filters from condensing steam under the transient temperature and flow conditions that simulate a severe LOCA.

Conclusions

Published research results obtained during a period extending from the mid 1950's through the 1970's appear to have been extensively utilized in the development of contemporary codes and standards. The realization of numerous improvements in filter-unit performance and reliability can be traced to these early investigations. However, knowledge gained since then does not appear to have been fully exploited in revisions of codes and standards specifying filter-unit performance. Current specifications in the United States do not reflect more recently gained knowledge of the modes and mechanisms of filter-unit mechanical failure documented in the open literature for a wide range of adverse operating conditions. This information has potential application for further improving filter reliability.

Despite some 30 years of performance advances, conventional HEPA filter units remain not only among the least robust components to be found in a nuclear air cleaning system, but also the most sensitive to the adverse effects of conditions deviating from those of normal operation. In this respect, they constitute the weakest link in a chain of crucial components forming the barriers between contaminated zones and the environment. One reason for this is the inherent fragility of conventional glass fiber filter media. Another is the sensitivity of unreinforced media to cumulative reductions in strength properties caused by pleating, aging, fatigue, elevated temperature, and moisture exposure. A third factor is the loosening of the filter pack that can result from exposure to high air velocities, temperature, and moisture.

Further enhancement of filter reliability will realistically be achieved only by increasing performance specifications in codes and standards to levels that are both technically feasible and economically justified. This process, however, needs to begin at the initiative of regulatory entities, which carry the ultimate responsibility for ensuring public health and safety. Meeting more stringent standards will have to entail cooperation and coordination on the part of both filter users and manufacturers working together with representatives of codes and standards organizations. The final step, optimizing the design and minimizing the cost of filter units that meet upgraded standards, can only be left to manufacturers and the free market.

Acknowledgments

The authors wish to express their appreciation to K. S. Ricketts for assistance in editing the draft manuscript.

References

- (1) Keigher D. J.
Fire Protection Considerations in "Clean Room" Design and Operation;
in: Proc. 6th Annual Technical Meeting of American Association for Contamination Control,
Washington, D.C. (1967) p. 187 ff.
- (2) Palmer, J. H.
Moisture and Burning Tests of Space Filters;
TID-7551 (1957) p. 53 ff.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (3) ASME AG-1-1994
Code on Nuclear Air and Gas Treatment
ASME, New York 10017-2392, 1995.
- (4) H. L. Horak et al.
Structural Performance of HEPA Filters Under Simulated Tornado Conditions;
La 9197-MS NUREG/CR-2565,
Los Alamos Scientific Laboratory, 1982.
- (5) Gregory, W. S. and P. R. Smith
Response of Standard and High Capacity HEPA Filters to
Simulated Tornado and Explosive Transients;
LA-9210-MS Los Alamo National Laboratory, 1982.
- (6) Pratt R. P.
The Performance of Filters Under Hot Dynamic Conditions;
in: ⁽³⁴⁾ p. 824 ff.
- (7) Ricketts, C. I.
The Behaviour of High-Efficiency Particulate Air Filter Units During
Exposure to Humid Airflow (in German);
KfK 5057, ISSN 0303-4003, Kernforschungszentrum Karlsruhe,
D-76021 Karlsruhe, Fed. Rep. of Germany, 1992.
- (8) Gilbert, H. et al.
Preliminary Studies to Determine the Shelf Life of HEPA Filters;
CONF-940 738 (1995) p. 613 ff.
- (9) Gilbert, H., W. Bergman, and J. K. Fretthold
Development and Evaluation of a HEPA Filter for
Increased Strength and Resistance to Elevated Temperature;
CONF-9020823 (1993) p. 617 ff.
- (10) Rüdinger, V., C. I. Ricketts, and J. G. Wilhelm
High-Strength High-Efficiency Particulate Air Filters for Nuclear Applications,
Nuclear Technology 92 (1) (1990) p. 11 ff.
- (11) TLA No. 22
Technical Specifications for the Delivery and the Acceptance of
Nuclear Grade HEPA Filter Units, 1st Ed. (in German)
Karlsruhe Nuclear Research Centre, Karlsruhe, Fed. Rep. of Germany, June 1988.
- (12) Dymont, J. and C. Hamblin
The Development of a HEPA Filter with Improved Dust Holding Characteristics;
CONF-940 738 (1995) p. 176 ff.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (13) Jacox, J.
Review of HEPA Filtration Test Standards and Their Application to Nuclear Applications;
CONF-9020823 (1993) p. 215 ff.
- (14) Anderson, W. L.
Making Sense of HEPA Filtration;
Filtration & Separation, Nov/Dec 1989, p. 439 ff.
- (15) Burchsted, C. A.
Progress in Standards for Nuclear Air and Gas Treatment;
CONF-780 819 (1979) p. 51 ff.
- (16) Regulatory Guide 1.140, Revision 1
Design, Testing, and Maintenance Criteria for Normal Ventilation Exhaust System Air
Filtration and Adsorption Units of Light-Water-Cooled Nuclear Reactor Power Plants;
Office of Standards Development, USNRC, Wash., D.C., 1979.
- (17) Regulatory Guide 1.52, Revision 2
Design, Testing, and Maintenance Criteria for Post Accident Engineered-Safety-Feature
Atmosphere Cleanup System Air Filtration and Adsorption Units of
Light-Water-Cooled Nuclear Power Plants;
Office of Standards Development,
USNRC, Wash., D.C., 1978.
- (18) FSC-4460 (in preparation)
Specifications for HEPA Filters Used by DoE Contractors;
U. S. Department of Energy, Washington, D. C. 20585.
- (19) Ricketts, C. I., V. Rüdinger, and J. G. Wilhelm
The Flow Resistance of HEPA Filters in Supersaturated Airstreams;
CONF-880 822 (1989) p. 668 ff.
- (20) Ricketts, C. I., M. Schneider, and J. G. Wilhelm,
Mathematical Models for Changes in HEPA Filter Pressure Drop Caused by High Air Humidity;
CONF-900 813 (1991) p. 671 ff.
- (21) Carbaugh, E. H.
A Survey of HEPA Filter Experience;
CONF-820 833 (1983) p. 790 ff.
- (22) Leonard, J. F.
HEPA Filter Concerns - An Overview;
CONF-940 738 (1995) p. 150 ff.
- (23) Nicolaysen, E., K. E. Carey, and J. J. Wolak
Standardization of Air Cleaning Systems for Nuclear Powerplants;
CONF 760 822 (1977) p. 761 ff.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

- (24) U.S. Atomic Energy Commission
Design Basis Tornado for Nuclear Power Plants;
Regulatory Guide 1.76, 1974.
- (25) Bergman, W., J. Elliot, and K. Wilson
Performance of HEPA Filters at LLNL Following the 1980 and 1989 Earthquakes;
CONF-940 738 (1995) p. 425 ff.
- (26) Smith, P. R. and W. S. Gregory
Structural Response of HEPA Filters to Shock Waves;
The Shock and Vibration Bulletin, No. 52,
The Shock and Vibration Information Center,
Naval Research Laboratory, Washington, D. C., May 1982.
- (27) Bergman, W. et al.
Criteria for Calculating the Efficiency of Deep-Pleated HEPA Filters with
Aluminum Separators During and After Design Basis Accidents;
CONF-940 738 (1995) p. 563 ff.
- (28) Manley, D. K., R. D. Porco, and S. H. Choi
Seismic Simulation and Functional Performance Evaluation of a Safety Related,
Seismic Category I Control Room Emergency Air Cleaning System;
CONF-840 806 (1985) p. 526 ff.
- (29) Yow, J. R., R. Holloman, and A. Algar
Seismic Qualification of HEPA Filters by Test in an Actual Operating Condition;
CONF-801 038 (1981) p. 1175 ff.
- (30) Robinson, K. S. et al.
In-Service Aging Effects on HEPA Filters;
in: ⁽³⁴⁾ p. 60 ff.
- (31) Johnson, J. S. et al.
The Effect of Age on the Structural Integrity of HEPA Filters;
CONF-880 822 (1989) p. 366 ff.
- (32) Hamblin, C. and P. J. Goodchild
The Effects of Temperature on HEPA Media;
CONF-9020823 (1993) p. 327 ff.
- (33) IES-RP-CC-001-86
Recommended Practice for HEPA Filters;
Institute of Environmental Sciences,
Mt. Prospect, IL 60056, 1986.
- (34) Fraser, G, and Luykx, L., Editors
Gaseous Effluent Treatment in Nuclear Installations;
Graham & Trotman, London, 1986.

Appendix

Table I: Typical ultimate tensile strength and elongation at rupture for the construction materials of nuclear grade HEPA filter units in a new, dry condition at room temperature ⁽⁷⁾.

Filter-unit component (material)	Thickness (mm)	Ultimate tensile strength		Elongation at rupture (%)
		(kN/m ²)	(kN/m)	
Filter medium (conventional glass fiber)	0.5	$2 \cdot 10^3$	1	1.5
Filter medium (glass fiber reinforced with glass fiber cloth)	0.55	$3.2 \cdot 10^4$	16	2.0
Separators (aluminum)	0.035	$1.4 \cdot 10^5$	6	4
Gasket (neoprene foam)	6	$6 \cdot 10^4$	360	400
Adhesive/sealant (solid polyurethane)	5	$1.4 \cdot 10^5$	700	1000
Frame (plywood)	19	$5 \cdot 10^4$	950	0.5

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Table II: The influence of various factors on the residual tensile strength of new¹, glass fiber, HEPA filter media of nuclear grade, in the machine direction at room temperature² ⁽⁷⁾.

Factor of Influence	Residual Tensile Strength (%)		Quantity of Filter Units Sampled
	Average value	Range of values	
Elevated temperature (after 1 h @ 250 °C)	30	25 - 35	3
Moisture (after 1 h soak @ p _{abs} = 5 kPa, specimens wet)	40	15 - 75	22
Pleating during filter-unit manufacture	50	20 - 75	23
Fog-laden airflow (up to burst pressure of filter, specimens dry)	65	50 - 90	30
High air rel. humidity (after 1 h @ 99% RH)			
dust loaded (used)	75	65 - 85	4
clean	95	90 - 100	3
Normal service (after approx. 24 months, used)	85	65 - 100	8
Elevated pressure drop (after 3 s at approx. 20 kPa)	85	75 - 95	12

¹ except where noted with (used).

² except for tests at 250 °C.

Table III: The influence of various factors on the residual elongation at rupture of new¹ glass-fiber, nuclear-grade HEPA filter media in the machine direction at room temperature² (7).

Factor of Influence	Residual Elongation at Rupture (%)		Quantity of Filter Units Sampled
	Average value	Range of values	
Pleating during filter-unit manufacture	40	20 - 60	23
Elevated temperature (after 1 h @ 250° C)	45	35 - 55	3
Elevated pressure drop (after 3 s at approx. 20 kPa)	80	45 - 95	12
Moisture (after 1 h soak @ $p_{abs} = 5$ kPa, specimens wet)	85	45 - 160	22
High air rel. humidity (after 1 h @ 99% RH)	90	85 - 90	3
clean			
dust loaded (used)	95	90 - 100	4
Fog laden airflow (up to burst pressure of filter, specimens dry)	105	60 - 150	30
Normal service (after approx. 24 months, used)	110	85 - 125	8

¹ except where noted with (used).

² except for tests at 250 °C.

DISCUSSION

BERGMAN: HEPA filters in the US have to pass qualification tests: a heated air test for five minutes at 700°F, an over pressure test for one hour at 10in.w., and a vibration test. Could you share with us some of your thoughts about these specifications and what you might recommend for improved qualification tests?

RICKETTS: I would not at all want to disparage the current qualification tests. Most of them (I can only think of one exception) involve testing different filters during the qualification process for the different challenges. In other words, you do not take the same filter that you put through the heated air test and run it through the resistance to over pressure test, which involves exposing filters to a pressure drop of 10in.w. and to a flow of fine droplets or fog. I think our primary recommendation, to answer your question in as short a time as possible, would be to test the same filter units under as many of these challenges as possible during the qualification process. I hope most of you were there yesterday when Dr. Bergman showed us another horror story with a blowout of filters following a fire and fire suppression measures taken at Rocky Flats in, I believe, 1980. This was a case where the same filters were exposed simultaneously not only to high temperature but also moisture and a high pressure drop caused by the moisture essentially clogging the filter medium. As I recall, there were four stages of filters in the air cleaning system, the first three stages were taken out completely, and the fourth stage was severely damaged. I think this provides an example of why some of these qualification tests might need to be reconsidered.

SCRIPSICK: I agree with this line of logic. I think Bergman and the people at Rocky Flats have done some sequential exposure tests on the same filter. What is needed, and we have to be careful in stating this, is simultaneous exposures. That is what can occur in the field, airflow resistance and heated air. I want to acknowledge that the United States has done its fair share in terms of nuclear air cleaning. Its technology is being used world wide now, so you can't fault the researchers here. I think you were very careful in the beginning of your talk to say that.

RICKETTS: I too think they have made enormous contributions, without which we would not be where we are today.

SCRIPSICK: This country is in a nuclear power reactor lull of a decade or so long. We are now behind the wave in nuclear power research. Although the DOE, as the manager from Hanford indicated, is knocking down our facilities, there is still a need for research. It should have been funded a number of years ago so the country could have gotten the most utility out of the research. Doing it now, I think it is still needed but it will be less useful.

FIRST: Because you did not mention it, I assume you did not get around to testing minipleat filters or separatorless filters. Based on what you already know, what would be your opinion regarding the relative safety of these alternative manufacturing methods? I also wonder about the difference between a six inch deep filter and a twelve inch deep filter. Would the deeper filter be more stable? I think your challenge is well stated, we have to be challenged to look at alternative methods of construction and materials to overcome the deficiencies which you have pointed out. I realize I am asking you for an opinion, but if you are willing to give it, I would appreciate your comments.

RICKETTS: I am willing to answer your first question concerning the minipleat design and the

separatorless design. Both designs are a very big improvement, or have the potential for being a big improvement, as far as dust holding capacity goes. It is my personal opinion that one of their advantages is not high strength. I think you will find, if you go to the literature, that deep pleat filters with separators do have a higher burst strength under most conditions of operation than the other two designs. I can recall approximately twenty years ago when the work in Germany first began, that prototype minipleat filters were tested and could not match the burst strength of the conventional deep pleat filters even when reinforced. We have stress models available now that tell us that the deeper the pleat, the stronger the filter. Pack depth is in the denominator of the stress term and I believe it is squared, so the larger the depth squared, the lower the stress is for a given pressure drop. I think that very well explains cautions that I recall running across in the literature many years ago from Mr. Burchstead saying please avoid the six inch pack depth because of its susceptibility to catastrophic failure, the whole pack would bulge out at very low pressure drops.

ADAMS: Did you look at the products of several manufacturers or did you restrict your investigation to just one manufacturer? A second question is, are there specific guidelines that you would say need to be changed, possibly by the regulatory agencies?

RICKETTS: Let me answer your second question first. I think you will find a whole list of recommendations in our preprint, more detail than anyone may want to read, but we took the liberty, anyway. Your first question had to do with how many manufacturers. Were you looking for brand names?

ADAMS: I do not know. I know there are several manufacturers of that filter design. Did you find similar findings in all of them, or in just one?

RICKETTS: In general, the results for filters from various manufacturers were similar. Naturally, there was a range that correlated primarily with filter medium tensile strength. Not all manufacturers use the same filter medium. To put this work in a little better context, I presented a summary of knowledge that goes back over the last fifteen or twenty years of testing filters under adverse operating conditions such as tornadoes; conditions that simulate loss of coolant accidents and so on.

PORCO: To build on Dennis Adams' questions, were all the filters you tested built and qualified to MIL-F-51068, to N-509, or to any current standards? Did they go through a QA Station? Do you have a baseline for comparison?

RICKETTS: Most of the results upon which these conclusions are based were for filters from European manufacturers and tested in Europe. To answer your questions specifically, no, they did not go through the qualification process. They were very, very similar in design to American filters. We have tested a few American filters under tornado conditions. Under those conditions the differences between the European brands and the American brands were insignificant.

PORCO: The reason I bring this up is that I know US manufacturers' nuclear grade filters look very similar to commercial grade filters, but their performance and the strength are quite different due to manufacturing methods and materials.

RICKETTS: In Europe there is also a grade of filter referred to as nuclear grade. It also has to be much, much higher quality than run of the mill filters used in non-contaminated applications. Just to go one step further, I think it has to do with the tensile strength of the filter medium. That is in essence what we feel

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

needs to be changed.

PORCO: I agree with you. Your slide was very interesting.

SCRIPSICK: One of the things that flies in the face of your premise that the medium is very weak is that we have had filters in place in this country for thirty years in some instances. They are still performing and they pass the in-place test. If the medium is now very weak (and I do not think there is any doubt about that) they have had an awful lot of exposure. This seems to go counter to what you are saying. Could you expound on that?

RICKETTS: I assume that any filter that has been in service for more than five years is probably in a second, third, maybe even a fourth stage in a train. It has not been loaded with much particulate and its pressure drop is probably going to be very close to its new pressure drop. For that reason, it probably hasn't been fatigued to the extent that a filter in the first stage has because first stage filters are changed out much more frequently. That would be my thought.

SCRIPSICK: Are you saying that it is not just long term exposure to low differential pressure or sudden new differential pressure but that the stress really multiplies at higher differential pressures?

RICKETTS: I can tell you it is probably approximately linear, but we do not have firm evidence. We certainly have some strong circumstantial evidence that indicates there is a fatiguing effect at the locations of highest stress in a filter pack and that location is typically at the top of the pleat, close to the adhesive, or at the bottom of the pleat, close to the adhesive.

SCRIPSICK: Would you think it would be proportional to pressure drop times time, the pressure exposure? With a thirty year filter, is there a time component?

RICKETTS: I have no basis to give you an answer on that, I can only speculate and I am not sure that would be useful.

BERGMAN: About eight years ago there was a paper published in which Jim Johnson and several other people from Livermore took third or fourth stage HEPA filters from our plutonium building. These filters were clean, and that is why we used them to assess performance. They ruptured at thirteen inches of water. We took new filters out of the box that had just been sitting at warehouses. We had published in either the last Proceedings or the Proceedings before that these filters that had been sitting in the warehouse had at least one half the strength of a brand new filter. So this is to counter the thought that if you do not have any challenge, these filters are going to be fine, and that is not true. These filters deteriorate from day one and it is unfortunate that Tim Sing from Evanite Fibers isn't here. He informed us that glass fibers themselves begin aging from the minute they are produced and some industries require glass fiber manufacturers to package the fibers in a hermetically sealed bag so they effectively stop this aging process.

OPENING COMMENTS OF SESSION CHAIRMAN

**PANEL SESSION: CHANGES TO ASME
CODE AG-1, SECTION FC, HEPA FILTERS**

This session is on changes to ASME Code AG-1, Section FC, HEPA Filters. The participants are Jack Hayes with the US Nuclear Regulatory Commission, Jim Slawski, with DOE; Bill Rown, with the US Army, Edgewood Research Development and Engineering Center; Ben Franklin with AAF; and Steve Klocke with Flanders Filters. I am Rich Porco with Ellis & Watts. We are going to give each of the panel participants a chance to say a few words starting with Jack Hayes.

PANEL DISCUSSION

HAYES: As an introduction to this panel session I would like to provide some background on the changes which have been made to Section FC, HEPA filters, and the basis for making the changes. In March, 1994, the Department of the Army proposed a review of ASME Code Section AG-1 to determine whether it could be utilized in lieu of two existing military standards, MIL F 51068, for high efficiency particulates filters, and MIL F 51079, dealing with filter media. Based upon the review, the Army determined that the ASME AG-1 code, specifically, Section FC, could be utilized. In April, 1995, the representatives of Code Section FC met with representatives from the Department of the Army and Department of the Navy to discuss incorporating all of these MIL standards into code section FC. Previously MIL F 51079 and 51068 were incorporated into the code by reference only. In addition, we wanted to discuss with the Departments of the Army and Navy the rough handling test, use of challenge agents other than DOP for aerosol testing, and alternative HEPA filter frame materials (because FC was initially limited to nuclear power plant applications and did not incorporate some of the frame materials in the Army standard.) We also wanted to talk about the acceptability of laser spectrometer testing for filter efficiency and, finally, we wanted to discuss seismic and environmental qualification. I might add that these discussions with the Departments of Army and Navy representatives were quite useful in developing the changes which were ultimately made to Section FC. Now, I am going to highlight important changes made to Section FC that I think will be of interest. We have defined an independent filter test laboratory. It is intended to allow any entity not associated with either a filter manufacturer or a supplier, that is capable of performing the laboratory tests called out by code section FC, to do so. This was done because Edgewood, the Department of the Army facility, may not continue to do this type of testing for others. We defined "test aerosol" to allow substances other than DOP.

I will now break the changes we have made to Section FC into two categories: first, those associated with the incorporation of the MIL Standards, and second, the changes that are independent of the MIL Standards. The MIL Standards have designations for framing materials, including one for plywood. Section FC did not previously incorporate filter designs using plywood but we now have direction from the Board of Nuclear Codes and Standards of ASME that we must broaden our code application. Therefore, we can not restrict the code to nuclear power plants applications alone, but must provide code assistance to other entities. That being the case we have added designations from the MIL Standard that will cover plywood. In the MIL Standards separators must have the ability to withstand corrosion. This aspect, as it applies to DOE-type applications, has been added to Section FC. We also added a new filter size to Code Section FC, a 12x12x11.5 in. filter, referred to as "size nine". It has a design flow rate of 250 CFM and a maximum resistance of 1 in.w. Because cancellation of MIL F 51079, is likely, mandatory. Appendix FC-1 now contains parts of F 51079, such as tensile strength. We also added a requirement for a certificate of conformance as a substitute for QPL qualification testing. Another significant change is to allowed qualification testing by an independent laboratory. We have also allowed the use of laser particle counters; previously, Section FC did not. A method for the filter rough handling test was added. We corrected the efficiency acceptance criterion for the heated air test. In the prior version of FC it was incorrectly stated as 0.3%. It has been corrected to 3%, and now it is consistent with the requirements of the MIL Standard. The radiation resistance section was deleted, not because it is no longer required, but because it is handled by another section of the AG-1 code. In early 1996, Section FC was balloted by the Board of Nuclear Codes and Standards of ASME and received three negatives. The comments associated with the three negatives have been resolved and we went back to the Board of Nuclear Codes and Standards to determine if

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

they had any further objections to the changes we made to FC. They had until July 5, 1996 to respond. It is my understanding that no objections were received and Section FC can now go to ANSI for concurrence, a thirty day process. After ANSI concurrence, Section FC will be available for use, but an official publication will not be made until the next addendum to the AG-1 Code. However, the revised version can be obtained from ASME or from Rich or me.

PORCO: I thought it would be appropriate to say a few words about ASME AG-1 Code and how section FC fits in. ASME AG-1 is an equipment code covering four general areas. Division I contains general requirements. Division II contains the requirements for ventilation air cleaning and ventilation air conditioning. FC is a subsection of Division II. Division III contains the requirements for process gas treatment. Division IV contains testing procedures. We are mostly concerned with Divisions I and II. Division I, section AA, contains the common sections that apply to section FC. The general requirements were pulled out of the each of the sections covering ventilation air cleaning and ventilation air conditioning equipment. Design criteria is one of the categories that is common. The division and section titles are shown in Table 1.

TABLE 1

DIVISION I	- GENERAL REQUIREMENTS
SECTION AA	- COMMON ARTICLES
DIVISION II	- VENTILATION AIR CLEANING & VENTILATION AIR CONDITIONING
SECTION BA	- FANS AND BLOWERS
SECTION DA	- DAMPERS AND LOUVERS
SECTION SA	- DUCTWORK
SECTION RA	- REFRIGERATION EQUIPMENT
SECTION CA	- CONDITIONING EQUIPMENT
SECTION FA	- MOISTURE SEPARATORS
SECTION FB	- PREFILTERS
SECTION FC	- HEPA FILTERS
SECTION FD	- TYPE II ADSORBER CELLS
SECTION FE	- TYPE III SORBERS
SECTION FF	- ADSORBENT MEDIA
SECTION FG	- FRAMES
SECTION IA	- INSTRUMENTATION AND CONTROL

PROPOSED NEW SECTIONS UNDER PREPARATION

SECTION FH	- TYPE IV SORBERS
SECTION FI	- METAL FILTERS

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

As can be seen from Table 1, CONAGT is very busy. Going down the list almost all the components, fans and blowers, dampers and louvers, prefilters, HEPA filters, Type II adsorbers (tray type) Type III adsorbers, filter frames, and racks are complete. There are also sections that are currently being worked on, e.g., Type IV adsorbers (v-type configuration), and Section FI on metal filters. Papers were given at this conference on metal filters; the code is active. The points to be made here are: (1) AG-1 is a code that has general requirements with common articles, therefore, Section FC is not a stand-alone document. (2) The code is interrelated with ASME N-509 and ASME NQA-1, which has the QA requirements. And (3) the code is a living document so we have active writing groups; not only in new areas like metal filters, but also for Section FC. The writing group currently is looking at ways of improving FC and meeting industry requirements. Therefore, suggestions made at this conference will be integrated into the code during the next revision. The writing group is made up of a cross section of industry and includes representatives from DOE, Army, Navy, Nuclear facilities, AE firms, and equipment manufacturers. If anybody is interested in participating in this code work, please give your name to any member of CONAGT. The code provides means for technical inquiries, both questions and concerns on how to apply the document. At the back of the code there is a mandatory appendix that gives instructions on how to submit questions. It is designed to provide a quick response to questions on the code.

HAYES: Prior to starting our panel discussion I would like to emphasize that this revision to section FC was done very quickly to avoid being left without documented guidance after military standards F 51068 and F51079 were voided. We have no more than just finished this revision and here we are looking to make the technical changes which need to be made to section FC. At the CONAGT subcommittee meeting on ventilation air cleaning equipment, we generated a list of about ten individuals who volunteered to participate in the revision. The changes so far just reflect correction of certain errors and recall of the MIL Standards. We would be interested in the participation of everyone willing to work with the committees and writing groups to make the needed changes. I think we are ready to discuss the changes to code section FC.

PORCO: Let me add another point. Some questions have been asked concerning design criteria. The code is different than the military standard in that it not only gives specific requirements for HEPA filters but also requires all the other design criteria to be addressed. For people looking for simple cookbook solutions, let me point out some of the other things the code and the standards require you to do. You need to address design criteria and environmental qualifications, volumetric air flow rate, minimum and maximum design pressures. In other words if you have a high design pressure, or a pressure-time transient, you must address it in addition to the requirements that are in FC. You must address how your filter selection is going to meet all requirements and determine if the filter specified in FC can meet it. When you have high temperature, entrained water droplets, or high relative humidity applications you must address them. Dr. Bergman has mentioned, time and again, the effects of entrained water blinding filters and causing failures. All the environmental conditions must be cited by the specifier, and the designers, or the engineers, must design the system and components to meet all the requirements. Other considerations, among others, are concentration of specific contaminants in the air stream, required decontamination factors, radiation integrated life dose, and structural loading. I repeat, you cannot use the code by just looking at section FC, you must also consider how the housing, fans, dampers, in fact, every component in the system, interacts to assure environmental and seismic qualification. The metal portions usually do not pose much of a problem, but the non-metallics definitely need to be addressed for environmental requirements. The

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

point that Dr. Ricketts made about different materials within HEPA filters was very important. There are also different materials within the houses that interact and affect overall system performance. The key is to have components, systems, and the complete air handling and facilities operation meet all the needs of your application.

FRANKLIN: I look forward to changes in the code. I think of the present code as an optimization of the HEPA filter, materials, thicknesses, et cetera, as it was thirty years ago. It does not pay attention to what the HEPA filter industry has become since then. At that earlier time, all HEPA filters were built the same way. Today, the Mil. Spec. or government specification HEPA filter for nuclear power plants are the least efficient filters we have. There are many other applications. I look forward to future modifications for handling new types of filters, and other types of applications. I think it will be a help to the industry. I see that European standards cover all kinds of filters, not just nuclear filters, in their standards.

KLOCKE: I think there is still plenty of room for improvement in section FC, although it is now very usable. Basically, it carries on our historical specifications without losing continuity. There are a couple of things that got dropped in the transition from the Mill Spec to section FC. They included the climatic exposure test which exposed filters to arctic, tropical, and desert conditions. These tests were not of major concern in the past, even when they were included by reference in DOE specifications. Most DOE customers would waive these specific requirements. Presumably they came from defense-related applications, but they are not of major importance or concern anymore. Other qualification tests, rough handling, wet over pressure, heated air, are still only required once in five years by an independent lab. Certainly, that's a long time to go between tests. We are very much a proponent of doing more testing of a lot of these design qualification criteria. However, there is not a lot of guidance for acceptance criteria on them, and it is certainly a point of discussion. We used to have to submit a very small number of filters, typically four filters for each type of test, to Edgewood, four for rough handling, four for the wet overpressure. You had to pass four out of four. Now, when we get into more routine testing of such filters, we obviously can't expect 100% compliance every time. Sooner or later, we will observe a test failure. How do we resolve it? What are the acceptance criteria levels to be used on a more ongoing basis? We need to discuss that and come to agreement through the consensus work of the committees and resolve the issues. Here is another point, we talked about media tensile strength earlier. The specifications still only require tensile strength of new media to be only 2.5 pounds per inch. I know that all good HEPA filter manufacturers of the nuclear grade filter are buying or manufacturing media that has twice or even higher tensile strength, right now. In fact, if you try to make HEPA filters for nuclear application with that low tensile strength, you can expect some failures on a design qualification basis. Therefore, there are many areas for improvement. We have to go back and ask why we adopted the old qualification tests, and then come up with a sound basis for what the new qualifications should be. A lot of work needs to be done by a lot of people in every area, from suppliers to users.

SLAWSKI: When I started working in this area, not long ago, one of the tasks that I picked up was to update the DOE technical standard on specifications for filters. And then I also got involved with CONAGT on the FC committee. We are definitely working our way to transferring to FC. I cannot say that we are ready to do that today. We have just had one more meeting on technical issues in the DOE draft standard, and are trying to get it to the point where it is compatible with FC. We have made some progress. We will do one more review and revision of the draft standard, and compare it, line-by-line, with what is issued as FC, and see where we are. I am just looking at the items discussed here this morning and I see that the DOE standard's reference to a size 3A seems to be the FC size 9,

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

and our pressure drop is higher than the value in the FC section, i.e., 1.3 versus 1.0. We have to resolve such issues. I think it is fair to say that except for the size 7 and size 8 there is a pressure drop difference of 1.3 versus the DOE's 1.0. We probably have a lot of tiny technical issues, and probably more in the area of what I would call "pick up errors", as opposed to "intentional errors", in pulling over the important parts of the Mil. Standards that have been dropped. That is what both ASME and DOE have to do, make sure that we haven't dropped things that we should pick up, and that we pick them up correctly.

ROWAN: There is also a correction in your program. As you probably know, we in the army have been custodians of MIL-F-51068 and MIL-F-51079 for over thirty years, plus the corresponding qualified products list (QPL). Of course we are vitally interested in particulate filtration in our mission to protect troops from chemical/biological warfare. However, this particular filter never really fit too well into the army's theme of management. When we develop filters, we start the configuration management system with a requirement from the field, i.e., they tell us they need such a filter for such-and-such a flow and such-and-such conditions, and then we develop the requirements from that. I am not really sure where all the requirements for MIL-F-51068 came from. I don't think anyone is around who was there when it was first developed. Another thing is that we have about six other particulate filters that we have Mil. Specs for. They were all developed in the conventional manner. They are procured with material procurement money and managed under a logistical system of inventory control and things like that. The MIL-F-51068 filters are used primarily in what we call fixed installation filter phases; they are mostly doomsday-type control centers. They are very highly secret. I do not know where they are and I don't even want to know much about them for fear I might disclose some information I am not supposed to. But it has been very difficult getting information as to what they need. We know they buy them, but we could never find out how many they bought. That is one reason we were unable to argue effectively against the canceling of MIL-F-51068. There is definitely a need for it. We know those installations are buying them regularly. We have a representative who serves as a point of contact with them, and we are going to have to use AG-1 for their purposes. There are several things we are going to have to undo in order to accomplish this, or make some kind of compensation for it. One is in MIL-F-51079, the text of which is being appended in AG-1. Things like mildew resistance and environmental resistance were left out. We will probably have to get them reinserted or make up our own document for our customers because they want them. The bottom line is that we are going to take a very strong interest in this in the future, probably much stronger than we did in the past. We know the requirements are going to be driven primarily by nuclear needs, but we have our own needs, and we are going to need this document.

PORCO: Thank you. I think we can now open the floor for general questions.

DISCUSSION

FRETTHOLD: Will a list of qualified filters be kept, and if so, by whom, or will the certification of conformance be kept by the manufacturer in lieu of the list?

PORCO: I think the issue here is not understanding the current code. The code requires you to have a QA program in accordance with ASME NQA-1. The NQA-1 program requires each manufacturer to have an auditable quality program that is in compliance with eighteen criteria. They include auditing, design, purchasing, and engineering, encompassing every facet of the facility. That program is the key here. In other words, manufacturers will have to have a program that is in compliance. They must be able to defend that program, it must be auditable. The purchaser may choose to audit them to make sure that they are in total compliance in order to have positive proof that all the qualification tests were performed and all the material certifications, *etc.*, are in place. Or they may choose to use a group such as NUPIC, a group of utilities that have come together to make auditing and verification a little cheaper. If You subscribe to their service, they will provide you with all the audit reports. The bottom line answer is no, there won't be a list.

GRAVES: If I am a nuclear utility, for instance, and I need to design, have built, and then commission an air cleaning system, what would you recommend I use, AG-1 or N-509? Are there any regulatory implications if I have to live with Reg. Guide 1.52?

HAYES: Our recommendation would be that you have to incorporate both AG-1 and N-509, because at this time I don't believe AG-1 is complete enough to exclude N-509. Once the code is completed, you will be able to utilize it exclusively, but until that time, it will still be necessary to use AG-1 and N509 as part of your design process. With respect to the acceptability of AG-1 to a regulatory agency such as the NRC, the NRC has already endorsed part of AG-1 in the implementation of improved standard technical specifications. Also, I believe, as part of the review of some of the advanced light water reactor designs such as the AP600 by Westinghouse, the Combustion Engineering System 80, and the advanced BWR from GE. So I think it has been incorporated into the advanced designs and would certainly be acceptable for consideration by any operating facility if they wanted to do a back fit to their existing ventilation systems.

FIRST: Let me get on to another topic, one that I have presented to sessions of this organization in past years. It refers to the efficiency requirements for HEPA filters used at nuclear facilities. The original efficiency requirement was for 99.95%, with 0.3 μm DOP. This requirement originated in the early days of the filter. Then in the 1960s, approximately, the minimum acceptable efficiency was raised to 99.97%. The question is, why was it raised at that time? I can assure you nobody did any research on the subject, it was a very simple matter. All of the manufacturers were sending in filters that were at 99.97% or above. And someone wisely said, why don't we raise the criteria since it is not a problem for the manufacturer? Here we are, thirty years later, and what we find in practice is that the filters that are sold for nuclear applications have minimum efficiencies in excess of 99.99%. My request to the committee is that they take this to heart, and that the revisions to this HEPA filter section recognize the fact that we need to raise our sights. Inasmuch as the filters already come through that way, anyway, is it important? I think the answer is, yes, it is, because we have people who are critical of the nuclear program who will be likely to rub our noses in the fact that we are not using standards that represent the best that the industry can produce. I think it is very important that

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

we recognize advances in technology and that we make this change in the definition of the HEPA filter for use in nuclear applications.

PORCO: Very good comment. I think we have a few panel members that want to respond as well as a few people in the audience.

KLOCKE: First, I want to point out where these higher efficiencies are rooted. In this industry, contrary to a lot of other ones, we have both a media specification and a finished filter specification. MIL-F-51079 very clearly points out that the minimum efficiency for the filter medium must be 99.97% for 0.3 μ m particles at a velocity of about 10.5fpm. It has been that way for many, many years and unchanged since the original specification. Most filters, on the other hand, are designed with a maximum media velocity of only about 5 fpm. As theory predicts, by reducing the flow rate, efficiency improves. So, when we start with media that perform well at twice the velocity used in the filter, we get the natural benefit of increased efficiency when we operate them at something less than 5fpm. These days, most designs have enough filter area that the velocity can be significantly less than even 5fpm. Also, media manufacturing technology has certainly progressed well beyond the basic minimum efficiency of 99.97%. We have the capability, as we saw on slides in earlier presentations, to make filter media that are two, three, four orders of magnitude more efficient than basic HEPA filter media. Obviously, pressure drop increases go along with it. There is always a cost/benefit issue here that needs to be addressed when considering choices of higher efficiency filters. Another thing we have talked about, but breezed over here at the session today, is that in some cases systems are designed with a number of filter banks in series, and penetration is multiplicative. Therefore, when we have a maximum of 0.01% penetration through the first bank, we can multiply that times the second bank and the third and the fourth. By the time air passes through the third or fourth bank, the overall efficiency of the system may be seven or eight nines. This is very difficult to verify in the field, for certain, but that is, in effect, what is happening. When dealing with the public, this certainly needs to be brought to light. Even though there may be higher efficiency filters available, systems may be designed that provide higher efficiency by using basic HEPA filter construction.

FIRST: I would like to offer a couple of items of rebuttal to your presentation. The first one is that the user is concerned with the performance of the fabricated filter, not with the paper. The paper is the manufacturer's concern, not the user's concern. No matter how efficient the paper may be, if the filter is not put together as it should be, it is going to leak. I think it is important, in addition to having good paper, to have good construction, and this is why I made the proposal that I did. That is item number one. The second is this matter of efficiency of filters in series. When you have a monodisperse aerosol, such as 0.3 μ m monodisperse DOP, each identical filter in the series can be depended upon to have equal efficiency, but when dealing with a polydisperse aerosol, there is differential efficiency by particle size. The effect of multiple filters in series is not the same efficiency with each stage, but a lesser efficiency for each stage because you are taking out the more easily filtered particles in the first stages and are left with the more difficultly filterable particles for the later stages. Therefore, equal efficiency for each stage in series is not quite correct.

FRANKLIN: We purchase our media. We are getting to the point where our supplier is trying to make better and better media for us, and we are getting more efficient media. We could probably convert without any change in anything to a minimum 99.99% HEPA filter, except that the pressure drop starts to rise, as Mr. Klocke advised. The pressure drop rises, and then there will be some rejects, either in our factory or by DOE, because the filters would exceed 1.0 in.w Therefore, there is a compromise that has to be made.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

PORCO: In the same train of thought, we are talking about filters and we are keyed in on efficiency. Remember, for nuclear applications that is not the only design criterion. Filters are available to 99.999999% efficiency or higher, but do they meet the other design criteria? No. Right now, as far as I know, the only media that will meet all of the requirements, not just efficiency, but all of the requirements of the codes and standards, are those conforming to Section FC and/or Mil. Spec. F-51069. Is there anything out there that is more efficient and still meets all the design criteria, including strength?

FRANKLIN: I had an informal discussion with DOE about this and was advised that at present the measurements of what is leaving the facilities are very, very satisfactory using the present filters. Therefore, there is no administrative pressure to change the efficiency of the filter at this time. It may be advisable from a public awareness standpoint to say that the manufacturers have a standard of 99.97% and yet, they are meeting 99.99%. They always exceed the standard. That may be better from the public standpoint.

FIRST: The point I was trying to make was that the filters that pass through the filter test stations do meet all the requirements and do have efficiency in excess of 99.97%. So it is not a question of, will they meet it? They do, in fact, meet it. The other factor is that the filter manufacturers are selecting their best filters to go to the filter test stations. There is no question about it. Nevertheless, there are users who need less strict compliance to a very rigorous standard and, obviously, filters are not being discarded. There are other applications for them. So I do not think there is a real barrier in terms of availability, or even of cost. They have already met that proposed standard.

KLOCKE: I concur with both your statement and Ben's. We are building according to the current specifications and building good filters. We can essentially meet a 99.99% criterion with no impact at all today. Essentially all the filters are meeting the proposed requirement.

FIRST: The fact that DOE is not asking for a higher standard is not the only consideration. Sometimes we have to push DOE a little bit and sometimes we have to push NRC a little bit, to help them break through the red tape of their own organizations with which they struggle all the time.

SLAWSKI: We do argue internally about these things and one argument I heard about two weeks ago, from a person not an industrial hygienist, was that the respirable size of particles is larger than the size that is getting through. Therefore, we don't care about them. I am not sure I would put it that way, because it is a public issue. I do want to give the idea consideration within the department as well as with the manufacturers. If we are already doing it why not recognize it and take credit for it? It will not hurt us in any way.

WEIDLER: My question falls on what you have just said. What is more basic to me than the efficiency of the filter is what size particles we are concerned about dealing with. We are selecting 0.3 μm but is there a smaller particle that we need to deal with to have good efficiency? What is the basis of the 0.3 μm ?

SLAWSKI: I do not know the history, Mel First or Werner Bergman may know. I know Werner Bergman has repeatedly stated to me that the most penetrating particle is smaller than 0.3 μm . Depending on who you are listening to there is a range roughly between 0.15 to about 0.18 μm .

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FIRST: Yes, $0.3\mu\text{m}$ is historic. When Irving Langmuir was asked to advise the army on the size of the aerosol to use to test their gas mask filters, he did the same analysis that Werner Bergman showed yesterday with his computerized program and he advised the army that $0.3\mu\text{m}$ was the minimum filterable size. He included impaction and diffusion, but did not include interception. Incidentally, interception was an advance that was made by Wendell Anderson and his colleagues at the Naval Research Lab at a somewhat later date. Please keep in mind that the filters we have today are quite different than the filters that were manufactured in 1943, or thereabouts. The fact that today's filters have a different minimum filterable size is not at all surprising. More basically, you might ask, what is the significance of the minimum filterable size in terms of what we are looking for in a filter? We have no idea what the aerosol is going to be that the filter will encounter. We can not say precisely what we will need in that regard until an accident happens or some other event occurs that gives us a real life situation. Nevertheless, any rigorous test of the kind we are talking about, even though it may not use the minimum filterable particle size, assures us that we have a high quality product. The test gives us a "figure of merit" even when it does not give us a precise efficiency number for what the filter will do in normal service.

WEBER: I would like to focus on some comments that Steve Klocke and Ben Franklin made by combining them. The issue is the clean pressure drop of a filter. This reflects some comments that Dr. Bergman made yesterday. Clean pressure drop is limited in most cases to 1.0 in.w. I think that number is held too affectionately because face velocity is by and large the big parameter with respect to dirt loading and I think the intent behind 1.0 in.w. is to assure the maximum useable life of a filter that will be disposed of in the end. Consider also the physical limitations of the filter, whatever they may be. To me, the important point is, what is the dirt capacity of the filter? For a given filter medium, that is mostly a function of accessible surface area. One could conceive of a fiber filter, or a metal filter, which has a low face velocity, but a somewhat higher pressure drop, and lasts longer. When Dr. Bergman said that a filter made of metal fibers of $1\mu\text{m}$ would fail, I think what he meant to say was that it would not meet the 1 in. w. pressure drop requirement. That is true. In a prior paper by Dr. Bergman, he said that the metal medium had twice the unit pressure drop of comparable efficiency glass media. I think the state of the art has improved considerably since that time. The upshot is, if you split the difference between 1.0 in.w. and twice that much, you may be getting enough additional area that the filter will last longer before it reaches the fan's limit. In the case of metal media, you would be cleaning the filter. My point is a generic one, I think that the 1 in.w. is held too affectionately and that some more consideration should be given to accessible filter area since plugging of a HEPA filter has been shown in these conferences to be principally a surface phenomenon. If that is agreed to, then there could be some other test which could be used to validate the dirt capacity of the filter, such as the ASHRAE 52 test.

FRANKLIN: As a filter manufacturer, we try to meet what the industry and our clients require. This change in the FC code allows 1.3 in.w. for a 1,500 CFM, 24 in. by 24 in. separator filter. We have had no problem with building higher pressure drop filters. It depends on the user's fans, system, et cetera.

ROWAN: We get into arguments sometimes on setting requirements. The general argument I hear against setting requirements is that, when you do not really have to meet them, you lose flexibility in design. For instance, later on something may come up that means you have to have higher temperature resistance, or something like that, as a first priority, but once a specific penetration requirement gets into the code it is pretty hard to get around it. Quite often, you can meet other requirements by relaxing the pressure drop requirement. It is one of the disadvantages of rigid

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

requirements. We have seen cases where they set requirements way, way too high for certain items simply because they could meet it but then they run into trouble later.

PORCO: That is a good point. Those of you who are close to the working groups in the CONAGT committee know that there is a conscious effort to move towards performance-based standards and code sections rather than equipment-based standards. In the future, I hope you will start to see more flexibility because of that. This question was from Laurie Todd, Farr Company. What is the quantity of filters required for testing? FC reads eleven, it is in table FC 5100-1. Are all eleven required?

HAYES: Yes, all eleven are required.

PORCO: The next question is also from Laurie Todd. Since the QPL is technically obsolete and a certificate of conformance (C of C) is required per AG-1, section FC, will all manufacturers have to submit filters for test to obtain C of Cs now? In other words, if the QPL is gone, doesn't the C of C time frame of five years begin now?

PORCO: The answer relates back to the QA issue. The code requires adherence. If the individual manufacturer presents proof of compliance, and it is acceptable within their QA program, and auditable, then it would be acceptable. If they have previous tests that are acceptable, *ie.*, they have positive proof, all of the necessary calibrations, necessary certifications, etc. in a format required by NQA-1, then I would say from that point on, the data are valid through the five year period and should be acceptable.

FIRST: We heard John Dymont speak about the British and the European standards and that they do their testing somewhat differently than we do. There is no indication, nevertheless, that the quality and performance of their filters is any different than ours. I believe they are quite the same. If we try to prove comparability, as we have in the past, by spending uncountable dollars trying to reconcile the various tests that use different particle sizes, different particle size distributions, different particle shapes, what we find is that there is not a convertible number that we can use with reliability. Rather than getting into that quest again, I would suggest to the committee to open the code and make it more acceptable from the standpoint of performance rather than hardware; so that there can be alternatives. In other words, when filters meet the European standard or the British standard, or any other standard that we recognize as being comparable to ours, we would accept that test as comparable performance. That would make things a lot better for manufacturers who want to sell from country to country. They could simply say, whichever one of these valid standards or codes that you have to conform to, they are all the same.

PORCO: That is an excellent point. The ASME is moving towards globalization. I think the leader in global standards is the QA Standard ISO 9000. For performance standards, I am sure we are somewhat restricted within the ASME code. Ray, would you like to comment on how easy it would be to do it?

WEIDLER: I don't know how you would recognize that concept through ASME. To me, this is a purchasing issue. If you could have a truly international standard, *i.e.*, twelve, fifteen countries could agree on one standard and have it be governed by one body, then we probably could do it. But we can't say we are going to do it through ASME; it would be desirable but difficult because we have not done that at this point.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

FRANKLIN: I have a question for Mr. Slawski. We have a QPL on a filter with exterior fire retardant plywood, as required. If we wanted to switch to marine fire retardant plywood, would we have to get a new QPL, or would DOE accept a proposal for a QPL filter revised to use marine plywood?

SLAWSKI: I don't know the answer to that. I think I would have to discuss it with the manufacturers, people like Rich Porco, and people from Aberdeen. Having said that, I will now say that, intuitively, it does not sound like that is a degradation. But I think you would still want some agreement among more than one party because it would affect other manufacturers.

DERDERIAN: A lot of the fire protection specifications within the code have been placed there in past years by the fire protection community to lessen the probability of fires. Basically, they are intended to reduce combustibility, or reduce the level of susceptibility to fire. Some of the provisions are beginning to change in the code. I am wondering if prescriptiveness is going to become the design basis. Is it going to be related to a design basis, as you seem to be indicating, or is it some other situation?

PORCO: I am not sure we are changing the requirement. In FC, there are two very tough requirements; UL 586, for the filter, and a heated air test. You cannot pass the heated air test if you add additional volatiles. I am no longer in filter manufacturing, but one of the toughest things for filter manufacturers to do is to manufacture a very rugged filter and still limit the amount of volatiles in the binder and adhesive used in the filter. What I am saying about performance-based requirements is that, in addition, you have application specific requirements and you must add them to the requirements of FC.

DERDERIAN: Is that specifically stated within the code, or is it something that is implied?

PORCO: That is something I went through this morning, it is stated in Section I, but I am not sure it is as clear as it should be. I think that is the reason why ISNATT, for instance, is looking at design guides to help the user apply the codes and standards.

FRETTHOLD: To expand on Laurie Todd's question, you need to define the number of filters that are required for each of the QPL tests. It is a bit vague right now. It is something we need to work on in the committee to permit people to qualify their filters.

HAYES: I agree. I think the concern is the call for eleven filters of each size. Is that the issue? That is something we will take under advisement with the working group.

FRETTHOLD: The thought was to get it into the record of the meeting, that would serve for people who want to qualify filters.

PORCO: Since this is a living code, the way to find problems and improve the document is through implementation and use. My experience with AG-1 is that it is being applied in the far east, in Korea and in China. All of a sudden, the things we put in the codes and thought were very clear are being read by Asians. They take a very literal interpretation of the code. So it is important that we make sure that all requirements in the codes are very clear and are not subject to different interpretations. I think that is a very difficult task for those working on the codes. We welcome all suggestions, recommendations, and constructive criticism. We will work on all problems to make sure

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

that they do meet the needs of industry. If there are no other questions, I will ask Jack Hayes to summarize.

HAYES: As the subgroup chairman for section FC, I would like once again to emphasize to all those present that, it is our intention to upgrade the code section and that we have no hidden agenda. It is not our intention to perpetuate the existing designs. If you have contributions you can make in terms of where we should be going, I encourage you to give your name to me, to Ray Weidler, or to Rich Porco. We solicit your participation. We need your participation. Based upon your participation, this will be either a good or a bad code section. In summary for this morning, we heard first from Ray Weidler who discussed the first twenty years of the ASME committee on nuclear air and gas treatment, as prepared by one of the founding members, Jack Jacox. We also had a discussion of the progression of the European standard for the HEPA filter. It is under development and will be completed in June, 1997. There were additional discussions on HEPA filters from the US perspective. The weaknesses associated with particular designs were cited and where we should be going, both with respect to the design and with respect to the standards, was presented by Dr. Ricketts. Finally, we had a panel discussion on revisions to code Section FC of the AG-1 code. Issues raised during this panel discussion included the frequency of testing, whether it should be more frequent, the acceptance of failures of certain of the qualifying filters, and the need, or the lack of need, to have 100% of units passing. We also discussed whether there is a need to improve the acceptance criteria for penetration by moving up to 99.99% from the 99.97% required by the present standard. The comment was tempered by the fact that raising qualification standards may close off a particular design to some needed applications.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

CONFERENCE CHAIRMAN'S SUMMARY AND CONCLUDING REMARKS

Some of the things that came out of this Conference are that we need to look more and more at performance based codes and standards and get away, as much as we can, from the hardware type. We also need to look at risk based requirements, a still more difficult step ahead for us. In other words, all situations are not the same, we have to look very critically at the requirements to determine the best possible way to handle each of the situations. We heard a great deal about how filters might be modified, and why they should be modified. The work that Werner Bergman showed us yesterday with computerized fluid-dynamic simulations, whereby we can follow one particle at a time as it goes through the maze of a filter is an indication of what the future holds. This is where we are going, but we have to keep in mind that we should always endeavor to verify the results of these very powerful tools to make sure that we still have our feet on the ground and know precisely what we are doing. We had a lot of input on HVAC, and I think that's a good thing because air and gas cleaning is basically inseparable from the subject of HVAC in general, they do go together very well. We had a session on waste management and this, again, is a wave of the future. We have to become more and more involved in this; not because we want to guide these operations but because we have to look closely at the operations in order to design the air cleaning and HVAC systems that will be necessary to carry out the decommissioning, remediation, and the restoration without endangering people, the environment, and all the other things that we stand for in this activity that we are engaged in.

I think it has been a very successful conference. I do want to thank all of you who have participated, particularly those who participated by presenting papers and those who made commentaries at the conclusion of presentations. As you know from past conferences, some of the most valuable parts of the Proceedings are the discussions which follow the presentation of papers and panel sections. I have one last thing to do before concluding this conference and that is to ask where would you like to have the next conference, in 1998? We try to determine where the majority of people would like to go, and try to make such arrangements. We meet in July or early August, before schools start so families can come together. I will make inquiries at the locations suggested and will consult with the program committee on a final decision. It has been a great pleasure to meet you all again, and I thank you all for coming and contributing.

Note: Minneapolis has been selected for the site of the 25th DOE/NRC Nuclear Air Cleaning and Treatment Conference, the meeting dates are August 3-6, 1998 at the Minneapolis Marriott City Center Hotel.

Index of Authors and Speakers

Adams	147, 161, 459, 531, 847
Ahmad	118
Arganbright	89
Banks	132, 176, 671
Banton	202
Barlow	187, 608
Barrow	532, 545
Bartlett	188, 200, 201
Battersby	325
Beason	89
Beckman	63, 676
Bellamy	12, 30, 31, 63, 85, 117, 129, 130, 364, 367, 381, 382
Bergman	38, 75, 89, 117, 325, 394, 470, 482, 485, 498, 649, 670, 708, 742, 752, 848
Bettencourt	649
Beyer	609
Billarand	500
Blacklaw	118, 129, 742
Bond, J.	788
Bresson	200, 631, 647
Braun	460
Burns	76, 85, 86, 87, 88
Burwinkel	202, 320, 321, 323, 331, 332
Cambell	383, 534, 545, 546, 547
Cass	532, 546
Chen	471
Conklin	63, 697
Corey	485
Counce	576
Crouch	788
Dalpiaz	65, 75
Dauber	30, 49, 682, 803, 804
Derderian	394, 696
Devena	329, 331, 332, 777, 860
Dorman	682, 751, 787, 805
Doughty	89
Ducret	500, 519
Duvall	187, 385, 394, 395
Dyment	88, 368, 380, 383, 498, 707, 743, 751, 819, 826, 827
Edling	363
Elliot	649
Engelmann	31, 145, 200, 427, 459, 483, 742, 777, 803
Fleming	87, 117, 147, 459
First	2, 3, 4, 10, 11, 30, 31, 32, 38, 39, 49, 320, 327, 334, 364, 380, 385, 395, 647, 846, 855, 856, 857, 858, 859, 862
Fordham	118
Franklin	87, 88, 532, 647, 670, 827, 853, 856, 857, 858, 860

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Freeman	520
Fretthold	322, 386, 394, 482, 752, 776, 855, 860
Fujine	778, 787
Fukasawa	378, 380, 470, 563, 575, 627
Funabashi	563
Furrer	609, 618
Ghosh	323, 324, 328, 329, 330, 532, 546, 547
Gilles	647
Golden	532, 545, 546
Gong	441
Görtz	460
Graves	132, 145, 202, 318, 319, 320, 321, 323, 326, 327, 328, 330, 331, 332, 682, 855
Gregonis	471, 482
Grot	400
Harris	532, 545
Hayes, J.	320, 327, 382, 531, 827, 828, 850, 852, 855, 859, 860, 861
Hermann, B.	562, 575, 609, 617, 618, 627
Hermann, F.	?????609, 618
Hoeflich	609
Jacox	807
Jubin	562, 575, 576, 608, 617, 627
Kihara	778
Kinase	778
Kitamura	778
Klocke	853, 856, 857
Kluge	202, 318, 320, 322, 323, 326, 328, 329, 330, 332
Komatsu	550
Kondo	563
Kovach, B.	145, 180, 670, 671, 675
Kovach, J.	33, 38, 318, 319, 322, 324, 334, 382, 524
Knoch	618, 627
Kranz	326, 329
Kress	
Kuhn	618
Lagus	147, 400, 426, 427
Larson	708
Lee, R.	3, 10, 367, 519
Lee, Y	65
Leonard	202, 320, 325, 326, 327, 331
Lifshutz	698
Lopes	708
Loughborough	743
Lyons	381
McGregor	708
McFarland	441, 459
Moeller	40, 49
Mokler	676

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Monroe	696
Muyshondt	441
Orzechowski	330
Paul	76
Pachernegg	118
Pest	202, 317, 318, 320, 322, 532
Philippi	426, 428
Pierce	86, 698, 707
Porco	3, 30, 75, 85, 86, 322, 324, 327, 329, 369, 380, 383, 426, 776, 827, 847, 848, 851
Prevost	162
Pyle	330, 331, 776
Rahimi	683
Rice	51, 63, 64, 75
Ricketts	117, 161, 380, 524, 675, 829, 846
Riley	118
Roberson	525, 531, 532, 533, 545
Robertson	118
Roblot	500
Rown	854, 858
Sakurai	550, 562, 617, 627
van Shoor	618
Scripsick	145, 318, 321, 324, 328, 331, 631, 676, 682, 696, 707, 826, 846, 848
Seigneur	162
Shaffer	132
Slawski	2, 379, 386, 631, 647, 649, 752, 853, 857, 860
Smith	829
Stagges	89
Stoffel	118
Ström	118
Takahashi	550
Thomas	498
Tseng	742
Vendel	163, 500
Wainhouse	118
Wagoner	337, 364
Walker, B.W.	76
Walker, B.A.	188
Wapman	89
Weber	38, 64, 86, 364, 683, 696, 697, 742, 803, 858
Weidler	30, 320, 322, 327, 328, 366, 369, 370, 379, 380, 381, 383, 859
Weil	460
Weishaupt	618
Wente	441
Wikoff	132, 671
Wilhelm	63, 319, 371, 380, 470, 742, 776, 827
Wilson	89, 649, 708
Witherell	708
Wong	76
Wright	788, 803

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

LIST OF ATTENDEES

Dennis G Adams
Commonwealth Edison Company
1400 Opus Place, Suite 400
Downers Grove, IL 60515
708 663-7428 FAX 708 663-67199

Wendell L. Anderson
9254 Mimosa Drive
Lapata, MD 20646
301 942-0552

Tim Arndt
Kaiser Hanford
PO Box 88
Richland, WA 99352

Ken Barrow
Duke Power Co
13225 Hagers Ferry Road
McGuire Nuclear Station
Huntersville, NC 28078
704 875-4208 FAX 704 875-4809

Robert L Barlow
British Nuclear Fuels Plc
Research & Development
Sellafield, Seascale
Cumbria CA20 1Pg
UNITED KINGDOM
44 19467 75028 FAX 44 19467 76984

William T. Bartlett
Environmental Evaluation Group
7007 Wyoming Blvd NE suite F2
Albuquerque, NM 87109
505 828-1003 FAX 505 828-1062

John Bates
Westinghouse Hanford Company
PO Box 1970 (Mail Stop H6-36)
Richland WA 99352

Glenn Battersby
TRIUMF
4004 Westbrook Mall
Vancouver, BC, V6T 1A6
CANADA
604 222-7408 FAX 604 222-1074

Ronald R Bellamy
US NRC
475 Allendale Road
King of Prussia, PA 19406

Patrick A. Bennett
GPU Nuclear Corp.
PO Box 480
Middletown, PA 17057
717 948-8232 FAX 717 992-6851

Werner Bergman
Lawrence Livermore Laboratories Hazards Control
Dept., L-379
7000 E Avenue
P.O. Box 5505
Livermore, CA 94550-9900

John R Blacklaw
Washington State
Department of Health
Industrial Blvd. Bldg 5
Olympia, WA 98504
360 7536-3350 FAX 360 753-1496

Leroy Bond
Lydall, Inc
Technical Papers Div.
PO Box 1960
Rochester, NH 03867
603 332-4600 FAX 603 332-9604

Jeffrey H Bond
Micro Composite Materials Corp
4608-D Industry Lane
Durham, NC 27713-5414
919 544-1717 FAX 919 361-3535

James F Bresson
Informatics Inc
1900 Randolph Road SE
Albuquerque, NM 87106

Ernest R. Brinkley
Westinghouse Savannah River Co
PO Box A
Savannah River Site, 724-F
Aiken, SC 29808
803 952-3805 FAX 803 952-3128

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Marten F. Brunk
Krantz - TKT GmbH
Am Stadion 18-24
Bergisch Gladbach
51465
GERMANY
49 2202 125 120
FAX 49 2202 125 104

Pete Bruno
Edison International SONGS
PO Box 128
San Clemente, CA 92674-0128

Richard Bruno
Filtration Group, Inc
PO Box 274
Mill Valley, CA 94942

Dan Burns
Westinghouse Savannah River Co
Savannah River Technology Center
Bldg 676-T Room 11
Savannah, GA 29808
803 557-7299 FAX 803 557-7271

Paul Burwinkel
Georgia Power Company
7821 River Road
Waynesboro, GA 30830
706 826-3389 FAX 706 826-3681

William Cambo
Lydall Inc
Chestnut Hill Road
Rochester, NH 03867
603 332-4600 FAX 603 330-3023

Robert R. Campbell
Tennessee Valley Authority
1101 Market Street
LP 4F-C
Chattanooga, TN 37402-2801
423 751-8210 FAX 423 751-8184

Tom Carter
Los Alamos National Laboratory
MS-583
Los Alamos, NM 87544

Joe Cass
Cooper Nuclear Station
Brownville, NE
tel 402 825-5528

Albert T. I. Chang
Panteck
PO Box 13-301
Taipei, Taiwan
ROC
02 7587115-6 FAX 02 7253210

Allen W. Conklin
DOH Division of Radiation Protection
Airdustrial Center, Bldg 5
PO Box 47827
Olympia, WA 98504-7827
360 586-5504

David W. Crosby
11403 Cronridge Drive
Owings Mills, MD 21117-2247
410 363-9696 FAX 410 363-9695

Steven Crouch
Micro Composite Materials Corp
4608-D Industry Lane
Durham, NC 27713-5414
919 544-1717 FAX 919 361-3535

Edwin L. Dalpiaz
ICF Kaiser Engineers
1800 Harrison Street
Oakland, CA 94612

Lyle L. Dauber
MIT Office, ERDEC
Aberdeen Proving Ground, MD 21010-5

Leo Derderian
US DOE
19901 Germantown Road
Germantown, MD 20874

Stan Devena
WCNOC Wolf Creek
Nuclear Operating Corp
1550 Oxen Lane
Burlington, KS 66839

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Sada Dhingra
Entergy Operations, Inc.
River Bend Station
PO Box 220
St. Francisville, LA 70775
504 381-3693 FAX 504 381-4871

Richard G Dorman
Consultant
24 Balmoral Road
Salisbury SP1 3PX
UNITED KINGDOM

Sachio Dr.Fujine
Japan Atomic Energy Reserch Institute
Tokai-mura Naka-gun Ibaraki-ken 3
JAPAN
81-29-282-6673 FAX 81-29-282-6677

Mr. D. Ducret
Institut de Protection et de Sûret Nucléaire
Département de Prévention et d'Etude des Accidents
DPEA/SERAC - CEA/Saclay
Bâtiment 393-91191 GIF-SUR-YVETTE Cedex
FRANCE

Maynor Dykes
Westinghouse Savannah River
Savannah River Site
Aiken, SC 29808

J. Dymant
AWE plc
Aldermaston
Reading
Berkshire RG7 4PR
UNITED KINGDOM
01734 826568 FAX 01734 824821

Rudolf Engelmann
Global Atmospheric Response
11701 Karen Drive
Potomac, MD 20854
301 903-5394 FAX 301 903-6233

Timo Eurasto
Tertuntle 7B
01400 Vantaa
FINLAND
358 0755 88 345
FAX 358 0 75988 350

Kevin Fleming
NCS Corporation
4555 Groves Road #41
Columbus, OH 43232

Mr. Ken Duvall
U.S. Dept. of Energy
Of of Envir Policy & Assistance
1000 Independence Ave., SW
Washington, DC 20585
Tel: (202) 586-0242

Dr. Melvin W. First
Harvard Air Cleaning Lab.
Harvard School of Public Health
665 Huntington Ave.
Boston, MA 02115-9957
617 432-1164
FAX 617 432-3349

Ben Franklin
AAF International
215 Central Avenue
Louisville, KY 40208
502 637-0631 FAX 502 631-0397

Roland L. Frenck
US DOE (DP-40)
16501 Apache Lane
Gaithersburg, MD 20878

Jan K. Fretthold
Rocky Flats
Environmental Technology
PO Box 464 Bldg 130
Golden, CO 80402-0464
303 966-8239 FAX 303 966-5037

Tetsuo Fukasawa
Hitachi. Ltd.
Power. & Industrial Systems
R&D Division
7-2-1 Omika-cho, Hitachi-shi
Ibaraki-ken, 319-12
JAPAN

Ray Gardner
W L Gore & Associates, Inc
101 Lewisville Road
Elkton, MD 21921
tel 410 392-3300
FAX 410 398-6624

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Deep Ghosh
Southern Company Services
PO Box 2625 Bin B241
Birmingham, AL 35202
205 877-7368 FAX205 868-5763

Mr. Humphrey Gilbert Consultant
1837 Poole Lane
McLean, VA 22101

D. A. Gilles
Westinghouse Hanford
PO Box 1970
MSIN S2-14
Richland, WA 99352
509 373-1857 FAX 509 373-4363

David J. Gladden
US Army Dugway Proving Ground
Chemical Test Division
Dugway, UT 94022

Christine Golden
American Electric Power
Cook Nuclear Plant
Bridgman, MI 4906

Curt Graves
Nucon International, Inc
7000 Huntley Road
Columbus, OH 43229

Terry Gray
Flanders Filters Inc
531 Flanders Filters Road
Washington, NC 27889

Robert A. Gregonis
Westinghouse Hanford
PO Box 1970/MSIN 55/52
Richland, WA 99352
509 373-3851

Gunter Groeger
Hoechst Celanese
7716 Bradenton
Charlotte, NC 28210

Tony Gross
Lockeed Martin Energy Systems
Y-12 Plant
PO Box 2009 Bldg 9723-16 MS-8148
Oak Ridge, TN 37830

Börje Gustavsson
ABB Atom
Vasterås
72136
SWEDEN
46 21 347527 FAX 46 21 347225

Roy Haber
3607 Willamette
Eugene, OR 97405
541 485-6418
541 687-6427

Jon Holtorp
Ontario Hydro
700 Universtiy Avenue
Toronto, Ontario M5G 1X6

G. Robert Hall
Raytheon Engineering & Construction
PO Box 134
APO AP 96558
808 621-3044 ex 3503
FAX 808 632-3707

Scott Harris
Union Electric Co Callaway Plant
PO Box 620
Fulton, MO 65251

Timothy W Hayes
Southern Company Services, Inc
42 Inverness Center Parkway
Birmingham, AL 35242

John J Hayes, Jr
MS OWF 10D15
US NRC
Washington, DC 20555

Victor Henzel
IAEC
PO Box 9001
Beer Sheva 84190
ISRAEL
9727568003 FAX 9727467865

Franz Josef Herrmann
WAK, DWK, Süd Chemie
Haydn Strasse
Eggenstein, D76344
GERMANY
49 721 700670 FAX 49 7247 4755

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Walter Hilbish
Perry Nuclear Power Plant
10 Center Road
Perry, OH 44081

J Holtorp
Ontario Hydro
Toronto, Ontario M56 1X6
CANADA

Ming-Teh Huang
Lydall, Inc
Chestnut Hill Road
Rochester, NH 03867
603 332-4600 FAX 603 330-3023

Michael Hughes
MC Air Filtration
Motney Hill Road
Gillingham
Kent ME8 7T2
UK
163 4388 333 FAX 164 3793 84

J. M. A. Humphreys
Vokes, Ltd
Henley Park
Guildford
United Kingdom
01483 569971 FAX 01 483 236419

Craig Hunt
TRIUMF
4004 Westbrook Mall
Vancouver, BC V6T-2A3
CANADA
604 222-1047 ex 6299

Stephen J. Jette
Battelle Pacific NW National Laboratory
PO Box 999
Richland, WA 99352
509 376-8581 FAX 509 372-2896

Robert T. Jubin
Oak Ridge National Lab
PO Box 2008
Oak Ridge, TN 37831-6223
423 574-6874 FAX 423 574-6870

Ray Kahle
Lawrence Livermore National Lab
POB 808, L-360
7000 E Avenue
P.O. Box 5505
Livermore, CA 94550-9900

Wayne Keuhl
Chalk River Laboratories
Atomic Energy of Canada Ltd.
Chalk River, Ontario
CANADA
613 584-3311 ex 3098
FAX 613 584-4108

Atushi Kinase
Hitachi Kyowa Eng. Co., Ltd. JAPAN
10-2 Benten-cho 3 -chome, Hitachi-shi
Ibarahi-ken
JAPAN

Steve Klocke
Flanders Filters Inc
531 Flanders Filters Road
Washington, NC 27889

Vincent H. Kluge
Arizona Public Service Co
PO BOx 52034 Station 7512
Phoenix, AZ 85072-2034
602 393-5866 FAX 602 393-5467

Bela D. Kovach
Nucon International
PO Box 29151
Columbus OH 43229

J Louis Kovach
NUCON International
7000 Huntley Road
Columbus, OH 43229
614 846-5710 or 800 992-5192
FAX 614 431-0858

Eugene Kranz
Northern States Power
1518 Chesnut Avenue North
Minneapolis/ St. Paul, MN 55403
612 347-9440 FAX 612 347-7367

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Dr. Thomas Kress, Chairman
Advisory Committee on Reactor Safeguards
US Nuclear Regulatory Commission
Washington, DC 20555

James E. Lyons
US NRC
MS 0-8 D1
Washington, DC 20555
301 415-2803 FAX301 415-3577

Jim Kriskovich
Westinghouse Hanford Co
PO Box 1970 MS IN S2-24
Richland, WA 99352
509 373-3686 FAX 509 373-2240

Yoshikazu Masaki
Toshiba
Isogo Nuclear Eng. Center, 8, Shinsugita-cho
Isogo-ku, Yokohama 235
JAPAN

Therese Kujawski
Flanders Filters Inc
531 Flanders Filters Road
Washington, NC 27889
919 946-8081 FAX 919 946-3425

Michael P. McCarthy
Schuller International
9 Bounty Court
Salem, NH 03079
603 893-2721 FAX 603 893-1437

Peter Lagus
Largus Applied Technology
11760 Sorrento Valley Road #M
San Diego, CA 92121

Andrew R McFarland
Department of Mech. Eng.
Texas & AM
College Station, TX 77843
409 845-2204
FAX 409 862-2418

Fred D. Leckie
NCS Corporation, Inc
4555 Grove Road
Columbus, OH

Vernon Milliner
AWE plc
Blg C21
Aldermaston
Reading, Berkshire, RG7 4PR
UNITED KINGDOM
01734 82656 FAX 01734 824821

Young J. Lee
ICF Kaiser Engineers
1800 Harrison Street
Oakland, CA 94612
570 419-6771 FAX 570 419-5355

Douglas M. Minnema
Department of Energy
19901 Germantown Road
Germantown, MD 20874
301 903-7098 FAX 301 903-8754

Dr. Richard Lee
Severe Accident Issues Branch
Mail Stop T 10K8
U.S. Nuclear Regulatory Commission
Washington, DC 20555

Len Leonard
Leonard Designs, Inc
4141 Dover Circle
Cypress, CA 90630-2721
714 527-8884 FAXsame

David L Monroe
Lockheed Martin Energy Systems
PO Box 2009 Bldg 1401
423 576-2038 FAX 423 576-2500

Ernest Lillyman
Probabilistic Risk Assessment
10 Harland Road
Castletown
Caithness KW14 8UB
SCOTLAND
code 01847 821512 FAX 01847 821502

Glen Moore
Flanders Filters Inc
531 Flanders Filters Road
Washington, NC 27889
919 946-8081 FAX919 946-3425

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Norihisa Mori
Mitsubishi Heavy Industries, Ltd
1-1, Wadasaki-cho
1-Chome, Hyogo-ku
Kobe, 652
JAPAN
078 672 2172 FAX 078-672-3245

Hiroshi Morita
Toshiba Engineering Co
Isogo Nuclear Eng. Center, 8, Shinsugita-cho
Isogo-ku, Yokohama 235
JAPAN

Sudesh Mukhi
Con Edison Co of NY
4 Irving Place Room 1049-S
New York, NY 10003
212 460-3822 FAX 212 777-4484

Annick Muller
CEA Marcoule
BP 177
Bagnols sur Ceze 30207
FRANCE

Gary Norman
Lockheed Martin Energy Research
PO Box 2008 ORNL
Oak Ridge, TN 37831-6054
434 574-7247 FAX 434 576-4923

Josef Orzechowski
Nordion International
4004 Wesbrook
Vancouver, BC V6T 2A3
CANADA

Joseph D. Paul
Westinghouse Savannah River Company
Savannah River Site
PO Box 6809
Aiken, SC 29804

John R. Pearson
NCS Corporation
4555 Groves Road 41
Columbus, OH 43222
614 864-7613
FAX 614 864-2296

Brad Pence
Omaha Public Power
Fort Calhoun Station
Box 399
Fort Calhoun, NE 68023
402 533-6910 FAX 402 533-6818

Mark E Pest
Palo Verde Nuclear Generating Station
PO Box 52034 MS 7259
Phoenix, AZ 85072-2034

Hardy M Philippi
Atomic Energy of Canada Ltd
Atomic Energy of Canada Ltd.
Chalk River, Ontario
CANADA
613 584-3311 ex 050533098
FAX 613 584-8042

Mary Pierce
Hollingsworth & Vose
219 Townsen Road
West Groton, MA 01472

Kim Poole
Lockheed Martin
16 S 600 W
Blackfoot, ID 83221

Richard Porco
Ellis & Watts
4400 Glen Willow Lake Lane
Batavia, OH 45103

Doug Porrey
Ionex Research Corp
PO Box 602
Broomfield, CO 80020

Greg Pyle
Kapl, Inc.
PO Box 1076, G1-101
Schenectady, NY 12301-1072
518 395-4070 FAX 518 395-6949

Nick Radloff
ComEd, Braidwood Nuclear Power Station
RR #1, Box 84
Braceville, IL 60407
815 458-2801 FAX 815 458-3803

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Riazuddin Rahmi
RT 281
PO Box 2030
Cortland, NY 13045

Robert J. Reynolds
HEPA Technologies
19 Tracy Lane
Oak Ridge, TN 37830
423 482-9795

Paul D. Rice
ICF Kaiser Hanford
PO Box 888
MSIN G3-12
Richland, WA 99352
509 376-2970 FAX 509 373-4115

Craig I Ricketts
New Mexico State University
PO Box 30001 Dept 3450
Las Cruces, NM 88003-8001

Phil Roberson
Duke Power Company
13225 Hagers Ferry Road
McGuire Nuclear Station
Huntersville, NC 28078
704 875-4000 FAX 704 875-4809

Hector Rodriguez
DOE Richland
PO Box 212
Richland, WA 99352

William A Rown
US Army SCBRD-ENP-A
Aberdeen Proving Ground, MD
21010-5423

Ron Shlomo
IAEC
POB 2061
Tel Aviv, 67020
ISRAEL

Tsutomu Sakurai
Japan Atomic Energy Research Institute
Tokai-mura, Naka-gun
Ibaraki-ken
319-11 JAPAN
029-282-5500 FAX 029-282-6097

Clayton Schroeder
ComEd, Braidwood Nuclear Power Station
RR #1, Box 84
Braceville, IL 60407
815 458-2801 FAX 815 458-3803

Terry Schubert
Lockheed Martin Energy Research
PO Box 2008 ORNL
Oak Ridge, TN 37831-6054
434 574-7248 FAX 434 576-4923

Ronald C Scripsick
Los Alamos National Lab
ESH-5
MS K553
Los Alamos, NM 87545
505 667-7382 FAX 505 665-3689

Balbir C. Seam
Bechtel Power Corp
9801 Washingtonian Blvd.
Gaithersburg, MD 20878-5356
301 869-8084

Kazunori Sekita
Shinwa Corporation
3-16-6 Nishi-Shinjuku
Shinjuku-ku
Tokyo 160 JAPAN

James J. Shake
Westinghouse Savannah River Co
PO Box A
Savannah River Site
Aiken, SC 29808
803 557-9476 FAX 803 557-9080

James Slawski
US DOE
19901 Germantown, MD 20876-1290

Ronald A. Smith
US Army, Dugway Proving Ground
5132 Valdez Circle #210
Dugway, UT 84022
801 831-5631 FAX 801 831-5902

Art Soma
Barnebey & Sutcliffe Corp
PO Box 2526
Columbus, OH 43213

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

Dan Stermer
Pacific Gas & Electric
MC 104/6/31 - PO Box 56
Avila Beach, CA 93424
805 545-4172 FAX 805 545-3412

Lars Ström
Instumentinvest
Trvffelstigen 12
S-61163 Nykoping
SWEDEN

Marcel Szyszkowski
WA State Department of Ecology
PO Box 47600
Olympia, WA 98504-7600
360 407-7147 FAX 360 407-7151

Benjamin Taylor
Entergy Ops Inc
Arkansas Nuclear One
1448 SR 333
Russellville, AR 72801

Warren K. Thomas, P.E.
Lockheed Martin Energy Systems
PO Box 2008
Oak Ridge, TN 337831-6341

Brian Tinklin
MC Air Filtration
Motney Hill Road
Gillingham
Kent ME8 7T2
UNITED KINGDOM
163 4388 333 FAX 164 3793 84

Lorrie Todd
Farr Company
301 Autumn Gate Drive
Raleigh, NC 27606

C. W. Jeff Tseng
Mason & Hanger
Pantex Plant
PO Box 30020
Amarillo, TX 79177

Mr. J. Vendel
Inst de Pro. Sûret Nucléa / Prév d"Etude Accidents
DPEA/SERAC - CEA/Saclay
Bâtiment 393-91191 GIF-SUR-YVETTE Cedex
FRANCE

Mr. John D. Wagoner
Manager, Richland Operations Office
DOE Richland Operations
PO Box 55
Richland, WA 99362

Lawrence D Weber
Pall Corporation
25 Harbor Park Drive
Port Washington, NY 11050

Raymond R. Weidler
McGuire Nuclear Station
Duke Power Co
13225 Hagers Ferry Road
Huntersville, NC 28078

Terry Wickland
Nuclear Filter Technology
741 Corporate Circle
Golden, CO 80401

Dale K. Wickman
Southern California Edison
PO Box 128
San Clemente, CA 92674-0128

Juergen G. Wilhelm
KfK, LAF II
Postfach 3640
D-7500 Karlsruhe 1
GERMANY

Chris Winstead
Flanders Filters Inc
531 Flanders Filters Road
Washington, NC 27889

Steve W. Wright
Micro Composite Materials Corp
4608-D Industry Lane
Durham, NC 27713-5414

Raymond O Yaukey
US Army Letterkenny Army Depot
217 Hickory Drive
Fayetteville, PA 17222

Roger Zavadoski
DNFSB US Government
Indiana Avenue, NW, Suite 700
Washington, DC 20004

PART I

INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0002	Welcome and Objectives of the Conference	First, M. W.
21-0005	Department of Energy Directions in Environment, Safety, and Health	Ziemer, P. L.
21-0016	Air Cleaning Requirements for Evolutionary and Advanced Reactors	Congel, F. J. Willis, C. A.
21-0028	Air Cleaning Technologies for the Management and Disposal of Radioactive Wastes	Moeller, D. W.
21-0042	Canadian Waste Management Program	Torgerson, D. F.
21-0057	Radiological Health Effects Models for Nuclear Power Plant Accident Consequence Analysis -- An Update (1990)	Evans, J. S. Sprung, J. L.
21-0080	New Injection System for a Short Mixing of Test Aerosols and Gas Tracers Inside Ventilation Ducts	Cassette, Ph. DuPoux, N. Laborde, J. C.
21-0095	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency Measurements of HEPA Filters	Mulcey, Ph. Pybot, P. Vendel, J.
21-0109	Aerosol Concentrations Produced by a Laskin Nozzle Generator a Comparison of Substitute Materials and DOP	Crosby, D. W.
21-0116	Characteristics of Laskin Nozzle Generated Aerosols	Yan, X. First, M. W. Rudnick, S. N.
21-0126	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol Penetrometer Machines	Carlton, H. R. Guelta, M. A.
21-0128	Effects of the Particle Penetration Inside the Filter Medium on the HEPA Filter Pressure Drop	Letourneau, P. Renaudin, V. Vendel, J.
21-0139	Development of Filter Systems - Part 2, Injection Systems and Multi-Point Sampler Evaluation	Loughborough, D. Morris, D. Capon, S.
21-0155	The Dust Holding Capacity of HEPA Filters	Loughborough, D.
21-0173	Simulated Performances of a Single Particle Laser Light Scattering Analyzer	Neri, E. Massacurati, V. Platini, M.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0186	Introductory Statement	Miller, Jr., W. H.
21-0189	Overview of Divisions I and II	Vogan, T. J.
21-0193	Field Testing of Nuclear Air Treatment and Gas Processing Systems	Banton, S. G.
21-0198	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	Hobart, S. A. Cannito, F. J. Nesbitt, L. B. Werkheiser, D. P. Pleva, J. M.
21-0212	European Community Nuclear Codes and Standards	Green, M. R.
21-0222	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	Herrmann, F. J. Motoi, V. Herrmann, B. van Schoor, A. Fang, D. Fies, H.
21-0234	Iodine-129 Distribution and Retention During Evaporation of MWL Solutions	Amend, J. Motoi, V. Herrmann, F. J. Furrer, J.
21-0247	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	Furrer, J. Deuber, H. Linck, A. Kaempffer, R. Jannakos, K.
21-0259	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed Column	Vignan, B. Goumondy, J. P. Roustan, M.
21-0271	Iodine and NO _x Behavior in the Dissolver Off-Gas and Iodex Systems in the Oak Ridge National Laboratory Integrated Equipment Test Facility	Birdwell, J. F.
21-0299	Development of a Process for Adsorptive Separation of KR-85 from the Off-Gas of Nuclear Facilities	Ringel, H. D. Brodda, B. G. Burbach, T. Printz, R. J.
21-0318	The Difficulty of Testing Non-509 Systems to the N510 Standard	Edwards, J. R.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0320	A Review of the History, Revisions and Interrelationships of ANSI/ASME N509 and N510, 1989 Editions	Jacox, J. W.
21-0327	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510 Requirements	Porco, R. D.
21-0329	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire Nuclear Station	Roberson, P. W.
21-0332	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at McGuire Nuclear Station	Olson, P.
21-0343	Changing Winds in NRC's Regulatory Environment	Remick, F. J.
21-0352	Quality Assurance Requirements for NESHAPS Compliance	Bresson, J. F.
21-0360	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum Filter Housings with Close Couple Redundant Series Filters	Dunbar, Jr., A. E. Edwards, J. R. Heffley, K. W.
21-0366	Investigation of Salt Loaded HEPA Filters	Smith, P. R. Leslie, L. H. Hensel, E. C. Schultheis, T. M. Walls, J. R. Gregory, W. S.
21-0376	Photochemical Removal of Radioactive Iodine from Air	Vikis, A. C. Evans, G. J. MacFarlane, R.
21-0385	Review of Department of Energy Filter Test Facility and Filter Test Facility Technical Support Group Activities FY 1986 - FY 1989	McIntyre, J. A.
21-0394	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic Diamines as an Impregnant of an Activated Carbon of the Nuclear Grade	Kim, Y. S.
21-0410	Type II HEPA Filter	Kovach, J. L.
21-0415	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling System (U)	Epperson, S. A.
21-0419	Adaptation of Nuclear Filtration Technology to the Demilitarization of Chemical Weapons	Hall, G. R.
21-0424	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	Weber, L. D.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0435	Field Measurement of the Performance of Air Cleaning Systems to Simulated Worst Case Chemical Accidents Using the Lawrence Livermore National Laboratory S-3 Facility at the Nevada Test Site	Johnson, J. S.
21-0442	LFCM Processing Characteristics of Mercury	Goles, R. W. Sevigny, G. J. Andersen, C. M.
21-0467	Behavior and Control of Ruthenium During Operation of the New Waste Calcining Facility at the Idaho Chemical Processing Plant	Christian, J. D.
21-0488	The Incineration of Low Level Radioactive Wastes - Current Status	Moeller, D. W. Long, S. W.
21-0510	Steps Towards the Minimization of Particulate Emissions From a Low-Level Waste Incineration Facility	Leibold, H. Mai, R. Wilhelm, J. G.
21-0526	Design Basis Documentation for the Control Room Ventilation/Chilled Water System at McGuire Nuclear Station	Hilley, Jr., J. R. Weidler, R. R.
21-0530	Demonstration of Carbon-14 Removal at Candu Nuclear Generating Stations	Chang, S. D. Cheh, C. H. Leinonen, P. J.
21-0545	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	Qi-dong, Li Changzhuo, Ye Shunqing, Yuam Yafang, Pang Junyue, Ling Xiaochun, Gu Miaoxianz, Yang Huijian, Zhu Zexiang, Liu
21-0563	A Study of the Effect of Coatings Operation on Radioiodine Removing Adsorbents	Freeman, W. P. Enneking, J. C.
21-0583	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated Carbon	Hyder, M. L. Malstorm, R. A.
21-0594	Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents	Kobayashi, Y. Kondo, Y. Hirose, Y. Fukasawa, T.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0607	Changes in Adsorber Testing as a Result of NRC Generic Information	Hayes, Jr., J. J.
21-0626	US NRC Regulatory Guidance for Engineered Safety Feature Air Cleaning Systems	Bellamy, R. R.
21-0635	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste Management	Plumb, G. R.
21-0646	CAIRE - A Real-Time Feedback System for Emergency Response	Braun, H. Brenk, H. D. de Witt, H.
21-0662	Kinetic Modelling of the Purging of Activated Carbon After Short Term Methyl Iodide Loading	Friedrich, V. Lux, I.
21-0671	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused by High Air Humidity	Ricketts, C. I. Schneider, M. Wilhelm, J. G.
21-0695	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	Hirao, K. Yoshino, H. Sonoda, T.
21-0714	Alternatives to Current Procedures Used to Estimate Concentrations in Building Wakes	Ramsdell, Jr., J. V.
21-0733	High Efficiency Steel Filters for Nuclear Air Cleaning	Bergman, W. Conner, J. Larsen, G. Lopez, R. Turner, C. Vahla, G. Violet, C. Williams, K.
21-0762	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box Cleaning and Increasing HEPA Filter Life	Watson, J. H. P. Boorman, C. H.
21-0772	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried by the Offgas Flow	Jannakos, K. Potgeter, G. Legner, W.
21-0782	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	Novick, V. J. Higgins, P. J. Dierkschiede, B. Abrahamson, C. Richardson, W. B.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0799	Aerosol Penetration Inside HEPA Filtration Media	Letourneau, P. Mulcey, Ph. Vendel, J.
21-0815	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	Laborde, J. C. Lopez, M. C. Pourprix, M. Savornin, J. Teissier, J.
21-0831	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of HLLW Storage Tanks	Philippe, M. Mercier, J. P. Gue, J. P.
21-0844	Pool Fires in a Large Scale Ventilation System	Smith, P. R. Leslie, L. H. Gregory, W. S. White, B.
21-0859	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	McFarland, A. R. Rodgers, J. C. Ortiz, C. A. Nelson, D. C.
21-0872	Measurement System for Alpha and Beta Aerosols with Wide Dynamic Range and Krypton-85 Masking	Wichmann, H. P. Tiggemann, H. Kreiner, H. J.
21-0876	Containment Venting Sliding Pressure Venting Process for PWR and BWR Plants - Process Design and Test Results	Eckardt, B.
21-0898	Investigations into the Design of a Filter System for PWR Containment Venting	Dillmann, H. G. Wilhelm, J. G.
21-0918	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	Hakii, J. Kaneko, I. Fukasawa, M. Yamashita, M. Matsumoto, M.
21-0933	Impact of the Filtered Venting System Design Upon the Total Radioactive Release in Case of a Severe Accident and a Comparison of European Requirements	Cederqvist, H. Elisson, K. Lowenhielm, G. Appelgren, E.
21-0946	Design and Full Scale Test of a Sand Bed Filter	Kaercher, M.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
21-0968	The Dutch Nuclear Programs	Scholten, L. C.
21-0969	Nuclear Air Cleaning Program in USA	Hyder, M. L.
21-0971	Nuclear Air Cleaning R&D Programs in Canada	Cheh, C. H.
21-0975	United Kingdom Atomic Energy Authority Programs	Holman, D.
21-0977	Developments in the Area of Regulatory Matters in the UK	Handyside, I.
21-0978	Nuclear Air Cleaning Programs in Progress in France	Mulcey, P.
21-0980	A Short Overview of the Programs in Sweden	Cederqvist, H.
21-0981	Nuclear Air Cleaning Activities in Germany	Wilhelm, J. G.
21-0984	Air Cleaning Programs Relating to the First Japanese Commercial Reprocessing Plant	Hirose, Y.
21-0986	Nuclear Air Cleaning Programs in Hungary	Friedrich, V.
22-0003	Welcome and Objectives of the Conference	First, M. W.
22-0004	Global Change and the Practice for Airborne Waste Treatment	Goossens, W. R. A. Van Rensbergen, J. B. H. F.
22-0018	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders in the 1990's	Bayne, P.
22-0034	Severe Accident Issues for Advanced Reactors	Congel, F. J. Willis, C. A. Lee, J. Y.
22-0043	GE's Advanced Nuclear Reactor Designs	Berglund, R. C.
22-0053	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine Trapping and Off-Gas Characterization Unit	Pouyat, D. Vignau, B. Roux, J. P.
22-0065	Tritium Emissions Reduction Facility (TERF)	Lamberger, P. H. Hedley, W. H.
22-0075	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	Herrmann, F. J. Motoi, V. Herrmann, B. Fang, D. Finsterwalder, L. Kuhn, K. D. van Schoor, A. Beyer, Ch. Furrer, J. Knoch, W.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0091	Iodine Stripping from Nitric Solutions in IATEMA	Furrer, J. Kaempffer, R. Linek, A. Jannakos, K.
22-0102	The Development of Corona Discharge for Iodine Removal from Nuclear Fuel Reprocessing Plant Off-Gases	Holt, N. S. Goldsmith, A. L. Denniss, I. S.
22-0118	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	Kondo, Y. Sugimoto, Y. Hirose, Y. Fukasawa, T. Furrer, J. Herrmann, F. J. Knoch, H. W.
22-0146	An Update: DOP Replacement in Testing Machines for Filters and Respirators	Carlton, H. R. Guelta, M. A.
22-0154	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and Photometric Detection with Computer Control	Parker, R. C. Marshall, M. Bosley, R. B.
22-0163	Development of the Quickmix Injector for In-Situ Filter Testing	Costigan, G. Loughborough, D.
22-0177	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY 1992	McIntyre, J. A.
22-0191	Chronic Inhalation Studies of Man-Made Vitreous Fibers	Hesterberg, T. Miller, W. C. Anderson, R.
22-0205	Effects of Filter Housing and Ductwork Configuration on Air Flow Uniformity Inside Air Cleaning Filter Housings	Paul, J. D.
22-0215	A Review of Gas Phase Filtration Standards and their Applicability to Nuclear Applications	Jacox, J.
22-0223	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	Kim, Y. K. Porco, R. D. York, J. D.
22-0233	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	Blacklaw, J. R. Fox-Williams, K. Peterson, D. Conklin, A.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0244	Experimental Study on the Volatile Ruthenium Decontamination Factor of the Perforated Plate Column Scrubber	Kitamura, M. Shirato, K. Arai, K.
22-0253	Measurement of Cesium Emissions During the Vitrification of Simulated High Level Radioactive Waste	Zamecnik, J. R. Miller, D. H. Carter, J. T.
22-0262	Structural Testing of Salt Loaded HEPA Filters for WIPP	Smith, P. R. Leslie, I. H. Hensel, E. C. Schulthesis, T. M. Walls, J. R.
22-0283	Direct Post-Accident Sampling System for Containment Atmospheres (DI-PAS System)	Eckardt, B.
22-0299	Performance Characterization of a New CAM System	Koskelo, M. Rodgers, J. C. Nelson, D. C. McFarland, A. R. Ortiz, C. A.
22-0310	Aerosol Particle Losses in Sampling Systems	Fan, B. J. Wong, F. S. Ortiz, C. A. Anand, N. K. McFarland, A. R.
22-0324	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by the European Community Countries	Dorman, R. G.
22-0327	The Effects of Temperature on HEPA Filter Media	Hamblin, C. Goodchild, P. J.
22-0341	Changes to Licensing for U.S. Nuclear Power Plants	de Planque, E. G.
22-0362	Revision of Reactor Accident Source Terms and Implications for Nuclear Air Cleaning Requirements	Soffer, L.
22-0374	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method Airflow Simulation	Farajian, T. Grewal, G. Tsal, R. J.
22-0393	The Experience with the Effectiveness of Filtering Systems for the Radioactive Fall-Out from the Chernobyl Accident in Germany	Braun, H.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0402	Aerosol Penetration Through a Seismically Loaded Shear Wall	Farrar, C. R. Girrens, S. P.
22-0415	Beta Experiments on Aerosol Release During Melt-Concrete Interaction and Filtering of the Off-Gas	Dillmann, H. G. Pasler, H. Alsmeyer, H.
22-0428	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	Castellani, F. Curzio, G. d'Errico, F. Lanza, S. Mori, A. Rossi, G. Sgalambro, G.
22-0443	Design of a Prefilter to Improve Radiation Protection and Filtering Efficiency of the Containment Venting System	Kaercher, M.
22-0453	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	Kaneko, I. Fukasawa, M. Naito, M. Miyata, K. Matsumoto, M.
22-0464	The Phebus FP Integral Source Term Experimental Project with Emphasis on Iodine Selective Filtering	Zeyen, R. Wilhelm, J. G. Lucas, M.
22-0485	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	Miller, Jr., W. H.
22-0488	Ductwork Section (SA) Improvements	Ashton, C.
22-0490	Instrument & Controls Section (IA) Improvements	Kramer, C. Paul, J.
22-0491	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	Porco, R.
22-0493	Codes in Use	Paschal, W. B.
22-0510	Challenges Within Ventilation Systems During Accident Situations	Fronhofer, M. Neuberger, M. Wilhelm, J. G.
22-0527	Radial Flow Systems for the Nuclear Industry	Davis, M. L.
22-0534	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets Carried by the Off-Gas Flow	Jannakos, K. Mock, H. Potgeter, G. Furrer, J.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0540	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	Leibold, H. Doffert, I. Leiber, T. Fronhofer, M. Wilhelm, J. G.
22-0554	Predicting Mass Loading as a Function of Pressure Difference Across Prefilter/HEPA Filter Systems	Novick, V. J. Klassen, J. F. Monson, P. R. Long, T. A.
22-0574	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of Non-Reactor Nuclear Facilities	Grewal, G. Milatovic, Z. Landon, F. L. Harty, W. M.
22-0586	Development and Evaluation of a Cleanable High Efficiency Steel Filter	Bergman, W. Larsen, G. Weber, F. Wilson, P. Lopez, R. Valha, G. Conner, J. Garr, J. Williams, K. Biermann, A. Wilson, K. Moore, P. Gellner, C. Rapchun, D. Simon, K. Turley, J. Frye, L. Monroe, D.
22-0617	Development and Evaluation of a HEPA Filter for Increased Strength and Resistance to Elevated Temperature	Gilbert, H. Bergman, W. Fretthold, J. K.
22-0637	A Simplified Test Procedure for Determining the Effectiveness of Adsorbents for the Removal of Methyl Iodide	Underhill, D. W.
22-0646	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl Iodide Removal	Kovach, J. L.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0661	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems Using the "New" Standards	Freeman, W. P.
22-0672	Experience with Ontario Hydro's In Place Carbon Filter Testing	Holtorp, J. Guest, A. Parker, K. Jarv, T. Brain, C.
22-0698	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbents in NATS	Pearson, J. R. Fleming, K. M. Hunt, J. R. Lagus, P. L.
22-0716	DOE Waste Management Program-Current and Future	Coleman, J. A.
22-0731a	Introductory Remarks	Soffer, L.
22-0732	A Utility Perspective on New Source Terms	Vanpelt, H. E.
22-0734	Notes on the Draft NUREG Report Accident Source Terms for Light-Water Nuclear Power Plants	Kovach, J. L.
22-0736	Proposed Source Term Revisions Potential Impact on Future Nuclear Air Cleaning Requirements, Applications to DOE Production Reactor Operation	Hyder, M. L.
22-0742	Revised Accident Source Terms and Control Room Habitability	Lahti, G. P. Hubner, R. S. Johnson, W. J. Schwartz, B. C.
22-0753	Effect of Filtering at Containment Venting on the Consequences for the Environment	Scholten, L. C. van Wonderen, E. L. M. J. van der Steen, J.
22-0762	Response of NRC Region III to Perceived Lack of Filter Testing Expertise Concerns	Gill, C. F.
22-0768	Methyl Iodide Tests on Used Adsorbents	Kovach, J. L.
22-0781	Development of Computer Design System for HVAC System	Miyazaki, Y. Yotsuya, M. Hasegawa, M.
22-0791	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	Suzuki, F. Ikeda, M. Hasegawa, M. Fujimori, K. Omoto, K. Shiomi, T.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
22-0808	Modern Technology Tools for Improvement of NPP Reliability-Case Study of NPP Filtration Systems Validation	Vujisic, L. Drace, Z.
22-0820	Heater Selection Criteria for Engineered Safety Features Atmosphere Filtration Systems	Hayes, T. W. Wehrenberg, J. A.
22-0830	Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station	Lagus, P. L. DuBois, L. J. Fleming, K. M. Brown, J. H.
22-0849	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	Moore, P. Bergman, W. Gilbert, H.
22-0863	Concept for a Passive Heat Removal and Filtration System Under Core Meltdown Conditions	Wilhelm, J. G. Neitzel, H. -J.
22-0875	Development of a Personal Computer Code for Fire Protection Analysis of DOE Facility Air Cleaning Systems	Gregory, W. S. Claybrook, S. Hensel, E.
22-0882	Efficiency Test for Ultra High Efficiency Metal Air Filters	Weber, L. D. Whitlock, M. B.
22-0899	A View of Licensee Event Reports - Relating to Nuclear Air Treatment Systems and Heating, Ventilating, Air Conditioning Systems, Filed During the Period 1988-1991	Sommer, R. Otermat, J. E.
23-0003	A Brief History of the Air Cleaning Conferences	First, M. W.
23-0016	The Integrated Melter Off-Gas Treatment Systems at the West Valley Demonstration Project	Vance, R. F.
23-0034	Challenges of Equipment Qualification Using Today's Standards with Emphasis on a Class IE Motor Program	Deaton, K.
23-0054	Evaluation of Self-Contained HEPA Filter	Arndt, T. E.
23-0068	ASME N510 Test Results for Savannah River Site AACS Filter Compartments	Paul, J. D. Punch, T. M.
23-0078	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	Freeman, W. P.
23-0087	HEPA Filter Testing - Department of Energy Office of Nuclear Energy Facilities	Sherwood, G. L.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
23-0093	An Example of a Component Replacement when Applying ASME N509 and ASME N510 to Older Ventilation Systems	Arndt, T. E.
23-0096	A Single Standard for In-Place Testing of DOE HEPA Filters	Mokler, B. V.
23-0098	Integrating Industry Nuclear Codes and Standards into United States Department of Energy Facilities	Jacox, J.
23-0115	Generation and Release of Radioactive Gases in LLW Disposal Facilities	Yim, M. S. Simonson, S. A.
23-0128	Numerical Analysis of a Natural Convection Cooling System for Radioactive Canisters Storage	Tsal, R. J. Anwar, S. Mercado, M. G.
23-0138	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear Power Plants	Minns, J. L.
23-0150	HEPA Filter Concerns - An Overview	Leonard, J. F.
23-0158	A Novel Permanently Magnetized High Gradient Magnetic Filter Using Assisted Capture for Fine Particles	Watson, J. H. P.
23-0176	The Development of a HEPA Filter with Improved Dust Holding Characteristics	Dyment, J. Hamblin, C.
23-0187	Effect of Humidity on the Filter Pressure Drop	Vendel, J. Letourneau, P.
23-0195	Preliminary Field Evaluation of High Efficiency Steel Filters	Bergman, W. Larsen, G. Lopez, R. Wilson, K. Simon, K. Frye, L.
23-0217	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	Rodgers, J. C. Fairchild, C. I. Wood, G. O. Ortiz, C. A. Muyshondt, A. McFarland, A. R.
23-0233	Radionuclide Air Emissions at Department of Energy Facilities	Duvall, K.
23-0241	EPA Perspective on Radionuclide Aerosol Sampling	Karhnak, J. M.
23-0250	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	Glissmeyer, J. A.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
23-0259	A Real-Time Stack Radioactivity Monitoring System and Dose Projection Program	Hull, A. P. Michael, P. A. Bernstein, H. J.
23-0269	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2: Dose Assessment Methodology Using Portable Low-Resolution Gamma Spectroscopy	Barnett, J. M.
23-0279	The Retention of Iodine in Stainless Steel Sample Lines	Evans, G. J. Deir, C. Ball, J. M.
23-0294	Gas Processing in the Nuclear Industry	Kovach, J. L.
23-0297	Application of Nuclear Air Cleaning and Treatment Codes	Krskovich, J. R.
23-0301	Gas Processing at DOE Nuclear Facilities	Jacox, J.
23-0308	Residence Time Determination for Adsorbent Beds of Different Configurations	Otermat, J. E. Wikoff, W. O. Kovach, J. L.
23-0313	Halide Test Agent Replacement Study	Banks, E. M. Freeman, W. P. Kovach, B. J. Kovach, J. L. Sommer, R. R.
23-0321	A Study on the Explosion of Iodine from Spent-Fuel Solutions	Sakurai, T. Takahashi, A. Ishikawa, N. Komaki, Y. Ohnuki, M. Kato, K.
23-0333	The Development and Design of the Off-Gas Treatment System for the Thermal Oxide Reprocessing Plant (THORP) at Sellafield	Hudson, P. I. Buckley, C. P. Miller, W. W.
23-0352	Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams	Funabashi, K. Fukasawa, T. Kikuchi, M. Kawamura, F.
23-0365	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	Hutter, E. Besserer, U. Jacqmin, G.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
23-0380	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	Daling, P. M. Marler, J. E. Vo, T. V. Phan, H. K. Friley, J. R. Leung, V. T.
23-0391	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	Lagus, P. L. Brown, J. H. DuBois, L. J. Fleming, K. M.
23-0404	Constant Depression Fan System: A Novel Glovebox Ventilation System	Milliner, W. V.
23-0412	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	Laborde, J. C. Prevost, C. Vendel, J. Perrin, G. Peirano, J. L. Raboin, S.
23-0425	Performance of HEPA Filters at LLNL Following the 1980 and 1989 Earthquakes	Bergman, W. Elliott, J. Wilson, K.
23-0432	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	Goossens, W. R. A.
23-0439	An Introduction to the Design, Commissioning, and Operation of Nuclear Air Cleaning Systems for Qinshan Nuclear Power Plant	Chen, X. Qu, J. Shi, M. Yang, L.
23-0454	AP600 Containment Purge Radiological Analysis	O'Connor, M. Schulz, J. Tan, C. Kasjaka, M. Alper, N.
23-0478	A Low Pressure Filter System for New Containment Concepts	Dillman, H. G. Pasler, H.
23-0488	Revised Accident Source Terms for Light-Water Reactors	Soffer, L.
23-0498	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1: Dose Assessment	Davis, W. E. Barnett, J. M.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
23-0509	The Link Between Off-Site-Emergency Planning and Plant-Internal Accident Management	Braun, H. Gortz, R.
23-0520	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear Power Plant Containments Following a Severe Accident	Sher, R. Li, J.
23-0539	Experimental Study on the Particles Deposition in the Sampling Duct	Vendel, J. Charuau, J.
23-0553	Filter-Adsorber Aging Assessment	Winegardner, W. K.
23-0563	Criteria for Calculating the Efficiency of HEPA Filters During and After Design Basis Accidents	Bergman, W. First, M. W. Anderson, W. L. Gilbert, H.
23-0601	Performance of HEPA Filters Under Hot Dynamic Conditions	Frankum, D. P. Costigan, G.
23-0613	Preliminary Studies to Determine the Shelf Life of HEPA Filters	Gilbert, H. Fretthold, J. K. Rainer, F. Bergman, W. Beason, D.
23-0639	Effects on the Efficiency of Activated Carbon on Exposure to Welding Fumes	Ghosh, D.
23-0658	Clean Air and Clear Responsibility	Rogers, K. C.
23-0670	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with the DOE's New 10 CFR 835 and the NRC's 10 CFR 20 Regulation	Bailey, W. H.
23-0682	Experimental Study of Elementary Collection Efficiency of Aerosols by Spray: Design of the Experimental Device	Ducret, D. Vendel, J. LeGarrec, S.
23-0695	Degradation of HEPA Filters Exposed to DMSO	Bergman, W. Wilson, K. Larsen, G. Lopez, R. LeMay, J.
23-0721	Proposed Retrofit of HEPA Plenums with Injection and Sampling Manifolds for In-Place Filter Testing	Fretthold, J. K.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
23-0743	New Performance Data for "Emery 3002" and "Emery 3004," Two Army-Approved Safe Materials to Replace DOP in Mask and Filter Testing	Carlton, H. R. Guelta, M. A.
23-0758	Comparison of Emery 3004 and 3006 Characteristics with DOP for Possible Use in HEPA Filter Leak Tests	Kovach, B. J. Banks, E. M. Kovacs, G.
23-0766	Review of In-Place HEPA Filter Testing at Several DOE Facilities	Mokler, B. V. Scripsick, R. C.
23-0784	Ventilation System Design for Control of Radioactive Airborne Particulates During the Decontamination and Dismantlement (D&D) of the Plant One Ore Silos	Williams, J. E.
24-0002	Opening Comments of Chairman and Greetings from Sponsors	First, M. W.
24-0005	Keynote Address: Nuclear Aerosols: Unfinished Business	Kress, Thomas
24-0012	Air Cleaning Issues with Contaminated Sites	Bellamy, R. R.
24-0033	New Challenges to Air/Gas Cleaning Systems	Kovach, J. L.
24-0040	Application of Innovative Policies for Controlling Radionuclide Releases: The "Open-Market Trading Rule"	Moeller, D. W.
24-0051	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	Rice, P. D.
24-0065	Development of a Computer Code to Predict a Ventilation Requirement for an Underground Radioactive Waste Storage Tank	Lee, Y. J. Dalpiaz, E. L.
24-0076	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator Air Pollution Control Systems	Burns, D. B. Wong, A. Walker, B. W. Paul, J. D.
24-0089	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	Bergman, W. Wilson, K. Stagges, K. Beason, D. Doughty, S. Arganbright, R. Wapman, D. Nelson, G.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
24-0118	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	Blacklaw, J. Robertson, G. Stoffel, D. Ahmad, J. Fordham, E. Pachernegg, S. Wainhouse, L. Riley, J.
24-0132	Practical Experience Applied to the Design of Injection and Sample Manifolds to Perform In-Place Surveillance Tests According to ANSI/ASME N-510	Banks, E. M. Wikoff, W. O. Shaffer, L. L.
24-0147	Unit Vent Airflow Measurements Using a Tracer Gas Technique	Adams, D. G. Lagus, P. L. Fleming, K. M.
24-0163	Development of Real Time Detector for Fluorescent Particles	Prevost, C. Vendel, J. Seigneur, A.
24-0176	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by Halide Pulse Integration Method	Kovach, B. J. Banks, E. M.
24-0181	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	Strom, L. H.
24-0188	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP Continuous Air Monitors	Bartlett, W. T. Walker, B. A.
24-0203	Section TA Acceptance Testing, Draft Revision 03/06/96	Banton, S. Pest, M. E. Burwinkel, P. Graves, C. Kluge, V. Leonard, L.
24-0264	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	Banton, S. Pest, M. E. Burwinkel, P. Graves, C. Kluge, V. Leonard, L.
24-0335	Progress and Challenges in Cleaning Up Hanford	Wagoner, J. D.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
24-0380	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	Weidler, R. Wilhelm, J. G. Bellamy, R. R. Dyment, J. Fukasawa, T. Lee, R. Porco, R. Slawski, J.
24-0386	Standardized Methods for In-Place Filter Testing	Dykes, M. Fretthold, J. K. Slawski, J.
24-0395	Charcoal Filter Testing	Lyons, J.
24-0400	Control Room Envelope Unfiltered Air Inleakage Test Protocols	Lagus, P. L. Grot, R. A.
24-0428	Variable Pattern Contamination Control Under Positive Pressure	Philippi, H. M.
24-0441	Aerosol Deposition In Bends with Turbulent Flow	McFarland, A. R. Gong, H. Wente, W. B. Anand, N. K. Muyschondt, A.
24-0460	Atmospheric Discharges from Nuclear Facilities during Decommissioning: German Experiences and Concepts	Braun, H. Gortz, R. Weil, L.
24-0471	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis of Purex Plant	Chen, W. W. Gregonis, R. A.
24-0485	Filtration Theory Using Computer Simulations	Bergman, W. Corey, I.
24-0500	Study on Collecting Efficiency of Fission Products by Spray: Experimental Device and Modelling	Ducret, D. Roblot, D. Vendel, J. Billarand, Y.
24-0520	Characterization and Restoration of Performance of "Aged" Radioiodine Removing Activated Carbons	Freeman, W. P.
24-0525	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon Adsorber Banks	Roberson, P. W.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
24-0534	Basis for and Practical Methods of Controlling Painting Activities at the Sequoyah Nuclear Plant	Campbell, R. R.
24-0550	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	Sakurai, T. Komatsu, K. Takahashi, A.
24-0563	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina Adsorbent	Fukasawa, T. Funabashi, K. Kondo, Y.
24-0576	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver Exchanged Mordenite	Jubin, R. T. Counce, R. M.
24-0609	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	Herrmann, F. J. Herrmann, B. Hoeflich, V. Beyer, Ch. Furrer, J.
24-0618	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	Herrmann, F. J. Herrmann, B. Kuhn, K. D. van Schoor, A. Weishaupt, M. Furrer, J. Knoch, W.
24-0631	A Review of DOE HEPA Filter Component Test Activities: FY-1994	Slawski, J. W. Bresson, J. F. Scripsick, R. C.
24-0649	In-Place HEPA Filter Efficiency Tests	Bergman, W. Wilson, K. Elliot, J. Slawski, J. W.
24-0671	Method for HEPA Filter Leak Scanning with Differentiating Aerosol Detector	Kovach, B. J. Banks, E. M. Wikoff, W. O.
24-0676	Uncertainty In-Place Filter Test Results	Scripsick, R. C. Beckman, R. J. Mokler, B. V.
24-0683	Validation Testing of Radioactive Waste Drum Filter Vents	Weber, L. D. Rahimi, R. S. Edling, D.

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY CONFERENCE NUMBER AND PAGE

Conference No. - Page	Title	Author(s)
24-0698	A General Correlation of MPPS Penetration as a Function of Face Velocity with the Model 8140 Using the Certitest 8160	Lifshutz, N. Pierce, M. E.
24-0708	Further Development of the Cleanable Steel HEPA Filter and Comparison with Competing Technologies	Bergman, W. Wilson, K. Larsen, G.
24-0743	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat HEPA Filters	Dyment, J. Loughborough, D.
24-0752	Potential for HEPA Filter Damage from Water Spray Systems in Filter Plenums	Bergman, W. Fretthold, J. K. Slawski, J. W.
24-0778	Simulation Test of Aerosol Generation from Vessels in the Pretreatment System of Fuel Reprocessing	Fujine, S. Kitamura, K. Kihara, T.
24-0788	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion Prefilters	Wright, S. W. Crouch, H. S. Bond, J. H.
24-0807	The First Twenty Years of the ASME Committee on Nuclear Air and Gas Treatment- A Retrospective by a Founding Member	Jacox, J.
24-0819	Performance Testing of HEPA Filters: Progress Towards a European Standard Procedure	Dyment, J.
24-0829	The Case for Improved HEPA-Filter Mechanical Performance Standards Revisited	Ricketts, C. I. Smith, P. R.
24-0850	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	Hayes, Jr., J. J. Porco, R. D. Slawski, J. Rown, R. Franklin, B. Klocke, S.

PART II

INDEX OF PAPERS BY AUTHOR(S)

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Abrahamson, C.	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	21-0782
Adams, D. G.	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Ahmad, J.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Alper, N.	AP600 Containment Purge Radiological Analysis	23-0454
Alsmeyer, H.	Beta Experiments on Aerosol Release During Melt-Concrete Interaction and Filtering of the Off-Gas	22-0415
Amend, J.	Iodine-129 Distribution and Retention During Evaporation of MWL Solutions	21-0234
Anand, N. K.	Aerosol Particle Losses in Sampling Systems	22-0310
Anand, N. K.	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Andersen, C. M.	LFCM Processing Characteristics of Mercury	21-0442
Anderson, R.	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Anderson, W. L.	Criteria for Calculating the Efficiency of HEPA Filters During and After Design Basis Accidents	23-0563
Anwar, S.	Numerical Analysis of a Natural Convection Cooling System for Radioactive Canisters Storage	23-0128
Appelgren, E.	Impact of the Filtered Venting System Design Upon the Total Radioactive Release in Case of a Severe Accident and a Comparison of European Requirements	21-0933
Arai, K.	Experimental Study on the Volatile Ruthenium Decontamination Factor of the Perforated Plate Column Scrubber	22-0244
Arganbright, R.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Arndt, T. E.	Evaluation of Self-Contained HEPA Filter	23-0054
Arndt, T. E.	An Example of a Component Replacement when Applying ASME N509 and ASME N510 to Older Ventilation Systems	23-0093
Ashton, C.	Ductwork Section (SA) Improvements	22-0488
Bailey, W. H.	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with the DOE's New 10 CFR 835 and the NRC's 10 CFR 20 Regulation	23-0670

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Ball, J. M.	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Banks, E. M.	Halide Test Agent Replacement Study	23-0313
Banks, E. M.	Comparison of Emery 3004 and 3006 Characteristics with DOP for Possible Use in HEPA Filter Leak Tests	23-0758
Banks, E. M.	Practical Experience Applied to the Design of Injection and Sample Manifolds to Perform In-Place Surveillance Tests According to ANSI/ASME N-510	24-0132
Banks, E. M.	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by Halide Pulse Integration Method	24-0176
Banks, E. M.	Method for HEPA Filter Leak Scanning with Differentiating Aerosol Detector	24-0671
Banton, S.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Banton, S.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Banton, S. G.	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Barnett, J. M.	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2: Dose Assessment Methodology Using Portable Low-Resolution Gamma Spectroscopy	23-0269
Barnett, J. M.	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1: Dose Assessment	23-0498
Bartlett, W. T.	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP Continuous Air Monitors	24-0188
Bayne, P.	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders in the 1990's	22-0018
Beason, D.	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Beason, D.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Beckman, R. J.	Uncertainty In-Place Filter Test Results	24-0676
Bellamy, R. R.	US NRC Regulatory Guidance for Engineered Safety Feature Air Cleaning Systems	21-0626
Bellamy, R. R.	Air Cleaning Issues with Contaminated Sites	24-0012

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Bellamy, R. R.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Berglund, R. C.	GE's Advanced Nuclear Reactor Designs	22-0043
Bergman, W.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Bergman, W.	Development and Evaluation of a HEPA Filter for Increased Strength and Resistance to Elevated Temperature	22-0617
Bergman, W.	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Bergman, W.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Bergman, W.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Bergman, W.	Performance of HEPA Filters at LLNL Following the 1980 and 1989 Earthquakes	23-0425
Bergman, W.	Criteria for Calculating the Efficiency of HEPA Filters During and After Design Basis Accidents	23-0563
Bergman, W.	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Bergman, W.	Degradation of HEPA Filters Exposed to DMSO	23-0695
Bergman, W.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Bergman, W.	Filtration Theory Using Computer Simulations	24-0485
Bergman, W.	In-Place HEPA Filter Efficiency Tests	24-0649
Bergman, W.	Further Development of the Cleanable Steel HEPA Filter and Comparison with Competing Technologies	24-0708
Bergman, W.	Potential for HEPA Filter Damage from Water Spray Systems in Filter Plenums	24-0752
Bernstein, H. J.	A Real-Time Stack Radioactivity Monitoring System and Dose Projection Program	23-0259
Besserer, U.	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Beyer, Ch.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Beyer, Ch.	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	24-0609

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Biermann, A.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Billarand, Y.	Study on Collecting Efficiency of Fission Products by Spray: Experimental Device and Modelling	24-0500
Birdwell, J. F.	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in the Oak Ridge National Laboratory Integrated Equipment Test Facility	21-0271
Blacklaw, J.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Blacklaw, J. R.	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Bond, J. H.	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion Prefilters	24-0788
Boorman, C. H.	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box Cleaning and Increasing HEPA Filter Life	21-0762
Bosley, R. B.	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and Photometric Detection with Computer Control	22-0154
Brain, C.	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Braun, H.	The Experience with the Effectiveness of Filtering Systems for the Radioactive Fall-Out from the Chernobyl Accident in Germany	22-0393
Braun, H.	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Braun, H.	The Link Between Off-Site-Emergency Planning and Plant-Internal Accident Management	23-0509
Braun, H.	Atmospheric Discharges from Nuclear Facilities during Decommissioning: German Experiences and Concepts	24-0460
Brenk, H. D.	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Bresson, J. F.	Quality Assurance Requirements for NESHAPS Compliance	21-0352
Bresson, J. F.	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Brodda, B. G.	Development of a Process for Adsorptive Separation of KR-85 from the Off-Gas of Nuclear Facilities	21-0299
Brown, J. H.	Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station	22-0830

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Brown, J. H.	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Buckley, C. P.	The Development and Design of the Off-Gas Treatment System for the Thermal Oxide Reprocessing Plant (THORP) at Sellafield	23-0333
Burbach, T.	Development of a Process for Adsorptive Separation of KR-85 from the Off-Gas of Nuclear Facilities	21-0299
Burns, D. B.	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator Air Pollution Control Systems	24-0076
Burwinkel, P.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Burwinkel, P.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Campbell, R. R.	Basis for and Practical Methods of Controlling Painting Activities at the Sequoyah Nuclear Plant	24-0534
Cannito, F. J.	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Capon, S.	Development of Filter Systems - Part 2, Injection Systems and Multi-Point Sampler Evaluation	21-0139
Carlson, H. R.	An Update: DOP Replacement in Testing Machines for Filters and Respirators	22-0146
Carlson, H. R.	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol Penetrometer Machines	21-0126
Carlson, H. R.	New Performance Data for "Emery 3002" and "Emery 3004," Two Army-Approved Safe Materials to Replace DOP in Mask and Filter Testing	23-0743
Carter, J. T.	Measurement of Cesium Emissions During the Vitrification of Simulated High Level Radioactive Waste	22-0253
Cassette, Ph.	New Injection System for a Short Mixing of Test Aerosols and Gas Tracers Inside Ventilation Ducts	21-0080
Castellani, F.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Cederqvist, H.	Impact of the Filtered Venting System Design Upon the Total Radioactive Release in Case of a Severe Accident and a Comparison of European Requirements	21-0933

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Cederqvist, H.	A Short Overview of the Programs in Sweden	21-0980
Chang, S. D.	Demonstration of Carbon-14 Removal at Candu Nuclear Generating Stations	21-0530
Changzhuo, Ye	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Charuau, J.	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Cheh, C. H.	Demonstration of Carbon-14 Removal at Candu Nuclear Generating Stations	21-0530
Cheh, C. H.	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Chen, W. W.	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis of Purex Plant	24-0471
Chen, X.	An Introduction to the Design, Commissioning, and Operation of Nuclear Air Cleaning Systems for Qinshan Nuclear Power Plant	23-0439
Christian, J. D.	Behavior and Control of Ruthenium During Operation of the New Waste Calcining Facility at the Idaho Chemical Processing Plant	21-0467
Claybrook, S.	Development of a Personal Computer Code for Fire Protection Analysis of DOE Facility Air Cleaning Systems	22-0875
Coleman, J. A.	DOE Waste Management Program-Current and Future	22-0716
Congel, F. J.	Severe Accident Issues for Advanced Reactors	22-0034
Congel, F. J.	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Conklin, A.	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Conner, J.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Conner, J.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Corey, I.	Filtration Theory Using Computer Simulations	24-0485
Costigan, G.	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
Costigan, G.	Performance of HEPA Filters Under Hot Dynamic Conditions	23-0601
Counce, R. M.	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver Exchanged Mordenite	24-0576

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Crosby, D. W.	Aerosol Concentrations Produced by a Laskin Nozzle Generator a Comparison of Substitute Materials and DOP	21-0109
Crouch, H. S.	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion Prefilters	24-0788
Curzio, G.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
d'Errico, F.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Daling, P. M.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Dalpiaz, E. L.	Development of a Computer Code to Predict a Ventilation Requirement for an Underground Radioactive Waste Storage Tank	24-0065
Davis, M. L.	Radial Flow Systems for the Nuclear Industry	22-0527
Davis, W. E.	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1: Dose Assessment	23-0498
de Planque, E. G.	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
de Witt, H.	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Deaton, K.	Challenges of Equipment Qualification Using Today's Standards with Emphasis on a Class IE Motor Program	23-0034
Deir, C.	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Denniss, I. S.	The Development of Corona Discharge for Iodine Removal from Nuclear Fuel Reprocessing Plant Off-Gases	22-0102
Deuber, H.	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	21-0247
Dierkschiede, B.	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	21-0782
Dillman, H. G.	A Low Pressure Filter System for New Containment Concepts	23-0478
Dillmann, H. G.	Beta Experiments on Aerosol Release During Melt-Concrete Interaction and Filtering of the Off-Gas	22-0415
Dillmann, H. G.	Investigations into the Design of a Filter System for PWR Containment Venting	21-0898

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Doffert, I.	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	22-0540
Dorman, R. G.	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by the European Community Countries	22-0324
Doughty, S.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Drace, Z.	Modern Technology Tools for Improvement of NPP Reliability-Case Study of NPP Filtration Systems Validation	22-0808
DuBois, L. J.	Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station	22-0830
DuBois, L. J.	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Ducret, D.	Experimental Study of Elementary Collection Efficiency of Aerosols by Spray: Design of the Experimental Device	23-0682
Ducret, D.	Study on Collecting Efficiency of Fission Products by Spray: Experimental Device and Modelling	24-0500
Dunbar, Jr., A. E.	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum Filter Housings with Close Couple Redundant Series Filters	21-0360
DuPoux, N.	New Injection System for a Short Mixing of Test Aerosols and Gas Tracers Inside Ventilation Ducts	21-0080
Duvall, K.	Radionuclide Air Emissions at Department of Energy Facilities	23-0233
Dykes, M.	Standardized Methods for In-Place Filter Testing	24-0386
Dyment, J.	The Development of a HEPA Filter with Improved Dust Holding Characteristics	23-0176
Dyment, J.	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat HEPA Filters	24-0743
Dyment, J.	Performance Testing of HEPA Filters: Progress Towards a European Standard Procedure	24-0819
Dyment, J.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Eckardt, B.	Direct Post-Accident Sampling System for Containment Atmospheres (DI-PAS System)	22-0283
Eckardt, B.	Containment Venting Sliding Pressure Venting Process for PWR and BWR Plants - Process Design and Test Results	21-0876

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Edling, D.	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Edwards, J. R.	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
Edwards, J. R.	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum Filter Housings with Close Couple Redundant Series Filters	21-0360
Elisson, K.	Impact of the Filtered Venting System Design Upon the Total Radioactive Release in Case of a Severe Accident and a Comparison of European Requirements	21-0933
Elliot, J.	In-Place HEPA Filter Efficiency Tests	24-0649
Elliott, J.	Performance of HEPA Filters at LLNL Following the 1980 and 1989 Earthquakes	23-0425
Enneking, J. C.	A Study of the Effect of Coatings Operation on Radioiodine Removing Adsorbents	21-0563
Epperson, S. A.	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling System (U)	21-0415
Evans, G. J.	Photochemical Removal of Radioactive Iodine from Air	21-0376
Evans, G. J.	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Evans, J. S.	Radiological Health Effects Models for Nuclear Power Plant Accident Consequence Analysis -- An Update (1990)	21-0057
Fairchild, C. I.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
Fan, B. J.	Aerosol Particle Losses in Sampling Systems	22-0310
Fang, D.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Fang, D.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
Farajian, T.	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method Airflow Simulation	22-0374
Farrar, C. R.	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Fies, H.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
Finsterwalder, L.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
First, M. W.	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
First, M. W.	Welcome and Objectives of the Conference	22-0003
First, M. W.	Welcome and Objectives of the Conference	21-0002
First, M. W.	A Brief History of the Air Cleaning Conferences	23-0003
First, M. W.	Criteria for Calculating the Efficiency of HEPA Filters During and After Design Basis Accidents	23-0563
First, M. W.	Opening Comments of Chairman and Greetings from Sponsors	24-0002
Fleming, K. M.	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in NATS	22-0698
Fleming, K. M.	Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station	22-0830
Fleming, K. M.	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Fleming, K. M.	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Fordham, E.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Fox-Williams, K.	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Franklin, B.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Frankum, D. P.	Performance of HEPA Filters Under Hot Dynamic Conditions	23-0601
Freeman, W. P.	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems Using the "New" Standards	22-0661
Freeman, W. P.	A Study of the Effect of Coatings Operation on Radioiodine Removing Adsorbents	21-0563
Freeman, W. P.	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
Freeman, W. P.	Halide Test Agent Replacement Study	23-0313
Freeman, W. P.	Characterization and Restoration of Performance of "Aged" Radioiodine Removing Activated Carbons	24-0520
Fretthold, J. K.	Development and Evaluation of a HEPA Filter for Increased Strength and Resistance to Elevated Temperature	22-0617

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES

INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Fretthold, J. K.	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Fretthold, J. K.	Proposed Retrofit of HEPA Plenums with Injection and Sampling Manifolds for In-Place Filter Testing	23-0721
Fretthold, J. K.	Standardized Methods for In-Place Filter Testing	24-0386
Fretthold, J. K.	Potential for HEPA Filter Damage from Water Spray Systems in Filter Plenums	24-0752
Friedrich, V.	Kinetic Modelling of the Purging of Activated Carbon After Short Term Methyl Iodide Loading	21-0662
Friedrich, V.	Nuclear Air Cleaning Programs in Hungary	21-0986
Friley, J. R.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Fronhofer, M.	Challenges Within Ventilation Systems During Accident Situations	22-0510
Fronhofer, M.	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	22-0540
Frye, L.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Frye, L.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Fujimori, K.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791
Fujine, S.	Simulation Test of Aerosol Generation from Vessels in the Pretreatment System of Fuel Reprocessing	24-0778
Fukasawa, M.	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Fukasawa, M.	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	21-0918
Fukasawa, T.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Fukasawa, T.	Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents	21-0594
Fukasawa, T.	Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams	23-0352
Fukasawa, T.	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina Adsorbent	24-0563

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Fukasawa, T.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Funabashi, K.	Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams	23-0352
Funabashi, K.	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina Adsorbent	24-0563
Furrer, J.	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Furrer, J.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Furrer, J.	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets Carried by the Off-Gas Flow	22-0534
Furrer, J.	Iodine-129 Distribution and Retention During Evaporation of MWL Solutions	21-0234
Furrer, J.	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	21-0247
Furrer, J.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Furrer, J.	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	24-0609
Furrer, J.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Garr, J.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Gellner, C.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Ghosh, D.	Effects on the Efficiency of Activated Carbon on Exposure to Welding Fumes	23-0639
Gilbert, H.	Development and Evaluation of a HEPA Filter for Increased Strength and Resistance to Elevated Temperature	22-0617
Gilbert, H.	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Gilbert, H.	Criteria for Calculating the Efficiency of HEPA Filters During and After Design Basis Accidents	23-0563

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Gilbert, H.	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Gill, C. F.	Response of NRC Region III to Perceived Lack of Filter Testing Expertise Concerns	22-0762
Girrens, S. P.	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Glissmeyer, J. A.	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Goldsmith, A. L.	The Development of Corona Discharge for Iodine Removal from Nuclear Fuel Reprocessing Plant Off-Gases	22-0102
Goles, R. W.	LFCM Processing Characteristics of Mercury	21-0442
Gong, H.	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Goodchild, P. J.	The Effects of Temperature on HEPA Filter Media	22-0327
Goossens, W. R. A.	Global Change and the Practice for Airborne Waste Treatment	22-0004
Goossens, W. R. A.	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Gortz, R.	The Link Between Off-Site-Emergency Planning and Plant-Internal Accident Management	23-0509
Gortz, R.	Atmospheric Discharges from Nuclear Facilities during Decommissioning: German Experiences and Concepts	24-0460
Goumondy, J. P.	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed Column	21-0259
Graves, C.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Graves, C.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Green, M. R.	European Community Nuclear Codes and Standards	21-0212
Gregonis, R. A.	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis of Purex Plant	24-0471
Gregory, W. S.	Development of a Personal Computer Code for Fire Protection Analysis of DOE Facility Air Cleaning Systems	22-0875
Gregory, W. S.	Investigation of Salt Loaded HEPA Filters	21-0366
Gregory, W. S.	Pool Fires in a Large Scale Ventilation System	21-0844

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Grewal, G.	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method Airflow Simulation	22-0374
Grewal, G.	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of Non-Reactor Nuclear Facilities	22-0574
Grot, R. A.	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Gue, J. P.	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of HLLW Storage Tanks	21-0831
Guelta, M. A.	An Update: DOP Replacement in Testing Machines for Filters and Respirators	22-0146
Guelta, M. A.	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol Penetrometer Machines	21-0126
Guelta, M. A.	New Performance Data for "Emery 3002" and "Emery 3004," Two Army-Approved Safe Materials to Replace DOP in Mask and Filter Testing	23-0743
Guest, A.	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Hakii, J.	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	21-0918
Hall, G. R.	Adaptation of Nuclear Filtration Technology to the Demilitarization of Chemical Weapons	21-0419
Hamblin, C.	The Effects of Temperature on HEPA Filter Media	22-0327
Hamblin, C.	The Development of a HEPA Filter with Improved Dust Holding Characteristics	23-0176
Handyside, I.	Developments in the Area of Regulatory Matters in the UK	21-0977
Harty, W. M.	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of Non-Reactor Nuclear Facilities	22-0574
Hasegawa, M.	Development of Computer Design System for HVAC System	22-0781
Hasegawa, M.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791
Hayes, T. W.	Heater Selection Criteria for Engineered Safety Features Atmosphere Filtration Systems	22-0820
Hayes, Jr., J. J.	Changes in Adsorber Testing as a Result of NRC Generic Information	21-0607

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Hayes, Jr., J. J.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Hedley, W. H.	Tritium Emissions Reduction Facility (TERF)	22-0065
Heffley, K. W.	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum Filter Housings with Close Couple Redundant Series Filters	21-0360
Hensel, E.	Development of a Personal Computer Code for Fire Protection Analysis of DOE Facility Air Cleaning Systems	22-0875
Hensel, E. C.	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Hensel, E. C.	Investigation of Salt Loaded HEPA Filters	21-0366
Herrmann, B.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Herrmann, B.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
Herrmann, B.	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	24-0609
Herrmann, B.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Herrmann, F. J.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Herrmann, F. J.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Herrmann, F. J.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
Herrmann, F. J.	Iodine-129 Distribution and Retention During Evaporation of MWL Solutions	21-0234
Herrmann, F. J.	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	24-0609
Herrmann, F. J.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Hesterberg, T.	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Higgins, P. J.	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	21-0782
Hilley, Jr., J. R.	Design Basis Documentation for the Control Room Ventilation/Chilled Water System at McGuire Nuclear Station	21-0526
Hirao, K.	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Hirose, Y.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Hirose, Y.	Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents	21-0594
Hirose, Y.	Air Cleaning Programs Relating to the First Japanese Commercial Reprocessing Plant	21-0984
Hobart, S. A.	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Hoeflich, V.	Removal Efficiency of Silver Impregnated Filter Materials and Performance of Iodine Filters in the Off-Gases of the Karlsruhe Reprocessing Plant Wak	24-0609
Holman, D.	United Kingdom Atomic Energy Authority Programs	21-0975
Holt, N. S.	The Development of Corona Discharge for Iodine Removal from Nuclear Fuel Reprocessing Plant Off-Gases	22-0102
Holtorp, J.	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Hubner, R. S.	Revised Accident Source Terms and Control Room Habitability	22-0742
Hudson, P. I.	The Development and Design of the Off-Gas Treatment System for the Thermal Oxide Reprocessing Plant (THORP) at Sellafield	23-0333
Huijian, Zhu	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Hull, A. P.	A Real-Time Stack Radioactivity Monitoring System and Dose Projection Program	23-0259
Hunt, J. R.	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbents in NATS	22-0698
Hutter, E.	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Hyder, M. L.	Proposed Source Term Revisions Potential Impact on Future Nuclear Air Cleaning Requirements, Applications to DOE Production Reactor Operation	22-0736
Hyder, M. L.	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated Carbon	21-0583
Hyder, M. L.	Nuclear Air Cleaning Program in USA	21-0969
Ikeda, M.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791
Ishikawa, N.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Jacox, J.	A Review of Gas Phase Filtration Standards and their Applicability to Nuclear Applications	22-0215
Jacox, J.	Integrating Industry Nuclear Codes and Standards into United States Department of Energy Facilities	23-0098
Jacox, J.	Gas Processing at DOE Nuclear Facilities	23-0301
Jacox, J.	The First Twenty Years of the ASME Committee on Nuclear Air and Gas Treatment- A Retrospective by a Founding Member	24-0807
Jacox, J. W.	A Review of the History, Revisions and Interrelationships of ANSI/ASME N509 and N510, 1989 Editions	21-0320
Jacqmin, G.	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Jannakos, K.	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Jannakos, K.	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets Carried by the Off-Gas Flow	22-0534
Jannakos, K.	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	21-0247
Jannakos, K.	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried by the Offgas Flow	21-0772
Jarv, T.	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Johnson, J. S.	Field Measurement of the Performance of Air Cleaning Systems to Simulated Worst Case Chemical Accidents Using the Lawrence Livermore National Laboratory S-3 Facility at the Nevada Test Site	21-0435
Johnson, W. J.	Revised Accident Source Terms and Control Room Habitability	22-0742

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Jubin, R. T.	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver Exchanged Mordenite	24-0576
Junyue, Ling	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Kaempffer, R.	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Kaempffer, R.	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	21-0247
Kaercher, M.	Design of a Prefilter to Improve Radiation Protection and Filtering Efficiency of the Containment Venting System	22-0443
Kaercher, M.	Design and Full Scale Test of a Sand Bed Filter	21-0946
Kaneko, I.	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Kaneko, I.	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	21-0918
Karhnak, J. M.	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Kasjaka, M.	AP600 Containment Purge Radiological Analysis	23-0454
Kato, K.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Kawamura, F.	Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams	23-0352
Kihara, T.	Simulation Test of Aerosol Generation from Vessels in the Pretreatment System of Fuel Reprocessing	24-0778
Kikuchi, M.	Development of Silver Impregnated Alumina for Iodine Separation from Off-Gas Streams	23-0352
Kim, Y. K.	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Kim, Y. S.	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic Diamines as an Impregnant of an Activated Carbon of the Nuclear Grade	21-0394
Kitamura, K.	Simulation Test of Aerosol Generation from Vessels in the Pretreatment System of Fuel Reprocessing	24-0778
Kitamura, M.	Experimental Study on the Volatile Ruthenium Decontamination Factor of the Perforated Plate Column Scrubber	22-0244
Klassen, J. F.	Predicting Mass Loading as a Function of Pressure Difference Across Prefilter/HEPA Filter Systems	22-0554

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Klocke, S.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Kluge, V.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Kluge, V.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Knoch, H. W.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Knoch, W.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Knoch, W.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Kobayashi, Y.	Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents	21-0594
Komaki, Y.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Komatsu, K.	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Kondo, Y.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Kondo, Y.	Removal Characteristics of Some Organic Iodine Forms by Silver Impregnated Adsorbents	21-0594
Kondo, Y.	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina Adsorbent	24-0563
Koskelo, M.	Performance Characterization of a New CAM System	22-0299
Kovach, B. J.	Halide Test Agent Replacement Study	23-0313
Kovach, B. J.	Comparison of Emery 3004 and 3006 Characteristics with DOP for Possible Use in HEPA Filter Leak Tests	23-0758
Kovach, B. J.	Accuracy Improvement in Leak Detection of Charcoal Adsorbents by Halide Pulse Integration Method	24-0176
Kovach, B. J.	Method for HEPA Filter Leak Scanning with Differentiating Aerosol Detector	24-0671
Kovach, J. L.	Notes on the Draft NUREG Report Accident Source Terms for Light-Water Nuclear Power Plants	22-0734

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Kovach, J. L.	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl Iodide Removal	22-0646
Kovach, J. L.	Methyl Iodide Tests on Used Adsorbents	22-0768
Kovach, J. L.	Type II HEPA Filter	21-0410
Kovach, J. L.	Gas Processing in the Nuclear Industry	23-0294
Kovach, J. L.	Residence Time Determination for Adsorbent Beds of Different Configurations	23-0308
Kovach, J. L.	Halide Test Agent Replacement Study	23-0313
Kovach, J. L.	New Challenges to Air/Gas Cleaning Systems	24-0033
Kovacs, G.	Comparison of Emery 3004 and 3006 Characteristics with DOP for Possible Use in HEPA Filter Leak Tests	23-0758
Kramer, C.	Instrument & Controls Section (IA) Improvements	22-0490
Kreiner, H. J.	Measurement System for Alpha and Beta Aerosols with Wide Dynamic Range and Krypton-85 Masking	21-0872
Kress, Thomas	Keynote Address: Nuclear Aerosols: Unfinished Business	24-0005
Kriskovich, J. R.	Application of Nuclear Air Cleaning and Treatment Codes	23-0297
Kuhn, K. D.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Kuhn, K. D.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Laborde, J. C.	New Injection System for a Short Mixing of Test Aerosols and Gas Tracers Inside Ventilation Ducts	21-0080
Laborde, J. C.	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	21-0815
Laborde, J. C.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Lagus, P. L.	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in NATS	22-0698
Lagus, P. L.	Control Room Inleakage Testing Using Tracer Gases at Zion Generating Station	22-0830
Lagus, P. L.	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Lagus, P. L.	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Lagus, P. L.	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Lahti, G. P.	Revised Accident Source Terms and Control Room Habitability	22-0742
Lamberger, P. H.	Tritium Emissions Reduction Facility (TERF)	22-0065
Landon, F. L.	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of Non-Reactor Nuclear Facilities	22-0574
Lanza, S.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Larsen, G.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Larsen, G.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Larsen, G.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Larsen, G.	Degradation of HEPA Filters Exposed to DMSO	23-0695
Larsen, G.	Further Development of the Cleanable Steel HEPA Filter and Comparison with Competing Technologies	24-0708
Lee, J. Y.	Severe Accident Issues for Advanced Reactors	22-0034
Lee, R.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Lee, Y. J.	Development of a Computer Code to Predict a Ventilation Requirement for an Underground Radioactive Waste Storage Tank	24-0065
LeGarrec, S.	Experimental Study of Elementary Collection Efficiency of Aerosols by Spray: Design of the Experimental Device	23-0682
Legner, W.	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried by the Offgas Flow	21-0772
Leiber, T.	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	22-0540
Leibold, H.	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	22-0540
Leibold, H.	Steps Towards the Minimization of Particulate Emissions From a Low-Level Waste Incineration Facility	21-0510

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Leinonen, P. J.	Demonstration of Carbon-14 Removal at Candu Nuclear Generating Stations	21-0530
LeMay, J.	Degradation of HEPA Filters Exposed to DMSO	23-0695
Leonard, J. F.	HEPA Filter Concerns - An Overview	23-0150
Leonard, L.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Leonard, L.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Leslie, I. H.	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Leslie, L. H.	Investigation of Salt Loaded HEPA Filters	21-0366
Leslie, L. H.	Pool Fires in a Large Scale Ventilation System	21-0844
Letourneau, P.	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Letourneau, P.	Effects of the Particle Penetration Inside the Filter Medium on the HEPA Filter Pressure Drop	21-0128
Letourneau, P.	Effect of Humidity on the Filter Pressure Drop	23-0187
Leung, V. T.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Li, J.	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear Power Plant Containments Following a Severe Accident	23-0520
Lifshutz, N.	A General Correlation of MPPS Penetration as a Function of Face Velocity with the Model 8140 Using the Certitest 8160	24-0698
Linck, A.	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance Striking for Liquid and Gaseous Iodine Fractions	21-0247
Linek, A.	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Long, S. W.	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Long, T. A.	Predicting Mass Loading as a Function of Pressure Difference Across Prefilter/HEPA Filter Systems	22-0554
Lopez, M. C.	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	21-0815
Lopez, R.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Lopez, R.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Lopez, R.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Lopez, R.	Degradation of HEPA Filters Exposed to DMSO	23-0695
Loughborough, D.	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
Loughborough, D.	Development of Filter Systems - Part 2, Injection Systems and Multi-Point Sampler Evaluation	21-0139
Loughborough, D.	The Dust Holding Capacity of HEPA Filters	21-0155
Loughborough, D.	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat HEPA Filters	24-0743
Lowenhielm, G.	Impact of the Filtered Venting System Design Upon the Total Radioactive Release in Case of a Severe Accident and a Comparison of European Requirements	21-0933
Lucas, M.	The Phebus FP Integral Source Term Experimental Project with Emphasis on Iodine Selective Filtering	22-0464
Lux, I.	Kinetic Modelling of the Purging of Activated Carbon After Short Term Methyl Iodide Loading	21-0662
Lyons, J.	Charcoal Filter Testing	24-0395
MacFarlane, R.	Photochemical Removal of Radioactive Iodine from Air	21-0376
Mai, R.	Steps Towards the Minimization of Particulate Emissions From a Low-Level Waste Incineration Facility	21-0510
Malstorm, R. A.	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated Carbon	21-0583
Marler, J. E.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Marshall, M.	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and Photometric Detection with Computer Control	22-0154
Massacurati, V.	Simulated Performances of a Single Particle Laser Light Scattering Analyzer	21-0173
Matsumoto, M.	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Matsumoto, M.	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	21-0918

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
McFarland, A. R.	Performance Characterization of a New CAM System	22-0299
McFarland, A. R.	Aerosol Particle Losses in Sampling Systems	22-0310
McFarland, A. R.	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
McFarland, A. R.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
McFarland, A. R.	Aerosol Deposition In Bends with Turbulent Flow	24-0441
McIntyre, J. A.	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY 1992	22-0177
McIntyre, J. A.	Review of Department of Energy Filter Test Facility and Filter Test Facility Technical Support Group Activities FY 1986 - FY 1989	21-0385
Mercado, M. G.	Numerical Analysis of a Natural Convection Cooling System for Radioactive Canisters Storage	23-0128
Mercier, J. P.	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of HLLW Storage Tanks	21-0831
Miaoxianz, Yang	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Michael, P. A.	A Real-Time Stack Radioactivity Monitoring System and Dose Projection Program	23-0259
Milatovic, Z.	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of Non-Reactor Nuclear Facilities	22-0574
Miller, D. H.	Measurement of Cesium Emissions During the Vitrification of Simulated High Level Radioactive Waste	22-0253
Miller, W. C.	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Miller, W. W.	The Development and Design of the Off-Gas Treatment System for the Thermal Oxide Reprocessing Plant (THORP) at Sellafield	23-0333
Miller, Jr., W. H.	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
Miller, Jr., W. H.	Introductory Statement	21-0186
Milliner, W. V.	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Minns, J. L.	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear Power Plants	23-0138

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Miyata, K.	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Miyazaki, Y.	Development of Computer Design System for HVAC System	22-0781
Mock, H.	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets Carried by the Off-Gas Flow	22-0534
Moeller, D. W.	Air Cleaning Technologies for the Management and Disposal of Radioactive Wastes	21-0028
Moeller, D. W.	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Moeller, D. W.	Application of Innovative Policies for Controlling Radionuclide Releases: The "Open-Market Trading Rule"	24-0040
Mokler, B. V.	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
Mokler, B. V.	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
Mokler, B. V.	Uncertainty In-Place Filter Test Results	24-0676
Monroe, D.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Monson, P. R.	Predicting Mass Loading as a Function of Pressure Difference Across Prefilter/HEPA Filter Systems	22-0554
Moore, P.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Moore, P.	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Mori, A.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Morris, D.	Development of Filter Systems - Part 2, Injection Systems and Multi-Point Sampler Evaluation	21-0139
Motoi, V.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
Motoi, V.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
Motoi, V.	Iodine-129 Distribution and Retention During Evaporation of MWL Solutions	21-0234
Mulcey, P.	Nuclear Air Cleaning Programs in Progress in France	21-0978

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES

INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Mulcey, Ph.	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency Measurements of HEPA Filters	21-0095
Mulcey, Ph.	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Muyshondt, A.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
Muyshondt, A.	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Naito, M.	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Neitzel, H. -J.	Concept for a Passive Heat Removal and Filtration System Under Core Meltdown Conditions	22-0863
Nelson, D. C.	Performance Characterization of a New CAM System	22-0299
Nelson, D. C.	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Nelson, G.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Neri, E.	Simulated Performances of a Single Particle Laser Light Scattering Analyzer	21-0173
Nesbitt, L. B.	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Neuberger, M.	Challenges Within Ventilation Systems During Accident Situations	22-0510
Novick, V. J.	Predicting Mass Loading as a Function of Pressure Difference Across Prefilter/HEPA Filter Systems	22-0554
Novick, V. J.	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	21-0782
O'Connor, M.	AP600 Containment Purge Radiological Analysis	23-0454
Ohnuki, M.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Olson, P.	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at McGuire Nuclear Station	21-0332
Omoto, K.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791
Ortiz, C. A.	Performance Characterization of a New CAM System	22-0299
Ortiz, C. A.	Aerosol Particle Losses in Sampling Systems	22-0310

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Ortiz, C. A.	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Ortiz, C. A.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
Otermat, J. E.	A View of Licensee Event Reports - Relating to Nuclear Air Treatment Systems and Heating, Ventilating, Air Conditioning Systems, Filed During the Period 1988-1991	22-0899
Otermat, J. E.	Residence Time Determination for Adsorbent Beds of Different Configurations	23-0308
Pachernegg, S.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Parker, K.	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Parker, R. C.	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and Photometric Detection with Computer Control	22-0154
Paschal, W. B.	Codes in Use	22-0493
Pasler, H.	Beta Experiments on Aerosol Release During Melt-Concrete Interaction and Filtering of the Off-Gas	22-0415
Pasler, H.	A Low Pressure Filter System for New Containment Concepts	23-0478
Paul, J.	Instrument & Controls Section (IA) Improvements	22-0490
Paul, J. D.	Effects of Filter Housing and Ductwork Configuration on Air Flow Uniformity Inside Air Cleaning Filter Housings	22-0205
Paul, J. D.	ASME N510 Test Results for Savannah River Site AACS Filter Compartments	23-0068
Paul, J. D.	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator Air Pollution Control Systems	24-0076
Pearson, J. R.	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in NATS	22-0698
Peirano, J. L.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Perrin, G.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Pest, M. E.	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Pest, M. E.	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air Treatment, Heating, Ventilation and Air Conditioning Systems, Draft Revision	24-0264
Peterson, D.	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Phan, H. K.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Philippe, M.	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of HLLW Storage Tanks	21-0831
Philippi, H. M.	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Pierce, M. E.	A General Correlation of MPPS Penetration as a Function of Face Velocity with the Model 8140 Using the Certitest 8160	24-0698
Platini, M.	Simulated Performances of a Single Particle Laser Light Scattering Analyzer	21-0173
Pleva, J. M.	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Plumb, G. R.	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste Management	21-0635
Porco, R.	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Porco, R.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Porco, R. D.	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Porco, R. D.	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510 Requirements	21-0327
Porco, R. D.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Potgeter, G.	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets Carried by the Off-Gas Flow	22-0534
Potgeter, G.	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried by the Offgas Flow	21-0772
Pourprix, M.	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	21-0815

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Pouyat, D.	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine Trapping and Off-Gas Characterization Unit	22-0053
Prevost, C.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Prevost, C.	Development of Real Time Detector for Fluorescent Particles	24-0163
Printz, R. J.	Development of a Process for Adsorptive Separation of KR-85 from the Off-Gas of Nuclear Facilities	21-0299
Punch, T. M.	ASME N510 Test Results for Savannah River Site AACS Filter Compartments	23-0068
Pybot, P.	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency Measurements of HEPA Filters	21-0095
Qi-dong, Li	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Qu, J.	An Introduction to the Design, Commissioning, and Operation of Nuclear Air Cleaning Systems for Qinshan Nuclear Power Plant	23-0439
Raboin, S.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Rahimi, R. S.	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Rainer, F.	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Ramsdell, Jr., J. V.	Alternatives to Current Procedures Used to Estimate Concentrations in Building Wakes	21-0714
Rapchun, D.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Remick, F. J.	Changing Winds in NRC's Regulatory Environment	21-0343
Renaudin, V.	Effects of the Particle Penetration Inside the Filter Medium on the HEPA Filter Pressure Drop	21-0128
Rice, P. D.	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Richardson, W. B.	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter Media Material	21-0782
Ricketts, C. I.	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused by High Air Humidity	21-0671

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Ricketts, C. I.	The Case for Improved HEPA-Filter Mechanical Performance Standards Revisited	24-0829
Riley, J.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Ringel, H. D.	Development of a Process for Adsorptive Separation of KR-85 from the Off-Gas of Nuclear Facilities	21-0299
Roberson, P. W.	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire Nuclear Station	21-0329
Roberson, P. W.	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon Adsorber Banks	24-0525
Robertson, G.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Roblot, D.	Study on Collecting Efficiency of Fission Products by Spray: Experimental Device and Modelling	24-0500
Rodgers, J. C.	Performance Characterization of a New CAM System	22-0299
Rodgers, J. C.	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Rodgers, J. C.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
Rogers, K. C.	Clean Air and Clear Responsibility	23-0658
Rossi, G.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Roustan, M.	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed Column	21-0259
Roux, J. P.	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine Trapping and Off-Gas Characterization Unit	22-0053
Rown, R.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Rudnick, S. N.	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
Sakurai, T.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Sakurai, T.	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Savornin, J.	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	21-0815
Schneider, M.	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused by High Air Humidity	21-0671
Scholten, L. C.	Effect of Filtering at Containment Venting on the Consequences for the Environment	22-0753
Scholten, L. C.	The Dutch Nuclear Programs	21-0968
Schultheis, T. M.	Investigation of Salt Loaded HEPA Filters	21-0366
Schulthesis, T. M.	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Schulz, J.	AP600 Containment Purge Radiological Analysis	23-0454
Schwartz, B. C.	Revised Accident Source Terms and Control Room Habitability	22-0742
Scripsick, R. C.	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
Scripsick, R. C.	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Scripsick, R. C.	Uncertainty In-Place Filter Test Results	24-0676
Seigneur, A.	Development of Real Time Detector for Fluorescent Particles	24-0163
Sevigny, G. J.	LFCM Processing Characteristics of Mercury	21-0442
Sgalambro, G.	Activated Charcoal Beds for Passive Mitigation of the Radioactivity Release from Severe Accidents. Heat Transport and Dynamic Noble-Gas Water-Vapour Coadsorption	22-0428
Shaffer, L. L.	Practical Experience Applied to the Design of Injection and Sample Manifolds to Perform In-Place Surveillance Tests According to ANSI/ASME N-510	24-0132
Sher, R.	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear Power Plant Containments Following a Severe Accident	23-0520
Sherwood, G. L.	HEPA Filter Testing - Department of Energy Office of Nuclear Energy Facilities	23-0087
Shi, M.	An Introduction to the Design, Commissioning, and Operation of Nuclear Air Cleaning Systems for Qinshan Nuclear Power Plant	23-0439
Shiomi, T.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Shirato, K.	Experimental Study on the Volatile Ruthenium Decontamination Factor of the Perforated Plate Column Scrubber	22-0244
Shunqing, Yuam	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Simon, K.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Simon, K.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Simonson, S. A.	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Slawski, J.	Standardized Methods for In-Place Filter Testing	24-0386
Slawski, J.	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Slawski, J.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Slawski, J. W.	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Slawski, J. W.	In-Place HEPA Filter Efficiency Tests	24-0649
Slawski, J. W.	Potential for HEPA Filter Damage from Water Spray Systems in Filter Plenums	24-0752
Smith, P. R.	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Smith, P. R.	Investigation of Salt Loaded HEPA Filters	21-0366
Smith, P. R.	Pool Fires in a Large Scale Ventilation System	21-0844
Smith, P. R.	The Case for Improved HEPA-Filter Mechanical Performance Standards Revisited	24-0829
Soffer, L.	Revision of Reactor Accident Source Terms and Implications for Nuclear Air Cleaning Requirements	22-0362
Soffer, L.	Introductory Remarks	22-0731a
Soffer, L.	Revised Accident Source Terms for Light-Water Reactors	23-0488
Sommer, R.	A View of Licensee Event Reports - Relating to Nuclear Air Treatment Systems and Heating, Ventilating, Air Conditioning Systems, Filed During the Period 1988-1991	22-0899
Sommer, R. R.	Halide Test Agent Replacement Study	23-0313

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Sonoda, T.	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Sprung, J. L.	Radiological Health Effects Models for Nuclear Power Plant Accident Consequence Analysis -- An Update (1990)	21-0057
Staggles, K.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Stoffel, D.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Strom, L. H.	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Sugimoto, Y.	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by Silver Impregnated Adsorbents	22-0118
Suzuki, F.	Design and Characteristics of Annulus Ventilation and HVAC System for Prototype FBR MONJU	22-0791
Takahashi, A.	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Takahashi, A.	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Tan, C.	AP600 Containment Purge Radiological Analysis	23-0454
Teissier, J.	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in the Event of Fire	21-0815
Tiggemann, H.	Measurement System for Alpha and Beta Aerosols with Wide Dynamic Range and Krypton-85 Masking	21-0872
Torgerson, D. F.	Canadian Waste Management Program	21-0042
Tsal, R. J.	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method Airflow Simulation	22-0374
Tsal, R. J.	Numerical Analysis of a Natural Convection Cooling System for Radioactive Canisters Storage	23-0128
Turley, J.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Turner, C.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Underhill, D. W.	A Simplified Test Procedure for Determining the Effectiveness of Adsorbents for the Removal of Methyl Iodide	22-0637

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Vahla, G.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Valha, G.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
van der Steen, J.	Effect of Filtering at Containment Venting on the Consequences for the Environment	22-0753
Van Rensbergen, J. B.	Global Change and the Practice for Airborne Waste Treatment	22-0004
van Schoor, A.	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant WAK	22-0075
van Schoor, A.	Retention and Measurement of Iodine-129 and of Organoiodine in the Off-Gas Streams of the Karlsruhe Reprocessing Plant WAK	21-0222
van Schoor, A.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
van Wonderen, E. L. M.	Effect of Filtering at Containment Venting on the Consequences for the Environment	22-0753
Vance, R. F.	The Integrated Melter Off-Gas Treatment Systems at the West Valley Demonstration Project	23-0016
Vanpelt, H. E.	A Utility Perspective on New Source Terms	22-0732
Vendel, J.	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency Measurements of HEPA Filters	21-0095
Vendel, J.	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Vendel, J.	Effects of the Particle Penetration Inside the Filter Medium on the HEPA Filter Pressure Drop	21-0128
Vendel, J.	Effect of Humidity on the Filter Pressure Drop	23-0187
Vendel, J.	Calculation Code Evaluating the Confinement of a Nuclear Facility in Case of Fires	23-0412
Vendel, J.	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Vendel, J.	Experimental Study of Elementary Collection Efficiency of Aerosols by Spray: Design of the Experimental Device	23-0682
Vendel, J.	Development of Real Time Detector for Fluorescent Particles	24-0163
Vendel, J.	Study on Collecting Efficiency of Fission Products by Spray: Experimental Device and Modelling	24-0500

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Vignan, B.	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed Column	21-0259
Vignau, B.	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine Trapping and Off-Gas Characterization Unit	22-0053
Vikis, A. C.	Photochemical Removal of Radioactive Iodine from Air	21-0376
Violet, C.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Vo, T. V.	Value-Impact Assessment for Resolution of Generic Safety Issue 143 - Availability of HVAC and Chilled Water Systems	23-0380
Vogan, T. J.	Overview of Divisions I and II	21-0189
Vujisic, L.	Modern Technology Tools for Improvement of NPP Reliability-Case Study of NPP Filtration Systems Validation	22-0808
Wagoner, J. D.	Progress and Challenges in Cleaning Up Hanford	24-0335
Wainhouse, L.	A Thick Homogeneous Vegetated Cover Design Proves Cost- and Schedule-Effective for the Reclamation of Uranium Mill Sites near Spokane, Washington	24-0118
Walker, B. A.	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP Continuous Air Monitors	24-0188
Walker, B. W.	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator Air Pollution Control Systems	24-0076
Walls, J. R.	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Walls, J. R.	Investigation of Salt Loaded HEPA Filters	21-0366
Wapman, D.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Watson, J. H. P.	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box Cleaning and Increasing HEPA Filter Life	21-0762
Watson, J. H. P.	A Novel Permanently Magnetized High Gradient Magnetic Filter Using Assisted Capture for Fine Particles	23-0158
Weber, F.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Weber, L. D.	Efficiency Test for Ultra High Efficiency Metal Air Filters	22-0882
Weber, L. D.	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Weber, L. D.	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Wehrenberg, J. A.	Heater Selection Criteria for Engineered Safety Features Atmosphere Filtration Systems	22-0820
Weidler, R.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Weidler, R. R.	Design Basis Documentation for the Control Room Ventilation/Chilled Water System at McGuire Nuclear Station	21-0526
Weil, L.	Atmospheric Discharges from Nuclear Facilities during Decommissioning: German Experiences and Concepts	24-0460
Weishaupt, M.	Control of Radio-Iodine at the German Reprocessing Plant Wak During Operation and After Shut Down	24-0618
Wente, W. B.	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Werkheiser, D. P.	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
White, B.	Pool Fires in a Large Scale Ventilation System	21-0844
Whitlock, M. B.	Efficiency Test for Ultra High Efficiency Metal Air Filters	22-0882
Wichmann, H. P.	Measurement System for Alpha and Beta Aerosols with Wide Dynamic Range and Krypton-85 Masking	21-0872
Wikoff, W. O.	Residence Time Determination for Adsorbent Beds of Different Configurations	23-0308
Wikoff, W. O.	Practical Experience Applied to the Design of Injection and Sample Manifolds to Perform In-Place Surveillance Tests According to ANSI/ASME N-510	24-0132
Wikoff, W. O.	Method for HEPA Filter Leak Scanning with Differentiating Aerosol Detector	24-0671
Wilhelm, J. G.	The Phebus FP Integral Source Term Experimental Project with Emphasis on Iodine Selective Filtering	22-0464
Wilhelm, J. G.	Challenges Within Ventilation Systems During Accident Situations	22-0510
Wilhelm, J. G.	The Application of HEPA Filter Units in Gas Streams of High Dust Concentrations	22-0540
Wilhelm, J. G.	Concept for a Passive Heat Removal and Filtration System Under Core Meltdown Conditions	22-0863

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Wilhelm, J. G.	Steps Towards the Minimization of Particulate Emissions From a Low-Level Waste Incineration Facility	21-0510
Wilhelm, J. G.	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused by High Air Humidity	21-0671
Wilhelm, J. G.	Investigtions into the Design of a Filter System for PWR Containment Venting	21-0898
Wilhelm, J. G.	Nuclear Air Cleaning Activities in Germany	21-0981
Wilhelm, J. G.	International Panel Reports on Nuclear Air and Gas Cleaning Activities from Around the World	24-0380
Williams, J. E.	Ventilation System Design for Control of Radioactive Airborne Particulates During the Decontamination and Dismantlement (D&D) of the Plant One Ore Silos	23-0784
Williams, K.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Williams, K.	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Willis, C. A.	Severe Accident Issues for Advanced Reactors	22-0034
Willis, C. A.	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Wilson, K.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Wilson, K.	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Wilson, K.	Performance of HEPA Filters at LLNL Following the 1980 and 1989 Earthquakes	23-0425
Wilson, K.	Degradation of HEPA Filters Exposed to DMSO	23-0695
Wilson, K.	Development of an Air Cleaning System for Dissolving High Explosives from Nuclear War Heads	24-0089
Wilson, K.	In-Place HEPA Filter Efficiency Tests	24-0649
Wilson, K.	Further Development of the Cleanable Steel HEPA Filter and Comparison with Competing Technologies	24-0708
Wilson, P.	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Winegardner, W. K.	Filter-Adsorber Aging Assessment	23-0553

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
INDEX OF PAPERS BY AUTHOR

Author	Title	Conference No. - Page
Wong, A.	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator Air Pollution Control Systems	24-0076
Wong, F. S.	Aerosol Particle Losses in Sampling Systems	22-0310
Wood, G. O.	Single Point Aerosol Sampling: Evaluation of Mixing and Probe Performance in a Nuclear Stack	23-0217
Wright, S. W.	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion Prefilters	24-0788
Xiaochun, Gu	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Yafang, Pang	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Yamashita, M.	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing Under High Temperature Steam Atmosphere	21-0918
Yan, X.	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
Yang, L.	An Introduction to the Design, Commissioning, and Operation of Nuclear Air Cleaning Systems for Qinshan Nuclear Power Plant	23-0439
Yim, M. S.	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
York, J. D.	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Yoshino, H.	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Yotsuya, M.	Development of Computer Design System for HVAC System	22-0781
Zamecnik, J. R.	Measurement of Cesium Emissions During the Vitrification of Simulated High Level Radioactive Waste	22-0253
Zexiang, Liu	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for Iodine Filter	21-0545
Zeyen, R.	The Phebus FP Integral Source Term Experimental Project with Emphasis on Iodine Selective Filtering	22-0464
Ziemer, P. L.	Department of Energy Directions in Environment, Safety, and Health	21-0005

PART III

KWOC INDEX OF AIR CLEANING CONFERENCE TITLES

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
AACS	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
AG-1	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
AG-1	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
AG-1	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
AG-1	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
AG-1	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
ANSI/ASME	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
ANSI/ASME	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510	21-0327
ANSI/ASME	Practical Experience Applied to the Design of Injection and Sample	24-0132
ASME	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
ASME	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
ASME	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
ASME	An Example of a Component Replacement when Applying ASME N509	23-0093
ASME	An Example of a Component Replacement when Applying ASME N509	23-0093
ASME	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
ASME	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
ASME	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
ASME/ANSI	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
ASTM	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
Acceptance	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Acceptance	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Accidents	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Accidents	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Accidents	Criteria for Calculating the Efficiency of HEPA Filters During and After	23-0563
Accuracy	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Activated	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Activated	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Activated	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Activated	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Activated	Effects on the Efficiency of Activated Carbon on Exposure to Welding	23-0639
Activated	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Activities	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY	22-0177
Activities	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Activities	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Activities	Nuclear Air Cleaning Activities in Germany	21-0981
Activities	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Activities	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Activities	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Adaptation	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Adsorbent	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Adsorbent	Residence Time Determination for Adsorbent Beds of Different	23-0308
Adsorbent	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina	24-0563
Adsorbents	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Adsorbents	A Simplified Test Procedure for Determining the Effectiveness of	22-0637
Adsorbents	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Adsorbents	Methyl Iodide Tests on Used Adsorbents	22-0768
Adsorbents	A Study of the Effect of Coatings Operation on Radioiodine Removing	21-0563
Adsorbents	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594
Adsorber	Changes in Adsorber Testing as a Result of NRC Generic Information	21-0607
Adsorber	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Adsorbers	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698
Adsorbers	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Adsorption	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Adsorptive	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Advanced	Severe Accident Issues for Advanced Reactors	22-0034
Advanced	GE's Advanced Nuclear Reactor Designs	22-0043
Advanced	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Aerosol	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Aerosol	Aerosol Particle Losses in Sampling Systems	22-0310
Aerosol	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Aerosol	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Aerosol	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Aerosol	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Aerosol	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Aerosol	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Aerosol	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Aerosol	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Aerosol	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Aerosol	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Aerosol	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Aerosol	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Aerosol	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Aerosol	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Aerosol	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Aerosol	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
Aerosol	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Aerosols	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Aerosols	Characteristics of Laskin Nozzle Generated Aerosols	21-0116

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Aerosols	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
Aerosols	Experimental Study of Elementary Collection Efficiency of Aerosols by	23-0682
Aerosols	Keynote Address: Nuclear Aerosols: Unfinished Business	24-0005
Aged	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Aging	Filter-Adsorber Aging Assessment	23-0553
Air	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Air	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Air	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Air	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Air	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Air	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
Air	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Air	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Air	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Air	Efficiency Test for Ultra High Efficiency Metal Air Filters	22-0882
Air	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Air	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Air	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Air	Air Cleaning Technologies for the Management and Disposal of	21-0028
Air	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Air	Photochemical Removal of Radioactive Iodine from Air	21-0376
Air	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Air	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Air	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Air	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Air	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Air	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Air	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Air	Nuclear Air Cleaning Program in USA	21-0969
Air	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Air	Nuclear Air Cleaning Programs in Progress in France	21-0978
Air	Nuclear Air Cleaning Activities in Germany	21-0981
Air	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Air	Nuclear Air Cleaning Programs in Hungary	21-0986
Air	A Brief History of the Air Cleaning Conferences	23-0003
Air	Radionuclide Air Emissions at Department of Energy Facilities	23-0233
Air	Application of Nuclear Air Cleaning and Treatment Codes	23-0297
Air	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Air	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Air	Clean Air and Clear Responsibility	23-0658
Air	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Air	Air Cleaning Issues with Contaminated Sites	24-0012
Air	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Air	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Air	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Air	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Air	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Air	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Air	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Air	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Air	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Air	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Air	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
Air/Gas	New Challenges to Air/Gas Cleaning Systems	24-0033
Airborne	Global Change and the Practice for Airborne Waste Treatment	22-0004
Airborne	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Airborne	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Airflow	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Airflow	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Alkyl	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Alpha	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
Alpha	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Alpha-Emitting	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Alternatives	Alternatives to Current Procedures Used to Estimate Concentrations in	21-0714
Alumina	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Alumina	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina	24-0563
Analysis	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Analysis	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Analysis	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Analysis	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Analysis	AP600 Containment Purge Radiological Analysis	23-0454
Analysis	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Analysis	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Analyzer	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Annulus	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
Applicability	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Area	Developments in the Area of Regulatory Matters in the UK	21-0977
Area	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Army-Approved	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Assessment	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Assessment	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Assessment	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Assessment	Filter-Adsorber Aging Assessment	23-0553
Assist	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Assisted	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Assurance	Quality Assurance Requirements for NESHAPS Compliance	21-0352
Atmosphere	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Atmosphere	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Atmospheres	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
Atmospheric	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Atomic	United Kingdom Atomic Energy Authority Programs	21-0975
Audit	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Audit	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Authority	United Kingdom Atomic Energy Authority Programs	21-0975
Automatic	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
BARCT	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
BWR	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Balance	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Banks	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Bar-Coded	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Bed	Design and Full Scale Test of a Sand Bed Filter	21-0946
Beds	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Beds	Residence Time Determination for Adsorbent Beds of Different	23-0308
Behavior	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Behavior	Iodine and NO _x Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Behavior	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Behavior	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Behavior	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
Behavior	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Behavior	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Behaviour	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Belgian	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Bends	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Beta	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Beta	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
Bubble-Tight	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Building	Alternatives to Current Procedures Used to Estimate Concentrations in	21-0714
CAIRE	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
CAM	Performance Characterization of a New CAM System	22-0299
CFR	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
CFR	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Calcining	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Canada	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Canadian	Canadian Waste Management Program	21-0042
Candu	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Canisters	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Capture	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Carbon	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Carbon	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Carbon	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Carbon	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated	21-0583
Carbon	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Carbon	Effects on the Efficiency of Activated Carbon on Exposure to Welding	23-0639
Carbon	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Carbon-14	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Carbons	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Certitest	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Cesium	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Challenges	Challenges Within Ventilation Systems During Accident Situations	22-0510
Challenges	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Challenges	New Challenges to Air/Gas Cleaning Systems	24-0033
Challenges	Progress and Challenges in Cleaning Up Hanford	24-0335
Characterization	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Characterization	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Characterization	Performance Characterization of a New CAM System	22-0299
Characterization	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Charcoal	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Charcoal	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Charcoal	Charcoal Filter Testing	24-0395
Chemical	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Chemical	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Chemical	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Chernobyl	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Chilled	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Chronic	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Class	Challenges of Equipment Qualification Using Today's Standards with	23-0034

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Clean	Clean Air and Clear Responsibility	23-0658
Cleanable	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Cleanable	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
Cleanable/Reusable	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Cleaning	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Cleaning	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Cleaning	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Cleaning	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Cleaning	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Cleaning	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Cleaning	Air Cleaning Technologies for the Management and Disposal of	21-0028
Cleaning	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Cleaning	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Cleaning	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Cleaning	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Cleaning	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Cleaning	Nuclear Air Cleaning Program in USA	21-0969
Cleaning	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Cleaning	Nuclear Air Cleaning Programs in Progress in France	21-0978
Cleaning	Nuclear Air Cleaning Activities in Germany	21-0981
Cleaning	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Cleaning	Nuclear Air Cleaning Programs in Hungary	21-0986
Cleaning	A Brief History of the Air Cleaning Conferences	23-0003
Cleaning	Application of Nuclear Air Cleaning and Treatment Codes	23-0297
Cleaning	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Cleaning	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Cleaning	Air Cleaning Issues with Contaminated Sites	24-0012
Cleaning	New Challenges to Air/Gas Cleaning Systems	24-0033
Cleaning	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Cleaning	Progress and Challenges in Cleaning Up Hanford	24-0335
Cleaning	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Cleaning	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Cleaning	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788
Clear	Clean Air and Clear Responsibility	23-0658
Clogging	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Close	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Coadsorption	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Coatings	A Study of the Effect of Coatings Operation on Radioiodine Removing	21-0563
Code	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Code	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
Code	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Code	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Code	Calculation Code Evaluating the Confinement of a Nuclear Facility in	23-0412
Code	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Code	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Code	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Coded	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Codes	Codes in Use	22-0493
Codes	European Community Nuclear Codes and Standards	21-0212
Codes	Integrating Industry Nuclear Codes and Standards into United States	23-0098
Codes	Application of Nuclear Air Cleaning and Treatment Codes	23-0297
Collecting	Study on Collecting Efficiency of Fission Products by Spray:	24-0500

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Collection	Experimental Study of Elementary Collection Efficiency of Aerosols by	23-0682
Column	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Column	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Commercial	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Commissioning	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Community	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Community	European Community Nuclear Codes and Standards	21-0212
Compartments	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
Competing	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
Compliance	Quality Assurance Requirements for NESHAPS Compliance	21-0352
Compliance	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Component	An Example of a Component Replacement when Applying ASME N509	23-0093
Component	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Computer	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Computer	Development of Computer Design System for HVAC System	22-0781
Computer	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Computer	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Computer	Filtration Theory Using Computer Simulations	24-0485
Concentrations	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Concentrations	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Concentrations	Alternatives to Current Procedures Used to Estimate Concentrations in	21-0714
Conditioning	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Conditioning	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Conditioning	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Conference	Welcome and Objectives of the Conference	22-0003
Conference	Welcome and Objectives of the Conference	21-0002

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Conferences	A Brief History of the Air Cleaning Conferences	23-0003
Configuration	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Configurations	Residence Time Determination for Adsorbent Beds of Different	23-0308
Confinement	Calculation Code Evaluating the Confinement of a Nuclear Facility in	23-0412
Confirmation	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Conservative	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Containment	Effect of Filtering at Containment Venting on the Consequences for the	22-0753
Containment	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
Containment	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Containment	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Containment	Investigations into the Design of a Filter System for PWR Containment	21-0898
Containment	AP600 Containment Purge Radiological Analysis	23-0454
Containment	A Low Pressure Filter System for New Containment Concepts	23-0478
Containments	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Contaminated	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Contaminated	Air Cleaning Issues with Contaminated Sites	24-0012
Contamination	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Control	Revised Accident Source Terms and Control Room Habitability	22-0742
Control	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Control	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Control	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Control	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Control	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Control	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Control	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Control	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Control	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Control	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Control	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Controlling	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Controlling	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Controls	Instrument & Controls Section (IA) Improvements	22-0490
Convection	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Cooling	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
Cooling	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Core	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
Corona	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Correlation	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Cost	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Costs	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Countries	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Couple	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Cover	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Criteria	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Criteria	Criteria for Calculating the Efficiency of HEPA Filters During and After	23-0563
Cyclic	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
D&D	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
D3803-89	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
DI-PAS	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
DMSO	Degradation of HEPA Filters Exposed to DMSO	23-0695
DOP	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
DOP	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
DOP	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
DOP	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
DOP	Comparison of Emery 3004 and 3006 Characteristics with DOP for	23-0758
Damage	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Dampers	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Deactivation	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Decadal	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Decommissioning	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Decontamination	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Decontamination	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Deep	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
Degradation	Degradation of HEPA Filters Exposed to DMSO	23-0695
Demilitarization	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Demonstration	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Demonstration	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Deposition	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Deposition	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Depression	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Design	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Design	Development of Computer Design System for HVAC System	22-0781
Design	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
Design	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Design	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Design	Investigations into the Design of a Filter System for PWR Containment	21-0898
Design	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Design	Design and Full Scale Test of a Sand Bed Filter	21-0946

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Design	The Development and Design of the Off-Gas Treatment System for the	23-0333
Design	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Design	Criteria for Calculating the Efficiency of HEPA Filters During and After	23-0563
Design	Experimental Study of Elementary Collection Efficiency of Aerosols by	23-0682
Design	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Design	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Design	Practical Experience Applied to the Design of Injection and Sample	24-0132
Designs	GE's Advanced Nuclear Reactor Designs	22-0043
Detection	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Detection	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Detection	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Detection	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Detector	Development of Real Time Detector for Fluorescent Particles	24-0163
Detector	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
Device	Experimental Study of Elementary Collection Efficiency of Aerosols by	23-0682
Device	Study on Collecting Efficiency of Fission Products by Spray:	24-0500
Diamines	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Difference	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Differentiating	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
Difficulty	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
Diffusional	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Directions	Department of Energy Directions in Environment, Safety, and Health	21-0005
Discharge	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Discharges	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Dismantlement	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Disposal	Air Cleaning Technologies for the Management and Disposal of	21-0028

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Disposal	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Disposal	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Dissolution	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Dissolution	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Dissolver	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Dissolver	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Dissolver	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Dissolving	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Distribution	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Division	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Divisions	Overview of Divisions I and II	21-0189
Documentation	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Dose	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Dose	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Dose	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Draft	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Draft	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Draft	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Droplets	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Droplets	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Drum	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Duct	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Ducts	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Ducts	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Ductwork	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Ductwork	Ductwork Section (SA) Improvements	22-0488

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Dust	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Dust	The Dust Holding Capacity of HEPA Filters	21-0155
Dust	The Development of a HEPA Filter with Improved Dust Holding	23-0176
Dust	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
Dutch	The Dutch Nuclear Programs	21-0968
EPA	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Earthquakes	Performance of HEPA Filters at LLNL Following the 1980 and 1989	23-0425
Editions	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
Effectiveness	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Effectiveness	A Simplified Test Procedure for Determining the Effectiveness of	22-0637
Effectiveness	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Effluent	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Effluents	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Elevated	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
Elimination	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Emergency	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Emery	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Emery	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Emery	Comparison of Emery 3004 and 3006 Characteristics with DOP for	23-0758
Emissions	Tritium Emissions Reduction Facility (TERF)	22-0065
Emissions	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Emissions	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Emissions	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Emissions	Radionuclide Air Emissions at Department of Energy Facilities	23-0233
Emissions	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Emissions	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Emphasis	The Phebus FP Integral Source Term Experimental Project with	22-0464
Emphasis	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Engineered	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Engineered	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Envelope	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Environment	Effect of Filtering at Containment Venting on the Consequences for the	22-0753
Environment	Department of Energy Directions in Environment, Safety, and Health	21-0005
Environment	Changing Winds in NRC's Regulatory Environment	21-0343
Equipment	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Equipment	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Estimate	Alternatives to Current Procedures Used to Estimate Concentrations in	21-0714
European	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
European	European Community Nuclear Codes and Standards	21-0212
European	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
European	Performance Testing of HEPA Filters: Progress Towards a European	24-0819
Evaporation	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Event	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Event	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Evolutionary	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Exchanged	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Exclusion	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788
Exhaust	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Experience	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Experience	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Experience	Practical Experience Applied to the Design of Injection and Sample	24-0132
Experiences	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Experiences	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Experiences	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Expertise	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Explosives	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Expulsion	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Exposed	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Exposed	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Exposed	Degradation of HEPA Filters Exposed to DMSO	23-0695
Exposure	Effects on the Efficiency of Activated Carbon on Exposure to Welding	23-0639
Expulsion	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Extended-Life	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788
FBR	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
FP	The Phebus FP Integral Source Term Experimental Project with	22-0464
Face	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Facilities	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Facilities	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Facilities	HEPA Filter Testing - Department of Energy Office of Nuclear Energy	23-0087
Facilities	Integrating Industry Nuclear Codes and Standards into United States	23-0098
Facilities	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Facilities	Radionuclide Air Emissions at Department of Energy Facilities	23-0233
Facilities	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Facilities	Gas Processing at DOE Nuclear Facilities	23-0301
Facilities	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Facilities	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
Facilities	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Facility	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Facility	Tritium Emissions Reduction Facility (TERF)	22-0065
Facility	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Facility	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Facility	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Facility	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Facility	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Facility	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Facility	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Facility	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Facility	Calculation Code Evaluating the Confinement of a Nuclear Facility in	23-0412
Fall-Out	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Fan	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Feedback	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Fiber	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Fibers	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Fibers	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Field	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Field	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Field	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Field	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Field	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Filed	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Filter	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Filter	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
Filter	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY	22-0177
Filter	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Filter	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Filter	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Filter	The Effects of Temperature on HEPA Filter Media	22-0327
Filter	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Filter	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Filter	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Filter	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Filter	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Filter	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
Filter	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Filter	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Filter	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
Filter	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Filter	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Filter	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Filter	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Filter	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Filter	Type II HEPA Filter	21-0410
Filter	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Filter	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Filter	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Filter	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Filter	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Filter	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Filter	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
Filter	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Filter	Investigations into the Design of a Filter System for PWR Containment	21-0898
Filter	Design and Full Scale Test of a Sand Bed Filter	21-0946
Filter	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Filter	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Filter	Evaluation of Self-Contained HEPA Filter	23-0054
Filter	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
Filter	HEPA Filter Testing - Department of Energy Office of Nuclear Energy	23-0087
Filter	HEPA Filter Concerns - An Overview	23-0150
Filter	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Filter	The Development of a HEPA Filter with Improved Dust Holding	23-0176
Filter	Effect of Humidity on the Filter Pressure Drop	23-0187
Filter	A Low Pressure Filter System for New Containment Concepts	23-0478
Filter	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Filter	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Filter	Comparison of Emery 3004 and 3006 Characteristics with DOP for	23-0758
Filter	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
Filter	Standardized Methods for In-Place Filter Testing	24-0386
Filter	Charcoal Filter Testing	24-0395
Filter	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Filter	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Filter	In-Place HEPA Filter Efficiency Tests	24-0649
Filter	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
Filter	Uncertainty In-Place Filter Test Results	24-0676
Filter	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Filter	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
Filter	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Filter	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Filter-Adsorber	Filter-Adsorber Aging Assessment	23-0553
Filtered	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Filtering	Effect of Filtering at Containment Venting on the Consequences for the	22-0753
Filtering	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Filtering	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Filtering	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Filtering	The Phebus FP Integral Source Term Experimental Project with	22-0464
Filters	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
Filters	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Filters	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Filters	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Filters	Efficiency Test for Ultra High Efficiency Metal Air Filters	22-0882
Filters	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Filters	The Dust Holding Capacity of HEPA Filters	21-0155
Filters	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Filters	Investigation of Salt Loaded HEPA Filters	21-0366
Filters	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Filters	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
Filters	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Filters	Performance of HEPA Filters at LLNL Following the 1980 and 1989	23-0425
Filters	Criteria for Calculating the Efficiency of HEPA Filters During and After	23-0563
Filters	Performance of HEPA Filters Under Hot Dynamic Conditions	23-0601
Filters	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Filters	Degradation of HEPA Filters Exposed to DMSO	23-0695
Filters	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Filters	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
Filters	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788
Filters	Performance Testing of HEPA Filters: Progress Towards a European	24-0819
Filters	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Filtration	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Filtration	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Filtration	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Filtration	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
Filtration	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Filtration	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Filtration	Filtration Theory Using Computer Simulations	24-0485
Fire	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Fire	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Fires	Pool Fires in a Large Scale Ventilation System	21-0844
Fires	Calculation Code Evaluating the Confinement of a Nuclear Facility in	23-0412
Fission	Study on Collecting Efficiency of Fission Products by Spray:	24-0500
Flow	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Flow	Radial Flow Systems for the Nuclear Industry	22-0527
Flow	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Flow	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Flow	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Flow	Aerosol Deposition In Bends with Turbulent Flow	24-0441
Fluorescent	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Fluorescent	Development of Real Time Detector for Fluorescent Particles	24-0163
Forms	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594
Fractions	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
France	Nuclear Air Cleaning Programs in Progress in France	21-0978
Fuel	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Fuel	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Fuels	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Fumes	Effects on the Efficiency of Activated Carbon on Exposure to Welding	23-0639
Fumes	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Function	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Function	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Future	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Future	DOE Waste Management Program-Current and Future	22-0716
GE's	GE's Advanced Nuclear Reactor Designs	22-0043
Gamma	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Gas	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Gas	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
Gas	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Gas	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Gas	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Gas	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Gas	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Gas	Gas Processing in the Nuclear Industry	23-0294
Gas	Gas Processing at DOE Nuclear Facilities	23-0301
Gas	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Gas	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Gas	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Gas	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
Gaseous	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Gaseous	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Gaseous	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Gaseous	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Gases	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Gases	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Gases	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Generated	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
Generating	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Generating	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Generation	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Generation	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Generation	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Generator	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Generic	Changes in Adsorber Testing as a Result of NRC Generic Information	21-0607
Generic	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
German	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
German	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Germany	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Germany	Nuclear Air Cleaning Activities in Germany	21-0981
Glass-Paper	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Global	Global Change and the Practice for Airborne Waste Treatment	22-0004
Glove-Box	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Glovebox	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Grade	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Gradient	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Gradient	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Guidance	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Guide	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
HEPA	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY	22-0177
HEPA	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
HEPA	The Effects of Temperature on HEPA Filter Media	22-0327
HEPA	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
HEPA	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
HEPA	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
HEPA	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
HEPA	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
HEPA	The Dust Holding Capacity of HEPA Filters	21-0155
HEPA	Investigation of Salt Loaded HEPA Filters	21-0366
HEPA	Type II HEPA Filter	21-0410
HEPA	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
HEPA	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
HEPA	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
HEPA	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
HEPA	Aerosol Penetration Inside HEPA Filtration Media	21-0799
HEPA	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
HEPA	Evaluation of Self-Contained HEPA Filter	23-0054
HEPA	HEPA Filter Testing - Department of Energy Office of Nuclear Energy	23-0087
HEPA	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
HEPA	HEPA Filter Concerns - An Overview	23-0150
HEPA	The Development of a HEPA Filter with Improved Dust Holding	23-0176
HEPA	Performance of HEPA Filters at LLNL Following the 1980 and 1989	23-0425
HEPA	Criteria for Calculating the Efficiency of HEPA Filters During and After	23-0563

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
HEPA	Performance of HEPA Filters Under Hot Dynamic Conditions	23-0601
HEPA	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
HEPA	Degradation of HEPA Filters Exposed to DMSO	23-0695
HEPA	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
HEPA	Comparison of Emery 3004 and 3006 Characteristics with DOP for	23-0758
HEPA	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
HEPA	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
HEPA	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
HEPA	In-Place HEPA Filter Efficiency Tests	24-0649
HEPA	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
HEPA	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
HEPA	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
HEPA	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
HEPA	Performance Testing of HEPA Filters: Progress Towards a European	24-0819
HEPA	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
HEPA-Filter	The Case for Improved HEPA-Filter Mechanical Performance Standards	24-0829
HLLW	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
HVAC	Development of Computer Design System for HVAC System	22-0781
HVAC	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
HVAC	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Habitability	Revised Accident Source Terms and Control Room Habitability	22-0742
Halide	Halide Test Agent Replacement Study	23-0313
Halide	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Hanford	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Hanford	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Hanford	Progress and Challenges in Cleaning Up Hanford	24-0335

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Heads	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Health	Department of Energy Directions in Environment, Safety, and Health	21-0005
Health	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Heat	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Heat	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
Heater	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Heating	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Heating	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Heating	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
High-Efficiency	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
History	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
History	A Brief History of the Air Cleaning Conferences	23-0003
Homogeneous	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Hot	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Housing	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Housings	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Housings	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Humidity	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Humidity	Effect of Humidity on the Filter Pressure Drop	23-0187
Hungary	Nuclear Air Cleaning Programs in Hungary	21-0986
Hydro's	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Hydrogen	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
IA	Instrument & Controls Section (IA) Improvements	22-0490
IAEA	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
IATEMA	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Idaho	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Impact	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Impact	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Impacts	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Implications	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Impregnant	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Impregnated	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Impregnated	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Impregnated	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594
Impregnated	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Impregnated	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Impurities	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina	24-0563
In-Place	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698
In-Place	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
In-Place	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
In-Place	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
In-Place	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
In-Place	Practical Experience Applied to the Design of Injection and Sample	24-0132
In-Place	Standardized Methods for In-Place Filter Testing	24-0386
In-Place	In-Place HEPA Filter Efficiency Tests	24-0649
In-Place	Uncertainty In-Place Filter Test Results	24-0676
In-Service	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
In-Situ	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
In-Situ	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
Incineration	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Incineration	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Incinerator	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Industry's	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Information	Changes in Adsorber Testing as a Result of NRC Generic Information	21-0607
Inhalation	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Injection	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Injection	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
Injection	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Injection	Practical Experience Applied to the Design of Injection and Sample	24-0132
Injector	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
Inleakage	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Inleakage	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Innovative	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Instrument	Instrument & Controls Section (IA) Improvements	22-0490
Integral	The Phebus FP Integral Source Term Experimental Project with	22-0464
Integrated	Iodine and NO _x Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Integrated	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Integrating	Integrating Industry Nuclear Codes and Standards into United States	23-0098
Integration	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Interaction	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
International	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Interrelationships	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
Introductory	Introductory Remarks	22-0731a
Introductory	Introductory Statement	21-0186
Investigations	Investigations into the Design of a Filter System for PWR Containment	21-0898
Iodide	A Simplified Test Procedure for Determining the Effectiveness of	22-0637
Iodide	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
Iodide	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Iodide	Methyl Iodide Tests on Used Adsorbents	22-0768
Iodide	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated	21-0583
Iodide	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Iodide	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Iodide-Impregnated	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated	21-0583
Iodides	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Iodine	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Iodine	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Iodine	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Iodine	The Phebus FP Integral Source Term Experimental Project with	22-0464
Iodine	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
Iodine	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Iodine	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Iodine	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Iodine	Iodine and NO _x Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Iodine	Photochemical Removal of Radioactive Iodine from Air	21-0376
Iodine	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Iodine	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594
Iodine	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Iodine	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Iodine	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Iodine	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Iodine	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina	24-0563
Iodine	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Iodine-129	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Iodine-129	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Iodine-129	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Iodine-129	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Iodox	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodox Systems in	21-0271
Japanese	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
KR-85	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Karlsruhe	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Karlsruhe	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Karlsruhe	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Karlsruhe	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Keynote	Keynote Address: Nuclear Aerosols: Unfinished Business	24-0005
Kinetic	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Korea	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Krypton-85	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
LFCM	LFCM Processing Characteristics of Mercury	21-0442
LLNL	Performance of HEPA Filters at LLNL Following the 1980 and 1989	23-0425
LLW	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Laboratory	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodox Systems in	21-0271
Laboratory	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Laboratory	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Lack	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Laser	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Laskin	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Laskin	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
Lawrence	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Leak	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698
Leak	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Leak	Comparison of Emery 3004 and 3006 Characteristics with DOP for	23-0758
Leak	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Leak	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671
Leakage	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Licensee	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Licensing	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
Life	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Life	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Life-Cycle	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Light	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Light-Water	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Light-Water	Revised Accident Source Terms for Light-Water Reactors	23-0488
Lines	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Link	The Link Between Off-Site-Emergency Planning and Plant-Internal	23-0509
Liquid	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Livermore	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Loaded	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Loaded	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Loaded	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Loaded	Investigation of Salt Loaded HEPA Filters	21-0366
Loading	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Loading	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Loading	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
Losses	Aerosol Particle Losses in Sampling Systems	22-0310
Low-Level	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Low-Resolution	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
MONJU	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
MPPS	A General Correlation of MPPS Penetration as a Function of Face	24-0698
MWL	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Machines	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
Machines	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Magnetic	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Magnetic	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Magnetized	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Magnetized	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Man-Made	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Management	DOE Waste Management Program-Current and Future	22-0716
Management	Air Cleaning Technologies for the Management and Disposal of	21-0028
Management	Canadian Waste Management Program	21-0042
Management	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Management	The Link Between Off-Site-Emergency Planning and Plant-Internal	23-0509
Manifolds	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Manifolds	Practical Experience Applied to the Design of Injection and Sample	24-0132
Marcoule	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Mask	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Masking	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
Mass	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Mass	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
Material	New Type Adsorbent Material of Impregnated Activated Carbon Fibers for	21-0545
Material	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
Materials	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Materials	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Materials	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Materials	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Materials	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Mathematical	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Matters	Developments in the Area of Regulatory Matters in the UK	21-0977
McGuire	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
McGuire	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
McGuire	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Measurement	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Measurement	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Measurement	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Measurement	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
Measurements	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Measurements	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Media	The Effects of Temperature on HEPA Filter Media	22-0327
Media	Efficiency and Mass Loading Characteristics of a Typical HEPA Filter	21-0782
Media	Aerosol Penetration Inside HEPA Filtration Media	21-0799
Media	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
Medium	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Melt-Concrete	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Meltdown	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
Melter	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Mercury	LFCM Processing Characteristics of Mercury	21-0442
Metal	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Metal	Efficiency Test for Ultra High Efficiency Metal Air Filters	22-0882
Methodology	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Methyl	A Simplified Test Procedure for Determining the Effectiveness of	22-0637
Methyl	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
Methyl	Methyl Iodide Tests on Used Adsorbents	22-0768
Methyl	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated	21-0583
Methyl	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Methyl	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Minimization	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Minimizing	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Mitigation	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Mixed	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Mixing	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Mixing	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Model	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Modelling	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Modelling	Study on Collecting Efficiency of Fission Products by Spray:	24-0500
Models	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Models	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Modern	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Monitor	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Monitor	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Monitoring	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Monitors	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Mordenite	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Motor	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Multi-Point	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
N509	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
N509	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510	21-0327
N509	An Example of a Component Replacement when Applying ASME N509	23-0093
N510	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
N510	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
N510	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510	21-0327
N510	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
N510	An Example of a Component Replacement when Applying ASME N509	23-0093
N510	Practical Experience Applied to the Design of Injection and Sample	24-0132
N511-19xx	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
NATS	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698
NAUAHYGROS	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
NESHAPS	Quality Assurance Requirements for NESHAPS Compliance	21-0352
NOx	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
NPP	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
NPP	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
NRC	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
NRC	Changes in Adsorber Testing as a Result of NRC Generic Information	21-0607
NRC	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
NRC's	Changing Winds in NRC's Regulatory Environment	21-0343
NRC's	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
NUREG	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
National	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
National	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Network	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Nevada	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Nitric	Iodine Stripping from Nitric Solutions in IATEMA	22-0091

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Noble-Gas	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Non-509	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
Non-ANSI/ASME	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510	21-0327
Non-N509	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Non-N509	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Non-Reactor	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Notes	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Novel	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Novel	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Nozzle	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Nozzle	Characteristics of Laskin Nozzle Generated Aerosols	21-0116
Nuclear	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Nuclear	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Nuclear	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Nuclear	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Nuclear	GE's Advanced Nuclear Reactor Designs	22-0043
Nuclear	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Nuclear	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Nuclear	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
Nuclear	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Nuclear	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Nuclear	Code on Nuclear Air and Gas Treatment ASME/ANSI AG-1	22-0485
Nuclear	Filter Sections of ASME AG-1, Code on Nuclear Air and Gas Treatment	22-0491
Nuclear	Radial Flow Systems for the Nuclear Industry	22-0527
Nuclear	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Nuclear	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Nuclear	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Nuclear	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Nuclear	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Nuclear	European Community Nuclear Codes and Standards	21-0212
Nuclear	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Nuclear	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Nuclear	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Nuclear	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Nuclear	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Nuclear	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Nuclear	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Nuclear	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Nuclear	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Nuclear	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Nuclear	The Dutch Nuclear Programs	21-0968
Nuclear	Nuclear Air Cleaning Program in USA	21-0969
Nuclear	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Nuclear	Nuclear Air Cleaning Programs in Progress in France	21-0978
Nuclear	Nuclear Air Cleaning Activities in Germany	21-0981
Nuclear	Nuclear Air Cleaning Programs in Hungary	21-0986
Nuclear	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
Nuclear	HEPA Filter Testing - Department of Energy Office of Nuclear Energy	23-0087
Nuclear	Integrating Industry Nuclear Codes and Standards into United States	23-0098
Nuclear	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Nuclear	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Nuclear	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Nuclear	Gas Processing in the Nuclear Industry	23-0294
Nuclear	Application of Nuclear Air Cleaning and Treatment Codes	23-0297
Nuclear	Gas Processing at DOE Nuclear Facilities	23-0301
Nuclear	Calculation Code Evaluating the Confinement of a Nuclear Facility in	23-0412
Nuclear	The Actual Practice of Air Cleaning in Belgian Nuclear Facilities	23-0432
Nuclear	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Nuclear	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Nuclear	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Nuclear	Keynote Address: Nuclear Aerosols: Unfinished Business	24-0005
Nuclear	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Nuclear	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Nuclear	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Nuclear	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Nuclear	Atmospheric Discharges from Nuclear Facilities during Decommissioning:	24-0460
Nuclear	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
Nuclear	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Nuclear	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Nuclear	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788
Nuclear	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
Numerical	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Oak	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Objectives	Welcome and Objectives of the Conference	22-0003
Objectives	Welcome and Objectives of the Conference	21-0002
Off-Gas	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Off-Gas	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Off-Gas	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Off-Gas	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Off-Gas	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Off-Gas	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Off-Gas	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodox Systems in	21-0271
Off-Gas	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Off-Gas	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Off-Gas	The Development and Design of the Off-Gas Treatment System for the	23-0333
Off-Gas	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Off-Gases	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Off-Gases	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Off-Site-Emergency	The Link Between Off-Site-Emergency Planning and Plant-Internal	23-0509
Offgas	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Office	HEPA Filter Testing - Department of Energy Office of Nuclear Energy	23-0087
Older	An Example of a Component Replacement when Applying ASME N509	23-0093
Ontario	Experience with Ontario Hydro's In Place Carbon Filter Testing	22-0672
Open-Market	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Operation	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Operation	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Operation	A Study of the Effect of Coatings Operation on Radioiodine Removing	21-0563
Operation	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Operation	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Optimization	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Orders	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Ore	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Organic	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594
Organoiodine	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Overview	A Short Overview of the Programs in Sweden	21-0980
Overview	Overview of Divisions I and II	21-0189
Overview	HEPA Filter Concerns - An Overview	23-0150
Oxide	The Development and Design of the Off-Gas Treatment System for the	23-0333
PWR	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
PWR	Investigations into the Design of a Filter System for PWR Containment	21-0898
Packed	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Painting	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Panel	International Panel Reports on Nuclear Air and Gas Cleaning Activities	24-0380
Panel	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Parametric	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
Particle	Aerosol Particle Losses in Sampling Systems	22-0310
Particle	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Particle	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Particles	Continuous Air Monitor for Alpha-Emitting Aerosol Particles	21-0859
Particles	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Particles	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Particles	Development of Real Time Detector for Fluorescent Particles	24-0163
Particulate	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Particulates	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Passive	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Passive	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
Pattern	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Penetration	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Penetration	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Penetration	Aerosol Penetration Inside HEPA Filtration Media	21-0799

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Penetration	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Penetration	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Penetrometer	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Perceived	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Perforated	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Performances	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Periodic	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Permanently	A Permanently Magnetized High Gradient Magnetic Filter for Glove-Box	21-0762
Permanently	A Novel Permanently Magnetized High Gradient Magnetic Filter Using	23-0158
Personal	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Perspective	A Utility Perspective on New Source Terms	22-0732
Perspective	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Phase	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Phebus	The Phebus FP Integral Source Term Experimental Project with	22-0464
Photochemical	Photochemical Removal of Radioactive Iodine from Air	21-0376
Photometric	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Pilot	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Planning	The Link Between Off-Site-Emergency Planning and Plant-Internal	23-0509
Plant	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Plant	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Plant	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Plant	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Plant	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Plant	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Plant	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Plant	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Plant	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Plant	The Development and Design of the Off-Gas Treatment System for the	23-0333
Plant	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Plant	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Plant	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Plant	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Plant	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Plant	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Plant	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Plant-Internal	The Link Between Off-Site-Emergency Planning and Plant-Internal	23-0509
Plants	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Plants	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Plants	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
Plants	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Plants	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
Plants	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Plate	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Pleat	The Effect of Media Area on the Dust Holding Capacity of Deep Pleat	24-0743
Plenum	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Plenums	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Plenums	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Policies	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Pollution	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Polygonal	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Polygonal	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Pool	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Pool	Pool Fires in a Large Scale Ventilation System	21-0844
Pool	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Portable	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Post-Accident	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
Post-Accident	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Potential	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Potential	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Potential	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Potential	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Power	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Power	The Nuclear Industry's Plan to Achieve New Nuclear Power Plant Orders	22-0018
Power	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
Power	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Power	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Power	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Power	An Evaluation of Efforts by Nuclear Power Plants to Use ASTM D3803-89	23-0078
Power	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Power	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Power	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Power	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Predict	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Predicting	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Prefilter	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Prefilter/HEPA	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Prefilters	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Prefilters	Extended-Life Nuclear Air Cleaning Filters Via Dynamic Exclusion	24-0788

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Preliminary	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Preliminary	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Pressure	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Pressure	Mathematical Models for Changes in HEPA Filter Pressure Drop Caused	21-0671
Pressure	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Pressure	Effects of the Particle Penetration Inside the Filter Medium on the HEPA	21-0128
Pressure	Effect of Humidity on the Filter Pressure Drop	23-0187
Pressure	A Low Pressure Filter System for New Containment Concepts	23-0478
Pressure	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Pretreatment	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Probe	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Produced	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Products	Study on Collecting Efficiency of Fission Products by Spray:	24-0500
Program-Current	DOE Waste Management Program-Current and Future	22-0716
Programs	High Efficiency and Ultra Low Penetration Aerosol Filter Test Programs by	22-0324
Programs	The Dutch Nuclear Programs	21-0968
Programs	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Programs	United Kingdom Atomic Energy Authority Programs	21-0975
Programs	Nuclear Air Cleaning Programs in Progress in France	21-0978
Programs	A Short Overview of the Programs in Sweden	21-0980
Programs	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Programs	Nuclear Air Cleaning Programs in Hungary	21-0986
Progress	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Progress	Nuclear Air Cleaning Programs in Progress in France	21-0978
Progress	Progress and Challenges in Cleaning Up Hanford	24-0335
Progress	Performance Testing of HEPA Filters: Progress Towards a European	24-0819

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Project	The Phebus FP Integral Source Term Experimental Project with	22-0464
Project	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Projection	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Protection	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Protection	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875
Protocols	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Prototype	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
Pulse	Accuracy Improvement in Leak Detection of Charcoal Adsorbers by	24-0176
Pulses	A New Method for In-Situ Filter Testing Using Pulses of Aerosol and	22-0154
Purex	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Purge	AP600 Containment Purge Radiological Analysis	23-0454
Purging	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Qinshan	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Qualification	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Quality	Quality Assurance Requirements for NESHAPS Compliance	21-0352
Quickmix	Development of the Quickmix Injector for In-Situ Filter Testing	22-0163
R&D	Nuclear Air Cleaning R&D Programs in Canada	21-0971
Radial	Radial Flow Systems for the Nuclear Industry	22-0527
Radiation	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Radiation	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Radioactive	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Radioactive	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Radioactive	Parametric Studies of Radioactive Iodine, Hydrogen Iodide and Methyl	22-0646
Radioactive	Air Cleaning Technologies for the Management and Disposal of	21-0028
Radioactive	Elimination of Iodine from Radioactive Gaseous Effluents in a Packed	21-0259
Radioactive	Photochemical Removal of Radioactive Iodine from Air	21-0376

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE
 21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
 KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Radioactive	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Radioactive	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635
Radioactive	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Radioactive	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Radioactive	Numerical Analysis of a Natural Convection Cooling System for	23-0128
Radioactive	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Radioactive	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Radioactive	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Radioactive	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Radioactive	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Radioactive	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Radioactivity	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Radioactivity	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Radioiodine	A Study of the Effect of Coatings Operation on Radioiodine Removing	21-0563
Radioiodine	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Radioiodine	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Radiological	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Radiological	AP600 Containment Purge Radiological Analysis	23-0454
Radionuclide	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Radionuclide	Radionuclide Air Emissions at Department of Energy Facilities	23-0233
Radionuclide	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Radionuclide	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Radionuclide	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Radionuclide	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Reactor	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Reactor	GE's Advanced Nuclear Reactor Designs	22-0043

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Reactor	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Reactor	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Reactors	Severe Accident Issues for Advanced Reactors	22-0034
Reactors	Air Cleaning Requirements for Evolutionary and Advanced Reactors	21-0016
Reactors	Revised Accident Source Terms for Light-Water Reactors	23-0488
Real-Time	Real-Time Detection of a Fluorescent Aerosol Application to the Efficiency	21-0095
Real-Time	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Real-Time	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Real-Time	Development of Real Time Detector for Fluorescent Particles	24-0163
Reclamation	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Reduction	Tritium Emissions Reduction Facility (TERF)	22-0065
Redundant	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Region	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Regulating	BARCT: A Conservative Approach to Regulating Radionuclide Emissions	22-0233
Regulation	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Regulatory	Changing Winds in NRC's Regulatory Environment	21-0343
Regulatory	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Regulatory	Developments in the Area of Regulatory Matters in the UK	21-0977
Release	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Release	Beta Experiments on Aerosol Release During Melt-Concrete Interaction	22-0415
Release	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Release	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Release	Generation and Release of Radioactive Gases in LLW Disposal Facilities	23-0115
Releases	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Reliability-Case	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Removing	A Study of the Effect of Coatings Operation on Radioiodine Removing	21-0563

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Removing	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Replace	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Replacement	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
Replacement	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698
Replacement	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Replacement	An Example of a Component Replacement when Applying ASME N509	23-0093
Replacement	Halide Test Agent Replacement Study	23-0313
Reprocessing	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
Reprocessing	The Development of Corona Discharge for Iodine Removal from Nuclear	22-0102
Reprocessing	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Reprocessing	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Reprocessing	Air Cleaning Programs Relating to the First Japanese Commercial	21-0984
Reprocessing	The Development and Design of the Off-Gas Treatment System for the	23-0333
Reprocessing	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Reprocessing	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Reprocessing	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Requirements	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Residence	Residence Time Determination for Adsorbent Beds of Different	23-0308
Resistance	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
Resolution	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Respirators	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
Response	Response of NRC Region III to Perceived Lack of Filter Testing Expertise	22-0762
Response	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
Responsibility	Clean Air and Clear Responsibility	23-0658
Restoration	Characterization and Restoration of Performance of "Aged" Radioiodine	24-0520
Retention	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Retention	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Retention	Factors Affecting the Retention of Methyl Iodide by Iodide-Impregnated	21-0583
Retention	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Retrofit	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Retrospective	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
Review	Review of Department of Energy HEPA Filter Test Activities FY 1990 - FY	22-0177
Review	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Review	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
Review	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Review	Review of In-Place HEPA Filter Testing at Several DOE Facilities	23-0766
Review	A Review of DOE HEPA Filter Component Test Activities: FY-1994	24-0631
Revision	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Revision	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Revision	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Revisions	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Revisions	A Review of the History, Revisions and Interrelationships of ANSI/ASME	21-0320
Revised	The Case for Improved HEPA-Filter Mechanical Performance Standards	24-0829
River	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
Room	Revised Accident Source Terms and Control Room Habitability	22-0742
Room	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Room	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Room	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Rule	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Ruthenium	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Ruthenium	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Ruthenium	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
S-3	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Safe	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Safe	New Performance Data for "Emery 3002" and "Emery 3004," Two	23-0743
Safety	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Safety	Department of Energy Directions in Environment, Safety, and Health	21-0005
Safety	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Safety	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Salt	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Salt	Investigation of Salt Loaded HEPA Filters	21-0366
Salt	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Sampler	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
Sampling	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
Sampling	Aerosol Particle Losses in Sampling Systems	22-0310
Sampling	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
Sampling	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Sampling	EPA Perspective on Radionuclide Aerosol Sampling	23-0241
Sampling	Guide to Sampling Airborne Radioactive Materials in Nuclear Facilities	23-0250
Sampling	Experimental Study on the Particles Deposition in the Sampling Duct	23-0539
Sampling	Proposed Retrofit of HEPA Plenums with Injection and Sampling	23-0721
Sampling	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Sand	Design and Full Scale Test of a Sand Bed Filter	21-0946
Savannah	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
Scale	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Scale	Pool Fires in a Large Scale Ventilation System	21-0844
Scale	Design and Full Scale Test of a Sand Bed Filter	21-0946
Scanning	Method for HEPA Filter Leak Scanning with Differentiating Aerosol	24-0671

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Scattering	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Schedule-Effective	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Scrubber	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
Scrubbing	Experimental Study on Aerosol Removal Effect by Pool Scrubbing	22-0453
Scrubbing	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Seismically	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Selection	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Selective	The Phebus FP Integral Source Term Experimental Project with	22-0464
Self-Contained	Evaluation of Self-Contained HEPA Filter	23-0054
Sellafield	The Development and Design of the Off-Gas Treatment System for the	23-0333
Separation	Development of a Process for Adsorptive Separation of KR-85 from the	21-0299
Separation	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Sequoyah	Basis for and Practical Methods of Controlling Painting Activities at the	24-0534
Series	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Session	Panel Session: Changes to ASME Code AG-1, Section FC, HEPA Filters	24-0850
Severe	Severe Accident Issues for Advanced Reactors	22-0034
Severe	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Severe	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Severe	NAUAHYGROS - A Code for Calculating Aerosol Behavior in Nuclear	23-0520
Shear	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
Shelf	Preliminary Studies to Determine the Shelf Life of HEPA Filters	23-0613
Shut	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
Shutdown	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
Silos	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Silver	Removal of Iodine-129 from Dissolver Off-Gas of Reprocessing Plant by	22-0118
Silver	Removal Characteristics of Some Organic Iodine Forms by Silver	21-0594

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Silver	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Silver	Influences of Impurities on Iodine Removal Efficiency of Silver Alumina	24-0563
Silver	Diffusional Analysis of the Adsorption of Methyl Iodide on Silver	24-0576
Silver	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
Simulated	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Simulated	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Simulated	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Simulation	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
Simulation	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Simulations	Filtration Theory Using Computer Simulations	24-0485
Single	Simulated Performances of a Single Particle Laser Light Scattering	21-0173
Single	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
Single	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Site	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Site	ASME N510 Test Results for Savannah River Site AACS Filter	23-0068
Site	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Site	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Sites	Air Cleaning Issues with Contaminated Sites	24-0012
Sites	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Sliding	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Slightly	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Smoke	Safe Replacement Materials for DOP in "Hot Smoke" Aerosol	21-0126
Solution	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Solutions	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Solutions	Iodine-129 Distribution and Retention During Evaporation of MWL	21-0234
Solutions	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Source	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Source	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Source	Revised Accident Source Terms and Control Room Habitability	22-0742
Source	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Source	The Phebus FP Integral Source Term Experimental Project with	22-0464
Source	A Utility Perspective on New Source Terms	22-0732
Source	Revised Accident Source Terms for Light-Water Reactors	23-0488
Spectroscopy	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Spent	Behavior of Iodine in the Dissolution of Spent Nuclear Fuels	24-0550
Spent-Fuel	A Study on the Expulsion of Iodine from Spent-Fuel Solutions	23-0321
Spokane	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Sponsors	Opening Comments of Chairman and Greetings from Sponsors	24-0002
Spray	Experimental Study of Elementary Collection Efficiency of Aerosols by	23-0682
Spray	Study on Collecting Efficiency of Fission Products by Spray:	24-0500
Spray	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Stack	Single Point Aerosol Sampling: Evaluation of Mixing and Probe	23-0217
Stack	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
Stack	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Stacks	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 2:	23-0269
Stacks	Potential Radionuclide Emissions from Stacks on the Hanford Site, Part 1:	23-0498
Stainless	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Stainless	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Standard	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
Standard	A Single Standard for In-Place Testing of DOE HEPA Filters	23-0096
Standard	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Standard	Performance Testing of HEPA Filters: Progress Towards a European	24-0819

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Standardized	Standardized Methods for In-Place Filter Testing	24-0386
Standards	A Review of Gas Phase Filtration Standards and their Applicability to	22-0215
Standards	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Standards	European Community Nuclear Codes and Standards	21-0212
Standards	Challenges of Equipment Qualification Using Today's Standards with	23-0034
Standards	Integrating Industry Nuclear Codes and Standards into United States	23-0098
Standards	The Case for Improved HEPA-Filter Mechanical Performance Standards	24-0829
Statement	Introductory Statement	21-0186
Station	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Station	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Station	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Station	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Station	Optimization of Air Ducts for Nuclear Reactor Power Generation Station	21-0695
Station	Testing the Sampling Efficiency of a Nuclear Power Station Stack Monitor	24-0181
Stations	Demonstration of Carbon-14 Removal at Candu Nuclear Generating	21-0530
Status	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Steam	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Steel	Development and Evaluation of a Cleanable High Efficiency Steel Filter	22-0586
Steel	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Steel	High Efficiency Steel Filters for Nuclear Air Cleaning	21-0733
Steel	Preliminary Field Evaluation of High Efficiency Steel Filters	23-0195
Steel	The Retention of Iodine in Stainless Steel Sample Lines	23-0279
Steel	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
Steps	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Storage	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
Storage	Numerical Analysis of a Natural Convection Cooling System for	23-0128

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Storage	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Streams	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Streams	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
Streams	Development of Silver Impregnated Alumina for Iodine Separation from	23-0352
Strength	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
Striking	Technical Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Stripping	Iodine Stripping from Nitric Solutions in IATEMA	22-0091
Structural	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
Substitute	Aerosol Concentrations Produced by a Laskin Nozzle Generator a	21-0109
Support	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Surveillance	Practical Experience Applied to the Design of Injection and Sample	24-0132
Survey	Survey of Life-Cycle Costs of Glass-Paper HEPA Filters	22-0849
Sweden	A Short Overview of the Programs in Sweden	21-0980
System	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
System	Direct Post-Accident Sampling System for Containment Atmospheres	22-0283
System	Performance Characterization of a New CAM System	22-0299
System	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
System	Development of Computer Design System for HVAC System	22-0781
System	Development of Computer Design System for HVAC System	22-0781
System	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
System	Concept for a Passive Heat Removal and Filtration System Under Core	22-0863
System	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
System	Confirmation of Automatic Flow Control for a Gaseous Effluent Sampling	21-0415
System	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
System	CAIRE - A Real-Time Feedback System for Emergency Response	21-0646
System	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
System	Pool Fires in a Large Scale Ventilation System	21-0844
System	Measurement System for Alpha and Beta Aerosols with Wide Dynamic	21-0872
System	Investigations into the Design of a Filter System for PWR Containment	21-0898
System	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
System	Numerical Analysis of a Natural Convection Cooling System for	23-0128
System	A Real-Time Stack Radioactivity Monitoring System and Dose Projection	23-0259
System	The Development and Design of the Off-Gas Treatment System for the	23-0333
System	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
System	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
System	A Low Pressure Filter System for New Containment Concepts	23-0478
System	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
System	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
System	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
System	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
System	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
Systematic	A Systematic Study on the Effectiveness of Mono Alkyl Iodides of Cyclic	21-0394
Systems	Aerosol Particle Losses in Sampling Systems	22-0310
Systems	The Experience with the Effectiveness of Filtering Systems for the	22-0393
Systems	Challenges Within Ventilation Systems During Accident Situations	22-0510
Systems	Radial Flow Systems for the Nuclear Industry	22-0527
Systems	Predicting Mass Loading as a Function of Pressure Difference Across	22-0554
Systems	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Systems	Testing of Adsorbents Used in Nuclear Power Plant Air Cleaning Systems	22-0661
Systems	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Systems	Heater Selection Criteria for Engineered Safety Features Atmosphere	22-0820
Systems	Development of a Personal Computer Code for Fire Protection Analysis of	22-0875

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Systems	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Systems	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Systems	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
Systems	Development of Filter Systems - Part 2, Injection Systems and Multi-Point	21-0139
Systems	Field Testing of Nuclear Air Treatment and Gas Processing Systems	21-0193
Systems	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
Systems	Iodine and NOx Behavior in the Dissolver Off-Gas and Iodex Systems in	21-0271
Systems	The Difficulty of Testing Non-509 Systems to the N510 Standard	21-0318
Systems	Testing of Non-ANSI/ASME N509 Systems to ANSI/ASME N510	21-0327
Systems	Testing of Non-N509 Filter Systems - Audit Experiences at McGuire	21-0329
Systems	Comments on Testing of Non-N509 Filter Systems - Audit Experiences at	21-0332
Systems	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
Systems	US NRC Regulatory Guidance for Engineered Safety Feature Air	21-0626
Systems	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Systems	An Example of a Component Replacement when Applying ASME N509	23-0093
Systems	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Systems	An Introduction to the Design, Commissioning, and Operation of Nuclear	23-0439
Systems	New Challenges to Air/Gas Cleaning Systems	24-0033
Systems	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Systems	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Systems	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
T-Method	Post-Accident Air Leakage Analysis in a Nuclear Facility via T-Method	22-0374
TB	AG-1 Division IV, Section TB: Field Testing of Gas Processing Systems	21-0198
TERF	Tritium Emissions Reduction Facility (TERF)	22-0068
THORP	The Development and Design of the Off-Gas Treatment System for the	23-0333
Tank	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Tank	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Tanks	Behavior of Ruthenium in the Case of Shutdown of the Cooling System of	21-0831
Technical	Technical.Scale Iodine Expulsion from the Dissolver Solution and Balance	21-0247
Technical	Review of Department of Energy Filter Test Facility and Filter Test Facility	21-0385
Technical	Technical Brief Stainless Steel Filter for Nuclear Air Cleaning	21-0424
Technologies	Air Cleaning Technologies for the Management and Disposal of	21-0028
Technologies	Further Development of the Cleanable Steel HEPA Filter and Comparison	24-0708
Technology	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Technology	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Temperature	The Effects of Temperature on HEPA Filter Media	22-0327
Temperature	Development and Evaluation of a HEPA Filter for Increased Strength and	22-0617
Temperature	Experimental Study on Aerosol Removal Efficiency for Pool Scrubbing	21-0918
Term	Proposed Source Term Revisions Potential Impact on Future Nuclear Air	22-0736
Term	The Phebus FP Integral Source Term Experimental Project with	22-0464
Term	Kinetic Modelling of the Purging of Activated Carbon After Short Term	21-0662
Terms	Notes on the Draft NUREG Report Accident Source Terms for	22-0734
Terms	Revised Accident Source Terms and Control Room Habitability	22-0742
Terms	Revision of Reactor Accident Source Terms and Implications for Nuclear	22-0362
Terms	A Utility Perspective on New Source Terms	22-0732
Terms	Revised Accident Source Terms for Light-Water Reactors	23-0488
Testing	Section TA Acceptance Testing, Draft Revision 03/06/96	24-0203
Theory	Filtration Theory Using Computer Simulations	24-0485
Thermal	The Development and Design of the Off-Gas Treatment System for the	23-0333
Thermal	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Tools	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Tracer	Replacement Tracer Agent for the In-Place Leak Testing of Adsorbers in	22-0698

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Tracer	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830
Tracer	Leak Testing of Bubble-Tight Dampers Using Tracer Gas Techniques	23-0391
Tracer	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Tracers	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Tracking	Bar Coded Air Sample Tracking: How It Can Assist in Compliance with	23-0670
Trading	Application of Innovative Policies for Controlling Radionuclide Releases:	24-0040
Transport	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Trapping	Dissolution Off-Gas Characterization at the Marcoule Pilot Facility: Iodine	22-0053
Treatment	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Treatment	The First Twenty Years of the ASME Committee on Nuclear Air and Gas	24-0807
Tritiated	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Tritium	Tritium Emissions Reduction Facility (TERF)	22-0065
Tritium	Treatment of Tritiated Exhaust Gases at the Tritium Laboratory Karlsruhe	23-0365
Tritium	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Turbulent	Aerosol Deposition In Bends with Turbulent Flow	24-0441
U.S.	Changes to Licensing for U.S. Nuclear Power Plants	22-0341
UK	Developments in the Area of Regulatory Matters in the UK	21-0977
Uncertainty	Uncertainty In-Place Filter Test Results	24-0676
Underground	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Unfiltered	Control Room Envelope Unfiltered Air Inleakage Test Protocols	24-0400
Unfinished	Keynote Address: Nuclear Aerosols: Unfinished Business	24-0005
Uniformity	Effects of Filter Housing and Ductwork Configuration on Air Flow	22-0205
Units	The Application of HEPA Filter Units in Gas Streams of High Dust	22-0540
Update	An Update: DOP Replacement in Testing Machines for Filters and	22-0146
Update	Radiological Health Effects Models for Nuclear Power Plant Accident	21-0057
Uranium	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Utility	A Utility Perspective on New Source Terms	22-0732
Validation	Modern Technology Tools for Improvement of NPP Reliability-Case Study	22-0808
Validation	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Value-Impact	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Variable	Variable Pattern Contamination Control Under Positive Pressure	24-0428
Vegetated	A Thick Homogeneous Vegetated Cover Design Proves Cost- and	24-0118
Velocity	A General Correlation of MPPS Penetration as a Function of Face	24-0698
Vent	Unit Vent Airflow Measurements Using a Tracer Gas Technique	24-0147
Ventilating	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Ventilating	Heating, Ventilating, and Air Conditioning Deactivation Thermal Analysis	24-0471
Ventilation	Challenges Within Ventilation Systems During Accident Situations	22-0510
Ventilation	Application of High-Efficiency Metal Fiber Filters in Ventilation Systems of	22-0574
Ventilation	Design and Characteristics of Annulus Ventilation and HVAC System for	22-0791
Ventilation	New Injection System for a Short Mixing of Test Aerosols and Gas	21-0080
Ventilation	Impacts of the Filter Clogging on the Behaviour of a Ventilation Network in	21-0815
Ventilation	Pool Fires in a Large Scale Ventilation System	21-0844
Ventilation	An Example of a Component Replacement when Applying ASME N509	23-0093
Ventilation	Constant Depression Fan System: A Novel Glovebox Ventilation System	23-0404
Ventilation	Ventilation System Design for Control of Radioactive Airborne Particulates	23-0784
Ventilation	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Ventilation	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Ventilation	ASME N511-19xx, Standard for Periodic In-Service Testing of Nuclear Air	24-0264
Ventilation/Chilled	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Venting	Effect of Filtering at Containment Venting on the Consequences for the	22-0753
Venting	Design of a Prefilter to Improve Radiation Protection and Filtering	22-0443
Venting	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Venting	Containment Venting Sliding Pressure Venting Process for PWR and	21-0876
Venting	Investigations into the Design of a Filter System for PWR Containment	21-0898
Venting	Impact of the Filtered Venting System Design Upon the Total Radioactive	21-0933
Vents	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Vessels	Simulation Test of Aerosol Generation from Vessels in the Pretreatment	24-0778
View	A View of Licensee Event Reports - Relating to Nuclear Air Treatment	22-0899
Vitreous	Chronic Inhalation Studies of Man-Made Vitreous Fibers	22-0191
Vitrification	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Volatile	Experimental Study on the Volatile Ruthenium Decontamination Factor of	22-0244
WAK	Minimizing of Iodine-129 Release in the Karlsruhe Reprocessing Plant	22-0075
WAK	Retention and Measurement of Iodine-129 and of Organoiodine in the	21-0222
WAK	Removal Efficiency of Silver Impregnated Filter Materials and	24-0609
WAK	Control of Radio-Iodine at the German Reprocessing Plant Wak During	24-0618
WIPP	Structural Testing of Salt Loaded HEPA Filters for WIPP	22-0262
WIPP	The Influence of Salt Aerosol on Alpha Radiation Detection by WIPP	24-0188
Wakes	Alternatives to Current Procedures Used to Estimate Concentrations in	21-0714
Walk-In	Progress Report on the In-Place Acceptance Tests of Walk-In Plenum	21-0360
Wall	Aerosol Penetration Through a Seismically Loaded Shear Wall	22-0402
War	Development of an Air Cleaning System for Dissolving High Explosives	24-0089
Waste	Global Change and the Practice for Airborne Waste Treatment	22-0004
Waste	Measurement of Cesium Emissions During the Vitrification of Simulated	22-0253
Waste	DOE Waste Management Program-Current and Future	22-0716
Waste	Canadian Waste Management Program	21-0042
Waste	Behavior and Control of Ruthenium During Operation of the New Waste	21-0467
Waste	Steps Towards the Minimization of Particulate Emissions From a	21-0510
Waste	IAEA Decadal Activities in the Field of Radioactive Gaseous Waste	21-0635

24th DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCE

21-24 DOE/NRC NUCLEAR AIR CLEANING AND TREATMENT CONFERENCES
KWOC INDEX ON CONFERENCE TITLES

Keyword	Title	Conference No. - Page
Waste	Radioactive Waste Tank Ventilation System Incorporating Tritium Control	24-0051
Waste	Development of a Computer Code to Predict a Ventilation Requirement	24-0065
Waste	Testing Cleanable/Reusable HEPA Prefilters for Mixed Waste Incinerator	24-0076
Waste	Validation Testing of Radioactive Waste Drum Filter Vents	24-0683
Wastes	Air Cleaning Technologies for the Management and Disposal of	21-0028
Wastes	The Incineration of Low Level Radioactive Wastes - Current Status	21-0488
Wastes	Disposal of Slightly Contaminated Radioactive Wastes from Nuclear	23-0138
Water	Behavior of the Loaded Polygonal HEPA Filter Exposed to Water Droplets	22-0534
Water	Design Basis Documentation for the Control Room Ventilation/Chilled	21-0526
Water	Behavior of the Polygonal HEPA Filter Exposed to Water Droplets Carried	21-0772
Water	Value-Impact Assessment for Resolution of Generic Safety Issue 143 -	23-0380
Water	Potential for HEPA Filter Damage from Water Spray Systems in Filter	24-0752
Water-Vapour	Activated Charcoal Beds for Passive Mitigation of the Radioactivity	22-0428
Weapons	Adaptation of Nuclear Filtration Technology to the Demilitarization of	21-0419
Welcome	Welcome and Objectives of the Conference	22-0003
Welcome	Welcome and Objectives of the Conference	21-0002
Welding	Effects on the Efficiency of Activated Carbon on Exposure to Welding	23-0639
Welding	Effects of Welding Fumes on Nuclear Air Cleaning System Carbon	24-0525
West Valley	The Integrated Melter Off-Gas Treatment Systems at the West Valley	23-0016
Winds	Changing Winds in NRC's Regulatory Environment	21-0343
Worst	Field Measurement of the Performance of Air Cleaning Systems to	21-0435
YGN	Application of ASME Code AG-1 to YGN 3 & 4 Plants, South Korea	22-0223
Zion	Control Room Inleakage Testing Using Tracer Gases at Zion Generating	22-0830

BIBLIOGRAPHIC DATA SHEET

(See instructions on the reverse)

1. REPORT NUMBER
(Assigned by NRC, Add Vol., Supp., Rev.,
and Addendum Numbers, if any.)

NUREG/CP-0153
CONF-960715

2. TITLE AND SUBTITLE

Proceedings of the 24th DOE/NRC Nuclear Air Cleaning and
Treatment Conference

Held in Portland, Oregon
July 15-18, 1996

3. DATE REPORT PUBLISHED

MONTH	YEAR
August	1997

4. FIN OR GRANT NUMBER
G6543

5. AUTHOR(S)

M. W. First, Editor

6. TYPE OF REPORT

Conference Proceeding

7. PERIOD COVERED *(Inclusive Dates)*

8. PERFORMING ORGANIZATION - NAME AND ADDRESS *(If NRC, provide Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)*

Harvard School of Public Health
665 Huntington Avenue
Boston, MA 02115-6021

9. SPONSORING ORGANIZATION - NAME AND ADDRESS *(If NRC, type "Same as above"; if contractor, provide NRC Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address.)*

U.S. Department of Energy
Washington, DC 20585
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

International Society of Nuclear Air Treatment Technologies, Inc.
Batavia, OH 45103
Harvard School of Public Health
Boston, MA 02115

10. SUPPLEMENTARY NOTES

R. Lee, NRC Project Manager

11. ABSTRACT *(200 words or less)*

This report contains the papers presented at the 24th DOE/NRC Nuclear Air Cleaning and Treatment Conference and the associated discussions. Major topics are: (1) nuclear air cleaning issues, (2) waste management, (3) instrumentation and measurement, (4) testing air and gas cleaning systems, (5) progress and challenges in cleaning up Hanford, (6) international nuclear programs, (7) standardized test methods, (8) HVAC, (9) decommissioning, (10) computer modeling applications, (11) iodine treatment, (12) filters, and (13) codes and standards for filters and adsorbers.

12. KEY WORDS/DESCRIPTORS *(List words or phrases that will assist researchers in locating the report.)*

Nuclear Air Cleaning	Nuclear Codes and Standards
HEPA Filters	Computer Modeling
Activated Carbon	Adsorption
Aerosols	Radioiodine
Nuclear Waste Management	Decontamination and Decommissioning

13. AVAILABILITY STATEMENT

unlimited

14. SECURITY CLASSIFICATION

(This Page)

unclassified

(This Report)

unclassified

15. NUMBER OF PAGES

16. PRICE