

348
9/4/79

Dr. 3085

DOE/NASA CONTRACTOR
REPORT

DOE/NASA CR-150523

LONG-TERM WEATHERING EFFECTS ON THE THERMAL PERFORMANCE OF
THE SOLARGENICS (LIQUID) SOLAR COLLECTOR AT OUTDOOR CONDITIONS

Prepared by

Wyle Laboratories
Solar Energy Systems Division
Huntsville, Alabama 35805

MASTER


Under Subcontract with

IBM Corporation, Federal Systems Division, Huntsville, Alabama 35805

Contract NAS8032036

National Aeronautics and Space Administration
George C. Marshall Space Flight Center, Alabama 35812

For the U. S. Department of Energy

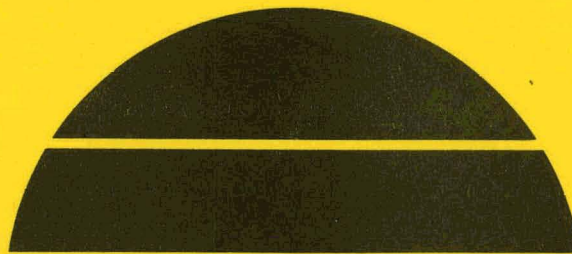

U. S. Department of Energy

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED



Solar Energy

DISCLAIMER


This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency Thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

DISCLAIMER

Portions of this document may be illegible in electronic image products. Images are produced from the best available original document.

NOTICE

This report was prepared to document work sponsored by the United States Government. Neither the United States nor its agents the United States Department of Energy, the United States National Aeronautics and Space Administration, nor any federal employees, nor any of their contractors, subcontractors or their employees, make any warranty, express or implied, or assume any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product or process disclosed, or represent that its use would not infringe privately owned rights.

1. REPORT NO. DOE/NASA CR-150523		2. GOVERNMENT ACCESSION NO.		3. RECIPIENT'S CATALOG NO.	
4. TITLE AND SUBTITLE Long-Term Weathering Effects on the Thermal Performance of the Solargenics (Liquid) Solar Collector at Outdoor Conditions			5. REPORT DATE July 1979		6. PERFORMING ORGANIZATION CODE
			8. PERFORMING ORGANIZATION REPORT # Adden. to Wyle TR-531-28		
7. AUTHOR(S)			10. WORK UNIT NO.		11. CONTRACT OR GRANT NO. NAS8-32036
9. PERFORMING ORGANIZATION NAME AND ADDRESS Wyle Laboratories Solar Energy Systems Division Huntsville, Alabama 35805			13. TYPE OF REPORT & PERIOD COVERED Contractor Report		
			12. SPONSORING AGENCY NAME AND ADDRESS National Aeronautics and Space Administration Washington, D. C. 20546		
15. SUPPLEMENTARY NOTES This work was done under the technical management of Mr. Charles N. Thomas, George C. Marshall Space Flight Center, Alabama.					
16. ABSTRACT <p>This report presents the test procedures used and the results obtained during the evaluation test program of the Solargenics single-covered liquid solar collector. The tests were performed under outdoor natural conditions at the Solar Test Facility at MSFC, following long-term exposure to natural weathering conditions. The collector was under stagnation conditions from August 26, 1978, to June 13, 1979, for a total of approximately ten months.</p> <p>The Solargenics solar collector is manufactured by Solargenics, 808 Gretna Green Way, Los Angeles, California. The solar collector is a liquid, single-glazed, flat-plate collector, and is about 240 inches long, 38 inches wide, and 3.8 inches in depth.</p> <p>For further information on the Solargenics test procedures and performance evaluation, see DOE/NASA CR-150857.</p>					
17. KEY WORDS			18. DISTRIBUTION STATEMENT UC-59c Unclassified-Unlimited  WILLIAM A. BROOKSBANK, JR. Mgr, Solar Energy Applications Projects		
19. SECURITY CLASSIF. (of this report) Unclassified		20. SECURITY CLASSIF. (of this page) Unclassified		21. NO. OF PAGES 12	22. PRICE NTIS

THIS PAGE
WAS INTENTIONALLY
LEFT BLANK

TABLE OF CONTENTS

		<u>Page No.</u>
1.0	PURPOSE	1
2.0	REFERENCES	1
3.0	COLLECTOR DESCRIPTION	1
4.0	SUMMARY	2
5.0	TEST REQUIREMENTS AND PROCEDURES	3
	5.1 Collector Thermal Efficiency Test	3
	5.2 Test Procedure	3
6.0	ANALYSIS	4
	6.1 Thermal Performance Test	4
TABLE I	SOLARGENICS LIQUID COLLECTOR PERFORMANCE RECHECK AFTER LONG TERM EXPOSURE TO NATURAL WEATHERING CONDITIONS	7
TABLE II	THERMAL PERFORMANCE TEST DATA FOR THE SOLARGENICS COLLECTOR BEFORE LONG TERM EXPOSURE	8
Figure 1	Solargenics Collector Thermal Performance Test Results	10

- NOTICE -

This report was prepared as an account of work sponsored by the United States Government. Neither the United States nor the United States Department of Energy, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.

1.0 PURPOSE

The purpose of this report is to present the test procedures used and the test results obtained during an evaluation test program. The test program was conducted to obtain thermal performance data on a Solargenics single-covered liquid solar collector under outdoor conditions (Reference 2.1), following long term exposure to natural weathering conditions. The tests were conducted utilizing the Marshall Space Flight Center Breadboard Test Facility in accordance with the outdoor test requirements of Reference 2.2.

2.0 REFERENCES

- 2.1 CR-150857 Thermal Performance Evaluation of the Solargenics Solar Collector at Outdoor Conditions
- 2.2 ASHRAE 93-77 Method of Testing to Determine the Thermal Performance of Solar Collectors

3.0 COLLECTOR DESCRIPTION

Manufacturer: Solargenics

Manufacturer's Address: 808 Gretna Green Way
Los Angeles, California

Model Number: None

Serial Number: None

Type: Flat Plate

Working Fluid: H₂O

Gross Collector Area, ft²: 63.54

Overall external dimensions: Width, inches: 38.12
Length, inches: 240.00
Thickness, inches: 3-7/8
Aperture area, ft²: 53.34 ft²

Collector glazing: Single

Weight, lbs: (Not available)

4.0

SUMMARY

Thermal performance tests were conducted on the Solar-genics single-covered liquid solar collector following long term exposure to natural weathering conditions. The collector was mounted on the weathering test stand at the Solar Test Facility at Marshall Space Flight Center, Alabama, with exposure to the natural ambient environment. The collector was under stagnation conditions from August 26, 1978, to June 13, 1979. The collector was retested at the MSFC Breadboard Test Facility under outdoor natural conditions on June 22, 1979. The total weathering period was approximately ten months.

Visual inspection of the collector, prior to retest, indicated that some rain water leakage had occurred at the cover seals leaving water marks on the absorber plate. No other material deficiencies were apparent. The test results indicated that a small change in performance had occurred. A slight increase in the negative slope indicates an increase in the heat loss parameters. The slightly lower intercept on the ordinate axis is likely a result of a slight decrease in the absorptivity of the absorber plate or a decrease in the transmissivity of the cover glass.

5.0 TEST REQUIREMENTS AND PROCEDURES

5.1 Collector Thermal Efficiency Test

Thermal performance evaluation criteria shall correspond to that of reference 2.1. Data shall be obtained at inlet temperatures of 0, 25, 50 and 100°F above the ambient temperature at the liquid flow rate of 1.50 GPM. The test shall be conducted at times having weather conditions such that the integrated average insolation measured in the plane of the collector used for computation of instantaneous efficiency values shall not be less than 200 BTU/Hr·Ft². The air velocity across the collector surface shall be measured and recorded as part of the test data. The following data shall be recorded during the test at each test condition.

1. Ambient temperature.
2. Collector inlet liquid temperature.
3. Collector outlet liquid temperature.
4. Collector differential temperature.
5. Total solar flux.
6. Flow rate.
7. Wind speed and direction.

5.2 Test Procedure

1. Mount test specimen and its associated equipment on test bed #2 at a tilt angle of 45°.
2. Assure data acquisition system is operational.
3. Establish the proper flowrate and inlet temperature for each test designation.
4. Continuously adjust the inlet temperature and flow rate to maintain the desired "data point" characteristics, as specified in paragraph 4.1.
5. After steady state conditions have been obtained for each "data point," record data for a minimum of five minutes. Monitor the test parameters by using the data acquisition system at the test site.
6. Once steady state data has been obtained for all specified data points, label and save the printout from teletype as a record.

6.0 ANALYSIS

6.1 Thermal Performance Test

The analysis of data contained in this report is in accordance with the National Bureau of Standards recommended approach. This approach is outlined below.

The efficiency of a collector is stated as:

$$\eta = \frac{q_u/A}{I} = \frac{\dot{m} C_{tf} (t_{f,e} - t_{f,i})}{I} \quad (1)$$

where:

q_u = Rate of useful energy extracted from the solar collector (BTU/Hr)

A = Gross collector area (Ft²)

I = Total solar energy incident upon the plane of the solar collector per unit time per unit area (BTU/Hr·Ft²)

\dot{m} = Mass flow rate of the transfer liquid through the collector per unit area of the collector (Lbm/Ft²·Hr)

C_{tf} = Specific heat of the transfer liquid (BTU/Lb·°F)

$t_{f,e}$ = Temperature of the transfer liquid leaving the collector (°F)

$t_{f,i}$ = Temperature of the transfer liquid entering the collector (°F)

Rewriting Equation (1) in terms of the total collector area yield:

$$\eta = \frac{(\dot{m}A) C_{tf} (t_{f,e} - t_{f,i})}{(IA)} = \frac{\dot{M} C_{tf} (t_{f,e} - t_{f,i})}{P_i} \quad (2)$$

Notice that:

$P_i = IA$ = Total power incident on the collector.

$\dot{m}A = \dot{M}$ = Total mass flow rate through the collector.

Therefore $\dot{M} C_{tf} (t_{f,e} - t_{f,i})$ = Total power collected by the collector.

6.0 ANALYSIS AND RESULTS (Continued)

6.1 Thermal Performance Test (Continued)

Substitution in Equation (2) results in:

$$\eta = \frac{P_{abs}}{P_{inc}} \quad (3)$$

where:

P_{abs} = Total collected power

P_{inc} = Total incident power

This value of efficiency is expressed as a percentage by multiplying by 100. This expression for percent efficiency is:

$$\text{Collector Efficiency} = \frac{P_{abs}}{P_{inc}} \times 100 \quad (4)$$

or from Equation (2), collector efficiency is defined by the equation:

$$\% \text{ Eff} = \frac{\dot{M} C_{tf} (t_{f,e} - t_{f,i})}{P_{inc}} \times 100 \quad (5)$$

Each term in Equation (5) was measured and recorded independently during the test.

The mean value of efficiency was determined over a five-minute period during which the test conditions remained in a quasi-steady state. Each five-minute period constitutes one "data point" as is graphically depicted on a plot of percent efficiency versus

$$\left((t_i - t_a)/I \right)$$

where:

t_i = Liquid inlet temperature ($^{\circ}\text{F}$)

t_a = Ambient temperature ($^{\circ}\text{F}$)

I = Incident flux per unit area ($\text{BTU}/\text{Hr}\cdot\text{Ft}^2$)

The abscissa term $\left((t_i - t_a)/I \right)$ was used to normalize the effect of operating at different values of I , t_i and t_a . The results are shown graphically in Figure 1 with the supporting test data given in Table I.

6.0 ANALYSIS AND RESULTS (Continued)

6.1 Thermal Performance Test (Continued)

Reference 2.2 uses the following terms relating to the thermal efficiency graph:

$F_R \alpha \tau$ = intercept of the efficiency curve on the ordinate axis

$F_R U_L$ = the negative of the slope of the efficiency curve

F_R = the solar heat removal factor

$\alpha \tau$ = absorptance of the collector surface for solar radiation

τ = transmittance of the solar collector cover plate

U_L = solar collector heat transfer loss coefficient

A comparison of the before and after weathering efficiency curves indicates that the slope, $F_R U_L$, did change slightly and that the value of $F_R \alpha \tau$ did drop a marginal amount.

TABLE I

SOLARGENICS LIQUID COLLECTOR PERFORMANCE RECHECK
AFTER LONG TERM EXPOSURE TO NATURAL WEATHERING CONDITIONS

	1	2	3	4	5	6	7	
Ambient Air Temperature (T_a), °F	85.8	89.9	86.5	85.0	86.1	91.1	84.1	
Fluid Inlet Temperature (T_i), °F	87.2	89.9	120.3	109.3	132.4	166.6	151.3	
Fluid Outlet Temperature (T_e), °F	102.2	103.9	131.2	120.4	142.1	173.6	157.3	
Differential Fluid Temperature (ΔT), °F	15.0	14.0	10.9	11.1	9.7	7.0	6.0	
Total Solar Flux (I), BTU/Hr·Ft ²	273.9	263.0	255.0	253.9	260.0	249.6	213.6	
Flow Rate, Lb/Min	11.50	11.71	12.06	12.30	12.13	11.92	11.96	
$(T_i - T_a)/I$ °F·Hr·Ft ² /BTU	0.005	0.000	0.135	0.096	0.178	0.302	0.314	
Efficiency (η), %	59.4	58.9	48.7	50.8	42.7	31.6	31.7	
Date	6/13	6/22	6/22	6/22	6/22	6/22	6/22	
Wind Speed and Direction	4 SE	3 SW	2 SW	2 SW	2 SW	4 SW	2 SW	

TABLE II

THERMAL PERFORMANCE TEST DATA FOR THE SOLARGENICS COLLECTOR
BEFORE LONG TERM EXPOSURE

Page 1 of 2

Date	7/18	7/18	7/20	7/20	7/24	7/24	7/24	7/24
Wind Speed and Direction	5E	5W	5E	5W	7W	5W	7E	
Ambient Air Temperature (T_a), °F	89.5	90.0	92.0	92.5	92.0	91.9	91.3	91.6
Fluid Inlet Temperature (T_i), °F	91.8	92.0	91.7	91.9	115.1	115.2	115.4	115.5
Fluid Outlet Temperature (T_e), °F	106.2	106.2	105.4	105.9	129.7	129.6	129.9	129.6
Differential Fluid Temperature (ΔT), °F	14.4	14.2	13.7	14.0	14.6	14.4	14.5	14.1
Total Solar Flux (I), BTU/Hr·Ft ²	303.6	310.3	282.6	283.0	320.6	314.9	316.4	314.1
Flow Rate, GPM	1.58	1.58	1.54	1.54	1.54	1.54	1.55	1.55
$(T_i - T_a)/I$ °F·Hr·Ft ² /BTU	.01	.01	.00	.00	.07	.07	.08	.08
Efficiency (η), %	58.7	56.6	58.4	59.6	54.6	54.8	55.2	54.1
Specific Gravity	0.996	0.996	0.996	0.996	0.989	0.989	0.989	0.989

TABLE II (Continued)

Page 2 of 2

Date	7/24	7/24	7/24	7/24	7/18	7/18	7/18	7/18
Wind Speed and Direction	10W	8W	6W	8W	5E	3E	8W	10W
Ambient Air Temperature (T_a), °F	93.5	93.0	92.5	92.3	93.9	93.9	94.5	95.2
Fluid Inlet Temperature (T_i), °F	145.4	145.4	145.3	145.1	187.8	189.4	189.9	189.9
Fluid Outlet Temperature (T_e), °F	158.3	158.2	158.6	158.4	195.4	197.5	199.4	199.4
Differential Fluid Temperature (ΔT), °F	12.9	12.8	13.3	13.3	7.6	8.1	9.5	9.5
Total Solar Flux (I), BTU/Hr·Ft ²	322.4	324.6	323.4	331.4	300.4	302.4	315.8	308.0
Flow Rate, GPM	1.51	1.51	1.51	1.51	1.57	1.57	1.57	1.57
$(T_i - T_a)/I$ °F·Hr·Ft ² /BTU	.16	.16	.16	.16	.31	.32	.30	.31
Efficiency (η), %	46.3	46.1	48.0	46.9	30.2	31.9	35.9	36.8
Specific Gravity	.984	.984	.984	.984	.966	.966	.966	.966

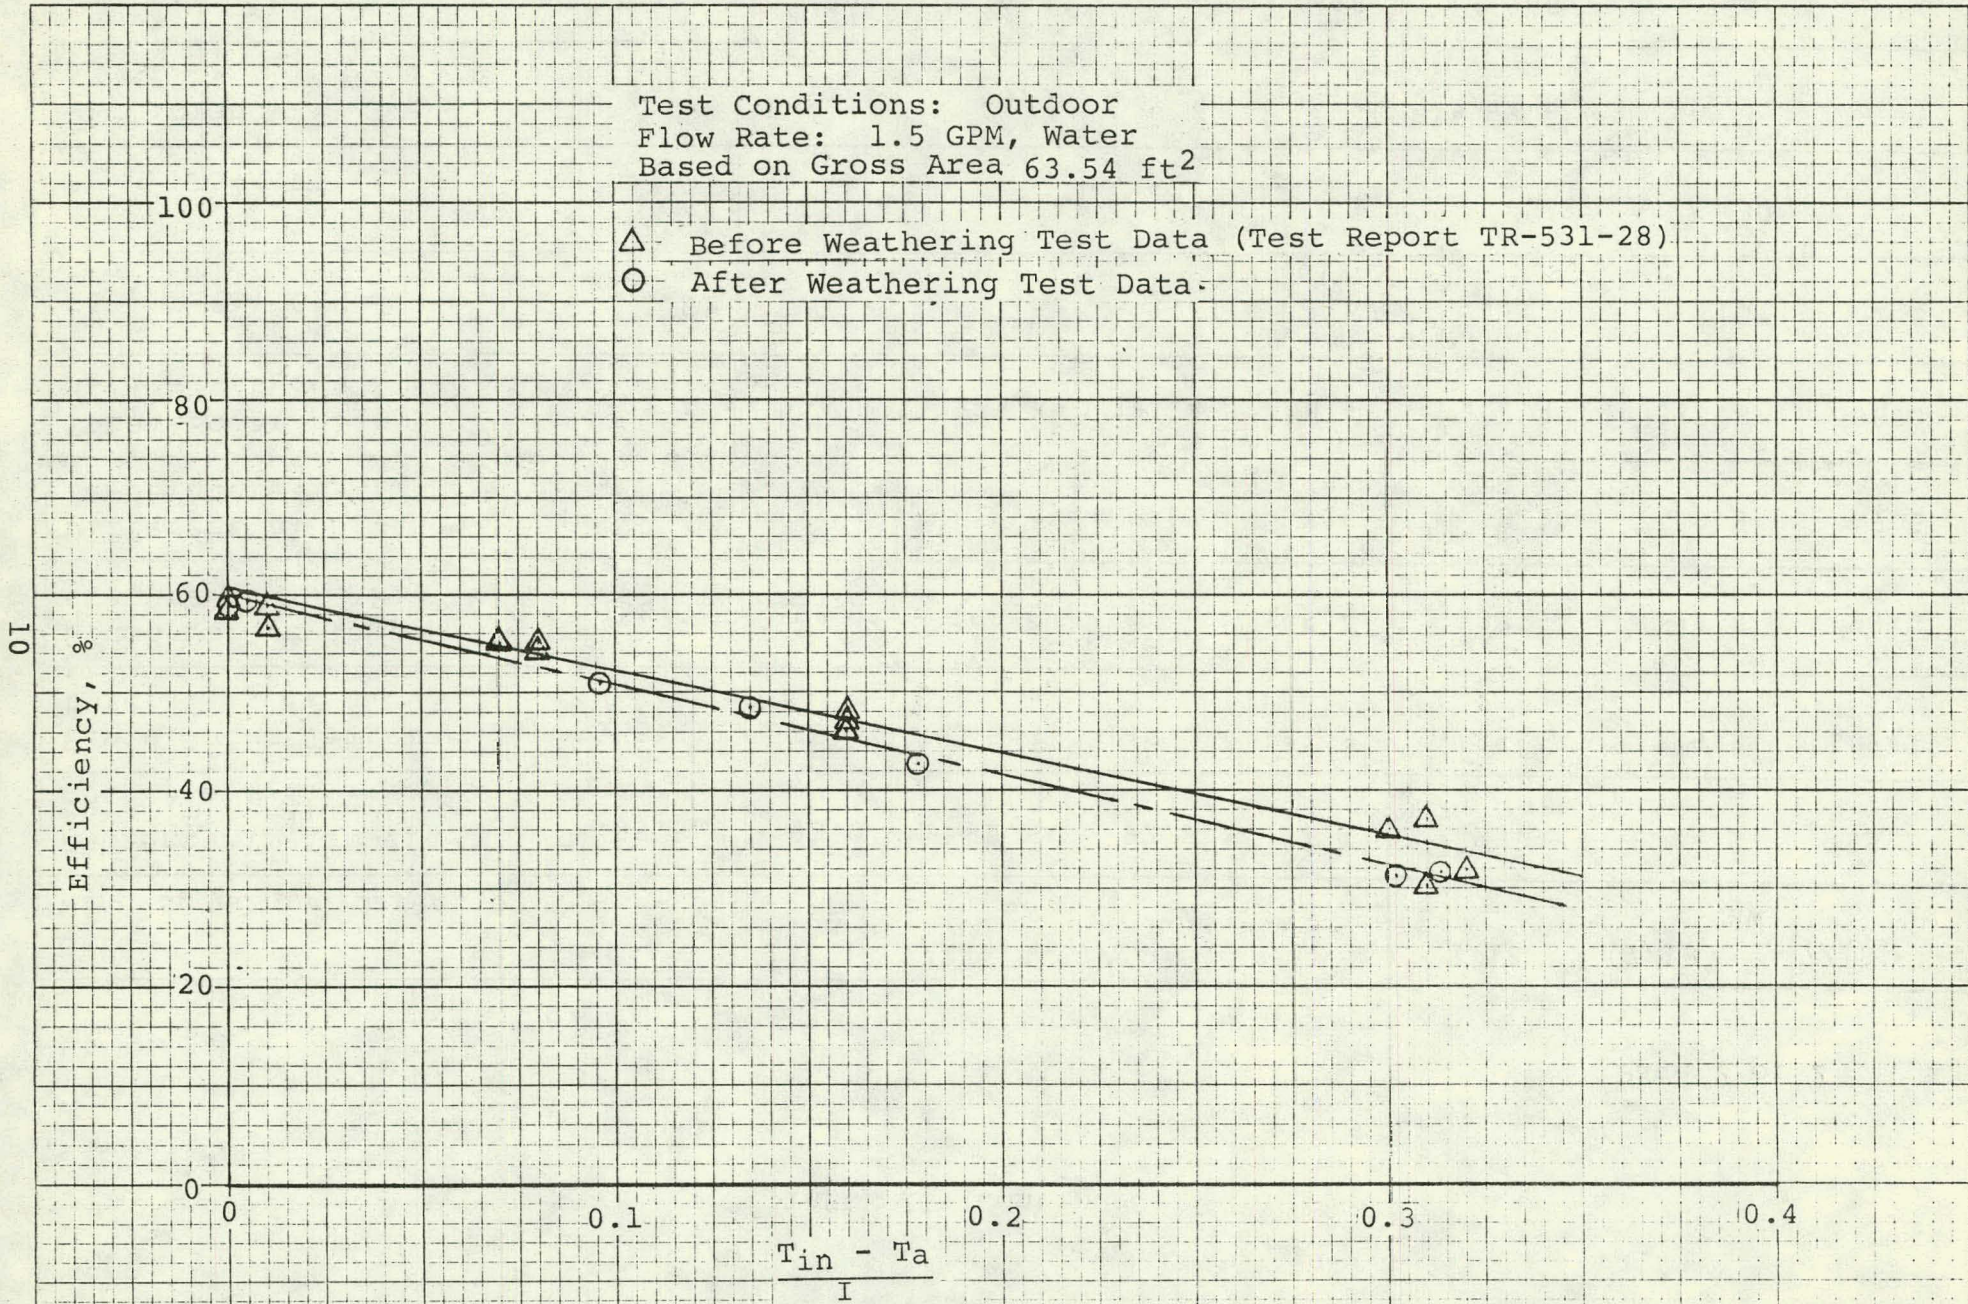


Figure 1. Solargenics Collector Thermal Performance Test Results