

Electric Power Annual 1997

Volume II

October 1998

Energy Information Administration
Office of Coal, Nuclear, Electric and Alternate Fuels
U.S. Department of Energy
Washington, DC 20585-0650

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

MASTER

Contacts

Questions regarding this report may be directed to:

Energy Information Administration, EI-53
Electric Power Division
U.S. Department of Energy
1000 Independence Avenue, S.W.
Washington, D.C. 20585-0650

Questions of a general nature should be directed to:

Robert Schnapp (202/426-1211)
Internet e-mail: robert.schnapp@eia.doe.gov
Director, Electric Power Division

Contributions to this report were provided by the following employees of the Electric Power Division (fax number 202/426-1311):

Volume II Publication Coordinator:

Jerome A. Sanderson (202/426-1162),
Internet e-mail: jerome.sanderson@eia.doe.gov;

The U.S. Electric Power Industry at a Glance:

Jerome A. Sanderson (202/426-1162),
Roger Sacquety (202/426-1160),
Internet e-mail: roger.sacquety@eia.doe.gov;

U.S. Electric Utility Retail Sales and Revenue:

Linda Bromley (202/426-1164);
Internet e-mail: linda.bromley@eia.doe.gov;

U.S. Electric Utility Financial Statistics:

Jerome A. Sanderson (202/426-1162) Investor,
Charlene Harris-Russell (202/426-1163) Public;
Internet e-mail:
charlene.harris-russell@eia.doe.gov;

U.S. Electric Utility Environmental Statistics:

Stephen R. Scott (202/426-1149);
Internet e-mail: sscott@eia.doe.gov;

U.S. Electric Power Transactions:

Thomas S. Williams (202/426-1267);
Internet e-mail: thomas.williams@eia.doe.gov;

U.S. Electric Utility Demand-Side Management:

Karen McDaniel (202/426-1234);
Internet e-mail: karen.mcdaniel@eia.doe.gov;

U.S. Nonutility Power Producers:

Betty Williams (202/426-1269).
Internet e-mail: betty.williams@eia.doe.gov;

Quality

The Energy Information Administration is committed to quality products and quality service. To ensure that this report meets the highest standards for quality, please forward your comments or suggestions about this publication to Jerome A. Sanderson at (202/426-1162) or Internet e-mail: jerome.sanderson@eia.doe.gov.

For general inquiries about energy data, please contact the National Energy Information Center at (202/586-8800). Internet users may contact the center at: infotr@eia.doe.gov.

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

DISCLAIMER

**Portions of this document may be illegible
in electronic image products. Images are
produced from the best available original
document.**

Preface

Electric Power Annual, Volumes I and II

The *Electric Power Annual* is published in two volumes. Volume I, released July 1998, contains 1997 data on U.S. electric utility net generation; fossil fuel consumption, stocks, receipts, and cost; preliminary data on generating unit capability and planned additions; and estimated retail sales of electricity, associated revenue, and average revenue per kilowatthour of electricity sold. Also included in Volume I is information on net generation and associated generating capability from renewable energy sources and estimates for national-level nonutility data.

Volume II contains annual summary statistics for the electric power industry, including information on both electric utilities and nonutility power producers. Included are data for electric utility retail sales of electricity, associated revenue, and average revenue per kilowatthour of electricity sold; financial statistics; environmental statistics; power transactions; and demand-side management. Also included are data for U.S. nonutility power producers on installed capacity; gross generation; emissions; and supply and disposition of energy.

The *Electric Power Annual 1997, Volume II* presents a summary of electric power industry statistics at national, regional, and State levels. The objective of the publication is to provide industry decisionmakers, government policymakers, analysts, and the general public with historical data that may be used in understanding U.S. electricity markets. The *Electric Power Annual, Volume II* is prepared by the Electric Power Division; Office of Coal, Nuclear, Electric and Alternate Fuels; Energy Information Administration (EIA); U.S. Department of Energy.


In the private sector, the majority of the users of the *Electric Power Annual, Volume II* are researchers, analysts, and individuals with policymaking and decisionmaking responsibilities in electric utility companies or other energy concerns. Other users include financial and investment institutions, economic development organizations, special interest groups, lobbyists, electric power associations, and the news media.

In the public sector, users include the U.S. Congress, Federal government agencies, State governments and public service commissions, and local governments.

Data in this report can be used in analytic studies to evaluate new legislation and are used by analysts, researchers, statisticians, and other professionals with regulatory, policy, and program responsibilities for Federal, State, and local governments.

The *Electric Power Annual, Volume II* presents an overview of the electric power industry in the United States, and a summary of the key statistics for the reporting year. The chapters present information and data in each specific area: electric utility retail sales, revenue, and average revenue per kilowatthour; financial statistics for major electric utilities; wholesale trade among electric utilities; electric utility environmental statistics; electric utility demand-side management activities; and statistics for nonutility power producers. Monetary values in this publication are expressed in nominal terms.

Data published in the *Electric Power Annual, Volume II* are compiled from six forms filed annually by electric utilities and one form filed annually by nonutility power producers. These forms are described in detail in the "Technical Notes."



Contents

	Page
The U.S. Electric Power Industry at a Glance	1
Industry Profile	1
The Changing Industry	3
A Review of 1997	5
U.S. Electric Utility Retail Sales and Revenue	15
U.S. Electric Utility Financial Statistics	23
U.S. Electric Utility Environmental Statistics	37
U.S. Electric Power Transactions	53
U.S. Electric Utility Demand-Side Management	73
U.S. Nonutility Power Producers	81
Appendices	
A. Technical Notes	101
Glossary	125

Tables

	Page
1. Electric Power Industry Summary Statistics for the United States, 1996 and 1997	12
2. U.S. Electric Utility Sales to Ultimate Consumers and Associated Revenue by Sector, 1993 Through 1997	17
3. Average Revenue per Kilowatthour for U.S. Electric Utilities by Sector, 1993 Through 1997	18
4. U.S. Electric Utility Sales to Ultimate Consumers by Sector, Census Division, and State, 1996 and 1997	19
5. Number of Ultimate Consumers Served by U.S. Electric Utilities by Sector, Census Division, and State, 1996 and 1997	20
6. Revenue from U.S. Electric Utility Sales to Ultimate Consumers by Sector, Census Division, and State, 1996 and 1997	21
7. Average Revenue per Kilowatthour for U.S. Electric Utilities by Sector, Census Division, and State, 1996 and 1997	22
8. Composite Statement of Income for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	26
9. Composite Balance Sheet for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	27
10. Composite Financial Indicators for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	29
11. Revenue and Expense Statistics for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	30
12. Revenue and Expense Percentages for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	30
13. Average Operating Expenses for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997	31
14. Composite Statement of Income for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997	33
15. Composite Balance Sheet for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997	33
16. Composite Financial Indicators for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997	34
17. Revenue and Expense Statistics for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997	34
18. Composite Statement of Income for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997	35
19. Composite Balance Sheet for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997	35
20. Composite Financial Indicators for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997	36
21. Revenue and Expense Statistics for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997	36
22. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities, 1993 Through 1997	40
23. Number and Capacity of Fossil-Fueled Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment, 1993 Through 1997	40
24. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities by Census Division and State, 1996 and 1997	41
25. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities by Fossil Fuel, Census Division and State, 1997	42
26. Number and Capacity of Coal-Fired Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment by Census Division and State, 1997	43
27. Number and Capacity of Petroleum- and Gas-Fired Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment by Census Division and State, 1997	44
28. Average Quality of Fossil Fuels Burned at U.S. Electric Utilities by Census Division and State, 1996 and 1997	45
29. Average Flue Gas Desulfurization Costs at U.S. Electric Utilities by Census Division and State, 1993 Through 1997	46
30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997	47
31. Sources and Disposition of Electricity at U.S. Electric Utilities, 1993 Through 1997	57
32. Net Generation from U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	57

33. U.S. Electric Utility Sales to Ultimate Consumers by Sector, North American Electric Reliability Council Region, and Hawaii, 1993 Through 1997	58
34. Generating Capability at U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, as of December 1993 Through 1997	60
35. Noncoincidental Peak Load at U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 2006	60
36. U.S. Electric Utility Receipts by North American Electric Reliability Council Region and Hawaii, 1992 Through 1996	62
37. U.S. Electric Utility Deliveries by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	64
38. U.S. Electric Utility Net Energy Flow by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	66
39. U.S. Electric Utility Purchases of Nonutility Generated Electricity by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	68
40. Net Internal Demand, Planned Capacity Resources, and Capacity Margins by North American Electric Reliability Council Region and Hawaii, 1997 Through 2005	69
41. Net Imports at U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	70
42. Imports to U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	71
43. Exports from U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997	71
44. U.S. Electric Utility Demand-Side Management Program Energy Savings, Actual and Potential Peak Load Reductions, and Cost, 1993 Through 1997	75
45. U.S. Electric Utility Actual Peak Load Reductions by North American Electric Reliability Council Region and Hawaii, by Demand-Side Management Program Category, 1993 Through 1997	76
46. U.S. Electric Utility Demand-Side Management Program Annual and Incremental Effects by Program Category, 1997	78
47. U.S. Electric Utility Demand-Side Management Program Annual and Incremental Effects by Sector, 1997	79
48. U.S. Electric Utility Demand-Side Management Energy Savings by North American Electric Reliability Council Region and Hawaii, 1993 through 1998	79
49. U.S. Electric Utility Demand-Side Management Cost by North American Electric Reliability Council Region and Hawaii, 1993 through 1998	80
50. U.S. Electric Utilities Demand-Side Management Direct and Indirect Cost, 1997 and 1998	80
51. Summary Statistics for U.S. Nonutility Power Producers, 1993 Through 1997	87
52. Installed Capacity at U.S. Nonutility Generating Facilities by Fossil Fuels, Renewable Energy Sources, and Census Division, 1993 Through 1997	88
53. Installed Capacity at U.S. Nonutility Generating Facilities by Energy Source and Census Division, 1993 Through 1997	89
54. Installed Capacity at U.S. Nonutility Generating Facilities by Energy Source and State, 1993 Through 1997	90
55. Installed Capacity at U.S. Nonutility Generating Facilities by Qualifying Facility Status and Census Division, 1993 Through 1997	91
56. Installed Capacity of U.S. Nonutilities Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997	92
57. Gross Generation for U.S. Nonutility Power Producers by Energy Source and Census Division, 1993 Through 1997	93
58. Gross Generation for U.S. Nonutility Power Producers by Energy Source and State, 1993 Through 1997	94
59. Gross Generation at U.S. Nonutility Generating Facilities by Qualifying Facility Status and Census Division, 1993 Through 1997	95
60. Gross Generation of U.S. Nonutilities Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997	96
61. U.S. Nonutility Electricity Supply and Disposition for Facilities by Census Division and State, 1996 and 1997	97
62. Estimated Emissions from U.S. Nonutility Power Producer Facilities by Census Division, 1993 Through 1997	98
A1. Installed Capacity at U.S. Nonutility Generating Facilities by Producing Energy Group and Census Division, 1993 Through 1997	118
A2. Gross Generation by U.S. Nonutility Generating Facilities by Producing Energy Group and Census Division, 1993 Through 1997	119
A3. Sulfur Dioxide, Nitrogen Oxide, and Carbon Dioxide Emission Factors	120
A4. Carbon Dioxide Emission Factors for Coal by Rank and State of Origin	122
A5. Nitrogen Oxide Reduction Factors	123
A6. Unit-of-Measure Equivalents	123

Illustrations

	Page
1. Composition of the Electric Power Industry in the United States, 1997	1
2. U.S. Electric Utility Sales to Ultimate Consumers by Sector, 1997	6
3. U.S. Electric Utility Average Revenue per Kilowatthour by Sector, 1997	6
4. U.S. Electric Utility Sales to Ultimate Consumers by Class of Ownership, 1997	7
5. Revenue from U.S. Electric Utility Sales to Ultimate Consumers by Class of Ownership, 1997	7
6. U.S. Electric Utility Sales for Resale by Class of Ownership, 1997	8
7. Revenue from U.S. Electric Utility Sales for Resale by Class of Ownership, 1997	8
8. Installed Capacity at U.S. Nonutility Generating Facilities by Type of Facility, 1997	11
9. Planned Capacity Additions for U.S. Nonutility Generating Facilities by Energy Source, as of December 31, 1997	11
10. Allocation of the Revenue Dollar from Electric Operations for Major U.S. Investor-Owned Electric Utilities, 1997	28
11. Electric Operating Expenses for Major U.S. Investor-Owned Electric Utilities, 1997	28
12. Average Operating Expenses of Fossil-Fueled and Nuclear Steam-Electric Plants for Major U.S. Investor-Owned Electric Utilities, 1997	32
13. North American Electric Reliability Council Regions for the Contiguous United States and Alaska	56
14. Topping-Cycle Plant Configuration	85
15. Bottoming-Cycle Plant Configuration	86


The U.S. Electric Power Industry at a Glance

Industry Profile

The electric power industry in the United States is composed of traditional electric utilities, including power marketers, and nonutility power producers. In this report, the traditional electric utilities are investor-owned, publicly owned, cooperative, and Federal utilities. They are defined as any person, corporation, municipality, State, political subdivision or agency, irrigation project, Federal power administration, or other legal entity that is primarily engaged in the retail or wholesale sale, exchange, and/or transmission of electric energy. Historically, they have generally been vertically integrated companies that provide for generation, transmission, distribution, and/or energy services for all customers in a designated service territory. However, the industry is currently changing from this vertically integrated and regulated monopoly to a functionally unbundled industry with a competitive market for power generation.¹

There are over 3,250 electric utilities (including power marketers) in the United States. Additionally, power marketers, which buy and sell electricity but generally do not own or operate generation, transmission, or distribution facilities, are considered electric utilities. Currently, over 200 power marketers have filed rate tariffs with the Federal Energy Regulatory Commission to sell wholesale electric power. Approximately 80 are actively engaged in wholesale trade. Nonutility power producers are defined as any person, corporation, municipality, State, political subdivision or agency, Federal agency, or other legal entity that is either: (1) a cogeneration qualifying facility under the Public Utilities Regulatory Policies Act of 1978 (PURPA), (2) small power producers qualified under PURPA that provide at least 75 percent of the total energy input in the form of renewable resources, (3) exempt wholesale generators (EWG) under the Energy Policy Act of 1992 (EPACT), (4) cogenerator non-qualifying facilities, and (5) independent power producers (IPP). There are approximately 2,000 nonutility power producers in the United States.

Figure 1. Composition of the Electric Power Industry in the United States, 1997

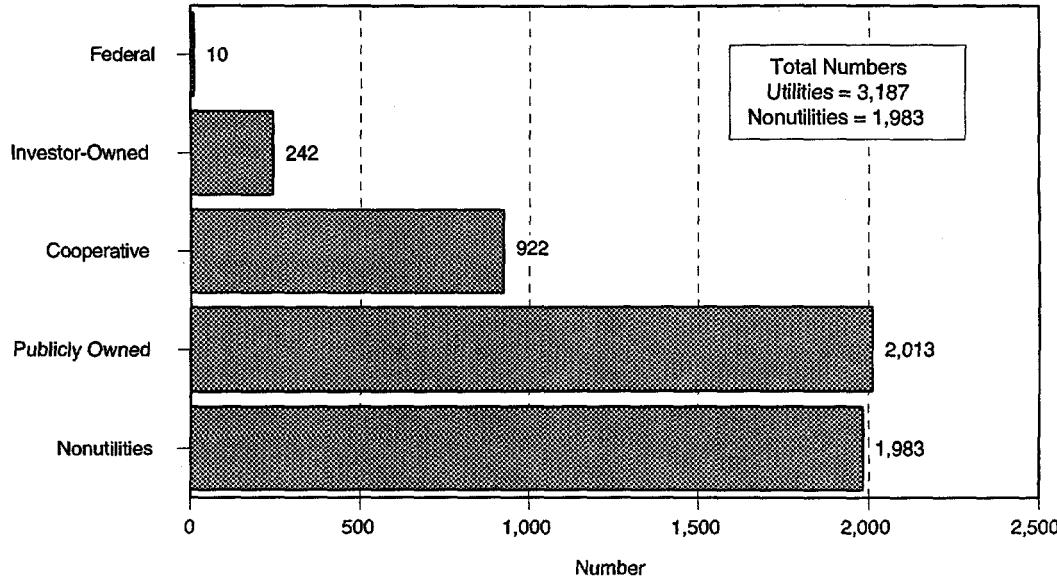

Notes: •Data for 1997 are preliminary. •Power marketers, Puerto Rico, and U.S. Territories are not included.
•Nonutilities represent the number of generating facilities, as these facilities are generally incorporated, and each is required to file Form EIA-867.

Sources: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report," Form EIA-867, "Annual Nonutility Power Producer Report."

¹ A detailed discussion covering the background of electric industry deregulation is contained in Energy Information Administration, *The Changing Structure of the Electric Power Industry: An Update*, DOE/EIA-0562(96) (Washington, DC, December 1996).

Traditional Electric Utilities

Investor-Owned Electric Utilities. Investor-owned electric utilities currently account for more than 75 percent of all U.S. electric utility generating capability, generation, sales, and revenue. Investor-owned utilities operate in all States except Nebraska. Like all private businesses, investor-owned electric utilities' objective is to produce a return for their investors. The profits are either distributed to stockholders as dividends or reinvested. Investor-owned electric utilities are granted service monopolies and are obligated to serve all customers in their service areas. As franchised monopolies, these electric utilities are regulated and required to charge reasonable and comparable prices to similar classifications of consumers and to give consumers access to services under similar conditions. Most investor-owned electric utilities are operating companies that provide basic services for the generation, transmission, and distribution of electricity. The majority of investor-owned electric utilities perform all three functions. As the industry becomes competitive, utilities are organizing generation, transmission, distribution, and energy services into separate business units, and prices for these functions are being unbundled.

Publicly Owned Electric Utilities. Publicly owned electric utilities in the United States are nonprofit government agencies established to serve their communities and nearby consumers at cost, returning excess funds to the consumer in the form community contributions, economic and efficient facilities, and reduced rates. Publicly owned electric utilities include municipals, public power districts, State authorities, irrigation districts, and other State organizations. Most municipal electric utilities simply distribute power, although some large ones produce and transmit electricity as well. They obtain their financing from municipal treasuries and from revenue bonds secured by proceeds from the sale of electricity. Public power districts and projects are concentrated in Nebraska, Washington, Oregon, Arizona, and California. Voters in a public power district elect commissioners or directors to govern the district, independent of any municipal government. State authorities, like the Power Authority of the State of New York or the South Carolina Public Service Authority are agencies of their respective State governments. Irrigation districts may have other forms of organization. In the Salt River Project Agricultural Improvement and Power District in Arizona, for example, votes for the Board of Directors are apportioned according to the size of landholdings.

Cooperative Electric Utilities. Cooperative electric utilities in the United States are owned by their members and are established to provide electricity to those members. The Rural Utilities Service (formerly the Rural Electrification Administration) in the U.S. Department of Agriculture was established under the Rural Electrification Act of 1936 with the purpose of extending electric service to small rural communities (usually fewer than 1,500 consumers) and farms where it was relatively expensive to provide service. Cooperatives are incorporated under State law and are usually directed by an elected board of directors,

which in turn selects a manager. The National Rural Utilities Cooperative Finance Corporation, the Federal Financing Bank, and the Bank for Cooperatives are the most important sources of debt financing for cooperatives. Cooperatives operate in all States except Connecticut, Hawaii, Massachusetts, and Rhode Island and the District of Columbia.

Federal Electric Utilities. Federal electric utilities are primarily producers and wholesalers of electric power and do not produce any profit. As required by law, preference in purchasing the electricity produced is given to publicly owned and cooperative electric utilities and to other nonprofit entities. Wholesale Federal producers include the U.S. Army Corps of Engineers, the U.S. Bureau of Reclamation, and the International Boundary and Water Commission. Power produced by these Federal entities is marketed by Federal power marketing administrations in the U.S. Department of Energy: Bonneville, Southeastern, Southwestern, and Western Area Power Administrations. The Federal power marketing administrations operate in all areas except the Northeast, upper Midwest, and Hawaii. The largest producer of Federal electricity, the Tennessee Valley Authority, markets its own power. The Alaska Power Administration operated and distributed power from its own projects and marketed both wholesale and retail electricity. On November 28, 1995, the President signed a bill authorizing the sale of the Alaska Power Administration's projects. Transfer of title to the State of Alaska and three utilities occurred August 1998.

Power Marketers. Power marketers are a rapidly growing segment of the electric power industry. Like traditional electric utilities, power marketers buy and sell electric power in the wholesale market and fall under FERC's jurisdiction, since they take ownership of power and are engaged in interstate trade. Power marketers differ from traditional electric utilities in that they generally lack both ownership of generation, transmission, or distribution facilities and a designated service territory.

The number of registered power marketers has grown substantially in the past two years, although in 1997 fewer than one-third of those registered with the FERC actually conducted wholesale electricity transactions. Many registered power marketers undertook only a few transactions, seemingly to test and improve their techniques and procedures and to observe marketplace opportunities.

As the States open retail access for electricity, power marketers are entering these new markets. The State public utility commissions may require registration of retail electricity providers, including power marketers. In 1997, pilot programs for retail access were conducted in several States, including Illinois, New Hampshire, Massachusetts, New York, and Washington. Power marketers were active participants in the pilots.

Many power marketers are affiliated with companies owning reserves of other sources of energy, such as natural gas. An exchange of fuel for electricity known as "tolling" allows a power marketer with access to

fuel resources to "rent" a generator from an electric utility, supply fuel to the unit to produce electricity, pay the "rental" fee with a portion of the generated power, and take delivery of the balance for sale to customers.

In 1997, 1,057 million megawatthours of electricity were reported as sales for resale by power marketers to the EIA. Marketers make numerous small transactions with many wholesale customers, including other power marketers. Although marketers generally are not all-requirements suppliers to distribution utilities, some marketers have successfully contracted with municipals to supply their power. The top three power marketers, Enron Power Marketing, Electric Clearinghouse, Incorporated and Southern Energy Trading and Marketing, reported sales for resale of over 359 million megawatthours in 1997.

Nonutility Power Producers

Cogenerator Qualifying Facilities. Generating facilities that produce electricity and another form of useful thermal energy, usually heat or steam, for industrial processes, or heating/cooling purposes. Cogenerators are qualified under the Public Utility Regulatory Policies Act of 1978 (PURPA) by meeting certain ownership, operating and efficiency criteria as set forth by the Federal Energy Regulatory Commission (FERC). They are guaranteed that utilities will purchase their output at a price based on the utility's "avoided cost" and will provide backup service at nondiscriminatory rates.²

Small Power Producers. Are also qualified under PURPA by meeting certain ownership, operating, and efficiency criteria as set forth by the FERC. They are distinguishable by their use of renewable resources such as biomass, geothermal, solar, wind, or water as a primary energy source. Renewable resources must provide at least 75 percent of the total energy input. Like cogenerators, they are also guaranteed that utilities will purchase their output based on the utility's "avoided cost" and provide backup service at nondiscriminatory rates.

Exempt Wholesale Generators. The Energy Policy Act of 1992 (EPACT) modified the Public Utility Holding Company Act (PUHCA) and created another class of nonutility power producers, exempt wholesale generators (EWG). EPACT exempted EWGs from the corporate and geographic restrictions that PUHCA imposed. With this modification, public utility holding companies are allowed to develop and operate independent power projects anywhere in the world.³ Lacking transmission facilities and selling wholesale only, EWGs are regulated but usually may charge

market-based rates. Utilities are not required to purchase their electricity.

Cogenerator Non-Qualifying Facilities. Utilize cogeneration technology and may themselves consume part of the electricity they cogenerate. They are not qualified under PURPA.

Independent Power Producers. Also considered nonutility power producers in the United States are independent power producers (IPP). These facilities are wholesale electricity producers that operate within the franchised service territories of host utilities and are usually authorized to sell at market-based rates. Unlike traditional electric utilities, IPPs do not possess transmission facilities or have retail electric sales.

The Changing Industry

The electric power industry is being transformed from a structure of highly regulated monopolies to one which places growing reliance on competitive markets to establish prices.⁴ The implementation of the Energy Policy Act of 1992 (EPACT) by the Federal Energy Regulatory Commission (FERC) and adoption of retail access plans by a growing number of States are introducing greater competition in the generation and retail supply segments of the industry. The EPACT amended the Federal Power Act authorizing the FERC to order public utilities to provide transmission services for competitive wholesale power purchases and sales. Prior to EPACT, the FERC could not mandate an electric utility to provide wheeling services for wholesale electric trade. This change in the law permits generators to make sales for resale to noncontiguous utilities. In 1996, relying on its authority to prevent undue discrimination in the provision of transmission services, the FERC issued Orders 888 and 889, requiring utilities to file open access transmission tariffs. Order 888 guaranteed suppliers and wholesale purchasers access to transmission-owning utilities. Order 888 also provided for utility recovery of costs that may be stranded as a result of open access. Potentially stranded costs are costs that utilities would have had the opportunity to recover at expected market prices.

Stakeholder disagreements soon arose as to how the FERC should deal with the transition costs associated with the shift to competition. As a result, the Commission's Order on Rehearing (Order No. 888-A) was issued in early 1997. Basically, Order 888-A strives to achieve a balance between the different approaches on how to achieve the recovery of stranded costs. Most critically addressed is how to maintain the financial

² See the chapter, "Nonutility Power Producers," for a description of the benefits under PURPA.

³ EWGs are not considered electric utilities under PUHCA; they are restricted to selling wholesale power to electric utilities and municipalities. However, EWGs were considered to be electric utilities under the Federal Power Act.

⁴ For a further treatise and more detailed information on the transformation of the electric power industry, the reader is referred to the publication Energy Information Administration, *The Changing Structure of the Electric Power Industry: Selected Issues, 1998*, DOE/EIA-0562(98)(Washington, DC, July 1998).

health of the industry, maintain the regulatory deals concerning large past investments, and to avoid shifting the costs to customers that had no responsibility for these stranded costs.

Order 889 requires public utilities that own or operate transmission facilities to establish electronic information systems, known as Open Access Same-time Information Systems (OASIS), to provide all parties identical access to information on available transmission capacity. Order 889 also requires utilities to implement standards of conduct that functionally separate the operation of the transmission system from each utility's wholesale merchant function.

Power pools and groups of utilities in most regions of the United States have responded to the FERC rulemakings by proposing the formation of independent system operators (ISO) to ensure nondiscriminatory operation of their transmission systems and facilitate the development of regional transmission tariffs. Known as comparable service, Order 888 requires utilities owning bulk power transmission facilities to treat any of their own new wholesale sales and purchases of energy over their own transmission facilities to the same transmission tariffs that they apply to others. Advantages are expected to arise from the operational efficiencies that result from overseeing a large regional transmission system and from the elimination of multiple tariffs. However, this program is not without its detractors who claim that advantages may still go to vertically integrated utilities who maintain transmission ownership rights as opposed to nonowners. A possible effect, they assert, is that the ISO will curtail needed future transmission facility expansion. Currently, four ISOs are operating and seven more are in various stages of planning.

The open access provisions of Order 888 have reduced barriers to FERC approval of market-based rates for wholesale power sales. Since the FERC began approving market-based pricing in 1988, the key impediment has been the potential for utilities to exercise market power through ownership or control of transmission facilities. Filing of an Order 888 open access transmission tariff meets FERC's standards with respect to mitigating market power in transmission. With this barrier removed, the FERC has approved market-based rates for more than 300 utilities and power marketers.

Mergers and acquisitions have been proposed as utilities position themselves for competition. During 1997 there were at least 13 completed and nine pending significant electric utility merger and acquisition activities. Several are "convergence" mergers, combining electric and gas companies. In December 1996, the FERC revised its merger policy to facilitate decisions

on a backlog of merger applications, provide greater certainty to merger applicants, and ensure that merger policies do not impede the development of competitive generation markets. Proponents of mergers cite increased economies of scale through the elimination of duplicate functions, penetration into new and additional customer territory, and the economic and financial advantages that come with increased financial strength and operational size.

The EPACT lifted the corporate and geographic restrictions in the Public Utility Holding Company Act (PUHCA) for a new class of nonutility generators, exempt wholesale generators (EWG). This modification of PUHCA allowed public utility holding companies to develop and operate independent power projects anywhere in the world. Also provided is consumer protection against financial abuses and cross-subsidization between regulated and unregulated utilities. The EPACT also amended the Public Utility Regulatory Policies Act (PURPA) by creating inducements for investments in cost-effective improvements in efficiency of power generation and supply. Also added were new rulemaking standards concerning wholesale purchased power. The Federal Power Act of 1935 was amended by broadening when the FERC can order transmission-owning utilities to wheel power and ensuring recovery of the associated costs. Also, the issuance of any order that is inconsistent with State laws governing the retail marketing areas of electric utilities is precluded.

Restructuring at both the Federal and State levels is rapidly transforming the generation and retail supply segments of the electric power industry into competitive markets that increasingly will replace State and Federal regulators in setting the price and terms of electric generation and supply services. Legislatures and/or public utility commissions in most States are considering or have approved plans that will allow retail customers direct access to generation markets by allowing customers to choose among competitive suppliers of generation. Some regions may establish generation tracking and disclosure systems, providing consumers the option of purchasing from suppliers of renewable or other preferred types of generation.

A number of States have adopted legislation or approved plans making retail access available to their customers. Pilot programs to initiate and evaluate retail access are being conducted in States where retail access plans are approved or likely to be approved soon. In some jurisdictions, retail access plans face legal challenges related to the recovery of potentially stranded costs and other issues. As of December 1997, 12 States had active pilot direct access programs with California enabling full direct access in March 1998.

A Review of 1997

U.S. Electric Utility Statistics

In 1997, the electric power industry experienced a variety of changes to its sales, finances, power transactions and other industry indicators. The following is a summary of those changes.

Retail Sales and Revenue. Sales of electricity to ultimate consumers increased 1.4 percent from 3,098 billion kilowatthours (kWh) in 1996 to 3,140 billion kWh in 1997. Revenue from retail sales increased 1.2 percent to \$215 billion in 1997 (Table 1). The national average revenue per kWh decreased slightly from 6.86 in 1996 to 6.85 in 1997. This is the fourth consecutive year that the national average revenue per kWh has decreased.

On a sectorial basis, sales to commercial consumers rose by 4.6 percent in 1997, while sales to residential customers declined by 0.6 percent. However, while the average revenue per kWh declined by 1.5 percent for industrial users (to 4.53 cents) and 0.7 percent for commercial customers (to 7.59 cents), the average revenue from residential customers was 0.8 percent higher (to 8.43 cents) than in 1996.⁵

Retail sales of investor-owned, publicly owned, and cooperative electric utilities all rose between 1 and 2 percent in 1997. Federal electric utility sales, however, were 5.2 percent less than in 1996. The average revenue per kWh in 1997 was 7.11 cents for investor-owned electric utilities, 6.03 cents for publicly owned, and 6.68 cents for cooperatives. Of these, only the cooperatives changed by a significant amount, declining by 0.06 cents.

Financial Statistics. In 1997, the major investor-owned electric utilities had electric utility operating revenues of \$195.2 billion, an increase of \$6.3 billion. Electric operating expenses (\$164.5 billion) increased

by \$7.5 billion resulting in a \$1.2 billion decline in electric operating income to \$30.7 billion. Increases in purchased power and depreciation were primarily responsible for the operating expense increase. Net income before extraordinary items showed a decrease (-1.1 percent) for the second consecutive year. However, extraordinary deductions of \$2.5 billion combined to reduce net income to \$18.4 billion. Common stock dividends declared rose 5.8 percent to \$17.8 billion.


In 1997, investment in the major investor-owned segment of the industry was \$587.4 billion, an increase of \$5.4 billion from 1996. Electric utility construction work in progress (CWIP) was \$11.1 billion, down from \$11.4 billion in 1996 and \$18.0 billion in 1993. Other property and investments increased 28.2 percent to \$42.5 billion. Total capitalization increased \$5.0 billion to \$370.8 billion. Common stock equity rose \$1.1 billion, whereas preferred stock continued its decline dropping to \$16.3 billion. Current assets to current liabilities (quick ratio) rose from 0.88 to 0.92.

In 1997, the major publicly owned generator electric utilities had electric utility operating revenue of \$24.6 billion up by 1.5 percent. Generator electric utility operating expenses increased by 3.0 percent, resulting in a decrease in net income (\$0.1 billion or 146 million) of 8.5 percent. Total assets for publicly owned generator electric utilities fell (\$0.78 billion) ending at \$113.1 billion. The electric utility plant per dollar of revenue ratio was 4.0 in 1997.

In 1997, the major publicly owned nongenerator electric utilities had electric utility operating revenue of \$8.8 billion, a 3.0-percent growth over 1996. Nongenerator electric utility operating expenses increased by 2.1 percent to end the year at \$8.3 billion. Net income for nongenerators remained at \$0.5 billion. Total assets for nongenerator electric utilities increased by 10.6 percent to end the year at \$12.4 billion. The electric utility plant per dollar of revenue ratio increased to 1.3 in 1997.

⁵ Reclassification of consumers, usually between the commercial and industrial sectors, may occur from year to year due to changes in demand level, economic factors, or other factors, including the impacts of restructuring. This may skew the changes reported in the commercial and industrial sectors.


Figure 2. U.S. Electric Utility Sales to Ultimate Consumers, 1997

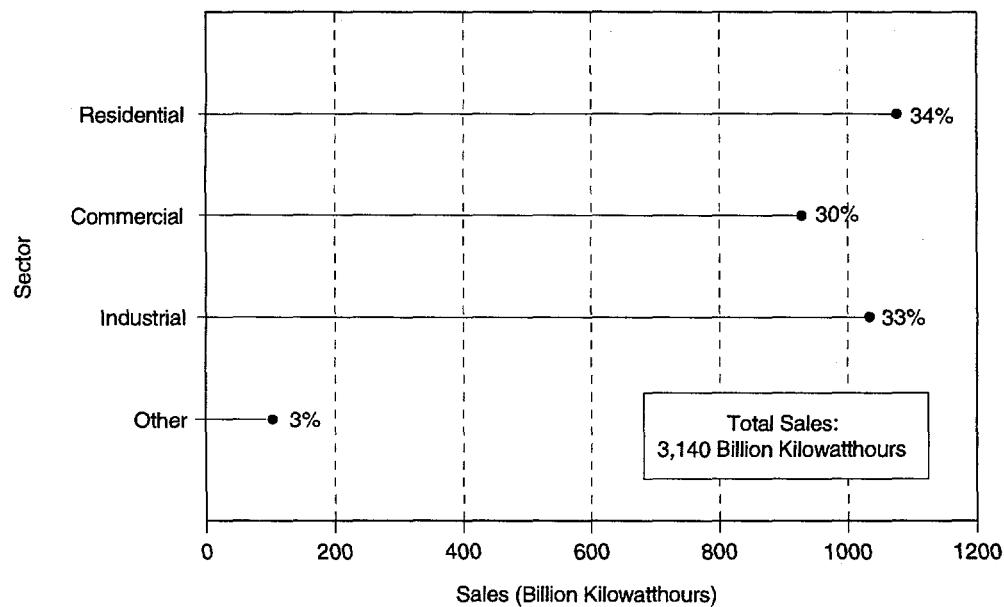

Notes: •Data for 1997 are preliminary. •Other includes sales for public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales. •Totals may not equal sum of components due to independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."


Figure 3. U.S. Electric Utility Average Revenue per Kilowatthour by Sector, 1997

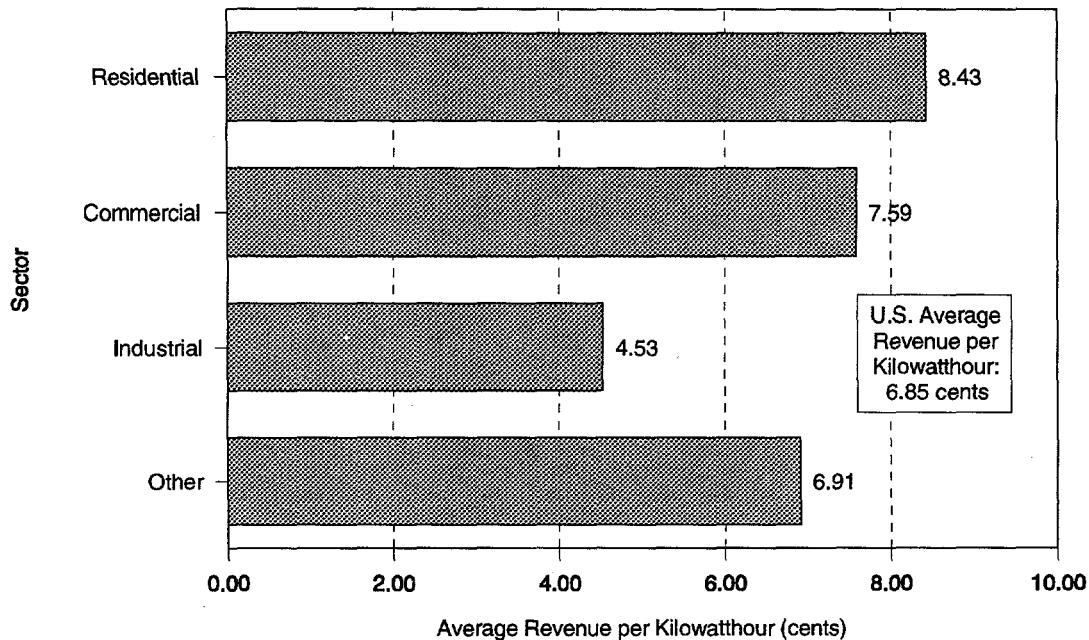

Notes: •Data for 1997 are preliminary. •Other includes sales for public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."


Figure 4. U.S. Electric Utility Sales to Ultimate Consumers by Class of Ownership, 1997

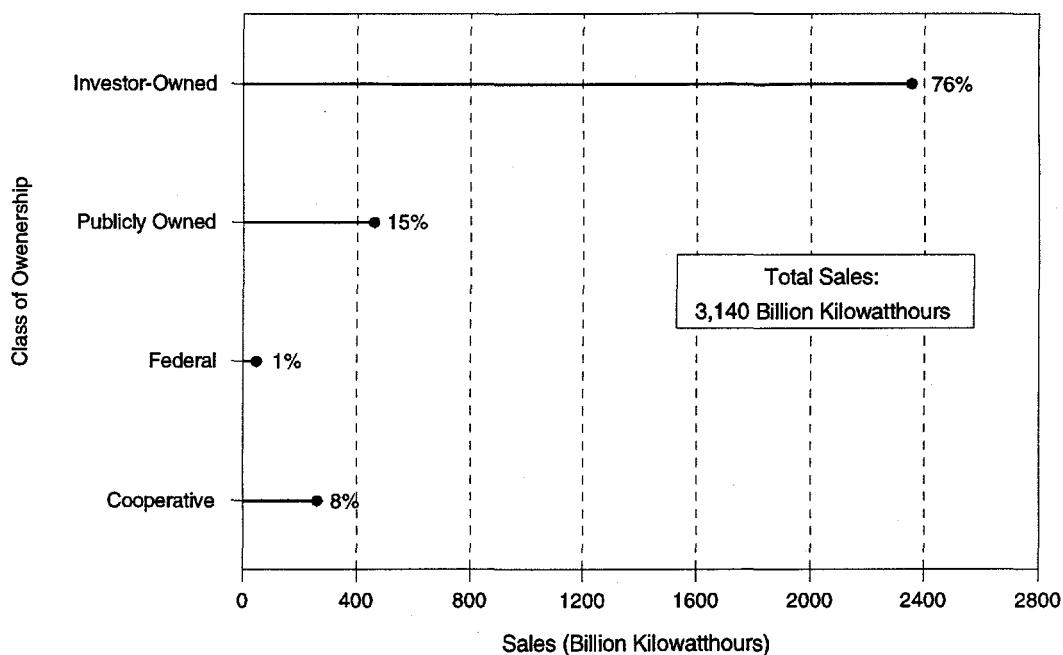

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."


Figure 5. Revenue from U.S. Electric Utility Sales to Ultimate Consumers by Class of Ownership, 1997

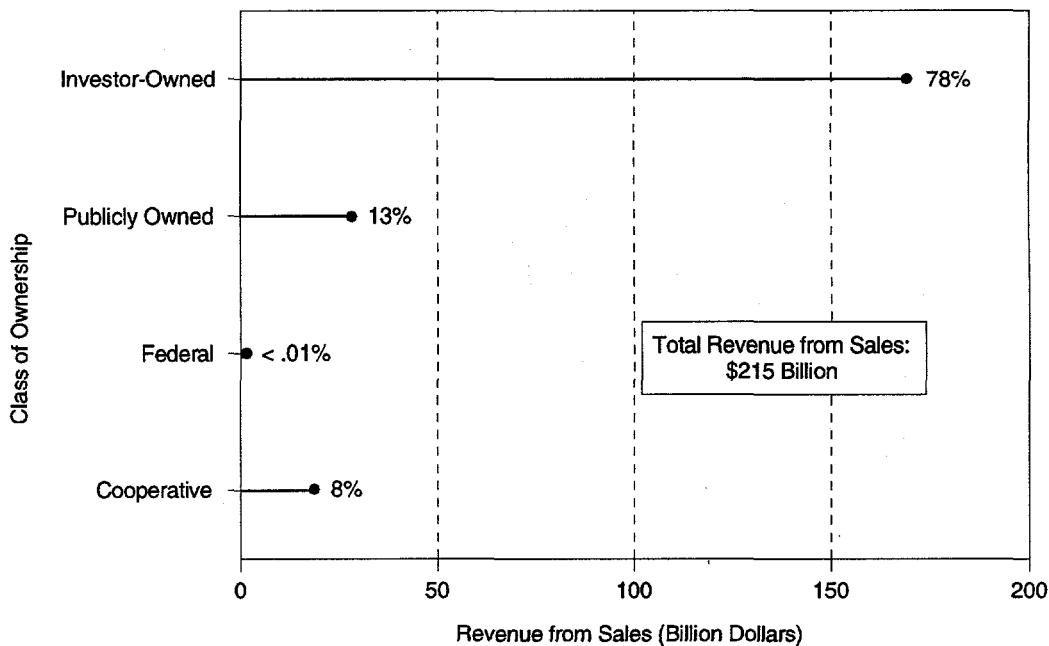

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."


Figure 6. U.S. Electric Utility Sales for Resale by Class of Ownership, 1997

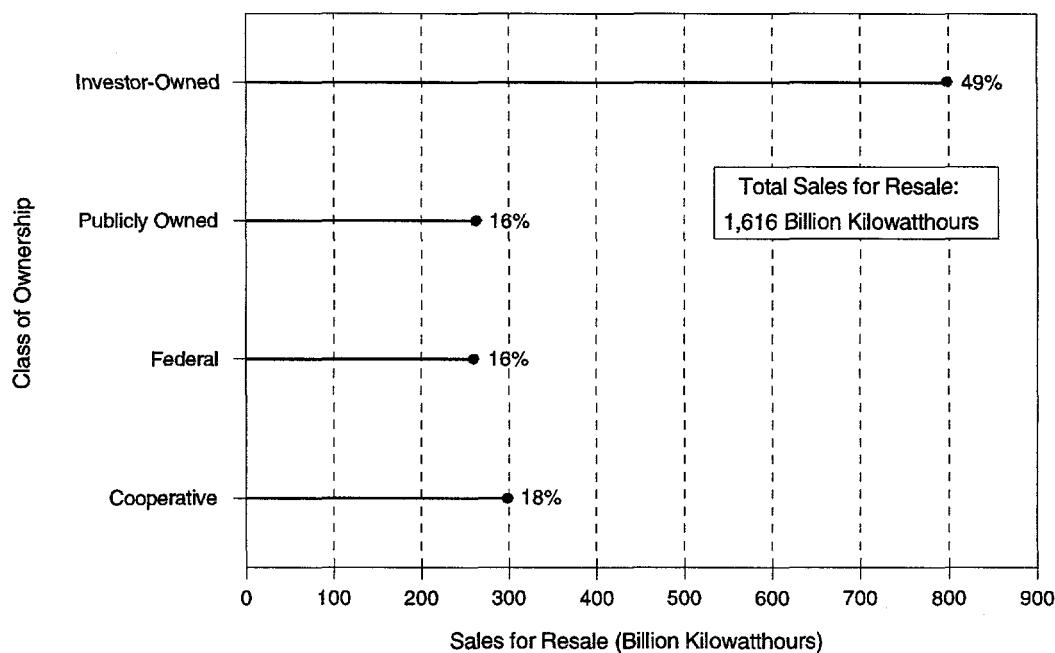

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding. •Power marketers are not shown this year.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Figure 7. Revenue from U.S. Electric Utility Sales for Resale by Class of Ownership, 1997

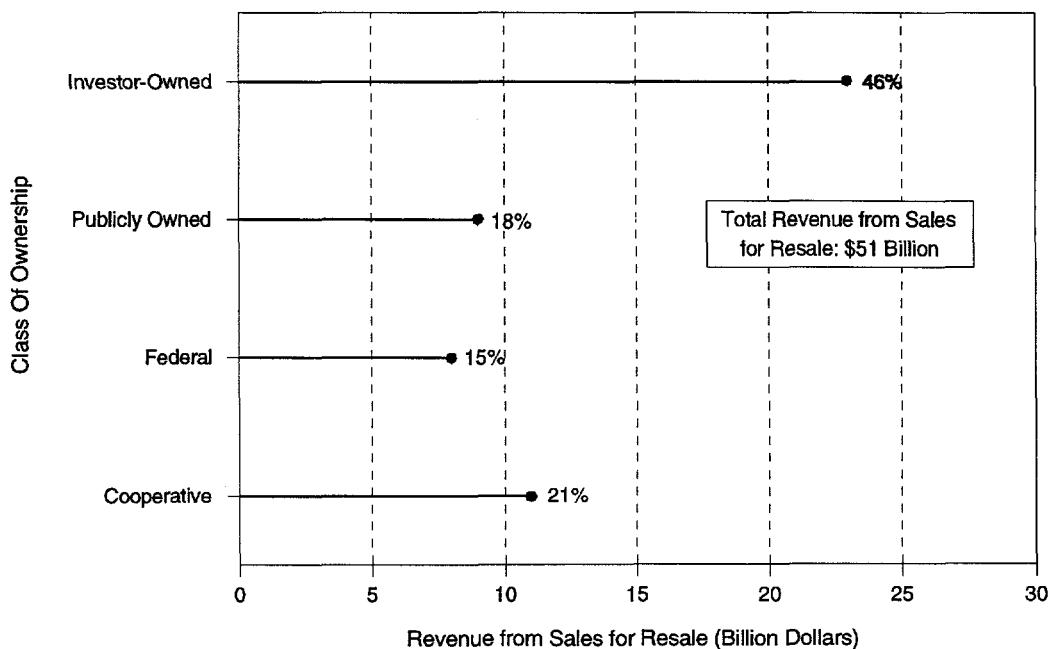

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding. •Power marketers are not shown this year.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Environmental. In 1997, air emissions from electric utility operated fossil-fueled steam electric plants were estimated to have increased from the previous year (values are expressed in short tons). Sulfur dioxide (SO_2) emissions were 12.5 million tons, an increase of about 2.2 percent. Nitrogen oxides (NO_x) and carbon dioxide (CO_2) emissions both showed increases of about 3 percent. Nitrogen oxides emissions were 7.2 million tons, and carbon dioxide emissions were 2,112 million tons.

Flue gas desulfurizations (FGD), sometimes referred to as scrubbers, use chemicals such as lime to remove sulfur oxides from the combustion gases of boilers before the gases are discharged into the atmosphere. In 1997, there were 183 generators connected to scrubbers at U.S. power plants, compared with 182 in 1996 and 151 in 1986. The average sulfur content of coal delivered to all U.S. electric utility plants increased slightly from 1.10 percent by weight in 1996 to 1.11 percent by weight in 1997.⁶

Power Transactions. On a national basis in 1997, wholesale power receipts (purchased power plus exchanges received and wheeling received) increased by 207 billion kilowatthours (kWh) to reach 2,474 billion kWh. Sales to ultimate consumers totaled 3,140 billion kWh, and 1,616 billion kWh of this (51 percent) is from wholesale trade with other electric utilities (Requirement and Nonrequirement Sales for Resale). To supply this electric energy in 1997, electric utilities had planned capacity resources on-hand for the summer of 730 million kilowatts and 744 million kilowatts for the winter, resulting in national capacity margins of 17.5 percent and 27.7 percent, respectively.

In 1997, the noncoincidental peak load at electric utilities in the contiguous United States showed an increase of 3.4 percent, from 617 to 638 million kilowatts for the summer. The winter peak load was 530 million kilowatts, dropping by 2.4 million kilowatts, which represented a change of about 4.4 percent. Both the summer and winter peak loads for the contiguous United States are projected for 2000 to grow to 673 and 595 million kilowatts, respectively. By the year 2005, the growth in the noncoincidental peak load will be above the 1997 actual by almost 98 million kilowatts for the summer and 120 million kilowatts for the winter.

Imports of electricity in 1997 by electric utilities and nonutilities in the United States remained at 47 billion kilowatthours, while exports rose 73 percent to 16 billion kilowatthours. Trade with Canada reached 48 billion kilowatthours of imported electricity and over 14 billion kilowatthours of exported electricity.

Exports to Mexico were above 1 billion kilowatthours, whereas imports dropped to less than 2 percent of the 1996 level, only 23 million kilowatthours. Nearly half the imports entered through the Midwest (Mid-Continent Area Power Pool - States of Minnesota and North Dakota) and the West (Western System Coordinating Council - Washington State). For exports, almost 76 percent exited from the West (Western System Coordinating Council - Washington State). For Mexico, almost all imports and exports came from the West (Western System Coordinating Council - State of California).

On January 1, 1997, the Florida Reliability Council (FRCC) officially became the tenth reliability region of the North American Electric Reliability Council (NERC). Current membership includes power marketers, municipals, and investor-owned utilities. All 37 entities joining the FRCC are full voting members. In 1997, the FRCC Operating Reliability Subcommittee instituted new operating procedures in the areas of regional import and export limits, real-time system security, and scheduled transmission outages. Reflecting the new NERC transmission load relief procedures for the Eastern Interconnection, the FRCC implemented a transmission loading distribution factor cutoff of 5 percent to manage system constraints. New transmission projects include a new 230 kV line between Seminole Electric Cooperative, Inc., Silver Springs North Substation and the Florida Power Corporation Silver Springs Substation. An additional 230 kV line will be in place between Florida Power Corporation DeBary Plant and the Florida Power & Light Company Sanford Plant prior to the summer peak.

Demand-Side Management. In 1997, 971 electric utilities reported having demand-side management (DSM) programs. Of these 971, 561 are classified as large and 410 are classified as small utilities. The 561 large utilities account for 89.5 percent of the total retail sales of electricity in the United States.⁷

Energy savings for the 561 large electric utilities decreased to 56,406 million kilowatthours (kWh), 5,436 million kWh less than 1996. These energy savings represent 1.8 percent of annual electric sales of 3,140 billion kWh to ultimate consumers in 1997.

Actual peak load reductions, the goal of the DSM program, for large utilities was 15.4 percent lower in 1997, at 25,284 megawatts, than in 1996. Potential peak load reductions were 14.7 percent lower in 1997 than in 1996.

DSM costs continued to decrease from \$1.9 billion in 1996 to \$1.6 billion in 1997.⁸ This is the fourth con-

⁶ Energy Information Administration, *Cost and Quality of Fuels for Electric Utility Plants 1997 Tables*, DOE/EIA-0191(97) (Washington DC, 1998).

⁷ Large utilities are those reporting sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours. Small utilities with sales to ultimate consumers and sales for resale of less than 120,000 megawatthours are only required to report incremental energy savings and peak load reduction, and total utility and total DSM costs for the reporting year and for the first forecast year.

⁸ It is tempting, but misleading, to compare DSM costs to supply-side investments on an unadjusted cost-per-kilowatthours or cost-per-kilowatt basis. The calculation of appropriate measures for economic comparisons of DSM and supply-side investments requires that consideration of the life-cycle cost of the options being compared be addressed on an integrated basis (i.e., the interaction of the change in end-use patterns with the production function of the utility must be considered over the expected life of the various options being compared). In

secutive year that DSM costs have decreased from a high of \$2.74 billion in 1993.

For 1997, incremental energy savings for large utilities were 4,831 million kilowatthours, incremental actual peak load reductions were 2,326 megawatts, and incremental potential peak load reductions were 3,540 megawatts.

U.S. Nonutility Power Producer Statistics

Generation. In 1997, U.S. nonutility power producers generated 385 billion kilowatthours (kWh) of electricity. U.S. nonutility power producers received 89 billion kWh from and delivered 241 billion kWh to electric utilities and other end users. Nonutility power producers delivered approximately 62.7 percent of their gross generation to electric utilities and other end users and used 232 billion kWh for their own power plant operations and industrial processes. Almost one-third of national nonutility production of electricity occurred in California and Texas, with 63 and 61 billion kWh, respectively.

Gross generation for nonutility power producers was 0.6 percent higher in 1997 than a year earlier. Slightly more than half of the generation by nonutility power producers was gas-fired, with generation from coal accounting for 15.3 percent of the total. Of the total nonutility generation, 324 billion kWh were from qualifying facilities, more than five times the quantity from nonqualifying facilities. (See the Chapter titled "Nonutility Power Producers" for a definition of these facilities.) The largest share of gross generation was produced by facilities in the West South Central Census Division (Arkansas, Louisiana, Oklahoma, and Texas), followed by the Pacific Census Division (Alaska, California, Hawaii, Oregon, and Washington). The manufacturing sector dominates electricity generation and is concentrated in the West South Central Census Division and Middle Atlantic Census Division (New Jersey, New York, and Pennsylvania) where there is a large potential for cogeneration in both the refining and the paper and pulp industries.

Capacity. The total installed capacity of nonutility power producers was 74,021 megawatts at the end of 1997, 1.1 percent more than in 1996. Nonutility capacity in 1997 was equivalent to 10.4 percent of the total U.S. electric industry capacity.⁹

Of all energy sources, gas accounted for the largest amount (30,748 megawatts) of nonutility capacity. The West South Central Census Division accounted for 35.3 percent of that gas-fired capacity. The second largest share of nonutility capacity was provided by petroleum, followed by coal. The largest volume of petroleum capacity (3,940 megawatts) was located in the Middle Atlantic Census Division. Cogeneration accounts for 70.5 percent of nonutility capacity (61.2 percent qualifying facility capacity and 9.3 percent nonqualifying facility capacity). Small power producers and other nonutilities account for 13.3 and 7.4 percent, respectively, of nonutility capacity.

The greatest number (517) of nonutility generating facilities was in the Pacific Census Division, and most of the capacity (14,889 megawatts) was in the West South Central Census Division. In the Pacific Census Division, California dominated because the State actively promoted alternative energy sources in the 1970's and 1980's by providing incentives to nontraditional electricity producers. Many of these incentives have since expired or been rescinded, but they served to assist in the development of nonutility generation. In the West South Central Census Division, Texas dominated mainly because of the large potential for cogeneration in the petroleum refining industry, where thermal and electric load requirements are co-located.

Nonutilities plan approximately 12 gigawatts of capacity additions; 4 gigawatts through 2000, with 10 gigawatts (generator nameplate capacity) planned for the same period by electric utilities. Electric utilities have planned 42 gigawatts (generator nameplate capacity) in capacity additions for the 10-year period, 1998 through 2007. Of the nonutility planned capacity, 36.0 percent is gas-fired and 10.0 percent is from renewable capacity.


Consumption. In 1997, consumption by nonutilities included 2,248 billion cubic feet of natural gas, 52 million short tons of coal, and 39 million barrels of petroleum. Compared to 1996, consumption decreased 9.2 percent for petroleum, 2.7 percent for coal, and 8.2 percent for gas.

Emissions. In 1997, estimated air emissions from nonutility facilities were 1,503 thousand short tons in SO_2 , 1,379 thousand short tons of NO_x , and 542,615 thousand short tons of CO_2 . This is a 10.3 percent decrease of NO_x emissions from the previous year.

addition, the rate impacts of each alternative must be compared because alternative DSM/supply-side combinations may result in differing patterns of revenue requirements over time. The data presented are not sufficient to allow for such comparison.

⁹ Energy Information Administration, *Inventory of Power Plants in the United States as of January 1, 1997*, DOE/EIA-0095(97).

Figure 8. Installed Capacity at U.S. Nonutility Generating Facilities by Type of Facility, 1997

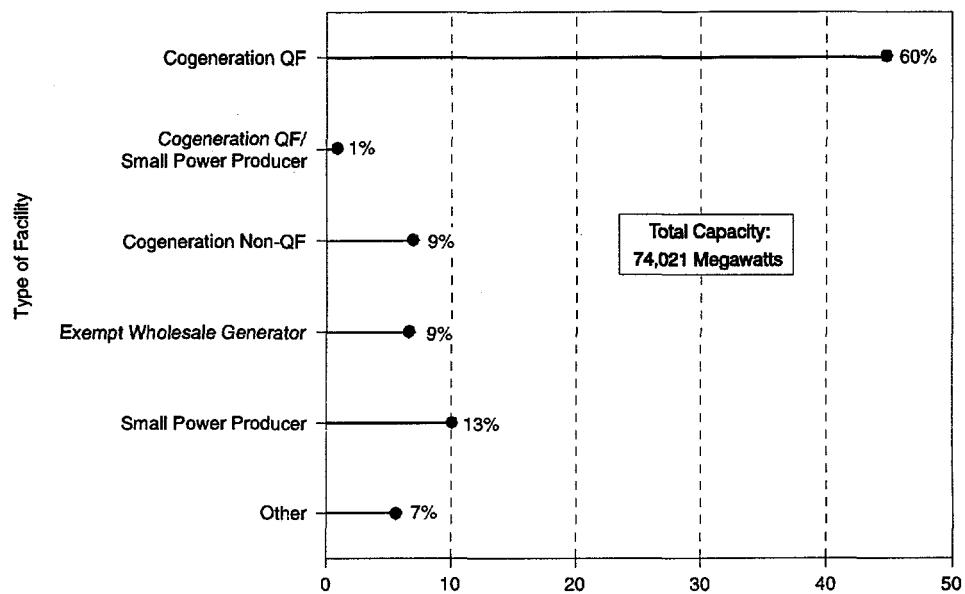


QF=Qualifying facility.

Notes: ● Data are preliminary. ● Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Figure 9. Planned Capacity Additions for U.S. Nonutility Generating Facilities by Energy Source, as of December 31, 1997

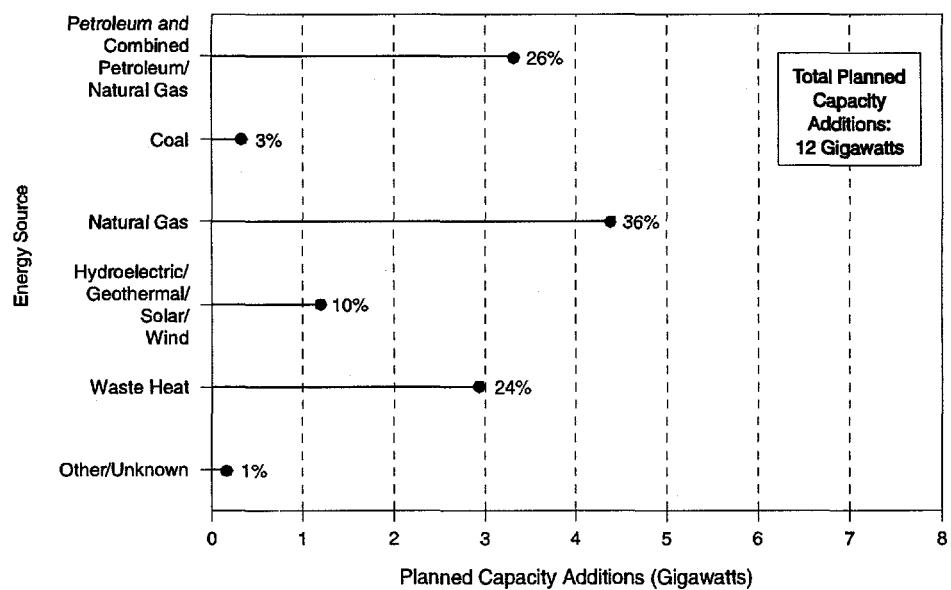

Notes: ● Totals may not equal sum of components because of independent rounding. ● Other includes hydrogen, sulfur, batteries, and chemicals. ● Data for planned capacity additions represent all planned generating facilities that meet one or more of three criteria presented in Chapter 6, "Nonutility Power Producers." ● Data are preliminary.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 1. Electric Power Industry Summary Statistics for the United States, 1996 and 1997

Item	1996	1997	Percent Change
Electric Power Industry¹			
Generating Capability (megawatts) ²	775,872	778,513	0.3
Net Generation (million kilowatthours)	3,446,994	3,494,441	1.4
Emissions (thousand short tons)			
Sulfur Dioxide (SO ₂)	13,070	13,316	1.9
Nitrogen Oxides (NOX)	8,224	8,294	.9
Carbon Dioxide (CO ₂)	2,480,615	2,508,574	1.1
Electric Utilities			
Generating Capability (megawatts) ² ³	709,942	711,889	.3
Coal	302,420	302,866	.1
Petroleum	70,421	69,539	-1.3
Gas	134,590	136,957	1.8
Nuclear	100,784	99,716	-1.1
Waste Heat	5,408	4,979	-7.9
Renewable			
Hydroelectric (conventional)	73,129	76,177	4.2
Geothermal	1,622	1,622	0
Biomass ⁴	445	482	8.3
Wind	8	14	75.0
Photovoltaic	4	5	25.0
Hydroelectric Pumped Storage	21,110	19,310	-8.5
Net Generation (million kilowatthours)	3,077,442	3,122,523	1.5
Coal	1,737,453	1,787,806	2.9
Petroleum ⁵	67,346	77,753	15.5
Gas	262,730	283,625	8.0
Nuclear	674,729	628,644	-6.8
Renewable			
Hydroelectric (conventional)	331,058	341,273	3.1
Geothermal	5,234	5,469	4.5
Biomass ⁴	1,967	1,983	.8
Wind	10	6	-40.0
Photovoltaic	3	3	0
Hydroelectric Pumped Storage ⁶	-3,088	-4,040	-30.8
Consumption			
Coal (million short tons)	875	900	2.9
Petroleum (million barrels) ⁸	113	125	10.6
Gas (billion cubic feet)	2,732	2,968	8.6
Stocks (Year End)			
Coal (million short tons)	115	99	-13.9
Petroleum (million barrels) ⁹	48	49	2.1
Receipts			
Coal (million short tons)	863	881	2.1
Petroleum (million barrels) ¹⁰	107	118	10.3
Gas (billion cubic feet) ¹¹	2,607	2,766	6.1
Cost (cents per million Btu)¹²			
Coal	128.9	127.3	-1.2
Petroleum ¹³	315.7	288.0	-8.8
Gas	264.1	276.0	4.5
Sales To Ultimate Consumers (million kilowatthours)	3,097,810	3,139,826	1.4
Residential	1,082,491	1,075,749	-6
Commercial	887,425	928,491	4.6
Industrial	1,030,356	1,032,672	.2
Other ¹⁴	97,539	102,913	5.5
Revenue From Ultimate Consumers (million dollars)	212,455	215,063	1.2
Residential	90,501	90,694	.2
Commercial	67,827	70,486	3.9
Industrial	47,385	46,772	-1.3
Other ¹⁴	6,741	7,111	5.5
Average Revenue per Kilowatthour (cents)	6.86	6.85	-1
Residential	8.36	8.43	.8
Commercial	7.64	7.59	-.7
Industrial	4.60	4.53	-1.5
Other ¹⁴	6.91	6.91	0
Net Electric Plant Inc Fuel (million dollars)			
Major Investor Owned	369,298	357,238	-3.3
Major Publicly Owned Generator/Nongenerator	R 70,416	69,949	-0.1
Emissions (thousand short tons)¹⁵			
Sulfur Dioxide (SO ₂)	12,179	12,452	2.2
Nitrogen Oxides (NOX)	6,967	7,174	3.0
Carbon Dioxide (CO ₂)	2,044,559	2,113,654	3.4
Noncoincident Summer Peak Load (megawatts)	616,790	637,677	3.4
DSM Actual Peak Load Reductions (megawatts)	29,893	25,284	-15.4
DSM Energy Savings (million kilowatthours)	61,842	56,406	-8.8
DSM Cost (million dollars)	1,902	1,636	-14.0

**Table 1. Electric Power Industry Summary Statistics for the United States, 1996 and 1997
(Continued)**

Item	1996	1997	Percent Change
Nonutility Power Producers			
Installed Capacity (megawatts)			
Coal ¹⁶	73,189	74,021	1.1
Petroleum Only ¹⁷	11,370	11,236	-1.2
Gas Only ¹⁸	2,251	2,994	33.0
Petroleum/Natural Gas (combined)	30,493	30,748	.8
Nuclear ¹⁹	10,912	9,767	-10.5
Renewable	—	—	—
Hydroelectric (conventional)	3,419	3,776	10.4
Geothermal	1,346	1,303	-3.2
Biomass ⁴	10,726	10,897	1.6
Wind	1,670	1,607	-3.8
Solar Thermal	354	354	.0
Photovoltaic	—	—	—
Other ²⁰	648	1,340	106.8
Gross Generation (million kilowatthours)			
Coal ¹⁶	382,423	384,707	.6
Petroleum ¹⁷	61,375	58,923	-4.0
Gas ¹⁸	14,959	15,620	4.4
Nuclear ¹⁹	213,304	219,753	3.0
Renewable	—	—	—
Hydroelectric (conventional)	16,555	17,905	8.2
Geothermal	10,198	9,110	-10.7
Biomass ⁴	57,937	55,887	-3.5
Wind	3,400	3,385	-4
Solar Thermal	903	893	-1.1
Photovoltaic	—	—	—
Other ²⁰	3,793	3,232	-14.8
Consumption²¹			
Coal (Thousand short tons)	53,199	51,781	-2.7
Petroleum (Thousand barrels) ⁶	42,928	38,979	-9.2
Natural Gas (Million cubic feet)	2,447,720	2,247,613	-8.2
Other Gas (Million cubic feet) ²³	1,737,271	1,372,001	-21.0
Supply and Disposition (million kilowatthours)			
Gross Generation	382,423	384,707	.6
Receipts ²⁴	103,219	89,045	-13.7
Deliveries ²⁵	238,929	241,401	1.0
Facility Use	246,713	232,327	-5.8
Emissions (thousand short tons)²⁶			
Sulfur Dioxide (SO ₂)	1,521	1,503	-1.2
Nitrogen Oxides (NO _x)	1,538	1,379	-10.3
Carbon Dioxide (CO ₂)	593,221	542,615	-8.5

¹ Electric utility and nonutility values (capability versus capacity, net versus gross generation, total emissions versus emission for the production of electricity) may not be summed directly—see Technical Notes for summation methodology.

² Data are based on the initial commercial operation year for the generator.

³ Net summer capability based on primary energy source; waste gases, and waste steam are included in the original primary energy source (i.e., coal, petroleum, or gas)—historical data have been revised to reflect this change.

⁴ Includes wood, wood waste, peat, wood liquors, railroad ties, pitch, wood sludge, municipal solid waste, agricultural byproduct, straw, tires, landfill gases, fish oils.

⁵ Includes petroleum coke.

⁶ Represents total pumped storage facility production minus energy used for pumping. Negative generation denotes that electric power consumed for plant use exceeds gross generation.

⁷ Includes 209 megawatts of multi-fueled capacity and 13 megawatts fueled by hot nitrogen.

⁸ Does not include petroleum coke consumption of 681 thousand short tons in 1996 and 1400 thousand short tons in 1997.

⁹ Does not include petroleum coke stocks of 91 thousand short tons at year end 1996 and 469 thousand short tons at year end 1997.

¹⁰ Does not include petroleum coke receipts of 1,410 thousand short tons in 1996 and 2,192 thousand short tons in 1997.

¹¹ Includes small amounts of coke-oven, refinery, blast furnace gas, and landfill gas.

¹² Average cost of fuel delivered to electric generating plants with a total steam-electric nameplate capacity of 50 or more megawatts; average cost values are weighted by Btu.

¹³ Does not include petroleum coke cost of 78.2 cents per million Btu in 1996 and 91.2 cents per million Btu in 1997.

¹⁴ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

¹⁵ Includes only those power plants with a fossil-fueled steam-electric nameplate capacity (existing or planned) of 10 or more megawatts. As of 1993, emission factors for the calculation of carbon dioxide emissions and reductions from nitrogen oxide control technologies have been changed—historical data were revised to reflect that change—see the Technical Notes for more information.

¹⁶ Includes coal, anthracite culm, coke breeze, fine coal waste coal, bituminous gob and lignite waste.

¹⁷ Includes petroleum, petroleum coke, diesel, kerosene, liquid butane, liquid propane, oil waste and tar oil.

¹⁸ Includes natural gas, waste heat, waste gas, butane, methane, propane and other gas.

¹⁹ Nuclear reactor and generator at Argonne National Laboratory used primarily for research and development in testing reactor fuels as well as for training. The generation from the unit is used for internal consumption.

²⁰ Includes hydrogen, sulfur, batteries, chemicals, purchased steam.

²¹ Includes all combustible fuels burned at generating facilities (not just for the production of electricity).

²² Does not include petroleum coke consumption of 4,484 thousand short tons for 1996 and 4,315 thousand short tons for 1997.

²³ Includes butane, methane, propane, digester gas, and other gas.

²⁴ Includes purchases, interchanges, and exchanges of electric energy with utilities and other nonutilities.

²⁵ Includes sales, interchanges, and exchanges of electric energy with utilities and other nonutilities. The disparity in these data and data reported on other EIA surveys occurs due to differences in the respondent universe. The Form EIA-867 is filed by nonutilities reporting the energy delivered, while

In addition, since the frame for the Form EIA-867 is derived from utility surveys, the Form EIA-867 universe lags 1 year.

²⁵ As of 1993, emission factors for the calculation of carbon dioxide emissions and reductions from nitrogen oxide control technologies have been changed--historical data were revised to reflect that change--see Technical Notes for more information.

NM = Calculation not meaningful.

Notes: •Data previously published has been reclassified by energy source and has been changed to reflect these changes.

Notes: •Data for nonutility power producers, and emissions are preliminary for 1997; other data in this table are final. •See Technical Notes for estimation methodology. •Totals may not equal sum of components because of independent rounding. •Percent change is calculated before rounding. •DSM = Demand-Side Management.

Sources: •Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities"; Form EIA-759, "Monthly Power Plant Report"; Form EIA-860, "Annual Electric Generator Report"; Form EIA-861, "Annual Electric Utility Report"; Form EIA-767, "Steam-Electric Plant Operation and Design Report"; Form EIA-867, "Annual Nonutility Power Producer Report." •Federal Energy Regulatory Commission (FERC) Form 1, "Annual Report of Major Electric Utilities, Licensees, and Others"; Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants." Form EIA-411, "Coordinated Bulk Power Supply Programs"; Department of Energy, Office of Emergency Policy, Form OE-411, "Coordinated Bulk Power Supply Program."

Renewable Energy Resources

Section 171 of Public Law 102-486, the Energy Policy Act of 1992, requires the Administrator of the Energy Information Administration to annually collect and publish the results of a survey of electricity production from domestic renewable energy resources. This requirement includes reporting data on electricity production (in kilowatthours) and total installed capacity. The 1996 renewable energy resources shown in Table 1, "Electric Power Industry Summary Statistics for the United States, 1996 and 1997," are reported in detail in the *Renewable Energy Annual, 1997*.

U.S. Electric Utility Retail Sales and Revenue

This chapter provides summary statistics on the sale of electricity to ultimate consumers, associated revenue, and average revenue per kilowatthour sold at the national, Census division, and State levels.

Background

Because electricity itself cannot be stored, it must be generated, transmitted to the consumer, and consumed instantaneously. Electric utility companies were formed to provide these services. An electric system consists of: generating plants (stations) to convert different energy sources to electric power; transformers to raise the voltage in order to reduce losses in transmitting the power; transmission lines to transmit the power to the general vicinity of consumption; transformers to lower the voltage; and distribution lines to distribute the power to the ultimate consumers. The entire system of generating stations, transformers, transmission lines, and distribution lines is a power system. Electric utilities historically build, design, and operate power systems. Most large investor-owned electric utilities own and operate entire power systems: the generation, transmission, and distribution functions. Many small companies are distribution companies, purchasing their electricity from generation suppliers, which can include traditional electric utilities, nonutility power producers, and power marketers. In anticipation of competition in the electric power industry, electric utility companies are forming separate business units for generation and customer service apart from transmission and distribution.

U.S. electric utilities are high-investment businesses and historically have been treated as monopolies because duplicate facilities, particularly transmission and distribution lines, would be inefficient. Thus, franchises are granted to electric utilities for given geographical areas by regulatory officials. To obtain a franchise, electric utilities must provide service to all consumers in their territories at a reasonable cost. As the electric power industry transitions to a competitive environment, access to transmission and distribution lines will be opened; however, revenue associated with these facilities will remain regulated. The generation function is now competitive at the wholesale trade level, and some States are planning to initiate competition at the retail level.

The service territory of an electric utility generally has many different classifications of consumers. Electric utilities determine consumer classification by various factors such as demand, rate schedule, North American Industry Classification (NAICS) code, dis-

tribution voltage, accounting methods, end-use applications, and other social and economic characteristics. Electric utilities use consumer classifications for planning purposes (e.g. load growth and peak demands) and for deriving their rate schedules, often with the approval of a government regulatory agency.

End-Use Sectors

Consumers within the service territory of an electric utility are grouped into end-use sectors: residential, commercial, industrial, and other. The electric utility determines the criteria for end-use sector classification based on its service territory, size, location, ownership, and regulatory structure.

The residential sector includes private households and apartment buildings, where energy is consumed primarily for space heating, water heating, air conditioning, lighting, refrigeration, cooking, and clothes drying. The commercial sector includes nonmanufacturing business establishments, such as hotels, motels, restaurants, wholesale businesses, and retail stores, and health, social, and educational institutions. The industrial sector includes manufacturing, construction, mining, agriculture, fishing, and forestry establishments (NAICS codes 111 through 339). Electric utilities may classify their commercial and industrial service based on demand or annual usage falling within a range specified by the utility, such as classifying a light manufacturer as commercial. The other sector includes public street and highway lighting, transportation, municipalities, divisions or agencies of State and Federal governments under special contracts or agreements, and other utility departments as defined by the pertinent regulatory agency and/or electric utility.

Revenue Requirements

The revenue requirements of an electric utility are set to reimburse the utility for providing electric service. Revenue requirements are the anticipated costs of providing services for some period of time in the future, usually one year. Revenue requirements are based on operating expenses, depreciation expenses, taxes, and return on the rate base (profit of the electric utility). The process of determining electricity prices generally follows three stages: (1) identification of revenue requirements, (2) allocation of the requirements for different classes of service (sectors), and (3) establishment of rate schedules for each sector. In the future, competition at the retail level may change the way rates are set and by whom. In a deregulated environment, generation prices will be market-based

rather than cost-based as under the current regulated system. Rates will be "unbundled," and bills will include a list of services and the associated rates and charges such as energy, transmission, distribution, metering, and other charges. Access will be opened to transmission and distribution lines, though the revenue associated with these lines will likely remain regulated. Under open access rules allowing competition for wholesale generation, some costs that are currently collected in rate schedules for generation assets may become stranded. This means that the costs of the generation asset may not be recoverable at market-based rates in a competitive environment for generation. The recovery of stranded costs is an issue that will need resolution as the industry undergoes deregulation. These stranded costs may be recovered in nonbypassable charges in the form of a rate per kilowatthour paid by all consumers in the jurisdictional distribution utility.

Currently, under a regulated environment, the rate schedules to generate revenue requirements for electric utilities, which are unique to each utility, are developed using a cost-based methodology and are subject to approval by the appropriate authority based on the ownership class applicable to the utility. For example, investor-owned electric utilities are regulated by State public service commissions and the Federal Energy Regulatory Commission (FERC). Under new FERC rules, transmission of wholesale power will remain regulated to ensure open access to transmission systems in a competitive environment, while wholesale rates for generation will become deregulated. State public utility commissions will continue to regulate retail sales and distribution. However, some States are considering retail competition for generation that will allow market-based rates for energy, while regulating distribution rates. Public electric utilities, in most States, are controlled through locally elected or appointed officials, and are not under the jurisdiction of FERC. Their rate schedules will, however, possibly be affected by any changes in State regulations addressing retail competition. A detailed discussion on utility classes of ownership and the emerging competitive environment are included in the "Industry Profile" section of the first chapter of this publication.

A rate schedule is a statement that the utility will provide service to a particular class of consumer at a certain price. Prices for different sectors vary based on the objectives of the utility. These objectives include the need to allocate the various costs incurred in providing service, to maintain the existing consumer base of the utility, and to promote new business.

Average Revenue per Kilowatthour

The average revenue per kilowatthour of electricity sold by electric utilities is calculated by dividing the annual revenue from retail sales by the annual retail sales for each sector and State. The resulting measurement is the cost (per kilowatthour of electricity sold) for providing service to a sector, given the rate schedule of the electric utility for that particular sector. The average revenue per kilowatthour is calculated for all consumers and for each sector (residential, commercial, industrial, and other sales). Utilities typically employ a number of rate schedules within a single sector. These alternative rate schedules reflect the varying consumption levels and patterns of different consumers and the associated impacts on the cost to the electric utility for providing electrical service. The average revenue per kilowatthour by sector reported in this publication represents a weighted average of revenue and sales from ultimate consumers within that sector and across sectors for all consumers.

The electric revenue used to derive the average revenue per kilowatthour is the operating revenue reported by the electric utility. Operating revenue includes energy charges, demand charges, consumer service charges, environmental surcharges, fuel adjustments, and other miscellaneous charges.

Utility operating revenues cover, among other costs of service, State and Federal taxes assessed on the utility. State and local authorities tax the value of plants (property taxes), the amount of revenues (gross receipts taxes), purchases of materials and services (sales and use taxes), and a potentially long list of other items that vary extensively by taxing authority. The Federal component of these taxes are, for the most part, "payroll" taxes. Taxes deducted from employees' pay such as Federal income taxes and employees' share of social security taxes are not a part of the utility's "tax costs," but are paid to the taxing authorities in the name of the employees. These taxes are included in the utility's cost of service (i.e., revenue requirements) and in the amounts recovered from consumers in rates. Therefore, such taxes are reported as operating revenues.

Electric utilities, like many other business enterprises, are required by various taxing authorities to collect and remit taxes assessed on its consumers. In this regard, the utility serves as an agent for the taxing authority. Taxes assessed on the consumer but collected by the utility, such as gross receipts tax, sales tax, or environmental surcharges, are called "pass-through" taxes. These taxes do not represent a cost of the utility and are not recorded in the operating revenues of the utility. However, taxing authorities differ in whether a specific tax is assessed on the utility or the consumer, a difference that in turn determines whether or not the tax is included in the electric utility's operating revenue.

Average revenue per kilowatthour for the residential sector is generally higher than for other sectors. This is primarily due to the higher costs associated with serving many consumers who use relatively small

amounts of electricity. These costs include direct-load costs (such as those for distribution lines, transformers, and meters) in addition to consumer or administrative costs. The industrial sector generally has the lowest average revenue per kilowatthour because of the economies of serving a few consumers who use relatively large amounts of electricity.

Federal electric utilities generally have the lowest average revenue per kilowatthour among the ownership classes because they have access to relatively low-cost financing and mostly utilize inexpensive hydroelectric facilities. Because publicly owned electric utilities also have access to relatively low-cost financing and are nonprofit entities, they have lower average revenue per kilowatthour than investor-owned electric utilities. Although cooperative electric utilities have economic advantages similar to those of publicly owned electric utilities, cooperatives generally serve sparsely populated areas; as a consequence, cooperatives generally have higher average revenue per kilowatthour than publicly owned utilities.

Because of the type and availability of capacity and the cost of fuel, the average revenue per kilowatthour differs across U.S. Census divisions. The New England and Middle Atlantic Census Divisions tend to have an average revenue per kilowatthour that is higher than the national average because of their reliance on petroleum; whereas, the East and West South

Central Census Divisions rely on gas-fired generation and the East North Central and South Atlantic Census Divisions rely on coal-fired generation. Petroleum is generally a more expensive energy source than coal and natural gas. Because the Mountain Census Division relies on inexpensive hydroelectric generation, the average revenue per kilowatthour in this region is usually below the national average for all classes of consumers. The Census divisions where Federal hydroelectric facilities provide significant amounts of electricity, such as the East South Central Census Division, also have low average revenue per kilowatthour.

Source of Data

Summary statistics on retail sales of electricity by electric utilities and average revenue are provided in the following tables. These data were obtained from the Form EIA-861, "Annual Electric Utility Report." The form is an annual census of electric utilities (approximately 3,250) that own and/or operate facilities within the United States, its territories, and Puerto Rico.¹⁰ Data collected include the generation, transmission, distribution, sales, and associated revenue of electric energy and is primarily used by the public. More detailed statistics on sales, average revenue, and revenue per kilowatthour are published annually in the *Electric Sales and Revenue*¹¹

Table 2. U.S. Electric Utility Sales to Ultimate Consumers and Associated Revenue by Sector, 1993 Through 1997

Item	1993	1994	1995	1996	1997
Sales (million kilowatthours)					
Residential.....	994,781	1,008,482	1,042,501	1,082,491	1,075,749
Commercial.....	794,573	820,269	862,685	887,425	928,491
Industrial.....	977,164	1,007,981	1,012,693	1,030,356	1,032,672
Other ¹	94,944	97,830	95,407	97,539	102,913
U.S. Total	2,861,462	2,934,563	3,013,287	3,097,810	3,139,826
Revenue (million dollars)					
Residential.....	82,814	84,552	87,610	90,501	90,694
Commercial.....	61,521	63,396	66,365	67,827	70,486
Industrial.....	47,357	48,069	47,175	47,385	46,772
Other ¹	6,528	6,689	6,567	6,741	7,111
U.S. Total	198,220	202,706	207,717	212,455	215,063

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Notes: *Data for 1997 are preliminary. *Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. *Retail sales reported by power marketers for 1996 and 1997, 3.3 million and 7.5 million megawatthours respectively, were complete for 1996 data, as of the time of publication of "Electric Sales and Revenue 1996" in December of 1997, and are complete for 1997 as of the time of this publication. *Totals may not equal sum of components because of independent rounding.

¹⁰ Summary data in this publication are for the United States only and do not include Puerto Rico and the U.S. territories.

¹¹ For detailed data, including data for the power authorities of Guam, Puerto Rico, American Samoa, and the Virgin Islands, see the *Electric Sales and Revenue*, DOE/EIA-0540, published annually by the Energy Information Administration.

Table 3. Average Revenue per Kilowatthour for U.S. Electric Utilities by Sector, 1993 Through 1997 (Cents)

Sector	1993	1994	1995	1996	1997
Residential.....	8.32	8.38	8.40	8.36	8.43
Commercial.....	7.74	7.73	7.69	7.64	7.59
Industrial.....	4.85	4.77	4.66	4.60	4.53
Other ¹	6.88	6.84	6.88	6.91	6.91
All Sectors.....	6.93	6.91	6.89	6.86	6.85

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Notes: *Data for 1997 are preliminary. *Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. *The average revenue per kilowatthour of electricity sold is calculated by dividing revenue by sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 4. U.S. Electric Utility Sales to Ultimate Consumers by Sector, Census Division, and State, 1996 and 1997
(Million Kilowatthours)

Census Division State	All Sectors		Residential		Commercial		Industrial		Other ²	
	1996	1997	1996	1997	1996	1997	1996	1997	1996	1997
New England	108,408	109,144	38,792	38,639	42,224	42,970	26,007	26,089	1,385	1,446
Connecticut	28,417	28,435	10,943	10,859	11,172	11,278	5,928	5,922	374	376
Maine	11,726	11,959	3,679	3,659	3,212	3,279	4,772	4,957	64	63
Massachusetts	47,294	47,659	16,256	16,274	20,346	20,834	10,085	9,930	607	622
New Hampshire	9,127	9,085	3,427	3,368	3,239	3,251	2,334	2,339	127	127
Rhode Island	6,604	6,693	2,481	2,486	2,607	2,652	1,351	1,380	165	174
Vermont	5,239	5,312	2,006	1,992	1,649	1,675	1,537	1,561	48	84
Middle Atlantic	326,040	325,727	106,561	105,060	118,464	119,879	86,758	86,608	14,257	14,179
New Jersey	66,889	65,915	22,632	22,286	30,152	29,753	13,603	13,369	502	507
New York	131,527	131,936	40,285	40,059	52,915	54,226	25,947	25,282	12,380	12,369
Pennsylvania	127,623	127,875	43,645	42,715	35,396	35,899	47,208	47,957	1,375	1,304
East North Central	528,123	531,504	156,555	154,620	139,229	141,151	217,018	220,323	15,321	15,410
Illinois	125,589	126,456	37,535	37,243	37,432	38,143	42,050	42,375	8,572	8,694
Indiana	88,901	89,052	26,860	26,518	18,292	18,494	43,203	43,508	546	532
Michigan	96,302	97,391	28,901	28,726	32,038	32,411	34,499	35,430	863	824
Ohio	158,587	158,511	44,573	43,621	36,034	36,373	73,394	73,906	4,585	4,610
Wisconsin	58,744	60,094	18,685	18,510	15,433	15,730	23,871	25,103	755	751
West North Central	223,623	228,430	80,583	81,003	61,809	63,034	75,682	78,360	5,548	6,033
Iowa	34,999	36,254	11,537	11,729	7,338	7,648	14,789	15,531	1,335	1,347
Kansas	31,291	32,270	10,672	10,862	11,005	11,424	9,231	9,365	383	619
Minnesota	54,942	55,674	17,157	17,073	10,115	10,147	26,934	27,703	735	750
Missouri	64,843	65,594	26,448	26,536	22,522	22,808	14,915	15,265	958	985
Nebraska	21,497	22,582	7,741	7,989	6,272	6,500	6,193	6,580	1,291	1,514
North Dakota	8,314	8,282	3,602	3,437	2,378	2,300	1,835	2,076	500	469
South Dakota	7,736	7,773	3,426	3,376	2,179	2,207	1,785	1,841	346	349
South Atlantic	639,019	645,037	261,981	256,596	199,778	204,992	157,304	163,157	19,956	20,292
Delaware	9,641	10,122	3,271	3,257	2,911	3,068	3,399	3,741	59	56
District of Columbia	10,137	10,107	1,614	1,554	7,905	7,925	252	262	366	366
Florida	171,832	175,041	88,315	87,845	60,988	63,337	17,212	18,266	5,317	5,593
Georgia	101,307	102,250	37,763	36,831	29,140	30,200	33,175	33,957	1,229	1,262
Maryland	56,998	56,264	22,986	21,937	23,126	23,419	10,098	10,128	787	781
North Carolina	108,296	109,050	41,592	40,611	30,662	31,388	34,142	35,095	1,901	1,955
South Carolina	67,086	68,534	22,514	21,611	14,545	14,806	29,185	31,278	843	840
Virginia	87,596	87,420	34,651	33,923	24,565	24,905	19,021	19,249	9,359	9,342
West Virginia	26,127	26,247	9,277	9,027	5,936	5,944	10,820	11,180	94	96
East South Central	277,405	278,483	97,285	94,107	37,447	63,286	137,276	115,578	5,396	5,511
Alabama	73,104	74,547	25,634	24,892	13,328	16,397	33,523	32,605	620	652
Kentucky	77,019	76,836	21,353	20,998	10,659	12,169	41,930	40,600	3,077	3,069
Mississippi	39,622	40,089	14,965	14,817	7,913	9,955	16,043	14,622	702	694
Tennessee	87,659	87,012	35,333	33,399	5,548	1 24,765	45,781	1 27,752	996	1,096
West South Central	433,147	443,900	154,204	155,961	105,780	107,616	155,152	161,355	18,010	18,967
Arkansas	36,137	36,858	12,934	12,990	7,442	7,597	15,139	15,632	621	638
Louisiana	75,269	71,504	24,311	24,754	15,920	15,262	32,544	28,664	2,494	2,823
Oklahoma	43,291	44,453	17,303	17,376	11,553	11,754	12,160	12,802	2,276	2,521
Texas	278,450	291,086	99,656	100,841	70,866	73,003	95,308	104,257	12,619	12,984
Mountain	195,177	199,600	61,394	63,346	59,456	61,400	66,962	67,288	7,366	7,565
Arizona	52,085	54,456	19,746	20,683	17,252	17,788	12,783	13,253	2,303	2,732
Colorado	37,073	38,069	11,871	12,261	14,239	14,600	9,947	10,297	1,016	911
Idaho	21,119	21,252	6,508	6,628	5,883	5,969	8,380	8,339	348	316
Montana	13,820	11,917	3,911	3,804	3,299	3,293	6,306	4,537	305	284
Nevada	22,574	24,218	7,526	7,801	5,150	5,453	9,075	10,034	823	930
New Mexico	17,173	17,528	4,328	4,502	5,296	5,440	5,921	6,187	1,628	1,399
Utah	19,858	20,373	5,481	5,660	5,911	6,462	7,660	7,430	806	820
Wyoming	11,475	11,786	2,022	2,007	2,425	2,394	6,891	7,211	138	174
Pacific	352,711	363,800	120,693	122,023	118,226	119,202	103,728	109,301	10,063	13,274
California	218,112	227,876	71,396	73,086	83,392	83,570	57,683	62,017	5,642	9,203
Oregon	47,185	47,603	17,285	17,185	13,588	14,047	15,804	15,931	708	440
Washington	87,413	88,321	32,012	31,752	21,446	21,585	30,241	31,353	3,713	3,630
Pacific Noncontiguous	14,159	14,204	4,442	4,394	5,011	4,962	4,468	4,612	237	235
Alaska	4,780	4,841	1,766	1,726	2,250	2,181	584	756	179	178
Hawaii	9,379	9,363	2,676	2,668	2,761	2,782	3,884	3,856	58	57
U. S. Total	3,097,810	3,139,826	1,082,491	1,075,749	887,425	928,491	1,030,356	1,032,672	97,539	102,913

¹ Year-to-year comparison is of data shown for the Commercial and industrial sectors may reflect respondent reclassifications of consumers in those sectors. The TVA defined industrial consumers as those having a monthly demand of at least 50 kW in 1996, but TVA changed to 1,000 kW in 1997. This reclassification resulted in substantial shifting of consumers, sales, and associated revenue out of the industrial sector to the commercial sector.**

² Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Notes: *Data for 1997 are preliminary. *Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. *Retail sales reported by power marketers for 1996 and 1997, 3.3 million and 7.5 million megawatthours respectively, were complete for 1996 data, as of the time of publication of "Electric Sales and Revenue 1996" in December of 1997, and are complete for 1997 as of the time of this publication. **Totals may not equal sum of components because of independent rounding.

Table 5. Number of Ultimate Consumers Served by U.S. Electric Utilities by Sector, Census Division, and State, 1996 and 1997 (Thousands)

Census Division State	All Sectors		Residential		Commercial		Industrial		Other ¹	
	1996	1997	1996	1997	1996	1997	1996	1997	1996	1997
New England.....	6,286	6,345	5,559	5,608	655	666	29	29	42	42
Connecticut.....	1,478	1,481	1,340	1,342	127	128	6	6	5	5
Maine.....	701	707	607	613	73	74	2	2	18	18
Massachusetts.....	2,746	2,779	2,424	2,451	296	302	14	14	12	11
New Hampshire.....	595	598	510	511	77	79	3	3	5	5
Rhode Island.....	451	462	404	414	44	44	3	3	1	1
Vermont.....	315	317	275	277	38	38	1	1	1	1
Middle Atlantic.....	16,266	16,371	14,369	14,450	1,790	1,819	57	51	50	51
New Jersey.....	3,437	3,471	3,024	3,050	390	397	13	13	10	11
New York.....	7,370	7,397	6,495	6,516	828	841	15	8	32	32
Pennsylvania.....	5,459	5,503	4,850	4,885	572	581	29	29	8	8
East North Central.....	19,631	19,902	17,572	17,812	1,904	1,943	73	73	82	74
Illinois.....	5,099	5,163	4,604	4,653	465	480	5	5	25	25
Indiana.....	2,680	2,716	2,389	2,421	265	270	18	18	7	8
Michigan.....	4,368	4,428	3,914	3,975	424	432	13	13	17	8
Ohio.....	5,027	5,095	4,482	4,543	493	500	31	31	20	21
Wisconsin.....	2,457	2,499	2,183	2,220	257	261	5	6	13	12
West North Central.....	8,968	9,131	7,755	7,897	1,043	1,065	47	47	123	122
Iowa.....	1,375	1,396	1,190	1,209	166	167	4	4	16	16
Kansas.....	1,279	1,298	1,085	1,099	171	175	13	11	10	12
Minnesota.....	2,141	2,215	1,888	1,963	211	219	10	10	31	23
Missouri.....	2,620	2,651	2,310	2,334	286	293	10	10	13	14
Nebraska.....	855	865	694	701	115	116	6	7	39	42
North Dakota.....	333	335	281	282	46	47	2	2	4	5
South Dakota.....	365	371	306	311	47	48	2	2	10	10
South Atlantic.....	22,944	23,426	20,208	20,615	2,494	2,563	79	77	164	170
Delaware.....	352	357	316	320	35	36	1	1	1	1
District of Columbia.....	219	220	192	193	27	27	*	*	*	*
Florida.....	7,473	7,627	6,595	6,727	802	823	22	22	54	55
Georgia.....	3,419	3,518	3,032	3,115	346	360	14	12	27	31
Maryland.....	2,101	2,125	1,888	1,908	205	208	7	7	1	1
North Carolina.....	3,694	3,790	3,206	3,289	452	465	14	13	22	23
South Carolina.....	1,867	1,910	1,608	1,641	239	249	5	6	15	14
Virginia.....	2,904	2,955	2,577	2,621	281	287	5	5	41	42
West Virginia.....	916	924	794	800	107	110	11	11	3	3
East South Central.....	7,795	8,010	6,731	6,892	942	1,026	70	22	52	70
Alabama.....	2,100	2,148	1,806	1,844	270	285	13	7	11	12
Kentucky.....	1,880	1,918	1,642	1,674	207	216	10	7	21	21
Mississippi.....	1,273	1,296	1,090	1,109	164	174	9	5	9	9
Tennessee.....	2,541	2,647	2,193	2,266	300	350	38	3	11	28
West South Central.....	13,297	13,550	11,557	11,756	1,474	1,525	128	126	138	143
Arkansas.....	1,274	1,291	1,106	1,121	129	132	25	26	14	12
Louisiana.....	1,962	1,985	1,726	1,745	201	204	15	15	21	21
Oklahoma.....	1,668	1,690	1,442	1,459	195	199	18	16	13	16
Texas.....	8,393	8,584	7,284	7,431	949	990	70	70	90	93
Mountain.....	7,374	7,621	6,329	6,545	852	879	39	41	153	156
Arizona.....	1,919	1,989	1,706	1,769	183	187	5	5	25	28
Colorado.....	1,886	1,944	1,573	1,623	217	224	2	5	93	92
Idaho.....	568	587	477	491	83	86	4	6	4	4
Montana.....	460	468	379	385	65	67	4	4	12	11
Nevada.....	748	790	652	689	93	98	1	1	1	2
New Mexico.....	779	797	668	683	96	98	6	6	10	10
Utah.....	753	782	664	692	71	75	13	10	5	5
Wyoming.....	261	264	211	212	43	44	3	4	4	4
Pacific Contiguous.....	16,772	17,064	14,690	14,886	1,938	1,966	63	96	81	116
California.....	12,672	12,885	11,096	11,231	1,492	1,510	38	65	45	79
Oregon.....	1,534	1,570	1,324	1,351	190	195	8	12	11	11
Washington.....	2,566	2,609	2,270	2,304	256	261	16	19	25	25
Pacific Noncontiguous.....	668	670	570	572	88	87	1	1	8	9
Alaska.....	256	255	216	215	36	35	1	*	4	5
Hawaii.....	412	415	354	357	52	52	1	1	4	4
U. S. Average.....	120,002	122,089	105,341	107,034	13,181	13,540	586	563	894	952

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

* =Value less than 0.5 thousand.

Notes: •Data for 1997 are preliminary. •Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. •Totals may not equal sum of components because of independent rounding. •The number of ultimate consumers is an average of the number of consumers at the close of each month.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 6. Revenue from U.S. Electric Utility Sales to Ultimate Consumers by Sector, Census Division, and State, 1996 and 1997
(Million Dollars)

Census Division State	All Sectors		Residential		Commercial		Industrial		Other ¹	
	1996	1997	1996	1997	1996	1997	1996	1997	1996	1997
New England.....	11,146	11,420	4,584	4,660	4,302	4,462	2,060	2,091	199	207
Connecticut.....	2,987	2,990	1,319	1,318	1,149	1,159	466	459	54	55
Maine.....	1,109	1,137	463	466	333	341	299	315	15	15
Massachusetts.....	4,789	4,993	1,829	1,886	2,022	2,145	850	872	88	90
New Hampshire.....	1,058	1,059	461	460	367	369	214	212	17	18
Rhode Island.....	692	716	293	301	264	276	115	118	20	22
Vermont.....	511	525	221	228	167	173	117	116	6	8
Middle Atlantic.....	31,815	31,852	12,616	12,576	12,454	12,675	5,368	5,221	1,377	1,380
New Jersey.....	7,026	6,950	2,714	2,693	3,111	3,079	1,109	1,084	92	93
New York.....	14,633	14,682	5,654	5,656	6,390	6,577	1,459	1,314	1,130	1,134
Pennsylvania.....	10,155	10,221	4,248	4,227	2,952	3,019	2,800	2,822	155	153
East North Central.....	34,210	34,357	13,265	13,227	10,266	10,349	9,610	9,713	1,069	1,068
Illinois.....	9,655	9,747	3,882	3,886	2,984	3,023	2,204	2,243	586	595
Indiana.....	4,651	4,708	1,819	1,842	1,086	1,117	1,696	1,699	50	50
Michigan.....	6,836	6,852	2,448	2,462	2,543	2,540	1,751	1,761	94	90
Ohio.....	9,983	9,913	3,831	3,765	2,778	2,789	3,086	3,077	288	282
Wisconsin.....	3,084	3,137	1,285	1,273	876	881	873	933	51	51
West North Central.....	13,218	13,464	5,826	5,880	3,825	3,887	3,211	3,327	356	369
Iowa.....	2,078	2,163	942	962	479	505	578	614	80	82
Kansas.....	2,041	2,036	839	837	733	739	434	423	35	37
Minnesota.....	3,046	3,122	1,223	1,235	621	632	1,148	1,201	53	53
Missouri.....	3,962	3,996	1,873	1,881	1,360	1,369	662	679	67	67
Nebraska.....	1,143	1,196	487	510	345	355	228	238	84	94
North Dakota.....	469	468	223	216	144	141	81	91	21	20
South Dakota.....	478	483	240	239	143	146	79	81	16	16
South Atlantic.....	41,804	42,010	20,530	20,277	13,177	13,526	6,841	6,940	1,255	1,266
Delaware.....	664	708	293	300	204	221	159	180	7	7
District of Columbia.....	745	747	125	122	585	589	11	12	23	24
Florida.....	12,343	12,588	7,060	7,097	4,043	4,191	879	920	362	380
Georgia.....	6,514	6,515	2,892	2,852	2,089	2,147	1,423	1,402	110	114
Maryland.....	3,966	3,928	1,898	1,827	1,580	1,607	419	426	68	69
North Carolina.....	7,075	7,069	3,348	3,263	1,959	2,019	1,634	1,655	133	133
South Carolina.....	3,802	3,771	1,688	1,623	928	937	1,135	1,160	51	51
Virginia.....	5,334	5,366	2,633	2,628	1,451	1,487	759	770	492	481
West Virginia.....	1,362	1,317	592	565	339	329	423	415	9	8
East South Central.....	13,993	14,055	6,018	5,904	2,347	3,814	5,303	4,007	326	331
Alabama.....	3,913	3,970	1,700	1,679	865	1,040	1,306	1,209	42	42
Kentucky.....	3,104	3,097	1,185	1,172	553	644	1,222	1,138	143	143
Mississippi.....	2,383	2,369	1,054	1,040	561	666	707	603	61	60
Tennessee.....	4,594	4,620	2,078	2,013	369	1,463	2,067	1,058	79	86
West South Central.....	26,348	26,896	11,741	11,881	7,062	7,174	6,382	6,657	1,163	1,183
Arkansas.....	2,224	2,266	1,005	1,013	502	515	676	695	41	42
Louisiana.....	4,569	4,544	1,836	1,811	1,134	1,134	1,405	1,426	194	173
Oklahoma.....	2,405	2,410	1,160	1,152	670	673	459	465	116	120
Texas.....	17,151	17,676	7,740	7,905	4,756	4,852	3,842	4,071	813	848
Mountain.....	11,708	11,839	4,654	4,763	3,884	3,946	2,751	2,724	418	407
Arizona.....	3,930	4,019	1,767	1,824	1,375	1,394	664	669	124	132
Colorado.....	2,244	2,265	889	910	844	842	432	441	78	73
Idaho.....	835	821	344	341	251	249	224	216	17	15
Montana.....	653	619	243	244	182	191	208	166	20	19
Nevada.....	1,342	1,358	519	528	340	344	445	450	37	36
New Mexico.....	1,161	1,192	386	402	420	431	258	273	97	86
Utah.....	1,049	1,054	381	390	349	369	283	259	36	36
Wyoming.....	495	511	124	125	123	126	237	250	10	10
Pacific Contiguous.....	26,586	27,513	10,684	10,934	9,935	10,075	5,420	5,637	547	866
California.....	20,668	21,750	8,088	8,405	8,199	8,343	4,018	4,312	364	690
Oregon.....	2,253	2,197	984	956	689	698	539	514	41	28
Washington.....	3,665	3,566	1,612	1,572	1,047	1,035	863	811	142	147
Pacific Noncontiguous.....	1,627	1,657	582	592	574	576	439	455	31	34
Alaska.....	489	488	201	197	215	207	49	57	24	26
Hawaii.....	1,137	1,169	382	395	359	369	390	398	7	8
U. S. Total.....	212,455	215,063	90,501	90,694	67,827	70,486	47,385	46,772	6,741	7,111

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Notes: •Data for 1997 are preliminary. •Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. •Retail sales reported by power marketers for 1996 and 1997, 3.3 million and 7.5 million megawatthours respectively, were complete for 1996 data, as of the time of publication of "Electric Sales and Revenue 1996" in December of 1997, and are complete for 1997 as of the time of this publication.

•Totals may not equal sum of components because of independent rounding.

Table 7. Average Revenue per Kilowatthour for U.S. Electric Utilities by Sector, Census Division, and State, 1996 and 1997 (Cents)

Census Division State	All Sectors		Residential		Commercial		Industrial		Other ¹	
	1996	1997	1996	1997	1996	1997	1996	1997	1996	1997
New England	10.28	10.46	11.82	12.06	10.19	10.38	7.92	8.02	14.39	14.30
Connecticut	10.51	10.52	12.05	12.13	10.29	10.28	7.86	7.75	14.35	14.52
Maine	9.46	9.51	12.58	12.75	10.35	10.39	6.26	6.36	23.03	23.23
Massachusetts	10.13	10.48	11.25	11.59	9.94	10.29	8.43	8.78	14.53	14.49
New Hampshire	11.59	11.65	13.44	13.67	11.32	11.34	9.16	9.05	13.34	14.06
Rhode Island	10.48	10.70	11.81	12.12	10.14	10.40	8.51	8.52	11.82	12.35
Vermont	9.74	9.89	10.99	11.45	10.14	10.33	7.58	7.44	12.96	9.56
Middle Atlantic	9.76	9.78	11.84	11.97	10.51	10.57	6.19	6.03	9.66	9.73
New Jersey	10.50	10.54	11.99	12.08	10.32	10.35	8.15	8.11	18.29	18.35
New York	11.13	11.13	14.04	14.12	12.08	12.13	5.62	5.20	9.13	9.17
Pennsylvania	7.96	7.99	9.73	9.90	8.34	8.41	5.93	5.89	11.29	11.71
East North Central	6.48	6.46	8.47	8.55	7.37	7.33	4.43	4.41	6.98	6.93
Illinois	7.69	7.71	10.34	10.43	7.97	7.93	5.24	5.29	6.84	6.84
Indiana	5.23	5.29	6.77	6.95	5.94	6.04	3.93	3.91	9.19	9.44
Michigan	7.10	7.04	8.47	8.57	7.94	7.84	5.08	4.97	10.84	10.88
Ohio	6.30	6.25	8.60	8.63	7.71	7.67	4.21	4.16	6.28	6.12
Wisconsin	5.25	5.22	6.88	6.88	5.68	5.60	3.66	3.72	6.79	6.77
West North Central	5.91	5.89	7.23	7.26	6.19	6.17	4.24	4.25	6.41	6.12
Iowa	5.94	5.97	8.16	8.20	6.53	6.60	3.91	3.96	5.98	6.08
Kansas	6.52	6.31	7.86	7.71	6.67	6.47	4.70	4.51	9.10	5.97
Minnesota	5.54	5.61	7.13	7.23	6.14	6.23	4.26	4.33	7.26	7.12
Missouri	6.11	6.09	7.08	7.09	6.04	6.00	4.44	4.45	7.03	6.77
Nebraska	5.32	5.30	6.29	6.38	5.49	5.46	3.68	3.61	6.49	6.19
North Dakota	5.65	5.65	6.19	6.27	6.07	6.15	4.44	4.38	4.14	4.27
South Dakota	6.18	6.22	7.00	7.08	6.57	6.63	4.45	4.42	4.59	4.72
South Atlantic	6.54	6.51	7.84	7.90	6.60	6.60	4.35	4.25	6.29	6.24
Delaware	6.88	7.00	8.97	9.22	7.00	7.19	4.68	4.82	12.04	12.45
District of Columbia	7.35	7.39	7.77	7.87	7.40	7.43	4.36	4.42	6.41	6.54
Florida	7.18	7.19	7.99	8.08	6.63	6.62	5.11	5.04	6.80	6.80
Georgia	6.43	6.37	7.66	7.74	7.17	7.11	4.29	4.13	8.96	9.05
Maryland	6.96	6.98	8.26	8.33	6.83	6.86	4.15	4.21	8.64	8.80
North Carolina	6.53	6.48	8.05	8.03	6.39	6.43	4.79	4.71	7.02	6.78
South Carolina	5.67	5.50	7.50	7.51	6.38	6.33	3.89	3.71	6.03	6.04
Virginia	6.09	6.14	7.60	7.75	5.91	5.97	3.99	4.00	5.26	5.14
West Virginia	5.21	5.02	6.38	6.26	5.71	5.54	3.91	3.71	9.27	8.71
East South Central	5.04	5.05	6.19	6.27	6.27	6.03	3.86	3.47	6.04	6.00
Alabama	5.35	5.33	6.63	6.74	6.49	6.34	3.90	3.71	6.82	6.45
Kentucky	4.03	4.03	5.55	5.58	5.19	5.29	2.92	2.80	4.66	4.64
Mississippi	6.01	5.91	7.04	7.02	7.09	6.69	4.41	4.12	8.68	8.61
Tennessee	5.24	5.31	5.88	6.03	6.64	5.91	4.52	3.81	7.96	7.88
West South Central	6.08	6.06	7.61	7.62	6.68	6.67	4.11	4.13	6.46	6.24
Arkansas	6.15	6.15	7.77	7.80	6.74	6.78	4.47	4.45	6.58	6.61
Louisiana	6.07	6.36	7.55	7.32	7.12	7.43	4.32	4.98	7.78	6.13
Oklahoma	5.56	5.42	6.71	6.63	5.80	5.73	3.78	3.63	5.08	4.76
Texas	6.16	6.07	7.77	7.84	6.71	6.65	4.03	3.90	6.44	6.53
Mountain	6.00	5.93	7.58	7.52	6.53	6.43	4.11	4.05	5.68	5.38
Arizona	7.54	7.38	8.95	8.82	7.97	7.83	5.19	5.05	5.39	4.84
Colorado	6.05	5.95	7.49	7.42	5.93	5.77	4.35	4.28	7.69	8.00
Idaho	3.96	3.86	5.28	5.15	4.26	4.17	2.68	2.60	4.79	4.68
Montana	4.72	5.20	6.22	6.40	5.51	5.80	3.30	3.66	6.42	6.68
Nevada	5.95	5.61	6.90	6.77	6.61	6.32	4.90	4.48	4.56	3.83
New Mexico	6.76	6.80	8.93	8.92	7.93	7.92	4.35	4.42	5.93	6.17
Utah	5.28	5.17	6.96	6.89	5.90	5.72	3.70	3.49	4.45	4.36
Wyoming	4.31	4.33	6.13	6.22	5.08	5.27	3.45	3.46	7.22	5.84
Pacific Contiguous	7.54	7.56	8.85	8.96	8.40	8.45	5.23	5.16	5.43	6.53
California	9.48	9.54	11.33	11.50	9.83	9.98	6.97	6.95	6.45	7.50
Oregon	4.77	4.61	5.69	5.56	5.15	4.97	3.41	3.23	5.74	6.44
Washington	4.19	4.04	5.03	4.95	4.88	4.79	2.85	2.59	3.84	4.06
Pacific Noncontiguous	11.49	11.66	13.11	13.48	11.45	11.61	9.82	9.86	13.23	14.37
Alaska	10.24	10.07	11.36	11.44	9.58	9.51	8.47	7.48	13.34	14.75
Hawaii	12.12	12.49	14.26	14.80	12.99	13.26	10.03	10.32	12.91	13.20
U. S. Average	6.86	6.85	8.36	8.43	7.64	7.59	4.60	4.53	6.91	6.91

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Notes: •Data for 1997 are preliminary. •Data do not include sales to ultimate consumers by power marketers in several State "retail wheeling" pilot programs. •The average revenue per kilowatthour of electricity sold is calculated by dividing revenue by sales.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

U.S. Electric Utility Financial Statistics

This chapter presents data on the financial results of operations for major U.S. investor-owned and publicly owned electric utilities. Composite financial data on other segments of the U.S. electric utility industry, for example, Federal electric utilities and rural electric cooperatives, are not included. The data exhibited consist of the Composite Statement of Income, the Composite Balance Sheet, Composite Financial Indicators, and Revenue and Expense Statistics. Historical data are provided for a 5-year period on major U.S. investor-owned and U.S. publicly owned electric utilities. Statistics on the average operating expenses for all plants owned by major U.S. investor-owned electric utilities are also provided.

Increasing competition and the pending shift to deregulation are causing utilities to position themselves to meet a changing industry structure through increased operating efficiencies, mergers, and restructuring. In an effort to restructure, utilities may have sold assets such as generating units, formed unregulated utility subsidiaries, or invested in nonutility power producers or foreign enterprises.

Background

Today, virtually all investor-owned electric utilities are subject to State and Federal regulatory jurisdiction. State commissions have the authority to regulate electric rates of utilities engaged in providing service to ultimate consumers (retail sales) and to oversee the issuance of mortgage bonds, debentures, notes, preferred stock, and common stock. The Federal Energy Regulatory Commission (FERC) regulates, among other things, electric rates for interstate wholesale transactions. The ratemaking process sets rates at levels that cover all operating expenses and taxes with a remaining balance that will enable a utility to pay a fair return on funds invested by the stockholders.

A component of any economic regulatory activity is the determination of financing and accounting rules. As a consequence of regulatory jurisdiction, regulations for financing and accounting are more critical to the electric power industry than to most other non-regulated industries. Both FERC and State commissions normally use quasi-judicial proceedings for financial and accounting regulation.

Many of the publicly owned electric utilities are self-regulated, for example, the City of Dover, Delaware), while some fall under the jurisdiction of the public utility commission within the State(s) where they provide electricity to ultimate consumers (as in the State of Ohio). Because of the absence of any require-

ment for reporting to a specific regulatory body, the accounting practices and policies of publicly owned electric utilities vary greatly. Many publicly owned electric utilities use the FERC Uniform System of Accounts or variations of this (and other) accounting systems. As a result, the composite statistics provided must be viewed with an appropriate degree of caution.

Electric utilities must submit data for a 12-month period (which does not necessarily end on December 31) and show consistency in their methods and reporting dates. Because of the respondent burden in preparing this information, publicly owned electric utilities are permitted to use the year-end period on which their fiscal practices are based. Data are provided for the major publicly owned electric utilities by generator and nongenerators.

Composite Statement of Income

This statement provides a summary of the revenue collected from consumers in return for services rendered within the reporting period; reflects the costs incurred by the electric utility in the production and delivery of electricity; and reports the net income or profit that remains for the owners of the business. Because of the unique nature of regulated electric utilities, the income statement that is standard to other nonregulated industries has been recast to reflect the reporting conventions in the electric power industry. For example, accounting for capital used in construction requires additional reporting on the income statement because of the perpetual nature of construction work in progress. Also, on occasion, electric utilities are required to defer the recovery of certain costs and earnings from consumers until a future period. This introduces additional accounting requirements, which must be reflected on all financial statements.

Composite Balance Sheet

The balance sheet represents an accounting at a particular time. For this section, the composite balance sheets are presented for major investor-owned electric utilities at the end of a calendar year and for major publicly owned electric utilities for the 12-month fiscal year ending in 1997. A summary of plant, property, and cash held by the electric utilities, as well as the receivables of the electric utilities, are represented as assets on the composite balance sheet. Future funds obligated by the electric utilities to acquire assets are shown as liabilities and any increased investment by stockholders is shown as capital on the balance sheet.

The standard balance sheet used in the electric power industry emphasizes capital intensity while the balance sheet used by nonregulated industries emphasizes liquidity.

Composite Financial Indicators

The financial statement accounts presented in this chapter represent compiled statistics resulting from the activity of the selected electric utilities. The measurement of how well the electric utility industry performs in different areas can be approximated by comparing some of the asset and income accounts to other relevant accounts. Using the financial statement information, some basic indicators that can be used to analyze or assess the financial condition of the industry are provided. The method used to derive these selected financial indicators is ratio analysis.

Activity ratios of the investor-owned electric utilities evaluate how assets are managed. The electric utility industry is one of the most capital intensive industries in the United States, and activity ratios are paramount indicators of the magnitude of this capital intensity. These ratios demonstrate the financial relationship that exists between the assets and the revenue, sales, and income that these fixed and total assets generate. The ratios on *electric-fixed-asset (net plant) turnover* and *total-asset turnover* assess the efficient use of assets in the generation of income.

Leverage ratios of the investor-owned electric utilities summarize the overall debt burden and debt structure. In addition, these ratios indicate the financial ability to meet debt service requirements and how well management uses leverage to increase the value of the stockholders' investment. The financial soundness of an industry is directly related to the ability of the industry to raise capital and to provide a reasonable return on the capital invested. To measure the ability to do this, a number of indicators are used. *Current assets to current liabilities* is a measure of liquidity. For example, do the investor-owned electric utilities have sufficient cash and other assets (current) that can be quickly converted to cash to cover maturing obligations (current liabilities)? *Long-term debt to capitalization, preferred stock to capitalization, and common-stock equity to capitalization* portray the financial structure and highlight the extent to which debt and other fixed obligations are used to finance operations. *Total debt to total assets* shows the amount of debt that has been incurred in relationship to the total assets possessed. As the value of this ratio increases, the financial risks also become greater and more apparent. *Common-stock equity to total assets* evaluates financial strength. As net worth increases in relationship to total assets, the debt portion is decreased and financial risks are lowered. *Interest coverage before taxes without AFUDC* (Allowance for Funds Used During Construction), a noncash source of income, is an indicator of the ability of the investor-owned electric utility to ensure its payment of annual interest costs and maintain its credit ratings.

Profitability ratios of the investor-owned electric utilities indicate operating effectiveness and are used to further evaluate the management of income. The *profit margin* is equal to net income divided by revenue. This widely used ratio represents the overall measure of income performance. *Return on average-common-stock equity* measures the rate of return on equity capital invested. Since one of the main objectives of management is to earn the highest return permissible, this ratio is the best single measure of the effectiveness of management from the perspective of the stockholders. *Return on investment* measures the overall rate of return that has been earned on assets. This ratio, determined by dividing total assets into net income, provides an indicator of overall financial performance.

Ratios on the publicly owned electric utilities are provided to assist in understanding the financial performance of the publicly owned segment of the industry. Six ratios are calculated from the statement of income. *Electric utility plant per dollar of revenue* highlights the capital intensity of the utility. *Current assets to current liabilities* provides a measure of the ease by which the utility can meet its current obligations. *Electric utility plant as a percent of total assets* represents the total gross investment in electric plant divided by the total assets. A significant variation in this ratio should signal a relatively fundamental change in the activities of the electric utility. *Net electric utility plant as a percent of total assets* represents the remaining book value and a significant variation should signal a change for the electric utility. *Debt as a percent of total liabilities* represents the amount of debt compared to total liabilities and other credits. *Accumulated provision for depreciation as a percent of total electric plant* measures the cost of recovery of the use of the assets over a period of time for an electric utility; an increase indicates that plant asset life is being used up. Five ratios are calculated from the balance sheet. The ratios of *electric operating and maintenance expenses, electric depreciation and amortization, taxes and tax equivalents, and interest on long-term debt to electric operating revenue* are indicators of how resources were used to produce income. *Net income per dollar of revenue* provides the amount of the revenue dollar that exceeds expenses and deductions.

Because a number of initiatives are being considered to promote increased competition in the electric power industry, three operating ratios that measure specific costs associated with the sale of each kilowatthour of electricity have been included. *Purchase Power Cents Per Kilowatthour* is the ratio of the cost of purchased power to the number of kilowatthours purchased. This ratio measures the purchased power component of power supply cost. *Generated Cents Per Kilowatthour* is the ratio of the cost of labor, materials used and expenses incurred in the production of electric generation. This ratio measures the generation component of production expenses. *Total Power Supply Per Kilowatthour Sold* is the ratio of the total cost of power supply to total sales to both ultimate and resale consumers. This ratio measures all power supply costs, including generation and pur-

chase power, associated with the sale of each kilowatthour of electricity.

Revenue and Expense Statistics

Summary revenue and expense statistics are basic to any analysis of the operating soundness of an electric utility. To conduct this analysis, it is necessary to separate the electric utility revenue and expense information from other utility revenue and expense data. Emphasis is placed on total electric operating expenses. Data are presented so that operating costs are separate from maintenance, depreciation, and taxes. For comparative purposes, the ratio of income from utility operations is also included.

Electric Operating Expenses

Before consumers can be provided with electricity, it first must be either produced (generated) or purchased, then transmitted to the general area where it will be consumed, and finally distributed to the individual consumer. Hence, electric utilities separate their costs of providing power into four functional areas: *generation*, *transmission*, *distribution*, and *administration*. Costs incurred at the generation site for the production of electricity are generally referred to as operating expenses.

Operating expenses include recurring expenses to operate and maintain the physical condition or operating efficiency of the plant. These expenses include wages and benefits of the operators, plant maintenance, security, supervision, materials (such as spare parts), and supplies (except fuel consumed during plant operation and maintenance). Fuel expenses include the costs of purchasing, handling, preparing, and transporting fuel. Operating expenses do not include capital carrying costs, such as interest on debt, return on equity, depreciation, amortization expenses, and associated taxes. Capital carrying costs must be added to the operating expenses to obtain total generation expenses.

Investor-owned electric utilities are the major sources of total electricity generation, accounting for about 80 percent of total utility generation in the United States in 1997. Publicly owned electric utilities were responsible for about 10 percent of the total U.S. utility generation, while the remainder was accounted for by Federal and cooperative electric utilities. Operating expenses per unit of output (kilowatthour) for the major investor-owned electric utilities from 1993 through 1997 are provided grouped into the following categories: fossil-fueled steam, nuclear, hydroelectric, and other (includes gas turbine and small scale electric plants).

Data Sources

Financial Statistics. The financial statistics reported in this chapter on the investor-owned electric utilities are compiled from data extracted from the FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." This survey is a restricted-universe census used annually to collect detailed accounting, financial, and operating data from major investor-owned electric utilities having, in each of the last three consecutive years, sales or transmission service that exceeds one or more of the following:

- 1 million megawatthours of total annual sales
- 100 megawatthours of annual sales for resale
- 500 megawatthours of annual power exchanges delivered
- 500 megawatthours of annual wheeling for others (deliveries plus losses).

Effective for 1997, FERC Form 1 data is as accepted as of August 1, 1998, from the FERC World Wide Website (<http://www.ferc.fed.us>). Detailed data for 1993 through 1996 are published in the *Financial Statistics of Major U.S. Investor-Owned Electric Utilities*.¹²

The financial statistics on the publicly owned electric utilities are compiled from data extracted from the Form EIA-412, "Annual Report of Public Electric Utilities." This form is a restricted-universe census used annually to collect detailed accounting, financial, and operating data from major publicly owned electric utilities having, in each of the last 2 consecutive years, sales that exceed either of the following:

- 120,000 megawatthours of sales to ultimate consumers
- 120,000 megawatthours of sales for resale.

Approximately 500 publicly owned electric utilities are required to submit the Form EIA-412. These major publicly owned electric utilities represent about one-fourth of all publicly owned electric utilities and more than 80 percent of total sales by publicly owned electric utilities to ultimate consumers. These electric utilities are requested, but not required, to follow the FERC Uniform System of Accounts. Detailed financial statistics on public electric utilities, Federal electric utilities, and rural electric cooperatives are published in the *Financial Statistics of Major U.S. Publicly Owned Electric Utilities*.¹³

¹² For detailed data, including data for independent power producers and cooperatives jurisdictional to the Federal Energy Regulatory Commission, see *Financial Statistics of Major U.S. Investor-Owned Electric Utilities*, DOE/EIA-0437/1, published annually by the Energy Information Administration (EIA).

¹³ For detailed data see *Financial Statistics of Major U.S. Publicly Owned Electric Utilities*, DOE/EIA-0437/2, published annually by the Energy Information Administration (EIA).

**Table 8. Composite Statement of Income for Major U.S. Investor-Owned Electric Utilities,
1993 Through 1997**
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Operating Revenue	193,637,843	196,281,500	199,966,979	207,459,078	214,322,732
Electric	176,354,365	179,307,260	183,655,263	188,900,781	195,202,204
Gas	16,686,912	16,221,506	15,580,382	17,869,394	18,598,414
Other Utility	596,567	752,734	731,333	688,903	522,114
Operating Expenses	161,908,147	164,207,153	165,321,023	173,920,492	181,758,787
Electric	146,118,013	148,662,734	150,598,710	156,937,816	164,465,582
Operation	91,328,230	93,107,998	91,880,940	97,206,642	103,353,465
Maintenance	12,446,914	12,021,790	11,767,040	12,049,844	12,329,419
Depreciation ¹	18,098,736	18,679,022	19,885,482	21,193,742	23,012,231
Taxes Other Than Income Taxes	13,040,400	13,275,354	13,519,143	13,569,490	13,596,555
Regulatory Debits (net)	429,481	706,108	1,142,138	683,185	641,813
Income Taxes	8,296,900	9,625,569	11,479,763	11,194,656	11,840,864
Deferred Income Tax	2,993,143	1,831,593	1,473,977	1,616,998	-244,674
Investment Tax Credit (Net)	-515,791	-584,701	-549,772	-576,741	-149,218
Gas	15,234,557	14,877,836	14,073,160	16,257,611	16,865,938
Income Taxes	251,533	465,076	531,748	223,871	562,397
Other	14,983,024	14,412,760	13,541,412	16,033,740	8,844,711
Other Utility	555,577	666,584	649,154	725,066	427,267
Income Taxes	10,763	14,963	5,807	-21,775	1,945
Other	544,814	651,621	643,347	746,841	85,586
Operating Income	31,729,696	32,074,346	34,645,955	33,538,586	32,563,945
Electric	30,236,352	30,644,526	33,056,553	31,962,965	30,736,622
Gas	1,452,354	1,343,670	1,507,223	1,611,783	1,732,476
Other	40,990	86,150	82,180	-36,163	94,847
Other Income and Deductions	1,346,398	1,809,553	1,811,414	1,614,287	2,487,488
Allowance for Other Funds Used During Construction	591,445	402,569	315,651	230,791	201,592
Less Taxes	1,119,581	477,529	350,716	597,230	591,711
Deferred Earnings (Misc.) (acct 421)	677,360	802,120	372,642	774,012	257,872
Less Other Income and Expenses ²	-1,197,174	-1,082,393	-1,473,837	-1,206,714	-1,288,447
Total Income Before Interest Charges	33,076,094	33,883,899	36,457,369	35,152,873	35,051,433
Net Interest Charges	14,700,488	14,161,602	14,421,406	13,990,388	14,122,641
Interest Expense	14,566,753	13,915,384	14,169,979	13,645,951	13,801,857
Less Allowance for Borrowed Funds Used During Construction	555,021	420,828	435,386	326,158	331,578
Other Charges--Net	688,756	667,046	686,814	670,597	237,721
Net Income Before Extraordinary Charges	18,375,606	19,722,298	22,035,963	21,162,485	20,928,793
Less Extraordinary Items After Taxes²	484,409	-165,288	-24,691	-65,696	2,537,855
Net Income	17,891,198	19,887,586	22,060,655	21,228,180	18,390,938
 Dividends Declared - Preferred Stock	 1,765,286	 1,581,940	 1,518,904	 1,248,409	 1,024,760
Earnings Available for Common Stocks	16,125,912	18,305,646	20,541,751	19,979,771	17,366,178
Dividends Declared - Common Stock	15,334,377	15,875,659	16,249,715	16,810,054	17,786,231
Additions Total Earnings	296,171	2,063,432	4,281,899	2,193,444	-755,318

¹ Includes amortization and depletion.

² Other Income and Expenses and Extraordinary Items After Taxes were affected negatively by aftertax write offs, accounting adjustments, and regulatory rate decisions.

Notes: •Data are final. •Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.


**Table 9. Composite Balance Sheet for Major U.S. Investor-Owned Electric Utilities,
1993 Through 1997
(Thousand Dollars)**

Description	1993	1994	1995	1996	1997
Assets					
Utility Plant - Net	393,829,243	397,812,254	397,383,148	396,437,823	382,168,627
Electric Utility Plant - Net	363,829,459	366,936,417	366,116,061	363,853,762	351,952,558
Electric Utility Plant	519,207,367	535,928,383	553,857,823	569,968,617	578,892,994
Construction Work in Progress	18,048,849	17,148,353	13,523,358	11,395,525	11,051,910
Less Accumulated Depreciation	173,426,756	186,140,318	201,265,120	217,510,379	237,992,346
Nuclear Fuel - Net	5,964,178	5,656,878	5,285,850	5,443,854	5,285,254
Other Utility Plant - Net	24,035,606	25,218,959	25,981,238	27,140,206	28,423,520
Unaccounted for plant	—	—	—	—	-3,492,705
Other Property and Investments	20,063,695	23,479,360	27,987,677	33,119,898	42,463,011
Current and Accrued Assets	42,409,989	41,262,977	44,139,661	43,515,064	47,050,759
Deferred Debits	110,338,355	111,957,082	109,423,227	108,918,179	111,606,444
Total Assets and other Debits	566,641,282	574,511,673	578,933,714	581,990,963	587,418,412
Capitalization and Liabilities					
Capitalization	360,455,273	364,724,736	365,774,716	365,782,779	370,755,230
Common Stock Equity (End of Year)	160,296,897	164,482,824	170,497,132	174,325,424	175,451,908
Common Stock	107,470,838	109,522,096	111,301,825	112,633,284	113,852,964
Retained Earnings (Adjusted)	52,826,059	54,960,728	59,195,307	61,692,140	61,598,944
Preferred Stock	25,304,294	24,859,833	21,569,105	18,830,248	16,253,063
Long-term Debt	174,854,082	175,382,079	173,708,479	172,627,107	179,050,259
Current Liabilities and Deferred Credits	206,186,010	209,786,937	213,158,998	216,208,185	216,663,182
Other Noncurrent Liabilities	11,478,303	13,452,636	14,352,102	15,309,391	15,992,675
Current and Accrued Liabilities	48,878,976	48,035,058	49,929,403	49,341,620	51,112,314
Deferred Credits	145,828,731	148,299,243	148,877,493	151,557,174	149,558,193
Accumulated Deferred Income Taxes	104,964,188	107,054,667	108,615,175	110,537,249	107,426,447
Accumulated Deferred Investment Tax Credit	13,428,995	12,784,415	12,138,942	11,491,332	10,836,884
Other Deferred Credits (Adjusted)	27,435,549	28,460,160	28,123,375	29,528,592	31,294,862
Total Liabilities and Other Credits	566,641,282	574,511,673	578,933,714	581,990,963	587,418,412

Notes: *Data are final. *Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.


Figure 10. Allocation of the Revenue Dollar from Electric Operations for Major U.S. Investor-Owned Electric Utilities, 1997

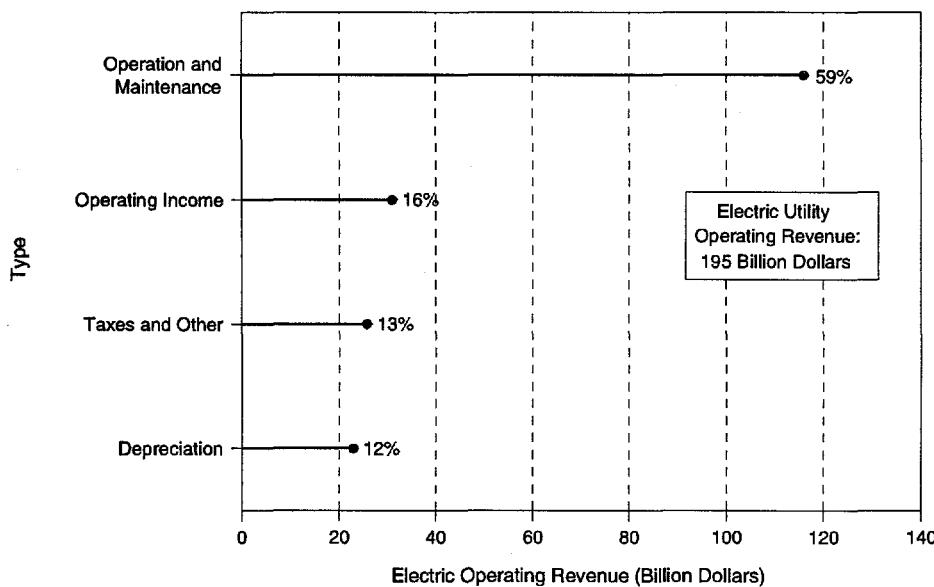

Notes: •Depreciation includes amortization and depletion. •Totals may not equal sum of components because of independent rounding. •Data are final.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

Figure 11. Electric Operating Expenses for Major U.S. Investor-Owned Electric Utilities, 1997

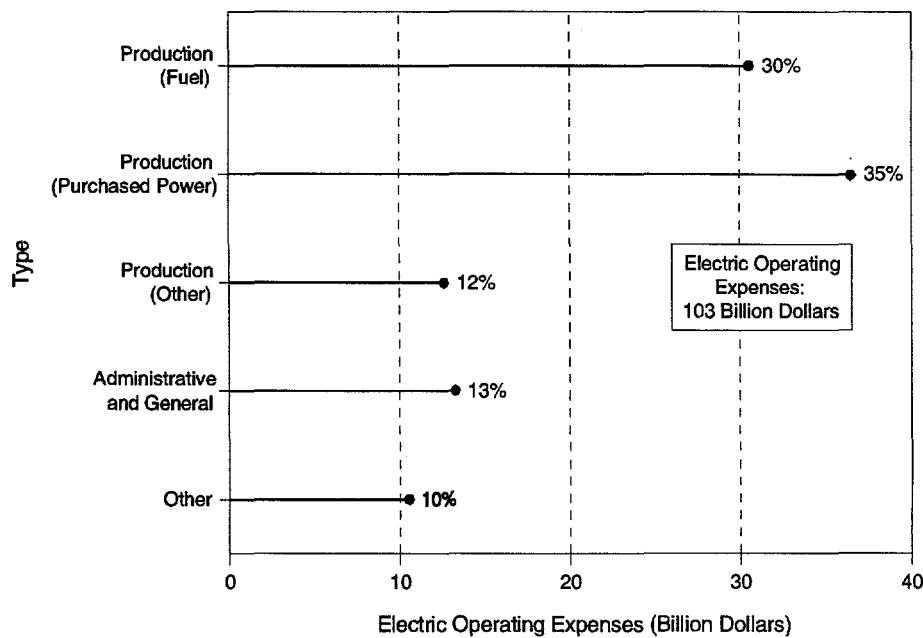

Notes: •Other includes transmission, distribution, customer account, customer service, and sales. •Totals may not equal sum of components because of independent rounding. •Data are final.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

Table 10. Composite Financial Indicators for Major U.S. Investor-Owned Electric Utilities, 1993 Through 1997

Description ¹	1993	1994	1995	1996	1997
Activity					
1. Electric Fixed Asset (Net Plant) Turnover.....	0.48	0.49	0.50	0.52	0.55
2. Total Asset Turnover.....	.34	.34	.35	.36	.36
Leverage					
3. Current Assets to Current Liabilities87	.86	.88	.88	.92
4. Long-term Debt to Capitalization	48.51	48.09	47.49	47.19	48.29
5. Preferred Stock to Capitalization.....	7.02	6.82	5.90	5.15	4.38
6. Common Stock Equity to Capitalization.....	44.47	45.10	46.61	47.66	47.32
7. Total Debt to Total Assets ²	32.48	32.35	31.89	31.57	32.23
8. Common Stock Equity to Total Assets	28.29	28.63	29.45	29.95	29.87
9. Interest Coverage Before Taxes without AFUDC	2.78	3.10	3.37	3.36	3.39
Profitability					
10. Profit Margin.....	9.24	10.13	11.03	10.23	8.58
11. Return on Average Common Stock Equity ³	22.32	12.24	13.17	12.31	10.52
12. Return on Investment.....	3.16	3.46	3.81	3.65	3.13

¹ Indicators 1, 2, 3, and 9 are ratios. Indicators 4 through 8 and 10 through 12 are percentages.

² Total debt is the sum of Long-term Debt and Short-term Debt. The values for Short-term Debt included in Current and Accrued Liabilities (Notes Payable) \$10,259,434,000 for 1997; \$11,129,401,000 for 1996; \$10,895,101,000 for 1995; \$10,448,573,000 for 1994, and \$9,210,845,000 for 1993.

³ The Average Common Stock Equity is the average of the beginning and ending year balances. The value for the beginning of 1993 was \$156,346,650,000.

AFUDC=Allowance for Funds Used During Construction.

Notes: *Data are final. *Formulas for computing the financial indicators are in Appendix A. *Indicators 4, 5, and 6 may not sum to 100 percent because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

**Table 11. Revenue and Expense Statistics for Major U.S. Investor-Owned Electric Utilities,
1993 Through 1997**
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Utility Operating Revenues	193,637,843	196,281,500	199,966,979	207,459,078	214,322,732
Electric Utility	176,354,365	179,307,260	183,655,263	188,900,781	195,202,204
Other Utility	17,283,479	16,974,240	16,311,715	18,558,297	19,120,528
Utility Operating Expenses	161,908,147	164,207,153	165,321,023	173,920,492	181,758,787
Electric Utility	146,118,013	148,662,734	150,598,710	156,937,816	164,465,582
Operation	91,328,230	93,107,998	91,880,940	97,206,642	103,353,465
Production	68,780,803	69,268,652	68,983,410	73,436,927	77,608,042
Cost of Fuel	31,214,057	30,107,888	29,121,982	30,706,261	30,540,202
Purchased Power	27,715,512	29,213,084	29,981,379	32,987,034	36,549,764
Other	9,851,234	9,947,680	9,880,049	9,743,632	10,518,076
Transmission	1,354,058	1,361,080	1,425,058	1,503,196	1,818,428
Distribution	2,595,023	2,581,409	2,560,835	2,604,058	2,661,846
Customer Accounts	3,418,487	3,546,489	3,613,101	3,848,302	3,690,914
Customer Service	1,852,267	1,955,991	1,922,475	1,920,450	1,907,798
Sales	203,291	231,589	348,345	435,477	485,909
Administrative and General	13,124,300	14,162,788	13,027,716	13,458,234	13,342,096
Maintenance	12,446,914	12,021,790	11,767,040	12,049,844	12,329,419
Depreciation	18,098,736	18,679,022	19,885,482	21,193,742	23,012,231
Taxes and Other	24,244,133	24,853,924	27,065,248	26,487,588	25,770,467
Other Utility	15,790,134	15,544,420	14,722,314	16,982,677	17,293,205
Net Utility Operating Income	31,729,696	32,074,346	34,645,955	33,538,586	32,563,945

Notes: *Data are final. *Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

**Table 12. Revenue and Expense Percentages for Major U.S. Investor-Owned Electric Utilities,
1993 Through 1997**

Description	1993	1994	1995	1996	1997
Utility Operating Revenues	100.0	100.0	100.0	100.0	100.0
Electric Utility	91.1	91.4	91.8	91.1	91.1
Other Utility	8.9	8.6	8.2	8.9	8.9
Utility Operating Expenses	83.6	83.7	82.7	83.8	84.8
Electric Utility	75.5	75.7	75.3	75.6	76.7
Operation	47.2	47.4	45.9	46.9	48.2
Production	35.5	35.3	34.5	35.4	36.2
Cost of Fuel	16.1	15.3	14.6	14.8	14.2
Purchased Power	14.3	14.9	15.0	15.9	17.1
Other	5.1	5.1	4.9	4.7	4.9
Transmission	.7	.7	.7	.7	.8
Distribution	1.3	1.3	1.3	1.3	1.2
Customer Accounts	1.8	1.8	1.8	1.9	1.7
Customer Service	1.0	1.0	1.0	.9	.9
Sales	.1	.1	.2	.2	.2
Administrative and General	6.8	7.2	6.5	6.5	6.2
Maintenance	6.4	6.1	5.9	5.8	5.8
Depreciation	9.3	9.5	9.9	10.2	10.7
Taxes and Other	12.5	12.7	13.5	12.8	12.0
Other Utility	8.2	7.9	7.4	8.2	8.1
Net Utility Operating Income	16.4	16.3	17.3	16.2	15.2

Notes: *Data are final. *Percents in this table are percentage of utility operating revenues. *Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

**Table 13. Average Operating Expenses for Major U.S. Investor-Owned Electric Utilities,
1993 Through 1997
(Mills per Kilowatthour)**

Plant Type	1993	1994	1995	1996	1997 ¹
Operation					
Nuclear.....	10.20	9.79	9.43	9.47	11.50
Fossil Steam.....	2.37	2.32	2.38	2.25	2.28
Hydroelectric ²	3.82	4.53	3.69	3.87	3.26
Gas Turbine and Small Scale ³	6.47	4.58	3.57	5.08	4.58
Maintenance					
Nuclear.....	5.73	5.20	5.21	5.68	7.40
Fossil Steam.....	2.96	2.82	2.65	2.49	2.40
Hydroelectric ²	2.65	2.90	2.19	2.08	2.47
Gas Turbine and Small Scale ³	7.52	5.39	4.28	4.98	3.45
Fuel					
Nuclear.....	5.88	5.87	5.75	5.50	5.89
Fossil Steam.....	17.65	16.67	16.07	16.51	16.67
Hydroelectric ²	—	—	—	—	—
Gas Turbine and Small Scale ³	26.39	22.19	20.83	30.58	24.91
Total⁴					
Nuclear.....	21.80	20.86	20.39	20.65	24.80
Fossil Steam.....	22.97	21.80	21.11	21.25	21.34
Hydroelectric ²	6.47	7.43	5.89	5.95	5.73
Gas Turbine and Small Scale ³	40.38	32.16	28.67	40.64	32.94

¹ Geysers are reported in the gas turbine and small scale category.

² Includes Pumped Storage.


³ Includes gas turbine, internal combustion, photovoltaic, and wind plants.

⁴ Totals may not equal sum of components because of independent rounding.

Notes: *Data are final. *Expenses are average expenses weighted by net generation. •A mill is a monetary cost and billing unit equal to 1/1000 of the U.S. dollar (equivalent to 1/10 of 1 cent).

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

Figure 12. Average Operating Expenses of Fossil-Fueled and Nuclear Steam-Electric Plants for Major U.S. Investor-Owned Electric Utilities, 1997

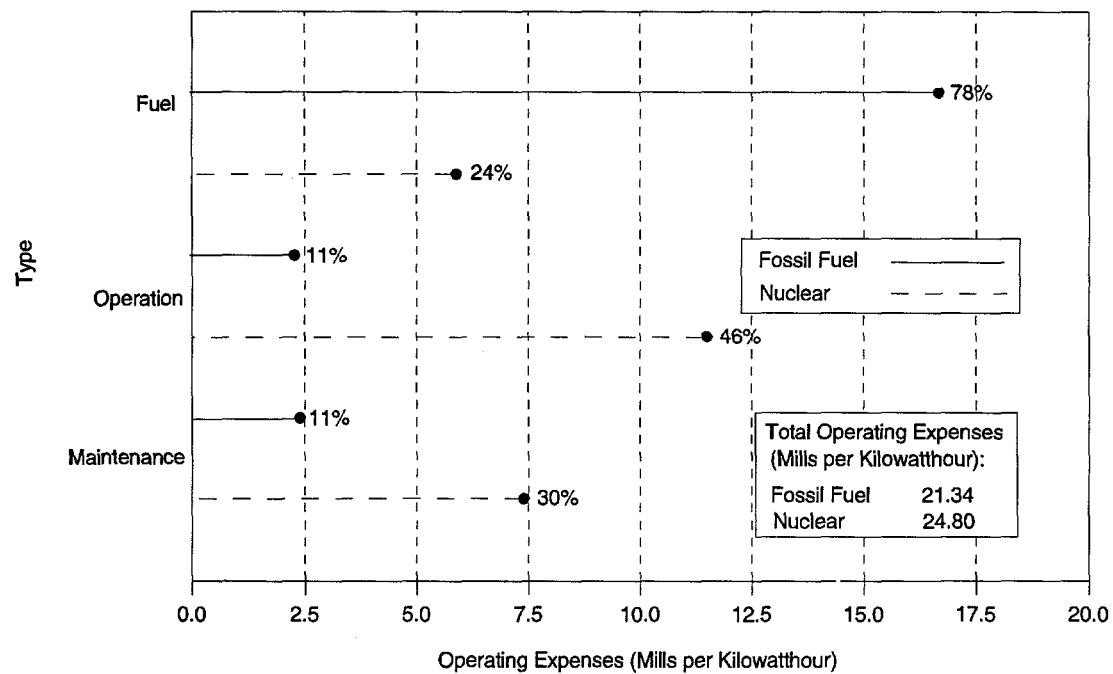

Notes: •Data are final. •Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others." The 1997 data are as accepted from the FERC World Wide Web site. See Appendix A for a detailed description of this restricted-universe census.

Table 14. Composite Statement of Income for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Operating Revenue - Electric	22,521,847	23,266,686	23,472,888	24,207,226	24,573,087
Operating Expenses - Electric	18,162,164	18,648,687	18,958,876	19,083,980	19,663,371
Operation Excluding Fuel	9,803,647	10,191,897	11,167,114	11,270,829	11,183,926
Fuel	3,437,920	3,385,718	2,485,770	2,497,215	3,088,158
Maintenance	1,565,293	1,584,444	1,575,208	1,637,828	1,579,353
Depreciation and Amortization	2,596,099	2,720,560	2,933,594	3,015,664	3,190,160
Taxes and Tax Equivalents	759,205	766,068	797,189	662,443	621,773
Operating Income - Electric	4,359,683	4,617,999	4,514,013	5,123,246	4,909,716
Other Income and Deductions	1,219,709	1,098,922	1,174,316	1,237,173	1,308,973
Income from Electric Plant Leased to Others	23,576	30,242	16,365	25,914	15,774
Allowance for Funds Used During Construction	28,476	7,872	9,145	6,660	4,320
Other Income Net	1,455,984	1,237,067	1,371,621	1,440,435	1,431,983
Less Other Electric Deductions	288,325	176,259	222,815	235,836	143,103
Total Income Before Interest Charges	5,579,392	5,716,920	5,688,329	6,360,419	6,218,689
Net Interest Charges	4,682,023	4,681,141	4,728,063	4,634,548	4,633,262
Interest Expenses	4,433,067	4,332,296	4,206,294	4,155,829	4,074,820
Other Income Deductions	248,956	348,845	521,769	478,719	558,442
Net Income Before Extraordinary Charges	897,369	1,035,779	960,266	1,725,871	1,585,427
Less Extraordinary Items	214,227	124,211	-250,918	-2,304	7,739
Net Income	683,142	911,568	1,211,184	1,723,567	1,577,688

Notes: *Data for 1997 are preliminary; data for prior years are final. *Totals may not equal sum of components because of independent rounding. *The number of publicly owned generating electric utilities that reported were 227 for 1997, 231 for 1996, 226 for 1995, 227 for 1994, and 226 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 15. Composite Balance Sheet for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Assets					
Electric Utility Plant-Net Inc Nuclear Fuel	62,477,584	63,576,104	63,412,608	64,159,411	62,992,537
Electric Utility Plant Inc Nuclear Fuel	88,353,146	92,044,086	93,771,319	97,433,005	98,769,397
Accumulated Provision for Depreciation and Amortization	25,875,562	28,467,982	30,358,711	33,273,595	35,776,860
Other Property and Investments	20,487,402	20,973,996	20,996,914	19,674,912	19,939,322
Current and Accrued Assets	15,357,112	15,782,291	15,086,442	16,521,745	16,620,790
Deferred Debits	13,987,324	13,913,754	14,242,677	13,520,724	13,539,129
Total Assets and Other Debits	112,309,422	114,246,146	113,738,640	113,876,791	113,091,778
Liabilities and Other Credits					
Investment of Municipality - Surplus	23,527,598	24,518,851	25,447,162	27,472,346	28,310,163
Long-Term Debt	76,168,783	76,815,309	74,982,156	73,950,415	72,279,199
Other Noncurrent Liabilities	590,789	701,406	714,354	766,093	572,995
Current and Accrued Liabilities	8,594,053	8,913,155	9,084,862	8,167,668	8,399,399
Deferred Credits	3,428,200	3,297,425	3,510,106	3,520,270	3,530,023
Total Liabilities and Other Credits	112,309,422	114,246,146	113,738,640	113,876,791	113,091,778

Notes: *Data for 1997 are preliminary; data for prior years are final. *Totals may not equal sum of components because of independent rounding. *The number of publicly owned generating electric utilities that reported were 227 for 1997, 231 for 1996, 226 for 1995, 227 for 1994, and 226 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 16. Composite Financial Indicators for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997

Description	1993	1994	1995	1996	1997
Electric Utility Plant per Dollar of Revenue	3.9	4.0	4.0	4.0	4.0
Current Assets to Current Liabilities	1.8	1.8	1.7	2.0	2.0
Electric Utility Plant as a Percent of Total Assets.....	78.7	80.6	82.4	85.6	87.3
Net Electric Utility Plant as a Percent of Total Assets.....	55.6	55.6	55.8	56.3	55.7
Debt as a Percent of Total Liabilities	75.5	75.0	73.9	72.1	71.3
Accumulated Provision for Depreciation as a Percent of Electric Utility Plant.....	29.3	30.9	32.4	34.2	36.2
Electric Operation and Maintenance Expenses as a Percent of Electric Operating Revenues	65.7	65.2	64.9	63.6	64.5
Electric Depreciation and Amortization as a Percent of Electric Operating Revenues.....	10.8	11.1	11.9	11.9	12.3
Taxes and Tax Equivalents as a Percent of Electric Operating Revenues	3.4	3.3	3.4	2.7	2.5
Interest Expenses as a Percent of Electric Operating Revenues.....	19.7	18.6	17.9	17.2	16.6
Net Income as a Percent of Electric Operating Revenues	3.0	3.9	5.2	7.1	6.4
Purchase Power Cents Per Kilowatthour	3.6	3.6	3.6	3.8	3.2
Generated Cents Per Kilowatthour	1.9	1.9	1.8	1.5	1.7
Total Power Supply Per Kilowatthour Sold	2.6	2.6	2.5	2.4	2.3

Notes: •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •The number of publicly owned generating electric utilities that reported were 227 for 1997, 231 for 1996, 226 for 1995, 227 for 1994, and 226 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 17. Revenue and Expense Statistics for Major U.S. Publicly Owned Generator Electric Utilities, 1993 Through 1997
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Operating Revenue - Electric	22,521,847	23,266,686	23,472,888	24,207,226	24,573,087
Operating Expenses - Electric	18,162,164	18,648,687	18,958,876	19,083,980	19,663,371
Operation Including Fuel	13,241,567	13,577,615	13,652,884	13,768,044	14,272,084
Production.....	10,254,301	10,444,534	10,384,858	11,080,348	10,912,901
Transmission.....	579,635	609,612	628,098	344,371	717,303
Distribution.....	408,335	429,535	425,831	497,019	521,828
Customer Accounts	314,992	316,794	323,122	365,277	382,615
Customer Service	94,089	104,101	102,061	103,390	131,565
Sales.....	17,210	22,436	19,617	17,528	45,549
Administrative and General	1,573,005	1,650,603	1,769,298	1,360,111	1,560,322
Maintenance.....	1,565,293	1,584,444	1,575,208	1,637,828	1,579,353
Depreciation and Amortization	2,596,099	2,720,560	2,933,594	3,015,664	3,190,160
Taxes and Tax Equivalents	759,205	766,068	797,189	662,443	621,773
Income from Electric Utility Operations	4,359,683	4,617,999	4,514,013	5,123,246	4,909,716

Notes: •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •The number of publicly owned generating electric utilities that reported were 227 for 1997, 231 for 1996, 226 for 1995, 227 for 1994, and 226 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 18. Composite Statement of Income for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Operating Revenue - Electric	7,523,453	7,995,632	8,435,445	8,573,080	8,833,965
Operating Expenses - Electric	7,063,260	7,566,745	7,978,811	8,114,610	8,288,991
Operation Excluding Fuel	6,424,783	6,857,958	7,172,611	7,351,011	7,443,795
Fuel	15	13	247	—	142
Maintenance	207,046	233,967	249,580	243,969	274,337
Depreciation and Amortization	256,736	273,770	312,724	313,479	336,121
Taxes and Tax Equivalents	174,681	201,038	243,648	206,151	234,596
Operating Income - Electric	460,193	428,887	456,634	458,470	544,973
Other Income and Deductions	98,822	97,664	142,214	153,710	126,541
Income from Electric Plant Leased to Others	2,405	2,185	4,345	12,569	5,707
Allowance for Funds Used During Construction	106	51	41	70	311
Other Income Net	172,569	178,515	215,559	207,720	200,824
Less Other Electric Deductions	76,258	83,086	77,731	66,649	80,301
Total Income Before Interest Charges	559,015	526,551	598,847	612,180	671,514
Net Interest Charges	172,792	156,433	168,632	148,098	162,556
Interest Expenses	114,527	108,647	127,013	99,730	119,376
Other Income Deductions	58,264	47,786	41,619	48,367	43,180
Net Income Before Extraordinary Charges	386,223	370,118	430,215	464,082	508,959
Less Extraordinary Items	25,600	3,821	6,659	4,110	1,979
Net Income	360,623	366,297	423,556	459,972	506,979

Notes: *Data for 1997 are preliminary; data for prior years are final. *Totals may not equal sum of components because of independent rounding. *The number of publicly owned nongenerating electric utilities that reported were 304 for 1997, 284 for 1996, 286 for 1995, 276 for 1994, and 269 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 19. Composite Balance Sheet for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997
(Thousand Dollars)

Description	1993	1994	1995	1996	1997
Assets					
Electric Utility Plant-Net Inc Nuclear Fuel	5,268,229	5,496,059	6,272,158	6,256,424	6,956,310
Electric Utility Plant Inc Nuclear Fuel	8,317,096	8,759,850	9,936,064	9,917,693	11,080,160
Accumulated Provision for					
Depreciation and Amortization	3,048,867	3,263,791	3,663,906	3,661,269	4,123,849
Other Property and Investments	1,911,724	1,904,194	2,196,898	1,883,118	2,046,670
Current and Accrued Assets	2,495,760	2,497,816	2,884,088	2,699,760	2,974,420
Deferred Debits	423,907	400,447	492,691	407,885	466,308
Total Assets and Other Debits	10,099,620	10,298,517	11,841,016	11,247,157	12,443,708
Liabilities and Other Credits					
Investment of Municipality - Surplus	5,983,376	6,281,647	6,938,969	7,145,596	7,979,250
Long-Term Debt	2,898,817	2,723,507	3,441,757	2,591,327	2,913,395
Other Noncurrent Liabilities	10,749	11,414	16,179	17,991	31,971
Current and Accrued Liabilities	1,039,867	1,098,941	1,232,623	1,262,762	1,259,026
Deferred Credits	166,812	183,009	211,487	229,481	260,066
Total Liabilities and Other Credits	10,099,620	10,298,517	11,841,016	11,247,157	12,443,708

Notes: *Data for 1997 are preliminary; data for prior years are final. *Totals may not equal sum of components because of independent rounding. *The number of publicly owned nongenerating electric utilities that reported were 304 for 1997, 284 for 1996, 286 for 1995, 276 for 1994, and 269 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

Table 20. Composite Financial Indicators for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997

Description	1993	1994	1995	1996	1997
Electric Utility Plant per Dollar of Revenue	1.1	1.1	1.2	1.2	1.3
Current Assets to Current Liabilities	2.4	2.3	2.3	2.1	2.4
Electric Utility Plant as a Percent of Total Assets.....	82.4	85.1	83.9	88.2	89.0
Net Electric Utility Plant as a Percent of Total Assets.....	52.2	53.4	52.9	55.6	55.9
Debt as a Percent of Total Liabilities	39.0	37.1	39.5	34.3	32.5
Accumulated Provision for Depreciation as a Percent of Electric Utility Plant.....	36.7	37.3	36.9	36.9	37.2
Electric Operation and Maintenance Expenses as a Percent of Electric Operating Revenues	88.1	88.7	88.0	88.6	87.4
Electric Depreciation and Amortization as a Percent of Electric Operating Revenues.....	3.4	3.4	3.7	3.6	3.8
Taxes and Tax Equivalents as a Percent of Electric Operating Revenues	2.3	2.5	2.9	2.4	2.7
Interest Expenses as a Percent of Electric Operating Revenues.....	1.5	1.4	1.5	1.2	1.4
Net Income as a Percent of Electric Operating Revenues	4.8	4.6	5.0	5.4	5.7
Purchase Power Cents Per Kilowatthour	4.1	4.1	4.3	4.0	3.1

Notes: •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •The number of publicly owned nongenerating electric utilities that reported were 304 for 1997, 284 for 1996, 286 for 1995, 276 for 1994, and 269 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

**Table 21. Revenue and Expense Statistics for Major U.S. Publicly Owned Nongenerator Electric Utilities, 1993 Through 1997
(Thousand Dollars)**

Description	1993	1994	1995	1996	1997
Operating Revenue - Electric	7,523,453	7,995,632	8,435,445	8,573,080	8,833,965
Operating Expenses - Electric	7,063,260	7,566,745	7,978,811	8,114,610	8,288,991
Operation Including Fuel	6,424,798	6,857,970	7,172,858	7,351,011	7,443,937
Production.....	5,760,626	6,185,035	6,421,965	6,571,536	6,601,168
Transmission.....	33,755	34,045	35,184	50,446	64,942
Distribution.....	189,023	190,181	204,130	233,861	252,801
Customer Accounts	117,353	119,019	125,143	141,178	133,702
Customer Service	17,166	16,941	17,934	18,238	18,100
Sales.....	8,704	9,845	9,535	11,615	13,493
Administrative and General	298,171	302,904	358,367	324,137	359,732
Maintenance.....	207,046	233,967	249,580	243,969	274,337
Depreciation and Amortization	256,736	273,770	312,724	313,479	336,121
Taxes and Tax Equivalents	174,681	201,038	243,648	206,151	234,596
Income from Electric Utility Operations	460,193	428,887	456,634	458,470	544,973

Notes: •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •The number of publicly owned nongenerating electric utilities that reported were 304 for 1997, 284 for 1996, 286 for 1995, 276 for 1994, and 269 for 1993.

Source: Energy Information Administration, Form EIA-412, "Annual Report of Public Electric Utilities."

U.S. Electric Utility Environmental Statistics

When fossil fuels are burned in the production of electricity, a variety of gases and particulates are formed. If these gases and particulates are not captured by some pollution control equipment, they are released into the atmosphere. This chapter provides a brief summary of the gaseous emissions from U.S. electric utilities and the methods employed to reduce or eliminate their release into the atmosphere.

Background

Among the gases emitted during the burning of fossil fuels are sulfur dioxide (SO_2), nitrogen oxides (NO_x), and carbon dioxide (CO_2). Coal-fired generating units produce more SO_2 and NO_x than other fossil-fuel units for two reasons. First, because coal generally contains more sulfur than other fossil fuels, it creates more SO_2 when burned. Second, there are more emissions from coal-fired plants because more coal-fired capacity than other fossil-fueled capacity is in use.

Sulfur is an element that is present in almost all coal, although some kinds of coal contain more sulfur than others depending on the geographic location of the coal mine and the type of coal being mined. Western coal has less sulfur than eastern coal. More than one-half of the coal mined in the West is subbituminous coal that is low in sulfur content (about 0.5 percent) and contains approximately 9,000 Btu per pound. Bituminous eastern coal can exceed both a 5-percent sulfur content and a heat content of 12,000 Btu per pound. The average percent of sulfur contained in coal ranges from 0.3 percent in the West to approximately 2.5 percent in the East. During combustion, the sulfur combines with the oxygen in the air to form SO_2 . As the SO_2 mixes further with oxygen and trace substances in the air, a variety of sulfate compounds emerges. How these transformations take place, and in what proportions, is a subject of vigorous research. The behavior of SO_2 emissions depends partly on the type of coal used and how it is burned. In addition, the presence of light, moisture, and other pollutants in the atmosphere may also be important in triggering the complex changes that SO_2 emissions undergo. To a lesser degree, sulfur is also contained in petroleum and varies according to the type of petroleum (for example, light oil, heavy oil, etc.). Petroleum burned at utility power plants ranges from containing almost no sulfur to about 3.5 percent sulfur. The weighted average percent of sulfur contained in petroleum consumed by utility plants ranges from about .5 percent in western plants to about 1.4 percent for plants in New England. The amount of sulfur contained in natural gas is insignificant.

Nitrogen is a colorless, odorless gas that makes up about 78 percent of the atmosphere. Nitrogen in the atmosphere during the combustion process (burning of fuels at the plant) combines with oxygen and water to form several NO_x compounds. Also, a small amount of nitrogen in the coal is converted to NO_x . The most important is nitrogen dioxide, one of the compounds that gives photochemical smog its characteristic yellowish-brown color. Only about 10 percent of the nitrogen compounds in the air are the result of human activity. The rest are formed by natural processes, such as the decay of organic matter. However, since the human-made 10 percent is emitted mostly in industrial urban areas, concentration there can become high enough to cause concern.

SO_2 and NO_x are called precursors to acid deposition, because, under the right set of conditions, they react with other chemicals in the atmosphere to form sulfuric acid and nitric acid, respectively. These two acids do not accumulate in the atmosphere, but are absorbed by rain droplets, thus cleansing the atmosphere but discharging the acid onto the earth in the form of "acid rain." In addition, sulfuric acid may form microscopic droplets that can be deposited directly onto the ground. This form of deposition, as well as the direct capture of SO_2 by vegetation, is referred to as dry deposition.

CO_2 is a colorless, odorless, nontoxic gas formed by the combustion of carbon and carbon compounds found in coal, petroleum, and gas. Currently, the only way to limit the emission of CO_2 when burning fossil fuels is extremely expensive. CO_2 is normally removed from the atmosphere by green plants and absorbed by the ocean. The increased use of fossil fuels in recent years, as well as extensive deforestation, has caused a buildup of CO_2 in the atmosphere. This increase of CO_2 causes the atmosphere to absorb infrared radiation reflected from the earth that would otherwise have been dissipated into space. This phenomenon could increase average global temperature. It is called the "greenhouse" effect because it is similar to the trapping of the sun energy in a greenhouse. These potential increases in temperatures are of concern because they could cause significant climatic changes, shifts in agricultural zones, and partial melting of the polar ice caps resulting in flooding of coastal areas. However, significant uncertainties exist regarding global warming, and no conclusions can be drawn regarding future warming based on past temperature records.

Efforts are underway to determine what methods can be employed to reduce or eliminate the release of CO_2 from power plants. Tail gas cleanup (CO_2 scrubbing) is currently the only technological option. This option

would require the adaptation by the electric utility industry of acid gas removal technologies used by the petroleum and petrochemical industries. Because of the potential expense involved and the uncertainty concerning the impacts of emissions from the gas, no emission standards or required reductions exist.

Additionally, the Department of Energy is developing clean coal technologies (such as pressurized fluidized-bed combustion) for new plants and repowering applications. Due to the increased conversion efficiencies of these technologies, CO_2 emissions are reduced.

Emission Standards

To respond to concerns about emissions of SO_2 and NO_x as well as several other air pollutants, Congress passed the Clean Air Act (CAA) in 1963. It was not until 1970, however, that the Environmental Protection Agency was empowered to set enforceable air quality standards. In 1971, this Agency established New Source Performance Standards (NSPS) that required coal-fired utility boilers built after August 17, 1971, to emit no more than 1.2 pounds of SO_2 per million Btu of heat input. Requirements for NO_x were more complex, with allowable limits ranging from 0.2 pounds per million Btu to 0.8 pounds per million Btu, depending on the type of fuel burned and the combustion device used.

In 1977, Congress amended the CAA to require States to set limits on existing sources in regions not attaining goals established in the Act. In 1979, the Environmental Protection Agency established the Revised New Source Performance Standards (RNSPS). The new standards retain the 1971 NSPS of 1.2 pounds of SO_2 per million Btu of heat input, but require SO_2 emissions from all new or modified (post 1978) boilers to be reduced by at least 90 percent unless 90-percent removal reduces emissions to less than 0.6 pounds per million Btu. If emissions fall below that level, reductions between 70 and 90 percent are permitted, depending on the sulfur content of the coal. RNSPS for NO_x are complex and, as with NSPS, set limits varying from 0.2 to 0.8 pounds per million Btu, depending on the type of fuel burned and combustion device used. RNSPS for NO_x differ from NSPS in the number of categories of combustion into which they are divided.

The primary goals of the Clean Air Act Amendments (CAAA) of 1990 that affect generators of electricity are a 10-million-ton reduction in SO_2 emissions and a 2-million-ton reduction in NO_x emissions from 1980 levels. The reduction in SO_2 is to occur in two phases that begin in 1995 and 2000, respectively. The CAAA established an innovative marketable emission allowance program. It also contains a list of the allowances to be issued in Phase 1, and the Environmental Protection Agency published a preliminary list of Phase 2 allowances in June 1992.

Emission Reductions

Sulfur Dioxide. One method available to reduce the SO_2 emitted when burning coal is to switch to a coal that has a lower sulfur content. Emissions of sulfur dioxide may also be reduced by using less polluting fuels, particularly gas. Another approach is to install equipment designed to remove SO_2 from the gas (flue gas) released through the flues of the plant. Additional methods for reducing emissions of SO_2 , which include converting boilers to the fluidized-bed combustion process and employing the technology of integrated-gasification combined cycle, are currently under study and not in extensive use.

Nitrogen Oxides. Formation of NO_x is less dependent on what type of fuel is burned than on how the fuel is burned. Apart from the nitrogen content of the fuel, the extent of nitric-oxide formation depends primarily on the combustion temperature. NO_x emissions can be reduced by low excess-air firing; low-combustion temperatures; use of low-nitrogen fuels (such as natural gas and light distillate oil); staged combustion in which localized fuel-rich conditions are created where both thermal and fuel NO_x are minimized; and use of low- NO_x burners and fluidized-bed combustion.

Environmental Equipment

While not the only kind of environmental equipment installed at power plants, flue gas desulfurization units, particulate collectors, and cooling towers are the most significant. In a flue gas desulfurization unit (scrubber), the gases resulting from combustion are passed through tanks containing a material that captures and neutralizes the SO_2 . Particulate matter is most frequently removed from the combustion gases by either filtering (a series of filter bags that trap the ash and dust much as a household vacuum cleaner does) in a baghouse or with an electrostatic precipitator. In the latter, the particulates are given an electric charge and collected. Particulate collection is mainly centered on coal combustion because of the large percentage of ash that coal contains. Petroleum has very little ash, and natural gas has practically none.

For a fossil-fueled steam-electric generating unit, about two-thirds of the heat produced by burning the fuel is released to the environment, and only about one-third is used to produce electricity. Most waste heat (contained in the cooling water) is dissipated into a body of water, such as a river, lake, or bay. Cooling towers are installed where there is insufficient cooling water and where the waste heat discharged into the cooling water affects plants or marine life. A cooling tower is a structure for transferring heat in the water to the atmosphere. The most common type is the wet tower, also called the evaporative tower. In a wet tower, cooling is caused mainly by evaporation of the water and partly by direct-heat transfer.

Environmental equipment can represent a significant part of the cost of a power plant. This cost includes

the initial capital cost of installation and the recurring operation and maintenance (O&M) costs. Capital costs are given as a cost per kilowatt of installed nameplate capacity.

Data Sources

Estimates are provided in the following tables for SO_2 , NO_x , and CO_2 emissions from fossil-fueled steam-electric generating units. The methodology for computing emission estimates is described in Appendix A. Emissions of SO_2 , NO_x , and CO_2 have been revised from the updated Air Pollutant Emissions Factor (AP-42 5th edition) of the Environment Protection Agency on August 1998. Additional detailed information on emissions from electric utilities can be obtained in Chapter 6 of the *Annual Energy Outlook*.¹⁴ Also presented in the following tables are the number and capacity of fossil-fueled steam-electric generators with environmental equipment (scrubbers, particulate collectors, and cooling towers). Because power plants can have more than one type of environmental equipment, the generators at these plants can be included in more than one category. Also, not all utility plants

have environmental equipment. Data regarding the quality of fossil fuels used to produce electricity by electric utilities, including heat, sulfur, and ash content, are also provided in the following tables. Lastly, average flue gas desulfurization costs (that is, operation and maintenance costs per kilowatthour of generation and installation costs per kilowatt of nameplate capacity) are presented.

These estimates were either derived or obtained directly from the Form EIA-767, "Steam-Electric Plant Operation and Design Report." This form is a restricted-universe census used to collect boiler-specific data from over 800 U.S. electric utility power plants with organic or nuclear-fueled steam-electric nameplate capacity of 10 or more megawatts operated by more than 300 electric utilities. The entire form, including data on environmental equipment, is filed by about 700 power plants with a nameplate capacity of 100 or more megawatts. Information on power plants with a nameplate capacity between 10 and 100 megawatts is submitted only for fuel consumption and flue gas desulfurization equipment. There are 67 nuclear power plants in the Form EIA-767 respondent universe.

¹⁴ Energy Information Administration, *Annual Energy Outlook* DOE/EIA-0383(98)(Washington, DC, 1997).

Table 22. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities, 1993 Through 1997
(Thousand Short Tons)

Emission	1993	1994	1995	1996	1997
Sulfur Dioxide (SO ₂).....	R 14,985	R 14,356	R 11,563	12,179	12,452
Nitrogen Oxides (NO _x).....	R 7,005	R 6,774	R 6,690	6,967	7,174
Carbon Dioxide (CO ₂).....	R 1,966,086	R 1,969,318	R 1,966,607	2,044,559	2,113,654

R = Revised data.

Notes: •Estimates for 1997 are preliminary; data for prior years are final. •Emissions of CO₂, NO_x, and SO₂ have been revised from the updated (August 1998) Air Pollutant Emissions Factors (AP-42 5th edition) of the Environmental Protection Agency (see Technical Notes). •Estimates are for steam-electric plants 10 megawatts and larger, based on fuel consumption data.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 23. Number and Capacity of Fossil-Fueled Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment, 1993 Through 1997

Environmental Equipment	Scrubbers		Particulate Collectors	
	Number of Generators	Capacity ¹ (megawatts)	Number of Generators	Capacity ¹ (megawatts)
1993.....	154	71,106	1,151	350,808
1994.....	168	80,617	1,135	351,180
1995.....	178	84,677	1,134	351,198
1996.....	182	86,359	1,136	352,254
1997.....	183	86,605	1,136	352,254

	Cooling Towers		Total ²	
	Number of Generators	Capacity ¹ (megawatts)	Number of Generators	Capacity ¹ (megawatts)
1993.....	486	164,807	1,330	376,831
1994.....	480	165,452	1,309	376,899
1995.....	471	165,295	1,295	375,691
1996.....	477	166,749	1,301	377,244
1997.....	480	166,886	1,304	377,381

¹ Nameplate capacity.

² Components are not additive since some generators are included in more than one category and not all units have environmental equipment.

Notes: •Data for 1997 are preliminary; data for prior years are final. •These data are only for plants with a fossil-fueled steam-electric capacity of 100 or more megawatts. •Historical data have been revised to reflect additional data reported by respondents.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 24. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities by Census Division and State, 1996 and 1997
(Thousand Short Tons)

Census Division State	1996			1997		
	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide
New England.....	183	63	31,436	255	80	42,391
Connecticut.....	34	10	7,252	50	15	10,936
Maine.....	5	1	578	11	1	1,278
Massachusetts.....	100	41	19,031	136	49	24,544
New Hampshire.....	45	11	4,354	58	14	5,383
Rhode Island.....	—	—	—	—	—	—
Vermont.....	0	0	222	0	0	249
Middle Atlantic.....	1,268	397	150,889	1,349	409	162,000
New Jersey.....	42	30	6,936	48	28	8,017
New York.....	214	86	39,055	224	93	43,124
Pennsylvania.....	1,012	281	104,898	1,076	288	110,859
East North Central	3,554	1,805	440,032	3,681	1,850	451,205
Illinois.....	725	350	79,671	776	374	85,041
Indiana.....	855	488	116,563	893	505	122,682
Michigan.....	386	268	69,797	403	265	69,550
Ohio.....	1,397	531	130,480	1,395	528	127,649
Wisconsin.....	190	168	43,521	213	178	46,282
West North Central	859	849	222,049	812	884	224,655
Iowa.....	140	139	33,267	141	144	34,652
Kansas.....	102	131	35,802	96	125	32,990
Minnesota.....	84	133	34,881	90	134	35,219
Missouri.....	326	240	63,276	273	269	66,363
Nebraska.....	61	83	18,311	59	89	19,571
North Dakota.....	133	110	33,720	133	104	32,149
South Dakota.....	14	13	2,792	21	17	3,710
South Atlantic.....	3,000	1,264	400,091	3,059	1,305	422,969
Delaware.....	38	15	5,991	38	14	5,406
District of Columbia	1	0	120	0	0	69
Florida.....	623	297	95,048	584	303	97,637
Georgia.....	460	189	69,030	484	201	73,034
Maryland.....	235	86	29,280	237	85	29,101
North Carolina.....	412	198	63,420	458	210	68,305
South Carolina.....	228	95	30,636	227	93	31,251
Virginia.....	177	86	28,692	192	92	30,672
West Virginia.....	825	297	77,874	838	307	87,494
East South Central.....	1,889	839	235,362	1,860	874	241,161
Alabama.....	538	249	74,958	500	248	73,339
Kentucky.....	788	338	88,206	790	353	91,146
Mississippi.....	85	55	16,753	96	59	17,742
Tennessee.....	478	196	55,445	474	215	58,933
West South Central.....	887	921	320,313	901	922	314,295
Arkansas.....	80	91	29,114	73	86	26,685
Louisiana.....	298	112	41,047	227	123	42,418
Oklahoma.....	114	144	42,410	82	126	35,582
Texas.....	395	574	207,742	519	588	209,609
Mountain.....	447	745	209,882	458	769	219,192
Arizona.....	107	111	34,316	117	123	37,783
Colorado.....	93	138	35,062	93	133	35,479
Idaho.....	—	—	—	—	—	—
Montana.....	19	45	14,152	16	53	16,641
Nevada.....	52	64	19,806	50	62	19,381
New Mexico.....	61	119	30,396	65	123	31,844
Utah.....	28	92	31,487	30	99	33,339
Wyoming.....	86	175	44,663	87	174	44,725
Pacific Contiguous.....	72	75	29,585	58	72	30,963
California.....	1	25	18,315	0	29	21,060
Oregon.....	5	8	1,916	5	7	1,672
Washington.....	66	42	9,354	52	36	8,232
Pacific Noncontiguous.....	20	10	4,920	20	10	4,825
Alaska.....	1	2	381	1	2	367
Hawaii.....	20	7	4,539	19	7	4,458
U.S. Total.....	12,179	6,967	2,044,559	12,452	7,174	2,113,654

Notes: *Estimates for 1997 are preliminary; data for prior years are final. •Emissions of CO₂, NO_x, and SO₂ have been revised from the updated (August 1998) Air Pollutant Emissions Factors (AP-42 5th edition) of the Environmental Protection Agency (see Technical Notes). •Estimates are for steam-electric plants 10 megawatts and larger, based on fuel consumption data.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 25. Estimated Emissions from Fossil-Fueled Steam-Electric Generating Units at U.S. Electric Utilities by Fossil Fuel, Census Division, and State, 1997
(Thousand Short Tons)

Census Division State	Coal			Petroleum			Gas			Other ¹		
	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide
New England	131	51	19,591	124	21	18,867	*	7	3,642	*	*	290
Connecticut	11	6	2,799	39	7	7,254	*	1	878	*	*	6
Maine	0	0	0	11	1	1,278	0	0	0	0	0	0
Massachusetts	70	32	12,386	66	11	9,410	*	6	2,723	*	*	26
New Hampshire	51	13	4,407	7	1	925	0	*	39	*	*	12
Rhode Island	—	—	—	—	—	—	—	—	—	—	—	—
Vermont	0	0	0	0	0	0	*	2	—	*	*	247
Middle Atlantic	1,311	380	138,898	37	11	9,465	*	18	13,476	*	*	161
New Jersey	47	27	7,507	1	*	188	*	1	305	*	*	17
New York	191	68	22,597	34	9	7,667	*	17	12,849	*	*	11
Pennsylvania	1,073	285	108,794	3	2	1,610	*	1	322	*	*	133
East North Central	3,675	1,842	445,795	6	2	1,455	*	6	3,492	*	1	462
Illinois	774	369	81,765	2	1	447	*	5	2,725	*	*	105
Indiana	893	505	122,326	*	*	181	*	*	174	0	0	0
Michigan	400	263	68,538	3	1	607	*	1	378	*	*	28
Ohio	1,394	528	127,397	*	*	204	0	*	46	*	*	1
Wisconsin	213	177	45,769	*	*	16	*	*	169	*	*	328
West North Central	810	876	221,233	1	*	301	*	4	2,056	1	2	1,064
Iowa	141	143	34,201	*	*	24	*	1	306	*	*	120
Kansas	95	122	31,601	*	*	81	*	3	1,308	0	0	0
Minnesota	89	132	34,059	*	*	23	*	1	249	*	2	888
Missouri	272	269	66,149	1	*	85	*	*	113	*	*	16
Nebraska	59	89	19,475	*	*	17	0	*	78	*	*	*
North Dakota	132	104	32,078	*	*	68	0	0	*	*	*	3
South Dakota	21	17	3,670	*	*	3	0	*	1	*	*	36
South Atlantic	2,849	1,250	389,409	210	34	22,729	*	20	10,713	*	*	118
Delaware	34	13	4,387	4	1	724	*	*	292	*	*	3
District of Columbia	0	0	0	*	*	65	0	0	0	*	*	3
Florida	393	254	68,268	191	30	19,521	*	19	9,816	*	*	32
Georgia	483	201	72,742	1	*	112	*	*	168	*	*	11
Maryland	229	83	27,471	8	2	1,253	*	1	329	*	*	48
North Carolina	458	210	68,184	*	*	121	0	0	0	0	0	0
South Carolina	227	93	31,145	*	*	73	0	*	13	*	*	21
Virginia	187	91	29,910	5	1	686	0	*	76	0	0	0
West Virginia	837	306	87,301	*	*	173	0	*	20	0	0	0
East South Central	1,828	864	235,647	33	4	2,450	*	6	3,055	*	*	8
Alabama	500	247	73,097	*	*	78	*	*	164	0	0	0
Kentucky	790	353	90,993	*	*	117	0	*	36	0	*	*
Mississippi	64	49	12,695	32	4	2,184	*	6	2,855	*	*	8
Tennessee	474	214	58,862	*	*	71	0	0	0	0	0	0
West South Central	895	766	228,865	5	1	819	*	153	83,674	*	2	937
Arkansas	73	83	25,139	*	*	49	*	3	1,496	0	0	0
Louisiana	222	91	25,259	4	1	565	*	29	15,731	*	2	863
Oklahoma	82	113	28,883	*	*	5	*	13	6,695	0	0	0
Texas	519	479	149,584	*	*	199	*	109	59,752	*	*	74
Mountain	458	760	214,411	*	*	170	*	9	4,611	*	*	*
Arizona	117	122	36,898	*	*	46	*	2	839	0	0	0
Colorado	93	132	35,260	*	*	6	*	*	213	*	*	*
Idaho	—	—	—	—	—	—	—	—	—	—	—	—
Montana	16	53	16,627	*	*	9	0	*	5	*	*	*
Nevada	50	59	17,774	*	*	20	*	4	1,587	0	0	0
New Mexico	65	120	29,995	*	*	18	*	3	1,830	0	0	0
Utah	30	99	33,185	*	*	23	*	*	131	0	0	0
Wyoming	87	174	44,671	*	*	48	0	*	6	0	0	0
Pacific Contiguous	57	43	9,250	*	*	36	*	28	20,714	*	1	962
California	0	0	0	*	*	23	*	28	20,711	*	*	325
Oregon	5	7	1,662	*	*	9	0	0	0	0	0	0
Washington	52	36	7,588	*	*	4	0	*	3	*	*	637
Pacific Noncontiguous	1	2	359	19	7	4,465	0	0	0	0	0	0
Alaska	1	2	359	*	*	8	0	0	0	0	0	0
Hawaii	0	0	0	19	7	4,458	0	0	0	0	0	0
U.S. Total	12,014	6,834	1,903,460	435	81	60,758	1	252	145,433	2	7	4,003

¹ Includes light oil, methane, coal/oil mixture, propane gas, blast furnace gas, wood, and refuse.

Notes: *Estimates for 1997 are preliminary. *Emissions of CO₂, NO_x, and SO₂ have been revised from the updated (August 1998) Air Pollutant Emissions Factors (AP-42 5th edition) of the Environmental Protection Agency (see Technical Notes). *Estimates are for steam-electric plants 10 megawatts and larger, based on fuel consumption data. **=Value less than 0.5.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 26. Number and Capacity of Coal-Fired Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment by Census Division and State, 1997

Census Division State	Generating Units ¹		Scrubbers		Particulate Collectors		Cooling Towers	
	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)
New England	15	2,773	0	0	15	2,773	0	0
Connecticut	1	400	0	0	1	400	0	0
Maine	0	0	0	0	0	0	0	0
Massachusetts	9	1,764	0	0	9	1,764	0	0
New Hampshire	5	609	0	0	5	609	0	0
Rhode Island	—	—	—	—	—	—	—	—
Vermont	0	0	0	0	0	0	0	0
Middle Atlantic	83	24,070	14	7,048	83	24,070	16	11,366
New Jersey	6	1,685	1	163	6	1,685	0	0
New York	25	3,721	3	978	25	3,721	0	0
Pennsylvania	52	18,664	10	5,907	52	18,664	16	11,366
East North Central	298	81,493	25	11,992	295	81,493	41	20,489
Illinois	55	17,123	3	821	55	17,123	2	562
Indiana	68	21,207	14	5,964	68	21,207	23	9,395
Michigan	49	12,124	0	0	49	12,124	2	199
Ohio	84	23,985	6	5,046	84	23,985	11	8,854
Wisconsin	39	7,053	2	160	39	7,053	3	1,479
West North Central	136	35,660	24	10,692	136	35,660	38	11,770
Iowa	29	5,691	1	176	29	5,691	6	1,681
Kansas	17	5,547	7	3,920	17	5,547	8	3,258
Minnesota	25	5,417	8	3,333	25	5,417	9	3,787
Missouri	38	11,448	2	455	38	11,448	7	789
Nebraska	14	3,092	0	0	14	3,092	4	430
North Dakota	12	4,009	6	2,809	12	4,009	4	1,826
South Dakota	1	456	0	0	1	456	0	0
South Atlantic	216	70,991	23	11,948	216	70,991	66	37,648
Delaware	6	1,034	0	0	6	1,034	1	442
District of Columbia	0	0	0	0	0	0	0	0
Florida	28	11,342	8	4,526	28	11,342	12	6,757
Georgia	37	14,491	1	123	37	14,491	12	9,774
Maryland	15	4,943	0	0	15	4,943	2	1,370
North Carolina	45	12,494	0	0	45	12,494	6	3,126
South Carolina	26	6,333	6	2,509	26	6,333	15	4,795
Virginia	26	5,397	2	848	26	5,397	5	1,561
West Virginia	33	14,958	6	3,942	33	14,958	13	9,822
East South Central	132	40,471	29	12,295	132	40,471	28	12,893
Alabama	39	12,586	4	1,597	39	12,586	4	2,599
Kentucky	54	15,956	21	7,698	54	15,956	21	9,394
Mississippi	6	2,150	2	400	6	2,150	3	900
Tennessee	33	9,780	2	2,600	33	9,780	0	0
West South Central	57	32,745	16	10,547	57	32,745	30	16,317
Arkansas	5	3,958	0	0	5	3,958	4	3,400
Louisiana	8	3,799	1	721	8	3,799	6	2,681
Oklahoma	8	4,265	1	520	8	4,265	6	3,127
Texas	36	20,724	14	9,306	36	20,724	14	7,109
Mountain	88	30,608	52	22,084	88	30,608	76	26,113
Arizona	14	5,749	10	3,681	14	5,749	12	5,347
Colorado	26	4,976	6	2,074	26	4,976	24	4,524
Idaho	—	—	—	—	—	—	—	—
Montana	5	2,464	4	2,273	5	2,464	4	2,273
Nevada	8	2,769	5	879	8	2,769	7	1,951
New Mexico	10	4,351	10	4,351	10	4,351	5	2,081
Utah	10	4,461	7	3,826	10	4,461	10	4,461
Wyoming	15	5,838	10	5,001	15	5,838	14	5,476
Pacific Contiguous	5	2,084	0	0	3	2,020	4	1,524
California	2	64	0	0	0	0	2	64
Oregon	1	561	0	0	1	561	0	0
Washington	2	1,460	0	0	2	1,460	2	1,460
Pacific Noncontiguous	0	0	0	0	0	0	0	0
Alaska	0	0	0	0	0	0	0	0
Hawaii	0	0	0	0	0	0	0	0
U.S. Total	1,027	320,896	183	86,605	1,025	320,832	299	138,120

1 Components are not additive since some generators are included in more than one category and not all units have environmental equipment.

2 Nameplate capacity.

Notes: •Totals may not equal sum of components because of independent rounding. •These data are only for plants with a fossil-fueled steam-electric capacity of 100 or more megawatts. •Data are preliminary.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 27. Number and Capacity of Petroleum- and Gas-Fired Steam-Electric Generators for U.S. Electric Utility Plants with Environmental Equipment by Census Division and State, 1997

Census Division State	Generating Units ¹		Particulate Collectors		Cooling Towers	
	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)
New England.....	25	6,369	24	5,954	1	415
Connecticut.....	12	2,167	11	1,752	1	415
Maine.....	4	846	4	846	0	0
Massachusetts.....	8	2,942	8	2,942	0	0
New Hampshire.....	1	414	1	414	0	0
Rhode Island.....	—	—	—	—	—	—
Vermont.....	0	0	0	0	0	0
Middle Atlantic.....	35	10,952	33	9,251	3	1,877
New Jersey.....	7	952	7	952	1	176
New York.....	18	6,635	18	6,635	0	0
Pennsylvania.....	10	3,365	8	1,664	2	1,701
East North Central.....	10	2,158	5	625	5	1,533
Illinois.....	1	210	0	0	1	210
Indiana.....	2	92	0	0	2	92
Michigan.....	6	1,743	4	512	2	1,231
Ohio.....	1	114	1	114	0	0
Wisconsin.....	0	0	0	0	0	0
West North Central.....	15	1,416	2	100	13	1,315
Iowa.....	1	19	1	19	0	0
Kansas.....	10	1,255	0	0	10	1,255
Minnesota.....	1	82	1	82	0	0
Missouri.....	3	61	0	0	3	61
Nebraska.....	0	0	0	0	0	0
North Dakota.....	0	0	0	0	0	0
South Dakota.....	0	0	0	0	0	0
South Atlantic.....	48	15,232	35	11,983	17	4,425
Delaware.....	4	597	4	597	2	132
District of Columbia.....	2	580	0	0	2	580
Florida.....	31	9,975	22	8,625	9	1,351
Georgia.....	1	46	1	46	0	0
Maryland.....	6	2,131	4	813	3	1,480
North Carolina.....	0	0	0	0	0	0
South Carolina.....	0	0	0	0	0	0
Virginia.....	4	1,902	4	1,902	1	882
West Virginia.....	0	0	0	0	0	0
East South Central.....	3	206	0	0	3	206
Alabama.....	0	0	0	0	0	0
Kentucky.....	0	0	0	0	0	0
Mississippi.....	3	206	0	0	3	206
Tennessee.....	0	0	0	0	0	0
West South Central.....	89	14,827	6	3,203	87	13,668
Arkansas.....	2	183	0	0	2	183
Louisiana.....	12	2,308	2	1,184	11	1,716
Oklahoma.....	21	5,295	3	1,512	20	4,728
Texas.....	54	7,041	1	507	54	7,041
Mountain.....	31	2,777	2	101	31	2,777
Arizona.....	13	1,382	0	0	13	1,382
Colorado.....	2	101	2	101	2	101
Idaho.....	—	—	—	—	—	—
Montana.....	0	0	0	0	0	0
Nevada.....	4	243	0	0	4	243
New Mexico.....	9	800	0	0	9	800
Utah.....	3	252	0	0	3	252
Wyoming.....	0	0	0	0	0	0
Pacific Contiguous.....	21	2,549	4	205	21	2,549
California.....	21	2,549	4	205	21	2,549
Oregon.....	0	0	0	0	0	0
Washington.....	0	0	0	0	0	0
Pacific Noncontiguous.....	0	0	0	0	0	0
Alaska.....	0	0	0	0	0	0
Hawaii.....	0	0	0	0	0	0
U.S. Total.....	277	56,485	111	31,422	181	28,766

¹ Components are not additive since some generators are included in more than one category and not all units have environmental equipment.

² Nameplate capacity.

Notes: *Totals may not equal sum of components because of independent rounding. *These data are only for plants with a fossil-fueled steam-electric capacity of 100 or more megawatts. *Data are preliminary.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 28. Average Quality of Fossil Fuels Burned at U.S. Electric Utilities by Census Division and State, 1996 and 1997

Census Division State	Coal						Petroleum					Gas	
	1996			1997			1996		1997			1996	1997
	Average Btu per Pound	Sulfur Percent by Weight	Ash Percent by Weight	Average Btu per Pound	Sulfur Percent by Weight	Ash Percent by Weight	Average Btu per Gallon	Sulfur Percent by Weight	Average Btu per Gallon	Sulfur Percent by Weight	Average Btu per Cubic Foot		
New England.....	12,632	0.86	7.9	12,650	0.91	7.9	152,037	1.06	151,474	1.04	1,033	1,031	
Connecticut.....	13,016	.54	7.1	13,064	.53	7.2	152,681	.88	151,890	.86	1,020	1,022	
Maine.....	—	—	—	—	—	—	150,991	1.23	151,039	1.34	—	—	
Massachusetts.....	12,453	.75	8.4	12,442	.75	8.3	151,476	1.11	151,126	1.11	1,036	1,034	
New Hampshire.....	12,952	1.45	6.8	12,997	1.61	7.3	153,015	1.59	152,353	1.27	1,020	1,019	
Rhode Island.....	—	—	—	—	—	—	—	—	—	—	—	—	
Vermont.....	—	—	—	—	—	—	136,888	.12	—	—	1,013	1,012	
Middle Atlantic.....	12,210	1.98	11.1	12,509	1.98	11.1	149,457	.64	149,574	.62	1,030	1,028	
New Jersey.....	12,888	1.36	8.9	12,910	1.15	8.8	148,828	.60	148,380	.73	1,034	1,035	
New York.....	12,868	1.72	8.2	12,940	1.75	8.2	149,442	.65	149,608	.69	1,029	1,028	
Pennsylvania.....	12,040	2.07	11.8	12,396	2.08	11.9	149,584	.61	149,549	.30	1,030	1,014	
East North Central.....	10,551	1.35	8.0	10,496	1.37	8.3	145,087	.76	143,808	.61	1,019	1,014	
Illinois.....	9,797	1.19	7.2	9,658	1.14	7.0	148,544	.99	145,803	.67	1,019	1,014	
Indiana.....	10,321	1.48	7.0	10,386	1.60	7.9	137,498	.33	137,121	.31	1,013	1,010	
Michigan.....	10,388	.65	6.9	10,407	.68	6.9	146,068	.78	146,863	.78	1,023	1,015	
Ohio.....	12,000	2.13	11.2	11,867	2.10	11.8	137,714	.30	137,819	.29	1,031	1,032	
Wisconsin.....	9,171	.46	5.7	9,263	.49	5.7	138,900	.39	139,684	.27	1,007	1,006	
West North Central.....	8,406	.54	6.9	8,372	.52	6.3	144,160	.69	143,452	.64	.986	.990	
Iowa.....	8,608	.44	5.8	8,579	.43	5.6	138,334	.32	138,451	.35	1,003	1,010	
Kansas.....	8,760	.48	5.6	8,715	.50	5.7	146,996	.67	144,847	.74	975	981	
Minnesota.....	8,877	.50	9.6	8,920	.52	6.4	138,558	.34	138,143	.38	1,005	1,006	
Missouri.....	9,052	.60	5.5	8,920	.47	5.3	148,021	1.19	145,726	.94	1,008	1,006	
Nebraska.....	8,579	.34	5.1	8,568	.31	4.8	138,578	.23	139,126	.40	1,006	1,000	
North Dakota.....	6,594	.71	9.2	6,530	.75	9.4	139,557	.41	144,063	.41	1,057	1,055	
South Dakota.....	8,925	.54	6.9	8,650	.61	8.6	137,458	.21	139,492	.36	1,021	1,022	
South Atlantic.....	12,048	1.26	9.7	12,224	1.27	10.0	151,486	1.43	152,043	1.45	1,014	1,017	
Delaware.....	12,801	.99	8.7	12,823	1.07	9.0	150,288	.78	149,928	.88	1,036	1,036	
District of Columbia.....	—	—	—	—	—	—	143,557	.80	144,441	.84	—	—	
Florida.....	12,099	1.54	8.1	11,976	1.61	8.2	152,055	1.53	152,639	1.54	1,011	1,014	
Georgia.....	11,541	.84	8.9	11,603	.84	9.3	142,996	1.22	143,556	1.44	1,024	1,025	
Maryland.....	12,870	1.14	9.5	12,894	1.16	9.6	150,516	1.02	150,715	1.02	1,041	1,041	
North Carolina.....	12,389	.86	10.0	12,334	.89	10.3	139,334	.20	139,458	.20	—	—	
South Carolina.....	12,705	1.19	8.9	12,758	1.19	8.8	139,976	.22	138,094	.21	1,021	1,024	
Virginia.....	12,578	.97	10.6	12,582	1.00	10.8	147,486	1.10	149,706	1.09	1,165	1,259	
West Virginia.....	11,475	1.90	11.9	12,352	1.84	12.1	138,910	.34	139,420	.33	1,000	1,000	
East South Central.....	11,770	1.74	9.9	11,634	1.68	9.9	150,297	.47	148,562	2.08	1,026	1,025	
Alabama.....	11,754	1.21	10.7	11,542	1.10	10.4	138,887	.30	138,871	.29	1,036	1,047	
Kentucky.....	11,745	2.22	10.4	11,727	2.18	10.6	138,746	.33	137,562	.39	1,022	1,023	
Mississippi.....	10,969	.87	6.8	10,458	.66	6.2	154,130	.53	149,988	2.32	1,026	1,023	
Tennessee.....	12,025	1.93	9.0	11,891	1.88	9.0	138,209	.26	138,182	.28	—	—	
West South Central.....	7,746	.39	7.9	7,673	.63	9.5	143,374	.54	147,751	.92	1,025	1,024	
Arkansas.....	8,616	.30	4.5	8,572	.30	5.5	146,261	1.48	141,918	.91	1,025	1,025	
Louisiana.....	7,954	.58	7.3	7,940	.64	7.4	145,264	.57	151,655	1.18	1,039	1,036	
Oklahoma.....	8,589	.37	5.2	8,575	.33	5.0	141,755	.95	140,587	.58	1,030	1,034	
Texas.....	7,407	.39	9.0	7,355	.72	11.1	142,704	.35	139,354	.26	1,021	1,020	
Mountain.....	9,794	.55	11.3	9,796	.56	11.3	141,069	.39	138,616	.20	1,016	1,018	
Arizona.....	10,224	.54	12.4	10,177	.54	12.6	141,919	.36	138,509	.16	1,015	1,013	
Colorado.....	9,955	.39	7.0	9,860	.38	6.8	137,586	.37	135,684	.10	984	1,010	
Idaho.....	—	—	—	—	—	—	—	—	—	—	—	—	
Montana.....	8,467	.68	9.0	8,472	.75	9.3	141,000	.50	141,000	.50	1,078	1,044	
Nevada.....	11,896	.49	9.9	11,973	.47	9.8	148,669	.69	142,195	.42	1,027	1,029	
New Mexico.....	9,119	.80	22.7	9,193	.82	22.7	134,769	.10	134,751	.10	1,011	1,011	
Utah.....	11,586	.48	10.9	11,532	.49	11.1	138,281	.20	138,594	.12	1,021	1,032	
Wyoming.....	8,639	.54	8.0	8,711	.55	7.6	139,262	.18	138,722	.20	1,040	1,041	
Pacific Contiguous.....	7,856	.62	13.8	7,855	.58	12.9	144,475	.41	143,445	.39	1,025	1,021	
California.....	—	—	—	—	—	—	144,557	.41	146,189	.41	1,025	1,021	
Oregon.....	8,708	.27	4.7	8,752	.34	5.4	138,800	.50	138,804	.50	—	—	
Washington.....	7,694	.68	15.5	7,685	.62	14.3	139,957	.11	140,000	.05	1,035	1,023	
Pacific Noncontiguous.....	7,795	.20	10.1	7,753	.17	10.0	138,128	.28	132,349	.27	—	—	
Alaska.....	7,795	.20	10.1	7,753	.17	10.0	138,128	.28	132,349	.27	—	—	
Hawaii.....	—	—	—	—	—	—	148,911	.68	149,497	.67	—	—	
U.S. Average.....	10,191	1.05	8.9	10,227	1.08	9.2	150,356	1.04	150,795	1.13	1,024	1,023	

Notes: *Data for 1997 are preliminary; data for prior years are final. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 29. Average Flue Gas Desulfurization Costs at U.S. Electric Utilities by Census Division and State, 1993 Through 1997

Census Division State	Average O&M Costs (cents per kilowatthour)					Average Installed Costs (dollars per kilowatt)				
	1993	1994	1995	1996	1997	1993	1994	1995	1996	1997
New England.....	—	—	—	—	—	—	—	—	—	—
Connecticut.....	—	—	—	—	—	—	—	—	—	—
Maine.....	—	—	—	—	—	—	—	—	—	—
Massachusetts.....	—	—	—	—	—	—	—	—	—	—
New Hampshire.....	—	—	—	—	—	—	—	—	—	—
Rhode Island.....	—	—	—	—	—	—	—	—	—	—
Vermont.....	—	—	—	—	—	—	—	—	—	—
Middle Atlantic.....	3.96	2.68	3.02	2.25	2.21	184	184	184	183	183
New Jersey.....	NM	NM	3.36	3.66	3.24	398	398	398	398	398
New York.....	1.09	1.03	1.18	1.33	1.35	331	331	331	331	331
Pennsylvania.....	4.65	2.96	3.40	2.38	2.36	157	157	158	156	156
East North Central.....	1.90	2.05	1.79	1.84	3.39	130	127	128	129	129
Illinois.....	2.52	2.71	2.51	2.28	3.54	147	147	147	147	147
Indiana.....	1.58	1.53	1.52	1.68	1.59	143	142	144	145	146
Michigan.....	—	—	—	—	—	—	—	—	—	—
Ohio.....	2.25	2.92	1.93	1.92	5.47	83	88	88	90	90
Wisconsin.....	—	2.86	2.08	2.13	.10	—	16	16	16	16
West North Central.....	.66	.60	.58	.53	.56	84	84	78	78	78
Iowa.....	1.87	1.53	1.56	1.37	1.39	202	202	202	202	202
Kansas.....	.49	.46	.49	.35	.38	72	73	61	61	61
Minnesota.....	.43	.39	.37	.39	.37	73	73	73	73	73
Missouri.....	1.86	1.35	1.20	1.36	1.05	87	87	50	50	50
Nebraska.....	—	—	—	—	—	—	—	—	—	—
North Dakota.....	.81	.79	.74	.72	.82	102	102	102	102	102
South Dakota.....	—	—	—	—	—	—	—	—	—	—
South Atlantic.....	.98	1.16	.95	.91	.83	119	115	120	120	116
Delaware.....	—	—	—	—	—	—	—	—	—	—
District of Columbia.....	—	—	—	—	—	—	—	—	—	—
Florida.....	.78	1.01	.87	.96	.90	69	67	73	73	67
Georgia.....	—	—	5.13	4.82	4.85	—	—	NM	NM	NM
Maryland.....	—	—	—	—	—	—	—	—	—	—
North Carolina.....	—	—	—	—	—	—	—	—	—	—
South Carolina.....	.59	.60	.48	.59	.49	43	43	43	43	43
Virginia.....	—	—	—	.20	.02	—	—	NM	NM	NM
West Virginia.....	2.09	2.33	1.44	1.35	1.28	217	209	216	216	217
East South Central.....	1.45	1.06	1.05	1.09	1.00	137	143	143	143	143
Alabama.....	.69	.82	.57	.62	.75	80	80	80	80	80
Kentucky.....	1.76	1.60	1.58	1.50	1.59	132	140	140	140	140
Mississippi.....	.27	.27	.35	.50	.68	70	70	70	70	70
Tennessee.....	NM	.05	.36	.37	.11	196	204	204	204	204
West South Central.....	1.01	1.08	.91	.82	.81	74	76	71	83	86
Arkansas.....	—	—	—	—	—	—	—	—	—	—
Louisiana.....	NM	NM	NM	NM	NM	75	75	75	75	75
Oklahoma.....	.54	.50	.59	1.14	1.26	92	92	92	92	92
Texas.....	1.03	1.11	.93	.81	.79	72	75	70	83	87
Mountain.....	.68	.73	.79	.70	.60	146	150	150	149	152
Arizona.....	.42	.77	.88	.72	.33	160	175	175	175	180
Colorado.....	.67	.52	.85	.60	.49	69	69	69	69	64
Idaho.....	—	—	—	—	—	—	—	—	—	—
Montana.....	1.10	1.11	1.14	.92	.97	274	274	274	274	274
Nevada.....	.99	.74	1.57	1.07	.47	126	126	126	126	126
New Mexico.....	1.07	1.07	1.03	.92	.90	165	165	165	162	162
Utah.....	.37	.41	.47	.52	.48	97	101	101	101	101
Wyoming.....	.54	.62	.61	.62	.63	137	137	137	137	137
Pacific Contiguous.....	—	—	—	—	—	—	—	—	—	—
California.....	—	—	—	—	—	—	—	—	—	—
Oregon.....	—	—	—	—	—	—	—	—	—	—
Washington.....	—	—	—	—	—	—	—	—	—	—
Pacific Noncontiguous.....	—	—	—	—	—	—	—	—	—	—
Alaska.....	—	—	—	—	—	—	—	—	—	—
Hawaii.....	—	—	—	—	—	—	—	—	—	—
U.S. Average.....	1.19	1.14	1.16	1.07	1.09	125	127	126	128	129

O&M = Operation and Maintenance

NM = Not meaningful because these plants did not generate during the year.

Notes: •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •A mill is a monetary cost and billing unit equal to 1/1000 of the U.S. dollar (equivalent to 1/10 of 1 cent).

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
Alabama Electric Coop Inc							
Charles R Lowman 2	538	236	7903	1.90	Spray	Limestone	85.0
Charles R Lowman 3	—	236	8005	1.90	Spray	Limestone	85.0
Arizona Electric Pwr Coop Inc							
Apache Station 2	464	195	7901	.70	Packed	Limestone	85.0
Apache Station 3	—	195	7901	.70	Packed	Limestone	85.0
Arizona Public Service Co							
Cholla 1	1,105	114	7312	1.00	Venturi	Lime	80.0
Cholla 2	—	289	7806	1.20	Venturi	Lime	90.0
Cholla 4	—	414	8106	1.20	Packed	Lime	95.0
Four Corners 1	2,270	190	7201	.80	Venturi	Lime	72.0
Four Corners 2	—	190	7201	.80	Venturi	Lime	72.0
Four Corners 3	—	253	7201	.80	Venturi	Lime	72.0
Four Corners 4	—	818	8501	.80	Tray	Lime	72.0
Four Corners 5	—	818	8501	.80	Tray	Lime	72.0
Atlantic City Electric Co							
B L England 2	476	163	9501	3.20	Spray	Limestone	93.0
Basin Electric Power Coop							
Antelope Valley FGD1	870	435	8307	1.20	Spray Dry	Lime/Alkaline Fly Ash	81.0
Antelope Valley FGD2	—	435	8511	1.20	Spray Dry	Lime/Alkaline Fly Ash	81.0
Laramie River 1	1,710	570	8007	.80	Spray	Limestone	90.0
Laramie River 2	—	570	8107	.80	Spray	Limestone	90.0
Laramie River 3	—	570	8405	.50	Spray Dry	Lime/Alkaline Fly Ash	85.0
Big Rivers Electric Corp							
D B Wilson W1	509	509	8611	3.80	Spray	Limestone	90.0
HMP&L Station 2 H1	365	180	9506	4.20	Tray	Lime	95.0
HMP&L Station 2 H2	—	185	9506	4.20	Tray	Lime	95.0
R D Green G1	527	264	7912	4.00	Spray	Lime	90.0
R D Green G2	—	264	8101	4.00	Spray	Lime	90.0
Black Hills Corp							
Neil Simpson II 2	—	—	9511	.90	Circulating Dry	Lime	92.0
Central Illinois Light Co							
Duck Creek 1	441	441	7607	3.40	Venturi	Limestone	86.0
Central Illinois Pub Serv Co							
Newton 1	1,235	617	7912	4.00	Spray	Sodium Carbonate	90.0
Central Louisiana Elec Co Inc							
Dolet Hills 1	721	721	8604	.70	Spray	Limestone	76.0
Cincinnati Gas & Electric Co							
East Bend 2	669	669	8103	5.20	Spray Dry	Lime	99.0
W H Zimmer 1	1,426	1,426	9103	4.50	Spray	Lime	99.0
Columbus Southern Power Co							
Conesville 5	2,175	444	7705	7.90	Spray	Lime	89.7
Conesville 6	—	444	7708	7.90	Spray	Lime	89.7
Coop Power Assn							
Coal Creek 1	1,012	506	7908	1.00	Spray	Lime	90.0
Coal Creek 2	—	506	8107	1.00	Spray	Lime	90.0
Deseret Generation & Tran Coop							
Bonanza 1-1	400	400	8605	.50	Spray	Limestone	95.0
Duquesne Light Co							
Elrama SCRB	510	510	7609	2.50	Venturi	Lime	83.0
F R Phillips SCRB	411	411	7406	2.50	Venturi	Lime	83.0

See footnotes at end of table.

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997 (Continued)

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
East Kentucky Power Coop Inc H L Spurlock 2	814	508	8306	3.60	Spray Dry	Lime	90.0
Georgia Power Co Yates YIFG	1,488	123	9210	2.50	Bubbling Reactor	Limestone	90.0
Grand Haven City of J B Sims 3	78	58	8308	2.80	Tray	Lime	90.0
Grand River Dam Authority GRDA 2	1,010	520	8604	1.50	Spray Dry	Lime/Alkaline Fly Ash	85.0
Hoosier Energy R E C Inc Frank E Ratts 1FGD	1,080	540	8309	3.00	Spray	Limestone	90.0
Frank E Ratts 2FGD	—	540	8202	3.00	Spray	Limestone	90.0
Houston Lighting & Power Co Limestone FGD1	1,627	813	8510	3.10	Spray	Limestone	90.0
Limestone FGD2	—	813	8610	3.10	Spray	Limestone	90.0
W A Parish FGD8	3,953	615	8212	.50	Spray	Limestone	85.0
Indianapolis Power & Light Co Petersburg 1	1,873	253	9605	4.50	Spray	Limestone	95.0
Petersburg 2	—	471	9605	4.50	Spray	Limestone	95.0
Petersburg 3	—	574	7711	—	Tray	Limestone	85.0
Petersburg 4	—	574	8604	—	Spray	Limestone	95.0
Jacksonville Electric Auth St. Johns River Powe 1	1,358	679	8703	2.20	Spray	Limestone	90.0
St. Johns River Powe 2	—	679	8805	2.20	Spray	Limestone	90.0
Kansas City Power & Light Co Lacygne 1	1,579	893	7306	5.40	Venturi	Limestone	80.0
Kentucky Utilities Co Ghent 1	2,226	557	9412	3.50	Spray	Limestone	95.0
Green River 1	264	75	7510	3.80	Venturi	Lime	80.0
Lakeland City of C. D. McIntosh, Jr. 3	593	364	8209	1.80	Spray	Limestone	85.0
Los Angeles City of Intermountain 1CCC	1,640	820	8607	.60	Spray	Limestone	90.0
Intermountain 2CCC	—	820	8707	.60	Spray	Limestone	90.0
Louisville Gas & Electric Co Cane Run 4	645	163	7612	3.50	Spray	Other	85.0
Cane Run 5	—	209	7805	3.50	Spray	Other	85.0
Cane Run 6	—	272	7904	3.50	Tray	Other	90.0
Mill Creek 1	1,717	356	8112	6.00	Spray	Limestone	90.0
Mill Creek 2	—	356	8012	6.00	Spray	Limestone	90.0
Mill Creek 3	—	463	8510	5.00	Spray	Limestone	90.0
Mill Creek 4	—	544	8207	6.30	Spray	Limestone	90.0
Trimble County 1	566	566	9012	4.50	Spray	Limestone	90.7
Lower Colorado River Authority Fayette Power Prjc 3	1,690	460	8804	1.70	Spray	Limestone	90.0
Marquette City of Shiras 3	40	40	8307	.50	Spray Dry	Limestone	80.0
Michigan South Central Pwr Agy Endicott Generating 1	55	50	8305	4.30	Spray	Limestone	90.0

See footnotes at end of table.

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997 (Continued)

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
Minnesota Power & Light Co							
Clay Boswell AQCS2	1,073	558	8004	1.00	Spray	Alkaline Fly Ash	83.2
Clay Boswell SCR3	—	365	7302	1.00	Spray	Alkaline Fly Ash	25.4
Syl Laskin SCR1	116	58	7105	1.00	Spray	Alkaline Fly Ash	—
Syl Laskin SCR2	—	58	7105	1.00	Spray	Alkaline Fly Ash	—
Minnkota Power Coop Inc							
Milton R Young FGD2	734	477	7806	1.20	Spray	Lime/Alkaline Fly Ash	77.9
Monongahela Power Co							
Harrison 1	2,052	684	9411	4.00	Spray	Lime	98.0
Harrison 2	—	684	9411	4.00	Spray	Lime	98.0
Harrison 3	—	684	9411	4.00	Spray	Lime	98.0
Pleasant 1	1,368	684	7903	4.50	Tray	Lime	90.0
Pleasant 2	—	684	8012	4.50	Tray	Lime	90.0
Montana Power Co							
Colstrip 1	2,273	358	7511	.80	Venturi	Lime/Alkaline Fly Ash	58.8
Colstrip 2	—	358	7608	.80	Venturi	Lime/Alkaline Fly Ash	58.8
Colstrip 3	—	778	8401	.80	Venturi	Lime/Alkaline Fly Ash	95.0
Colstrip 4	—	778	8604	.80	Venturi	Lime/Alkaline Fly Ash	95.0
Montana-Dakota Utilities Co							
Coyote FGD1	450	450	8105	.80	Spray Dry	Lime/Alkaline Fly Ash	70.0
Muscatine City of							
Muscatine Plant # 1 9	276	176	8306	3.20	Spray	Limestone	96.0
Nevada Power Co							
Reid Gardner 1	612	114	7404	.50	Spray	Sodium Carbonate	90.5
Reid Gardner 2	—	114	7404	.50	Spray	Sodium Carbonate	90.5
Reid Gardner 3	—	114	7607	.50	Spray	Sodium Carbonate	90.5
Reid Gardner 4	—	270	8307	.90	Spray	Sodium Carbonate	85.0
New York State Elec & Gas Corp							
Kintigh 1	655	655	8408	3.60	Spray	Limestone	90.0
Milliken 1	322	155	9506	3.20	Spray	Limestone	95.0
Milliken 2	—	167	9501	3.20	Spray	Limestone	95.0
Northern Indiana Pub Serv Co							
Bailly 78	616	616	9206	—	Packed	Limestone	90.0
R M Schahfer 17	1,943	424	8304	3.20	Spray	Other	90.0
R M Schahfer 18	—	424	8602	3.20	Spray	Other	90.0
Northern States Power Co							
Riverside 7	404	165	8101	1.30	Spray Dry	Lime/Alkaline Fly Ash	70.0
Sherburne Co 1	2,129	660	7605	.90	Venturi	Limestone/Alk Fly Ash	50.0
Sherburne Co 2	—	660	7704	.90	Spray	Limestone/Alk Fly Ash	50.0
Sherburne Co 3	—	809	8711	.90	Spray Dry	Lime/Alkaline Fly Ash	72.3
Ohio Edison Co							
Niles 1	266	266	9510	3.00	Spray	Limestone	90.0
Ohio Power Co							
Gen J M Gavin 1	2,600	1,300	9412	3.50	Spray	Lime	95.0
Gen J M Gavin 2	—	1,300	9503	3.50	Spray	Lime	95.0
Orlando Utilities Comm							
Stanton energy cente 1	929	465	8707	3.50	Spray	Limestone	90.0
Stanton energy cente 2	—	465	9606	3.40	Spray	Limestone	95.0
Owensboro City of							
Elmer Smith FGD	416	416	9411	3.50	Spray	Limestone	96.0

See footnotes at end of table.

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997 (Continued)

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
PacifiCorp							
Dave Johnston SC44	817	360	7202	0.40	Venturi	Lime	—
Hunter 1	1,339	446	7806	.60	Spray	Lime	80.0
Hunter 2	—	446	8006	.60	Spray	Lime	80.0
Hunter 3	—	446	8306	.60	Spray	Limestone	90.0
Huntington 1	893	446	7802	.60	Spray	Lime	80.0
Jim Bridger SC71	2,242	561	9009	1.00	Tray	Soda Liquor Waste	86.4
Jim Bridger SC72	—	561	8609	1.00	Tray	Soda Liquor Waste	86.4
Jim Bridger SC73	—	561	8809	1.00	Tray	Soda Liquor Waste	86.4
Jim Bridger SC74	—	561	7911	1.00	Tray	Soda Liquor Waste	91.0
Naughton 3	707	326	8110	.80	Tray	Sodium Carbonate	70.0
Wyodak SC91	362	362	8612	.80	Spray Dry	Lime	75.2
Pennsylvania Electric Co							
Conemaugh 1	1,872	936	9412	2.70	Spray	Limestone	95.0
Conemaugh 2	—	936	9511	2.70	Spray	Limestone	95.0
Pennsylvania Power Co							
Bruce Mansfield 1	2,741	914	7604	4.80	Venturi	Lime	92.1
Bruce Mansfield 2	—	914	7710	4.80	Venturi	Lime	92.1
Bruce Mansfield 3	—	914	8009	4.80	Spray	Lime	92.1
Philadelphia Electric Co							
Cromby 1	418	188	8212	2.60	Spray	Magnesium Oxide	95.0
Eddystone 1	1,489	354	8212	2.60	Spray	Magnesium Oxide	92.0
Eddystone 2	—	354	8212	2.60	Spray	Magnesium Oxide	92.0
Plains Elec Gen&Trans Coop Inc							
Pegs 1	233	233	8412	.80	Spray	Limestone	95.0
Platte River Power Authority							
Rawhide 101	285	285	8404	.30	Spray Dry	Lime/Alkaline Fly Ash	80.0
Public Service Co of Colorado							
Arapahoe 4	232	100	9306	.40	Spray Dry	Other	20.0
Cherokee 4	710	350	8905	.40	Spray Dry	Other	26.0
Public Service Co of NM							
San Juan 1	1,848	369	7804	1.30	Tray	Other	90.0
San Juan 2	—	369	7808	1.30	Tray	Other	90.0
San Juan 3	—	555	8203	1.30	Tray	Other	90.0
San Juan 4	—	555	8204	1.30	Tray	Other	90.0
PSI Energy Inc							
Tibson 4	3,340	668	9501	3.50	Spray	Limestone	92.0
Tibson 5	—	668	8210	4.40	Spray	Limestone	86.0
Richmond City of							
Whitewater Valley LPC	—	—	9410	2.10	Spray Dry	Limestone	72.5
Salt River Proj Ag I & P Dist							
Coronado FGD1	822	411	7912	1.00	Spray	Limestone	82.5
Coronado FGD2	—	411	8011	1.00	Spray	Limestone	82.5
Navajo 3	2,409	803	9711	.60	Spray	Limestone	92.0
San Antonio City of							
J K Spruce FGD1	546	546	9212	.60	Spray	Limestone	70.0
San Miguel Electric Coop Inc							
San Miguel SM-1	410	410	8201	2.00	Spray	Limestone	86.0
Seminole Electric Coop Inc							
Seminole 1	1,429	715	8402	3.00	Spray	Limestone	90.0
Seminole 2	—	715	8412	3.00	Spray	Limestone	90.0

See footnotes at end of table.

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997 (Continued)

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
Sierra Pacific Power Co							
Valmy 2	521	267	8507	0.50	Spray Dry	Lime	70.0
Sikeston City of Sikeston 1	261	261	8111	2.80	Venturi	Limestone	75.5
South Carolina Electric&Gas Co							
Cope COP1	417	417	9511	1.90	Spray Dry	Lime	95.0
South Carolina Pub Serv Auth							
Cross 1	1,147	591	9505	1.10	Spray	Limestone	90.0
Cross 2	—	556	8312	1.60	Spray	Limestone	81.4
Winyah 2	1,260	315	7707	1.10	Venturi	Limestone	45.0
Winyah 3	—	315	8006	2.30	Spray	Limestone	90.0
Winyah 4	—	315	8111	1.70	Spray	Limestone	90.4
South Mississippi El Pwr Assn							
R D Morrow 1	400	200	7809	1.50	Spray	Limestone	52.7
R D Morrow 2	—	200	7906	1.50	Spray	Limestone	52.7
Southern Illinois Power Coop							
Marion 4	272	173	7904	4.40	Venturi	Limestone	89.4
Southern Indiana Gas & Elec Co							
A B Brown 1	530	265	7904	4.50	Spray	Sodium Ash	85.0
A B Brown 2	—	265	8602	4.50	Spray	Sodium Ash	90.0
F B Culley 2-3	415	369	9501	3.80	Spray	Limestone	95.0
Southwestern Electric Power Co							
Pirkey 1	721	721	8501	1.50	Spray	Limestone	85.0
Soyland Power Coop Inc							
Pearl Station 1A	22	22	7611	3.40	Venturi	Other	11.8
Springfield City of							
Dallman 33	388	207	8012	3.30	Packed	Limestone	95.0
Southwest Power St. 1	194	194	7704	3.20	Tray	Limestone	87.0
Sunflower Electric Power Corp							
Holcomb SDA1	349	349	8308	1.00	Spray Dry	Lime/Alkaline Fly Ash	80.0
Holcomb SDA2	—	349	8308	1.00	Spray Dry	Lime/Alkaline Fly Ash	80.0
Holcomb SDA3	—	349	8308	1.00	Spray Dry	Lime/Alkaline Fly Ash	80.0
Tampa Electric Co							
Big Bend FGD4	1,823	932	8502	3.50	Spray	Limestone	90.0
Tennessee Valley Authority							
Cumberland 1	2,600	1,300	9501	4.00	Spray	Limestone	95.0
Cumberland 2	—	1,300	9501	4.00	Spray	Limestone	95.0
Paradise 1	2,558	704	8309	3.20	Spray	Limestone	84.2
Paradise 2	—	704	8312	3.20	Spray	Limestone	84.2
Widows Creek 7	1,969	575	8112	4.00	Spray	Limestone	83.4
Widows Creek 8	—	550	7801	4.50	Tray	Limestone	80.0
Texas Municipal Power Agency							
Gibbons Creek 1	444	444	8310	.30	Spray	Limestone	90.0
Texas Utilities Electric Co							
Martin Lake 1	2,380	793	7705	.90	Spray	Limestone	91.0
Martin Lake 2	—	793	7805	.90	Spray	Limestone	91.0
Martin Lake 3	—	793	7904	.90	Spray	Limestone	91.0
Monticello 3	1,980	793	7808	1.50	Spray	Limestone	74.0
Sandow 4	591	591	8105	1.60	Spray	Limestone	73.9

See footnotes at end of table.

Table 30. Flue Gas Desulfurization (FGD) Capacity in Operation at U.S. Electric Utility Plants as of December 1997 (Continued)

Utility Plant and FGD No.	Nameplate Capacity (megawatts)		Initial Start up Date of FGD System	Design Coal Sulfur (Percent by WT)	FGD Type	Sorbent	Designed SO2 Removal (Percent Efficiency)
	by Plant	by Unit with FGD System					
Tri-State G & T Assn Inc							
Craig C1	1,339	446	8010	.60	Spray	Limestone	85.0
Craig C2	—	446	8005	.60	Spray	Limestone	85.0
Craig C3	—	446	8410	.70	Spray Dry	Lime	85.0
Tucson Electric Power Co							
Springerville 1	850	425	8506	.70	Spray Dry	Lime/Alkaline Fly Ash	61.3
Springerville 2	—	425	9006	.70	Spray Dry	Lime/Alkaline Fly Ash	61.3
United Power Assn							
Elk River 1	46	46	8903	—	Spray Dry	Lime	90.0
Stanton Station 10	172	172	8206	.70	Spray Dry	Lime	70.0
Virginia Electric & Power Co							
Clover 1	848	424	9510	2.00	Spray	Limestone	90.0
Clover 2	—	424	9606	2.00	Spray	Limestone	90.0
Mt Storm 3	1,662	522	9501	2.00	Spray	Limestone	90.0
West Penn Power Co							
Mitchell 33	449	299	8208	4.00	Spray	Lime	95.0
West Texas Utilities Co							
Oklawhoma 1	720	720	8612	.40	Spray	Limestone	86.8
Western Resources, Inc							
Jeffrey EC 1	2,160	720	7807	.30	Spray	Limestone	60.0
Jeffrey EC 2	—	720	8005	.30	Spray	Limestone	60.0
Jeffrey EC 3	—	720	8305	.30	Spray	Limestone	60.0
Lawrence EC 4N	604	114	6906	.90	Venturi	Limestone	73.0
Lawrence EC 4S	—	114	6906	.90	Venturi	Limestone	73.0
Lawrence EC 5	—	403	7105	.90	Venturi	Limestone	52.0
Wisconsin Electric Power Co							
Port Washington 1	320	80	9308	1.20	Spray	Sodium Carbonate	50.0
Port Washington 4	—	80	9408	1.20	Spray	Sodium Carbonate	50.0

Notes: *Data are preliminary. • SO2 = Sulfur Dioxide; WT=weight; FGD=Flue Gas Desulfurization.

Source: Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report."

U.S. Electric Power Transactions

This chapter provides summary information for the U.S. electric power industry on its operations and wholesale electricity trade at the international (Canada and Mexico), national, and North American Electric Reliability Council (NERC) region levels.¹⁵ Generating capability, generation from utility and nonutility sources, and end-user consumption are also presented.

Background

An electric power system is a group of generation, transmission, distribution, communication, and other facilities that are physically connected and operated as a single unit under one control. Transmission and distribution lines and associated facilities are used to transmit electricity from its point of origin (the generator) to the ultimate consumer. Although, due to its physical characteristics, electricity flows along all available paths, it follows the path of least resistance. The flow of electricity must be closely monitored to ensure that sufficient generating capacity is available and on-call to satisfy all demand (load) for electricity placed on the power system. In addition, for system standardization and reliability purposes, the flow is maintained at a frequency of 60 cycles per second.

The flow of electricity within the system is maintained and monitored by dispatch centers having control and security responsibilities. Historically, the dispatch center inventoried and prioritized all generating capacity available to it, tracked transactions involving the buying or selling of either electric power or capacity, monitored current load, and anticipated future load on the system. In the future, this responsibility may be handled differently. How, is now being determined by participants in the new electric power industry.

It is the responsibility of the dispatch center to match the supply of electricity with demand. The demand for electricity is not constant in nature. That is, load requirements fluctuate continuously, based on such factors as time of day, season of the year, and the characteristics of territory served by the system. Nonetheless, the dispatch center must be ready to

meet the highest level of load placed on the system. The dispatch center must accommodate the loss of generating facilities (both planned and unexpected). In addition, the center must monitor transmission lines to determine whether the flow of electricity is approaching the carrying limits of the lines. In order to carry out its responsibilities in a timely fashion, the dispatch center is authorized to buy and sell electricity based on system requirements.

Authority for these transactions has been preapproved under interconnection agreements (contracts) that have been signed by all the electric utilities that are physically interconnected and/or have coordination agreements with other utilities not physically interconnected. (All these agreements are subject to regulatory approval.) These agreements include transaction categories for purchases, sales for resale, exchanges, and wheeling of energy. In the near future, a competitive power market will address this allocation of resources through the open buying and selling of electricity and the independent pricing of system operating costs which were bundled into the total charges for electricity.

Purchase transactions involve buying power from electric utilities and nonutility producers of electricity. Sales for resale transactions refer to power sold by one electric utility or power marketer to other electric utilities for distribution. (Direct interstate wholesale sales to retail customers by power marketers are not authorized.) Some transactions involving the trade of electric energy are based on availability of excess generating capacity or diversity in load requirements. For example, if one electric utility has its lowest load during the winter season, it may arrange to offer its available excess generating capacity in exchange for excess generating capacity available at a facility with low summer load. This type of arrangement is an exchange transaction. However, the repayment or replacement of exchange energy may have extended over several years. The use of exchange transactions is disappearing. Spot and futures markets will eventually replace this type of transaction. Wheeling transactions are the movement of electricity from one utility to another utility over the transmission facilities of one or more intervening utilities.

¹⁵ The NERC is an organization established by the electric utility industry for maintaining, coordinating, and promoting reliability among the interconnected systems of North America.

Electric Utility Transactions

Electric power transactions (*wholesale electricity trade*) allowed electric utilities to acquire power, to share resources, and to provide mutual assistance in times of potential and actual need. They allowed the utility systems to provide lower cost service to their consumers by taking advantage of the load diversity of each utility. These transactions also allowed each utility to conserve its own resources, to share the benefits of reduced operating costs with its consumers, to receive emergency energy support from other utilities, and to reduce the cost of its own requirements for operating reserve. Competitive markets (spot and futures) are expected to be substituted as the electric utility industry continues to change from a monopoly based structure. However, due to the complexity of electric power transactions involving the specifics of contracts, simultaneous energy transactions, the unintended receipt and delivery of energy (inadvertent flow), and losses, the reporting of both the classification and quantity of each transaction among utilities is expected to be inconsistent in the future as well.

Electric utilities originally became interested in energy transactions because of the savings gained from reduced or avoided production costs. They avoided building expensive additional capacity by obtaining power from other sources. Purchasing power from other utilities helped utilities meet peak load without using expensive oil- or gas-fired turbines. Similarly, utilities benefited from being able to delay or stagger construction of additional baseload plants. Electric utilities have also delayed or replaced new plant construction by purchasing electricity from nonutility generators under long-term contracts. Now, opportunities are developing for price based decisions.

Power Pool Transactions

In addition to dealing in one-time purchase and sale transactions, many electric utilities have joined together and formed power pools to achieve better operating efficiencies and to gain additional support for maintaining a functional electrical system. Thus, they share the benefits achieved by joint planning, coordinated use of generating and transmission facilities, and/or common coverage of facility outages. This coordination also provides the opportunity to achieve short-term saving, largely from varying fuel prices and the costs associated with different mixes of capacity. The future of this type of agreement will hinge on the full implementation of the Federal Energy Regulatory Commission (FERC) Orders that directed changes be made to these agreements.

Power pools can be made up of two electric utilities, like the Michigan Electric Coordinated System (Detroit Edison Company and Consumer Power Company), include all the major investor-owned utilities within a State (the New York Power Pool), or cross State lines (the PJM Power Pool includes parts or all of Pennsylvania, New Jersey, Maryland, and Delaware).

Power pools may run under a single-system dispatch to meet combined-load requirements and maintenance programs, or they may just share the benefits of planned or hourly wholesale sales of power and energy among the member utilities. They may also have responsibility for coordinating flow within the geographic area of the interconnected systems. In any case, they are bound by the operating standards established by the electric power industry. These standards require the coordination and maintenance of system stability and reliable service on a regional basis.

NERC Profile

The North American Electric Reliability Council (NERC) consists of 10 regional reliability councils whose memberships comprise essentially all of the electric utility systems in the contiguous United States, Canada, and Baja California Norte, Mexico. Part of the State of Alaska operates together and is an affiliate member; sometimes referenced as the tenth council. The regional councils are responsible for maintaining and setting standards for the reliability and stability of the electricity flowing within the three power grids (the Eastern Power Grid, the Western Power Grid, and the Electric Reliability Council of Texas Power Grid) present in the contiguous United States. The data for NERC regions in this publication are based upon the assignment of all electric utilities to an individual region and are for the U.S. portion of the regions only (Figure 13).

Regulation of U.S. Electric Utility Transactions

The Federal Energy Regulatory Commission (FERC) is responsible for regulating interstate wholesale transactions. U.S. electric utilities and potential power marketers (registration and rate structure) file with the FERC for approval of proposed rate schedules for transmission services and charges, and for wholesale transactions. Historically, transmission filings covered the allocation of electric power flows on the transmission line systems. Other categories described in the filings usually include the responsibilities of the utilities to one another during normal and emergency conditions, operating-reserves, support, diversity exchanges, and unscheduled or inadvertent-energy flows. Authority was granted the FERC by the Energy Policy Act of 1992 to ensure that any wholesale generator--electric utility or nonutility--can access the transmission grid to reach its markets. After application, the FERC can order electric utilities to provide transmission (wheeling) services, provided that the proposed transaction is in the public interest and meets key criteria related to pricing, reliability, and self-dealing.

Wholesale transactions include *capacity sales*, *energy sales*, and *energy exchanges*. Wholesale transactions are further divided by duration of the sale and the type of capacity and energy sold. The length of the sale can be for an hour, a day, a week, a month (or

several months), a season, several years, or some combination of these time periods.

Capacity sales are usually considered *firm* sales (that is, associated energy may be taken, or the capacity must be paid for if the energy is not taken; and the delivery is scheduled during normal system operating conditions). This capacity may be made available from the entire system or from an identified generating unit. The capacity offered in these transactions may be available only during a set period of a given season, for an off-peak time of the day, or from a generator fired by a particular fuel that is currently not fully utilized. The energy associated with this capacity sale, if required, has a separate cost schedule from the capacity charge attached to each kilowatt of power.

Nonfirm sales, sometimes called energy, economy, or interruptible sales, do not include a demand or capacity charge in the price of the transaction. These transactions are subject to curtailment or cessation of delivery by the supplier in accordance with prior agreements or under specified conditions. The sales are often based on splitting the benefits gained by the parties involved. They are used to gain operational savings, for example, by avoiding the use of more expensive fuels, or by selling electricity generated by the spillage of excess reservoir water.

Energy exchanges involve transfers of energy to other systems at no monetary charge. The energy must be returned in kind at a later date agreed upon by both parties. Otherwise, the receiving party pays for the energy received. The incidental miscellaneous transfer of energy and inadvertent flow are also handled in the same manner. In total, these wholesale transactions have become very important tools used by the U.S. electric utility industry to reduce costs and avoid expensive new capacity.

Other Wholesale Electricity Trade Concerns

Environmental issues associated with air, solid-waste disposal, water quality, and aquatic habitat have received increasing attention from utility and power plant operators. Plant operating restrictions caused by air and water emissions have altered or restricted the dispatching of some facilities and in certain cases, plant cooling water sources have been contaminated or shut down due to aquatic organisms. Transmission line right-of-way and projected line construction are also being affected because of concerns linked to generated electromagnetic forces surrounding the transmission lines. The issue of who will build new transmission lines in the future is uncertain. Changing responsibilities in the electric power industry may make it difficult to justify new construction in one State that address requirements for new transmission capability or reliability support coming from another State.

Legislative and regulatory initiatives have been implemented to address emissions at power plants. For example, the Clean Air Act Amendments of 1990 established emission allowances for nitrogen oxides, sulfur dioxide, and carbon dioxide for power plants based on historical levels. (The implementation occurs in two phases: 1995 for an identified set of utility plants and 2000 for all others.) The cost of compliance is expected to change the cost of the output of some existing plants, alter construction approaches to new facilities, cause changes to the fuel use of other power plants, and cause an reexamination by powerplant operators of what can be done to reduce emissions. The impact of the changes will affect the future availability of power from power plants emitting high levels of these gases and increase the attractiveness of acquiring power from other facilities and electrical systems emitting low levels. In addition, traditional wholesale trade patterns are going to be altered by changing practices in the new electric power industry. Cost issues will change to one of price. Availability of electrical energy will change to issues concerning more effective capacity utilization and that may mean more use of high emission source generators.


International Transactions

U.S. electric utilities and power marketers have taken advantage of being able to enter into international trade agreements to acquire energy from Canada and Mexico. These trade agreements between Canadian utilities and U.S. participants in the electric power industry cover a variety of transaction options. The options include purchasing nonfirm energy from relatively inexpensive renewable resources (hydroelectric from Canada and geothermal from Mexico); acquiring additional generating capability to support contracted requirements for supply; the holding of purchased electricity (as reservoir water) to be reacquired when needed; and sharing the benefits of coordinated operations planning for the electrical systems. In some instances, consumers can be served more efficiently if they are connected to foreign transmission lines, because they are geographically closer to those lines.

Data Sources

Statistics on electricity transactions among U.S. electric utilities and on international electricity trade (including the United States, Canada, and Mexico) are presented in the following tables. These data were obtained from the Form EIA-861, "The Annual Electric Utility Report"; the Form EIA-860, "Annual Electric Generator Report"; the Form EIA-411, "Coordinated Bulk Power Supply Program Report"; and the Department of Energy, Office of the Assistant Secretary for Fossil Energy, Form FE-781R, "Annual Report of International Electric Export/Import Data."

Figure 13. North American Electric Reliability Council Regions for the Contiguous United States and Alaska

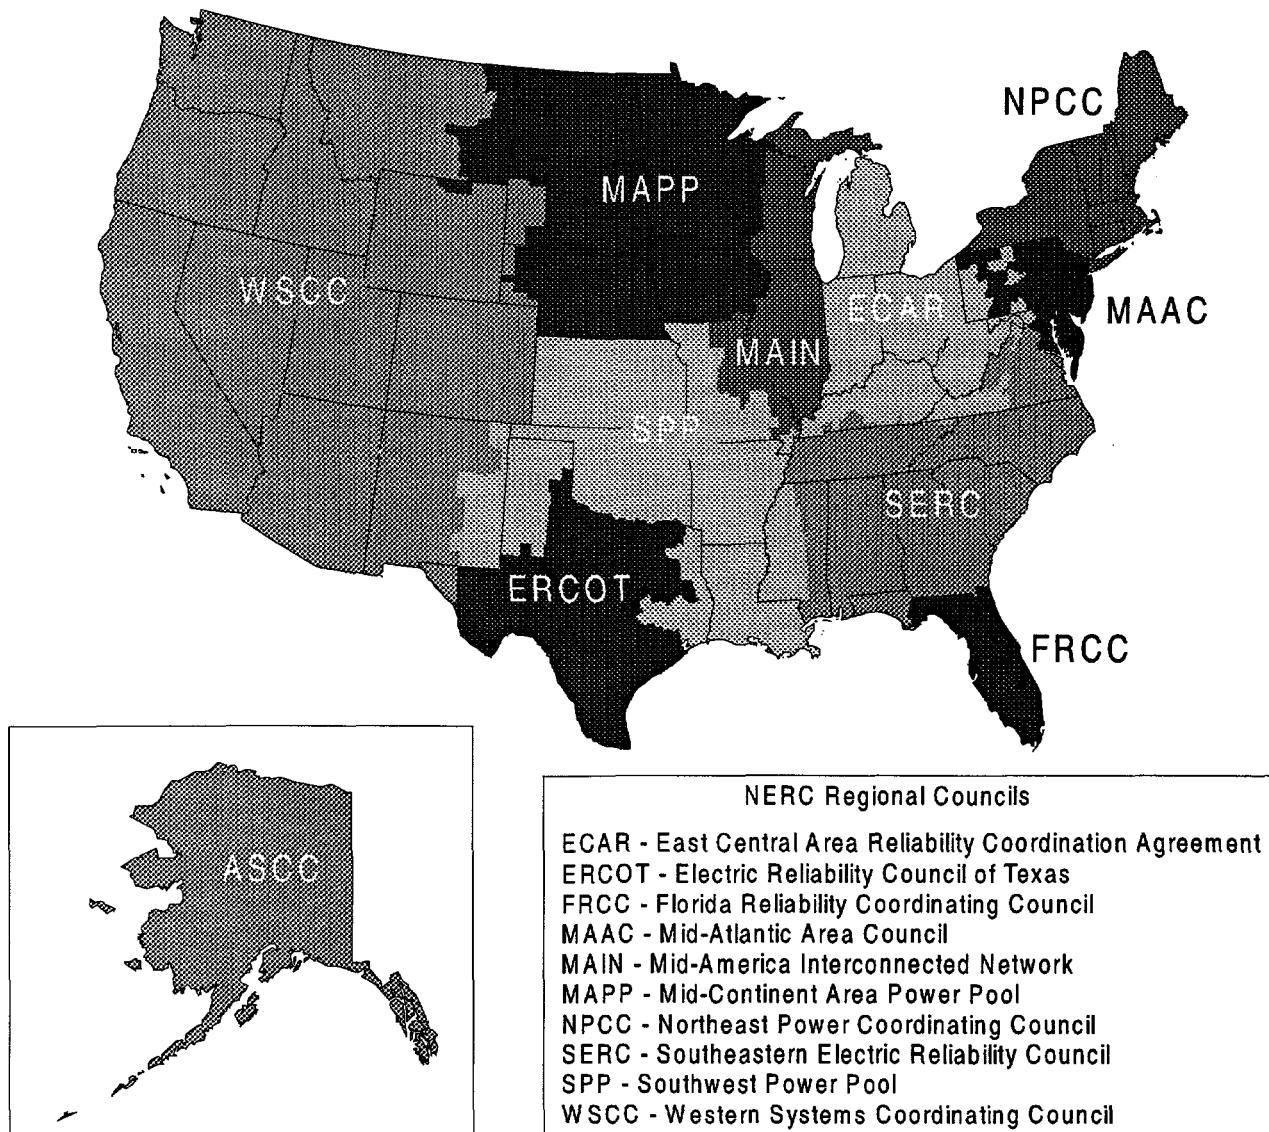

Note: The Alaska Systems Coordinating Council (ASCC) is an affiliate NERC member.

Source: Energy Information Administration, Office of Coal, Nuclear, Electric and Alternate Fuels.

Table 31. Sources and Disposition of Electricity at U.S. Electric Utilities, 1993 Through 1997
(Million Kilowatthours)

Item	1993	1994	1995	1996	1997
Source					
Net Generation.....	2,897,815	2,924,961	3,002,304	3,099,945	3,144,768
Purchases from Utilities.....	1,218,882	1,226,814	R 1,305,958	1,465,174	1,634,203
Purchases from Nonutilities.....	188,537	208,778	R 222,110	229,018	243,213
Net Exchange.....	-2,725	-3,659	R -39	-11,677	-17,047
Net Wheeling.....	4,668	4,225	7,016	7,324	7,095
Disposition					
Sales to Ultimate Consumers.....	2,861,462	2,934,563	3,013,287	3,097,810	3,139,826
Requirements and Nonrequirements Sales for Resale.....	1,200,047	1,185,352	R 1,276,356	1,431,179	1,615,648
Energy Furnished Without Charge.....	5,003	4,762	5,362	6,205	6,319
Energy Used by Utility Electric Department.....	14,245	15,495	R 12,455	13,886	13,424
Energy Losses ¹	226,415	220,948	R 228,196	238,695	234,861

¹ These values are not measured; however, they represent losses and unaccounted for energy. These values are calculated in order that source and disposition of energy are equivalent.

R = Revised data.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Annual net generation data shown here should only be used in comparison with other Form EIA-861 data. Differences in this net generation data and net generation reported on the Form EIA-759, "Monthly Power Plant Report," (Table 1) occur due to the time frame in reporting. Since the components of net generation are provided monthly by the Form EIA-759 by prime mover and energy source, the Form EIA-759 is used as the official Energy Information Administration source for net generation. •Totals may not equal sum of components because of independent rounding. •The source and disposition of electricity represent the total volume of energy transactions between utilities. These data should not be summed as they are the aggregation of data reported for each utility and could be double counted due to the nature and types of electricity trade. •Due to the complexity of electric power transactions that involve specifics of contracts, simultaneous energy transactions, the unintended receipt and delivery of energy (inadvertent flow), and losses, uniformity in reporting the classification and quantity of each transaction among utilities may not exist.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 32. Net Generation from U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
(Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
BCAR.....	494,602	492,074	509,468	528,214	530,896
ERCOT.....	198,187	204,256	210,596	218,497	221,407
FRCC.....	—	—	—	—	146,217
MAAC.....	205,552	206,221	203,801	200,669	204,269
MAIN.....	217,284	221,770	229,424	231,315	216,732
MAPP(U.S.).....	124,808	124,607	130,637	132,689	133,885
NPCC(U.S.).....	195,140	189,546	183,021	185,521	188,075
SERC.....	667,464	678,423	703,899	740,784	617,191
SPP.....	256,901	260,025	274,475	276,205	278,701
WSCC(U.S.).....	527,428	537,399	546,208	574,878	596,496
Contiguous U.S.....	2,887,366	2,914,320	2,991,529	3,088,772	3,133,869
ASCC.....	4,660	4,913	4,925	5,178	5,013
Hawaii.....	5,790	5,728	5,851	5,994	5,886
U.S. Total	2,897,815	2,924,961	3,002,304	3,099,945	3,144,768

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Annual net generation data shown here should only be used in comparison with other Form EIA-861 data. Differences in this net generation data and net generation reported on the Form EIA-759, "Monthly Power Plant Report," (Table 1) occur due to the time frame in reporting. Since the components of net generation are provided monthly by the Form EIA-759 by prime mover and energy source, the Form EIA-759 is used as the official Energy Information Administration source for net generation. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 33. U.S. Electric Utility Sales to Ultimate Consumers by Sector, North American Electric Reliability Council Region, and Hawaii, 1993 Through 1997
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	All Sectors	Residential	Commercial	Industrial	Other ¹
1993					
ECAR	447,062	139,068	108,441	189,527	10,026
ERCOT	212,182	76,887	55,602	70,508	9,185
FRCC	—	—	—	—	—
MAAC	220,037	77,450	69,026	70,687	2,873
MAIN	207,004	61,610	57,843	78,858	8,693
MAPP(U.S.)	124,143	44,718	26,568	49,353	3,504
NPCC(U.S.)	236,012	78,417	86,723	56,570	14,302
SERC	638,223	256,275	158,893	204,832	18,223
SPP	249,891	88,012	62,965	90,606	8,308
WSCC(U.S.)	514,212	168,376	164,167	162,076	19,593
Contiguous U.S.	2,848,766	990,812	790,229	973,017	94,708
ASCC	4,374	1,629	2,062	501	182
Hawaii	8,325	2,340	2,285	3,646	54
U.S. Total	2,861,465	994,781	794,576	977,164	94,944
1994					
ECAR	459,747	139,521	111,731	198,793	9,701
ERCOT	218,781	78,708	57,209	73,248	9,615
FRCC	—	—	—	—	—
MAAC	223,635	78,264	75,475	66,999	2,897
MAIN	214,304	62,094	60,086	83,056	9,068
MAPP(U.S.)	128,935	45,372	28,015	51,776	3,771
NPCC(U.S.)	238,679	79,177	89,591	55,255	14,656
SERC	656,478	261,240	164,290	212,424	18,524
SPP	257,183	88,909	65,485	94,302	8,488
WSCC(U.S.)	523,696	171,081	163,782	167,957	20,876
Contiguous U.S.	2,921,437	1,004,366	815,664	1,003,811	97,596
ASCC	4,533	1,688	2,155	511	179
Hawaii	8,593	2,428	2,451	3,659	56
U.S. Total	2,934,563	1,008,482	820,269	1,007,981	97,830
1995					
ECAR	477,126	147,019	116,092	204,072	9,942
ERCOT	222,465	81,158	59,065	72,542	9,700
FRCC	—	—	—	—	—
MAAC	227,532	79,483	86,687	58,440	2,922
MAIN	218,728	66,039	62,774	80,711	9,204
MAPP(U.S.)	134,495	47,489	29,530	53,636	3,840
NPCC(U.S.)	238,492	78,615	94,185	51,661	14,031
SERC	686,458	273,502	172,424	221,297	19,234
SPP	266,912	93,533	67,399	97,392	8,588
WSCC(U.S.)	527,641	171,479	169,704	168,739	17,719
Contiguous U.S.	2,999,849	1,038,317	857,860	1,008,492	95,179
ASCC	4,631	1,713	2,200	546	172
Hawaii	8,806	2,471	2,625	3,655	55
U.S. Total	3,013,287	1,042,501	862,685	1,012,693	95,407

See footnotes at end of table.

Table 33. U.S. Electric Utility Sales to Ultimate Consumers by Sector, North American Electric Reliability Council Region, and Hawaii, 1993 Through 1997 (Continued)
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	All Sectors	Residential	Commercial	Industrial	Other ¹
1996					
ECAR	483,750	149,381	117,924	206,397	10,048
ERCOT	235,780	87,324	60,959	77,113	10,383
FRCC	—	—	—	—	—
MAAC	229,013	81,141	87,597	57,336	2,939
MAIN	219,978	66,015	63,919	80,655	9,390
MAPP(U.S.)	137,767	48,099	30,233	55,600	3,835
NPCC(U.S.)	241,258	79,650	95,532	52,236	13,840
SERC	714,441	288,556	178,815	227,381	19,689
SPP	277,115	96,689	70,230	101,332	8,864
WSCC(U.S.)	544,937	181,329	177,304	167,988	18,316
Contiguous U.S.	3,084,040	1,078,184	882,513	1,026,039	97,504
ASCC	4,779	1,766	2,250	584	179
Hawaii	8,991	2,540	2,662	3,733	55
U.S. Total	3,097,810	1,082,491	887,425	1,030,356	97,539
1997					
ECAR	485,313	146,524	119,486	209,274	10,029
ERCOT	243,029	88,459	61,965	81,583	11,022
FRCC	149,249	73,598	56,159	14,364	5,128
MAAC	228,115	79,143	88,156	57,952	2,864
MAIN	222,714	65,453	64,920	82,790	9,550
MAPP(U.S.)	141,249	48,394	30,760	58,074	4,020
NPCC(U.S.)	242,435	79,287	97,608	51,644	13,896
SERC	571,416	208,634	152,495	195,251	15,036
SPP	282,082	97,416	71,826	103,442	9,398
WSCC(U.S.)	560,421	184,584	180,258	173,842	21,737
Contiguous U.S.	3,126,023	1,071,493	923,634	1,028,215	102,680
ASCC	4,840	1,726	2,180	756	178
Hawaii	8,963	2,531	2,677	3,701	55
U.S. Total	3,139,826	1,075,749	928,491	1,032,672	102,913

¹ Includes public street and highway lighting, other sales to public authorities, sales to railroads and railways, and interdepartmental sales.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 34. Generating Capability at U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Megawatts)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
ECAR.....	R 104,818	R 104,812	104,426	R 103,360	102,518
ERCOT.....	52,889	R 53,110	53,400	R 53,903	53,711
FRCC.....	—	—	—	R 32,751	32,616
MAAC.....	51,589	R 51,629	52,083	R 53,163	53,588
MAIN.....	50,314	R 50,863	51,430	R 52,155	52,093
MAPP(U.S.).....	R 30,915	31,357	31,311	R 30,610	34,820
NPCC(U.S.).....	56,043	55,956	55,567	R 52,177	51,406
SERC.....	149,748	R 151,127	153,434	R 125,079	155,786
SPP.....	R 71,009	R 71,099	71,375	R 71,593	42,871
WSCC(U.S.).....	R 129,334	R 128,937	129,751	R 131,292	129,232
Contiguous U.S.	696,659	698,890	702,777	R 706,083	708,641
ASCC.....	1,711	1,737	1,732	1,734	1,750
Hawaii.....	1,602	1,602	1,602	1,610	1,499
U.S. Total.....	699,971	702,229	706,111	R 709,942	711,889

R = Revised data.

Notes: •Data are final. • The collection of data are as of January 1 of the following year. The 1996 data include the Florida Reliability Coordinating Council created January 1, 1997. The 1997 data include the Entergy Corporation which became part of the Southeastern Electric Reliability Council from the Southwest Power Pool effective January 1, 1998. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 35. Noncoincident Peak Load Actual and Projected, by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Megawatts)

North American Electric Reliability Council Region and Hawaii	Actual				
	1993	1994	1995	1996	1997
Summer					
ECAR.....	85,930	87,165	92,619	90,798	93,492
ERCOT.....	44,255	44,162	46,618	47,480	50,541
FRCC.....	NA	NA	NA	NA	35,375
MAAC.....	46,494	46,019	48,577	44,302	49,464
MAIN.....	41,956	42,562	45,782	46,402	45,887
MAPP(U.S.).....	24,396	27,000	29,192	28,253	29,787
NPCC(U.S.).....	46,706	47,581	47,705	45,094	49,269
SERC.....	136,101	132,584	146,569	145,650	137,382
SPP.....	57,106	56,035	59,595	60,072	36,479
WSCC(U.S.).....	97,809	102,212	103,592	108,739	110,001
Contiguous U.S.	580,753	585,320	620,249	616,790	637,677
ASCC.....	511	524	622	NA	(2)
Hawaii.....	(1)	(1)	(1)	(1)	(1)
U.S. Total.....	581,264	585,844	620,871	616,790	637,677
Winter					
ECAR.....	81,846	75,638	83,465	84,534	75,670
ERCOT.....	35,407	36,180	36,965	38,868	37,966
FRCC.....	NA	NA	NA	NA	33,076
MAAC.....	41,406	40,653	40,790	R 40,468	37,217
MAIN.....	34,966	33,999	35,734	37,162	34,973
MAPP(U.S.).....	21,955	23,033	23,429	24,251	25,390
NPCC(U.S.).....	42,063	42,547	42,755	R 41,208	41,338
SERC.....	133,635	132,661	142,032	143,060	122,649
SPP.....	41,644	42,505	44,626	49,095	27,437
WSCC(U.S.).....	88,811	91,037	94,890	R 95,435	94,158
Contiguous U.S.	521,733	518,253	544,684	554,081	529,874
ASCC.....	632	641	676	NA	(2)
Hawaii.....	(1)	(1)	(1)	(1)	(1)
U.S. Total.....	522,365	518,894	545,360	554,081	529,874

See footnotes at end of table.

Table 35. Noncoincidental Peak Load, Actual and Projected, by North American Electric Reliability Council Region and Hawaii, 1998 Through 2005 (Megawatts)

North American Electric Reliability Council Region and Hawaii	Projected				
	1998	1999	2000	2001	2005
Summer					
ECAR.....	94,725	96,543	97,992	99,918	106,718
ERCOT.....	50,944	52,055	53,076	54,195	59,307
FRCC.....	35,633	36,628	37,410	38,220	41,112
MAAC.....	48,846	49,547	50,228	50,967	53,868
MAIN.....	47,522	48,199	49,101	49,883	53,024
MAPP(U.S.).....	30,407	30,911	31,468	32,064	34,349
NPCC(U.S.).....	50,242	51,050	51,731	52,456	55,273
SERC.....	143,280	146,799	150,095	152,942	164,420
SPP.....	38,638	39,026	39,722	40,512	43,930
WSCC(U.S.).....	108,461	110,648	112,589	114,711	123,480
Contiguous U.S.....	648,694	661,406	673,412	685,870	735,481
ASCC.....	(2)	(2)	(2)	(2)	(2)
Hawaii.....	(1)	(1)	(1)	(1)	(1)
U.S. Total.....	648,694	661,406	673,412	685,870	735,481
Winter					
ECAR.....	85,866	87,648	89,328	90,701	96,771
ERCOT.....	41,094	42,229	43,150	43,912	48,487
FRCC.....	39,449	40,383	41,395	42,219	45,896
MAAC.....	42,680	43,280	43,917	44,554	47,056
MAIN.....	37,993	38,829	39,515	40,178	42,847
MAPP(U.S.).....	25,882	26,367	26,835	27,278	29,122
NPCC(U.S.).....	44,300	44,680	45,208	45,730	48,383
SERC.....	127,404	130,204	132,773	135,310	145,731
SPP.....	28,243	28,692	29,194	29,767	32,072
WSCC(U.S.).....	100,196	101,893	103,741	105,635	113,600
Contiguous U.S.....	573,107	584,205	595,059	605,284	649,965
ASCC.....	(2)	(2)	(2)	(2)	(2)
Hawaii.....	(1)	(1)	(1)	(1)	(1)
U.S. Total.....	573,107	584,205	595,059	605,284	649,965

(1) Data for Hawaii are not submitted on this form.

(2) Data for ASCC (Alaska) was not filed for 1997.

R = Revised data.

Notes: *Data are final. *Totals may not equal sum of components because of independent rounding.

Sources: Data for 1996 and beyond: Form EIA-411, "Coordinated Bulk Power Supply Programs"; Data for prior years: Department of Emergency Policy, Form OE-411, "Coordinated Regional Bulk Power Supply Program."

Table 36. U.S. Electric Utility Receipts by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	Total Receipts	Purchased Power	Exchange Received	Wheeling Received
1993				
ECAR	201,396	167,278	2,927	31,191
ERCOT	144,491	63,523	54,253	26,716
FRCC	—	—	—	—
MAAC	93,051	76,663	3,256	13,132
MAIN	67,930	62,511	400	5,018
MAPP(U.S.)	109,222	89,875	2,567	16,781
NPCC(U.S.)	249,585	178,147	3,622	67,815
SERC	398,660	341,136	30,391	27,132
SPP	166,846	135,037	6,282	25,528
WSCC(U.S.)	485,155	287,564	59,660	137,931
Contiguous U.S.	1,916,336	1,401,733	163,359	351,244
ASCC	3,039	2,582	0	456
Hawaii	3,106	3,103	3	0
U.S. Total....	1,922,481	1,407,419	163,361	351,701
1994				
ECAR	199,000	166,157	1,982	30,861
ERCOT	141,092	61,901	55,122	24,069
FRCC	—	—	—	—
MAAC	94,910	79,907	3,214	11,789
MAIN	66,538	61,159	502	4,877
MAPP(U.S.)	109,057	87,606	2,414	19,038
NPCC(U.S.)	267,351	194,510	3,957	68,883
SERC	397,661	340,918	31,609	25,134
SPP	172,119	142,619	5,955	23,545
WSCC(U.S.)	472,025	294,190	49,919	127,915
Contiguous U.S.	1,919,751	1,428,966	154,675	336,111
ASCC	3,952	3,184	73	695
Hawaii	3,444	3,442	3	0
U.S. Total....	1,927,147	1,435,591	154,750	336,805
1995				
ECAR	223,966	188,679	2,158	33,128
ERCOT	145,430	62,215	50,420	33,795
FRCC	—	—	—	—
MAAC	114,216	98,773	528	14,915
MAIN	67,367	60,707	389	6,270
MAPP(U.S.)	112,956	92,315	2,826	17,816
NPCC(U.S.)	262,947	199,059	3,998	59,890
SERC	426,796	354,477	41,550	30,769
SPP	176,109	147,082	5,525	23,502
WSCC(U.S.)	484,202	297,960	51,633	134,610
Contiguous U.S.	2,013,988	1,500,268	159,026	354,694
ASCC	4,217	3,301	137	779
Hawaii	3,522	3,518	4	0
U.S. Total....	2,021,728	1,507,087	159,167	355,473

See footnotes at end of table.

Table 36. U.S. Electric Utility Receipts by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Continued)
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	Total Receipts	Purchased Power	Exchange Received	Wheeling Received
1996				
ECAR	264,825	203,637	1,361	59,827
ERCOT	148,971	73,590	55,354	20,027
FRCC	—	—	—	—
MAAC	141,448	120,701	474	20,272
MAIN	75,234	67,287	252	7,695
MAPP(U.S.)	124,893	102,960	4,189	17,744
NPCC(U.S.)	276,773	209,271	3,799	63,703
SERC	454,193	384,930	31,998	37,264
SPP	198,090	166,768	5,340	25,982
WSCC(U.S.)	574,451	358,142	51,859	164,449
Contiguous U.S.	2,258,877	1,687,286	154,627	416,964
ASCC	4,257	3,338	99	820
Hawaii	3,572	3,568	4	0
U.S. Total	2,266,707	1,694,192	154,731	417,784
1997				
ECAR	319,497	259,083	1,764	58,650
ERCOT	134,715	78,170	56,511	1 0
FRCC	50,820	40,140	33	10,647
MAAC	151,729	135,582	518	15,629
MAIN	105,155	88,740	294	16,121
MAPP(U.S.)	132,812	108,307	3,814	20,691
NPCC(U.S.)	290,015	201,349	4,879	83,786
SERC	425,460	343,940	29,589	51,932
SPP	209,892	168,466	9,780	31,645
WSCC(U.S.)	645,753	446,667	47,919	151,166
Contiguous U.S.	2,465,847	1,870,443	155,101	440,303
ASCC	4,267	3,348	79	840
Hawaii	3,627	3,625	2	0
U.S. Total	2,473,741	1,877,416	155,183	441,143

¹ "Wheeling Received" and "Wheeling Delivered" for ERCOT in 1997 reflect enactment by the Public Utility Commission of Texas (the Commission) of Substantive Rule 23.67 ("Open-access Comparable Transmission Service"), effective on September 12, 1996. SR 23.67 governs virtually all phases of transmission access in Texas and requires that wheeling services, provided by transmission facility operators under the jurisdiction of the Commission, shall be reimbursed using the vector-absolute, megawatt/mile method. This method derives reimbursement rates utilizing information on the total line-mileage under load, the maximum load in megawatts, and the fee per megawatt-mile. Use of this method does not require transmission service providers to measure energy flows."

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 37. U.S. Electric Utility Deliveries by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	Total Deliveries	Requirements and Nonrequirements Sales for Resale	Exchange Delivered	Wheeling Delivered
1993				
ECAR	216,294	182,147	3,153	30,994
ERCOT	114,854	33,760	54,409	26,686
FRCC	—	—	—	—
MAAC	60,556	47,525	1	13,030
MAIN	62,541	57,410	180	4,951
MAPP(U.S.)	98,325	77,943	4,251	16,130
NPCC(U.S.)	189,109	119,632	1,923	67,553
SERC	374,073	321,445	27,304	25,324
SPP	151,816	119,353	7,044	25,419
WSCC(U.S.)	442,657	238,351	67,816	136,489
Contiguous U.S.	1,710,224	1,197,567	166,081	346,576
ASCC	2,936	2,480	0	456
Hawaii	5	0	5	0
U.S. Total	1,713,165	1,200,047	166,086	347,032
1994				
ECAR	199,188	166,045	2,513	30,630
ERCOT	112,985	33,536	55,360	24,088
FRCC	—	—	—	—
MAAC	60,205	48,483	2	11,720
MAIN	58,584	53,490	284	4,810
MAPP(U.S.)	92,834	70,181	4,236	18,417
NPCC(U.S.)	198,490	128,171	1,731	68,587
SERC	367,081	312,497	31,071	23,514
SPP	153,989	124,902	5,638	23,448
WSCC(U.S.)	429,034	244,874	57,489	126,672
Contiguous U.S.	1,672,389	1,182,180	158,324	331,885
ASCC	3,945	3,172	78	695
Hawaii	6	0	6	0
U.S. Total	1,676,341	1,185,352	158,409	332,580
1995				
ECAR	221,627	186,464	2,270	32,893
ERCOT	118,456	34,017	50,644	33,796
FRCC	—	—	—	—
MAAC	71,357	56,800	9	14,548
MAIN	61,427	55,044	209	6,175
MAPP(U.S.)	95,503	74,621	4,285	16,596
NPCC(U.S.)	186,345	124,463	2,256	59,626
SERC	393,683	327,687	37,116	28,880
SPP	161,207	132,687	5,113	23,406
WSCC(U.S.)	449,423	260,585	57,080	131,758
Contiguous U.S.	1,759,028	1,252,369	158,981	347,678
ASCC	4,138	3,250	109	779
Hawaii	11	0	11	0
U.S. Total	1,763,177	1,255,618	159,101	348,457

See footnotes at end of table.

Table 37. U.S. Electric Utility Deliveries by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Continued)
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	Total Deliveries	Requirements and Nonrequirements Sales for Resale	Exchange Delivered	Wheeling Delivered
1996				
ECAR	274,275	213,373	1,381	59,522
ERCOT	115,163	39,924	55,230	20,009
FRCC	—	—	—	—
MAAC	93,421	73,221	22	20,177
MAIN	69,301	61,421	330	7,550
MAPP(U.S.)	104,835	82,899	5,479	16,457
NPCC(U.S.)	201,223	135,832	1,991	63,400
SERC	429,948	352,216	42,307	35,425
SPP	174,435	143,548	5,017	25,870
WSCC(U.S.)	541,181	325,405	54,546	161,230
Contiguous U.S.	2,003,783	1,427,839	166,304	409,640
ASCC	4,257	3,340	97	820
Hawaii	7	0	7	0
U.S. Total	2,008,047	1,431,179	166,407	410,460
1997				
ECAR	329,876	269,688	1,782	58,406
ERCOT	96,812	40,346	56,392	10
FRCC	37,627	27,182	19	10,426
MAAC	108,060	92,418	16	15,626
MAIN	83,187	66,939	331	15,918
MAPP(U.S.)	112,294	89,619	3,306	19,370
NPCC(U.S.)	215,183	128,377	3,315	83,491
SERC	431,021	336,819	44,850	49,352
SPP	182,790	140,450	10,656	31,685
WSCC(U.S.)	621,033	420,696	51,476	148,860
Contiguous U.S.	2,217,885	1,612,533	172,144	433,208
ASCC	4,037	3,115	82	840
Hawaii	4	0	4	0
U.S. Total	2,221,926	1,615,648	172,230	434,048

¹ "Wheeling Received" and "Wheeling Delivered" for ERCOT in 1997 reflect enactment by the Public Utility Commission of Texas (the Commission) of Substantive Rule 23.67 ("Open-access Comparable Transmission Service"), effective on September 12, 1996. SR 23.67 governs virtually all phases of transmission access in Texas and requires that wheeling services, provided by transmission facility operators under the jurisdiction of the Commission, shall be reimbursed using the vector-absolute, megawatt/mile method. This method derives reimbursement rates utilizing information on the total line-mileage under load, the maximum load in megawatts, and the fee per megawatt-mile. Use of this method does not require transmission service providers to measure energy flows."

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding. •This is a summation of utility trade for utilities that operate within the NERC Region. •Due to the complexity of electric power transactions that involve specifics of contracts, simultaneous energy transactions, the unintended receipt and delivery of energy (inadvertent flow), and losses, uniformity in reporting the classification and quantity of each transaction among utilities may not exist. •Includes utility, export, and nonutility transactions.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

**Table 38. U.S. Electric Utility Net Energy Flow by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
(Million Kilowatthours)**

North American Electric Reliability Council Region and Hawaii	Net Energy Flow ¹	Receipts ²	Deliveries ³
1993			
ECAR	-14,898	201,396	216,294
ERCOT	29,637	144,491	114,854
FRCC	—	—	—
MAAC	32,495	93,051	60,556
MAIN	5,388	67,930	62,541
MAPP(U.S.)	10,898	109,222	98,325
NPCC(U.S.)	60,476	249,585	189,109
SERC	24,587	398,660	374,073
SPP	15,031	166,846	151,816
WSCC(U.S.)	42,498	485,155	442,657
Contiguous U.S.	206,112	1,916,336	1,710,224
ASCC	103	3,039	2,936
Hawaii	3,101	3,106	5
U.S. Total	209,316	1,922,481	1,713,165
1994			
ECAR	-188	199,000	199,188
ERCOT	28,107	141,092	112,985
FRCC	—	—	—
MAAC	34,705	94,910	60,205
MAIN	7,954	66,538	58,584
MAPP(U.S.)	16,223	109,057	92,834
NPCC(U.S.)	68,861	267,351	198,490
SERC	30,580	397,661	367,081
SPP	18,130	172,119	153,989
WSCC(U.S.)	42,990	472,025	429,034
Contiguous U.S.	247,362	1,919,751	1,672,389
ASCC	6	3,952	3,945
Hawaii	3,438	3,444	6
U.S. Total	250,806	1,927,147	1,676,341
1995			
ECAR	2,339	223,966	221,627
ERCOT	26,974	145,430	118,456
FRCC	—	—	—
MAAC	42,859	114,216	71,357
MAIN	5,940	67,367	61,427
MAPP(U.S.)	17,453	112,956	95,503
NPCC(U.S.)	76,602	262,947	186,345
SERC	33,112	426,796	393,683
SPP	14,902	176,109	161,207
WSCC(U.S.)	34,779	484,202	449,423
Contiguous U.S.	254,960	2,013,988	1,759,028
ASCC	79	4,217	4,138
Hawaii	3,512	3,522	11
U.S. Total	258,551	2,021,728	1,763,177

See footnotes at end of table.

Table 38. U.S. Electric Utility Net Energy Flow by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Continued)
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	Net Energy Flow ¹	Receipts ²	Deliveries ³
1996			
ECAR	-9,450	264,825	274,275
ERCOT	33,808	148,971	115,163
FRCC	—	—	—
MAAC	48,027	141,448	93,421
MAIN	5,933	75,234	69,301
MAPP(U.S.)	20,058	124,893	104,835
NPCC(U.S.)	75,550	276,773	201,223
SERC	24,245	454,193	429,948
SPP	23,655	198,090	174,435
WSCC(U.S.)	33,270	574,451	541,181
Contiguous U.S.	255,095	2,258,877	2,003,783
ASCC	—	4,257	4,257
Hawaii	3,565	3,572	7
U.S. Total	258,660	2,266,707	2,008,047
1997			
ECAR	-10,379	319,497	329,876
ERCOT	37,903	134,715	96,812
FRCC	13,192	50,820	37,627
MAAC	43,669	151,729	108,060
MAIN	21,968	105,155	83,187
MAPP(U.S.)	20,518	132,812	112,294
NPCC(U.S.)	74,831	290,015	215,183
SERC	-5,561	425,460	431,021
SPP	27,101	209,892	182,790
WSCC(U.S.)	24,720	645,753	621,033
Contiguous U.S.	247,962	2,465,847	2,217,885
ASCC	230	4,267	4,037
Hawaii	3,623	3,627	4
U.S. Total	251,815	2,473,741	2,221,926

¹ Equals receipts minus deliveries.

² Equals purchased power plus exchange received plus wheeling received and imports.

³ Equals sales for resale plus exchange delivered plus wheeling delivered and exports.

* =Value less than 0.5 thousand.

Notes: *Data for 1997 are preliminary. Data for all other years are final. *Totals may not equal sum of components because of independent rounding. *This is a summation of all utility trade for utilities that operate within the NERC Region. *Due to the complexity of electric power transactions that involve specifics of contracts, simultaneous energy transactions, the unintended receipt and delivery of energy (inadvertent flow), and losses, uniformity in reporting the classification and quantity of each transaction among utilities may not exist. *Includes utility, import, and nonutility transactions.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 39. U.S. Electric Utility Purchases of Nonutility Generated Electricity by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
 (Million Kilowatthours)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
ECAR.....	11,962	12,659	13,131	15,861	15,989
ERCOT.....	24,267	23,264	22,653	23,916	25,908
FRCC.....	—	—	—	—	11,824
MAAC.....	18,083	20,911	23,870	23,892	24,019
MAIN.....	401	392	447	468	971
MAPP(U.S.).....	582	585	585	706	1,053
NPCC(U.S.).....	42,724	49,348	57,511	56,207	58,858
SERC.....	19,021	24,020	29,184	31,276	15,324
SPP.....	6,809	6,856	5,345	6,090	5,130
WSCC(U.S.).....	61,580	67,297	65,842	67,028	80,502
Contiguous U.S.	185,429	205,332	218,567	225,445	239,577
ASCC.....	4	4	7	5	10
Hawaii.....	3,103	3,442	3,518	3,568	3,625
U.S. Total.....	188,537	208,778	222,092	229,018	243,213

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 40. Net Internal Demand, Planned Capacity Resources, and Capacity Margins by North American Electric Reliability Council Region and Hawaii, 1997 Through 2005 (Megawatts)

North American Electric Reliability Council Region and Hawaii	1997			1998		
	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)
Summer						
ECAR.....	88,573	104,953	15.6	91,103	105,106	13.3
ERCOT.....	45,636	55,230	17.4	47,746	55,771	14.4
FRCC.....	31,868	38,237	16.7	32,874	39,613	17.0
MAAC.....	45,628	56,774	19.6	46,548	56,155	17.1
MAIN.....	44,470	52,880	15.9	45,194	52,160	13.4
MAPP(U.S).....	27,298	33,121	17.6	28,221	34,027	17.1
NPCC(U.S).....	48,950	58,592	16.5	50,240	60,729	17.3
SERC.....	109,270	126,196	13.4	134,968	155,016	12.9
SPP.....	59,017	69,344	14.9	37,009	43,591	15.1
WSCC(U.S).....	101,728	135,049	24.7	104,486	135,687	23.0
Contiguous U.S.....	602,438	730,376	17.5	618,389	737,855	16.2
ASCC.....	(1)	(1)	(1)	(1)	(1)	(1)
Hawaii.....	(2)	(2)	(2)	(2)	(2)	(2)
U.S. Total.....	602,438	730,376	17.5	618,389	737,855	16.2
2000						
North American Electric Reliability Council Region and Hawaii	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)
	Summer			2005		
ECAR.....	94,253	108,183	12.9	102,869	118,003	12.8
ERCOT.....	49,607	58,190	14.7	55,486	61,990	10.5
FRCC.....	34,305	40,499	15.3	37,768	45,465	16.9
MAAC.....	48,342	56,607	14.6	52,110	56,441	7.7
MAIN.....	46,678	54,401	14.2	50,463	58,967	14.4
MAPP(U.S).....	29,068	34,217	15.0	31,627	33,846	6.6
NPCC(U.S).....	51,731	62,458	17.2	55,273	60,057	8.0
SERC.....	141,572	159,280	11.1	155,707	173,531	10.3
SPP.....	37,832	44,305	14.6	41,843	47,473	11.9
WSCC(U.S).....	108,458	135,787	20.1	119,287	139,772	14.7
Contiguous U.S.....	641,846	753,887	14.9	702,433	795,545	11.7
ASCC.....	(1)	(1)	(1)	(1)	(1)	(1)
Hawaii.....	(2)	(2)	(2)	(2)	(2)	(2)
U.S. Total.....	641,846	753,887	14.9	702,433	795,545	11.7
1997						
North American Electric Reliability Council Region and Hawaii	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)
	Winter			1998		
ECAR.....	80,592	106,399	24.3	82,641	105,870	21.9
ERCOT.....	37,267	55,422	32.8	38,056	55,972	32.0
FRCC.....	34,650	40,193	13.8	35,671	42,181	15.4
MAAC.....	41,338	59,671	30.7	41,563	58,425	28.9
MAIN.....	35,093	53,364	34.2	36,158	51,685	30.0
MAPP(U.S).....	23,697	32,511	27.1	24,639	33,242	25.9
NPCC(U.S).....	43,900	62,304	29.5	44,300	62,107	28.7
SERC.....	101,390	127,701	20.6	120,792	156,074	22.6
SPP.....	43,880	69,617	37.0	27,689	41,953	34.0
WSCC(U.S).....	96,233	136,574	29.5	98,897	136,543	27.6
Contiguous U.S.....	538,040	743,756	27.7	550,406	744,052	26.0
ASCC.....	(1)	(1)	(1)	(1)	(1)	(1)
Hawaii.....	(2)	(2)	(2)	(2)	(2)	(2)
U.S. Total.....	538,040	743,756	27.7	550,406	744,052	26.0

¹ Data for ASCC (Alaska) was not filed.

² Data for Hawaii are not submitted on this form.

Table 40. Net Internal Demand, Planned Capacity Resources, and Capacity Margins by North American Electric Reliability Council Region and Hawaii, 1997 Through 2005 (Continued) (Megawatts)

North American Electric Reliability Council Region and Hawaii	2000			2005		
	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)	Net Internal Demand	Planned Capacity Resources	Capacity Margin (percent)
Winter						
ECAR.....	86,063	110,013	21.8	93,410	121,216	22.9
ERCOT.....	39,962	58,459	31.6	44,987	61,113	26.4
FRCC.....	37,322	42,884	13.0	41,536	48,801	14.9
MAAC.....	43,186	57,546	25.0	46,358	57,553	19.5
MAIN.....	37,712	52,028	27.5	40,926	58,127	29.6
MAPP(U.S.).....	25,542	33,308	23.3	27,658	33,437	17.3
NPCC(U.S.).....	45,208	63,390	28.7	48,383	62,553	22.7
SERC.....	125,958	160,682	21.6	138,432	175,382	21.1
SPP.....	28,460	42,515	33.1	31,274	45,091	30.6
WSCC(U.S.).....	102,331	137,749	25.7	112,142	140,977	20.5
Contiguous U.S.....	571,744	758,574	24.6	625,106	804,250	22.3
ASCC.....	(b)	(b)	(b)	(b)	(b)	(b)
Hawaii.....	(2)	(2)	(2)	(2)	(2)	(2)
U.S. Total.....	571,744	758,574	24.6	625,106	804,250	22.3

1 Data for ASCC (Alaska) was not filed.

2 Data for Hawaii are not submitted on this form.

Notes: *Data are final. *Totals may not equal sum of components because of independent rounding.

Sources: Data for 1996 and beyond: Form EIA-411, "Coordinated Bulk Power Supply Programs"; Data for prior years: Department of Emergency Policy, Form OE-411, "Coordinated Regional Bulk Power Supply Program."

Table 41. Net Imports at U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997 (Thousand Kilowatthours)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
ECAR.....	931,679	6,906,673	5,758,866	1,901,577	1,385,174
ERCOT.....	-7,760	-25,191	-6,475	3,171	3,425
FRCC.....	—	—	—	—	—
MAAC.....	—	—	—	—	—
MAIN.....	—	—	—	—	—
MAPP(U.S.).....	7,808,685	9,380,144	9,858,469	11,203,425	13,768,757
NPCC(U.S.).....	16,756,045	23,535,934	22,309,577	19,022,934	16,870,671
SERC.....	—	—	—	—	—
SPP.....	—	—	—	—	—
WSCC(U.S.).....	2,938,533	4,840,154	-306,773	5,392,064	-87,828
Contiguous U.S.....	28,427,182	44,637,717	37,613,664	37,523,171	31,940,199
ASCC.....	*	*	*	*	*
Hawaii.....	—	—	—	—	—
U.S. Total.....	28,427,182	44,637,717	37,613,664	37,523,171	31,940,199
Net Canada.....	27,283,021	43,695,066	36,510,673	37,575,644	33,419,529
Net Mexico.....	1,144,160	942,651	1,102,990	-52,474	-1,479,330

* =Value less than 0.5.

Notes: *Data for 1997 are preliminary. Data for all other years are final. *Totals may not equal sum of components because of independent rounding.

*Values identify point of entry or exit, but do not necessarily identify point of consumption. *These data reflect electricity trade with Canada and Mexico.

*Net imports data represent gross imports minus gross exports.

Source: Office of Fuels Programs, Fossil Energy, Form FE-781R, "Annual Report of International Electric Export/Import Data."

Table 42. Imports to U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
(Thousand Kilowatthours)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
ECAR.....	959,746	6,909,598	5,798,944	2,110,820	3,097,274
ERCOT.....	14	70	0	5,566	6,236
FRCC.....	—	—	—	—	—
MAAC.....	—	—	—	—	—
MAIN.....	—	—	—	—	—
MAPP(U.S.).....	10,767,276	10,130,216	10,332,719	11,852,438	14,208,046
NPCC(U.S.).....	18,741,212	25,080,505	23,413,069	20,548,422	18,459,687
SERC.....	—	—	—	—	—
SPP.....	—	—	—	—	—
WSCC(U.S.).....	8,613,566	10,109,276	7,215,641	12,026,170	11,729,358
Contiguous U.S.....	39,081,814	52,229,668	46,760,374	46,543,416	47,500,601
ASCC.....	*	*	*	*	*
Hawaii.....	—	—	—	—	—
U.S. Total	39,081,814	52,229,668	46,760,374	46,543,416	47,500,601
From Canada.....	37,088,486	50,218,349	44,502,962	45,280,264	47,477,872
From Mexico.....	1,993,327	2,011,319	2,257,411	1,263,152	22,729

* =Value less than 0.5.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.
•Values identify point of entry or exit, but do not necessarily identify point of consumption. •These data reflect electricity imported from Canada and Mexico.

Source: Office of Fuels Programs, Fossil Energy, Form FE-781R, "Annual Report of International Electric Export/Import Data."


Table 43. Exports from U.S. Electric Utilities by North American Electric Reliability Council Region and Hawaii, 1993 Through 1997
(Thousand Kilowatthours)

North American Electric Reliability Council Region and Hawaii	1993	1994	1995	1996	1997
ECAR.....	28,067	2,925	40,078	209,243	1,712,100
ERCOT.....	7,774	25,261	6,475	2,395	2,811
FRCC.....	—	—	—	—	—
MAAC.....	—	—	—	—	—
MAIN.....	—	—	—	—	—
MAPP(U.S.).....	2,958,591	750,072	474,250	649,013	439,289
NPCC(U.S.).....	1,985,167	1,544,571	1,103,492	1,525,488	1,589,016
SERC.....	—	—	—	—	—
SPP.....	—	—	—	—	—
WSCC(U.S.).....	5,675,033	5,269,122	7,522,414	6,634,106	11,817,186
Contiguous U.S.....	10,654,632	7,591,951	9,146,710	9,020,245	15,560,402
ASCC.....	*	*	*	*	*
Hawaii.....	—	—	—	—	—
U.S. Total	10,654,632	7,591,951	9,146,710	9,020,245	15,560,402
To Canada.....	9,805,465	6,523,283	7,992,289	7,704,620	14,058,343
To Mexico.....	849,167	1,068,668	1,154,421	1,315,625	1,502,059

* =Value less than 0.5.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.
•Values identify point of entry or exit, but do not necessarily identify point of consumption. •These data reflect electricity exported to Canada and Mexico.

Source: Office of Fuels Programs, Fossil Energy, Form FE-781R, "Annual Report of International Electric Export/Import Data."



U.S. Electric Utility Demand-Side Management

U.S. electric utilities have come to realize that a flexible and diverse management strategy provides the greatest opportunity for success in the competitive and uncertain environment in which they operate. An important component of this strategy has been the reliance on demand-side management (DSM) programs to modify the growth in demand for energy use, to cost-effectively meet customer energy service requirements, to selectively expand customer services, and to optimize the use of generating resources. This chapter provides a brief description of the key elements of electric utility DSM programs in the United States.

its increased attention to DSM programs and its integration of supply- and demand-side resources into a flexible resource portfolio. Utilities and some State regulatory commissions use the IRP process to assess a variety of resource options that meet consumer energy-service requirements, while being responsive to external changes such as economic conditions, resource prices, new technologies, and changes in regulatory and tax policy. In addition to balanced consideration of supply- and demand-side options, the IRP process includes consideration of risk and diversity of supply, maintenance of system reliability, and in some instances the application of specific values to reflect environmental and other external impacts.

Background

DSM consists of electric utilities planning, implementing, and monitoring activities that are designed to encourage consumers to modify their level and pattern of electricity usage. In the past, the primary objective of most DSM programs was to provide cost-effective energy and capacity resources to help defer the need for new sources of power, including generating facilities, power purchases, and transmission and distribution capacity additions. However, due to changes that are occurring within the industry, electric utilities are also using DSM as a way to enhance customer service.

Identifying the right mix of DSM options can be mutually beneficial to the utility, the consumer, and society. The utility can benefit from lowered costs of service, improved operating efficiency, and reduced capital requirements. Consumers can benefit from reduced costs and improved value of service. Society can benefit from reduced emissions and the conservation of finite energy sources.

With the changes that are occurring within the electric utility industry, there is a great deal of uncertainty about the direction of utility sponsored DSM programs. Some utilities have abandoned their DSM programs altogether, other utilities have formed energy service companies, while other utilities are making no changes to their DSM programs.

In many states DSM programs are still a key component of the integrated resource plans (IRP) of a number of electric utilities. The IRP process differs from traditional utility planning practices primarily in

Identify Program Alternatives

The types of DSM programs that utilities select to alter the timing and level of demand for electricity varies depending on their overall organization and market environment, strategic objectives, and system operating characteristics. DSM programs generally promote one of three basic objectives that differ in their intended effects on electricity use (measured in kilowatthours) and demand (measured in kilowatts); energy efficiency, load management, and load shifting.

Energy efficiency or conservation programs are aimed at reducing the energy used by promoting high-efficiency equipment and building design. Such high-efficiency measures generally use less electricity to provide consumers an equivalent or greater level of electric energy services (light, heat, cooling, or drive power).

Load management programs are aimed at reducing demand at certain critical times (such as summer or winter peak) and usually have only a minor effect on annual energy consumption. For example, residential and commercial air conditioners or water heaters may be allowed to operate unimpeded during off-peak demand hours, but are cycled on and off by the utility during a few peak-demand hours.

Flexible load shape programs give consumers the incentive to alter their consumption in response to changes in the utility's cost of providing power. Real time pricing is an example of this type of program.

Planning and Selection of Programs

The main elements of the DSM program planning and selection process are to evaluate consumer characteristics that influence the acceptance of DSM programs and utility considerations affecting resource requirements and the cost of alternative resource options. Among the consumers' characteristics that influence a program's success are demographics, income, knowledge and awareness, attitude and motivation, and discount rate. External influences such as economic conditions, energy prices, technologies, regulation, and tax credits also influence consumer's decisions regarding fuel and appliance choice, efficiency, and use. The utility's considerations are usually focused on the interaction of load shape changes and supply-side resource options, transmission and distribution effects, and regulatory compliance.

The inclusion of environmental externalities in planning generally affects DSM options favorably. For example, if only traditional costs are considered in the planning process, a supply-side option might appear more attractive than a particular energy efficiency program.

However, traditional costs seldom reflect the full cost to society of utility activities that adversely affect the environment. In assessing supply- and demand-side options for planning purposes, regulators have been moving to consider broad impacts of utility resource acquisition on society, including environmental and other externalities. Environmental externalities are real impacts on the production or utility functions of others, including impacts on health and property values which are not reflected in the prices of goods and services.¹⁶ Under traditional command-and-control air quality regulation, the additional emissions associated with operating a polluting facility for more hours do not increase the production costs of the source. Thus, many residual air emissions are classi-

fied as externalities. Externalities also may include foreign oil or transition costs associated with local economic dislocations. Environmental externalities have become a part of the criteria for comparison and selection of utility resource options in 26 States and the District of Columbia.¹⁷

Data Sources

The data in the following tables were collected on Schedule V, "Demand-Side Management Information" of the 1997 Form EIA-861, "Annual Electric Utility Report." Schedule V collects utility information on actual and potential peak load reductions and energy savings for two program categories: Energy Efficiency and Load Management programs, by four major consumer sectors (residential, commercial, industrial, and other). Utilities provide information for the reporting year (1997) and the first forecast year (1998).

Both annual and incremental energy savings and peak load reductions are collected for the reporting year. Annual effects are the total effects in energy use and peak load caused by all new and prior-year participants in the DSM programs that are in place during a given year. It includes all participants in existing and new programs (those implemented during the given year). Incremental effects are the annual effects in energy use and peak load caused by new participants in DSM programs during a given year. Incremental effects are annualized to indicate the program effects that would have occurred had these participants been in the program on January 1 of the given year. DSM costs are reported in one of two categories. If the cost can be tracked to a specific program category (energy efficiency, or load management), it is reported as a direct utility cost under that program category. If the cost cannot be tracked to a program category, it is reported as an indirect utility cost.

¹⁶ William J. Baumol and Wallace E. Oates, *The Theory of Environmental Policy*, 2nd Ed., (Cambridge University Press, New York, 1989) p. 17.

¹⁷ The Consumer Energy Council of America Research Foundation, *Incorporating Environmental Externalities into Utility Planning* (Washington, D.C., 1993).

Why the Numbers are Changing

Utility sponsored DSM programs in the United States have been greatly affected by changes within the electric utility industry. These changes are reflected in the 1997 DSM data, including decreases in Energy Efficiency, Potential Peak Load reductions, Actual Peak Load reductions, and Cost.

The large decrease in Energy Savings can be directly attributed to deregulation. Specifically, many utilities find that it is no longer economically advantageous to continue Energy Efficiency programs, as they did when they acted as monopolies. Instead, many utilities have created Energy Service Companies, which may be subsidiaries of the electric utility. In these cases, the utility is able to 'charge' their customers for energy efficiency programs. As subsidiaries, energy service companies are not required to report data to EIA, yet the programs may continue to exist. Both New York and California have enacted restructuring legislation, and the utilities in these States have reported decreases in their energy savings.

There are a number of reasons for the decreases that occurred between 1996 and 1997 in Potential Peak Load Reduction. Part of these can be attributed to deregulation, in that it is now in a utility's best interest to sell electricity to their consumers. However, a number of utilities operating in states that are not undergoing changes have found that it is cheaper to buy peak power from other utilities, than to offer their customer's peak load control programs.

Changes in Actual Peak Load reduction can not be directly attributed to changes in deregulation and other changes within the industry. Outside factors, such as weather can lead to year-to-year fluctuations in actual peak load reductions.

In 1997, 288 electric utilities reported that they had not spent as much on their DSM programs in 1997 as they had in 1996. Specifically, these utilities combined reported that they spent \$511 million dollars less on DSM in 1997. In comparison, the 284 utilities that reported they spent more on DSM programs in 1997, spent \$120 million more in 1997 than in 1996.

Table 44. U.S. Electric Utility Demand Side Management Program Energy Savings, Actual and Potential Peak Load Reductions, and Cost, 1993 Through 1997

Item	1993	1994	1995	1996	1997
Energy Savings (million kilowatthours) ¹	45,294	52,483	57,421	61,842	56,406
Actual Peak Load Reductions (megawatts) ¹ ²	23,069	25,001	29,561	29,893	25,284
Potential Peak Load Reductions (megawatts) ¹	39,508	42,917	47,029	48,344	41,237
Cost (thousand dollars) ³	2,743,533	2,715,657	2,421,261	1,902,197	1,636,020

¹ Represents the total annual effects caused by all participants in demand-side management programs in effect during a given year. Included are new and existing participants in existing programs (those implemented in prior years that are in place during the reporting year) and all participants in new programs (those implemented during the reporting year).

² Represents the actual reduction in annual peak load achieved by consumers, at the time of annual peak load, as opposed to the installed peak load reduction capability (Potential Peak Reduction).

³ Data represent the sum of the direct and indirect utility costs for the year and reflect the total cash expenditures incurred for the year, reported in nominal dollars, that flowed out to support demand-side management programs. Nonutility costs are excluded.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Data are provided for electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 45. U.S. Electric Utility Actual Peak Load Reductions by North American Electric Reliability Council Region and Hawaii, by Demand-Side Management Program Category, 1993 Through 1997 (Megawatts)

North American Electric Reliability Council Region and Hawaii	Total Actual Peak Load Reduction	Direct Load Control	Interruptible Load	Energy Efficiency	Other Load Management	Other Demand-Side Management
1993						
ECAR.....	1,671	179	773	573	115	31
ERCOT.....	1,414	42	114	949	291	17
FRCC.....	—	—	—	—	—	—
MAAC.....	1,493	329	516	301	340	7
MAIN.....	844	60	247	494	39	4
MAPP(U.S.).....	2,121	793	632	413	270	12
NPCC(U.S.).....	1,968	201	228	1,520	18	*
SERC.....	8,447	1,770	2,792	3,329	439	115
SPP.....	889	395	323	111	36	23
WSCC(U.S.).....	4,210	183	1,003	2,671	250	104
Contiguous U.S.	23,057	3,953	6,628	10,363	1,799	315
ASCC.....	7	2	0	*	4	0
Hawaii.....	5	0	0	5	0	0
U.S. Total.....	23,069	3,955	6,628	10,368	1,803	315
1994						
ECAR.....	1,583	200	634	631	103	15
ERCOT.....	1,838	20	77	1,420	301	19
FRCC.....	—	—	—	—	—	—
MAAC.....	1,803	353	676	414	356	4
MAIN.....	1,177	26	523	576	46	6
MAPP(U.S.).....	2,319	933	656	505	211	14
NPCC(U.S.).....	2,261	90	194	1,959	16	1
SERC.....	8,562	2,118	2,736	3,023	494	192
SPP.....	855	232	249	177	185	13
WSCC(U.S.).....	4,584	203	998	2,950	376	57
Contiguous U.S.	24,983	4,176	6,743	11,655	2,088	321
ASCC.....	8	2	0	1	0	4
Hawaii.....	10	0	0	6	4	0
U.S. Total.....	25,001	4,179	6,743	11,662	2,092	326
1995						
ECAR.....	2,458	364	1,088	839	107	60
ERCOT.....	1,873	22	94	1,447	306	4
FRCC.....	—	—	—	—	—	—
MAAC.....	2,110	311	752	671	362	13
MAIN.....	1,254	26	505	658	59	9
MAPP(U.S.).....	3,373	1,284	1,198	661	215	15
NPCC(U.S.).....	2,594	87	301	2,178	28	*
SERC.....	10,103	2,928	3,314	3,134	495	232
SPP.....	744	150	203	200	172	19
WSCC(U.S.).....	5,028	178	947	3,415	424	63
Contiguous U.S.	29,539	5,350	8,401	13,203	2,168	416
ASCC.....	9	3	0	2	0	5
Hawaii.....	13	0	0	7	0	6
U.S. Total.....	29,561	5,352	8,401	13,212	2,168	426

See footnotes at end of table.

Table 45. U.S. Electric Utility Actual Peak Load Reductions by North American Electric Reliability Council Region and Hawaii, by Demand-Side Management Program Category, 1993 Through 1997 (Continued)
(Megawatts)

North American Electric Reliability Council Region and Hawaii	Total Actual Peak Load Reduction	Direct Load Control	Interruptible Load	Energy Efficiency	Other Load Management	Other Demand-Side Management
1996						
ECAR.....	2,547	398	1,129	852	103	64
ERCOT.....	2,002	27	91	1,571	309	4
FRCC.....	—	—	—	—	—	—
MAAC.....	1,773	230	167	936	426	15
MAIN.....	1,625	42	790	697	84	12
MAPP(U.S.).....	3,106	1,205	853	797	235	15
NPCC(U.S.).....	2,554	79	230	2,219	18	9
SERC.....	10,203	3,221	2,793	3,468	508	212
SPP.....	924	165	387	176	182	13
WSCC(U.S.).....	5,134	206	945	3,517	405	62
Contiguous U.S.	29,869	5,573	7,387	14,233	2,270	405
ASCC.....	7	3	3	2	0	0
Hawaii.....	17	0	0	8	8	1
U.S. Total.....	29,893	5,575	7,390	14,243	2,278	407
1997						
	Total Actual Peak Load Reduction		Energy Efficiency		Load Management	
ECAR	1,239		418		821	
ERCOT.....	1,699		1,593		106	
FRCC.....	3,439		1,909		1,531	
MAAC.....	1,548		1,028		520	
MAIN.....	1,390		377		1,013	
MAPP(U.S.).....	2,502		902		1,600	
NPCC(U.S.).....	2,586		2,287		299	
SERC.....	6,043		1,671		4,372	
SPP.....	709		215		493	
WSCC(U.S.).....	4,108		2,917		1,190	
Contiguous U.S.	25,263		13,318		11,945	
ASCC.....	7		1		6	
Hawaii.....	14		7		7	
U.S. Total.....	25,284		13,326		11,958	

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Data are provided for electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours. •These data reflect actual real changes in the demand for electricity at the time of annual peak load, as opposed to the installed peak load reduction capability (i.e., potential peak load reduction), achieved by all program participants during the reporting year.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 46. U.S. Electric Utility Demand-Side Management Program Annual and Incremental Effects by Program Category, 1997

Program	Actual Peak Load Reductions ¹ (megawatts)	Potential Peak Load Reductions ² (megawatts)	Energy Savings (million kilowatthours)
Annual Effects³			
Large Utilities⁴			
Energy Efficiency ⁵	13,326	0	55,453
Load Management ³	0	0	0
U.S. Total	13,326	0	55,453
Incremental Effects⁶			
Large Utilities⁴			
Energy Efficiency ⁵	1,066	0	4,661
Load Management ³	0	0	0
U.S. Total	1,066	0	4,661
Small Utilities⁷			
Energy Efficiency ⁵	12	0	10
Load Management ³	0	0	0
U.S. Total	12	0	10

¹ Represents the reduction in annual peak load achieved by consumers, at the time of annual peak load.

² Represents the potential peak load reduction as a result of load management, and also includes the actual peak load reduction achieved by energy efficiency programs.

³ Represents the total effects caused by all participants in demand-side management programs in effect during a given year. Included are new and existing participants in existing programs (those implemented in prior years that are in place during the reporting year) and all participants in new programs (those implemented during the reporting year).

⁴ Refers to electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours.

⁵ Includes programs aimed at reducing energy consumption over many hours during the year. These programs reduce load and if they coincide with periods of peak usage they are included in the actual peak load reduction. However, these programs cannot be implemented specifically at the time of peak usage.

⁶ Represents the total effects caused by new participants in existing demand-side management programs and all participants in new programs during the year. Incremental effects are annualized to indicate the program effects that would have resulted had participants been initiated into the program on January 1 of the reporting year.

⁷ Refers to electric utilities with sales to ultimate consumers and sales for resale less than 120,000 megawatthours.

Notes: *Data for 1997 are preliminary. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 47. U.S. Electric Utility Demand-Side Management Program Annual and Incremental Effects by Sector, 1997

Sector	Actual Peak Load Reductions ¹ (megawatts)	Potential Peak Load Reductions ² (megawatts)	Energy Savings (million kilowatthours)
Annual Effects³			
Large Utilities⁴			
Residential	0	0	0
Commercial	0	0	0
Industrial	0	0	0
Other	0	644	0
U.S. Total	0	0	0
Incremental Effects⁵			
Large Utilities⁴			
Residential	0	0	0
Commercial	0	0	0
Industrial	0	0	0
Other	0	0	0
U.S. Total	0	0	0
Small Utilities⁶			
Residential	0	0	0
Commercial	0	0	0
Industrial	0	0	0
Other	0	0	0
U.S. Total	0	0	0

¹ Represents the reduction in annual peak load achieved by consumers, at the time of annual peak load.

² Represents the potential peak load reduction as a result of load management, and also includes the actual peak load reduction achieved by energy efficiency programs.

³ Represents the total effects caused by all participants in demand-side management programs in effect during 1993. Included are new and existing participants in existing programs (those implemented in prior years that were in place during 1993) and all participants in new programs (those implemented during 1993).

⁴ Refers to electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours.

⁵ Represents the total effects caused by new participants in existing demand-side management programs and all participants in new programs during the year. Incremental effects are annualized to indicate program effects that would have resulted had participants been initiated into the program on January 1 of the reporting year.

⁶ Refers to electric utilities with sales to ultimate consumers and sales for resale less than 120,000 megawatthours.

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

**Table 48. U.S. Electric Utility Demand-Side Management Energy Savings by North American Electric Reliability Council Region and Hawaii, 1993 Through 1998
(Million Kilowatthours)**

North American Electric Reliability Council Region and Hawaii	Historical Savings					Projected Savings
	1993	1994	1995	1996	1997	
ECAR.....	1,779	2,237	3,030	3,695	1,984	1,613
ERCOT.....	2,288	3,739	3,757	3,866	3,530	3,678
FRCC.....	—	—	—	—	5,418	5,638
MAAC.....	1,150	1,820	3,000	3,620	4,003	4,162
MAIN.....	2,125	2,453	2,732	3,007	1,429	1,611
MAPP(U.S.).....	1,581	1,883	2,506	3,153	3,442	4,769
NPCC(U.S.).....	6,769	8,422	9,694	10,022	9,125	8,632
SERC.....	11,264	11,768	10,143	10,404	4,588	4,450
SPP.....	365	492	335	358	253	262
WSCC(U.S.).....	17,954	19,634	22,178	23,663	22,570	19,057
Contiguous U.S.	45,275	52,449	57,374	61,789	56,342	53,872
ASCC.....	2	3	4	5	9	7
Hawaii.....	17	31	43	49	55	75
U.S. Total.....	45,294	52,483	57,421	61,842	56,406	53,954

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.

•Data are provided for electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 49. U.S. Electric Utility Demand-Side Management Cost by North American Electric Reliability Council Region and Hawaii, 1993 Through 1998
(Thousand Dollars)

North American Electric Reliability Council Region and Hawaii	Existing					Projected
	1993	1994	1995	1996	1997	
ECAR.....	187,137	137,118	138,910	77,031	37,270	42,205
ERCOT.....	62,533	69,538	70,421	54,120	41,839	53,921
FRCC.....	—	—	—	—	267,738	253,466
MAAC.....	262,111	305,190	300,347	225,253	184,125	201,205
MAIN.....	128,607	96,253	78,004	70,350	50,513	56,345
MAPP(U.S.).....	103,185	138,256	158,971	156,688	125,804	127,467
NPCC(U.S.).....	565,145	462,668	346,716	263,160	272,144	252,842
SERC.....	643,081	684,647	681,161	551,038	245,385	236,888
SPP.....	33,376	28,626	26,523	28,385	18,751	17,497
WSCC(U.S.).....	756,947	792,387	619,575	471,759	384,197	331,855
Contiguous U.S.	2,741,832	2,714,726	2,420,628	1,897,782	1,627,766	1,573,691
ASCC.....	419	386	633	291	322	403
Hawaii.....	1,282	588	0	4,124	7,932	12,117
Total Cost¹	2,743,533	2,715,657	2,421,261	1,902,197	1,636,020	1,586,211

¹ Reflects the sum of the total incurred direct and indirect utility cost for the year. Utility cost reflect the total cash expenditures for the year, in nominal dollars, that flows out to support demand-side management programs. Nonutility costs are excluded.

Notes: •Data for 1997 are preliminary. Data for all other years are final. •Totals may not equal sum of components because of independent rounding.

•Data are provided for electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours. •These data refer to electric utility costs and represent the total cash expenditures incurred during the year, in nominal dollars, that flows out to support demand-side management programs.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

Table 50. U.S. Electric Utility Demand-Side Management Direct and Indirect Cost, 1997 and 1998
(Thousand Dollars)

Program	Historical Cost		Projected Costs
	1997	1998	
Total Direct Cost¹	1,347,245		1,336,017
Energy Efficiency.....	892,468		883,658
Total Utility Cost	1,636,020		1,586,211

¹ Reflects electric utility cost incurred during the year that are identified with one of the demand-side program categories.

Notes: •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding. •Data are provided for electric utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours.

Source: Energy Information Administration, Form EIA-861, "Annual Electric Utility Report."

U.S. Nonutility Power Producers

This chapter provides an overview of U.S. nonutility power producers, and their generating technologies, together with statistical data on capacity, generation, sales, consumption and emissions for 1993 through 1997. These data are aggregated at the U.S. Census division level. Since nonutility data are confidential, the EIA implemented information disclosure rules. (See "Nondisclosure of Data" in Appendix A.)

In 1989, the Energy Information Administration (EIA) began collecting nonutility electricity generation data on the Form EIA-867, "Annual Nonutility Power Producers Report." This survey enables the EIA to supplement its data on electric utility production and to fill the information gap on this growing source of electric power. The initial survey was developed to include capacity, fuel consumption, generation, and deliveries of electricity to traditional utilities. Due to the sensitivity of the data on costs and reliability expressed by representatives of the nonutility power producers, these data were excluded from the survey. (See "Form EIA-867" in Appendix A.)

Background

Early in the 20th century, more than half of all electricity produced in the United States came from industrial firms. However, during the first half of the 20th century, major changes occurred in the industry: economies of scale in generation, decreased rates, and greatly improved reliability made electricity inexpensive and demand soared. Most industrial plants shifted away from generating their own power and opted to purchase electricity from their local utilities. By 1950, the electric utility industry was serving virtually all electricity demand, except for a few industries that generated small amounts for their own use. Electricity was inexpensive, capacity growth appeared to be limitless, and electric utilities were strictly regulated to protect the consumers.

By the late 1970's changing economic conditions and legislation made nonutility generation attractive again for many industrial facilities and power project developers. During the 1970's, the electric utility industry changed from one characterized by decreasing marginal costs to one of increasing costs. Inflation, the energy crises, environmental concerns, and the rising costs of nuclear power led to increased electricity rates and reduced growth in capacity. The oil-price shocks in the 1970's led to a dramatic rise in energy prices, while high interest rates and stricter Federal air quality regulations increased the cost of building

power plants. These factors led to a re-examination of alternatives such as nonutility electric power.

Nonutility power producing facilities seeking to establish interconnected operations with electric utilities faced three major obstacles. First, utilities were seldom willing either to purchase the electric power output of nonutility producers or pay a fair rate for that output. Second, some utilities charged high rates for backup services to nonutility power producers. Third, facilities that provided electricity to a utility connected to the grid risked being considered a public utility and subject to extensive State and Federal regulation.

Congress acted to relieve a nationwide energy crisis by enacting the National Energy Act of 1978, which encompassed the Public Utility Regulatory Policies Act (PURPA) and four other laws: the National Energy Conservation Policy Act, the Powerplant and Industrial Fuel Use Act, the Natural Gas Policy Act, and the Energy Tax Act. PURPA provided for increased conservation of energy and increased efficiency in the use of facilities and resources by electric utilities. It called for State regulatory authorities to encourage conservation and energy efficiency and to provide for equitable rates. Some of the provisions of PURPA were designed to encourage the development of cogeneration and small power production by loosening the economic, regulatory, and institutional barriers that discouraged cogeneration and the use of renewable energy resources.

PURPA makes a distinction between facilities that qualify for benefits, referred to as qualifying facilities (QF's), and other generating facilities. QF's include cogenerators and small power producers. Cogeneration is an energy efficient technology, while small power production is defined in PURPA as a technology that primarily uses renewable energy sources. Other generating facilities include industrial and commercial generators and independent power producers without a designated franchised service area. The Federal Energy Regulatory Commission (FERC) is responsible for the implementation of PURPA and has established rules to encourage the development of cogenerators and small power production facilities. In addition, each State regulatory authority is required to implement such rules for each electric utility under its rate-making authority. The rules for the FERC program that define QF's are published in the *Code of Federal Regulations*, Title 18, Part 292.

Under FERC rules, cogeneration and small power production facilities may be designated as QF's if they

meet specific ownership,¹⁸ operating, and efficiency criteria. A facility may file an information report, known as a "self qualifying notice," with the FERC if it meets the requirements of FERC published rules, or it may apply to the FERC for certification as a QF under PURPA. QF's are guaranteed that electric utilities will purchase their output at the utilities' avoided cost, which is the incremental cost that an electric utility would incur to produce or purchase an amount of power equivalent to that purchased from QF's. Additionally, QF's are guaranteed that electric utilities will provide back up service at prevailing (non discriminatory) rates.

PURPA became a catalyst for competition in the electricity supply industry because it opened generation markets to facilities that met certain ownership, operating, and efficiency criteria, established by the FERC. Utilities initially did not welcome this competition, but some utilities soon discovered that buying generation from a QF has certain advantages over adding to their own capacity, especially because of the increasing uncertainty of recovering capital costs.

Nonutilities are not subject to 'rate base' as the basis of the price setting process and, therefore, the economic regulation regarding recovery of the investments of nonutilities is generally established on a different basis from that of a regulated public utility that is subject to 'avoided cost' based pricing, pricing that is a direct result of negotiations between the parties, 'market-based' pricing and others. As a result of this exception, a shorter lead time exists for the types of contracts signed by the nonutilities with their contractors (turnkey and other incentive based construction contracts). This type of contract had not been the historical practice of the utility industry, but under current conditions, clearly utilities and nonutilities alike will avail themselves of whatever provisions will allow the shortest lead time and lowest cost. The utility and nonutility are both looking at the need for and timing of new capacity in very similar ways. The NERC Reliability Assessment 1996-2005 states that in the later years of the ten-year assessment period, a number of Regions and subregions are no longer reporting generation capacity additions needed to satisfy regional criteria, although they do recognize such needs. However, it does signal an increased reliance on short lead-time resources that allow commitments to be delayed until required and reflects a shift toward a market-driven supply where customers choose the quantity and level of supply appropriate for their purposes.

The growth of nonutilities was further advanced by the Energy Policy Act of 1992 (EPACT). EPACT expanded the nonutility markets by creating a new category of power producers called exempt wholesale generators (EWG), which are exempt from the corporate and geographic restrictions imposed by the Public Utility Holding Company Act of 1935 (PUCHA).¹⁹ EWG's are defined as businesses that own and/or

operate a facility exclusively for the generation of electric energy for sale at wholesale. Exempting EWG's from PUHCA regulation removed obstacles to wholesale power competition by allowing utilities and nonutilities to form EWG's without triggering the restrictions of PUHCA. EWG's differ from QF's in several ways. They are not required to meet PURPA's cogeneration or renewable fuels limitations, utilities are not required to purchase their power, and they may charge market-based rates.

While the passage of PURPA opened generation markets to nonutility power producers of electricity, EPACT expanded the wholesale generation markets by opening access to the transmission system. In 1996, the FERC issued rules for implementing open access to the transmission network. Marketing of EWG wholesale power is being facilitated by transmission provisions that gave FERC the authority to order utilities to provide access to their transmission systems at nondiscriminatory rates.

With increasing competition in the electric power industry, PURPA is under review for repeal or modification. Several bills were introduced in Congress in 1996 and 1997 that would either repeal or amend PURPA. Proponents of repeal or reform contend that its QF power purchase mandate is anticompetitive and costly, and its environmental and fuel diversification goals will be maintained by the workings of a free market. Opponents of PURPA's repeal maintain the mandate is a necessary check against utility monopoly power.

Nonutility Classifications

Cogeneration. The major technology used in nonutility generation is known as cogeneration. Cogeneration is the combined production of electric power and another form of useful energy (such as heat or steam) through the use of one energy source. The process can begin either with heat or steam production or with electricity generation. The unused energy from the first process is used as input to the second process. The primary energy source is generally a fossil fuel (coal, petroleum, or natural gas), although renewables are also used, particularly wood and waste. To receive QF status under PURPA from FERC, a cogenerating facility must meet the operating criteria by producing electric energy and "another form of useful thermal energy through the sequential use of energy." In addition, depending on the technology of the cogeneration facility, it must meet specific efficiency criteria.

Cogeneration uses a number of technologies to produce electric power and another form of useful energy. The technology selected depends on the requirement for processed steam. Cogenerating tech-

¹⁸ FERC rules require that QF's be less than 50 percent owned by electric utilities.

¹⁹ PUHCA was designed to discourage holding companies from structuring their operations in ways that would prevent effective State regulation.

nologies are classified as "topping-cycle" and "bottoming-cycle" systems, depending on whether electrical or thermal energy is produced first. In a typical topping-cycle system (Figure 14), the energy input to the system is first transformed into electricity by using high-temperature, high-pressure steam from a boiler to drive a turbine to generate electricity. The waste heat, or the lower pressure steam exhausting from the turbine, is used as a source of processed heat. Topping-cycle systems are the most common and are used in commercial, rural, and industrial applications. The two configurations in Figure 14 represent most topping-cycle facilities.

In a bottoming-cycle system (Figure 15), high-temperature thermal energy is produced first for applications such as reheat furnaces, glass kilns, or aluminum metal furnaces. Heat is extracted from the hot exhaust stream and transferred (through one or more mediums) to drive a turbine. Bottoming-cycle systems are generally used by industrial processes that require very high temperature heat, thus making it economical to recover the waste heat.

Fossil-fueled steam turbine systems are used in most industrial cogenerating processes, while gas-turbine systems are used in most processes. Gas-turbine systems use combustion gases to drive a turbine to produce electricity and recover heat from the exhaust gases for waste-heat boilers. Compared with gas turbine systems, diesel engine systems are limited in application since they provide less useable processed heat per unit of electric power output. In a diesel system, the engine is cooled with water. The heated water is then used for processed steam, heat, or hot water applications. Exhaust gases can be used in a similar manner. Diesel systems are attractive to small cogenerating applications that need an instantaneous supply of electricity where the electric power requirement is generally greater than the heat requirement. With diesel systems, unlike some technologies, boiler warmup time is not necessary.

Small Power Production. To be designated as a small power producer under the 1978 PURPA regulations, a facility was limited to a capacity no greater than 80 megawatts and had to generate electricity using renewable energy as a primary source. In 1990, for specific energy sources (biomass (waste), solar, geothermal, and wind), the size restriction to qualify as a small power producer was removed. Fossil fuels can be used, but 75 percent or more of total energy consumption must be derived from renewable resources. The aggregate of fossil fuel usage cannot exceed 25 percent of total energy input during any calendar year. Reliance on these technologies can reduce the need to consume fossil fuels to generate electric power.

Renewable energy includes solar, wind, biomass, geothermal, and water (hydraulic). Solar thermal technology converts solar energy through high concentration and heat absorption into electricity or process energy and is mainly used in the Pacific Contiguous Census Division. Wind generators produce mechanical energy directly through shaft power. Windmills rotating parallel or perpendicular to the ground are the

most common harnesses used in wind technology and are mainly concentrated in the Pacific Contiguous and West South Central Census Divisions. Biomass energy is derived from a variety of sources. The biomass resource base potentially includes hundreds of plant species, various agricultural and industrial residues and processing wastes, municipal solid waste and sewage, and animal wastes. Industrial wood and wood waste is the form of biomass energy most commonly used by nonutilities. When economic to do so, the industries that produce paper, wood, and agricultural products are increasing their use of biomass to improve efficiency of their operations and to contribute to their on-site energy requirements. These industries are indigenous to the South Atlantic and Pacific Contiguous Census Divisions. Geothermal technologies convert heat naturally present in the earth into energy and electricity by tapping into high- and low-temperature fluids and by extracting steam. Hydropower is derived by converting the potential energy of water to electrical energy using a hydraulic turbine connected to a generator. Hydropower and geothermal technologies are mainly concentrated in the Pacific Contiguous Census Division.

Other Nonutility Generators. In addition to facilities that are classified as qualifying cogenerators and small power producers, other nonutility companies produce electric power for their own use and for sale to electric utilities. They include independent power producers (IPP's), nonqualifying cogenerators, and other commercial and industrial establishments. These nonutility companies are built mainly to supply and sell power to electric utilities. They do not qualify under PURPA because of the ownership, operating, or efficiency criteria established by FERC. IPP's are defined by FERC as producers of electric power other than QF's that are unaffiliated with franchised utilities in the IPP's market area and that for other reasons lack significant market power. IPP's may lack market power due to restrictions imposed by their site or transmission access.

Nonutility Operations

Business Classification. The nonutility power producing industry operates in various sectors of the U.S. economy and is classified according to the *Standard Industrial Classification (SIC) Manual* of the Office of Management and Budget. In 1997, the SIC Manual name was changed to North American Industry Classification System (NAICS). The main classifications are:

- Agriculture, Forestry, and Fishing
- Mining
- Construction
- Manufacturing
- Transportation and Public Utilities
- Wholesale and Retail Trade
- Finance, Insurance, and Real Estate
- Services

Public Administration Other.

A list of the categories of primary business activity within each classification is contained in Appendix A.

The nonutility power producing industry includes business entities that transform materials or substances into new products using mechanical or chemical processes. In some processes, the energy is transformed into steam for generating both electricity and another useful thermal output. This thermal output can be used directly in a manufacturing process such as paper production and indirectly for heating buildings or by other end users. The manufacturing sector uses the most energy (i.e. is the most energy intensive) because it creates new products using mechanical or chemical processes. It is therefore more cost-effective to produce one's own energy in this sector than in sectors that only require energy for space conditioning and lighting, such as the nonmanufacturing sectors.

Energy Sources. Most nonutility power producers use fossil fuels in their production processes. Many of them are able to switch from one fossil fuel to another when fuel supply is interrupted or when there is a price advantage in switching to another fuel. For example, they may switch from gas to oil in winter when their gas supplies are diverted to residential use, or from oil to coal when oil prices rise. Other nonutility power producers use various renewable energy sources. Increasingly, many facilities are able to switch from fossil fuels to renewable fuels. Many nonutility power producers use combustors that are able to burn two or more different fuels simultaneously, in varying combinations, to generate the desired heat output. Other nonutility power producers can only burn one fuel at a time, but their combustors can be converted to burn different fuels. Finally, many producers have multiple combustors that use different fuels to supply heat or power. Thus, the adaptability of nonutility power producers to using multiple fuel sources depends primarily on the type of generating equipment available and economic conditions. A nonutility power producer with many options for fuel choice has an economic advantage over a producer tied to only one fuel source.

Data Sources

Summary statistics on nonutility capacity, generation, sales, consumption, and emissions in the United States are provided in the following tables. Data for 1997 are preliminary; data for prior years are final. These data were obtained from the Form EIA-867, "Annual Nonutility Power Producer Report." The Form EIA-867 is a mandatory survey of all existing

and planned nonutility electric generating facilities in the United States with a total generator nameplate capacity of 1 or more megawatts. In 1992, the reporting threshold of the Form EIA-867 was lowered from 5 megawatts to 1 megawatt to include all facilities with a combined nameplate capacity of 1 or more megawatts. Previously, data were collected from facilities with a nameplate capacity between 1 and 5 megawatts every 3 years. Planned generators are defined as a proposal by a company to install electric generating equipment at an existing or planned facility. The proposal is based on the owner having obtained (1) all environmental and regulatory approvals, (2) a signed contract for the electric energy, or (3) financial closure of the facility. Nonutilities generally install small, turn-key packaged generating facilities with minimal regulatory requirements which result in considerably less lead time to finance and build, as compared to traditional electric utility facilities. Data on planned nonutility capacity additions as of December 31, 1997, are presented by energy source in Figure 9. These data represent all nonutility planned generating facilities that meet one or more of the criteria defined earlier.


Some nonutility power producers of 1 or more megawatts use only fossil fuels; some use only renewable energy; and some use a combination of both fossil fuels and renewable energy sources. Although the majority of nonutility power producers generate electric power using fossil energy, those using renewable energy represent a large portion of capacity. Because of the consumption of multiple energy sources by some generating units, capacity and generation were allocated by energy source. The algorithms used to allocate installed capacity and generation by energy source are discussed in the Technical Notes (Appendix A).

The other energy sources in Tables 51, 53, 54, 57, and 58 include hydrogen, sulfur, batteries, chemicals, and purchased steam.

The number of facilities shown for 1997 includes operational facilities in 1996 and new facilities or planned facilities that became operational during that year.

The total capacity for 1993 through 1997 (Table 51) includes all operable generating units including units not normally used but on standby with little or no generation, and units out of service for the entire reporting year that are expected to be returned to service in the future. Units on standby, test, maintenance/repairs, out of service, and indefinite shutdown represented 11 percent of the total nonutility generating capacity in 1997.


Figure 14. Two Topping-Cycle Plant Configurations

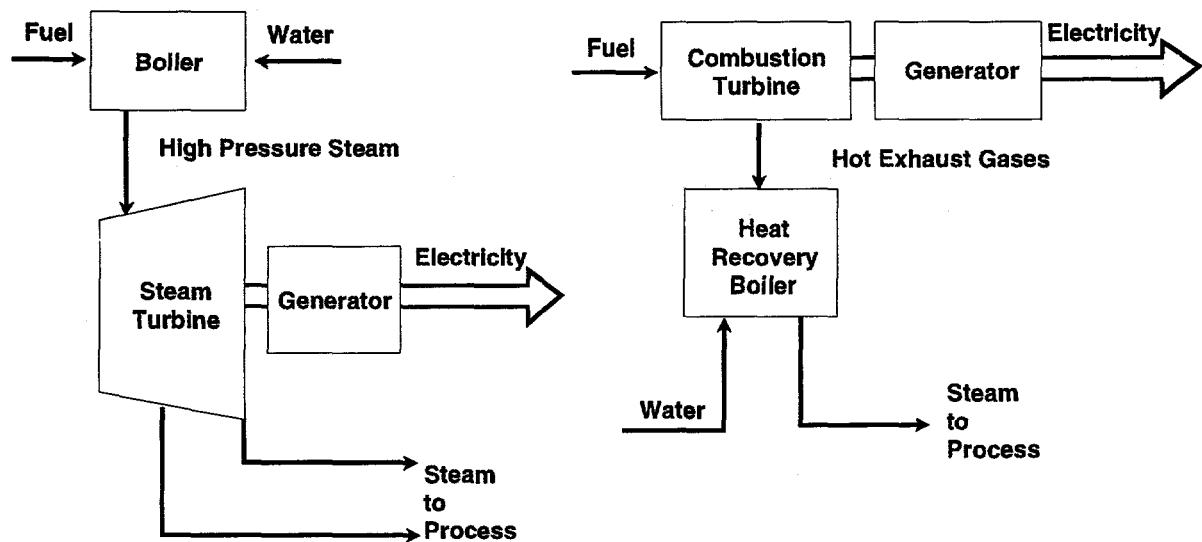

1. A boiler produces steam to power a turbine-generator to produce electricity. The turbine steam leaving the turbine is used in thermal applications such as space heating or food preparation.
2. A combustion turbine or diesel engine burns fuel to spin a shaft connected to a generator to produce electricity. Waste heat from the burning fuel is recaptured in a waste-heat recovery boiler and is used for direct heating or is used to produce steam for thermal applications.

Source: Federal Energy Regulatory Commission, *Cogeneration*, 1985

Figure 15. Bottoming-Cycle Plant Configuration

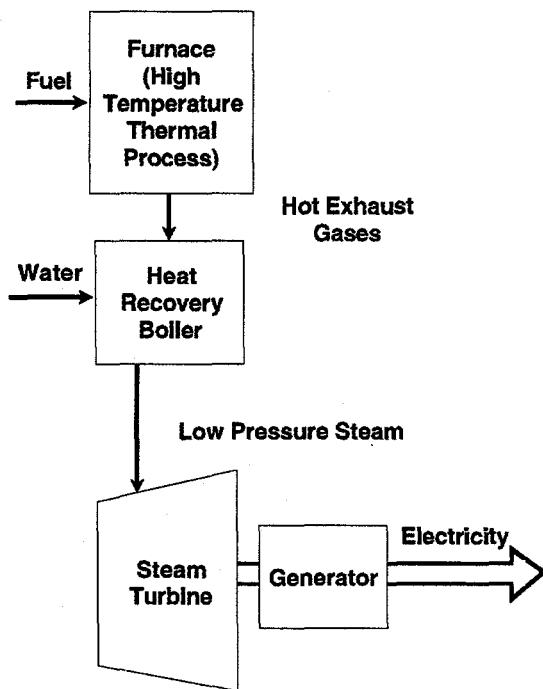

A furnace is used in a smelting or forming process. A waste-heat recovery boiler recaptures the unused energy and uses it to produce steam to drive a steam turbine generator to produce electricity.

Source: Federal Energy Regulatory Commission, *Cogeneration*, 1985.

Table 51. Summary Statistics for U.S. Nonutility Power Producers, 1993 Through 1997

Item	1993	1994	1995	1996	1997
Installed Capacity (megawatts)	60,778	68,461	70,254	73,189	74,021
Coal ¹	9,772	10,372	10,877	11,370	11,236
Petroleum ²	2,043	2,262	2,116	2,251	2,994
Natural Gas ³	23,463	26,925	27,906	30,166	30,476
Other Gas ⁴	—	1,130	1,217	327	273
Petroleum/Natural Gas (Combined)	8,505	9,820	10,479	10,912	9,767
Hydroelectric	2,741	3,364	3,399	3,419	3,776
Geothermal	1,318	1,335	1,295	1,346	1,303
Solar	360	354	354	354	354
Wind	1,813	1,737	1,723	1,670	1,607
Wood ⁵	7,046	7,416	6,885	7,263	7,181
Waste ⁶	3,131	3,150	3,430	3,463	3,715
Nuclear ⁷	20	—	—	—	—
Other ⁸	566	597	574	648	1,340
Gross Generation (million kilowatthours)	325,226	354,925	375,901	382,423	384,707
Coal	53,367	59,035	60,234	61,375	58,923
Petroleum ²	13,364	15,069	15,049	14,959	15,620
Natural Gas ⁴	174,282	179,735	196,633	198,555	206,411
Other Gas ³	—	12,480	13,984	14,750	13,342
Hydroelectric	11,511	13,227	14,774	16,555	17,905
Geothermal	9,749	10,122	9,912	10,198	9,110
Solar	897	824	824	903	893
Wind	3,052	3,482	3,185	3,400	3,385
Wood ⁵	37,421	38,595	37,283	37,525	35,218
Waste ⁶	18,325	18,797	20,231	20,412	20,669
Nuclear ⁷	78	54	—	—	—
Other ⁸	3,181	3,507	3,792	3,793	3,232
Consumption	48,343	52,261	50,328	53,199	51,781
Petroleum (Thousand barrels) ⁹	40,142	46,630	39,219	42,928	38,979
Natural Gas (Million cubic feet)	2,013,788	2,149,246	2,303,944	2,447,720	2,247,613
Other Gas (Million cubic feet) ⁴	1,681,916	1,591,051	1,611,993	1,737,271	1,372,001
Supply and Disposition (million kilowatthours)					
Gross Generation	325,226	354,925	375,901	382,423	384,707
Receipts ¹⁰	85,323	94,166	89,919	103,219	89,045
Sales to Utilities ¹¹	187,466	204,688	217,906	224,646	223,467
Sales to Other End Users ¹²	15,569	17,626	15,548	14,284	17,935
Facility Use	207,514	226,777	232,367	246,713	232,327

¹ Includes coal, anthracite culm, bituminous gob, coke breeze, fine coal, tar coal, lignite waste, and waste coal.

² Includes petroleum, petroleum coke, liquid butane, diesel, light oil, kerosene, methanol, oil waste, sludge oil, tar oil and liquid propane.

³ Includes natural gas, waste heat and waste gas.

⁴ Includes butane, methane, propane, other gas and digester gas.

⁵ Includes black liquor, pitch, peat, railroad ties, sludge wood, wood/wood waste, spent sulfite liquor and red liquor.

⁶ Includes agricultural byproducts, fish oil, liquid acetonitrile waste, landfill gas, municipal solid waste, sludge waste, straw, tires, waste alcohol, solid byproducts, and tall oil.

⁷ Nuclear reactor and generator at Argonne National Laboratory used primarily for research and development in testing reactor fuels as well as for training. The generation from the unit is used for internal consumption.

⁸ Includes batteries, chemicals, hydrogen, sulfur, purchased steam.

⁹ Does not include petroleum coke consumption of 4,484 thousand short tons for 1996 and 4,315 thousand short tons in 1997.

¹⁰ Includes purchases, interchanges, and exchanges of electric energy with utilities and other nonutilities.

¹¹ Includes sales, interchanges, and exchanges of electric energy with utilities.

¹² Includes sales, interchanges, and exchanges of electric energy with other nonutilities. The disparity in this data and data reported on other EIA surveys occurs due to differences in the respondent universe. The Form EIA-867 is filed by nonutilities reporting the energy delivered, while other data sources are filed by electric utilities reporting energy received. Differences in terminology and accounting procedures attribute to the disparity. In addition, since the frame for the Form EIA-867 is derived from utility surveys the Form EIA-867 universe lags 1 year.

NA = Not available.

Notes: *All data are for 1 megawatt and greater. •Data for 1997 are preliminary; data for prior years are final; •Totals may not equal sum of components because of independent rounding. •Percent change is calculated before rounding. •See the Technical Notes for the methodology for allocating capacity and generation by energy sources, respectively.

Source: Energy Information Administration, (EIA) Form EIA-867, "Annual Nonutility Power Producer Report."

Table 52. Installed Capacity at U.S. Nonutility Generating Facilities by Fossil Fuels, Renewable Energy Sources, and Census Division, 1993 Through 1997
 (Megawatts)

Census Division	Fossil Fuels ¹	Renewables/ Other/ Nuclear ²	Both Fossil Fuels and Renewables/ Other/ Nuclear
1993			
New England	2,369	1,479	882
Middle Atlantic.....	7,107	1,089	535
East North Central.....	4,079	421	1,046
West North Central.....	972	143	146
South Atlantic	6,357	1,358	2,587
East South Central.....	444	253	1,037
West South Central.....	10,673	255	2,142
Mountain.....	1,042	635	344
Pacific	7,420	5,205	760
U.S. Total.....	40,463	10,836	9,478
1994			
New England	2,532	1,486	877
Middle Atlantic.....	9,956	1,215	581
East North Central.....	4,476	341	1,130
West North Central.....	959	178	159
South Atlantic	7,778	1,799	2,806
East South Central.....	426	245	1,418
West South Central.....	11,339	255	2,170
Mountain.....	1,819	610	253
Pacific	7,700	5,092	861
U.S. Total.....	46,986	11,221	10,254
1995			
New England	2,619	1,426	992
Middle Atlantic.....	10,617	1,269	591
East North Central.....	4,243	503	1,171
West North Central.....	918	185	130
South Atlantic	8,202	2,095	2,698
East South Central.....	437	234	1,418
West South Central.....	11,413	261	2,217
Mountain.....	1,890	614	253
Pacific	8,014	5,014	831
U.S. Total.....	48,354	11,601	10,299
1996			
New England	2,773	1,233	1,196
Middle Atlantic.....	11,096	859	1,032
East North Central.....	4,396	391	1,287
West North Central.....	912	194	149
South Atlantic	8,831	1,785	3,046
East South Central.....	438	234	1,495
West South Central.....	11,919	285	2,230
Mountain.....	1,962	604	316
Pacific	8,578	4,821	1,128
U.S. Total.....	50,905	10,406	11,879
1997			
New England	2,852	1,433	1,007
Middle Atlantic.....	11,067	1,400	564
East North Central.....	4,220	822	1,103
West North Central.....	1,154	214	241
South Atlantic	8,546	2,042	2,917
East South Central.....	474	341	1,333
West South Central.....	10,280	556	4,053
Mountain.....	1,919	637	305
Pacific	8,663	4,852	1,027
U.S. Total.....	49,173	12,298	12,550

¹ Includes petroleum, natural gas, digester gas, coke breeze, fine coal and/or coal as energy sources.

² Includes hydroelectric, geothermal, solar, wind, wood, wood/wood waste, peat, wood liquors, railroad ties, pitch, municipal solid waste, other waste, agricultural waste, straw, tires, landfill gases, fish oils, tall oil, sludge, other (sulfur, hydrogen, batteries, chemicals,) and/ or nuclear as energy sources.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final. *See Technical Notes for a description of allocating capacity. *Total may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form ELA-867, "Annual Nonutility Power Producer Report."

Table 53. Installed Capacity at U.S. Nonutility Generating Facilities by Energy Source and Census Division, 1993 Through 1997 (Megawatts)

Census Division	Coal ¹	Natural Gas ²	Petroleum ³ only / and Natural Gas ⁴	Hydroelectric/ Geothermal/ Solar / Wind	Wood ⁵ Waste ⁶	Other ⁷ Nuclear	Total
1993							
New England	363	587	1,780	587	1,412	—	4,729
Middle Atlantic	2,049	1,860	3,494	W	856	W	8,730
East North Central	1,733	2,523	525	W	646	W	5,546
West North Central	758	118	157	73	156	—	1,261
South Atlantic	2,770	1,664	2,332	209	2,953	375	10,303
East South Central	289	222	W	—	1,099	W	1,734
West South Central	828	9,915	1,022	W	1,089	W	13,069
Mountain	233	808	W	548	166	W	2,020
Pacific	749	5,768	W	4,099	1,801	W	13,385
U.S. Total	9,772	23,463	10,548	6,232	10,177	585	60,778
1994							
New England	353	1,028	1,512	586	1,416	—	4,895
Middle Atlantic	2,302	4,533	W	441	888	W	11,752
East North Central	2,057	2,544	572	115	658	—	5,947
West North Central	729	122	182	95	168	—	1,296
South Atlantic	2,771	2,033	3,436	568	3,197	379	12,384
East South Central	323	224	W	W	1,265	W	2,088
West South Central	828	10,652	943	W	1,125	W	13,764
Mountain	238	1,289	W	551	157	W	2,682
Pacific	771	5,630	W	4,069	1,692	W	13,654
U.S. Total	10,372	28,055	12,081	6,790	10,566	597	68,461
1995							
New England	353	1,118	1,579	584	1,404	—	5,037
Middle Atlantic	2,590	4,713	W	485	913	W	12,477
East North Central	W	3,044	577	103	690	W	5,917
West North Central	782	53	127	95	176	—	1,232
South Atlantic	3,536	1,746	3,755	568	3,010	379	12,995
East South Central	312	225	W	W	1,254	W	2,088
West South Central	W	10,808	887	W	1,145	W	13,891
Mountain	W	1,294	447	560	153	W	2,757
Pacific	W	6,122	1,387	4,012	1,571	W	13,860
U.S. Total	10,877	29,122	12,595	6,771	10,316	574	70,254
1996							
New England	441	925	W	589	1,436	W	5,202
Middle Atlantic	2,554	4,947	4,083	485	919	—	12,987
East North Central	1,792	W	583	105	730	W	6,074
West North Central	741	63	172	103	175	—	1,255
South Atlantic	3,694	2,255	3,549	568	3,257	340	13,662
East South Central	324	197	W	W	1,328	W	2,167
West South Central	839	W	1,011	W	1,117	81	14,433
Mountain	239	W	513	560	150	W	2,881
Pacific	748	6,715	1,379	3,978	1,614	93	14,527
U.S. Total	11,370	30,493	13,163	6,788	10,726	648	73,189
1997							
New England	441	958	1,796	599	1,384	114	5,292
Middle Atlantic	2,583	4,915	3,940	526	993	74	13,031
East North Central	1,692	W	485	W	805	231	6,144
West North Central	W	W	381	111	213	W	1,609
South Atlantic	3,682	2,342	3,219	709	3,196	357	13,504
East South Central	274	228	131	W	1,251	W	2,147
West South Central	829	10,855	1,228	372	1,395	210	14,889
Mountain	W	W	487	534	144	83	2,861
Pacific	741	7,114	1,094	3,880	1,515	199	14,543
U.S. Total	11,236	30,748	12,760	7,040	10,897	1,340	74,021

¹ Includes coal, anthracite culm, bituminous gob, coke breeze, fine coal, tar coal, lignite waste, and waste coal.

² Includes natural gas, waste heat, butane, methane, propane, other gas, waste gas, and digester gas.

³ Includes petroleum, petroleum coke, liquid butane, diesel, light oil, kerosene, methanol, oil waste, sludge oil, tar oil and liquid propane.

⁴ Includes petroleum used as a single energy source, and petroleum and natural gas used as a fuel combination by themselves and with other fuels.

⁵ Includes black liquor, pitch, peat, railroad ties, sludge wood, wood/wood waste, spent sulfite liquor, and red liquor.

⁶ Includes agricultural byproducts, fish oil, landfill gas, municipal solid waste, sludge waste, straw, tires, waste alcohol, solid byproducts, and tall oil.

⁷ Includes batteries, chemicals, hydrogen, sulfur, purchased steam and other.

Notes: *All data are for 1 megawatt and greater. •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •W = Withheld to avoid disclosure of individual company data.

**Table 54. Installed Capacity at U.S. Nonutility Generating Facilities by Energy Source and State, 1997
(Megawatts)**

State	Coal ¹	Natural Gas ²	Petroleum ³ only / and Natural Gas ⁴	Hydroelectric/Geothermal/Solar / Wind	Wood ⁵ Waste ⁶	Other ⁷ Nuclear	Total
Alabama	W	115	W	W	806	W	1,099
Alaska	W	155	60	—	W	W	313
Arizona	W	W	34	—	—	W	172
Arkansas	—	65	W	W	352	—	421
California	449	5,870	317	3,584	928	154	11,303
Colorado	W	657	W	32	—	W	768
Connecticut	W	W	209	21	260	—	724
Delaware	W	—	W	—	—	W	W
Florida	W	1,097	511	W	1,227	279	3,989
Georgia	276	186	834	12	575	12	1,894
Hawaii	W	W	W	81	178	—	816
Idaho	W	W	—	256	W	W	447
Illinois	421	314	69	24	126	15	970
Indiana	202	339	199	—	18	120	878
Iowa	255	W	74	W	W	—	344
Kansas	—	10	42	W	—	W	55
Kentucky	—	—	—	—	—	W	W
Louisiana	—	W	259	W	767	56	3,745
Maine	W	W	W	361	679	36	1,431
Maryland	W	W	W	—	138	—	674
Massachusetts	W	866	W	71	261	22	2,123
Michigan	560	W	110	29	456	W	3,340
Minnesota	371	W	248	104	198	W	1,046
Mississippi	—	78	W	—	W	—	408
Missouri	101	—	W	—	—	W	114
Montana	W	—	W	W	W	—	129
Nebraska	W	W	—	—	—	—	13
Nevada	—	W	W	230	—	—	845
New Hampshire	—	—	23	91	W	W	315
New Jersey	W	1,230	1,660	18	181	W	3,605
New Mexico	—	154	W	—	—	W	259
New York	392	3,163	1,893	420	441	61	6,369
North Carolina	W	W	213	369	298	62	1,920
North Dakota	W	—	W	—	W	—	37
Ohio	W	43	W	—	31	9	344
Oklahoma	W	296	—	—	W	—	840
Oregon	W	W	W	107	163	33	1,008
Pennsylvania	W	522	387	88	371	W	3,057
Rhode Island	—	W	W	W	W	W	622
South Carolina	W	W	W	19	375	—	430
Tennessee	269	W	W	W	113	W	637
Texas	W	W	966	117	197	154	9,882
Utah	W	W	W	W	—	W	136
Vermont	—	—	—	W	W	—	76
Virginia	W	682	1,235	30	584	W	3,826
Washington	—	349	W	108	207	W	1,103
West Virginia	344	W	W	W	—	—	595
Wisconsin	304	W	51	52	174	W	612
Wyoming	W	W	W	W	—	W	104
U.S. Total	11,236	30,748	12,760	7,040	10,897	1,340	74,021

¹ Includes coal, anthracite culm, bituminous gob, coke breeze, fine coal, tar coal, lignite waste, and waste coal.

² Includes natural gas, waste heat, butane, methane, propane, other gas, waste gas, and digester gas.

³ Includes petroleum, petroleum coke, liquid butane, diesel, light oil, kerosene, methanol, oil waste, sludge oil, tar oil and liquid propane.

⁴ Includes petroleum used as a single energy source, and petroleum and natural gas used as a fuel combination by themselves and with other fuels.

⁵ Includes black liquor, pitch, peat, railroad ties, sludge wood, wood/wood waste, spent sulfite liquor, and red liquor.

⁶ Includes agricultural byproducts, fish oil, landfill gas, municipal solid waste, sludge waste, straw, tires, waste alcohol, solid byproducts, and tall oil.

⁷ Includes batteries, chemicals, hydrogen, sulfur, purchased steam and other.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary. *Totals may not equal sum of components because of independent rounding. *W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 55. Installed Capacity at U.S. Nonutility Generating Facilities by Qualifying Facility Status and Census Division, 1993 Through 1997 (Megawatts)

Census Division	QF Capacity		Non-QF Capacity		Total Capacity	
	No. of Facilities	Capacity (megawatts)	No. of Facilities	Capacity (megawatts)	No. of Facilities	Capacity (megawatts)
1993						
New England	116	3,404	73	1,325	189	4,729
Middle Atlantic.....	230	8,351	44	379	274	8,730
East North Central.....	98	3,403	101	2,143	199	5,546
West North Central.....	25	512	49	749	74	1,261
South Atlantic.....	139	7,011	97	3,291	236	10,303
East South Central.....	24	881	30	853	54	1,734
West South Central.....	107	11,159	60	1,910	167	13,069
Mountain.....	81	1,446	38	574	119	2,020
Pacific	412	11,606	142	1,779	554	13,385
U.S. Total.....	1,232	47,774	634	13,004	1,866	60,778
1994						
New England	117	3,420	75	1,475	192	4,895
Middle Atlantic.....	248	11,350	48	402	296	11,752
East North Central.....	101	3,448	118	2,498	219	5,947
West North Central.....	26	535	51	760	77	1,296
South Atlantic.....	151	8,300	129	4,083	280	12,384
East South Central.....	24	930	35	1,159	59	2,088
West South Central.....	107	11,846	61	1,917	168	13,764
Mountain.....	85	1,905	38	776	123	2,682
Pacific	408	11,826	146	1,828	554	13,654
U.S. Total.....	1,267	53,562	701	14,900	1,968	68,461
1995						
New England	119	3,478	73	1,560	192	5,037
Middle Atlantic.....	258	12,087	48	390	306	12,477
East North Central.....	112	3,712	110	2,205	222	5,917
West North Central.....	28	575	52	658	80	1,232
South Atlantic.....	160	9,066	125	3,929	285	12,995
East South Central.....	28	1,143	31	945	59	2,088
West South Central.....	109	12,165	58	1,726	167	13,891
Mountain.....	85	1,980	38	777	123	2,757
Pacific	400	11,940	139	1,920	539	13,860
U.S. Total.....	1,299	56,145	674	14,109	1,973	70,254
1996						
New England	119	3,625	76	1,577	195	5,202
Middle Atlantic.....	259	12,604	45	383	304	12,987
East North Central.....	113	3,758	116	2,316	229	6,074
West North Central.....	28	576	54	679	82	1,255
South Atlantic.....	165	9,728	123	3,934	288	13,662
East South Central.....	27	1,214	32	954	59	2,167
West South Central.....	111	12,696	62	1,737	173	14,433
Mountain.....	90	2,102	40	779	130	2,881
Pacific	401	12,042	134	2,485	535	14,527
U.S. Total.....	1,313	58,345	682	14,844	1,995	73,189
1997						
New England	119	3,704	79	1,588	198	5,292
Middle Atlantic.....	258	12,650	44	381	302	13,031
East North Central.....	121	3,911	113	2,233	234	6,144
West North Central.....	28	930	56	680	84	1,609
South Atlantic.....	164	9,588	122	3,917	286	13,504
East South Central.....	28	1,216	31	932	59	2,147
West South Central.....	111	13,050	66	1,838	177	14,889
Mountain.....	87	2,080	39	782	126	2,861
Pacific	388	12,052	129	2,491	517	14,543
U.S. Total.....	1,304	59,179	679	14,841	1,983	74,021

QF = Nonutility generating facilities that have obtained status as qualifying facilities under the Public Utility Regulatory Policies Act of 1978. (qualifying cogen, qualifying small power producers, qualifying cogen, small power producers exempt wholesale generator).

Non-QF = Cogenerator and other nonutility generator.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final. *The number of facilities shown includes operational, new, and planned facilities. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 56. Installed Capacity at U.S. Nonutility Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997 (Megawatts)

Census Division	Manufacturing	Transportation and Public Utilities	Services	Mining	Public Administration	Other Industry Groups	Total
1993							
New England	2,248	2,363	W	—	W	—	4,729
Middle Atlantic.....	5,807	1,989	511	W	W	225	8,730
East North Central.....	4,851	301	271	W	W	W	5,546
West North Central	702	184	165	W	W	W	1,261
South Atlantic.....	6,925	R 2,905	158	W	W	R 278	10,303
East South Central.....	1,676	18	W	W	W	—	1,734
West South Central	12,245	442	203	180	—	—	13,069
Mountain.....	772	566	158	245	—	278	2,020
Pacific	4,678	R 5,532	324	2,439	239	173	13,385
U.S. Total.....	39,904	R 14,300	1,908	3,246	406	R 1,014	60,778
1994							
New England	2,267	2,499	W	—	—	W	4,895
Middle Atlantic.....	8,509	2,168	546	W	W	225	11,752
East North Central.....	5,129	373	287	W	W	90	5,947
West North Central	706	R 207	166	W	W	W	1,296
South Atlantic.....	8,180	R 3,875	176	W	W	R 79	12,384
East South Central.....	2,029	18	W	27	W	—	2,088
West South Central	12,940	442	202	180	—	—	13,764
Mountain.....	833	779	139	245	—	686	2,682
Pacific	5,086	R 5,307	433	2,438	239	151	13,654
U.S. Total.....	45,678	R 15,668	2,070	3,252	542	R 1,252	68,461
1995							
New England	2,281	2,602	W	—	—	W	5,037
Middle Atlantic.....	9,202	2,074	553	W	W	225	12,477
East North Central.....	5,086	356	353	W	W	W	5,917
West North Central	755	R 98	164	W	W	W	1,232
South Atlantic.....	8,842	R 3,691	169	W	W	R 218	12,995
East South Central.....	2,027	W	W	27	W	—	2,088
West South Central	13,297	W	202	177	—	W	13,891
Mountain.....	865	823	132	245	—	692	2,757
Pacific	5,250	R 5,258	436	2,498	242	176	13,860
U.S. Total.....	47,606	R 15,124	2,165	3,428	544	R 1,388	70,254
1996							
New England	W	2,391	154	—	—	W	5,202
Middle Atlantic.....	W	2,400	562	W	221	225	12,987
East North Central.....	5,172	459	358	W	W	W	6,074
West North Central	762	112	168	W	—	W	1,255
South Atlantic.....	W	3,763	165	W	64	461	13,662
East South Central.....	2,104	22	W	26	W	—	2,167
West South Central	13,409	743	197	72	W	W	14,433
Mountain.....	W	913	W	242	—	667	2,881
Pacific	5,930	5,247	436	2,498	241	176	14,527
U.S. Total.....	49,529	16,050	2,181	3,313	542	1,575	73,189
1997							
New England	W	2,437	148	—	—	W	5,292
Middle Atlantic.....	W	2,586	571	W	221	225	13,031
East North Central.....	5,160	550	347	W	W	W	6,144
West North Central	1,103	125	168	W	—	W	1,609
South Atlantic.....	W	3,932	171	W	139	407	13,504
East South Central.....	2,025	76	W	26	W	—	2,147
West South Central	13,886	726	197	67	W	W	14,889
Mountain.....	W	904	W	239	—	667	2,861
Pacific	5,922	5,287	433	2,498	242	161	14,543
U.S. Total.....	49,780	16,622	2,181	3,305	619	1,513	74,021

R = Revised data.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final. *See Technical Notes for Standard Industrial Classifications for these industry groups. *Totals may not equal sum of components because of independent rounding. *W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 57. Gross Generation for U.S. Nonutility Power Producers by Energy Source and Census Division, 1993 Through 1997 (Million Kilowatthours)

Census Division	Coal ¹	Petroleum ²	Natural Gas ³	Hydroelectric	Geothermal/Solar/Wind	Wood ⁴ Waste ⁵	Other ⁶ Nuclear	Total
1993								
New England.....	2,417	1,764	12,460	2,526	—	9,062	—	28,229
Middle Atlantic.....	10,950	W	28,381	1,724	—	5,714	W	48,705
East North Central.....	7,138	627	14,274	W	—	3,602	W	26,211
West North Central.....	2,852	63	687	336	—	737	—	4,675
South Atlantic.....	15,466	2,774	7,886	963	—	14,821	1,710	43,620
East South Central.....	2,289	W	2,170	—	—	6,019	W	10,741
West South Central.....	5,798	3,239	63,077	W	—	5,804	W	80,073
Mountain.....	1,317	112	4,638	948	1,588	767	201	9,572
Pacific.....	5,140	2,905	40,708	W	12,110	9,220	W	73,400
U.S. Total	53,367	13,364	174,282	11,511	13,698	55,746	3,259	325,226
1994								
New England.....	2,575	1,937	13,917	2,709	—	8,787	—	29,925
Middle Atlantic.....	12,169	2,213	34,178	1,877	—	5,824	197	56,457
East North Central.....	8,652	717	15,139	533	—	3,952	—	28,993
West North Central.....	3,111	W	726	339	W	789	—	5,077
South Atlantic.....	17,122	3,369	11,348	2,983	—	15,328	2,002	52,152
East South Central.....	2,325	174	2,246	W	—	6,874	W	12,786
West South Central.....	6,227	W	64,768	W	—	5,882	W	81,989
Mountain.....	1,567	115	6,131	837	W	768	W	11,273
Pacific.....	5,285	3,114	43,762	1,918	12,752	9,188	252	76,271
U.S. Total	59,035	15,069	192,214	13,227	14,428	57,392	3,560	354,925
1995								
New England.....	2,404	1,860	13,425	2,561	—	9,099	—	29,350
Middle Atlantic.....	14,799	1,781	45,187	1,584	—	6,227	189	69,768
East North Central.....	6,795	646	16,187	W	—	4,247	W	28,436
West North Central.....	2,680	W	707	303	W	908	—	4,702
South Atlantic.....	18,948	2,736	15,535	2,799	—	15,622	1,985	57,624
East South Central.....	2,378	125	2,175	W	—	7,033	W	12,708
West South Central.....	6,314	W	67,102	W	—	5,880	1,122	84,635
Mountain.....	1,511	179	6,828	1,171	W	745	W	12,263
Pacific.....	4,404	W	43,471	4,070	12,205	7,754	W	76,415
U.S. Total	60,234	15,049	210,617	14,774	13,921	57,514	3,792	375,901
1996								
New England.....	2,289	1,779	W	3,235	—	9,036	W	29,862
Middle Atlantic.....	15,569	1,425	W	2,337	—	6,414	W	68,860
East North Central.....	6,972	812	18,113	525	—	4,630	79	31,130
West North Central.....	2,503	W	564	382	W	812	W	4,362
South Atlantic.....	19,429	3,034	15,319	3,042	—	15,959	1,703	58,485
East South Central.....	2,418	194	2,571	W	—	7,031	W	13,249
West South Central.....	6,026	3,409	66,115	W	W	5,783	1,598	83,994
Mountain.....	1,461	W	W	1,280	1,663	668	187	13,480
Pacific.....	4,708	3,784	46,290	3,878	12,703	7,605	33	79,001
U.S. Total	61,375	14,959	213,304	16,555	14,500	57,937	3,793	382,423
1997								
New England.....	2,560	1,582	W	2,978	—	8,804	W	30,029
Middle Atlantic.....	14,439	1,528	W	2,167	—	6,251	W	68,644
East North Central.....	6,931	737	18,152	528	—	5,191	98	31,637
West North Central.....	3,001	W	476	W	W	838	W	4,843
South Atlantic.....	17,750	3,756	12,362	3,567	—	15,489	1,673	54,598
East South Central.....	2,268	167	3,011	W	—	5,879	W	12,659
West South Central.....	6,150	3,572	W	2,109	W	5,626	732	91,348
Mountain.....	1,475	W	W	1,267	1,576	622	255	13,729
Pacific.....	4,349	3,706	46,249	3,715	11,676	7,187	338	77,220
U.S. Total	58,923	15,620	219,753	17,905	13,388	55,887	3,232	384,707

¹ Includes coal, anthracite culm, bituminous gob, coke breeze, fine coal, tar coal, lignite waste and waste coal.

² Includes petroleum, petroleum coke, liquid butane, diesel, light oil, kerosene, methanol, oil waste, sludge oil, tar oil and liquid propane.

³ Includes natural gas, waste heat, butane, methane, propane, other gas, waste gas, and digester gas.

⁴ Includes black liquor, pitch, peat, railroad ties, sludge wood, wood/wood waste, spent sulfite liquor, and red liquor.

⁵ Includes agricultural byproducts, fish oil, landfill gas, municipal solid waste, sludge waste, straw, tires, waste alcohol, solid byproducts, and tall oil.

⁶ Includes batteries, chemicals, hydrogen, sulfur, purchased steam.

Notes: •All data are for 1 megawatt and greater. •Data for 1997 are preliminary; data for prior years are final. •Totals may not equal sum of components because of independent rounding. •Percent change is calculated before rounding. •W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 58. Gross Generation for U.S. Nonutility Power Producers by Energy Source and State, 1997
(Million Kilowatthours)

State	Coal ¹	Petroleum ²	Natural Gas ³	Hydroelectric	Geothermal/ Solar/Wind	Wood ⁴ Waste ⁵	Other ⁶ Nuclear	Total
Alabama.....	333	115	1,945	W	—	W	—	6,211
Alaska.....	W	121	752	—	—	W	W	1,143
Arizona.....	W	4	W	—	—	W	—	803
Arkansas.....	W	7	1,006	W	—	1,464	W	2,540
California.....	2,401	1,968	39,469	2,640	11,407	5,263	337	63,484
Colorado.....	W	W	2,959	137	—	W	—	3,395
Connecticut.....	W	78	1,124	66	—	W	—	4,717
Delaware.....	W	W	W	—	—	—	—	687
Florida.....	5,153	564	W	W	—	5,681	1,412	21,098
Georgia.....	673	682	1,667	36	—	W	W	6,021
Hawaii.....	W	1,251	W	98	W	624	—	4,288
Idaho.....	W	W	317	1,038	—	W	W	2,069
Illinois.....	W	5	1,563	88	—	1,033	W	4,369
Indiana.....	1,184	W	W	—	—	127	—	4,779
Iowa.....	1,043	9	60	W	—	W	W	W
Kansas.....	—	W	68	W	—	—	—	87
Kentucky.....	—	—	—	—	—	W	—	W
Louisiana.....	W	W	15,881	W	—	3,005	335	22,606
Maine.....	W	1,109	27	1,906	—	3,509	W	7,354
Maryland.....	W	86	W	—	—	777	—	2,231
Massachusetts.....	W	170	8,671	348	—	2,223	W	11,460
Michigan.....	2,303	168	W	141	—	2,599	W	17,832
Minnesota.....	W	79	217	339	W	759	—	3,031
Mississippi.....	W	W	857	—	—	1,789	—	2,705
Missouri.....	257	14	W	—	—	W	—	312
Montana.....	W	W	W	W	—	W	—	816
Nebraska.....	W	—	W	—	—	—	—	63
Nevada.....	—	W	2,667	W	1,576	—	W	4,269
New Hampshire.....	—	159	W	469	—	W	—	1,672
New Jersey.....	W	331	14,747	W	—	1,218	W	17,391
New Mexico.....	—	W	W	—	—	—	—	915
New York.....	2,437	654	26,538	1,647	—	2,572	—	33,847
North Carolina.....	W	268	370	1,785	—	1,758	W	8,591
North Dakota.....	W	W	W	—	—	W	—	156
Ohio.....	543	24	548	—	—	622	—	1,736
Oklahoma.....	W	W	1,410	—	—	W	—	4,783
Oregon.....	W	W	W	429	—	613	—	3,446
Pennsylvania.....	10,952	543	2,973	475	—	2,461	—	17,405
Rhode Island.....	—	65	4,257	W	—	W	—	4,440
South Carolina.....	595	187	W	57	—	W	—	2,646
Tennessee.....	1,887	W	209	W	—	499	W	3,734
Texas.....	W	1,747	54,783	W	W	918	391	61,419
Utah.....	W	W	W	W	—	—	—	785
Vermont.....	—	W	—	181	—	W	—	386
Virginia.....	4,589	1,541	1,019	129	—	2,643	—	9,921
Washington.....	W	W	3,282	549	—	638	—	4,859
West Virginia.....	2,259	W	355	W	—	—	W	3,403
Wisconsin.....	W	254	258	300	—	810	W	2,920
Wyoming.....	W	W	393	—	—	—	W	677
U.S. Total.....	58,923	15,620	219,753	17,905	13,388	55,887	3,232	384,707

¹ Includes coal, anthracite culm, bituminous gob, coke breeze, fine coal, tar coal, lignite waste and waste coal.

² Includes petroleum, petroleum coke, liquid butane, diesel, light oil, kerosene, methanol, oil waste, sludge oil, tar oil and liquid propane.

³ Includes natural gas, waste heat, butane, methane, propane, other gas, waste gas, and digester gas.

⁴ Includes black liquor, pitch, peat, railroad ties, sludge wood, wood/wood waste, spent sulfite liquor, and red liquor.

⁵ Includes agricultural byproducts, fish oil, landfill gas, municipal solid waste, sludge waste, straw, tires, waste alcohol, solid byproducts, and tall oil.

⁶ Includes batteries, chemicals, hydrogen, sulfur, purchased steam.

Notes: •All data are for 1 megawatt and greater. •Data for 1997 are preliminary. •Totals may not equal sum of components because of independent rounding. •Percent change is calculated before rounding. •W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 59. Gross Generation at U.S. Nonutility Generating Facilities by Qualifying Facility Status and Census Division, 1993 Through 1997 (Million Kilowatthours)

Census Division	QF Generation		Non-QF Generation		Total Generation	
	No. of Facilities ¹	Generation (million kilowatthours)	No. of Facilities ¹	Generation (million kilowatthours)	No. of Facilities ¹	Generation (million kilowatthours)
1993						
New England	114	20,936	72	7,293	186	28,229
Middle Atlantic.....	227	46,602	43	2,102	270	48,705
East North Central.....	94	17,238	96	8,973	190	26,211
West North Central.....	24	2,257	48	2,418	72	4,675
South Atlantic.....	137	32,132	95	11,488	232	43,620
East South Central.....	23	5,383	28	5,358	51	10,741
West South Central.....	105	68,884	57	11,190	162	80,073
Mountain.....	76	7,391	35	2,181	111	9,572
Pacific	409	66,820	146	6,580	555	73,400
U.S. Total.....	1,209	267,641	620	57,584	1,829	325,226
1994						
New England	115	21,832	73	8,093	188	29,925
Middle Atlantic.....	244	54,274	47	2,183	291	56,457
East North Central.....	96	17,961	111	11,033	207	28,993
West North Central.....	25	2,480	50	2,597	75	5,077
South Atlantic.....	149	39,312	121	12,840	270	52,152
East South Central.....	23	5,702	34	7,085	57	12,786
West South Central.....	106	70,773	57	11,217	163	81,989
Mountain.....	85	9,089	37	2,183	122	11,273
Pacific	400	70,659	146	5,612	546	76,271
U.S. Total.....	1,243	292,082	676	62,843	1,919	354,925
1995						
New England	115	21,681	72	7,669	187	29,350
Middle Atlantic.....	252	67,661	47	2,107	299	69,768
East North Central.....	107	19,255	105	9,182	212	28,436
West North Central.....	28	2,377	52	2,325	80	4,702
South Atlantic.....	158	44,277	120	13,348	278	57,624
East South Central.....	28	7,567	31	5,142	59	12,708
West South Central.....	107	74,579	57	10,056	164	84,635
Mountain.....	84	10,024	37	2,239	121	12,263
Pacific	391	69,168	136	7,247	527	76,415
U.S. Total.....	1,270	316,587	657	59,314	1,927	375,901
1996						
New England	112	21,489	75	8,372	187	29,862
Middle Atlantic.....	255	66,782	44	2,078	299	68,860
East North Central.....	108	21,747	110	9,383	218	31,130
West North Central.....	25	2,196	54	2,166	79	4,362
South Atlantic.....	159	46,234	119	12,252	278	58,485
East South Central.....	26	7,727	32	5,522	58	13,249
West South Central.....	110	74,126	60	9,868	170	83,994
Mountain.....	87	11,007	39	2,473	126	13,480
Pacific	383	69,801	132	9,200	515	79,001
U.S. Total.....	1,265	321,109	665	61,314	1,930	382,423
1997						
New England	114	21,730	78	8,299	192	30,029
Middle Atlantic.....	248	66,742	44	1,901	292	68,644
East North Central.....	109	21,991	107	9,646	216	31,637
West North Central.....	26	2,277	56	2,566	82	4,843
South Atlantic.....	156	43,218	113	11,379	269	54,598
East South Central.....	27	7,720	32	4,940	59	12,659
West South Central.....	109	81,737	64	9,612	173	91,348
Mountain.....	82	11,109	37	2,620	119	13,729
Pacific	376	67,694	128	9,526	504	77,220
U.S. Total.....	1,247	324,217	659	60,490	1,906	384,707

¹ The number of facilities with no generation that were not retired were 37 in 1993, 49 in 1994, 46 in 1995, 65 in 1996, and 72 in 1997.

QF = Nonutility generating facilities that have obtained status as qualifying facilities under the Public Utility Regulatory Policies Act of 1978. (qualifying cogen, qualifying small power producer, exempt wholesale generator).

Non-QF = Cogenerator and other nonutility generator.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final. *The number of facilities shown includes operational, new, and planned facilities. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 60. Gross Generation of U.S. Nonutility Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997
(Million Kilowatthours)

Census Division	Manufacturing	Transportation and Public Utilities	Services	Mining	Public Administration	Other Industry Groups	Total
1993							
New England.....	12,644	15,120	466	—	—	—	28,229
Middle Atlantic.....	31,368	11,669	2,809	W	W	1,273	48,705
East North Central.....	23,015	1,698	987	W	W	W	26,211
West North Central.....	2,983	341	W	W	W	W	4,675
South Atlantic.....	33,179	8,461	657	W	W	1,184	43,620
East South Central.....	10,531	72	W	W	W	—	10,741
West South Central.....	76,103	2,232	611	1,127	—	—	80,073
Mountain.....	4,622	2,899	975	W	—	W	9,572
Pacific.....	26,889	25,056	2,038	17,228	1,530	659	73,400
U.S. Total	221,334	67,549	8,970	20,877	2,671	3,826	325,226
1994							
New England.....	13,641	15,743	W	—	—	W	29,925
Middle Atlantic.....	37,382	12,009	3,385	W	1,452	W	56,457
East North Central.....	24,909	2,415	1,067	W	W	254	28,993
West North Central.....	3,150	R 422	421	W	W	W	5,077
South Atlantic.....	41,152	10,142	635	W	W	W	52,152
East South Central.....	12,478	81	W	148	W	—	12,786
West South Central.....	78,974	2,013	539	464	—	—	81,989
Mountain.....	5,096	3,173	954	563	—	1,486	11,273
Pacific.....	31,053	22,971	2,406	17,757	1,523	561	76,271
U.S. Total	247,836	R 68,969	9,900	21,024	3,172	R 4,024	354,925
1995							
New England.....	13,334	15,422	W	—	—	W	29,350
Middle Atlantic.....	51,375	10,749	3,668	W	968	W	69,768
East North Central.....	24,716	1,994	1,345	W	W	W	28,436
West North Central.....	3,025	W	403	W	W	W	4,702
South Atlantic.....	45,772	10,998	657	W	W	169	57,624
East South Central.....	12,448	70	W	125	W	—	12,708
West South Central.....	82,434	W	614	492	—	W	84,635
Mountain.....	4,976	3,603	890	482	—	2,311	12,263
Pacific.....	30,630	23,352	2,606	17,730	1,528	569	76,415
U.S. Total	268,711	R 67,682	10,775	21,277	2,617	R 4,839	375,901
1996							
New England.....	W	13,987	640	—	—	W	29,862
Middle Atlantic.....	W	12,347	3,819	W	1,033	1,621	68,860
East North Central.....	27,124	2,506	1,381	W	W	W	31,130
West North Central.....	2,829	548	W	W	—	W	4,362
South Atlantic.....	W	10,678	722	W	19	1,066	58,485
East South Central.....	12,983	69	W	118	W	—	13,249
West South Central.....	80,776	2,190	566	385	W	W	83,994
Mountain.....	5,347	3,921	863	550	—	2,800	13,480
Pacific.....	32,691	23,586	2,639	18,060	1,535	489	79,001
U.S. Total	271,528	69,831	11,059	21,214	2,659	6,133	382,423
1997							
New England.....	W	13,873	461	—	—	W	30,029
Middle Atlantic.....	W	13,781	3,882	W	951	1,510	68,644
East North Central.....	27,664	2,489	1,401	—	W	W	31,637
West North Central.....	2,894	587	W	W	—	W	4,843
South Atlantic.....	42,170	9,940	748	W	W	1,358	54,598
East South Central.....	12,130	306	W	114	W	—	12,659
West South Central.....	86,534	3,801	538	396	W	W	91,348
Mountain.....	5,483	3,886	865	503	—	2,991	13,729
Pacific.....	31,925	22,912	2,571	17,749	1,584	480	77,220
U.S. Total	271,479	71,574	10,961	21,191	2,984	6,519	384,707

R = Revised Data.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final. *See Technical Notes for Standard Industrial Classifications for these industry groups. *Totals may not equal sum of components because of independent rounding. *W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 61. U.S. Nonutility Electricity Supply and Disposition for Facilities by Census Division and State, 1996 and 1997
(Million Kilowatthours)

Census Division and State	Gross Generation		Receipts ¹		Sales ²		Facility Use	
	1996	1997	1996	1997	1996	1997	1996	1997
New England.....	29,862	30,029	3,984	3,599	24,134	24,050	9,712	9,578
Connecticut.....	4,688	4,717	291	273	3,958	3,845	1,021	1,146
Maine.....	7,604	7,354	2,662	2,262	4,393	4,122	5,873	5,495
Massachusetts.....	10,673	11,460	735	782	9,641	10,220	1,766	2,023
New Hampshire.....	1,697	1,672	191	197	1,283	1,265	605	604
Rhode Island.....	W	4,440	93	W	4,522	4,273	380	244
Vermont.....	391	386	W	W	337	325	W	W
Middle Atlantic.....	68,860	68,644	5,517	4,902	58,520	58,481	15,857	15,064
New Jersey.....	18,541	17,391	901	794	16,492	15,509	2,950	2,677
New York.....	32,486	33,847	1,471	1,333	29,106	30,368	4,850	4,813
Pennsylvania.....	17,833	17,405	3,145	2,775	12,922	12,605	8,056	7,575
East North Central.....	31,130	31,637	18,359	18,542	14,863	14,940	34,627	35,239
Illinois.....	4,028	4,369	5,482	5,804	415	615	9,095	9,558
Indiana.....	4,561	4,779	5,149	4,782	109	132	9,600	9,429
Michigan.....	18,031	17,832	1,760	1,831	14,025	13,918	5,767	5,745
Ohio.....	1,609	1,736	3,023	3,119	75	66	4,556	4,789
Wisconsin.....	2,902	2,920	2,945	3,006	239	208	5,608	5,718
West North Central.....	4,362	4,843	6,013	5,496	938	1,745	9,437	8,594
Iowa.....	1,131	1,193	1,493	1,564	217	219	2,407	2,538
Kansas.....	73	87	1,147	W	W	W	1,209	1,105
Minnesota.....	2,660	3,031	2,967	2,477	683	1,483	4,944	4,025
Missouri.....	306	312	288	268	W	W	568	553
Nebraska.....	W	63	W	58	—	—	W	121
North Dakota.....	163	156	73	98	W	W	235	251
South Atlantic.....	58,485	54,598	24,210	17,320	34,133	31,890	48,562	40,028
Delaware.....	778	W	373	W	W	W	1,036	W
Florida.....	23,011	21,098	1,845	1,917	14,928	14,008	9,928	9,007
Georgia.....	5,924	6,021	11,432	3,628	143	1,017	17,213	8,631
Maryland.....	W	2,231	W	147	1,329	1,601	2,654	777
North Carolina.....	9,986	8,591	3,274	5,379	7,366	6,017	5,894	7,953
South Carolina.....	2,414	2,646	510	687	381	365	2,542	2,968
Virginia.....	11,001	9,921	3,001	3,197	8,538	7,468	5,464	5,650
West Virginia.....	3,403	3,403	1,760	1,970	1,333	1,354	3,830	4,019
East South Central.....	13,249	12,659	8,250	8,462	2,101	2,026	19,398	19,073
Alabama.....	6,885	6,211	3,280	3,309	936	938	9,228	8,559
Kentucky.....	W	W	—	—	W	W	W	W
Mississippi.....	W	2,705	1,860	1,936	W	54	4,423	4,587
Tennessee.....	3,645	3,734	3,111	3,217	1,017	1,032	5,738	5,919
West South Central.....	83,994	91,348	25,355	18,708	29,856	35,190	79,493	74,867
Arkansas.....	W	2,540	740	730	W	46	3,198	3,224
Louisiana.....	20,209	22,606	7,923	8,413	3,385	3,828	24,747	27,191
Oklahoma.....	4,674	4,783	1,048	1,050	3,291	3,400	2,432	2,434
Texas.....	56,609	61,419	15,643	8,515	23,136	27,916	49,116	42,018
Mountain.....	13,480	13,729	3,946	4,351	10,768	10,868	6,658	7,212
Arizona.....	W	W	222	263	W	W	641	681
Colorado.....	3,276	3,395	152	185	3,109	3,098	319	481
Idaho.....	W	2,069	1,087	W	1,781	1,892	1,204	1,253
Montana.....	836	816	W	W	668	658	W	W
Nevada.....	4,387	4,269	W	W	4,027	3,961	362	309
New Mexico.....	841	915	1,359	1,519	W	W	1,801	1,944
Utah.....	764	W	W	W	W	W	967	1,061
Wyoming.....	663	677	140	241	W	W	797	915
Pacific.....	79,001	77,220	7,586	7,664	63,616	62,212	22,970	22,673
Alaska.....	1,201	1,143	125	119	21	14	1,305	1,248
California.....	63,935	63,484	3,279	2,972	52,588	52,008	14,626	14,448
Hawaii.....	4,410	4,288	65	31	3,680	3,708	795	611
Oregon.....	3,239	3,446	842	850	2,514	2,985	1,567	1,312
Washington.....	6,216	4,859	3,275	3,692	4,813	3,497	4,678	5,054
U.S. Total.....	382,423	384,707	103,219	89,045	238,929	241,401	246,713	232,327

¹ Includes purchases, interchanges, and exchanges of electric energy with utilities and other nonutilities.

² Includes sales, interchanges, and exchanges of electric energy with utilities and other nonutilities. The disparity in this data and data reported on other EIA surveys occurs due to differences in the respondent universe. The Form EIA-867 is filed by nonutilities reporting the energy delivered, while other data sources are filed by electric utilities reporting energy received. Differences in terminology and accounting procedures attribute to the disparity. In addition, since the frame for the Form EIA-867 is derived from utility surveys, the Form EIA-867 universe lags one year.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior year are final. *Totals may not equal sum of components because of independent rounding. •W = Withheld to avoid disclosure of individual company data.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table 62. Estimated Emissions from U.S. Nonutility Power Producer Facilities by Census Division, 1993 Through 1997
 (Thousand Short Tons)


Census Division	Sulfur Dioxide	Nitrogen Oxides	Carbon Dioxide ¹
1993			
New England.....	45	49	33,616
Middle Atlantic.....	127	168	56,669
East North Central.....	205	307	92,877
West North Central.....	83	42	14,235
South Atlantic.....	374	250	118,221
East South Central.....	130	75	45,715
West South Central.....	227	250	102,544
Mountain.....	20	33	10,318
Pacific Contiguous.....	44	111	55,062
Pacific Noncontiguous.....	12	15	6,742
U.S. Total	1,267	1,300	535,999
1994			
New England.....	48	48	33,809
Middle Atlantic.....	124	172	59,731
East North Central.....	291	325	101,517
West North Central.....	68	45	14,790
South Atlantic.....	404	273	130,675
East South Central.....	138	78	51,625
West South Central.....	263	233	100,721
Mountain.....	22	37	12,015
Pacific Contiguous.....	52	109	55,089
Pacific Noncontiguous.....	14	15	7,309
U.S. Total	1,424	1,335	567,281
1995			
New England.....	45	65	40,427
Middle Atlantic.....	118	206	61,567
East North Central.....	227	295	89,212
West North Central.....	77	45	16,020
South Atlantic.....	380	299	135,217
East South Central.....	94	68	43,405
West South Central.....	194	242	93,766
Mountain.....	26	61	17,514
Pacific Contiguous.....	44	140	51,453
Pacific Noncontiguous.....	12	19	7,743
U.S. Total	1,217	1,440	556,324
1996			
New England.....	53	61	35,195
Middle Atlantic.....	135	215	63,102
East North Central.....	298	340	103,102
West North Central.....	77	44	14,046
South Atlantic.....	422	291	140,507
East South Central.....	127	86	49,267
West South Central.....	289	269	107,129
Mountain.....	23	62	17,815
Pacific Contiguous.....	82	151	55,681
Pacific Noncontiguous.....	15	19	7,377
U.S. Total	1,521	1,538	593,221
1997			
New England.....	52	64	35,442
Middle Atlantic.....	156	197	59,271
East North Central.....	289	299	89,118
West North Central.....	80	48	15,197
South Atlantic.....	400	228	120,170
East South Central.....	120	57	40,675
West South Central.....	273	273	107,116
Mountain.....	23	57	17,408
Pacific Contiguous.....	97	137	51,516
Pacific Noncontiguous.....	13	19	6,702
U.S. Total	1,503	1,379	542,615

¹ As of 1993 data, emission factors for the calculation of carbon dioxide emissions and reductions from nitrogen oxide control technologies have been changed--historical estimates were revised to reflect that change--See Technical Notes for more information.

Notes: *All data are for 1 megawatt and greater. *Estimates for 1997 are preliminary; estimates for prior years are final. *Historical data have been revised to reflect a change in methodology--see Technical Notes for more information. *Totals may not equal sum of components because of independent rounding. *See Appendix A, "Technical Notes," for methodology.

Appendix A

Technical Notes



Appendix A

Technical Notes

Sources of Data

The *Electric Power Annual Volume II* is prepared by the Electric Power Division; Office of Coal, Nuclear, Electric and Alternate Fuels; Energy Information Administration (EIA); U.S. Department of Energy (DOE). Data published in the *Electric Power Annual Volume II* are compiled from six forms filed annually by electric utilities and one form filed annually by nonutility power producers. Those forms are: the Form EIA-861, "Annual Electric Utility Report"; the Federal Energy Regulatory Commission (FERC) Form 1, "Annual Report of Major Electric Utilities, Licensees, and Others"; the Form EIA-412, "Annual Report of Public Electric Utilities"; the Form EIA-767, "Steam-Electric Plant Operation and Design Report"; the Form EIA-867, "Annual Nonutility Power Producer Report"; the Department of Energy, Office of Emergency Planning Form EIA-411, "Coordinated Bulk Power Supply Program Report"; and the Department of Energy, Office of Fuels Programs, Fossil Energy Form FE-781R, "Annual Report of International Electric Export/Import Data." Each form is summarized below.

Form EIA-861

The Form EIA-861 is a mandatory census of electric utilities in the United States, its territories, and Puerto Rico. The Form EIA-861 data contained in this publication are for the United States only. The survey is used to collect information on power production and sales of electricity and demand-side management information from approximately 3,200 electric utilities. The data collected are used to update the electric utility frame data base maintained by the EIA. This data base supports queries from the Executive Branch, Congress, other public agencies, and the general public. Summary data from the Form EIA-861 are also contained in the *Electric Power Monthly*; the *Electric Sales and Revenue*; the *Financial Statistics of Major U.S. Investor-Owned Electric Utilities*; the *Financial Statistics of Major U.S. Publicly Owned Electric Utilities*; the *Annual Energy Outlook*; the *U.S. Electric Utility Demand-Side Management*; and the *Electric Trade in the United States*. These reports present aggregate totals for electric utilities on national, State, and regional levels by ownership type.

Demand-side management data collected on the Form EIA-861 are estimated by electric utilities based on engineering data or statistical analysis. The utilities also use a variety of verification methodologies for these estimates. The Energy Policy Act (EPACT) of 1992, Section 171(a), mandated that EIA verify DSM data estimates and the methodologies used for estimation and verification. In response to this mandate, EIA conducted a study of DSM estimation methodologies and DSM verification methodologies. The report describes typical estimation methodologies and DSM verification methodologies, as well as the difficulties in reaching broad conclusions concerning the quality of savings estimates reported to EIA. The report is featured in the EIA publication, *U.S. Electric Utility Demand-Side Management 1993*, released in July 1995.

Instrument and Design History. The Form EIA-861 was implemented in January 1985 to collect data as of year-end 1984. The Federal Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Data Processing. The Form EIA-861 is mailed to the respondents to collect data as of the end of the calendar year. The completed forms are to be returned to the EIA by April 30. The data are entered into the interactive on-line system. Internal edit checks are performed to verify that current data total across and between schedules and are comparable to data reported the previous year. Edit checks are also performed to compare data reported on the Form EIA-861 and similar data reported on the Forms EIA-826, "Monthly Electric Utility Sales and Revenue Report with State Distributions," the FERC Form 1, and the Form EIA-412. These are utility-level checks. Respondents are telephoned to obtain clarification of reported data and to obtain missing data.

FERC Form 1

The FERC Form 1 is a mandatory restricted-universe census of major investor-owned electric utilities in the United States having, in each of the last three consecutive years, sales or transmission service that exceeds one or more of the following: (1) 1 million megawatthours of total annual sales, (2) 100 megawatthours of annual sales for resale, (3) 500 megawatthours of annual power exchanges delivered, or (4) 500 megawatthours of annual wheeling for

others (deliveries plus losses). All major U.S. investor-owned electric utilities, licensees, or others subject to the Federal Power Act of 1935 must submit this form annually to the FERC. Classification of such entities is provided in the FERC Uniform System of Accounts Prescribed for Public Utilities and Licensees Subject to the Provisions of the Federal Power Act. Approximately 179 electric utilities are classified as major. Excluded from the summary data are the independent power producers and cooperatives jurisdictional to the FERC.

The FERC Form 1 is used to collect data on income and earnings, taxes, depreciation and amortization, distribution of salaries and wages, electric operating revenues, electric maintenance expenses, generating plant statistics, planned construction data, year-end balance sheets, and general corporate information. Respondents are required to report data on historical plant cost and power production expenses for their hydroelectric plants with a generator nameplate capacity of 10 or more megawatts; each steam-electric plant with a generator nameplate capacity of 25 or more megawatts; and each gas-turbine plant with a generator nameplate capacity of 10 or more megawatts. Less detailed data are required for other plants.

This data base supports queries from the Executive Branch, Congress, other public agencies, and the general public. Summary and detailed data from the FERC Form 1 are also contained in the *State Energy Data Report*; the *Financial Statistics of Major U.S. Investor-Owned Electric Utilities* (through 1996 only); the *State Energy Price and Expenditure Report*; the *Annual Energy Review*; and the *Electric Trade in the United States*. These reports present aggregate totals for electric utilities on a national level, by State, and by ownership type.

Instrument and Design History. The Federal Power Commission's (FPC) Form 1, the predecessor of the FERC Form 1, was implemented in 1935 by the FPC. When the FPC was merged with the DOE in October 1977, the processing of data on the survey became the responsibility of the EIA. In 1991, the collection responsibility reverted to the FERC. This mandatory survey is conducted in accordance with the FERC Uniform System of Accounts Prescribed for Private Utilities and Licensees.

Data Processing. The completed surveys, both hard copy and diskettes, are returned to the FERC on or before April 30, containing data for the preceding calendar year. A copy of each survey and diskette is forwarded to the EIA for processing. Manual editing of the reported data is completed prior to data entry. Additional edit checks of the data are performed through computer programs. The program edits include both deterministic checks, in which records are checked for the presence of data in required fields, and statistical checks, in which the data are checked against a range of values based on historical data values and for logical or mathematical consistency with data elements reported in the survey. Discrepancies found in the data, as a result of these checks, are resolved either by the processing office or by further information obtained from a telephone call to the

respondent company. Effective for 1997, FERC Form 1 data is as accepted as of August 1, 1998, from the FERC World Wide Web site (<http://www.ferc.fed.us>).

Form EIA-412

The Form EIA-412 is a restricted-universe census used annually to collect accounting, financial, and operating data from major publicly owned electric utilities in the United States. Those publicly owned electric utilities engaged in the generation, transmission, or distribution of electricity which had 120,000 megawatthours of sales to ultimate consumers and/or 120,000 megawatthours of sales for resale for the 2 previous years, as reported on the Form EIA-861, "Annual Electric Utility Report," must submit the Form EIA-412. The criteria used to select the respondents for this survey results in approximately 500 publicly owned electric utilities.

Federal electric utilities are required to file the Form EIA-412. The financial data for the U.S. Army Corps of Engineers (except for Saint Mary's Falls at Sault Ste. Marie, Michigan); the U.S. International Boundary and Water Commission; and the U.S. Department of Interior, Bureau of Reclamation were collected on the Form EIA-412 from the Federal power marketing administrations.

Instrument and Design History. The FPC created the FPC Form 1M in 1961 as a mandatory survey. It became the responsibility of the EIA in October 1977 when the FPC was merged with DOE. In 1979, the FPC Form 1M was superseded by the Economic Regulatory Administration (ERA) Form ERA-412, and in January 1980 by the Form EIA-412.

This data base supports queries from the Executive Branch, Congress, other public agencies, and the general public. Summary and detail data from the Form EIA-412 are also contained in the *Financial Statistics of Major U.S. Publicly Owned Electric Utilities*; the *State Energy Price and Expenditure Report*; the *Electric Trade in the United States*. These reports present aggregate totals for electric utilities on a national level, by State, and by ownership type.

Data Processing. The processing of data reported on this survey is the responsibility of the Coal and Electric Data and Renewables Division within the Office of Coal, Nuclear, Electric and Alternate Fuels. The completed surveys are due in this office on or before April 30. Nonresponse follow-up procedures are used to attain 100-percent response. Manual editing of the reported data is completed prior to data entry. Additional edit checks of the data are performed through computer programs. The program edits include both deterministic checks, in which records are checked for the presence of data in required fields, and statistical checks, in which the data are checked against a range of values based on historical data values and for logical or mathematical consistency with data elements reported in the survey. Discrepancies found in the data, as a result of these

checks, are resolved either by the processing office or by further information obtained from a telephone call to the respondent company.

Form EIA-767

The Form EIA-767 is a mandatory restricted-universe census of all electric power plants with a total existing or planned organic- or nuclear-fueled steam-electric generator nameplate rating of 10 or more megawatts. The entire form is filed by approximately 700 power plants with a nameplate capacity of 100 or more megawatts. An additional 200 power plants with a nameplate capacity between 10 and 100 megawatts submit information only on fuel consumption/quality, boiler/generator configuration, and flue-gas desulfurization equipment, if applicable. The Form EIA-767 is used to collect data annually on plant operations and equipment design (including boiler, generator, cooling system, flue gas desulfurization, flue gas particulate collectors, and stack data). Data from the Form EIA-767 are used for economic, regulatory, and environmental analyses conducted by the DOE and the Environmental Protection Agency.

This data base supports queries from the Executive Branch, Congress, other public agencies, and the general public. These reports present aggregate totals for electric utilities on a national level, by State, and by ownership type.

Instrument and Design History. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data. The predecessor form, FPC-67, "Steam-Electric Plant Air and Water Quality Control Data," was used to collect data from 1969 to 1980, when the form number was changed to Form EIA-767. In 1982, the form was completely redesigned and given the name Form EIA-767, "Steam-Electric Plant Operation and Design Report." In 1986, the respondent universe of 700 was increased to 900 to include plants with nameplate capacity from 10 megawatts to 100 megawatts. Respondents for these 200 additional plants complete only pages 1, 5, 6, and, if applicable, 13, and 14.

Data Processing. The Form EIA-767 is mailed to respondents in January to collect data as of the end of the preceding calendar year. The completed forms are to be returned to the EIA by May 1. Equipment design data for each respondent are preprinted from the applicable data base. Respondents are instructed to verify all preprinted data and to supply missing data. The data are manually reviewed before being keyed for automatic data processing. Computer programs containing additional edit checks are run. Respondents are telephoned to obtain correction or clarification of reported data and to obtain missing data, as a result of the manual and automatic editing process.

Form EIA-860

The Form EIA-860 is a mandatory census of electric utilities in the United States that operate power plants or plan to operate a power plant within 10 years of the reporting year. The survey is used to collect data on existing power plants from the electric utilities and their 10-year plans for constructing new plants, and modifying and retiring existing plants. Data on the survey are collected at the generating unit level. These data are then aggregated by energy source, geographic area, and prime mover. Final data from the Form EIA-860 are also summarized in the *Inventory of Power Plants in the United States*.

Instrument and Design History. The Form EIA-860 was implemented in January 1985 to collect data as of year-end 1984. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Data Processing. The Form EIA-860 is mailed to approximately 900 respondents in December of the reporting year and the completed forms are to be returned to the EIA by February 15 containing data as of January 1 of the following year. Effective with the 1996 reporting, respondents have the option of filing Form EIA-860 directly with the EIA or through an agent such as the respondent's regional electric reliability council. Data reported through the regional electric reliability councils are submitted to the EIA electronically from the North American Electric Reliability Council (NERC). Data for each respondent are preprinted from the applicable data base. Respondents are instructed to verify all preprinted data and to supply missing data. The data are manually edited before being keyed for automatic data processing. Computer programs containing additional edit checks are run. Respondents are telephoned to obtain correction or clarification of reported data and to obtain missing data, as a result of the manual and automatic editing process. After EIA approval, the data are made available for public use.

Form EIA-411

The Form EIA-411 is filed annually as a voluntary report. The information reported includes: (1) actual energy and peak demand for the preceding year and 10 additional years; (2) existing and future generating capacity; (3) scheduled capacity transfers; (4) projections of capacity, demand, purchases, sales, and scheduled maintenance; and (5) bulk power system maps. These data support queries from the executive branch, Congress, other public agencies, and the general public. These reports present various council aggregate totals for their member electric utilities, with some nonmember information included.

Instrument and Design History. The Form EIA-411 program was initiated under the Federal Power Commission Docket R-362, reliability and adequacy of electric service, and Orders 383-2, 383-3, and 383-4. The Department of Energy, established in October 1977, assumed the responsibility for this activity. This form is considered voluntary under the authority of the Federal Power Act (Public Law 88-280), The Federal Energy Administration Act of 1974 (Public Law 93-275), and the Department of Energy Organization Act (Public Law 95-91). The responsibility for collecting these data had been delegated to the Office of Emergency Planning and Operations within the Department of Energy and was returned to EIA for the reporting year 1996.

Data Processing. The Form EIA-411 is filed annually on June 1 by the ten North American Electric Reliability Councils. The forms are compiled from data furnished by electric utilities and nonutilities (members, associates, and for nonmembers) within the council areas.

Form FE-781R

The Form FE-781R, "Annual Report of International Electrical Export/Import Data" is used to collect on an annual basis, monthly information on the gross amounts of electrical energy received and delivered and the costs and revenue associated with these transactions. The use of the format contained in Form FE-781R is optional for reporting purposes; however, submission of the data is mandatory.

Instrument and Design History. The authority to issue presidential permits pursuant to Executive Order Number 10485 was transferred to the Secretary of Energy by Executive Order Number 12038 (43 FR 4957 February 7, 1987). This responsibility was delegated by the Secretary to the Economic Regulatory Administration (DOE Delegation Order Number 0204-04, October 1, 1977). The authority was redelegated (DOE Delegation Order Number 127) to the Office of Fuels Programs, Fossil Energy, (54 FR 11436 March 20, 1990). The survey universe is defined under Title 10 of the Code of Federal Regulations, Sections 205.308 and 205.325 to include all public utilities or other entities subject to the Department of Energy jurisdiction under Part II of the Federal Power Act engaged in the export of electric energy across the international borders of the United States with Canada and Mexico. It also includes those engaged in the transmission of electrical energy across these borders who hold a presidential permit.

Data Processing. The Form FE-781R is mailed to the respondents to collect annually, the monthly data for the preceding calendar year. The completed forms are to be returned to the DOE by February 15. The receipts are manually edited and the data used for the Presidential Permit Program are entered into a machine readable format.

Form EIA-867

The Form EIA-867 is a mandatory survey of all existing and planned nonutility electric generating facilities in the United States with a total generator nameplate capacity of 1 or more megawatts. In 1992, the reporting threshold of the Form EIA-867 was lowered to include all facilities with a combined nameplate capacity of 1 or more megawatts. Previously, data were collected every 3 years from facilities with a nameplate capacity between 1 and 5 megawatts. Planned generators are defined as a proposal by a company to install electric generating equipment at an existing or planned facility. The proposal is based on the owner having obtained (1) all environmental and regulatory approvals, (2) a contract for the electric energy, or (3) financial closure on the facility. The Form consists of Schedules I, "Identification and Certification"; Schedule II, "Facility Information"; Schedule III, "North American Industry Classification System"; Schedule IVA, "Facility Fuel Information"; Schedule IVB, "Facility Thermal and Generation Information"; Schedule V, "Facility Environmental Information"; and Schedule VI, "Electric Generator Information."

Submission of the Form EIA-867 is required from all facilities that have a combined facility nameplate capacity of 1 megawatt or more. Schedule V, "Facility Environmental Information" is only required of those facilities of 25 megawatts or more.

The form is used to collect data on the installed capacity, energy consumption, generation, and electric energy sales to electric utilities and other nonutilities by facility. Additionally, the form is used to collect data on the quality of fuels burned and the types of environmental equipment used by the respondent.

Instrument and Design History. The Form EIA-867 was implemented in December 1989 to collect data as of year-end 1989. The Federal Energy Administration Act of 1984 (Public Law 93-275) defines the legislative authority to collect these data.

Data Processing. The Form EIA-867 is mailed to the respondents in January to collect data as of the end of the preceding calendar year. Static data for each respondent are preprinted from the previous year, and the respondents are instructed to verify all preprinted information and to supply the missing data. The completed forms are to be returned to the EIA by April 30. The response rate for all facilities for which addresses were confirmed was 100 percent. The data are manually edited before being keyed for automated data processing. Computer programs containing additional edit checks are run. Respondents are telephoned to obtain corrections or clarifications of reported data and to obtain missing data as a result of the manual and automated editing.

Data Quality. The Manufacturing Energy Consumption Survey (MECS) produces detailed estimates of manufacturing electricity generation by industry and Census Division on a triennial basis. The data are published in the *Manufacturing Energy Consumption Survey, Consumption of Energy*. Gross generation by

nonutility power producers by major industry groups, and Census division, for 1993 through 1997 presented in this report, are reasonable given the growth in manufacturing on site generation.

Data for the Form EIA-867 are collected from all existing and planned nonutility generating facilities in the United States with a total generator nameplate capacity of 1 or more megawatts. These data are aggregated to provide geographic totals for selected States and at the Census division and national levels. Since the Form EIA-867 data are considered confidential, suppression of some data is necessary to protect the confidentiality of the individual respondent data. See "Confidentiality of the Data" in this section for further information on the nondisclosure of data.

Allocating Capacity. The installed capacity for nonutility generating units is allocated to one energy source using the following algorithms:

- For generating units using a single fossil energy source, the capacity is allocated totally to that energy source.
- For generating units that use hydraulic, geothermal, solar, biomass, or wind energy, the capacity is allocated to that energy source (even if a secondary fuel is burned).
- For generating units using a combination of fossil energy and renewable energy sources, capacity is classified as fossil or renewable based on the greatest percentage of Btu consumed when summed.
- To allocate capacity by fuel within the fossil energy and renewable energy sources, the single fuel within that energy source with the greatest percentage of Btu consumed is used.

Allocating Generation. The generation for nonutility facilities is allocated to one energy source using the following algorithms:

- For generating units that use energy sources that are not burned (hydraulic, geothermal, nuclear, solar, or wind energy), the generation is allocated to that energy source (even if a secondary fuel is burned).
- For facilities having generating units using energy sources that are burned, the generation is allocated based on the percentage of Btu consumed. This algorithm assumes that unit efficiency is the same for all energy sources.

Gross-to-Net Generation Conversion Methodology. Gross electricity generation data from the Form EIA-867, reported by generator, are aggregated to provide totals by energy source and geographic area. Nonutility power producers report gross electricity generated on the Form EIA-867, unlike electric utilities that report net generation on various

EIA and FERC forms. Nonutilities generally do not measure and record electrical consumption used solely for the production of electricity. Nonutility generators and associated auxiliary equipment are often an integral part of a manufacturing or other industrial process and individual watt-hour meters are not generally installed on auxiliary equipment.

Estimated values for net generation from nonutility power producers were developed by EIA using gross generation, prime mover, fuels, and type of air pollution control data reported on the Form EIA-867. The difference between gross and net generation is the electricity consumed by auxiliary equipment and environmental control devices such as pumps, fans, coal pulverizers, particulate collectors, and flue gas desulfurization (FGD) units. The difference between gross and net generation is sometimes called parasitic load. In smaller power plants rotating auxiliaries are almost always electric motors. In large power plants that produce steam, rotating auxiliaries can be powered by either steam turbines or electric motors and sometimes both because of cold startup requirements.

This methodology for estimating net generation from gross generation is based on determining typical energy consumption for auxiliary electrical equipment associated with electrical generators. For instance, wind turbines have none of the auxiliaries common to a coal-burning power plant such as a coal pulverizers, fans, and emission controls. On the other hand, windfarms do consume electricity since automatic, computer-based control systems are used to control blade pitch and speed thereby affecting generator electricity output.

Shown below are the conversion factors used to estimate net generation by nonutility generators. The factors are typical of a modern electric power plant but could vary significantly between individual plants. Net generation is calculated by multiplying the appropriate conversion factor by the reported gross electrical generation.

Prime Mover Type	Gross-to-Net Generation Conversion Factor
Gas (Combustion) Turbine	.98
Steam Turbine	.97 ^a
Internal Combustion	.98
Wind Turbine	.99
Solar-Photovoltaic	.99
Hydraulic Turbine	.99
Fuel Cell	.99
Other	.97

^aFactor reduced by .01 if the facility has flue gas particulate collectors and another .03 if the facility has flue gas desulfurization (FGD) equipment. Facilities under 25 megawatts and burning coal in traditional boilers (e.g., not fluidized bed boilers) are assumed to have particulate and FGD equipment.

These conversion factors were estimated by the staff of the Office of Coal, Nuclear, Electric and Alternate Fuels, Energy Information Administration. The primary reference used in developing the conversion factors was *Steam, Its Generation and Use*, 40th Edition, Babcock & Wilcox, Barberton, Ohio.

Emissions for the Production of Electricity Methodology. Emissions for nonutility power producers include emissions from cogeneration facilities that produce electric power as an integral part of a manufacturing or other thermal consuming process. Emissions are directly proportional to the quantities of fuels consumed. To calculate emissions for the production of electricity, a methodology was developed to estimate the consumption of fuel associated for the production of electricity by cogeneration facilities. The methodology is based on net generation heat rates by primary fuel and prime-mover. The primary fuel is the predominant energy source for the generator based

on fuel consumption at the facility expressed in total Btu by fuel type. The heat rates were estimated by the staff of the Office of Coal, Nuclear, Electric and Alternate Fuels; Energy Information Administration. The primary reference used in developing the conversion factors was TAG—Technical Assessment Guide, Volume 1: Electricity Supply—1986, Electric Power Research Institute, Palo Alto, California, December 1986. The procedure to estimate the fuel consumed for the production of electricity is to calculate net generation by primary fuel and prime-mover (see gross-to-net generation methodology), multiply the net generation by the appropriate heat rate to obtain total Btu consumed for the production of electricity, and apportion by the total Btu weighted by energy source.

Net generation heat rates by primary fuel and prime mover are as follows:

Prime Mover	Heat Rate (Btu/kWh - net) By Primary Fuel			
	Coal	Petroleum	Natural Gas	Other
Gas (Combustion Turbine)				
Single Cycle	N/A	14,000	14,500	N/A
Combined Cycle	N/A	8,100	8,200	N/A
Steam Turbine				
Single Cycle	10,200	9,600	9,600	16,500
Combined Cycle	9,000	9,000	9,000	10,500
Internal Combustion	N/A	11,700	11,700	N/A
Other	10,200	11,700	11,700	10,500

Nameplate Capacity to Summer Capability Conversion Methodology. Form EIA-867, "Annual Nonutility Power Producer Report," collects nameplate capacity for electric generating units. Estimated values for net summer capability from nameplate capacity are aggregated to provide a U.S. total. The methodology used for estimating summer capability from nameplate capacity is the same methodology shown in this Appendix for the Form EIA-860.

Business Classification. The nonutility industry consists of all manufacturing, agricultural, forestry, transportation, finance, service and administrative industries, based on the Office of Management and Budget's Standard Industrial Classification (SIC) Manual.²⁰ In 1997, the SIC Manual name was changed to North American Industry Classification System (NAICS). The following is a list from the Form EIA-867 of the main classifications and the category of primary business activity within each classification.

Agriculture, Forestry, and Fishing
111 Agriculture production-crops

112 Agriculture production, livestock and animal specialties
115 Agricultural services
113 Forestry
114 Fishing, hunting, and trapping

Mining
2122 Metal mining
2121 Coal mining
211 Oil and gas extraction
2123 Mining and quarrying of nonmetallic minerals except fuels

Construction
23

Manufacturing
311 Food and kindred products
3122 Tobacco products
314 Textile and mill products
315 Apparel and other finished products made from fabrics and similar materials

²⁰ Office of Management and Budget, *Standard Industrial Classification Manual*, 1972 (Washington, DC, 1987).

321 Lumber and wood products, except furniture
337 Furniture and fixtures
322 Paper and allied products (other than 322122 or 32213)
 322122 Paper mills, except building paper
 32213 Paperboard mills
323 Printing and publishing
325 Chemicals and allied products (other than 325188, 325211, 32512, or 325311)
 325188 Industrial Inorganic Chemicals
 325211 Plastics materials and resins
 32512 Industrial organic chemicals
 325311 Nitrogenous fertilizers
324 Petroleum refining and related industries (other than 32411)
 32411 Petroleum refining
326 Rubber and miscellaneous plastic products
316 Leather and leather products
327 Stone, clay, glass, and concrete products (other than 32731)
 32731 Cement, hydraulic
331 Primary metal industries (other than 331111 or 331312)
 331111 Blast furnaces and steel mills
 331312 Primary aluminum
332 Fabricated metal products, except machinery and transportation equipment
333 Industrial and commercial equipment and components except computer equipment
335 Electronic and other electrical equipment and components except computer equipment
336 Transportation equipment
3345 Measuring, analyzing, and controlling instruments, photographic, medical, and optical goods, watches and clocks
339 Miscellaneous manufacturing industries

Transportation and Public Utilities

482 Railroad transportation
485 Local and suburban transit and interurban highway passenger transport
484 Motor freight transportation and warehousing
491 United States Postal Service
483 Water transportation
481 Transportation by air
486 Pipelines, except natural gas
487 Transportation services
513 Communications
22 Electric, gas, and sanitary services
 2212 Natural gas transmission
 2213 Water supply
 22132 Sewerage systems
 562212 Refuse systems
 22131 Irrigation systems

Wholesale Trade

421 to 422

Retail Trade

441 to 454

Finance, Insurance, and Real Estate

521 to 533

Services

721 Hotels
812 Personal services
514 Business services
8111 Automotive repair, services, and parking
811 Miscellaneous repair services

512 Motion pictures
713 Amusement and recreation services
622 Health services
541 Legal services
611 Education services
624 Social services
712 Museums, art galleries, and botanical and zoological gardens
813 Membership organizations
561 Engineering, accounting, research, management, and related services
814 Private households
514199 Miscellaneous services

92 Public Administration

92

Other (explain):

Historically, (Tables 56 and 60) show cogeneration facilities reporting the Standard Classification Code (SIC) that identified the user of the electric and/or thermal energy. Beginning in 1993, the SIC code was broadened to include the SIC code(s) of the producing facility based on the facilities consumption. This revision provides an alternative method of comparing power needs and utilization within the nonutility power industry. In 1997, all the tables are based on North American Industry Classification System. Tables A1 and A2 show the installed capacity and gross generation of electricity by the producing energy group, respectively.

Quality of Data

The Office of Coal, Nuclear, Electric and Alternate Fuels (CNEAF) is responsible for routine data improvement and quality assurance activities. All operations in this office are done in accordance with formal standards established by the EIA. These standards are the measuring rod necessary for quality statistics. Data improvement efforts include verification of data-keyed input by automatic computerized methods, editing by subject matter specialists, and follow up on nonrespondents. The CNEAF office supports the quality assurance efforts of the data collectors by providing advisory reviews of the structure of information requirements, and of proposed designs for new and revised data collection forms and systems. Once implemented, the actual performance of working data collection systems is also validated. Computerized respondent data files are checked to identify those who fail to respond to the survey. By law, nonrespondents may be fined or otherwise penalized for not filing a mandatory EIA data form. Before invoking the law, the EIA tries to obtain the required information by encouraging cooperation of nonrespondents.

Completed forms received by the CNEAF office are sorted, screened for completeness of reported information, and keyed onto computer tapes for storage and transfer to random access data bases for computer processing. The information coded on the computer

tapes is manually spot-checked against the forms to certify accuracy of the tapes. To ensure the quality standards established by the EIA, formulas that use the past history of data values in the data base have been designed and implemented to check data input for errors automatically. Data values that fall outside the ranges prescribed in the formulas are verified by telephoning respondents to resolve any discrepancies.

Data Editing System

Data from the form surveys are edited using automated systems. The edit includes both deterministic checks, in which records are checked for the presence of required fields and their validity; and statistical checks, in which estimation techniques are used to validate data according to their behavior in the past and in comparison to other current fields.

Confidentiality of the Data

In general, the data collected on the forms used for input to this report are not confidential. However, data from the Form EIA-867, "Annual Nonutility Power Producer Report," are considered confidential and must adhere to EIA's "Policy on the Disclosure of Individually Identifiable Energy Information in the Possession of the EIA" (45 *Federal Register* 59812 (1980)). In order to protect the confidentiality of individual respondent's data, a procedure was developed to suppress the data for publication. The procedure is described as follows.

Disclosure of Data

Data reported on the Form EIA-867, "Annual Nonutility Power Producer Report," are confidential. In order to protect the confidentiality of data for an individual respondent, a policy was implemented to ensure that the reporting of survey data would not associate those data with a particular company. The final phase in the data quality assurance and control procedures is to determine which data must be suppressed (withheld) during publication to provide the necessary confidentiality for respondents that operate in small reporting areas. These procedures are performed as follows:

- Primary Withholding Based on the Number of Respondents in a Cell--All cells with three or fewer respondents are suppressed.
- Residual Withholding Dominance Rule--All cells containing four or more respondents are tested using a linear sensitivity rule.
- Complementary Suppression--All tables are reviewed to identify cells that should have data withheld to prevent disclosure of already suppressed cells.

An example of this concept, when U.S. totals are available, would be the complementary suppression of a second State in order to prevent the derivation of an initially suppressed State.

The withholding/suppression of data is performed as an adjunct to Quality Assurance (QA) procedures. The work is performed by survey editors and the QA staff and is reviewed by the survey manager before being submitted to the division level QA review.

All sensitive cells identified in the withholding analysis are denoted with the symbol/letter "W." The use of the symbol/letter applies to primary, complementary and inter-table suppressions as well as all withheld data.

Rounding Rules for Data

Given a number with r digits to the left of the decimal and $d+t$ digits in the fraction part, with d being the place to which the number is to be rounded and t being the remaining digits which will be truncated, this number is rounded to $r+d$ digits by adding 5 to the $(r+d+1)$ th digit when the number is positive or by subtracting 5 when the number is negative. The t digits are then truncated at the $(r+d+1)$ th digit. The symbol for a rounded number truncated to zero is (*).

CNEAF Data Revision and Policy

The Office of Coal, Nuclear, Electric and Alternate Fuels has adopted the following policy with respect to the revision and correction of recurrent data in energy publications:

1. Annual survey data collected by this office are published either as preliminary or final when first appearing in a data report. Data initially released as preliminary will be so noted in the report. These data will be revised, if necessary, and declared final in the next publication of the data.
2. All monthly and quarterly survey data collected by this office are published as preliminary. These data are revised only after the completion of the 12-month cycle of the data. No revisions are made to the published data before this unless approved by the Office Director.
3. The magnitude of changes due to revisions experienced in the past will be included in the data reports, so that the reader can assess the accuracy of the data.
4. After data are published as final, corrections will be made only in the event of a greater than one percent difference at the national level. Corrections for differences that are less than the before-mentioned threshold are left to the discretion of the Office Director.

The *Electric Power Annual Volume II* presents the most current annual data available to the EIA. The statistics may differ from those published previously in EIA publications due to corrections, revisions, or other adjustments to the data subsequent to its original release. On a chapter basis, the status (preliminary versus final) of the data contained in the EPA follows:

- **U.S. Electric Utility Retail Sales and Revenue**
Data on sales, revenue, and average revenue per kilowatthour from the Form EIA-861 for 1997 are preliminary.
- **U.S. Electric Utility Financial Statistics**
Financial data from the Federal Energy Regulatory Commission Form 1 and the Form EIA-412 for 1997 are preliminary.
- **U.S. Electric Utility Environmental Statistics**
Data from the Form EIA-767 for 1996 are final. Data for 1997 are preliminary. A comparison of preliminary versus final data at the national level for 1997 will be provided in the *Electric Power Annual Volume II 1998*.
- **U.S. Electric Power Transactions**
All data from the Form EIA-411 are final. Data from the Forms EIA-861 and FE-781R for 1997 are preliminary. Data from the Form EIA-860 are final.
- **U.S. Electric Utility Demand-Side Management**
All data on demand-side management from the Form EIA-861 are preliminary.
- **U.S. Nonutility Power Producers** Data from the Form EIA-867 for 1993 through 1996 are final. Data for 1997 are preliminary.

Formulas and Calculations

Average Heat Content

In order to determine the Btu value per unit of consumption for each of the fossil fuels collected on the Form EIA-759, the heat content values contained on the FERC Form 423 were used. Data on the FERC Form 423 represent approximately 85 percent of the total generator nameplate capacity for all electric utilities.

Percent Difference

The following formula is used to calculate percent differences.

$$\text{Percent Difference} = \left(\frac{x(t_2) - x(t_1)}{x(t_1)} \right) \times 100,$$

where $x(t_1)$ and $x(t_2)$ denote the quantity at year t_1 and subsequent year t_2 .

Form EIA-861

Data for the Form EIA-861 are collected at the utility level from all electric utilities in the United States, its territories, and Puerto Rico. Form EIA-861 data in this publication are for the United States only. These data are then aggregated to provide geographic totals at the State, NERC region, Census division, and national level. Sources and disposition of data are also provided by utility class of ownership and retail consumer class of service. Average revenue (nominal dollars) per kilowatthour of electricity sold is calculated by dividing total annual retail revenue (nominal dollars) by the total annual retail sales of electricity.

Average revenue per kilowatthour is defined as the cost per unit of electricity sold and is calculated by dividing retail electric revenue by the corresponding sales of electricity. The average revenue per kilowatthour is calculated for all consumers and for each sector (residential, commercial, industrial, and other sales).

Electric utilities typically employ a number of rate schedules within a single sector. These alternative rate schedules reflect the varying consumption levels and patterns of consumers and their associated impact on the costs to the electric utility for providing electrical service. The average revenue per kilowatthour reported in this publication by sector represents a weighted average of consumer revenue and sales within that sector and across sectors for all consumers.

The electric revenue used to derive the average revenue per kilowatthour is the operating revenue reported by the electric utility. Operating revenue includes energy charges, demand charges, consumer service charges, environmental surcharges, fuel adjustments, and other miscellaneous charges.

Electric utility operating revenues cover, among other costs of service, State and Federal income taxes and taxes other than income taxes paid by the utility. The Federal component of these taxes are, for the most part, "payroll" taxes. State and local authorities tax the value of plant (property taxes), the amount of revenues (gross receipts taxes), purchases of materials and services (sales and use taxes), and a potentially long list of other items that vary extensively by taxing authority. Taxes deducted from employees' pay (such as Federal income taxes and employees' share of social security taxes) are not a part of the utility's "tax costs," but are paid to the taxing authorities in the name of the employees. These taxes are included in

the utility's cost of service (for example, revenue requirements) and are included in the amounts recovered from consumers in rates and reported in operating revenues.

Electric utilities, like many other business enterprises, are required by various taxing authorities to collect and remit taxes assessed on their consumers. In this regard, the electric utility serves as an agent for the taxing authority. Taxes assessed on the consumer, such as a gross receipts tax or sales tax, are called "pass through" taxes. These taxes do not represent a cost to the utility and are not recorded in the operating revenues of the utility. However, taxing authorities differ as to whether a specific tax is assessed on the utility or the consumer--which, in turn, determines whether or not the tax is included in the operating revenue of the electric utility.

EIA collects Demand-Side Management (DSM) information from all utilities with DSM programs. Utilities with sales to ultimate consumers or sales for resale greater than or equal to 120,000 megawatthours report their incremental peak load reductions and energy savings for the reporting year, annual peak load reductions and energy savings for the reporting year and first forecast year, and direct and indirect utility costs attributable to DSM programs for 2 years. Annual and incremental effects for the reporting year are reported by consumer sector (residential, commercial, industrial, other) for each program category (energy efficiency and load management). Forecast peak reductions and energy savings are reported by program category with all consumer sectors combined. Utilities with sales to ultimate consumers and sales for resale less than 120,000 megawatthours report incremental peak load reductions and energy savings. They also report total utility cost and total DSM cost for the reporting year and first forecast year.

FERC Form 1

Composite Financial Indicators for Major Investor-Owned Electric Utilities

All financial monetary data in this report are expressed in nominal terms. The following formulas are used to calculate composite financial indicators.

Electric Fixed Asset (Net Plant) Turnover =

$$\frac{\sum_i (EOR_i)}{\sum_i (U_i)},$$

where EOR_i is the Electric Operating Revenue for the i^{th} major utility, and U_i is the Electric Utility Plant -- Net for the i^{th} major utility.

Total Asset Turnover =

$$\frac{\sum_i (OR_i)}{\sum_i (A_i)},$$

where OR_i is the Operating Revenue for the i^{th} major utility, and A_i are the Total Assets for the i^{th} major utility.

Current Assets to Current Liabilities =

$$\frac{\sum_i (CAA_i)}{\sum_i (CAL_i)},$$

where CAA_i are the Current and Accrued Assets for the i^{th} major utility, and CAL_i are the Current and Accrued Liabilities for the i^{th} major utility.

Long-term Debt to Capitalization =

$$\frac{\sum_i (LTD_i)}{\sum_i (C_i)} \times 100,$$

where LTD_i is the Long-term Debt for the i^{th} major utility, and C_i is the Capitalization for the i^{th} major utility.

Preferred Stock to Capitalization =

$$\frac{\sum_i (PS_i)}{\sum_i (C_i)} \times 100,$$

where PS_i is the Preferred Stock for the i^{th} major utility, and C_i is the Capitalization for the i^{th} major utility.

Common Stock Equity to Capitalization =

$$\frac{\sum_i (CSE_i)}{\sum_i (C_i)} \times 100,$$

where CSE_i is the Common Stock Equity of the i^{th} major utility; and, C_i is the Capitalization for the i^{th} major utility.

Total Debt to Total Assets =

$$\frac{\sum_i (LTD_i + STD_i)}{\sum_i (TA_i)} \times 100,$$

where LTD_i is the Long-term Debt of the i^{th} major utility; STD_i is the Short-term Debt of the i^{th} major utility; and, TA_i are the Total Assets of the i^{th} major utility.

Common Stock Equity to Total Assets =

$$\frac{\sum_i (CSE_i)}{\sum_i (TA_i)} \times 100,$$

where CSE_i is the Common Stock Equity of the i^{th} major utility; and, TA_i are the Total Assets of the i^{th} major utility.

**Interest Coverage Before Taxes
Without AFUDC =**

$$\frac{\sum_i \left(+IBI_i + EIT_i + GIT_i \right)}{\sum_i (IE_i)},$$

where IBI_i is Total Income Before Interest Charges for the i^{th} major utility; EIT_i are the Electric Income Taxes for the i^{th} major utility; GIT_i are the Gas Income Taxes for the i^{th} major utility; $QUIT_i$ are the Other Utility Income Taxes for the i^{th} major utility; $TOID_i$ are the Taxes for Other Income and Deductions for the i^{th} major utility; AC_i is the Allowance for Other Funds Used During Construction for the i^{th} major utility; and, IE_i is the Interest Expense for the i^{th} major utility.

Profit Margin =

$$\frac{\sum_i (NI_i)}{\sum_i (OR_i)} \times 100,$$

where NI_i is the Net Income of the i^{th} major utility; and, OR_i is the Operating Revenue for the i^{th} major utility.

Return on Average Common Stock Equity =

$$\frac{\sum_i (NI_i)}{\left(\sum_i (CSEB_i) + \sum_i (CSEE_i) \right)} / 2 \times 100,$$

where NI_i is the Net Income of the i^{th} major utility; $CSEB_i$ is the Common Stock Equity at Beginning

of Year, for the i^{th} major utility, and $CSEE_i$ is the Common Stock Equity at End of Year for the i^{th} major utility.

Return on Investment =

$$\frac{\sum_i (NI_i)}{\sum_i (TA_i)} \times 100,$$

where NI_i is the Net Income of the i^{th} major utility; and, TA_i are the Total Assets of the i^{th} major utility.

Form EIA-412

**Composite Financial Indicators for Major
Publicly Owned Electric Utilities**

Electric Utility Plant per Dollar of Revenue =

$$\frac{\sum_i (EUP_i)}{\sum_i (EOR_i)},$$

where EUP is the Electric Utility Plant for the the i^{th} public utility; and, EOR is the Electric Operating Revenue for the i^{th} public utility.

Current Assets to Current Liabilities =

$$\frac{\sum_i (CA_i)}{\sum_i (CL_i)},$$

where CA_i are the Current and Accrued Assets for the i^{th} public utility; and, CL_i are the Current and Accrued Liabilities for the i^{th} public utility.

Electric Utility Plant as a Percent of Total Assets =

$$\frac{\sum_i (EUP_i)}{\sum_i (TA_i)} \times 100,$$

where EUP_i is the Electric Utility Plant for the i^{th} public utility; and, TA_i are the Total Assets for the i^{th} public utility.

**Net Electric Utility Plant as a Percent of
Total Assets =**

$$\frac{\sum_i (NEUP_i)}{\sum_i (TA_i)} \times 100,$$

where $NEUP_i$ is the Net Electric Utility Plant for the i^{th} public utility; and, TA_i is the Total Assets for the i^{th} public utility.

Debt as a Percent of Total Liabilities =

$$\frac{\sum_i (D_i)}{\sum_i (TL_i)} \times 100,$$

where D_i is the Debt for the i^{th} public utility; and, TL_i is the Total Liabilities for the i^{th} public utility.

Accumulated Provision for Depreciation as a Percent of Electric Utility Plant =

$$\frac{\sum_i (APD_i)}{\sum_i (EUP_i)} \times 100,$$

where APD_i is the Accumulated Provision for Depreciation for the i^{th} public utility; and, EUP_i is the Electric Utility Plant for the i^{th} public utility.

Electric Operation and Maintenance Expenses as a Percent of Electric Operating Revenue =

$$\frac{\sum_i (EOME_i)}{\sum_i (EOR_i)} \times 100,$$

where $EOME_i$ is the Electric Operation and Maintenance Expenses for the i^{th} public utility; and, EOR_i is the Electric Operating Revenue for the i^{th} public utility.

Electric Depreciation and Amortization as a Percent of Electric Operating Revenue =

$$\frac{\sum_i (EDA_i)}{\sum_i (EOR_i)} \times 100,$$

where EDA_i is Electric Depreciation and Amortization for the i^{th} public utility; and, EOR_i is the Electric Operating Revenue for the i^{th} public utility.

Taxes and Tax Equivalents as a Percent of Electric Operating Revenue =

$$\frac{\sum_i (TTE_i)}{\sum_i (EOR_i)} \times 100,$$

where TTE_i are the Taxes and Tax Equivalents for the i^{th} public utility; and, EOR_i is the Electric Operating Revenue for the i^{th} public utility.

Interest Expense as a Percent of Electric Operating Revenue =

$$\frac{\sum_i (IE_i)}{\sum_i (EOR_i)} \times 100,$$

where IE_i is the Interest Expense for the i^{th} public utility; and, EOR_i is the Electric Operating Revenue for the i^{th} public utility.

Net Income as a Percent of Electric Operating Revenues =

$$\frac{\sum_i (NI_i)}{\sum_i (EOR_i)} \times 100,$$

where NI_i is the Net Income of the i^{th} public utility; and, EOR_i is the Electric Operating Revenue for the i^{th} public utility.

Purchase Power Cents Per Kilowatthour =

$$\frac{\sum_i (PPC_i)}{\sum_i (PPK_i)} \times 10, \quad (A1)$$

where PPC_i is the Purchase Power Costs (in cents) for the i^{th} public utility; and, PPK_i is the Purchased Power Kilowatthours for the i^{th} public utility.

Generated Cents Per Kilowatthour =

$$\frac{\sum_i (TGC_i)}{\sum_i (TGK_i)} \times 10, \quad (A2)$$

where TGC_i is the Total Generation Costs (in cents) for the i^{th} public utility; and, TGK_i is the Total Generated Kilowatthours for the i^{th} public utility.

Total Power Supply Per Kilowatthour Sold =

$$\frac{\sum_i (TPC_i)}{\sum_i (TPK_i)} \times 10, \quad (A3)$$

where TPC_i is the Total Generation and Purchase Power Cost for the i^{th} public utility; and, TPK_i is the Total Generated and Purchased Power Kilowatthours Sold for the i^{th} public utility.

Air Emissions

This section describes the methodology employed to calculate estimates of sulfur dioxide (SO_2), nitrogen oxides (NO_x), and carbon dioxide (CO_2) emissions from utility and nonutility electric generating plants.

Utility Air Emissions

The following describes the methodology employed to calculate estimates of SO_2 , NO_x , and CO_2 emissions from power plants operated by electric utilities. These air emissions are estimated using information contained on Form EIA-767, "Steam-Electric Plant Operation and Design Report." Form EIA-767 collects information annually for all U.S. power plants with a total existing or planned organic- or nuclear-fueled steam-electric generator nameplate rating of 10 megawatts (MW) or larger. Power plants with a total generator nameplate rating of 100 MW or more must complete the entire form, providing, among other things, information about fuel consumption and quality, legal air emission limits, and flue gas desulfurization (FGD) efficiency. Power plants with a total generator nameplate rating from 10 MW to less than 100 MW complete only part of the form, including information on fuel consumption and FGD sulfur removal efficiency, if applicable.

Uncontrolled Air Pollutant Emissions. Uncontrolled air pollutant emissions are those emissions that would occur in the absence of any control equipment. Uncontrolled SO_2 , NO_x , and CO_2 emissions are determined by multiplying the quantity of fuel burned by an emission factor. An emission factor is the average quantity of a pollutant released from a boiler when a unit of fuel is burned.

The source of the SO_2 and NO_x emission factors, when available, is the Environmental Protection Agency report AP-42, "Compilation of Air Pollutant Emission Factors" (Table A3).²¹ Emissions of SO_2 , NO_x , and CO_2

have been revised from the updated Air Pollutant Emissions Factor (AP-42 5th edition) of the Environment Protection Agency on August 1998. Environmental Protection Agency emission factors are based on boiler type, firing configuration, and fuel burned. The methodology for determining emissions of CO_2 has been revised since the 1991 publication. Emissions of carbon dioxide for 1992 and prior years have been revised using the set of factors shown in Tables A3 and A4.

In 1992, a special study of the relationship between the heat and carbon content of coal was completed by the Energy Information Administration's Analysis and Systems Division of the Office of Coal, Nuclear, Electric and Alternate Fuels. The hypothesis underlying this study was that the ratio of carbon-to-heat content varies not only by coal rank (i.e., anthracite, bituminous, subbituminous, and lignite), but also by geographic location of the coal. In this study, the hypothesis was tested and the results of the analysis supported the hypothesis. That is, it was concluded from the analysis that coal rank and location of the coal are significant factors in the variation of the ratio of carbon-to-heat content. After this determination, a set of emission factors, by rank and State were derived on the basis of data contained in EIA's Coal Analysis File.²²

In editions prior to 1992 of this publication, separate conversion factors by coal rank were published and used to estimate emissions of CO_2 . The special study by EIA concluded that since geographic location of coal in addition to rank of coal is a significant factor in determining the carbon/heat content relationship, the use of emission factors that consider both of these elements may yield more accurate estimates of CO_2 emissions. The emission factors for coal were developed in the units of pounds of CO_2 per million Btu of coal.

The emission factors for CO_2 (Table A4) from coal are applied by power plant, based on the rank, amount of coal received, and the State from which the coal originated, as reported in FERC Form 423, "Cost and Quality of Fuels for Electric Utility Plants." Thus, a weighted average emissions factor is obtained by plant and multiplied by the quantity of coal consumed by plant, as reported on Form EIA-767, "Steam-Electric Plant Operation and Design Report," to determine the emissions of CO_2 . The emission factors for CO_2 based on 100-percent combustion of the carbon in the fuel. Since a small percentage of the carbon in the coal is not converted to CO_2 , this publication assumes 99 percent combustion. The 1 percent of emissions is deducted at the State/National level. The emissions at the State level are based on the State in which the plant is located.

Uncontrolled emissions of SO_2 and NO_x do not always accurately depict the quantity of emissions released

²¹ "Compilation of Air Pollutant Emission Factors, Vol. 1: Stationary Point and Area Sources (AP-44); 5th Edition (including Supplement A) Research Triangle Park, North Carolina, August 1998.

²² For a description of methodology and data use to develop the EIA CO_2 emission factors, see B. D. Hong and E. R. Slatick, "Carbon Dioxide Emission Factors for Coal," *Quarterly Coal Report, January-March 1994*, DOE/EIA-0121(94/1Q) (Washington, DC, August 1994), Energy Information Administration.

into the atmosphere because they fail to reflect reductions from control equipment and/or operating technologies. Consequently, controlled emissions are calculated to provide a more accurate estimate of actual utility air emission.

Controlled Sulfur Dioxide Emissions. Because of environmental regulations controlling SO_2 emissions, many utilities are required to install FGD units at their coal-fired plants.²³ FGD units typically remove between 70 to 90 percent of SO_2 from the boiler flue gas although higher removal efficiencies can be achieved. Electric utilities report both sulfur removal efficiency (percent) and their most stringent SO_2 emission limits on the Form EIA-767. To determine controlled SO_2 emissions, the uncontrolled emissions are reduced by the annual average removal efficiencies reported on the Form EIA-767. This emission is the controlled emission. As a check, the controlled emission is compared with the most stringent legal limit reported on the Form EIA-767. The controlled emission should be less than the legal limit because research indicates that utilities routinely remove more SO_2 than required to assure an operating margin of safety. If the controlled emission is not less than the most stringent legal limit, it implies that the utility is out of legal compliance and could be subject to fines and other penalties.

Utilities are permitted to take credit for sulfur that remains in bottom ash -- ash remaining in the bottom of the furnace after the coal is burned. For example, if a utility is required to remove 90 percent of the sulfur in the coal and 3 percent remains in the ash, it has to remove only 87 percent using scrubbers. This credit is included in emissions data in this report. It is likely, however, that in many cases the credit is not taken. In order to take the ash credit, utilities need to monitor the coal consumed on a daily basis; this is both time-consuming and costly. To the extent that utilities do not take the ash credit, emissions might be slightly overstated.

Sulfur Dioxide Emission Comparison. Title IV of the Clean Air Act Amendments of 1990 requires annual sulfur dioxide (SO_2) emissions from electric power plants to be reduced 10 million tons below their 1990 level by the year 2010. The Clean Air Act required electric utility units covered under the Acid Rain Program (units 25 megawatts and greater) to be equipped with continuous emission monitoring systems (CEMS). CEMS is the industry standard for measuring and recording hourly SO_2 , nitrogen oxide (NO_x), and carbon dioxide (CO_2) emissions. In 1994, the first 263 utility units covered under the Acid Rain Program were required to install CEMS and submit a year's worth of emissions data to the Environmental Protection Agency (EPA). In 1995, the operators of more than 2,000 additional units were required to measure and report emissions data. EPA published

1996 CEMS emissions data by state and plant in its publication *Acid Rain Program, Emissions Scorecard 1996 (EPA430/R-97-025)*.

Preliminary 1996 CEMS data for about 1,000 power plants was received from EPA just prior to the publication deadline. A comparison was made between SO_2 emissions data from electric utility plants for which both EPA and EIA collected data. On a national basis, the data collected by EPA is 2.5 percent higher than SO_2 emissions calculated by EIA.

Controlled Nitrogen Oxide Emissions. The controlled NO_x emission is calculated by applying the appropriate reduction factor in Table A5. Prior to 1995 for utility boilers with regulated nitrogen oxide emission limits, the annual controlled estimate used was the lesser of the controlled estimate or the annual limitation. When more than one control technology is reported, the highest single reduction factor is used to estimate the annual controlled NO_x emission.

Carbon Dioxide Emissions. There are no Federal regulations that limit CO_2 emissions. Information pertinent to the estimation of controlled CO_2 emissions is not collected on the Form EIA-767; therefore, no estimates of controlled CO_2 emissions are made.

A degree of complexity is added to this approach, however, because air emission standards are not reported in consistent units. In some rare instances, emission standards are reported in units that cannot be directly compared with estimated uncontrolled emission rates. Examples of such standards are ones that specify the concentration of NO_x allowed in the flue gas or the ambient concentration of NO_x (parts per million). In cases where these types of standards are reported, the uncontrolled emission estimate is used. Such standards are uncommon, however, and do not significantly affect the results.

Air Emissions from Small Plants. The Form EIA-767 does not collect data for generators powered by internal combustion engines, gas turbines, combined cycle units (for example, gas turbines with waste heat boilers), and boilers at steam-electric plants with a total nameplate capacity of less than 10 MW. Accordingly, utility air emission from these generators are not estimated by the methodology. An estimate of air emissions from these generating units based on a similar methodology using 1991 fuel consumption data reported on the Form EIA-759, "Monthly Power Plant Report," was performed. Results of this effort indicate that the emissions of SO_2 , NO_x , and CO_2 from utility sources not included on the Form EIA-767, are less than 0.1, 1.2, and 1.1 percent, respectively, of total utility air emissions.

²³ Flue gas desulfurization units may also reduce sulfur dioxide emissions from plants that burn oil and petroleum coke.

Nonutility Air Emissions

The following describes the methodology employed to calculate estimates of SO_2 , NO_x , and CO_2 emissions from power plants operated by nonutilities. The emissions are estimated using information contained on Form EIA-867, "Annual Nonutility Power Producer Report." Form EIA-867 collects information annually from all nonutility power producers with a total generator nameplate rating of 1 megawatt (MW) or more, including cogenerators, small power producers, and other nonutility electricity generators. Facilities with a total generator nameplate rating of 1 MW or more must complete the entire form, providing, among other things, information about fuel consumption and quality. Facilities with a combined nameplate capacity of less than 25 megawatts are not required to complete Schedule V "Facility Environmental Information" of the Form EIA-867.

Uncontrolled Emissions. Uncontrolled air pollutant emissions are those emissions that would occur in the absence of any control equipment. Uncontrolled SO_2 , NO_x , and CO_2 emissions are determined by multiplying the quantity of fuel burned by an emission factor. An emission factor is the average quantity of a pollutant released from a boiler when a unit of fuel is burned. As with electric utilities, the source of both the SO_2 and NO_x emission factors, when available, is the Environmental Protection Agency report AP-42, "Compilation of Air Pollutant Emission Factors."²⁴ However, the boiler type and firing configuration are not reported on the Form EIA-867 so all boilers are assumed to be large boilers²⁵ with pulverized coal firing and dry bottoms. For other types of prime movers (for example, gas turbines, combined cycle, and internal combustion engines) the same set of emission factors are used.

The methodology for determining emissions of CO_2 from nonutility electric power plants has been revised. The new methodology uses the results of the coal study discussed under "Utility Air Emissions." Based on the coal rank, the quality of coal received and its State of origin, weighted average emission factors are determined by State for electric utility plants. It is assumed that nonutility plants located in the same State as utility plants obtain coal from the same State. The weighted emission factors by State for utility coal-fired plants are multiplied by the coal consumption reported for nonutility plants in the respective State on Form EIA-867.

Uncontrolled emissions of SO_2 and NO_x do not always accurately depict the quantity of emissions released into the atmosphere because they fail to reflect reductions from control equipment and operating technologies. Consequently, controlled emissions are calculated to provide a more accurate estimate of actual nonutility air emissions.

Controlled Sulfur Dioxide Emissions. The Clean Air Act of 1971 established Federal emission limits for new fossil-fueled steam generators -- 1.2 pounds of SO_2 per million Btu of solid fossil fuel consumed and 0.8 pounds for liquid fossil fuels. The Clean Air Act of 1978 established even more stringent sulfur dioxide emission limits. The revised law mandates the installation of flue gas desulfurization (FGD) equipment at some new industrial and commercial facilities built after June 19, 1984, and requires that these facilities remove 90 percent of the SO_2 in the flue gases. Nonutilities report whether they have FGD equipment at their facilities and the date of first electrical generation on the Form EIA-867. Air emission limits are based on the date construction began. It is assumed that it takes two years from the start of construction to the date of first electrical generation as reported on the form.

Controlled SO_2 emissions are calculated for respondents reporting FGD equipment or fluidized bed combustion. For facilities reporting first electrical generation before August 1973, no reductions are assumed. For facilities reporting first electrical generation between August 1973 and June 1986, the controlled emission is estimated as the lesser of either: the uncontrolled emission, or a weighted average of 1.2 and 0.8 pounds of SO_2 per million Btu of solid and liquid fossil fuel consumed, respectively. For facilities reporting first electrical generation after June 1986, the controlled emission is estimated as the lesser of either: the uncontrolled emission reduced by 90 percent, or a weighted average of 1.2 and 0.8 pounds of SO_2 per million Btu of solid and liquid fossil fuel consumed, respectively.

Facilities with a total nameplate rating between 5 MW and 25 MW are not required to report whether they have FGD units. Controlled SO_2 emissions for these facilities are calculated based on the year electricity was first generated at the facility as reported on the Form EIA-867. For facilities reporting electrical generation before August 1973, no control equipment is assumed and the controlled SO_2 emission is equal to the uncontrolled emission as calculated above. For facilities reporting the date of their first electrical generation as between August 1973 and August 1980, the controlled SO_2 emission is estimated as the lesser of either: the uncontrolled SO_2 emission, or 1.2 pound of SO_2 per million Btu of fuel consumed. For facilities reporting their first electrical generation after August 1980, the controlled SO_2 emission is estimated as the lesser of either: the uncontrolled emission reduced by 80 percent, or 1.2 pounds of sulfur dioxide per million Btu of fuel consumed.

Controlled Nitrogen Oxide Emissions. Nonutilities with a total facility nameplate rating of 25 MW or more are required to report on the Form EIA-867 whether they have any NO_x control equipment and its type. Controlled NO_x emissions estimates are based on assumed removal efficiencies for the different types

²⁴ "Compilation of Air Pollutant Emission Factors, Vol. I: Stationary Point and Area Sources(AP-42)," 5th Edition (including Supplement A) Research Triangle Park, North Carolina, January 1996.

²⁵ Boilers with a gross heat rate of 100 million Btu per hour or greater.

of NO_x control equipment. The percent removal efficiencies of the NO_x control equipment and/or operating technologies are shown in Table A5.

The controlled NO_x emission is calculated by reducing the uncontrolled emission by the appropriate reduction percentage based on the NO_x technology. In cases where more than one type of technology is reported, the highest single reduction percentage of the equipment reported is applied.

Facilities with a total nameplate rating between 5 MW and 25 MW are not required to report whether they have NO_x reduction equipment. However, the Clean Air Act limits NO_x emissions to 0.8 pounds per million Btu of fuel consumed. Controlled NO_x emissions for these facilities are calculated based on the

year electricity was first generated at the facility as reported on the Form EIA-867. For facilities reporting electrical generation before August 1973, no control equipment is assumed and the controlled NO_x emission is estimated to be equal to the uncontrolled emission as calculated above. For facilities reporting the first date of electrical generation after August 1973, the controlled NO_x emission is estimated as the lesser of either: the uncontrolled NO_x emission, or 0.8 pounds of NO_x per million Btu of fuel consumed.

Controlled Carbon Dioxide Emissions. There are no Federal regulations that limit CO_2 emissions. Information pertinent to the estimation of controlled CO_2 emissions is not collected on the Form EIA-867; therefore, no estimates of controlled CO_2 emissions are provided.

General Information

Use of the Glossary

The terms in the glossary have been defined for general use. Restrictions on the definitions, as used in these data collection systems, are included in each definition when necessary to define the terms as they are used in this report.

Obtaining Copies of Data

Upon EIA approval of the *Electric Power Annual Volume II* these data are available for public use.

Magnetic tapes may be purchased by using Visa, MasterCard, or American Express cards, as well as money orders or checks payable to the National Technical Information Service (NTIS). Purchasers may

also use NTIS and Government Printing Office deposit accounts. To place an order, contact:

National Technical Information Service (NTIS)
Office of Data Base Services
U.S. Department of Commerce
5285 Port Royal Road
Springfield, Virginia 22161
(703) 487-4650 or Fax (703) 321-8547

Personal computer diskette (3 1/2" or 5 1/4") may be purchased by using Visa or MasterCard, as well as money orders or checks payable to the U.S. Department of Energy. To place an order, contact:

Office of Scientific and Technical Information
U.S. Department of Energy
Request Services
P.O. Box 62
Oak Ridge, Tennessee 37831
(615) 576-8401 or Fax (615) 576-2865

Table A1. Installed Capacity at U.S. Nonutility Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997 (Megawatts)

Census Division	Manufacturing	Transportation and Public Utilities	Services	Mining	Public Administration	Other Industry Groups	Total
1993							
New England	1,692	2,919	W	—	W	—	4,729
Middle Atlantic	2,945	5,409	295	—	W	W	8,730
East North Central	3,015	2,141	267	W	W	W	5,546
West North Central	702	184	165	W	W	W	1,261
South Atlantic	5,715	R 4,396	84	W	W	R 70	10,303
East South Central	1,676	18	W	W	W	—	1,734
West South Central	10,175	2,512	203	180	—	—	13,069
Mountain	431	989	77	245	—	278	2,020
Pacific	3,541	R 8,137	236	1,142	239	R 91	13,385
U.S. Total	29,892	R 26,705	1,444	1,860	297	R 580	60,778
1994							
New England	1,455	3,322	118	—	—	—	4,895
Middle Atlantic	3,311	8,170	W	—	W	W	11,752
East North Central	3,059	2,492	272	W	W	W	5,947
West North Central	706	R 207	166	W	W	W	1,296
South Atlantic	6,114	R 6,015	102	W	W	R 79	12,384
East South Central	2,029	18	W	27	W	—	2,088
West South Central	10,604	2,778	202	180	—	—	13,764
Mountain	425	1,602	58	245	—	352	2,682
Pacific	3,206	8,706	293	1,142	239	R 68	13,654
U.S. Total	30,909	R 33,311	1,445	1,867	330	R 599	68,461
1995							
New England	1,247	3,718	72	—	—	—	5,037
Middle Atlantic	R 2,225	10,127	W	W	—	W	12,477
East North Central	R 3,021	2,489	323	W	W	W	5,917
West North Central	755	R 131	131	W	W	W	1,232
South Atlantic	4,653	R 8,090	100	W	W	R 78	12,995
East South Central	1,920	127	W	27	W	—	2,088
West South Central	9,294	4,218	202	177	—	—	13,891
Mountain	393	1,716	51	245	—	352	2,757
Pacific	2,396	R 10,346	200	644	188	R 85	13,860
U.S. Total	25,902	R 40,962	1,186	1,369	273	R 561	70,254
1996							
New England	1,190	3,938	75	—	—	—	5,202
Middle Atlantic	1,757	W	105	—	—	W	12,987
East North Central	3,076	2,584	331	W	W	W	6,074
West North Central	762	145	135	W	—	W	1,255
South Atlantic	4,690	W	96	W	64	81	13,662
East South Central	1,997	129	W	26	W	—	2,167
West South Central	W	4,636	197	72	W	—	14,433
Mountain	W	W	W	242	—	W	2,881
Pacific	2,460	11,120	169	595	99	85	14,527
U.S. Total	25,850	44,457	1,168	1,204	179	331	73,189
1997							
New England	1,166	4,059	67	—	—	—	5,292
Middle Atlantic	1,712	W	105	—	—	W	13,031
East North Central	3,045	2,684	331	W	W	W	6,144
West North Central	788	473	135	W	—	W	1,609
South Atlantic	4,721	W	89	W	139	102	13,504
East South Central	1,918	183	W	26	W	—	2,147
West South Central	W	4,264	197	67	W	—	14,889
Mountain	W	W	W	239	—	W	2,861
Pacific	2,371	11,248	169	595	99	61	14,543
U.S. Total	26,463	44,620	1,158	1,196	256	328	74,021

R = Revised data.

W = Withheld to avoid disclosure of individual company data.

Notes: *All data are for 1 megawatt and greater. *Data for the 1997 are preliminary; data for prior years are final; *See Technical Notes for Standard Industrial Classifications for these industry groups. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table A2. Gross Generation of U.S. Nonutility Attributed to Major Industry Groups and Census Divisions, 1993 Through 1997 (Million Kilowatthours)

Census Division	Manufacturing	Transportation and Public Utilities	Services	Mining	Public Administration	Other Industry Groups	Total
1993							
New England.....	9,833	17,930	466	—	—	—	28,229
Middle Atlantic.....	16,469	30,513	W	—	—	W	48,705
East North Central.....	14,763	9,981	956	W	W	W	26,211
West North Central.....	2,983	341	403	W	W	W	4,675
South Atlantic.....	32,412	10,769	159	W	W	W	43,620
East South Central.....	10,531	72	W	W	W	—	10,741
West South Central.....	61,708	16,627	611	1,127	—	—	80,073
Mountain.....	2,443	5,701	W	523	—	W	9,572
Pacific.....	20,704	41,692	1,407	7,720	1,530	346	73,400
U.S. Total	171,845	133,627	5,541	10,689	1,767	1,757	325,226
1994							
New England.....	7,840	21,613	471	—	—	—	29,925
Middle Atlantic.....	17,948	37,167	W	—	W	W	56,457
East North Central.....	14,728	12,762	993	W	W	W	28,993
West North Central.....	3,150	R 422	421	W	W	W	5,077
South Atlantic.....	35,043	R 16,719	166	W	W	W	52,152
East South Central.....	12,478	81	W	148	W	—	12,786
West South Central.....	62,636	18,351	539	464	—	—	81,989
Mountain.....	2,473	7,199	336	563	—	701	11,273
Pacific.....	19,485	R 45,193	1,720	8,069	1,523	281	76,271
U.S. Total	175,782	R 159,508	5,781	10,618	1,747	R 1,490	354,925
1995							
New England.....	6,581	22,593	175	—	—	—	29,350
Middle Atlantic.....	12,831	56,428	419	W	—	W	69,768
East North Central.....	14,859	12,134	1,159	W	W	W	28,436
West North Central.....	3,025	W	W	W	W	W	4,702
South Atlantic.....	25,931	R 31,283	237	W	W	W	57,624
East South Central.....	11,593	W	W	125	W	—	12,708
West South Central.....	57,667	25,861	614	492	—	—	84,635
Mountain.....	2,190	8,455	255	482	—	880	12,263
Pacific.....	12,714	R 56,952	1,022	4,338	1,104	285	76,415
U.S. Total	147,392	R 215,233	4,196	6,440	1,217	R 1,422	375,901
1996							
New England.....	5,940	23,653	268	—	—	—	29,862
Middle Atlantic.....	9,433	W	463	—	—	W	68,860
East North Central.....	14,795	14,988	1,232	W	W	W	31,130
West North Central.....	2,829	W	305	W	—	W	4,362
South Atlantic.....	25,712	W	247	W	19	138	58,485
East South Central.....	12,132	W	W	118	W	—	13,249
West South Central.....	W	26,598	566	385	W	—	83,994
Mountain.....	W	W	W	550	—	W	13,480
Pacific.....	13,970	59,471	838	4,096	389	237	79,001
U.S. Total	143,304	227,736	4,164	5,783	480	956	382,423
1997							
New England.....	5,825	23,957	247	—	—	—	30,029
Middle Atlantic.....	9,491	W	473	—	—	W	68,644
East North Central.....	15,150	15,131	1,289	—	W	W	31,637
West North Central.....	2,893	684	333	W	—	W	4,843
South Atlantic.....	25,488	28,388	W	W	W	146	54,598
East South Central.....	11,348	1,088	W	114	W	—	12,659
West South Central.....	W	27,354	538	396	W	—	91,348
Mountain.....	W	W	232	503	—	W	13,729
Pacific.....	13,715	58,052	770	4,089	412	182	77,220
U.S. Total	149,043	223,642	4,140	6,028	861	995	384,707

R = Revised data.

Notes: *All data are for 1 megawatt and greater. *Data for 1997 are preliminary; data for prior years are final; *See Technical Notes for Standard Industrial Classifications for these industry groups. *Totals may not equal sum of components because of independent rounding.

Source: Energy Information Administration, Form EIA-867, "Annual Nonutility Power Producer Report."

Table A3. Sulfur Dioxide, Nitrogen Oxide, and Carbon Dioxide Emission Factors

Fuel	Boiler Type/ Firing Configuration	Emission Factors			
		Sulfur Dioxide ¹	Nitrogen Oxides ²	Carbon Dioxide ³	
Utility.....					
Coal and Other Solid Fuels.....					
Bituminous ⁴	cyclone	38.00 x S	33.0	See Table A4	
	fluidized bed ⁵	39.60 x S	5.0	See Table A4	
	spreader stoker	38.00 x S	12.0	See Table A4	
	tangential	38.00 x S	14.0(15)	See Table A4	
	all others	38.00 x S	22.0(31)	See Table A4	
Subbituminous ⁴	cyclone	35.00 x S	17.0	See Table A4	
	fluidized bed ⁵	39.60 x S	5.0	See Table A4	
	spreader stoker	35.00 x S	9.0	See Table A4	
	tangential	35.00 x S	8.4	See Table A4	
	all others	35.00 x S	22.0(34)	See Table A4	
Lignite ⁴	cyclone	30.00 x S	15.50	See Table A4	
	fluidized bed	10.00 x S	3.60	See Table A4	
	front/opposed	30.00 x S	13.10	See Table A4	
	spreader stoker	30.00 x S	5.80	See Table A4	
	tangential	30.00 x S	7.10	See Table A4	
	all others	30.00 x S	7.10(13)	See Table A4	
Petroleum Coke ^{6,8}	fluidized bed ⁵	39.00 x S	1.80	5,680	
	all others	39.00 x S	18.00	5,680	
Refuse.....	all types	3.46	5.50	1,970	
Wood.....	all types	0.08	1.50	2,000	
Petroleum and Other Liquid Fuels.....					
Residual Oil ⁷	tangential	162.70 x S	32.00	25,000	
	vertical	162.70 x S	47.00	25,000	
	all others	162.70 x S	47.00	25,000	
Distillate Oil ⁷	all types	144.00 x S	24.00	22,300	
Methanol ⁸	all types	0.05	12.40	7,603	
Propane (liquid).....	all types	0.05	19.00	12,500	
Coal-Oil Mixture ⁸	all types	185.00 x S	50.00	22,368	
Natural Gas and Other Gaseous Fuels.....					
Natural Gas.....	tangential	lbs per 10 ⁶ cf	lbs per 10 ⁶ cf	lbs per 10 ⁶ cf	
	all others	0.60	170.00	120,000	
Blast Furnace Gas.....	all types	0.60	280.00	120,000	
Nonutility⁸.....					
Coal and Other Solid Fuels.....					
Anthracite Culm.....	all types	39.00 x S	9.00	See Table A4	
Bituminous ⁴	all types	38.00 x S	21.70	See Table A4	
Bituminous Gob.....	all types	38.00 x S	21.70	See Table A4	
Subbituminous.....	all types	35.00 x S	21.70	See Table A4	
Lignite ⁴	all types	30.00 x S	11.10	See Table A4	
Lignite Waste.....	all types	30.00 x S	11.10	See Table A4	
Peat.....	all types	30.00 x S	11.10	See Table A4	
Agricultural Waste.....	all types	0.08	1.20	1,560	
Black Liquor.....	all types	7.00	1.50	2,725	
Chemicals.....	all types	7.00	1.50	2,725	
Closed Loop Biomass.....	all types	0.08	1.50	2,100	
Internal.....	all types	0.08	1.50	2,100	

See footnotes at end of table.

Table A3. Sulfur Dioxide, Nitrogen Oxide, and Carbon Dioxide Emission Factors (Continued)

Fuel	Boiler Type/ Firing Configuration	Emission Factors		
		Sulfur Dioxide ¹	Nitrogen Oxides ²	Carbon Dioxide ³
Coal and Other Solid Fuels (Continued)				
Liquid Acetonitrile Waste	all types	7.00	1.50	2,725
Liquid Waste	all types	7.00	1.50	2,725
Municipal Solid Waste	all types	3.46	2.69	2,344
Petroleum Coke ⁷	all types	39.00 x S	18.00	5,680
Pitch	all types	30.00 x S	11.10	See Table A4
Railroad Ties	all types	0.08	1.50	2,100
Red Liquor	all types	7.00	1.50	2,725
Sludge	all types	2.80	5.00	2,100
Sludge Waste	all types	2.80	5.00	2,100
Sludge Wood	all types	2.80	5.00	2,100
Spent Sulfite Liquor	all types	7.00	1.50	2,725
Straw	all types	0.08	1.50	2,100
Sulfur	all types	7.00	0.00	0
Tar Coal	all types	30.00 x S	11.10	See Table A4
Tires	all types	38.00 x S	21.70	5,715
Waste Byproducts	all types	3.46	2.69	2,344
Waste Coal	all types	38.00 x S	21.70	See Table A4
Wood/Wood Waste	all types	0.08	1.50	2,100
Petroleum and Other Liquid Fuels				
Heavy Oil ⁷	all types	162.70 x S	67.00	25,445
Light Oil ⁷	all types	162.70 x S	20.00	22,572
Diesel	all types	162.70 x S	20.00	22,572
Kerosene	all types	162.70 x S	20.00	22,572
Butane (liquid)	all types	0.60	21.00	14,700
Fish Oil	all types	0.50	12.40	7,603
Methanol	all types	0.50	12.40	7,603
Oil Waste	all types	147.00 x S	19.00	20,000
Propane (liquid)	all types	0.50	19.00	12,500
Sludge Oil	all types	147.00 x S	19.00	20,000
Tar Oil	all types	162.70 x S	67.00	25,445
Waste Alcohol	all types	0.50	12.40	7,603
Natural Gas and Other Gaseous Fuels				
Natural Gas	all types	0.60	550.00	120,000
Butane (gas)	all types	0.60	550.00	479,450
Hydrogen	all types	0.00	550.00	0
Landfill Gas	all types	0.60	550.00	120,000
Methane	all types	0.60	550.00	116,436
Other Gas	all types	0.60	550.00	120,000
Propane (gas)	all types	0.60	550.00	358,333

¹ Uncontrolled sulfur dioxide emission factors. "x S" indicates that the constant must be multiplied by the percentage (by weight) of sulfur in the fuel. Sulfur dioxide emission estimates from facilities with flue gas desulfurization equipment are calculated by multiplying uncontrolled emission estimates by one minus the reported sulfur removal efficiencies. Sulfur dioxide emission factors also account for small quantities of sulfur trioxide and gaseous sulfates.

² Parenthetical values are for wet bottom boilers; otherwise dry bottom boilers. If bottom type is unknown, dry bottom is assumed. Emission factors are for boilers with a gross heat rate of 100 million Btu per hour or greater. See Table A5 for nitrogen oxide reduction factors used to calculate controlled nitrogen oxide emission estimates.

³ Uncontrolled carbon dioxide emission estimates are reduced by 1 percent to account for unburned carbon.

⁴ Coal types are categorized by Btu content as follows: bituminous (greater than or equal to 9,750 Btu per pound), subbituminous (equal to 7,500 to 9,750 Btu per pound), and lignite (less than 7,500 Btu per pound).

⁵ Sulfur dioxide emission estimates from fluidized bed boilers assume a sulfur removal efficiency of 90 percent.

⁶ Emission factors for petroleum coke are assumed to be the same as those for anthracite. If the sulfur content of petroleum coke is unknown, a 6 percent sulfur content is assumed.

⁷ Oil types are categorized by Btu content as follows: heavy (greater than or equal to 144,190 Btu per gallon), and light (less than 144,190 Btu per gallon).

⁸ Emission Of CO₂, NO_x, and SO₂ for these fuels are calculated from the (January 1996) Air Pollutant Emissions Factors (AP-42 5th release) of the Environmental Protection Agency. All other fuels have been revised from the updated (August 1998) Air Pollutant Emissions Factors (AP-42 5th edition) of the Environmental Protection Agency (See Technical Notes).

cf = Cubic Feet.

gal = U.S. Gallons.

lbs = Pounds.

Sources: •For sulfur dioxide and nitrogen oxide factors: Environmental Protection Agency, *Compilation of Air Pollutant Emission Factors, Volume I: Stationary Point and Area Sources*, Fifth Edition (including supplement A), Research Triangle Park, North Carolina, January, 1996. •For carbon dioxide factors: Department of Energy, "Carbon Dioxide Emissions from Fossil Fuels: A Procedure for Estimation of Results, 1950-1981," June 1983.

Table A4. Carbon Dioxide Emission Factors for Coal by Rank and State of Origin

Rank	State of Origin	Factors (Pounds per Million Btu)
Anthracite	Pennsylvania	227.38
Bituminous.....	Alabama	205.46
Bituminous.....	Arizona	209.68
Bituminous.....	Arkansas	211.60
Bituminous.....	Colorado	206.21
Bituminous.....	Illinois	203.51
Bituminous.....	Indiana	203.64
Bituminous.....	Iowa	201.57
Bituminous.....	Kansas	202.79
Bituminous.....	Kentucky: East	204.80
Bituminous.....	Kentucky: West	203.23
Bituminous.....	Maryland	210.16
Bituminous.....	Missouri	201.31
Bituminous.....	Montana	209.62
Bituminous.....	New Mexico	205.71
Bituminous.....	Ohio	202.84
Bituminous.....	Oklahoma	205.93
Bituminous.....	Pennsylvania	205.72
Bituminous.....	Tennessee	204.79
Bituminous.....	Utah	204.08
Bituminous.....	Virginia	206.23
Bituminous.....	Washington	203.62
Bituminous.....	West Virginia	207.10
Bituminous.....	Wyoming	206.48
Bituminous.....	Texas	204.39
Subbituminous	Alaska	214.00
Subbituminous	Colorado	212.72
Subbituminous	Iowa	200.79
Subbituminous	Missouri	201.31
Subbituminous	Montana	213.42
Subbituminous	New Mexico	208.84
Subbituminous	Utah	207.09
Subbituminous	Washington	208.69
Subbituminous	Wyoming	212.71
Lignite.....	Arkansas	213.54
Lignite.....	California	216.31
Lignite.....	Louisiana	213.54
Lignite.....	Montana	220.59
Lignite.....	North Dakota	218.76
Lignite.....	South Dakota	216.97
Lignite.....	Texas	213.54
Lignite.....	Washington	211.68
Lignite.....	Wyoming	215.59

Source: Energy Information Administration, Quarterly Coal Report, January-April 1994, DOE-EIA-0121(94/Q1) (Washington, D.C., August 1994), pp. 1-8.)

Table A5. Nitrogen Oxide Reduction Factors


Nitrogen Oxide Control Technology	EIA-767 Code(s)	EIA-867 Code(s)	Reduction Factor (Percent)
Advanced Overfire Air	AA	--	30 ¹
Alternate Burners	BF	--	20
Flue Gas Recirculation	FR	FG	40
Fluidized Bed Combustor	CF	--	20
Fuel Reburning	FU	--	30
Low Excess Air	LA	LE	20
Low Nitrogen Oxide Burners	LN	LN	30 ¹
Other (or Unspecified)	OT	OT	20
Overfire Air	OV	OA	20 ¹
Selective Catalytic Reduction	SR	CC	70
Selective Catalytic Reduction			
With Low Nitrogen Oxide Burners	SR and LN	CC and LN	90
Selective Noncatalytic Reduction	SN	--	30
Selective Noncatalytic Recuction			
With Low Nitrogen Oxide Burners	SN and LN	--	50
Slagging	SC	--	20
Steam or Water Injection	--	SW	20

¹ Starting with 1995 data, reduction factors for advanced overfire air, low nitrogen oxide burners, and overfire air were reduced by 10.
Source: Babcock and Wilcox, *Steam: Its Generation and Use*, 40th Edition, 1992.

Table A6. Unit-of-Measure Equivalents

Unit	Equivalent
Kilowatt (kW)	1,000 (One Thousand) Watts
Megawatt (MW)	1,000,000 (One Million) Watts
Gigawatt (GW)	1,000,000,000 (One Billion) Watts
Terawatt (TW)	1,000,000,000,000 (One Trillion) Watts
Gigawatt	1,000,000 (One Million) Kilowatts
Thousand Gigawatts	1,000,000,000 (One Billion) Kilowatts
Kilowatthours (kWh)	1,000 (One Thousand) Watthours
Megawatthours (MWh)	1,000,000 (One Million) Watthours
Gigawatthours (GWh)	1,000,000,000 (One Billion) Watthours
Terawatthours (TWh)	1,000,000,000,000 (One Trillion) Watthours
Gigawatthours	1,000,000 (One Million) Kilowatthours
Thousand Gigawatthours	1,000,000,000 (One Billion) Kilowatthours
U.S. Dollar	1,000 (One Thousand) Mills
U.S. Cent	10 (Ten) Mills

Source: Energy Information Administration, Office of Coal, Nuclear, Electric and Alternate fuels.



Glossary

Acid Rain: Also called acid precipitation or acid deposition, acid rain is precipitation containing harmful amounts of nitric and sulfuric acids formed primarily by nitrogen oxides and sulfur oxides released into the atmosphere when fossil fuels are burned. It can be wet precipitation (rain, snow, or fog) or dry precipitation (absorbed gaseous and particulate matter, aerosol particles or dust). Acid rain has a pH below 5.6. Normal rain has a pH of about 5.6, which is slightly acidic. The term pH is a measure of acidity or alkalinity and ranges from 0 to 14. A pH measurement of 7 is regarded as neutral. Measurements below 7 indicate increased acidity, while those above indicate increased alkalinity.

Actual Peak Reduction: The actual reduction in annual peak load (measured in kilowatts) achieved by consumers that participate in a utility DSM program. It reflects the changes in the demand for electricity resulting from a utility DSM program that is in effect at the same time the utility experiences its annual peak load, as opposed to the installed peak load reduction capability (i.e., Potential Peak Reduction). It should account for the regular cycling of energy efficient units during the period of annual peak load.

Allowance for Funds Used During Construction (AFUDC): A noncash item representing the estimated composite interest costs of debt and a return on equity funds used to finance construction. The allowance is capitalized in the property accounts and included in income.

Ampere: The unit of measurement of electrical current produced in a circuit by 1 volt acting through a resistance of 1 ohm.

Annual Effects: The total effects in energy use (measured in megawatthours) and peak load (measured in kilowatts) caused by all participants in the DSM programs that are in effect during a given year. It includes new and existing participants in existing programs (those implemented in prior years that are in place during the given year) and all participants in new programs (those implemented during the given year). The effects of new participants in existing programs and all participants in new programs should be based on their start-up dates (i.e., if participants enter a program in July, only the effects from July to December should be reported). If start-up dates are unknown and cannot be reasonably estimated, the effects can be annualized (i.e., assume the participants were initiated into the program on January 1 of the given year). The Annual Effects should consider the useful life of efficiency measures, by accounting for building demolition, equipment degradation and attrition.

Anthracite: A hard, black lustrous coal, often referred to as hard coal, containing a high percentage of fixed carbon and a low percentage of volatile matter. Comprises three groups classified according to the following ASTM Specification D388-84, on a dry mineral-matter-free basis:

	Fixed Carbon	Volatile Limits	Matter	
	GE	LT	GT	LE
Meta-Anthracite	98	-	-	2
Anthracite	92	98	2	8
Semianthracite	86	92	8	14

Appliances: Energy Efficiency program promotion of high efficiency appliances such as dishwashers, ranges, refrigerators, and freezers in the residential, commercial, and industrial sectors. Includes programs aimed at improving the efficiency of refrigeration equipment and electrical cooking equipment, including replacement. It also includes the promotion and identification of high efficiency appliances in retail stores using a labeling system different from the federally-mandated Energy Guide. Energy Efficiency program promotion of high efficiency cooling and heating appliances are included under Cooling System and Heating System, respectively.

Ash: Impurities consisting of silica, iron, alumina, and other noncombustible matter that are contained in coal. Ash increases the weight of coal, adds to the cost of handling, and can affect its burning characteristics. Ash content is measured as a percent by weight of coal on an "as received" or a "dry" (moisture-free, usually part of a laboratory analysis) basis.

Asset: An economic resource, tangible or intangible, which is expected to provide benefits to a business.

Available but not Needed Capability: Net capability of main generating units that are operable but not considered necessary to carry load, and cannot be connected to load within 30 minutes.

Average Revenue per Kilowatthour: The average revenue per kilowatthour of electricity sold by sector (residential, commercial, industrial, or other) and geographic area (State, Census division, and national), is calculated by dividing the total monthly revenue by the corresponding total monthly sales for each sector and geographic area.

Barrel: A volumetric unit of measure for crude oil and petroleum products equivalent to 42 U.S. gallons.

Base Bill: A charge calculated through multiplication of the rate from the appropriate electric rate schedule by the level of consumption.

Baseload: The minimum amount of electric power delivered or required over a given period of time at a steady rate.

Baseload Capacity: The generating equipment normally operated to serve loads on an around-the-clock basis.

Baseload Plant: A plant, usually housing high-efficiency steam-electric units, which is normally operated to take all or part of the minimum load of a system, and which consequently produces electricity at an essentially constant rate and runs continuously. These units are operated to maximize system mechanical and thermal efficiency and minimize system operating costs.

Bbl: The abbreviation for barrel.

Bcf: The abbreviation for 1 billion cubic feet.

Bituminous Coal: The most common coal. It is dense and black (often with well-defined bands of bright and dull material). Its moisture content usually is less than 20 percent. It is used for generating electricity, making coke, and space heating. Comprises five groups classified according to the following ASTM Specification D388-84, on a dry mineral-matter-free (mmf) basis for fixed-carbon and volatile matter and a moist mmf basis for calorific value.

Fixed Carbon Limits	Volatile Matter Limits	Calorific Value Limits	Btu/lb		
GE	LT	GT	LT	GE	LE
LV 78	86	14	22	-	-
MV 69	78	22	31	-	-
HVA -	69	31	-	14000	-
HVB -	-	-	-	13000	14000
HVC -	-	-	-	10500	13000

LV = Low-volatile bituminous coal

MV = Medium-volatile bituminous coal

HVA = High-volatile A bituminous coal

HVB = High-volatile B bituminous coal

HVC = High-volatile C bituminous coal

Boiler: A device for generating steam for power, processing, or heating purposes or for producing hot water for heating purposes or hot water supply. Heat from an external combustion source is transmitted to a fluid contained within the tubes in the boiler shell. This fluid is delivered to an end-use at a desired pressure, temperature, and quality.

Btu (British Thermal Unit): A standard unit for measuring the quantity of heat energy equal to the quantity of heat required to raise the temperature of 1 pound of water by 1 degree Fahrenheit.

Capability: The maximum load that a generating unit, generating station, or other electrical apparatus can carry under specified conditions for a given

period of time without exceeding approved limits of temperature and stress.

Capacity: The amount of electric power delivered or required for which a generator, turbine, transformer, transmission circuit, station, or system is rated by the manufacturer.

Capacity (Purchased): The amount of energy and capacity available for purchase from outside the system.

Capacity Charge: An element in a two-part pricing method used in capacity transactions (energy charge is the other element). The capacity charge, sometimes called Demand Charge, is assessed on the amount of capacity being purchased.

Capital (Financial): The line items on the right side of a balance sheet, that include debt, preferred stock, and common equity. A net increase in assets must be financed by an increase in one or more forms of capital.

Census Divisions: The nine geographic divisions of the United States established by the Bureau of the Census, U.S. Department of Commerce, for the purpose of statistical analysis. The boundaries of Census divisions coincide with State boundaries. The Pacific Division is subdivided into the Pacific Contiguous and Pacific Noncontiguous areas.

Circuit: A conductor or a system of conductors through which electric current flows.

Coal: A black or brownish-black solid combustible substance formed by the partial decomposition of vegetable matter without access to air. The rank of coal, which includes anthracite, bituminous coal, subbituminous coal, and lignite, is based on fixed carbon, volatile matter, and heating value. Coal rank indicates the progressive alteration from lignite to anthracite. Lignite contains approximately 9 to 17 million Btu per ton. The contents of subbituminous and bituminous coal range from 16 to 24 million Btu per ton and from 19 to 30 million Btu per ton, respectively. Anthracite contains approximately 22 to 28 million Btu per ton.

Cogenerator: A generating facility that produces electricity and another form of useful thermal energy (such as heat or steam), used for industrial, commercial, heating, or cooling purposes. To receive status as a qualifying facility (QF) under the Public Utility Regulatory Policies Act (PURPA), the facility must produce electric energy and "another form of useful thermal energy through the sequential use of energy," and meet certain ownership, operating, and efficiency criteria established by the Federal Energy Regulatory Commission (FERC). (See the Code of Federal Regulations, Title 18, Part 292.)

Coincidental Demand: The sum of two or more demands that occur in the same time interval.

Coincidental Peak Load: The sum of two or more peak loads that occur in the same time interval.

Coke (Petroleum): A residue high in carbon content and low in hydrogen that is the final product of thermal decomposition in the condensation process in cracking. This product is reported as marketable coke or catalyst coke. The conversion factor is 5 barrels (42 U.S. gallons each) per short ton.

Combined Cycle: An electric generating technology in which electricity is produced from otherwise lost waste heat exiting from one or more gas (combustion) turbines. The exiting heat is routed to a conventional boiler or to a heat recovery steam generator for utilization by a steam turbine in the production of electricity. This process increases the efficiency of the electric generating unit.

Combined Cycle Unit: An electric generating unit that consists of one or more combustion turbines and one or more boilers with a portion of the required energy input to the boiler(s) provided by the exhaust gas of the combustion turbine(s).

Combined Pumped-Storage Plant: A pumped-storage hydroelectric power plant that uses both pumped water and natural streamflow to produce electricity.

Commercial: The commercial sector is generally defined as nonmanufacturing business establishments, including hotels, motels, restaurants, wholesale businesses, retail stores, and health, social, and educational institutions. The utility may classify commercial service as all consumers whose demand or annual use exceeds some specified limit. The limit may be set by the utility based on the rate schedule of the utility.

Commercial Operation: Commercial operation begins when control of the loading of the generator is turned over to the system dispatcher.

Connection: The physical connection (e.g. transmission lines, transformers, switch gear, etc.) between two electric systems permitting the transfer of electric energy in one or both directions.

Conservation and Other DSM: This Demand-Side Management category represents the amount of consumer load reduction at the time of system peak due to utility programs that reduce consumer load during many hours of the year. Examples include utility rebate and shared savings activities for the installation of energy efficient appliances, lighting and electrical machinery, and weatherization materials. In addition, this category includes all other Demand-Side Management activities, such as thermal storage, time-of-use rates, fuel substitution, measurement and evaluation, and any other utility-administered Demand-Side Management activity designed to reduce demand and/or electricity use.

Construction Work In Progress (CWIP): The balance shown on a utility's balance sheet for construction work not yet completed but in process. This balance line item may or may not be included in the rate base.

Consumption (Fuel): The amount of fuel used for gross generation, providing standby service, start-up and/or flame stabilization.

Contract Price: Price of fuels marketed on a contract basis covering a period of 1 or more years. Contract prices reflect market conditions at the time the contract was negotiated and therefore remain constant throughout the life of the contract or are adjusted through escalation clauses. Generally, contract prices do not fluctuate widely.

Contract Receipts: Purchases based on a negotiated agreement that generally covers a period of 1 or more years.

Cooling System: Energy Efficiency program promotion aimed at improving the efficiency of the cooling delivery system, including replacement, in the residential, commercial, or industrial sectors.

Cooperative Electric Utility: An electric utility legally established to be owned by and operated for the benefit of those using its service. The utility company will generate, transmit, and/or distribute supplies of electric energy to a specified area not being serviced by another utility. Such ventures are generally exempt from Federal income tax laws. Most electric cooperatives have been initially financed by the Rural Electrification Administration, U.S. Department of Agriculture.

Cost: The amount paid to acquire resources, such as plant and equipment, fuel, or labor services.

Current (Electric): A flow of electrons in an electrical conductor. The strength or rate of movement of the electricity is measured in amperes.

Demand (Electric): The rate at which electric energy is delivered to or by a system, part of a system, or piece of equipment, at a given instant or averaged over any designated period of time.

Demand-Side Management: The planning, implementation, and monitoring of utility activities designed to encourage consumers to modify patterns of electricity usage, including the timing and level of electricity demand. It refers only to energy and load-shape modifying activities that are undertaken in response to utility-administered programs. It does not refer to energy and load-shape changes arising from the normal operation of the marketplace or from government-mandated energy-efficiency standards. Demand-Side Management (DSM) covers the complete range of load-shape objectives, including strategic conservation and load management, as well as strategic load growth.

Demand-Side Management Costs: The costs incurred by the utility to achieve the capacity and energy savings from the Demand-Side Management Program. Costs incurred by consumers or third parties are to be excluded. The costs are to be reported in nominal dollars in the year in which they are incurred, regardless of when the savings occur. Program costs include expensed items incurred to implement the

program, incentive payments provided to consumers to install Demand-Side Management measures, and annual operation and maintenance expenses incurred during the year. Utility costs that are general, administrative, or not specific to a particular Demand-Side Management category are to be included in "other" costs.

Direct Load Control: Refers to program activities that can interrupt consumer load at the time of annual peak load by direct control of the utility system operator by interrupting power supply to individual appliances or equipment on consumer premises. This type of control usually involves residential consumers. Direct Load Control excludes Interruptible Load and Other Load Management effects. (Direct Load Control, as defined here, is synonymous with Direct Load Control Management reported to the North American Electric Reliability Council on the voluntary Office of Energy Emergency Operations Form OE-411, "Coordinated Regional Bulk Power Supply Program Report," with the exception that annual peak load effects are reported here and seasonal (i.e., summer and winter) peak load effects are reported on the OE-411.)

Direct Utility Cost: A utility cost that is identified with one of the DSM program categories (i.e. Energy Efficiency, Direct Load Control, Interruptible Load, Other Load Management, Other DSM Programs, Load Building).

Distillate Fuel Oil: A general classification for one of the petroleum fractions produced in conventional distillation operations. It is used primarily for space heating, on-and-off-highway diesel engine fuel (including railroad engine fuel and fuel for agriculture machinery), and electric power generation. Included are Fuel Oils No. 1, No. 2, and No. 4; and Diesel Fuels No. 1, No. 2, and No. 4.

Distribution System: The portion of an electric system that is dedicated to delivering electric energy to an end user.

Diversity Exchange: An exchange of capacity or energy, or both, between systems whose peak loads occur at different times.

Electric Plant (Physical): A facility containing prime movers, electric generators, and auxiliary equipment for converting mechanical, chemical, and/or fission energy into electric energy.

Electric Rate Schedule: A statement of the electric rate and the terms and conditions governing its application, including attendant contract terms and conditions that have been accepted by a regulatory body with appropriate oversite authority.

Electric Utility: A corporation, person, agency, authority, or other legal entity or instrumentality that owns and/or operates facilities within the United States, its territories, or Puerto Rico for the generation, transmission, distribution, or sale of electric energy primarily for use by the public and files forms

listed in the Code of Federal Regulations, Title 18, Part 141. Facilities that qualify as cogenerators or small power producers under the Public Utility Regulatory Policies Act (PURPA) are not considered electric utilities.

Energy: The capacity for doing work as measured by the capability of doing work (potential energy) or the conversion of this capability to motion (kinetic energy). Energy has several forms, some of which are easily convertible and can be changed to another form useful for work. Most of the world's convertible energy comes from fossil fuels that are burned to produce heat that is then used as a transfer medium to mechanical or other means in order to accomplish tasks. Electrical energy is usually measured in kilowatthours, while heat energy is usually measured in British thermal units.

Energy Charge: That portion of the charge for electric service based upon the electric energy (kWh) consumed or billed.

Energy Deliveries: Energy generated by one electric utility system and delivered to another system through one or more transmission lines.

Energy Effects: The changes in aggregate electricity use (measured in megawatthours) for customers that participate in a utility DSM program. Energy Effects should represent changes at the consumer meter (i.e. exclude transmission and distribution effects) and reflect only activities that are undertaken specifically in response to utility-administered programs, including those activities implemented by third parties under contract to the utility. To the extent possible, Energy Effects should exclude non-program related effects such as changes in energy usage attributable to nonparticipants, government-mandated energy-efficiency standards that legislate improvements in building and appliance energy usage, changes in consumer behavior that result in greater energy use after initiation in a DSM program, the natural operations of the marketplace, and weather and business-cycle adjustments.

Energy Efficiency: Refers to programs that are aimed at reducing the energy used by specific end-use devices and systems, typically without affecting the services provided. These programs reduce overall electricity consumption (reported in megawatthours), often without explicit consideration for the timing of program-induced savings. Such savings are generally achieved by substituting technically more advanced equipment to produce the same level of end-use services (e.g. lighting, heating, motor drive) with less electricity. Examples include high-efficiency appliances, efficient lighting programs, high-efficiency heating, ventilating and air conditioning (HVAC) systems or control modifications, efficient building design, advanced electric motor drives, and heat recovery systems.

Energy Receipts: Energy generated by one electric utility system and received by another system through one or more transmission lines.

Energy Source: The primary source that provides the power that is converted to electricity through chemical, mechanical, or other means. Energy sources include coal, petroleum and petroleum products, gas, water, uranium, wind, sunlight, geothermal, and other sources.

Equity Capital: The sum of capital from retained earnings and the issuance of stocks.

Expenditure: The incurrence of a liability to obtain an asset or service.

Facility: An existing or planned location or site at which prime movers, electric generators, and/or equipment for converting mechanical, chemical, and/or nuclear energy into electric energy are situated, or will be situated. A facility may contain more than one generator of either the same or different prime mover type. For a cogenerator, the facility includes the industrial or commercial process.

Federal Energy Regulatory Commission (FERC): A quasi-independent regulatory agency within the Department of Energy having jurisdiction over interstate electricity sales, wholesale electric rates, hydroelectric licensing, natural gas pricing, oil pipeline rates, and gas pipeline certification.

Federal Power Act: Enacted in 1920, and amended in 1935, the Act consists of three parts. The first part incorporated the Federal Water Power Act administered by the former Federal Power Commission, whose activities were confined almost entirely to licensing non-Federal hydroelectric projects. Parts II and III were added with the passage of the Public Utility Act. These parts extended the Act's jurisdiction to include regulating the interstate transmission of electrical energy and rates for its sale as wholesale in interstate commerce. The Federal Energy Regulatory Commission is now charged with the administration of this law.

Federal Power Commission: The predecessor agency of the Federal Energy Regulatory Commission. The Federal Power Commission (FPC) was created by an Act of Congress under the Federal Water Power Act on June 10, 1920. It was charged originally with regulating the electric power and natural gas industries. The FPC was abolished on September 20, 1977, when the Department of Energy was created. The functions of the FPC were divided between the Department of Energy and the Federal Energy Regulatory Commission.

FERC: The Federal Energy Regulatory Commission.

Firm Gas: Gas sold on a continuous and generally long-term contract.

Firm Power: Power or power-producing capacity intended to be available at all times during the period covered by a guaranteed commitment to deliver, even under adverse conditions.

Flue Gas Desulfurization Unit (Scrubber): Equipment used to remove sulfur oxides from the com-

bustion gases of a boiler plant before discharge to the atmosphere. Chemicals, such as lime, are used as the scrubbing media.

Flue Gas Particulate Collectors: Equipment used to remove fly ash from the combustion gases of a boiler plant before discharge to the atmosphere. Particulate collectors include electrostatic precipitators, mechanical collectors (cyclones), fabric filters (baghouses), and wet scrubbers.

Fly Ash: Particulate matter from coal ash in which the particle diameter is less than 1×10^{-4} meter. This is removed from the flue gas using flue gas particulate collectors such as fabric filters and electrostatic precipitators.

Forced Outage: The shutdown of a generating unit, transmission line or other facility, for emergency reasons or a condition in which the generating equipment is unavailable for load due to unanticipated breakdown.

Fossil Fuel: Any naturally occurring organic fuel, such as petroleum, coal, and natural gas.

Fossil-Fuel Plant: A plant using coal, petroleum, or gas as its source of energy.

Fuel: Any substance that can be burned to produce heat; also, materials that can be fissioned in a chain reaction to produce heat.

Fuel Expenses: These costs include the fuel used in the production of steam or driving another prime mover for the generation of electricity. Other associated expenses include unloading the shipped fuel and all handling of the fuel up to the point where it enters the first bunker, hopper, bucket, tank, or holder in the boiler-house structure.

Full-Forced Outage: The net capability of main generating units that is unavailable for load for emergency reasons.

Gas: A fuel burned under boilers and by internal combustion engines for electric generation. These include natural, manufactured and waste gas.

Gas Turbine Plant: A plant in which the prime mover is a gas turbine. A gas turbine consists typically of an axial-flow air compressor, one or more combustion chambers, where liquid or gaseous fuel is burned and the hot gases are passed to the turbine and where the hot gases expand to drive the generator and are then used to run the compressor.

Generating Unit: Any combination of physically connected generator(s), reactor(s), boiler(s), combustion turbine(s), or other prime mover(s) operated together to produce electric power.

Generation (Electricity): The process of producing electric energy by transforming other forms of energy; also, the amount of electric energy produced, expressed in watthours (Wh).

Gross Generation: The total amount of electric energy produced by the generating units at a generating station or stations, measured at the generator terminals.

Net Generation: Gross generation less the electric energy consumed at the generating station for station use.

Generator: A machine that converts mechanical energy into electrical energy.

Generator Nameplate Capacity: The full-load continuous rating of a generator, prime mover, or other electric power production equipment under specific conditions as designated by the manufacturer. Installed generator nameplate rating is usually indicated on a nameplate physically attached to the generator.

Geothermal Plant: A plant in which the prime mover is a steam turbine. The turbine is driven either by steam produced from hot water or by natural steam that derives its energy from heat found in rocks or fluids at various depths beneath the surface of the earth. The energy is extracted by drilling and/or pumping.

Gigawatt (GW): One billion watts.

Gigawatthour (GWh): One billion watthours.

Greenhouse Effect: The increasing mean global surface temperature of the earth caused by gases in the atmosphere (including carbon dioxide, methane, nitrous oxide, ozone, and chlorofluorocarbon). The greenhouse effect allows solar radiation to penetrate but absorbs the infrared radiation returning to space.

Grid: The layout of an electrical distribution system.

Gross Generation: The total amount of electric energy produced by a generating facility, as measured at the generator terminals.

Heating System: Energy Efficiency program promotion aimed at improving the efficiency of the heating delivery system, including replacement, in the residential, commercial, or industrial sectors.

Heavy Oil: The fuel oils remaining after the lighter oils have been distilled off during the refining process. Except for start-up and flame stabilization, virtually all petroleum used in steam plants is heavy oil.

Hydroelectric Plant: A plant in which the turbine generators are driven by falling water.

Incremental Effects: The annual effects in energy use (measured in megawatthours) and peak load (measured in kilowatts) caused by new participants in existing DSM programs and all participants in new DSM programs during a given year. Reported Incremental Effects should be annualized to indicate the program effects that would have occurred had these participants been initiated into the program on January 1 of the given year. Incremental effects are

not simply the Annual Effects of a given year minus the Annual Effects of the prior year, since these net effects would fail to account for program attrition, degradation, demolition, and participant dropouts.

Indirect Utility Cost: A utility cost that may not be meaningfully identified with any particular DSM program category. Indirect costs could be attributable to one of several accounting cost categories (i.e., Administrative, Marketing, Monitoring & Evaluation, Utility-Earned Incentives, Other). Accounting costs that are known DSM program costs should not be reported under Indirect Utility Cost, rather those costs should be reported as Direct Utility Costs under the appropriate DSM program category.

Industrial: The industrial sector is generally defined as manufacturing, construction, mining agriculture, fishing and forestry establishments Standard Industrial Classification (SIC) codes 01-39. The utility may classify industrial service using the SIC codes, or based on demand or annual usage exceeding some specified limit. The limit may be set by the utility based on the rate schedule of the utility.

Inoperable Capacity: Utility-owned or operated capacity that is totally or partially out of service for reasons such as: environmental restrictions, legal or regulatory restrictions, extensive modifications or repair, or capacity specified as being in a mothballed state.

Interdepartmental Service (Electric): Interdepartmental service includes amounts charged by the electric department at tariff or other specified rates for electricity supplied by it to other utility departments.

Intermediate Load (Electric System): The range from base load to a point between base load and peak. This point may be the midpoint, a percent of the peak load, or the load over a specified time period.

Internal Combustion Plant: A plant in which the prime mover is an internal combustion engine. An internal combustion engine has one or more cylinders in which the process of combustion takes place, converting energy released from the rapid burning of a fuel-air mixture into mechanical energy. Diesel or gas-fired engines are the principal types used in electric plants. The plant is usually operated during periods of high demand for electricity.

Internal Demand: Peak hour integrated megawatt demand is defined as the sum of the demands of all customers that a system serves, including the demands of the organization providing the electric service, plus the losses incidental to that service. Total Internal Demand is the sum of the metered (net) outputs of all generators within the system and the metered line flows into the system, less the metered line flows out of the system. The demand of station service or auxiliary needs (such as fan motors, pump motors, and other equipment essential to the operation of the generating units) is not included.

Internal Demand includes adjustments for utility indirect demand-side management programs such as con-

servation programs, improvements in efficiency of electric energy use, rate incentives, and rebates. Internal Demand should not be reduced by Direct Control Load Management or Interruptible Demand.

Interruptible Demand: The magnitude of customer demand that, in accordance with contractual arrangements, can be interrupted at the time of the NERC Council or Reporting Party seasonal peak by direct control of the System Operator or by action of the customer at the direct request of the System Operator. In some instances, the demand reduction may be effected by direct action of the System Operator (remote tripping) after notice to the customer in accordance with contractual provisions. For example, demands that can be interrupted to fulfill planning or operating reserve requirements normally should be reported as Interruptible Demand. Interruptible Demand as reported here does not include Direct Control Load Management.

Interruptible Gas: Gas sold to customers with a provision that permits curtailment or cessation of service at the discretion of the distributing company under certain circumstances, as specified in the service contract.

Interruptible Load: Refers to program activities that, in accordance with contractual arrangements, can interrupt consumer load at times of seasonal peak load by direct control of the utility system operator or by action of the consumer at the direct request of the system operator. It usually involves commercial and industrial consumers. In some instances the load reduction may be affected by direct action of the system operator (remote tripping) after notice to the consumer in accordance with contractual provisions. For example, loads that can be interrupted to fulfill planning or operation reserve requirements should be reported as Interruptible Load. Interruptible Load as defined here excludes Direct Load Control and Other Load Management. (Interruptible Load, as reported here, is synonymous with Interruptible Demand reported to the North American Electric Reliability Council on the voluntary Office of Energy Emergency Operations Form OE-411, "Coordinated Regional Bulk Power Supply Program Report," with the exception that annual peak load effects are reported on the Form EIA-861 and seasonal (i.e., summer and winter) peak load effects are reported on the OE-411).

Kilowatt (kW): One thousand watts.

Kilowatthour (kWh): One thousand watthours.

Leverage Ratio: A measure that indicates the financial ability to meet debt service requirements and increase the value of the investment to the stockholders. (i.e. the ratio of total debt to total assets).

Liability: An amount payable in dollars or by future services to be rendered.

Light Oil: Lighter fuel oils distilled off during the refining process. Virtually all petroleum used in internal combustion and gas-turbine engines is light oil.

Lignite: A brownish-black coal of low rank with high inherent moisture and volatile matter (used almost exclusively for electric power generation). It is also referred to as brown coal. Comprises two groups classified according to the following ASTM Specification D388-84 for calorific values on a moist material-matter-free basis:

	Limits Btu/lb.	
	GE	LT
Lignite A	6300	8300
Lignite B	-	6300

Load (Electric): The amount of electric power delivered or required at any specific point or points on a system. The requirement originates at the energy-consuming equipment of the consumers.

Load Building: Refers to programs that are aimed at increasing the usage of existing electric equipment or the addition of electric equipment. Examples include industrial technologies such as induction heating and melting, direct arc furnaces and infrared drying; cooking for commercial establishments; and heat pumps for residences. Load Building should include programs that promote electric fuel substitution. Load Building effects should be reported as a negative number, shown with a minus sign.

Marketing Cost: Expenses directly associated with the preparation and implementation of the strategies designed to encourage participation in a DSM program. The category excludes general market and load research costs.

Monitoring & Evaluation Cost: Expenditures associated with the planning, collection, and analysis of data used to assess program operation and effects. It includes the activities such as load metering, customer surveys, new technology testing, and program evaluations that are intended to establish or improve the ability to monitor and evaluate the impacts of DSM programs, collectively or individually.

Maximum Demand: The greatest of all demands of the load that has occurred within a specified period of time.

Mcf: One thousand cubic feet.

Megawatt (MW): One million watts.

Megawatthour (MWh): One million watthours.

MMcf: One million cubic feet.

Natural Gas: A naturally occurring mixture of hydrocarbon and nonhydrocarbon gases found in porous geological formations beneath the earth's surface, often in association with petroleum. The principal constituent is methane.

Net Capability: The maximum load-carrying ability of the equipment, exclusive of station use, under spec-

ified conditions for a given time interval, independent of the characteristics of the load. (Capability is determined by design characteristics, physical conditions, adequacy of prime mover, energy supply, and operating limitations such as cooling and circulating water supply and temperature, headwater and tailwater elevations, and electrical use.)

Net Generation: Gross generation minus plant use from all electric utility owned plants. The energy required for pumping at a pumped-storage plant is regarded as plant use and must be deducted from the gross generation.

Net Internal Demand: Internal Demand less Direct Control Load Management and Interruptible Demand.

Net Summer Capability: The steady hourly output, which generating equipment is expected to supply to system load exclusive of auxiliary power, as demonstrated by tests at the time of summer peak demand.

Net Winter Capability: The steady hourly output which generating equipment is expected to supply to system load exclusive of auxiliary power, as demonstrated by tests at the time of winter peak demand.

New Construction: Energy-efficiency program promotion to encourage the building of new homes, buildings, and plants to exceed standard government-mandated energy efficiency codes; it may include major renovations of existing facilities.

Noncoincidental Peak Load: The sum of two or more peak loads on individual systems that do not occur in the same time interval. Meaningful only when considering loads within a limited period of time, such as a day, week, month, a heating or cooling season, and usually for not more than 1 year.

Non-Firm Power: Power or power-producing capacity supplied or available under a commitment having limited or no assured availability.

Nonutility Power Producer: A corporation, person, agency, authority, or other legal entity or instrumentality that owns electric generating capacity and is not an electric utility. Nonutility power producers include qualifying cogenerators, qualifying small power producers, and other nonutility generators (including independent power producers) without a designated franchised service area, and which do not file forms listed in the Code of Federal Regulations, Title 18, Part 141.

North American Electric Reliability Council (NERC): A council formed in 1968 by the electric utility industry to promote the reliability and adequacy of bulk power supply in the electric utility systems of North America. NERC consists of ten regional reliability councils and encompasses essentially all the power regional of the contiguous United States, Canada, and Mexico. The NERC Regions are:

ASCC - Alaskan System Coordination Council

ECAR - East Central Area Reliability Coordination Agreement

ERCOT - Electric Reliability Council of Texas

MAIN - Mid-America Interconnected Network

MAAC - Mid-Atlantic Area Council

MAPP - Mid-Continent Area Power Pool

NPCC - Northeast Power Coordinating Council

SERC - Southeastern Electric Reliability Council

SPP - Southwest Power Pool

WSCC - Western Systems Coordinating Council

Nuclear Fuel: Fissionable materials that have been enriched to such a composition that, when placed in a nuclear reactor, will support a self-sustaining fission chain reaction, producing heat in a controlled manner for process use.

Nuclear Power Plant: A facility in which heat produced in a reactor by the fissioning of nuclear fuel is used to drive a steam turbine.

Off-Peak Gas: Gas that is to be delivered and taken on demand when demand is not at its peak.

Ohm: The unit of measurement of electrical resistance. The resistance of a circuit in which a potential difference of 1 volt produces a current of 1 ampere.

Operable Nuclear Unit: A nuclear unit is "operable" after it completes low-power testing and is granted authorization to operate at full power. This occurs when it receives its full power amendment to its operating license from the Nuclear Regulatory Commission.

Other Cost: A residual category to capture the Indirect Costs of DSM programs that cannot be meaningfully included in any of the other cost categories listed and defined herein. Included are costs such as those incurred in the research and development of DSM technologies.

Other DSM Programs: A residual category to capture the effects of DSM programs that cannot be meaningfully included in any of the program categories listed and defined herein. The energy effects attributable to this category should be the net effects of all the residual programs. Programs that promote consumer's substitution of electricity by other energy types should be included in Other DSM Programs. Also, self-generation should be included in Other DSM Programs to the extent that it is not accounted for as backup generation in Other Load Management or Interruptible Load categories.

Other Incentives: Energy Efficiency programs that offer cash or noncash awards to electric energy efficiency deliverers, such as appliance and equipment dealers, building contractors, and architectural and engineering firms, that encourage consumer participation in a DSM program and adoption of recommended measures.

Other Load Management: Refers to programs other than Direct Load Control and Interruptible Load that limit or shift peak load from on-peak to off-peak time

periods. It includes technologies that primarily shift all or part of a load from one time-of-day to another and secondarily may have an impact on energy consumption. Examples include space heating and water heating storage systems, cool storage systems, and load limiting devices in energy management systems. This category also includes programs that aggressively promote time-of-use (TOU) rates and other innovative rates such as real time pricing. These rates are intended to reduce consumer bills and shift hours of operation of equipment from on-peak to off-peak periods through the application of time-differentiated rates.

Outage: The period during which a generating unit, transmission line, or other facility is out of service.

Peak Demand: The maximum load during a specified period of time.

Peak Load Plant: A plant usually housing old, low-efficiency steam units; gas turbines; diesels; or pumped-storage hydroelectric equipment normally used during the peak-load periods.

Peaking Capacity: Capacity of generating equipment normally reserved for operation during the hours of highest daily, weekly, or seasonal loads. Some generating equipment may be operated at certain times as peaking capacity and at other times to serve loads on an around-the-clock basis.

Percent Difference: The relative change in a quantity over a specified time period. It is calculated as follows: the current value has the previous value subtracted from it; this new number is divided by the absolute value of the previous value; then this new number is multiplied by 100.

Petroleum: A mixture of hydrocarbons existing in the liquid state found in natural underground reservoirs, often associated with gas. Petroleum includes fuel oil No. 2, No. 4, No. 5, No. 6; topped crude; Kerosene; and jet fuel.

Petroleum Coke: See Coke (Petroleum).

Petroleum (Crude Oil): A naturally occurring, oily, flammable liquid composed principally of hydrocarbons. Crude oil is occasionally found in springs or pools but usually is drilled from wells beneath the earth's surface.

Planned Capacity Resources: Utility- and IPP-owned generating capacity that is existing or in various stages of planning or construction, less inoperable capacity, plus planned capacity purchases from other resources, less planned capacity sales.

Planned Generator: A proposal by a company to install electric generating equipment at an existing or planned facility or site. The proposal is based on the owner having obtained (1) all environmental and regulatory approvals, (2) a signed contract for the electric energy, or (3) financial closure for the facility.

Plant: A facility at which are located prime movers, electric generators, and auxiliary equipment for converting mechanical, chemical, and/or nuclear energy into electric energy. A plant may contain more than one type of prime mover. Electric utility plants exclude facilities that satisfy the definition of a qualifying facility under the Public Utility Regulatory Policies Act of 1978.

Plant Use: The electric energy used in the operation of a plant. Included in this definition is the energy required for pumping at pumped-storage plants.

Plant-Use Electricity: The electric energy used in the operation of a plant. This energy total is subtracted from the gross energy production of the plant; for reporting purposes the plant energy production is then reported as a net figure. The energy required for pumping at pumped-storage plants is, by definition, subtracted, and the energy production for these plants is then reported as a net figure.

Potential Peak Reduction: The potential annual peak load reduction (measured in kilowatts) that can be deployed from Direct Load Control, Interruptible Load, Other Load Management, and Other DSM Program activities. It represents the load that can be reduced either by the direct control of the utility system operator or by the consumer in response to a utility request to curtail load. It reflects the installed load reduction capability, as opposed to the Actual Peak Reduction achieved by participants, during the time of annual system peak load.

Power: The rate at which energy is transferred. Electrical energy is usually measured in watts. Also used for a measurement of capacity.

Power Pool: An association of two or more interconnected electric systems having an agreement to coordinate operations and planning for improved reliability and efficiencies.

Power Marketers: Power marketers are business entities engaged in buying and selling electricity, but do not own generating or transmission facilities. Power marketers, as opposed to Brokers, take ownership of the electricity and are involved in interstate trade. These entities file with FERC for status as a power marketer.

Price: The amount of money or consideration-in-kind for which a service is bought, sold, or offered for sale.

Prime Mover: The engine, turbine, water wheel, or similar machine that drives an electric generator; or, for reporting purposes, a device that converts energy to electricity directly (e.g., photovoltaic solar and fuel cell(s)).

Process Heating: Energy Efficiency program promotion of increased electric energy efficiency applications in industrial process heating.

Profit: The income remaining after all business expenses are paid.

Public Authority Service to Public Authorities: Public authority service includes electricity supplied and services rendered to municipalities or divisions or agencies of State or Federal governments, under special contracts or agreements or service classifications applicable only to public authorities.

Public Street and Highway Lighting: Public street and highway lighting includes electricity supplied and services rendered for the purposes of lighting streets, highways, parks, and other public places; or for traffic or other signal system service, for municipalities, or other divisions or agencies of State or Federal governments.

Pumped-Storage Hydroelectric Plant: A plant that usually generates electric energy during peak-load periods by using water previously pumped into an elevated storage reservoir during off-peak periods when excess generating capacity is available to do so. When additional generating capacity is needed, the water can be released from the reservoir through a conduit to turbine generators located in a power plant at a lower level.

Purchased Power Adjustment: A clause in a rate schedule that provides for adjustments to the bill when energy from another electric system is acquired and it varies from a specified unit base amount.

Pure Pumped-Storage Hydroelectric Plant: A plant that produces power only from water that has previously been pumped to an upper reservoir.

Qualifying Facility (QF): A cogeneration or small power production facility that meets certain ownership, operating, and efficiency criteria established by the Federal Energy Regulatory Commission (FERC) pursuant to the Public Utility Regulatory Policies Act (PURPA). (See the Code of Federal Regulations, Title 18, Part 292.) Part 292.

Railroad and Railway Services: Railroad and railway services include electricity supplied and services rendered to railroads and interurban and street railways, for general railroad use, including the propulsion of cars or locomotives, where such electricity is supplied under separate and distinct rate schedules.

Rate Base: The value of property upon which a utility is permitted to earn a specified rate of return as established by a regulatory authority. The rate base generally represents the value of property used by the utility in providing service and may be calculated by any one or a combination of the following accounting methods: fair value, prudent investment, reproduction cost, or original cost. Depending on which method is used, the rate base includes cash, working capital, materials and supplies, and deductions for accumulated provisions for depreciation, contributions in aid of construction, customer advances for construction, accumulated deferred income taxes, and accumulated deferred investment tax credits.

Ratemaking Authority: A utility commission's legal authority to fix, modify, approve, or disapprove rates,

as determined by the powers given the commission by a State or Federal legislature.

Receipts: Purchases of fuel.

Regulation: The governmental function of controlling or directing economic entities through the process of rulemaking and adjudication.

Reserve Margin (Operating): The amount of unused available capability of an electric power system at peak load for a utility system as a percentage of total capability.

Residential: The residential sector is defined as private household establishments which consume energy primarily for space heating, water heating, air conditioning, lighting, refrigeration, cooking and clothes drying. The classification of an individual consumer's account, where the use is both residential and commercial, is based on principal use. For the residential class, do not duplicate consumer accounts due to multiple metering for special services (water, heating, etc.). Apartment houses are also included.

Residual Fuel Oil: The topped crude of refinery operation, includes No. 5 and No. 6 fuel oils as defined in ASTM Specification D396 and Federal Specification VV-F-815C; Navy Special fuel oil as defined in Military Specification MIL-F-859E including Amendment 2 (NATO Symbol F-77); and Bunker C fuel oil. Residual fuel oil is used for the production of electric power, space heating, vessel bunkering, and various industrial purposes. Imports of residual fuel oil include imported crude oil burned as fuel.

Restricted-Universe Census: This is the complete enumeration of data from a specifically defined subset of entities including, for example, those that exceed a given level of sales or generator nameplate capacity.

Retail: Sales covering electrical energy supplied for residential, commercial, and industrial end-use purposes. Other small classes, such as agriculture and street lighting, also are included in this category.

Revenue: The total amount of money received by a firm from sales of its products and/or services, gains from the sales or exchange of assets, interest and dividends earned on investments, and other increases in the owner's equity except those arising from capital adjustments.

Running and Quick-Start Capability: The net capability of generating units that carry load or have quick-start capability. In general, quick-start capability refers to generating units that can be available for load within a 30-minute period.

Sales: The amount of kilowatthours sold in a given period of time; usually grouped by classes of service, such as residential, commercial, industrial, and other. Other sales include public street and highway lighting, other sales to public authorities and railways, and interdepartmental sales.

Sales for Resale: Energy supplied to other electric utilities, cooperatives, municipalities, and Federal and State electric agencies for resale to ultimate consumers.

Scheduled Outage: The shutdown of a generating unit, transmission line, or other facility, for inspection or maintenance, in accordance with an advance schedule.

Short Ton: A unit of weight equal to 2,000 pounds.

Small Power Producer (SPP): Under the Public Utility Regulatory Policies Act (PURPA), a small power production facility (or small power producer) generates electricity using waste, renewable (water, wind and solar), or geothermal energy as a primary energy source. Fossil fuels can be used, but renewable resource must provide at least 75 percent of the total energy input. (See Code of Federal Regulations, Title 18, Part 292.)

Spinning Reserve: That reserve generating capacity running at a zero load and synchronized to the electric system.

Spot Purchases: A single shipment of fuel or volumes of fuel, purchased for delivery within 1 year. Spot purchases are often made by a user to fulfill a certain portion of energy requirements, to meet unanticipated energy needs, or to take advantage of low-fuel prices.

Stability: The property of a system or element by virtue of which its output will ultimately attain a steady state. The amount of power that can be transferred from one machine to another following a disturbance. The stability of a power system is its ability to develop restoring forces equal to or greater than the disturbing forces so as to maintain a state of equilibrium.

Standard Industrial Classification (SIC): A set of codes developed by the Office of Management and Budget, which categorizes business into groups with similar economic activities.

Standby Demand: The Demand specified by contractual arrangement with a customer to provide power and energy to that customer as a secondary source or backup for an outage of the customer's primary source. Standby Demand is intended to be used infrequently by any one customer.

Standby Facility: A facility that supports a utility system and is generally running under no-load. It is available to replace or supplement a facility normally in service.

Standby Service: Support service that is available, as needed, to supplement a consumer, a utility system, or to another utility if a schedule or an agreement authorizes the transaction. The service is not regularly used.

Steam-Electric Plant (Conventional): A plant in which the prime mover is a steam turbine. The steam

used to drive the turbine is produced in a boiler where fossil fuels are burned.

Stocks: A supply of fuel accumulated for future use. This includes coal and fuel oil stocks at the plant site, in coal cars, tanks, or barges at the plant site, or at separate storage sites.

Subbituminous Coal: Subbituminous coal, or black lignite, is dull black and generally contains 20 to 30 percent moisture. The heat content of subbituminous coal ranges from 16 to 24 million Btu per ton as received and averages about 18 million Btu per ton. Subbituminous coal, mined in the western coal fields, is used for generating electricity and space heating.

Substation: Facility equipment that switches, changes, or regulates electric voltage.

Sulfur: One of the elements present in varying quantities in coal which contributes to environmental degradation when coal is burned. In terms of sulfur content by weight, coal is generally classified as low (less than or equal to 1 percent), medium (greater than 1 percent and less than or equal to 3 percent), and high (greater than 3 percent). Sulfur content is measured as a percent by weight of coal on an "as received" or a "dry" (moisture-free, usually part of a laboratory analysis) basis.

Switching Station: Facility equipment used to tie together two or more electric circuits through switches. The switches are selectively arranged to permit a circuit to be disconnected, or to change the electric connection between the circuits.

System (Electric): Physically connected generation, transmission, and distribution facilities operated as an integrated unit under one central management, or operating supervision.

Total DSM Cost: Refers to the sum of total utility cost and nonutility cost.

Total DSM Programs: Refers to the total net effects of all the utility's DSM programs. For the purpose of this survey, it is the sum of the effects for Energy Efficiency, Direct Load Control, Interruptible Load, Other Load Management, Other DSM Programs, and Load Building. Net growth in energy or load effects should be reported as a negative number, shown with a minus sign.

Total Nonutility Cost: Refers to total cash expenditures incurred by consumers and trade allies that are associated with participation in a DSM program, but that are not reimbursed by the utility. The nonutility expenditures should include only those additional costs necessary to purchase or install an efficient measure relative to a less efficient one. Costs are to be reported in nominal dollars in the year in which they are incurred, regardless of when the actual effects occur. To the extent possible, provide the best estimate of nonutility costs if actual costs are unavailable.

Total Utility Cost: Refers to the sum of the total Direct and Indirect Utility Costs for the year. Utility costs should reflect the total cash expenditures for the year, reported in nominal dollars, that flowed out to support DSM programs. They should be reported in the year they are incurred, regardless of when the actual effects occur.

Transformer: An electrical device for changing the voltage of alternating current.

Transmission: The movement or transfer of electric energy over an interconnected group of lines and associated equipment between points of supply and points at which it is transformed for delivery to consumers, or is delivered to other electric systems. Transmission is considered to end when the energy is transformed for distribution to the consumer.

Transmission System (Electric): An interconnected group of electric transmission lines and associated equipment for moving or transferring electric energy in bulk between points of supply and points at which it is transformed for delivery over the distribution system lines to consumers, or is delivered to other electric systems.

Turbine: A machine for generating rotary mechanical power from the energy of a stream of fluid (such as water, steam, or hot gas). Turbines convert the kinetic energy of fluids to mechanical energy through the principles of impulse and reaction, or a mixture of the two.

Uniform System of Accounts: Prescribed financial rules and regulations established by the Federal Energy Regulatory Commission for utilities subject to its jurisdiction under the authority granted by the Federal Power Act.

Useful Thermal Output: The thermal energy made available for use in any industrial or commercial process, or used in any heating or cooling application, i.e., total thermal energy made available for processes and applications other than electrical generation.

Utility-Earned Incentives: Costs in the form of incentives paid to the utility for achievement in consumer participation in DSM programs. These financial incentives are intended to influence the utility's consideration of DSM as a resource option by addressing cost recovery, lost revenue, and profitability.

Voltage Reduction: Any intentional reduction of system voltage by 3 percent or greater for reasons of maintaining the continuity of service of the bulk electric power supply system.

Water Heating: Energy Efficiency program promotion to increase efficiency in water heating, including low-flow shower heads and water heater insulation wraps. Could be applicable to residential, commercial, or industrial consumer sectors.

Watt: The electrical unit of power. The rate of energy transfer equivalent to 1 ampere flowing under a pressure of 1 volt at unity power factor.

Watthour (Wh): An electrical energy unit of measure equal to 1 watt of power supplied to, or taken from, an electric circuit steadily for 1 hour.

Wheeling Service: The movement of electricity from one system to another over transmission facilities of intervening systems. Wheeling service contracts can be established between two or more systems.

Wholesale Sales: Energy supplied to other electric utilities, cooperatives, municipals, and Federal and State electric agencies for resale to ultimate consumers.