

LARGE SCALE SODIUM INTERACTIONS

Part 2: Preliminary Test Results for Limestone Concrete*

by

J. E. Smaardyk
H. J. Sutherland
D. L. King
D. A. Dahlgren

Sandia Laboratories
Albuquerque, New Mexico 87115

Any sodium cooled reactor system must consider the interaction of hot sodium with cell liners, and given either a failed liner or a hypothetical core disruptive accident, the interaction of hot sodium with concrete. The data base available for safety assessments involving these interactions is limited, especially for the concrete and failed liner interactions. To better understand what happens when hot sodium comes in contact with concrete, a series of tests is being carried out to investigate sodium concrete reactions under conditions which are similar to actual reactor accident conditions. Tests cover the cases of sodium spills on bare concrete and on cells with defective steel liners. Specific objectives have been to obtain a complete description of the sodium/concrete interaction including heat balance, gas evolution and flow, movement and heat generation of the reaction zone, reaction product formation and the layering or movement of the products.

NOTICE
This report was prepared as an account of work sponsored by the United States Government. Neither the United States nor the United States Energy Research and Development Administration, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.

*Work is supported by the U. S. Nuclear Regulatory Commission.

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency Thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

DISCLAIMER

Portions of this document may be illegible in electronic image products. Images are produced from the best available original document.

To meet these objectives, emphasis is being placed on the following measurements:

1. Measurement of the temperature profile of the concrete crucible as well as the temperature of the sodium pool and vapor.
2. Measurement of the quantity and composition of the gases evolved from the sodium concrete reactions as a function of time.
3. Measurement of the penetration rate and total penetration of the reaction zone into the concrete for sodium drops while varying the initial temperature.
4. Identification of the effects of specific engineering features such as the presence of cracks and steel reinforcement on the penetration of sodium into the concrete crucible.
5. Identification of the effects when sodium flows into the vent space between the concrete and its steel liner.

The concrete for this test series meets the current concrete specifications obtained from the Clinch River Breeder Reactor Plant (CRBRP) project and was mixed from raw materials obtained from CRBRP site sources.

Several tests of this series have now been completed. For each test, up to 100 Kg of sodium is first heated to 550C in a separate tank. The sodium is then dumped rapidly (less than 10 seconds) into an instrumented concrete crucible. Fig. 1 shows the approximate locations of the instrumentation transducers. The initial sodium depth in the crucible was 86.36 mm.

Based on the tests completed, the reaction is reasonably quiescent for about 5 minutes. During this time the sodium pool cools to about 450C. Then, the sodium/concrete reaction is sufficiently exothermic to heat the reaction pool to about 800 C (compared to the boiling temperature of sodium of approximately 860C at atmospheric pressure of 83426 N/m^2) is about 10 minutes. The pool

temperature remains relatively stable at about 800C for a period of time then cools gradually to ambient.

During a test, reports are heard periodically, followed by the expulsion of gas. It appears that these reports are due to the concrete spalling and the resulting gas from the reaction of the fresh concrete exposed to sodium.

On post test examination the reaction debris consisted of hard, irregularly surfaced material which was difficult to break. The debris appeared to consist of two phases: (1) a light gray material (concrete) and (2) a dark material resembling fused slag. The light gray material was dispersed throughout the black "slag" in layers. The maximum penetration of the reaction into the concrete was about equal to the initial sodium depth in the crucible. Also, in several tests, an annular region of broken-up concrete (without any traces of reaction products) was found underneath the layer of slag-like material. Since there are no reaction products present, it appears that this concrete damage is due to unrelieved thermal stresses present after the sodium-concrete reaction was completed.

Thermal stresses in the crucible during the reaction were strong enough to cause radial cracking of the crucible. These cracks were independent of pre-existing cracks. Slight water leakage from these cracks at the outside edge of the crucible was noted in the oxide layer on the test chamber floor.

In conclusion, several tests have been conducted. Up to 100 Kg of sodium at 550 C has been rapidly dumped into a limestone aggregate concrete creating a sodium pool 86.36 mm deep. The resulting sodium/concrete reaction was sufficiently exothermic to raise the temperature of the reaction pool to about 800C. The erosion of concrete appeared to occur in discrete steps due to spalling. In addition, in the large diameter crucible there appeared to be thermal stress damage to the concrete after the sodium/concrete reaction was completed.

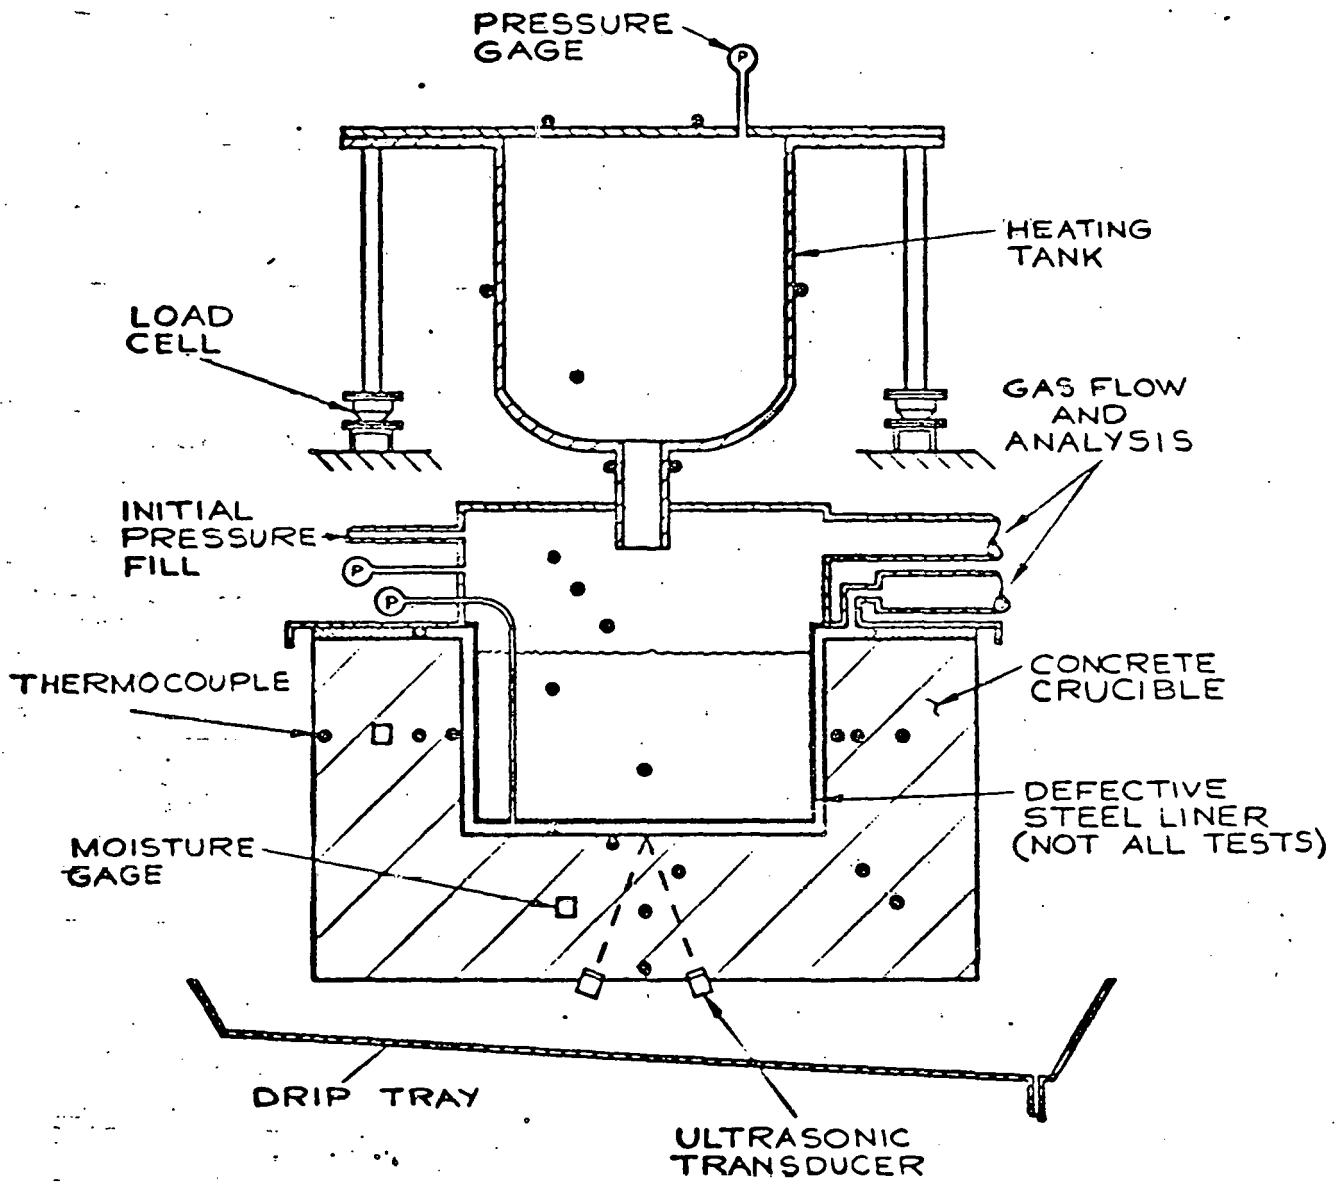


Fig. 1. Test configuration showing the approximate locations of the instrumentation transducers.

FILING AND MAILING INFORMATION

Name and full mailing address of author to whom correspondence should be sent. (Type or print legibly - form used for mailing.)

LOG # _____

J. E. Smaardyk
Organization 5167
Sandia Laboratories
Albuquerque, NM 87115

Telephone:
Commercial: (505) 264-1187
FTS: 475-1187

Title of Summary Large Scale Sodium Interactions
- Part 2: Preliminary Test Results for Limestone Concrete

This is to acknowledge receipt of your summary. Please use the log number above in future correspondence.

This summary will be considered for inclusion in the program of the American Nuclear Society's 1977 Winter Meeting, San Francisco, CA, Nov. 27 - Dec. 2, 1977. Another copy of this form will be sent to you about August 7, 1977 informing you of the Program Committee action.

Your paper has been reviewed and:

- 1. Accepted for presentation at the 1977 Winter Meeting. (See Attached Instructions)
- 2. It is suggested that your summary be revised. (See Attachment)
- 3. It is suggested that your summary be combined with the summary referenced as Log # _____ (See Attachment)
- 4. Rejected. (See Attached Comments)

In all correspondence regarding your summary, please refer to the Log Number shown above.

Thank you for submitting this summary.

Sincerely,

Dennis A. Bitz
ANS Technical Program Chairman
1977 Winter Meeting

SUMMARY COVER SHEET

CONTRIBUTED PAPER

INVITED PAPER

FOUR COPIES REQUIRED

MASTER

TITLE: Large Scale Sodium Interactions

Part 2: Preliminary Test Results for Limestone Concrete

AUTHOR(S): (List authors in the proper order and exactly as they are to be published. PLACE AN ASTERISK AFTER EACH AUTHOR WHO IS AN ANS MEMBER; AN "S" AFTER STUDENT AUTHOR.)

1. J. E. Smaardyk
2. H. J. Sutherland
3. D. L. King
4. D. A. Dahlgren*

CONF-791109-457

AFFILIATION(S): (List corresponding author's affiliation and complete mailing address.)

1. Sandia Laboratories, Organization 5167, Albuquerque, New Mexico 87115
2. Sandia Laboratories, Organization 5167, Albuquerque, New Mexico 87115
3. Sandia Laboratories, Organization 9337, Albuquerque, New Mexico 87115
4. Sandia Laboratories, Organization 5411, Albuquerque, New Mexico 87115

Indicate number of author to whom correspondence should be addressed 1, and complete page 4.

To whom should the page charge be billed? Sandia Laboratories

Attach purchase order with appropriate purchase order number to original copy of the summary.

FOR CONTRIBUTED SUMMARY:

Identify ANS Division or Technical Group having cognizance of your subject Nuclear Reactor Safety

In which subject category (from page 3) do you feel this summary belongs? 10.1

Alternative Category: _____

Has the substance of this summary been presented or published previously (including U. S. ERDA or equivalent reports)?

YES

NO

Give details _____

Has the paper been submitted for publication in a technical journal?

YES

NO

Give details _____

Have you presented related papers?

YES

NO

Give details Sandia Quarterly Reports to NRC

Has this summary been approved for publication by your institution or company?

YES

NO

Give details Management, Classification and Patent Reviews.

FOR INVITED SUMMARY:

Which ANS Division or Technical Group invited you? _____

Person who invited you _____

Session No. _____

FOR CONTRIBUTED OR INVITED SUMMARY:

Number of: Pages _____

Tables 0

Figures 1

Word Count: Text 708

+ (No. of figures plus tables) x 150 150

+ (No. of lines of equations x 10) 0

Total 858

Original line drawings or glossy black-and-white prints of each figure or table must be attached to original.

A COMPLETED SUMMARY COVER SHEET, TOGETHER WITH THE INFORMATION REQUESTED ON PAGE 4, MUST BE ATTACHED TO EACH OF THE FOUR COPIES OF THE SUMMARY. Please have copies made to complete your four copies.