

## ENGINEERING CHANGE NOTICE

Page 1 of 21. ECN 663357  
Proj. ECN

2. ECN Category (mark one)	3. Originator's Name, Organization, MSIN, and Telephone No.	4. USQ Required?	5. Date
Supplemental Direct Revision Change ECN Temporary Standby Supersedure Cancel/Void [x]	T. Pierce, CVDF, X3-78, 372-3739	<input checked="" type="checkbox"/> Yes <input checked="" type="checkbox"/> No <i>J. Buehm 10/23/00</i>	10/17/00
	6. Project Title/No./Work Order No.  SNF/W-441 Spent Nuclear Fuel Cold Vacuum Drying	7. Bldg./Sys./Fac. No.  CVDF 142-K	8. Approval Designator  <b>S<sup>N</sup>Q</b>
	9. Document Numbers Changed by this ECN (includes sheet no. and rev.)  SNF-3877, Rev. 3	10. Related ECN No(s).  N/A	11. Related PO No.  N/A
12a. Modification Work  [ ] Yes (fill out Blk. 12b) [X] No (NA Blks. 12b, 12c, 12d)	12b. Work Package No.  N/A	12c. Modification Work Complete  N/A  Design Authority/Cog. Engineer Signature & Date	12d. Restored to Original Condi- tion (Temp. or Standby ECN only)  N/A  Design Authority/Cog. Engineer Signature & Date

13a. Description of Change      13b. Design Baseline Document?  Yes  No**HOOD**

SC

Revised GOV Seat Leakage to remove"(110%)".

USQ: *CVDF-00-2498 Categorical Exclusion per NS-4-001, Appendix C, B.1.*  
*J. Buehm 10/23/00*

14a. Justification (mark one)	Criteria Change <input type="checkbox"/>	Design Improvement <input checked="" type="checkbox"/>	Environmental <input type="checkbox"/>	Facility Deactivation <input type="checkbox"/>
As-Found <input type="checkbox"/>	Facilitate Const <input type="checkbox"/>	Const. Error/Omission <input type="checkbox"/>	Design Error/Omission <input type="checkbox"/>	

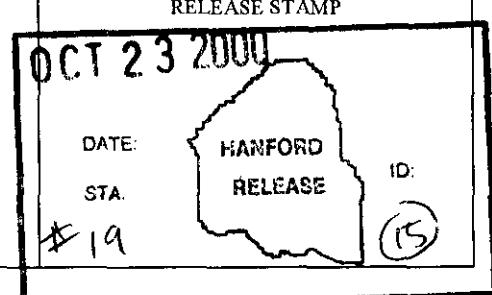
14b. Justification Details

Revision 3 did not pick up hand mark-up on page 3 from revision. 2, this revision was created to clarify that change.

The design verification method for SS/SC Components is by independent review in accordance with EN-6-027-01. Documentation of this review is accomplished by the independent reviewer approval signature on page 2 of this ECN.

15. Distribution (include name, MSIN, and no. of copies)

See Distribution








# ENGINEERING CHANGE NOTICE

1. ECN (use no. from pg. 1)

Page 2 of 2

663357

16. Design Verification Required	17. Cost Impact			18. Schedule Impact (days)		
	ENGINEERING		CONSTRUCTION			
<input checked="" type="checkbox"/> Yes	Additional	<input type="checkbox"/> \$	Additional	<input type="checkbox"/> \$	Improvement	<input type="checkbox"/>
<input type="checkbox"/> No	Savings	<input type="checkbox"/> \$	Savings	<input type="checkbox"/> \$	Delay	<input type="checkbox"/>
19. Change Impact Review: Indicate the related documents (other than the engineering documents identified on Side 1) that will be affected by the change described in Block 13. Enter the affected document number in Block 20.						
SDD/DD	<input type="checkbox"/>	Seismic/Stress Analysis		<input type="checkbox"/>	Tank Calibration Manual	
Functional Design Criteria	<input type="checkbox"/>	Stress/Design Report		<input type="checkbox"/>	Health Physics Procedure	
Operating Specification	<input type="checkbox"/>	Interface Control Drawing		<input type="checkbox"/>	Spares Multiple Unit Listing	
Criticality Specification	<input type="checkbox"/>	Calibration Procedure		<input type="checkbox"/>	Test Procedures/Specification	
Conceptual Design Report	<input type="checkbox"/>	Installation Procedure		<input type="checkbox"/>	Component Index	
Equipment Spec.	<input type="checkbox"/>	Maintenance Procedure		<input type="checkbox"/>	ASME Coded Item	
Const. Spec.	<input type="checkbox"/>	Engineering Procedure		<input type="checkbox"/>	Human Factor Consideration	
Procurement Spec.	<input type="checkbox"/>	Operating Instruction		<input type="checkbox"/>	Computer Software	
Vendor Information	<input type="checkbox"/>	Operating Procedure		<input type="checkbox"/>	Electric Circuit Schedule	
OM Manual	<input type="checkbox"/>	Operational Safety Requirement		<input type="checkbox"/>	ICRS Procedure	
FSAR/SAR	<input type="checkbox"/>	IEFD Drawing		<input type="checkbox"/>	Process Control Manual/Plan	
Safety Equipment List	<input type="checkbox"/>	Cell Arrangement Drawing		<input type="checkbox"/>	Process Flow Chart	
Radiation Work Permit	<input type="checkbox"/>	Essential Material Specification		<input type="checkbox"/>	Purchase Requisition	
Environmental Impact Statement	<input type="checkbox"/>	Fac. Proc. Samp. Schedule		<input type="checkbox"/>	Tickler File	
Environmental Report	<input type="checkbox"/>	Inspection Plan		<input type="checkbox"/>	None	
Environmental Permit	<input type="checkbox"/>	Inventory Adjustment Request		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
20. Other Affected Documents: (NOTE: Documents listed below will not be revised by this ECN.) Signatures below indicate that the signing organization has been notified of other affected documents listed below.						
Document Number/Revision	Document Number/Revision			Document Number Revision		
NA						
21. Approvals						
Design Authority	Signature	Date	Design Agent	Signature	Date	
C. Miska		10/20/00	QA			
Mgr. C. Haller		10/23/00	Safety			
QA R. Ramsgate		10/23/00	Design			
Safety J. Brehm		10/23/00	Environ.			
Environ. N/A			Other			
Independent Reviewer		10/23/00	DEPARTMENT OF ENERGY			
			Signature or a Control Number that tracks the Approval Signature			
			<u>ADDITIONAL</u>			

## **DISTRIBUTION SHEET**

# **WORCESTER 1" SOLENOID ACTUATED GAS-OPERATED SCHE SYSTEM VALVES**

Prepared for the U.S. Department of Energy  
Assistant Secretary for Environmental Management

Project Hanford Management Contractor for the  
U.S. Department of Energy under Contract DE-AC06-96RL13200

**Fluor Hanford**  
P.O. Box 1000  
Richland, Washington

SNF-3877  
Revision 4

ECN 663357

# WORCESTER 1" SOLENOID ACTUATED GAS-OPERATED SCHE SYSTEM VALVES

Project No: W-441

Document Type: RPT

Division: SNF

C Van Katwijk  
FH

Date Published  
October 2000

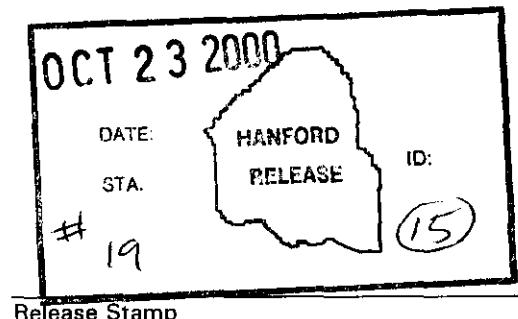
Prepared for the U.S. Department of Energy  
Assistant Secretary for Environmental Management

Project Hanford Management Contractor for the  
U.S. Department of Energy under Contract DE-AC06-96RL13200

**Fluor Hanford**  
P.O. Box 1000  
Richland, Washington

Chris Braden  
Release Approval

10/23/00  
Date



Release Stamp

SNF-3877  
RW 4

**TRADEMARK DISCLAIMER**

Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof or its contractors or subcontractors.

This report has been reproduced from the best available copy.

Printed in the United States of America

Total Pages: 14

## RECORD OF REVISION

(1) Document Number

SNF-3877

Page 1

(2) Title

WORCESTER 1" SOLENOID ACTUATED GAS-OPERATED SCHE SYSTEM VALVES

## Change Control Record

## Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

EGN No. N/A CGI No. CGI-SNF-D-13-P4-002  
Title: Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves

Page 1 of 10

Section 1 Part Information			
Item No.: <u>N/A</u>	Manufacturer: <u>N/A</u>	Supplier: <u>N/A</u>	
Mfg. Part/Model No.: <u>N/A</u>		Supplier's P/N: <u>N/A</u>	
Part Description: <u>N/A</u>			
End Use Description: <u>N/A</u>			
Section 2a Component Information			
Equipment No.: <u>He-GOV/SOV-1*02, 1*06 SCHe-GOV/SOV-5*12, 5*31, 5*51, 5*71</u>	Specification No.: <u>SNF-5303 (W-441-P4)</u>	Manufacturer: <u>Worcester Controls</u>	Past P.O. No.: <u>N/A</u>
Procurement and/or Model Number: <u>1" E 5966RTBW4 with 15I939SWM2120PBC</u>	Equipment Supplier (if different from manufacturer): <u>Olympic Tool &amp; Engineering</u>		Equip. Supplier's Part No.: <u>N/A</u>
Component Description: <b>1" Gas-operated full-port ball valves incorporate a solenoid and limit switches as integral parts of the actuator. These valves are normally open and fail safe to the open position (GOV-1*02 and 1*06 fail closed) to provide a flow path of helium gas to the MCO under helium purge and off-normal conditions when the MCO is isolated.</b>			
Section 2b Commercial Availability of the Item			
<p>1. Is the item available from a catalogue from a qualified NQA1 supplier or ISO 9000 supplier (coordinate with project CGI interface Engineer or BTR)? <input type="checkbox"/> YES (go to #2 below) <input checked="" type="checkbox"/> NO (go to procedure step 6.3.2, proceed to dedicate Item)          If not available from a qualified NQA1 supplier, is it available from an ISO 9000 supplier? (coordinate w/ project CGI Interface Engineer or BTR):  <input type="checkbox"/> YES (go to #2 below, procedure step 6.3.2, dedicate item) <input checked="" type="checkbox"/> NO (procedure step 6.3.2, dedicate item)</p>			
2. List of Candidate qualified suppliers or ISO 9000 suppliers: <u>N/A</u>			
3. Recommended Procurement Strategy(coordinate with project CGI interface Engineer or BTR): <u>N/A</u>			
Section 2c CGI Determination			
CGI Determination Questions:			
#1: Is the item subject to design or specification requirements that are unique to nuclear facilities or activities? <input type="checkbox"/> YES (the item is not commercial grade) <input checked="" type="checkbox"/> NO (continue)			
#2: Is the item used in applications other than nuclear facilities or activities? <input type="checkbox"/> NO (the item is not commercial grade) <input checked="" type="checkbox"/> YES (continue)			
#3: Is the item ordered from manufacturer/supplier on the basis of specifications set forth in the manufacturer's catalog? <input type="checkbox"/> NO (the item is not commercial grade) <input checked="" type="checkbox"/> YES (continue)			
<b><input checked="" type="checkbox"/> All three criteria have been satisfied. The item meets the definition of commercial grade.</b>			
Section 2d Reason for Dedication			
The above Commercial Grade (CG) described item is being Dedicated for use in the application cited for the following reason(s):			
<input checked="" type="checkbox"/>	Item is being purchased from a non-ESL manufacturer supplier as CG to be used in a Safety Class application.		
<input type="checkbox"/>	Item is being purchased from a non-ESL manufacturer supplier as CG to be used in a Safety Significant application.		
<input type="checkbox"/>	Item was purchased from a non-ESL manufacturer supplier as CG to be used in a Safety Class application.		
<input type="checkbox"/>	Item was purchased from a non-ESL manufacturer supplier as CG to be used in a Safety Significant application.		
<input type="checkbox"/>	Other ('like-for-like', similar, substitution, replacement evaluation)		

# Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A CGI No. CGI-SNF-D-13-P4-002  
Title: Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves

Page 2 of 10

Section 3 Failure Effects Evaluation					
A. Part/Component Safety Function:					
1. <b>MCO overpressurization, Thermal Runaway, and H<sub>2</sub> Explosion Prevention.</b>					
2. <b>Remain intact and functional during any event that might threaten the valve integrity. Maintain intact pressure boundary/confinement.</b>					
3. <b>Maintain critical function before and after seismic event.</b>					
B. Part/Component Functional Mode:					
Safety Function #1: <input checked="" type="checkbox"/> Active <input type="checkbox"/> Passive			Active - Mechanical or Electrical change of state is required to occur for the component to perform its safety function		
Safety Function #2: <input type="checkbox"/> Active <input checked="" type="checkbox"/> Passive			Passive – Change of state is not required for the component to perform its safety function		
Safety Function #3: <input type="checkbox"/> Active <input checked="" type="checkbox"/> Passive					
C. Host Component Safety Function (if applicable): <b>N/A</b>					
1.					
D. Failure Mode(s) and the effects on component or system safety function (see Worksheet 1):					
1. <b>Electrical fault in the solenoid. Valve fails open (fail-safe), fails closed for GOV-1*02 &amp; 1*06.</b>					
2. <b>Loss of air pressure to the pneumatic actuator. Valve fails open (fail safe), fails closed for GOV-1*02 &amp; 1*06.</b>					
3. <b>Loss of control signal to solenoid. Valve fails open (fail safe), fails closed for GOV-1*02 &amp; 1*06.</b>					
Section 4 Environmental & Natural Phenomena Hazard Design					
Environmental Qualification Required:			If yes: Environmental Qualification Requirements		
Yes <input type="checkbox"/>			Limiting Environmental Conditions:		
No <input checked="" type="checkbox"/> Environmental Condition B			Required Safety Functions:		
			Qualification Period:		
Natural Phenomena Hazard (NPH) Design Required:			If yes: NPH Design Requirements		
Yes <input checked="" type="checkbox"/>			Performance Category: <b>PC-3</b>		
No <input type="checkbox"/>			NPH Design Req'ts.: <b>Seismic Condition A</b>		
HNF-PRO-97 SNF-5303			Required Safety Functions: <b>MCO overpressurization, Thermal Runaway and H<sub>2</sub> Explosion Prevention. Maintain Critical Function before and after seismic event.</b>		
Section 5 Component Functional Classification					
<input checked="" type="checkbox"/>	Safety Class (SC)		General Service (GS)		Safety Significant (SS)
If part/component classification is different from host component/system, document basis. <b>N/A</b>					
Sections 6 and 7 (Reserved)					
Section 8 References (for Functional Classification)					
National Codes/Standards: <b>ASME B31.3</b>					
Safety Analysis Report (SAR): <b>HNF- 3553, Annex B</b>					
Drawings: <b>H-1-82161, HNF-SD-SNF-SEL-002</b>					
Vendor Manual/Manufacturer/Supplier Information: <b>Worcester PB451-22</b>					

## Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. <u>N/A</u>	CGI No. <u>CGI-SNF-D-13-P4-002</u>
Title: <u>Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves</u>	

Page 3 of 10

Section 9 Critical Characteristics				
Critical Characteristics	Acceptance Criteria/Tolerances	Acceptance Method	ID	Function
1. Item Identification Critical Characteristics (necessary for reasonable assurance that the item delivered is the item specified)				
Nameplate - Manufacturer	Worcester Controls	1, IN	X	
Valve-Component Number-Procurement and/or Model Number	1" E 5966RTBW4 (Per SNF-5303, Section H, Design Data Sheet)	1, IN	X	
Actuator-Component Number-Procurement and/or Model Number (Includes SOV)	15I939SWM2120PBC (Per SNF-5303, Section H, Design Data Sheet)	1, IN	X	
Nameplate Data of Actuator (Includes SOV)	Per Vendor Manual. To Include "R6" (Upper Right Corner)	1, IN	X	
2. Physical Critical Characteristics (for reasonable assurance that the item delivered is the item specified)				
Valve Body Material	Stainless Steel (Note 4)	1, IN; 1, T	X	
Configuration/Mounting	Integral Actuator/Valve Assembly. Black recessed override button	1, IN	X	
Process Connection	1" Butt Weld	1, IN	X	
3. Performance Critical Characteristics (for reasonable assurance that the item will perform its intended safety function(s))				
GOV Pressure Boundary	Pressure Test At nominal 165 psig (Zero Leakage) Note 3	1, T		X
Internal Pressure	Withstands nominal 150 psig and 29" Hg Vacuum (Zero Leakage)	1, T		X
GOV Seat Leakage	Pressurize the upstream side of the valve seat to 165 psig and reduce to 150 psig, soaking for 10 min. at 150 psig, then check for obvious leaks. Apply bubble leak solution on the valve seat to find leaks. Proceed to lower the pressure to 15 psig for the Sensitive Leak Test. Apply solution to valve seat area after minimum 15 minutes soak time at nominal 15 psig. Acc. Criteria: No Leakage-No Bubbles. Note 5	1, T		X
GOV Fail Safe Position GOV-5*12, 5*31, 5*51, 5*71	Valve fails OPEN on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.	1, T		X
GOV Fail Safe Position GOV-1*02 & 1*06*	Valve fails CLOSED on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.	1, T		X
Environmental	Note 1			
Seismic Condition A	Note 2	1, T		X

## Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A CGI No. CGI-SNF-D-13-P4-002  
 Title: Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves

Page 4 of 10

## 4. Notes and Legend:

1. **These valves have coro-lube (nickel-acetate), acetal resin, and NEMA Enclosed Solenoids, these materials are not subject to degradation at 40°F and 60% RH or 115°F and 22% RH and are suitable for condition B Application.**
2. **Maintain critical function before and after seismic event. SNF-5303, Appendix L, pages L-2 & L-4, provide a seismic testing plan for these components at a SNF-4896 seismic spectra. Equipment that has been shaker-table tested should not be installed in a plant (Ref. IEEE Standard 344-1984, Section 7). Consequently, the seismic test constitutes a destructive test. The industry sampling practice for destructive test is to test only one item.**
3. **Pressure test at 110% of design accident condition pressure of 150 psig.**
4. **Material verification acceptance method may be by either inspection or test.**
5. **15 psig = 15 psig or 25% of 150 psig=37.5 whichever is less (ASME V, Article 10, T-1044 and B31.1-1993, 345.8(a))**

Rev. 2: Rev'd all pages - new forms; rev'd Internal Pressure Acc. Criteria to "Withstands nominal 150 psig and 29" Hg Vacuum", GOV Seat Leakage Acc. Criteria - rev'd all, GOV Fail Safe Position rev'd Stroke Time to "Less Than 2 Seconds", Deleted CC: Insulation Resistance, Solenoid Inrush Current, Solenoid Holding Current, and Current Carrying Capability Of Contacts

Rev. 3: Updated reference documentation.

Rev. 4: Rev'd GOV Seat Leakage CC from "Pressurize the upstream side of the valve seat to 165 psig (110%) and reduce to 150 psig (110%)...." to "Pressurize the upstream side of the valve seat to 165 psig and reduce to 150 psig...."

## Acceptance Method:

1. Special Test and Inspection  
1, IN for Inspection  
1,T for Test
2. Commercial Grade Survey
3. Source Verification
4. Vendor/Item History

## Section 10 Initial Review and Approval

Approvals:

Ana per telecon -

Designated Engineer:

for Carl Van Katwijk 10/23/00

Design Authority:

CR 10/20/00

QA Engineer:

MT Rand 10/23/00

# Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A CGI No. CGI-SNF-D-13-P4-002  
Title: **Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves**

Page 5 of 10

## WORKSHEET 1 DETERMINATION OF FAILURE MECHANISMS

Section 1		
Typical Failure Mechanisms	Definition	X = Applicable to Component under Evaluation X? Indicate Failure Mode
Fracture	Separation of a solid accompanied by little or no macroscopic plastic deformation.	
Corrosion	The gradual deterioration of a material due to chemical or electrochemical reactions, such as oxidation, between the material and its environment.	
Erosion	Destruction of materials by the abrasive action of moving fluids, usually accelerated by the presence of solid particles carried with the fluid.	
Open Circuit	An electrical circuit that is unintentionally broken so that there is no complete path for current flow.	
Short Circuit	An abnormal connection by which an electrical current is connected to ground, or to some conducting body, resulting in excessive current flow.	
Blockage	Clogging of a filtering medium resulting in the inability to perform its purification function or blockage of flow.	
Seizure	Binding of a normally moving item through excessive pressure, temperature, friction, jamming.	X <b>Structural Failure or Seizure of Valve/Disc</b>
Unacceptable Vibration	Mechanical oscillations produced are beyond the defined permissible limits due to unbalancing, poor support, or rotation at critical speeds.	
Loss of Properties	A loss of mechanical and physical properties of a material due to exposure to high temperatures, radiation exposure.	
Excess Strain	Under the action of excessive external forces the material of the part has been deformed or distorted.	
Mechanical Creep	From prolonged exposure to high temperature and stress, the object will show a slow change in its physical (shape and dimension) and mechanical characteristics.	
Ductile Fracture	Fracture characterized by tearing of metal accompanied by appreciable gross plastic deformation.	
Section 2 Additional Failure Modes Applicable to the Component Under Evaluation:		
<b>1. Loss of Air Pressure</b>		

# Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A

CGI No. CGI-SNF-D-13-P4-002

Title: Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves

Page 6 of 10

## Checklist 1 - Acceptance Method 1 - Special Test/Inspection Verification

### SECTION 1

Item Description: <b>1" SCHe Solenoid Valves</b> System #: <b>13</b>	Equip #: <b>He-GOV/SOV-1*02, 1*06, SCHe-GOV/SOV-5*12, 5*31, 5*51, 5*71</b> Procurement and/ or Model #: <b>1" E 5966RTBW4 with 15I939SWM2120PBC</b>
---	--

Manufacturer (Address/Phone): <b>Worcester Controls</b> <b>P.O. Box 538</b> <b>33 Lock Dr.</b> <b>Marlborough, MA 01752</b> <b>(508) 481-4800</b>	Supplier (Address/Phone): <b>Olympic Tool &amp; Engineering</b> <b>W. 21 Sanderson Way</b> <b>Shelton, WA 98584</b> <b>(360)426-5231</b>
--	--

### SECTION 2 CRITICAL CHARACTERISTICS TO BE VERIFIED BY METHOD 1.

Insp	Test	Post-Test	
X			<b>1. Nameplate - Manufacturer</b>
X			<b>2. Component Number-Procurement and/or Model Number</b>
X			<b>3. Actuator-Component Number-Procurement and/or Model Number (Includes SOV)</b>
X			<b>4. Nameplate Data of Actuator (Includes SOV)</b>
X	X		<b>5. Body Material (Verification may be by either inspection or test)</b>
X			<b>6. Configuration/Mounting</b>
X			<b>7. Process Connection</b>
	X		<b>8. GOV Pressure Boundary</b>
	X		<b>9. Internal Pressure</b>
	X		<b>10. GOV Seat Leakage</b>
	X		<b>11. GOV Fail Safe Position</b>
	X		<b>12. Seismic Condition A</b>

### SECTION 3 BY INSPECTION \* See Appendix D, Table D-1, of EN-6-035-01 for Sampling Size, References (See Section 7)

Characteristic: <b>Nameplate – Manufacturer</b>	Sample Size*: <b>100%</b>
Acceptance Criteria: <b>Worcester Controls</b>	Receipt Inspection Plan / Report #:
Characteristic: <b>Valve Component Number-Procurement and/or Model Number</b>	Sample Size*: <b>100%</b>
Acceptance Criteria: <b>1" E 5966RTBW4 (Per SNF-5303, Section H, Design Data Sheet)</b>	
Receipt Inspection Plan / Report #:	
Characteristic: <b>Actuator-Component Number-Procurement and/or Model No. (Includes SOV)</b>	Sample Size*: <b>100%</b>
Acceptance Criteria: <b>15I939SWM2120PBC (Per SNF-5303, Section H, Design Data Sheet)</b>	
Receipt Inspection Plan / Report #:	

# Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A CGI No. CGI-SNF-D-13-P4-002  
Title: Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves

Page 7 of 10

Characteristic Nameplate Data of Actuator (Includes SOV)		Sample Size*: 100%
Acceptance Criteria: Per Vendor Manual. To Include "R6" (Upper Right Corner).		
Receipt Inspection Plan / Report #:		
Characteristic: Process Connection		Sample Size*: 100%
Acceptance Criteria: 1" Butt-weld		Receipt Inspection Plan / Report #:
Characteristic: Configuration/Mounting		Sample Size*: 100%
Acceptance Criteria: Integral Actuator/Valve Assembly. Black recessed override button.		
Receipt Inspection Plan / Report #:		
Characteristic: Valve Body Material		Sample Size*: 100%
Acceptance Criteria: Stainless Steel		Receipt Inspection Plan / Report #:
Section 4 By Special Test* See Appendix D, Table D-1, of EN-6-035-01 for Sampling Size, References (See Section 7)		
Characteristic for Test: GOV Pressure Boundary		Samp Size*: <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Reduced <input type="checkbox"/> Tightened
Acceptance Criteria: Pressure Test at nominal 165 psig for >10 minutes; Reduce pressure to 100%, perform snoop test (No Leakage-No Bubbles)		
Actual Test Value:		Test Plan and Report #:
Characteristic for Test: Internal Pressure		Samp Size*: <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Reduced <input type="checkbox"/> Tightened
Acceptance Criteria: Withstands nominal 150 psig and 29" Hg Vacuum (Zero Leakage)		
Actual Test Value:		Test Plan and Report #:
Characteristic for Test: GOV Seat Leakage		Samp Size*: <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Reduced <input type="checkbox"/> Tightened
Acceptance Criteria: Pressurize the upstream side of the valve seat to 165 psig and reduce to 150 psig, soaking for 10 min. at 150 psig, then check for obvious leaks. Apply bubble leak solution on the valve seat to find leaks. Proceed to lower the pressure to 15 psig for the Sensitive Leak Test. Apply solution to valve seat area after minimum 15 minutes soak time at nominal 15 psig. Acc. Criteria: No Leakage-No Bubbles		
Actual Test Value:		Test Plan and Report #:
Characteristic for Test: GOV Fail Safe Position GOV-5*12, 5*31, 5*51, 5*71		Samp Size*: <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Reduced <input type="checkbox"/> Tightened
Acceptance Criteria: Valve fails OPEN on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.		
Actual Test Value:		Test Plan and Report #:
Characteristic for Test: GOV Fail Safe Position GOV-1*02 & 1*06		Samp Size*: <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Reduced <input type="checkbox"/> Tightened
Acceptance Criteria: Valve fails CLOSED on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.		
Actual Test Value:		Test Plan and Report #:
Characteristic for Test: Seismic Condition A		Samp Size*: Destructively Test Only One Item
Acceptance Criteria: Maintain Critical Function Before and After Seismic Event		
Actual Test Value:		Test Plan and Report #:

\*\*If Supplier/Manufacturer or Other, Refer to CGI Checklist-2 for Support Information

## Commercial Grade Item Upgrade Dedication Form

ECN No. <u>N/A</u>	CGI No. <u>CGI-SNF-D-13-P4-002</u>
Title: <u>Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves</u>	

SNF-3877, Rev. 4

Page 8 of 10

## Section 5 Test/Inspection Summary (Acceptance Method 1)

## 1. SUMMARY OF VERIFIED CRITICAL CHARACTERISTICS, THEIR VERIFICATION METHODS, AND RESULTS

## ITEM DESCRIPTION: Gas Operated Full Port Ball Valves

Critical Characteristics		Verification Results									
Critical Characteristics	Acceptance Critical Tolerances	ID	Function	Method T/N	Procedure or RR#	Check-list ID	Number Tested	Number Failed	Verifying Organization	Printed Name Signature	Date
Manufacturer	Worcester Controls	X		1, IN							
Valve Component No.- Proc. and/or Model No.	1" E 5966RTBW4 (Per SNF-5303, Section H, Design Data Sheet)	X		1, IN							
Actuator P/N-Comp. No.-Proc. and/or Model No. (Includes SOV)	151939SVM2120PBC (Per SNF-5303, Section H, Design Data Sheets)	X		1, IN							
Nameplate Data of Actuator (Includes SOV)	Per Vendor Manual to Include "R6" (Upper Right Corner).	X		1, IN							
Body Material	Stainless Steel	X		1, IN							
Configuration/ Mounting	Integral Actuator/Valve Assembly. Black recessed override button.	X		1, IN							
Process Connection	1" Butt-weld	X		1, IN							

## Commercial Grade Item Upgrade Dedication Form

ECN No. <u>N/A</u>	CGI No. <u>CGI-SNF-D-13-P4-002</u>
Title: <u>Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves</u>	

SNF-3877, Rev. 4

Page 9 of 10

### ITEM DESCRIPTION: Gas Operated Full Port Ball Valves - Continued

Critical Characteristics		Verification Results									
Critical Characteristics	Acceptance Criteria/Tolerances	ID	Function	Method T/N	Procedure or RR#	Check-list ID	Number Tested	Number Failed	Verifying Organization	Printed Name Signature	Date
<b>GOV Pressure Boundary</b>	Pressure Test At nominal 165 psig (Zero Leakage)	X	1, T								
<b>Internal Pressure</b>	Withstands nominal 150 psig and 29" Hg Vacuum (Zero Leakage)	X	1, T								
<b>GOV Seat Leakage</b>	Pressurize the upstream side of the valve seat to 165 psig and reduce to 150 psig, soaking for 10 min. at 150 psig, then check for obvious leaks. Apply bubble leak solution on the valve seat to find leaks. Proceed to lower the pressure to 15 psig for the Sensitive Leak Test. Apply solution to valve seat area after minimum 15 minutes soak time at nominal 15 psig. Acc. Criteria: No Leakage-No Bubbles	X	1, T								
<b>GOV Fail Safe Position GOV-5*12, 5*31, 5*51, 5*71</b>	Valve fails OPEN on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.	X	1, T								
<b>GOV Fail Safe Position GOV-1*02 &amp; 1*06*</b>	Valve fails CLOSED on loss of air pressure, control signal, or electrical power to the solenoid. Stroke time less than 2 seconds.	X	1, T								
<b>Seismic Condition A</b>	Maintain Critical Function Before and After Seismic Event	X	1, T								
2. DISPOSITION OF UNVERIFIED OR FAILED CRITICAL CHARACTERISTICS											
Critical Characteristic		Disposition									
3. Signature Indicates All Critical Characteristics Verified Satisfactory or Acceptably Dispositioned And Commercial Grade Dedication Is Satisfactory and Complete.											
Testing Agency Approval:		Date _____									Date _____
Testing Agency QA Engineer:		Date _____									Date _____
QA Engineer: _____											

10/18/00

# Commercial Grade Item Upgrade Dedication Form

SNF-3877, Rev. 4

ECN No. N/A

CGI No. CGI-SNF-D-13-P4-002

Title: **Worcester 1" Solenoid-Actuated Gas-Operated SCHE System Valves**

Page 10 of 10

## Section 6: Contacts / Phone Numbers

Title	Name	Phone
Design Authority		
QA		
QC		
Cog - Engineer		
CGI Engineer	<b>Larry Price</b>	<b>372-8770</b>
Procurement Engineer		
Other		

## Section 7: Supporting Documentation for This Checklist

Initial Procurement Documents	For Critical Characteristics
Drawings:	
Manuals (specify type & number):	
Design Calculations	
Installation Instructions	
Operation Instructions	
Calibration Instructions	
Manufacturer's Recommended Spare Parts List	
<input checked="" type="checkbox"/> Other: Vendor Specifications: Worcester PB451-22	All
Procurement Documents	
Certificate of Conformance/Compliance	
Seismic Qualification Certificate	
Environmental Qualification Certificate	
Test Report (s):	
Inspection Report (s):	
CMTRs for ASME Pressure Retaining Materials	
Valve Seat Leakage Report	
Weld Records	
Material Traceability Record	
Other:	